

TEXAS
COMMISSION
ON ENVIRONMENTAL
QUALITY

2015 FEB -6 PM 2:07

CHIEF CLERKS OFFICE

Katten

KattenMuchinRosenman LLP

One Congress Plaza
111 Congress Avenue
Suite 1000
Austin, TX 78701-4073
512.691.4000 tel
www.kattenlaw.com

DANNY G. WORRELL
danny.worrell@kattenlaw.com
512.691.4012 direct

February 6, 2015

Via Hand Delivery

Bridget Bohac, Chief Clerk
Texas Commission on Environmental Quality
Building F
12100 Park 35 Circle
Austin, Texas 78753


Re: Lerin Hills Municipal Utility District's Response to Hearing Requests
Application for Renewal of TPDES Permit No. WQ0014712001
TCEQ Docket No. 2014-1706-MWD

Dear Ms. Bohac:

Enclosed for filing please find an original and seven copies of Lerin Hills Municipal Utility District's Response to Hearing Requests in the above-referenced matter.

Thank you for your assistance on this matter, and if you have any questions, please do not hesitate to contact me.

Very truly yours,



Danny Worrell

Enclosures

cc: Ashley McDonald, TCEQ
Jose Alfonso Martinez, TCEQ
Brian Christian, TCEQ
Vic McWherter, TCEQ
Robert Webster
William R. Wood, P.E.

TCEQ DOCKET NUMBER 2014-1706-MWD

APPLICATION BY LERIN HILLS
MUNICIPAL UTILITY DISTRICT

§
§
§

BEFORE THE TEXAS COMMISSION ON
ENVIRONMENTAL QUALITY

2015 FEB -6 PM 2:10
CHIEF CLERK'S OFFICE

LERIN HILLS MUNICIPAL UTILITY DISTRICT'S
RESPONSE TO HEARING REQUESTS

Lerin Hills Municipal Utility District (Lerin Hills) files this Response to Hearing Requests on its application for a renewal of its existing Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0014712001. Like the existing TPDES permit issued August 29, 2009, the renewal permit would authorize Lerin Hills to discharge treated domestic wastewater at a daily average flow not to exceed 490,000 gallons per day. The wastewater treatment Facility has been constructed and when it becomes operational, it will serve the Lerin Hills subdivision.

Two commenters submitted requests for a contested case hearing (CCH) in this case, citing a number of concerns, including: the potential impact of the renewal permit on the water quality of receiving waters; potential impacts to the Edwards Underground Aquifer; the failure of the existing permit to consider the effects of drought on receiving waters; and the Administrative Law Judge's (ALJ's) recommendations in the CCH on the existing permit.

The hearing requesters in this case have no right to a CCH under applicable Texas law, because this application meets the conditions of Texas Water Code § 26.028(d) and Commission rules at 30 Tex. Admin. Code (TAC) §§ 55.201(i)(5). Under these statutory and regulatory provisions, there is no right to a CCH for permit renewals if:

(A) the applicant is not applying to:

- (i) increase significantly the quantity of waste authorized to be discharged; or
- (ii) change materially the pattern or place of discharge;

(B) the activity to be authorized by the renewal or amended permit will maintain or improve the quality of waste authorized to be discharged;

(C) any required opportunity for public meeting has been given;

(D) consultation and response to all timely received and significant public comment has been given; and

(E) the applicant's compliance history for the previous five years raises no issues regarding the applicant's ability to comply with a material term of the permit.

30 TAC § 55.201(i)(5); *see also* Tex. Water Code § 26.028(d).

As the Executive Director's Statement of Basis/Technical Summary on this Renewal Application notes: This application requests "Renewal with no changes." Statement of Basis/Technical Summary and Executive Director's Preliminary Decision at 1 (hereinafter "Statement of Basis/Technical Summary") (Attachment A). First, Lerin Hills is not applying to increase the quantity of waste it is authorized to discharge or to change the pattern or place of discharge. Under the draft renewal permit, the maximum daily average flow of effluent from the facility would remain authorized for 490,000 gallons per day. *See* Statement of Basis/Technical Summary at 1-2 (Attachment A). Further, the point of discharge and the discharge route proposed in the renewal permit application and incorporated in the draft renewal permit are the same as those in the existing permit. Renewal Permit Application at 11 (Attachment B); Draft Permit at 12 (Attachment C).


Second, the draft renewal permit would maintain the quality of waste authorized to be discharged, because the renewal makes no changes to the existing permit that would adversely affect the quality of discharged waste. In fact, the draft renewal permit retains the effluent limits of the existing permit, and adds an additional effluent limit for bacteria (i.e., *E. coli*) that is not in the existing permit. *See* Statement of Basis/Technical Summary at 3 (Attachment A); Draft

Permit at 2b (Attachment C). Thus, the renewal permit's effluent limits are more stringent than those of the existing permit.

Third, although the public was provided with an opportunity to request a public meeting, no public meetings were requested on this renewal application. *See* Tear Sheets from Newspaper Notices (Attachment D). Fourth, the TCEQ Executive Director gave consultation and response to all timely received and significant public comments in his Response to Public Comment, issued October 9, 2014. *See* Executive Director's Response to Public Comment (Attachment E). Finally, Lerin Hills' compliance history raises no issues regarding its ability to comply with the material terms of the permit. *See* TCEQ Compliance History Report for Lerin Hills MUD Wastewater Treatment Plant (Attachment F).

Because Lerin Hills' renewal permit application meets the requirements of Texas Water Code Section 26.028(d) and 30 TAC Section 55.201(i)(5), the hearing requesters have no right to a contested case hearing in this case. Consequently, Lerin Hills respectfully requests that the Commission deny the requests for contested case hearing in this matter.

Respectfully submitted,

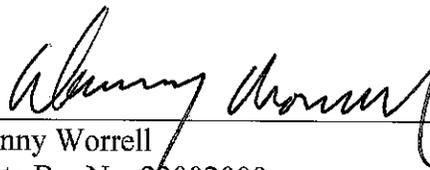


Danny Worrell
State Bar No. 22002000
Catherine Hobson
State Bar No. 24082680
Katten Muchin Rosenman LLP
111 Congress Avenue
Suite 1000
Austin, TX 78701
(512) 691-4012 - Telephone
(512) 691-4000 - Facsimile

ATTORNEYS FOR LERIN HILLS
MUNICIPAL UTILITY DISTRICT

CERTIFICATE OF SERVICE

By my signature below, I certify that on this 6th day of February 2015, a copy of the foregoing Response to Hearing Requests of Lerin Hills Municipal Utility District was sent to the parties identified below by certified mail, return receipt requested.

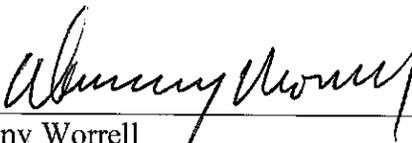

Danny Worrell

FOR THE EXECUTIVE DIRECTOR

Ashley McDonald, Staff Attorney
Texas Commission on Environmental Quality
Environmental Law Division, MC-173
P.O. Box 13087
Austin, Texas 78711-3087
Tel: (512) 239-0600
Fax: (512) 239-0606

Jose Alfonso Martinez, Technical Staff
Texas Commission on Environmental Quality
Water Quality Division, MC-148
P.O. Box 13087
Austin, Texas 78711-3087
Tel: (512) 239-4668
Fax: (512) 239-4430

Brian Christian, Director
Texas Commission on Environmental Quality
Environmental Assistance Division
Public Education Program, MC-108
P.O. Box 13087
Austin, Texas 78711-3087
Tel: (512) 239-4000
Fax: (512) 239-5678

FOR THE PUBLIC INTEREST COUNSEL

Vic McWherter
Texas Commission on Environmental Quality
Public Interest Counsel, MC-103
P.O. Box 13087
Austin, Texas 78711-3087
Tel: (512) 239-6363
Fax: (512) 239-6377

REQUESTERS

Robert Webster
325 W. State Highway
Boerne, Texas 78006

William R. Wood, P.E.
306 State Highway 46 W
Boerne, Texas 78006-8104

Attachment A
to Lerin Hills Municipal Utility District's
Response to Hearing Requests

Statement of Basis/Technical Summary and
Executive Director's Preliminary Decision

**STATEMENT OF BASIS/TECHNICAL SUMMARY
AND EXECUTIVE DIRECTOR'S PRELIMINARY DECISION**

DESCRIPTION OF APPLICATION

Applicant: Lerin Hills Municipal Utility District
Texas Pollutant Discharge Elimination System (TPDES) Permit
No. WQ0014712001, EPA ID No. TX0128767

Regulated Activity: Domestic Wastewater Permit

Type of Application: Renewal

Request: Renewal with no changes

Authority: Federal Clean Water Act (CWA) § 402; Texas Water Code (TWC)
§ 26.027; 30 Texas Administrative Code (TAC) Chapters 30,
305, 307, 309, 312, and 319; Commission policies; and United
States Environmental Protection Agency (EPA) guidelines.

EXECUTIVE DIRECTOR RECOMMENDATION

The Executive Director has made a preliminary decision that this permit, if issued, meets all statutory and regulatory requirements. The draft permit includes an expiration date of March 1, 2017 according to 30 TAC § 305.71, Basin Permitting.

REASON FOR PROJECT PROPOSED

The applicant has applied to the Texas Commission on Environmental Quality (TCEQ) for a renewal of the existing permit that authorizes the discharge of treated domestic wastewater at a daily average flow not to exceed 0.055 million gallons per day (MGD) in the Interim I phase, a daily average flow not to exceed 0.11 MGD in the Interim II phase and a daily average flow not to exceed 0.49 MGD in the Final phase. The proposed wastewater treatment facility will serve the Lerin Hills Subdivision.

PROJECT DESCRIPTION AND LOCATION

The Lerin Hills Municipal Utility District Wastewater Treatment Facility will be an activated sludge process plant operated in a complete mix variation of single-staged nitrification. Treatment units for the Interim I phase will include a lift station, a bar screen, an aeration basin, a final clarifier, a sludge digester, a tertiary filter, a chlorine contact chamber and a dechlorination chamber. Treatment units for the Interim II phase will include a lift station, a bar screen, aeration basins (2), a final clarifier, sludge digesters (2), a tertiary filter, a chlorine contact chamber and a dechlorination chamber. Treatment units for the Final phase will include a lift station, a bar screen, an aeration basin, a final clarifier, sludge digesters (2), a tertiary filter, a chlorine contact chamber and a dechlorination chamber. The facility has not been constructed.

Sludge generated from the treatment facility will be hauled by a registered transporter to Texas Organic Recovery Composting Facility, Permit No. 42016 to be digested, dewatered and then disposed of with the bulk of the sludge from the plant accepting the sludge. The draft permit also authorizes the disposal of sludge at a TCEQ authorized land application site or co-disposal

Lerin Hills Municipal Utility District

TPDES Permit No. WQ0014712001

Statement of Basis/Technical Summary and Executive Director's Preliminary Decision

landfill.

The plant site will be located on the north side of State Highway 46, approximately 4.1 miles west of Interstate Highway 10, as measured along State Highway 46, northeast of Deep Hollow Drive in Kendall County, Texas 78006.

The treated effluent will be discharged to an unnamed tributary; thence to the headwaters of an impoundment on Deep Hollow Creek (Soil Conservation Service (SCS) Site 4 Reservoir); thence to Deep Hollow Creek; thence to Frederick Creek; thence to Upper Cibolo Creek in Segment No. 1908 of the San Antonio River Basin. The unclassified receiving water uses are minimal aquatic life use for the unnamed tributary and high aquatic life use for SCS Site #4 Reservoir and Deep Hollow Creek. The designated uses for Segment No. 1908 are high aquatic life use, public water supply, aquifer protection, and primary contact recreation. The effluent limitations in the draft permit will maintain and protect the existing instream uses. All determinations are preliminary and subject to additional review and/or revisions.

Effluent limitations for the conventional effluent parameters (i.e., Biochemical Oxygen Demand or Carbonaceous Biochemical Oxygen Demand, Ammonia Nitrogen, etc.) are based on stream standards and waste load allocations for water quality limited streams as established in the Texas Surface Water Quality Standards and the State of Texas Water Quality Management Plan (WQMP).

The effluent limitations in the draft permit have been reviewed for consistency with the WQMP. The proposed effluent limitations are contained in the approved WQMP. A Waste Load Evaluation has not been completed for the segment.

The discharge from this permit action is not expected to have an effect on any federal endangered or threatened aquatic or aquatic dependent species or proposed species or their critical habitat. This determination is based on the United States Fish and Wildlife Service's (USFWS) biological opinion on the State of Texas authorization of the Texas Pollutant Discharge Elimination System (TPDES, September 14, 1998; October 21, 1998 update). To make this determination for TPDES permits, TCEQ and EPA only considered aquatic or aquatic dependent species occurring in watersheds of critical concern or high priority as listed in Appendix A of the USFWS biological opinion. The determination is subject to reevaluation due to subsequent updates or amendments to the biological opinion. The permit does not require EPA review with respect to the presence of endangered or threatened species.

Segment No. 1908 is currently listed on the State's inventory of impaired and threatened waters, the 2012 Clean Water Act §303(d) list. The listing is specifically for elevated levels of bacteria and chloride. The impairment for bacteria in Upper Cibolo Creek is from approximately 2 miles upstream of Hwy 87 in Boerne to the upper end of the segment (AU 1908_02). The impairment for chlorides is segment wide for Upper Cibolo Creek (AU 1908_01, AU 1908_02, and AU 1908_03). This facility is designed to provide adequate disinfection and when operated properly should not add to the bacterial impairment of the segment. In addition, the facility is not expected to receive industrial wastewater and should not contribute to the chloride impairment of the segment.

SUMMARY OF EFFLUENT DATA

There is no effluent data since the facility has not been constructed.

DRAFT PERMIT CONDITIONS

The draft permit authorizes a discharge of treated domestic wastewater at an interim I volume not to exceed a daily average flow of 0.055 MGD, an interim II volume not to exceed a daily average flow of 0.11 MGD and a final volume not to exceed a daily average flow of 0.49 MGD.

The effluent limitations in the Interim I, Interim II, and Final phases of the draft permit, based on a 30-day average, are 5 mg/l CBOD₅, 5 mg/l TSS, 1 mg/l NH₃-N, 0.5 mg/l Total Phosphorus, Report mg/l Nitrate-Nitrogen, Report mg/l Total Nitrogen, 126 CFU or MPN of *E. coli* per 100 ml and 6.0 mg/l minimum dissolved oxygen (DO). The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes based on peak flow. The permittee shall dechlorinate the chlorinated effluent to less than 0.1 mg/l chlorine residual and shall monitor chlorine residual daily by grab sample after the dechlorination process.

The facility does not appear it will receive significant industrial wastewater contributions. Permit requirements for pretreatment are based on TPDES regulations contained in 30 TAC Chapter 315 which references 40 CFR Part 403, General Pretreatment Regulations for Existing and New Sources of Pollution [*rev. Federal Register/ Vol. 70/ No. 198/ Friday, October 14, 2005/ Rules and Regulations, pages 60134-60798*]. The permit includes specific requirements that establish responsibilities of local government, industry, and the public to implement the standards to control pollutants which pass through or interfere with treatment processes in publicly owned treatment works or which may contaminate the sewage sludge. This permit has appropriate pretreatment language for a facility of this size and complexity.

The draft permit includes Sludge Provisions according to the requirements of 30 TAC Chapter 312, Sludge Use, Disposal and Transportation. Sludge generated from the treatment facility will be hauled by a registered transporter to Texas Organic Recovery Composting Facility, Permit No. 42016 to be digested, dewatered and then disposed of with the bulk of the sludge from the plant accepting the sludge. The draft permit also authorizes the disposal of sludge at a TCEQ authorized land application site or co-disposal landfill.

SUMMARY OF CHANGES FROM APPLICATION

None.

SUMMARY OF CHANGES FROM EXISTING PERMIT

Effluent limitations and monitoring requirements in the draft permit remain the same as the existing permit requirements with the addition of bacteria limits.

E. coli Enterococci bacteria limits have been added to the draft permit in accordance with the recent amendments to 30 TAC Chapters 309 and 319.

The Standard Permit Conditions, Sludge Provisions, and Other Requirements sections of the

Lerin Hills Municipal Utility District
TPDES Permit No. WQ0014712001
Statement of Basis/Technical Summary and Executive Director's Preliminary Decision

draft permit have been updated.

The pretreatment language has not been updated from the current permit. The pretreatment requirements will continue until permit expiration.

Other Requirement No. 7 of the existing permit has been updated with a new facility to accept the sludge from the Lerin Hills Municipal Utility District Wastewater Treatment Facility.

BASIS FOR DRAFT PERMIT

The following items were considered in developing the draft permit:

1. Application received November 11, 2013 and additional information received April 8, 2014.
2. TPDES Permit No. WQ0014712001 issued February 24, 2014.
3. The effluent limitations and conditions in the draft permit comply with the Texas Surface Water Quality Standards, 30 TAC §§ 307.1 - 307.10, effective August 17, 2000 and the EPA approved portions of the 2010 Texas Surface Water Quality Standards, effective July 22, 2010.
4. The effluent limitations in the draft permit meet the requirements for secondary treatment and the requirements for disinfection according to 30 TAC Chapter 309, Subchapter A: Domestic Wastewater Effluent Limitations.
5. Interoffice memoranda from the Water Quality Assessment Section of the TCEQ Water Quality Division. Interoffice memorandum from the Storm Water & Pretreatment Team of the TCEQ Water Quality Division.
6. Consistency with the Coastal Management Plan: The facility is not located in the Coastal Management Program boundary.
7. *Procedures to Implement the Texas Surface Water Quality Standards (IP)*, Texas Commission on Environmental Quality, June 2010, as approved by EPA and the IP, January 2003, for portions of the 2010 IP not approved by EPA.
8. Texas 2012 Clean Water Act Section 303(d) List, Texas Commission on Environmental Quality, February 21, 2013; approved by the EPA May 9, 2013.
9. TNRCC Guidance Document for Establishing Monitoring Frequencies for Domestic and Industrial Wastewater Discharge Permits, Document No. 98-001.000-OWR-WQ, May 1998.

PROCEDURES FOR FINAL DECISION

When an application is declared administratively complete, the Chief Clerk sends a letter to the applicant advising the applicant to publish the Notice of Receipt of Application and Intent to Obtain Permit in the newspaper. In addition, the Chief Clerk instructs the applicant to place a copy of the application in a public place for review and copying in the county where the facility is or will be located. This application will be in a public place throughout the comment period. The

Lerin Hills Municipal Utility District

TPDES Permit No. WQ0014712001

Statement of Basis/Technical Summary and Executive Director's Preliminary Decision

Chief Clerk also mails this notice to any interested persons and, if required, to landowners identified in the permit application. This notice informs the public about the application, and provides that an interested person may file comments on the application or request a contested case hearing or a public meeting.

Once a draft permit is completed, it is sent, along with the Executive Director's preliminary decision, as contained in the technical summary or fact sheet, to the Chief Clerk. At that time, Notice of Application and Preliminary Decision will be mailed to the same people and published in the same newspaper as the prior notice. This notice sets a deadline for making public comments. The applicant must place a copy of the Executive Director's preliminary decision and draft permit in the public place with the application. This notice sets a deadline for public comment.


Any interested person may request a public meeting on the application until the deadline for filing public comments. A public meeting is intended for the taking of public comment, and is not a contested case proceeding.

After the public comment deadline, the Executive Director prepares a response to all significant public comments on the application or the draft permit raised during the public comment period. The Chief Clerk then mails the Executive Director's Response to Comments and Final Decision to people who have filed comments, requested a contested case hearing, or requested to be on the mailing list. This notice provides that if a person is not satisfied with the Executive Director's response and decision, they can request a contested case hearing or file a request to reconsider the Executive Director's decision within 30 days after the notice is mailed.

The Executive Director will issue the permit unless a written hearing request or request for reconsideration is filed within 30 days after the Executive Director's Response to Comments and Final Decision is mailed. If a hearing request or request for reconsideration is filed, the Executive Director will not issue the permit and will forward the application and request to the TCEQ Commissioners for their consideration at a scheduled Commission meeting. If a contested case hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

If the Executive Director calls a public meeting or the Commission grants a contested case hearing as described above, the Commission will give notice of the date, time, and place of the meeting or hearing. If a hearing request or request for reconsideration is made, the Commission will consider all public comments in making its decision and shall either adopt the Executive Director's response to public comments or prepare its own response.

For additional information about this application, contact J. Alfonso Martinez III at (512) 239-4668.



J. Alfonso Martinez III
Municipal Permits Team
Wastewater Permitting Section (MC 148)

June 11, 2014
Date

Attachment B
to Lerin Hills Municipal Utility District's
Response to Hearing Requests
Renewal Permit Application

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
TCEQ DOMESTIC WASTEWATER PERMIT APPLICATION
DOMESTIC ADMINISTRATIVE REPORT

Submit this checklist with the application. Do not submit the instructions with the application. Indicate if the following are included in the application.

Applicant Lerin Hills MUD

Permit Number WQ0014712-001

WORKSHEET	Y	N	WORKSHEET	Y	N
Administrative Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original USGS Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Administrative Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Affected Landowner Map	<input type="checkbox"/>	<input checked="" type="checkbox"/>
SPIF	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Landowner Disk or Labels	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Technical Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Buffer Zone Map	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Technical Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Flow Diagram	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 2.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Site Drawing	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 2.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Original Photographs	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Design Calculations	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Design Features	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 4.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Solids Management Plan	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 5.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Water Balance	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 6.0 (Required For All POTWs)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Copy of Application Fee Check	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 7.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	All fees owed TCEQ are paid	<input checked="" type="checkbox"/>	<input type="checkbox"/>

Please indicate by a check mark the amount submitted for the application fee:

Flow	New/Major Amendment	Renewals
< .05 MGD	<input type="checkbox"/> \$350.00	<input checked="" type="checkbox"/> \$315.00
≥ .05 but < .10 MGD	<input type="checkbox"/> \$550.00	<input type="checkbox"/> \$515.00
≥ .10 but < .25 MGD	<input type="checkbox"/> 850.00	<input type="checkbox"/> \$815.00
≥ .25 but < .50 MGD	<input type="checkbox"/> \$1,250.00	<input type="checkbox"/> \$1,215.00
≥ .50 but < 1.0 MGD	<input type="checkbox"/> \$1,650.00	<input type="checkbox"/> \$1,615.00
≥ 1.0 MGD	<input type="checkbox"/> \$2,050.00	<input type="checkbox"/> \$2,015.00
Minor Amendment (any flow)	<input type="checkbox"/> \$115.00	

* All facilities are designated as minors until formally classified as a major by EPA.

For Commission Use Only:		
Segment Number: _____	County: _____	Expiration Date: _____
Proposed/Current Permit Number: _____	Region: _____	

DOMESTIC ADMINISTRATIVE REPORT 1.0

The following is required for all applications--Renewal, New, And Amendment

Type of application:

- | | |
|--|--|
| <input type="checkbox"/> New TPDES | <input type="checkbox"/> New TLAP |
| <input type="checkbox"/> Major amendment with Renewal | <input type="checkbox"/> Major Amendment without Renewal |
| <input checked="" type="checkbox"/> Renewal of existing permit | <input type="checkbox"/> Minor amendment to permit |
| | <input type="checkbox"/> Minor modification to permit |

If applying for an amendment to a permit, please describe the request in detail.

1. APPLICANT INFORMATION (Instructions, Page 18)

a. Facility Owner (Owner of the facility must apply for the permit.)

What is the Legal Name of the entity (applicant) applying for this permit?

Lerin Hills Municipal Utility District of Kendall County (Lerin Hills MUD)

(The legal name must be spelled exactly as filed with the Texas Secretary of State, County, or in the legal document forming the entity.)

If the applicant is currently a customer with TCEQ, what is the Customer Number (CN)?

Search for your CN at:

<http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch>

CN 602989105

What is the name and title of the person signing the application?

(The person must be an executive official meeting signatory requirements in TAC 305.43(a).)

Prefix: Edward Suarez

(Mr. Ms, Miss)

First/Last Name: _____

Suffix: _____

Title: President

Credential: _____

What is the applicant's mailing address as recognized by the **US Postal Service**?

You may verify the address at: <http://zip4.usps.com/zip4/welcome.jsp>

Organization Name: Lerin Hills MUD

Mailing Address: 3200 Southwest Frwy., Suite 2600

Internal Routing (Mail Code, Etc.): _____

City: Houston

State: TX

ZIP Code: 77027

Mailing Information if outside USA

Territory: _____ Country Code: _____ Postal Code: _____

Phone No.: (713) 860-6473 Extension: _____

Fax No.: (713) 860-6663 E-mail Address: bhamilton@abhr.com

Indicate the type of Customer:

- | | |
|--|---|
| <input type="checkbox"/> Individual | <input type="checkbox"/> Sole Proprietorship-D.B.A. |
| <input type="checkbox"/> Limited Partnership | <input type="checkbox"/> Corporation |
| <input type="checkbox"/> Trust | <input type="checkbox"/> Estate |
| <input type="checkbox"/> Federal Government | <input type="checkbox"/> State Government |
| <input type="checkbox"/> County Government | <input type="checkbox"/> City Government |
| <input type="checkbox"/> Other Government | <input checked="" type="checkbox"/> Other: MUD |

Independent entity

- Yes
 No (If governmental entity, subsidiary, or part of a larger corporation)

Number of Employees:

- 0-20; 21-100; 101-250; 251-500; or 501 or higher

Customer Business Tax and Filing Numbers

(Not applicable to individuals, governments, general partnerships or sole proprietors. **REQUIRED** for corporations and limited partnerships)

State Franchise Tax ID Number: _____

TX SOS Charter (filing) Number: _____

Federal Tax ID: _____

DUNS Number (if known): _____

b. Co-Permittee information (complete only if the operator must be a co-permittee)

What is the Legal Name of the entity (operator) applying for this permit?

Operator N/A

(The legal name must be spelled exactly as filed with the Texas Secretary of State, County, or in the legal document forming the entity.)

If the operator is currently a customer with TCEQ, what is the Customer Number (CN)? Search for your CN at:

<http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch>

CN _____

What is the name and title of the person signing the application?

(The person must be an executive official meeting signatory requirements in TAC 305.43(a).)

Prefix: _____

(Mr. Ms, Miss)

First/Last Name: _____

Suffix: _____

Title: _____ Credential: _____

What is the applicant's mailing address as recognized by the **US Postal Service**?

You may verify the address at: <http://zip4.usps.com/zip4/welcome.jsp>

Organization Name: _____

Mailing Address: _____

Internal Routing (Mail Code, Etc.): _____

City: _____ State: TX ZIP Code: _____

Mailing Information if outside USA

Territory: _____ Country Code: _____ Postal Code: _____

Phone No.: _____ Extension: _____

Fax No.: _____ E-mail Address: _____

Indicate the type of Customer:

- | | |
|--|---|
| <input type="checkbox"/> Individual | <input type="checkbox"/> Sole Proprietorship-D.B.A. |
| <input type="checkbox"/> Limited Partnership | <input type="checkbox"/> Corporation |
| <input type="checkbox"/> Trust | <input type="checkbox"/> Estate |
| <input type="checkbox"/> Federal Government | <input type="checkbox"/> State Government |
| <input type="checkbox"/> County Government | <input type="checkbox"/> City Government |
| <input type="checkbox"/> Other Government | <input type="checkbox"/> Other: _____ |

Independent entity

- Yes
 No (If governmental entity, subsidiary, or part of a larger corporation)

Number of Employees:

- 0-20; 21-100; 101-250; 251-500; or 501 or higher

Customer Business Tax and Filing Numbers

(Not applicable to individuals, governments, general partnerships or sole proprietors. **REQUIRED** for corporations and limited partnerships)

State Franchise Tax ID Number: _____

TX SOS Charter (filing) Number: _____

Federal Tax ID: _____

DUNS Number (if known): _____

Provide a brief description of the need for a co-permittee:

c. Individual information (complete only if the facility owner or co-permittee is an individual)

What is the Legal Name of the owner/co-permittee applying for this permit?

N/A

If the owner/co-permittee is currently a customer with TCEQ, what is the Customer Number (CN)? Search for your CN at:

<http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch>

CN _____

What is the name and title of the person signing the application?

(The person must be the individual. See signatory requirements in TAC 305.43(a).)

Prefix: _____

(Mr. Ms, Miss)

First/Last Name: _____

Suffix: _____

State Identification Number: _____

Date of Birth: _____

Assumed business or professional name: _____

Business name: _____

What is the applicant's mailing address as recognized by the **US Postal Service**?

You may verify the address at: <http://zip4.usps.com/zip4/welcome.jsp>

Mailing Address: _____

Internal Routing (Mail Code, Etc.): _____

City: _____ State: _____ ZIP Code: _____

Mailing Information if outside USA

Territory: _____ Country Code: _____ Postal Code: _____

Phone No.: _____ Extension: _____

Fax No.: _____ E-mail Address: _____

2. BILLING CONTACT (Instructions Page 21)

a. Billing Contact and Address Information

*The permittee is responsible for paying the annual fee. The annual fee will be assessed to permits **active on September 1 of each year**. TCEQ will send a bill to the address provided in this section. The permittee is responsible for terminating the permit when it is no longer needed.*

Is the billing address the same as the permittee or co-permittee?

Permittee Co-permittee No, fill out this section

Prefix: _____

(Mr. Ms, Miss)

First/Last Name: _____

Suffix: _____

Title: _____ Credential: _____

Organization Name: _____

Billing Mailing Address: _____
Internal Routing (Mail Code, Etc.): _____
City: _____ State: TX ZIP Code: _____
Mailing Information if outside USA.
Territory: _____ Country Code: _____ Postal Code: _____
Phone No.: _____ Extension: _____
Fax No.: _____ E-mail Address: _____

3. APPLICATION CONTACT INFORMATION (Instructions, Page 21)

If TCEQ needs additional information regarding this application, who should be contacted?

a. Application Contact

Prefix: Mr. _____
(Mr. Ms, Miss)
First/Last Name: Mark S. Brown
Suffix: P.E.
Title: Consultant Credential: _____
Organization Name: Jones & Carter, Inc.
Mailing Address: 1000 Central Pkwy. N., Suite 100
Internal Routing (Mail Code, Etc.): _____
City: San Antonio State: TX ZIP Code: 78232
Mailing Information if outside USA.
Territory: _____ Country Code: _____ Postal Code: _____
Phone No.: (210) 494-5511 Extension: _____
Fax No.: (210) 494-5519 E-mail Address: mbrown@jonescarter.com
Check on or both: Administrative contact Technical Contact

b. Application Contact

Prefix: _____
(Mr. Ms, Miss)
First/Last Name: _____
Suffix: _____
Title: _____ Credential: _____
Organization Name: _____
Mailing Address: _____
Internal Routing (Mail Code, Etc.): _____
City: _____ State: TX ZIP Code: _____
Mailing Information if outside USA.
Territory: _____ Country Code: _____ Postal Code: _____
Phone No.: _____ Extension: _____
Fax No.: _____ E-mail Address: _____

Check on or both: Administrative contact Technical Contact

4. DMR CONTACT INFORMATION (Instructions Page 22)

Contact Responsible for Discharge Monitoring Reports (EPA 3320-1)

Provide the name of the person and their complete mailing address delegated to receive and submit Discharge Monitoring Report Forms.

Prefix: _____

(Mr. Ms, Miss)

First/Last Name: Brooks Hamilton

Suffix: _____

Title: Attorney Credential: _____

Organization Name: Allen Boone Humphries Robinson LLP

Mailing Address: 3200 Southwest Freeway, Suite 2600

Internal Routing (Mail Code, Etc.): _____

City: Houston State: TX ZIP Code: 77027

Mailing Information if outside USA.

Territory: _____ Country Code: _____ Postal Code: _____

Phone No.: (713) 860-6406 Extension: _____

Fax No.: _____ E-mail Address: bhamilton@abhr.com



Did you know you can submit DMR data on line?

Go to Sign up now at:

<https://www6.tceq.state.tx.us/steers/>

Establish an electronic reporting account when you get your permit number.

5. PERMIT CONTACT INFORMATION (Instructions, Page 22)

Provide two names of individuals that can be contacted throughout the permit term.

Prefix: Mr.

(Mr. Ms, Miss)

First/Last Name: Edward Suarez

Suffix: _____

Title: President Credential: _____

Organization Name: _____

Mailing Address: 3200 Southwest Freeway, Suite 2600

Internal Routing (Mail Code, Etc.): _____

City: Houston State: TX ZIP Code: 77027

Mailing Information if outside USA.

Territory: _____ Country Code: _____ Postal Code: _____

Phone No.: (713) 860-6406 Extension: _____

Fax No.: _____ E-mail Address: _____

Prefix: _____
(Mr. Ms, Miss)
First/Last Name: Brooks Hamilton
Suffix: _____
Title: District Attorney _____ Credential: _____
Organization Name: Lerin Hills MUD
Mailing Address: 3200 Southwest Frwy., Suite 2600
Internal Routing (Mail Code, Etc.): _____
City: Houston _____ State: TX _____ ZIP Code: 77027
Mailing Information if outside USA.
Territory: _____ Country Code: _____ Postal Code: _____
Phone No.: (713) 860-6406 _____ Extension: _____
Fax No.: _____ E-mail Address: bhamilton@abhr.com

6. NOTICE INFORMATION (Instructions, Page 22)

a. Individual publishing the notices

Prefix: Mr.
(Mr. Ms, Miss)
First/Last Name: Mark S. Brown
Suffix: P.E.
Title: Consultant _____ Credential: _____
Organization Name: Jones & Carter, Inc.
Mailing Address: 1000 Central Pkwy. N., Suite 100
Internal Routing (Mail Code, Etc.): _____
City: San Antonio _____ State: TX _____ ZIP Code: 78232
Mailing Information if outside USA.
Territory: _____ Country Code: _____ Postal Code: _____
Phone No.: (210) 494-5511 _____ Extension: _____
Fax No.: (210) 494-5519 _____ E-mail Address: mbrown@jonescarter.com

b. Method for receiving Notice of Receipt and Intent to Obtain a Water Quality Permit Package

Indicate by a check mark the preferred method for receiving the first notice and instructions:

- E-mail Address: mbrown@jonescarter.com
- Fax No.: _____
- Overnight/Priority mail: (self addressed, prepaid envelope required)
- Regular Mail:
Mailing Address: _____
Internal Routing (Mail Code, Etc.): _____
City: _____ State: TX _____ ZIP Code: _____

c. Contact in the Notice

Prefix: Mr.
(Mr. Ms, Miss)
First/Last Name: Mark S. Brown
Suffix: P.E.
Title: Consultant Credential: _____
Organization Name: Jones & Carter, Inc.
Phone No.: (210) 494-5511 Extension: _____

d. Public Place Information

If the facility and/or outfall is located in more than one county, a public viewing place for each county must be provided.

Public Building name: N/A
Location within the building: _____
Physical address of building: _____
City: _____ County: _____
Contact Name: _____
Phone No.: _____ Extension: _____

e. Bilingual Notice Requirements:

For new permit applications, major amendment and renewal applications. Not applicable for minor amendment or minor modification applications.

Please call the bilingual/ESL coordinator at the nearest elementary and middle schools and obtain the following information to determine if an alternative language notice is required:

1. Is a bilingual education program required by the Texas Education Code at the nearest elementary or middle school to the facility or proposed facility?
 Yes. No (If No, an alternative language notice publication is not required; skip to item 4. FACILITY INFORMATION.)
2. Are the students who attend either the elementary school or the middle school enrolled in a bilingual education program at that school?
 Yes No
3. Do the students at these schools attend a bilingual education program at another location?
 Yes No
4. Would the school be required to provide a bilingual education program but the school has waived out of this requirement under 19 TAC §89.1205(g)?
 Yes. No

5. If the answer is yes to 1, 2, 3, or 4, public notice in an alternative language is required. Which language is required by the bilingual program?
N/A

This section of the application is only used to determine if alternative language notice will be needed. Complete instructions on publishing the alternative language notice will be in your public notice package.

7. REGULATED ENTITY AND PERMITTED SITE INFORMATION (Instructions Page 24)

If the site of your business is part of a larger business site, a Regulated Entity Number (RN) may already be assigned for the larger site. Use the RN assigned for the larger site. Search TCEQ's Central Registry to see if the larger site may already be registered as a regulated site at:

<http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=regent.RNSearch>

If the site is found, provide the assigned Regulated Entity Reference Number and provide the information for the site to be authorized through this application below. The site information for this authorization may vary from the larger site information.

TCEQ issued RE Reference Number (RN): RN 105160311

- a. State/TPDES Permit No.: WQ0014712001 Expiration date: 03/01/2014
EPA Identification No. (TPDES Permits only): TX 0128767
- b. Name of project or site (the name known by the community where located):
Lerin Hills MUD Wastewater Treatment Plant
- c. Is the facility located in Bexar, Comal, Hays, Kinney, Medina, Travis, Uvalde, or Williamson County? Yes No (If Yes, additional information concerning protection of the Edwards Aquifer may be required.)
- d. Is the location of the facility used in the existing permit correct? Yes No

Does the site have a physical address?

If Yes, complete Section A for a physical address.

If No (the location description is not accurate or this is a new permit application, complete), complete Section B for site location information.

Section A: Enter the physical address for the site.

Verify the address with USPS. If the address is not recognized as a delivery address, provide the address as identified for overnight mail delivery, 911 emergencies, or other online map tool to confirm an address.

Physical Address of Project or Site:

Street Number: N/A Street Name: _____
City: _____ ZIP Code: _____

Section B: Enter the site location information.

If no physical address (Street Number & Street Name), provide a written location access description to the site:

Located 5 miles west of IH-10 on the northside of State Highway 46

(Ex.: Located 2 miles west from intersection of Hwy 290 & IH35 accessible on Hwy 290 South)

e. City where the site is located or, if not in a city, what is the nearest city:

Boerne

f. ZIP Code where the site is located: 78006

g. County where the site is located: Kendall County

h. Latitude: 29 45 46 Longitude: 98 47 43

i. In your own words, briefly describe the primary business of the Regulated Entity:

(Do not repeat the SIC and NAICS code)

Treatment of domestic wastewater

j. Owner of treatment facility: Lerin Hills MUD

Ownership of Facility: Public Private Both Federal

k. Owner of land where treatment facility is/will be: Lerin Hills MUD

(If not the same as the facility owner, there must be a long term lease agreement in effect for at least six years. In some cases, a lease may not suffice - see instructions.)

l. Owner of effluent disposal site: N/A

(If not the same as the facility owner, there must be a long term lease agreement in effect for at least six years.)

m. Owner of sewage sludge disposal site: N/A

(Required only if authorization is sought in the permit for sludge disposal on property owned/controlled by the applicant.)

8. DISCHARGE/ DISPOSAL INFORMATION (Instructions, Page 27)

a. Is the point of discharge and discharge route in the existing permit correct?

Yes No

If no, or a new or amendment permit application, please give an accurate description.

[Empty box for description]

b. City or Town in which the outfall(s) is or will be located N/A

c. County the outfall(s) is located: Kendall County

d. Outfall Latitude: 29 45 46 Longitude: 98 47 43

e. For all applications involving an average daily discharge of 5 million gallons per day or more, provide the names of all counties located within 100 statute miles downstream of the point(s) of discharge. N/A

f. If a TLAP, is the location of the effluent disposal site in the existing permit accurate?
 Yes No If no, or a new or amendment permit application, please give an accurate description.
N/A

g. City or Town in which the disposal site is or will be located _____

h. County the disposal site is located: _____

i. Outfall Latitude: _____ Longitude: _____

j. If a TLAP, describe the routing of effluent from the treatment facility to the effluent disposal site:

k. For TLAP applications please identify the nearest watercourse to the disposal site to which rainfall runoff might flow if not contained: _____

l. Is the location of the sewage sludge disposal site in the existing permit accurate?
 Yes No If no, or a new permit application, please give an accurate description.

- m. Provide an **original** full size USGS Topographic Map with all required information. Indicate by a check mark that the information is provided.
- Applicant's property boundary
 - Treatment facility boundaries
 - Labeled point of discharge and highlighted discharge route
 - Sewage sludge disposal site
 - Effluent disposal site boundaries
 - New and future construction
 - 1 mile radius and 3 miles downstream information
 - All ponds

n. Is/will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch? Yes No

If Yes, indicate by a check mark if:

Authorization granted Authorization pending

(For new and amendments, provide copies of letters that show proof of contact and the approval letter upon receipt.)

o. Is the facility located on or does the treated effluent cross American Indian Land?

Yes No

9. MISCELLANEOUS INFORMATION (Instructions, Pages 30)

a. List each person formerly employed by the TCEQ who represented your company and was paid for service regarding the application:

None

b. Do you owe fees to the TCEQ? Yes No

If yes, please provide:

Account number: _____ Amount past due: _____

c. Do you owe any penalties to the TCEQ? Yes No

If yes, please provide:

Enforcement order number _____ Amount past due _____

10. SIGNATURE PAGE (Instructions, Page 31)

Permit Number: WQ0014712-001

Applicant: Lerin Hills MUD

Certification:

I, Edward Suarez

President

Typed or printed name

Title

certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code §305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature: _____

(Use blue ink)

Date: 11/8/13

Subscribed and Sworn to before me by the said Edward Suarez

on this 8th day of November, 2013

My commission expires on the 31 day of May, 2014


[Signature]

Notary Public

Bexar

County, Texas

[SEAL]

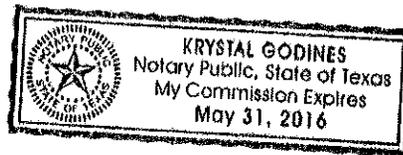

If co-permittees are necessary, each entity must submit an original, separate signature page.

DOMESTIC ADMINISTRATIVE REPORT 1.1

The following is required for new and amendment applications.

1. **AFFECTED LANDOWNER INFORMATION** (Instructions, Page 32)
 - a. Indicate by a check mark that the landowners map or drawing, with scale, includes the following, as applicable.
 - The applicant's property boundaries
 - The facility site boundaries within the applicant's property boundaries
 - The distance the buffer zone falls into adjacent properties and the property boundaries of the landowners located within the buffer zone
 - The property boundaries of all landowners surrounding the applicant's property
 - The point(s) of discharge and highlighted discharge route clearly shown for one mile downstream
 - The property boundaries of the landowners located on both sides of the discharge route for one full stream mile downstream of the point of discharge
 - The property boundaries of the landowners along the watercourse for a one-half mile radius from the point of discharge if the point of discharge is into a lake, bay estuary, or affected by tides
 - The boundaries of the effluent disposal site (for example, irrigation area or sub surface drainfield site), all evaporation/holding ponds within the applicant's property
 - The property boundaries of all landowners surrounding the applicant's property boundaries where the effluent disposal site is located
 - The boundaries of the sludge land application site (for land application of sewage sludge for beneficial use) and the property boundaries of landowners surrounding the applicant's property boundaries where the sewage sludge land application site is located
 - The property boundaries of landowners within one-half mile in all directions from the applicant's property boundaries where the sewage sludge disposal site (for example, sludge surface disposal site or sludge monofill) is located
 - b. Indicate by a check mark in which format the landowners list is submitted:
 - Read/Writeable CD or Disk
 - 4 sets of labels
 - c. Check if a separate list with the landowners' names and mailing address cross-referenced to the landowners map has been provided.
 - d. Provide the source of the landowners' names and mailing addresses.
-

- e. As required by Texas Water Code §5.115, is any permanent school fund land affected by this application? Yes No

If yes, provide the location and foreseeable impacts and effects this application has on the land(s).

2. BUFFER ZONE MAP (Instructions, Page 34)

- a. Provide a buffer zone map on 8.5 x 11-inch paper. The applicant's property line and the buffer zone line may be distinguished by using different colors and appropriate labels. Indicate by a check mark that all the following information is included on the map.
- The applicant's property boundary
 - The required buffer zone
 - Each treatment unit
 - The distance from each treatment unit to the property boundaries
- b. How will the buffer zone requirement be met?
- Ownership
 - Restrictive easement
 - Nuisance odor control
 - Variance
- c. Does the facility comply with the requirements regarding unsuitable site characteristic found in 30 TAC §309.13(a) through (d)?
- Yes No

3. ORIGINAL PHOTOGRAPHS (Instructions, Page 37)

Provide original ground level photographs. Indicate by checking that the following information is provided.

- At least one original photograph of the new or expanded treatment unit location
- At least two photographs of the existing/proposed point of discharge and as much area downstream (photo 1) and upstream (photo 2) as can be captured.
- If the discharge is to an open water body (e.g., lake, bay), the point of discharge should be in the right or left edge of each photograph showing the open water and with as much area on each respective side of the discharge as can be captured.
- At least one photograph of the existing/proposed effluent disposal site
- A plot plan or map showing the location and direction of each photograph

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)
FOR AGENCIES REVIEWING MUNICIPAL
TPDES WASTEWATER PERMIT APPLICATIONS

TCEQ USE ONLY:	
Application type: <input type="checkbox"/> Renewal <input type="checkbox"/> Major Amendment <input type="checkbox"/> Minor Amendment <input type="checkbox"/> New	
County: _____	Segment Number: _____ Admin Complete Date: _____
Agency Receiving SPIF:	
<input type="checkbox"/> Texas Historical Commission	<input type="checkbox"/> U.S. Fish and Wildlife
<input type="checkbox"/> Texas Parks and Wildlife Department	<input type="checkbox"/> U.S. Army Corps of Engineers

This form applies to TPDES permit applications only. (Instructions, Page 38).
 The SPIF must be completed as a separate document. The TCEQ will mail a copy of the SPIF to each agency as required by the TCEQ agreement with EPA. If any of the items are not completely addressed and/or further information is needed, you will be contacted to provide the information before the permit is issued. Each item must be completely addressed.

Do not refer to a response of any item in the permit application form. Each attachment must be provided with this form separately from the administrative report of the application. The application will not be declared administratively complete without this form being completed in its entirety including all attachments.

The following applies to all applications:

1. Permittee: Lerin Hills MUD
2. Permit No. WQ00 14712-001 (EPA ID No.) TX 0128767
3. Address of the project (location description that includes street/highway, city/vicinity, & county)

4.1 miles west of IH-10 measured along SH-46 and then 200 feet north of SH-46, Kendall County, Texas
4. Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.
 Name: Mark S. Brown Company: Jones & Carter, Inc.
 Phone number: 210-494-5511 Fax number: 210-494-5519
 Street No.: 1000 Street name: Central Pkwy. N, Suite 100 Street type: _____
 P.O. Box: _____ City: San Antonio State: TX ZIP code: 78232
 Email: mbrown@jonescarter.com

5. List the county in which the facility is located: Kendall County

6. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.

The property owner is the permittee

7. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the Segment Number.

From the facility thence to a series of dry creeks thence to Deep Hollow Creek, thence to Frederick Creek, thence to Cibolo Creek

8. Please provide a separate 7.5 minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required **in addition to** the map in the administrative report).

9. Provide original photographs of any structures 50 years or older on the property.

10. Does your project involve any of the following? Check all that apply.

- a. Proposed access roads, utility lines, construction easements
- b. Visual effects that could damage or detract from a historic property's integrity
- c. Vibration effects during construction or as a result of project design
- d. Additional phases of development that are planned for the future
- e. Sealing caves, fractures, sinkholes, other karst features
- f. Disturbance of vegetation or wetlands

11. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features).

About 5 acres of land will be disturbed. No caves or karst features will be sealed.

12. Describe existing disturbances, vegetation and land use.

Pasture Land

THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

13. List construction dates of all buildings and structures on the property.

14. Provide a brief history of the property, and name of the architect/builder, if known.

**TCEQ DOMESTIC WASTEWATER PERMIT APPLICATION
DOMESTIC TECHNICAL REPORT 1.0**

**THE FOLLOWING IS REQUIRED FOR ALL APPLICATIONS;
RENEWAL, NEW, AND AMENDMENT**

1. PERMITTED AND/OR PROPOSED FLOWS (Instructions, Page 39)

PERMITTED AND/OR PROPOSED FLOW:	Existing/Interim I Phase	Interim II Phase	Final Phase
Design Flow (MGD)	0.055	.110	.49
2-Hr Peak Flow (MGD)	.22	.44	1.96
Date construction estimated to commence	2014	2016	2018
Date waste disposal estimated to commence	2014	2016	2018

Phase currently in operation: None

2. NAICS and SIC CODE (Instructions, Page 39)

Provide the appropriate SIC Code: 4952 and NAICS code: 221320

3. TREATMENT UNITS (Instructions, Page 40)

- a. Provide a detailed description of the treatment process. Include the type of treatment plant, mode of operation, and all treatment units. Start with the plant's head works and finish with the point of discharge. Include all sludge processing and drying units. If more than one phase exists or is proposed in the permit, a description of each phase must be provided.**

See Attachment "C"

Port or pipe diameter at the discharge point: 8 inches

- b. Provide the startup date of the current treatment facility:** Not Constructed

Have plans and specifications been approved for the existing facilities and/or each proposed phase?

Yes No

(If yes, provide the date(s) of approval for each phase) _____

- c. For applicants with an existing permit: Check the Other Requirements page(s) of the existing permit and provide information (including dates) on any actions taken to meet an Other Requirement pertaining to the submission of a summary submittal letter if applicable.

See Attachment "D"

- d. Have the buffer zone requirements been met? Yes No

- e. For applicants with an existing permit: Check the Other Requirements page(s) of the existing permit and provide information (including dates) on any actions taken to meet the conditions of an Other Requirement pertaining to the buffer zone if applicable.

None

- f. Provide flow diagrams for the existing facilities and/or each proposed phase of construction. Indicate by a check mark that the required information is included.
See Attachment "E"

- g. Provide the type and dimensions (length, width, height) of each treatment unit and for all phases.

TREATMENT UNITS	# OF UNITS	DIMENSIONS (L x W x D)
See Attachment "C"		

4. POLLUTANT ANALYSIS OF TREATED EFFLUENT (Instructions, Page 40)

Provide an analysis of the treated effluent for the following pollutants (data must be taken within 1 year of the date of application submission: (Not required for new permit applications unless the facility is in operation)

For discharges from **water treatment plants** provide the following pollutant analysis: Total Suspended Solids, Total Dissolved Solids, pH, aluminum, and fluoride instead of the table below.

N/A

POLLUTANT	CONCENTRATION		NUMBER OF SAMPLES	TYPE OF SAMPLE	SAMPLE DATE/TIME
	AVG.	MAX.			
(1) CBOD ₅ mg/l					
(2) Total Suspended Solids, mg/l					
(3) Ammonia-Nitrogen, mg/l					
(4) Nitrate-Nitrogen, mg/l					
(5) Total Kjeldahl Nitrogen, mg/l					
(6) Sulfate, mg/l					
(7) Chloride, mg/l					
(8) Total Phosphorus, mg/l					
(9) pH, standard units					
(10) Dissolved Oxygen, mg/l					
(11) Chlorine Residual, mg/l					
(12) <i>E. coli</i> (colonies/100ml) freshwater discharge					
(13) Enterococci (colonies/100ml) saltwater discharge					
(14) Total Dissolved Solids, mg/l					
(15) Elec. Conductivity, umhos/cm					
(16) Oil and Grease, mg/l					

5. FACILITY OPERATOR (Instructions, Page 41)

Provide the name and operator certification number for the facility operator:

Contract Operator To Be Determined

6. SEWAGE SLUDGE MANAGEMENT AND DISPOSAL (Instruction, Page 41)

- a. Please check the current sludge disposal method or methods. More than one method can be checked.

Permitted landfill

Permitted or Registered land application site for beneficial use

Land application for beneficial use authorized in the wastewater permit

Marketing and distribution as authorized in the wastewater permit

Composting as authorized in the wastewater permit

Permitted surface disposal site (sludge monofill)

Surface disposal site (sludge monofill) authorized in the wastewater permit

- Transported to another permitted wastewater treatment plant or permitted sludge processing facility (a current statement or agreement is required, see the item below)

Written statement/contractual agreement from the wastewater treatment plant or permitted sludge processing facility accepting the sludge is attached

Other method (provide description):

- b. Provide the following information for the sludge site:

Disposal site name: See Attachment "F"

TCEQ Permit or Registration Number: _____

County where the site is located: _____

- c. Provide the following:

Method of transportation (truck, train, pipe, other): _____

Name of the hauler: See Attachment "F"

Hauler Registration Number: _____

Transported in: liquid semi-liquid semi-solid solid state

Land application for: Reclamation Soil Conditioning

7. PERMIT AUTHORIZATION FOR SEWAGE SLUDGE DISPOSAL (Instructions, Page 41)

- a. Does the existing permit include authorization for land application of sewage sludge for beneficial use? Yes No

If yes, are you requesting to continue this authorization to land apply sewage sludge for beneficial use: Yes No

If yes, is the completed **APPLICATION FOR PERMIT FOR BENEFICIAL LAND USE OF SEWAGE SLUDGE (TCEQ Form No. 10451)** attached to this permit renewal application (see the instructions for details): Yes No

b. Does the existing permit include authorization for any of the following sludge processing, storage or disposal options?

- | | | |
|---|------------------------------|--|
| Sludge Composting | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |
| Marketing and Distribution of sludge | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |
| Sludge Surface Disposal or Sludge Monofill | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |
| Temporary storage of sludge in sludge lagoons | <input type="checkbox"/> Yes | <input checked="" type="checkbox"/> No |

If yes to any of the above sludge options and the applicant is requesting to continue this authorization, is the completed **DOMESTIC WASTEWATER PERMIT**

APPLICATION: SEWAGE SLUDGE TECHNICAL REPORT (TCEQ Form No.

10056) attached to this permit renewal application. Yes No

8. SEWAGE SLUDGE SOLIDS MANAGEMENT PLAN (Instructions, Page 42)

Does the facility discharge in the Lake Houston watershed? Yes No

Does the facility accept sludge from other domestic wastewater treatment facilities?

Yes No

If yes to either question, is the required solids management plan attached? Yes No

9. SEWAGE SLUDGE LAGOONS (Instructions, Page 43)

a. Location information

Indicate by a check mark that the following required maps are submitted as part of the application and that they contain the required information?

- Original General Highway (County) Map
- USDA Natural Resources Conservation Service Soil Map
- Federal Emergency Management Map
- Site map

Indicate by a check mark if any of the following existing within the area used/proposed for the lagoons:

- Overlap a designated 100-year frequency flood plain
- Soils with flooding classification
- Overlap an unstable area
- Wetlands
- Located less than 60 meters from a fault
- None of these

If a portion of the lagoon(s) is located within the 100-year frequency flood plain, provide the protective measures to be utilized including type and size of protective structures:

b. Temporary storage information

Provide the results of the following in addition to the pollutants listed in the Technical Report 1.0

Pollutant	mg/kg
Nitrate Nitrogen	
Total Nitrogen	
Phosphorus	
Potassium	
pH (Standard Units)	
Ammonia Nitrogen	

Provide the following information:

Volume and frequency of sludge to lagoon(s): _____

Total dry tons stored in the sludge lagoon(s) per 365-day period: _____

Total dry tons stored in the sludge lagoon(s) over the life of the unit: _____

c. Facility information

Does the active/proposed sludge lagoon(s) have a liner with a maximum hydraulic conductivity of 1×10^{-7} cm/sec? Yes No

If yes, describe the liner: Please note that lining is required.

d. Site Development Plan

Provide a detailed description of the methods used to deposit sludge in the lagoon(s):

In addition to the detailed description, please indicate by a check mark that the following information is provided:

- Plan view and cross-section of the sludge lagoon(s)
- Copy of the closure plan
- Copy of deed recordation for the site
- Size of the sludge lagoon(s) in surface acres and capacity in cubic feet and gallons
- Description of the method of controlling infiltration of groundwater and surface water from entering the site
- Procedures to prevent the occurrence of nuisance conditions

e. Groundwater Monitoring

Is groundwater monitoring currently conducted at this site, or are any wells available for groundwater monitoring, or are groundwater monitoring data otherwise available for the sludge lagoon(s)?

Yes No If groundwater monitoring data are available, provide a copy.

Provide a profile of soil types encountered down to the groundwater table and the depth to the shallowest groundwater as a separate attachment.

10. AUTHORIZATIONS/REQUIREMENTS/COMPLIANCE/ENFORCEMENT
(Instructions, Page 44)

a. Does the permittee have additional authorizations for this facility, such as reuse authorization, sludge permit, etc? Yes No

If yes, provide the TCEQ authorization number and description of the authorization:

R14712001

b. Is the permittee currently under enforcement? Yes No

Is the permittee required to meet any implementation schedule for compliance or enforcement? Yes No

If yes to either question for item 10, provide a brief summary of the enforcement and/or implementation schedule, and a status update:

11. UNBUILT PHASES (Instructions, Pages 44)

Is the application for renewal of a permit that contains an unbuilt phase or phases?

Yes No

If yes, does the existing permit contain a phase that has not been constructed within five years of being authorized by the TCEQ? Yes No

If yes, provide a detailed discussion regarding the continued need for the unbuilt phase. Failure to provide sufficient justification may result in the Executive Director recommending denial of the unbuilt phase or phases.

See Attachment "G"

12. SITE DRAWING (Instructions, Page 45) See Attachment "H"

Provide a site drawing for the facility. Indicate by a check mark that it contains the following.

- The boundaries of the treatment facility
- The boundaries of the area served by the treatment facility
- If land disposal of effluent, the boundaries of the disposal site and all storage/holding ponds
- If sludge disposal authorized in the permit, the boundaries of the land application or disposal site

Provide the name and description of the area served by the treatment facility.

Lerin Hills Subdivision, a master planned community including 1,900 connections developed on an 866-acre project area located in Kendall County, Texas.

13. RCRA/CERCLA/OTHER WASTES (Instructions, Page 45)

- a. Does the facility receive, will it receive, or has it received RCRA hazardous waste in the past three years? Yes No
- b. Does the facility receive, will it receive, or has it received in the past three years, CERCLA wastewater, RCRA remediation/corrective action wastewater or other remediation activity wastewater? Yes No
- c. If yes to either a. or b., is a detailed attachment with information concerning these wastes provided? Yes No

14. LABORATORY ACCREDITATION:

Effective July 1, 2008, all laboratory tests performed must meet the requirements of 30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification with the following general exemptions: N/A, WWTP not constructed

- i. The laboratory is an in-house laboratory and is:
 - 1. periodically inspected by the TCEQ; or
 - 2. located in another state and is accredited or inspected by that state; or
 - 3. performing work for another company with a unit located in the same site;or
 - 4. performing pro bono work for a governmental agency or charitable organization.
- ii. The laboratory is accredited under federal law.
- iii. The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- iv. The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review 30 TAC Chapter 25 for specific requirements. The following certification statement shall be signed and submitted with every application. See Instructions, TCEQ Form 10053-inst, Page 30, for a list of designated representatives who may sign the certification.

CERTIFICATION:	
I, _____	_____
<i>Typed or Printed Name</i>	<i>Title</i>
certify that all laboratory tests submitted with this application meet the requirements of 30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification.	
_____	_____
<i>Signature</i>	<i>Date</i>

Attachment C
to Lerin Hills Municipal Utility District's
Response to Hearing Requests

Draft Permit



TPDES PERMIT NO. WQ0014712001
[For TCEQ office use only - EPA I.D.
No. TX0128767]

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY
P.O. Box 13087
Austin, Texas 78711-3087

This is a renewal that replaces TPDES
Permit No. WQ0014712001 issued
February 24, 2014.

PERMIT TO DISCHARGE WASTES
under provisions of
Section 402 of the Clean Water Act
and Chapter 26 of the Texas Water Code

Lerin Hills Municipal Utility District

whose mailing address is

1108 Lavaca Street, Suite 510
Austin, Texas 78701

is authorized to treat and discharge wastes from the Lerin Hills Municipal Utility District Wastewater Treatment Facility, SIC Code 4952

located on the north side of State Highway 46, approximately 4.1 miles west of Interstate Highway 10, as measured along State Highway 46, northeast of Deep Hollow Drive in Kendall County, Texas 78006

to an unnamed tributary; thence to the headwaters of an impoundment on Deep Hollow Creek (Soil Conservation Service (SCS) Site 4 Reservoir); thence to Deep Hollow Creek; thence to Frederick Creek; thence to Upper Cibolo Creek in Segment No. 1908 of the San Antonio River Basin

only according with effluent limitations, monitoring requirements and other conditions set forth in this permit, as well as the rules of the Texas Commission on Environmental Quality (TCEQ), the laws of the State of Texas, and other orders of the TCEQ. The issuance of this permit does not grant to the permittee the right to use private or public property for conveyance of wastewater along the discharge route described in this permit. This includes, but is not limited to, property belonging to any individual, partnership, corporation or other entity. Neither does this permit authorize any invasion of personal rights nor any violation of federal, state, or local laws or regulations. It is the responsibility of the permittee to acquire property rights as may be necessary to use the discharge route.

This permit shall expire at midnight, **March 1, 2017**.

ISSUED DATE:

For the Commission

INTERIM I EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

1. During the period beginning upon the date of issuance and lasting through the completion of expansion to the 0.11 million gallons per day (MGD) facilities the permittee is authorized to discharge subject to the following effluent limitations:

The daily average flow of effluent shall not exceed 0.055 MGD; nor shall the average discharge during any two-hour period (2-hour peak) exceed 153 gallons per minute (gpm).

<u>Effluent Characteristic</u>	<u>Discharge Limitations</u>			<u>Min. Self-Monitoring Requirements</u>	
	Daily Avg mg/l (lbs/day)	7-day Avg mg/l	Daily Max mg/l	Report Daily Avg. & Max. Single Grab Measurement Frequency	Sample Type
Flow, MGD	Report	N/A	Report	Continuous	Totalizing Meter
Carbonaceous Biochemical Oxygen Demand (5-day)	5 (2-3)	10	20	One/week	Grab
Total Suspended Solids	5 (2-3)	10	20	One/week	Grab
Ammonia Nitrogen	1 (0.46)	2	4	One/week	Grab
Total Phosphorus	0.5 (0.23)	1	2	One/week	Grab
Nitrate-Nitrogen	Report (Report)	N/A	N/A	One/week	Grab
Total Nitrogen	Report (Report)	N/A	N/A	One/week	Grab
<i>E. coli</i> , CFU or MPN/100 ml	126	N/A	N/A	One/quarter	Grab

2. The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes (based on peak flow), and shall be monitored five times per week by grab sample. The permittee shall dechlorinate the chlorinated effluent to less than 0.1 mg/l chlorine residual and shall monitor chlorine residual five times per week by grab sample after the dechlorination process. An equivalent method of disinfection may be substituted only with prior approval of the Executive Director.
3. The pH shall not be less than 6.0 standard units nor greater than 9.0 standard units and shall be monitored once per month by grab sample.
4. There shall be no discharge of floating solids or visible foam in other than trace amounts and no discharge of visible oil.
5. Effluent monitoring samples shall be taken at the following location(s): Following the final treatment unit.
6. The effluent shall contain a minimum dissolved oxygen of 6.0 mg/l and shall be monitored once per week by grab sample.

INTERIM II EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

1. During the period beginning upon the completion of expansion to the 0.11 million gallons per day (MGD) facilities and lasting through the completion of expansion to the 0.49 MGD facilities the permittee is authorized to discharge subject to the following effluent limitations:

The daily average flow of effluent shall not exceed 0.11 MGD; nor shall the average discharge during any two-hour period (2-hour peak) exceed 306 gallons per minute (gpm).

<u>Effluent Characteristic</u>	<u>Discharge Limitations</u>			<u>Min. Self-Monitoring Requirements</u>	
	Daily Avg mg/l (lbs/day)	7-day Avg mg/l	Daily Max mg/l	Report Daily Avg. & Max. Single Grab Measurement Frequency	Sample Type
Flow, MGD	Report	N/A	Report	Continuous	Totalizing Meter
Carbonaceous Biochemical Oxygen Demand (5-day)	5 (4.6)	10	20	One/week	Grab
Total Suspended Solids	5 (4.6)	10	20	One/week	Grab
Ammonia Nitrogen	1 (0.92)	2	4	One/week	Grab
Total Phosphorus	0.5 (0.46)	1	2	One/week	Grab
Nitrate-Nitrogen	Report (Report)	N/A	N/A	One/week	Grab
Total Nitrogen	Report (Report)	N/A	N/A	One/week	Grab
<i>E. coli</i> , CFU or MPN/100 ml	126	N/A	N/A	One/month	Grab

2. The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes (based on peak flow), and shall be monitored five times per week by grab sample. The permittee shall dechlorinate the chlorinated effluent to less than 0.1 mg/l chlorine residual and shall monitor chlorine residual five times per week by grab sample after the dechlorination process. An equivalent method of disinfection may be substituted only with prior approval of the Executive Director.
3. The pH shall not be less than 6.0 standard units nor greater than 9.0 standard units and shall be monitored once per month by grab sample.
4. There shall be no discharge of floating solids or visible foam in other than trace amounts and no discharge of visible oil.
5. Effluent monitoring samples shall be taken at the following location(s): Following the final treatment unit.
6. The effluent shall contain a minimum dissolved oxygen of 6.0 mg/l and shall be monitored once per week by grab sample.

FINAL EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTSOutfall Number 001

1. During the period beginning upon the completion of expansion to the 0.49 million gallons per day (MGD) facilities and lasting through the date of expiration, the permittee is authorized to discharge subject to the following effluent limitations:

The daily average flow of effluent shall not exceed 0.49 MGD; nor shall the average discharge during any two-hour period (2-hour peak) exceed 1361 gallons per minute (gpm).

<u>Effluent Characteristic</u>	<u>Discharge Limitations</u>			<u>Min. Self-Monitoring Requirements</u>	
	Daily Avg mg/l (lbs/day)	7-day Avg mg/l	Daily Max mg/l	Report Daily Avg. & Max. Single Grab Measurement Frequency	Sample Type
Flow, MGD	Report	N/A	Report	Continuous	Totalizing Meter
Carbonaceous Biochemical Oxygen Demand (5-day)	5 (20)	10	20	One/week	Grab
Total Suspended Solids	5 (20)	10	20	One/week	Grab
Ammonia Nitrogen	1 (4.1)	2	4	One/week	Grab
Total Phosphorus	0.5 (2.0)	1	2	One/week	Grab
Nitrate-Nitrogen	Report (Report)	N/A	N/A	One/week	Grab
Total Nitrogen	Report (Report)	N/A	N/A	One/week	Grab
<i>E. coli</i> , CFU or MPN/100 ml	126	N/A	N/A	One/month	Grab

2. The effluent shall contain a chlorine residual of at least 1.0 mg/l and shall not exceed a chlorine residual of 4.0 mg/l after a detention time of at least 20 minutes (based on peak flow), and shall be monitored five times per week by grab sample. The permittee shall dechlorinate the chlorinated effluent to less than 0.1 mg/l chlorine residual and shall monitor chlorine residual five times per week by grab sample after the dechlorination process. An equivalent method of disinfection may be substituted only with prior approval of the Executive Director.
3. The pH shall not be less than 6.0 standard units nor greater than 9.0 standard units and shall be monitored once per month by grab sample.
4. There shall be no discharge of floating solids or visible foam in other than trace amounts and no discharge of visible oil.
5. Effluent monitoring samples shall be taken at the following location(s): Following the final treatment unit.
6. The effluent shall contain a minimum dissolved oxygen of 6.0 mg/l and shall be monitored once per week by grab sample.

DEFINITIONS AND STANDARD PERMIT CONDITIONS

As required by Title 30 Texas Administrative Code (TAC) Chapter 305, certain regulations appear as standard conditions in waste discharge permits. 30 TAC § 305.121 - 305.129 (relating to Permit Characteristics and Conditions) as promulgated under the Texas Water Code (TWC) §§ 5.103 and 5.105, and the Texas Health and Safety Code (THSC) §§ 361.017 and 361.024(a), establish the characteristics and standards for waste discharge permits, including sewage sludge, and those sections of 40 Code of Federal Regulations (CFR) Part 122 adopted by reference by the Commission. The following text includes these conditions and incorporates them into this permit. All definitions in TWC § 26.001 and 30 TAC Chapter 305 shall apply to this permit and are incorporated by reference. Some specific definitions of words or phrases used in this permit are as follows:

1. Flow Measurements

- a. Annual average flow - the arithmetic average of all daily flow determinations taken within the preceding 12 consecutive calendar months. The annual average flow determination shall consist of daily flow volume determinations made by a totalizing meter, charted on a chart recorder and limited to major domestic wastewater discharge facilities with one million gallons per day or greater permitted flow.
- b. Daily average flow - the arithmetic average of all determinations of the daily flow within a period of one calendar month. The daily average flow determination shall consist of determinations made on at least four separate days. If instantaneous measurements are used to determine the daily flow, the determination shall be the arithmetic average of all instantaneous measurements taken during that month. Daily average flow determination for intermittent discharges shall consist of a minimum of three flow determinations on days of discharge.
- c. Daily maximum flow - the highest total flow for any 24-hour period in a calendar month.
- d. Instantaneous flow - the measured flow during the minimum time required to interpret the flow measuring device.
- e. 2-hour peak flow (domestic wastewater treatment plants) - the maximum flow sustained for a two-hour period during the period of daily discharge. The average of multiple measurements of instantaneous maximum flow within a two-hour period may be used to calculate the 2-hour peak flow.
- f. Maximum 2-hour peak flow (domestic wastewater treatment plants) - the highest 2-hour peak flow for any 24-hour period in a calendar month.

2. Concentration Measurements

- a. Daily average concentration - the arithmetic average of all effluent samples, composite or grab as required by this permit, within a period of one calendar month, consisting of at least four separate representative measurements.
 - i. For domestic wastewater treatment plants - When four samples are not available in a calendar month, the arithmetic average (weighted by flow) of all values in the previous four consecutive month period consisting of at least four measurements shall be utilized as the daily average concentration.

- ii. For all other wastewater treatment plants - When four samples are not available in a calendar month, the arithmetic average (weighted by flow) of all values taken during the month shall be utilized as the daily average concentration.
- b. 7-day average concentration - the arithmetic average of all effluent samples, composite or grab as required by this permit, within a period of one calendar week, Sunday through Saturday.
- c. Daily maximum concentration - the maximum concentration measured on a single day, by the sample type specified in the permit, within a period of one calendar month.
- d. Daily discharge - the discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in terms of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the sampling day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the average measurement of the pollutant over the sampling day.

The daily discharge determination of concentration made using a composite sample shall be the concentration of the composite sample. When grab samples are used, the daily discharge determination of concentration shall be the arithmetic average (weighted by flow value) of all samples collected during that day.

- e. Bacteria concentration (*E. coli* or Enterococci) - Colony Forming Units (CFU) or Most Probable Number (MPN) of bacteria per 100 milliliters effluent. The daily average bacteria concentration is a geometric mean of the values for the effluent samples collected in a calendar month. The geometric mean shall be determined by calculating the n th root of the product of all measurements made in a calendar month, where n equals the number of measurements made; or, computed as the antilogarithm of the arithmetic mean of the logarithms of all measurements made in a calendar month. For any measurement of bacteria equaling zero, a substituted value of one shall be made for input into either computation method. If specified, the 7-day average for bacteria is the geometric mean of the values for all effluent samples collected during a calendar week.
 - f. Daily average loading (lbs/day) - the arithmetic average of all daily discharge loading calculations during a period of one calendar month. These calculations must be made for each day of the month that a parameter is analyzed. The daily discharge, in terms of mass (lbs/day), is calculated as (Flow, MGD x Concentration, mg/l x 8.34).
 - g. Daily maximum loading (lbs/day) - the highest daily discharge, in terms of mass (lbs/day), within a period of one calendar month.
3. Sample Type
- a. Composite sample - For domestic wastewater, a composite sample is a sample made up of a minimum of three effluent portions collected in a continuous 24-hour period or during the period of daily discharge if less than 24 hours, and combined in volumes proportional to flow, and collected at the intervals required by 30 TAC § 319.9 (a). For industrial wastewater, a composite sample is a sample made up of a minimum of three effluent portions collected in a continuous 24-hour period or during the period of daily discharge if less than 24 hours, and combined in volumes proportional to flow, and collected at the intervals required by 30 TAC § 319.9 (b).

- b. Grab sample - an individual sample collected in less than 15 minutes.
4. Treatment Facility (facility) - wastewater facilities used in the conveyance, storage, treatment, recycling, reclamation and/or disposal of domestic sewage, industrial wastes, agricultural wastes, recreational wastes, or other wastes including sludge handling or disposal facilities under the jurisdiction of the Commission.
5. The term "sewage sludge" is defined as solid, semi-solid, or liquid residue generated during the treatment of domestic sewage in 30 TAC Chapter 312. This includes the solids that have not been classified as hazardous waste separated from wastewater by unit processes.
6. Bypass - the intentional diversion of a waste stream from any portion of a treatment facility.

MONITORING AND REPORTING REQUIREMENTS

1. Self-Reporting

Monitoring results shall be provided at the intervals specified in the permit. Unless otherwise specified in this permit or otherwise ordered by the Commission, the permittee shall conduct effluent sampling and reporting in accordance with 30 TAC §§ 319.4 - 319.12. Unless otherwise specified, a monthly effluent report shall be submitted each month, to the Enforcement Division (MC 224), by the 20th day of the following month for each discharge which is described by this permit whether or not a discharge is made for that month. Monitoring results must be reported on an approved self-report form that is signed and certified as required by Monitoring and Reporting Requirements No. 10.

As provided by state law, the permittee is subject to administrative, civil and criminal penalties, as applicable, for negligently or knowingly violating the Clean Water Act (CWA); TWC §§ 26, 27, and 28; and THSC § 361, including but not limited to knowingly making any false statement, representation, or certification on any report, record, or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or noncompliance, or falsifying, tampering with or knowingly rendering inaccurate any monitoring device or method required by this permit or violating any other requirement imposed by state or federal regulations.

2. Test Procedures

- a. Unless otherwise specified in this permit, test procedures for the analysis of pollutants shall comply with procedures specified in 30 TAC §§ 319.11 - 319.12. Measurements, tests, and calculations shall be accurately accomplished in a representative manner.
- b. All laboratory tests submitted to demonstrate compliance with this permit must meet the requirements of 30 TAC § 25, Environmental Testing Laboratory Accreditation and Certification.

3. Records of Results

- a. Monitoring samples and measurements shall be taken at times and in a manner so as to be representative of the monitored activity.

- b. Except for records of monitoring information required by this permit related to the permittee's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 CFR Part 503), monitoring and reporting records, including strip charts and records of calibration and maintenance, copies of all records required by this permit, records of all data used to complete the application for this permit, and the certification required by 40 CFR § 264.73(b)(9) shall be retained at the facility site, or shall be readily available for review by a TCEQ representative for a period of three years from the date of the record or sample, measurement, report, application or certification. This period shall be extended at the request of the Executive Director.
- c. Records of monitoring activities shall include the following:
 - i. date, time and place of sample or measurement;
 - ii. identity of individual who collected the sample or made the measurement.
 - iii. date and time of analysis;
 - iv. identity of the individual and laboratory who performed the analysis;
 - v. the technique or method of analysis; and
 - vi. the results of the analysis or measurement and quality assurance/quality control records.

The period during which records are required to be kept shall be automatically extended to the date of the final disposition of any administrative or judicial enforcement action that may be instituted against the permittee.

4. Additional Monitoring by Permittee

If the permittee monitors any pollutant at the location(s) designated herein more frequently than required by this permit using approved analytical methods as specified above, all results of such monitoring shall be included in the calculation and reporting of the values submitted on the approved self-report form. Increased frequency of sampling shall be indicated on the self-report form.

5. Calibration of Instruments

All automatic flow measuring or recording devices and all totalizing meters for measuring flows shall be accurately calibrated by a trained person at plant start-up and as often thereafter as necessary to ensure accuracy, but not less often than annually unless authorized by the Executive Director for a longer period. Such person shall verify in writing that the device is operating properly and giving accurate results. Copies of the verification shall be retained at the facility site and/or shall be readily available for review by a TCEQ representative for a period of three years.

6. Compliance Schedule Reports

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later

than 14 days following each schedule date to the Regional Office and the Enforcement Division (MC 224).

7. Noncompliance Notification

- a. In accordance with 30 TAC § 305.125(9) any noncompliance which may endanger human health or safety, or the environment shall be reported by the permittee to the TCEQ. Report of such information shall be provided orally or by facsimile transmission (FAX) to the Regional Office within 24 hours of becoming aware of the noncompliance. A written submission of such information shall also be provided by the permittee to the Regional Office and the Enforcement Division (MC 224) within five working days of becoming aware of the noncompliance. The written submission shall contain a description of the noncompliance and its cause; the potential danger to human health or safety, or the environment; the period of noncompliance, including exact dates and times; if the noncompliance has not been corrected, the time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance, and to mitigate its adverse effects.
- b. The following violations shall be reported under Monitoring and Reporting Requirement 7.a.:
 - i. Unauthorized discharges as defined in Permit Condition 2(g).
 - ii. Any unanticipated bypass that exceeds any effluent limitation in the permit.
 - iii. Violation of a permitted maximum daily discharge limitation for pollutants listed specifically in the Other Requirements section of an Industrial TPDES permit.
- c. In addition to the above, any effluent violation which deviates from the permitted effluent limitation by more than 40% shall be reported by the permittee in writing to the Regional Office and the Enforcement Division (MC 224) within 5 working days of becoming aware of the noncompliance.
- d. Any noncompliance other than that specified in this section, or any required information not submitted or submitted incorrectly, shall be reported to the Enforcement Division (MC 224) as promptly as possible. For effluent limitation violations, noncompliances shall be reported on the approved self-report form.

8. In accordance with the procedures described in 30 TAC §§ 35.301 - 35.303 (relating to Water Quality Emergency and Temporary Orders) if the permittee knows in advance of the need for a bypass, it shall submit prior notice by applying for such authorization.

9. Changes in Discharges of Toxic Substances

All existing manufacturing, commercial, mining, and silvicultural permittees shall notify the Regional Office, orally or by facsimile transmission within 24 hours, and both the Regional Office and the Enforcement Division (MC 224) in writing within five (5) working days, after becoming aware of or having reason to believe:

- a. That any activity has occurred or will occur which would result in the discharge, on a routine or frequent basis, of any toxic pollutant listed at 40 CFR Part 122, Appendix D,

Tables II and III (excluding Total Phenols) which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":

- i. One hundred micrograms per liter (100 µg/L);
 - ii. Two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4,6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
 - iii. Five (5) times the maximum concentration value reported for that pollutant in the permit application; or
 - iv. The level established by the TCEQ.
- b. That any activity has occurred or will occur which would result in any discharge, on a nonroutine or infrequent basis, of a toxic pollutant which is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":
- i. Five hundred micrograms per liter (500 µg/L);
 - ii. One milligram per liter (1 mg/L) for antimony;
 - iii. Ten (10) times the maximum concentration value reported for that pollutant in the permit application; or
 - iv. The level established by the TCEQ.

10. Signatories to Reports

All reports and other information requested by the Executive Director shall be signed by the person and in the manner required by 30 TAC § 305.128 (relating to Signatories to Reports).

11. All Publicly Owned Treatment Works (POTWs) must provide adequate notice to the Executive Director of the following:

- a. Any new introduction of pollutants into the POTW from an indirect discharger which would be subject to CWA § 301 or § 306 if it were directly discharging those pollutants;
- b. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit; and
- c. For the purpose of this paragraph, adequate notice shall include information on:
 - i. The quality and quantity of effluent introduced into the POTW; and
 - ii. Any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

PERMIT CONDITIONS**1. General**

- a. When the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in an application or in any report to the Executive Director, it shall promptly submit such facts or information.
- b. This permit is granted on the basis of the information supplied and representations made by the permittee during action on an application, and relying upon the accuracy and completeness of that information and those representations. After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked, in whole or in part, in accordance with 30 TAC Chapter 305, Subchapter D, during its term for good cause including, but not limited to, the following:
 - i. Violation of any terms or conditions of this permit;
 - ii. Obtaining this permit by misrepresentation or failure to disclose fully all relevant facts; or
 - iii. A change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- c. The permittee shall furnish to the Executive Director, upon request and within a reasonable time, any information to determine whether cause exists for amending, revoking, suspending or terminating the permit. The permittee shall also furnish to the Executive Director, upon request, copies of records required to be kept by the permit.

2. Compliance

- a. Acceptance of the permit by the person to whom it is issued constitutes acknowledgment and agreement that such person will comply with all the terms and conditions embodied in the permit, and the rules and other orders of the Commission.
- b. The permittee has a duty to comply with all conditions of the permit. Failure to comply with any permit condition constitutes a violation of the permit and the Texas Water Code or the Texas Health and Safety Code, and is grounds for enforcement action, for permit amendment, revocation, or suspension, or for denial of a permit renewal application or an application for a permit for another facility.
- c. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of the permit.
- d. The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal or other permit violation that has a reasonable likelihood of adversely affecting human health or the environment.
- e. Authorization from the Commission is required before beginning any change in the permitted facility or activity that may result in noncompliance with any permit requirements.

- f. A permit may be amended, suspended and reissued, or revoked for cause in accordance with 30 TAC §§ 305.62 and 305.66 and TWC§ 7.302. The filing of a request by the permittee for a permit amendment, suspension and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
 - g. There shall be no unauthorized discharge of wastewater or any other waste. For the purpose of this permit, an unauthorized discharge is considered to be any discharge of wastewater into or adjacent to water in the state at any location not permitted as an outfall or otherwise defined in the Other Requirements section of this permit.
 - h. In accordance with 30 TAC § 305.535(a), the permittee may allow any bypass to occur from a TPDES permitted facility which does not cause permitted effluent limitations to be exceeded or an unauthorized discharge to occur, but only if the bypass is also for essential maintenance to assure efficient operation.
 - i. The permittee is subject to administrative, civil, and criminal penalties, as applicable, under TWC §§ 7.051 - 7.075 (relating to Administrative Penalties), 7.101 - 7.111 (relating to Civil Penalties), and 7.141 - 7.202 (relating to Criminal Offenses and Penalties) for violations including, but not limited to, negligently or knowingly violating the federal CWA §§ 301, 302, 306, 307, 308, 318, or 405, or any condition or limitation implementing any sections in a permit issued under the CWA § 402, or any requirement imposed in a pretreatment program approved under the CWA §§ 402 (a)(3) or 402 (b)(8).
3. Inspections and Entry
- a. Inspection and entry shall be allowed as prescribed in the TWC Chapters 26, 27, and 28, and THSC § 361.
 - b. The members of the Commission and employees and agents of the Commission are entitled to enter any public or private property at any reasonable time for the purpose of inspecting and investigating conditions relating to the quality of water in the state or the compliance with any rule, regulation, permit or other order of the Commission. Members, employees, or agents of the Commission and Commission contractors are entitled to enter public or private property at any reasonable time to investigate or monitor or, if the responsible party is not responsive or there is an immediate danger to public health or the environment, to remove or remediate a condition related to the quality of water in the state. Members, employees, Commission contractors, or agents acting under this authority who enter private property shall observe the establishment's rules and regulations concerning safety, internal security, and fire protection, and if the property has management in residence, shall notify management or the person then in charge of his presence and shall exhibit proper credentials. If any member, employee, Commission contractor, or agent is refused the right to enter in or on public or private property under this authority, the Executive Director may invoke the remedies authorized in TWC § 7.002. The statement above, that Commission entry shall occur in accordance with an establishment's rules and regulations concerning safety, internal security, and fire protection, is not grounds for denial or restriction of entry to any part of the facility, but merely describes the Commission's duty to observe appropriate rules and regulations during an inspection.

4. Permit Amendment and/or Renewal

- a. The permittee shall give notice to the Executive Director as soon as possible of any planned physical alterations or additions to the permitted facility if such alterations or additions would require a permit amendment or result in a violation of permit requirements. Notice shall also be required under this paragraph when:
 - i. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in accordance with 30 TAC § 305.534 (relating to New Sources and New Dischargers); or
 - ii. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are subject neither to effluent limitations in the permit, nor to notification requirements in Monitoring and Reporting Requirements No. 9;
 - iii. The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan.
- b. Prior to any facility modifications, additions, or expansions that will increase the plant capacity beyond the permitted flow, the permittee must apply for and obtain proper authorization from the Commission before commencing construction.
- c. The permittee must apply for an amendment or renewal at least 180 days prior to expiration of the existing permit in order to continue a permitted activity after the expiration date of the permit. If an application is submitted prior to the expiration date of the permit, the existing permit shall remain in effect until the application is approved, denied, or returned. If the application is returned or denied, authorization to continue such activity shall terminate upon the effective date of the action. If an application is not submitted prior to the expiration date of the permit, the permit shall expire and authorization to continue such activity shall terminate.
- d. Prior to accepting or generating wastes which are not described in the permit application or which would result in a significant change in the quantity or quality of the existing discharge, the permittee must report the proposed changes to the Commission. The permittee must apply for a permit amendment reflecting any necessary changes in permit conditions, including effluent limitations for pollutants not identified and limited by this permit.
- e. In accordance with the TWC § 26.029(b), after a public hearing, notice of which shall be given to the permittee, the Commission may require the permittee, from time to time, for good cause, in accordance with applicable laws, to conform to new or additional conditions.
- f. If any toxic effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is promulgated under CWA § 307(a) for a toxic pollutant which is present in the discharge and that standard or prohibition is more stringent than any limitation on the pollutant in this permit, this permit shall be

modified or revoked and reissued to conform to the toxic effluent standard or prohibition. The permittee shall comply with effluent standards or prohibitions established under CWA § 307(a) for toxic pollutants within the time provided in the regulations that established those standards or prohibitions, even if the permit has not yet been modified to incorporate the requirement.

5. Permit Transfer

- a. Prior to any transfer of this permit, Commission approval must be obtained. The Commission shall be notified in writing of any change in control or ownership of facilities authorized by this permit. Such notification should be sent to the Applications Review and Processing Team (MC 148) of the Water Quality Division.
- b. A permit may be transferred only according to the provisions of 30 TAC § 305.64 (relating to Transfer of Permits) and 30 TAC § 50.133 (relating to Executive Director Action on Application or WQMP update).

6. Relationship to Hazardous Waste Activities

This permit does not authorize any activity of hazardous waste storage, processing, or disposal that requires a permit or other authorization pursuant to the Texas Health and Safety Code.

7. Relationship to Water Rights

Disposal of treated effluent by any means other than discharge directly to water in the state must be specifically authorized in this permit and may require a permit pursuant to TWC Chapter 11.

8. Property Rights

A permit does not convey any property rights of any sort, or any exclusive privilege.

9. Permit Enforceability

The conditions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstances, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

10. Relationship to Permit Application

The application pursuant to which the permit has been issued is incorporated herein; provided, however, that in the event of a conflict between the provisions of this permit and the application, the provisions of the permit shall control.

11. Notice of Bankruptcy

- a. Each permittee shall notify the Executive Director, in writing, immediately following the filing of a voluntary or involuntary petition for bankruptcy under any chapter of Title 11 Bankruptcy) of the United States Code (11 USC) by or against:

- i. the permittee;
 - ii. an entity (as that term is defined in 11 USC, § 101(14)) controlling the permittee or listing the permit or permittee as property of the estate; or
 - iii. an affiliate (as that term is defined in 11 USC, § 101(2)) of the permittee.
- b. This notification must indicate:
- i. the name of the permittee and the permit number(s);
 - ii. the bankruptcy court in which the petition for bankruptcy was filed; and
 - iii. the date of filing of the petition.

OPERATIONAL REQUIREMENTS

1. The permittee shall at all times ensure that the facility and all of its systems of collection, treatment, and disposal are properly operated and maintained. This includes, but is not limited to, the regular, periodic examination of wastewater solids within the treatment plant by the operator in order to maintain an appropriate quantity and quality of solids inventory as described in the various operator training manuals and according to accepted industry standards for process control. Process control, maintenance, and operations records shall be retained at the facility site, or shall be readily available for review by a TCEQ representative, for a period of three years.
2. Upon request by the Executive Director, the permittee shall take appropriate samples and provide proper analysis in order to demonstrate compliance with Commission rules. Unless otherwise specified in this permit or otherwise ordered by the Commission, the permittee shall comply with all applicable provisions of 30 TAC Chapter 312 concerning sewage sludge use and disposal and 30 TAC §§ 319.21 - 319.29 concerning the discharge of certain hazardous metals.
3. Domestic wastewater treatment facilities shall comply with the following provisions:
 - a. The permittee shall notify the Municipal Permits Team, Wastewater Permitting Section (MC 148) of the Water Quality Division, in writing, of any facility expansion at least 90 days prior to conducting such activity.
 - b. The permittee shall submit a closure plan for review and approval to the Municipal Permits Team, Wastewater Permitting Section (MC 148) of the Water Quality Division, for any closure activity at least 90 days prior to conducting such activity. Closure is the act of permanently taking a waste management unit or treatment facility out of service and includes the permanent removal from service of any pit, tank, pond, lagoon, surface impoundment and/or other treatment unit regulated by this permit.
4. The permittee is responsible for installing prior to plant start-up, and subsequently maintaining, adequate safeguards to prevent the discharge of untreated or inadequately treated wastes during electrical power failures by means of alternate power sources, standby generators, and/or retention of inadequately treated wastewater.

5. Unless otherwise specified, the permittee shall provide a readily accessible sampling point and, where applicable, an effluent flow measuring device or other acceptable means by which effluent flow may be determined.
6. The permittee shall remit an annual water quality fee to the Commission as required by 30 TAC Chapter 21. Failure to pay the fee may result in revocation of this permit under TWC § 7.302(b)(6).
7. Documentation

For all written notifications to the Commission required of the permittee by this permit, the permittee shall keep and make available a copy of each such notification under the same conditions as self-monitoring data are required to be kept and made available. Except for information required for TPDES permit applications, effluent data, including effluent data in permits, draft permits and permit applications, and other information specified as not confidential in 30 TAC §§ 1.5(d), any information submitted pursuant to this permit may be claimed as confidential by the submitter. Any such claim must be asserted in the manner prescribed in the application form or by stamping the words confidential business information on each page containing such information. If no claim is made at the time of submission, information may be made available to the public without further notice. If the Commission or Executive Director agrees with the designation of confidentiality, the TCEQ will not provide the information for public inspection unless required by the Texas Attorney General or a court pursuant to an open records request. If the Executive Director does not agree with the designation of confidentiality, the person submitting the information will be notified.

8. Facilities that generate domestic wastewater shall comply with the following provisions; domestic wastewater treatment facilities at permitted industrial sites are excluded.
 - a. Whenever flow measurements for any domestic sewage treatment facility reach 75% of the permitted daily average or annual average flow for three consecutive months, the permittee must initiate engineering and financial planning for expansion and/or upgrading of the domestic wastewater treatment and/or collection facilities. Whenever the flow reaches 90% of the permitted daily average or annual average flow for three consecutive months, the permittee shall obtain necessary authorization from the Commission to commence construction of the necessary additional treatment and/or collection facilities. In the case of a domestic wastewater treatment facility which reaches 75% of the permitted daily average or annual average flow for three consecutive months, and the planned population to be served or the quantity of waste produced is not expected to exceed the design limitations of the treatment facility, the permittee shall submit an engineering report supporting this claim to the Executive Director of the Commission.

If in the judgment of the Executive Director the population to be served will not cause permit noncompliance, then the requirement of this section may be waived. To be effective, any waiver must be in writing and signed by the Director of the Enforcement Division (MC 169) of the Commission, and such waiver of these requirements will be reviewed upon expiration of the existing permit; however, any such waiver shall not be interpreted as condoning or excusing any violation of any permit parameter.

- b. The plans and specifications for domestic sewage collection and treatment works associated with any domestic permit must be approved by the Commission and failure to secure approval before commencing construction of such works or making a discharge is a violation of this permit and each day is an additional violation until approval has been secured.
 - c. Permits for domestic wastewater treatment plants are granted subject to the policy of the Commission to encourage the development of area-wide waste collection, treatment, and disposal systems. The Commission reserves the right to amend any domestic wastewater permit in accordance with applicable procedural requirements to require the system covered by this permit to be integrated into an area-wide system, should such be developed; to require the delivery of the wastes authorized to be collected in, treated by or discharged from said system, to such area-wide system; or to amend this permit in any other particular to effectuate the Commission's policy. Such amendments may be made when the changes required are advisable for water quality control purposes and are feasible on the basis of waste treatment technology, engineering, financial, and related considerations existing at the time the changes are required, exclusive of the loss of investment in or revenues from any then existing or proposed waste collection, treatment or disposal system.
9. Domestic wastewater treatment plants shall be operated and maintained by sewage plant operators holding a valid certificate of competency at the required level as defined in 30 TAC Chapter 30.
 10. For Publicly Owned Treatment Works (POTWs), the 30-day average (or monthly average) percent removal for BOD and TSS shall not be less than 85%, unless otherwise authorized by this permit.
 11. Facilities that generate industrial solid waste as defined in 30 TAC § 335.1 shall comply with these provisions:
 - a. Any solid waste, as defined in 30 TAC § 335.1 (including but not limited to such wastes as garbage, refuse, sludge from a waste treatment, water supply treatment plant or air pollution control facility, discarded materials, discarded materials to be recycled, whether the waste is solid, liquid, or semisolid), generated by the permittee during the management and treatment of wastewater, must be managed in accordance with all applicable provisions of 30 TAC Chapter 335, relating to Industrial Solid Waste Management.
 - b. Industrial wastewater that is being collected, accumulated, stored, or processed before discharge through any final discharge outfall, specified by this permit, is considered to be industrial solid waste until the wastewater passes through the actual point source discharge and must be managed in accordance with all applicable provisions of 30 TAC Chapter 335.
 - c. The permittee shall provide written notification, pursuant to the requirements of 30 TAC § 335.8(b)(1), to the Environmental Cleanup Section (MC 127) of the Remediation Division informing the Commission of any closure activity involving an Industrial Solid Waste Management Unit, at least 90 days prior to conducting such an activity.

- d. Construction of any industrial solid waste management unit requires the prior written notification of the proposed activity to the Registration and Reporting Section (MC 129) of the Registration, Review, and Reporting Division. No person shall dispose of industrial solid waste, including sludge or other solids from wastewater treatment processes, prior to fulfilling the deed recordation requirements of 30 TAC § 335.5.
- e. The term "industrial solid waste management unit" means a landfill, surface impoundment, waste-pile, industrial furnace, incinerator, cement kiln, injection well, container, drum, salt dome waste containment cavern, or any other structure vessel, appurtenance, or other improvement on land used to manage industrial solid waste.
- f. The permittee shall keep management records for all sludge (or other waste) removed from any wastewater treatment process. These records shall fulfill all applicable requirements of 30 TAC § 335 and must include the following, as it pertains to wastewater treatment and discharge:
 - i. Volume of waste and date(s) generated from treatment process;
 - ii. Volume of waste disposed of on-site or shipped off-site;
 - iii. Date(s) of disposal;
 - iv. Identity of hauler or transporter;
 - v. Location of disposal site; and
 - vi. Method of final disposal.

The above records shall be maintained on a monthly basis. The records shall be retained at the facility site, or shall be readily available for review by authorized representatives of the TCEQ for at least five years.

12. For industrial facilities to which the requirements of 30 TAC § 335 do not apply, sludge and solid wastes, including tank cleaning and contaminated solids for disposal, shall be disposed of in accordance with THSC § 361.

TCEQ Revision 08/2008

SLUDGE PROVISIONS

The permittee is authorized to dispose of sludge only at a Texas Commission on Environmental Quality (TCEQ) authorized land application site or co-disposal landfill. **The disposal of sludge by land application on property owned, leased or under the direct control of the permittee is a violation of the permit unless the site is authorized with the TCEQ. This provision does not authorize Distribution and Marketing of sludge. This provision does not authorize land application of Class A Sludge. This provision does not authorize the permittee to land apply sludge on property owned, leased or under the direct control of the permittee.**

SECTION I. REQUIREMENTS APPLYING TO ALL SEWAGE SLUDGE LAND APPLICATION**A. General Requirements**

1. The permittee shall handle and dispose of sewage sludge in accordance with 30 TAC § 312 and all other applicable state and federal regulations in a manner that protects public health and the environment from any reasonably anticipated adverse effects due to any toxic pollutants that may be present in the sludge.
2. In all cases, if the person (permit holder) who prepares the sewage sludge supplies the sewage sludge to another person for land application use or to the owner or lease holder of the land, the permit holder shall provide necessary information to the parties who receive the sludge to assure compliance with these regulations.
3. The permittee shall give 180 days prior notice to the Executive Director in care of the Wastewater Permitting Section (MC 148) of the Water Quality Division of any change planned in the sewage sludge disposal practice.

B. Testing Requirements

1. Sewage sludge shall be tested once during the term of this permit in accordance with the method specified in both 40 CFR Part 261, Appendix II and 40 CFR Part 268, Appendix I [Toxicity Characteristic Leaching Procedure (TCLP)] or other method that receives the prior approval of the TCEQ for the contaminants listed in 40 CFR Part 261.24, Table 1. Sewage sludge failing this test shall be managed according to RCRA standards for generators of hazardous waste, and the waste's disposition must be in accordance with all applicable requirements for hazardous waste processing, storage, or disposal. Following failure of any TCLP test, the management or disposal of sewage sludge at a facility other than an authorized hazardous waste processing, storage, or disposal facility shall be prohibited until such time as the permittee can demonstrate the sewage sludge no longer exhibits the hazardous waste toxicity characteristics (as demonstrated by the results of the TCLP tests). A written report shall be provided to both the TCEQ Registration and Reporting Section (MC 129) of the Permitting and Remediation Support Division and the Regional Director (MC Region 13) within seven (7) days after failing the TCLP Test.

The report shall contain test results, certification that unauthorized waste management has stopped and a summary of alternative disposal plans that comply with RCRA standards for the management of hazardous waste. The report shall be addressed to: Director, Registration, Review, and Reporting Division (MC 129), Texas Commission on Environmental Quality, P.O. Box 13087, Austin, Texas 78711-3087. In addition, the permittee shall prepare an annual report on the results of all sludge toxicity testing. This annual report shall be submitted to the TCEQ Regional Office (MC Region 13) and the Water Quality Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30 of each year.

2. Sewage sludge shall not be applied to the land if the concentration of the pollutants exceeds the pollutant concentration criteria in Table 1. The frequency of testing for pollutants in Table 1 is found in Section I.C.

TABLE 1

<u>Pollutant</u>	<u>Ceiling Concentration</u> (<u>Milligrams per kilogram</u>)*
Arsenic	75
Cadmium	85
Chromium	3000
Copper	4300
Lead	840
Mercury	57
Molybdenum	75
Nickel	420
PCBs	49
Selenium	100
Zinc	7500

* Dry weight basis

3. Pathogen Control

All sewage sludge that is applied to agricultural land, forest, a public contact site, or a reclamation site shall be treated by one of the following methods to ensure that the sludge meets either the Class A or Class B pathogen requirements.

- a. Six alternatives are available to demonstrate compliance with Class A sewage sludge. The first 4 options require either the density of fecal coliform in the sewage sludge be less than 1000 Most Probable Number (MPN) per gram of total solids (dry weight basis), or the density of Salmonella sp. bacteria in the sewage sludge be less than three MPN per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed. Below are the additional requirements necessary to meet the definition of a Class A sludge.

Alternative 1 - The temperature of the sewage sludge that is used or disposed shall be maintained at or above a specific value for a period of time. See 30 TAC § 312.82(a)(2)(A) for specific information.

Alternative 2 - The pH of the sewage sludge that is used or disposed shall be raised to above 12 std. units and shall remain above 12 std. units for 72 hours.

The temperature of the sewage sludge shall be above 52° Celsius for 12 hours or longer during the period that the pH of the sewage sludge is above 12 std. units.

At the end of the 72-hour period during which the pH of the sewage sludge is above 12 std. units, the sewage sludge shall be air dried to achieve a percent solids in the sewage sludge greater than 50%.

Alternative 3 - The sewage sludge shall be analyzed for enteric viruses prior to pathogen treatment. The limit for enteric viruses is less than one Plaque-forming Unit per four grams of total solids (dry weight basis) either before or following pathogen treatment. See 30 TAC § 312.82(a)(2)(C)(i-iii) for specific information. The sewage sludge shall be analyzed for viable helminth ova prior to pathogen treatment. The limit for viable helminth ova is less than one per four grams of total solids (dry weight basis) either before or following pathogen treatment. See 30 TAC § 312.82(a)(2)(C)(iv-vi) for specific information.

Alternative 4 - The density of enteric viruses in the sewage sludge shall be less than one Plaque-forming Unit per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed. The density of viable helminth ova in the sewage sludge shall be less than one per four grams of total solids (dry weight basis) at the time the sewage sludge is used or disposed.

Alternative 5 (PFRP) - Sewage sludge that is used or disposed of shall be treated in one of the processes to Further Reduce Pathogens (PFRP) described in 40 CFR Part 503, Appendix B. PFRP include composting, heat drying, heat treatment, and thermophilic aerobic digestion.

Alternative 6 (PFRP Equivalent) - Sewage sludge that is used or disposed of shall be treated in a process that has been approved by the U.S. Environmental Protection Agency as being equivalent to those in Alternative 5.

- b. Three alternatives are available to demonstrate compliance with Class B criteria for sewage sludge.

Alternative 1

- i. A minimum of seven random samples of the sewage sludge shall be collected within 48 hours of the time the sewage sludge is used or disposed of during each monitoring episode for the sewage sludge.
- ii. The geometric mean of the density of fecal coliform in the samples collected shall be less than either 2,000,000 MPN per gram of total solids (dry weight basis) or 2,000,000 Colony Forming Units per gram of total solids (dry weight basis).

Alternative 2 - Sewage sludge that is used or disposed of shall be treated in one of the Processes to Significantly Reduce Pathogens (PSRP) described in 40 CFR Part 503, Appendix B, so long as all of the following requirements are met by the generator of the sewage sludge.

- i. Prior to use or disposal, all the sewage sludge must have been generated from a single location, except as provided in paragraph v. below;
- ii. An independent Texas Licensed Professional Engineer must make a certification to the generator of a sewage sludge that the wastewater treatment facility generating the sewage sludge is designed to achieve one of the PSRP at the permitted design loading of the facility. The certification need only be repeated if the design loading of the facility is increased. The certification shall include a statement indicating the design meets all the applicable standards specified in Appendix B of 40 CFR Part 503;
- iii. Prior to any off-site transportation or on-site use or disposal of any sewage sludge generated at a wastewater treatment facility, the chief certified operator of the wastewater treatment facility or other responsible official who manages the processes to significantly reduce pathogens at the wastewater treatment facility for the permittee, shall certify that the sewage sludge underwent at least the minimum operational requirements necessary in order to meet one of the PSRP. The acceptable processes and the minimum operational and record keeping requirements shall be in accordance with established U.S. Environmental Protection Agency final guidance;
- iv. All certification records and operational records describing how the requirements of this paragraph were met shall be kept by the generator for a minimum of three years and be available for inspection by commission staff for review; and
- v. If the sewage sludge is generated from a mixture of sources, resulting from a person who prepares sewage sludge from more than one wastewater treatment facility, the resulting derived product shall meet one of the PSRP, and shall meet the certification, operation, and record keeping requirements of this paragraph.

Alternative 3 - Sewage sludge shall be treated in an equivalent process that has been approved by the U.S. Environmental Protection Agency, so long as all of the following requirements are met by the generator of the sewage sludge.

- i. Prior to use or disposal, all the sewage sludge must have been generated from a single location, except as provided in paragraph v. below;
- ii. Prior to any off-site transportation or on-site use or disposal of any sewage sludge generated at a wastewater treatment facility, the chief certified operator of the wastewater treatment facility or other responsible official who manages the processes to significantly reduce pathogens at the wastewater treatment facility for the permittee, shall certify that the sewage sludge underwent at least the minimum operational requirements necessary in order to meet one of the PSRP. The acceptable processes and the minimum operational and record keeping requirements shall be in accordance with established U.S. Environmental Protection Agency final guidance;
- iii. All certification records and operational records describing how the requirements of this paragraph were met shall be kept by the generator for a minimum of three years and be available for inspection by commission staff for review;

- iv. The Executive Director will accept from the U.S. Environmental Protection Agency a finding of equivalency to the defined PSRP; and
- v. If the sewage sludge is generated from a mixture of sources resulting from a person who prepares sewage sludge from more than one wastewater treatment facility, the resulting derived product shall meet one of the Processes to Significantly Reduce Pathogens, and shall meet the certification, operation, and record keeping requirements of this paragraph.

In addition, the following site restrictions must be met if Class B sludge is land applied:

- i. Food crops with harvested parts that touch the sewage sludge/soil mixture and are totally above the land surface shall not be harvested for 14 months after application of sewage sludge.
 - ii. Food crops with harvested parts below the surface of the land shall not be harvested for 20 months after application of sewage sludge when the sewage sludge remains on the land surface for 4 months or longer prior to incorporation into the soil.
 - iii. Food crops with harvested parts below the surface of the land shall not be harvested for 38 months after application of sewage sludge when the sewage sludge remains on the land surface for less than 4 months prior to incorporation into the soil.
 - iv. Food crops, feed crops, and fiber crops shall not be harvested for 30 days after application of sewage sludge.
 - v. Animals shall not be allowed to graze on the land for 30 days after application of sewage sludge.
 - vi. Turf grown on land where sewage sludge is applied shall not be harvested for 1 year after application of the sewage sludge when the harvested turf is placed on either land with a high potential for public exposure or a lawn.
 - vii. Public access to land with a high potential for public exposure shall be restricted for 1 year after application of sewage sludge.
 - viii. Public access to land with a low potential for public exposure shall be restricted for 30 days after application of sewage sludge.
 - ix. Land application of sludge shall be in accordance with the buffer zone requirements found in 30 TAC § 312.44.
4. Vector Attraction Reduction Requirements

All bulk sewage sludge that is applied to agricultural land, forest, a public contact site, or a reclamation site shall be treated by one of the following Alternatives 1 through 10 for vector attraction reduction.

- Alternative 1 - The mass of volatile solids in the sewage sludge shall be reduced by a minimum of 38%.
- Alternative 2 - If Alternative 1 cannot be met for an anaerobically digested sludge, demonstration can be made by digesting a portion of the previously digested sludge anaerobically in the laboratory in a bench-scale unit for 40 additional days at a temperature between 30° and 37° Celsius. Volatile solids must be reduced by less than 17% to demonstrate compliance.
- Alternative 3 - If Alternative 1 cannot be met for an aerobically digested sludge, demonstration can be made by digesting a portion of the previously digested sludge with percent solids of two percent or less aerobically in the laboratory in a bench-scale unit for 30 additional days at 20° Celsius. Volatile solids must be reduced by less than 15% to demonstrate compliance.
- Alternative 4 - The specific oxygen uptake rate (SOUR) for sewage sludge treated in an aerobic process shall be equal to or less than 1.5 milligrams of oxygen per hour per gram of total solids (dry weight basis) at a temperature of 20° Celsius.
- Alternative 5 - Sewage sludge shall be treated in an aerobic process for 14 days or longer. During that time, the temperature of the sewage sludge shall be higher than 40° Celsius and the average temperature of the sewage sludge shall be higher than 45° Celsius.
- Alternative 6 - The pH of sewage sludge shall be raised to 12 or higher by alkali addition and, without the addition of more alkali shall remain at 12 or higher for two hours and then remain at a pH of 11.5 or higher for an additional 22 hours at the time the sewage sludge is prepared for sale or given away in a bag or other container.
- Alternative 7 - The percent solids of sewage sludge that does not contain unstabilized solids generated in a primary wastewater treatment process shall be equal to or greater than 75% based on the moisture content and total solids prior to mixing with other materials. Unstabilized solids are defined as organic materials in sewage sludge that have not been treated in either an aerobic or anaerobic treatment process.
- Alternative 8 - The percent solids of sewage sludge that contains unstabilized solids generated in a primary wastewater treatment process shall be equal to or greater than 90% based on the moisture content and total solids prior to mixing with other materials at the time the sludge is used. Unstabilized solids are defined as organic materials in sewage sludge that have not been treated in either an aerobic or anaerobic treatment process.
- Alternative 9 -
- i. Sewage sludge shall be injected below the surface of the land.
 - ii. No significant amount of the sewage sludge shall be present on

the land surface within one hour after the sewage sludge is injected.

- iii. When sewage sludge that is injected below the surface of the land is Class A with respect to pathogens, the sewage sludge shall be injected below the land surface within eight hours after being discharged from the pathogen treatment process.

Alternative 10-

- i. Sewage sludge applied to the land surface or placed on a surface disposal site shall be incorporated into the soil within six hours after application to or placement on the land.
- ii. When sewage sludge that is incorporated into the soil is Class A with respect to pathogens, the sewage sludge shall be applied to or placed on the land within eight hours after being discharged from the pathogen treatment process.

C. Monitoring Requirements

- Toxicity Characteristic Leaching Procedure (TCLP) Test - once during the term of this permit
- PCBs - once during the term of this permit

All metal constituents and fecal coliform or Salmonella sp. bacteria shall be monitored at the appropriate frequency shown below, pursuant to 30 TAC § 312.46(a)(1):

<u>Amount of sewage sludge (*) metric tons per 365-day period</u>	<u>Monitoring Frequency</u>
0 to less than 290	Once/Year
290 to less than 1,500	Once/Quarter
1,500 to less than 15,000	Once/Two Months
15,000 or greater	Once/Month

() The amount of bulk sewage sludge applied to the land (dry wt. basis).*

Representative samples of sewage sludge shall be collected and analyzed in accordance with the methods referenced in 30 TAC § 312.7

SECTION II. REQUIREMENTS SPECIFIC TO BULK SEWAGE SLUDGE FOR APPLICATION TO THE LAND MEETING CLASS A or B PATHOGEN REDUCTION AND THE CUMULATIVE LOADING RATES IN TABLE 2, OR CLASS B PATHOGEN REDUCTION AND THE POLLUTANT CONCENTRATIONS IN TABLE 3

For those permittees meeting Class A or B pathogen reduction requirements and that meet the cumulative loading rates in Table 2 below, or the Class B pathogen reduction requirements and contain concentrations of pollutants below listed in Table 3, the following conditions apply:

A. Pollutant Limits

Table 2

<u>Pollutant</u>	<u>Cumulative Pollutant Loading Rate (pounds per acre)*</u>
Arsenic	36
Cadmium	35
Chromium	2677
Copper	1339
Lead	268
Mercury	15
Molybdenum	Report Only
Nickel	375
Selenium	89
Zinc	2500

Table 3

<u>Pollutant</u>	<u>Monthly Average Concentration (milligrams per kilogram)*</u>
Arsenic	41
Cadmium	39
Chromium	1200
Copper	1500
Lead	300
Mercury	17
Molybdenum	Report Only
Nickel	420
Selenium	36
Zinc	2800

*Dry weight basis

B. Pathogen Control

All bulk sewage sludge that is applied to agricultural land, forest, a public contact site, a reclamation site, shall be treated by either Class A or Class B pathogen reduction requirements as defined above in Section I.B.3.

C. Management Practices

1. Bulk sewage sludge shall not be applied to agricultural land, forest, a public contact site, or a reclamation site that is flooded, frozen, or snow-covered so that the bulk sewage sludge enters a wetland or other waters in the State.
2. Bulk sewage sludge not meeting Class A requirements shall be land applied in a manner which complies with the Management Requirements in accordance with 30 TAC § 312.44.
3. Bulk sewage sludge shall be applied at or below the agronomic rate of the cover crop.
4. An information sheet shall be provided to the person who receives bulk sewage sludge sold or given away. The information sheet shall contain the following information:
 - a. The name and address of the person who prepared the sewage sludge that is sold or given away in a bag or other container for application to the land.
 - b. A statement that application of the sewage sludge to the land is prohibited except in accordance with the instruction on the label or information sheet.
 - c. The annual whole sludge application rate for the sewage sludge application rate for the sewage sludge that does not cause any of the cumulative pollutant loading rates in Table 2 above to be exceeded, unless the pollutant concentrations in Table 3 found in Section II above are met.

D. Notification Requirements

1. If bulk sewage sludge is applied to land in a State other than Texas, written notice shall be provided prior to the initial land application to the permitting authority for the State in which the bulk sewage sludge is proposed to be applied. The notice shall include:
 - a. The location, by street address, and specific latitude and longitude, of each land application site.
 - b. The approximate time period bulk sewage sludge will be applied to the site.
 - c. The name, address, telephone number, and National Pollutant Discharge Elimination System permit number (if appropriate) for the person who will apply the bulk sewage sludge.
2. The permittee shall give 180 days prior notice to the Executive Director in care of the Wastewater Permitting Section (MC 148) of the Water Quality Division of any change planned in the sewage sludge disposal practice.

E. Record keeping Requirements

The sludge documents will be retained at the facility site and/or shall be readily available for review by a TCEQ representative. The person who prepares bulk sewage sludge or a sewage sludge material shall develop the following information and shall retain the information at

the facility site and/or shall be readily available for review by a TCEQ representative for a period of five years. If the permittee supplies the sludge to another person who land applies the sludge, the permittee shall notify the land applier of the requirements for record keeping found in 30 TAC § 312.47 for persons who land apply.

1. The concentration (mg/kg) in the sludge of each pollutant listed in Table 3 above and the applicable pollutant concentration criteria (mg/kg), or the applicable cumulative pollutant loading rate and the applicable cumulative pollutant loading rate limit (lbs/ac) listed in Table 2 above.
2. A description of how the pathogen reduction requirements are met (including site restrictions for Class B sludge, if applicable).
3. A description of how the vector attraction reduction requirements are met.
4. A description of how the management practices listed above in Section II.C are being met.
5. The following certification statement:

“I certify, under penalty of law, that the applicable pathogen requirements in 30 TAC § 312.82(a) or (b) and the vector attraction reduction requirements in 30 TAC § 312.83(b) have been met for each site on which bulk sewage sludge is applied. This determination has been made under my direction and supervision in accordance with the system designed to ensure that qualified personnel properly gather and evaluate the information used to determine that the management practices have been met. I am aware that there are significant penalties for false certification including fine and imprisonment.”
6. The recommended agronomic loading rate from the references listed in Section II.C.3. above, as well as the actual agronomic loading rate shall be retained. The person who applies bulk sewage sludge or a sewage sludge material shall develop the following information and shall retain the information at the facility site and/or shall be readily available for review by a TCEQ representative indefinitely. If the permittee supplies the sludge to another person who land applies the sludge, the permittee shall notify the land applier of the requirements for record keeping found in 30 TAC § 312.47 for persons who land apply:
 - a. A certification statement that all applicable requirements (specifically listed) have been met, and that the permittee understands that there are significant penalties for false certification including fine and imprisonment. See 30 TAC § 312.47(a)(4)(A)(ii) or 30 TAC § 312.47(a)(5)(A)(ii), as applicable, and to the permittee's specific sludge treatment activities.
 - b. The location, by street address, and specific latitude and longitude, of each site on which sludge is applied.
 - c. The number of acres in each site on which bulk sludge is applied.
 - d. The date and time sludge is applied to each site.

- e. The cumulative amount of each pollutant in pounds/acre listed in Table 2 applied to each site.
- f. The total amount of sludge applied to each site in dry tons.

The above records shall be maintained on-site on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

F. Reporting Requirements

The permittee shall report annually to the TCEQ Regional Office (MC Region 13) and Water Quality Compliance Monitoring Team (MC 224) of the Enforcement Division, by September 30 of each year the following information:

1. Results of tests performed for pollutants found in either Table 2 or 3 as appropriate for the permittee's land application practices.
2. The frequency of monitoring listed in Section I.C. that applies to the permittee.
3. Toxicity Characteristic Leaching Procedure (TCLP) results.
4. Identity of hauler(s) and TCEQ transporter number.
5. PCB concentration in sludge in mg/kg.
6. Date(s) of disposal.
7. Owner of disposal site(s).
8. Texas Commission on Environmental Quality registration number, if applicable.
9. Amount of sludge disposal dry weight (lbs/acre) at each disposal site.
10. The concentration (mg/kg) in the sludge of each pollutant listed in Table 1 (defined as a monthly average) as well as the applicable pollutant concentration criteria (mg/kg) listed in Table 3 above, or the applicable pollutant loading rate limit (lbs/acre) listed in Table 2 above if it exceeds 90% of the limit.
11. Level of pathogen reduction achieved (Class A or Class B).
12. Alternative used as listed in Section I.B.3.(a. or b.). Alternatives describe how the pathogen reduction requirements are met. If Class B sludge, include information on how site restrictions were met.
13. Vector attraction reduction alternative used as listed in Section I.B.4.
14. Annual sludge production in dry tons/year.
15. Amount of sludge land applied in dry tons/year.
16. The certification statement listed in either 30 TAC § 312.47(a)(4)(A)(ii) or 30 TAC § 312.47(a)(5)(A)(ii) as applicable to the permittee's sludge treatment activities, shall be attached to the annual reporting form.

17. When the amount of any pollutant applied to the land exceeds 90% of the cumulative pollutant loading rate for that pollutant, as described in Table 2, the permittee shall report the following information as an attachment to the annual reporting form.
 - a. The location, by street address, and specific latitude and longitude.
 - b. The number of acres in each site on which bulk sewage sludge is applied.
 - c. The date and time bulk sewage sludge is applied to each site.
 - d. The cumulative amount of each pollutant (i.e., pounds/acre) listed in Table 2 in the bulk sewage sludge applied to each site.
 - e. The amount of sewage sludge (i.e., dry tons) applied to each site.

The above records shall be maintained on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

**SECTION III. REQUIREMENTS APPLYING TO ALL SEWAGE SLUDGE
DISPOSED IN A MUNICIPAL SOLID WASTE LANDFILL**

- A. The permittee shall handle and dispose of sewage sludge in accordance with 30 TAC § 330 and all other applicable state and federal regulations to protect public health and the environment from any reasonably anticipated adverse effects due to any toxic pollutants that may be present. The permittee shall ensure that the sewage sludge meets the requirements in 30 TAC § 330 concerning the quality of the sludge disposed in a municipal solid waste landfill.
- B. If the permittee generates sewage sludge and supplies that sewage sludge to the owner or operator of a municipal solid waste landfill (MSWLF) for disposal, the permittee shall provide to the owner or operator of the MSWLF appropriate information needed to be in compliance with the provisions of this permit.
- C. The permittee shall give 180 days prior notice to the Executive Director in care of the Wastewater Permitting Section (MC 148) of the Water Quality Division of any change planned in the sewage sludge disposal practice.
- D. Sewage sludge shall be tested once during the term of this permit in accordance with the method specified in both 40 CFR Part 261, Appendix II and 40 CFR Part 268, Appendix I (Toxicity Characteristic Leaching Procedure) or other method, which receives the prior approval of the TCEQ for contaminants listed in Table 1 of 40 CFR § 261.24. Sewage sludge failing this test shall be managed according to RCRA standards for generators of hazardous waste, and the waste's disposition must be in accordance with all applicable requirements for hazardous waste processing, storage, or disposal.

Following failure of any TCLP test, the management or disposal of sewage sludge at a facility other than an authorized hazardous waste processing, storage, or disposal facility shall be prohibited until such time as the permittee can demonstrate the sewage sludge no longer exhibits the hazardous waste toxicity characteristics (as demonstrated by the results of the TCLP tests). A written report shall be provided to both the TCEQ Registration and Reporting Section (MC 129) of the Permitting and Remediation Support Division and the Regional Director (MC Region 13) of the appropriate TCEQ field office within 7 days after failing the TCLP Test.

The report shall contain test results, certification that unauthorized waste management has stopped and a summary of alternative disposal plans that comply with RCRA standards for the management of hazardous waste. The report shall be addressed to: Director, Registration, Review, and Reporting Division (MC 129), Texas Commission on Environmental Quality, P. O. Box 13087, Austin, Texas 78711-3087. In addition, the permittee shall prepare an annual report on the results of all sludge toxicity testing. This annual report shall be submitted to the TCEQ Regional Office (MC Region 13) and the Water Quality Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30 of each year.

- E. Sewage sludge shall be tested as needed, in accordance with the requirements of 30 TAC Chapter 330.
- F. Record keeping Requirements

The permittee shall develop the following information and shall retain the information for five years.

1. The description (including procedures followed and the results) of all liquid Paint Filter Tests performed.
2. The description (including procedures followed and results) of all TCLP tests performed.

The above records shall be maintained on-site on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

G. Reporting Requirements

The permittee shall report annually to the TCEQ Regional Office (MC Region 13) and Water Quality Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30 of each year the following information:

1. Toxicity Characteristic Leaching Procedure (TCLP) results.
2. Annual sludge production in dry tons/year.
3. Amount of sludge disposed in a municipal solid waste landfill in dry tons/year.
4. Amount of sludge transported interstate in dry tons/year.
5. A certification that the sewage sludge meets the requirements of 30 TAC § 330 concerning the quality of the sludge disposed in a municipal solid waste landfill.
6. Identity of hauler(s) and transporter registration number.
7. Owner of disposal site(s).
8. Location of disposal site(s).
9. Date(s) of disposal.

The above records shall be maintained on-site on a monthly basis and shall be made available to the Texas Commission on Environmental Quality upon request.

OTHER REQUIREMENTS

1. The permittee shall employ or contract with one or more licensed wastewater treatment facility operators or wastewater system operations companies holding a valid license or registration according to the requirements of 30 TAC Chapter 30, Occupational Licenses and Registrations and in particular 30 TAC Chapter 30, Subchapter J, Wastewater Operators and Operations Companies.

This Category C facility must be operated by a chief operator or an operator holding a Category C license or higher. The facility must be operated a minimum of five days per week by the licensed chief operator or an operator holding the required level of license or higher. The licensed chief operator or operator holding the required level of license or higher must be available by telephone or pager seven days per week. Where shift operation of the wastewater treatment facility is necessary, each shift which does not have the on-site supervision of the licensed chief operator must be supervised by an operator in charge who is licensed not less than one level below the category for the facility.

2. The facility is not located in the Coastal Management Program boundary.
3. The permittee is hereby placed on notice that this permit may be reviewed by the TCEQ after the completion of any new intensive water quality survey on Segment No. 1908 of the San Antonio River Basin and any subsequent updating of the water quality model for Segment No. 1908, in order to determine if the limitations and conditions contained herein are consistent with any such revised model. The permit may be amended, pursuant to 30 TAC § 305.62, as a result of such review. The permittee is also hereby placed on notice that effluent limits may be made more stringent at renewal based on, for example, any change to modeling protocol approved in the TCEQ Continuing Planning Process.
4. On May 15, 2014 and May 22, 2014, the permittee submitted sufficient evidence of legal restrictions prohibiting residential structures within the part of the buffer zone not owned by the permittee according to 30 TAC § 309.13(e)(3). The evidence of legal restrictions shall be submitted to the Executive Director in care of the TCEQ Wastewater Permitting Section (MC 148). The permittee shall comply with the requirements of 30 TAC § 309.13(a) through (d). (See Attachment A and Attachment B.)

Prior to construction of the Final phase wastewater treatment facilities, the permittee shall submit sufficient evidence of legal restrictions prohibiting residential structures within the part of the buffer zone not owned by the permittee according to 30 TAC § 309.13(e)(3). The evidence of legal restrictions shall be submitted to the Executive Director in care of the TCEQ Wastewater Permitting Section (MC 148). The permittee shall comply with the requirements of 30 TAC § 309.13(a) through (d).

5. Reporting requirements according to 30 TAC Sections 319.1-319.11 and any additional effluent reporting requirements contained in this permit are suspended from the effective date of the permit until plant startup or discharge, whichever occurs first, from the facility described by this permit. The permittee shall provide written notice to the TCEQ Regional Office (MC Region 13) and the Applications Review and Processing Team (MC 148) of the Water Quality Division at least forty-five (45) days prior to plant startup or anticipated discharge, whichever occurs first and prior to completion of each additional phase on Notification of Completion Form 20007.

6. Prior to construction of the Interim I, Interim II and Final phase wastewater treatment facilities, the permittee shall submit to the TCEQ Wastewater Permitting Section (MC 148) a summary submittal letter in accordance with the requirements in 30 TAC Section 217.6(c). If requested by the Wastewater Permitting Section, the permittee shall submit plans, specifications and a final engineering design report which comply with 30 TAC Chapter 217, Design Criteria for Wastewater Treatment Systems. The permittee shall clearly show how the treatment system will meet the final permitted effluent limitations required on Page 2, 2a and 2b of the permit.
7. The permittee is authorized to haul sludge from the wastewater treatment facility, by a licensed hauler, to the Texas Organic Recovery Composting Facility, TCEQ Permit No. 42016, or any other facility authorized by the TCEQ to accept sludge, for final processing and disposal.

The permittee shall keep records of all sludge removed from the wastewater treatment plant site and these records shall include the following information:

- a. The volume of sludge hauled;
- b. The date(s) that sludge was hauled;
- c. The identity of haulers; and
- d. The permittee, TCEQ permit number, and location of the facility to which the sludge is hauled.

These records shall be maintained on a monthly basis and shall be reported to the TCEQ Regional Office (MC Region 13) and the TCEQ Water Quality Compliance Monitoring Team (MC 224) of the Enforcement Division by September 30 of each year.


8. In accordance with 30 TAC §319.9, a permittee that has at least twelve months of uninterrupted compliance with its bacteria limit may notify the commission in writing of its compliance and request a less frequent measurement schedule. To request a less frequent schedule, the permittee shall submit a written request to the TCEQ Wastewater Permitting Section (MC 148) for each phase that includes a different monitoring frequency. The request must contain all of the reported bacteria values (Daily Avg. and Daily Max/Single Grab) for the twelve consecutive months immediately prior to the request. If the Executive Director finds that a less frequent measurement schedule is protective of human health and the environment, the permittee may be given a less frequent measurement schedule. For this permit, 1/quarter may be reduced to 1/6 months in the Interim I phase and 1/month may be reduced to 1/quarter in the Interim II and Final phases. **A violation of any bacteria limit by a facility that has been granted a less frequent measurement schedule will require the permittee to return to the standard frequency schedule and submit written notice to the TCEQ Wastewater Permitting Section (MC 148).** The permittee may not apply for another reduction in measurement frequency for at least 24 months from the date of the last violation. The Executive Director may establish a more frequent measurement schedule if necessary to protect human health or the environment.

CONTRIBUTING INDUSTRIES AND PRETREATMENT REQUIREMENTS

1. The following pollutants may not be introduced into the treatment facility:
 - a. Pollutants which create a fire or explosion hazard in the publicly owned treatment works (POTW), including, but not limited to, waste streams with a closed cup flashpoint of less than 140 degrees Fahrenheit (60 degrees Celsius) using the test methods specified in 40 CFR § 261.21;
 - b. Pollutants which will cause corrosive structural damage to the POTW, but in no case shall there be discharges with pH lower than 5.0 standard units, unless the works are specifically designed to accommodate such discharges;
 - c. Solid or viscous pollutants in amounts which will cause obstruction to the flow in the POTW, resulting in Interference;
 - d. Any pollutant, including oxygen demanding pollutants (e.g., BOD), released in a discharge at a flow rate and/or pollutant concentration which will cause Interference with the POTW;
 - e. Heat in amounts which will inhibit biological activity in the POTW resulting in Interference but in no case shall there be heat in such quantities that the temperature at the POTW treatment plant exceeds 104 degrees Fahrenheit (40 degrees Celsius) unless the Executive Director, upon request of the POTW, approves alternate temperature limits;
 - f. Petroleum oil, non-biodegradable cutting oil, or products of mineral oil origin in amounts that will cause Interference or Pass Through;
 - g. Pollutants which result in the presence of toxic gases, vapors, or fumes within the POTW in a quantity that may cause acute worker health and safety problems; and
 - h. Any trucked or hauled pollutants, except at discharge points designated by the POTW.
2. The permittee shall require any indirect discharger to the treatment works to comply with the reporting requirements of Sections 204(b), 307, and 308 of the Clean Water Act, including any requirements established under 40 CFR Part 403[*rev. Federal Register/ Vol. 70/ No. 198/ Friday, October 14, 2005/ Rules and Regulations, pages 60134-60798*].
3. The permittee shall provide adequate notification to the Executive Director care of the Wastewater Permitting Section (MC 148) of the Water Quality Division within 30 days subsequent to the permittee's knowledge of either of the following:
 - a. Any new introduction of pollutants into the treatment works from an indirect discharger which would be subject to Sections 301 and 306 of the Clean Water Act if it were directly discharging those pollutants; and
 - b. Any substantial change in the volume or character of pollutants being introduced into the treatment works by a source introducing pollutants into the treatment works at the time of issuance of the permit.

Any notice shall include information on the quality and quantity of effluent to be introduced into the treatment works, and any anticipated impact of the change on the quality or quantity of effluent to be discharged from the POTW.

Revised July 2007

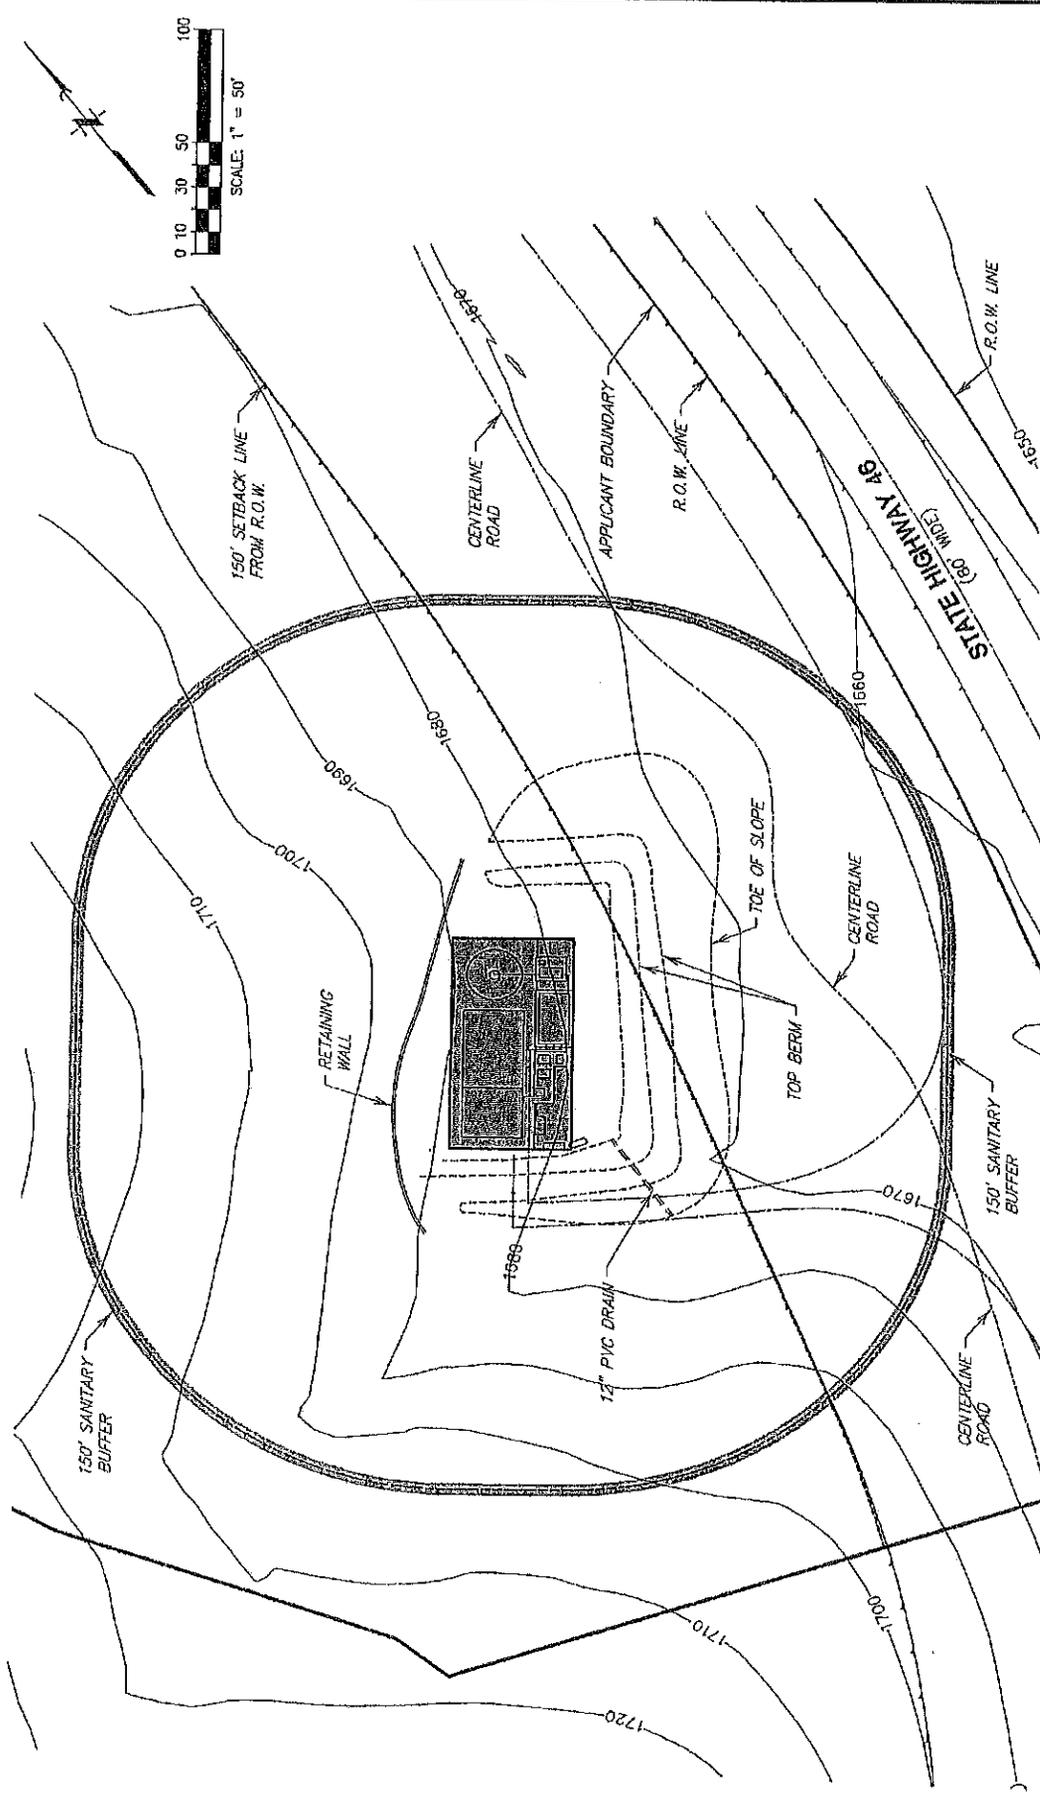


WQ0014712001
 Lerin Hills Municipal Utility District
 Interim I and II Phase
 Attachment A

LEGEND	
	WASTEWATER TREATMENT UNIT
	150' SANITARY BUFFER
	AERIAL CONTOURS
	PROPOSED WWTP SITE BOUNDARY

JONES & CARTER, INC.
 ENGINEERS • PLANNERS • SURVEYORS
 Texas Board of Professional Engineers Registration No. F-459
 1000 Central Parkway N., Suite 100
 San Antonio, Texas 78232-5030
 TEL 210 494 4511
 FAX 210 494 5519

© 2014 Jones & Carter, Inc. All rights reserved. This drawing is the property of Jones & Carter, Inc. and is not to be reproduced or used in any manner without the written consent of Jones & Carter, Inc.




SCALE: 1" = 40'

EXHIBIT
OF
WWTP SITE WITH BUFFER
AT
LERIN HILLS DEVELOPMENT

J.C. JONES & CARTER, INC.
LAND SURVEYORS, PLANNERS - SURVEYORS
Texas Board of Professional Engineers Registration No. 7-499
1000 Central Parkway N., Suite 100
San Antonio, Texas 78232-5050
TEL. 210 494 5311
FAX 210 494 5319

5/17/2004

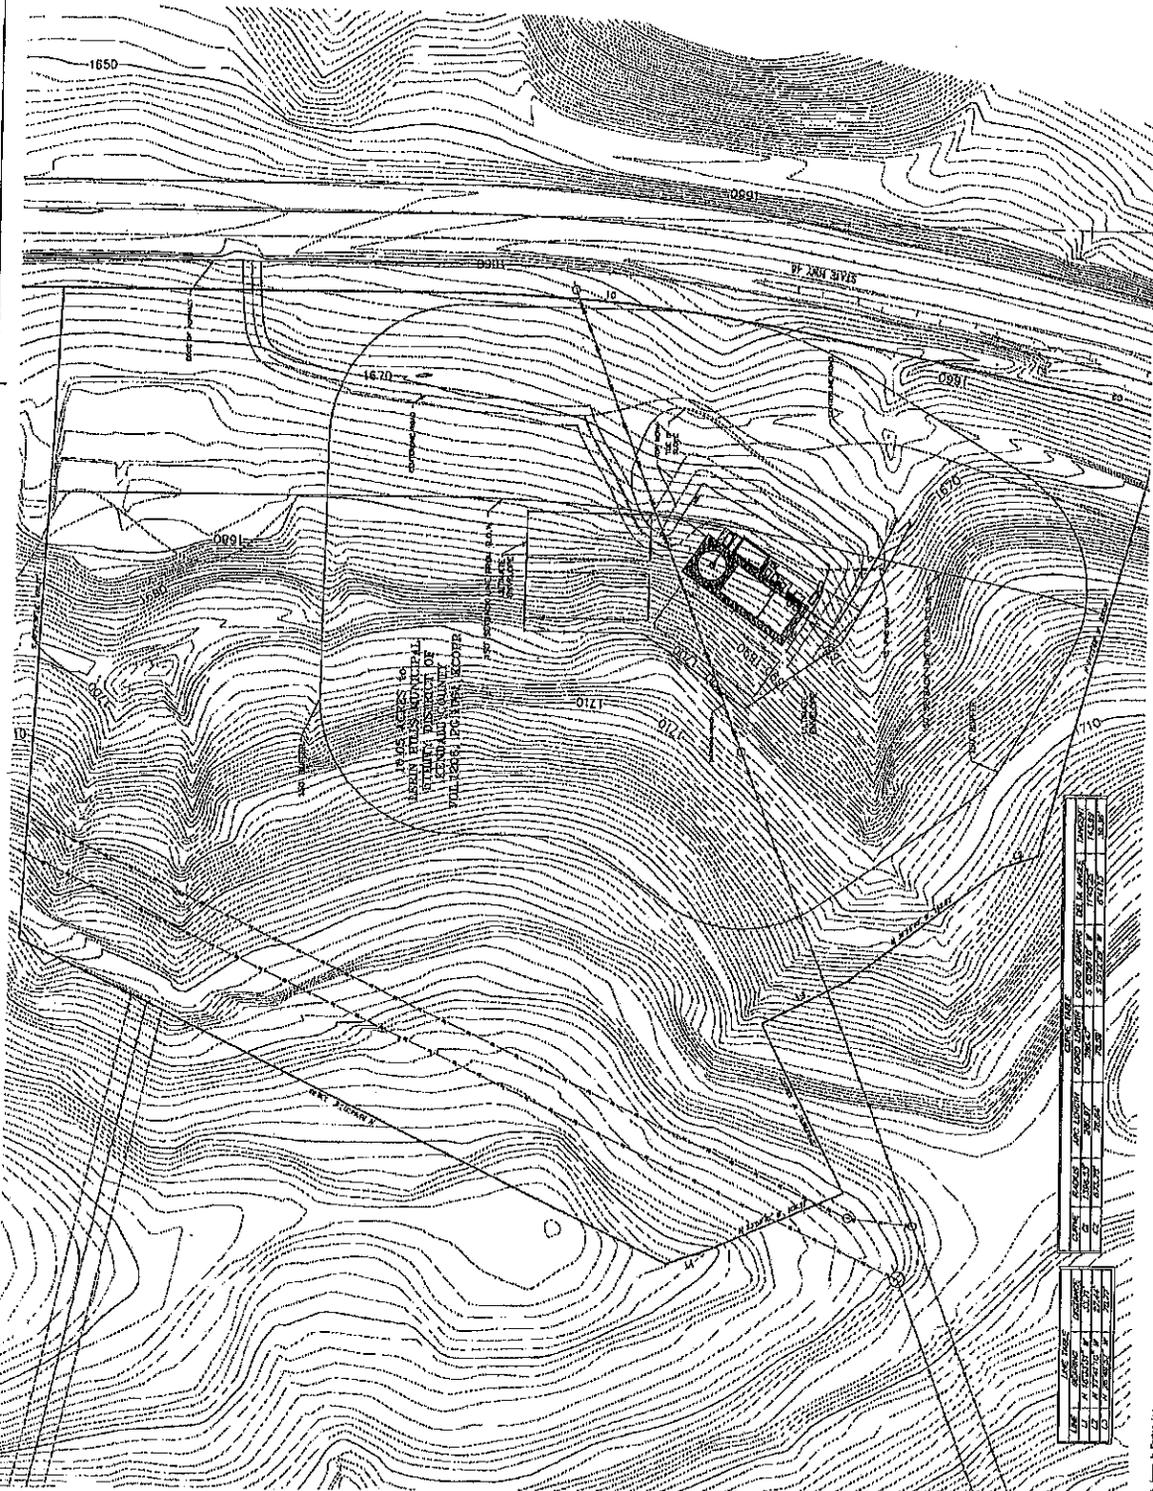

PLACES TO
BE REMOVED
FROM THE
PROPERTY OF
LERIN HILLS DEVELOPMENT
TOTAL AREA TO BE REMOVED

NO.	DESCRIPTION	AREA (SQ. FT.)	PERCENT	TOTAL
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50

WQ0014712001
Lerin Hills Municipal Utility District
Final Phase
Attachment B

Attachment D
to Lerin Hills Municipal Utility District's
Response to Hearing Requests
Tear Sheets from Newspaper Notices

TCEQ-OFFICE OF THE CHIEF CLERK
MC-105 Attn: Notice Team
P.O. BOX 13087
AUSTIN, TX 78711-3087

Applicant Name: Lerin Hills Municipal Utility District
Permit No.: WQ0014712001
Notice of Intent to Obtain Permit

**PUBLISHER'S AFFIDAVIT
FOR WATER QUALITY PERMITS**

STATE OF TEXAS §
COUNTY OF Kendall §

Before me, the undersigned authority, on this day personally appeared
Brian Cartwright who being by me duly sworn, deposes
(name of person representing newspaper)

and says that (s)he is the Publisher
(title of person representing newspaper)

of the The Boerne Star; that this newspaper is a newspaper of
(name of newspaper)

largest circulation in Kendall County, Texas or is
(name of county)

a newspaper of general circulation in Boerne,
(name of municipality)


Texas; and that the enclosed notice was published in said newspaper on the following date(s):

4/29/14
[Signature]
(newspaper representative's signature)

Subscribed and sworn to before me this the 29 day of April, 2014.

Kolleen M. Roe
Notary Public in and for the State of Texas

(Seal)



Kolleen M. Roe
Print or Type Name of Notary Public

My Commission Expires 11/1/2016

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



NOTICE OF RECEIPT OF APPLICATION AND INTENT TO OBTAIN WATER QUALITY PERMIT RENEWAL

Permit No. WQ0014712001

APPLICATION. Lerin Hills Municipal Utility District, 1108 Lavaca Street, Suite 510, Austin, Texas 78701, has applied to the Texas Commission on Environmental Quality (TCEQ) to renew Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0014712001 (EPA I.D. No. TX0128767) to authorize the discharge of treated wastewater at a volume not to exceed a daily average flow of 490,000 gallons per day. The domestic wastewater treatment facility is located on the north side of State Highway 46, approximately 4.1 miles west of Interstate Highway 10, as measured along State Highway 46, northeast of Deep Hollow Drive, in Kendall County, Texas 78006. The discharge route is from the plant site to an unnamed tributary; thence to the headwaters of an impoundment on Deep Hollow Creek; thence to Deep Hollow Creek; thence to Frederick Creek; thence to Upper Cibolo Creek. TCEQ received this application on November 13, 2013. The permit application is available for viewing and copying at the Patrick Heath Public Library, 451 North Main Street, Building 100, Boerne, Kendall County, Texas. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For exact location, refer to application. <http://www.tceq.texas.gov/assets/public/hb610/index.html?lat=29.766833&lng=-98.709222&zooom=13&type=r>

ADDITIONAL NOTICE. TCEQ's Executive Director has determined the application is administratively complete and will conduct a technical review of the application. After technical review of the application is complete, the Executive Director may prepare a draft permit and will issue a preliminary decision on the application. Notice of the Application and Preliminary Decision will be published and mailed to those who are on the county-wide mailing list and to those who are on the mailing list for this application. That notice will contain the deadline for submitting public comments.

PUBLIC COMMENT / PUBLIC MEETING. You may submit public comments or request a public meeting on this application. The purpose of a public meeting is to provide the opportunity to submit comments or to ask questions about the application. TCEQ will hold a public meeting if the Executive Director determines that there is a significant degree of public interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

OPPORTUNITY FOR A CONTESTED CASE HEARING. After the deadline for submitting public comments, the Executive Director will consider all timely comments and prepare a response to all relevant and material, or significant public comments. Unless the application is directly referred for a contested case hearing, the response to comments, and the Executive Director's decision on the application, will be mailed to everyone who submitted public comments and to those persons who are on the mailing list for this application. If comments are received, the mailing will also provide instructions for requesting reconsideration of the Executive Director's decision and for requesting a contested case hearing. A contested case hearing is a legal proceeding similar to a civil trial in state district court.

TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST: your name, address, phone number; applicant's name and proposed permit number; the location and distance of your property/activities relative to the proposed facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; and, the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are relevant to the group's purpose.

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

The Commission will only grant a contested case hearing on disputed issues of fact that are relevant and material to the Commission's decision on the application. Further, the Commission will only grant a hearing on issues that were raised in timely filed comments that were not subsequently withdrawn. TCEQ may act on an application to renew a permit for discharge of wastewater without providing an opportunity for a contested case hearing if certain criteria are met.

MAILING LIST. If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be placed on: (1) the permanent mailing list for a specific applicant name and permit number; and/or (2) the mailing list for a specific county. If you wish to be placed on the permanent and/or the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

AGENCY CONTACTS AND INFORMATION. All written public comments and requests must be submitted to the Office of the Chief Clerk, MC 109, TCEQ, P.O. Box 13087, Austin, TX 78711-3087 or electronically at www.tceq.texas.gov/about/comments.html. If you need more information about this permit application or the permitting process, please call TCEQ Public Education Program, Toll Free, at 1-800-687-4040. Si desea información en Español, puede llamar al 1-800-687-4040. General information about TCEQ can be found at our web site at www.tceq.texas.gov.

Further information may also be obtained from Lerin Hills Municipal Utility District at the address stated above or by calling Mr. Mark S. Brown, P.E., Jones & Carter, Inc., at 210-494-5511.

Issuance Date: April 11, 2014

TCEQ-OFFICE OF THE CHIEF CLERK
MC-105 Attn: Notice Team
PO BOX 13087
AUSTIN TX 78711-3087

APPLICANT NAME: LERIN HILLS MUD
PERMIT NO.: WQ0014712001
CCO#: 91982
NOTICE OF APPLICATION AND
PRELIMINARY DECISION

ALTERNATIVE LANGUAGE PUBLISHER'S AFFIDAVIT

STATE OF TEXAS §

COUNTY OF Kendall §

Before me, the undersigned authority, on this day personally appeared

Frank Shubert, who being by me duly
(name of person representing newspaper)

sworn, deposes and says that (s)he is the Marketing Director
(title of person representing newspaper)

of the The Boerne Star; that this newspaper is
(name of newspaper)

generally circulated in Kendall County, Texas,
(same county as proposed facility)

and is published primarily in Spanish language;
(alternative language)

the enclosed notice was published in said newspaper on the following date(s):

7/11/14
(date or dates, of publication in the newspaper)

[Signature]
Newspaper Representative's Signature

Subscribed and sworn to before me this the 17 day of July,
2014, to certify which witness my hand and seal of office.

(Seal)



Kolleen M. Roe
Notary Public in and for the State of Texas

Kolleen M. Roe
Print or Type Name of Notary Public

My Commission Expires 11/1/2016

AUCTIONS

PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICES

PUBLIC NOTICES

ATTENTION CO. GADGETS

Auction
Items for auction
come by your
appointment only.

OR:
JEWELRY | DESIGNER PURSES
SERVING TRAYS & SETS
PREFERABLY COMPLETE
ACCESSORIES | RECLINERS
LIVING ROOM FURNITURE
BOATING OUTDOOR EQUIPMENT
WELDING EQUIPMENT
WELCOMED TO ADD ITEMS
(NO LIQUOR ITEMS)
(GOOD CONDITION)

PACK & SHIP SERVICE

saddleauction.com
p. TX Lic# 17290
830.895.1554
(Merchandise)

GARAGE SALES

Multi-family
Sale, 139 Lilly
Creek, Herff
Ranch Subdiv,
Fri & Sat, 7am-
? Ping pong
table, furniture,
housewares,
clothes, toys,
dog crate.

HUGE SALE,
305 Los Indios
Ranch Rd on
Hwy 46 East,
7/12 from 9am-
1pm.

Multi-family
Sale, 109 Calk
Ln, Sat. 7/12
8am-1pm. China
hutch, Pack
n Play, child
bike, side table,
toys, adult and
child clothes,
kitchenware,
household misc.

Quilter's Sale,
120 Calk Lane,
Saturday 7/12.

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



NOTICE OF APPLICATION AND PRELIMINARY DECISION FOR TPDES PERMIT FOR MUNICIPAL WASTEWATER RENEWAL

PERMIT NO. WQ0014712001

APPLICATION AND PRELIMINARY DECISION. Lerin Hills Municipal Utility District, 1108 Lavaca Street, Suite 510, Austin, Texas 78701, has applied to the Texas Commission on Environmental Quality (TCEQ) for a renewal of Texas Pollution Discharge Elimination System (TPDES) Permit No. WQ0014712001, which authorizes the discharge of treated domestic wastewater at a daily average flow not to exceed 490,000 gallons per day. TCEQ received this application on November 11, 2013.

The facility will be located on the north side of State Highway 46, approximately 4.1 miles west of Interstate Highway 10, as measured along State Highway 46, northeast of Deep Hollow Drive in Kendall County, Texas 78006. The treated effluent will be discharged to an unnamed tributary; thence to the headwaters of an impoundment on Deep Hollow Creek (Soil Conservation Service (SCS) Site 4 Reservoir); thence to Deep Hollow Creek; thence to Frederick Creek; thence to Upper Cibolo Creek in Segment No. 1908 of the San Antonio River Basin. The unclassified receiving water uses are minimal aquatic life use for the unnamed tributary and high aquatic life use for SCS Site #4 Reservoir and Deep Hollow Creek. The designated uses for Segment No. 1908 are high aquatic life use, public water supply, aquifer protection, and primary contact recreation. All determinations are preliminary and subject to additional review and/or revisions.

The TCEQ Executive Director has completed the technical review of the application and prepared a draft permit. The draft permit, if approved, would establish the conditions under which the facility must operate. The Executive Director has made a preliminary decision that this permit, if issued, meets all statutory and regulatory requirements. The permit application, Executive Director's preliminary decision, and draft permit are available for viewing and copying at the Patrick Heath Public Library, 451 North Main Street, Building 100, Boerne, Kendall County, Texas. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For exact location, refer to application.

<http://www.tceq.texas.gov/assets/public/hb610/index.html?lat=29.260833&lng=-98.292222&zoom=13&tupe=r>

PUBLIC COMMENT / PUBLIC MEETING. You may submit public comments or request a public meeting about this application. The purpose of a public meeting is to provide the opportunity to submit comments or to ask questions about the application. TCEQ holds a public meeting if the Executive Director determines that there is a significant degree of public interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

OPPORTUNITY FOR A CONTESTED CASE HEARING. After the deadline for submitting public comments, the Executive Director will consider all timely comments and prepare a response to all relevant and material, or significant public comments. Unless the application is directly referred for a contested case hearing, the response to comments will be mailed to everyone who submitted

9am-4pm and Sunday, 7/13, 9am-2pm. Horn cabinet and caddie still in box, sewing machines, accessories, sergers, fabric, books and patterns, and more! Great prices, great variety!

Moving Sale, 29824 Windchime Hill, Fair Oaks Ranch, July 12, 8am-2pm. Games, crafts, new carpet rolls.

Multi-family Garage Sale, 502 E James St, 7/12, starting at 8am.

MOVING SALE!
358 Chaparral Creek Dr, Friday and Saturday, July 11 & 12, 8am - 5pm.
Microwave, LazyBoy dual recliner/love seat, upholstered chair, vacuum cleaner, dining room table with 6 chairs, toaster oven, Bissell Steam Mo, 40" Yamaha "Portable Grand" Keyboard, Metal Bistro Set, clothes, shoes. Household items, and MUCH MORE!

118 First St, Saturday, 7am-2pm. Antique sink and dining room, table, other misc.

Yard Sale, 7611 Cheryl Dianne Cir, Leon Springs, July 12, 8am-4pm.

102 Lauren Ln, Saturday, 8am-12pm. Furniture & misc.

public comments and to those persons who are on the mailing list for this application. If comments are received, the mailing will also provide instructions for requesting a contested case hearing or reconsideration of the Executive Director's decision. A contested case hearing is a legal proceeding similar to a civil trial in a state district court.

TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST: your name; address, phone number; applicant's name and permit number; the location and distance of your property/activities relative to the facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; and the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are germane to the group's purpose.

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

The Commission will only grant a contested case hearing on disputed issues of fact that are relevant and material to the Commission's decision on the application. Further, the Commission will only grant a hearing on issues that were raised in timely filed comments that were not subsequently withdrawn. **TCEQ may act on an application to renew a permit for discharge of wastewater without providing an opportunity for a contested case hearing if certain criteria are met.**

EXECUTIVE DIRECTOR ACTION. The Executive Director may issue final approval of the application unless a timely contested case hearing request or request for reconsideration is filed. If a timely hearing request or request for reconsideration is filed, the Executive Director will not issue final approval of the permit and will forward the application and request to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

MAILING LIST. If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be placed on: (1) the permanent mailing list for a specific applicant name and permit number; and/or (2) the mailing list for a specific county. If you wish to be placed on the permanent and/or the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

All written public comments and public meeting requests must be submitted to the Office of the Chief Clerk, MC 105, Texas Commission on Environmental Quality, P.O. Box 13087, Austin, TX 78711-3087 or electronically at www.tceq.texas.gov/about/comments.html within 30 days from the date of newspaper publication of this notice.

AGENCY CONTACTS AND INFORMATION. If you need more information about this permit application or the permitting process, please call the TCEQ Public Education Program, Toll Free, at 1-800-687-4040. Si desea informaci6n en Espaol, puede Hamar al 1-800-687- 4040. General information about the TCEQ can be found at our web site at www.TCEO.texas.gov.

Further information may also be obtained from Lerin Hills Municipal Utility District at the address stated above or by calling Mr. Mark S. Brown, P.E., Jones & Carter, Inc. at (210) 494- 5511.

Issuance Date: June 19, 2014



Attachment E
to Lerin Hills Municipal Utility District's
Response to Hearing Requests
Executive Director's Response to Public Comment

TCEQ PERMIT NO. WQ0014712001

**APPLICATION BY
LERIN HILLS MUNICIPAL
UTILITY DISTRICT**

**§
§
§**

**BEFORE THE
TEXAS COMMISSION ON
ENVIRONMENTAL QUALITY**

EXECUTIVE DIRECTOR'S RESPONSE TO PUBLIC COMMENT

The Executive Director (ED) of the Texas Commission on Environmental Quality (the Commission or TCEQ) files this Response to Public Comment (Response) on the Executive Director's preliminary decision to approve Lerin Hills Municipal Utility District's (Lerin Hills) application to renew its existing Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0014712001. As required by 30 Texas Administrative Code (TAC) Section 55.156, before a permit is issued, the Executive Director prepares a response to all timely, relevant and material, or significant comments. The Office of Chief Clerk received a timely comment letter from William "Rick" Wood. This response addresses all timely filed public comments received, whether or not withdrawn.

BACKGROUND

A. Description of Facility

Lerin Hills applied to the TCEQ for a renewal of its existing permit that authorizes it to discharge treated domestic wastewater at a daily average flow not to exceed 490,000 gallons per day. The existing permit was issued August 28, 2009; however, the facility has not been constructed. The facility will be located on the north

side of State Highway 46, approximately 4.1 miles west of the Interstate Highway 10, as measured along State Highway 46, northeast of Deep Hollow Drive in Kendall County, Texas 78006. The proposed wastewater treatment facility will serve the Lerin Hills Subdivision.

The treated effluent will be discharged to an unnamed tributary; then to the headwaters of an impoundment on Deep Hollow Creek (Soil Conservation Service (SCS) Site #4 Reservoir); then to Deep Hollow Creek; then to Frederick Creek; then to Upper Cibolo Creek in Segment No. 1908 of the San Antonio River Basin.. The unclassified receiving water uses are minimal aquatic life use for the unnamed tributary and high aquatic life use for SCS Site #4 Reservoir and Deep Hollow Creek. The designated uses for Segment No. 1908 are high aquatic life use, public water supply, aquifer protection, and primary contact recreation.

B. Procedural Background

The TCEQ received Lerin Hills' application to renew its TPDES permit on November 13, 2013 and declared it administratively complete on April 11, 2014. The Notice of Receipt and Intent to Obtain a Water Quality Permit (NORI) was published in English and Spanish on April 29, 2014, in the *Boerne Star*. The ED completed the technical review of the application and prepared an initial TPDES draft permit. The Notice of Application and Preliminary Decision (NAPD) was published in English and Spanish on July 11, 2014 in the *Boerne Star*. The public comment period ended on August 11, 2014. This application was administratively complete on or after September

1, 1999; therefore, this application is subject to the procedural requirements adopted pursuant to House Bill 801, 76th Legislature, 1999.

C. Access to Rules, Laws, and Records

Please consult the following websites to access the rules and regulations applicable to this permit:

- Secretary of State website: www.sos.state.tx.us;
- TCEQ rules in Title 30 of the Texas Administrative Code:
www.sos.state.tx.us/tac/;
- Texas statutes: <http://www.capitol.state.tx.us>;
- TCEQ website: <http://www.tceq.state.tx.us/>
- Federal environmental laws and rules: www2.epa.gov/laws-regulations.

Commission records for this facility are available for viewing and copying and are located at TCEQ's main office in Austin, 12100 Park 35 Circle, Building F, 1st Floor (Office of Chief Clerk).

If you need more information about this permit application or the wastewater permitting process, please call the TCEQ Office of Public Participation and Education Program at 1-800-687-4040. General information about the TCEQ can be found at our website at www.tceq.state.tx.us. The permit application, ED's preliminary decision, and draft permit are available for viewing and copying at the Patrick Heath Public Library, 451 North Main Street, Building 100, Boerne, Kendall County, Texas.

COMMENTS AND RESPONSES

COMMENT 1:

Rick Wood stated that there was no deadline posted for public comment in the publication for public notice of the Lerin Hills TPDES permit renewal.

RESPONSE 1:

The deadline for providing public comment is included in the Notice of Application and Preliminary Decision (NAPD) and on the TCEQ's website. TCEQ's rules provide that notice must be provided by publication and by mail, and such notice shall specify a deadline to file public comment when applicable.¹ The applicant is required to publish two notices. The first notice, the Notice of Receipt and Intent to Obtain a Water Quality Permit (NORI), must be published no later than 30 days after the executive director deems an application administratively complete.² Lerin Hills published the NORI in the *Boerne Star* on April 29, 2014.

The second notice, the Notice of Application and Preliminary Decision (NAPD) for a Water Quality Permit, must be published after the chief clerk has mailed the preliminary decision to the applicant.³ Lerin Hills published the NAPD in the *Boerne Star* on July 11, 2014. Given that Lerin Hills applied for a permit renewal, mailed notice is not required to adjacent or downstream landowners.⁴ However, the NAPD must set a deadline to file public comment with the chief clerk that is not less than 30 days after

¹ 30 TEX. ADMIN. CODE §39.9

² 30 TEX. ADMIN. CODE §39.551 (b)(1).

³ *Id.* §39.551 (c).

⁴ *Id.* §39.551 (b)(2)(A).

the newspaper publication.⁵ According to the NAPD published by Lerin Hills, the deadline for public comments and public meeting requests was specified in the *Boerne Star* on July 11, 2014.

Additionally, information regarding the application process, including the deadline to file comments can be found on TCEQ's website at:

<http://www14.tceq.texas.gov/epic/eCID/>.

COMMENT 2:

Rick Wood commented that the application to discharge treated domestic wastewater into Deep Hollow Creek within one mile upstream of three recreational lakes has not been adequately evaluated.

RESPONSE 2:

The downstream impoundments, whether small or large, will be protected by the aquatic life assessment. To develop the proposed permit, the ED considered the discharge route from the outfall to the first classified segment and determined that if the Lerin Hills wastewater treatment facility is operated according to the permit and TCEQ's rules, the downstream impoundments will be protected. TCEQ has a standard review process for all domestic discharge permit applications received. The Lerin Hills application was reviewed in the standard review process. It was administratively reviewed by the Applications Review and Processing Team, and technically reviewed by

⁵ 30 TEX. ADMIN. CODE §55.152 (a).

the Water Quality Standards Implementation Team, the Water Quality Assessment Team, the Pretreatment Team, and the Municipal Permits Team.

The treated effluent from the Lerin Hills wastewater treatment facility will be discharged to an unnamed tributary, then to the headwaters of an impoundment on Deep Hollow Creek; then to Deep Hollow Creek; then to Frederick Creek; then to Upper Cibolo Creek in Segment No. 1908 of the San Antonio River Basin. The unclassified receiving water uses are minimal aquatic life use for the unnamed tributary and high aquatic life use for SCS Site #4 Reservoir and Deep Hollow Creek. The designated uses for Segment No. 1908 are high aquatic life use, public water supply, aquifer protection, and primary contact recreation.

As part of the review process, the ED performed a dissolved oxygen analysis of the discharge and determined that effluent limits of 5 mg/L carbonaceous oxygen demand (5-day), 1.0 mg/L ammonia nitrogen and 6.0 mg/L dissolved oxygen demand are predicted to maintain dissolved oxygen levels above the criteria for the unnamed tributary.

COMMENT 3:

Rick Wood expressed concern about the quantity and quality of treated effluent flowing down Deep Hollow Creek which recharges the shallow groundwater contained in the Karst geology of the Trinity Aquifer.

RESPONSE 3:

The Water Quality Division of TCEQ has determined that the protective limits that are required in the issued permit are in accordance with the Texas Surface Water Quality Standards, which ensures that the wastewater effluent discharge is protective of aquatic life, human health, and the environment.⁶ The review process for surface water quality is conducted by the Standards Implementation Team and Water Quality Assessment Team surface water modelers. According to the *Texas Groundwater Protection Strategy*, AS-188, if the surface water quality is protected, then the groundwater quality in the vicinity will not be impacted by the discharge. The ED has determined that if Lerin Hills complies with the effluent limitations set forth in the proposed permit and the surface water quality is protected, the groundwater quality in the vicinity of the discharge route will not be impacted by the wastewater effluent discharge.

COMMENT 4:

Rick Wood stated that the location of the discharge route would increase the likelihood of contaminating the groundwater which would diminish the value and use of his property as well as others in the area.

RESPONSE 4:

As discussed in Response 3, the ED has determined that if Lerin Hills complies with the effluent limitations set forth in the proposed permit and the surface water

⁶ 30 TEX. ADMIN. CODE §307.

quality is protected, the groundwater quality in the vicinity of the discharge route will not be impacted by the wastewater effluent discharge.

The TCEQ does not have jurisdiction to review the effect, if any, the location of the discharge route might have on property values and tax assessments of surrounding landowners in reviewing a domestic wastewater discharge permit application.

COMMENT 5:

Rick Wood expressed concern about the proximity of Lerin Hills to his property and asserted that the resulting odors would adversely affect the value and enjoyment of his personal residence.

RESPONSE 5:

TCEQ rules require domestic wastewater treatment facilities to meet buffer zone requirements for the abatement and control of nuisance odors according to 30 TAC Section 309.13(e). These rules provide three options for applicants to use to satisfy the nuisance odor abatement and control requirement. The Applicant can meet this requirement by owning the buffer zone area, by obtaining a restrictive easement from the adjacent property owner(s) for any part of the buffer zone not owned by the Applicant, or by providing odor control.⁷ Lerin Hills intends to meet the buffer zone requirements by obtaining restrictive easements. Other Requirement No. 4 in the permit requires Lerin Hills, to submit sufficient evidence of legal restrictions prohibiting

⁷ 30 TEX. ADMIN. CODE § 309.13(e)(3).

residential structures within the part of the buffer zone it does not own prior to construction of the wastewater treatment facilities not owned by the permittee.⁸

If anyone experiences nuisance odor conditions or any other suspected incidents of noncompliance with the permit or TCEQ rules they may contact the TCEQ Regional Office at 210-490-3096 or at the toll free, 24-hour complaints hotline at 1-888-777-3186. Citizen complaints may also be filed on-line at <http://www.tceq.state.tx.us/compliance/complaints>. TCEQ staff investigates violations in response to complaints. If the regional investigator documents a violation of TCEQ regulations or the permit, then appropriate action may be taken, including enforcement.

COMMENT 6:

Rick Wood stated that the treated effluent destroys fish habitat in the surrounding lakes and streams no matter the degree of restrictions imposed on the discharge quality and results in phosphate loading.

RESPONSE 6:

The proposed permit was developed to protect aquatic life and human health in accordance with the Texas Surface Water Quality Standards and was established to be protective of human health and the environment provided the Applicant operates and maintains the facility according to TCEQ rules and the requirements in the permit. As part of the permit application process, TCEQ must determine the uses of the receiving water and set effluent limits that are protective of those uses.

⁸ See Page 31 of the proposed permit.

The effluent limits in the proposed permit are set to maintain and protect the existing instream uses. In this case, the receiving stream uses are high aquatic life uses, public water supply, aquifer protection, and contact recreation. The ED has determined that these uses should be protected given that Lerin Hills will be operated and maintained as required by the proposed permit and applicable regulations. The stringent treatment levels proposed for the Lerin Hills discharge permit are expected to remove the pollutants of concern and maintain high dissolved oxygen concentrations downstream so that the propagation and consumption of fish will be protected. In addition to the usual effluent limitations, 0.5mg/L total phosphorus limits were added to the permit to ensure that nutrient levels do not become elevated to levels that might lead to excessive algal or aquatic vegetation growth⁹.

COMMENT 7:

Rick Wood stated the applicant has not presented a compelling need to discharge effluent into Deep Hollow Creek.

RESPONSE 7:

TCEQ has a standard review process for all discharge permits applications received. When the TCEQ receives an application for a new permit or major amendment to a permit, the Applicant is required to provide documents demonstrating a justification for the Applicant's permit request. There is no requirement that the Applicant provide justification for a renewal application unless there are unbuilt phases

⁹ See Page 2a of the proposed permit.

contained in the existing permit that have not been constructed in the past five years. Lerin Hills was required by the ED to provide a justification for the continued need for the unbuilt phases in its application for the TDPES permit renewal.

COMMENT 8:

Rick Wood expressed concerned that the alternative to discharging the wastewater onto the applicant's property through land application was not taken into consideration in the permit review process.

RESPONSE 8:

The ED evaluates applications for wastewater treatment plants, based on the information provided in the application, and the existing quality of the water body. The ED evaluates the method of treatment and the discharge routes that were proposed in the application to determine if they are protective of human health and the environment, and whether there is compliance with the applicable rules. The ED does not have the authority to mandate a different discharge method for the treated wastewater.

If Lerin Hills opts to reuse its treated effluent it must obtain authorization under 30 TAC Chapter 210. However, before an entity can obtain a 30 TAC Chapter 210 authorization, it must have a wastewater permit that provides for an alternative means

of disposal during times when there is no demand for the use of the reclaimed water.¹⁰

The Chapter 210 authorization is a separate authorization.

COMMENT 9:

Rick Wood suggested that the applicant sell the discharge effluent to Tapatio Springs for use on their golf course.

RESPONSE 9:

The Texas Water Code authorizes the TCEQ to issue permits for discharges into water in the state.¹¹ While the ED encourages the beneficial reuse of effluent from treated domestic wastewater, he does not have the authority to mandate beneficial reuse of treated wastewater. As discussed in Response 8, if Lerin Hills opts to sell its treated wastewater to Tapatio Springs, or any other entity, the effluent must meet certain conditions, and Lerin Hills must have a valid permit.¹²

COMMENT 10:

Rick Wood suggested that the applicant regionalize the treatment of wastewater by combining the resources of Kendall West Utility Company with Lerin Hills MUD to create one regional wastewater treatment plant on Fredericks Creek.

RESPONSE 10:

Information regarding regionalization is not required for applications to renew existing permits; however, as required by Section 26.081(a) of the Texas Water Code,

¹⁰ 30 TEX. ADMIN. CODE §210.1.

¹¹ TEX. WATER CODE §26.027.

¹² 30 TEX. ADMIN. CODE §210.

information concerning the regionalization was required by the ED during the review process of the new permit application submitted by Lerin Hills on May 3, 2006. Kendall West Utility, LLC submitted an application for a new TPDES permit proposing to discharge into the Fredericks Creek on October 1, 2013 and withdrew the application on February 7, 2014.

CHANGES MADE TO THE DRAFT PERMIT IN RESPONSE TO COMMENT


No changes to the draft permit have been made in response to public comment.

Respectfully submitted,

Texas Commission on Environmental Quality

Richard A. Hyde, P.E.
Executive Director

Robert Martinez, Director
Environmental Law Division




Ashley McDonald, Staff Attorney
Environmental Law Division
State Bar No. 24086775
P.O. Box 13087, MC 173
Austin, Texas 78711-3087

(512) 239-1283
REPRESENTING THE
EXECUTIVE DIRECTOR OF THE
TEXAS COMMISSION ON
ENVIRONMENTAL QUALITY

CERTIFICATE OF SERVICE

I certify that on October 9, 2014, the "Executive Director's Response to Public Comment" for Permit No. WQ0014712001 was filed with the Texas Commission on Environmental Quality's Office of Chief Clerk.



Ashley S. McDonald, Staff Attorney
Environmental Law Division
State Bar No. 24086775

Attachment F
to Lerin Hills Municipal Utility District's
Response to Hearing Requests

TCEQ Compliance History Report for
Lerin Hills MUD Wastewater Treatment Plant



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SITE SEARCH:

please enter search phrase

SUBJECT INDEX

> Air >Water >Waste

> Search TCEQ Data

> Agency Organization Map

The list below is not sorted.

Compliance History for Customer at this Site (If no Site appears in the same row, this is the Customer's overall compliance history.)									
Site Associated with This Customer									
Customer Name	City or Nearest City	County	TCEQ Region	Related Numbers	Rating	Classification	Date Rated	Date Posted	
LERIN HILLS LTD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ WQ0014712001 ■ WQ0014712001 	0		09/01/2008	
LERIN HILLS MUD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ TX0128767 ■ WQ0014712001 ■ WQ0014712001 ■ TX0128767 ■ R14712001 ■ R14712001 ■ R14712001 	0	HIGH	09/01/2010	11/15/2014
LERIN HILLS LTD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ TX0128767 ■ R14712001 	0		09/01/2009	
LERIN HILLS MUD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ WQ0014712001 ■ R14712001 	0	HIGH	09/01/2014	11/15/2014
LERIN HILLS LTD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ TX0128767 	0		09/01/2009	
LERIN HILLS MUD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ TX0128767 	0	HIGH	09/01/2012	11/15/2014
LERIN HILLS LTD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ R14712001 	0		09/01/2008	
LERIN HILLS MUD	LERIN HILLS MUD WWTP	BOERNE	KENDALL	REGION 13 - SAN ANTONIO	<ul style="list-style-type: none"> ■ R14712001 ■ WQ0014712001 ■ TX0128767 ■ WQ0014712001 	0	HIGH	09/01/2011	11/15/2014

■ TX0128767

What's a "site"?

A "site" (sometimes called a "regulated entity") is any person or thing that is of environmental interest to the TCEQ. At a "site", one or more regulatory activities of interest to us occur or have occurred in the past. Some examples of sites are:

- Industrial plants, such as the Exxon Baytown Facility
- Small businesses, such as Texaco Gas Station #200 or Elroy's Dry Cleaning & Laundry
- Public facilities, such as the City of Austin's Hornsby Bend Wastewater Treatment Plant

What's a "customer"?

A "customer" owns, operates, is responsible for, or is affiliated with a regulated entity. Examples include:

- Major industrial corporations, such as Exxon USA, Exxon Inc, or Texaco Inc
- Small businesses, such as Karl Redmond dba Karl's Kleaners, which owns several dry-cleaner locations
- Governmental bodies, such as the City of Austin, the United States Air Force, or a municipal utility district
- Individuals, such as Karl A. Redmond, owner of Karl Redmond dba Karl's Kleaners

[Return to top](#)

[Get a list of compliance histories](#)

Learn more [about compliance histories](#)

Questions? E-mail comphist@tceq.texas.gov

[Return to search form](#)