






**Below is a flowchart describing 30 TAC Ch. 117, Subch. B, Division 1: ICI Boilers. It will likely not be accessible using a screen reader. For the text of the statute/rule, please go to [30 TAC Chapter 117, Subchapter B, Division 1: ICI Boilers](#) (1 of 67)**

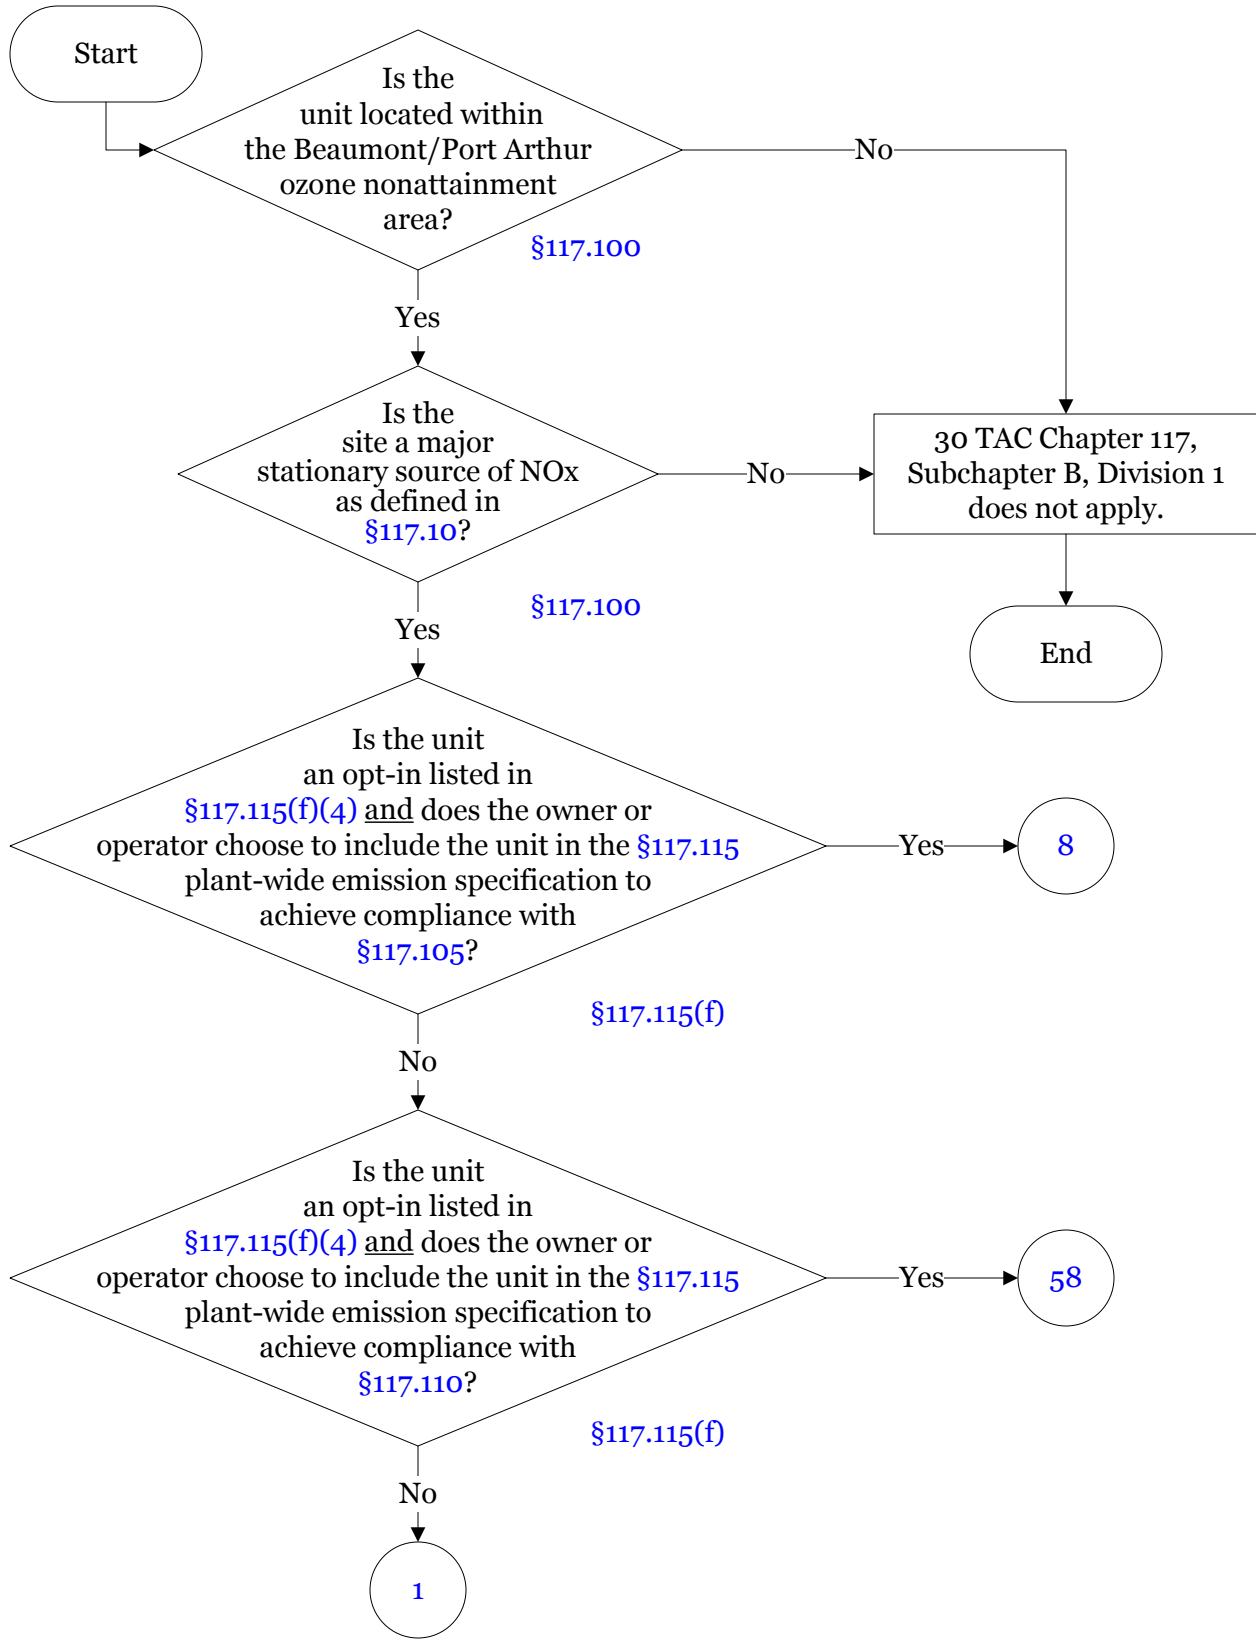


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(2 of 67)**

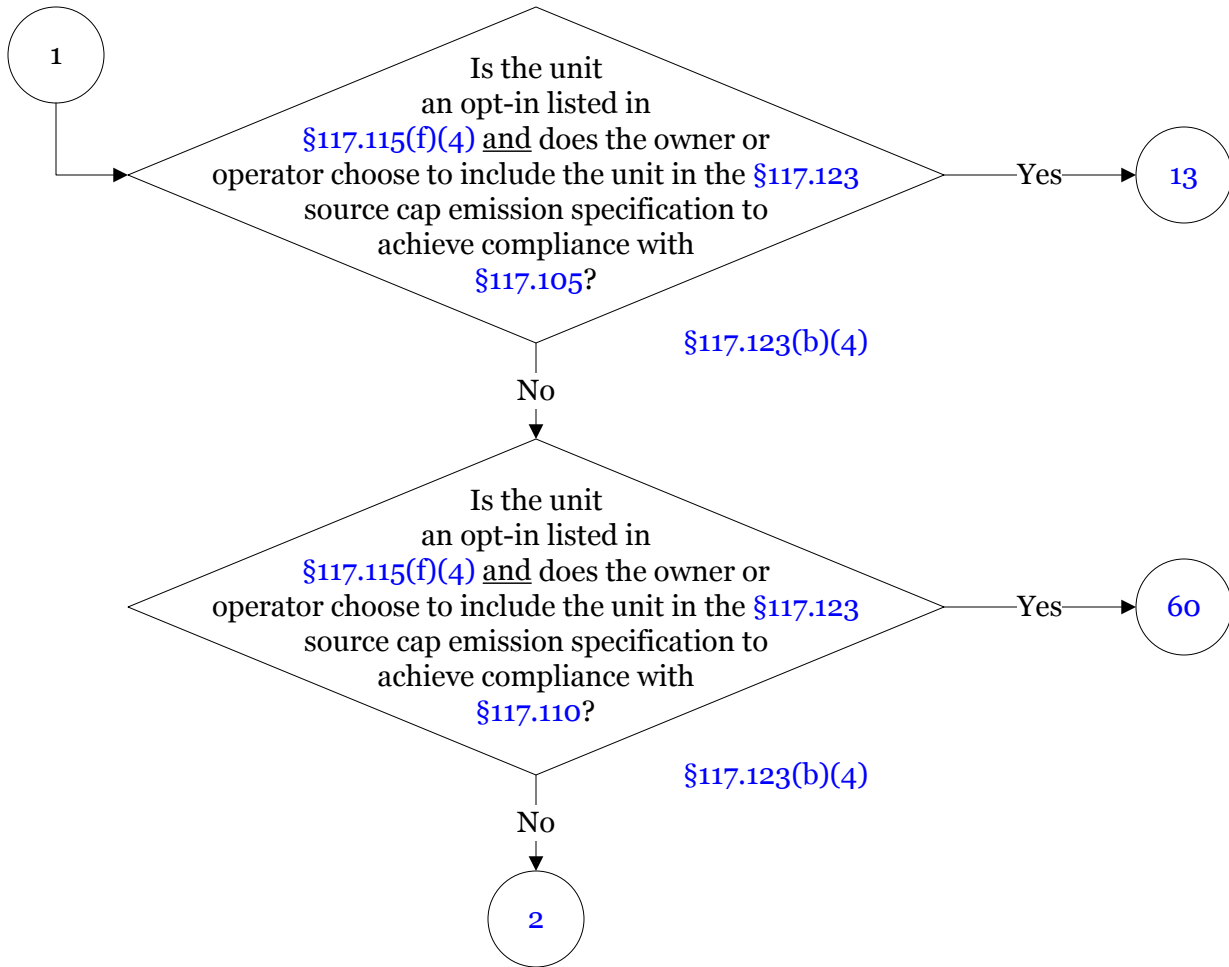


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(3 of 67)**

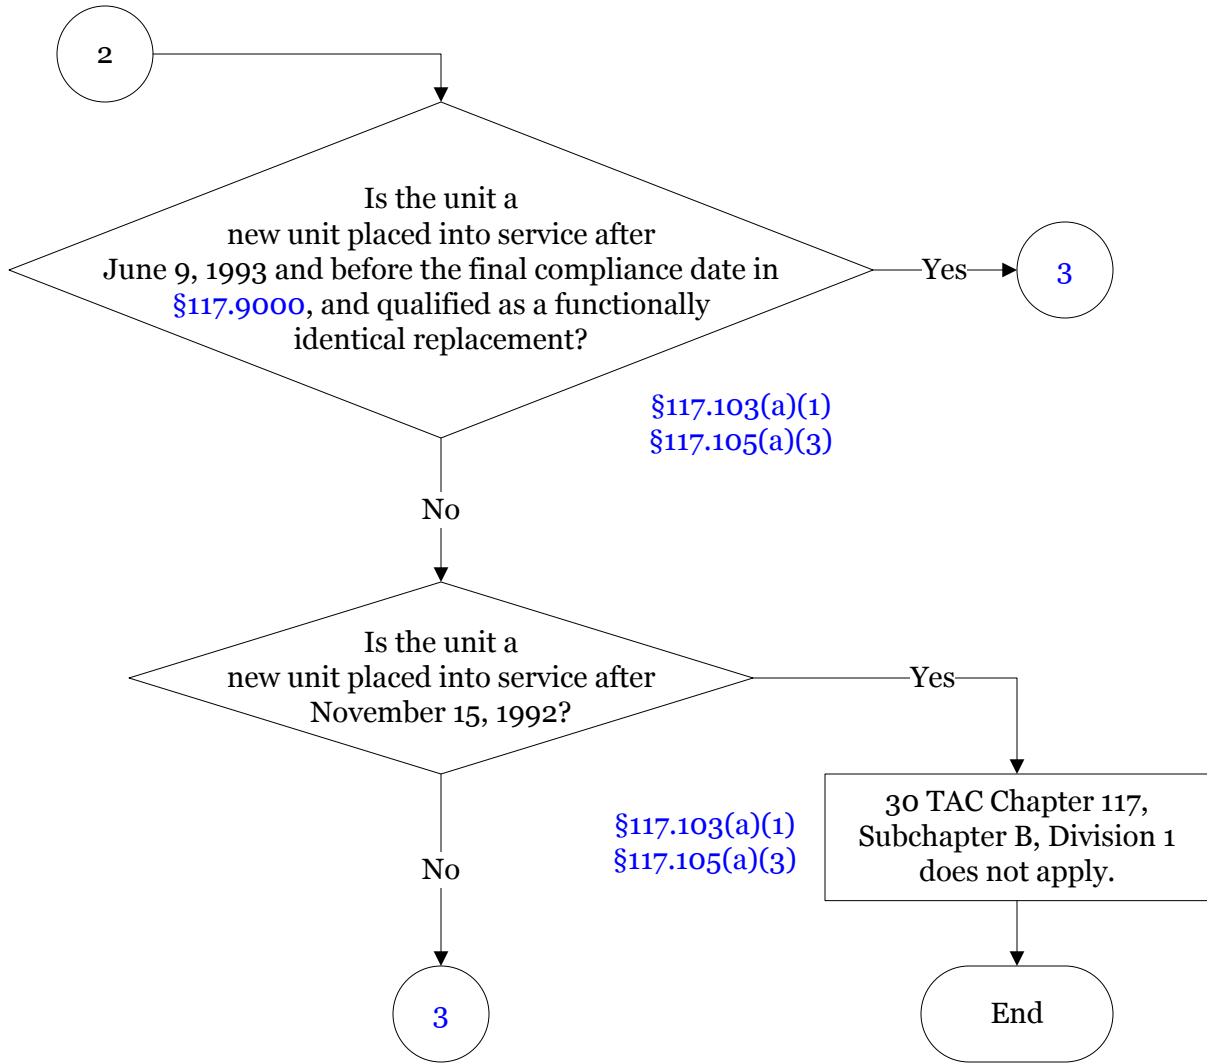


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(4 of 67)**

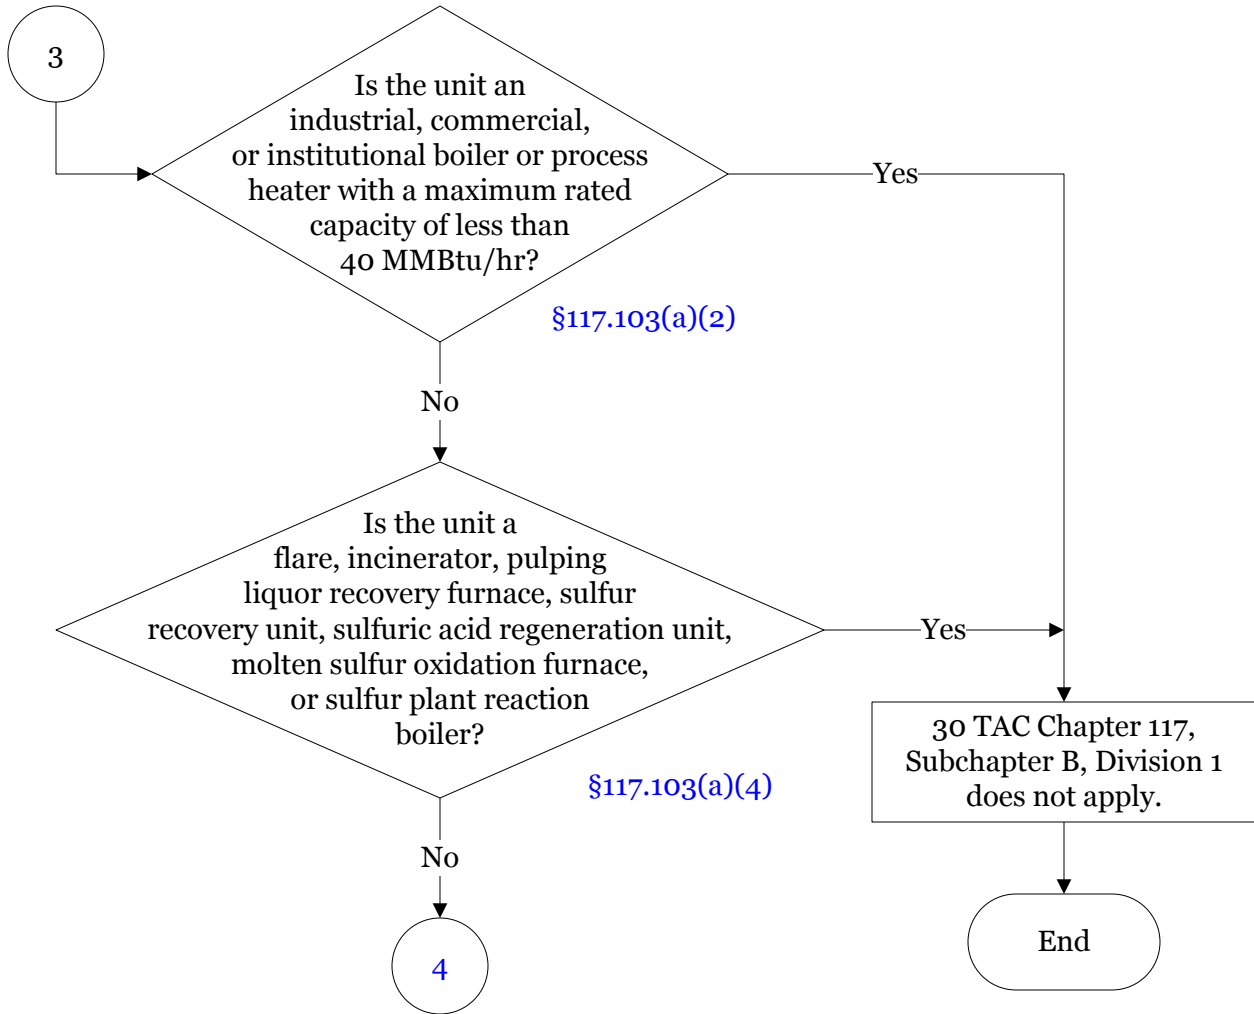


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(5 of 67)**

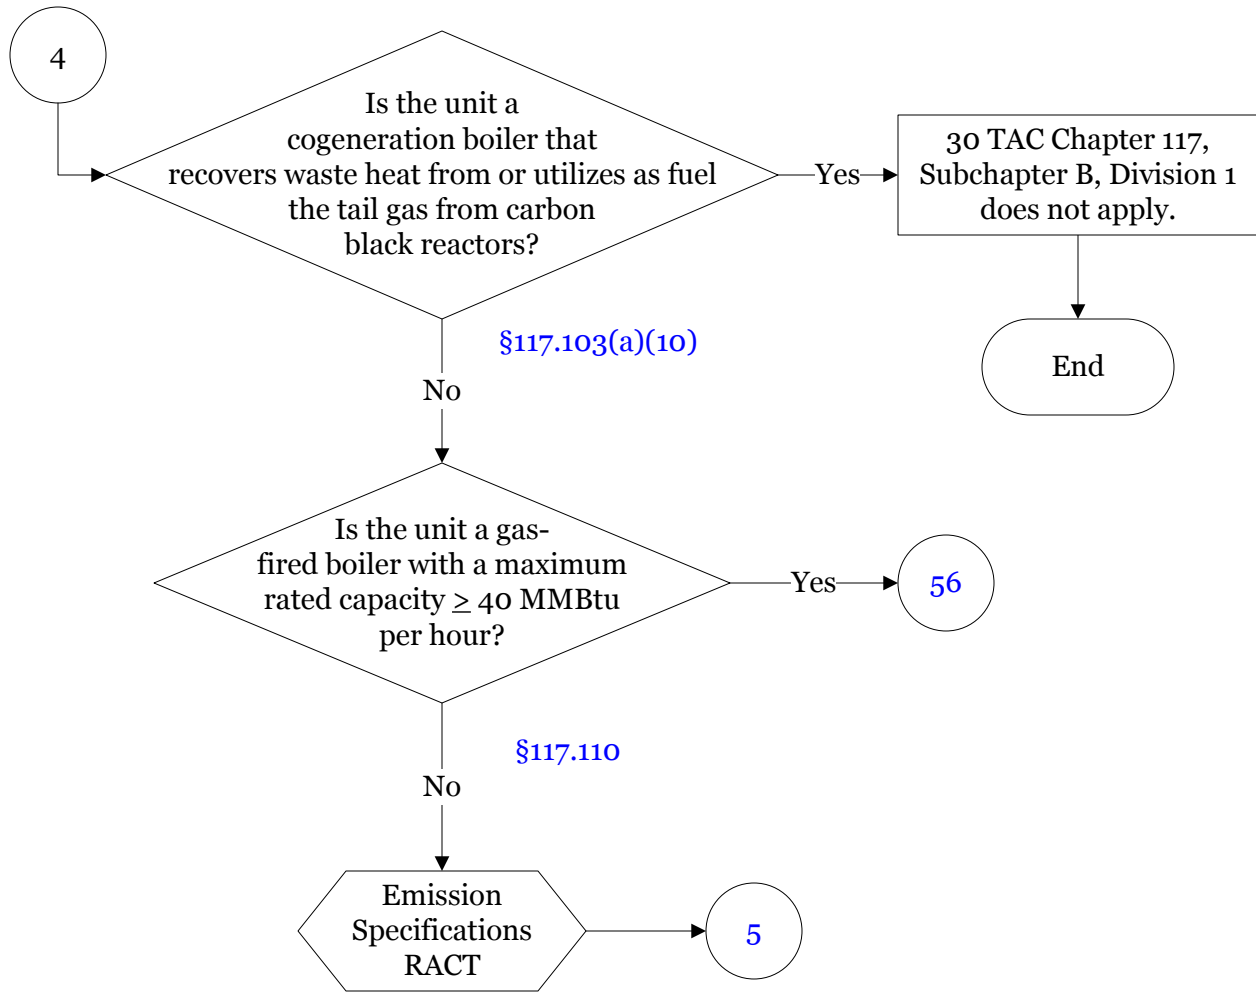


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(6 of 67)**

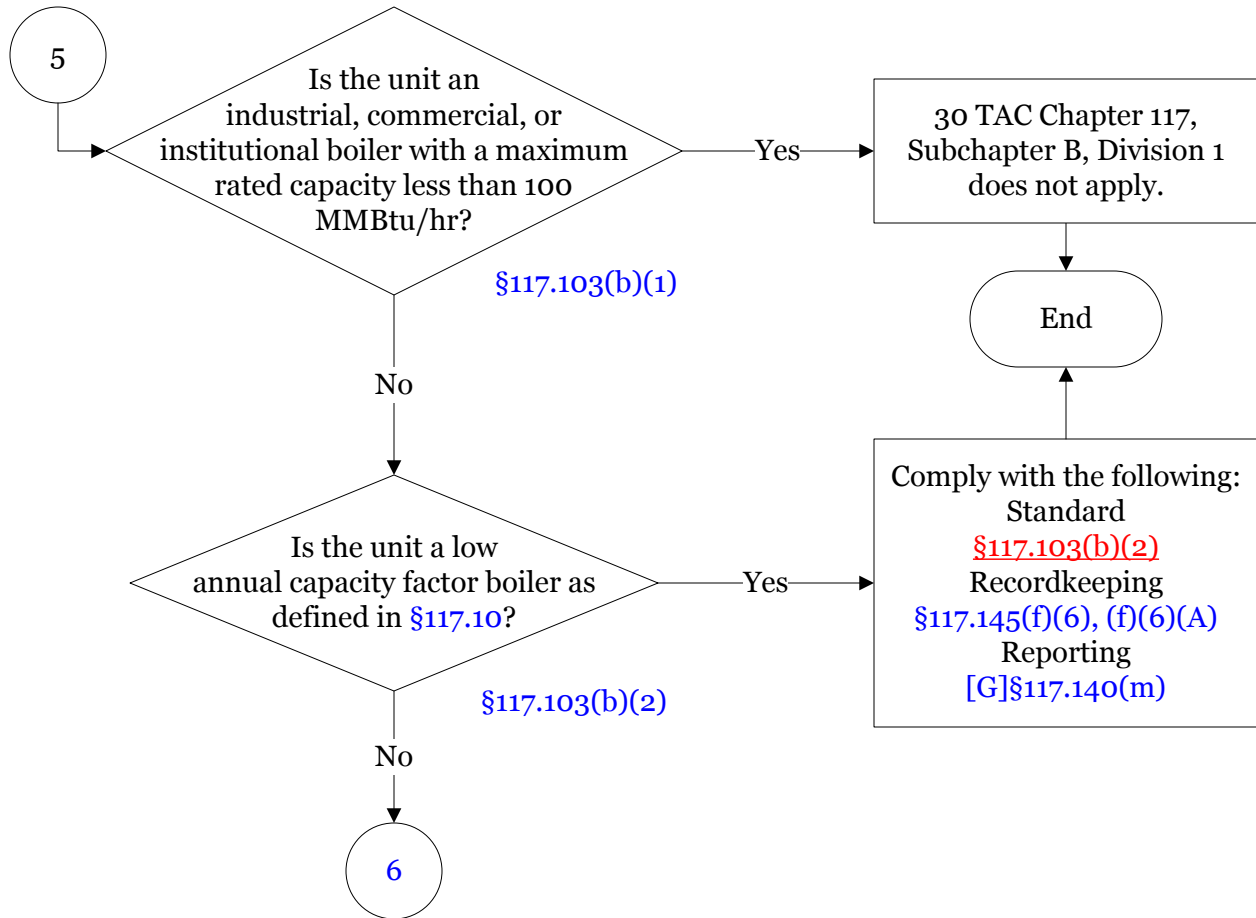

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(7 of 67)**

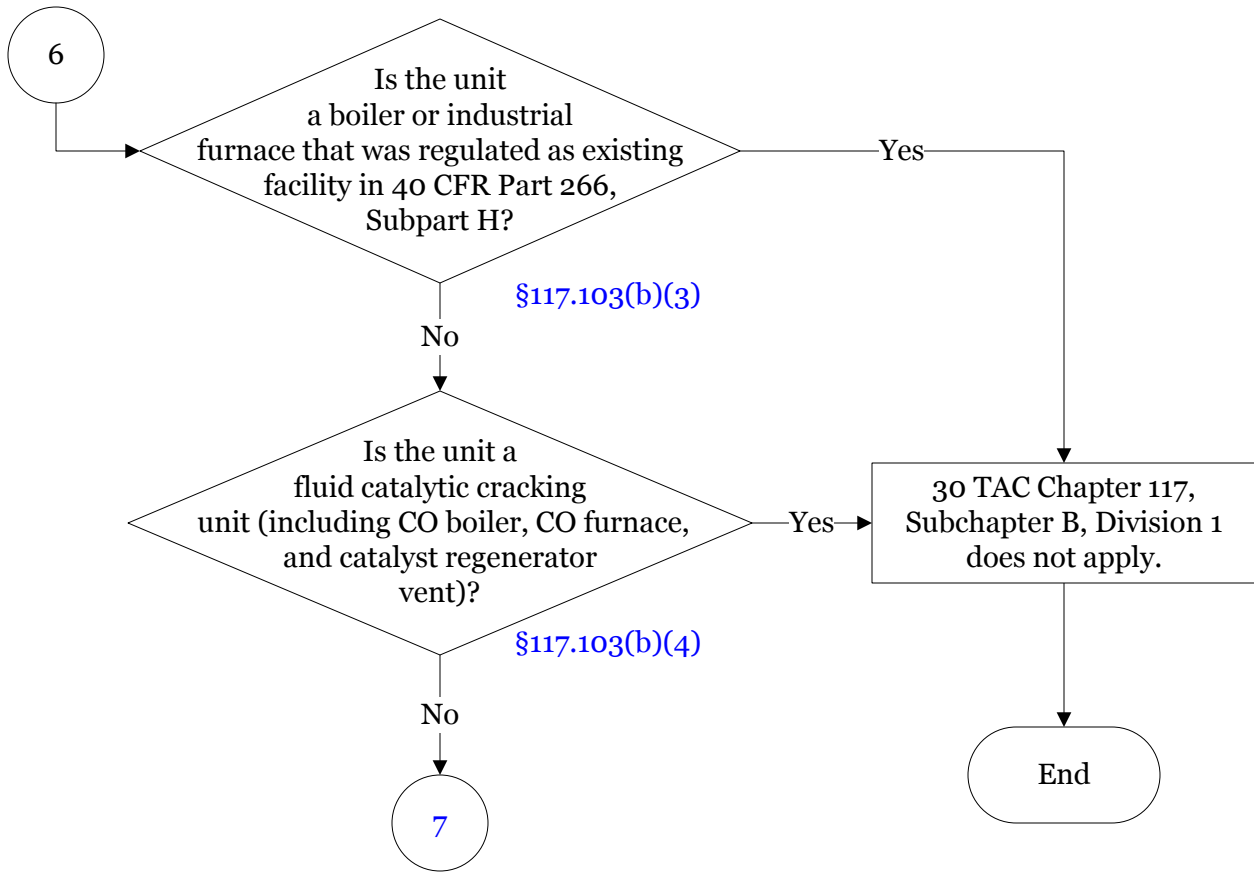


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(8 of 67)**

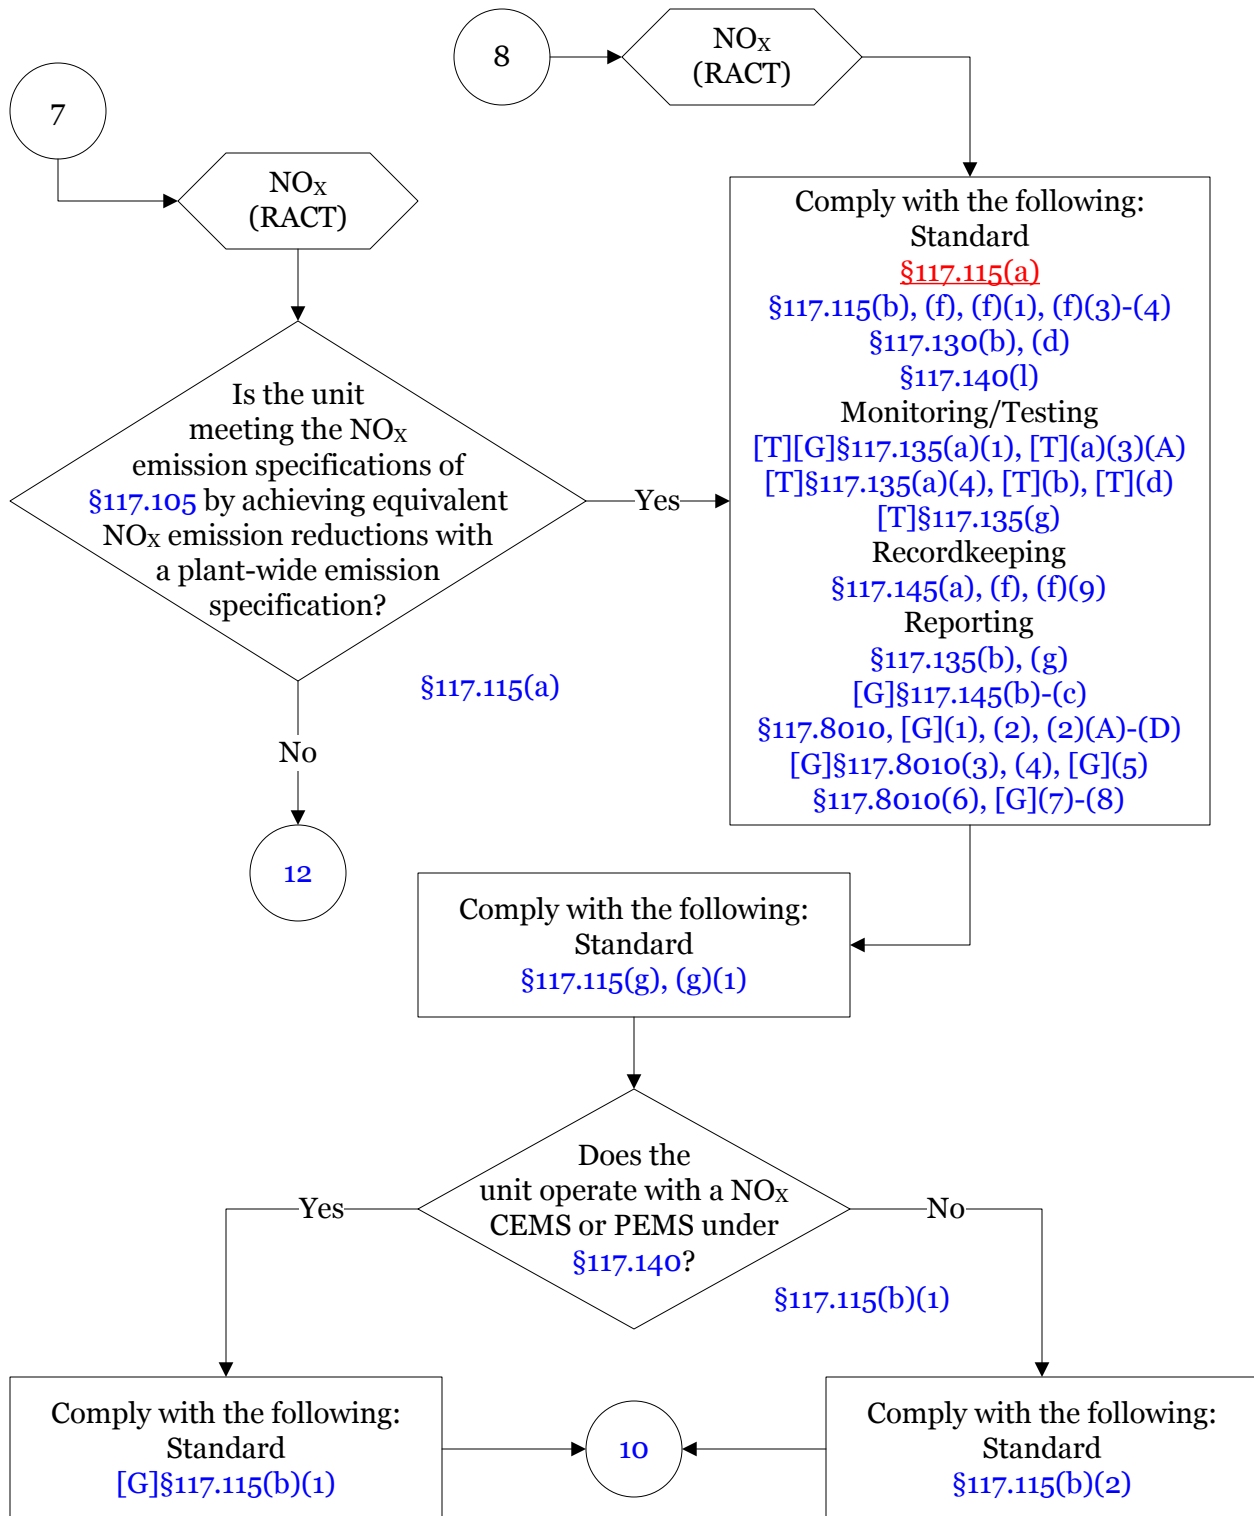





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(9 of 67)**

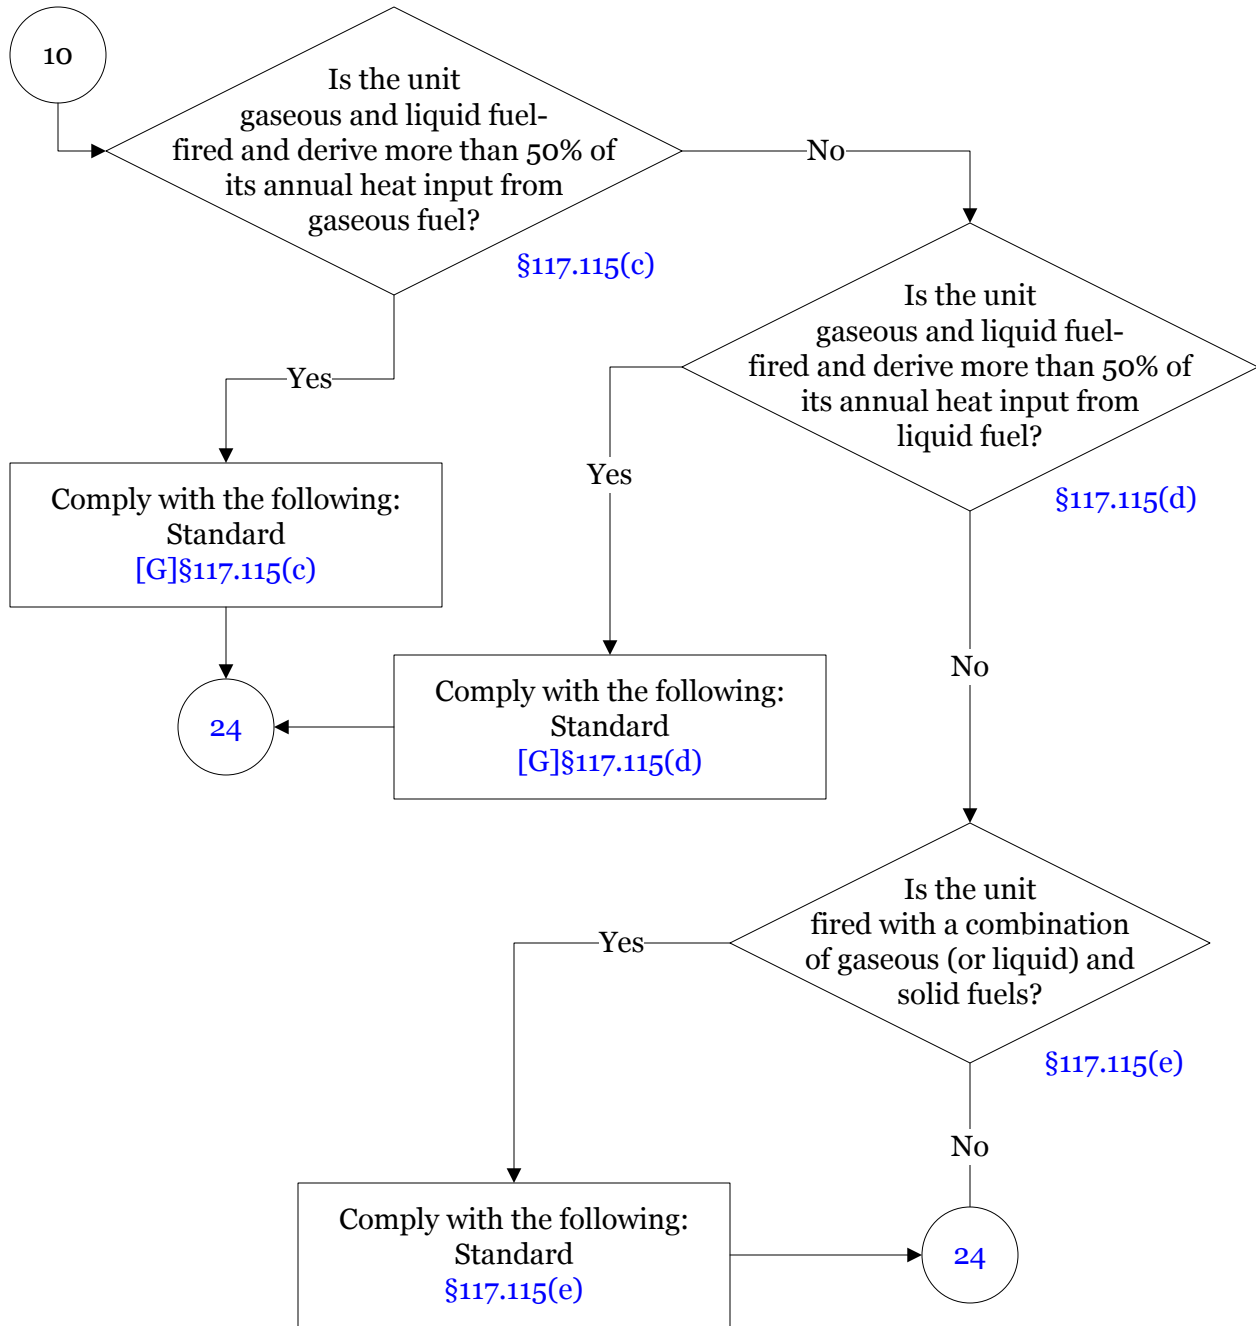


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(10 of 67)**

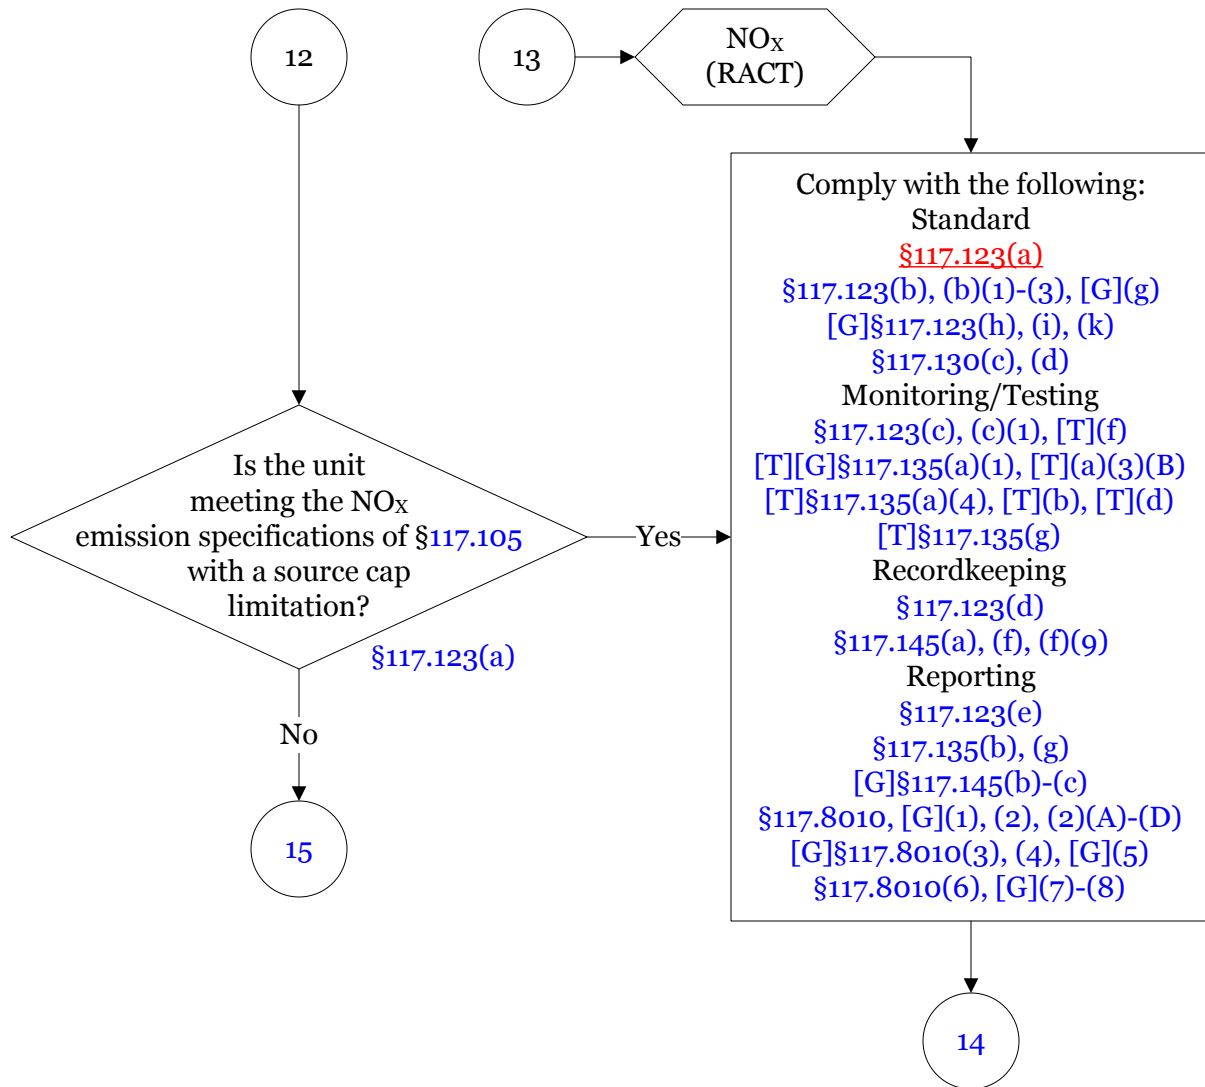


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(11 of 67)**

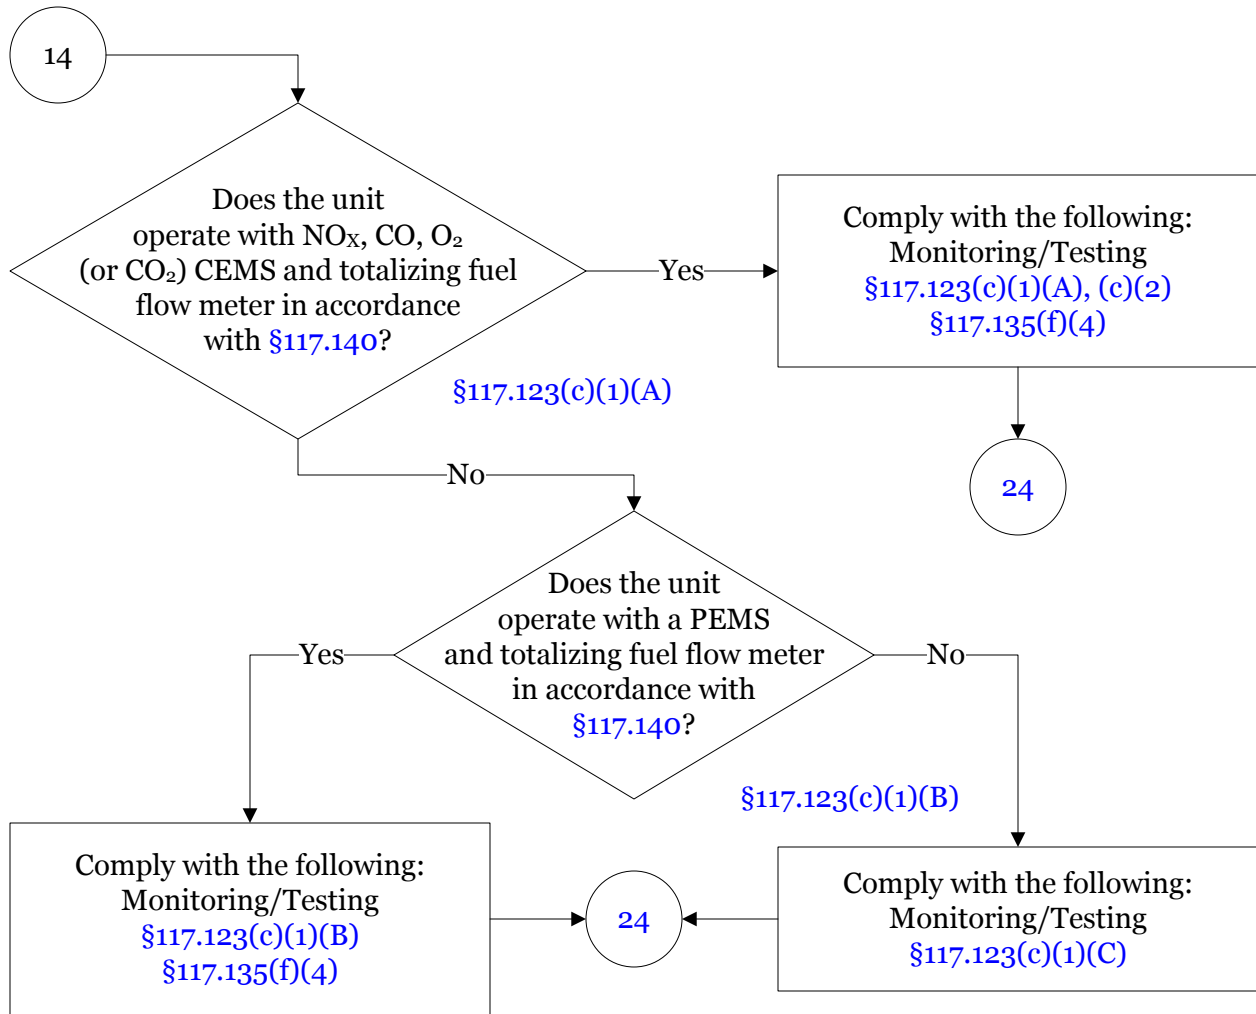


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(12 of 67)**

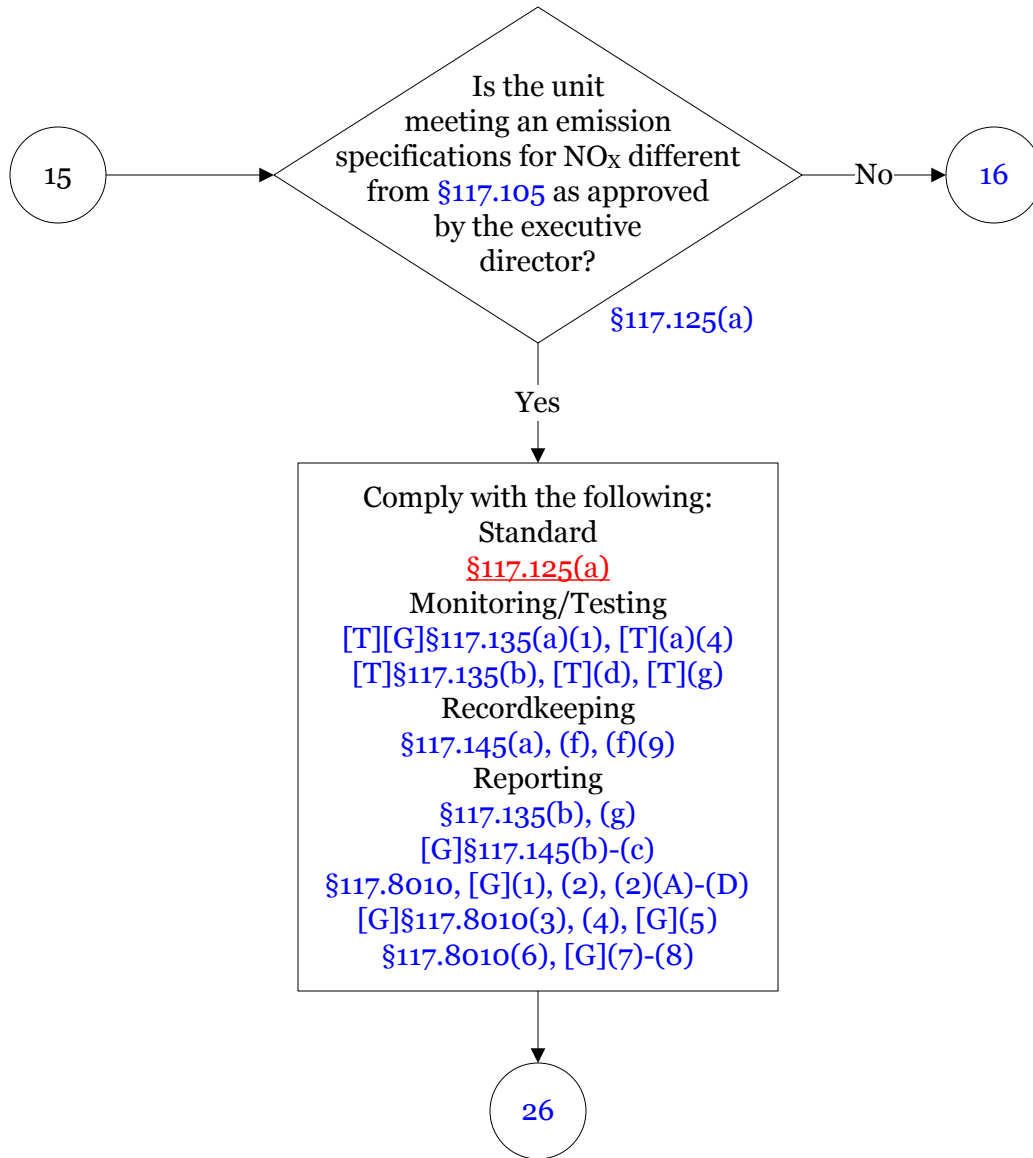


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(13 of 67)**

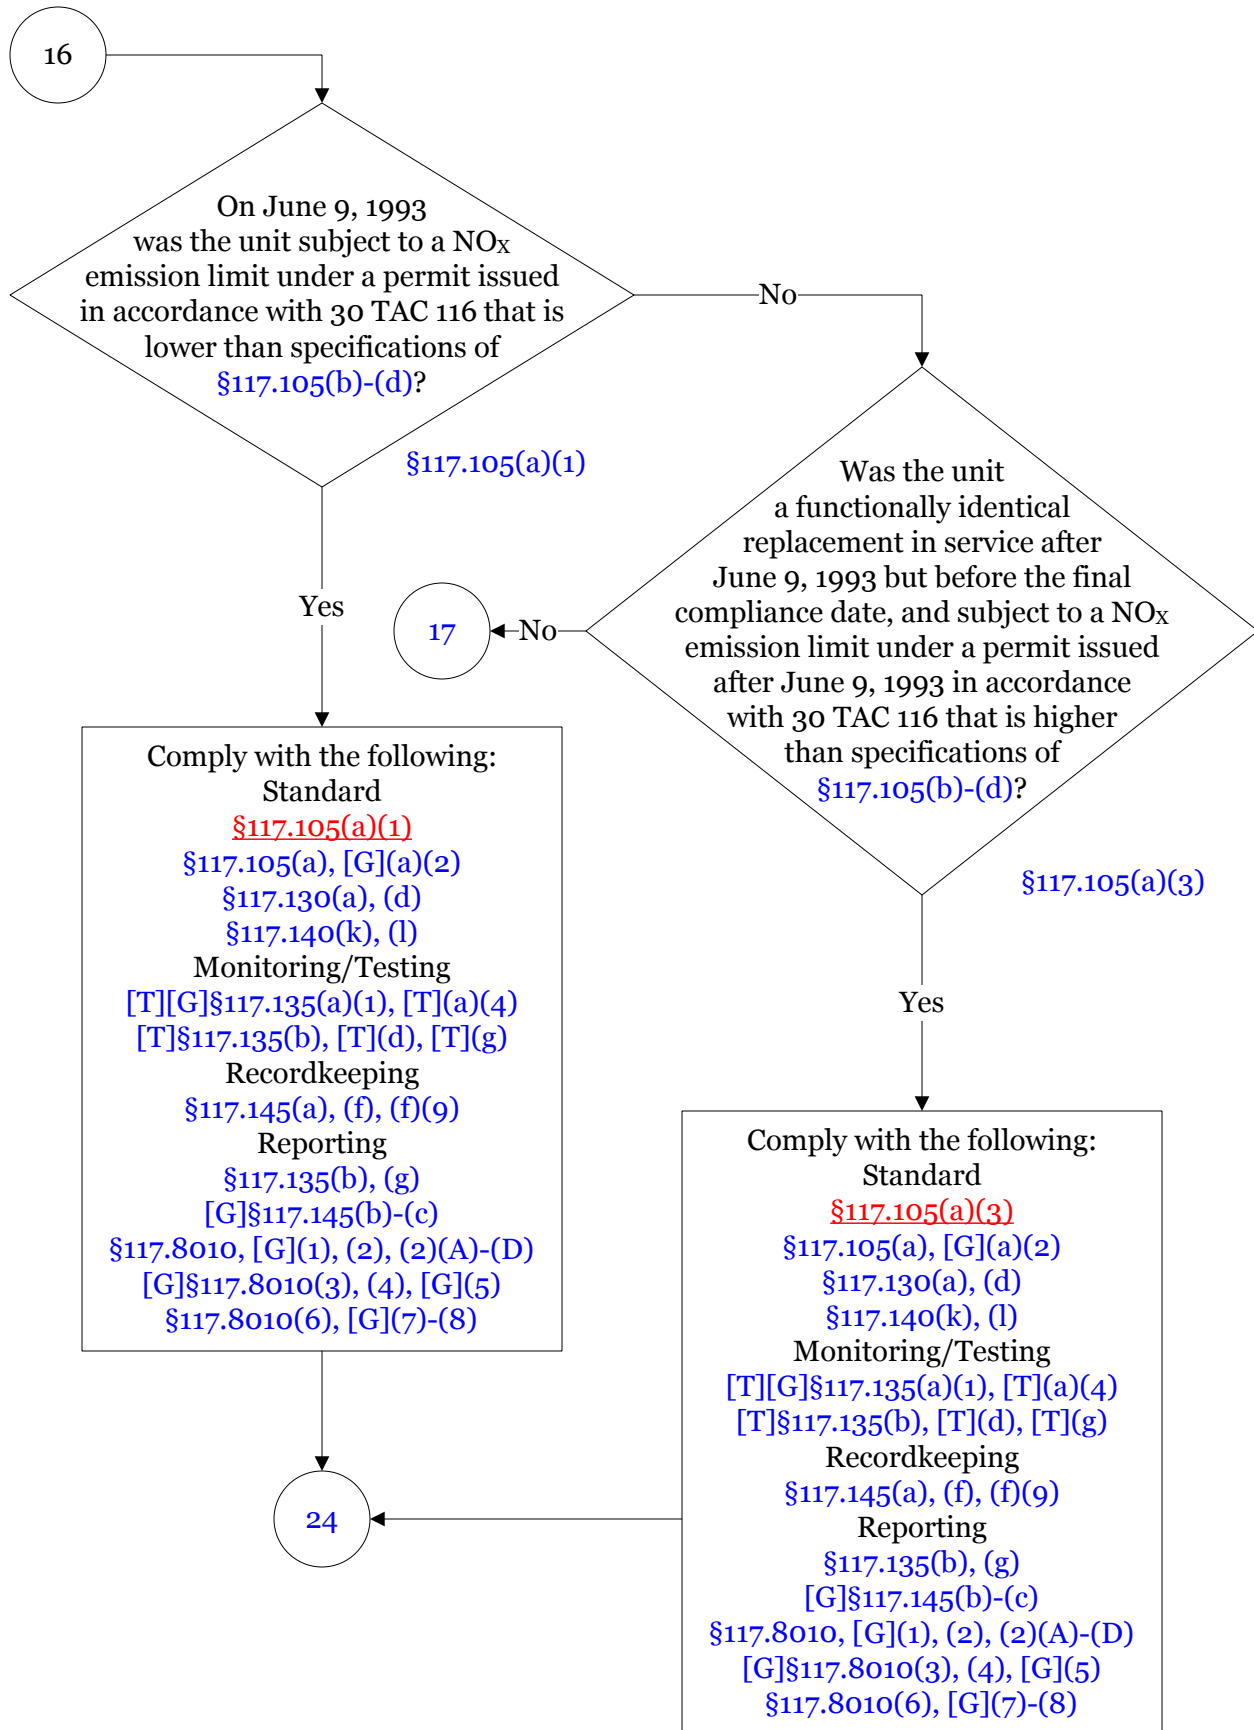


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(14 of 67)**

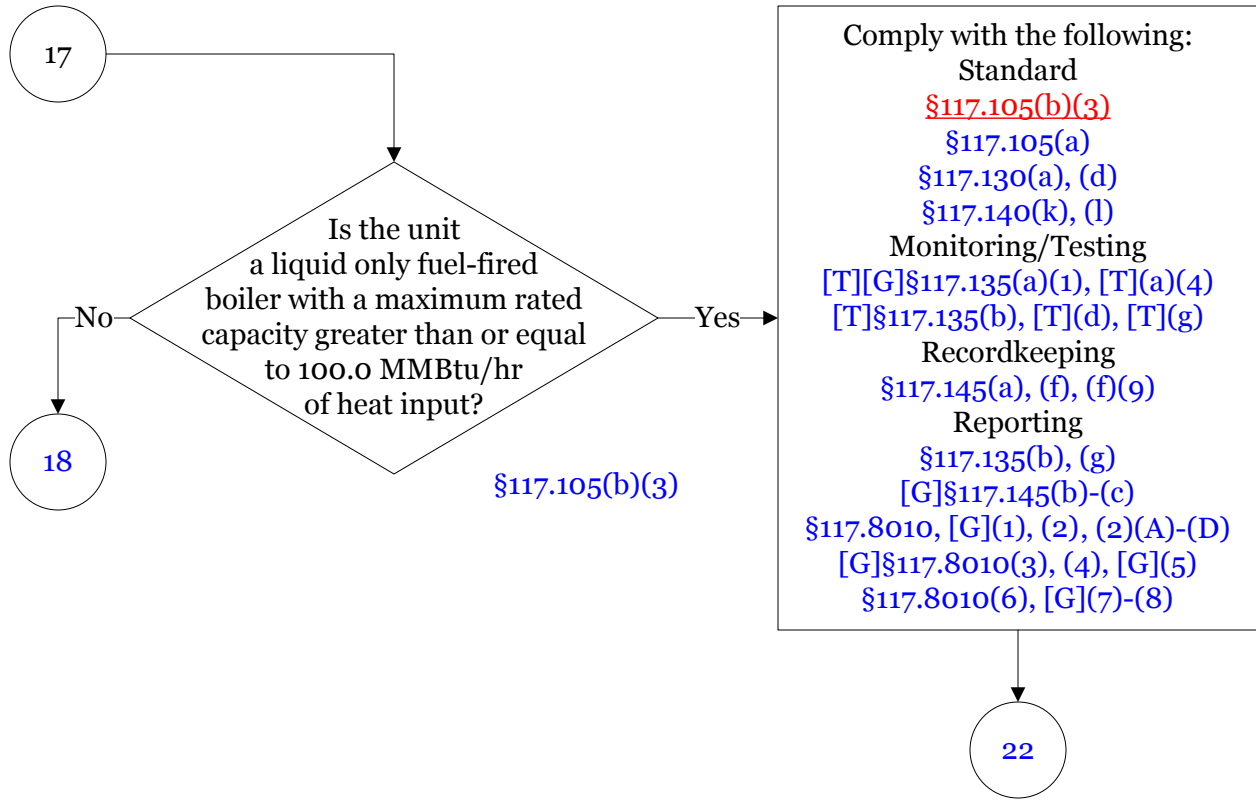

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(15 of 67)**

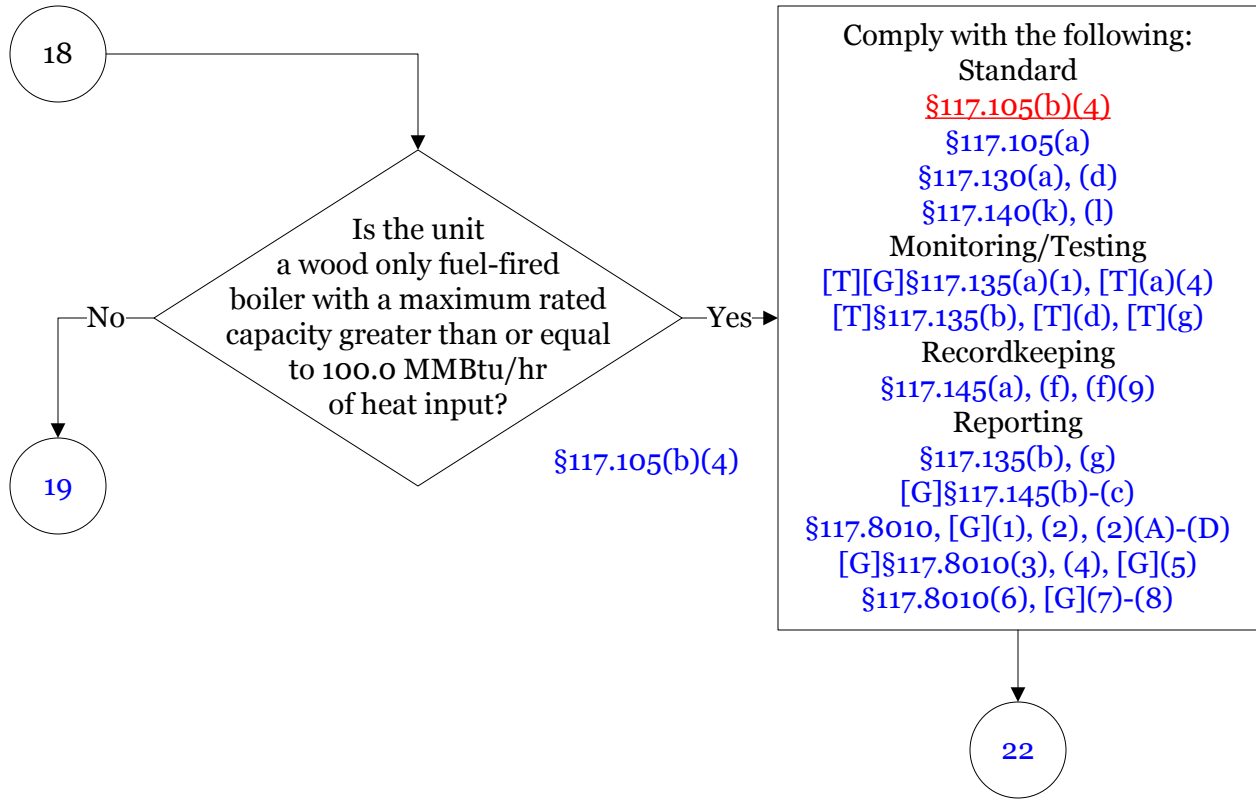


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(16 of 67)**

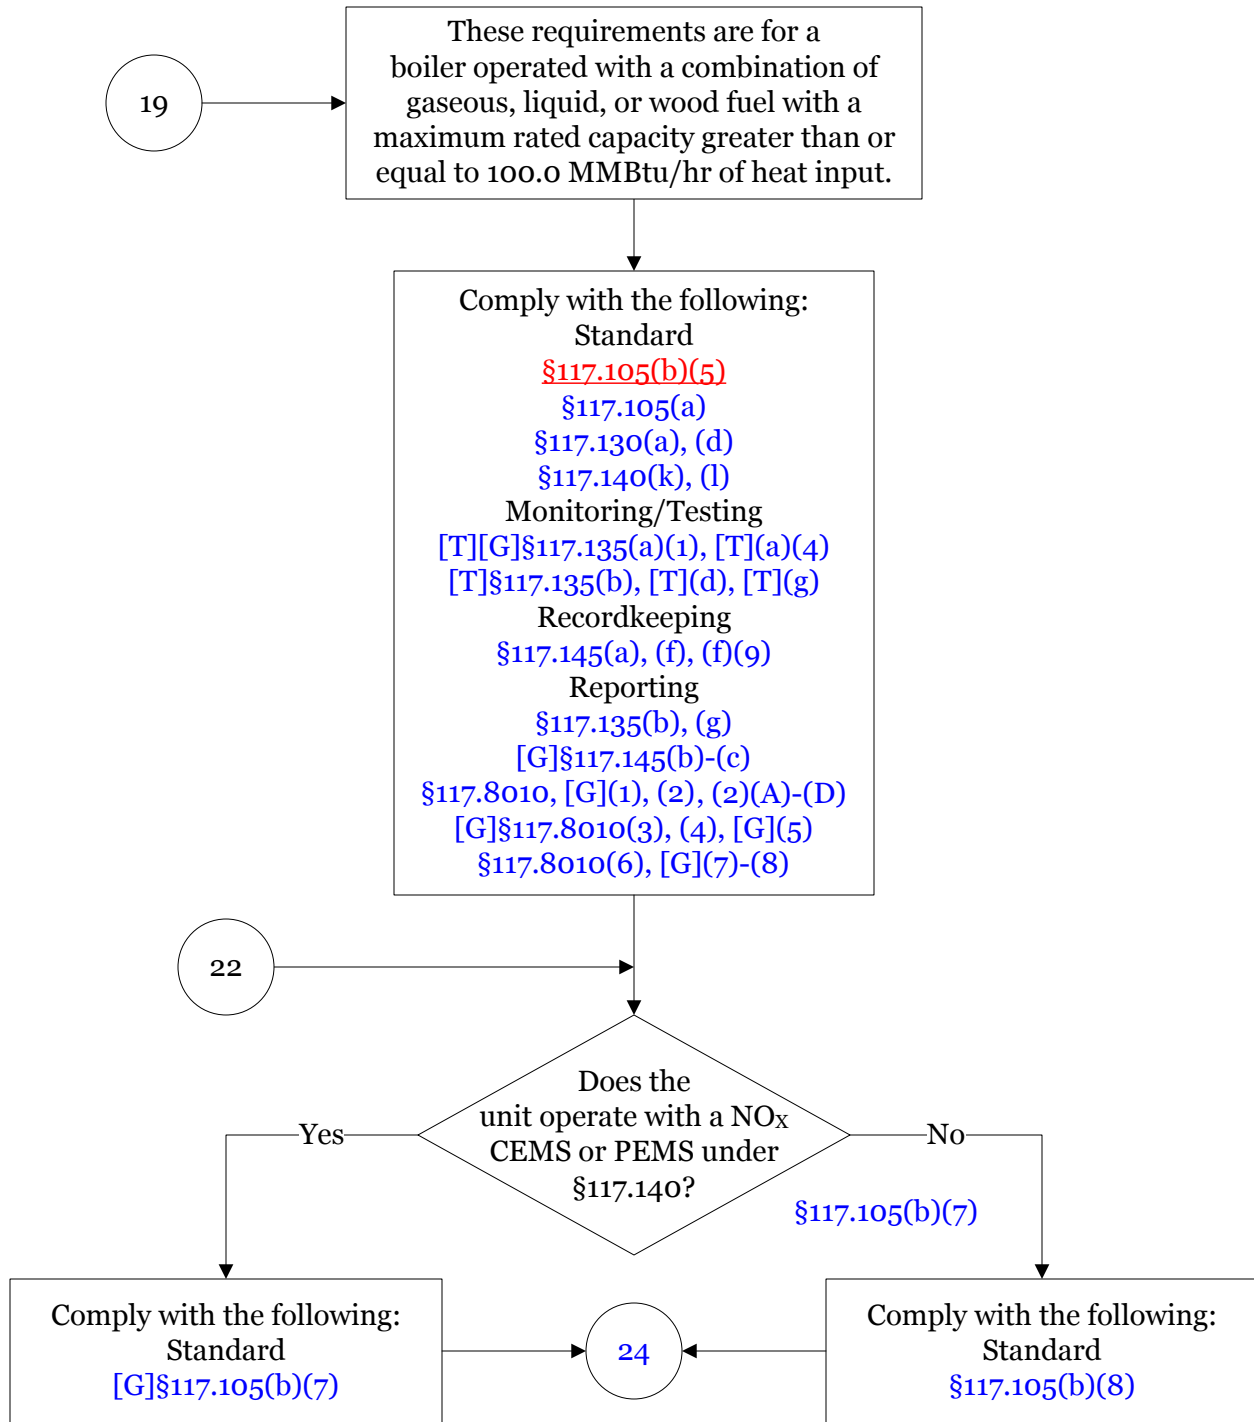





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(17 of 67)**

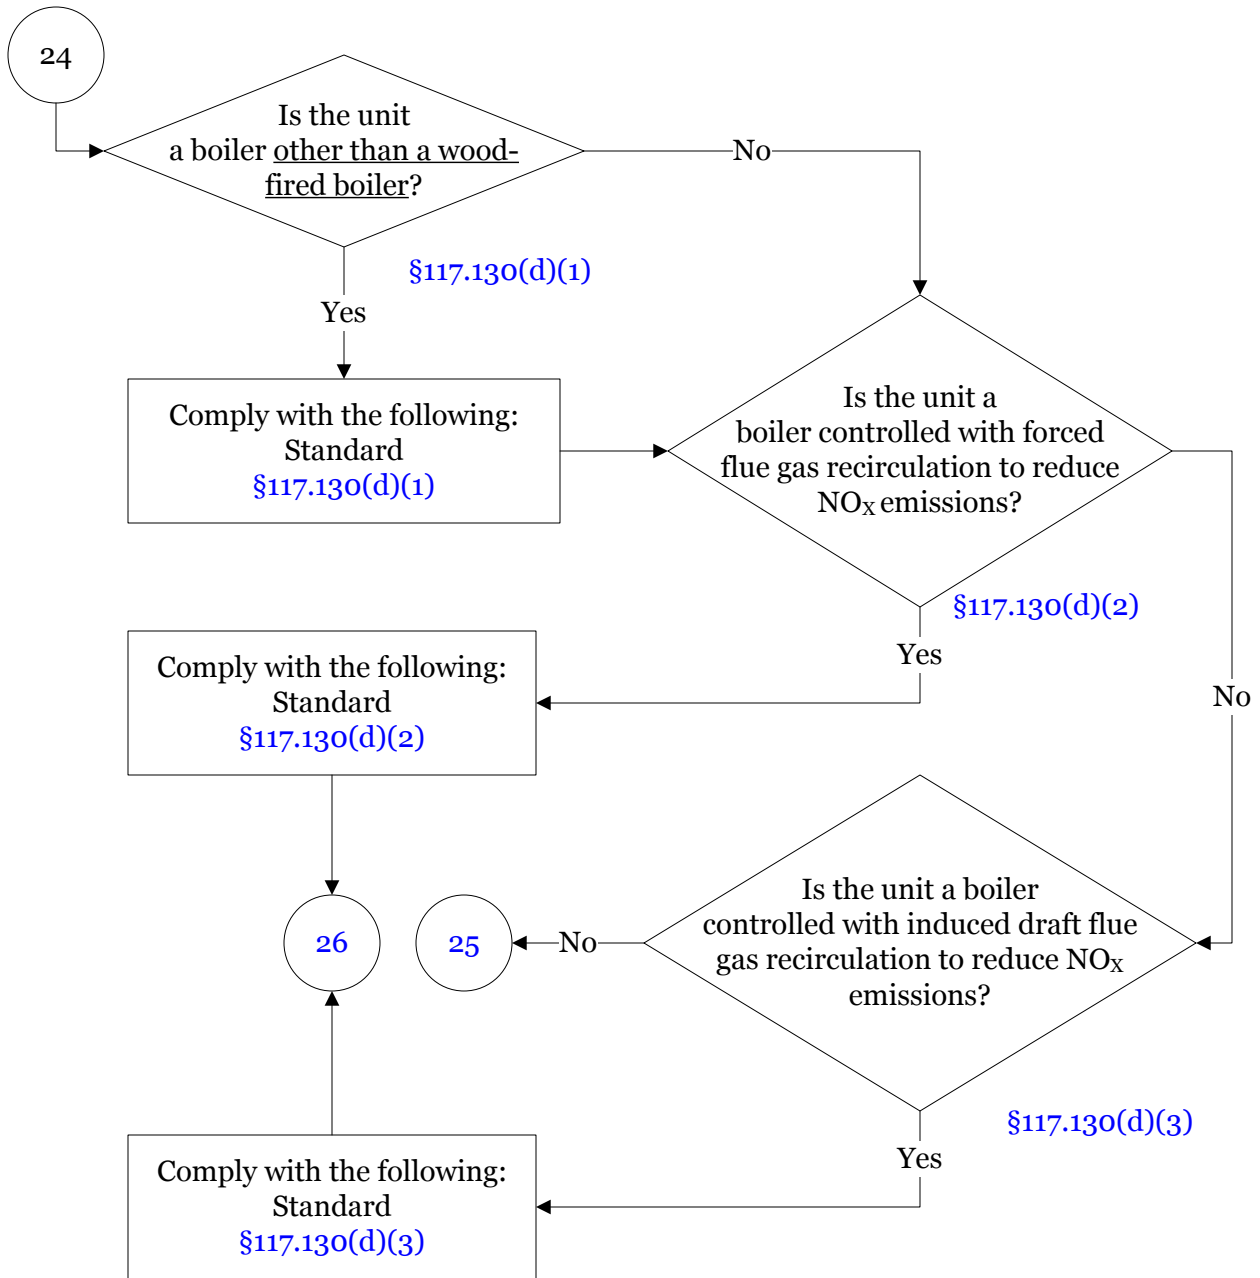


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(18 of 67)**

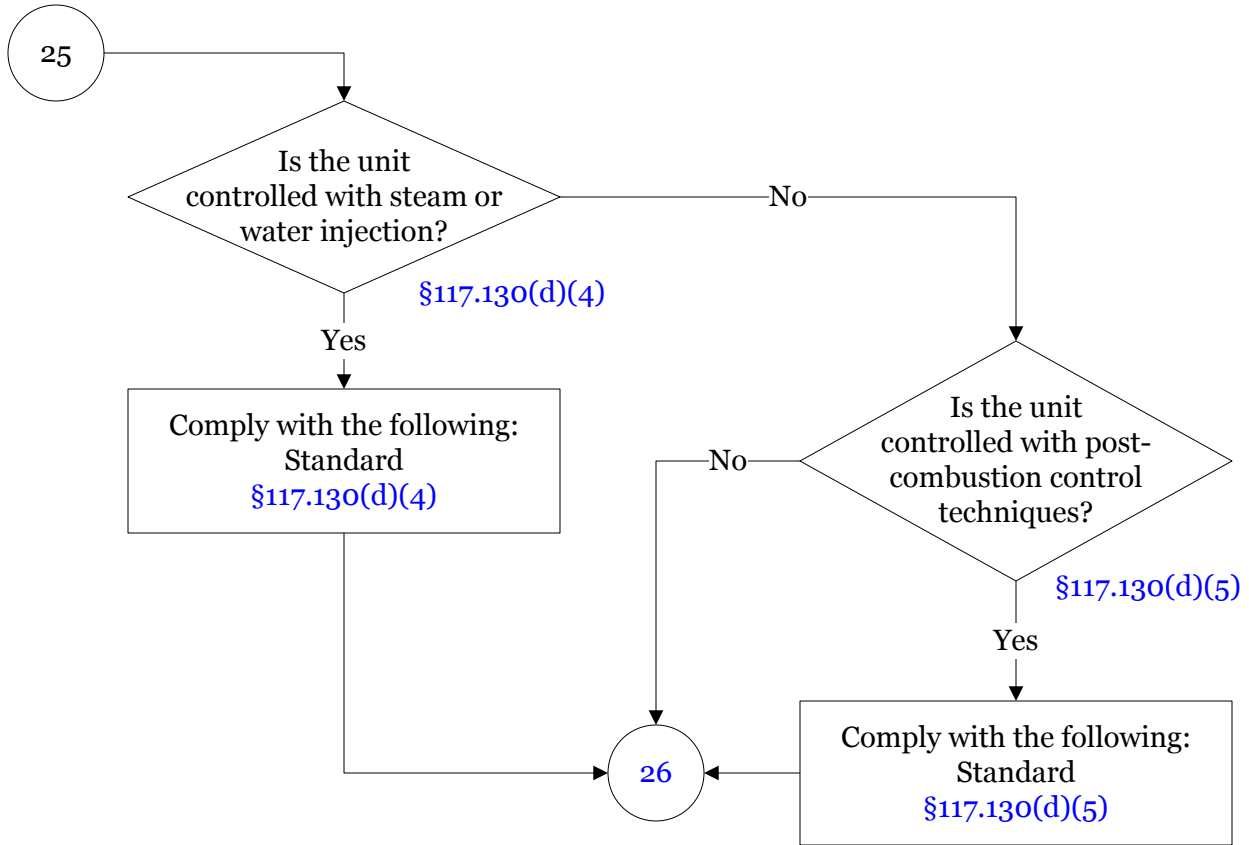


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(19 of 67)**

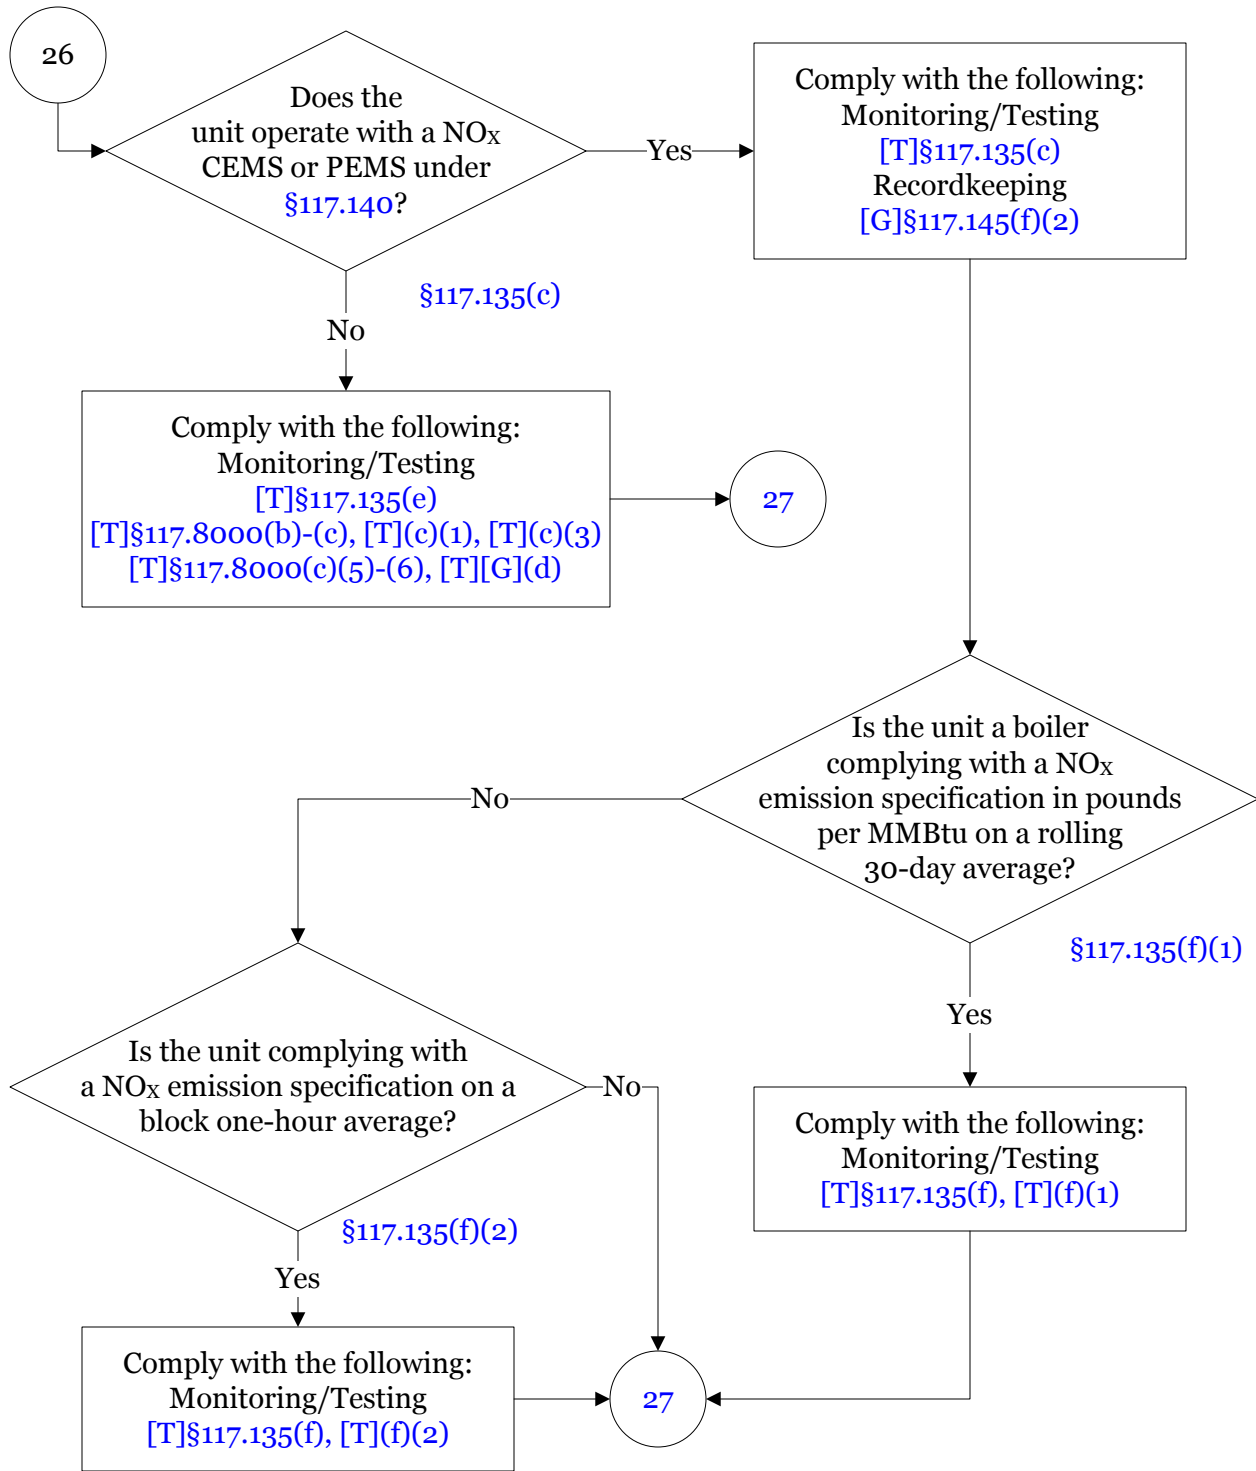


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(20 of 67)**

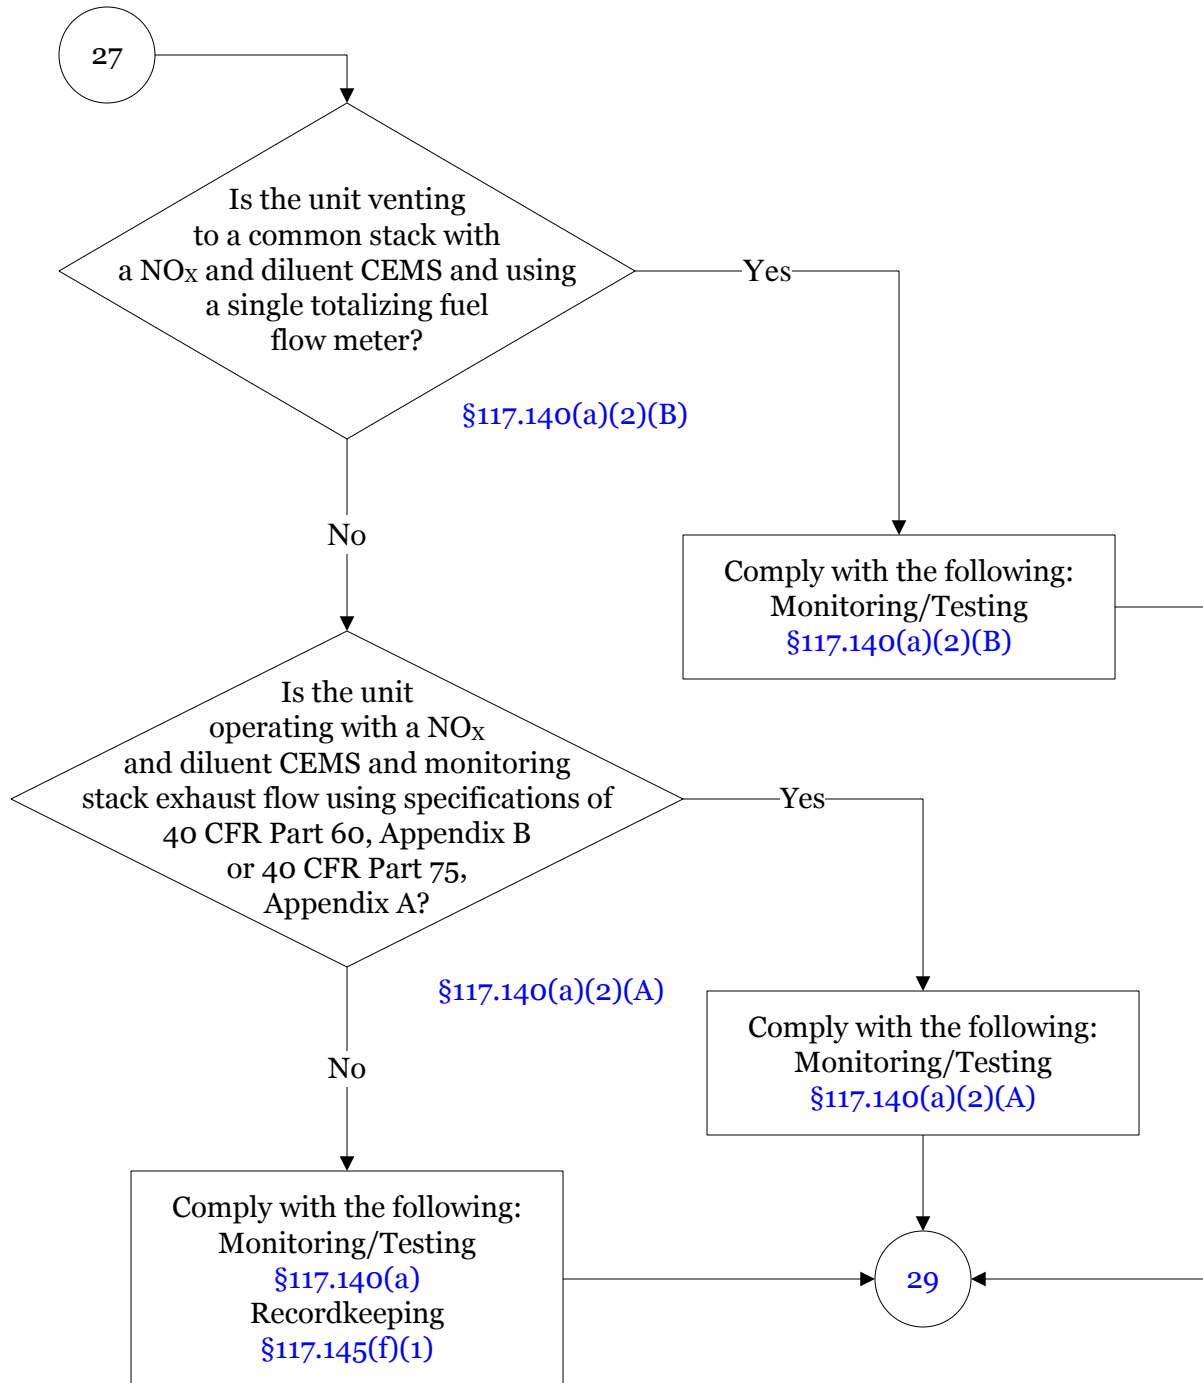


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(21 of 67)**

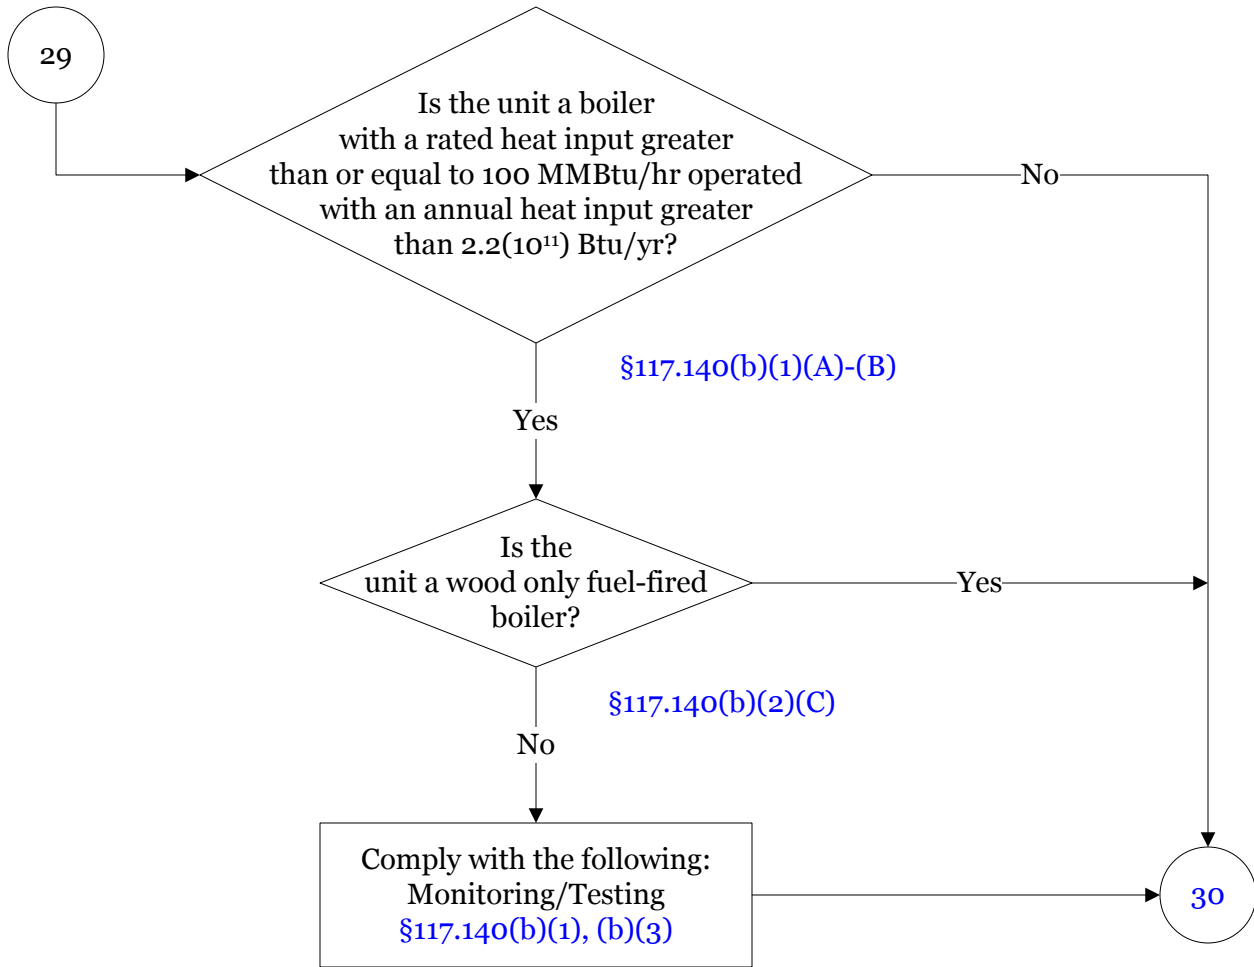


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(22 of 67)**

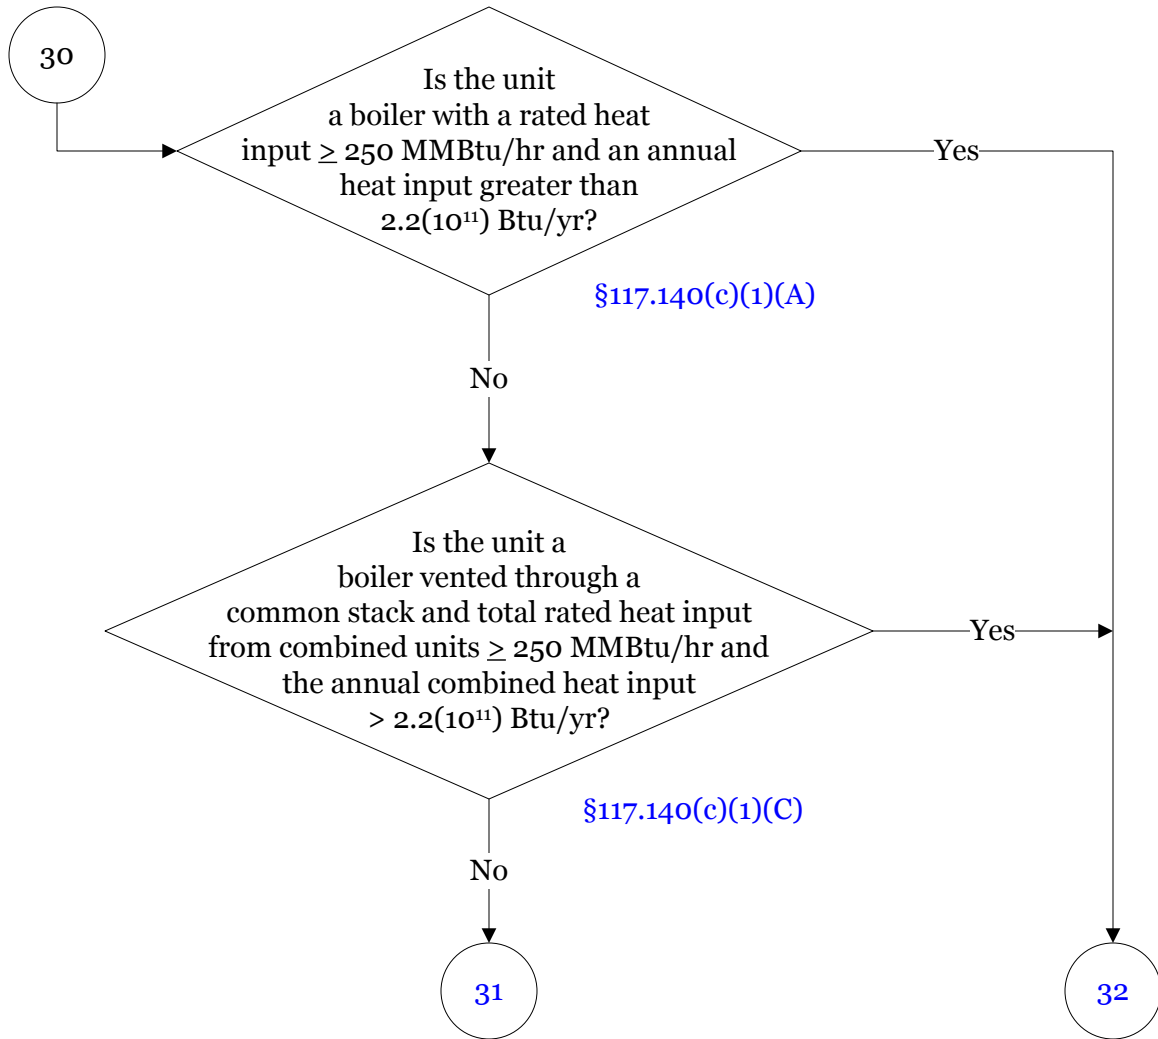

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(23 of 67)**

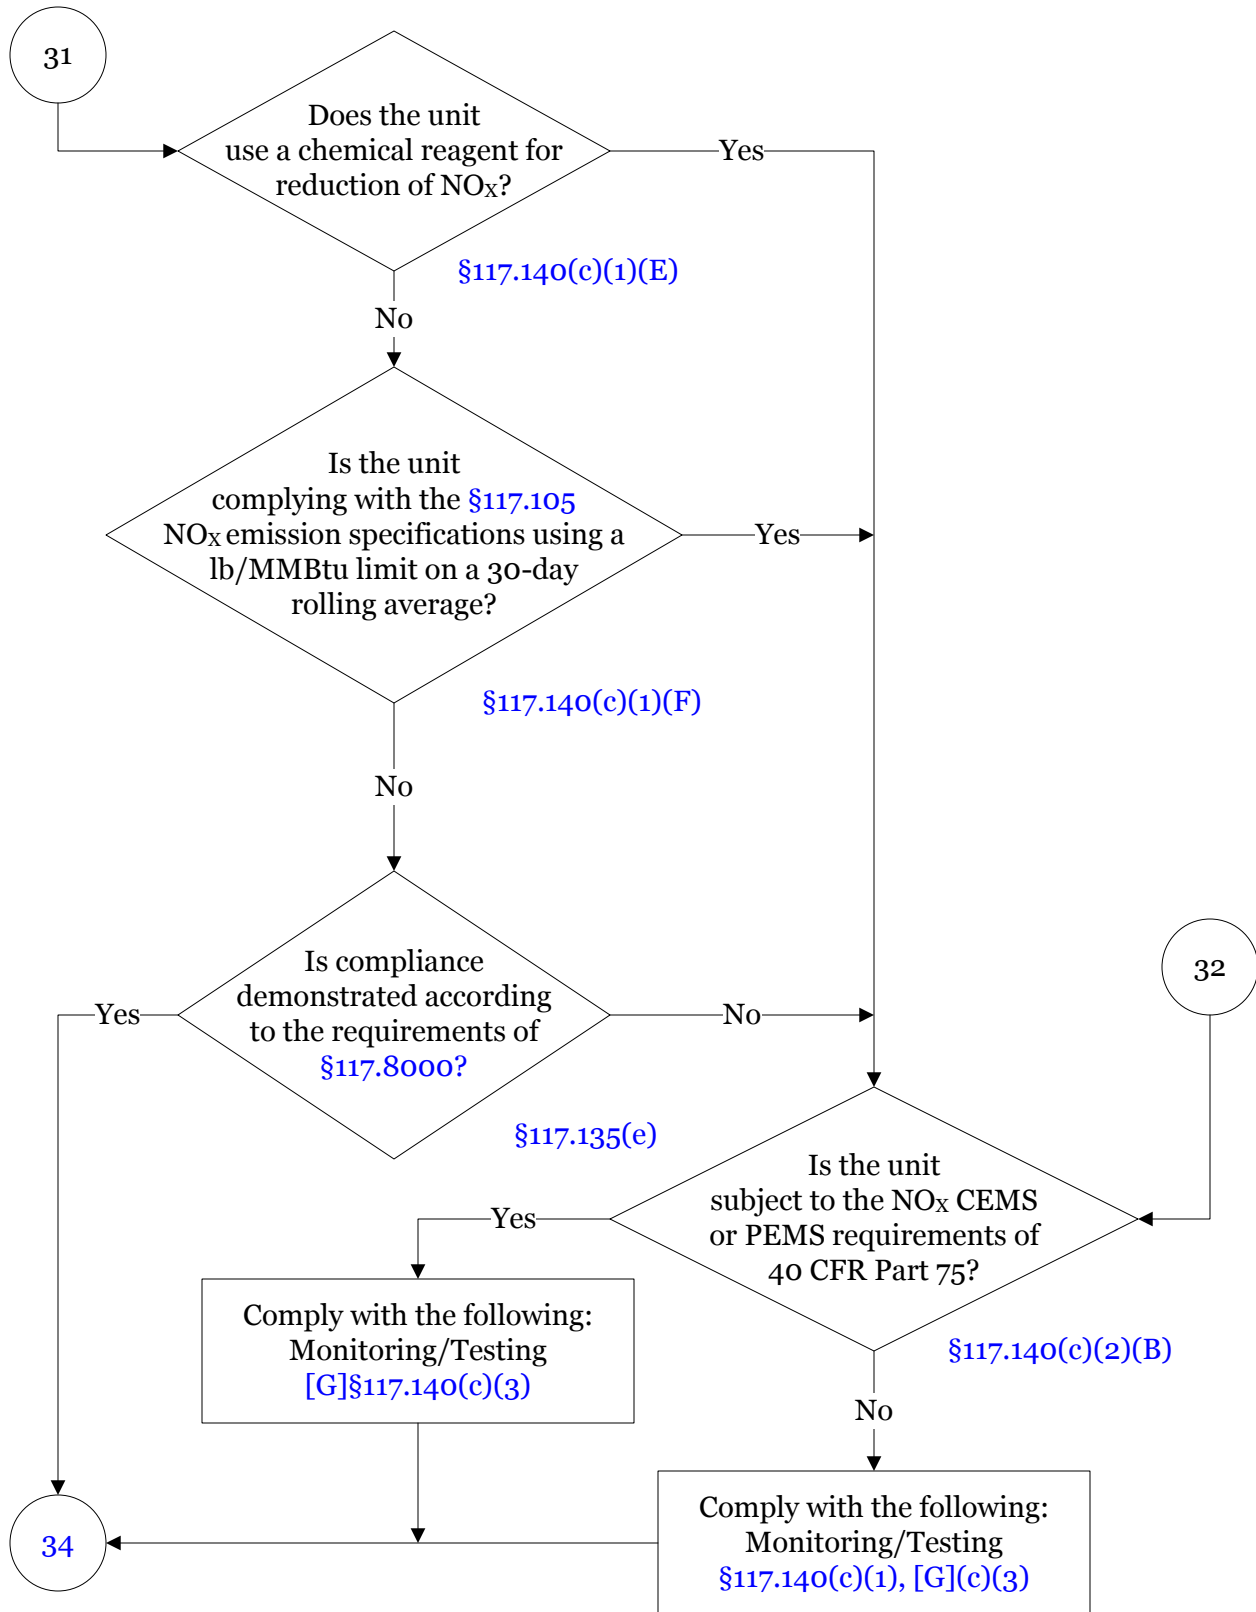


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(24 of 67)**

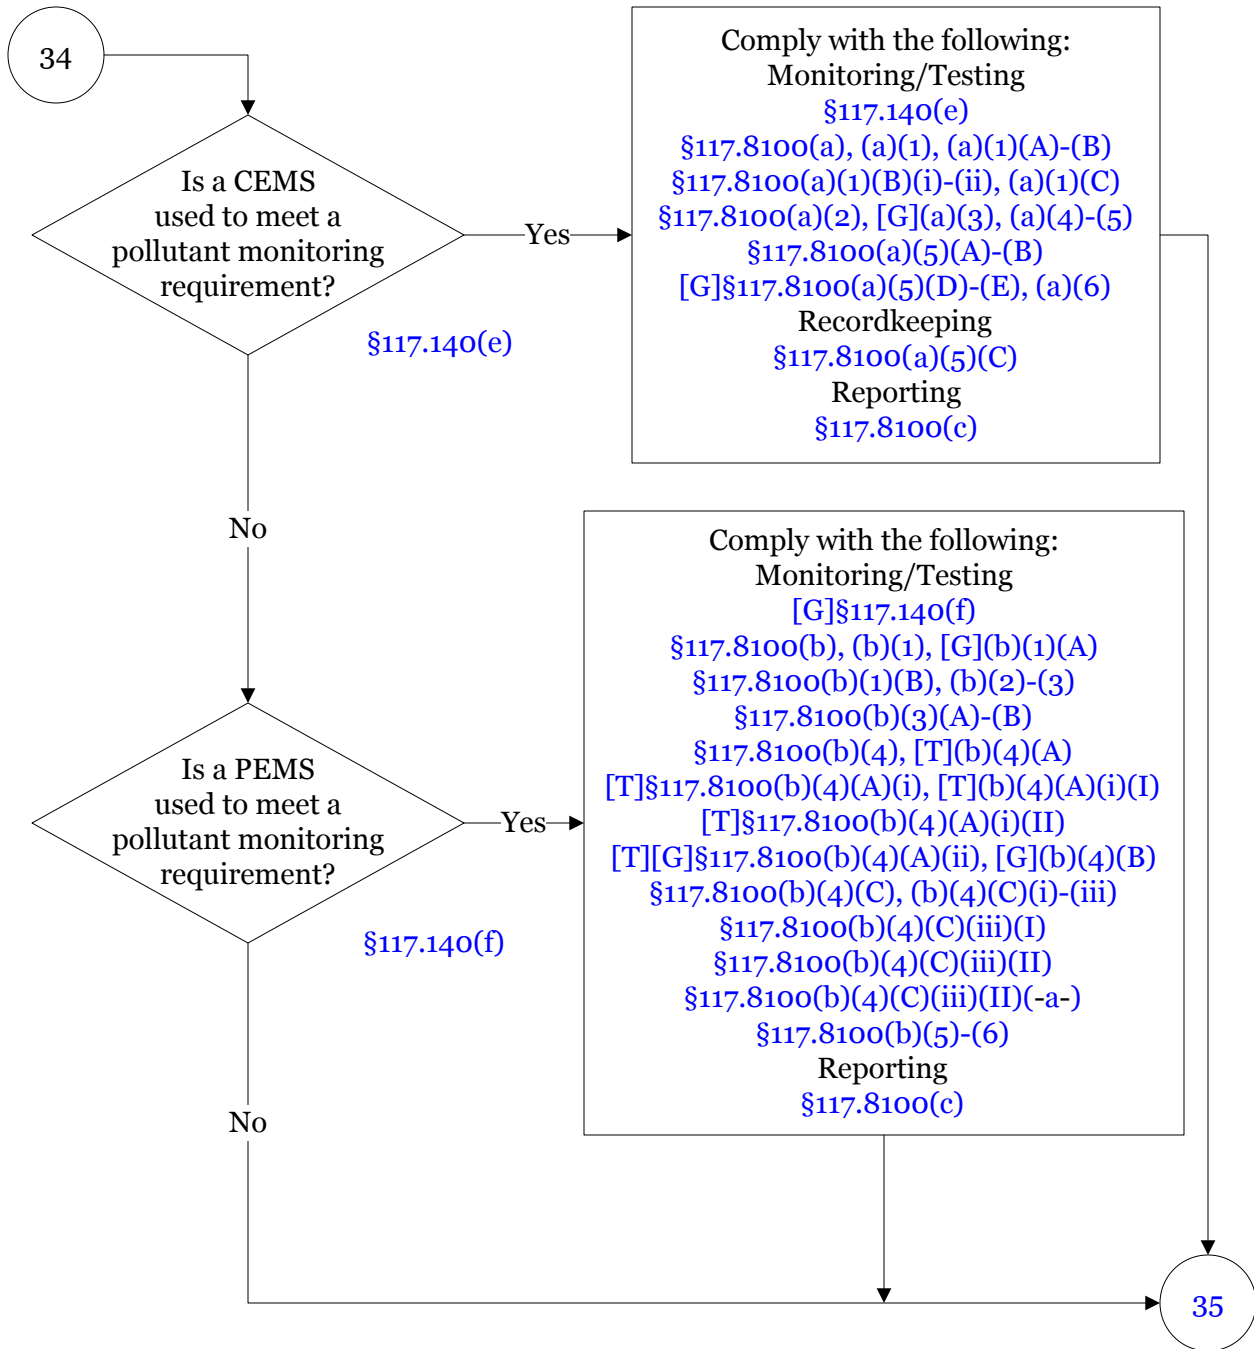





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(25 of 67)**

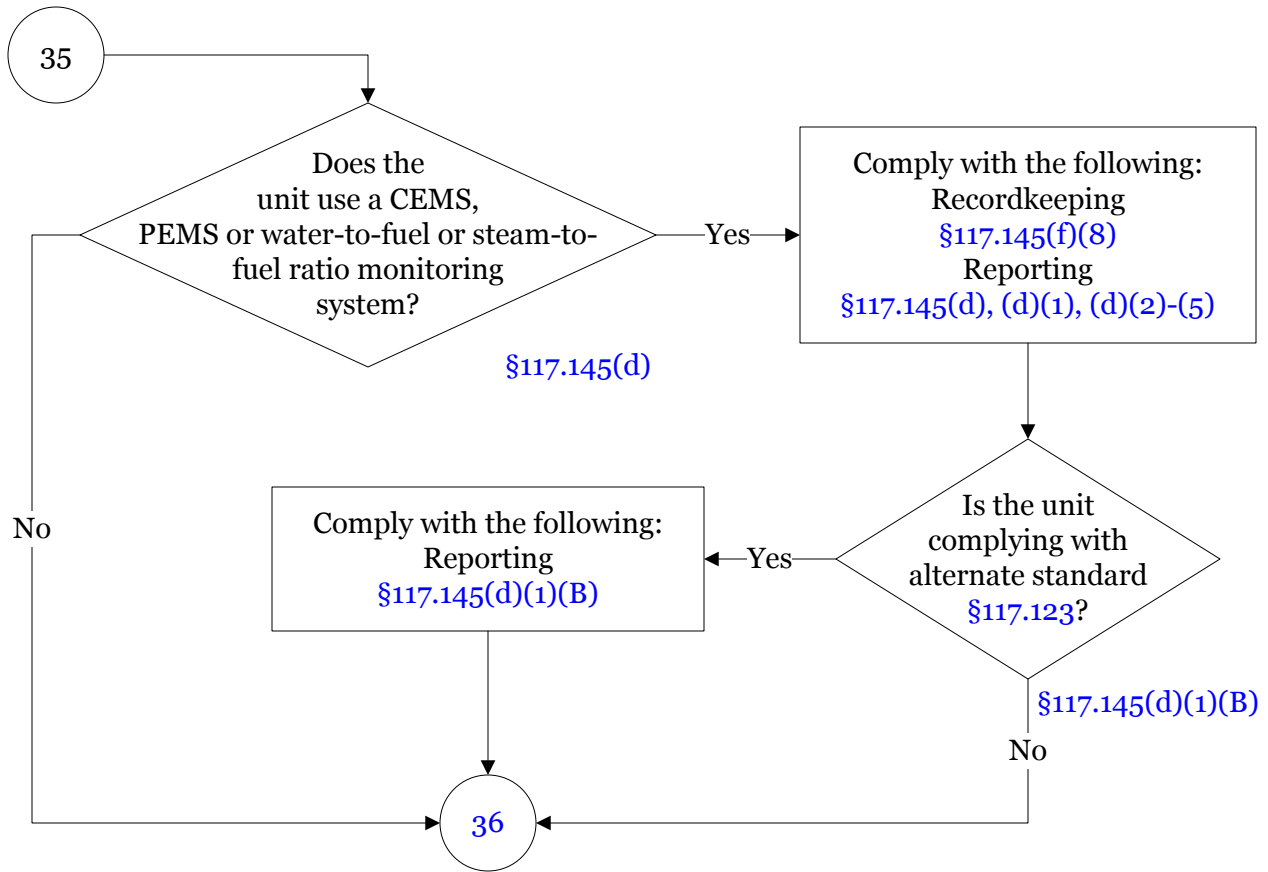


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(26 of 67)**

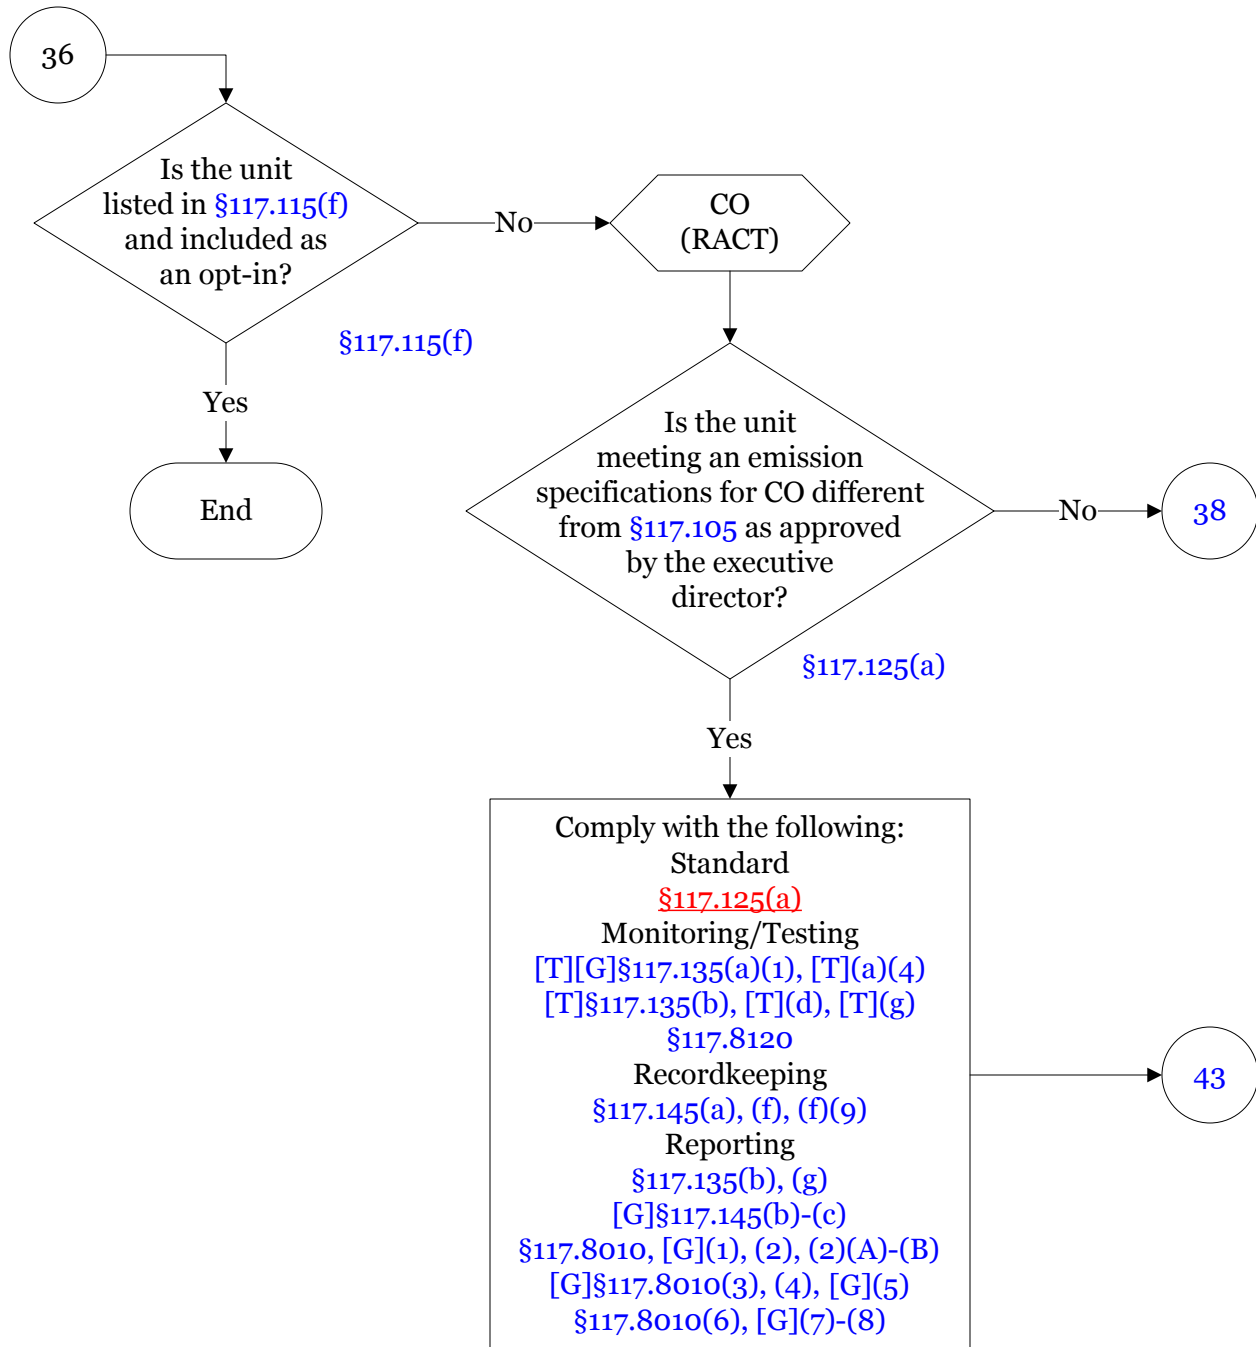


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(27 of 67)**

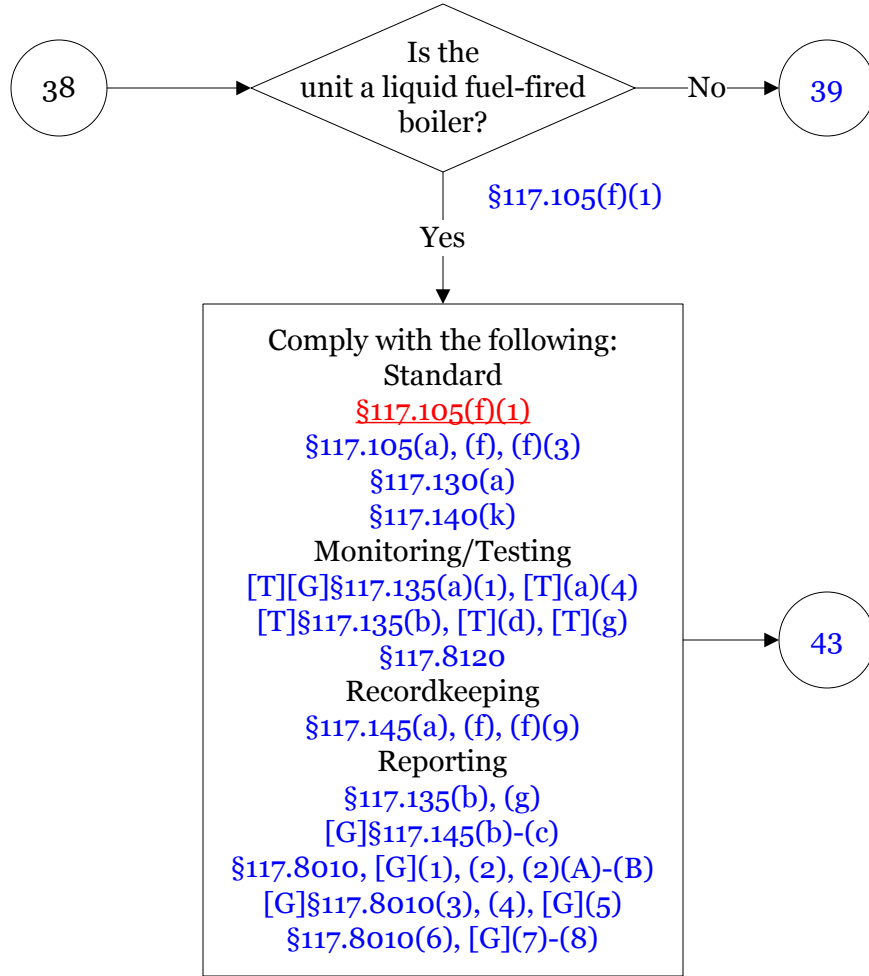


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(28 of 67)**

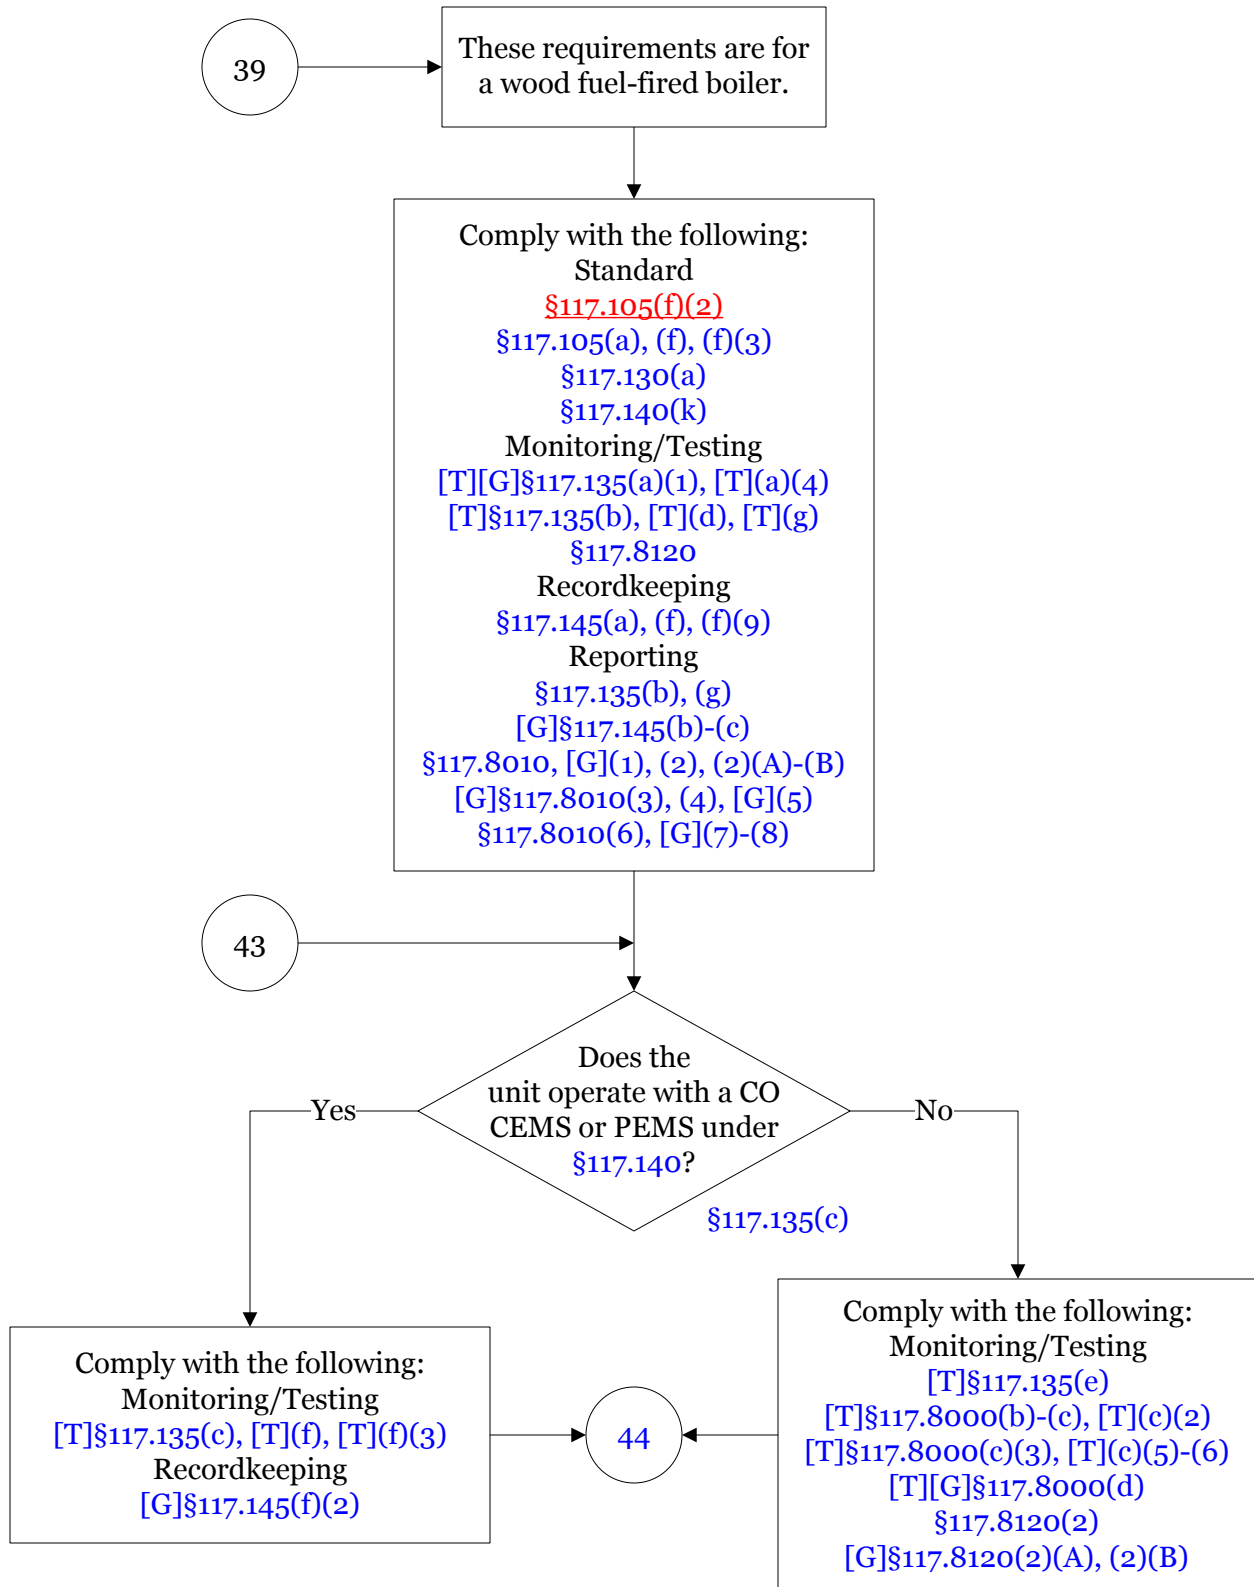


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(29 of 67)**

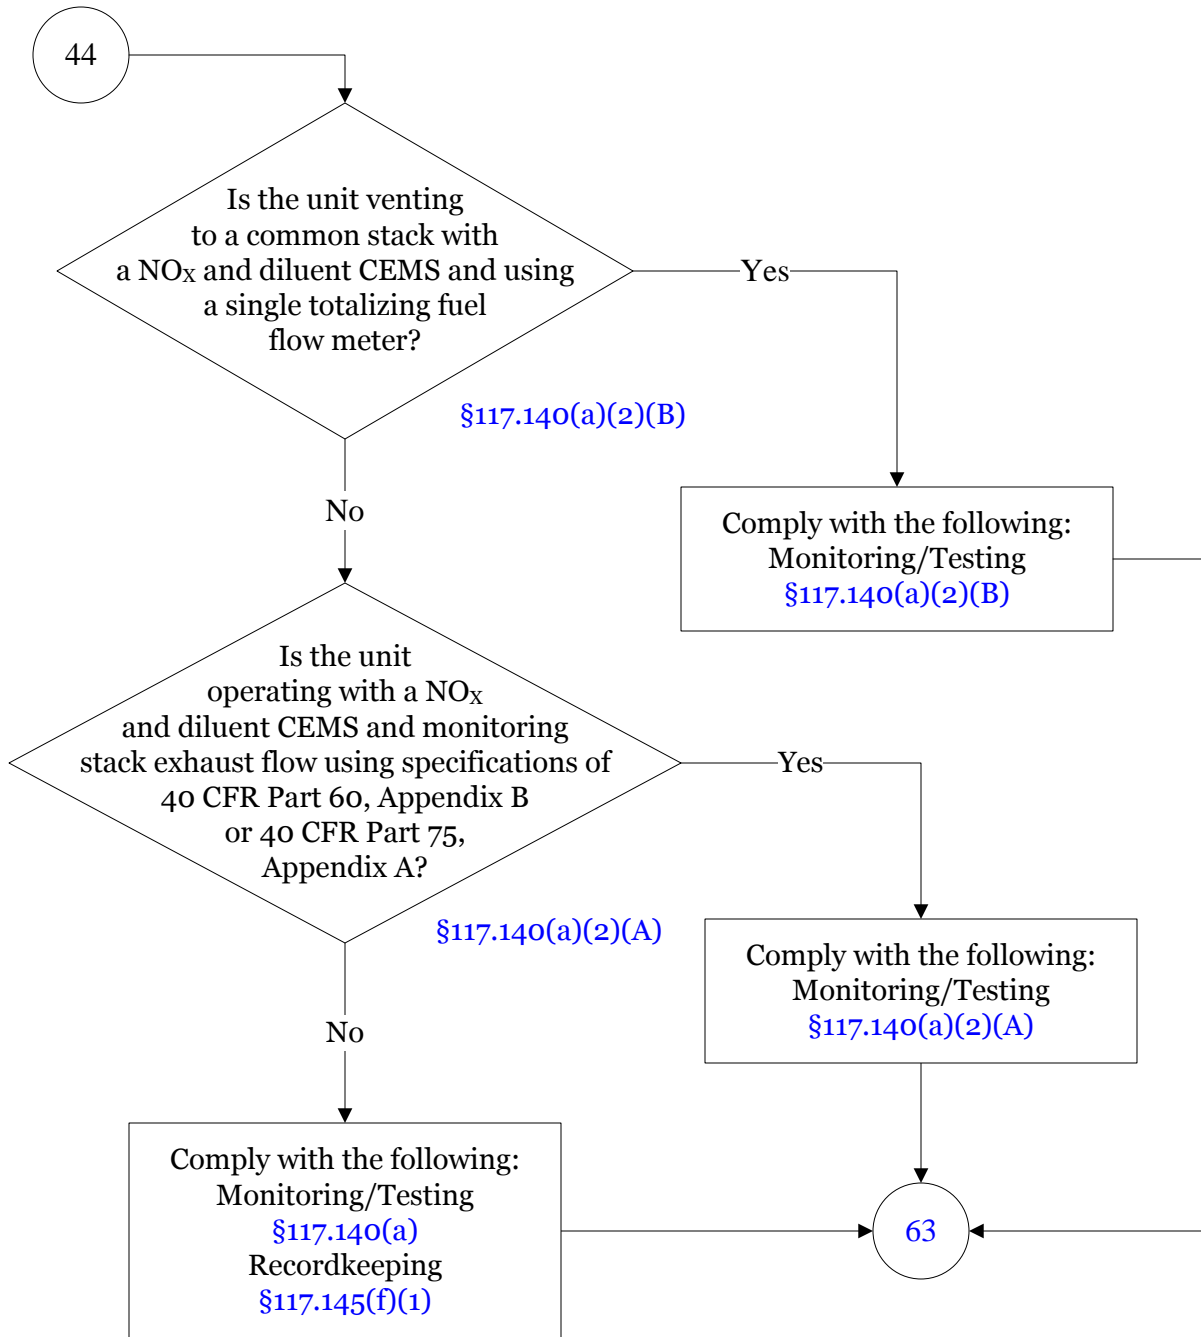


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(30 of 67)**

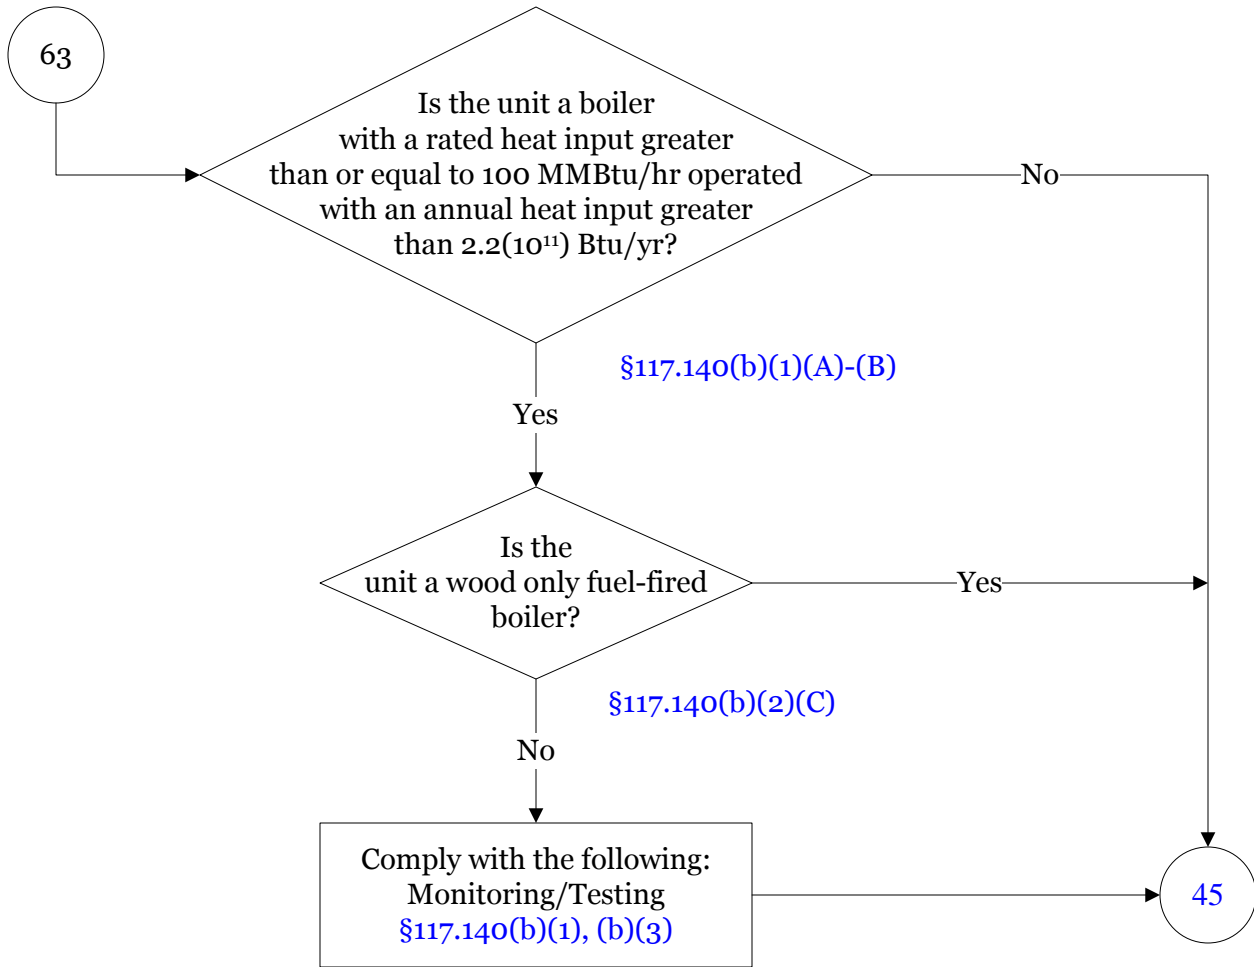

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(31 of 67)**

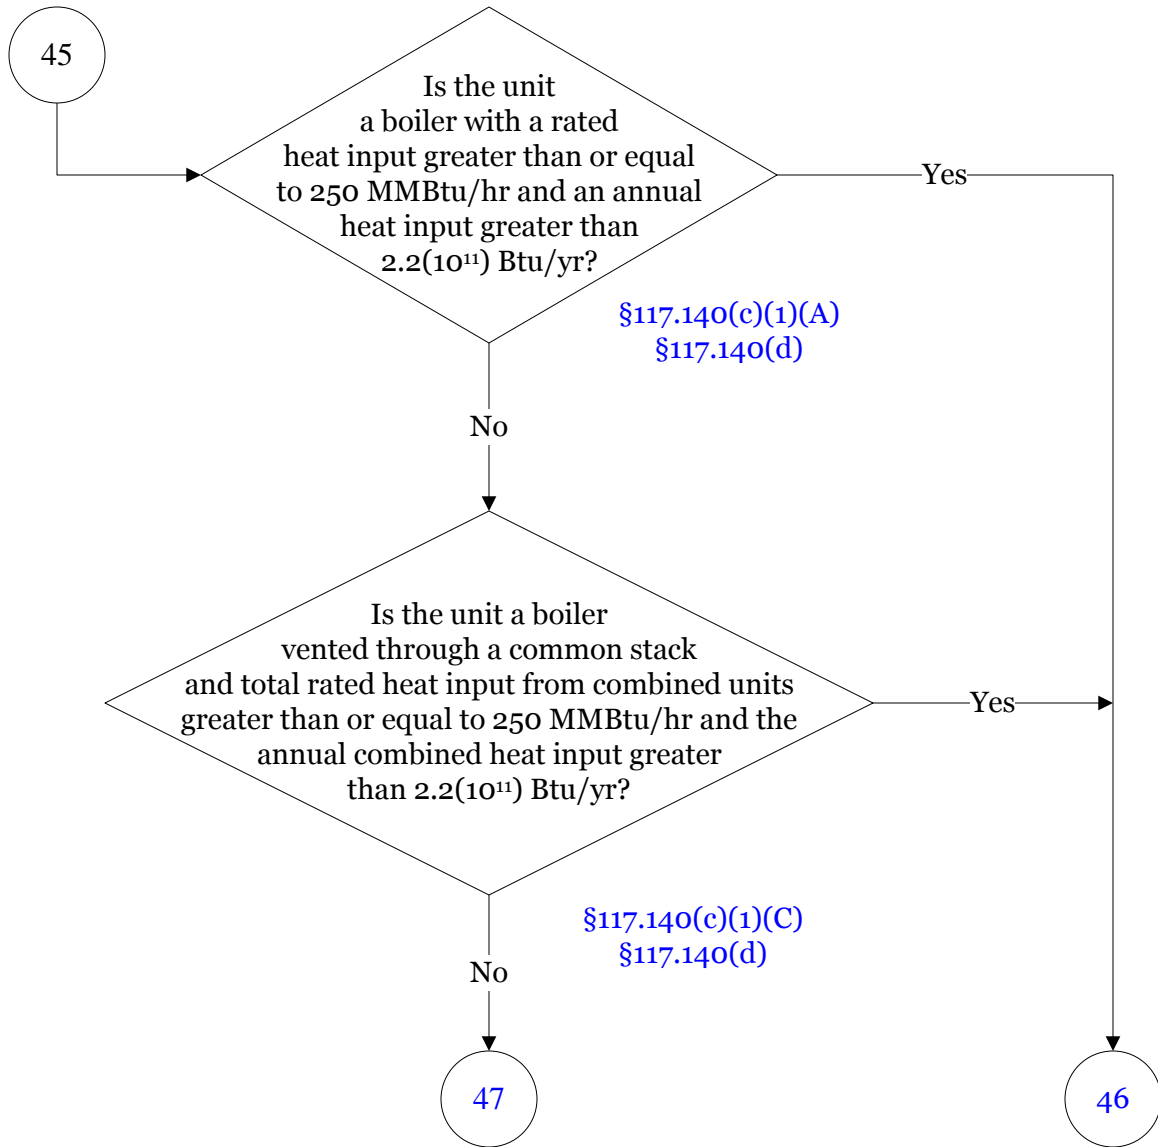


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(32 of 67)**

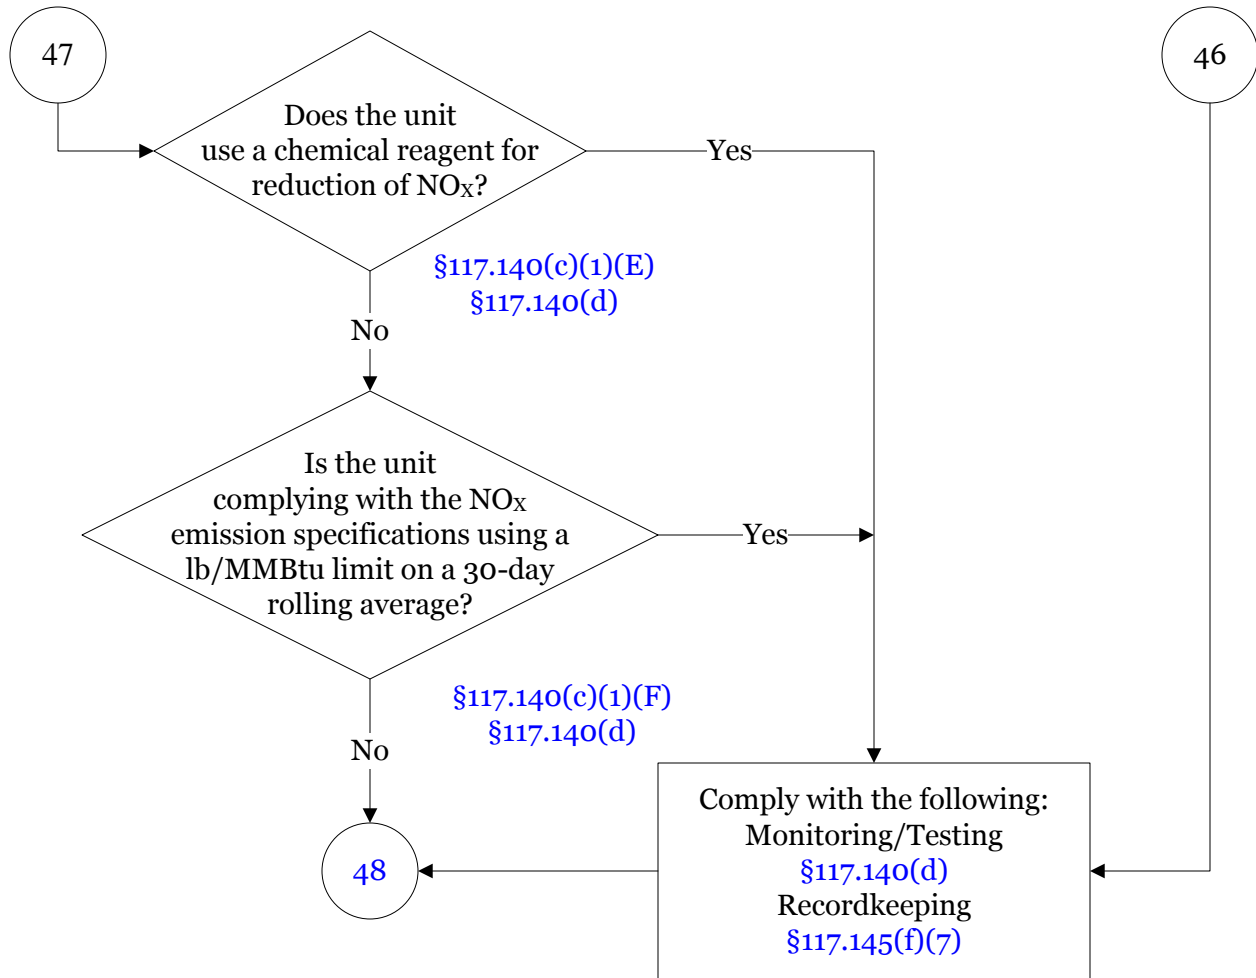





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(33 of 67)**

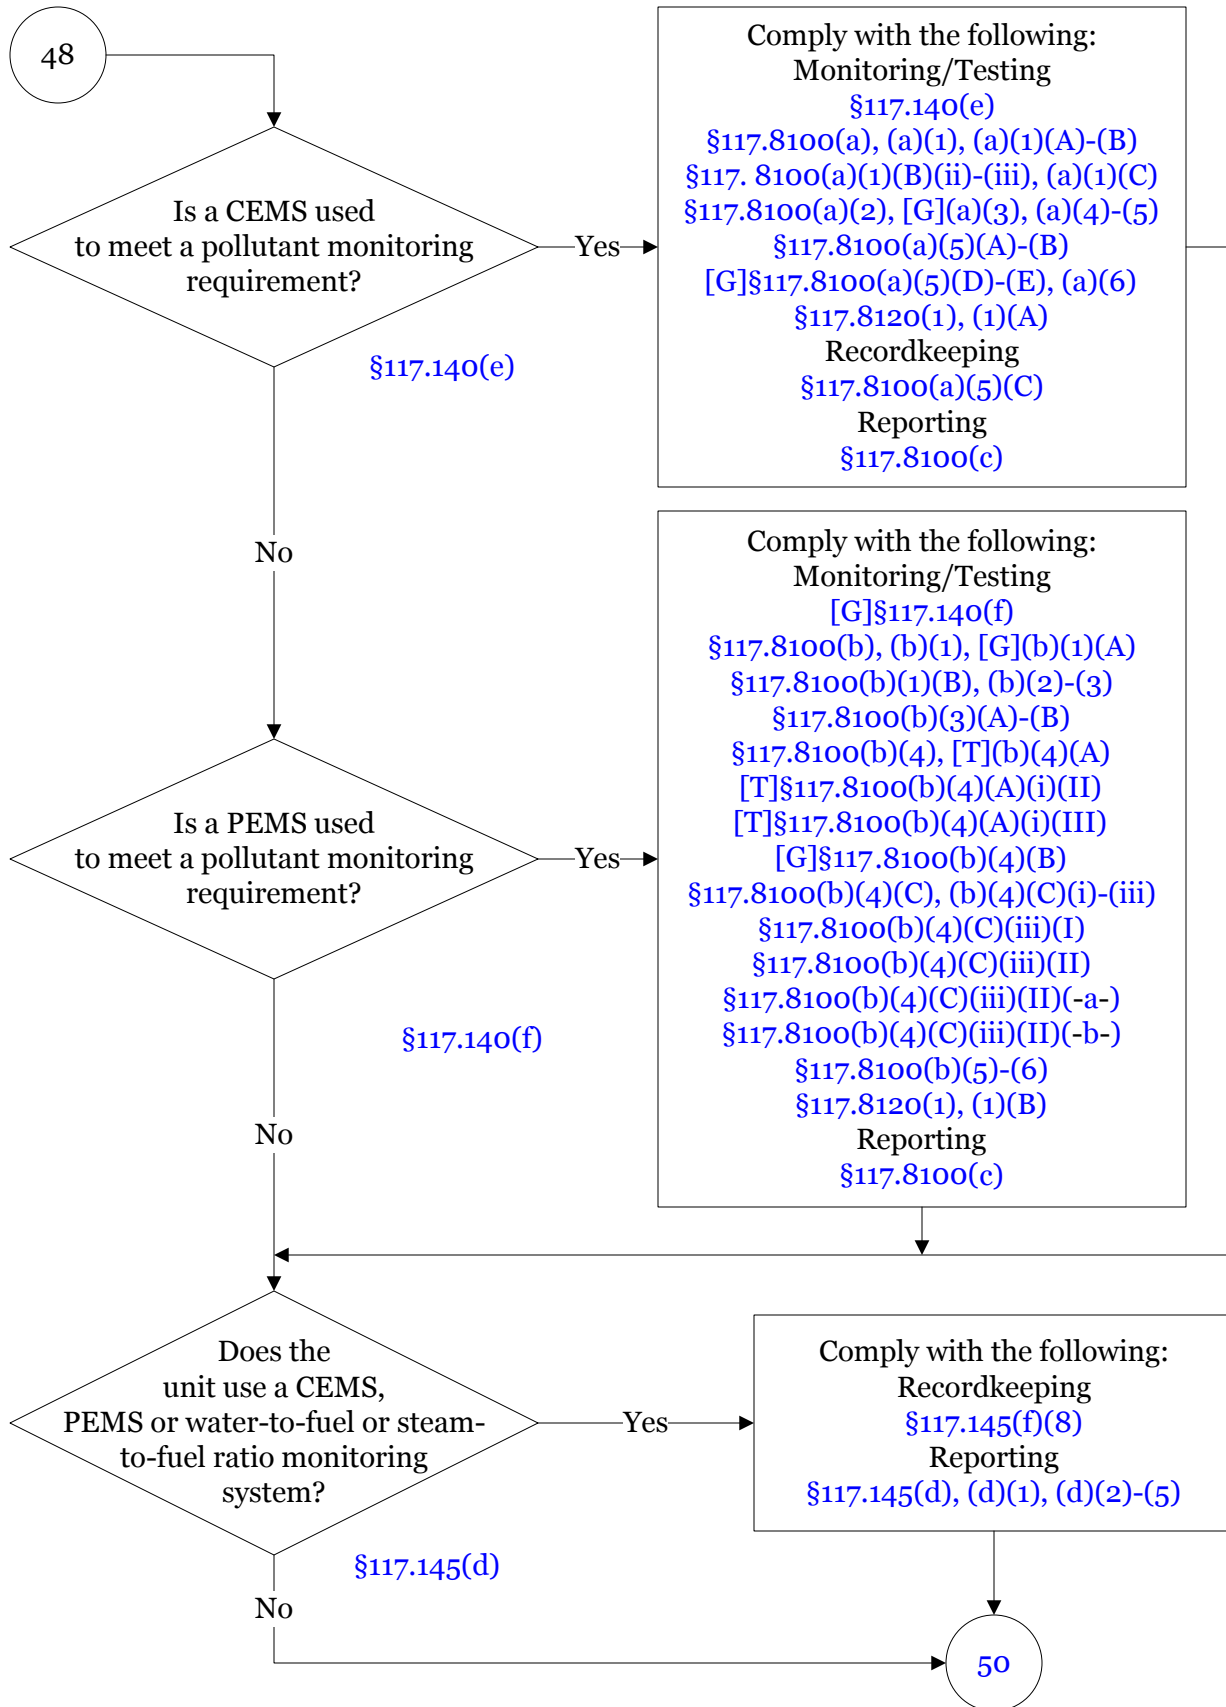


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(34 of 67)**

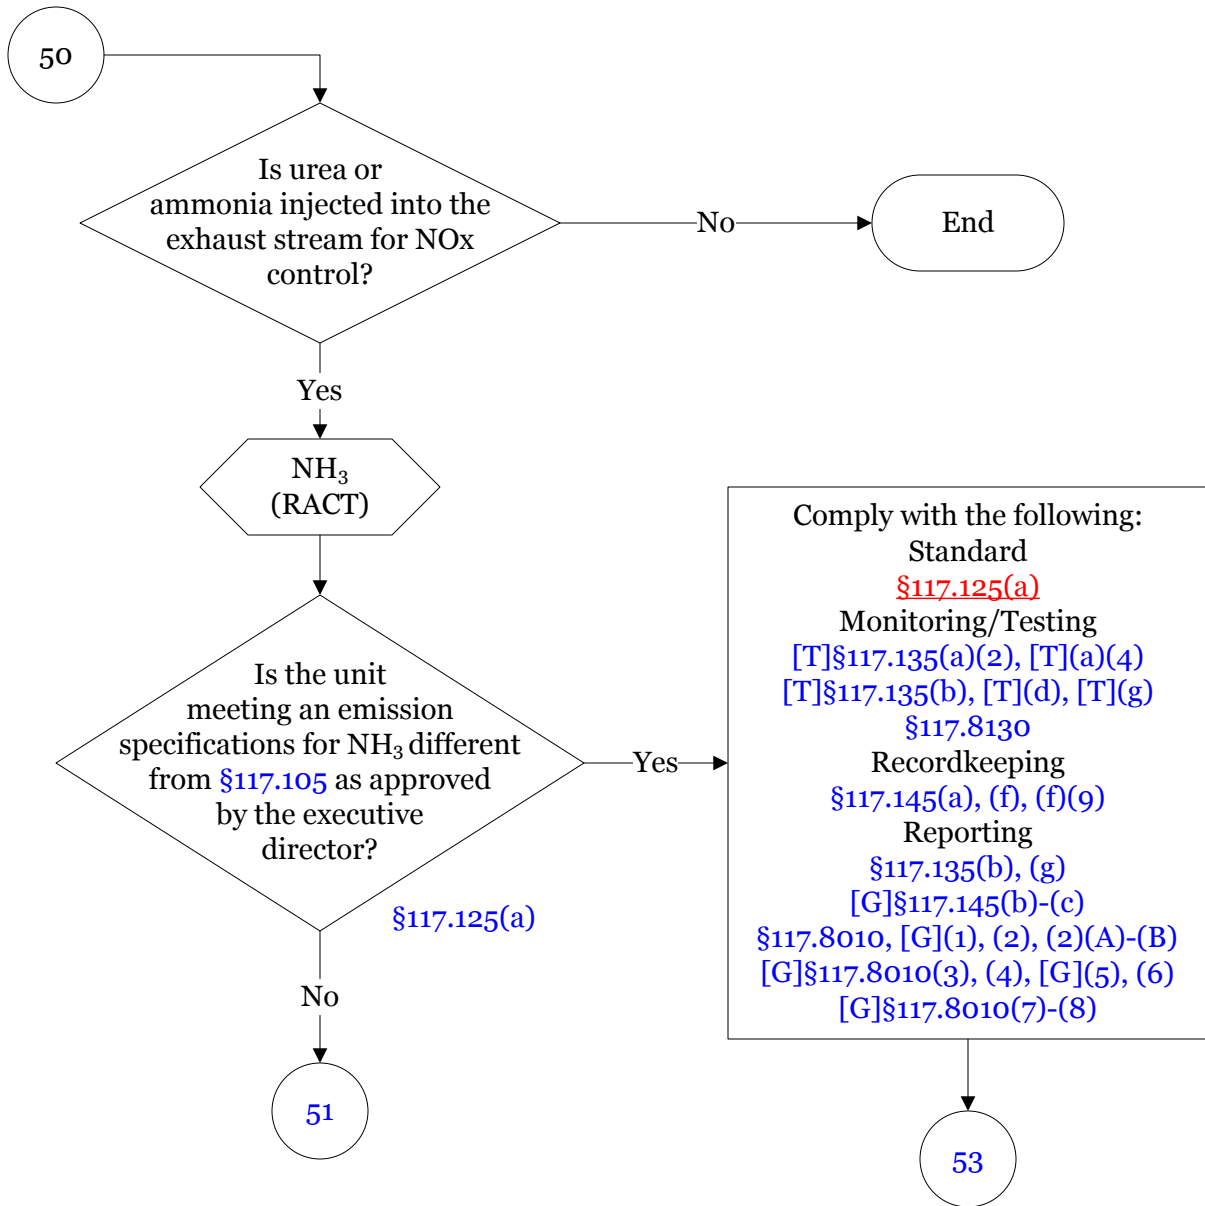


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(35 of 67)**

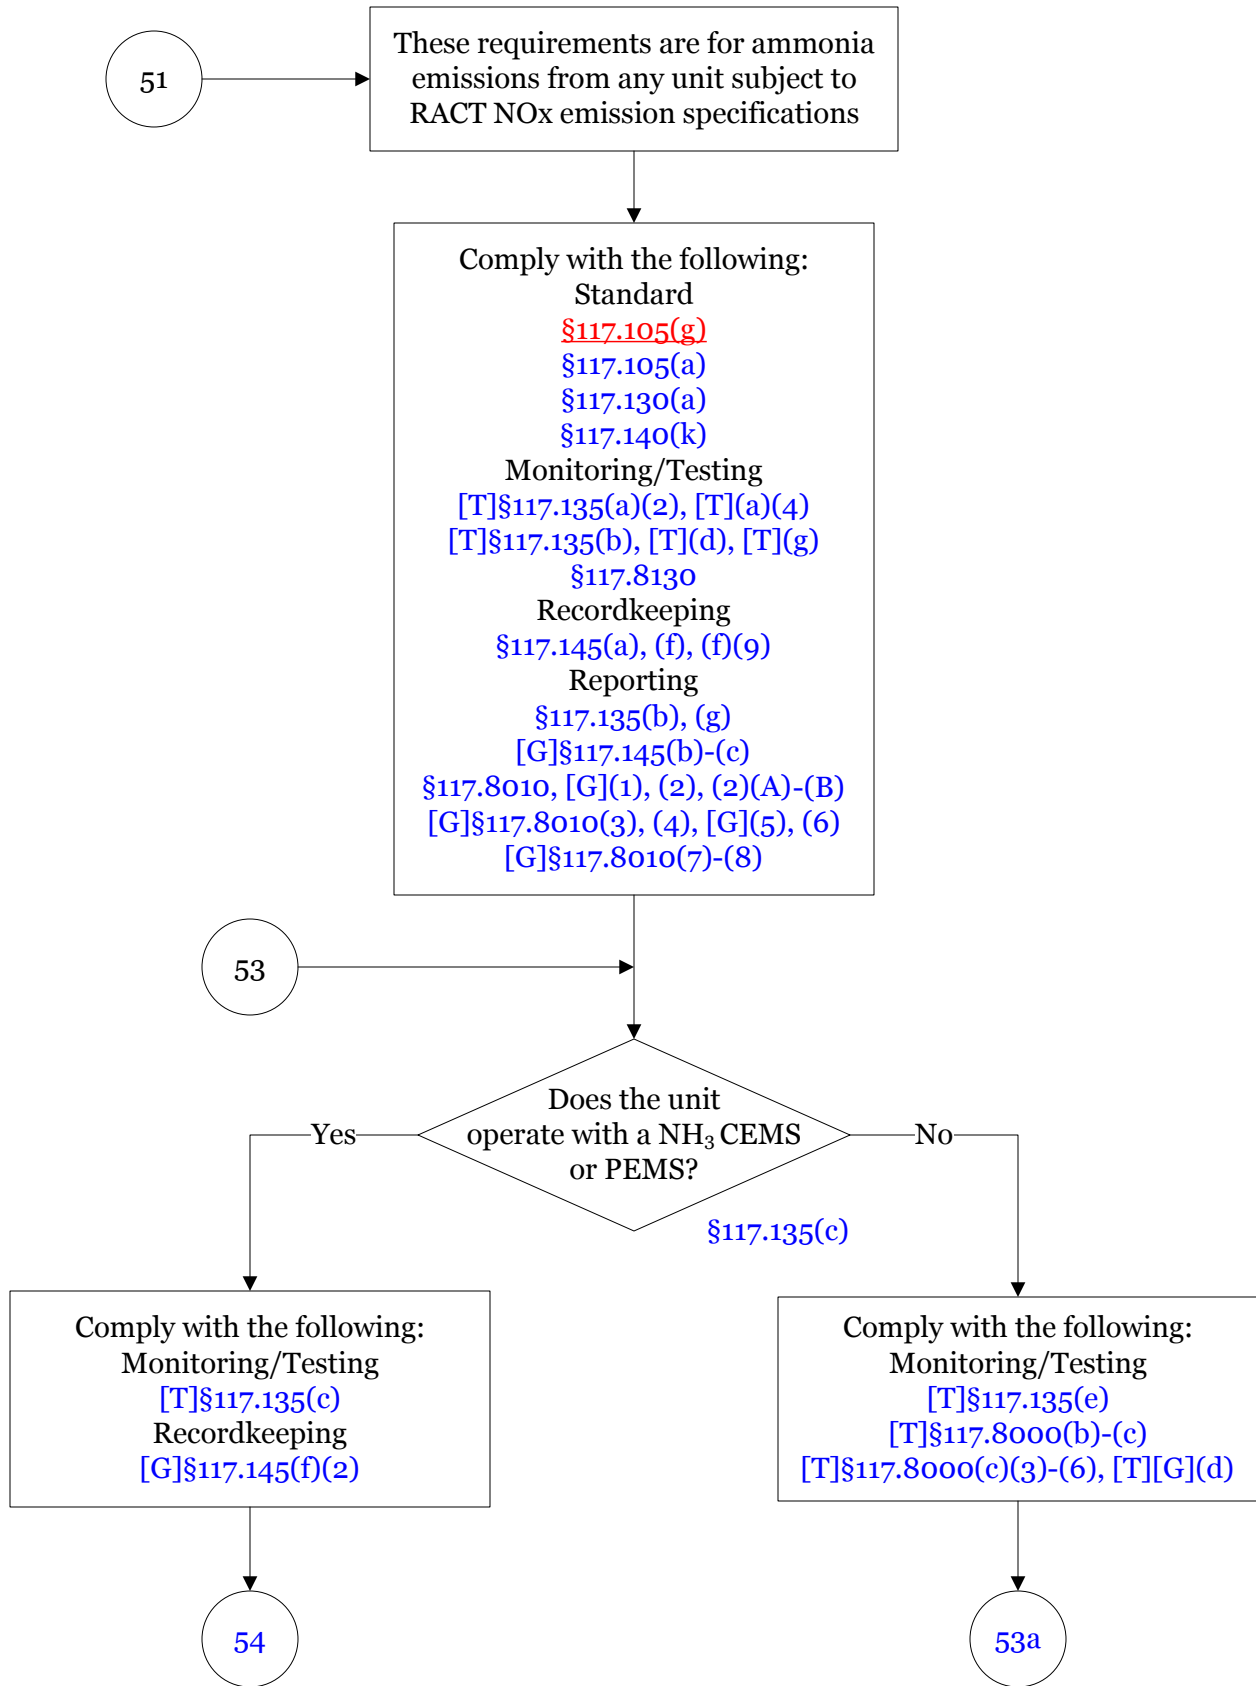


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(36 of 67)**

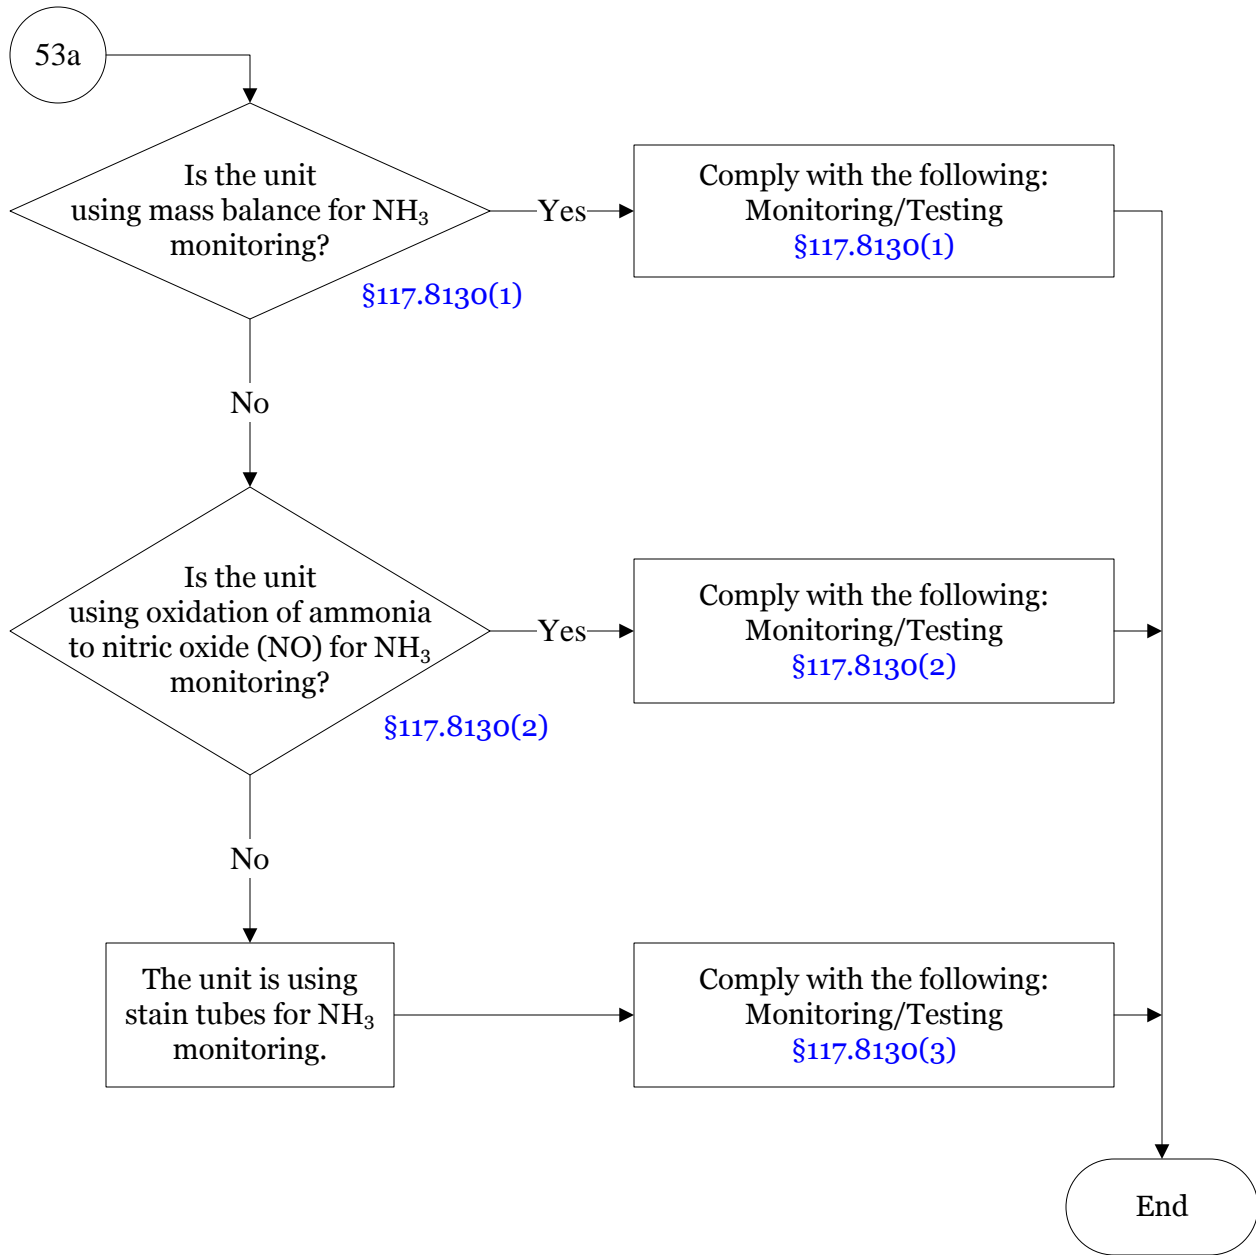


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(37 of 67)**

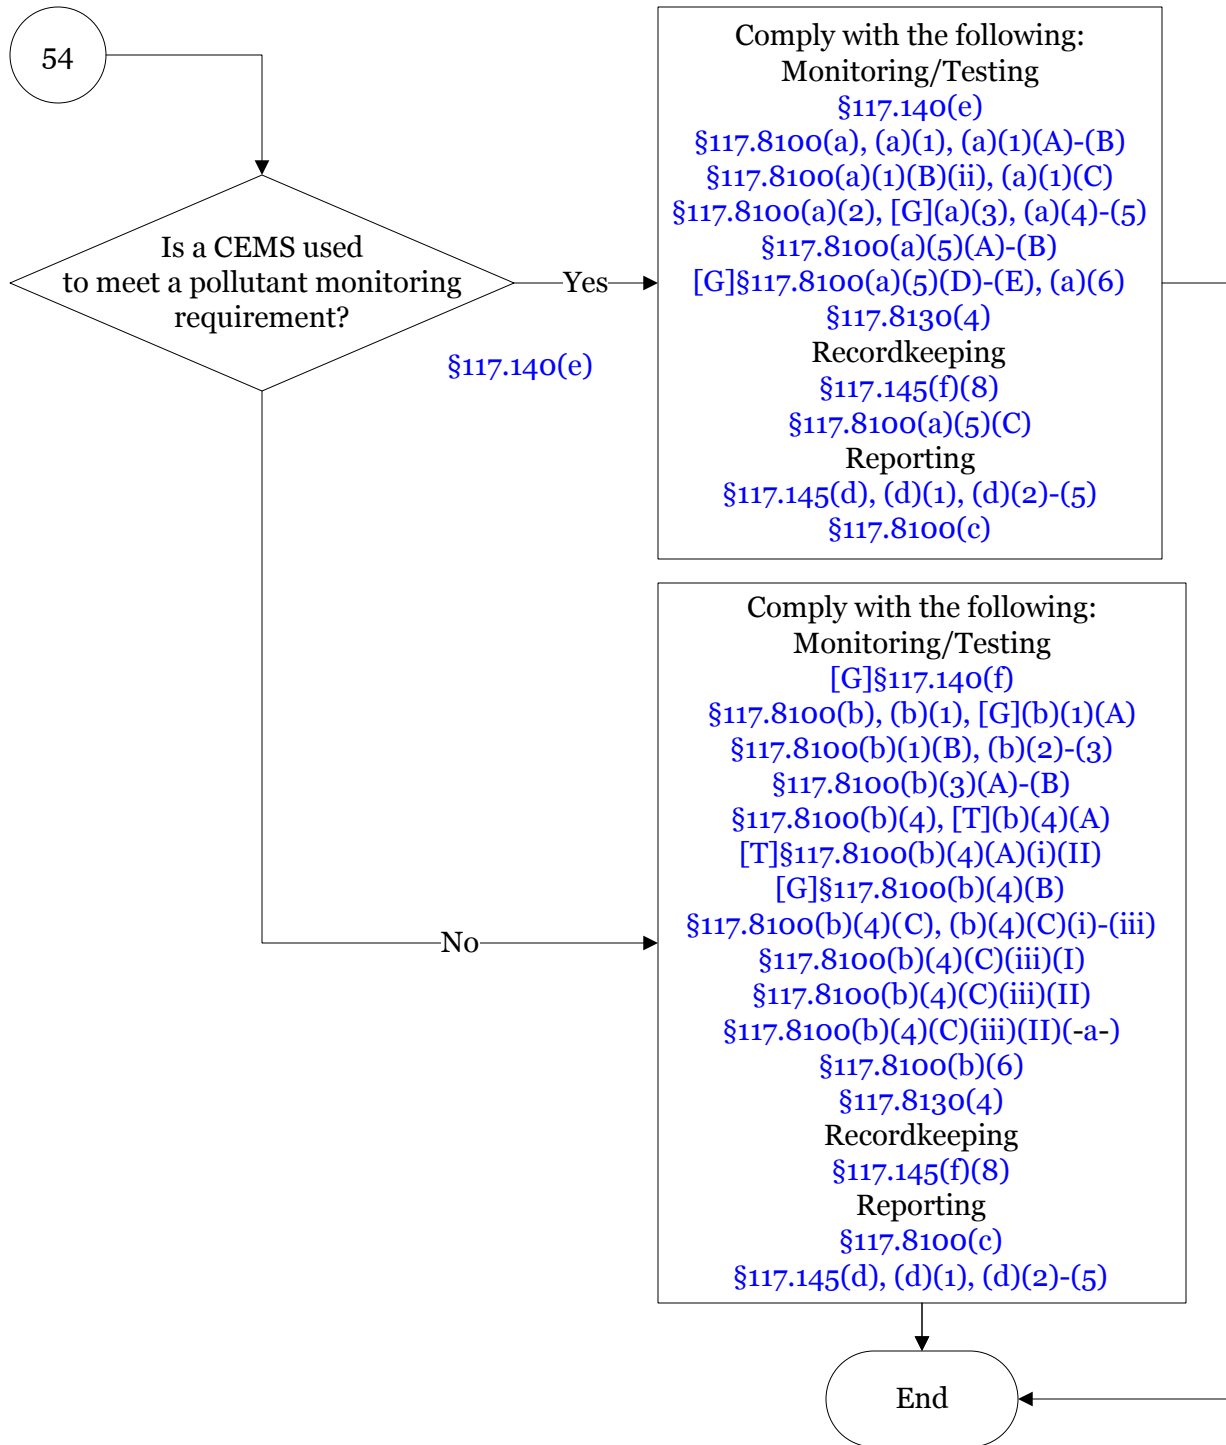


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(38 of 67)**

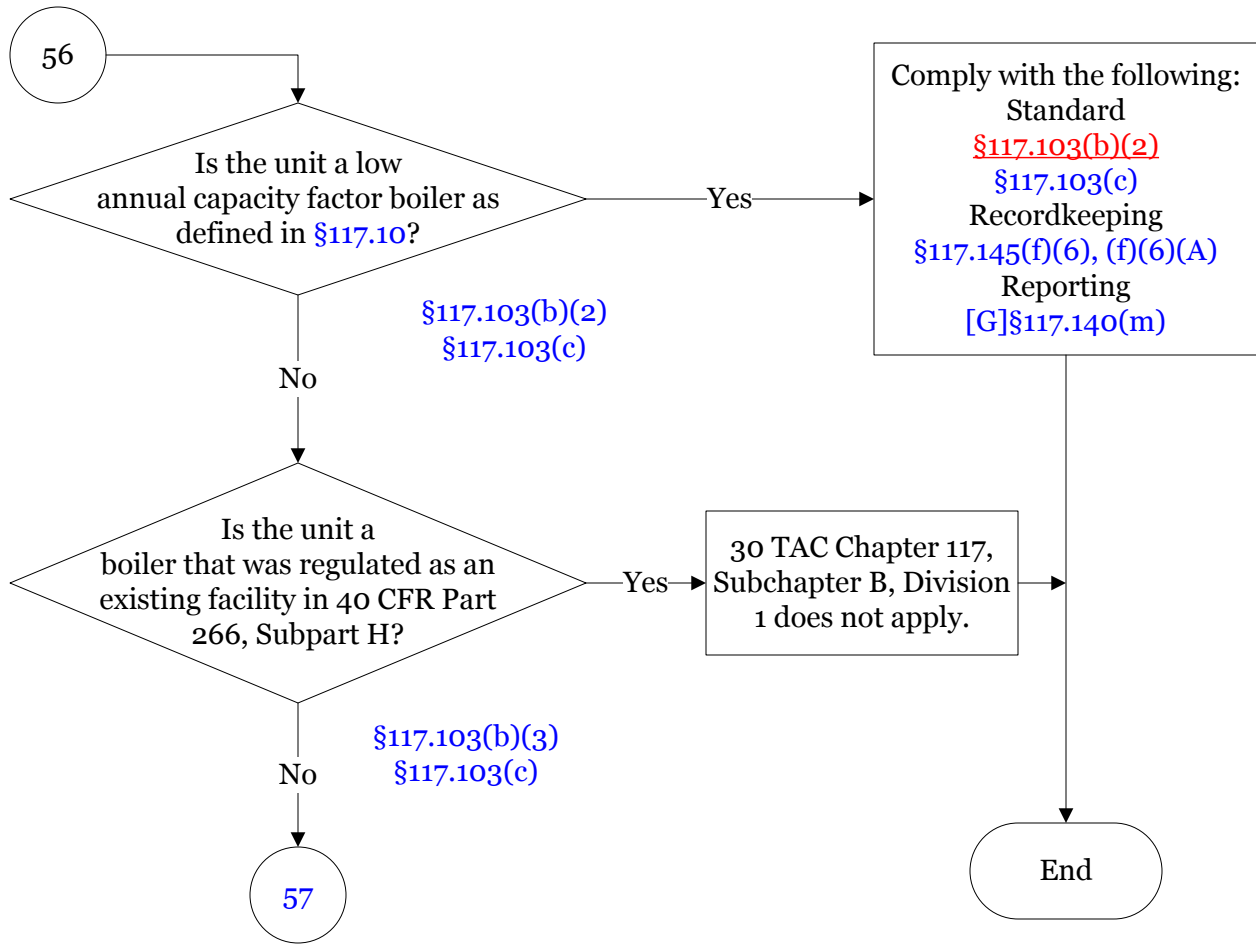

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(39 of 67)**

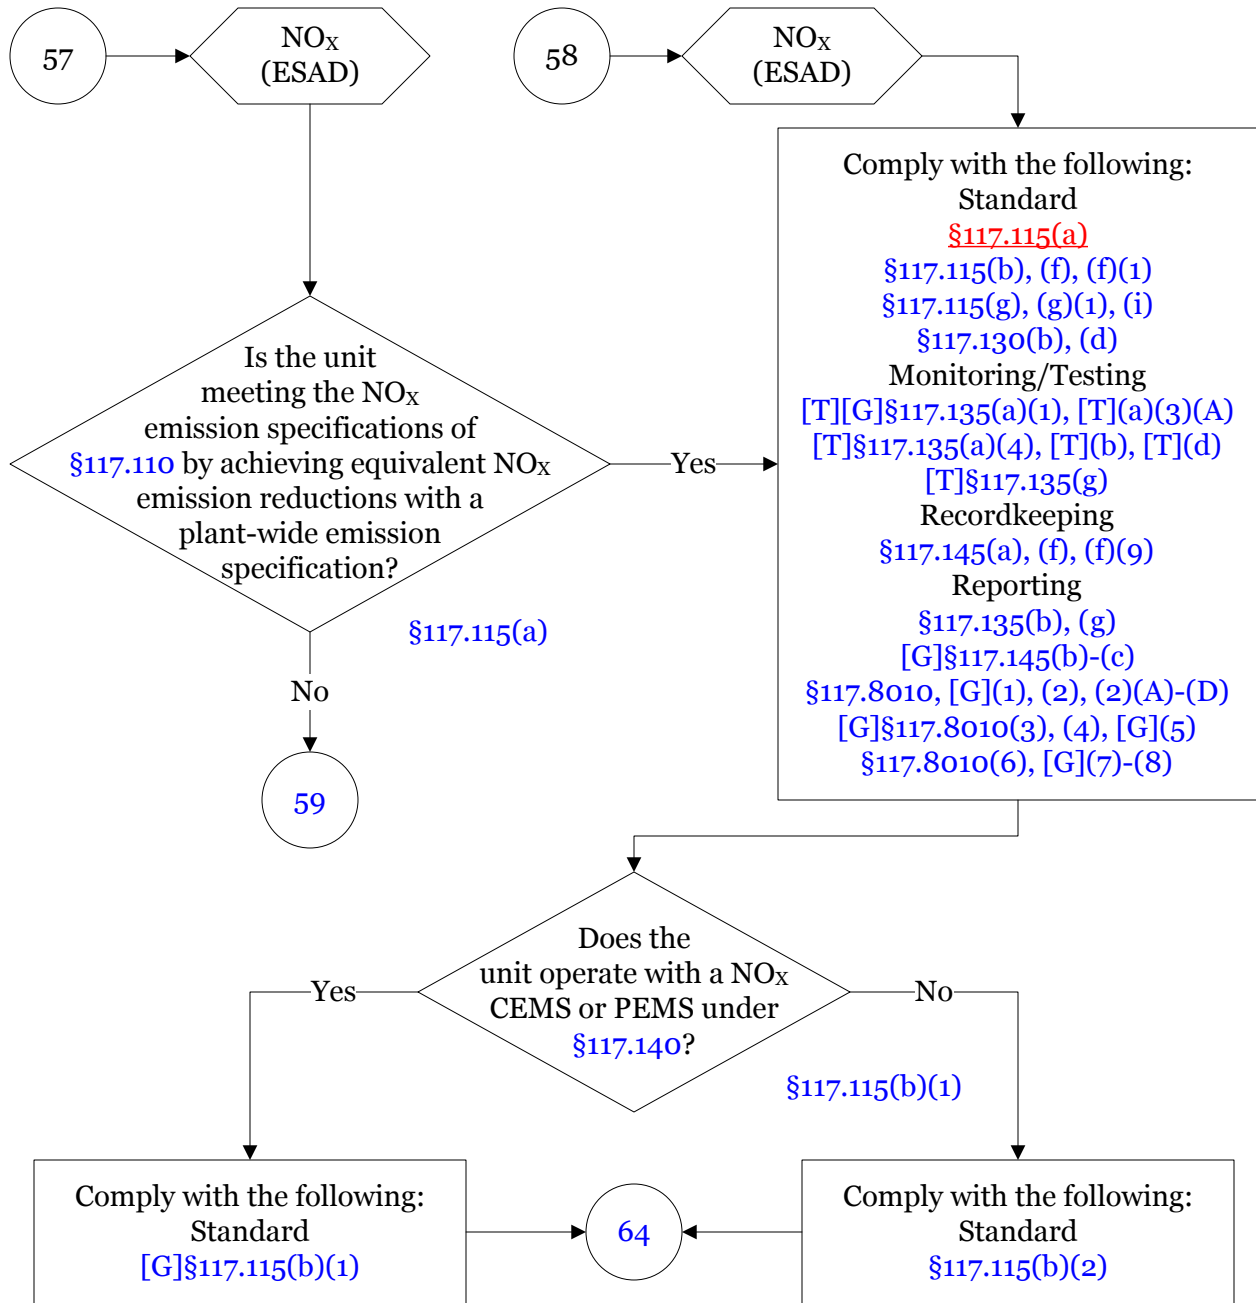


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(40 of 67)**

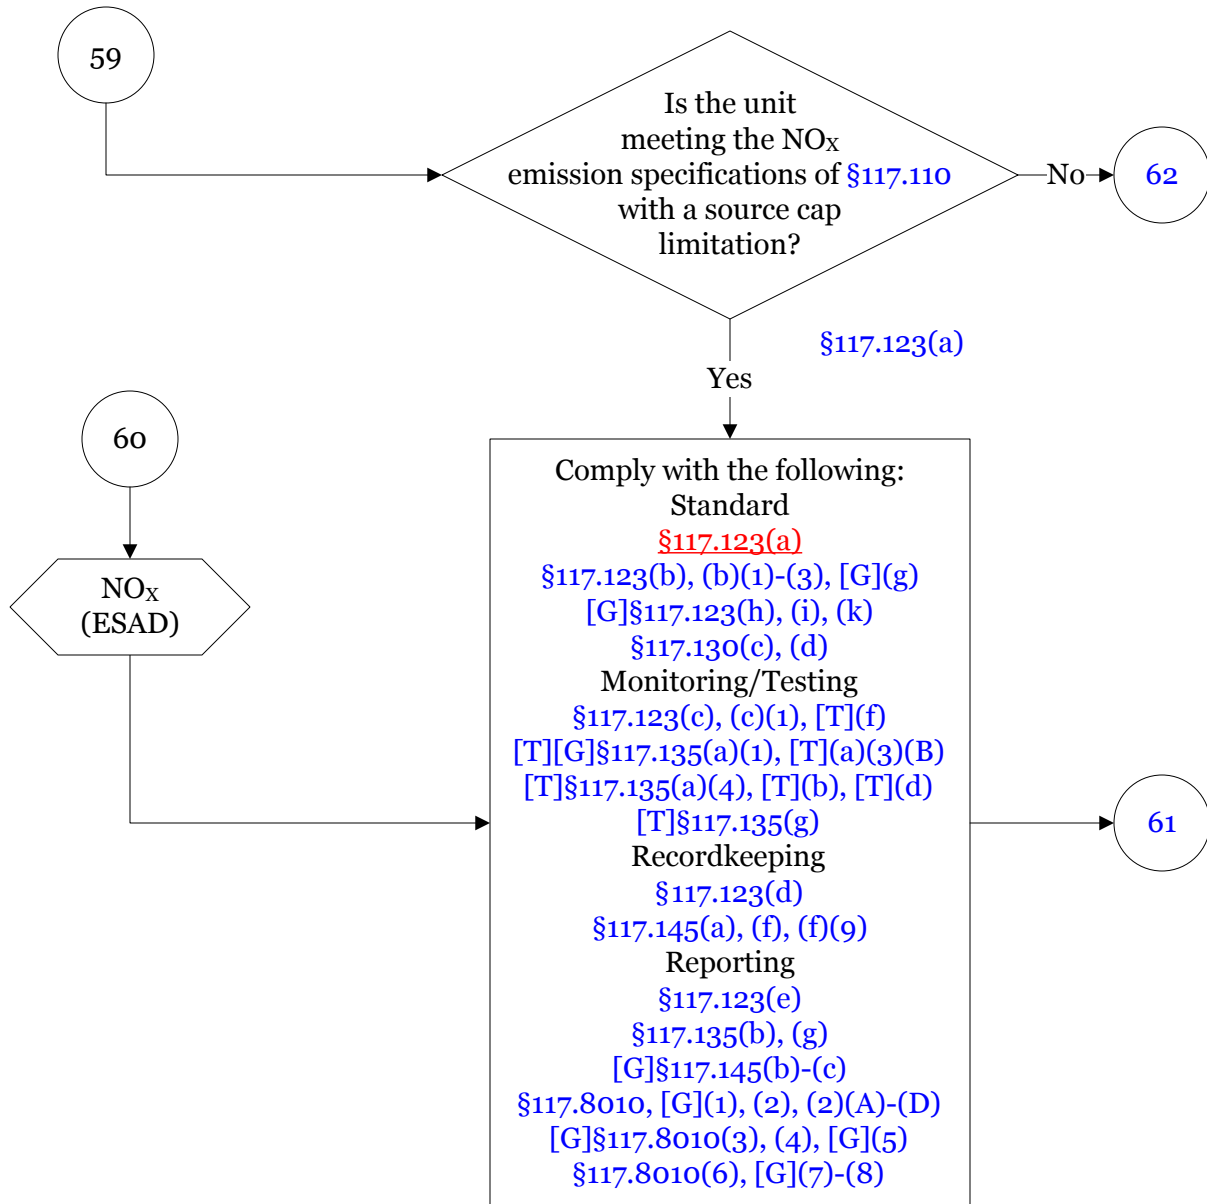





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(41 of 67)**

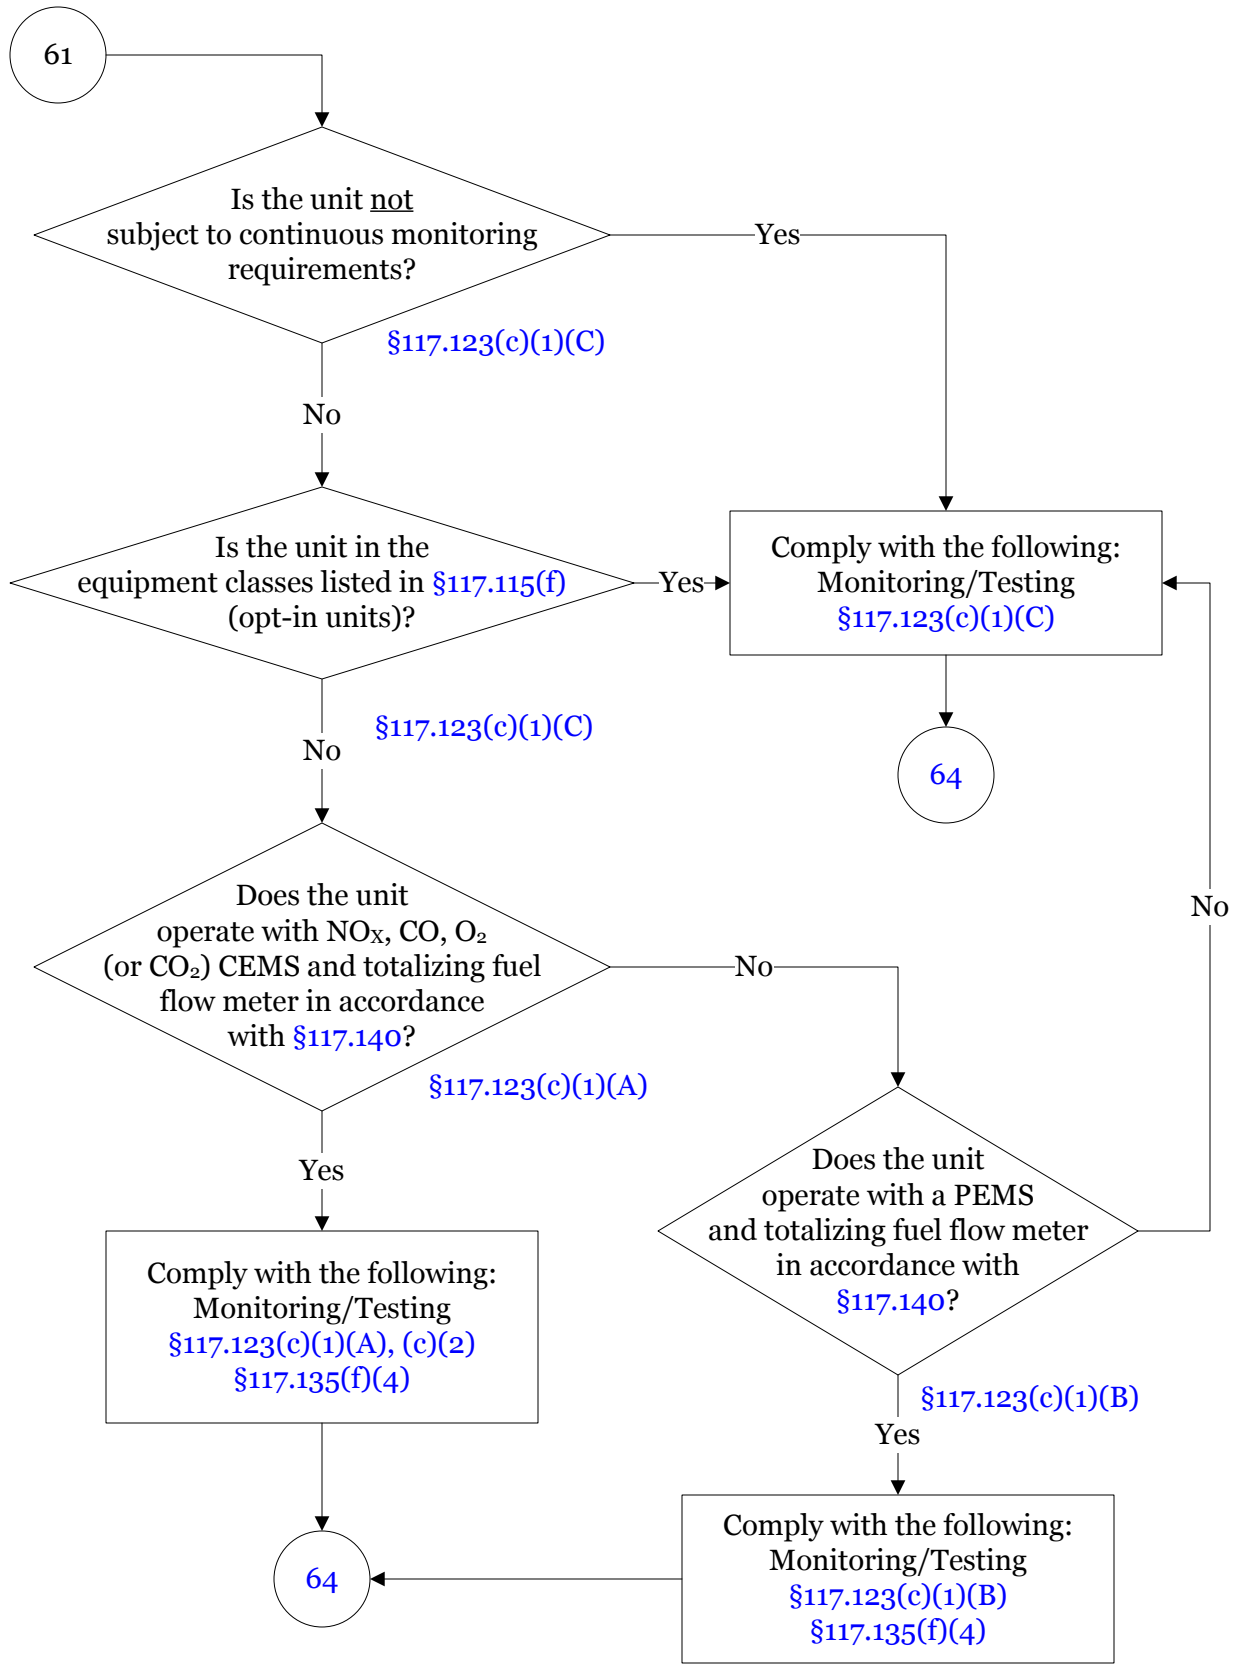


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(42 of 67)**

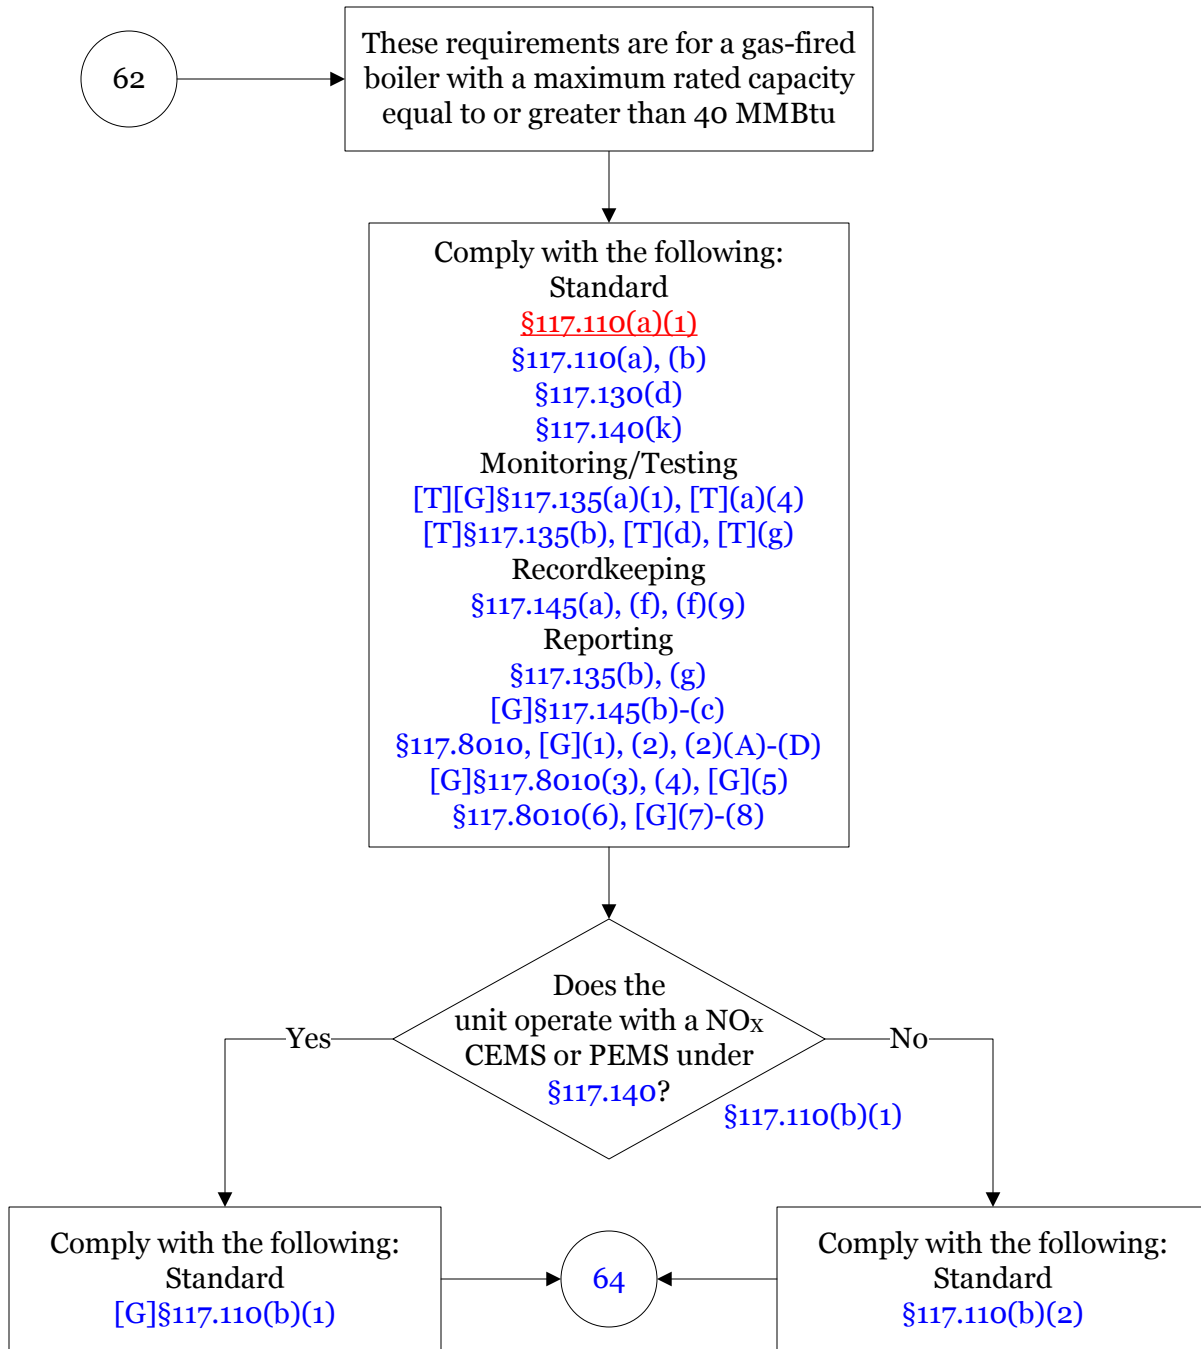


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(43 of 67)**

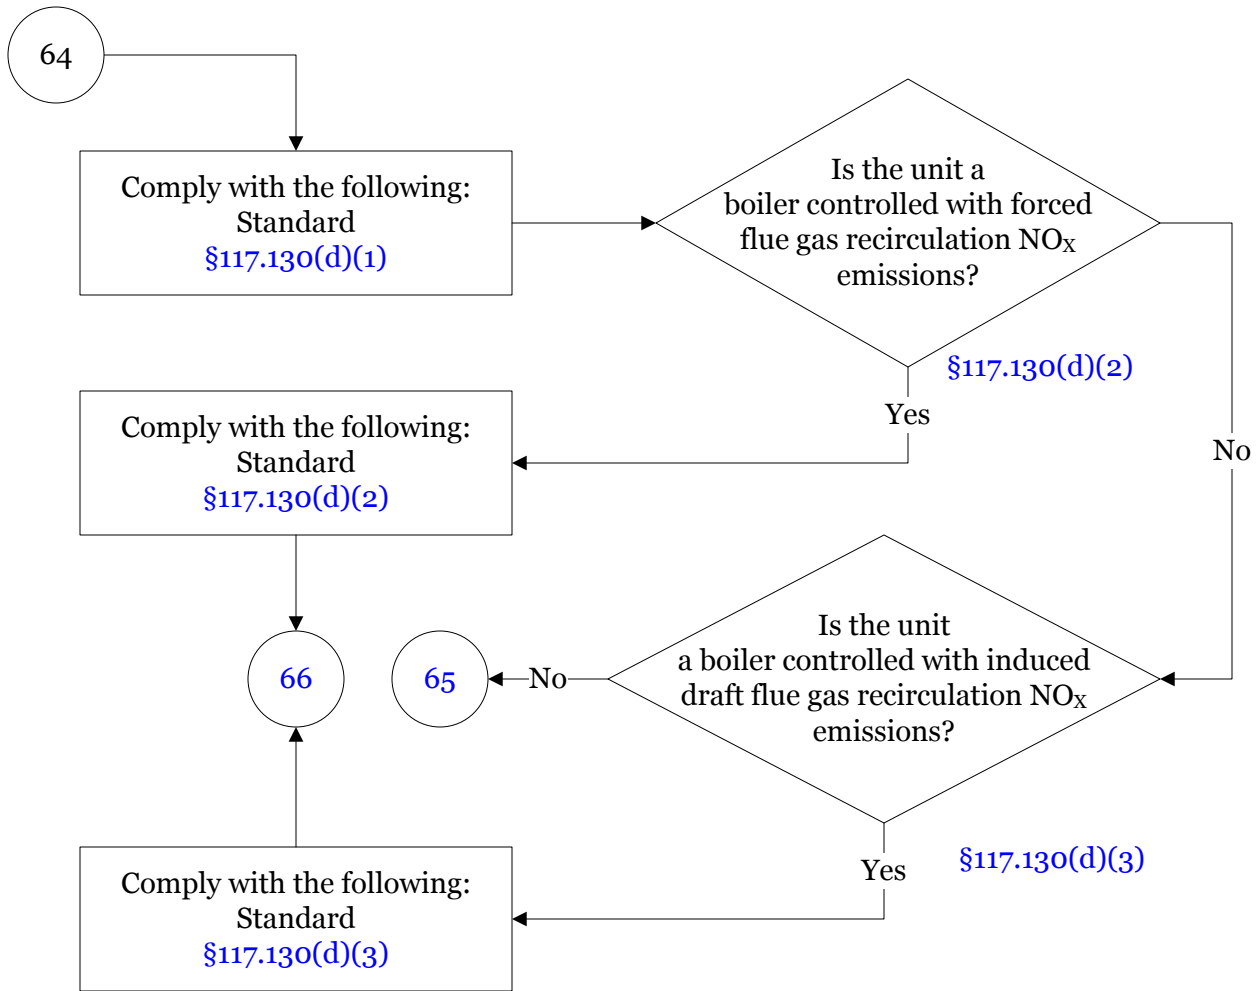


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(44 of 67)**

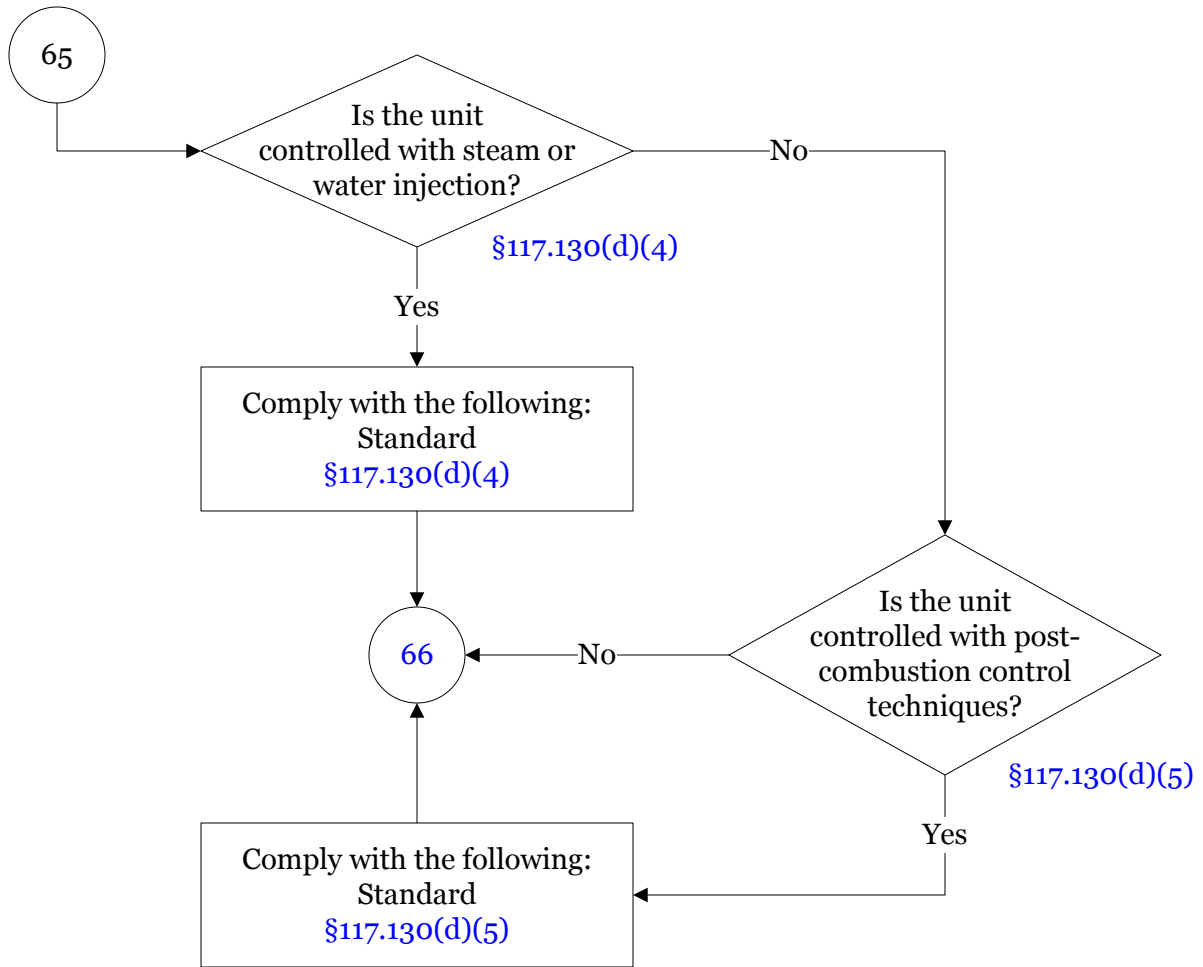


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(45 of 67)**

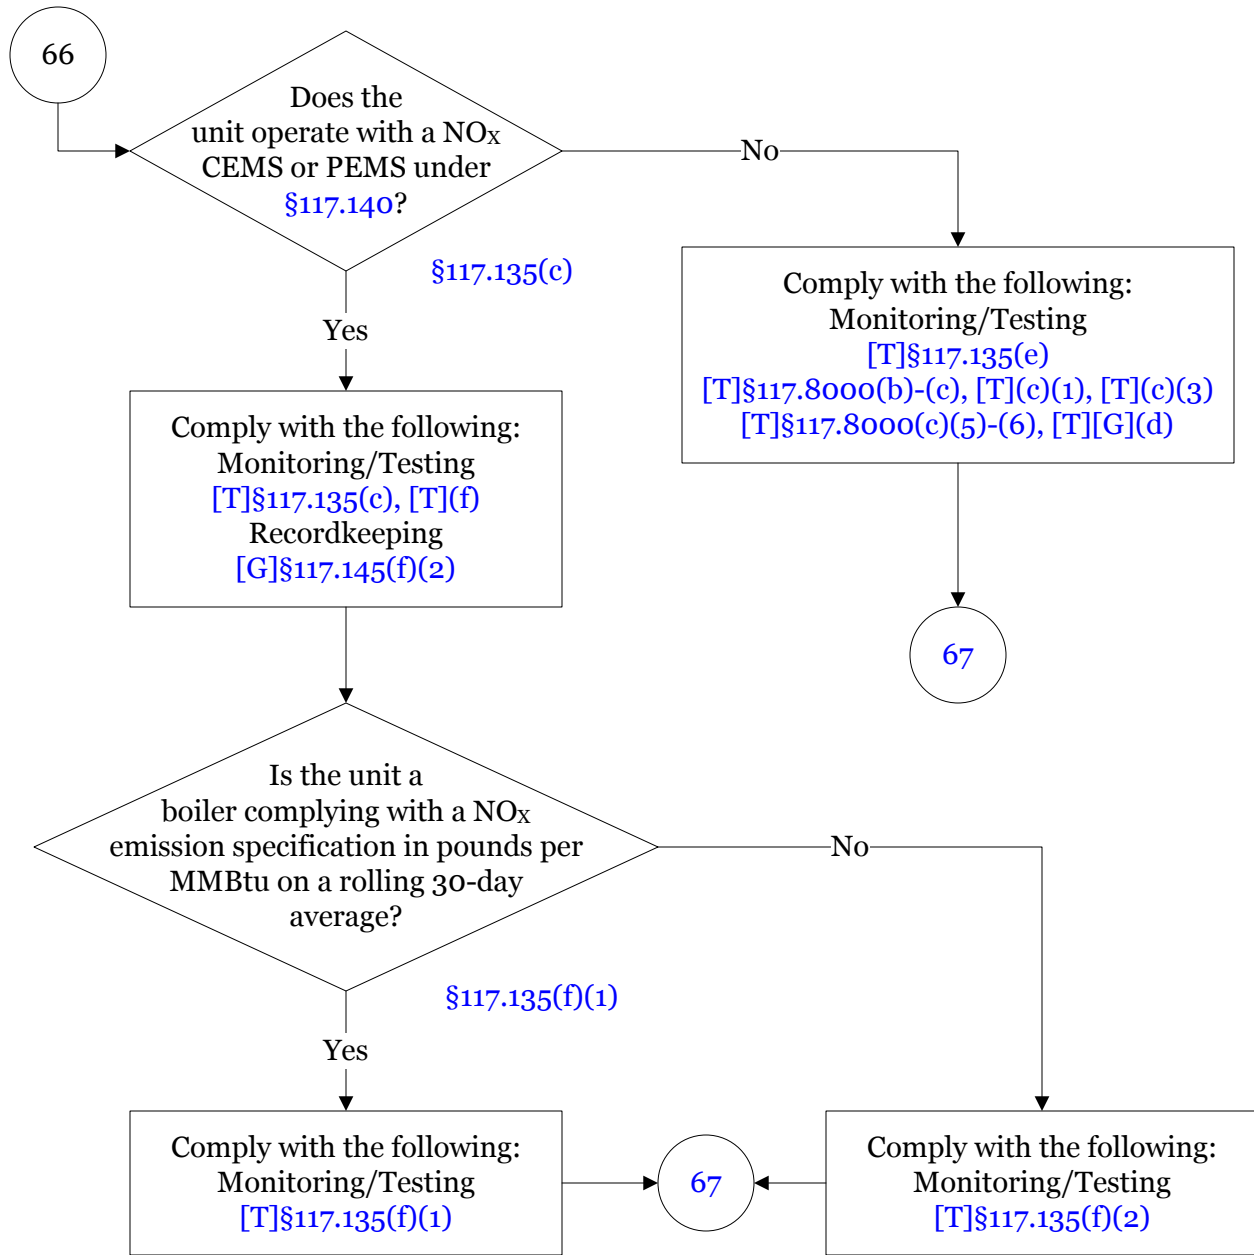


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(46 of 67)**

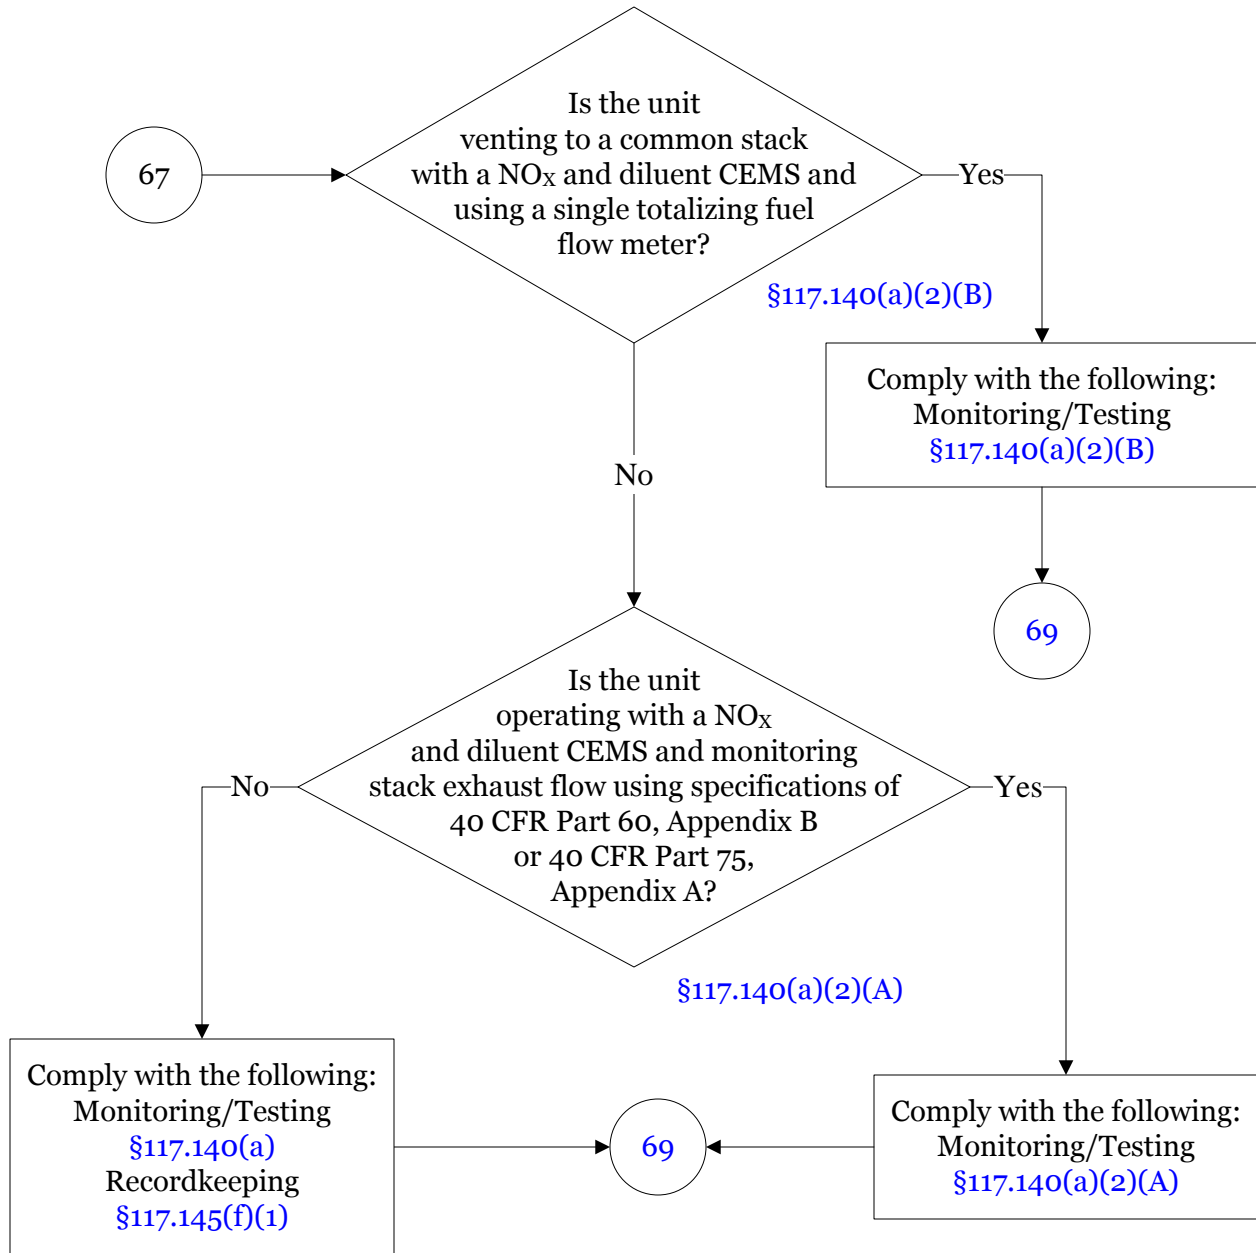

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(47 of 67)**

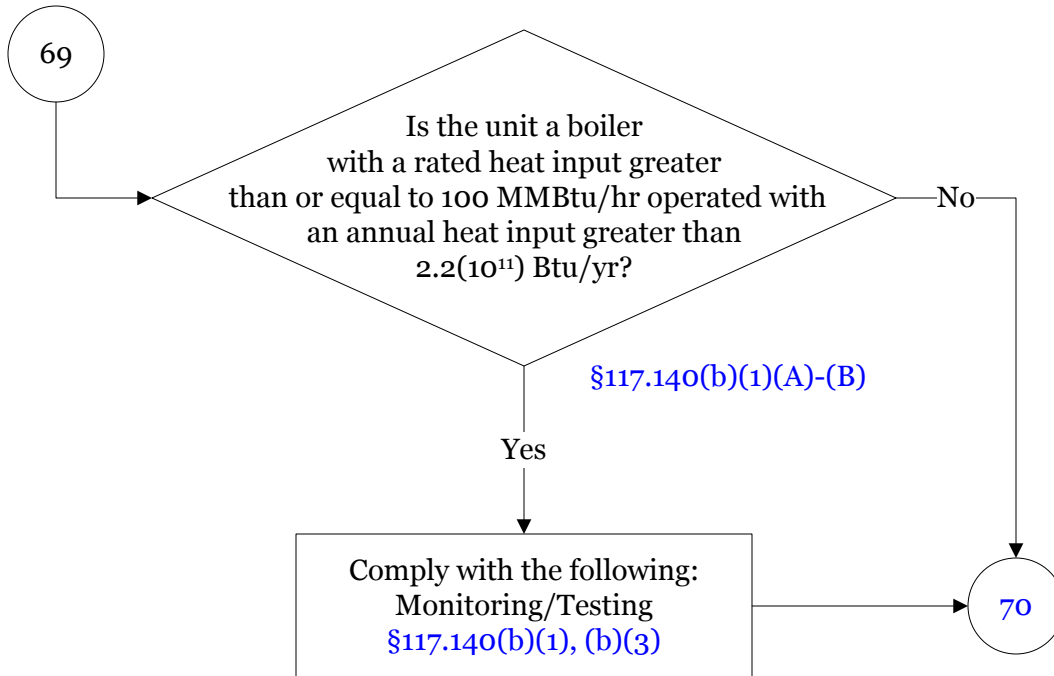


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(48 of 67)**

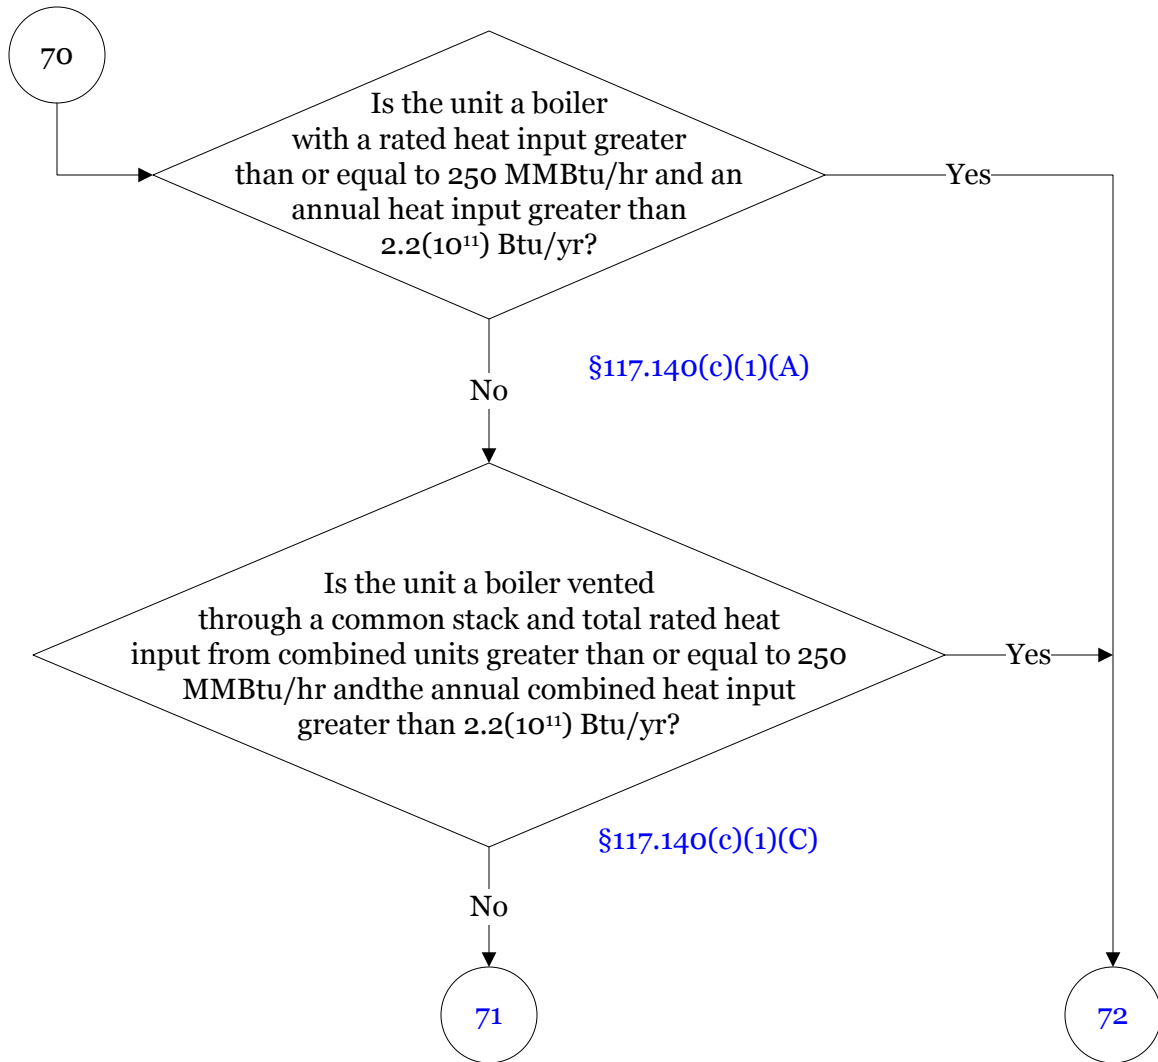





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(49 of 67)**

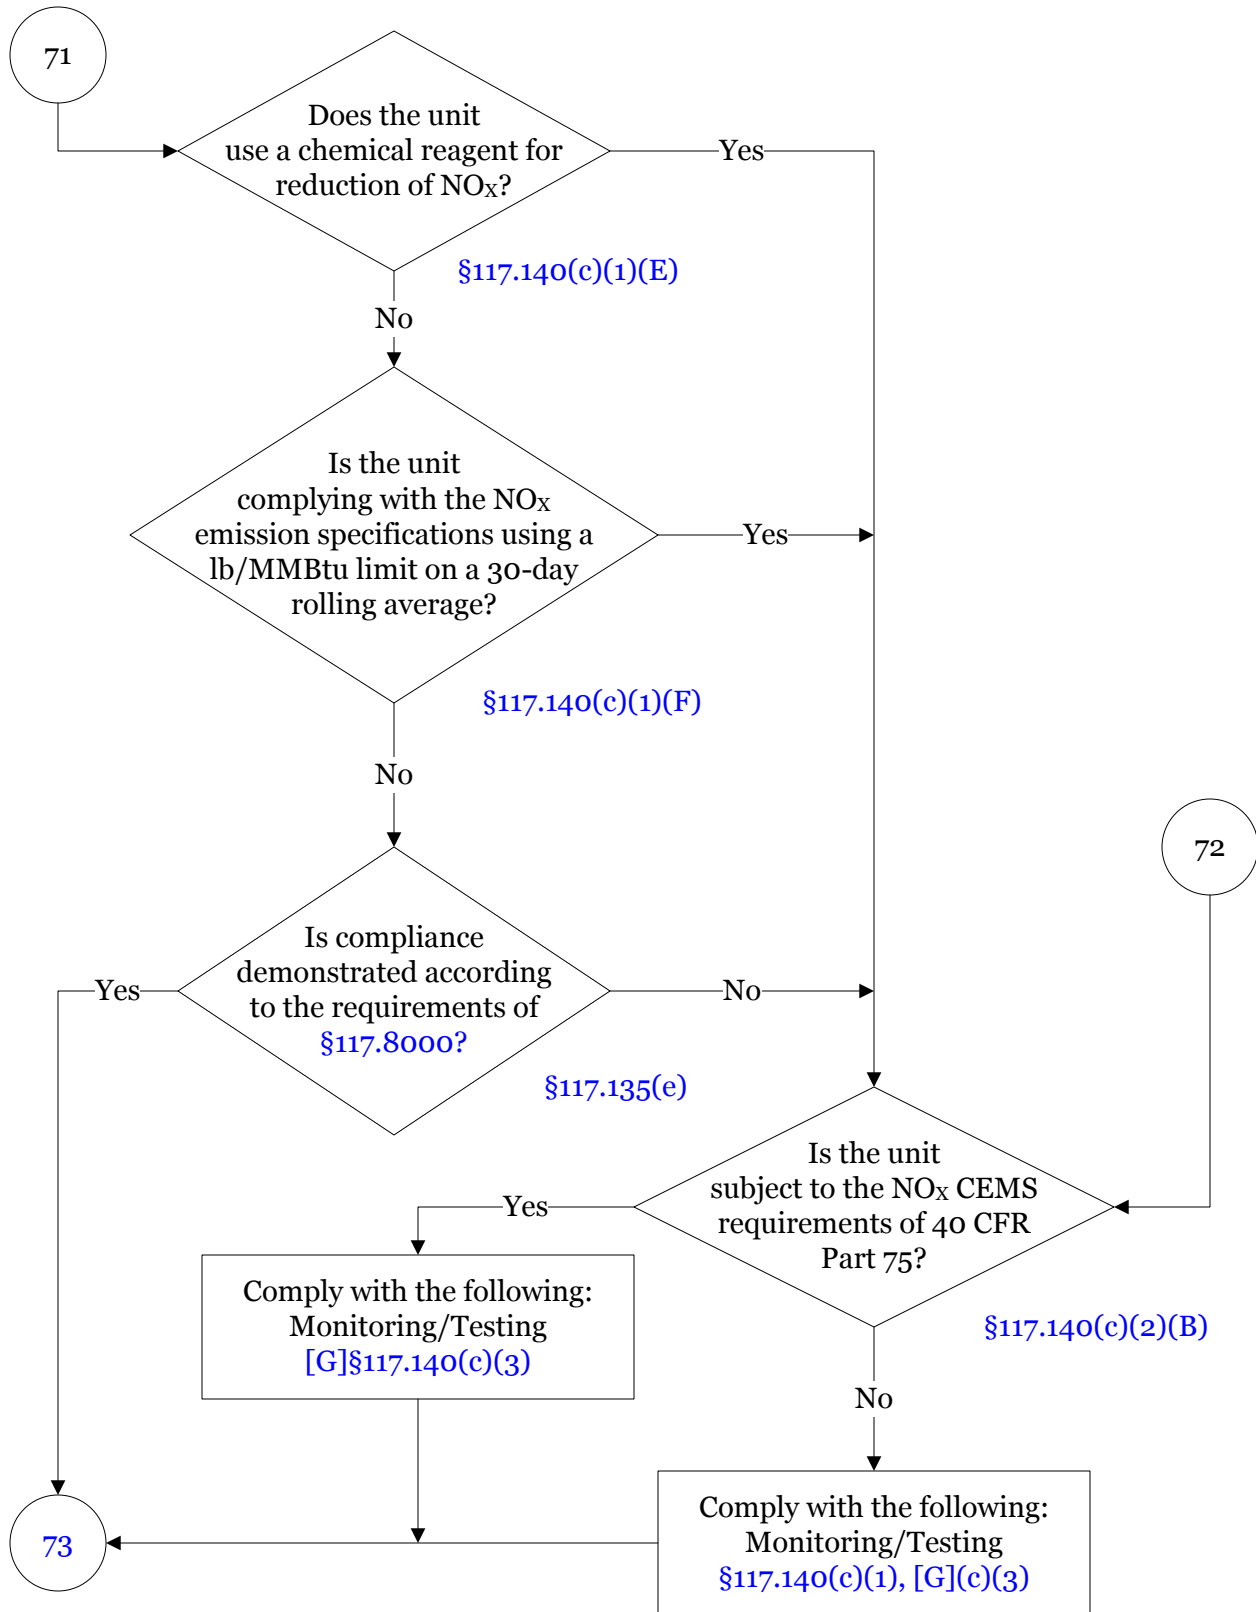


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(50 of 67)**

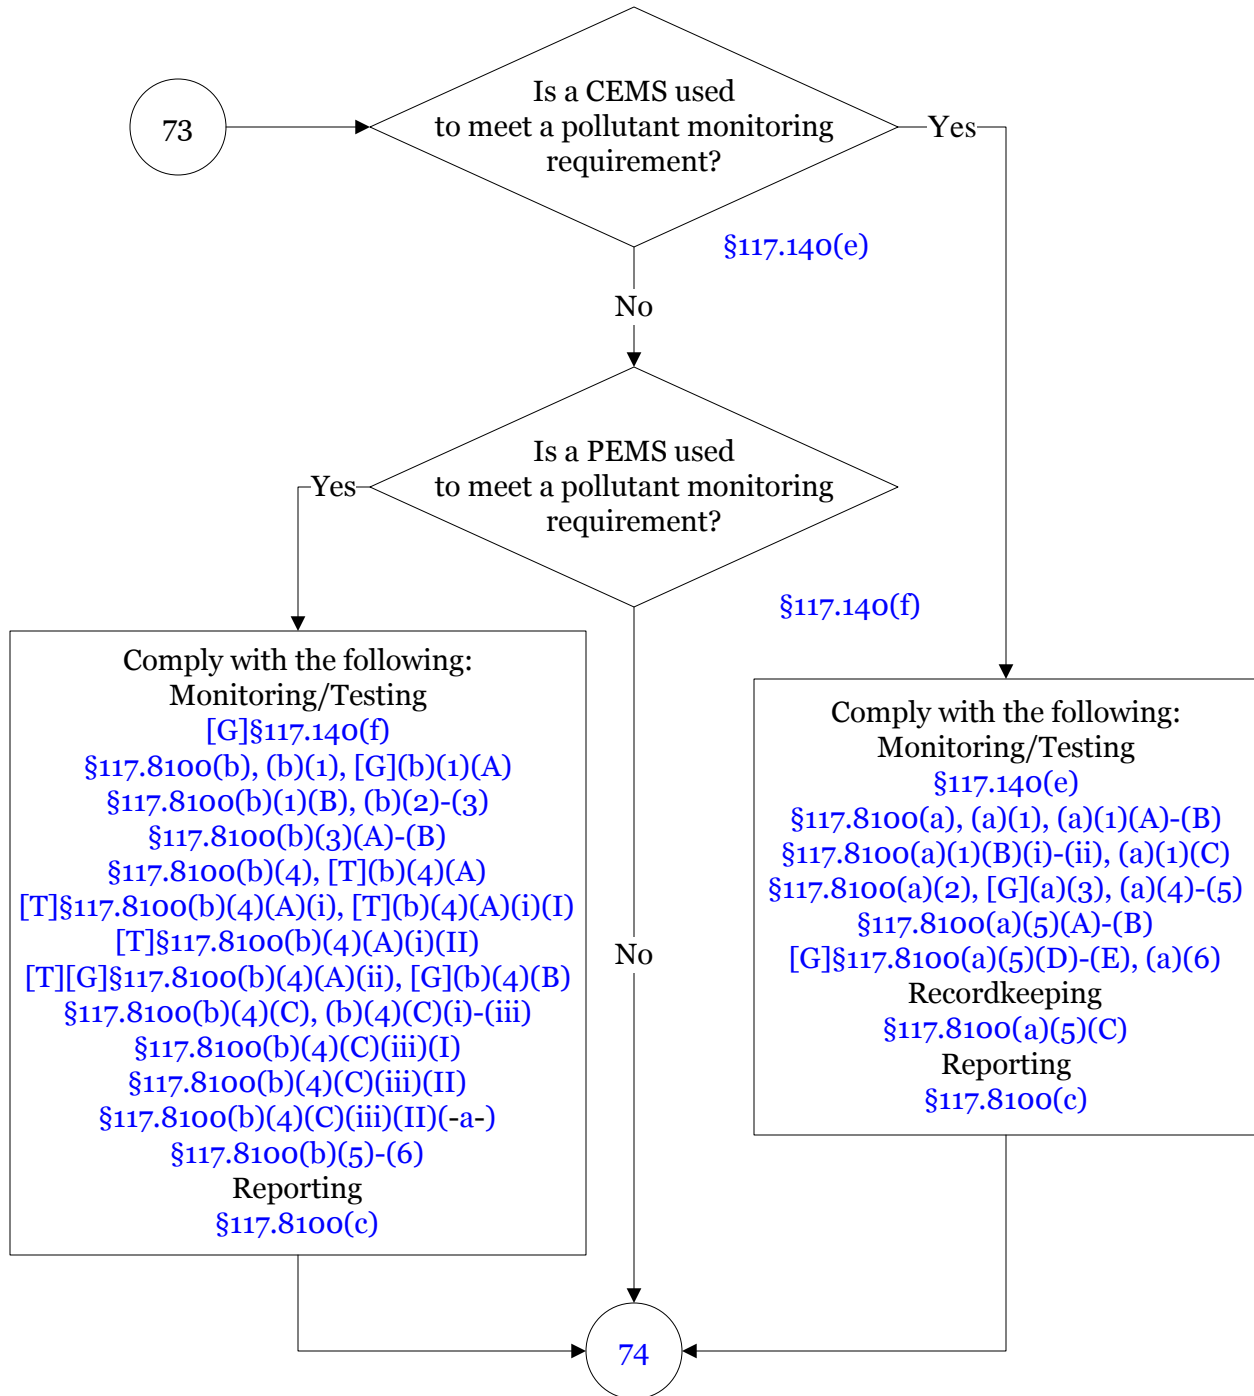


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(51 of 67)**

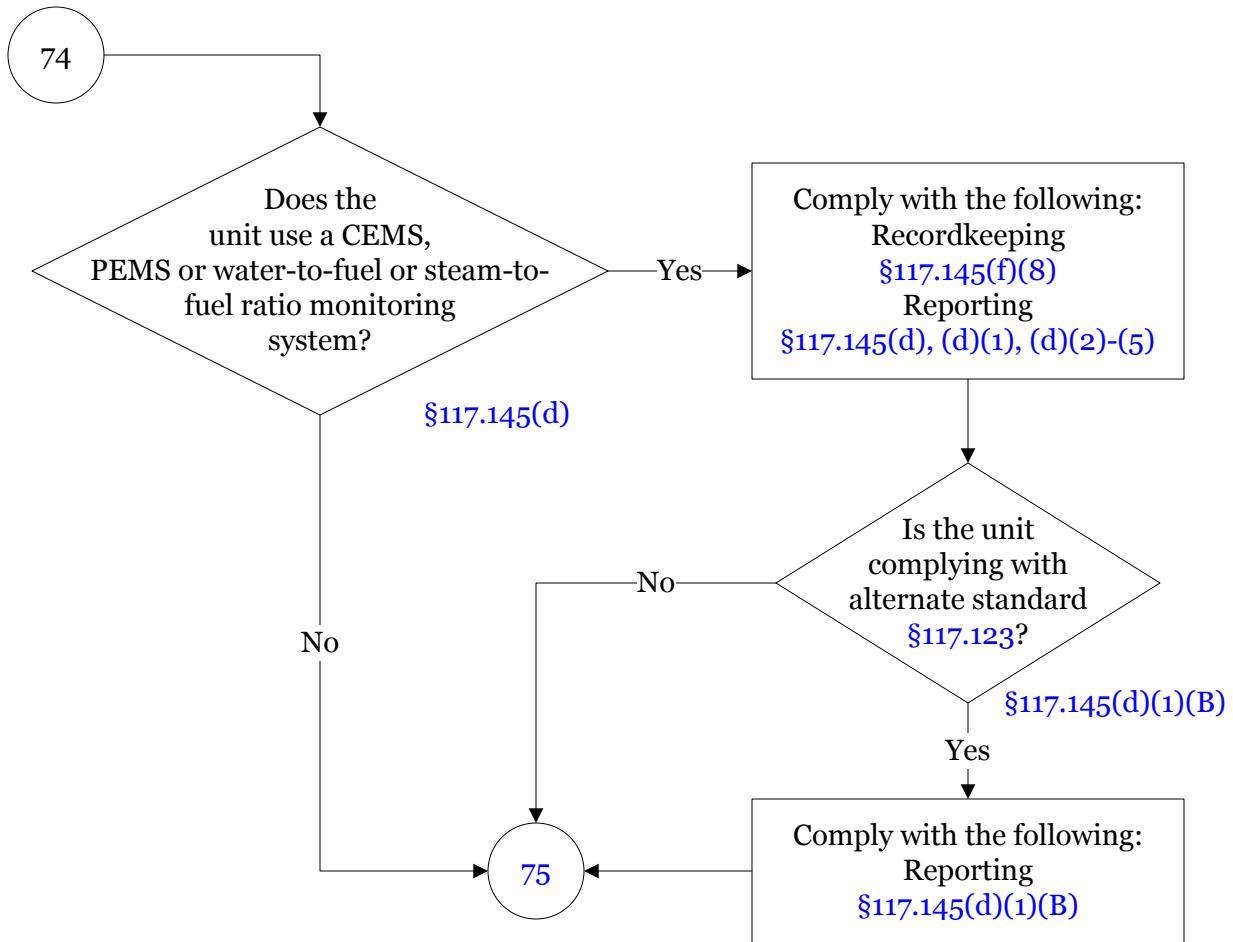


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(52 of 67)**

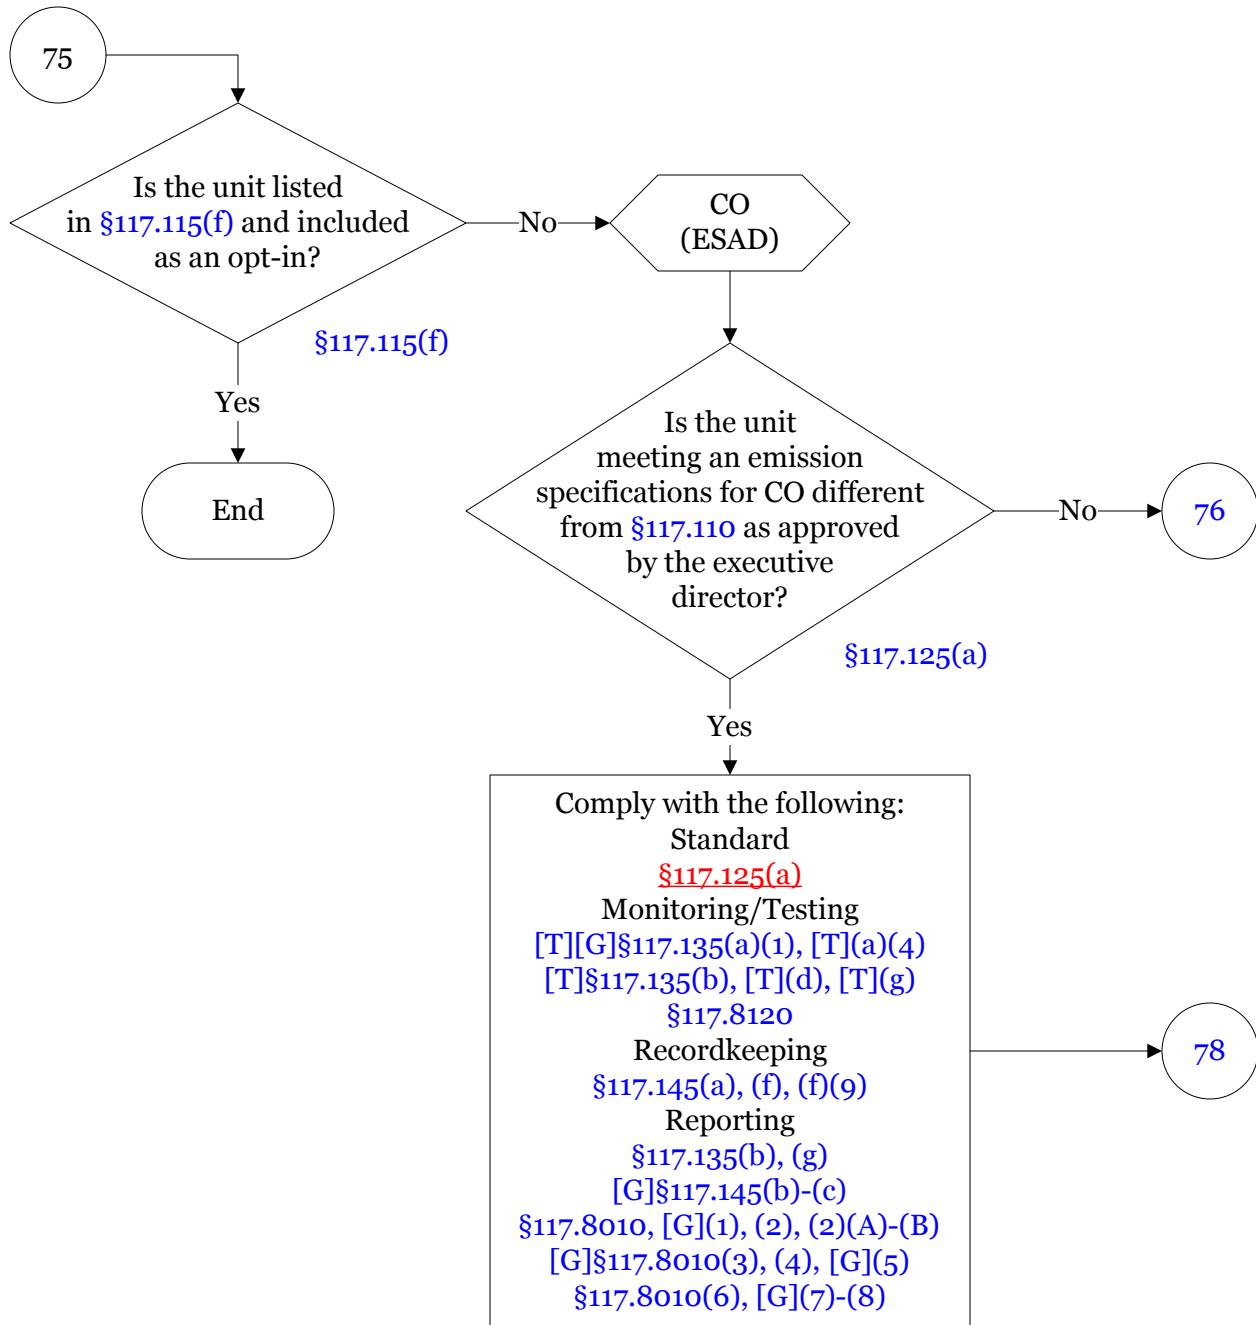


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(53 of 67)**

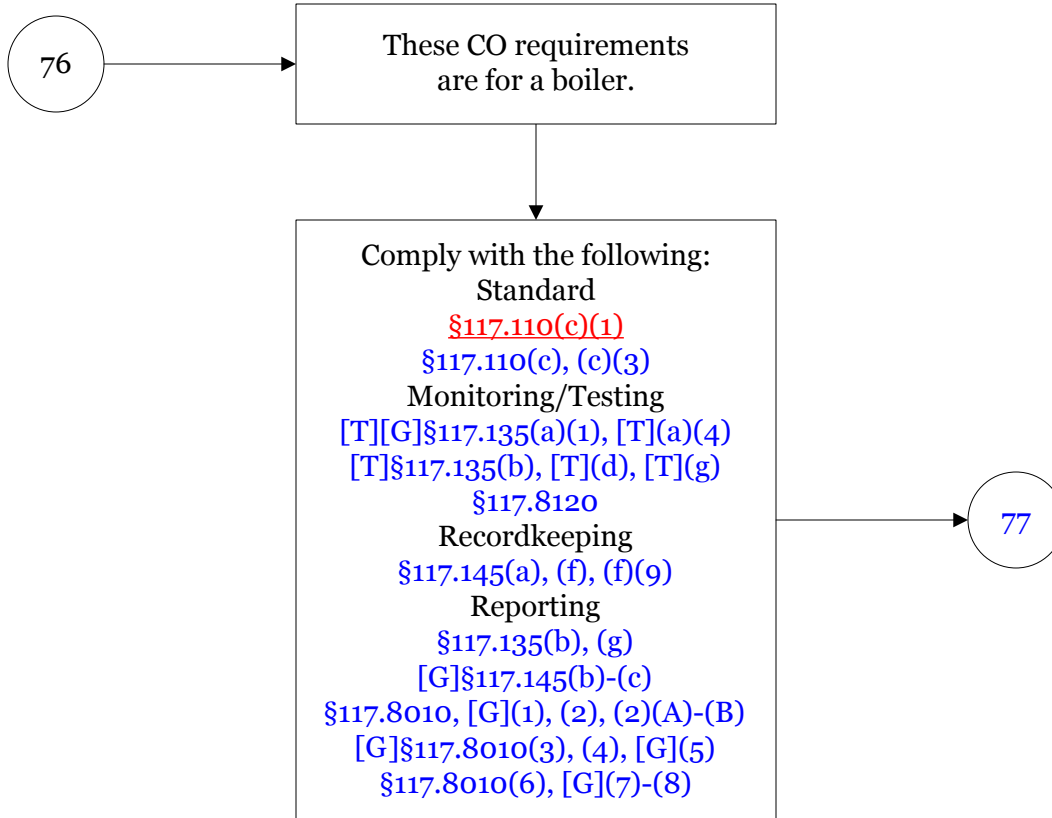


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(54 of 67)**

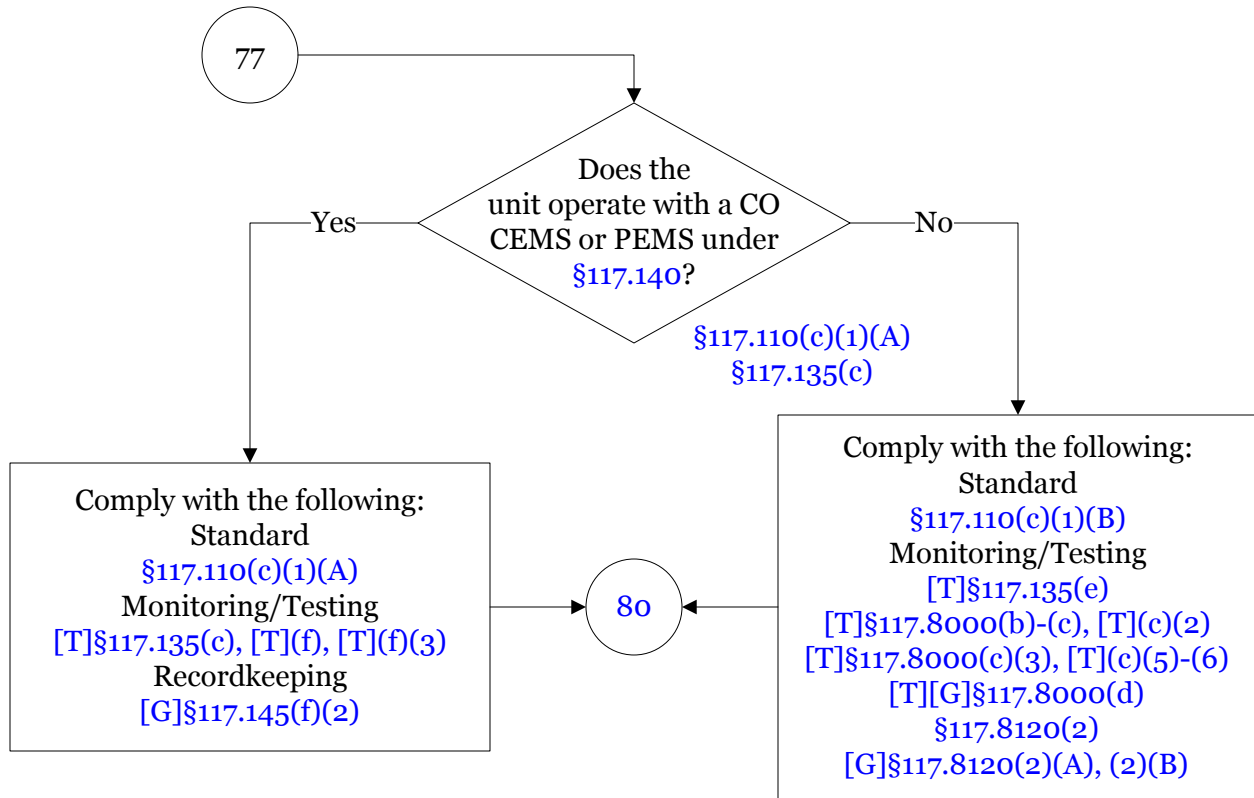

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(55 of 67)**

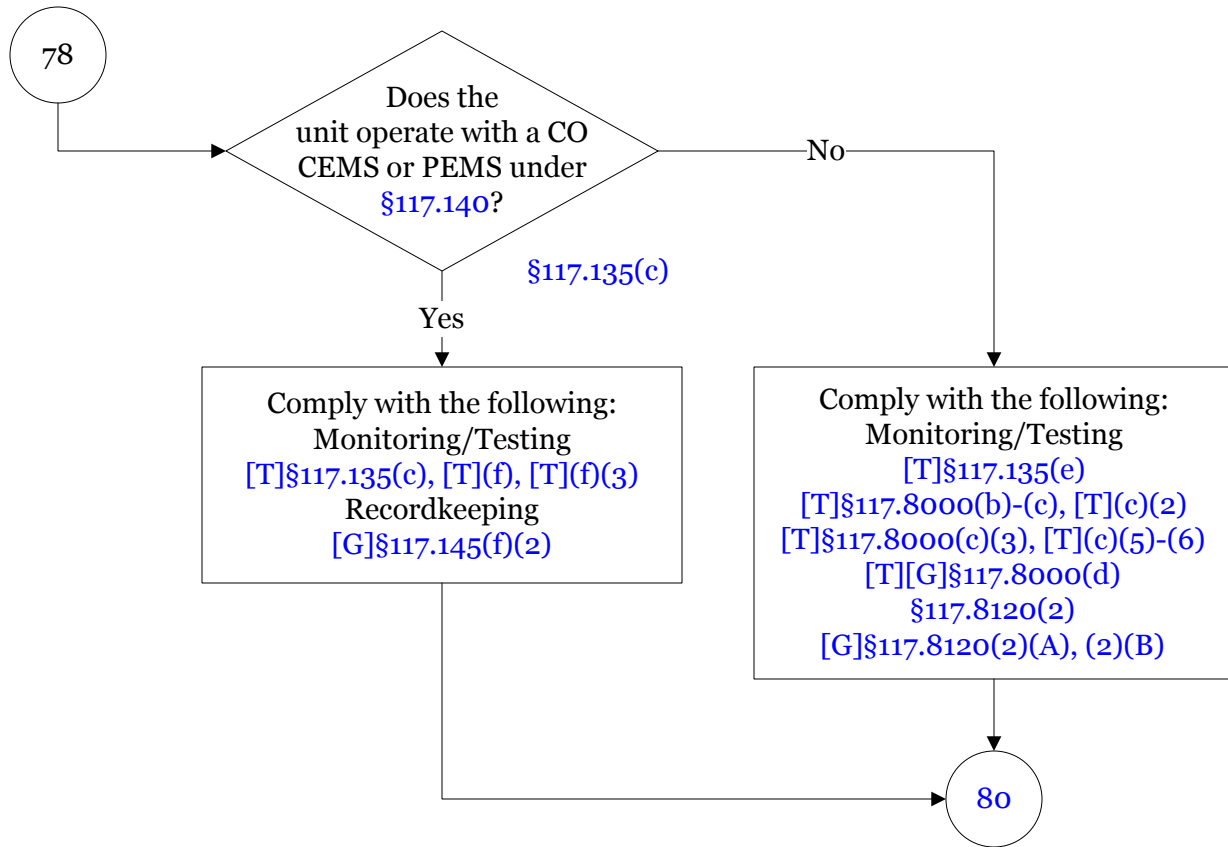


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(56 of 67)**

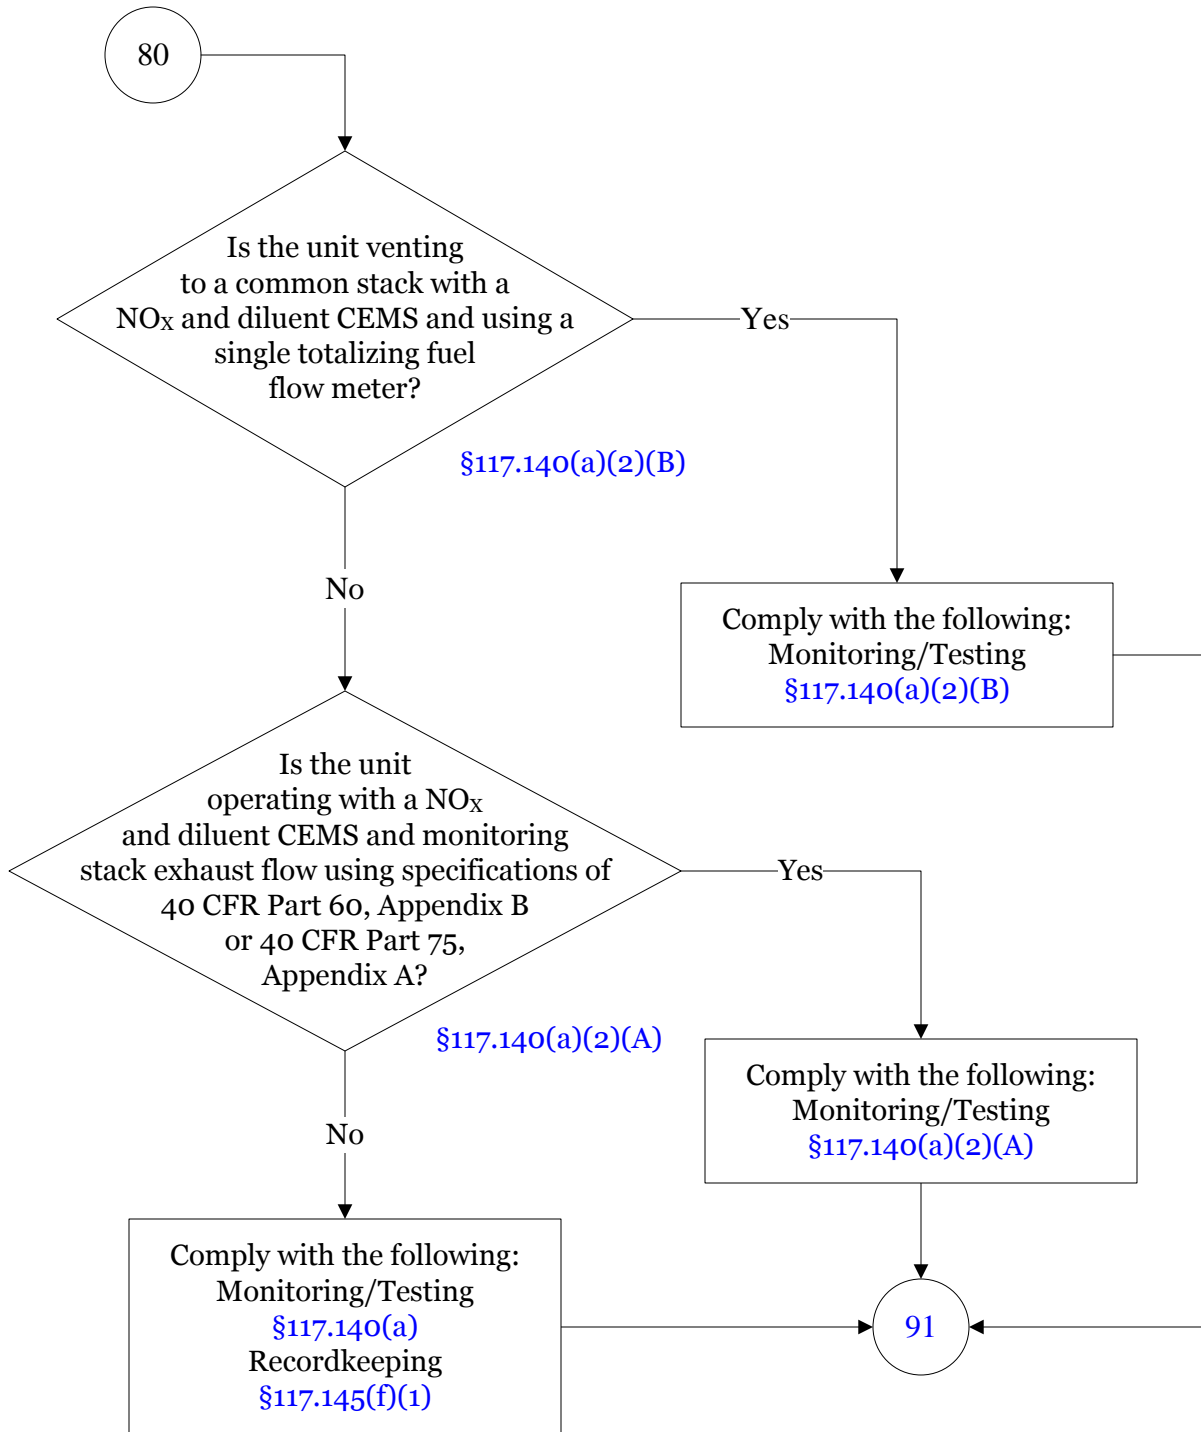





**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(57 of 67)**

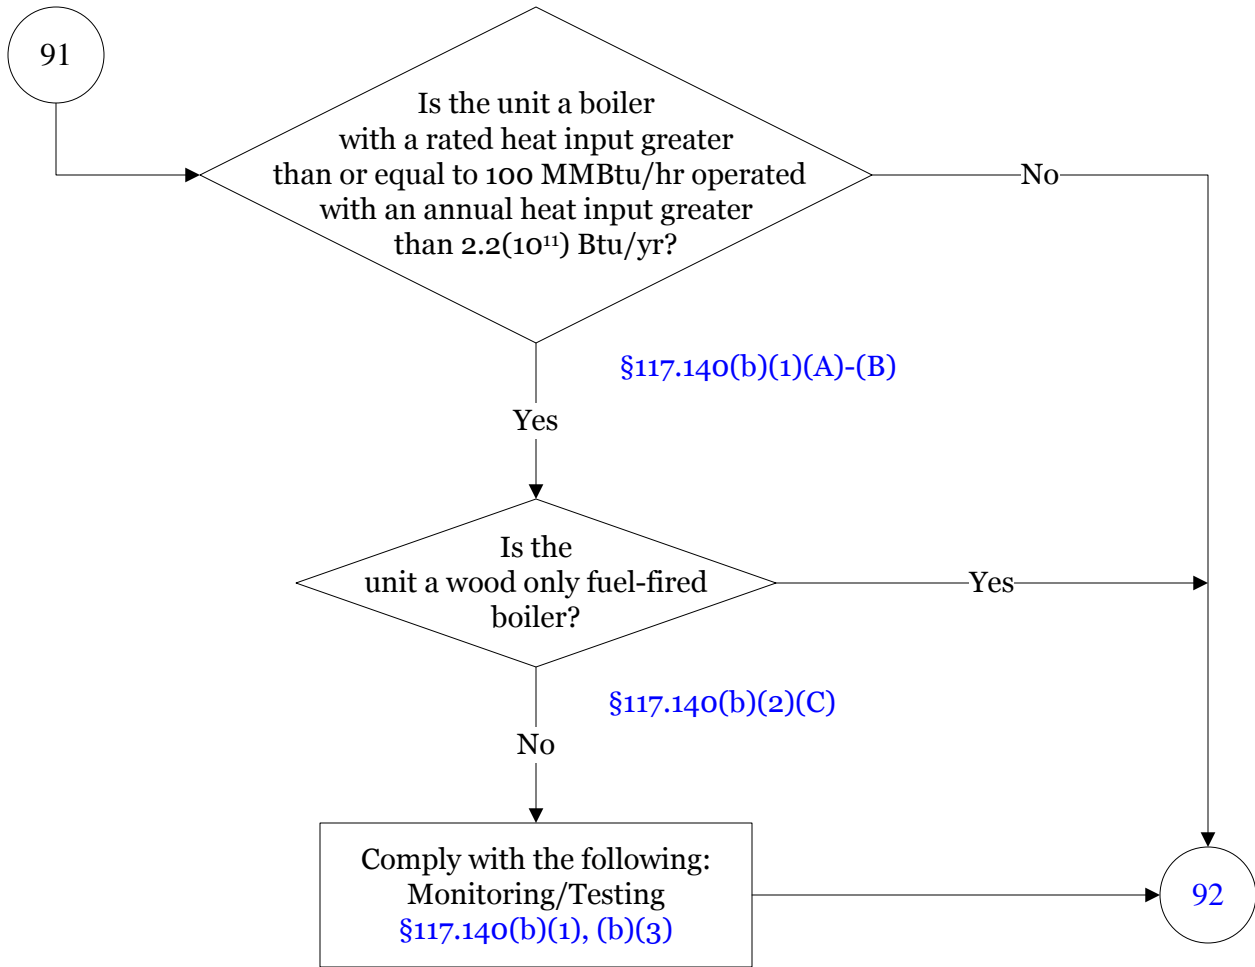


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(58 of 67)**

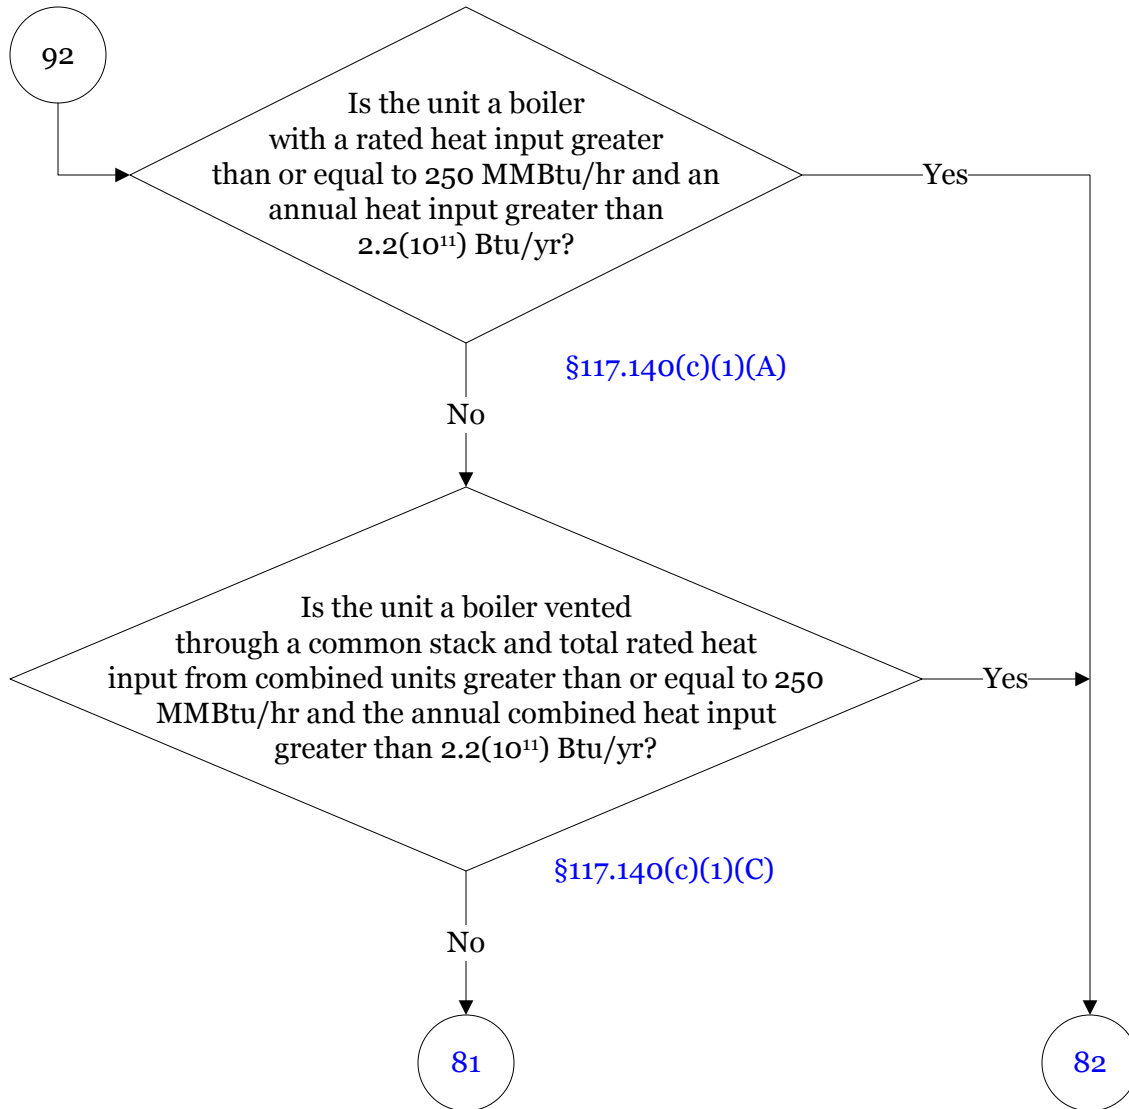


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(59 of 67)**

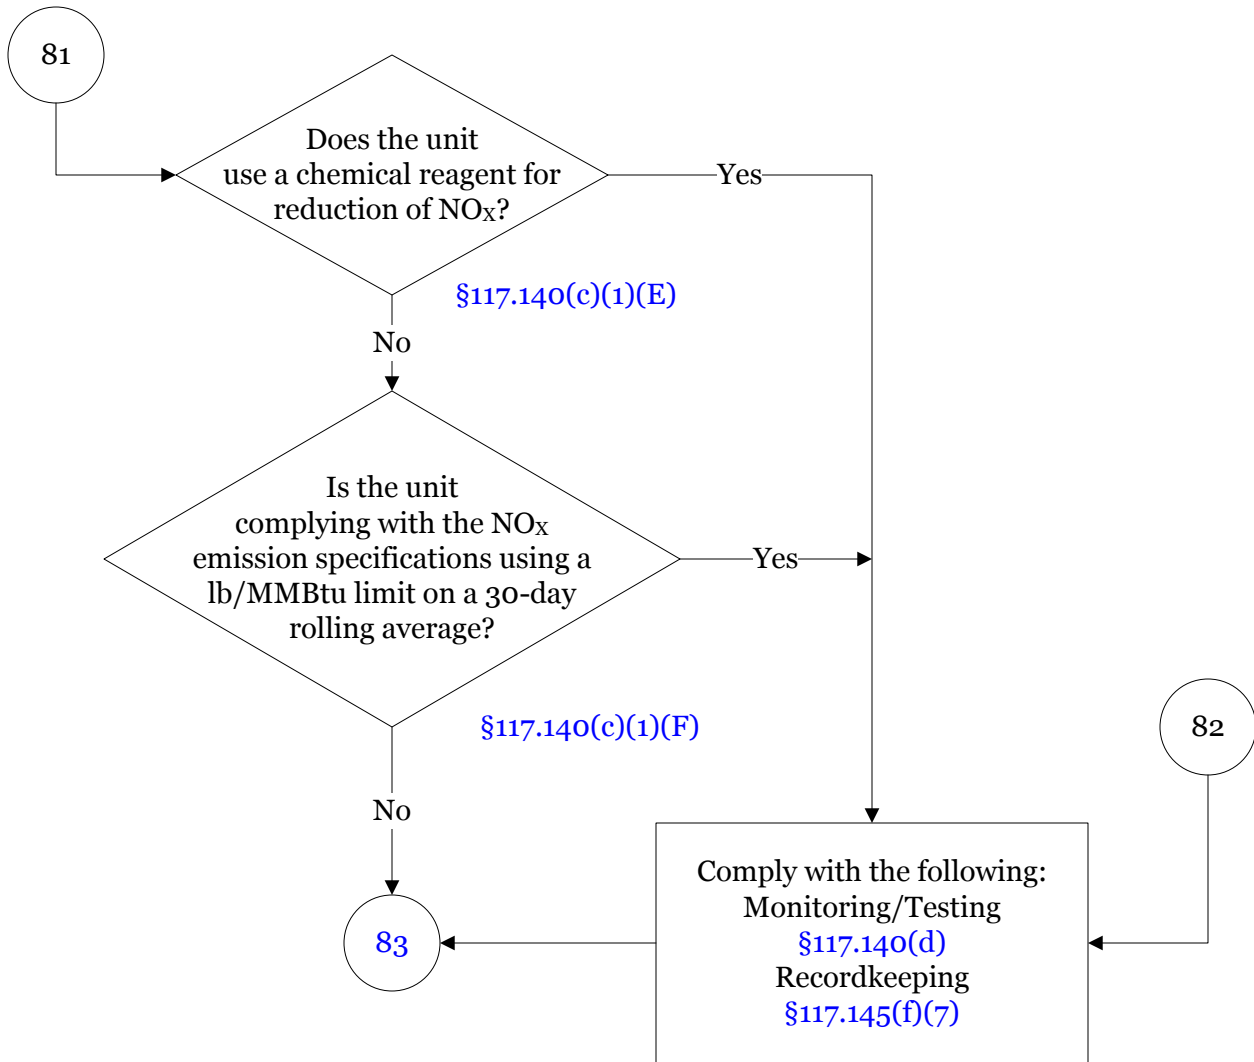


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(60 of 67)**

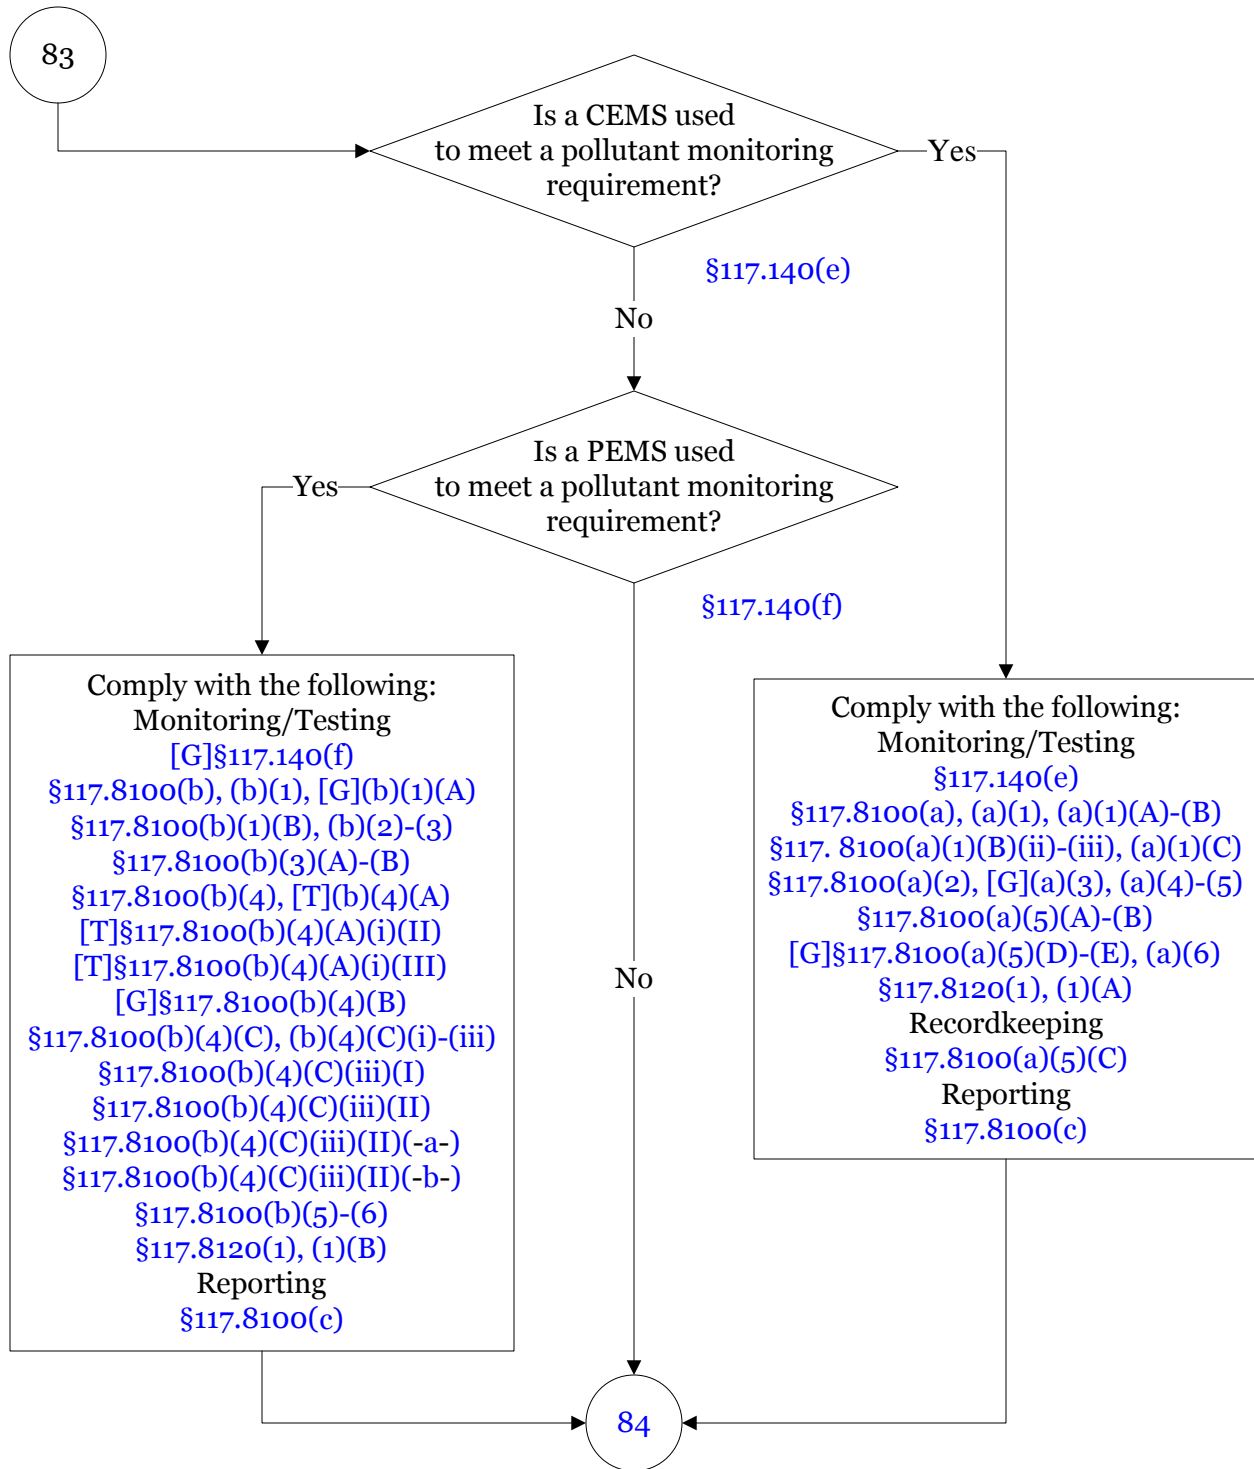


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(61 of 67)**

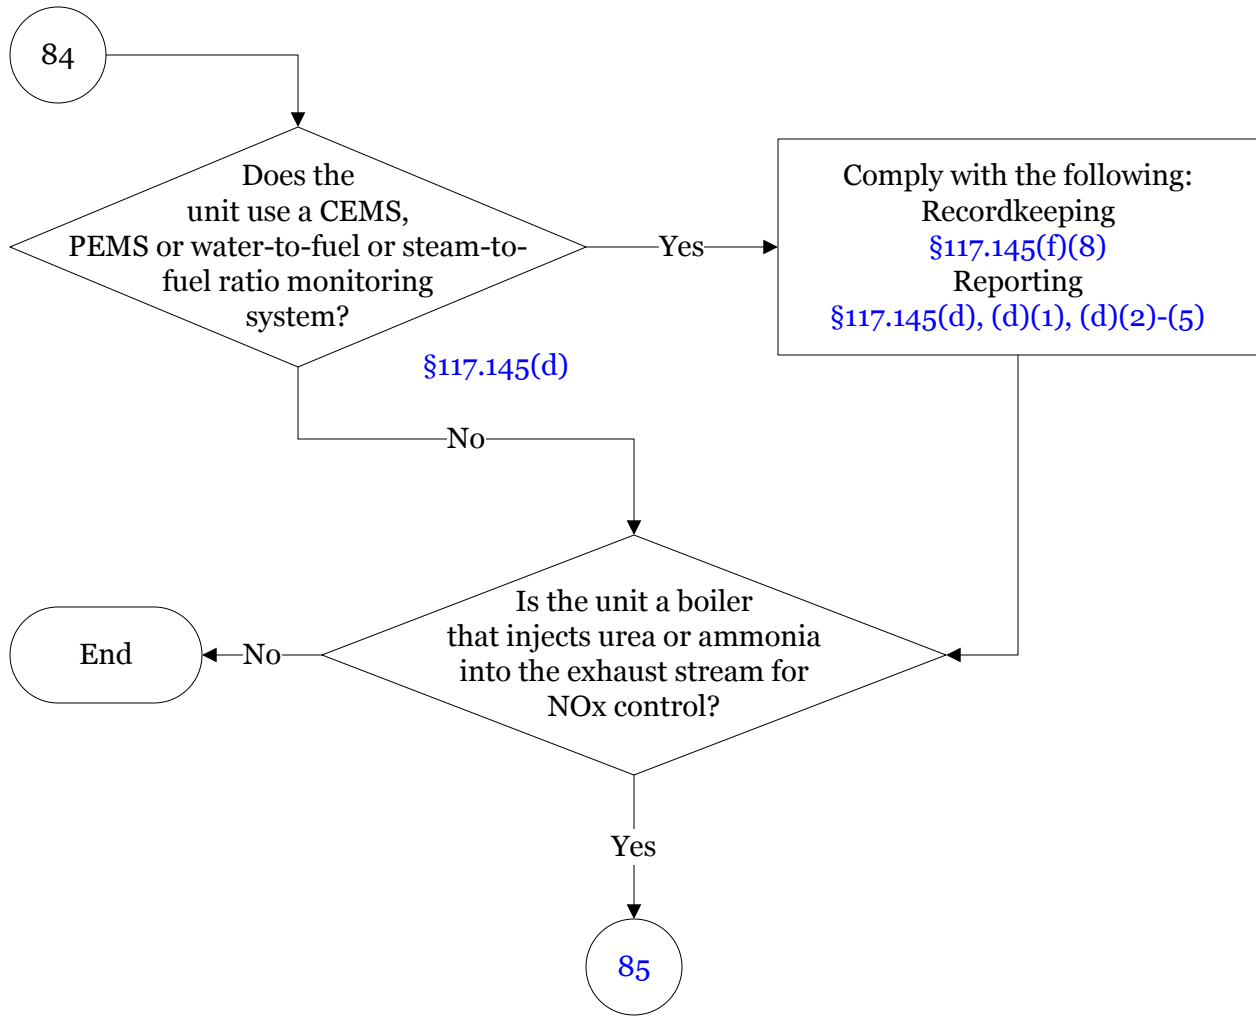


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(62 of 67)**

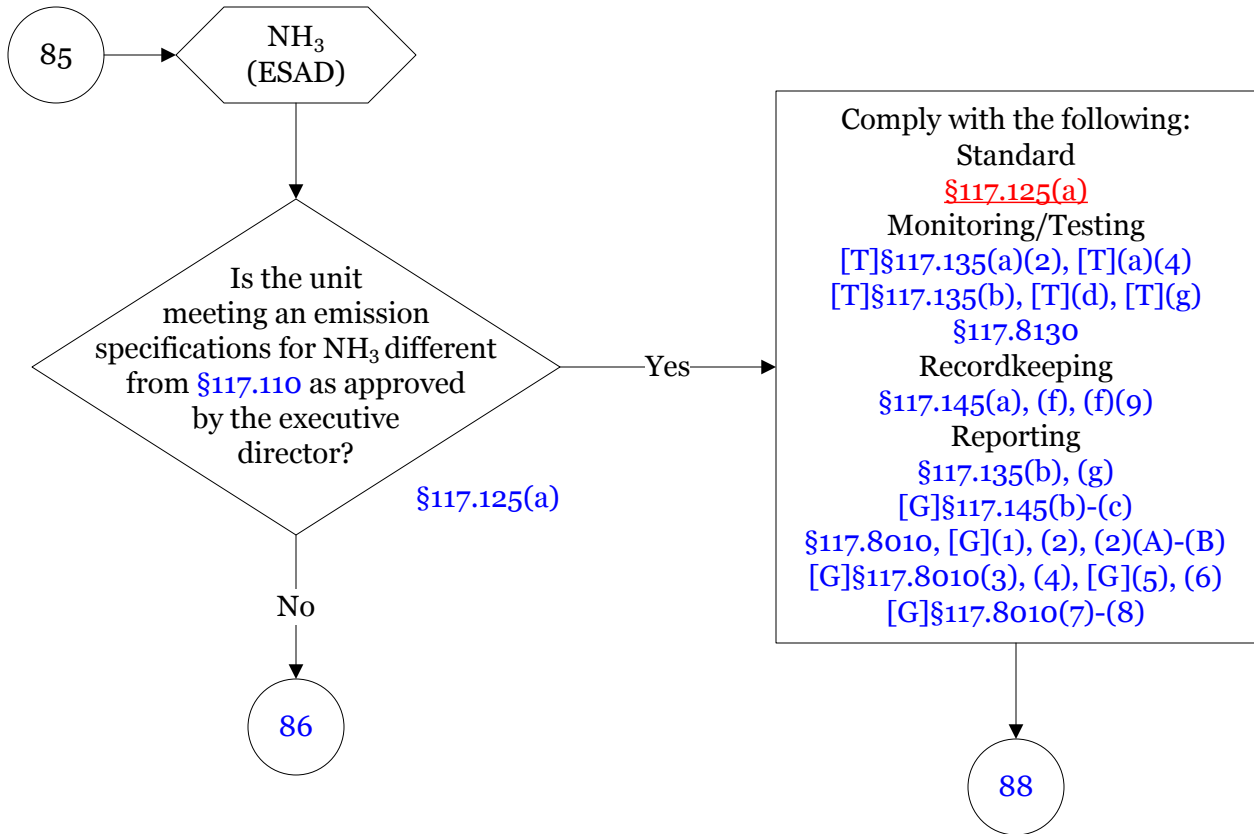

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(63 of 67)**

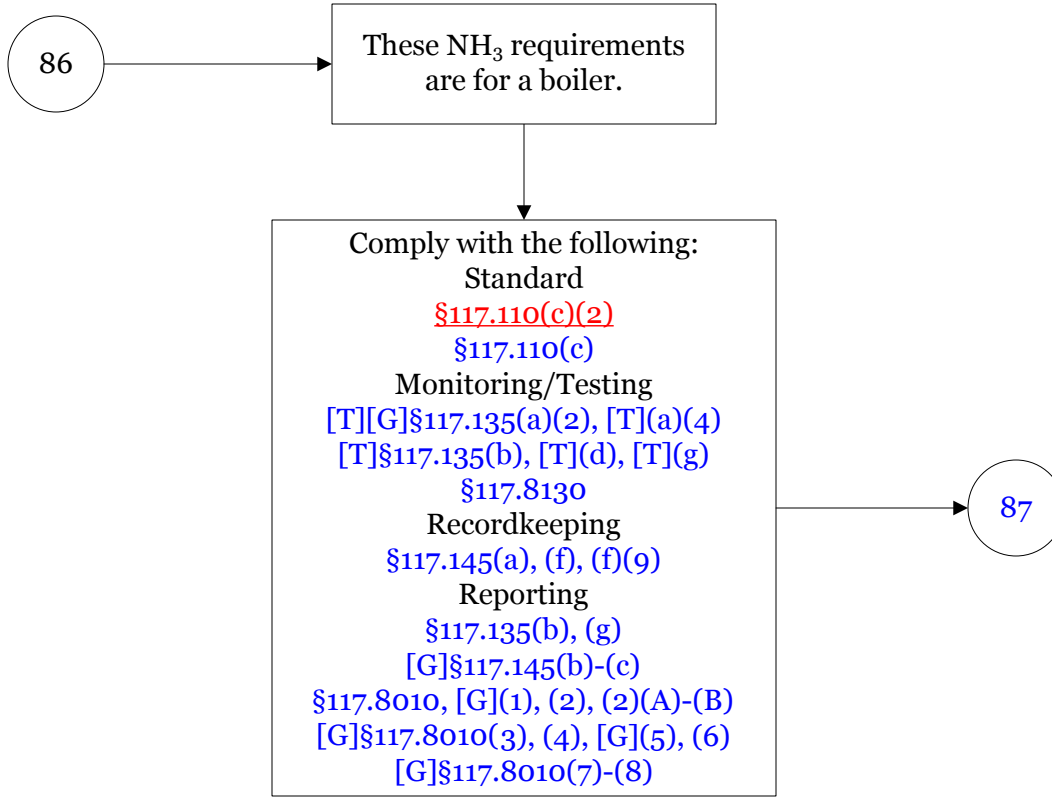


**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(64 of 67)**

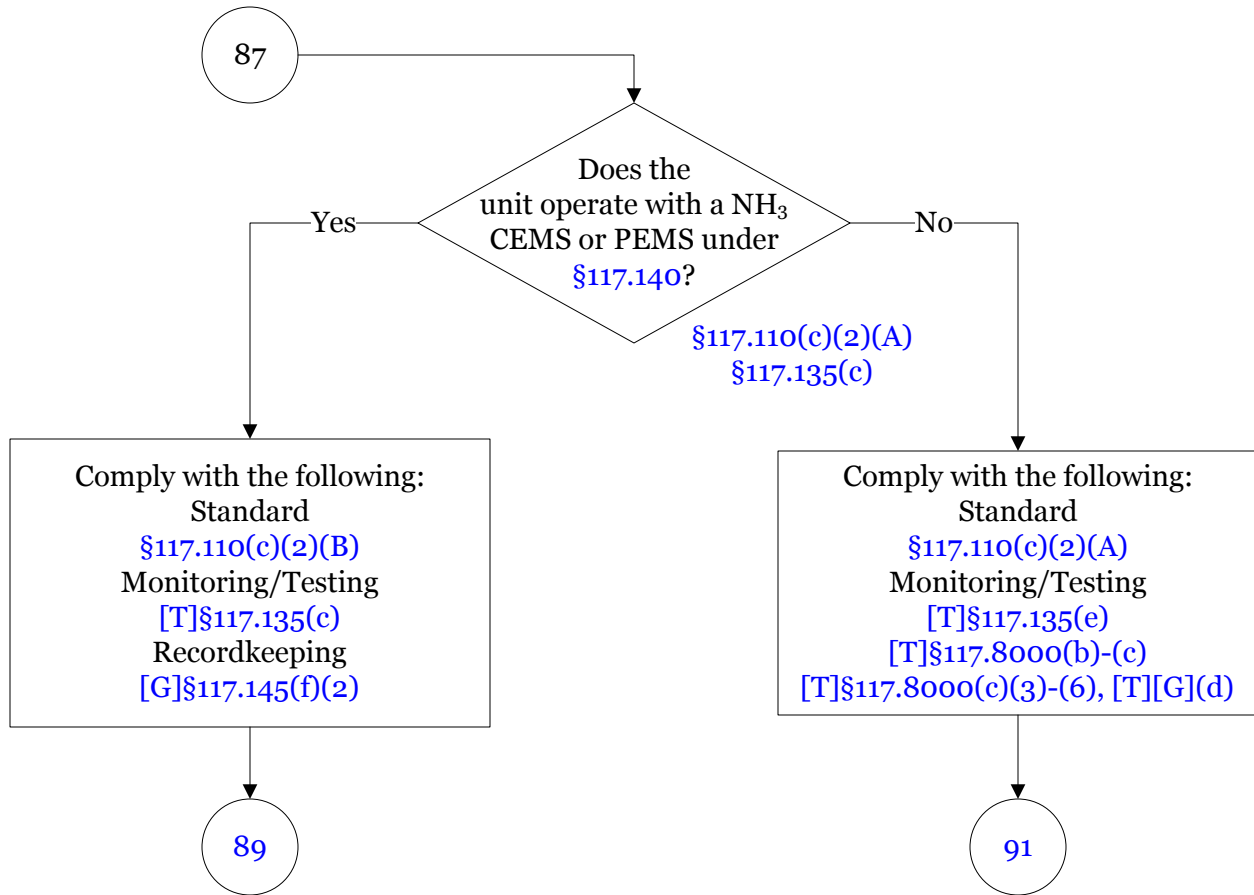




**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(65 of 67)**

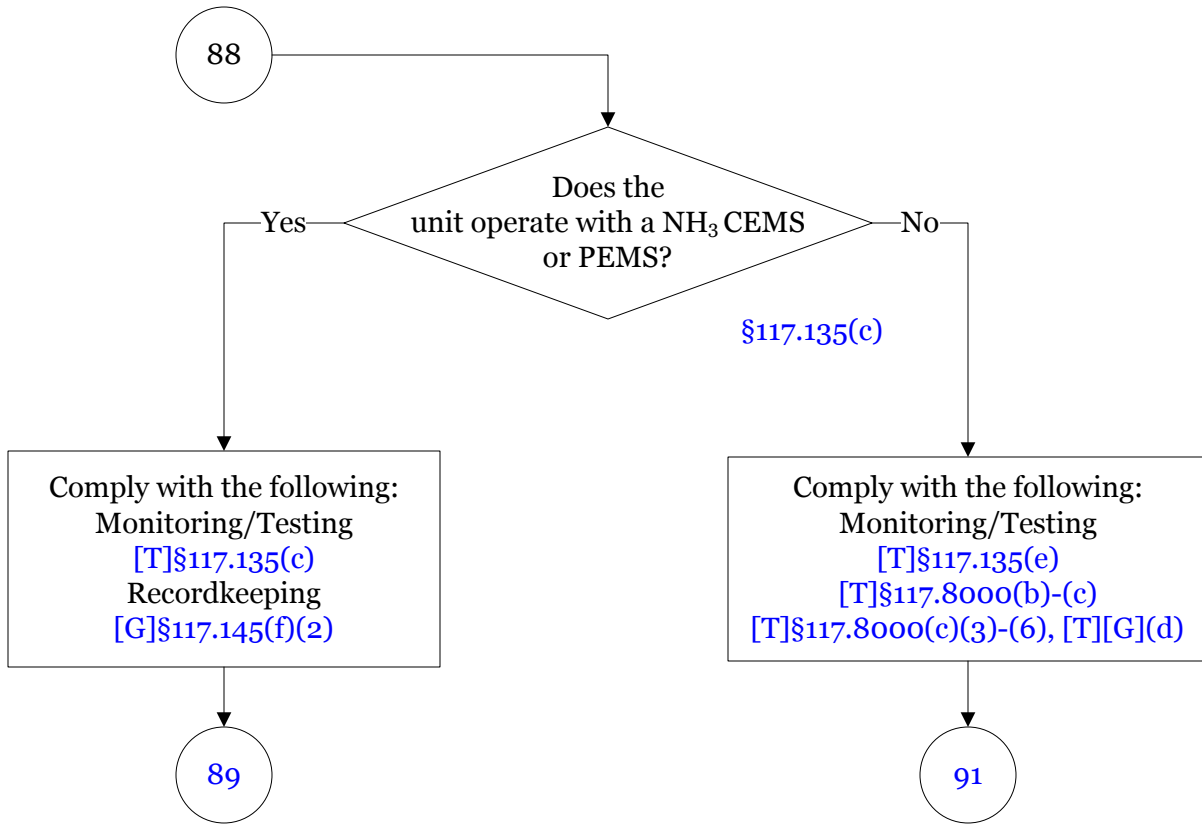

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(66 of 67)**

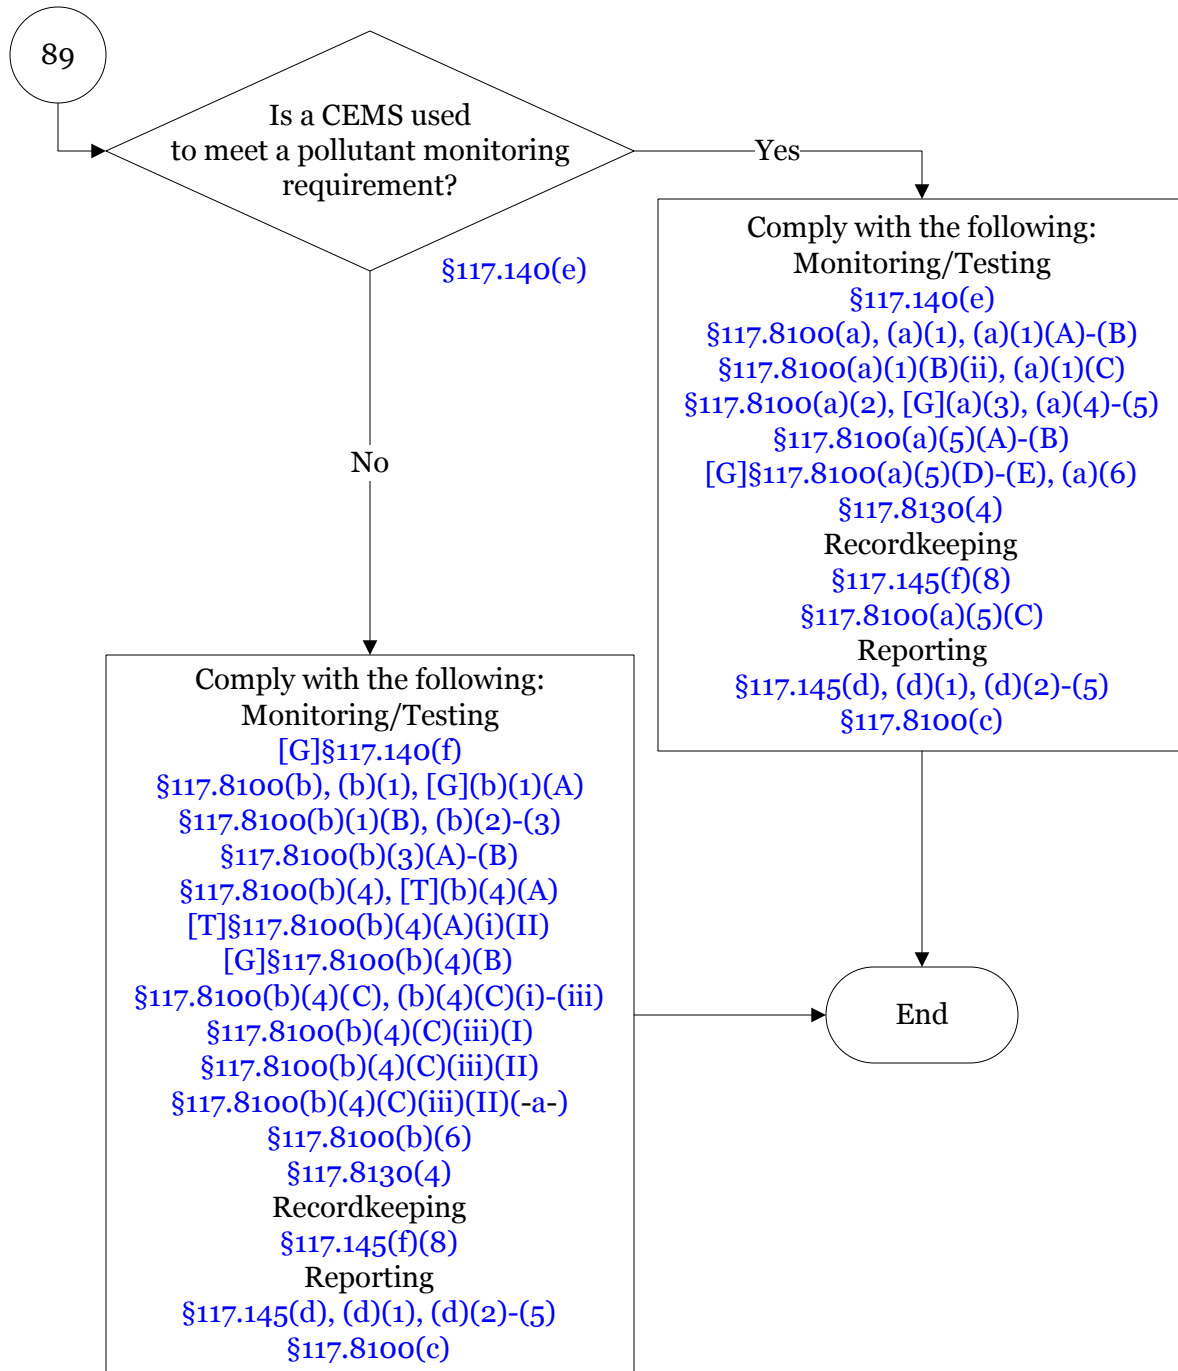

**30 TAC Chapter 117, Subchapter B, Combustion Control at Major ICI,  
Division 1, Beaumont-Port Arthur Ozone Nonattainment Area: Boilers  
(67 of 67)**

