CONTRIBUTING ZONE PLAN

NOLINA PHASE 2A NORTHWEST OF RONALD REAGAN BLVD. AND CR 248 WILLIAMSON COUNTY, TEXAS

Prepared For: JDS RR, LLC

5005 Riverway Dr., Ste 500 Houston, TX 77056

Prepared By: KIMLEY-HORN AND ASSOCIATES, INC.

501 S. Austin Ave., Suite 1310 Georgetown, Texas 78626 (512) 520-0768

Firm No. 928 KHA Project No. 069291601

June 19, 2023

TABLE OF CONTENTS

EDWARDS AQUIFER APPLICATION COVER PAGE	Section 1
EDWARDS AQUIFER APPLICATION COVER PAGE	TCEQ-20705
CONTRIBUTING ZONE PLAN APPLICATION	
CONTRIBUTING ZONE PLAN APPLICATION	TCEQ-10257
Road Map	Attachment A
USGS Quadrangle Map	Attachment B
Project Narrative	
Factors Affecting Surface Water Quality	
Volume and Character of Stormwater	
Suitability Letter from Authorized Agent	Attachment F
Alternative Secondary Containment Methods	
AST Containment Structure Drawings	
20% or Less Impervious Cover Waiver	
BMPs for Upgradient Stormwater	
BMPs for On-site Stormwater	Attachment K
BMPs for Surface Streams	Attachment L
Construction Plans	
Inspection, Maintenance, Repair and Retrofit Plan	Attachment N
Pilot-Scale Field Testing Plan	
Measures for Minimizing Surface Stream Contamination	Attachment P
STORM WATER POLLUTION PREVENTION PLAN	Section 3
ADDITIONAL FORMS	Section 4
COPY OF NOTICE OF INTENT	NOI
AGENT AUTHORIZATION FORM	TCEQ-0599
APPLICATION FEE FORM	TCEQ-0574
Check Payable to the "Texas Commission on Environmental Quality"	
CORE DATA FORM	TCEQ-10400
APPROVED PRELIMINARY PLAT	EX-A

Kimley **»Horn**

SECTION 1: EDWARDS AQUIFER APPLICATION COVER PAGE

Our Review of Your Application

The Edwards Aquifer Program staff conducts an administrative and technical review of all applications. The turnaround time for administrative review can be up to 30 days as outlined in 30 TAC 213.4(e). Generally administrative completeness is determined during the intake meeting or within a few days of receipt. The turnaround time for technical review of an administratively complete Edwards Aquifer application is 90 days as outlined in 30 TAC 213.4(e). Please know that the review and approval time is directly impacted by the quality and completeness of the initial application that is received. In order to conduct a timely review, it is imperative that the information provided in an Edwards Aquifer application include final plans, be accurate, complete, and in compliance with <u>30 TAC 213</u>.

Administrative Review

1. <u>Edwards Aquifer applications</u> must be deemed administratively complete before a technical review can begin. To be considered administratively complete, the application must contain completed forms and attachments, provide the requested information, and meet all the site plan requirements. The submitted application and plan sheets should be final plans. Please submit one full-size set of plan sheets with the original application, and half-size sets with the additional copies.

To ensure that all applicable documents are included in the application, the program has developed tools to guide you and web pages to provide all forms, checklists, and guidance. Please visit the below website for assistance: <u>http://www.tceq.texas.gov/field/eapp</u>.

- 2. This Edwards Aquifer Application Cover Page form (certified by the applicant or agent) must be included in the application and brought to the administrative review meeting.
- 3. Administrative reviews are scheduled with program staff who will conduct the review. Applicants or their authorized agent should call the appropriate regional office, according to the county in which the project is located, to schedule a review. The average meeting time is one hour.
- 4. In the meeting, the application is examined for administrative completeness. Deficiencies will be noted by staff and emailed or faxed to the applicant and authorized agent at the end of the meeting, or shortly after. Administrative deficiencies will cause the application to be deemed incomplete and returned.

An appointment should be made to resubmit the application. The application is re-examined to ensure all deficiencies are resolved. The application will only be deemed administratively complete when all administrative deficiencies are addressed.

- 5. If an application is received by mail, courier service, or otherwise submitted without a review meeting, the administrative review will be conducted within 30 days. The applicant and agent will be contacted with the results of the administrative review. If the application is found to be administratively incomplete, it can be retrieved from the regional office or returned by regular mail. If returned by mail, the regional office may require arrangements for return shipping.
- 6. If the geologic assessment was completed before October 1, 2004 and the site contains "possibly sensitive" features, the assessment must be updated in accordance with the *Instructions to Geologists* (TCEQ-0585 Instructions).

Technical Review

- 1. When an application is deemed administratively complete, the technical review period begins. The regional office will distribute copies of the application to the identified affected city, county, and groundwater conservation district whose jurisdiction includes the subject site. These entities and the public have 30 days to provide comments on the application to the regional office. All comments received are reviewed by TCEQ.
- 2. A site assessment is usually conducted as part of the technical review, to evaluate the geologic assessment and observe existing site conditions. The site must be accessible to our staff. The site boundaries should be clearly marked, features identified in the geologic assessment should be flagged, roadways marked and the

alignment of the Sewage Collection System and manholes should be staked at the time the application is submitted. If the site is not marked the application may be returned.

- 3. We evaluate the application for technical completeness and contact the applicant and agent via Notice of Deficiency (NOD) to request additional information and identify technical deficiencies. There are two deficiency response periods available to the applicant. There are 14 days to resolve deficiencies noted in the first NOD. If a second NOD is issued, there is an additional 14 days to resolve deficiencies. If the response to the second notice is not received, is incomplete or inadequate, or provides new information that is incomplete or inadequate, the application must be withdrawn or will be denied. Please note that because the technical review is underway, whether the application is withdrawn or denied the application fee will be forfeited.
- 4. The program has 90 calendar days to complete the technical review of the application. If the application is technically adequate, such that it complies with the Edwards Aquifer rules, and is protective of the Edwards Aquifer during and after construction, an approval letter will be issued. Construction or other regulated activity may not begin until an approval is issued.

Mid-Review Modifications

It is important to have final site plans prior to beginning the permitting process with TCEQ to avoid delays.

Occasionally, circumstances arise where you may have significant design and/or site plan changes after your Edwards Aquifer application has been deemed administratively complete by TCEQ. This is considered a "Mid-Review Modifications". Mid-Review Modifications may require redistribution of an application that includes the proposed modifications for public comment.

If you are proposing a Mid-Review Modification, two options are available:

- If the technical review has begun your application can be denied/withdrawn, your fees will be forfeited, and the plan will have to be resubmitted.
- TCEQ can continue the technical review of the application as it was submitted, and a modification application can be submitted at a later time.

If the application is denied/withdrawn, the resubmitted application will be subject to the administrative and technical review processes and will be treated as a new application. The application will be redistributed to the affected jurisdictions.

Please contact the regional office if you have questions. If your project is located in Williamson, Travis, or Hays County, contact TCEQ's Austin Regional Office at 512-339-2929. If your project is in Comal, Bexar, Medina, Uvalde, or Kinney County, contact TCEQ's San Antonio Regional Office at 210-490-3096

Please fill out all required fields below and submit with your application.

1. Regulated Entity Name: Nolina Phase 2A				2. Regulated Entity No.:					
3. Customer Name: JDS RR, LLC				4. Cu	4. Customer No.: 606006823				
5. Project Type: (Please circle/check one)	New X	Modification			۱	Extension		Exception	
6. Plan Type: (Please circle/check one)	WPAP	CZP x	SCS	UST	AST	EXP	EXT	Technical Clarification	Optional Enhanced Measures
7. Land Use: (Please circle/check one)	Resider X	ntial	Non-residential			n-residential 8. S		te (acres): 52.20	
9. Application Fee:	\$6,500		10. Permanent E			BMP(s):		Batch Detention Ba Stormtroopers (We	asin, Vegetative Filter Strips, et Vaults)
11. SCS (Linear Ft.):	N/A		12. AST/UST (No			2. AST/UST (No. Tanks):		N/A	
13. County:	Willian	nson	14. W	/aters	hed:			North Fork San Gabriel River	

Application Distribution

Instructions: Use the table below to determine the number of applications required. One original and one copy of the application, plus additional copies (as needed) for each affected incorporated city, county, and groundwater conservation district are required. Linear projects or large projects, which cross into multiple jurisdictions, can require additional copies. Refer to the "Texas Groundwater Conservation Districts within the EAPP Boundaries" map found at:

http://www.tceq.texas.gov/assets/public/compliance/field_ops/eapp/EAPP%20GWCD%20map.pdf

For more detailed boundaries, please contact the conservation district directly.

	Austin Region					
County:	Hays	Travis	Williamson			
Original (1 req.)	—		Х			
Region (1 req.)			Х			
County(ies)			_			
Groundwater Conservation District(s)	Edwards Aquifer Authority Barton Springs/ Edwards Aquifer Hays Trinity Plum Creek	Barton Springs/ Edwards Aquifer	NA			
City(ies) Jurisdiction	Austin Buda Dripping Springs Kyle Mountain City San Marcos Wimberley Woodcreek	Austin Bee Cave Pflugerville Rollingwood Round Rock Sunset Valley West Lake Hills	Austin Cedar Park Florence Georgetown Jerrell Leander Liberty Hill Pflugerville Round Rock			

	San Antonio Region						
County:	Bexar	Comal	Kinney	Medina	Uvalde		
Original (1 req.)							
Region (1 req.)							
County(ies)							
Groundwater Conservation District(s)	Edwards Aquifer Authority Trinity-Glen Rose	Edwards Aquifer Authority	Kinney	EAA Medina	EAA Uvalde		
City(ies) Jurisdiction	Castle Hills Fair Oaks Ranch Helotes Hill Country Village Hollywood Park San Antonio (SAWS) Shavano Park	Bulverde Fair Oaks Ranch Garden Ridge New Braunfels Schertz	NA	San Antonio ETJ (SAWS)	NA		

I certify that to the best of my knowledge, that the application is complete and accurate. This application is hereby submitted to TCEQ for administrative review and technical review.

Alejandro E. Granados Rico, P.E.

Print Name of Customer/Authorized Agent Alejandro E. Granda hier rized Agent

June 19, 2023

Date

	\/**			
**FOR TCEQ INTERNAL USE ONL	.Y^^			
Date(s)Reviewed:		Date Adn	ninistratively Complete:	
Received From:		Correct N	lumber of Copies:	
Received By:		Distribut	ion Date:	
EAPP File Number:		Complex:		
Admin. Review(s) (No.):		No. AR Rounds:		
Delinquent Fees (Y/N):		Review Time Spent:		
Lat./Long. Verified:		SOS Customer Verification:		
Agent Authorization Complete/Notarized (Y/N):		Payable to TCEQ (Y/N):		
Core Data Form Complete (Y/N):		Check: Signed (Y/N): Less than 90 days old (Y/N):		
Core Data Form Incomplete Nos.:				

Kimley **»Horn**

SECTION 2: CONTRIBUTING ZONE PLAN APPLICATION

Contributing Zone Plan Application

Texas Commission on Environmental Quality for Regulated Activities on the Contributing Zone to the Edwards Aquifer and Relating to 30 TAC §213.24(1), Effective June 1, 1999

To ensure that the application is administratively complete, confirm that all fields in the form are complete, verify that all requested information is provided, consistently reference the same site and contact person in all forms in the application, and ensure forms are signed by the appropriate party.

Note: Including all the information requested in the form and attachments contributes to more streamlined technical reviews.

Signature

To the best of my knowledge, the responses to this form accurately reflect all information requested concerning the proposed regulated activities and methods to protect the Edwards Aquifer. This Contributing Zone Plan Application is hereby submitted for TCEQ review and Executive Director approval. The application was prepared by:

Print Name of Customer/Agent: Alejandro E. Granados Rico, P.E.

Date: <u>June 19, 2023</u>

Signature of Customer/Agent:

Alejandro E. Grandon Rico

Regulated Entity Name: Nolina Phase 2A

Project Information

- 1. County: Williamson
- 2. Stream Basin: North Fork San Gabriel
- 3. Groundwater Conservation District (if applicable): <u>N/A</u>
- 4. Customer (Applicant):

Contact Person: L. Michael CoxEntity: JDS RR, LLCMailing Address: 5005 Riverway Drive, Ste. 500City, State: Houston, TXZip: 77056Telephone: (512) 496-4070Fax: ------Email Address: michael@johnsondev.com

5. Agent/Representative (If any):

Contact Person: Alejandro E Granados Rico, P.E.Entity: Kimley-Horn and Associates, Inc.Mailing Address: 501 S. Austin Ave., Suite 1310City, State: Georgetown, TexasTelephone: 512-782-0602Email Address: alex.granados@kimley-horn.com

Zip: <u>78626</u> Fax: <u>N/A</u>

6. Project Location:

The project site is located inside the city limits of _____

- The project site is located outside the city limits but inside the ETJ (extra-territorial jurisdiction) of ______.
- \boxtimes The project site is not located within any city's limits or ETJ.
- 7. X The location of the project site is described below. Sufficient detail and clarity has been provided so that the TCEQ's Regional staff can easily locate the project and site boundaries for a field investigation.

The Subject property is located northwest of the intersection of Ronald Reagan Blvd. and CR 248. This can be seen in the Road Map and the USGS Quadrangle Map, which are Attachments A and B, respectively.

- 8. Attachment A Road Map. A road map showing directions to and the location of the project site is attached. The map clearly shows the boundary of the project site.
- 9. Xttachment B USGS Quadrangle Map. A copy of the official 7 ½ minute USGS Quadrangle Map (Scale: 1" = 2000') is attached. The map(s) clearly show:

Project site boundaries.USGS Quadrangle Name(s).

- 10. Attachment C Project Narrative. A detailed narrative description of the proposed project is attached. The project description is consistent throughout the application and contains, at a minimum, the following details:
 - \boxtimes Area of the site
 - \boxtimes Offsite areas
 - \boxtimes Impervious cover
 - Permanent BMP(s)
 - $\boxtimes\,$ Proposed site use
 - \boxtimes Site history
 - Previous development
 - Area(s) to be demolished

- 11. Existing project site conditions are noted below:
 - Existing commercial site
 - Existing industrial site
 - Existing residential site
 - Existing paved and/or unpaved roads
 - Undeveloped (Cleared)
 - ☐ Undeveloped (Undisturbed/Not cleared)
 - Other: _____
- 12. The type of project is:
 - Residential: # of Lots: _133
 - Residential: # of Living Unit Equivalents: ____133_____
 - Commercial
 - Industrial
 - Other: _____
- 13. Total project area (size of site): <u>52.20 acres</u>

Total disturbed area: <u>50.51 Acres</u>

- 14. Estimated projected population: <u>466</u>
- 15. The amount and type of impervious cover expected after construction is complete is shown below:

Impervious Cover of Proposed Project	Sq. Ft.	Sq. Ft./Acre	Acres
Structures/Rooftops (HOMES AND DRIVEWAYS)	494,842	÷ 43,560 =	11.36
Parking	0	÷ 43,560 =	0
Other paved surfaces (ROADS AND SIDEWALK)	325,829	÷ 43,560 =	7.48
Total Impervious Cover	820,671	÷ 43,560 =	18.84

1.	Table 1 - Impervious Cover
— •	

Total Impervious Cover 18.84 ÷ Total Acreage 52.20 X 100 = 36.09% Impervious Cover

- 16. Attachment D Factors Affecting Surface Water Quality. A detailed description of all factors that could affect surface water quality is attached. If applicable, this includes the location and description of any discharge associated with industrial activity other than construction.
- 17. 🛛 Only inert materials as defined by 30 TAC 330.2 will be used as fill material.

For Road Projects Only

Complete questions 18 - 23 if this application is exclusively for a road project.

 \square N/A 18. Type of project: TXDOT road project. County road or roads built to county specifications. City thoroughfare or roads to be dedicated to a municipality. Street or road providing access to private driveways. 19. Type of pavement or road surface to be used: Concrete Asphalt concrete pavement Other: 20. Right of Way (R.O.W.): Length o f R .O.W.: ____ feet. Width o f R .O.W.: feet. $L x W = Ft^2 \div 43,560 Ft^2/Acre = ____acres.$ 21. Pavement Area: Length o f R .O.W.: ____ feet. Width o f R .O.W.: ____ feet. L x W =__Ft² ÷ 43,560 Ft²/Acre = ____acres. Pavement area _____acres ÷ R .O.W. a rea ____acres x 100 = ___ % impervious cover. 22. A rest stop will be included in this project.

A rest stop will not be included in this project.

23. Maintenance and repair of existing roadways that do not require approval from the TCEQ Executive Director. Modifications to existing roadways such as widening roads/adding shoulders totaling more than one-half (1/2) the width of one (1) existing lane require prior approval from the TCEQ.

Stormwater to be generated by the Proposed Project

24. Attachment E - Volume and Character of Stormwater. A detailed description of the volume (quantity) and character (quality) of the stormwater runoff which is expected to occur from the proposed project is attached. The estimates of stormwater runoff quality and quantity are based on area and type of impervious cover. Include the runoff coefficient of the site for both pre-construction and post-construction conditions.

Wastewater to be generated by the Proposed Project

25. Wastewater is to be discharged in the contributing zone. Requirements under 30 TAC§213.6(c) relating to Wastewater Treatment and Disposal Systems have been satisfied.

🖂 N/A

26. Wastewater will be disposed of by:

On-Site Sewage Facility (OSSF/Septic Tank):

Attachment F - Suitability Letter from Authorized Agent. An on-site sewage facility will be used to treat and dispose of the wastewater from this site. The appropriate licensing authority's (authorized agent) written approval is attached. It states that the land is suitable for the use of private sewage facilities and will meet or exceed the requirements for on-site sewage facilities as specified under 30 TAC Chapter 285 relating to On-site Sewage Facilities.

☐ Each lot in this project/development is at least one (1) acre (43,560 square feet) in size. The system will be designed by a licensed professional engineer or registered sanitarian and installed by a licensed installer in compliance with 30 TAC Chapter 285.

 \boxtimes Sewage Collection System (Sewer Lines):

The sewage collection system will convey the wastewater to the <u>Pecan Branch Wastewater</u> <u>Treatment Plan</u>. The treatment facility is:

Existing. Proposed.

Permanent Aboveground Storage Tanks (ASTs) ≥ 500 Gallons

Complete questions 27 - 33 if this project includes the installation of AST(s) with volume(s) greater than or equal to 500 gallons.

🖂 N/A

27. Tanks and substance stored:

2. Table 2 - Tanks and Substance Storage

AST Number	Size (Gallons)	Substance to be Stored	Tank Material
1			
2			
3			
4			
5			

- 28. The AST will be placed within a containment structure that is sized to capture one and one-half (1 1/2) times the storage capacity of the system. For facilities with more than one tank system, the containment structure is sized to capture one and one-half (1 1/2) times the cumulative storage capacity of all systems.
 - Attachment G Alternative Secondary Containment Methods. Alternative methods for providing secondary containment are proposed. Specifications showing equivalent protection for the Edwards Aquifer are attached.
 - 29. Inside dimensions and capacity of containment structure(s):

Length (L)(Ft.)	Width(W)(Ft.)	Height (H)(Ft.)	L x W x H = (Ft3)	Gallons
			Tot	al: Gallons

3	Table 3 -	Secondary	/ Containment
J .	10010 0 -		

- All piping, hoses, and dispensers will be located inside the containment structure.
- Some of the piping to dispensers or equipment will extend outside the containment structure.
- The piping will be aboveground

30. Piping:

- The piping will be underground
- 31. The containment area must be constructed of and in a material impervious to the substance(s) being stored. The proposed containment structure will be constructed of:
- 32. Attachment H AST Containment Structure Drawings. A scaled drawing of the containment structure is attached that shows the following:
 - Interior dimensions (length, width, depth and wall and floor thickness).
 - Internal drainage to a point convenient for the collection of any spillage.
 - Tanks clearly labeled
 - Piping clearly labeled
 - Dispenser clearly labeled
- 33. Any spills must be directed to a point convenient for collection and recovery. Spills from storage tank facilities must be removed from the controlled drainage area for disposal within 24 hours of the spill.

In the event of a spill, any spillage will be removed from the containment structure within 24 hours of the spill and disposed of properly.

☐ In the event of a spill, any spillage will be drained from the containment structure through a drain and valve within 24 hours of the spill and disposed of properly. The drain and valve system are shown in detail on the scaled drawing.

Site Plan Requirements

Items 34 - 46 must be included on the Site Plan.

34. \square The Site Plan must have a minimum scale of 1" = 400'.

Site Plan Scale: 1" = <u>100</u>'.

35. 100-year floodplain boundaries:

Some part(s) of the project site is located within the 100-year floodplain. The floodplain is shown and labeled.

- No part of the project site is located within the 100-year floodplain. The 100-year floodplain boundaries are based on the following specific (including date of material) sources(s): FEMA Map No. 48491C 0275E dated September 26, 2008.
- 36. The layout of the development is shown with existing and finished contours at appropriate, but not greater than ten-foot contour intervals. Lots, recreation centers, buildings, roads, etc. are shown on the site plan.

The layout of the development is shown with existing contours at appropriate, but not greater than ten-foot contour intervals. Finished topographic contours will not differ from the existing topographic configuration and are not shown. Lots, recreation centers, buildings, roads, etc. are shown on the site plan.

- 37. \square A drainage plan showing all paths of drainage from the site to surface streams.
- 38. 🖂 The drainage patterns and approximate slopes anticipated after major grading activities.
- 39. \square Areas of soil disturbance and areas which will not be disturbed.
- 40. X Locations of major structural and nonstructural controls. These are the temporary and permanent best management practices.
- 41. Locations where soil stabilization practices are expected to occur.
- 42. Surface waters (including wetlands).

N/A

- 43. Locations where stormwater discharges to surface water.
 - \square There will be no discharges to surface water.
- 44. Temporary aboveground storage tank facilities.
 - Temporary aboveground storage tank facilities will not be located on this site.

- 45. Permanent aboveground storage tank facilities.
 - Permanent aboveground storage tank facilities will not be located on this site.
- 46. \boxtimes Legal boundaries of the site are shown.

Permanent Best Management Practices (BMPs)

Practices and measures that will be used during and after construction is completed.

47. Permanent BMPs and measures must be implemented to control the discharge of pollution from regulated activities after the completion of construction.

N/A

- 48. These practices and measures have been designed, and will be constructed, operated, and maintained to insure that 80% of the incremental increase in the annual mass loading of total suspended solids (TSS) from the site caused by the regulated activity is removed. These quantities have been calculated in accordance with technical guidance prepared or accepted by the executive director.
 - The TCEQ Technical Guidance Manual (TGM) was used to design permanent BMPs and measures for this site.
 - A technical guidance other than the TCEQ TGM was used to design permanent BMPs and measures for this site. The complete citation for the technical guidance that was used is:

N/A

49. Owners must insure that permanent BMPs and measures are constructed and function as designed. A Texas Licensed Professional Engineer must certify in writing that the permanent BMPs or measures were constructed as designed. The certification letter must be submitted to the appropriate regional office within 30 days of site completion.

____ N/A

50. Where a site is used for low density single-family residential development and has 20 % or less impervious cover, other permanent BMPs are not required. This exemption from permanent BMPs must be recorded in the county deed records, with a notice that if the percent impervious cover increases above 20% or land use changes, the exemption for the whole site as described in the property boundaries required by 30 TAC §213.4(g) (relating to Application Processing and Approval), may no longer apply and the property owner must notify the appropriate regional office of these changes.

The site will be used for low density single-family residential development and has 20% or less impervious cover.

- The site will be used for low density single-family residential development but has more than 20% impervious cover.
- The site will not be used for low density single-family residential development.

51.	The executive director may waive the requirement for other permanent BMPs for multi-
	family residential developments, schools, or small business sites where 20% or less
	impervious cover is used at the site. This exemption from permanent BMPs must be
	recorded in the county deed records, with a notice that if the percent impervious cover
	increases above 20% or land use changes, the exemption for the whole site as described in
	the property boundaries required by 30 TAC §213.4(g) (relating to Application Processing
	and Approval), may no longer apply and the property owner must notify the appropriate
	regional office of these changes.

Attachment I - 20% or Less Impervious Cover Waiver. The site will be used for multi-family residential developments, schools, or small business sites and has 20% or less impervious cover. A request to waive the requirements for other permanent BMPs and measures is attached.

The site will be used for multi-family residential developments, schools, or small business sites but has more than 20% impervious cover.

The site will not be used for multi-family residential developments, schools, or small business sites.

52. X Attachment J - BMPs for Upgradient Stormwater.

A description of the BMPs and measures that will be used to prevent pollution of surface water, groundwater, or stormwater that originates upgradient from the site and flows across the site is attached.

No surface water, groundwater or stormwater originates upgradient from the site and flows across the site, and an explanation is attached.

Permanent BMPs or measures are not required to prevent pollution of surface water, groundwater, or stormwater that originates upgradient from the site and flows across the site, and an explanation is attached.

- 53. X Attachment K BMPs for On-site Stormwater.
 - A description of the BMPs and measures that will be used to prevent pollution of surface water or groundwater that originates on-site or flows off the site, including pollution caused by contaminated stormwater runoff from the site is attached.

Permanent BMPs or measures are not required to prevent pollution of surface water or groundwater that originates on-site or flows off the site, including pollution caused by contaminated stormwater runoff, and an explanation is attached.

54. Attachment L - BMPs for Surface Streams. A description of the BMPs and measures that prevent pollutants from entering surface streams is attached.

N/A

55. Attachment M - Construction Plans. Construction plans and design calculations for the proposed permanent BMPs and measures have been prepared by or under the direct supervision of a Texas Licensed Professional Engineer, and are signed, sealed, and dated. Construction plans for the proposed permanent BMPs and measures are

attached and include: Design calculations, TCEQ Construction Notes, all proposed structural plans and specifications, and appropriate details.

N/A

56. Attachment N - Inspection, Maintenance, Repair and Retrofit Plan. A site and BMP specific plan for the inspection, maintenance, repair, and, if necessary, retrofit of the permanent BMPs and measures is attached. The plan fulfills all of the following:

Prepared and certified by the engineer designing the permanent BMPs and measures

- \boxtimes Signed by the owner or responsible party
- Outlines specific procedures for documenting inspections, maintenance, repairs, and, if necessary, retrofit.
- Contains a discussion of record keeping procedures
- N/A
- 57. Attachment O Pilot-Scale Field Testing Plan. Pilot studies for BMPs that are not recognized by the Executive Director require prior approval from the TCEQ. A plan for pilot-scale field testing is attached.

🖂 N/A

58. Attachment P - Measures for Minimizing Surface Stream Contamination. A description of the measures that will be used to avoid or minimize surface stream contamination and changes in the way in which water enters a stream as a result of the construction and development is attached. The measures address increased stream flashing, the creation of stronger flows and in-stream velocities, and other in-stream effects caused by the regulated activity, which increase erosion that result in water quality degradation.

□ N/A

Responsibility for Maintenance of Permanent BMPs and Measures after Construction is Complete.


- 59. The applicant is responsible for maintaining the permanent BMPs after construction until such time as the maintenance obligation is either assumed in writing by another entity having ownership or control of the property (such as without limitation, an owner's association, a new property owner or lessee, a district, or municipality) or the ownership of the property is transferred to the entity. Such entity shall then be responsible for maintenance until another entity assumes such obligations in writing or ownership is transferred.
- 60. A copy of the transfer of responsibility must be filed with the executive director at the appropriate regional office within 30 days of the transfer if the site is for use as a multiple single-family residential development, a multi-family residential development, or a non-residential development such as commercial, industrial, institutional, schools, and other sites where regulated activities occur.

Administrative Information


- 61. Submit one (1) original and one (1) copy of the application, plus additional copies as needed for each affected incorporated city, groundwater conservation district, and county in which the project will be located. The TCEQ will distribute the additional copies to these jurisdictions.
- 62. Any modification of this Contributing Zone Plan may require TCEQ review and Executive Director approval prior to construction, and may require submission of a revised application, with appropriate fees.
- 63. The site description, controls, maintenance, and inspection requirements for the storm water pollution prevention plan (SWPPP) developed under the EPA NPDES general permits for stormwater discharges have been submitted to fulfill paragraphs 30 TAC §213.24(1-5) of the technical report. All requirements of 30 TAC §213.24(1-5) have been met by the SWPPP document.
 - The Temporary Stormwater Section (TCEQ-0602) is included with the application.

NOLINA PHASE 2A CONTRIBUTING ZONE PLAN

ROAD MAP

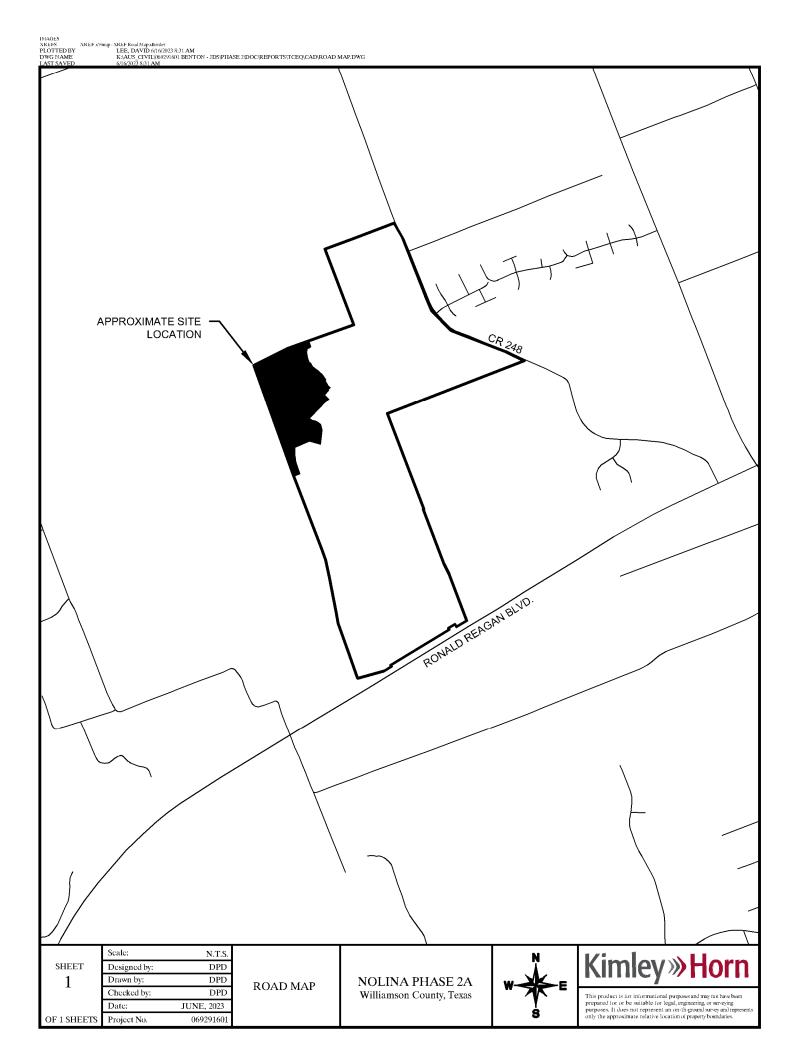

USGS QUADRANGLE MAP

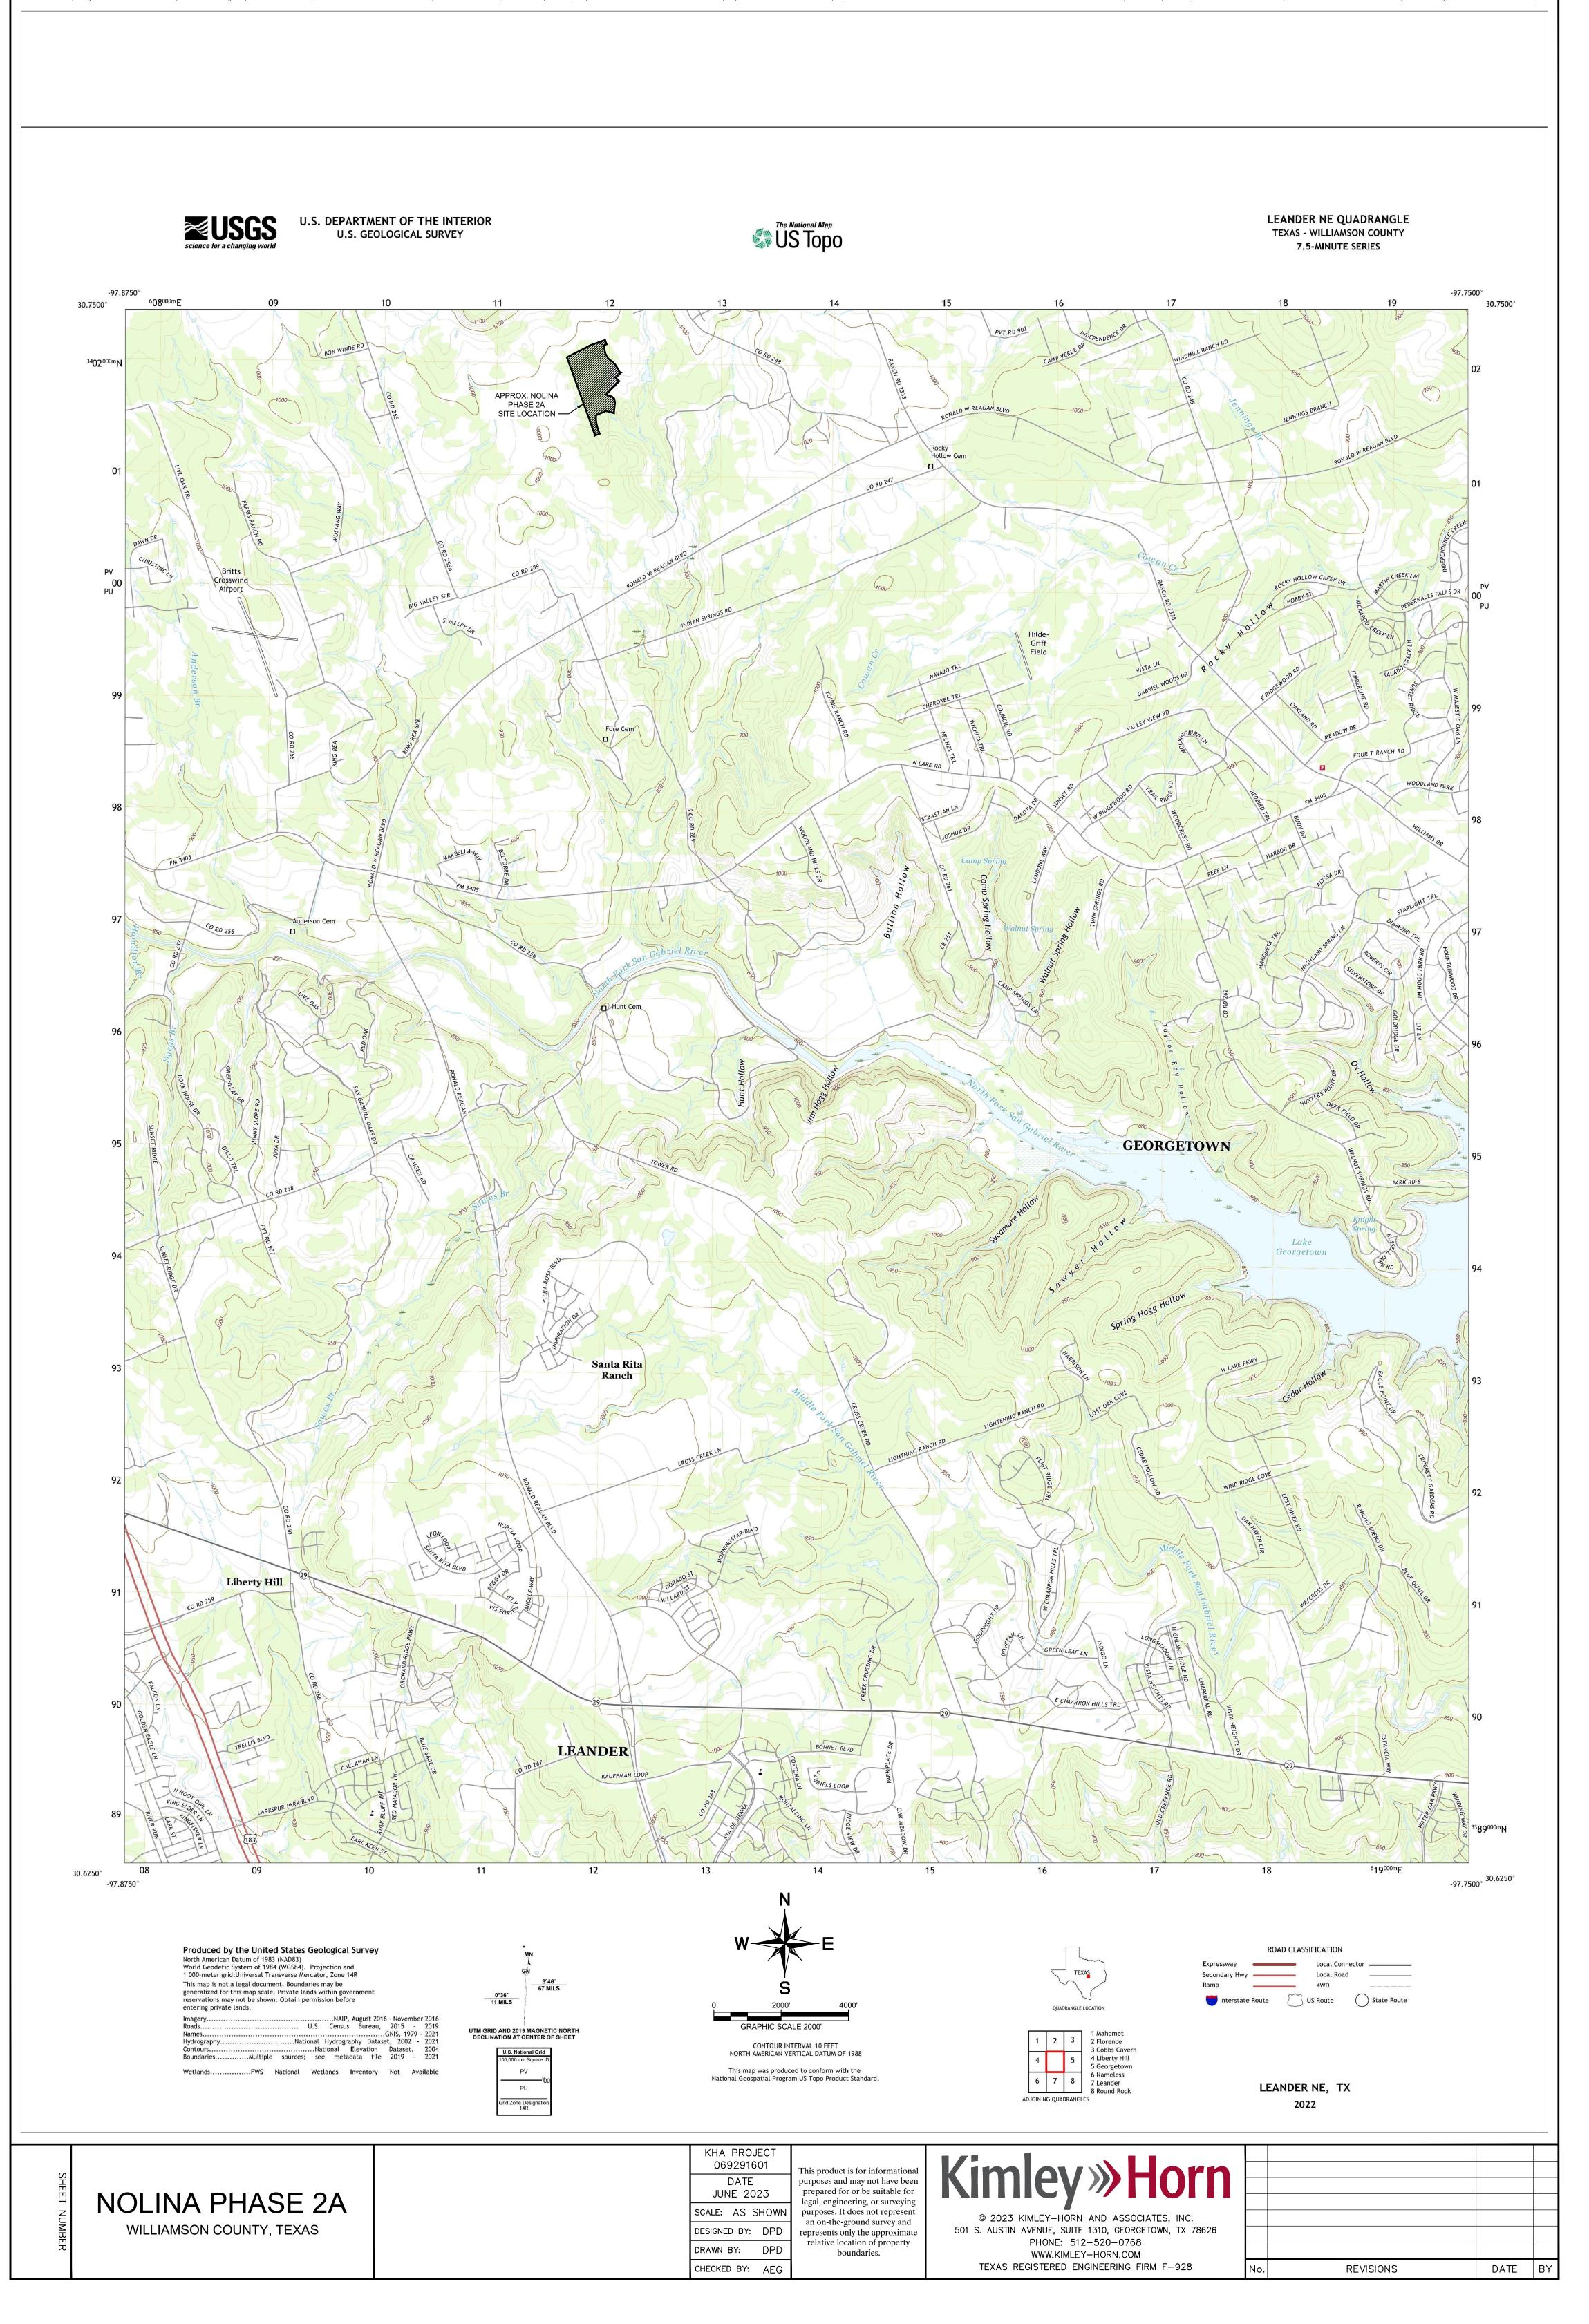

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Plotted By:Lee, David Date: June 16, 2023 08: 34: 25am File Path:K: \AUS_Civil\069291601 Benton - JDS\PHASE 2\Doc\Reports\TCEQ\CAD\USGS Map.dwg

PROJECT NARRATIVE

Nolina Phase 2A is a portion of a larger mixed-use development, Nolina, which encompasses approximately 523 acres. Nolina Phase 2A encompasses approximately 52.20 acres of on-site single-family residential development. The Subject property is located northwest of Ronald Reagan Blvd. and CR 248 intersection, in Williamson County, Texas. The existing site is undeveloped rangeland. The scope of the project consists of the following civil improvements: roadway, water, wastewater, and storm sewer. The site lies over the Edwards Aquifer Contributing Zone and does not contain areas within the 100-year floodplain as defined by Federal Emergency Management Agency Federal Insurance Rate Map # 48491C0275E, dated September 26, 2008.

The Site, Nolina Phase 2A, has an overall impervious cover of 18.84 acres or 36.09% as shown in the table below. The onsite permanent BMP is designed to handle the increase in impervious cover on-site will be one on-site batch detention pond, vegetative filter strips, and three Stormtroopers (Wet Vaults). A portion of Nolina Phase 2A (WQP-C) will be treated by a batch detention pond built with Benton Phase 1, Section 3. Nolina Phase 2A includes 133 single family lots. Each lot has a pad that is either 2,100 ft², 2,240 square feet, 2,800 square feet, 3,200 square feet, or 4,000 square feet. An additional 350 square feet is added to each lot to account for the driveway. There are 51 lots that have 4,350 square feet of impervious cover, 39 lots that have 3,550 square feet of impervious cover, 41 lots that have 3,150 square feet of impervious cover, 1 lot that has 2,590 square feet of impervious cover, and 1 lot that has 2,450 square feet of impervious cover. Total, the 133 single family lots account for approximately 11.36 acres of impervious cover.

The required capture volume for the proposed batch detention pond is 84,432 cubic ft for WQP-D. The water quality volume provided for WQP-D is 88,027 cubic ft. The total volume proposed for WQP-D is 114,244 cubic ft.

Approximately 0.48 acres from the Nolina Phase 2A site is proposed to drain into the water quality basin WQP-C in the Benton Phase 1, Section 3 site. The additional required capture volume for the proposed batch detention pond is 1,616 cubic feet for the Nolina Phase 2A portion of WQP-C. The current required capture volume for the proposed batch detention pond is 109,401 cubic feet for the Benton Phase 1, Section 3 portion of WQP-C. The water quality volume provided for WQP-C is 117,975 cubic feet. Therefore, the water quality volume provided for WQP-C can adequately support the additional required capture volume proposed for Nolina Phase 2A portion of WQP-C.

All the proposed impervious cover is compliant with the limitations of the impervious allotted by the regulating entity (Williamson County). The percentage of impervious cover proposed is calculated for the fully developed project. The Overall proposed impervious is shown below.

	TCEQ Overall Water Quality Drainage Basins						
Basin ID	Proposed Area (AC)	Proposed Impervious Cover (AC)	% Impervious Cover	REQUIRED TSS REMOVAL	PROPOSED TSS REMOVAL		
WQP-D	20.47	11.51	56%	10018	11090		
WQP-C (2A)	0.48	0.36	75%	313	313		
WV-1	1.12	0.92	82%	801	797		
WV-2	0.89	0.68	76%	592	610		
WV-3	1.06	0.77	73%	670	695		
VFS-1	2.36	1.00	42%	870	870		
VFS-2	2.63	1.38	52%	1201	1201		
VFS-3	2.38	1.23	52%	1071	1071		
UNTREATED	20.81	0.99	5%	862	0		
TOTAL ONSITE	52.20	18.84	36.09%	16398	16647		

FACTORS AFFECTING SURFACE WATER QUALITY

Examples of items and activities to be expected with the proposed development include petroleum based fuels used in vehicles from vehicle parking, and grass and leaves from landscaping.

During construction, water quality could be affected by the runoff carrying sediments from the open construction area. Silt fence will be installed along the downstream portion of the property and inlet protections will be installed around all proposed inlet structures (once constructed).

After construction, all disturbed areas on the site will be re-vegetated and runoff from the proposed improvements will be captured by the proposed storm sewer system and into one of the proposed BMP's.

VOLUME AND CHARACTER OF STORMWATER

The proposed BMP's were designed and sized to treat the proposed onsite and offsite flows. The proposed improvements create a total of 18.84 acres of impervious cover, making up 36.09% of the overall site that drains into the proposed BMPs. TCEQ TSS Removal calculations are provided on the sheets that follow. Please reference the following sheets 35-38 in attached construction plans.

SUITABILITY LETTER FROM AUTHORIZED AGENT

(NOT APPLICABLE)

CONTRIBUTING ZONE PLAN ATTACHMENT F

BMPs FOR UPGRADIENT STORMWATER

(NOT APPLICABLE)

BMPs FOR ON-SITE STORMWATER

During construction, BMP's include silt fence and inlet protection to capture sediment from the construction area contained within the storm water runoff. Silt fence will be installed along the downstream portion of the property. Inlet protection will be installed on all storm sewer curb inlets existing and proposed (once constructed).

Nolina Phase 2A has a total of 9 onsite water quality basins, 2 batch detention pond areas, 3 VFS areas, 3 WV areas, and 1 untreated area. The overall required removal for this phase of development is Lm = 16,398 LBS. The system has been designed to provide 16,647 LBS of TSS removal. The basins have been broken out and are shown on the construction drawings (Water Quality Area Map, Sheet 35). Water quality drainage area WQP-D will overland flow to drainage inlets then pipe flow to Batch Detention Pond D. Batch Detention Pond D will provide 11,090 LBS of TSS removal. Water quality drainage area WQP-C (2A) will overland flow to drainage inlets then pipe flow to Batch Detention Pond C built with Benton Phase 1, Section 3. Batch Detention Pond C will provide 313 LBS of TSS removal from this development. WV-1, WV-2, and WV-3 will overland flow to drainage inlets then discharge into natural channel. The Stormtroopers will provide a total of 2,102 LBS of TSS removal. VFS-1, VFS-2, and VFS-3 will all overland flow over vegetative filter strips. The VFS will provide a total of 3142 LBS of TSS removal. All TSS calculations are shown on the construction drawings sheets 35-38. The impervious breakdown is shown under the project narrative.

After construction, all disturbed areas on the site will be re-vegetated and runoff from the proposed improvements will be captured by the proposed storm system and conveyed through the proposed BMP's.

BMPs FOR SURFACE STREAMS

There are no existing surface streams or sensitive features being affected on site. All permanent BMPs have been designed to remove the increase in Total Suspended Solids as per current TCEQ requirements.


CONSTRUCTION PLANS

Please reference attached construction plans.

SHEET INDEX

SHEET NO.	DESCRIPTION
1	COVER SHEET
2	CITY OF GEORGETOWN AND TCEQ GENERAL NOTES
3	WILLIAMSON COUNTY GENERAL NOTES
4	KIMLEY-HORN GENERAL NOTES
5	EXISTING CONDITIONS & DEMOLITION PLAN
6	EROSION CONTROL PLAN
7	REVEGETATION PLAN
8	GRADING PLAN (SHEET 1 OF 2)
9	GRADING PLAN (SHEET 2 OF 2)
10	PAVING PLAN & PROFILE - WILD NOLINA WAY STA. 1+00 TO 10+50
11	PAVING PLAN & PROFILE - WILD NOLINA WAY STA. 10+50 TO END
12	PAVING PLAN & PROFILE - BEEBALM COVE STA. 1+00 TO END
13	PAVING PLAN & PROFILE - SNAKEROOT TRAIL STA. 1+00 TO 9+50
14	PAVING PLAN & PROFILE - SNAKEROOT TRAIL STA. 9+50 TO END
15	PAVING PLAN & PROFILE - STANDING CYPRESS TRAIL STA. 1+00 TO 9+50
16	PAVING PLAN & PROFILE - STANDING CYPRESS TRAIL STA. 9+50 TO END
17 18	PAVING PLAN & PROFILE - PRICKLY POPPY WAY STA. 1+00 TO END PAVING PLAN & PROFILE - LADY FERN DRIVE STA. 1+00 TO END
18	PAVING PLAN & PROFILE - LADY FERN DRIVE STA. 1+00 TO END PAVING PLAN & PROFILE - WINTERBERRY WAY STA. 1+00 TO END
20	PAVING PLAN & PROFILE - WINTERBERRY WAY STA. 1+00 TO END PAVING PLAN & PROFILE - BLUESTEM BRUSH LANE STA. 1+00 TO END
20	EXISTING & PROPOSED DRAINAGE AREA MAP
22	INLET DRAINAGE AREA MAP
23	DRAINAGE CALCULATIONS
24	OVERALL UTILITY PLAN
25	STORM PLAN & PROFILE - LINE SD-A (SHEET 1 OF 2)
26	STORM PLAN & PROFILE - LINE SD-A (SHEET 2 OF 2)
27	STORM PLAN & PROFILE - LINE SD-B
28	STORM PLAN & PROFILE - LINE SD-C
29	STORM PLAN & PROFILE - LINE SD-D, SD-E & SD-F
30	STORM PLAN & PROFILE - LINE SD-G & SD-H
31	STORM PLAN & PROFILE - SD-J & EX SD-F
32	STORM PLAN & PROFILE - CULV A & CULV B
33	STORM LATERALS (SHEET 1 OF 2)
34	STORM LATERALS (SHEET 2 OF 2)
35	
36	WATER QUALITY CALCULATIONS (SHEET 1 OF 3) WATER QUALITY CALCULATIONS (SHEET 2 OF 3)
37	WATER QUALITY CALCULATIONS (SHEET 2 OF 3) WATER QUALITY CALCULATIONS (SHEET 3 OF 3)
<u>38</u> 39	WATER QUALITY CALCULATIONS (SHEET'S OF 3)
40	DETENTION POND E
40	WATER QUALITY DETAILS (SHEET 1 OF 2)
42	WATER QUALITY DETAILS (SHEET 2 OF 2)
43	OVERALL WATER PLAN (SHEET 1 OF 2)
44	OVERALL WATER PLAN (SHEET 2 OF 2)
45	WATER PLAN & PROFILE (SHEET 1 OF 2)
46	WATER PLAN & PROFILE (SHEET 2 OF 2)
47	OVERALL WASTEWATER PLAN
48	WASTEWATER PLAN & PROFILE - WWL-A (SHEET 1 OF 3)
49	WASTEWATER PLAN & PROFILE - WWL-A (SHEET 2 OF 3)
50	WASTEWATER PLAN & PROFILE - WWL-A (SHEET 3 OF 3) & WWL-B
51	WASTEWATER PLAN & PROFILE - WWL-C & WWL-D (SHEET 1 OF 2)
52	WASTEWATER PLAN & PROFILE - WWL-D (SHEET 2 OF 2) & WWL-E
53	WASTEWATER PLAN & PROFILE - WWL-F & WWL-G
54	WASTEWATER PLAN & PROFILE - WWL-H & WWL-J
55	STREET LIGHT & SIGN PLAN
56	STRIPING PLAN
57	
58	PAVING DETAILS (SHEET 1 OF 3)
59	PAVING DETAILS (SHEET 2 OF 3)
60	PAVING DETAILS (SHEET 3 OF 3)
61	STORM DRAIN DETAILS (SHEET 1 OF 2)
62	STORM DRAIN DETAILS (SHEET 2 OF 2)
63	WATER DETAILS

CIVIL CONSTRUCTION PLANS PAVING, GRADING & UTILITIES FOR NOLINA PHASE 2A WILLIAMSON COUNTY, TEXAS

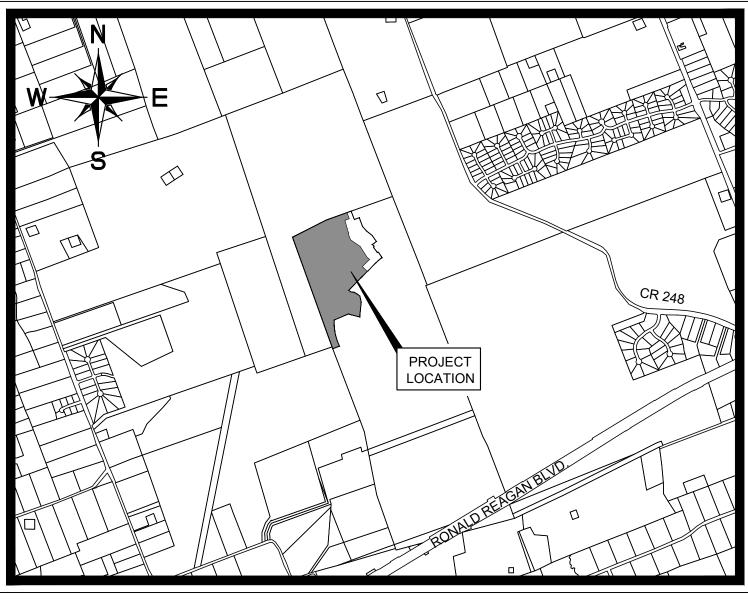

EGAL DESCRIPTION

AND SITUATED IN THE JAMES NOR OLORES CASANOVA SURVEY, ABSTRACT 128 SITUATED IN WILLIAMSON COUNTY EXAS; AND BEING A PORTION OF A CALLED 523.52 ACRE TRACT OF LAND DESCRIBED TO JDS RR LLC, AS SHOWN ON INSTRUMENT RECORDED UNDER DOCUMENT NO. 2022010857 OF THE OFFICIAL PUBLIC RECORDS OF WILLIAMSON COUNTY

RELEASE OF THIS APPLICATION DOES NOT CONSTITUTE A VERIFICATION OF ALL DATA, INFORMATION AND CALCULATIONS SUPPLIED BY THE APPLICANT. THE ENGINEER OF RECORD IS SOLELY RESPONSIBLE FOR THE COMPLETENESS, ACCURACY AND ADEQUACY OF HIS/HER SUBMITTAL, WHETHER OR NOT THE APPLICATION IS REVIEWED FOR CODE COMPLIANCE BY CITY ENGINEERS


VICINITY MAP SCALE: 1" = 2,000'

AUGUST 2023

CITY OF GEORGETOWN	DATE
3 B&J MUNICIPAL UTILITY DISTRICT	DATE
REVIEWED FOR COMPLIANCE WITH COUNTY REQUIREMENTS:	
WILLIAMSON COUNTY ENGINEER'S OFFICE	DATE
REVIEWED FOR COMPLIANCE WITH WILLIAMSON COUNTY FIRE MARSHAL'S OFFICE	
WILLIAMSON COUNTY FIRE MARSHAL	DATE



- FOR CODE COMPLIANCE BY CITY ENGINEERS
- ALL OVERALL DRAINAGE AREA MAPS AND CALCULATIONS FOR THE NOLINA KIMLEY-HORN FOR THE 3B&J MUD.

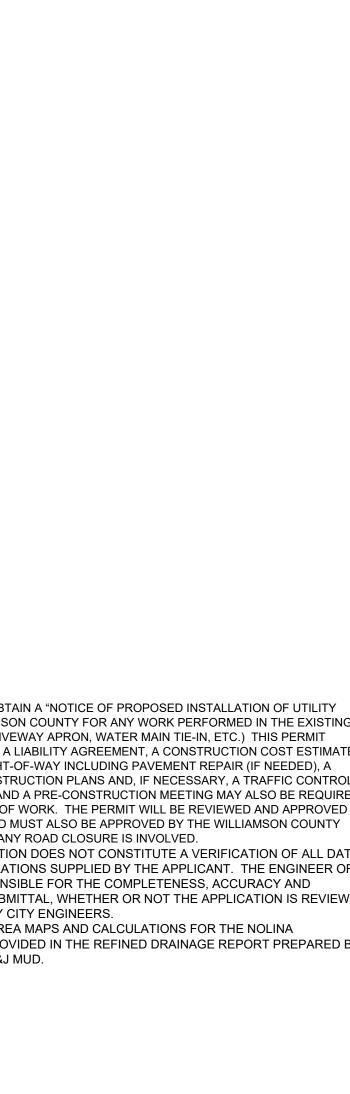

OWNER/DEVELOPER

JDS RR, LLC, 5005 RIVERWAY DR. HOUSTON, TX 77056 TEL: (512) 496-4070 CONTACT: RICK YARBROUGH

ENGINEER


SUITE 1310

Kimley»Horn 501 S. AUSTIN AVENUE

STATE OF TEXAS **REGISTRATION NO. F-928**

GEORGETOWN, TEXAS 78626

PH. (512) 520-0768	
CONTACT: ALEJANDRO E. GRANADOS RICO, P.E	Ξ.

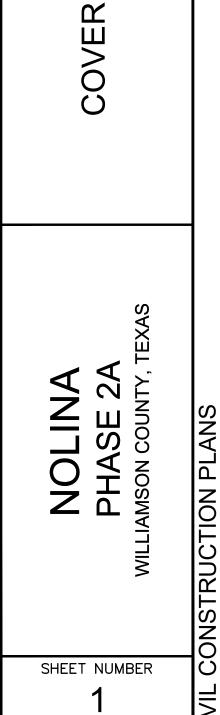

8/04/2023

JANDRO E GRANADOS

Ш

SHE



Know what's **below. Call** before you dig.

BM #50000 COTTON SPINDLE SET AT THE SOUTH END OF COUNTY ROAD 248, APPROXIMATELY 453'

DATUM IS NAVD '88, USING GEOID 18, BASED ON GPS OBSERVATIONS.

BENCHMARKS

SOUTHEAST OF THE INTERSECTION OF WEST RIDGE ANE AND COUNTY ROAD 248. ELEV.= 1012.516' (NAVD '88)

BM #50058 MAG NAIL SET IN THE SOUTH IN CULVERT ALONG SOUTH ROW OF COUNTY ROAD 248, PPROXIMATELY 1,070' FROM THE INTERSECTION OF OUNTY ROAD 248 AND WEST RIDGE LANE.

ELEV.=987.278' (NAVD '8

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY CONTRIBUTIN GENERAL CONSTRUCTION NOTES: -	JOINT OF AT LEAST 150 PSI PRE SIZES LARGER THAN THE NEW (SUPPORTED AT FIVE-FOOT INTE
 A WRITTEN NOTICE OF CONSTRUCTION MUST BE SUBMITTED HOURS PRIOR TO THE START OF ANY GROUND DISTURBANCE MUST INCLUDE: 	
- THE NAME OF THE APPROVED PROJECT; - THE ACTIVITY START DATE; AND - THE CONTACT INFORMATION OF THE PRIME CONTRACT	LINE REGARDLESS OF CONSTRU 13. SUCTION MAINS TO PUMP
2. ALL CONTRACTORS CONDUCTING REGULATED ACTIVITIES AS	
PROVIDED WITH COMPLETE COPIES OF THE APPROVED CONT LETTER INDICATING THE SPECIFIC CONDITIONS OF ITS APPRO REGULATED ACTIVITIES, THE CONTRACTOR(S) SHOULD KEEP APPROVAL LETTER ON- SITE.	OVAL. DURING THE COURSE OF THESEDRAINFIELDS [§290.44(E)(8)].COPIES OF THE APPROVED PLAN AND
3. NO HAZARDOUS SUBSTANCE STORAGE TANK SHALL BE INSTA SOURCE, DISTRIBUTION SYSTEM, WELL, OR SENSITIVE FEATU	
4. PRIOR TO BEGINNING ANY CONSTRUCTION ACTIVITY, ALL TEM CONTROL MEASURES MUST BE PROPERLY INSTALLED AND MANUFACTURERS SPECIFICATIONS. IF INSPECTIONS INDICATI INAPPROPRIATELY, OR INCORRECTLY, THE APPLICANT MUST SITUATIONS. THESE CONTROLS MUST REMAIN IN PLACE UNTIL PERMANENTLY STABILIZED.	IPORARY EROSION AND SEDIMENTATION (E&S)CONTAMINATION PERSISTS. A MAINTAINED IN ACCORDANCE WITH THEWATERLINE WILL BE REQUIREDE A CONTROL HAS BEEN USEDAS DESIGNATED BY THE DESIGNREPLACE OR MODIFY THE CONTROL FOR SITE16.DECHLORINATION OF DISI
5. ANY SEDIMENT THAT ESCAPES THE CONSTRUCTION SITE MUS OF BEFORE THE NEXT RAIN EVENT TO ENSURE IT IS NOT WAS FEATURES, ETC.	HED INTO SURFACE STREAMS, SENSITIVE
 SEDIMENT MUST BE REMOVED FROM THE SEDIMENT TRAPS C 50% OF THE BASIN'S DESIGN CAPACITY. 	OR SEDIMENTATION BASINS WHEN IT OCCUPIES OR SEDIMENTATION BASINS WHEN IT OCCUPIES CONCURRENCE OF COMPLI PROPOSED PROJECT ARE H
7. LITTER, CONSTRUCTION DEBRIS, AND CONSTRUCTION CHEMI PREVENTED FROM BEING DISCHARGED OFFSITE.	
 ALL EXCAVATED MATERIAL THAT WILL BE STORED ON-SITE MI IF PORTIONS OF THE SITE WILL HAVE A CEASE IN CONSTRUCT 	TIME OF SUBMITTAL OF THE
SOIL STABILIZATION IN THOSE AREAS SHALL BE INITIATED AS SO	3. THE SITE CONSTRUCTION F
INACTIVITY. IF ACTIVITY WILL RESUME PRIOR TO THE 21 REQUIRED. IF DROUGHT CONDITIONS OR INCLEMENT WE STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS	ST DAY, STABILIZATION MEASURES ARE NOT 4. WASTEWATER MAINS AND SEATHER PREVENT ACTION BY THE 14_{TH} DAY,
10. THE FOLLOWING RECORDS SHOULD BE MAINTAINED AND MAD	
- THE DATES WHEN MAJOR GRADING ACTIVITIES OCCUR - THE DATES WHEN CONSTRUCTION ACTIVITIES TEMPOR OF THE SITE; AND	
	9. WASTEWATER MAINS SHAL
1. THE HOLDER OF ANY APPROVED CZP MUST NOTIFY THE APPF OBTAIN APPROVAL FROM THE EXECUTIVE DIRECTOR PRIOR T	O INITIATING ANY OF THE FOLLOWING:
 A. ANY PHYSICAL OR OPERATIONAL MODIFICATION OF AN STRUCTURE(S), INCLUDING BUT NOT LIMITED TO TEMPO SILT FENCES, AND DIVERSIONARY STRUCTURES; 	DRARY OR PERMANENT PONDS, DAMS, BERMS, HOURS.
 B. ANY CHANGE IN THE NATURE OR CHARACTER OF THE I ORIGINALLY APPROVED; C. ANY CHANGE THAT WOULD SIGNIFICANTLY IMPACT T 	THE BUILDING SPRINKLER S
EDWARDS AQUIFER; OR D. ANY DEVELOPMENT OF LAND PREVIOUSLY IDENTIF CONTRIBUTING ZONE PLAN.	TIED AS UNDEVELOPED IN THE APPROVED12. PUBLIC WATER SYSTEM MA150 PSI FOR 4 HOURS.
TCEQ REGION 11 OFFICE	13. ALL BENDS AND CHANGES I BLOCKED.
12100 PARK 35 CIRCLE, BUILDING A, RM 179 AUSTIN, TEXAS 78753-3795	14. LONG FIRE HYDRANT LEADS
PHONE: (512) 339-2929	STANDARDS AND SPECIFICA
FAX: (512) 339-3795	16. WATER AND SEWER MAIN C
T.C.E.Q WATER NOTES	17. FLEXIBLE BASE MATERIAL F 18. HOT MIX ASPHALTIC CONCF
1. THIS WATER DISTRIBUTION SYSTEM MUST BE CONSTRUCURRENT TEXAS COMMISSION ON ENVIRONMENTAL QU	
REGULATIONS FOR PUBLIC WATER SYSTEMS 30 TEXAS A 290 SUBCHAPTER D. WHEN CONFLICTS ARE NOTED WITH STRINGENT REQUIREMENT SHALL BE APPLIED. AT A MIN WATER SYSTEMS MUST ALWAYS MEET TCEQ'S "RULES A	ADMINISTRATIVE CODE (TAC) CHAPTER H LOCAL STANDARDS, THE MORE IMUM, CONSTRUCTION FOR PUBLIC AND REGULATIONS FOR PUBLIC WATER AND REGULATIONS FOR PUBLIC WATER ADD REGULATIONS FOR PUBLIC WATER
SYSTEMS." 2. ALL NEWLY INSTALLED PIPES AND RELATED PRODUCTS NATIONAL STANDARDS INSTITUTE (ANSI)/NSF INTERNAT	DESIGN ENGINEED DDIAD T
CERTIFIED BY AN ORGANIZATION ACCREDITED BY ANSI 3. PLASTIC PIPE FOR USE IN PUBLIC WATER SYSTEMS MU SEAL OF APPROVAL (NSF-PW) AND HAVE AN ASTM DESIGN P	[§290.44(A)(1)]. TO CITY IN PDF FORMAT. JST BEAR THE NSF INTERNATIONAL 22. IT IS THE RESPONSIBILITY C
OR A STANDARD DIMENSION RATIO OF 26 OR LESS [§290.44() 4. NO PIPE WHICH HAS BEEN USED FOR ANY PURPOSE O DRINKING WATER SHALL BE ACCEPTED OR RELOCATED FOR	A)(2)]. MAINTAINED IN CONFORMA THER THAN THE CONVEYANCE OF
SUPPLY [§290.44(A)(3)]. 5. ALL WATER LINE CROSSINGS OF WASTEWATER MAINS	(UDC), THE CITY OF GEORG
 [§290.44(E)(4)(B)]. 6. WATER TRANSMISSION AND DISTRIBUTION LINES SHAL WITH THE MANUFACTURER'S INSTRUCTIONS. HOWEVER, THE 	E TOP OF THE WATER LINE MUST BE SERVICES DEPARTMENT. N
LOCATED BELOW THE FROST LINE AND IN NO CASE SHALL T THAN 24 INCHES BELOW GROUND SURFACE [§290.44(A)(4)]. 7. THE MAXIMUM ALLOWABLE LEAD CONTENT OF PIPES, I	26. SIDEWALKS SHALL BE PROV
 THE MAXIMUM ALLOWABLE LEAD CONTENT OF PIPES, I AND FIXTURES IS 0.25 PERCENT [§290.44(B)]. THE CONTRACTOR SHALL INSTALL APPROPRIATE AIR F 	27. DRIVEWAYS WILL REQUIRE
OPENINGS TO THE ATMOSPHERE COVERED WITH 16-MESH O SCREENING MATERIAL OR AN ACCEPTABLE EQUIVALENT [§2	90.44(D)(1)]. 28. OUTDOOR LIGHTING SHALL
9. THE CONTRACTOR SHALL NOT PLACE THE PIPE IN WAT WITH WATER OR SEWAGE DURING ITS STORAGE OR INSTALL WHEN WATERLINES ARE LAID UNDER ANY FLOWING OR INTE	ATION [§290.44(F)(1)]. CHAPTER 8 OF THE UDC. TH
SEMI-PERMANENT BODY OF WATER THE WATERLINE SHALL WATERTIGHT PIPE ENCASEMENT. VALVES MUST BE PROVIDE WITH FACILITIES TO ALLOW THE UNDERWATER PORTION OF	BE INSTALLED IN A SEPARATE ED ON EACH SIDE OF THE CROSSING 30. THE COMPANION LANDSCA
TESTED [§290.44(F)(2)]. 10. THE CONTRACTOR SHALL MAINTAIN A MINIMUM SEPARAT NINE FEET BETWEEN THE PROPOSED WATERLINE AND WAS	
INCLUDING MANHOLES. IF THIS DISTANCE CANNOT BE MAINT	AINED, THE CONTRACTOR MUST R DIRECTION. SEPARATION 32. A SEPARATE IRRIGATION PL
IMMEDIATELY NOTIFY THE PROJECT ENGINEER FOR FURTHE	
IMMEDIATELY NOTIFY THE PROJECT ENGINEER FOR FURTHE DISTANCES, INSTALLATION METHODS, AND MATERIALS UTILI 11. THE SEPARATION DISTANCE FROM A POTABLE WATER LATERAL MANHOLE OR CLEANOUT SHALL BE A MINIMUM OF	RLINE TO A WASTEWATER MAIN OR 33. FIRE FLOW REQUIREMENTS

ACHIEVED, THE POTABLE WATERLINE SHALL BE ENCASED IN A E CLASS PIPE AT LEAST 18 FEET LONG AND TWO NOMINAL EYANCE. THE SPACE AROUND THE CARRIER PIPE SHALL BE S WITH SPACERS OR BE FILLED TO THE SPRINGLINE WITH PE SHALL BE CENTERED ON THE CROSSING AND BOTH ENDS ANUFACTURED SEALANT [§290.44(E)(5)].

INSTALLED WITHIN NINE FEET VERTICALLY OR R LINE, WASTEWATER LATERAL, OR WASTEWATER SERVICE I [§290.44(E)(6)].

QUIPMENT SHALL NOT CROSS WASTEWATER MAINS, WATER SERVICE LINES. RAW WATER SUPPLY LINES SHALL OF ANY TILE OR CONCRETE WASTEWATER MAIN, VATER SERVICE LINE [§290.44(E)(7)].

TALLED CLOSER THAN TEN FEET TO SEPTIC TANK

IFECT THE NEW WATERLINES IN ACCORDANCE WITH AWWA , THEN FLUSH AND SAMPLE THE LINES BEFORE BEING ALL BE COLLECTED FOR MICROBIOLOGICAL ANALYSIS TO DISINFECTION PROCEDURE WHICH SHALL BE REPEATED IF JM OF ONE SAMPLE FOR EACH 1,000 FEET OF COMPLETED T THE NEXT AVAILABLE SAMPLING POINT BEYOND 1,000 FEET INEER [§290.44(F)(3)].

TING WATER SHALL BE IN STRICT ACCORDANCE WITH OR MOST RECENT.

THESE PLANS WERE PREPARED, SEALED, SIGNED AND DATED BY AL ENGINEER. THEREFORE BASED ON THE ENGINEER'S , THE CONSTRUCTION PLANS FOR CONSTRUCTION OF THE APPROVED SUBJECT TO THE STANDARD CONSTRUCTION ANUAL AND ALL OTHER APPLICABLE CITY, STATE AND FEDERAL

CITY STANDARD SPECIFICATIONS AND DETAILS IN EFFECT AT THE JECT TO THE CITY.

SHALL MEET ALL REQUIREMENTS OF THE APPROVED SITE PLAN.

ICE LINES SHALL BE SDR 26 PVC.

NSTALLED WITHOUT HORIZONTAL OR VERTICAL BENDS. ASTEWATER MANHOLES IS 500 FEET.

OW PRESSURE AIR TESTED AND MANDREL TESTED BY THE ITY OF GEORGETOWN AND TCEQ REQUIREMENTS.

BE VACUUM TESTED AND COATED BY THE CONTRACTOR TOWN AND TCEQ REQUIREMENTS.

CAMERA TESTED BY THE CONTRACTOR AND SUBMITTED TO THE PAVING THE STREETS.

INES SHALL BE TESTED BY THE CONTRACTOR TO 200 PSI FOR 2

INES SHALL BE DUCTILE IRON PIPING FROM THE WATER MAIN TO EM, AND 200 PSI C900 PVC FOR ALL OTHERS.

HALL BE 150 PSI C900 PVC AND TESTED BY THE CONTRACTOR AT

ECTION ON WATER MAINS SHALL BE RESTRAINED AND THRUST

L BE RESTRAINED.

CTERIA TESTED BY THE CONTRACTOR ACCORDING TO THE CITY

SINGS SHALL MEET ALL REQUIREMENTS OF THE TCEQ AND THE CITY.

UBLIC STREETS SHALL BE TXDOT TYPE A GRADE 1.

PAVEMENT SHALL BE TYPE D UNLESS OTHERWISE SPECIFIED AND S THICK ON PUBLIC STREETS AND ROADWAYS.

E INSTALLED WITH THE PUBLIC INFRASTRUCTURE.

RED TO BE SUBMITTED TO THE CITY PRIOR TO ACCEPTANCE OF THE OND SHALL BE ESTABLISHED FOR 2 YEARS IN THE AMOUNT OF 10% PROVEMENTS AND SHALL FOLLOW THE CITY FORMAT.

LIC IMPROVEMENTS SHALL BE SUBMITTED TO THE CITY BY THE CEPTANCE OF THE PROJECT. THESE DRAWINGS SHALL BE EMAILED

E PROPERTY OWNER, AND SUCCESSORS TO THE CURRENT THE SUBJECT PROPERTY AND ANY IMPROVEMENTS ARE ITH THIS SITE DEVELOPMENT PLAN.

PLY WITH ALL STANDARDS OF THE UNIFIED DEVELOPMENT CODE IN CONSTRUCTION STANDARDS AND SPECIFICATIONS MANUAL, THE OTHER APPLICABLE CITY STANDARDS.

HALL MEET THE UDC STORMWATER REQUIREMENTS. RATE APPLICATION AND APPROVAL FROM THE INSPECTION NAGE IS APPROVED WITH THE SITE DEVELOPMENT PLAN.

IN ACCORDANCE WITH THE UDC.

OVAL BY THE DEVELOPMENT ENGINEER OF THE CITY OF

PLY WITH SECTION 7.05 OF THE UDC.

JIPMENT, DUMPSTERS AND PARKING SHALL COMPLY WITH REENING IS SHOWN ON THE LANDSCAPE AND ARCHITECTURAL

AN HAS BEEN DESIGNED AND PLANT MATERIALS SHALL BE EMENTS OF THE UDC.

LANDSCAPE SHALL COMPLY WITH THE MAINTENANCE STANDARDS

HALL BE REQUIRED AT THE TIME OF BUILDING PERMIT APPLICATION.

500 GALLONS PER MINUTE ARE BEING MET BY THIS PLAN.

THIS SITE DEVELOPMENT PLAN IS SUBJECT, IN PERPETUITY, TO THE ND REMOVAL REQUIREMENTS OF THE UDC.

					ВΥ
					DATE
					REVISIONS
					No.
08/04/		© 2023 KIMLEY-HORN AND ASSOCIATES, INC.	501 S. AUSTIN AVENUE, SUITE 1310, GEORGETOWN, TX 78626	PHONE: 512-520-0768 FAX: 512-418-1791 WWW.KIMLEY-HORN.COM	TEXAS REGISTERED ENGINEERING FIRM F-928
08/04/	STATE JANDRO E	3008 CENS ^S VAL	Etas NADOS 4 ENGI	RICC	
KHA PROJECT 069291601	DATE APRIL 2023	SCALE: AS SHOWN	DESIGNED BY: DPD	DRAWN BY: DPD	снескер вт: АЕС
	CITY OF GEORGETOWN	AND TCEQ GENERAL	NOTEO		
	NOLINA	DHASE 20		WILLIAMSON COUNTY, IEXAS	
	SHEET	2 2	MB	ĒR	

<u>B4</u>	- CONSTRUCTION – GENERAL	Lime treated Subgrade (3)	
•	B4.1 A PRECONSTRUCTION MEETING SHALL BE SCHEDULED PRIOR TO THE START OF CONSTRUCTION. THE DESIGN ENGINEER, OWNER, CONTRACTOR, SUBCONTRACTORS, AND COUNTY ENGINEER SHALL ATTEND THIS MEETING. ALL ROADS ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE CONSTRUCTION DOCUMENTS AS APPROVED BY THE COUNTY ENGINEER AND IN ACCORDANCE WITH THE SPECIFICATIONS FOUND IN THE CURRENT VERSION OF THE "TEXAS DEPARTMENT OF TRANSPORTATION MANUAL STANDARD SPECIFICATIONS FOR CONSTRUCTION OF HIGHWAYS, STREETS, AND BRIDGES" UNLESS OTHERWISE STATED ON THE CONSTRUCTION DOCUMENTS APPROVED BY THE COUNTY	Notes:	 (1) See A (2) See A (3) Pellett: Confirm si (4) For PI reviewed
•	ENGINEER. B4.2 ALL MATERIALS SHALL BE SAMPLED AND TESTED BY AN INDEPENDENT TESTING LABORATORY IN ACCORDANCE WITH THE CONSTRUCTION DOCUMENTS APPROVED BY THE COUNTY ENGINEER. THE OWNER SHALL PAY FOR ALL TESTING SERVICES AND SHALL	Collector R	loadway (
	FURNISH THE COUNTY ENGINEER WITH CERTIFIED COPIES OF THESE TEST RESULTS. THE COUNTY ENGINEER MUST APPROVE THE TEST RESULTS PRIOR TO CONSTRUCTING THE NEXT COURSE OF THE ROADWAY STRUCTURE. ANY MATERIAL WHICH DOES NOT MEET THE	Plasticity Index	PI <20
	NEAT COURSE OF THE ROADWAT STRUCTURE. ANT WATERIAL WHICH DUES NOT MEET THE		Olaurau

Plasticity Index	PI <20	PI 20-35	PI 35-55 (4)	Material Requirements	
Soil Classification	Clayey Sand	Lean Clay	Fat Clay		
				TxDOT Item 421 – Class P Concrete	
CRCP (1)	6"	6"	8"	CRCP – 13, Continuously Reinforced Concrete Pavement, One-layer steel bar placement	
HMA Bond Breaker	1"	1"	1"	TxDOT Item D- GR HMA TY D or TY F PG 64-22	
Flexible Base (2)	8"	10"	10"	TxDOT Item 247 FLBS TY A GR 4 (2)	
Lime treated Subgrade (3)	8" TxDOT Item 260 ⁽³⁾			TxDOT Item 260 (3)	
	(1) See Appendix B7 for material requirements for CRCP				
	(2) See Appendix B6 for additional Cement Treated Base specifications				
Notes:	(3) Pelletized lime is not allowed. Use hydrated lime or lime slurry. Confirm sulfates are not present in soil.				
	(4) For PI >55 additional pavement structure is necessary and shall be reviewed and approved by the County Engineer				

Arterial Roadway (Urban/ Rural) Rigid Pavement design						
Plasticity Index	PI <20	PI 20-35	PI 35- 55 (4)	Material Requirements		
Soil Classification	Clayey Sand	Lean Clay	Fat Clay	material requiremente		
				TxDOT Item 421 – Class P Concrete		
CRCP (1)	11"	11"	11"	CRCP – 13, Continuously Reinforced Concrete Pavement, One-layer steel bar placement		
HMA Bond Breaker	1"	1"	1"	TxDOT Item D- GR HMA TY D or TY F PG 64-22		
Flexible Base (2)	12"	12"	12"	TxDOT Item 247 FLBS TY A GR 4		
Lime treated Subgrade (3)		6"	10"	TxDOT Item 260		
Notes:	 (1) See Appendix B7 for material requirements for CRCP (2) See Appendix B6 for additional Cement Treated Base specifications (3) Pelletized lime is not allowed. Use hydrated lime or lime slurry. Confirm sulfates are not present in soil. 					

B5 - SUBGRADE

- SUBGRADE SHALL BE PREPARED AND COMPACTED TO ACHIEVE A DRY DENSITY PER TXDOT
- HYDRATED LIME OR LIME SLURRY IS APPROVED; HOWEVER, THE USE OF PELLETIZED LIME IS NOT APPROVED.
- STABILIZATION. PROVIDE SULFATE TEST TO COUNTY ENGINEER PRIOR TO STABILIZATION.
- B5.4 ANY VARIATION TO THE COUNTY'S STABILIZATION REQUIREMENTS MUST BE APPROVED BY THE COUNTY ENGINEER.
- ENGINEER.
- THE COUNTY ENGINEER.

B6 - BASE MATERIAL

• B6.1 BASE MATERIAL SHALL CONFORM TO ITEM 247 OF THE CURRENT EDITION OF THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION, "FLEXIBLE BASE". THE BASE MATERIAL SHALL BE TYPE A GRADE 4, OR AS APPROVED BY THE COUNTY ENGINEER. GRADE 4 MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF TABLE B6.1 BELOW:

Table B6.1: Gradation Specification for TY A, Grade 4

Master gradation sieve size	Cumulative % Retained
2 1⁄2"	-
1 ¾"	0
7/8"	10% - 35%
3/8"	30% - 65%
#4	45% - 75%
#40	70% - 90%
#200	87% - 95%

B4.5 Flexible Pavement Designs based on Roadway Classification

SUBGRADE FOR PLASTICITY INDEX.

COUNTY ENGINEER.

lexible Pavement Designs based on Roadway Classification						
Minimum Local Roadway (Urban/Rural) Flexible Pavement design						
Plasticity Index	PI <20	PI 20-35	PI 35-55 ⁽⁴⁾			
Soil Classification	Clayey Sand	Lean Clay	Fat Clay	Material Requirements		
HMA Surface (1)	2"	2"	2"	TxDOT Item 340 D- GR HMA PG 70-22 SAC B		
Prime Coat or One Course Underseal	YES	YES	YES	AEP or TxDOT Item 316		
Flexible Base (2)(5)	12"	12"	14"	TxDOT Item 247 FLBS TY A GR 5		
Lime treated Subgrade (3)	NO	8"	8"	TxDOT Item 260		
Notes:	 (1) For Urban See Appendix B7 – B10 for HMA material requirements. Rural is also allowed B7.11 (2) See Appendix B6 for additional Flexible Base specifications. (3) Pelletized lime is not allowed. Use hydrated lime or lime slurry. Confirm sulfates are not present in soil. (4) For PI >55 additional pavement structure is necessary and shall be reviewed and approved by the County Engineer. 					
	(5) Should solid rock be encountered prior to the depth necessary for 12" of base material underneath 2" HMA, a substitute pavement design may be allowed. Substitute pavement design shall have a base thickness no less than 8" and existing material shall be excavated to the exposed solid rock layer. No significant amount of existing material shall be left remaining between the base layer and the rock layer.					

MINIMUM REQUIRED TEST SPECIFICATIONS SHALL BE REMOVED AND RECOMPACTED OR

REPLACED UNLESS ALTERNATIVE REMEDIAL ACTION IS APPROVED IN WRITING FROM THE

B4.3 EXCEPT FOR ELECTRICAL LINES, ALL UNDERGROUND NONFERROUS UTILITIES WITHIN

IN TRACING THE LOCATION OF SAID UTILITIES THROUGH THE USE OF A METAL DETECTOR.

REGISTERED PROFESSIONAL ENGINEER. PAVEMENT DESIGNS SHALL FOLLOW THE BELOW

THE PROPOSED ROADWAYS. TEST BORINGS SHALL BE PLACED AT A MAXIMUM SPACING OF

500 FEET OR OTHER SAMPLING FREQUENCY APPROVED BY THE COUNTY ENGINEER BASED

ON RECOMMENDATIONS PROVIDED BY THE GEOTECHNICAL ENGINEER. BORINGS SHALL BE

NON-FRACTURED ROCK OR 3 FT BELOW FRACTURED ROCK. THE PAVEMENT DESIGN MUST

MEET AT LEAST THE MINIMUM OF ONE OF THE APPROVED COUNTY DESIGNS AND PROVIDED IN THE GEOTECHNICAL REPORT FOR REVIEW AND APPROVAL PRIOR TO THE REVIEW AND APPROVAL OF THE CONSTRUCTION PLANS. IN ADDITION TO THE BASIS OF THE PAVEMENT DESIGN, THE SOILS REPORT SHALL CONTAIN THE RESULTS OF SAMPLED AND TESTED

COUNTY REQUIREMENTS BASED UPON SOIL CONDITIONS FROM SAMPLES TAKEN ALONG

B4.4 ALL PROPOSED PAVEMENTS (FLEXIBLE AND RIGID) ARE TO BE SPECIFIED IN THE

GEOTECH REPORT. THE GEOTECH REPORT IS TO BE SIGNED AND SEALED BY A

TO A DEPTH OF TEN FT OR, IF SOLID ROCK IS ENCOUNTERED, ONE FT BELOW

A RIGHT-OF-WAY OR EASEMENT MUST BE ACCOMPANIED BY FERROUS METAL LINES TO AID

Minimum Collector Roadway (Urban/Rural) Flexible Pavement design						
Plasticity Index	PI <20	PI 20-35	PI 35-55 (4)			
Soil Classification	Clayey Sand	Lean Clay	Fat Clay	Material Requirements		
HMA Surface (1)	2"	2"	2"	TxDOT Item 340 D- GR HMA		
	2	2	2	PG 70-22 SAC B		
Prime Coat or One Course Underseal	YES	YES	YES	AEP or TxDOT Item 316		
Flexible Base (2)(5)	14"	14"	16"	TxDOT Item 247 FLBS TY A GR 5		
Lime treated Subgrade (3)	NO	8"	8"	TxDOT Item 260		
Notes:	(1). (1) For Urban See Appendix B7 – B10 for HMA material requirements. Rural is also allowed B7.11					

(2) See Appendix B6 for additional Flexible Base specifications. (3) Pelletized lime is not allowed. Use hydrated lime or lime slurry. Confirm sulfates are not present in soil. (4) For PI >55 additional pavement structure is necessary and shall be reviewed and approved by the County Engineer. (5) Should solid rock be encountered prior to the depth necessary for 14" of base material underneath 2" HMA, a substitute pavement design may be allowed. Substitute pavement design shall have a base thickness no less than 10" and existing material shall be excavated to the exposed solid rock layer. No significant amount of existing material shall be left remaining between the base layer and the rock layer.

Minimum Arterial Roadway (Urban/Rural) Flexible Pavement design						
Plasticity Index	PI <20	PI 20-35	PI 35-55 ⁽⁴⁾			
Soil Classification	Clayey Sand	Lean Clay	Fat Clay	Material Requirements		
HMA Surface (1)	2"	2"	2"	TxDOT Item 340 D- GR HMA		
	2	-	2	PG 70-22 SAC B		
Prime Coat or One Course Underseal	YES	YES	YES	AEP or TxDOT Item 316		
Flexible Base (2)	20"	20"	22"	TxDOT Item 247 FLBS TY A GR 5		
Lime treated Subgrade (3)	NO	8"	10"	TxDOT Item 260		
	(1) See Appendix B7 for material requirements for HMA.					
	(2) See /	Appendix B6 f	or additional Fl	exible Base specifications.		
Notes: (3) Pelletized lime is not allowed. Use hydrated lime or lime s Confirm sulfates are not present in soil.						
	(4) For PI >55 additional pavement structure is necessary and sh reviewed and approved by the County Engineer.					

B4.6 Rigid Pavement Designs based on Roadway Classification

Local Roadway (Urban/ Rural) Rigid Pavement design						
Plasticity Index	PI <20	PI 20-35	PI 35-55 (4)	Material Requirements		
Soil Classification	Clayey Sand	Lean Clay	Fat Clay			
CRCP (1)	6"	6"	8"	TxDOT Item 421 – Class P Concrete CRCP – 13, Continuously Reinforced Concrete Pavement, One-layer steel bar placement		
HMA Bond Breaker	1"	1"	1"	TxDOT Item D- GR HMA TY D or TY F PG 64-22		
Flexible Base (2)	6"	8"	8"	TxDOT Item 247 FLBS TY A GR 4		

TxDOT Item 260 ppendix B7 for material requirements for CRCP

ppendix B6 for additional Cement Treated Base specifications

ized lime is not allowed. Use hydrated lime or lime slurry. sulfates are not present in soil.

>55 additional pavement structure is necessary and shall be and approved by the County Engineer

Urban/ Rural) Rigid Pavement design

(4) For PI >55 additional pavement structure is necessary and shall be reviewed and approved by the County Engineer

 B5.1 THE PREPARATION OF THE SUBGRADE SHALL FOLLOW GOOD ENGINEERING PRACTICES AS DIRECTED BY THE COUNTY ENGINEER IN CONJUNCTION WITH RECOMMENDATIONS OUTLINED IN THE GEOTECHNICAL REPORT. WHEN THE PLASTICITY INDEX (PI) IS GREATER THAN 20, A SUFFICIENT AMOUNT OF LIME SHALL BE ADDED AS DESCRIBED IN ITEM 260 OF THE CURRENT EDITION OF THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION UNTIL THE PI IS LESS THAN 20. IF THE ADDITION OF LIME AS DESCRIBED IN ITEM 260 IS NOT FEASIBLE, AN ALTERNATE STABILIZING DESIGN SHALL BE PROPOSED AND SUBMITTED TO THE COUNTY ENGINEER FOR APPROVAL. THE

ITEM 132. IN ADDITION, PROOF ROLLING MAY BE REQUIRED BY THE COUNTY ENGINEER. B5.2 IF LIME IS NECESSARY, THEN A SUFFICIENT AMOUNT OF LIME SHALL BE ADDED, AS DESCRIBED IN ITEM 260 OF THE CURRENT EDITION OF THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION TO PROPERLY STABILIZE SUBGRADE. THE USE OF

 B5.3 PRIOR TO LIME STABILIZATION, A SULFATE TEST OF IN SITU SOILS SHALL BE PERFORMED BY DEVELOPER TO CONFIRM THE APPROPRIATE MEANS AND METHODS OF

 B5.5 THE SUBGRADE SHALL BE PREPARED AND COMPACTED TO ACHIEVE A DRY DENSITY PER TXDOT ITEM 132. IN ADDITION, PROOF ROLLING MAY BE REQUIRED BY THE COUNTY

 B5.6 THE SUBGRADE SHALL BE INSPECTED AND APPROVED BY AN INDEPENDENT TESTING LABORATORY AND A CERTIFIED COPY OF ALL INSPECTION REPORTS FURNISHED TO THE COUNTY ENGINEER. THE COUNTY ENGINEER MUST APPROVE THE REPORT PRIOR TO APPLICATION OF THE BASE MATERIAL. ALL DENSITY TEST REPORTS SHALL INCLUDE A COPY OF THE WORK SHEET SHOWING THE PERCENTAGE OF THE MAXIMUM DRY (PROCTOR) DENSITY. THE NUMBER AND LOCATION OF ALL SUBGRADE TESTS SHALL BE DETERMINED BY

- B6.2 EACH LAYER OF BASE COURSE SHALL BE TESTED FOR IN-PLACE DRY DENSITY AND MEASURED FOR COMPACTED THICKNESS. THE NUMBER AND LOCATION OF ALL BASE TEST SAMPLES SHALL BE DETERMINED BY THE COUNTY ENGINEER.
- B6.3 THE BASE SHALL BE PREPARED AND COMPACTED TO ACHIEVE A MINIMUM OF 100% OF THE MAXIMUM (PROCTOR) DRY DENSITY OR AS APPROVED BY THE COUNTY ENGINEER UPON RECOMMENDATION BY THE TESTING LABORATORY. THE MAXIMUM LIFT SHALL NOT EXCEED SIX INCHES. THE BASE MUST BE INSPECTED AND APPROVED BY AN INDEPENDENT TESTING LABORATORY AND A CERTIFIED COPY OF THE TEST RESULTS FURNISHED TO THE COUNTY ENGINEER FOR APPROVAL. PRIOR TO THE PLACEMENT OF THE FIRST LIFT OF BASE, THE STOCKPILE SHALL BE TESTED FOR THE SPECIFICATIONS FOUND IN ITEM 247 TABLE 1 AND THE RESULT FURNISHED TO THE COUNTY ENGINEER FOR APPROVAL.

B7 - BITUMINOUS PAVEMENT

- B7.1 URBAN ROADS REQUIRE A MINIMUM 2 INCH WEARING SURFACE OF HMAC TYPE D. THE MIX SHALL BE FROM A TXDOT CERTIFIED PLANT AND THE MIX DESIGN SHALL BE SUBMITTED TO THE COUNTY ENGINEER FOR APPROVAL PRIOR TO PLACEMENT OF THE MATERIAL.
- B7.2 IF PROVIDING MIXTURE TYPE C OR D, USE PERFORMANCE GRADE (PG) BINDER 70-22. PROVIDE PG BINDER THAT DOES NOT CONTAIN RECYCLED ENGINE OIL BOTTOMS (REOBS) OR POLY PHOSPHORIC ACID (PPA). RECYCLED ASPHALT PAVEMENT (RAP) IS NOT PERMITTED FOR USE AS A COMPONENT OF THE HMACP. THE CONTRACTOR IS ALSO NOT PERMITTED THE USE RECYCLED ASPHALT SHINGLES (RAS) AS A COMPONENT OF THE HMACP
- B7.3 IF PROVIDING MIXTURE TYPE B, USE PG BINDER 64-22. PROVIDE PG BINDERS THAT DO NOT CONTAIN REOBS OR PPA. FOR SUBSURFACE COURSE TYPE B, THE USE OF TWENTY PERCENT (20%) RAP IS PERMITTED IN THE MIX DESIGN. THE CONTRACTOR IS NOT PERMITTED TO USE RAS AS A COMPONENT OF THE HMACP.
- B7.4 TARGET LABORATORY MOLDED DENSITY IS 96.5% FOR ALL MIXTURES WITHOUT RAP AND WHEN USING A TEXAS GYRATORY COMPACTOR (TGC) FOR DESIGNING THE MIXTURE. WHEN USING SUPERPAVE GYRATORY COMPACTOR (SGC) TO DESIGN MIXTURES, SUBMIT THE SGC MIX DESIGN TO THE ENGINEER FOR APPROVAL.
- B7.5 ALL MIXTURES MUST MEET THE HAMBURG REQUIREMENT AS STATED IN THE TABLE BELOW.

High-Temperature	-	Hamburg Wheel Test Requirements*		
Binder Grade	Test Method	Minimum # of Passes @ 0.5" Rut Depth, Tested @122°F		
PG 64 or lower	Tex-242-F	7,000		
PG 70	Tex-242-F	15,000		
PG 76 or higher	Tex-242-F	20,000		

The County Engineer may accept Hamburg Wheel test results for production and placement if no more than 1of the 5 most recent tests is below the specified number of passes and the failing test is no more than 2,000 passes below the specified number of passes.

- B7.6 SUBMIT ANY PROPOSED ADJUSTMENTS OR CHANGES TO A JOB MIX FORMULA TO THE COUNTY ENGINEER BEFORE PRODUCTION OF THE NEW JOB MIX FORMULA.
- B7.7 UNLESS OTHERWISE APPROVED, PROVIDE TYPE B MIXTURES THAT HAVE NO LESS
- THAN 4.5% ASPHALT BINDER, AND TY C AND D MIXTURES WITH NO LESS THAN 4.7% BINDER. B7.8 FOR MIXTURE DESIGN VERIFICATION, PROVIDE THE ENGINEER WITH TWO 5-GALLON BUCKETS OF EACH AGGREGATE STOCKPILE TO BE USED ON THE PROJECT AND THREE GALLONS OF EACH PG BINDER TO BE USED ON THE PROJECT. ALSO PROVIDE SUFFICIENT QUANTITIES OF ANY OTHER ADDITIVES THAT WILL BE USED IN THE HMA MIXTURE. THIS MUST BE DONE PRIOR TO APPROVAL OF THE MIX DESIGN, UNLESS ALREADY PERFORMED WITHIN A ONE-YEAR TIME PERIOD.
- B7.9 PRIOR TO ALLOWING PRODUCTION OF THE TRIAL BATCH, THE ENGINEER WILL USE THE MATERIALS PROVIDED BY THE CONTRACTOR TO PERFORM THE FOLLOWING TESTS TO VERIFY THE HMA MIXTURE DESIGN.
 - 1. INDIRECT TENSILE TEST IN ACCORDANCE WITH TEX-226-F 2. HAMBURG WHEEL TEST IN ACCORDANCE WITH TEX-242-F
 - 3. OVERLAY TEST IN ACCORDANCE WITH TEX-248-F
 - 4. CANTABRO TEST IN ACCORDANCE WITH TEX-245-F

FOR MIXTURES DESIGNED WITH A TEXAS GYRATORY COMPACTOR (TGC). THE ENGINEER MAY REQUIRE THAT THE TARGET LABORATORY MOLDED DENSITY BE RAISED TO NO MORE THAN 97.5% OR MAY LOWER THE DESIGN NUMBER OF GYRATIONS TO NO LESS THAN 35 FOR MIXTURES DESIGNED WITH AN SGC IF ANY OF THE FOLLOWING CONDITIONS EXIST. 1. THE INDIRECT TENSILE TEST RESULTS IN A VALUE GREATER THAN 200 PSI

- 2. THE HAMBURG WHEEL TEST RESULTS IN A VALUE LESS THAN 3.0 MM
- 3. THE OVERLAY TEST RESULTS IN A VALUE LESS THAN 100 CYCLES 4. THE CANTABRO TEST RESULTS IN A VALUE OF MORE THAN 20% LOSS

IN LIEU OF, OR IN ADDITION TO EVALUATING THE MIXTURE DESIGN PRIOR TO ALLOWING A TRIAL BATCH TO BE PRODUCED, THE ENGINEER MAY ALSO EVALUATE THE MIXTURE


- PRODUCED DURING THE TRIAL BATCH FOR COMPLIANCE WITH THE 4 TESTS LISTED ABOVE. B7.10 CONTRACTOR'S QUALITY CONTROL (CQC) TEST REPORTS SHALL BE SUBMITTED TO THE COUNTY ENGINEER ON A DAILY BASIS. AS A MINIMUM, DAILY CQC TESTING ON THE PRODUCED MIX SHALL INCLUDE: SIEVE ANALYSIS TEX-200-F, ASPHALT CONTENT TEX-236-F, HVEEM STABILITY TEX-208-F, LABORATORY COMPACTED DENSITY TEX-207-F, AND MAXIMUM SPECIFIC GRAVITY TEX-227-F. THE NUMBER AND LOCATION OF ALL HMAC TESTS SHALL BE DETERMINED BY THE COUNTY ENGINEER WITH A MINIMUM OF THREE, 6-INCH DIAMETER FIELD CORES SECURED AND TESTED BY THE CONTRACTOR FROM EACH DAY'S PAVING. EACH HMAC COURSE SHALL BE TESTED FOR IN-PLACE DENSITY, BITUMINOUS CONTENT AND AGGREGATE GRADATION, AND SHALL BE MEASURED FOR COMPACTED THICKNESS. THE NUMBER AND LOCATION OF ALL HMAC TEST SAMPLES SHALL BE DETERMINED BY THE COUNTY ENGINEER.
- B7.11 RURAL ROADS MAY USE EITHER THE SPECIFICATIONS FOUND IN SECTION B7.1 OR A TWO-COURSE SURFACE IN ACCORDANCE WITH ITEM 316, TREATMENT WEARING SURFACE, OF THE CURRENT EDITION OF THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION. THE TYPE AND RATE OF ASPHALT AND AGGREGATE SHALL BE INDICATED ON THE PLANS AS A BASIS OF ESTIMATE AND SHALL BE DETERMINED AT THE PRECONSTRUCTION CONFERENCE. AGGREGATE USED IN THE MIX SHALL BE ON THE TXDOT QUALITY MONITORING SCHEDULE. AGGREGATE SHALL BE TYPE B GRADE 4. GRADATION TESTS SHALL BE REQUIRED FOR EACH 300 CUBIC YARDS OF MATERIAL PLACED WITH A MINIMUM OF TWO TESTS PER EACH GRADE PER EACH PROJECT. TEST RESULTS SHALL BE REVIEWED BY THE COUNTY ENGINEER PRIOR TO APPLICATION OF THE MATERIAL.

B8 - CONCRETE PAVEMENT

 B8.1 IN LIEU OF BITUMINOUS PAVEMENT, PORTLAND CEMENT CONCRETE PAVEMENT MAY BE USED. IN SUCH CASES, THE PAVEMENT THICKNESS SHALL BE A MINIMUM OF 9 INCHES OF CONCRETE, AND SHALL BE JOINTED AND REINFORCED IN ACCORDANCE WITH THE DETAIL INCLUDED IN APPENDIX I. THE MIX SHALL BE FROM A TXDOT CERTIFIED PLANT. THE MIX DESIGN SHALL BE SUBMITTED TO THE COUNTY ENGINEER FOR APPROVAL PRIOR TO PLACEMENT OF THE MATERIAL.

B9 - CONCRETE - GENERAL

- B9.1 UNLESS OTHERWISE SPECIFIED, CONCRETE SHALL BE IN ACCORDANCE WITH ITEM 421 OF THE CURRENT EDITION OF THE TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION AND BE PLACED IN ACCORDANCE WITH THE APPLICABLE ITEM.
- B9.2 ALL CONCRETE SHALL BE TESTED FOR COMPRESSIVE STRENGTH. ONE SET OF THREE CONCRETE TEST CYLINDERS SHALL BE MOLDED FOR EVERY 50 CUBIC YARDS OF CONCRETE PLACED FOR EACH CLASS OF CONCRETE PER DAY, OR AT ANY OTHER INTERVAL AS DETERMINED BY THE COUNTY ENGINEER. A SLUMP TEST SHALL BE REQUIRED WITH EACH SET OF TEST CYLINDERS. ONE CYLINDER SHALL BE TESTED FOR COMPRESSIVE STRENGTH AT AN AGE OF SEVEN DAYS AND THE REMAINING TWO CYLINDERS SHALL BE TESTED AT 28 DAYS OF AGE.



STREET DESIGN TABLE						
STREET NAME	CLASSIFICATION	DESIGN SPEED	LENGTH	ROW WIDTH	PAVEMENT WIDTH	
WILD NOLINA WAY	ARTERIAL	45 MPH	1200'	120' (MIN)	*37 LF (LOG-LOG)	
BEEBALM COVE	MINOR COLLECTOR	35 MPH	255'	60'	37 LF (LOG-LOG)	
DEEDALIVICOVE	MINOR COLLECTOR	35 MPH	265'	69'	46 LF (LOG-LOG)	
SNAKEROOT TRAIL	LOCAL	25 MPH	1657'	50'	30 LF (LOG-LOG)	
TNADING CYPRESS TRAIL	LOCAL	25 MPH	1137'	50'	30 LF (LOG-LOG)	
PRICKLY POPPY WAY	LOCAL	25 MPH	776'	50'	30 LF (LOG-LOG)	
LADY FERN DRIVE	LOCAL	25 MPH	616'	50'	30 LF (LOG-LOG)	
WINTERBERRY WAY	LOCAL	25 MPH	620'	50'	30 LF (LOG-LOG)	
BLUESTEM BRUSH LANE	MINOR COLLECTOR	35 MPH	275'	69'	46 LF (LOG-LOG)	
TE: MINIMUM ROW WIDTH FOR MINOR COLLECTOR IS 60'.						
AVEMENT WIDTH BASED ON ESTIMATED AVERAGE DAILY TRIPS AND WILLIAMSON COUNTY SUBDIVISION REGULATIONS						
OF DECEMBER 7TH, 2021.						

Benton Tract Phase 1 Section 3 & Phase 2 Engineer's Job No. 22101100.152


RECOMMENDATIONS - PAVEMENT THICKNESS SECTIONS

Street Classification	Subgrade Material	Hot Mix Asphaltic Concrete, in	Crushed Limestone Base, in	Lime Stabilized Subgrade, in
	Limestone	2.0	8	-
Local	Subgrade PI < 20	2.0	12	-
Streets	Subgrade PI 20 - 35	2.0	12	8
	Subgrade PI > 35	2.0	14	8
	Limestone	2.0	14	-
Callestars	Subgrade PI < 20	2.0	14	_
Collectors	Subgrade PI 20 - 35	2.0	14	8
	Subgrade PI > 35	2.0	17	8
	Limestone	3.5	20	-
A	Subgrade PI < 20	3.5	20	-
Arterial	Subgrade PI 20 - 35	3.5	20	8
	Subgrade PI > 35	3.5	24	10

Notes:

- 1. The surface clay must first be tested for sulfate reaction and a mix design should be completed to determine the proper lime content, lime type, mixing procedure and curing conditions required. Delineation between these different pavement thickness sections should be completed in the field by observation of open utilities trenches and the pavement subgrade by the Geotechnical **Engineer.** Given the known variability of surface soils at this site, the geotechnical engineer must verify the subgrade before installation of the pavement system can proceed. Multiple site visits may be required depending upon the construction schedule. Finalized distinction between pavement thickness section options shall be provided as addendums to this report as these observations are completed. Please contact the geotechnical engineer when the utility trenches are open.
- 3. The concern has arisen that ground water may enter the utility trenches at this site causing detrimental settlement of the utility trench backfill. To address this concern, the wastewater utility trenches could be turned in to French drains. To achieve this, additional open-graded gravel, such as the gravel already being used for pipe bedding at this site, should be placed above the pipe bedding material to the elevation where ground water is encountered. This extra layer of gravel should be covered with a geotextile fabric to prevent material above the gravel from infiltrating the gravel layer. Then, the utility trench should be filled in compacted layers in accordance with the construction plans. The wastewater utility trench must then be allowed to daylight from its lowest point such that water does not accumulate in the utility trench. Additional gravel may be required in the utility trench depending upon the depth that ground water is entering the utility trench during construction. A line item for French drains should be included in construction bid documents.
- 4. The subgrade improvement should be extended 3 feet beyond the back of the curb line.
- 5. These pavement thickness designs are intended to transfer the load from the anticipated traffic conditions. 6. The responsibility of assigning street classification to the streets in this project is left to the civil
- engineer 7. If pavement designs other than those listed above are desired, please contact MLA Geotechnical.

MLA Geotechnical	Dallas/Fort Worth	Austin	San Antonio	Houston	Bryan/College Station	Killeen	"put us to the test"

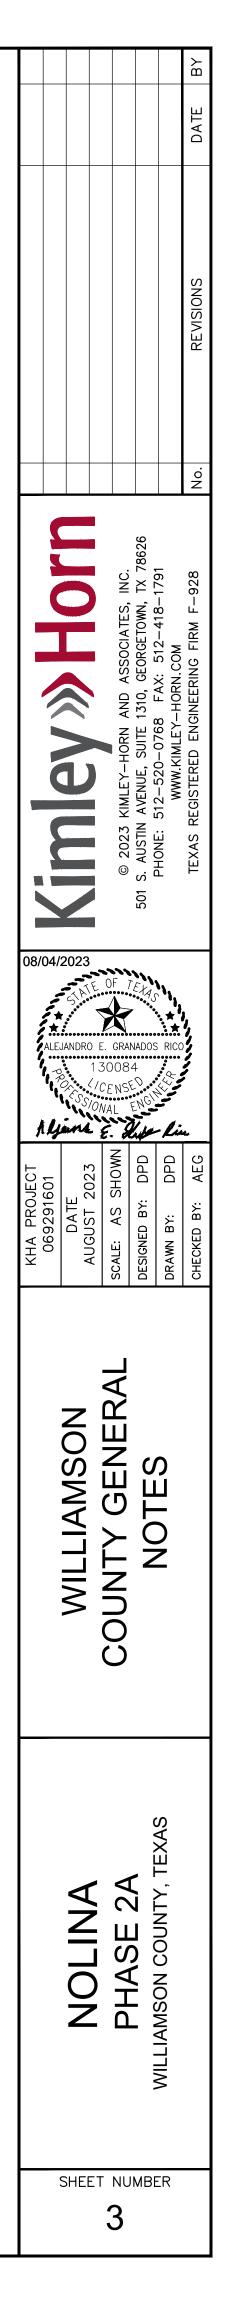



IN THE FIELD THAT AFFECT THE GRADING PLAN TO THE CIVIL ENGINEER. PROPOSED SITE GRADING, AND NOTIFY THE CIVIL ENGINEER AND LANDSCAPE ARCHITECT OF ANY CONFLICTS WITH THE TREE

EFFECTIVELY CONTROL EROSION AND PREVENT SEDIMENTATION FROM WASHING OFF THE SITE, THEN THE CONTRACTOR SHALL

11 OFF-SITE SOIL BORROW SPOIL AND STORAGE AREAS (IF APPLICABLE) ARE CONSIDERED AS PART OF THE PROJECT SITE AND MUST ALSO COMPLY WITH THE EROSION CONTROL REQUIREMENTS FOR THIS PROJECT. THIS INCLUDES THE INSTALLATION OF BMP'S TO CONTROL EROSION AND SEDIMENTATION AND THE ESTABLISHMENT OF PERMANENT GROUND COVER ON DISTURBED AREAS PRIOR TO FINAL APPROVAL OF THE PROJECT. CONTRACTOR IS RESPONSIBLE FOR MODIFYING THE SWPPP AND EROSION CONTROL PLAN TO INCLUDE BMPS FOR ANY OFF-SITE THAT ARE NOT ANTICIPATED OR SHOWN ON THE EROSION CONTROL PLAN. 12. ALL STAGING, STOCKPILES, SPOIL, AND STORAGE SHALL BE LOCATED SUCH THAT THEY WILL NOT ADVERSELY AFFECT STORM WATER QUALITY. PROTECTIVE MEASURES SHALL BE PROVIDED IF NEEDED TO ACCOMPLISH THIS REQUIREMENT, SUCH AS COVERING OR

13. CONTRACTORS SHALL INSPECT ALL EROSION CONTROL DEVICES, BMPS, DISTURBED AREAS, AND VEHICLE ENTRY AND EXIT AREAS WEEKLY AND WITHIN 24 HOURS OF ALL RAINFALL EVENTS OF 0.5 INCHES OR GREATER, AND KEEP A RECORD OF THIS INSPECTION IN THE SWPPP BOOKI ET IF APPLICABLE. TO VERIEV THAT THE DEVICES AND EROSION CONTROL PLAN ARE FUNCTIONING PROPERLY 14. CONTRACTOR SHALL CONSTRUCT A STABILIZED CONSTRUCTION ENTRANCE AT ALL PRIMARY POINTS OF ACCESS IN ACCORDANCE WITH CITY SPECIFICATIONS. CONTRACTOR SHALL ENSURE THAT ALL CONSTRUCTION TRAFFIC USES THE STABILIZED ENTRANCE AT

15. SITE ENTRY AND EXITS SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT THE TRACKING AND FLOWING OF SEDIMENT AND 16. THE CONTRACTOR IS RESPONSIBLE FOR REMOVING ALL SILT AND DEBRIS FROM THE AFFECTED OFF-SITE ROADWAYS THAT ARE A

17. WHEN WASHING OF VEHICLES IS REQUIRED TO REMOVE SEDIMENT PRIOR TO EXITING THE SITE, IT SHALL BE DONE IN AN AREA

STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP BMP 18. CONTRACTOR SHALL INSTALL A TEMPORARY SEDIMENT BASIN FOR ANY ON-SITE DRAINAGE AREAS THAT ARE GREATER THAN 10 ACRES, PER TCEQ AND CITY STANDARDS. IF NO ENGINEERING DESIGN HAS BEEN PROVIDED FOR A SEDIMENTATION BASIN ON THESE PLANS, THEN THE CONTRACTOR SHALL ARRANGE FOR AN APPROPRIATE DESIGN TO BE PROVIDED. 19 ALL FINES IMPOSED FOR SEDIMENT OR DIRT DISCHARGED FROM THE SITE SHALL BE PAID BY THE RESPONSIBLE CONTRACTOR 20. WHEN SEDIMENT OR DIRT HAS CLOGGED THE CONSTRUCTION ENTRANCE VOID SPACES BETWEEN STONES OR DIRT IS BEING TRACKED ONTO A ROADWAY, THE AGGREGATE PAD MUST BE WASHED DOWN OR REPLACED. RUNOFF FROM THE WASH-DOWN OPERATION SHALL

NOT BE ALLOWED TO DRAIN DIRECTLY OFF SITE WITHOUT FIRST FLOWING THROUGH ANOTHER BMP TO CONTROL SEDIMENTATION. PERIODIC RE-GRADING OR NEW STONE MAY BE REQUIRED TO MAINTAIN THE EFFECTIVENESS OF THE CONSTRUCTION ENTRANCE. 21. TEMPORARY SEEDING OR OTHER APPROVED STABILIZATION SHALL BE INITIATED WITHIN 14 DAYS OF THE LAST DISTURBANCE OF ANY AREA, UNLESS ADDITIONAL CONSTRUCTION IN THE AREA IS EXPECTED WITHIN 21 DAYS OF THE LAST DISTURBANCE. 22.CONTRACTOR SHALL FOLLOW GOOD HOUSEKEEPING PRACTICES DURING CONSTRUCTION, ALWAYS CLEANING UP DIRT, LOOSE

23. UPON COMPLETION OF FINE GRADING, ALL SURFACES OF DISTURBED AREAS SHALL BE PERMANENTLY STABILIZED. STABILIZATION IS ACHIEVED WHEN THE AREA IS EITHER COVERED BY PERMANENT IMPERVIOUS STRUCTURES, SUCH AS BUILDINGS, SIDEWALK, PAVEMENT, OR A UNIFORM PERENNIAL VEGETATIVE COVER. 24.AT THE CONCLUSION OF THE PROJECT, ALL INLETS, DRAIN PIPE, CHANNELS, DRAINAGEWAYS AND BORROW DITCHES AFFECTED BY THE CONSTRUCTION SHALL BE DREDGED, AND THE SEDIMENT GENERATED BY THE PROJECT SHALL BE REMOVED AND DISPOSED IN

CONTRACTOR SHALL COMPLY WITH ALL TCEQ AND EPA STORM WATER POLLUTION PREVENTION REQUIREMENTS. 2. CONTRACTOR SHALL COMPLY WITH THE REQUIREMENTS OF THE TCEQ GENERAL PERMIT TO DISCHARGE UNDER THE TEXAS

3 THE CONTRACTOR SHALL ENSURE THAT ALL PRIMARY OPERATORS SUBMIT A NOLTO TO TO AT LEAST SEVEN DAYS PRIOR TO COMMENCING CONSTRUCTION (IF APPLICABLE), OR IF UTILIZING ELECTRONIC SUBMITTAL, PRIOR TO COMMENCING CONSTRUCTION. ALL PRIMARY OPERATORS SHALL PROVIDE A COPY OF THE SIGNED NOI TO THE OPERATOR OF ANY MS4 (TYPICALLY THE CITY) 4. CONTRACTOR SHALL BE RESPONSIBLE FOR THE IMPLEMENTATION OF THE STORM WATER POLLUTION PREVENTION PLAN (SWPPP) IF

APPLICABLE, INCLUDING POSTING SITE NOTICE, INSPECTIONS, DOCUMENTATION, AND SUBMISSION OF ANY INFORMATION REQUIRED ALL CONTRACTORS AND SUBCONTRACTORS PROVIDING SERVICES RELATED TO THE SWPPP SHALL SIGN THE REQUIRED CONTRACTOR

CERTIFICATION STATEMENT ACKNOWLEDGING THEIR RESPONSIBILITIES AS SPECIFIED IN THE SWPPP. 6. A COPY OF THE SWPPP, INCLUDING NOI, SITE NOTICE, CONTRACTOR CERTIFICATIONS, AND ANY REVISIONS, SHALL BE SUBMITTED TO THE CITY BY THE CONTRACTOR AND SHALL BE RETAINED ON-SITE DURING CONSTRUCTION. 7. A NOTICE OF TERMINATION (NOT) SHALL BE SUBMITTED TO TCEQ BY ANY PRIMARY OPERATOR WITHIN 30 DAYS AFTER ALL SOIL DISTURBING ACTIVITIES AT THE SITE HAVE BEEN COMPLETED AND A UNIFORM VEGETATIVE COVER HAS BEEN ESTABLISHED ON ALL UNPAVED AREAS AND AREAS NOT COVERED BY STRUCTURES, A TRANSFER OF OPERATIONAL CONTROL HAS OCCURRED, OR THE OPERATOR HAS OBTAINED ALTERNATIVE AUTHORIZATION UNDER A DIFFERENT PERMIT. A COPY OF THE NOT SHALL BE PROVIDED TO THE OPERATOR OF ANY MS4 RECEIVING DISCHARGE FROM THE SITE.

. KH IS NOT RESPONSIBLE FOR THE MEANS AND METHODS EMPLOYED BY THE CONTRACTOR TO IMPLEMENT THIS DEMOLITION PLAN. THIS PRELIMINARY DEMOLITION PLAN SIMPLY INDICATES THE KNOWN OBJECTS ON THE SUBJECT TRACT THAT ARE TO BE DEMOLISHED

2. KH DOES NOT WARRANT OR REPRESENT THAT THE PLAN, WHICH WAS PREPARED BASED ON SURVEY AND UTILITY INFORMATION PROVIDED BY OTHERS, SHOWS ALL IMPROVEMENTS AND UTILITIES, THAT THE IMPROVEMENTS AND UTILITIES ARE SHOWN ACCURATELY, OR THAT THE UTILITIES SHOWN CAN BE REMOVED. THE CONTRACTOR IS RESPONSIBLE FOR PERFORMING ITS OWN SITE RECONNAISSANCE TO SCOPE ITS WORK AND TO CONFIRM WITH THE OWNERS OF IMPROVEMENTS AND UTILITIES THE ABILITY AND 3. THIS PLAN IS INTENDED TO GIVE A GENERAL GUIDE TO THE CONTRACTOR, NOTHING MORE. THE GOAL OF THE DEMOLITION IS TO LEAVE THE SITE IN A STATE SUITABLE FOR THE CONSTRUCTION OF THE PROPOSED DEVELOPMENT. REMOVAL OR PRESERVATION OF IMPROVEMENTS, UTILITIES, ETC. TO ACCOMPLISH THIS GOAL ARE THE RESPONSIBILITY OF THE CONTRACTOR. 4. CONTRACTOR IS STRONGLY CAUTIONED TO REVIEW THE FOLLOWING REPORTS DESCRIBING SITE CONDITIONS PRIOR TO BIDDING AND

A ENVIRONMENTAL SITE ASSESSMENT PROVIDED BY THE OWNER b. ASBESTOS BUILDING INSPECTION REPORT(S) PROVIDED BY THE OWNER,

5 CONTRACTOR SHALL CONTACT THE OWNER TO VERIEV WHETHER ADDITIONAL REPORTS OR AMENDMENTS TO THE ABOVE CITED REPORTS HAVE BEEN PREPARED AND TO OBTAIN/REVIEW/AND COMPLY WITH THE RECOMMENDATION OF SUCH STUDIES PRIOR TO

6. CONTRACTOR SHALL COMPLY WITH ALL LOCAL, STATE, AND FEDERAL REGULATIONS REGARDING THE DEMOLITION OF OBJECTS ON THE SITE AND THE DISPOSAL OF THE DEMOLISHED MATERIALS OFF-SITE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO REVIEW THE SITE DETERMINE THE APPLICABLE REGULATIONS RECEIVE THE REQUIRED PERMITS AND AUTHORIZATIONS AND COMPLY . KH DOES NOT REPRESENT THAT THE REPORTS AND SURVEYS REFERENCED ABOVE ARE ACCURATE, COMPLETE, OR COMPREHENSIVE SHOWING ALL ITEMS THAT WILL NEED TO BE DEMOLISHED AND REMOVED. 8. SURFACE PAVEMENT INDICATED MAY OVERLAY OTHER HIDDEN STRUCTURES, SUCH AS ADDITIONAL LAYERS OF PAVEMENT, FOUNDATIONS OR WALLS. THAT ARE ALSO TO BE REMOVED.

1. THE CONTRACTOR AND GRADING SUBCONTRACTOR SHALL VERIFY THE SUITABILITY OF EXISTING AND PROPOSED SITE CONDITIONS INCLUDING GRADES AND DIMENSIONS BEFORE START OF CONSTRUCTION. THE CIVIL ENGINEER SHALL BE NOTIFIED IMMEDIATELY OF 2. CONTRACTOR SHALL OBTAIN ANY REQUIRED GRADING PERMITS FROM THE CITY.

3. UNLESS OTHERWISE NOTED, PROPOSED CONTOURS AND SPOT ELEVATIONS SHOWN IN PAVED AREA REFLECT TOP OF PAVEMENT SURFACE. IN LOCATIONS ALONG A CURB LINE, ADD 6-INCHES (OR THE HEIGHT OF THE CURB) TO THE PAVING GRADE FOR TOP OF CURB

4. PROPOSED SPOT ELEVATIONS AND CONTOURS OUTSIDE THE PAVEMENT ARE TO TOP OF FINISHED GRADE. 5. PROPOSED CONTOURS ARE APPROXIMATE. PROPOSED SPOT ELEVATIONS AND DESIGNATED GRADIENT ARE TO BE USED IN CASE OF . ALL FINISHED GRADES SHALL TRANSITION UNIFORMLY BETWEEN THE FINISHED ELEVATIONS SHOWN

7. CONTOURS AND SPOT GRADES SHOWN ARE ELEVATIONS OF TOP OF THE FINISHED SURFACE. WHEN PERFORMING THE GRADING OPERATIONS. THE CONTRACTOR SHALL PROVIDE AN APPROPRIATE ELEVATION HOLD-DOWN ALLOWANCE FOR THE THICKNESS OF PAVEMENT SIDEWALK TOPSOIL MULCH STONE LANDSCAPING RIP-RAP AND ALL OTHER SURFACE MATERIALS THAT WILL CONTRIBUTE TO THE TOP OF FINISHED GRADE. FOR EXAMPLE, THE LIMITS OF EARTHWORK IN PAVED AREAS IS THE BOTTOM OF THE 8. NO REPRESENTATIONS OF EARTHWORK QUANTITIES OR SITE BALANCE ARE MADE BY THESE PLANS. THE CONTRACTOR SHALL

PROVIDE THEIR OWN EARTHWORK CALCULATION TO DETERMINE THEIR CONTRACT QUANTITIES AND COST. ANY SIGNIFICANT VARIANCE FROM A BALANCED SITE SHALL BE IMMEDIATELY BROUGHT TO THE ATTENTION OF THE CIVIL ENGINEER. 9. ALL GRADING AND EARTHWORK SHALL COMPLY WITH THE PROJECT'S FINAL GEOTECHNICAL REPORT (OR LATEST EDITION), INCLUDING

10. ALL EXCAVATION IS UNCLASSIFIED AND SHALL INCLUDE ALL MATERIALS ENCOUNTERED. UNUSABLE EXCAVATED MATERIAL AND ALL WASTE RESULTING FROM SITE CLEARING AND GRUBBING SHALL BE REMOVED FROM THE SITE AND APPROPRIATELY DISPOSED BY THE 11. EROSION CONTROL DEVICES SHOWN ON THE EROSION CONTROL PLAN FOR THE PROJECT SHALL BE INSTALLED PRIOR TO THE START OF GRADING. REFERENCE EROSION CONTROL PLAN, DETAILS, GENERAL NOTES, AND SWPPP FOR ADDITIONAL INFORMATION AND 12.BEFORE ANY EARTHWORK IS PERFORMED, THE CONTRACTOR SHALL STAKE OUT AND MARK THE LIMITS OF THE PROJECT'S PROPERTY LINE AND SITE IMPROVEMENTS. THE CONTRACTOR SHALL PROVIDE ALL NECESSARY ENGINEERING AND SURVEYING FOR LINE AND

13. CONTRACTOR TO DISPOSE OF ALL EXCESS EXCAVATION MATERIALS IN A MANNER THAT ADHERES TO LOCAL, STATE AND FEDERAL LAWS AND REGULATIONS. THE CONTRACTOR SHALL KEEP A RECORD OF WHERE EXCESS EXCAVATION WAS DISPOSED, ALONG WITH 14. CONTRACTOR IS RESPONSIBLE FOR REMOVAL AND REPLACEMENT OF TOPSOIL AT THE COMPLETION OF FINE GRADING. CONTRACTOR SHALL REFER TO LANDSCAPE ARCHITECTURE PLANS FOR SPECIFICATIONS AND REQUIREMENTS FOR TOPSOIL.

15. CONTRACTOR SHALL MAINTAIN ADEQUATE SITE DRAINAGE DURING ALL PHASES OF CONSTRUCTION, INCLUDING MAINTAINING EXISTING DITCHES OR CULVERTS FREE OF OBSTRUCTIONS AT ALL TIMES 16.NO EARTHWORK FILL SHALL BE PLACED IN ANY EXISTING DRAINAGE WAY, SWALE, CHANNEL, DITCH, CREEK, OR FLOODPLAIN FOR ANY REASON OR ANY LENGTH OF TIME. UNLESS THESE PLANS SPECIFICALLY INDICATE THIS IS REQUIRED. 17. TEMPORARY CULVERTS MAY BE REQUIRED IN SOME LOCATIONS TO CONVEY RUN-OFF.

19. THE CONTRACTOR SHALL CLEAR AND GRUB THE SITE AND PLACE, COMPACT, AND CONDITION FILL PER THE PROJECT GEOTECHNICAL ENGINEER'S SPECIFICATIONS. THE FILL MATERIAL TO BE USED SHALL BE APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO

20.CONTRACTOR IS RESPONSIBLE FOR ALL SOILS TESTING AND CERTIFICATION, UNLESS SPECIFIED OTHERWISE BY OWNER. ALL SOILS TESTING SHALL BE COORDINATED WITH THE APPROPRIATE CITY INSPECTOR AND SHALL COMPLY WITH CITY STANDARD SPECIFICATIONS AND THE GEOTECHNICAL REPORT. SOILS TESTING SHALL BE PERFORMED BY AN APPROVED INDEPENDENT AGENCY FOR TESTING SOILS. THE OWNER SHALL APPROVE THE AGENCY NOMINATED BY THE CONTRACTOR FOR SOILS TESTING. 21.ALL COPIES OF SOILS TEST RESULTS SHALL BE SENT TO THE OWNER, ENGINEER AND ARCHITECT DIRECTLY FROM THE TESTING

22.IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO SHOW, BY THE STANDARD TESTING PROCEDURES OF THE SOILS, THAT THE WORK CONSTRUCTED MEETS THE PROJECT REQUIREMENTS AND CITY SPECIFICATIONS. 23. THE SCOPE OF WORK FOR CIVIL IMPROVEMENT SHOWN ON THESE PLANS TERMINATES 5-FEET FROM THE BUILDING. CONTRACTOR SHALL REFER TO THE GEOTECHNICAL REPORT AND STRUCTURAL PLANS AND SPECIFICATIONS FILL, CONDITIONING, AND PREPARATION

24.DUE TO THE POTENTIAL FOR DIFFERENTIAL SOIL MOVEMENT ADJACENT TO THE BUILDING, THE CONTRACTOR SHALL ADHERE TO GEOTECHNICAL REPORT'S RECOMMENDATION FOR SUBGRADE PREPARATION SPECIFIC TO FLATWORK ADJACENT TO THE PROPOSED BUILDING. THE OWNER AND CONTRACTOR ARE ADVISED TO OBTAIN A GEOTECHNICAL ENGINEER RECOMMENDATION SPECIFIC TO FLATWORK ADJACENT TO THE BUILDING JE NONE IS CURRENTLY EXISTING

OF THE PROPOSED BUILDING(S) DURING GRADING OPERATIONS AND IN THE FINAL CONDITION. IF THE CONTRACTOR OBSERVES THAT THIS WILL NOT BE ACHIEVED, THE CONTRACTOR SHALL CONTACT THE ENGINEER TO REVIEW THE LOCATION 26.THE CONTRACTOR SHALL TAKE ALL AVAILABLE PRECAUTIONS TO CONTROL DUST. CONTRACTOR SHALL CONTROL DUST BY SPRINKLING WATER OR BY OTHER MEANS APPROVED BY THE CITY AT NO ADDITIONAL COST TO THE OWNER

27. CONTRACTOR SHALL COORDINATE WITH THE UTILITY COMPANIES FOR ANY REQUIRED UTILITY ADJUSTMENTS AND/OR RELOCATIONS NEEDED FOR GRADING OPERATIONS AND TO ACCOMMODATE PROPOSED GRADE, INCLUDING THE UNKNOWN UTILITIES NOT SHOWN ON THESE PLANS. CONTRACTOR SHALL REFER TO THE GENERAL NOTES "OVERALL" SECTION THESE PLANS FOR ADDITIONAL

28.EXISTING TREE LOCATIONS SHOWN ON THESE PLANS ARE APPROXIMATE. CONTRACTOR SHALL REPORT ANY DISCREPANCIES FOUND 29.CONTRACTOR SHALL FIELD VERIFY ALL PROTECTED TREE LOCATIONS, INDIVIDUAL PROTECTED TREE CRITICAL ROOT ZONES, AND

PRESERVATION PLAN BY THE LANDSCAPE ARCHITECT PRIOR TO COMMENCING THE WORK. 30. TREE PROTECTION MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH THE CITY STANDARD TREE PROTECTION DETAILS AND THE

APPROVED TREE PRESERVATION PLANS BY THE LANDSCAPE ARCHITECT. 31.CONTRACTOR SHALL REFER TO THE LANDSCAPING AND TREE PRESERVATIONS PLANS FOR ALL INFORMATION AND DETAILS

- REGARDING EXISTING TREES TO BE REMOVED AND PRESERVED 32.NO TREE SHALL BE REMOVED UNLESS A TREE REMOVAL PERMIT HAS BEEN ISSUED BY THE CITY, OR CITY HAS OTHERWISE COL IN WRITING THAT ONE IS NOT NEEDED FOR THE TREE(S).
- 33 NO TREE SHALL BE REMOVED OR DAMAGED WITHOUT PRIOR AUTHORIZATION OF THE OWNER OR OWNER'S REPRESENTATIVE EXISTING TREES SHALL BE PRESERVED WHENEVER POSSIBLE AND GRADING IMPACT TO THEM HELD TO A MINIMUM. 34 AFTER PLACEMENT OF SUBGRADE AND PRIOR TO PLACEMENT OF PAVEMENT, CONTRACTOR SHALL TEST AND OBSERVE PAVE AREAS FOR EVIDENCE OF PONDING AND INADEQUATE SLOPE FOR DRAINAGE. ALL AREAS SHALL ADEQUATELY DRAIN TOWARI INTENDED STRUCTURE TO CONVEY STORMWATER RUNOFF. CONTRACTOR SHALL IMMEDIATELY NOTIFY OWNER AND ENGINEER
- AREAS OF POOR DRAINAGE ARE DISCOVERED 35. CONTRACTOR FIELD ADJUSTMENT OF PROPOSED SPOT GRADES IS ALLOWED, IF THE APPROVAL OF THE CIVIL ENGINEER IS OB **RETAINING WALLS:**
- . RETAINING WALLS SHOWN ARE FOR SITE GRADING PURPOSES ONLY, AND INCLUDE ONLY LOCATION AND SURFACE SPOT ELEV AT THE TOP AND BOTTOM OF THE WALL. 2. RETAINING WALL TYPE OR SYSTEM SHALL BE SELECTED BY THE OWNER.
- DIRT ONTO OFF-SITE ROADWAYS. ALL SEDIMENT AND DIRT FROM THE SITE THAT IS DEPOSITED ONTO AN OFF-SITE ROADWAY SHALL BE 3. RETAINING WALL DESIGN SHALL BE PROVIDED BY OTHERS AND SHALL FIT IN THE WALL ZONE OR LOCATION SHOWN ON THESE STRUCTURAL DESIGN AND PERMITTING OF RETAINING WALLS, RAILINGS, AND OTHER WALL SAFETY DEVICES SHALL BE PERFOR A LICENSED ENGINEER AND ARE NOT PART OF THIS PLAN SET. 4. RETAINING WALL DESIGN SHALL MEET THE INTENT OF THE GRADING PLAN AND SHALL ACCOUNT FOR ANY INFLUENCE ON ADJA
 - BUILDING FOUNDATIONS, UTILITIES, PROPERTY LINES AND OTHER CONSTRUCTABILITY NOTES. 5. RETAINING WALL ENGINEER SHALL CONSULT THESE PLANS AND THE GEOTECHNICAL REPORT FOR POTENTIAL CONFLICTS.
 - 1. ALL PAVING MATERIALS AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH THESE PLANS, THE CITY STANDARD DETAILS AN SPECIFICATIONS, THE FINAL GEOTECHNICAL REPORT AND ALL ISSUED ADDENDA, AND COMMONLY ACCEPTED CONSTRUCTION
 - STANDARDS. THE CITY SPECIFICATIONS SHALL GOVERN WHERE OTHER SPECIFICATIONS DO NOT EXIST. IN CASE OF CONFLICTI SPECIFICATIONS OR DETAILS, THE MORE RESTRICTIVE SPECIFICATION/DETAIL SHALL BE FOLLOWED 2. ALL PRIVATE ON-SITE PAVING AND PAVING SUBGRADE SHALL COMPLY WITH THE PROJECT'S FINAL GEOTECHNICAL REPORT (O
 - EDITION), INCLUDING ALL ADDENDA. 3. ALL FIRELANE PAVING AND PAVING SUBGRADE SHALL COMPLY WITH CITY STANDARDS AND DETAILS. IF THESE ARE DIFFERENT THOSE IN THE GEOTECHNICAL REPORT THEN THE MORE RESTRICTIVE SHALL BE FOLLOWED 4. ALL PUBLIC PAVING AND PAVING SUBGRADE SHALL COMPLY WITH CITY STANDARD CONSTRUCTION DETAILS AND SPECIFICATIO
 - 5. CONTRACTOR IS RESPONSIBLE FOR ALL PAVING AND PAVING SUBGRADE TESTING AND CERTIFICATION, UNLESS SPECIFIED OTI BY OWNER. ALL PAVING AND PAVING SUBGRADE TESTING SHALL BE COORDINATED WITH THE APPROPRIATE CITY INSPECTOR TESTING SHALL BE PERFORMED BY AN APPROVED INDEPENDENT AGENCY FOR TESTING PAVING AND SUBGRADE. OWNER SHA APPROVE THE AGENCY NOMINATED BY THE CONTRACTOR FOR PAVING AND PAVING SUBGRADE TESTING.
 - 6. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO SHOW, BY THE STANDARD TESTING PROCEDURES OF THE PAVING AND P SUBGRADE, THAT THE WORK CONSTRUCTED MEETS THE PROJECT REQUIREMENTS AND CITY SPECIFICATIONS. 7. DUE TO THE POTENTIAL FOR DIFFERENTIAL SOIL MOVEMENT ADJACENT TO THE BUILDING, THE CONTRACTOR SHALL ADHERE GEOTECHNICAL REPORT'S RECOMMENDATION FOR SUBGRADE PREPARATION SPECIFIC TO FLATWORK ADJACENT TO THE PRO
 - BUILDING. THE OWNER AND CONTRACTOR ARE ADVISED TO OBTAIN A GEOTECHNICAL ENGINEER RECOMMENDATION SPECIFIC FLATWORK ADJACENT TO THE BUILDING. IF NONE IS CURRENTLY EXISTING. 8. CURB RAMPS ALONG PUBLIC STREETS AND IN THE PUBLIC RIGHT-OF-WAY SHALL BE CONSTRUCTED BASED ON THE CITY STAN
 - CONSTRUCTION DETAIL AND SPECIFICATIONS 9. PRIVATE CURB RAMPS ON THE SITE (I.E. OUTSIDE PUBLIC STREET RIGHT-OF-WAY) SHALL CONFORM TO ADA AND TAS STANDAR SHALL HAVE A DETECTABLE WARNING SURFACE THAT IS FULL WIDTH AND FULL DEPTH OF THE CURB RAMP. NOT INCLUDING FUL 10. ALL ACCESSIBLE RAMPS, CURB RAMPS, STRIPING, AND PAVEMENT MARKINGS SHALL CONFORM TO ADA AND TAS STANDARDS.
 - EDITION. 11. ANY COMPONENTS OF THE PROJECT SUBJECT TO RESIDENTIAL USE SHALL ALSO CONFORM TO THE FAIR HOUSING ACT, AND (WITH THE FAIR HOUSING ACT DESIGN MANUAL BY THE US DEPARTMENT OF HOUSING AND URBAN DEVELOPMENT. 12. CONTRACTOR SHALL CONSTRUCT PROPOSED PAVEMENT TO MATCH EXISTING PAVEMENT WITH A SMOOTH FLUSH CONNECT
 - 13 CONTRACTOR SHALL FURNISH AND INSTALL ALL PAVEMENT MARKINGS FOR FIRE LANES. PARKING STALLS, HANDICAPPED PAR SYMBOLS, AND MISCELLANEOUS STRIPING WITHIN PARKING LOT AND AROUND BUILDING AS SHOWN ON THE PLANS. ALL PAINT PAVEMENT MARKINGS SHALL ADHERE TO CITY AND OWNER STANDARDS. 14. REFER TO GEOTECHNICAL REPORT FOR PAVING JOINT LAYOUT PLAN REQUIREMENTS FOR PRIVATE PAVEMENT.
 - 15. REFER TO CITY STANDARD DETAILS AND SPECIFICATIONS FOR JOINT LAYOUT PLAN REQUIREMENTS FOR PUBLIC PAVEMENT. 16. ALL REINFORCING STEEL SHALL CONFORM TO THE GEOTECHNICAL REPORT, CITY STANDARDS, AND ASTM A-615, GRADE 60, AI BE SUPPORTED BY BAR CHAIRS. CONTRACTOR SHALL USE THE MORE STRINGENT OF THE CITY AND GEOTECHNICAL STANDARI 17. ALL JOINTS SHALL EXTEND THROUGH THE CURB.
 - 18. THE MINIMUM LENGTH OF OFFSET JOINTS AT RADIUS POINTS SHALL BE 2 FEET. 19. CONTRACTOR SHALL SUBMIT A JOINTING PLAN TO THE ENGINEER AND OWNER PRIOR TO BEGINNING ANY OF THE PAVING WOR 20. ALL SAWCUTS SHALL BE FULL DEPTH FOR PAVEMENT REMOVAL AND CONNECTION TO EXISTING PAVEMENT.
 - 21.FIRE LANES SHALL BE MARKED AND LABELED AS A FIRELANE PER CITY STANDARDS. 22. UNLESS THE PLANS SPECIFICALLY DICTATE TO THE CONTRARY, ON-SITE AND OTHER DIRECTIONAL SIGNS SHALL BE ORIENTED THEY ARE READILY VISIBLE TO THE ONCOMING TRAFFIC FOR WHICH THEY ARE INTENDED. 23.CONTRACTOR IS RESPONSIBLE FOR INSTALLING NECESSARY CONDUIT FOR LIGHTING, IRRIGATION, ETC. PRIOR TO PLACEMENT PAVEMENT. ALL CONSTRUCTION DOCUMENTS (CIVIL, MEP, LANDSCAPE, IRRIGATION, AND ARCHITECT) SHALL BE CONSULTED.
 - 24.BEFORE PLACING PAVEMENT, CONTRACTOR SHALL VERIFY THAT SUITABLE ACCESSIBLE PEDESTRIAN ROUTES (PER ADA, TAS, FHA) EXIST TO AND FROM EVERY DOOR AND ALONG SIDEWALKS, ACCESSIBLE PARKING SPACES, ACCESS AISLES, AND ACCESS ROUTES. IN NO CASE SHALL AN ACCESSIBLE RAMP SLOPE EXCEED 1 VERTICAL TO 12 HORIZONTAL. IN NO CASE SHALL SIDEWAL CROSS SLOPE EXCEED 2.0 PERCENT. IN NO CASE SHALL LONGITUDINAL SIDEWALK SLOPE EXCEED 5.0 PERCENT. ACCESSIBLE
 - SPACES AND ACCESS AISLES SHALL NOT EXCEED 2.0 PERCENT SLOPE IN ANY DIRECTION 25. CONTRACTOR SHALL TAKE FIELD SLOPE MEASUREMENTS ON FINISHED SUBGRADE AND FORM BOARDS PRIOR TO PLACING PAV TO VERIFY THAT ADA/TAS SLOPE REQUIREMENTS ARE PROVIDED. CONTRACTOR SHALL CONTACT ENGINEER PRIOR TO PAVING EXCESSIVE SLOPES ARE ENCOUNTERED. NO CONTRACTOR CHANGE ORDERS WILL BE ACCEPTED FOR ADA AND TAS SLOPE COMPLIANCE ISSUES.

STORM DRAINAGI

- 1. ALL STORM SEWER MATERIALS AND CONSTRUCTION SHALL COMPLY WITH CITY STANDARD CONSTRUCTION DETAILS AND SPECIFICATIONS
- 2. THE SITE UTILITY CONTRACTOR SHALL PROVIDE ALL MATERIALS AND APPURTENANCES NECESSARY FOR COMPLETE INSTALLA THE STORM SEWER 3. THE CONTRACTOR SHALL FIELD VERIFY THE SIZE, CONDITION, HORIZONTAL, AND VERTICAL LOCATIONS OF ALL EXISTING STOR
- SEWER FACILITIES THAT ARE TO BE CONNECTED TO, PRIOR TO START OF CONSTRUCTION OF ANY STORM SEWER, AND SHALL THE ENGINEER OF ANY CONFLICTS DISCOVERED.
- 4 THE CONTRACTOR SHALL VERIEV AND COORDINATE ALL DIMENSIONS SHOWN INCLUDING THE HORIZONTAL AND VERTICAL LO OF CURB INLETS AND GRATE INLETS AND ALL UTILITIES CROSSING THE STORM SEWER
- 5. FLOW LINE, TOP-OF-CURB, RIM, THROAT, AND GRATE ELEVATIONS OF PROPOSED INLETS SHALL BE VERIFIED WITH THE GRADIN AND FIELD CONDITIONS PRIOR TO THEIR INSTALLATION. 6. ALL PUBLIC STORM SEWER CONSTRUCTION, PIPE, STRUCTURES, AND FITTINGS SHALL ADHERE TO CITY PUBLIC WORKS STAND
- DETAILS AND SPECIFICATIONS CONTRACTOR SHALL ARRANGE FOR REQUIRED CITY INSPECTIONS 7. ALL PRIVATE STORM SEWER CONSTRUCTION, PIPE, STRUCTURES, AND FITTINGS SHALL ADHERE TO THE APPLICABLE PLUMBIN
- CONTRACTOR SHALL ARRANGE FOR REQUIRED CITY INSPECTIONS. 8. ALL PVC TO RCP CONNECTIONS AND ALL STORM PIPE CONNECTIONS ENTERING STRUCTURES OR OTHER STORM PIPES SHALL
- CONCRETE COLLAR AND BE GROUTED TO ASSURE THE CONNECTION IS WATERTIGHT. 9. ALL PUBLIC STORM SEWER LINES SHALL BE MINIMUM CLASS III RCP. PRIVATE STORM SEWER LINES 18-INCHES AND GREATER CLASS III RCP OR OTHER APPROVED MATERIAL 10. WHERE COVER EXCEEDS 20-FEET OR IS LESS THAN 2-FEET, CLASS IV RCP SHALL BE USED.
- 11.IF CONTRACTOR PROPOSES TO USE HDPE OR PVC IN LIEU OF RCP FOR PRIVATE STORM SEWER, CONTRACTOR SHALL SUBMIT TECHNICAL DATA TO THE OWNER, ENGINEER AND CITY ENGINEER/INSPECTOR FOR APPROVAL PRIOR TO ORDERING THE MATEI ANY PROPOSED HDPE AND PVC SHALL BE WATERTIGHT 12. THE CONTRACTOR SHALL PROVIDE CONSTRUCTION SURVEYING FOR ALL STORM SEWER LINES.
- 13.EMBEDMENT FOR ALL STORM SEWER LINES, PUBLIC OR PRIVATE, SHALL BE PER CITY STANDARD DETAILS. 14. ALL WYE CONNECTIONS AND PIPE BENDS ARE TO BE PREFABRICATED AND INSTALLED PER MANUFACTURERS SPECIFICATIONS
- 15. USE 4 FOOT JOINTS WITH BEVELED ENDS IF RADIUS OF STORM SEWER IS LESS THAN 100 FEET. 16 THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND SUBMITTING A TRENCH SAFETY PLAN, PREPARED BY A PROFESSION/ ENGINEER IN THE STATE OF TEXAS, TO THE CITY PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING SAFETY REQUIREMENTS IN ACCORDANCE WITH CITY, STATE, AND FEDERAL REQUIREMENTS, INCLUDING OSHA FOR ALL TRENC OPEN TRENCHES SHALL BE ALLOWED OVERNIGHT WITHOUT PRIOR WRITTEN APPROVAL OF THE CITY. 17. THE CONTRACTOR SHALL KEEP TRENCHES FREE FROM WATER.


ANY PONDS THAT ARE INTENDED TO HOLD WATER INDEFINITELY SHALL BE CONSTRUCTED WATERTIGHT.


- 2. FOR ANY PONDS INTENDED TO HOLD WATER INDEFINITELY: THE CONTRACTOR SHALL REFER TO THE GEOTECHNICAL REPORT POND LINER SPECIFICATIONS
- 3. A GEOTECHNICAL ENGINEER SHALL REVIEW AND APPROVE ALL POND LINER MATERIAL, PLACEMENT PROCEDURES, AND PROVI TESTING TO ENSURE THE POND LINER MATERIAL PLACED IS WATERTIGHT. 4. STORM SEWER PIPES AND HEADWALLS THAT CONNECT TO A POND INTENDED TO HOLD WATER INDEFINITELY SHALL BE INSTAL
- WITH WATERTIGHT JOINTS TO AT LEAST 1-FOOT ABOVE THE NORMAL POOL WATER SURFACE ELEVATION. 5. ANY GRAVEL OR OTHER PERVIOUS EMBEDMENT AROUND PIPES OR OUTFALL STRUCTURES NEAR THE POND SHALL BE ELIMINA AT LEAST 20-FEET FROM THE POND SO NO ROUTE FOR WATER TO LEAK THROUGH THE EMBEDMENT MATERIAL IS PROVIDED. B
- IN THESE AREAS SHALL BE OF IMPERVIOUS MATERIAL 6. FOR ANY PONDS INTENDED TO HOLD WATER INDEFINITELY: THE WATER LEVEL FOLLOWING COMPLETION AND FILLING OF THE SHALL BE MONITORED BY THE CONTRACTOR FOR AT LEAST 60 DAYS TO OBSERVE WATER INFLOW, OUTFLOW, AND CALCULATE
- EVAPORATION TO VERIFY THAT THE POND IS WATERTIGHT. 7. FOR ANY PONDS INTENDED TO HOLD WATER INDEFINITELY: THE POND WATER LEVEL SHALL ALSO BE MAINTAINED BY THE CONTRACTOR FOR THE DURATION OF CONSTRUCTION SO THAT IT REMAINS FULL TO ITS DESIGN WATER LEVEL. AND IS NOT LC AS THIS MAY DRY-OUT THE POND LINER AND RISK ITS WATERTIGHT PROPERTIES.

WATER AND WASTEWATER: . ALL WATER AND WASTEWATER MATERIALS AND CONSTRUCTION SHALL COMPLY WITH CITY STANDARD CONSTRUCTION DETAIL


- SPECIFICATIONS 2. CONTRACTOR SHALL FIELD VERIFY THE SIZE, CONDITION, HORIZONTAL, AND VERTICAL LOCATIONS OF ALL EXISTING WATER AN WASTEWATER FACILITIES THAT ARE TO BE CONNECTED TO, PRIOR TO START OF CONSTRUCTION OF ANY WATER OR WASTEWA CONSTRUCTION, AND SHALL NOTIFY THE ENGINEER OF ANY CONFLICTS DISCOVERED.
- 3. CONTRACTOR SHALL VERIFY AND COORDINATE ALL DIMENSIONS SHOWN, INCLUDING THE HORIZONTAL AND VERTICAL LOCATION ALL UTILITY SERVICES ENTERING THE BUILDING 4. THE CONTRACTOR SHALL FIELD VERIFY THE ELEVATION OF ALL UTILITY CROSSINGS PRIOR TO THE INSTALLATION OF ANY PIPE 5. THE SITE UTILITY CONTRACTOR SHALL PROVIDE ALL MATERIALS AND APPURTENANCES NECESSARY FOR COMPLETE INSTALLA
- THE WATER AND WASTEWATER IMPROVEMENTS. 6. ALL PUBLIC WATER AND WASTEWATER CONSTRUCTION, PIPE, STRUCTURES, AND FITTINGS SHALL ADHERE TO CITY PUBLIC WO STANDARD DETAILS AND SPECIFICATIONS. CONTRACTOR SHALL ARRANGE FOR REQUIRED CITY INSPECTIONS.
- 7. ALL PRIVATE WATER AND WASTEWATER CONSTRUCTION, PIPE, STRUCTURES, AND FITTINGS SHALL ADHERE TO THE APPLICABI PLUMBING CODE. CONTRACTOR SHALL ARRANGE FOR REQUIRED CITY INSPECTIONS 8. FIRE SPRINKLER LINES SHALL BE DESIGNED AND INSTALLED BY A LICENSED FIRE SPRINKLER CONTRACTOR, AND COMPLY TO 1 APPLICABLE CODES AND INSPECTIONS REQUIRED. THESE PLANS WERE PREPARED WITHOUT THE BENEFIT OF THE FIRE SPRIN DESIGN. CONTRACTOR SHALL NOTIFY THE ENGINEER IF ANY DISCREPANCIES.
- 9. EMBEDMENT FOR ALL WATER AND WASTEWATER LINES, PUBLIC OR PRIVATE, SHALL BE PER CITY STANDARD DETAILS. 10. CONTRACTOR SHALL TAKE REQUIRED SANITARY PRECAUTIONS, FOLLOWING ANY CITY, TCEQ, AND AWWA STANDARDS, TO KEE WATER PIPE AND FITTINGS CLEAN AND CAPPED AT TIMES WHEN INSTALLATION IS NOT IN PROGRESS. 11 CONTRACTOR SHALL PROVIDE CONSTRUCTION SURVEYING FOR ALL WATER AND WASTEWATER LINES
- 25.CONTRACTOR SHALL ENSURE THAT SUFFICIENT POSITIVE SLOPE AWAY FROM THE BUILDING PAD IS ACHIEVED FOR ENTIRE PERIMETER 12. ALL WATER AND WASTEWATER SERVICES SHALL TERMINATE 5-FEET OUTSIDE THE BUILDING, UNLESS NOTED OTHERWISE. 13. CONTRACTOR SHALL COMPLY WITH CITY REQUIREMENTS FOR WATER AND WASTEWATER SERVICE DISRUPTIONS AND THE AMC
 - PRIOR NOTICE THAT IS REQUIRED, AND SHALL COORDINATE DIRECTLY WITH THE APPROPRIATE CITY DEPARTMENT. 14. CONTRACTOR SHALL SEQUENCE WATER AND WASTEWATER CONSTRUCTION TO AVOID INTERRUPTION OF SERVICE TO SURROU PROPERTIES
 - 15. CONTRACTOR SHALL MAINTAIN WATER SERVICE AND WASTEWATER SERVICE TO ALL CUSTOMERS THROUGHOUT CONSTRUCT NECESSARY, BY USE OF TEMPORARY METHODS APPROVED BY THE CITY AND OWNER). THIS WORK SHALL BE CONSIDERED SUBSIDIARY TO THE PROJECT AND NO ADDITIONAL COMPENSATION SHALL BE ALLOWED
 - 16. THE CONTRACTOR IS RESPONSIBLE TO PROTECT ALL WATER AND WASTEWATER LINES CROSSING THE PROJECT. THE CONTRA SHALL REPAIR ALL DAMAGED LINES IMMEDIATELY. ALL REPAIRS OF EXISTING WATER MAINS, WATER SERVICES, SEWER MAINS SANITARY SEWER SERVICES ARE SUBSIDIARY TO THE WORK, AND NO ADDITIONAL COMPENSATION SHALL BE ALLOWED.
 - 17. VALVE ADJUSTMENTS SHALL BE CONSTRUCTED SUCH THAT THE COVERS ARE AT FINISHED SURFACE GRADE OF THE PROPOSI PAVEMENT
 - 18. THE ENDS OF ALL EXISTING WATER MAINS THAT ARE CUT, BUT NOT REMOVED, SHALL BE PLUGGED AND ABANDONED IN PLACE. WORK SHALL BE CONSIDERED AS A SUBSIDIARY COST TO THE PROJECT AND NO ADDITIONAL COMPENSATION SHALL BE ALLO


	THRUST	E HYDRANTS, VALVES, TEES, BENDS, WYES, REDUCERS, FITTINGS, AND ENDS SHALL BE MECHANICALLY RESTRAINED AND/OR BLOCKED TO CITY STANDARDS.	B
ONFIRMED	JOINTS	ACTOR SHALL INSTALL A FULL SEGMENT OF WATER OR WASTEWATER PIPE CENTERED AT ALL UTILITY CROSSINGS SO THAT THE ARE GREATER THAN 9-FEET FROM THE CROSSING. DSSINGS AND LOCATIONS WHERE WASTEWATER IS LESS THAN 9-FEET FROM WATER, WASTEWATER CONSTRUCTION AND	ATE
Ξ.	MATERI	ALS SHALL COMPLY WITH TCEQ CHAPTER 217.53. DSSING AND LOCATIONS WHERE WATER IS LESS THAN 9-FEET FROM WASTEWATER, WATER CONSTRUCTION AND MATERIALS	DV
EMENT DS THE ER IF ANY	23.ALL WA	COMPLY WITH TCEQ CHAPTER 290.44. TER AND WASTEWATER SHALL BE TESTED IN ACCORDANCE WITH THE CITY, AWWA, AND TCEQ STANDARDS AND CATIONS. AT A MINIMUM, THIS SHALL CONSIST OF THE FOLLOWING:	
BTAINED.	a. ALL WA ⁻ SHALL C	TERLINES SHALL BE HYDROSTATICALLY TESTED AND CHLORINATED BEFORE BEING PLACED INTO SERVICE. CONTRACTOR COORDINATE WITH THE CITY FOR THEIR REQUIRED PROCEDURES AND SHALL ALSO COMPLY WITH TCEQ REGULATIONS.	
VATIONS	REQUIR	VATER LINES AND MANHOLES SHALL BE PRESSURE TESTED. CONTRACTOR SHALL COORDINATE WITH THE CITY FOR THEIR ED PROCEDURES AND SHALL ALSO COMPLY WITH TCEQ REGULATIONS. AFTER COMPLETION OF THESE TESTS, A TELEVISION FION SHALL BE PERFORMED AND PROVIDED TO THE CITY AND OWNER ON A DVD.	
E PLANS.	MARKEF	ACTOR SHALL INSTALL DETECTABLE WIRING OR MARKING TAPE A MINIMUM OF 12" ABOVE WATER AND WASTEWATER LINES. R DECALS SHALL BE LABELED "CAUTION - WATER LINE", OR "CAUTION - SEWER LINE". DETECTABLE WIRING AND MARKING TAPE	N N N N N N N N N N N N N N N N N N N
E PLANS. DRMED BY	25.DUCTILE SINGLE	COMPLY WITH CITY STANDARDS, AND SHALL BE INCLUDED IN THE COST OF THE WATER AND WASTEWATER PIPE. E IRON PIPE SHALL BE PROTECTED FROM CORROSION BY A LOW-DENSITY POLYETHYLENE LINER WRAP THAT IS AT LEAST A LAYER OF 8-MIL. ALL DUCTILE IRON JOINTS SHALL BE BONDED.	EVISION
ACENT	27.CONTRA	LINES SHALL BE INSTALLED AT NO LESS THAN THE MINIMUM COVER REQUIRED BY THE CITY. ACTOR SHALL PROVIDE CLEAN-OUTS FOR PRIVATE SANITARY SEWER LINES AT ALL CHANGES IN DIRECTION AND 100-FOOT ALS, OR AS REQUIRED BY THE APPLICABLE PLUMBING CODE. CLEAN-OUTS REQUIRED IN PAVEMENT OR SIDEWALKS SHALL	REV
	HAVE CA 28.CONTRA	AST IRON COVERS FLUSH WITH FINISHED GRADE. ACTOR SHALL PROVIDE BACKWATER VALVES FOR PLUMBING FIXTURES AS REQUIRED BY THE APPLICABLE PLUMBING CODE (E.G.	
ND N TING	PUBLIC	ELEVATION OF FIXTURE UNIT IS BELOW THE ELEVATION OF THE MANHOLE COVER OF THE NEXT UPSTREAM MANHOLE IN THE SEWER). CONTRACTOR SHALL REVIEW BOTH MEP AND CIVIL PLANS TO CONFIRM WHERE THESE ARE REQUIRED. NTRACTOR IS RESPONSIBLE FOR OBTAINING AND SUBMITTING A TRENCH SAFETY PLAN, PREPARED BY A PROFESSIONAL	
OR LATEST	ENGINE SAFETY	ER IN THE STATE OF TEXAS, TO THE CITY PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING TRENCH REQUIREMENTS IN ACCORDANCE WITH CITY, STATE, AND FEDERAL REQUIREMENTS, INCLUDING OSHA FOR ALL TRENCHES. NO	
NT THAN		RENCHES SHALL BE ALLOWED OVERNIGHT WITHOUT PRIOR WRITTEN APPROVAL OF THE CITY. NTRACTOR SHALL KEEP TRENCHES FREE FROM WATER.	o z
IONS. THERWISE R.	ABBREVIA	TIONS AND DEFINITIONS:	
HALL	A ADA	AREA AMERICANS WITH DISABILITIES ACT	8626
PAVING TO	AWWA B-B BC	AMERICAN WATER WORKS ASSOCIATION BACK TO BACK BEGIN CURVE	Z8 28
OPOSED IC TO	BC BCR	BACK OF CURB BEGIN CURB RETURN	vi z 💩 🖵
NDARD	BMP BOC	BEST MANAGEMENT PRACTICE BACK OF CURB	
RDS AND LARES.	BVCE BVCS BW	BEGIN VERTICAL CURVE ELEVATION BEGIN VERTICAL CURVE STATION BOTTOM OF WALL	
S, LATEST	BW CFS CITY	CUBIC FEET PER SECOND CITY, TOWN, OR OTHER APPLICABLE LOCAL GOVERNMENT JURISDICTION	
TION.	C/L CL	CENTERLINE	UITE 0768 ALEY-
rking It and	CONC CY DEMO	CONCRETE CUBIC YARD DEMOLITION	CENCE, SL ENUE, SL WWW.KIM STERED
	DG	DEMOLITION DECOMPOSED GRANITE DETAIL	KIMLEY-HO A AVENUE, S 512-520- WWW.KIN REGISTERED
ND SHALL RDS.	EA EC	EACH END CURVE	
RK.	ECR EG	END CURB RETURN EXISTING GROUND	© 2023 S. AUSTIN PHONE: TEXAS
D SO	EL ELEC ELEV	ELEVATION ELECTRICAL / ELECTRICITY ELEVATION	501 5
NT OF	EPA ESMT	UNITED STATES ENVIRONMENTAL PROTECTION AGENCY EASEMENT	
S, AND SSIBLE		END VERTICAL CURVE ELEVATION END VERTICAL CURVE STATION	08/04/2023
ALK E PARKING	F-F	EXISTING FACE TO FACE	SATE OF TELAS
AVEMENT NG IF ANY	FG FH FL	FINISHED GROUND FIRE HYDRANT FLOW LINE	
		FACE OF CURB FEET	ALEJANDRO E. GRANADOS RICO
	HGL KH	HYDRAULIC GRADE LINE KIMLEY-HORN AND ASSOCIATES, INC.	Or CICENSED
ATION OF	KHA LAT LF	KIMLEY-HORN AND ASSOCIATES, INC. LATERAL LINEAR FEET	Aljana E. Supe Lin
RM L NOTIFY	LT MAX	LEFT MAXIMUM	
	ME MH	MATCH EXISTING ELEVATION MANHOLE	
ING PLAN		MINUTE / MINIMUM NUMBER NOTICE OF INTENT, REF. TCEQ GENERAL PERMIT	
DARD		NOTICE OF INTENT, REF. TCEQ GENERAL PERMIT NOTICE OF TERMINATION, REF. TCEQ GENERAL PERMIT NOT TO SCALE	KE N CO OG
NG CODE. L HAVE A	OC OFF	ON CENTER OFFSET	X SCAL DRA CHE
R SHALL BE	OSHA PC	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION POINT OF CURVATURE	
Т	PCC PGL PI	PORTLAND CEMENT CONCRETE / POINT OF COMPOUND CURVATURE PROPOSED GRADE LINE POINT OF INFLECTION	۲.
ERIAL.	PROP PRC	PROPOSED POINT OF REVERSE CURVATURE	
IS.	PSI PT	POUNDS PER SQUARE INCH POINT OF TANGENCY	Ž
IAL	PVI	POLYVINYL CHLORIDE POINT OF VERTICAL INFLECTION PAVEMENT	Ш
G TRENCH CHES. NO	PVMT RCP ROW	PAVEMENT REINFORCED CONCRETE PIPE RIGHT OF WAY	U U U
	RT SF	RIGHT SQUARE FEET	
T FOR	SS SSMH STA	SANITARY SEWER SANITARY SEWER MANHOLE STATION	HORN
VIDE	STA STD SY	STATION STANDARD SQUARE YARD	ŢZ
ALLED	TAS TC	ARCHITECTURAL BARRIERS TEXAS ACCESSIBILITY STANDARDS TOP OF CURB	
IATED FOR BACKFILL	TEMP	TEXAS COMMISSION OF ENVIRONMENTAL QUALITY TEMPORARY TEXAS DEPARTMENT OF TRANSPORTATION	
E POND		TEXAS DEPARTMENT OF TRANSPORTATION TEXAS MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES TOP OF WALL	Σ I
	TYP VC	TYPICAL VERTICAL CURVE	N N N
OWERED,	WTR WW	WATER WASTEWATER	
ILS AND	UTILITY	<u>′ CONTACTS:</u>	
AND VATER	1. <u>PEC</u>	, BRANDON BUTTS, (512) 525-6519, BRANDON BUTTS@PECI.COM	
ION OF	2. <u>ATN</u>	10S, MICHAEL ANDREWS, (512) 310-3855, MICHAEL.ANDREW@ATMOSENERGY.COM	(AS
E. ATION OF	3. <u>CIT</u>	Y OF GEORGETOWN, DAVID MUNK, (512) 930-2572, DAVID.MUNK@GEORGETOWN.ORG	
ORKS			
BLE			Ζ Ψ ⁵
THE NKLER			
EP			NOLIN PHASE
			Z⊡∛
	GEOTECH	AN AND GENERAL NOTES REFER TO: INICAL ENGINEERING REPORT	
ounding Tion (if	<u>MLA ENGI</u> #22101100	0.152	Ī
RACTOR		ER 2022 G ALL REVISIONS AND ADDENDA TO THIS THAT MAY HAVE BEEN RELEASED AFTER	
S, AND	THE NOTE		
sed E. This			SHEET NUMBER
WED.			4
		© COPYRIGHT 2023 KIMLEY-HORN AND ASSOCIATES, INC., ALL RIGHTS RESERVED	

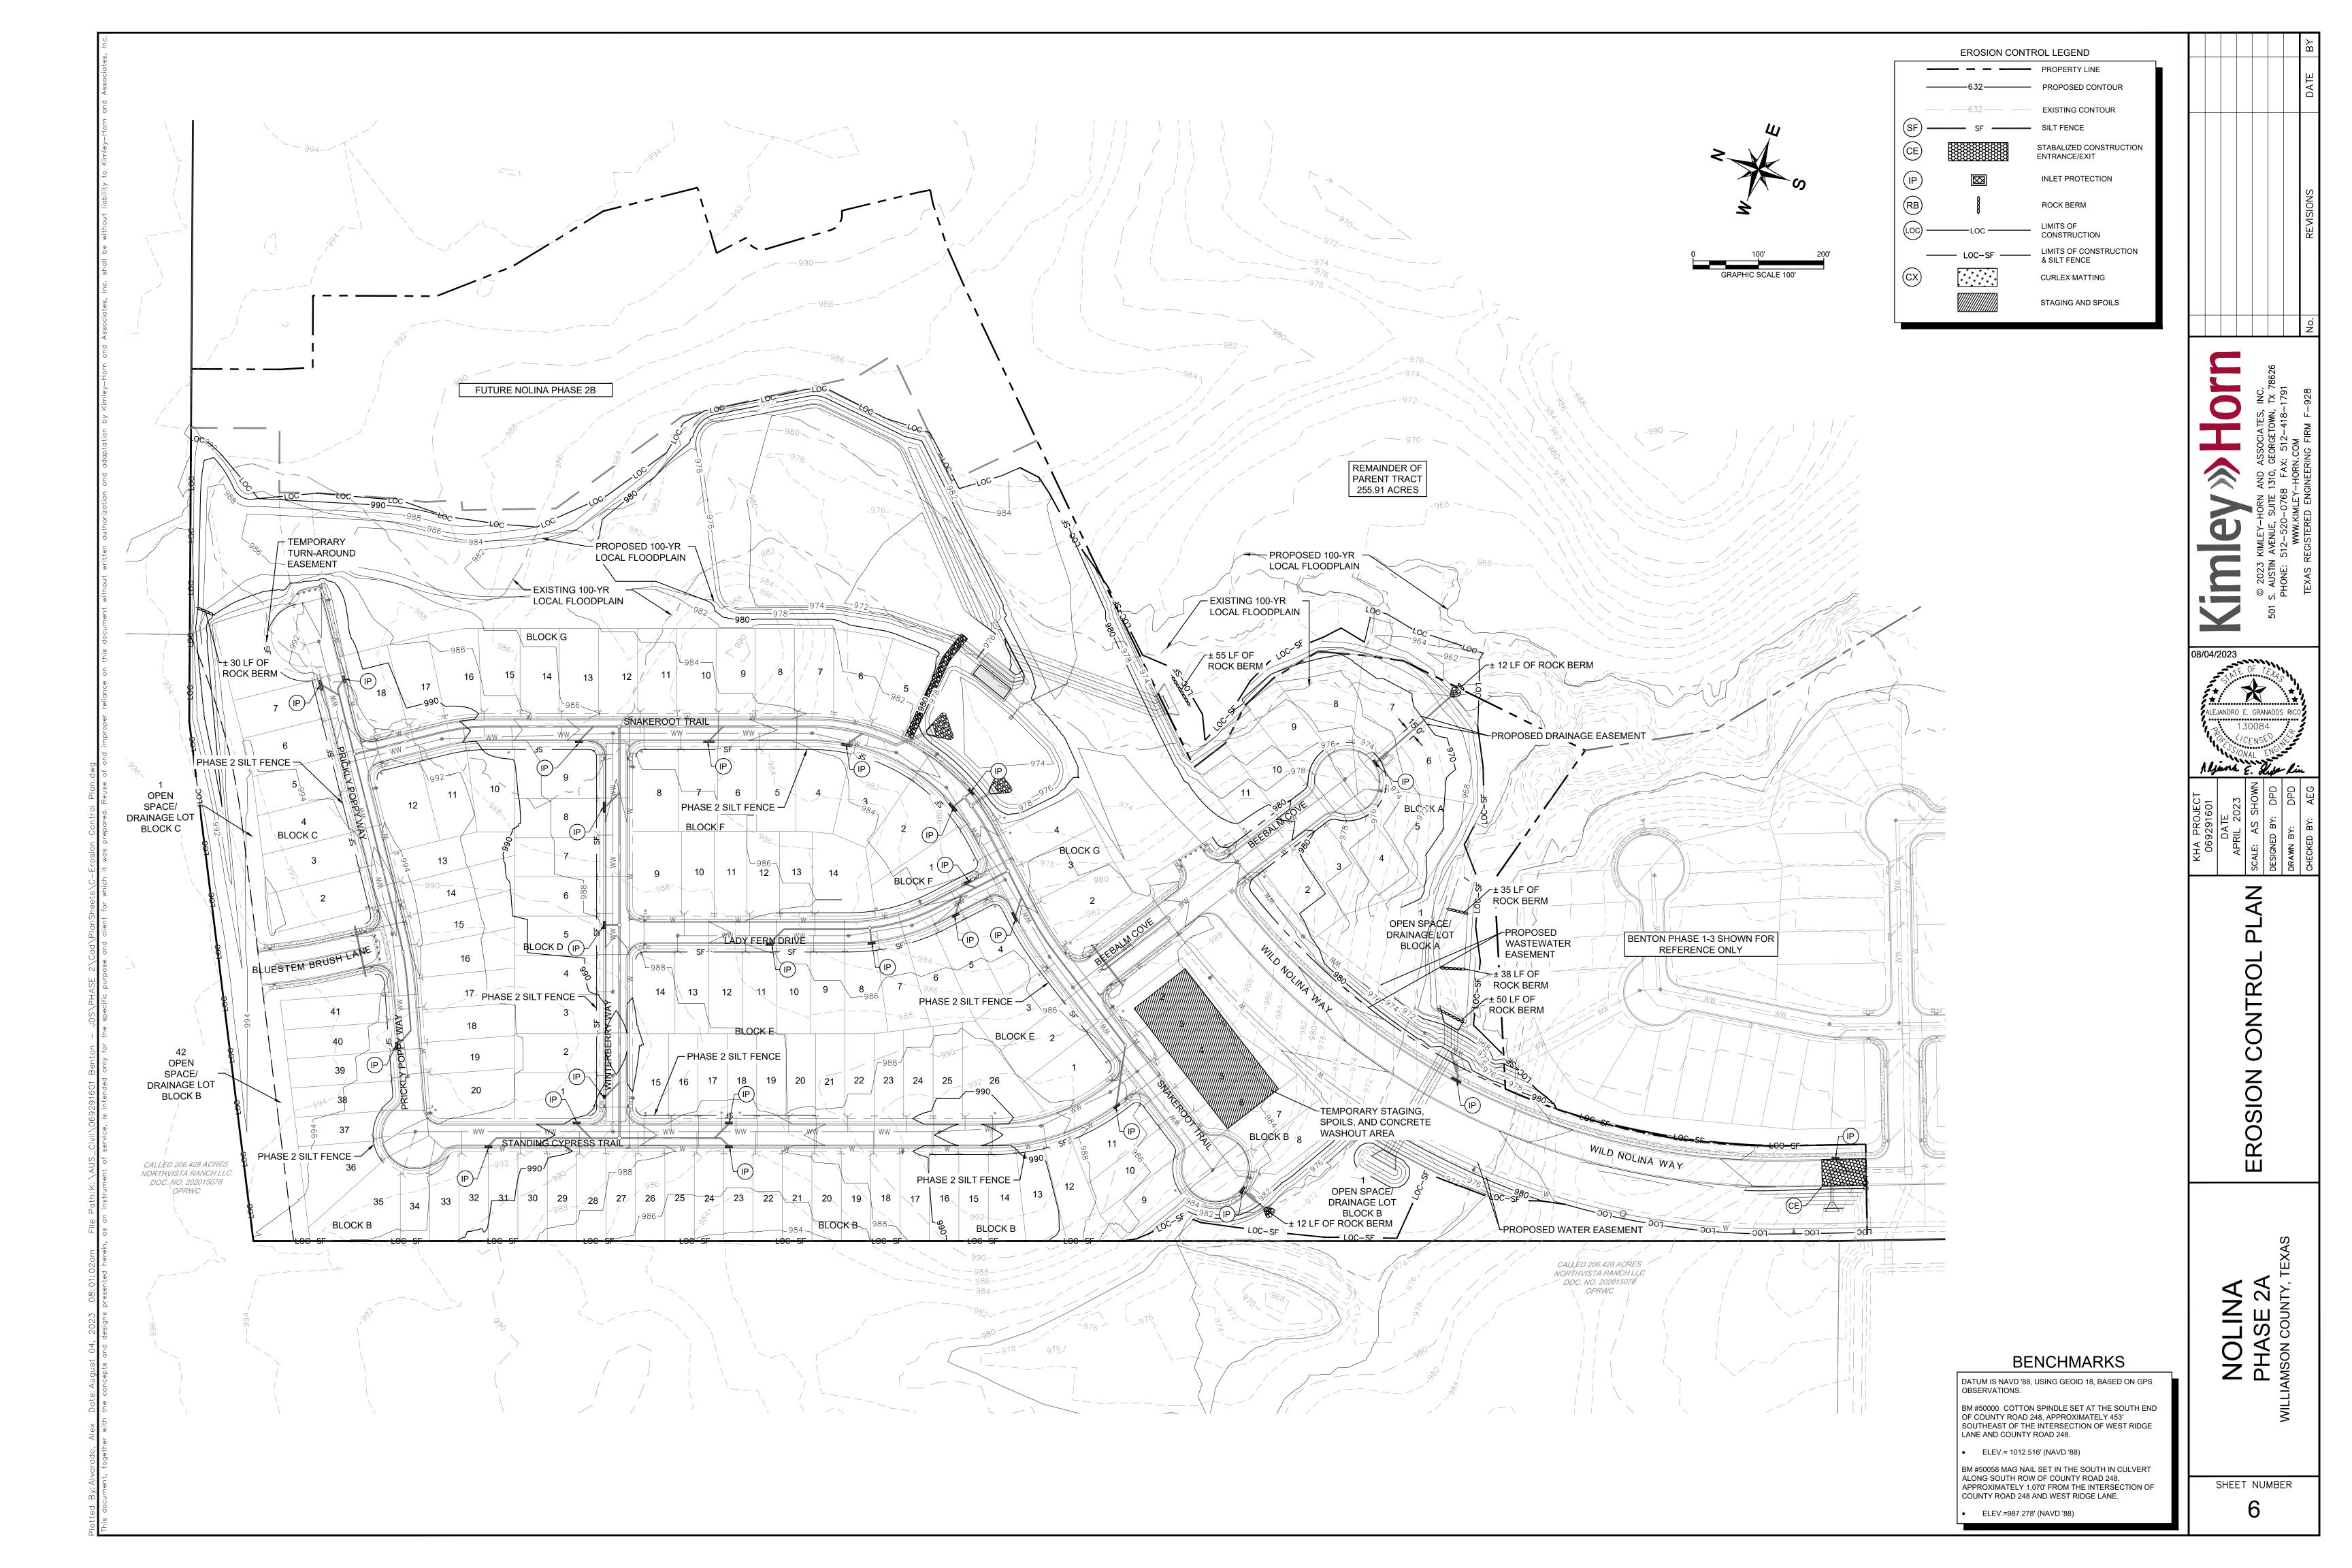


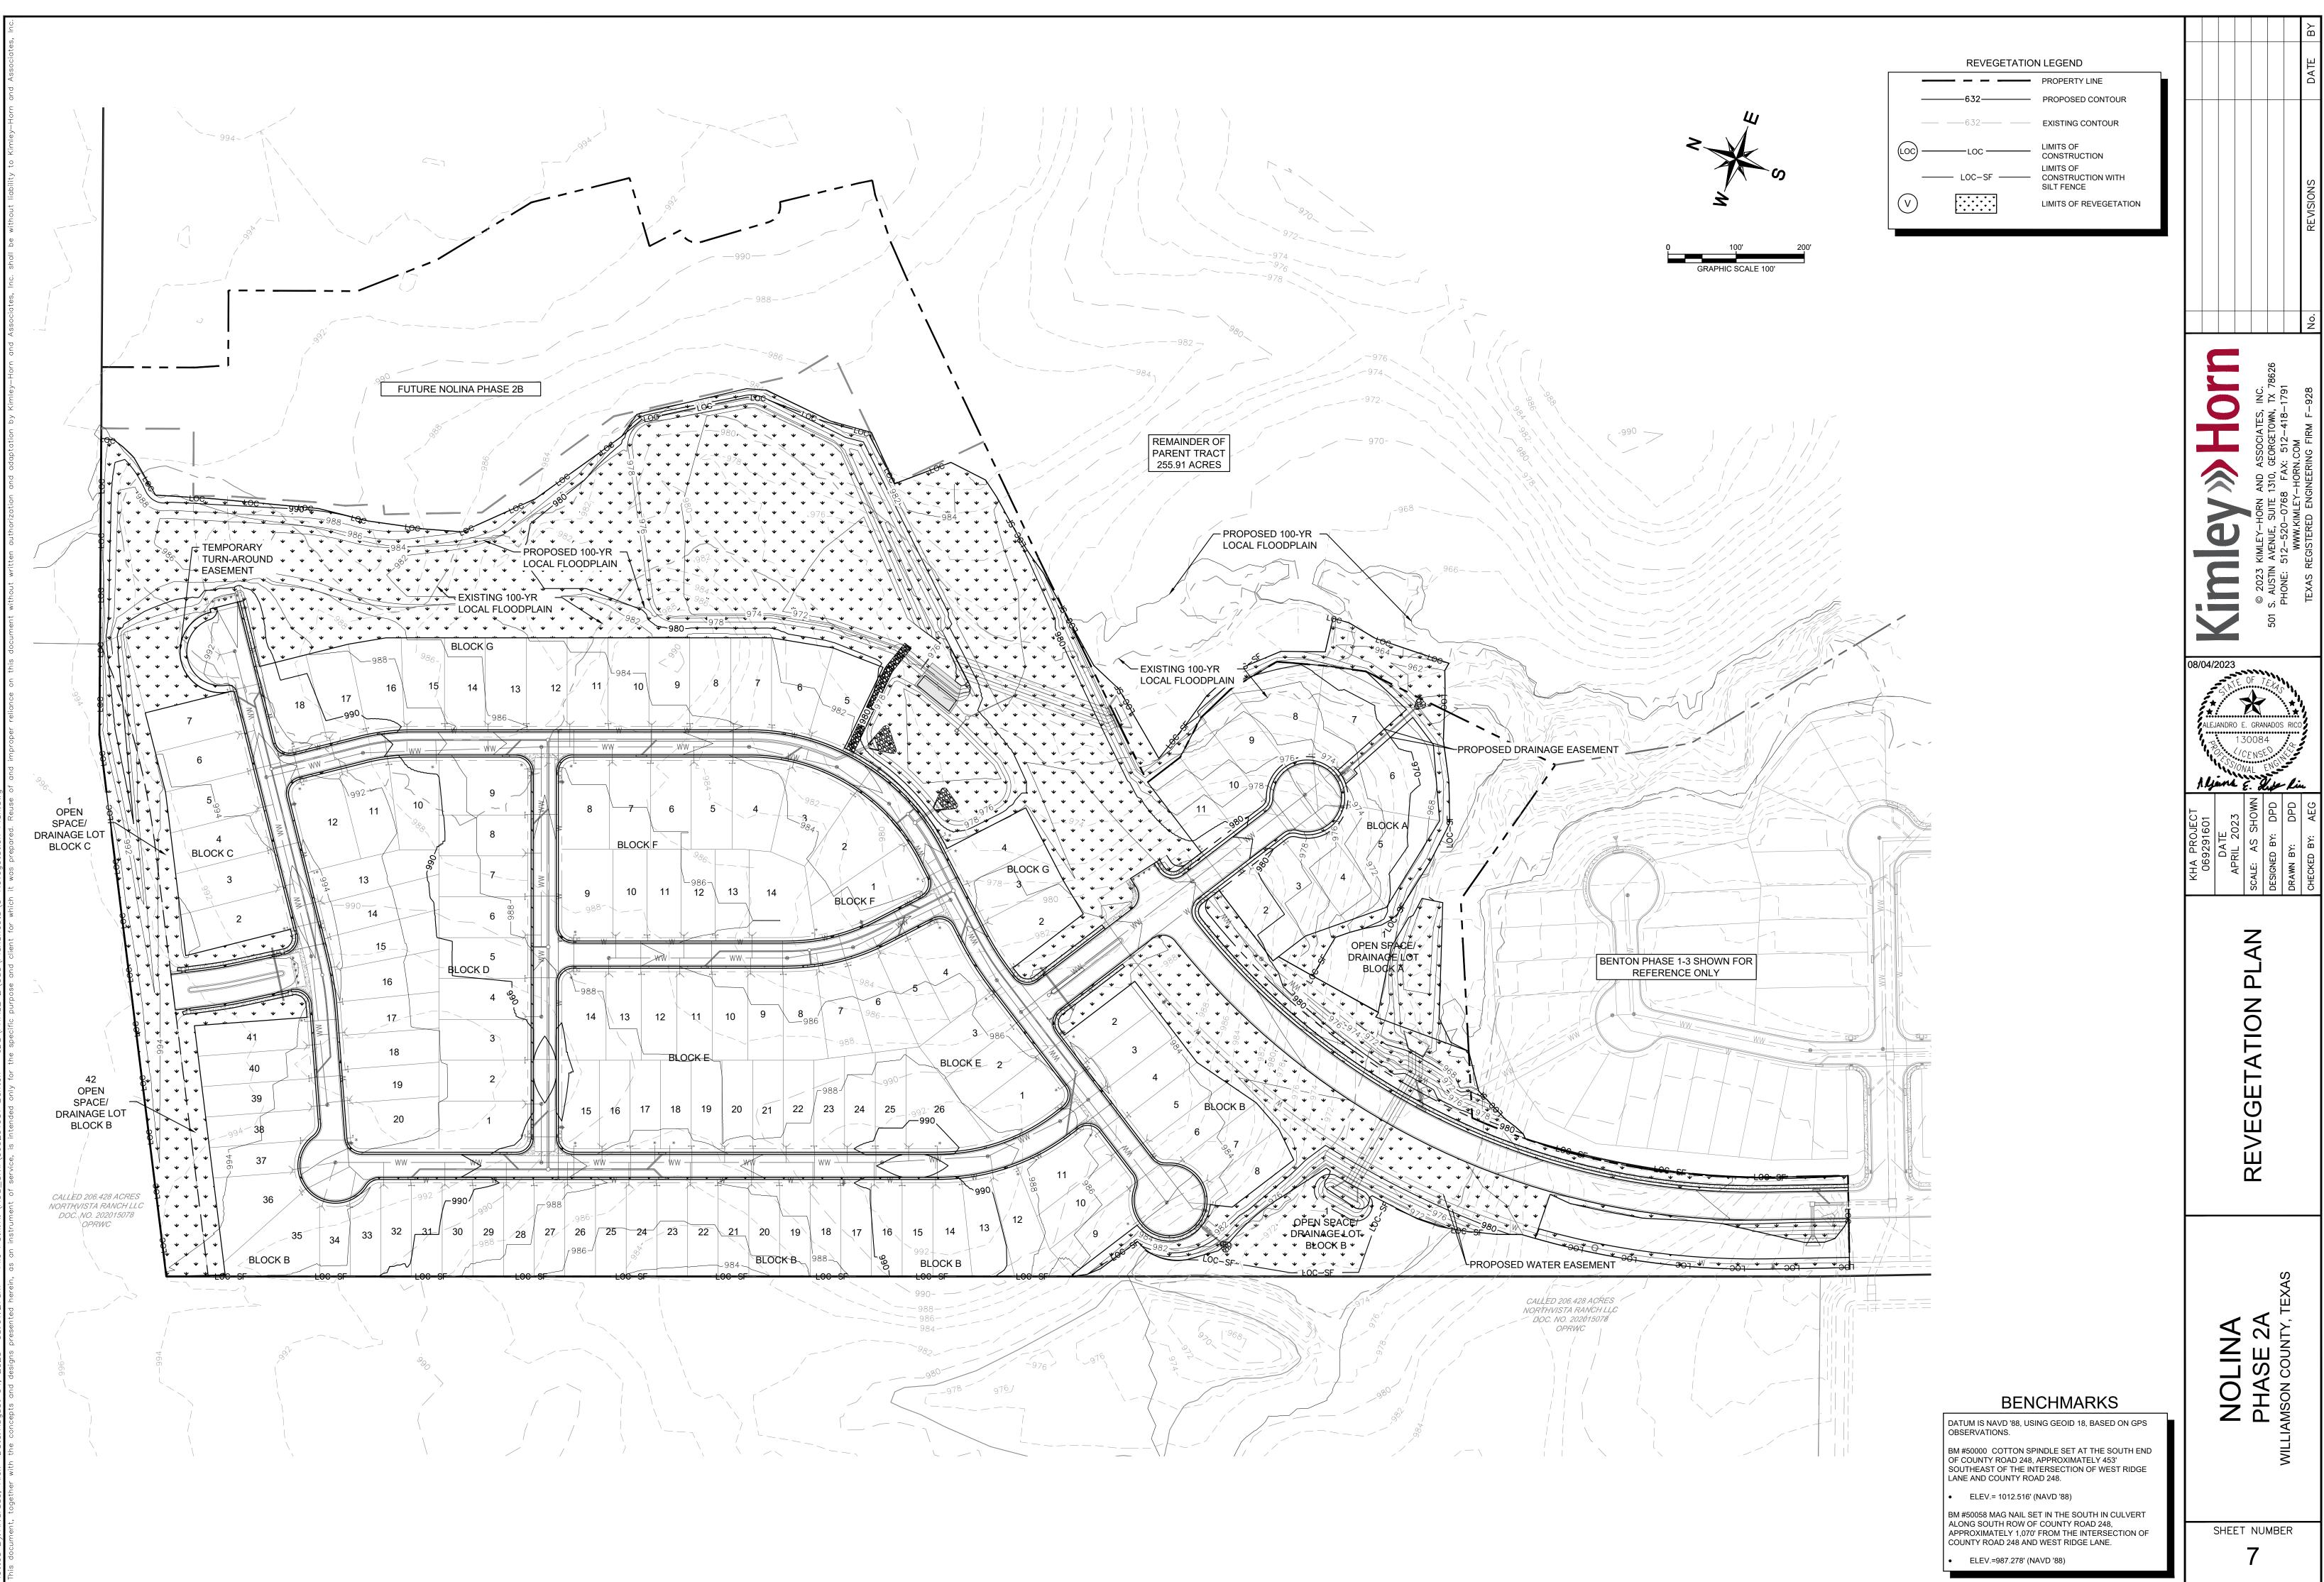

vtted By: Alvarado, Alex Date: August 04, 2023 08:01:27am File Path:K: \AUS_Civil\069291601 Benton - JDS\PHASE 2\Cad\PlanSheets\C-Revegetation Plan.dwg

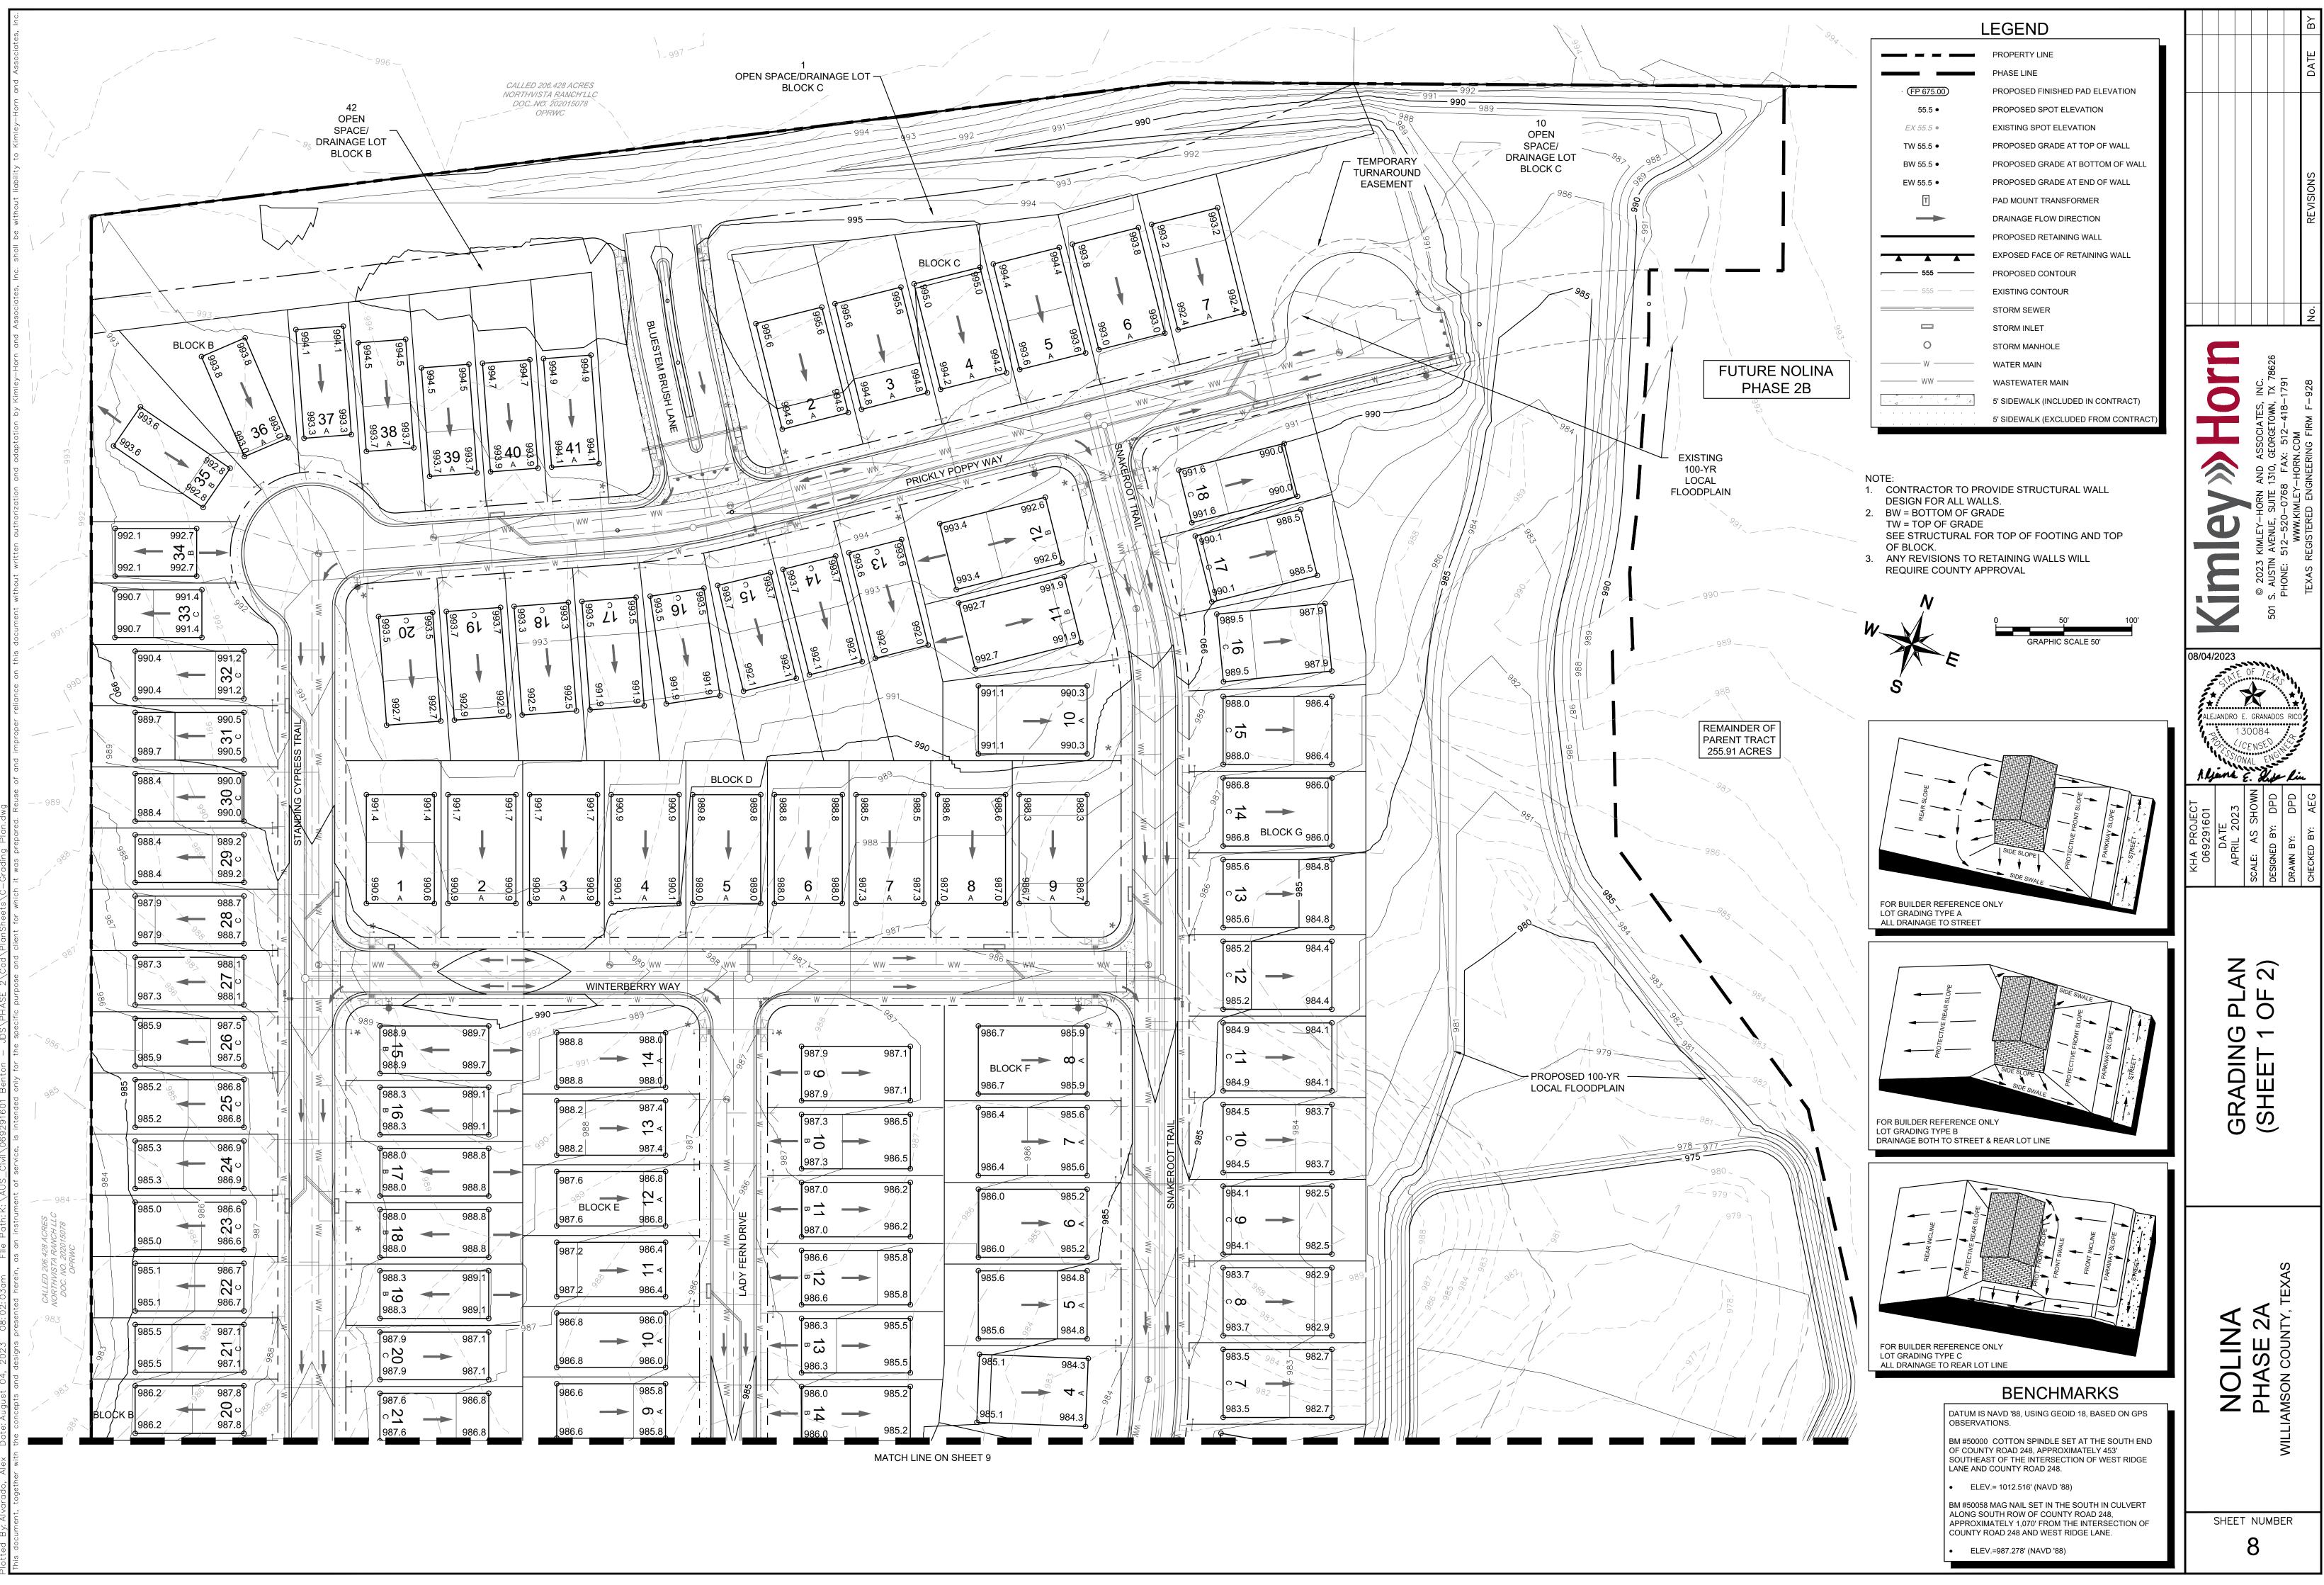

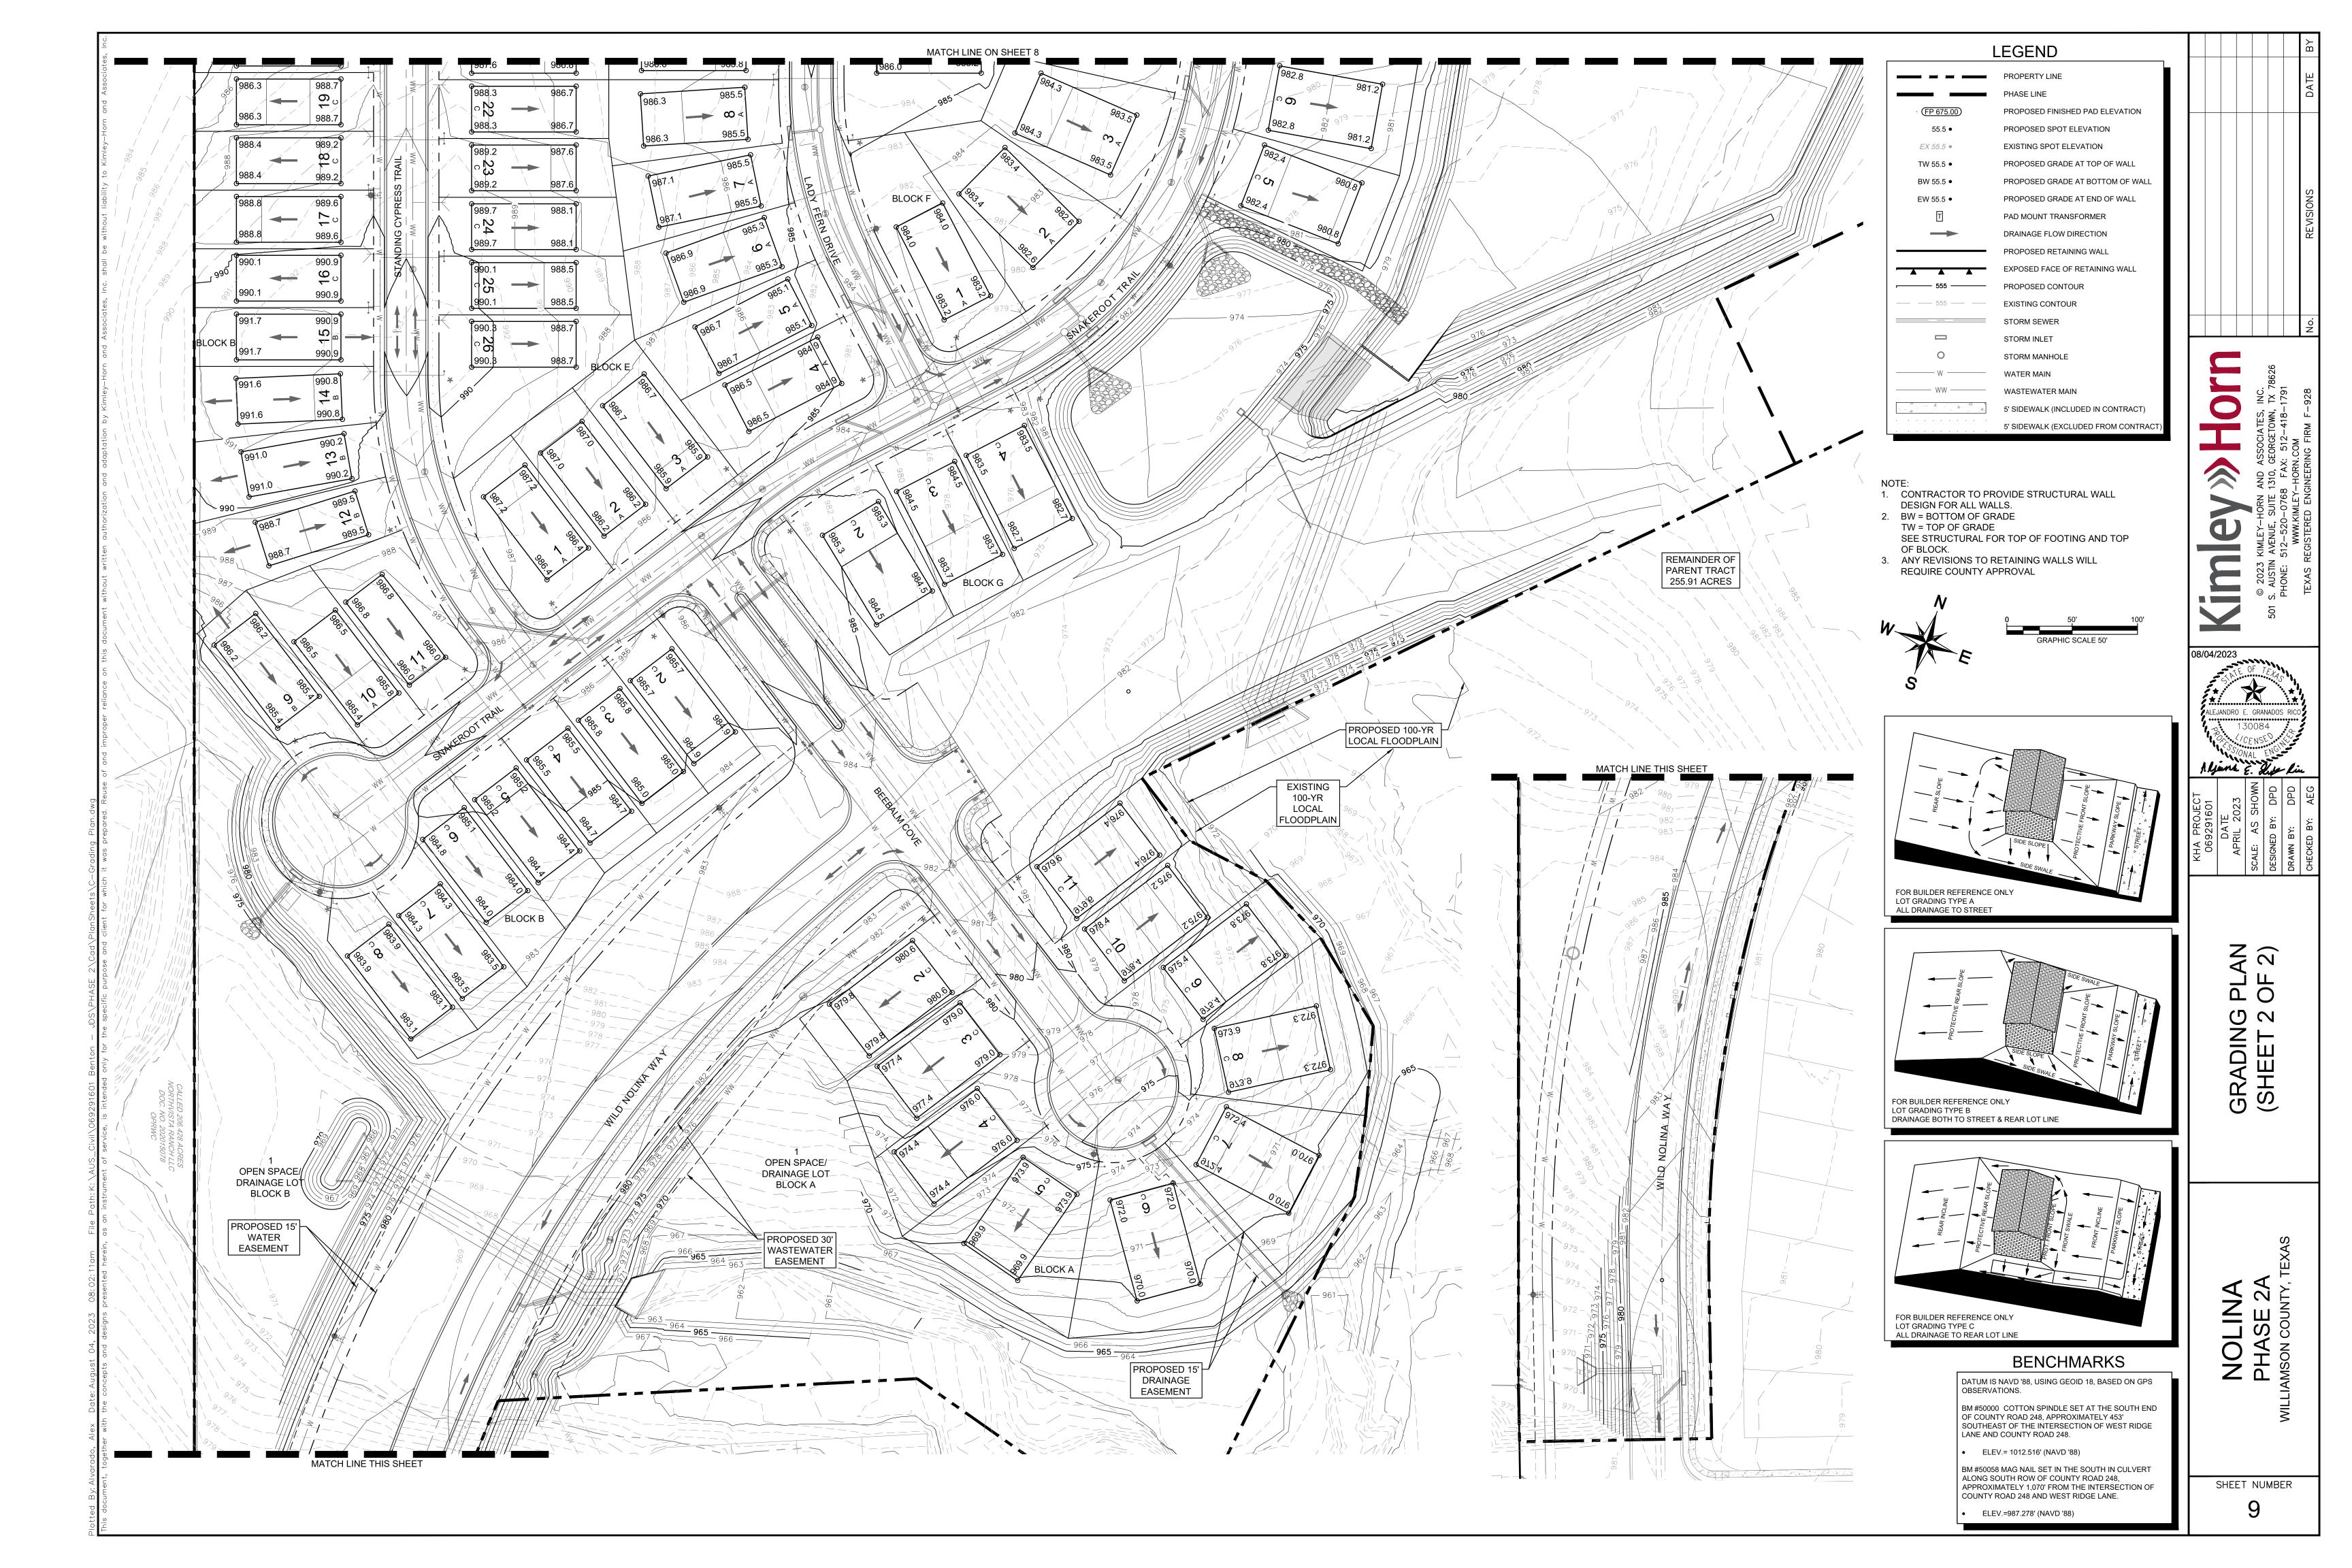

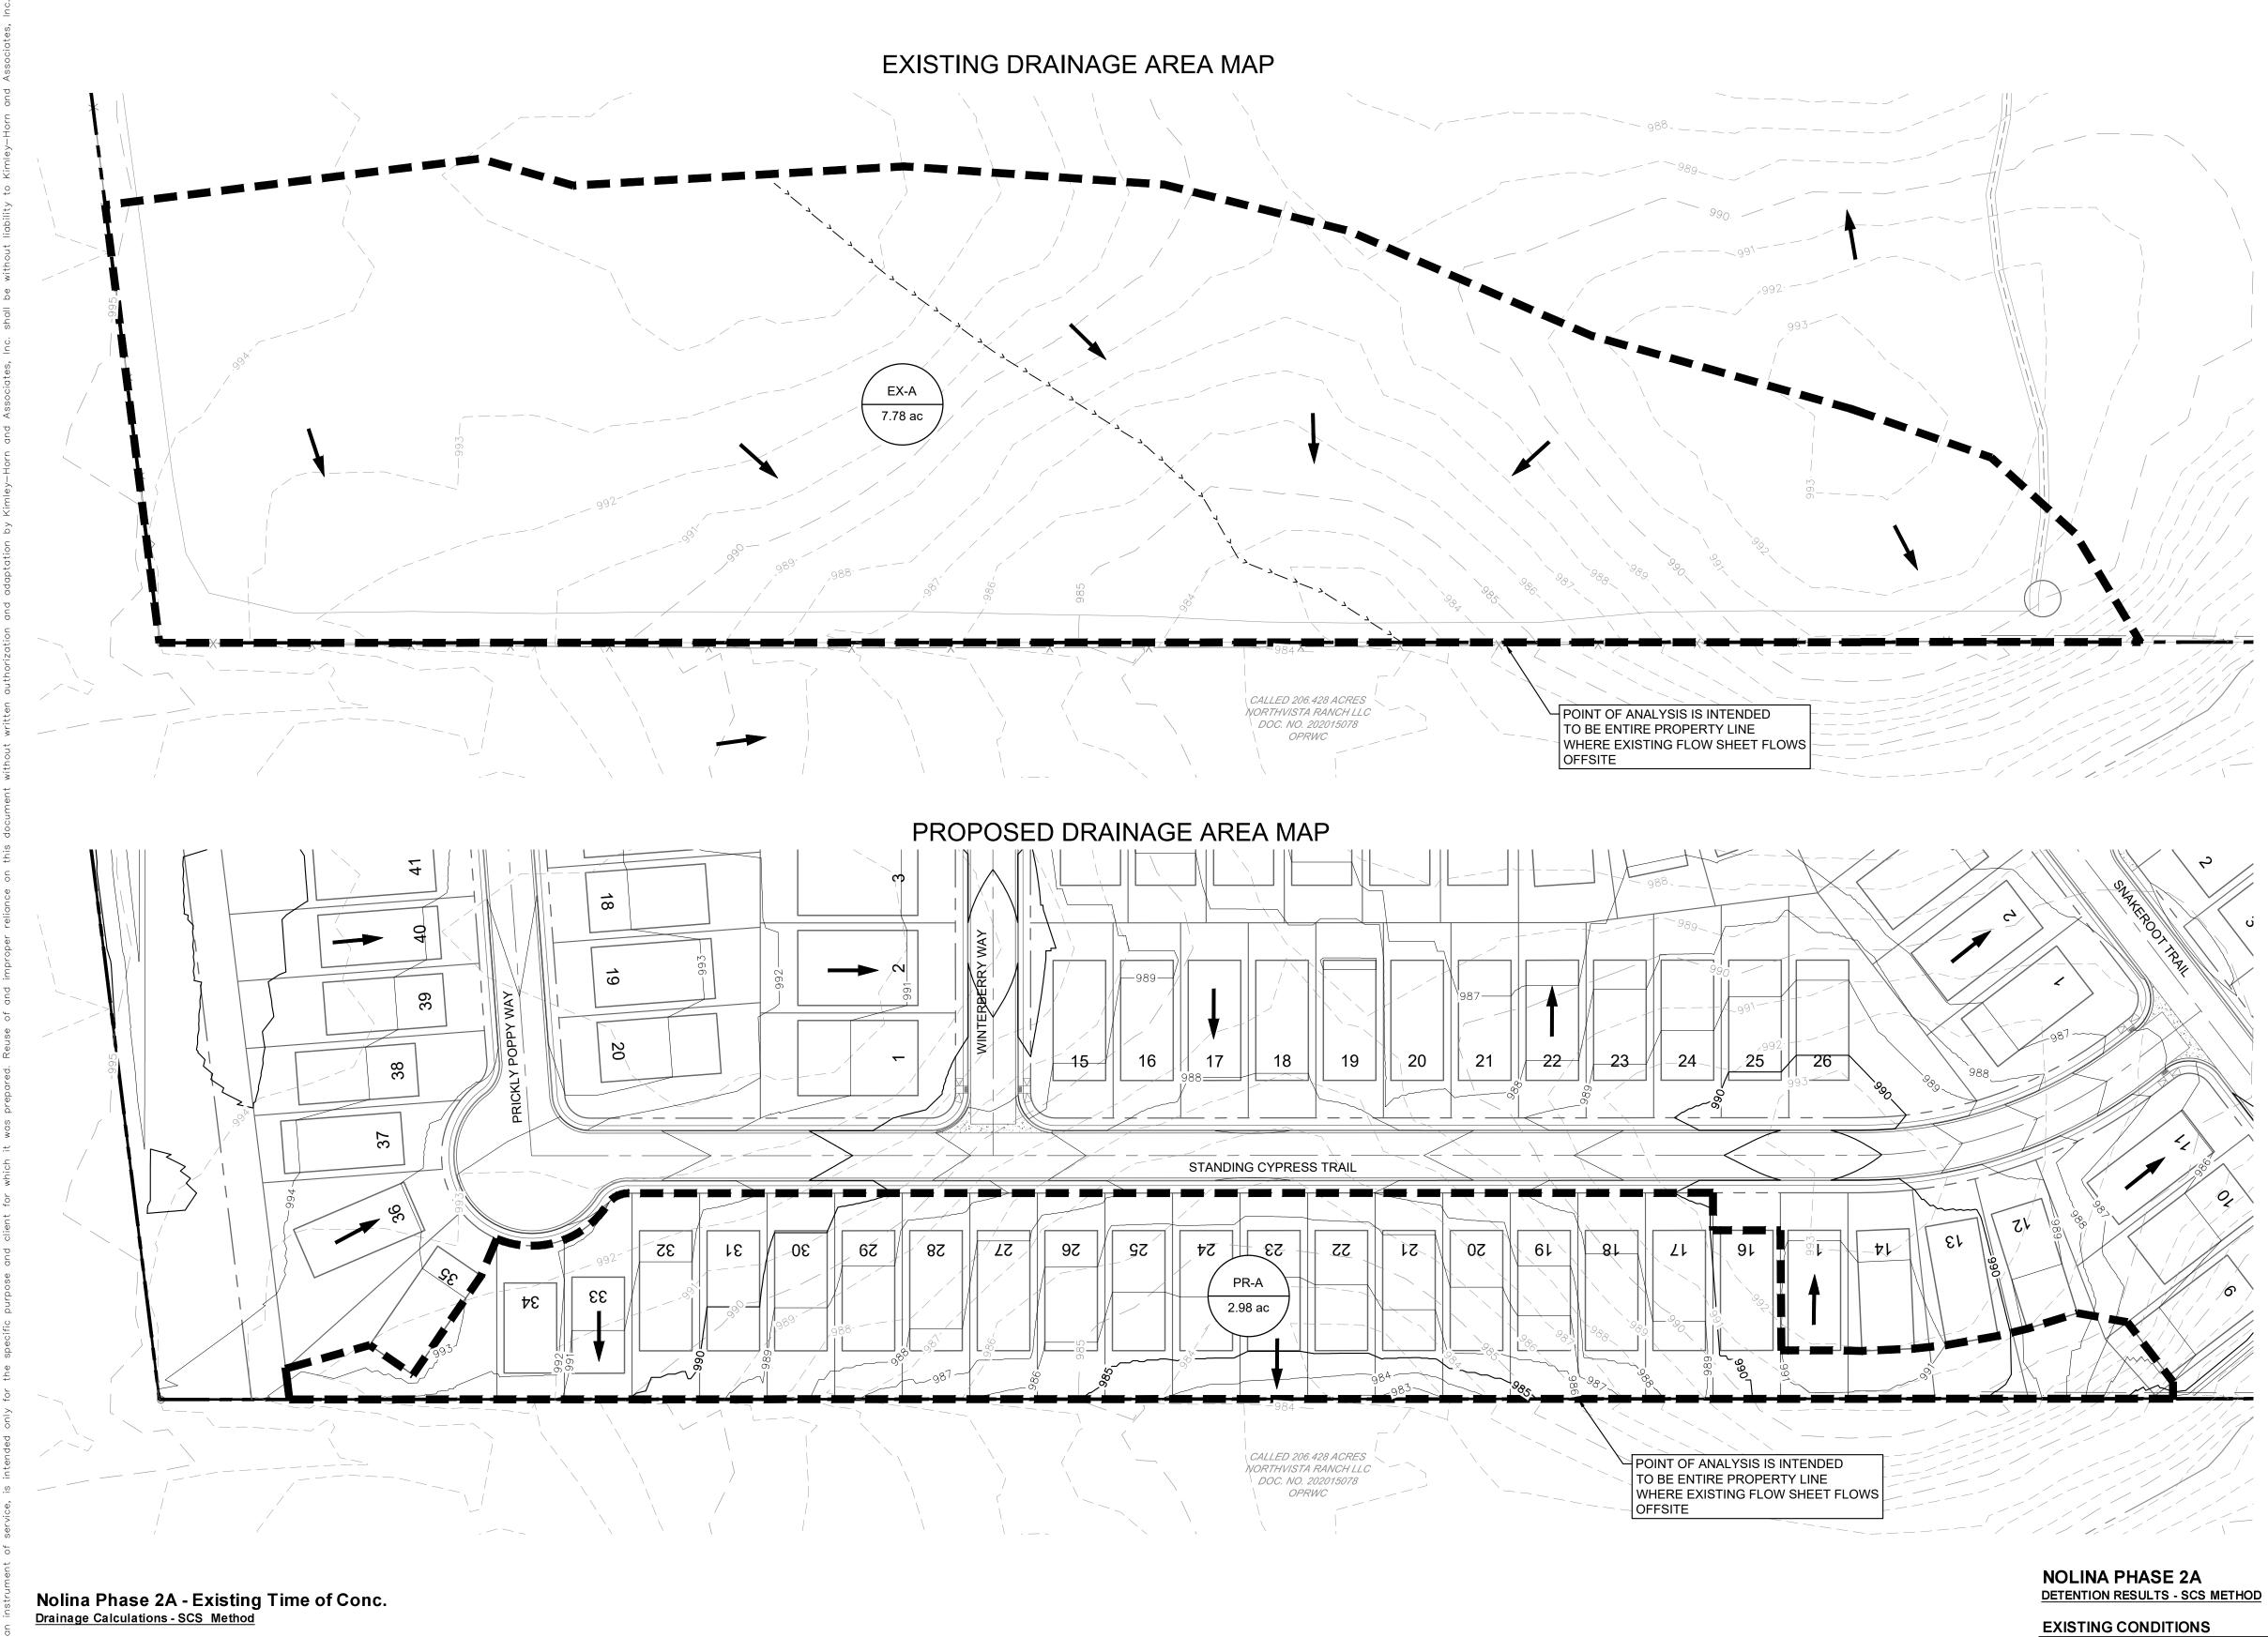

DRAINAGE AREA					PERVIOUS	WEIGHTED		SHEET FL	.000				NCENTRAT	ED FLOW					CHANNEL	- FLOW					FOTAL Tc**
DRAINAGE AREA			COVER	COVER	CURVE NO.	CURVE NO.		P-2yr24hr	3.92	IN		Gras	s Surface			Cha	nnel Flo	w			Cha	nnel Flo	ow 2		(min)
	(sf)	(Ac.)	(Ac.)	%	Cn*	Cn*	N	L (ft)	S (ft/ft)	Tt(min)	L (ft)	V (fps)	S (ft/ft)	Tt(min)	L (ft)	V (fps)	n "	S (ft/ft)	Tt(min)	L (ft)	V (fps)	n	S (ft/ft)	Tt(min)	
EX-A	338,684	7.78	0.00	0.00	82.00	82.00	0.15	100	0.010	11.68	424	2.60	0.026	2.72	0	6.0	0.040	0.025	0.00	-	-	0.035	-	0.00	14.40
The minimum Tc is 6 minutes per the TR-55.				-	-																				

Nolina Phase 2A - Proposed Time of Conc.
Drainage Calculations - SCS Method

	AREA	AREA	IMPERVIOUS	IMPERVIOUS	PERVIOUS	WEIGHTED		SHEET F	LOW		SHALLO	W CON	CENTRATE	ED FLOW				(CHANNEL	FLOW				Г	OTAL Tc**
DRAINAGE AREA			COVER	COVER	CURVE NO.	CURVE NO.		P-2yr24h	r 3.92	IN		Grass	Surface			Cha	nnel Flo	w			Р	ipe Flow			(min)
	(sf)	(Ac.)	(Ac.)	%	Cn*	Cn*	Ν	L (ft)	S (ft/ft)	Tt(min)	L (ft)	V (fps)	S (ft/ft)	Tt(min)	L (ft)	V (fps)	n T	S (ft/ft)	Tt(min)	L (ft)	V (fps)	n T	S (ft/ft)	ˈt(min)	
PR-A	129,809	2.98	1.37	45.97%	82.00	89.36	0.15	100	0.030	7.53	37	2.70	0.028	0.23	0	6.0	0.013	0.010	0.00	0	8.0	0.013	0.010	0.00	7.76

LEGEND

X-1

9.9 ac

A-1


0 \bigtriangleup

━►

— — 555 — —

AREA DESIGNATOR AREA IN ACRES

INLET NUMBER PROPERTY LINE PROPOSED STORM SEWER LINE EXISTING STORM SEWER LINE PROPOSED DRAINAGE DIVIDE PROPOSED STORM SEWER INLET PROPOSED STORM SEWER MANHOLE PROPOSED STORM SEWER HEADWAL PROPOSED FLOW DIRECTION PROPOSED CONTOUR EXISTING CONTOUR




		© 2023 KIMI FY-HORN AND ASSOCIATES. INC.	5	PHONE: 512-520-0/68 FAX: 512-418-1/91
08/04/	JANDRO	E. GRA 3008 /CENS	TEXAS INADOS 34 ENGI	G RI
KHA PROJECT 069291601	DATE APRIL 2023	SCALE: AS SHOWN	DESIGNED BY: DPD	DRAWN BY: DDD
			DRAINAGE AREA MAP	



CO	NDI	τιο	NS

Point of Analysis	Total Drainage Area (Acres)	Total Impervious Cover Area (acres)	Impervious Area (%)	Storm Event	Existing Runoff (cfs)
A	7.78	0.00	0.00%	2 10 25 100	19.96 36.55 47.79 65.84
PROPOSED C	ONDITIONS				
Point of Analysis	Total Drainage Area (Acres)	Total Impervious Cover Area (acres)	Impervious Area (%)	Storm Event	Developed Runoff (With Detention) (cfs)
A	2.98	1.37	45.97%	2 10 25 100	12.65 20.50 25.65 33.90
PROPOSED V	S. EXISTING C	OMPARISON			
Point of Analysis	Storm Event	Existing Runoff (cfs)	Developed Runoff (cfs)	Runoff Difference at Point of Analysis (cfs)	ls Developed ≤ Existing?
A	2 10 25 100	19.96 36.55 47.79 65.84	12.65 20.50 25.65 33.90	(7.31) (16.05) (22.14) (31.94)	YES YES YES YES

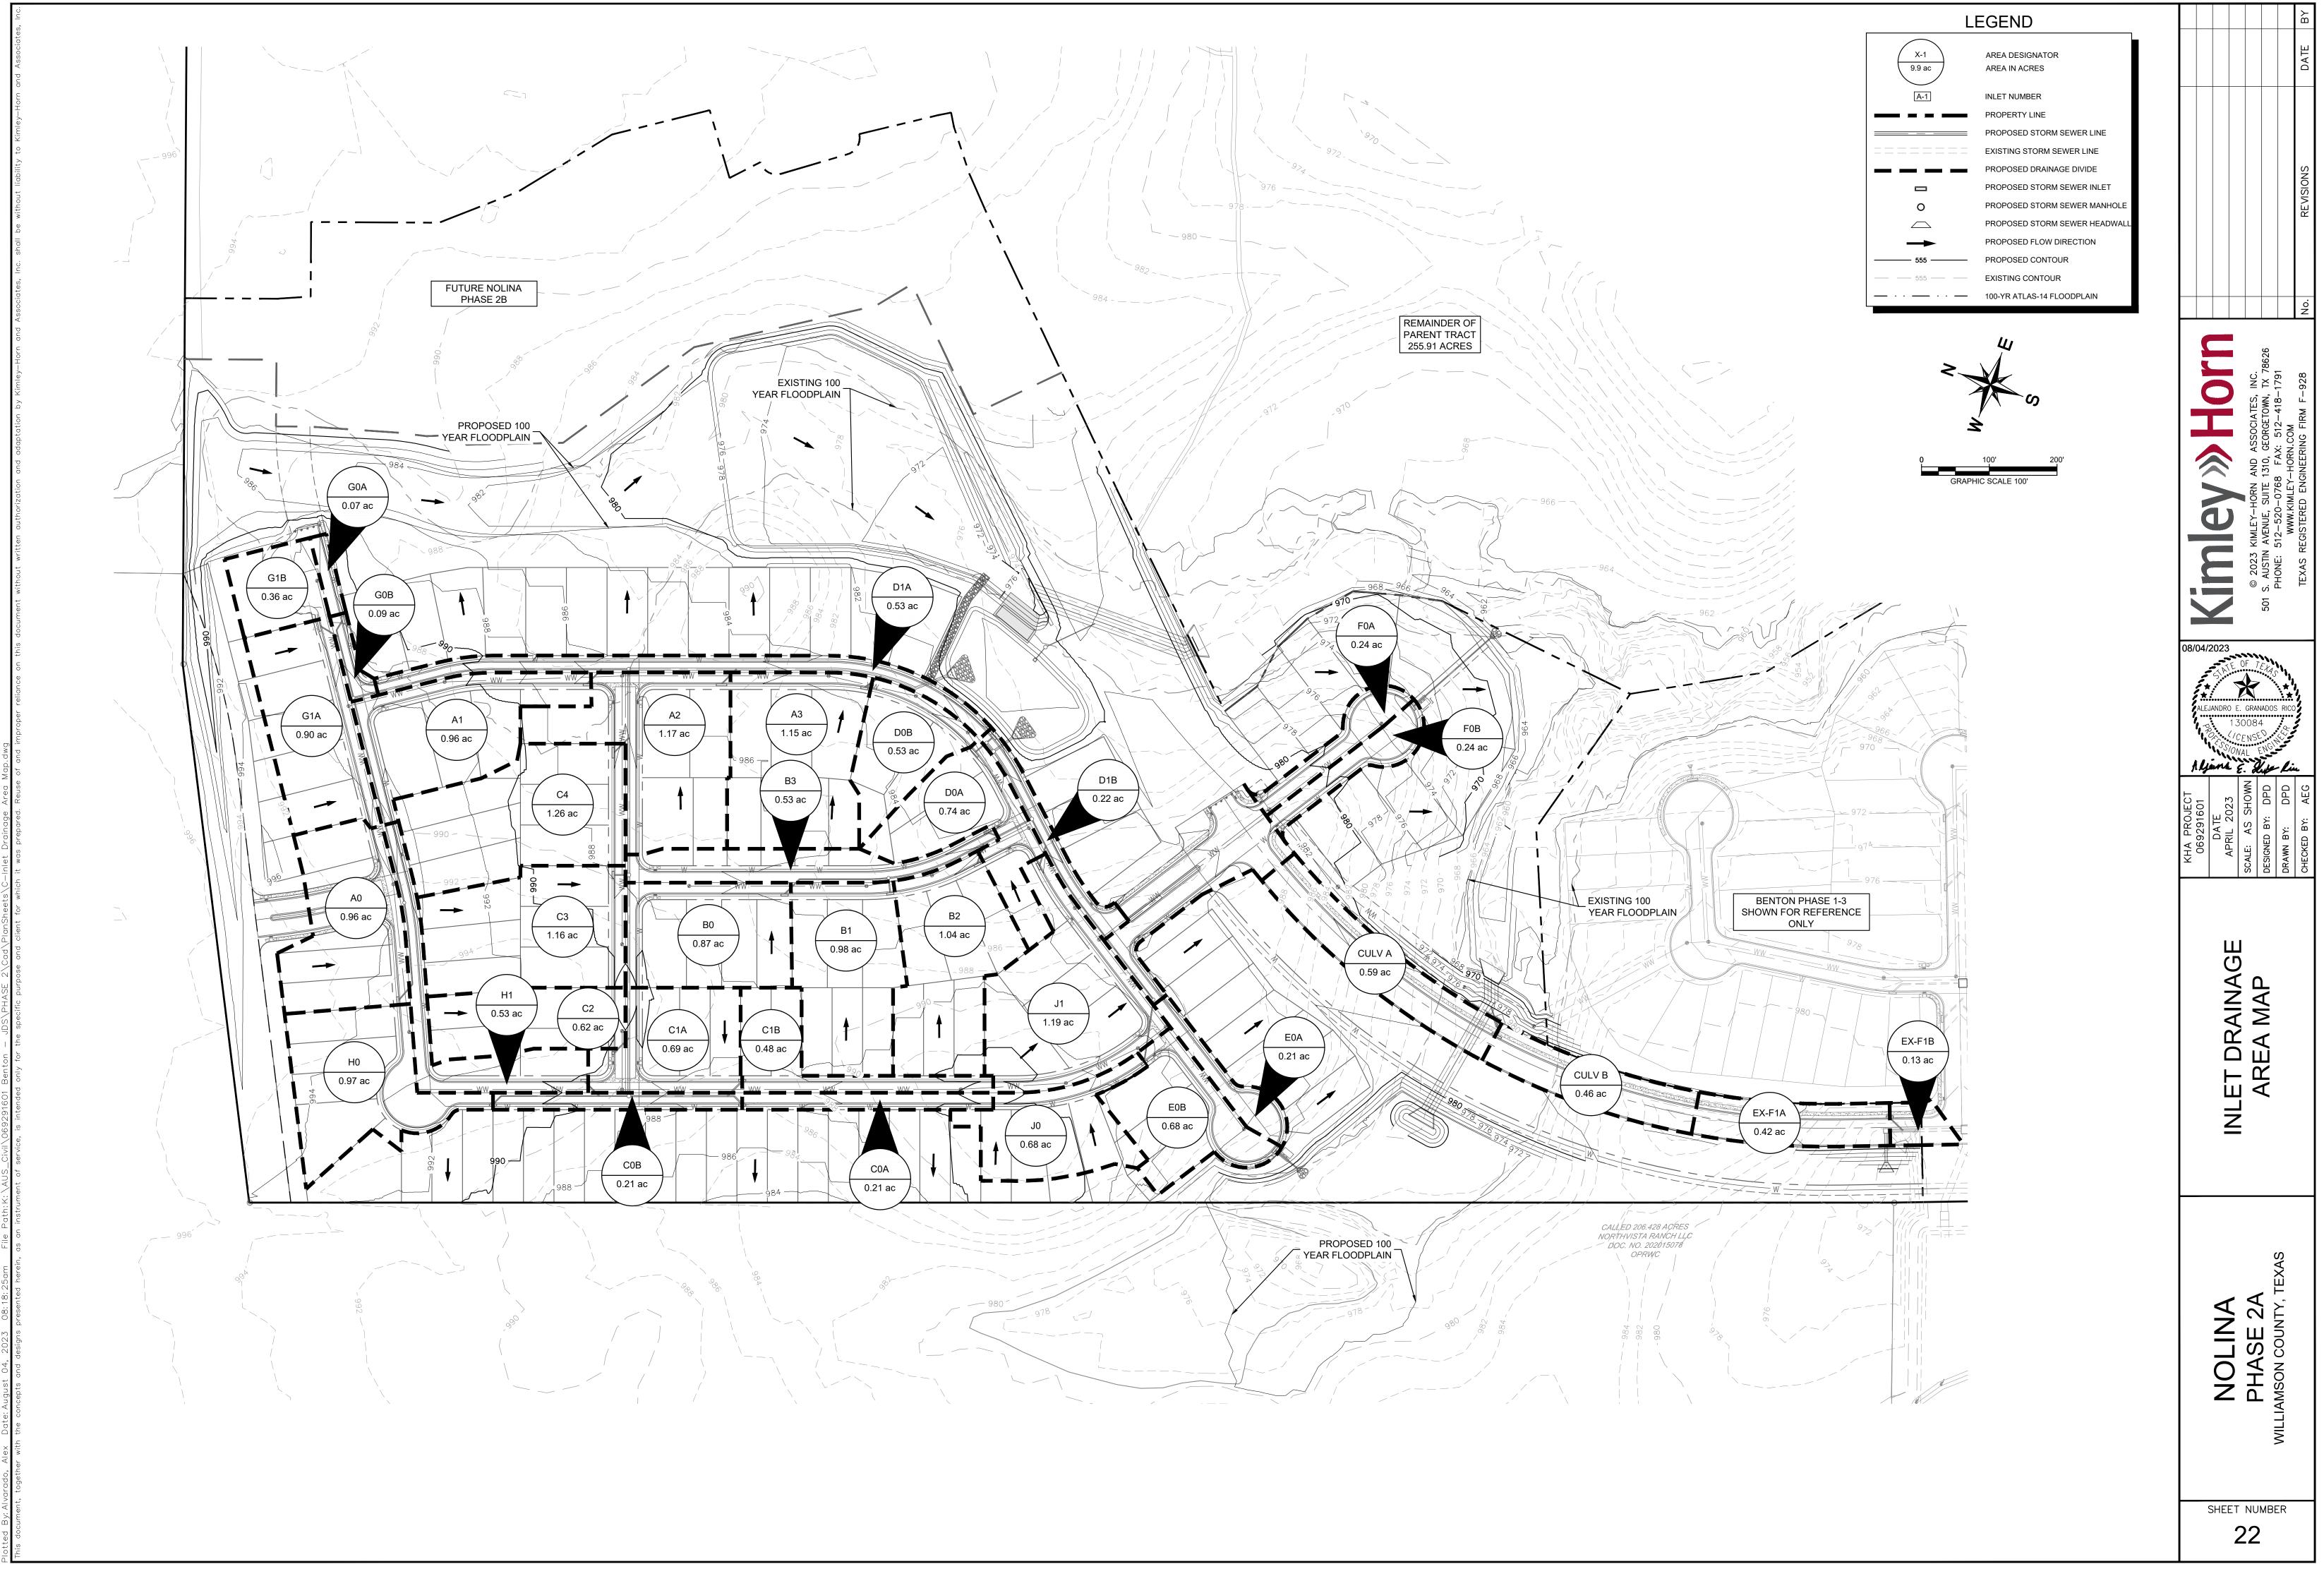

DRAINAGE AREA	AREA	AREA	Lots	SF of Lots	LF of Local	SF of Local	LF of Collector (Minor)	Collector	LF of Collector (Major)	SF of Collector (Major)	LF of Arterial	SF of Arterial	IMPERVIOUS COVER	IMPERVIOUS COVER	Comp. C ₂₅	Com C ₁₀₀		
A0 A1	(sf) 41630.6 41864.94	(Ac.) 0.96 0.96	3.00 3.00	10,650 13,050	267 547	5874 12034	135 0	3645 0	0	0	0	0	(sf) 20,169 25,084	% 48% 60%	0.63	0.71		
A2 A3 B0	51168.04 50308.7 37975.03	1.17 1.15 0.87	5.00 7.00 4.00	20,150 27,250 14,200	475 211 400	10450 4642 8800	0 0 0 0	0 0 0	0 0 0	0 0 0	0 0 0 0	0 0 0	30,600 31,892 23,000	60% 63% 61%	0.68 0.70 0.69	0.76	3 3	
B1 B2	42508.94 45382.46	0.98 1.04	6.00 6.00	20,100 20,100	151 133	3322 2926	0 0	0	0	0	0	0	23,422 23,026	55% 51%	0.66 0.64	0.74	k 2	
B3 C0A C0B	22932.96 9263.90 9195.93	0.53 0.21 0.21	0.00 0.00 0.00	0 0 0	606 371 367	13332 8162 8074	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	13,332 8,162 8,074	58% 88% 88%	0.67 0.82 0.82	0.76 0.91 0.91		
C1A C1B C2	29982.73 20963.48 26830.82	0.69 0.48 0.62	3.00 2.00 3.50	9,450 6,300 13,800	447 371 90	9834 8162 1980	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	19,284 14,462 15,780	64% 69% 59%	0.71 0.73 0.68	0.79 0.81 0.76		
C3 C4 D0A	50510.87 54933.2 32181.85	1.16 1.26 0.74	6.00 6.00 1.50	23,700 23,700 5,550	180 180 333	3960 3960 7326	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	27,660 27,660 12,876	55% 50% 40%	0.66 0.64 0.59	0.74	2	
D0B D1A D1B	22906.25 23298.59 9581.12	0.53 0.53 0.22	1.50 0.00 0.00	6,700 0 0	184 919 350	4048 20218 7700	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	10,748 20,218 7,700	47% 87% 80%	0.62 0.82 0.78	0.70)	
E0A E0B F0A	9147.76 29795.2 10388.41	0.21 0.68 0.24	0.00 3.00 0.00	0 10,250 0	395 469 0	8690 10318 0	0 0 369	0 0 9963	0 0 0	0 0 0	0 0 0	0 0 0	8,690 20,568 9,963	95% 69% 96%	0.86 0.73 0.86	0.94	k 	
F0B G0A	10669.34 2999.66	0.24 0.07	0.00 0.00	0 0	0 120	0 2640	369 0	9963 0	0	0	0 0	0	9,963 2,640	93% 88%	0.85	0.94	<u> </u>	
G0B G1A G1B	3788.78 39380.22 15600.85	0.09 0.90 0.36	0.00 5.00 2.00	0 21,750 8,700	160 318 120	3520 6996 2640	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	3,520 28,746 11,340	93% 73% 73%	0.85 0.75 0.75	0.93 0.83 0.83	<u>}</u>	
H0 H1 J0	42172.55 23170.77 29439.19	0.97 0.53 0.68	4.00 0.50 4.00	12,600 2,000 12,600	514 651 226	11308 14322 4972	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	23,908 16,322 17,572	57% 70% 60%	0.67 0.74 0.68	0.75 0.82 0.76	2	
J1 CULV A CULV B	51923.86 25844.45 20115.55	1.19 0.59 0.46	4.00 0.00 0.00	13,800 0 0	603 0 0	13266 0 0	0 0 0	0 0 0	0 412 321	0 18952 14766	0 0 0	0 0 0	27,066 18,952 14,766	52% 73% 73%	0.65 0.75 0.75	0.73 0.83 0.83	3	
EX-F1A EX-F1B	18170.74 5445.95	0.42 0.13	0.00 0.00	0	0 0	0 0	0	0 0	289 90	13294 4140	0 0	0 0	13,294 4,140	73% 76%	0.75 0.76	0.83 0.85		
n ight Crown Inlet Inlet No. Type A0 Grade	Area No.	Street Wid (FOC - FOO 32') (cfs) 0 5.53	(c)	Pass Q fs) (Qa 00 (Total Si a) (cfs) (5.53 1.0	FLOW (bppe %) (i 00% 5	a yo n.) (ft. 5.0 0.27	ATION T Ponde Width (4 13.69	ABLE (25-Yr Fl R.F. (%) 10	Qa/La La (ft) 0.73 7.62	Length L/La (ft) 10 1.31	a/yo 1.52	Q/Qa 1.00	Q (cfs) 5.53	Q Pass (cfs) 0.00
InletInletNo.TypeA0GraduA1GraduA2GraduB0GraduB1GraduB2GraduB3GraduC0ASum	Area No. Area No. Al Bl	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	 (%) 2.0 	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 6.14 0 3.28 0 1.61	(c: 0. 0. 0. 0. 0. 0. 0. 0. 0.	Pass Q fs) (Qa 00 5	Total Sk a) (cfs) (' 5.53 1.0 6.06 0.8 7.40 0.8 5.52 1.1 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.8	FLOW (i 00% 5 30% 5 30% 5 30% 5 30% 5 50% 5 50% 5 50% 5 50% 5 50% 5 50% 5 50% 5 50% 5	a yo in.) (ft. 5.0 0.27 5.0 0.31 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32	Ponde Width (4 13.69 15 14.77 8 15.92 9 15.97 19 13.44 10 16.01 14 16.21	ABLE ((25-Yr Fl R.F. (%)	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCU	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.23 110 1.30 10 1.27 10 2.16 ULATIONS BELOW			(cfs)	(cfs)
InletInletNo.TypeA0GraduA1GraduA2GraduB0GraduB1GraduB2GraduB3Gradu	Area No. Area No. Al Bl Cl	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 6.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.41 0 3.99	(c: 0. 0. 0. 0. 0. 0. 0. 0. 0. 0. 0. 0. 0.	Pass Q fs) (Qa 00 (Qa	Total Single a) (cfs) (" 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 6.14 0.5 1.61 1.6 1.60 2.0 3.28 1.6 3.28 1.6 1.61 1.8 3.23 1.6 3.23 1.6 3.85 1.9 7.04 1.8 7.41 0.5	Pope (i %) (i 00% 5 30% 5 30% 5 30% 5 50% 5	a yo n.) (ft. 5.0 0.27 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.26 5.0 0.226 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42	ABLE ((25-Yr Fl R.F. (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCUSEE SUMP CALCUSE SEE SUMP CALCUSEE SUMP CALCUSE SEE SUM	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 5 0.86 10 1.02 15 1.63 ULATIONS BELOW ULATIONS BELOW	1.52 1.41 1.31 1.30 1.55 1.30 1.29	1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14	(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.
InletInletNo.TypeA0GraddA1GraddA2GraddA3GraddB0GraddB1GraddB2GraddB3GraddB3GraddC0BSumC1BSumC1BSumC2GraddC3GraddD0BSumD1ASumE0BSumF0ASumG0ASumG0BSum	Area No. Area No. All Bl Bl Bl Bl Bl Bl Classic Classic All	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.54 0 5.54 0 5.54 0 5.54 0 5.54 0 6.14 0 3.28 0 1.61 0 4.60 0 7.04 0 7.04 0 3.99 0 3.01 0 4.62 0 1.59 0 1.89 0 1.92 0 0.52 0 0.68	(c: 0. 0. 0. 0. 0. 0. 0. 0. 0. 0. 0. 0. 0.	Pass Q 00 (Qa) 00	Total Single a) (cfs) (" 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.8 4.02 0.8 1.59 1.6 1.60 4.0 1.59 1.6 1.60 4.0 1.92 4.0 0.52 0.5 0.68 0.5	Pope (i) %) (i) 00% 5 30% 5 30% 5 50% 5 <	a yo n.) (ft. 5.0 0.27 5.0 0.31 5.0 0.32	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42	ABLE ((%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCH SEE SUMP CALCH	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 5 0.86 10 1.02 15 1.63 ULATIONS BELOW	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.97	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04	(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.
InletInletNo.TypeA0GraddA1GraddA2GraddA3GraddB0GraddB1GraddB2GraddB3GraddB3GraddC0BSumC1BSumC1BSumC2GraddC3GraddC4GraddD0ASumD1BSumD1BSumF0ASumG0ASumG1ASumG1BSumH0GraddH1Gradd	Area No. Area No. Alta Blata Blata Blata Blata Blata Alta A	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0	(cfs) 0 5.53 0 6.06 0 7.40 0 7.40 0 7.46 0 5.52 0 6.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.99 0 3.01 0 4.60 0 1.59 0 1.68 0 1.92 0 0.52 0 0.52 0 0.52 0 0.52 0 0.68 0 2.47 0 5.96 0 3.61	(c) (c) (c) (c) (c) (c) (c) (c) (c) (c)	Pass Q fs) (Qa) 00 (Qa) 00	Total Single a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.8 4.02 0.8 1.59 1.6 1.66 4.0 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5	ELOW (i) %) (i) 00% 5 30%	a yo n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.34 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28	ABLE (25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW<	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 5.96 3.61	(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.
InletInletNo.TypeA0GraddA1GraddA2GraddA3GraddB0GraddB1GraddB2GraddB3GraddB3GraddC0BSumC1BSumC1BSumC2GraddC3GraddC4GraddD0BSumD1BSumD1BSumF0ASumG0ASumG1BSumG1BSumG1BSumG1ASumJ1GraddJ1GraddJ1GraddJ1GraddJ1GraddJ1GraddJ1GraddJULV BSum	Area No. Area No. A0 A1 A2 A3 B0 B1 B2 B3 C0A C0A C0B C1B C2 C3 C4 C0A C0B C1A C1B C2 C3 C4 D0A D0B D1A D1B E0A	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.94 0 6.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.41 0 3.99 0 3.01 0 4.60 0 1.59 0 1.62 0 1.92 0 0.52 0 0.52 0 0.52 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 3.19	(c) (c) (c) (c) (c) (c) (c) (c) (c) (c)	Pass Q 00 (Qa) 00	Total Single a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 3.23 1.6 3.85 1.9 7.04 1.8 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 4.25 0.5 3.19 1.5	ELOW (i) %) (i) 00% 5 30%	a yo n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 16 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW<	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41	(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.
Inlet Inlet No. Type A0 Gradu A1 Gradu A2 Gradu A3 Gradu B0 Gradu B1 Gradu B2 Gradu B3 Gradu C0A Sum C1B Sum C1B Sum C1B Sum C1B Sum C1B Sum C1B Sum D0A Sum D1B Sum D1B Sum G0A Sum G0B Sum G0B Sum G1B Sum G1B Sum J0 Gradu J1 Gradu J2 Gradu J3 Gradu G1B Sum J1 Gradu J2 Gradu J3 Gradu J4 Gradu J1 Gradu <t< td=""><td>Area No. Area No. Alta Bla Bla</td><td>(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'</td><td>(%) 2.0 2</td><td>(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.94 0 6.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.41 0 3.99 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.52 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 3.19 0 2.88</td><td>(c: 0.1</td><td>Pass Q 00 (Qa) 00</td><td>Total Sin a) (cfs) (") 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.8 4.02 0.8 1.59 1.6 1.66 4.0 4.02 0.8 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 4.25 0.5 3.19 1.5 2.88 0.5</td><td>Pope (i) %) (i) 00% 5 30% 5 30% 5 50%</td><td>a yoo n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32</td><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW 10 1.30 10 1.73 10 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW <t< td=""><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 5.96 3.61 4.25</td><td>(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.</td></t<></td></t<>	Area No. Area No. Alta Bla	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.94 0 6.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.41 0 3.99 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.52 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 3.19 0 2.88	(c: 0.1	Pass Q 00 (Qa) 00	Total Sin a) (cfs) (") 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.8 4.02 0.8 1.59 1.6 1.66 4.0 4.02 0.8 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 4.25 0.5 3.19 1.5 2.88 0.5	Pope (i) %) (i) 00% 5 30% 5 30% 5 50%	a yoo n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW 10 1.30 10 1.73 10 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW <t< td=""><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 5.96 3.61 4.25</td><td>(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.</td></t<>	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 5.96 3.61 4.25	(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.
Inlet Inlet No. Type A0 Gradd A1 Gradd A2 Gradd A3 Gradd B0 Gradd B1 Gradd B2 Gradd B3 Gradd C0A Sum C1B Sum C1B Sum C2 Gradd C3 Gradd D0A Sum D1B Sum D1B Sum F0A Sum G0A Sum G0B Sum G1B Sum G0A Sum G1B Sum G1B Sum G1B Sum G1B Sum J0 Gradd J1 Gradd J2 Gradd J3 Gradd J4 Sum J5 Sum J1 Gradd J2 Gradd J3 Gradd J4 Sum J5 Sum J6 Sum J1 Gradd J2 Gradd J	Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A C0A C0A C0A C0A C0A C0A C1B C2 C3 C4 D0A D0B D1A D1B C0A C0B C1A C1B C2 C3 C4 D0A D0B D1A D1B E0A E0A C0A G0A	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88	(c: 0.1	Pass Q 00 (Qa) 00	Total Sin a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.85 1.9 7.04 1.8 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5	FLOW (i oppe (i) 00% 5 00%	a yoo n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.26 5.0 0.32	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW<	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 5.96 3.61 4.25	(cfs) 0.00 0.00 0.00 0.00 0.00 0.00 0.00 0.
Inlet Inlet No. Type A0 Gradu A1 Gradu A2 Gradu A3 Gradu B0 Gradu B1 Gradu B2 Gradu B3 Gradu B3 Gradu C0A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C2 Gradu C3 Gradu D0A Sum D1B Sum G0A Sum G0A Sum G0A Sum G1B Sum J0 Gradu J1 Gradu J1 Gradu J1 Gradu J1 Gradu J1 Gradu <t< td=""><td>Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A C0A</td><td>(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32'</td><td>(%) 2.0 2</td><td>(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88</td><td>(c: 0.1</td><td>Pass Q fs) (Qa) 00 (Q</td><td>Total Sinal (cfs) a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5 0.88 0.5 0.771 0.7 7.00 0.5 6.25 0.5</td><td>ELOW (i 200% 5 30%</td><td>a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.31 10 1.31 10 1.31 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 10 10 1.30 10 1.73 10 1.73 10 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10</td><td>(cfs) 0.00 0.35 0.38</td></tr<></td></t<>	Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88	(c: 0.1	Pass Q fs) (Qa) 00 (Q	Total Sinal (cfs) a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5 0.88 0.5 0.771 0.7 7.00 0.5 6.25 0.5	ELOW (i 200% 5 30%	a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.31 10 1.31 10 1.31 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 10 10 1.30 10 1.73 10 1.73 10 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10</td><td>(cfs) 0.00 0.35 0.38</td></tr<>	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.31 10 1.31 10 1.31 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 10 10 1.30 10 1.73 10 1.73 10 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10	(cfs) 0.00 0.35 0.38
Inlet Inlet No. Type A0 Gradu A1 Gradu A2 Gradu A3 Gradu B0 Gradu B1 Gradu B2 Gradu B3 Gradu B3 Gradu C0A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C1A Sum D1B Sum D0A Sum D1B Sum F0A Sum G0A Sum G0A Sum G0B Sum G1B Sum J0 Gradu J1 Gradu J2 Gradu J3 Gradu J4 Sum G1B Sum J1 Gradu	Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A	(FOC - FOC 32' 32' 32' 32' 32' 32' 32' 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88	(c: 0.1	Pass Q fs) (Qa) 00 (Q	Total Similar a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 3.28 0.5 3.161 1.6 3.85 1.9 7.04 1.6 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 4.02 0.5 0.68 0.5 0.68 0.5 0.68 0.5 1.90 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5 0.710 0.7 7.00 0.7 3.81 0.1 3.81 0.1 3.81 0.1 <td>ELOW (i %) (ii %) (ii) %) 5 %) 6<td>a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10</td><td>(cfs) 0.00 0.01 0.35 0.31 0.35</td></tr<></td></td>	ELOW (i %) (ii %) (ii) %) 5 %) 6 <td>a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10</td><td>(cfs) 0.00 0.01 0.35 0.31 0.35</td></tr<></td>	a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22</td><td>1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10</td><td>(cfs) 0.00 0.01 0.35 0.31 0.35</td></tr<>	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22	1.00 1.00 1.00 1.00 1.00 1.00 1.00 1.00	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10	(cfs) 0.00 0.01 0.35 0.31 0.35
Inlet Inlet No. Type A0 Gradu A1 Gradu A2 Gradu A3 Gradu B0 Gradu B1 Gradu B2 Gradu B3 Gradu B3 Gradu C0A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C1A Sum D0A Sum D1B Sum D0B Sum F0A Sum G0A Sum G0A Sum G0A Sum G1A Sum G0A Sum G1A Sum G1A Sum G1A Sum G1A Sum G1A Sum J1 Gradu	Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A	(FOC - FOC 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88	(c: 0.1	Pass Q fs) (Qa) 00 (Q	Total Similar a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 1.60 2.0 3.23 1.6 3.99 1.6 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 1.92 4.0 0.52 0.5 0.68 0.5 6.24 0.5 3.61 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5 0.561 0.0 6.25 0.3 3.81 0.1 3.87 0.1	FLOW (i ppe (i %) (i 00% 5 50%	a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.24 5.0 0.24 5.0 0.24 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS B</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22 Length (ft) 10.0 15.0 10.0 10.0 10.0 10.0 10.0 10.0</td><td>1.00 1.3.5 1.3.5 9.0 9.0 9.0 9.0 9.0 9.0 9.0 1.3.5 1.5 1.5 1.5 1.5 1.5 1.5 1.5 1</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10 0.36 0.61 0.52 0.62 0.69 0.42 0.13 0.64 0.54</td><td>(cfs) 0.00 0.03 0.31 0.35 0.38 0.32</td></tr<>	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS B	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22 Length (ft) 10.0 15.0 10.0 10.0 10.0 10.0 10.0 10.0	1.00 1.3.5 1.3.5 9.0 9.0 9.0 9.0 9.0 9.0 9.0 1.3.5 1.5 1.5 1.5 1.5 1.5 1.5 1.5 1	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10 0.36 0.61 0.52 0.62 0.69 0.42 0.13 0.64 0.54	(cfs) 0.00 0.03 0.31 0.35 0.38 0.32
Inlet Inlet No. Type A0 Gradu A1 Gradu A2 Gradu A3 Gradu B0 Gradu B1 Gradu B2 Gradu B3 Gradu B3 Gradu C0A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C1A Sum D0A Sum D1B Sum D0B Sum F0A Sum G0A Sum G0A Sum G0A Sum G1A Sum G0A Sum G1A Sum G1A Sum G1A Sum G1A Sum G1A Sum J1 Gradu	Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A C0B C1A C0B C1A C1B C2 C3 C4 D0A D1A D1B C2 C3 C4 D0A D1B C1B C2 C3 C4 D0A D0B D1A D1B C0 C0A C0B C0A C0B C0A C0B C0A C0B C0A C0B A0A C0A C0B C0A C0B <	(FOC - FOC 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88	(c: 0.1	Pass Q fs) (Qa) 00 (Q	Total Similar a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 3.28 1.6 3.23 1.6 3.85 1.9 7.41 0.5 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 4.02 0.5 0.68 0.5 0.68 0.5 0.68 0.5 1.90 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5 0.561 0.0 6.25 0.3 3.81 0.1	FLOW (i ppe (i %) (i 00% 5 50%	a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.24 5.0 0.24 5.0 0.24 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS B</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22 Length (ft) 10.0 15.0 15.0 10.0 10.0 10.0 15.0 15.0</td><td>1.00 1.3.5 1.3.5 9.0 9.0 9.0 9.0 9.0 9.0 9.0 1.3.5 1.5 1.5 1.5 1.5 1.5 1.5 1.5 1</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10 0.36 0.61 0.52 0.62 0.69 0.42 0.13 0.64 0.54</td><td>(cfs) 0.00 0.03 0.31 0.35 0.38 0.32</td></tr<>	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS B	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22 Length (ft) 10.0 15.0 15.0 10.0 10.0 10.0 15.0 15.0	1.00 1.3.5 1.3.5 9.0 9.0 9.0 9.0 9.0 9.0 9.0 1.3.5 1.5 1.5 1.5 1.5 1.5 1.5 1.5 1	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10 0.36 0.61 0.52 0.62 0.69 0.42 0.13 0.64 0.54	(cfs) 0.00 0.03 0.31 0.35 0.38 0.32
Inlet Inlet No. Type A0 Gradu A1 Gradu A2 Gradu A3 Gradu B0 Gradu B1 Gradu B2 Gradu B3 Gradu B3 Gradu C0A Sum C1B Sum C1A Sum C1B Sum C1A Sum C1B Sum C1A Sum D0A Sum D1B Sum D0B Sum F0A Sum G0A Sum G0A Sum G0A Sum G1A Sum G0A Sum G1A Sum G1A Sum G1A Sum G1A Sum G1A Sum J1 Gradu	Area No. A0 A0 A1 A2 A3 B0 B1 B2 B3 C0A C0B C1A C0B C1A C1B C2 C3 C4 D0A D1A D1B C2 C3 C4 D0A D1B C1B C2 C3 C4 D0A D0B D1A D1B C0 C0A C0B C0A C0B C0A C0B C0A C0B C0A C0B A0A C0A C0B C0A C0B <	(FOC - FOC 32'	(%) 2.0 2	(cfs) 0 5.53 0 6.06 0 7.40 0 7.46 0 5.52 0 5.94 0 5.54 0 5.14 0 5.52 0 5.14 0 3.28 0 1.61 0 4.48 0 3.23 0 3.85 0 7.04 0 7.04 0 3.01 0 4.02 0 1.59 0 1.66 0 4.60 0 1.92 0 0.52 0 0.68 0 2.47 0 3.61 0 4.25 0 7.10 0 4.10 0 3.19 0 2.88	(c: 0.1	Pass Q fs) (Qa) 00 (Q	Total Similar a) (cfs) (f) 5.53 1.0 6.06 0.6 7.40 0.6 5.52 1.1 5.94 0.5 5.94 0.5 6.14 0.5 3.28 0.5 1.61 1.6 3.28 1.6 3.23 1.6 3.85 1.9 7.41 0.5 3.01 0.6 4.02 0.6 1.59 1.6 1.66 4.0 4.02 0.5 0.68 0.5 0.68 0.5 0.68 0.5 1.90 0.5 3.19 1.5 2.88 0.5 0.88 0.5 0.88 0.5 0.561 0.0 6.25 0.3 3.81 0.1	FLOW (i ppe (i %) (i 00% 5 50%	a you n.) (ft. 5.0 0.27 5.0 0.28 5.0 0.31 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.32 5.0 0.24 5.0 0.24 5.0 0.24 5.0 0.32 <tr< td=""><td>ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13</td><td>ABLE (</td><td>(25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10</td><td>Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI SEE SUMP CALCI</td><td>(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS B</td><td>1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22 Length (ft) 10.0 15.0 15.0 10.0 10.0 10.0 15.0 15.0</td><td>1.00 1.3.5 1.3.5 9.0 9.0 9.0 9.0 9.0 9.0 9.0 1.3.5 1.5 1.5 1.5 1.5 1.5 1.5 1.5 1</td><td>(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10 0.36 0.61 0.52 0.62 0.69 0.42 0.13 0.64 0.54</td><td>(cfs) 0.00 0.03 0.31 0.35 0.38 0.32</td></tr<>	ATION T Ponde Width (4 13.69 5 14.77 8 15.92 9 15.97 9 13.44 10 16.01 4 16.21 6 12.81 2 10.60 8 13.42 8 17.39 1 16.04 6 13.28 13 14.13	ABLE ((25-Yr FI (%) 10 10 10 10 10 10 10 10 10 10	Qa/La La (ft) 0.73 7.62 0.75 8.10 0.77 9.59 0.77 9.65 0.72 7.66 0.77 7.68 0.78 7.89 0.71 4.63 SEE SUMP CALCI	(ft) 10 1.31 10 1.23 15 1.56 10 1.04 10 1.31 10 1.30 10 1.27 10 2.16 ULATIONS BELOW ULATIONS BELOW ULATIONS BELOW 1.12 ULATIONS BELOW ULATIONS BELOW ULATIONS B	1.52 1.41 1.31 1.30 1.55 1.30 1.29 1.63 1.97 1.55 1.20 1.55 1.20 1.57 1.47 1.22 Length (ft) 10.0 15.0 15.0 10.0 10.0 10.0 15.0 15.0	1.00 1.3.5 1.3.5 9.0 9.0 9.0 9.0 9.0 9.0 9.0 1.3.5 1.5 1.5 1.5 1.5 1.5 1.5 1.5 1	(cfs) 5.53 6.06 7.40 7.46 5.52 5.94 6.14 3.28 3.32 7.04 7.41 3.28 3.32 7.04 7.41 5.96 3.61 4.25 7.10 5.96 3.61 4.25 7.10 0.36 0.61 0.52 0.62 0.69 0.42 0.13 0.64 0.54	(cfs) 0.00 0.03 0.31 0.35 0.38 0.32

ed By: Alvarado, Alex Date: August 04, 2023 08:18: 31am File Path: K: \AUS_Civil \069291601 Benton - JDS \PHASE 2 \Cad \PlanSheets \C-Drainage Calculations.dwg


Proposed Inlet Runoff (Q) Calculations D.A. Drainage TOTAL I.C. Comp. Comp. TOTAL i25 i100 Q25 Number Area (Ac) (%) C25 C100 T_5 (Min.) (in/hr) (in/hr) (cfs) A0 0.96 48% 0.63 0.71 10.0 9.22 12.14 5.53 A1 0.96 60% 0.68 0.77 10.0 9.22 12.14 5.53 A2 1.15 63% 0.70 0.78 10.0 9.22 12.14 7.40 A3 1.15 63% 0.66 0.77 10.0 9.22 12.14 7.46 B0 0.87 61% 0.64 0.72 10.0 9.22 12.14 5.94 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 6.14 B2 1.04 51% 0.82 0.91 10.0 9.22 12.14 3.16				N	OLINA P	HASE 2A	۱.		
Number Area (Ac) (%) C25 C100 To (Min.) (in/hr) (in/hr) (cfs) A0 0.96 48% 0.63 0.71 10.0 9.22 12.14 5.53 A1 0.96 60% 0.68 0.77 10.0 9.22 12.14 6.06 A2 1.17 60% 0.68 0.76 10.0 9.22 12.14 7.46 B0 0.87 61% 0.69 0.77 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 5.52 B1 0.53 58% 0.67 0.76 10.0 9.22 12.14 3.28 COA 0.21 88% 0.82 0.91 10.0 9.22 12.14 3.48 C1B 0.48 69% 0.73			Prop	osed In	let Rund	off (Q) Ca	Iculatio	ns	
A0 0.96 48% 0.63 0.71 10.0 9.22 12.14 5.53 A1 0.96 60% 0.68 0.77 10.0 9.22 12.14 6.06 A2 1.17 60% 0.68 0.76 10.0 9.22 12.14 7.40 A3 1.15 63% 0.70 0.78 10.0 9.22 12.14 7.46 B0 0.87 61% 0.69 0.77 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 5.52 B2 1.04 51% 0.64 0.72 10.0 9.22 12.14 3.28 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 3.23 C2 0.62 59% 0.68 0	D.A.	Drainage	TOTAL I.C.	Comp.	Comp.	TOTAL	i ₂₅	i ₁₀₀	Q ₂₅
A1 0.96 60% 0.68 0.77 10.0 9.22 12.14 6.06 A2 1.17 60% 0.68 0.76 10.0 9.22 12.14 7.40 A3 1.15 63% 0.70 0.78 10.0 9.22 12.14 7.46 B0 0.87 61% 0.66 0.74 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 6.14 B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 6.14 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.66	Number	Area (Ac)	(%)	C ₂₅	C ₁₀₀	T _c (Min.)	(in/hr)	(in/hr)	(cfs)
A2 1.17 60% 0.68 0.76 10.0 9.22 12.14 7.40 A3 1.15 63% 0.70 0.78 10.0 9.22 12.14 7.40 B0 0.87 61% 0.69 0.77 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.72 10.0 9.22 12.14 5.94 B2 1.04 51% 0.64 0.72 10.0 9.22 12.14 6.14 B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 3.28 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 3.28 C1A 0.69 64% 0.71 0.79 10.0 9.22 12.14 3.28 C2 0.62 55% 0.66	A0	0.96	48%	0.63	0.71	10.0	9.22	12.14	5.53
A3 1.15 63% 0.70 0.78 10.0 9.22 12.14 7.46 B0 0.87 61% 0.69 0.77 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 5.94 B2 1.04 51% 0.66 0.74 10.0 9.22 12.14 6.14 B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 3.28 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.71 0.79 10.0 9.22 12.14 3.28 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.28 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 3.01 D0A 0.74 40% 0.59	A1	0.96	60%	0.68	0.77	10.0	9.22	12.14	6.06
B0 0.87 61% 0.69 0.77 10.0 9.22 12.14 5.52 B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 5.94 B2 1.04 51% 0.64 0.72 10.0 9.22 12.14 6.14 B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 6.14 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.60 C1A 0.69 64% 0.71 0.79 10.0 9.22 12.14 3.28 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.23 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 3.33 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 3.43 D0A 0.74 40% 0.59	A2	1.17	60%	0.68	0.76	10.0	9.22	12.14	7.40
B1 0.98 55% 0.66 0.74 10.0 9.22 12.14 5.94 B2 1.04 51% 0.64 0.72 10.0 9.22 12.14 6.14 B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 6.14 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.60 C1A 0.69 64% 0.71 0.79 10.0 9.22 12.14 3.23 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.35 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 <t< td=""><td>A3</td><td>1.15</td><td>63%</td><td>0.70</td><td>0.78</td><td>10.0</td><td>9.22</td><td>12.14</td><td>7.46</td></t<>	A3	1.15	63%	0.70	0.78	10.0	9.22	12.14	7.46
B2 1.04 51% 0.64 0.72 10.0 9.22 12.14 6.14 B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 3.28 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.66 0.74 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.72 10.0 9.22 12.14 7.94 D4 0.53 87% 0.82 <t< td=""><td>B0</td><td>0.87</td><td>61%</td><td>0.69</td><td>0.77</td><td>10.0</td><td>9.22</td><td>12.14</td><td>5.52</td></t<>	B0	0.87	61%	0.69	0.77	10.0	9.22	12.14	5.52
B3 0.53 58% 0.67 0.76 10.0 9.22 12.14 3.28 C0A 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 C0B 0.21 88% 0.82 0.91 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.66 0.74 10.0 9.22 12.14 3.23 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.72 10.0 9.22 12.14 3.91 D0A 0.74 40% 0.87 <	B1	0.98	55%	0.66	0.74	10.0	9.22	12.14	5.94
COA 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.61 COB 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.60 C1A 0.69 64% 0.71 0.79 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.87	B2	1.04	51%	0.64	0.72	10.0	9.22	12.14	6.14
COB 0.21 88% 0.82 0.91 10.0 9.22 12.14 1.60 C1A 0.69 64% 0.71 0.79 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.04 C4 1.26 50% 0.66 0.72 10.0 9.22 12.14 7.04 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.82	B3	0.53	58%	0.67	0.76	10.0	9.22	12.14	3.28
C1A 0.69 64% 0.71 0.79 10.0 9.22 12.14 4.48 C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.04 C4 1.26 50% 0.64 0.72 10.0 9.22 12.14 7.04 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 4.02 D1A 0.53 87% 0.82 0.90 10.0 9.22 12.14 4.60 D1A 0.22 80% 0.73	C0A	0.21	88%	0.82	0.91	10.0	9.22	12.14	1.61
C1B 0.48 69% 0.73 0.81 10.0 9.22 12.14 3.23 C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.04 C4 1.26 50% 0.64 0.72 10.0 9.22 12.14 7.04 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 3.01 D1B 0.22 80% 0.78 0.87 10.0 9.22 12.14 1.66 E0A 0.21 95% 0.86 0.94 10.0 9.22 12.14 1.66 E0B 0.68 69% 0.73	C0B	0.21	88%	0.82	0.91	10.0	9.22	12.14	1.60
C2 0.62 59% 0.68 0.76 10.0 9.22 12.14 3.85 C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.04 C4 1.26 50% 0.64 0.72 10.0 9.22 12.14 7.04 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 3.99 D1B 0.22 80% 0.78 0.87 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.73 0.81 10.0 9.22 12.14 1.66 E0B 0.68 69% 0.73 0.81 10.0 9.22 12.14 1.66 E0B 0.24 96% 0.86	C1A	0.69	64%	0.71	0.79	10.0	9.22	12.14	4.48
C3 1.16 55% 0.66 0.74 10.0 9.22 12.14 7.04 C4 1.26 50% 0.64 0.72 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 7.41 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 3.01 D1A 0.53 87% 0.82 0.90 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.78 0.87 10.0 9.22 12.14 4.02 E0A 0.21 95% 0.86 0.94 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.73 0.81 10.0 9.22 12.14 1.66 E0B 0.68 69% 0.73	C1B	0.48	69%	0.73	0.81	10.0	9.22	12.14	3.23
C4 1.26 50% 0.64 0.72 10.0 9.22 12.14 7.41 D0A 0.74 40% 0.59 0.66 10.0 9.22 12.14 3.99 D0B 0.53 47% 0.62 0.70 10.0 9.22 12.14 3.01 D1A 0.53 87% 0.82 0.90 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.78 0.87 10.0 9.22 12.14 4.02 D1B 0.22 80% 0.78 0.87 10.0 9.22 12.14 4.02 D1B 0.21 95% 0.86 0.94 10.0 9.22 12.14 1.66 E0B 0.68 69% 0.73 0.81 10.0 9.22 12.14 1.89 F0B 0.24 93% 0.85 0.94 10.0 9.22 12.14 1.92 G0A 0.07 88% 0.82	C2	0.62	59%	0.68	0.76	10.0	9.22	12.14	3.85
D0A0.7440%0.590.6610.09.2212.143.99D0B0.5347%0.620.7010.09.2212.143.01D1A0.5387%0.820.9010.09.2212.144.02D1B0.2280%0.780.8710.09.2212.144.02D1B0.2280%0.780.8710.09.2212.144.02D1B0.2280%0.780.8710.09.2212.141.59E0A0.2195%0.860.9410.09.2212.141.66E0B0.6869%0.730.8110.09.2212.141.66E0B0.6869%0.730.8110.09.2212.141.69F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.92G0A0.0788%0.820.9110.09.2212.141.92G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.146.24G1B0.3673%0.750.8310.09.2212.145.96H10.5370%0.670.7510.09.2212.143.61J00.6860% <td>C3</td> <td>1.16</td> <td>55%</td> <td>0.66</td> <td>0.74</td> <td>10.0</td> <td>9.22</td> <td>12.14</td> <td>7.04</td>	C3	1.16	55%	0.66	0.74	10.0	9.22	12.14	7.04
D0B0.5347%0.620.7010.09.2212.143.01D1A0.5387%0.820.9010.09.2212.144.02D1B0.2280%0.780.8710.09.2212.144.02E0A0.2195%0.860.9410.09.2212.141.66E0B0.6869%0.730.8110.09.2212.141.66F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.66G0A0.0788%0.820.9110.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.92G0A0.0788%0.820.9110.09.2212.144.60G1B0.3673%0.750.8310.09.2212.146.24G1B0.3673%0.750.8310.09.2212.145.96H10.5370%0.670.7510.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.144.10CULV A0.5973%0.750.8310.09.2212.144.10	C4	1.26	50%	0.64	0.72	10.0	9.22	12.14	7.41
D1A0.5387%0.820.9010.09.2212.144.02D1B0.2280%0.780.8710.09.2212.141.59E0A0.2195%0.860.9410.09.2212.141.66E0B0.6869%0.730.8110.09.2212.144.60F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.89G0A0.0788%0.820.9110.09.2212.141.66G0B0.0993%0.850.9310.09.2212.141.62G0B0.0993%0.850.9310.09.2212.144.62G1A0.9073%0.750.8310.09.2212.144.624G1B0.3673%0.750.8310.09.2212.145.96H10.5370%0.670.7510.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.144.10CULV A0.5973%0.750.8310.09.2212.144.10	D0A	0.74	40%	0.59	0.66	10.0	9.22	12.14	3.99
D1B0.2280%0.780.8710.09.2212.141.59E0A0.2195%0.860.9410.09.2212.141.66E0B0.6869%0.730.8110.09.2212.141.66F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.89G0A0.0788%0.820.9110.09.2212.141.92G0B0.0993%0.850.9310.09.2212.140.52G0B0.0993%0.850.9310.09.2212.140.52G1A0.9073%0.750.8310.09.2212.142.47H00.9757%0.670.7510.09.2212.145.96H10.5370%0.680.7610.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.147.10CULV A0.5973%0.750.8310.09.2212.144.10	D0B	0.53	47%	0.62	0.70	10.0	9.22	12.14	3.01
E0A0.2195%0.860.9410.09.2212.141.66E0B0.6869%0.730.8110.09.2212.144.60F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.92G0A0.0788%0.820.9110.09.2212.141.92G0B0.0993%0.850.9310.09.2212.140.52G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.142.47H00.9757%0.670.7510.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.144.10CULV A0.5973%0.750.8310.09.2212.144.10	D1A	0.53	87%	0.82	0.90	10.0	9.22	12.14	4.02
E0B0.6869%0.730.8110.09.2212.144.60F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.92G0A0.0788%0.820.9110.09.2212.140.52G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.142.47H00.9757%0.670.7510.09.2212.145.96H10.5370%0.740.8210.09.2212.143.61J00.6860%0.650.7310.09.2212.144.25J11.1952%0.650.7310.09.2212.144.10	D1B	0.22	80%	0.78	0.87	10.0	9.22	12.14	1.59
F0A0.2496%0.860.9510.09.2212.141.89F0B0.2493%0.850.9410.09.2212.141.92G0A0.0788%0.820.9110.09.2212.140.52G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.140.68G1B0.3673%0.750.8310.09.2212.145.96H10.5370%0.670.7510.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.147.10CULV A0.5973%0.750.8310.09.2212.144.10	E0A	0.21	95%	0.86	0.94	10.0	9.22	12.14	1.66
F0B0.2493%0.850.9410.09.2212.141.92G0A0.0788%0.820.9110.09.2212.140.52G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.146.24G1B0.3673%0.750.8310.09.2212.146.24H00.9757%0.670.7510.09.2212.145.96H10.5370%0.740.8210.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.147.10CULV A0.5973%0.750.8310.09.2212.144.10	E0B	0.68	69%	0.73	0.81	10.0	9.22	12.14	4.60
G0A0.0788%0.820.9110.09.2212.140.52G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.146.24G1B0.3673%0.750.8310.09.2212.145.47H00.9757%0.670.7510.09.2212.145.96H10.5370%0.740.8210.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.144.10CULV A0.5973%0.750.8310.09.2212.144.10	F0A	0.24	96%	0.86	0.95	10.0	9.22	12.14	1.89
G0B0.0993%0.850.9310.09.2212.140.68G1A0.9073%0.750.8310.09.2212.146.24G1B0.3673%0.750.8310.09.2212.142.47H00.9757%0.670.7510.09.2212.145.96H10.5370%0.740.8210.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.147.10CULV A0.5973%0.750.8310.09.2212.144.10	F0B	0.24	93%	0.85	0.94	10.0	9.22	12.14	1.92
G1A0.9073%0.750.8310.09.2212.146.24G1B0.3673%0.750.8310.09.2212.142.47H00.9757%0.670.7510.09.2212.145.96H10.5370%0.740.8210.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.147.10CULV A0.5973%0.750.8310.09.2212.144.10	G0A	0.07	88%	0.82	0.91	10.0	9.22	12.14	0.52
G1B0.3673%0.750.8310.09.2212.142.47H00.9757%0.670.7510.09.2212.145.96H10.5370%0.740.8210.09.2212.143.61J00.6860%0.680.7610.09.2212.144.25J11.1952%0.650.7310.09.2212.147.10CULV A0.5973%0.750.8310.09.2212.144.10	G0B	0.09	93%	0.85	0.93	10.0	9.22	12.14	0.68
H0 0.97 57% 0.67 0.75 10.0 9.22 12.14 5.96 H1 0.53 70% 0.74 0.82 10.0 9.22 12.14 3.61 J0 0.68 60% 0.68 0.76 10.0 9.22 12.14 3.61 J1 1.19 52% 0.65 0.73 10.0 9.22 12.14 4.25 J1 1.19 52% 0.65 0.73 10.0 9.22 12.14 4.10 CULV A 0.59 73% 0.75 0.83 10.0 9.22 12.14 4.10	G1A	0.90	73%	0.75	0.83	10.0	9.22	12.14	6.24
H1 0.53 70% 0.74 0.82 10.0 9.22 12.14 3.61 J0 0.68 60% 0.68 0.76 10.0 9.22 12.14 4.25 J1 1.19 52% 0.65 0.73 10.0 9.22 12.14 7.10 CULV A 0.59 73% 0.75 0.83 10.0 9.22 12.14 4.10	G1B	0.36	73%	0.75	0.83	10.0	9.22	12.14	2.47
J0 0.68 60% 0.68 0.76 10.0 9.22 12.14 4.25 J1 1.19 52% 0.65 0.73 10.0 9.22 12.14 4.25 CULV A 0.59 73% 0.75 0.83 10.0 9.22 12.14 4.10	H0	0.97	57%	0.67	0.75	10.0	9.22	12.14	5.96
J1 1.19 52% 0.65 0.73 10.0 9.22 12.14 7.10 CULV A 0.59 73% 0.75 0.83 10.0 9.22 12.14 4.10	H1	0.53	70%	0.74	0.82	10.0	9.22	12.14	3.61
CULV A 0.59 73% 0.75 0.83 10.0 9.22 12.14 4.10	JO	0.68	60%	0.68	0.76	10.0	9.22	12.14	4.25
	J1	1.19	52%	0.65	0.73	10.0	9.22	12.14	7.10
CULV B 046 73% 075 083 100 922 1214 319	CULV A	0.59	73%	0.75	0.83	10.0	9.22	12.14	4.10
	CULV B	0.46	73%	0.75	0.83	10.0	9.22	12.14	3.19
EX-F1A 0.42 73% 0.75 0.83 10.0 9.22 12.14 2.88	EX-F1A	0.42	73%	0.75	0.83	10.0	9.22	12.14	2.88
EX-F1B 0.13 76% 0.76 0.85 10.0 9.22 12.14 0.88	EX-F1B	0.13	76%	0.76	0.85	10.0	9.22	12.14	0.88


									-	-	SEC 1 & 2									
						I	NLET FI	LOW C		ATION	TABLE (1	00-Yr Flo	ows)							
raight Cro			04 (147) ki 0						1	1				<u> </u>			· · ·	0.0		
Inlet No.	Inlet Type	Drainage Area No.	Street Width C (FOC - FOC)	(%)	Q (cfs)	Q Pass (cfs)	Q Total (Qa) (cfs)	Slope (%)	a (in.)	yo (ft.)	Ponded Width (ft)	R.F. (%)	Qa/La	La (ft)	Length (ft)	L/La	a/yo	Q/Qa	Q (cfs)	Q Pass (cfs)
A0	Grade	Alea No. A0	32'	2.00	8.20	0.00	8.20	1.00%	5.0	0.317	15.87	10	0.77	10.64	10	0.94	1.31	0.94	7.71	0.49
A0 A1	Grade	A1	32'	2.00	8.93	0.00	8.93	0.80%	5.0	0.342	17.08	10	0.80	11.21	10	0.89	1.22	0.89	7.96	0.97
A2	Grade	A2	32'	2.00	10.91	1.19	12.10	0.80%	5.0	0.383	19.14	10	0.84	14.40	15	1.04	1.09	1.00	12.10	0.00
A3	Grade	A3	32'	2.00	10.98	0.00	10.98	0.80%	5.0	0.369	18.46	10	0.83	13.30	10	0.75	1.13	0.75	8.26	2.72
B0	Grade	до В0	32'	2.00	8.14	0.00	8.14	1.10%	5.0	0.303	15.54	10	0.76	10.65	10	0.94	1.34	0.94	7.64	0.49
B1	Grade	B1	32'	2.00	8.78	0.49	9.27	0.50%	5.0	0.378	18.92	10	0.84	11.10	10	0.90	1.10	0.90	8.35	0.92
B2	Grade	B2	32'	2.00	9.09	0.92	10.00	0.50%	5.0	0.389	19.47	10	0.85	11.81	10	0.85	1.07	0.85	8.47	1.53
B3	Grade	B3	32'	2.00	4.83	0.00	4.83	0.50%	5.0	0.296	14.82	10	0.75	6.45	10	1.55	1.41	1.00	4.83	0.00
COA	Sump	COA	32'	2.00	2.35	0.00	2.35	1.80%	5.0	0.200	14.02	10					1.41	1.00	4.00	0.00
COB	Sump	COB	32'	2.00	2.33	0.94	3.26	2.00%	5.0											
C1A	Sump	C1A	32'	2.00	6.58	2.19	8.78	2.00%	5.0											
C1B	Sump	C1B	32'	2.00	4.74	0.00	4.74	1.80%	5.0											
C2	Grade	C2	32'	2.00	5.68	0.00	5.68	1.90%	5.0	0.245	12.26	10	0.70	8.15	5	0.61	1.70	0.61	3.49	2.19
C3	Grade	C3	32'	2.00	10.40	0.00	10.40	1.80%	5.0	0.311	15.54	10	0.76	13.62	10	0.73	1.34	0.73	7.64	2.76
C4	Grade	C4	32'	2.00	10.40	2.76	13.73	0.50%	5.0	0.439	21.93	10	0.90	15.25	15	0.98	0.95	0.98	13.51	0.22
D0A	Sump	D0A	32'	2.00	5.95	3.49	9.44	1.60%	5.0	0.400	21.55	10					0.00	0.00	10.01	0.22
D0B	Sump	DOB	32'	2.00	4.46	2.72	7.19	0.80%	5.0											
D1A	Sump	D1A	32'	2.00	5.86	0.00	5.86	0.80%	5.0											
D1B	Sump	D1B	32'	2.00	2.32	0.00	2.32	1.60%	5.0											
EOA	Sump	E0A	32'	2.00	2.41	0.00	2.41	4.00%	5.0											
E0B	Sump	E0B	32'	2.00	6.74	0.00	6.74	4.00%	5.0						LCULATION					
FOA	Sump	F0A	32'	2.00	2.75	0.00	2.75	4.00%	5.0											
F0B	Sump	F0B	32'	2.00	2.78	0.00	2.78	4.00%	5.0											
GOA	Sump	G0A	32'	2.00	0.76	0.00	0.76	0.50%	5.0											
G0B	Sump	G0B	32'	2.00	0.99	0.00	0.99	0.50%	5.0											
G1A	Sump	G1A	32'	2.00	9.13	0.00	9.13	0.50%	5.0											
G1B	Sump	G1B	32'	2.00	3.61	0.00	3.61	0.50%	5.0											
HO	Grade	HO	32'	2.00	8.80	0.49	9.29	0.50%	5.0	0.379	18.94	10	0.84	11.12	10	0.90	1.10	0.90	8.36	0.94
H1	Grade	H1	32'	2.00	5.29	0.00	5.29	0.50%	5.0	0.307	15.33	10	0.76	6.96	10	1.44	1.36	1.00	5.29	0.00
JO	Grade	JO	32'	2.00	6.27	0.00	6.27	0.50%	5.0	0.327	16.34	10	0.78	8.03	10	1.25	1.27	1.00	6.27	0.00
J1	Grade	J1	32'	2.00	10.50	0.00	10.50	0.50%	5.0	0.397	19.83	10	0.85	12.28	10	0.81	1.05	0.81	8.55	1.95
ULV A	Sump	CULVA	40'	2.00	6.01	0.00	6.01	1.50%	5.0											
ULV B	Sump	CULV B	40'	2.00	4.68	0.00	4.68	1.50%	5.0						LCULATION					
EX-F1A	Sump	EX-F1A	40'	2.00	4.22	0.00	4.22	0.50%	5.0						LCULATION					
EX-F1B	Sump	EX-F1B	40'	2.00	1.29	0.00	1.29	0.50%	5.0						LCULATION					
np Inlets	;																			
Inlet	Inlet	Drainage	Street Width				Q	Q Pass	Q Total							R.F.	Length	RFx L	Q/L	yo+a
No.	Туре	Area No.	(CL - FOC)				(cfs)	(cfs)	(Qa) (cfs)							(%)	(ft)	(Ft.)	(cfs/ft)	(ft.)
C0	Sump	C0A & C0B	16.0'				4.67	0.94	5.61							10%	10.0	9.0	0.62	0.35
C1	Sump	C1A & C1B	16.0'				11.33	2.19	13.52							10%	15.0	13.5	1.00	0.48
D0	Sump	D0A & D0B	16.0'				10.42	6.21	16.63							10%	15.0	13.5	1.23	0.55
D1	Sump	D1A & D1B	16.0'				8.18	0.00	8.18							10%	10.0	9.0	0.91	0.45
E0	Sump	E0A & E0B	16.0'				9.49	0.00	9.49							10%	10.0	9.0	1.05	0.50
F0	Sump	F0A & F0B	16.0'				5.53	0.00	5.53							10%	10.0	9.0	0.61	0.35
G0	Sump	G0A & G0B	16.0'				1.75	0.00	1.75							10%	10.0	9.0	0.19	0.16
G1	Sump	G1A & G1B	16.0'				12.74	0.00	12.74							10%	15.0	13.5	0.94	0.46
CULV	Sump	CULVA & CULVE	3 20.0'				10.68	0.00	10.68							10%	15.0	13.5	0.79	0.41
EX-F1	Sump	EX-F1A & EX-F1B	20.0'				5.50	0.00	5.50							10%	10.0	9.0	0.61	0.35


Q ₁₀₀
(cfs)
8.20
8.93
10.91
10.98
8.14
8.78
9.09
4.83
2.35
2.33
6.58
4.74
5.68
10.40
10.97
5.95
4.46
5.86
2.32
2.41
6.74
2.75
2.78
0.76
0.99
9.13 3.61
8.80
5.29
6.27
10.50
6.01
4.68
 4.22
1.29

					DATE BY
					REVISIONS
					No.
		2023 KIMLEY-HORN AND ASSOCIATES, INC.	501 S. AUSTIN AVENUE, SUITE 1310, GEORGETOWN, TX 78626	PHONE: 012-020-0768 FAX: 012-418-1791 WWW.KIMLEY-HORN.COM	TEXAS REGISTERED ENGINEERING FIRM F-928
08/04/	SATE JANDRO E	OF 7 GRAN 3008- CENSE VAL		RICC	t "www.
KHA PROJECT 069291601	DATE APRIL 2023	SCALE: AS SHOWN	DESIGNED BY: DPD	DRAWN BY: DPD	снескер ву: АЕС
	DRAINAGE		CALCULATIONS		
	NOLINA	PHASE 2A	•	WILLIAMSON COUNTY, IEXAS	
	SHEET	- _{NU} 23		ĒR	




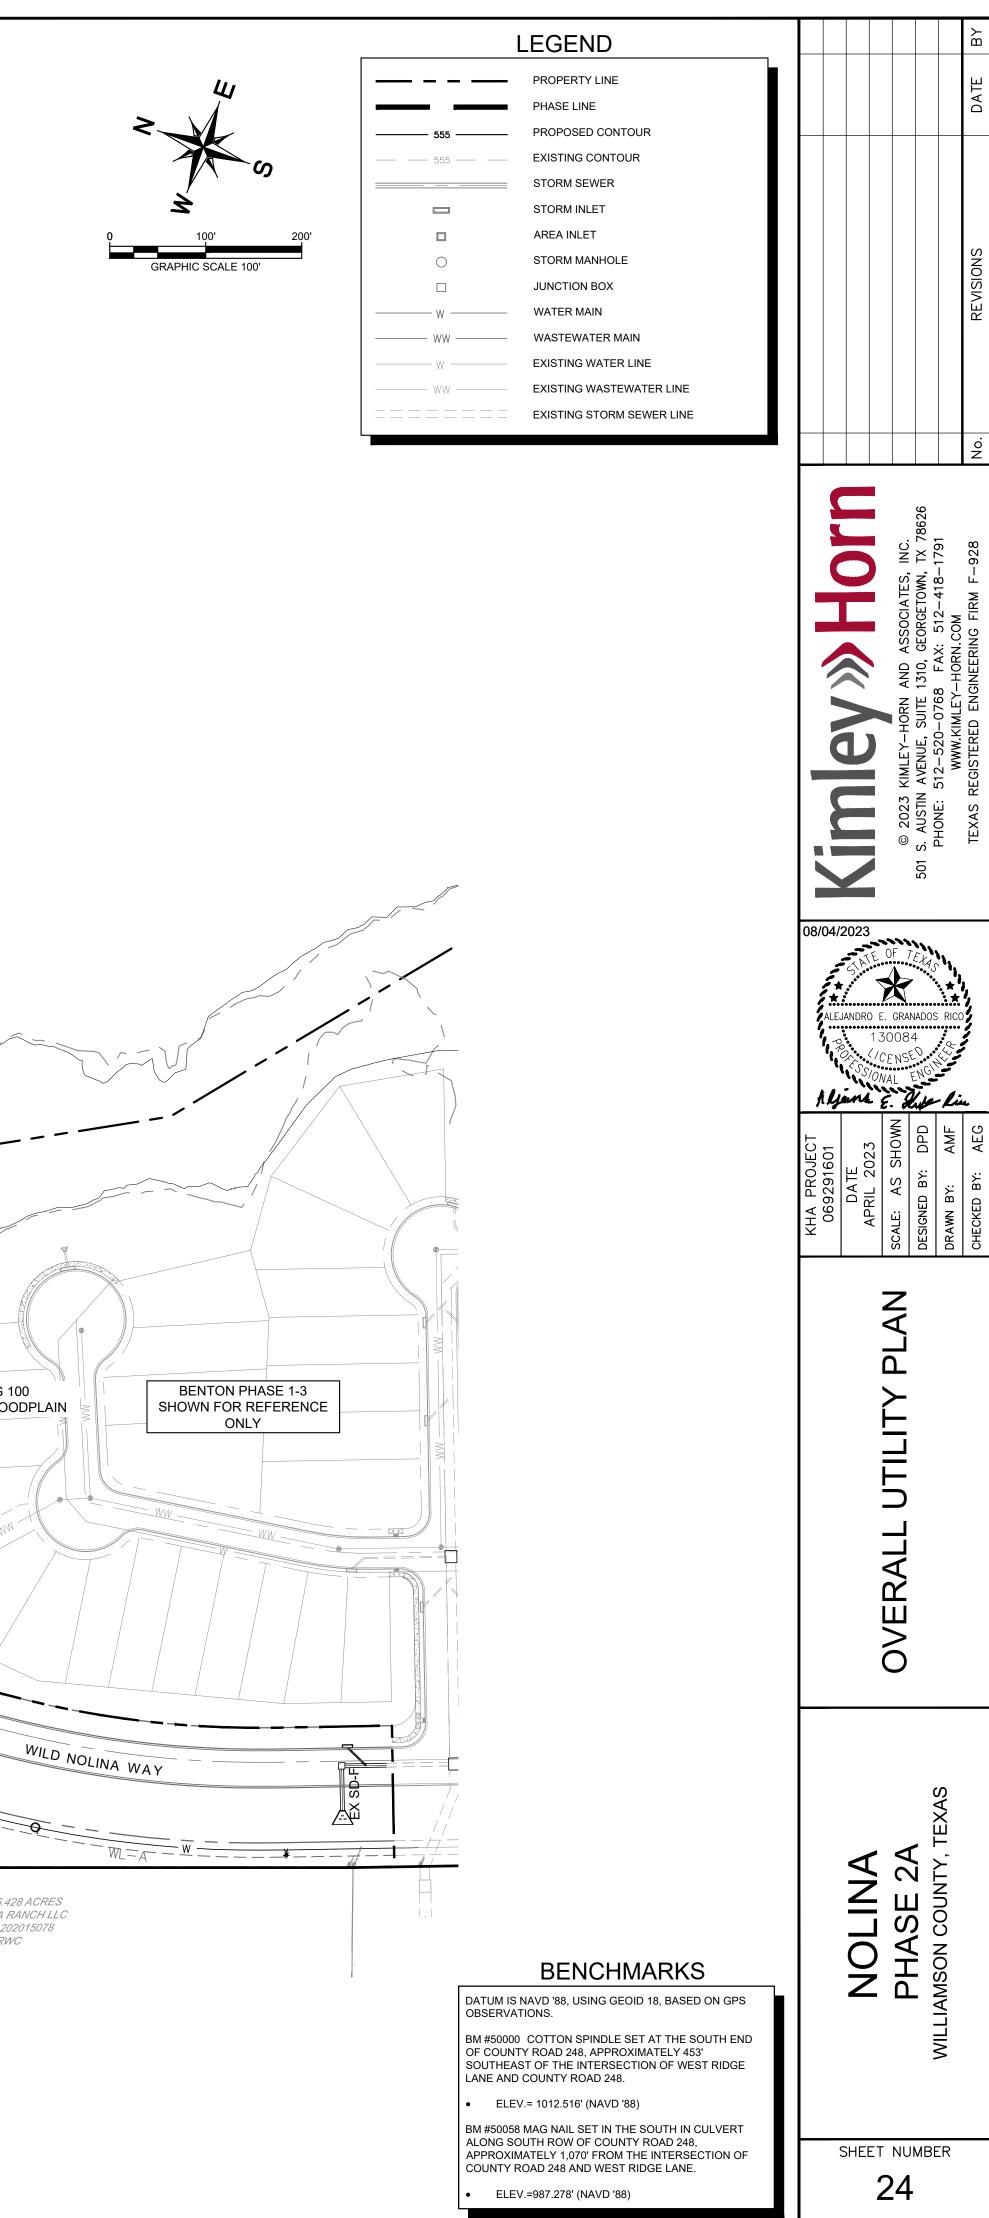


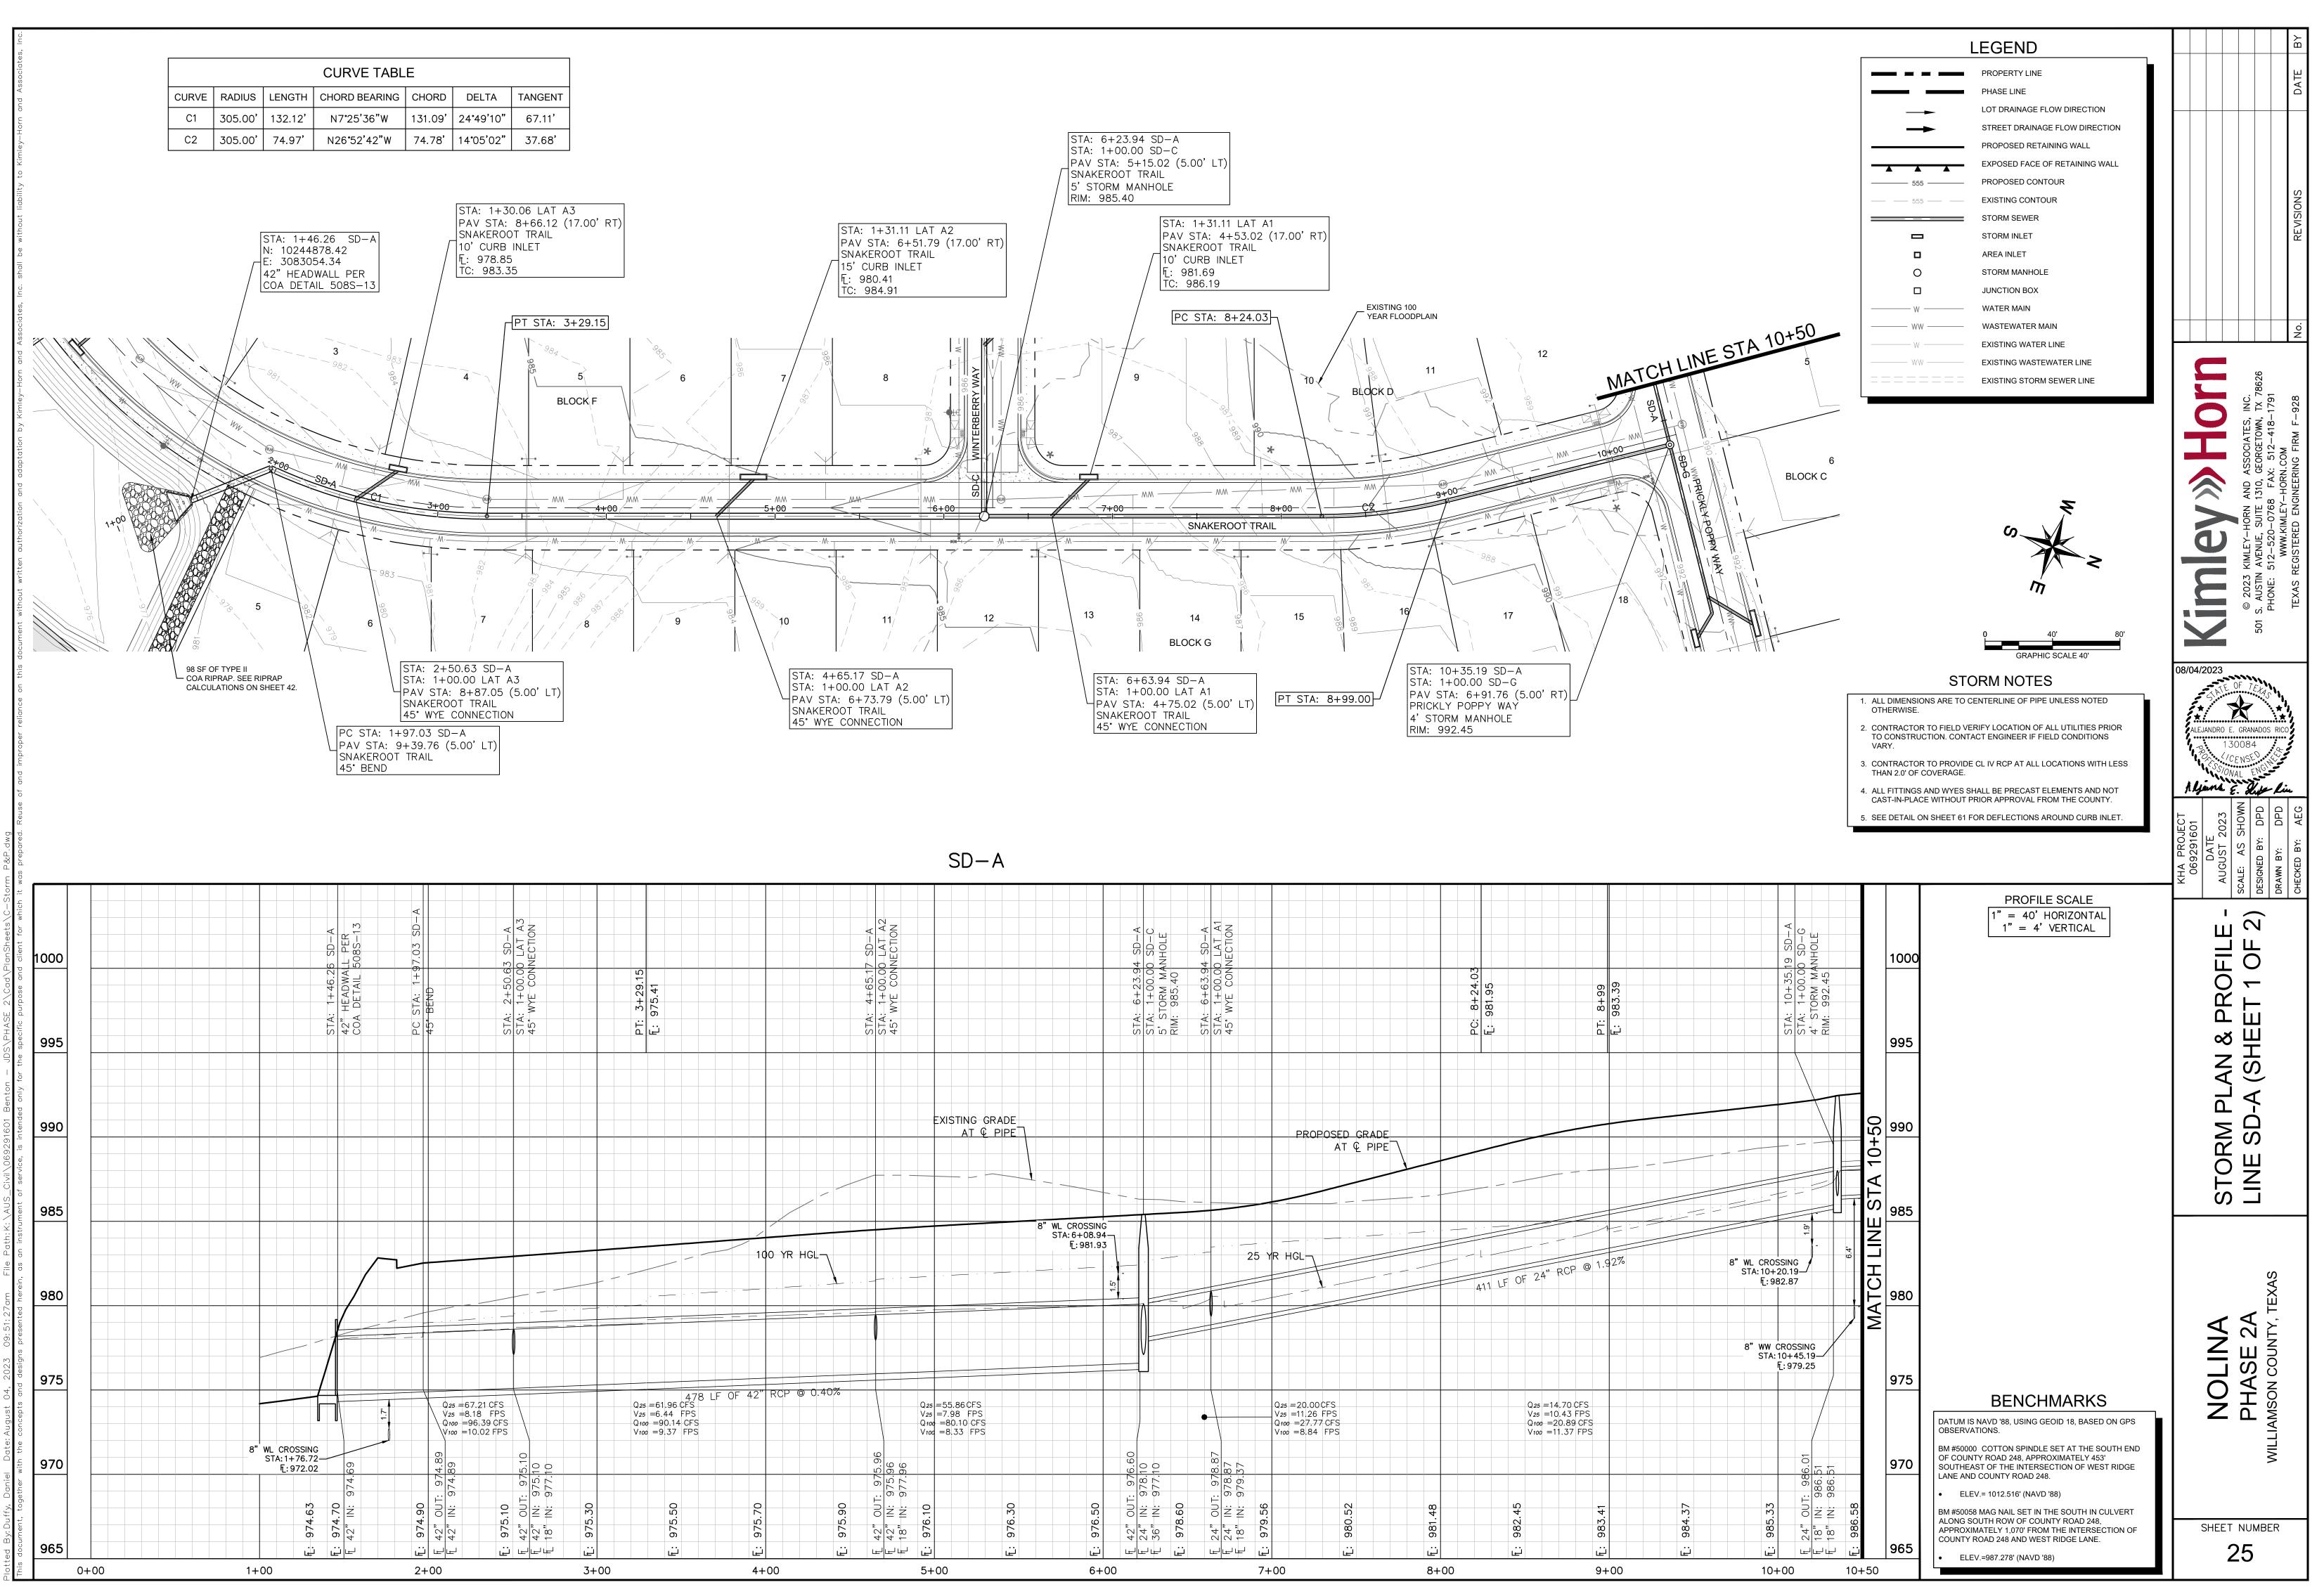


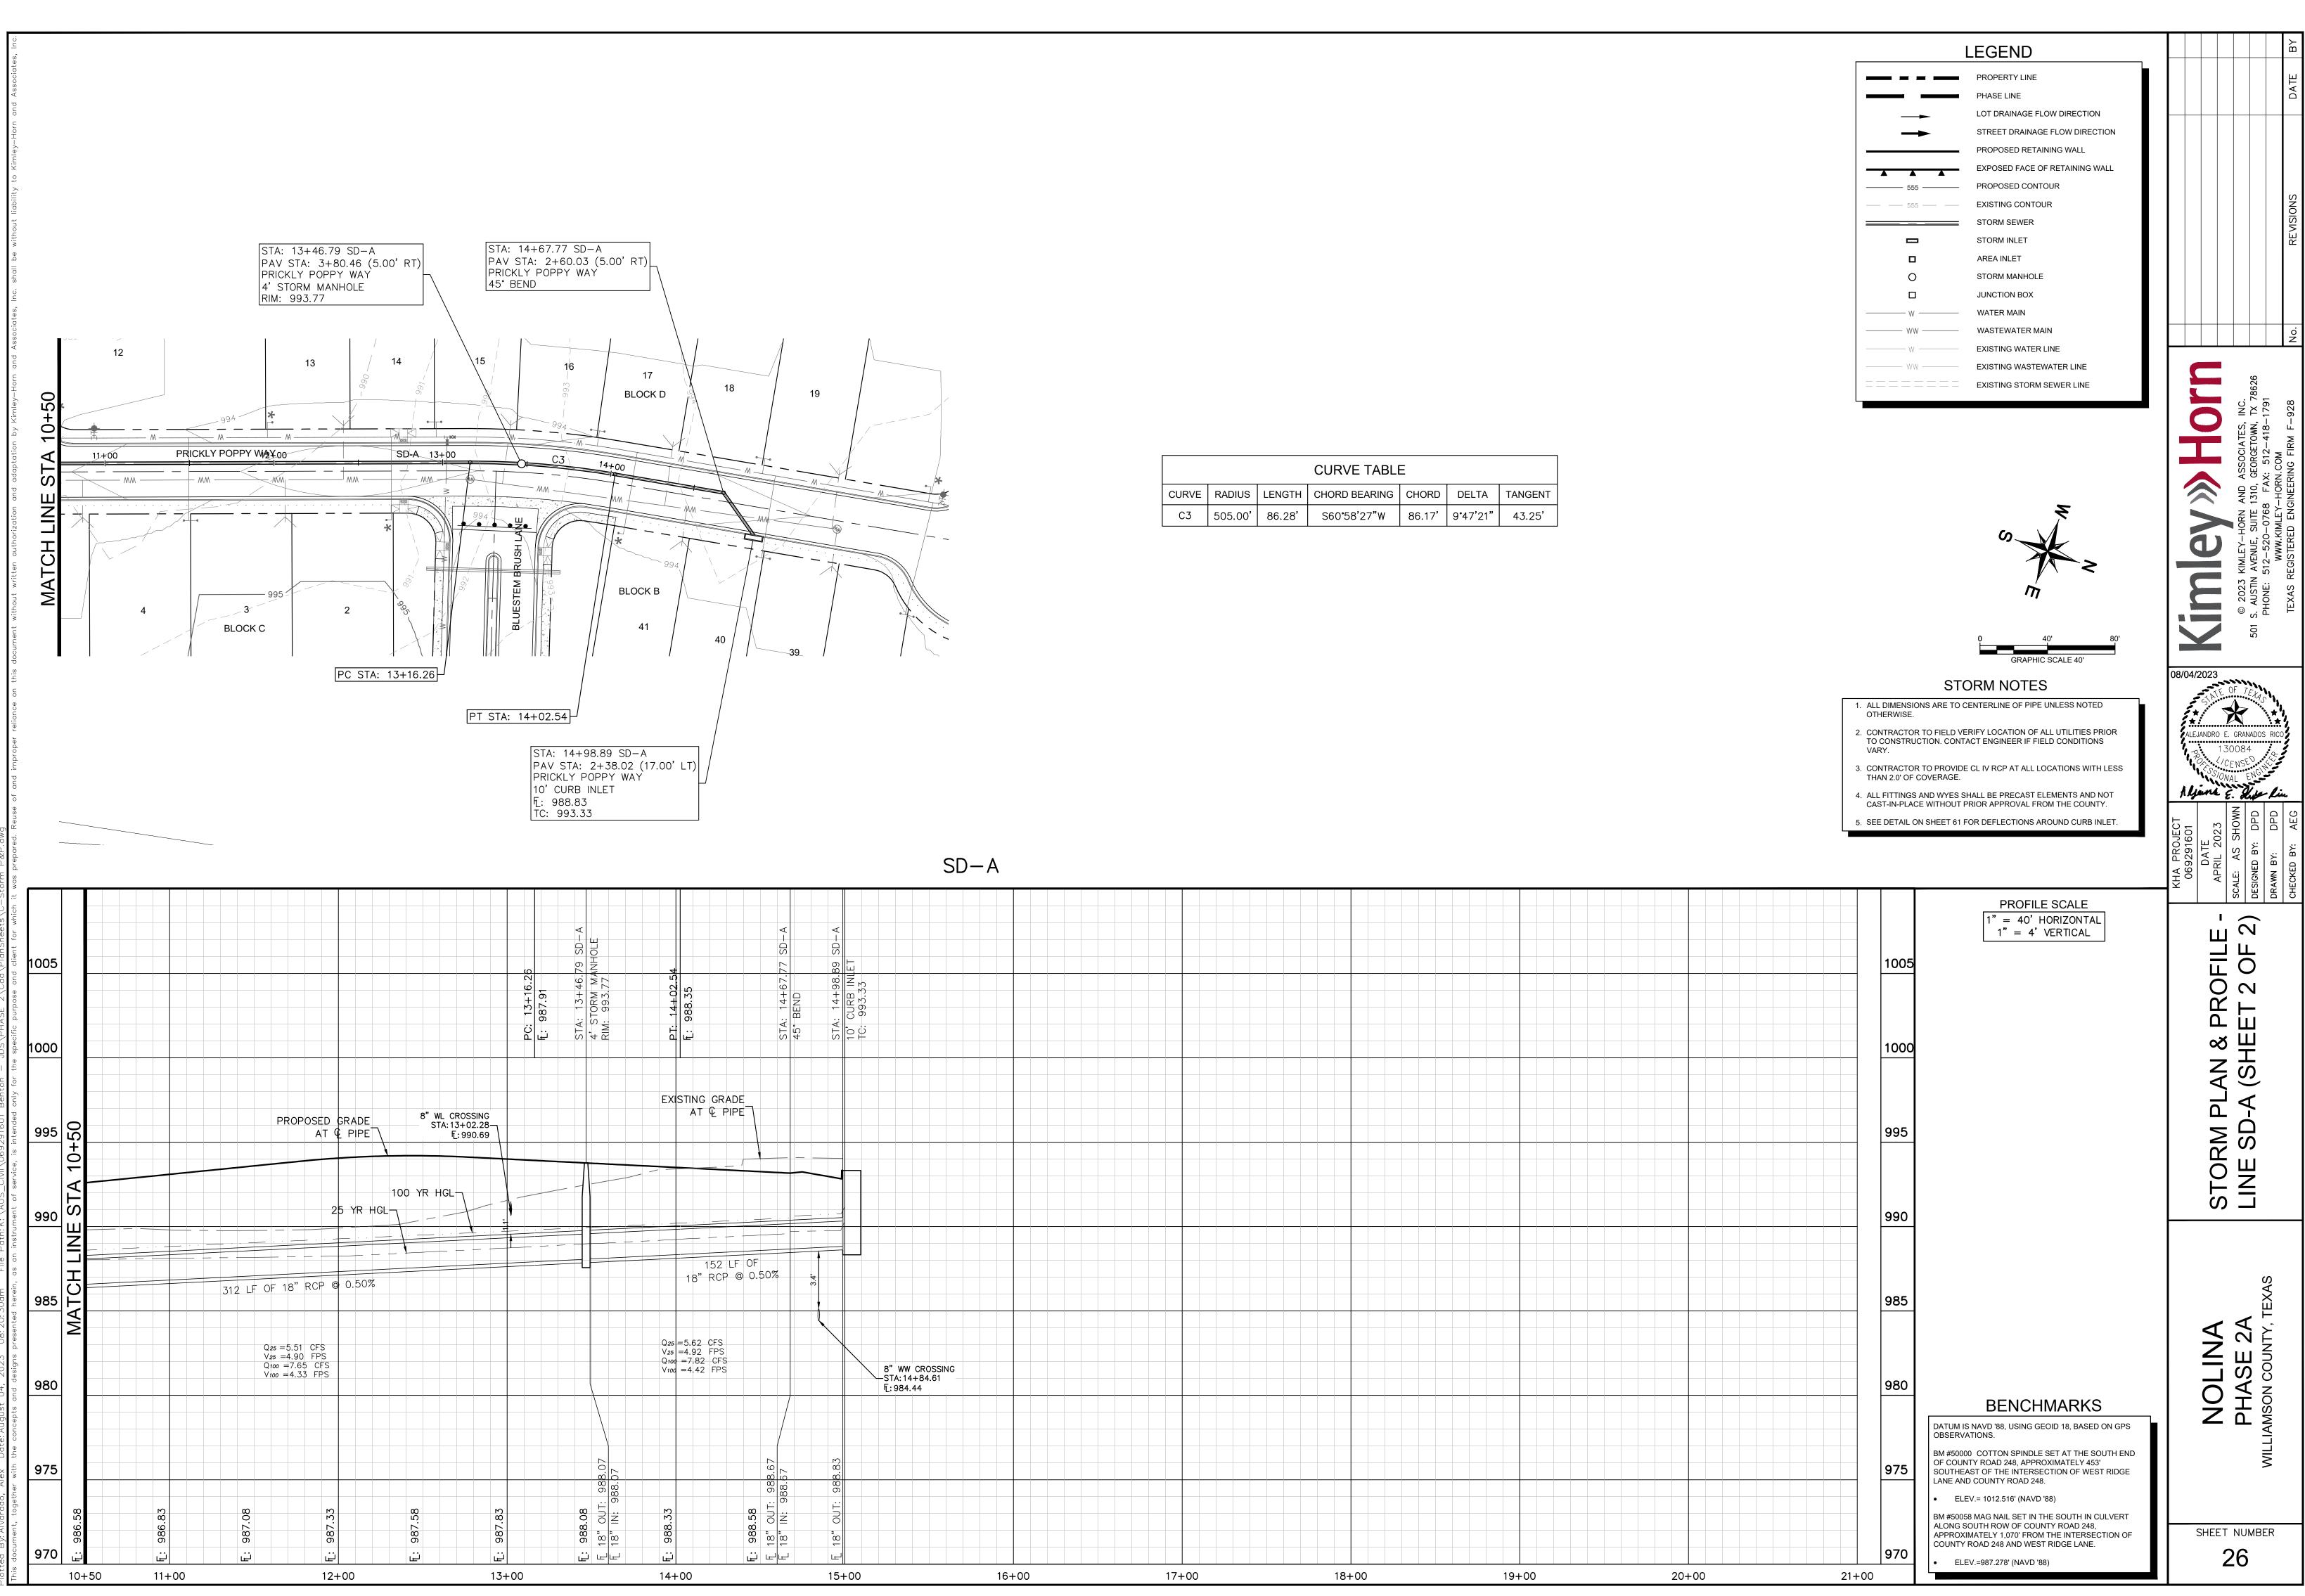



			CURVE TABLE	Ξ		
CURVE	RADIUS	LENGTH	CHORD BEARING	CHORD	DELTA	TANGENT
C3	505.00'	86.28'	S60 * 58'27"W	86.17'	9 ° 47'21"	43.25'

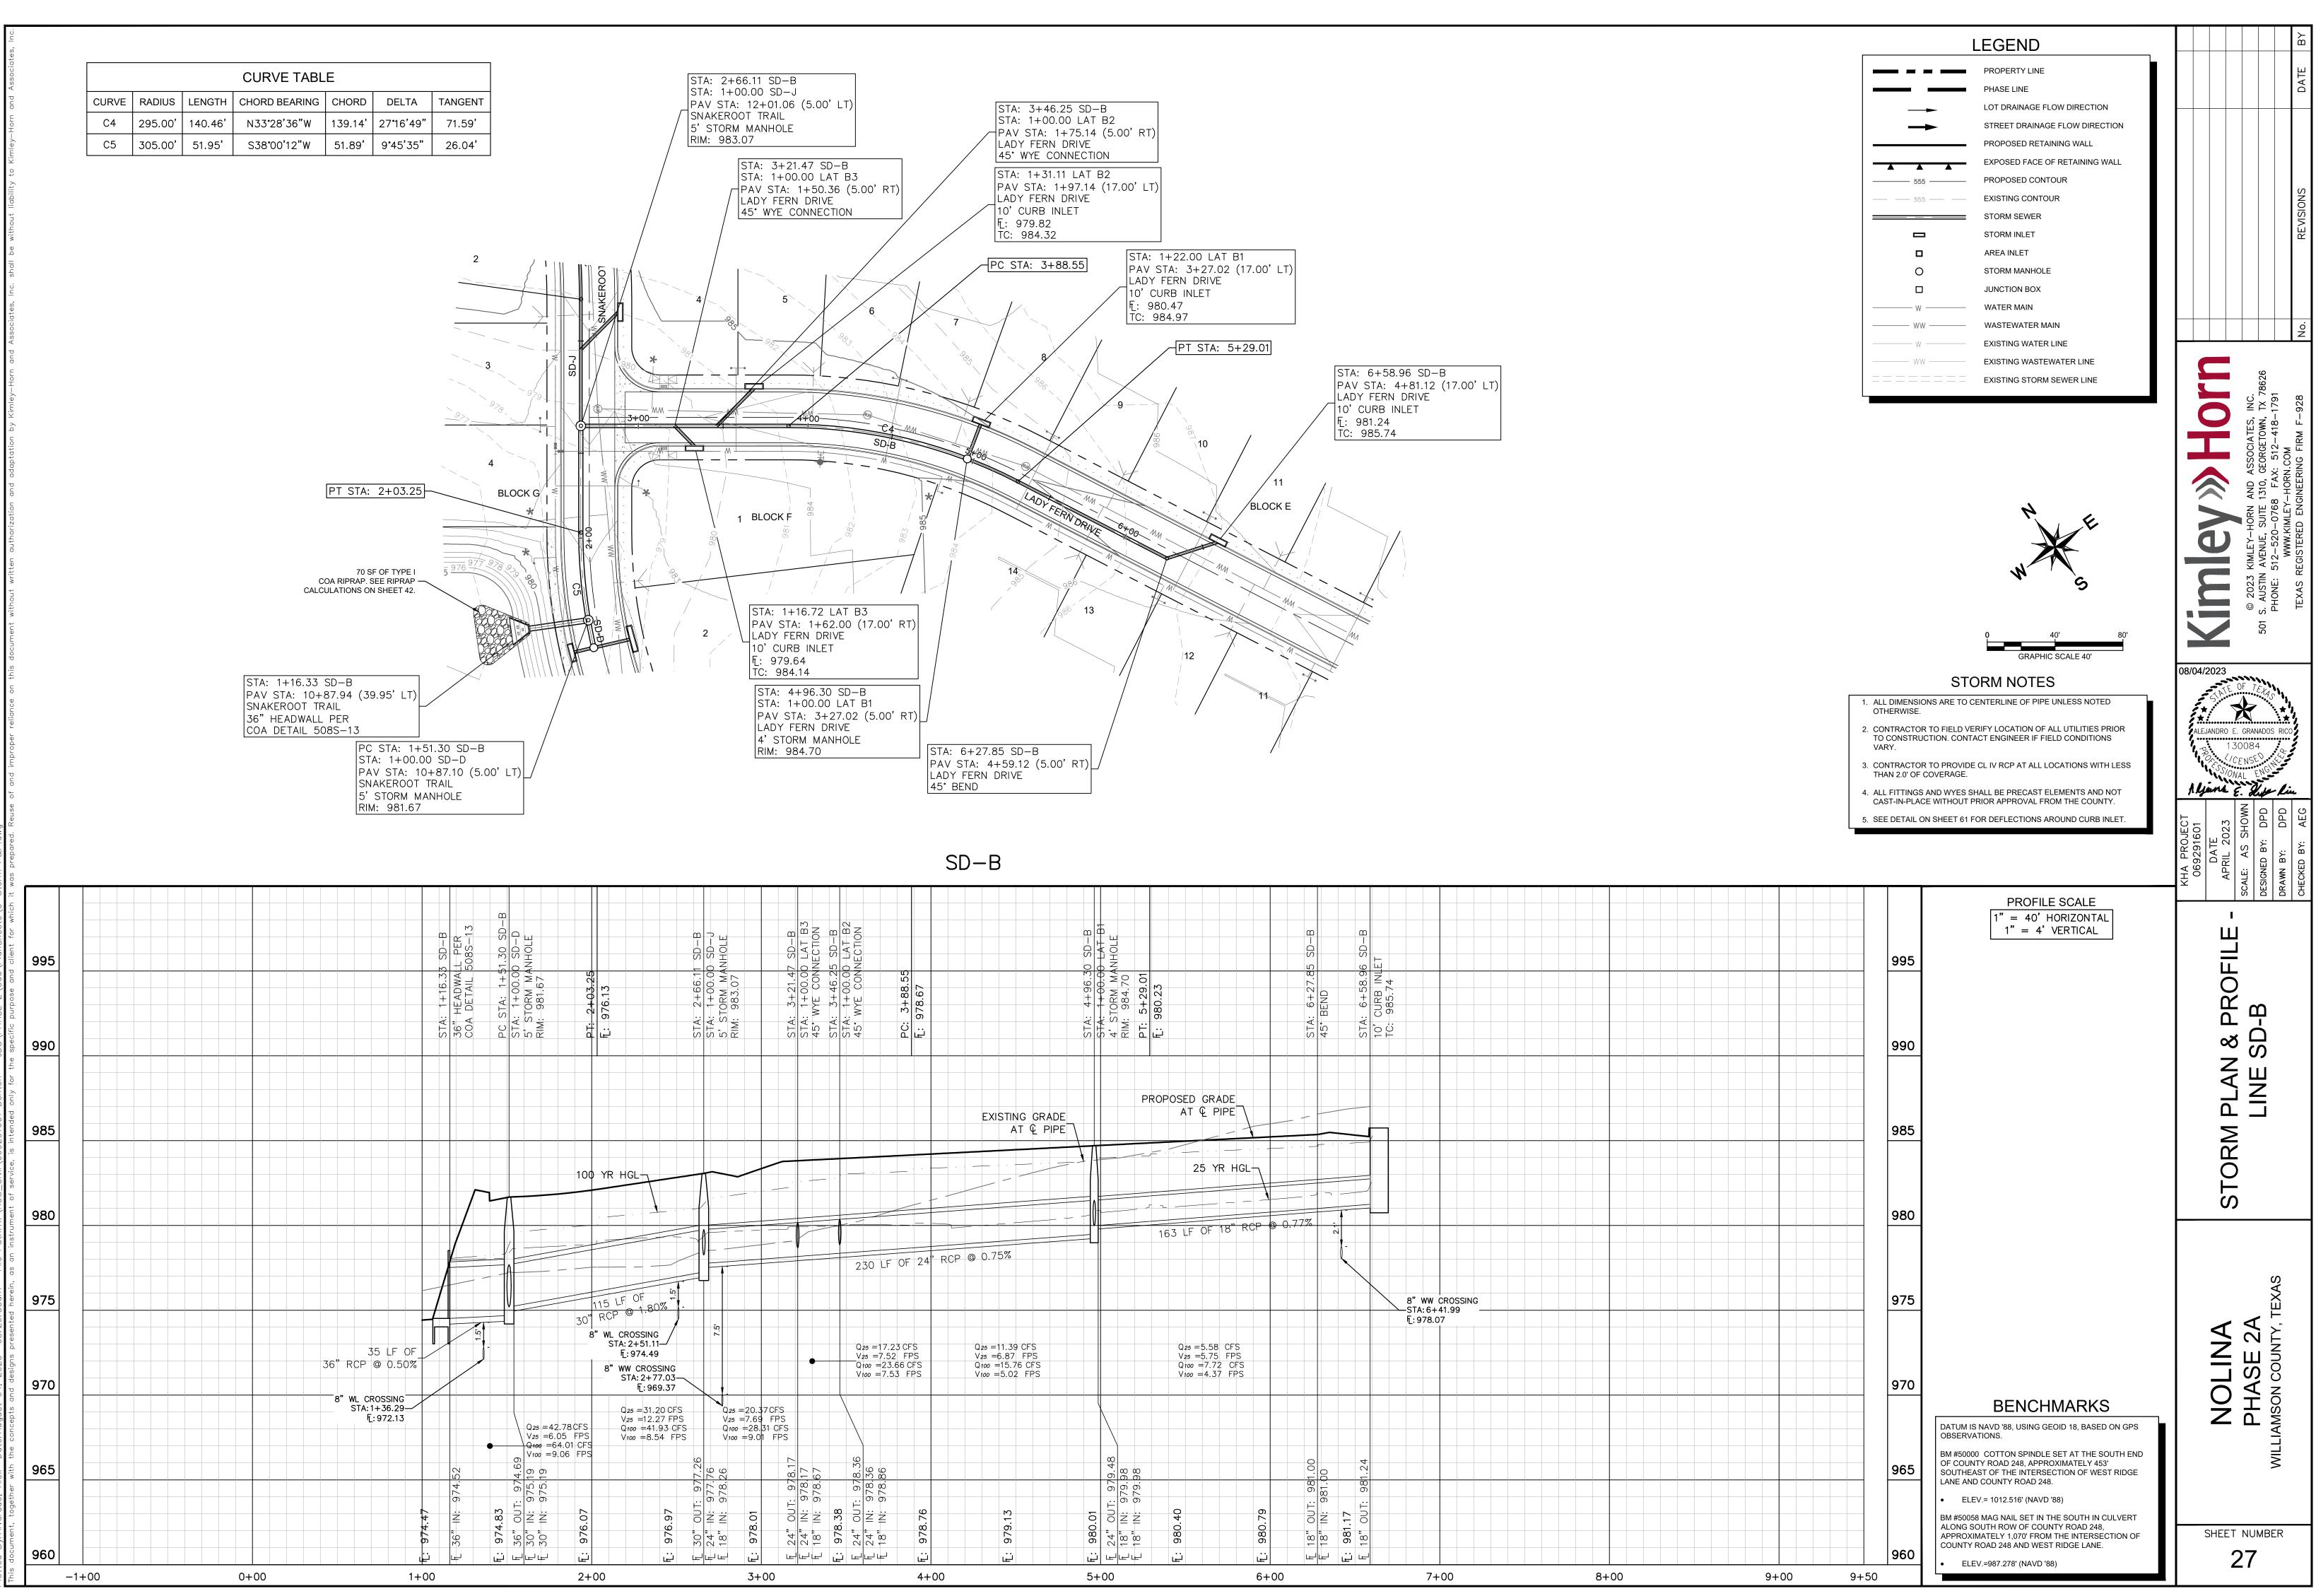


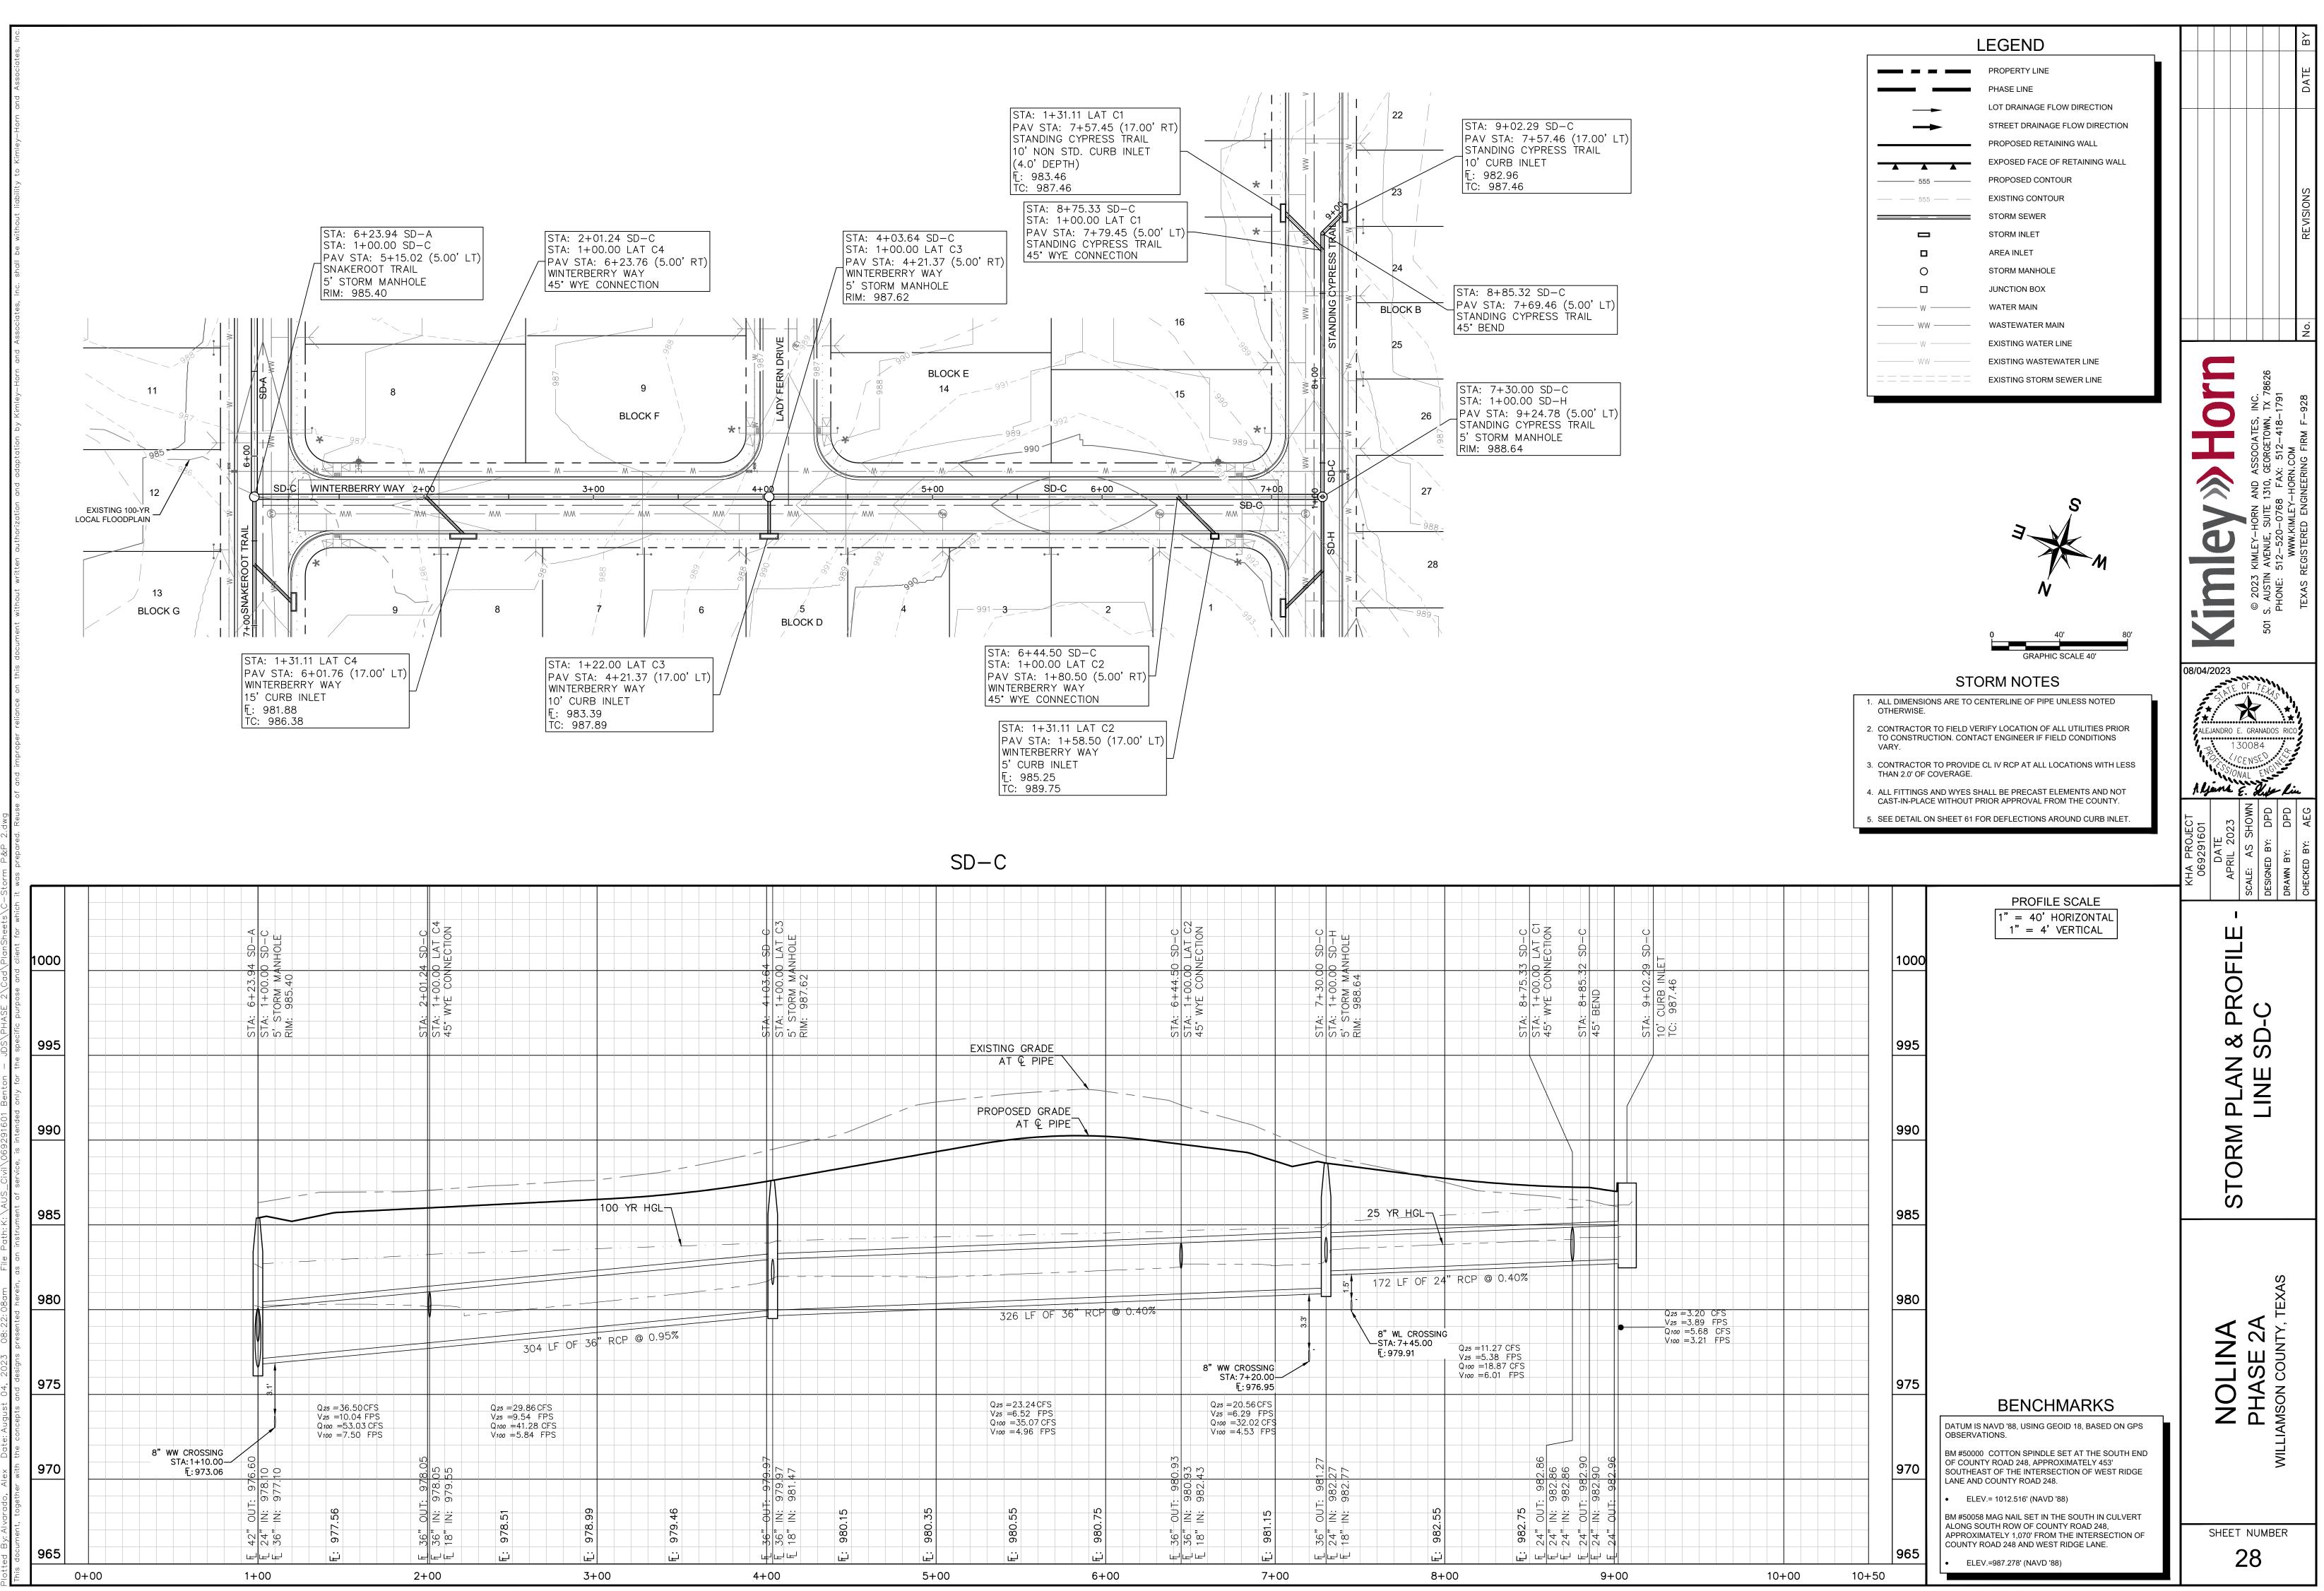

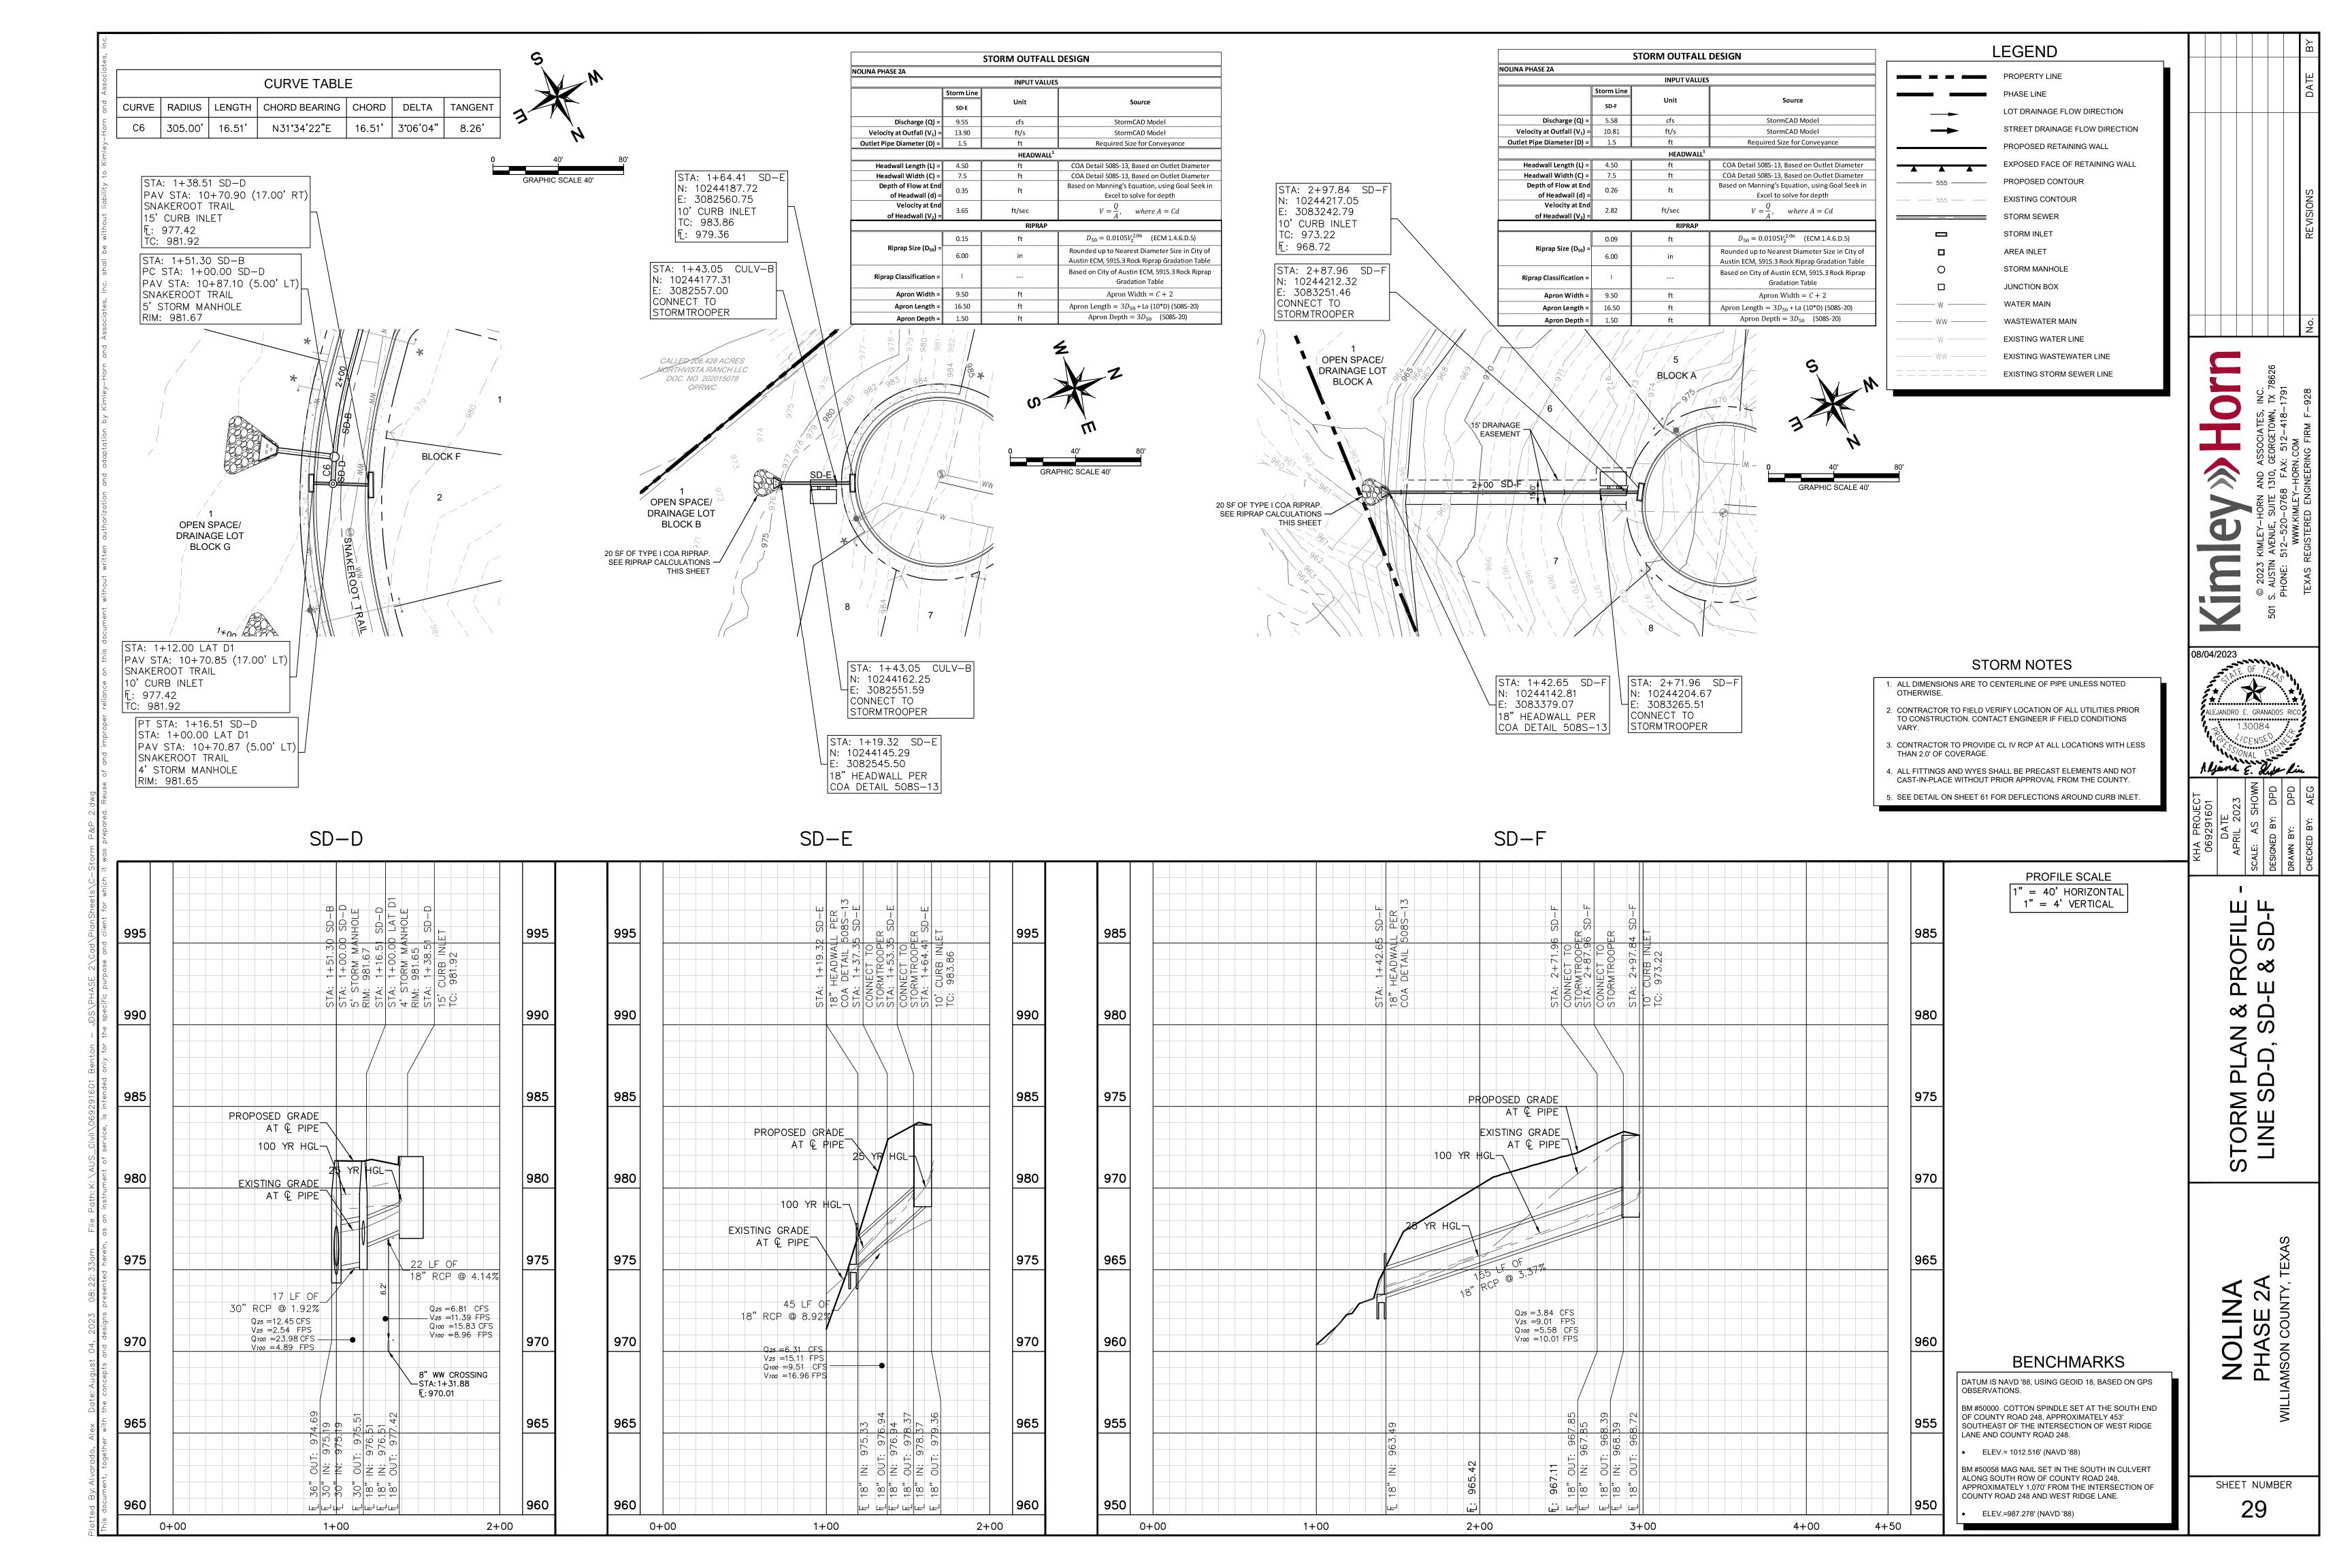


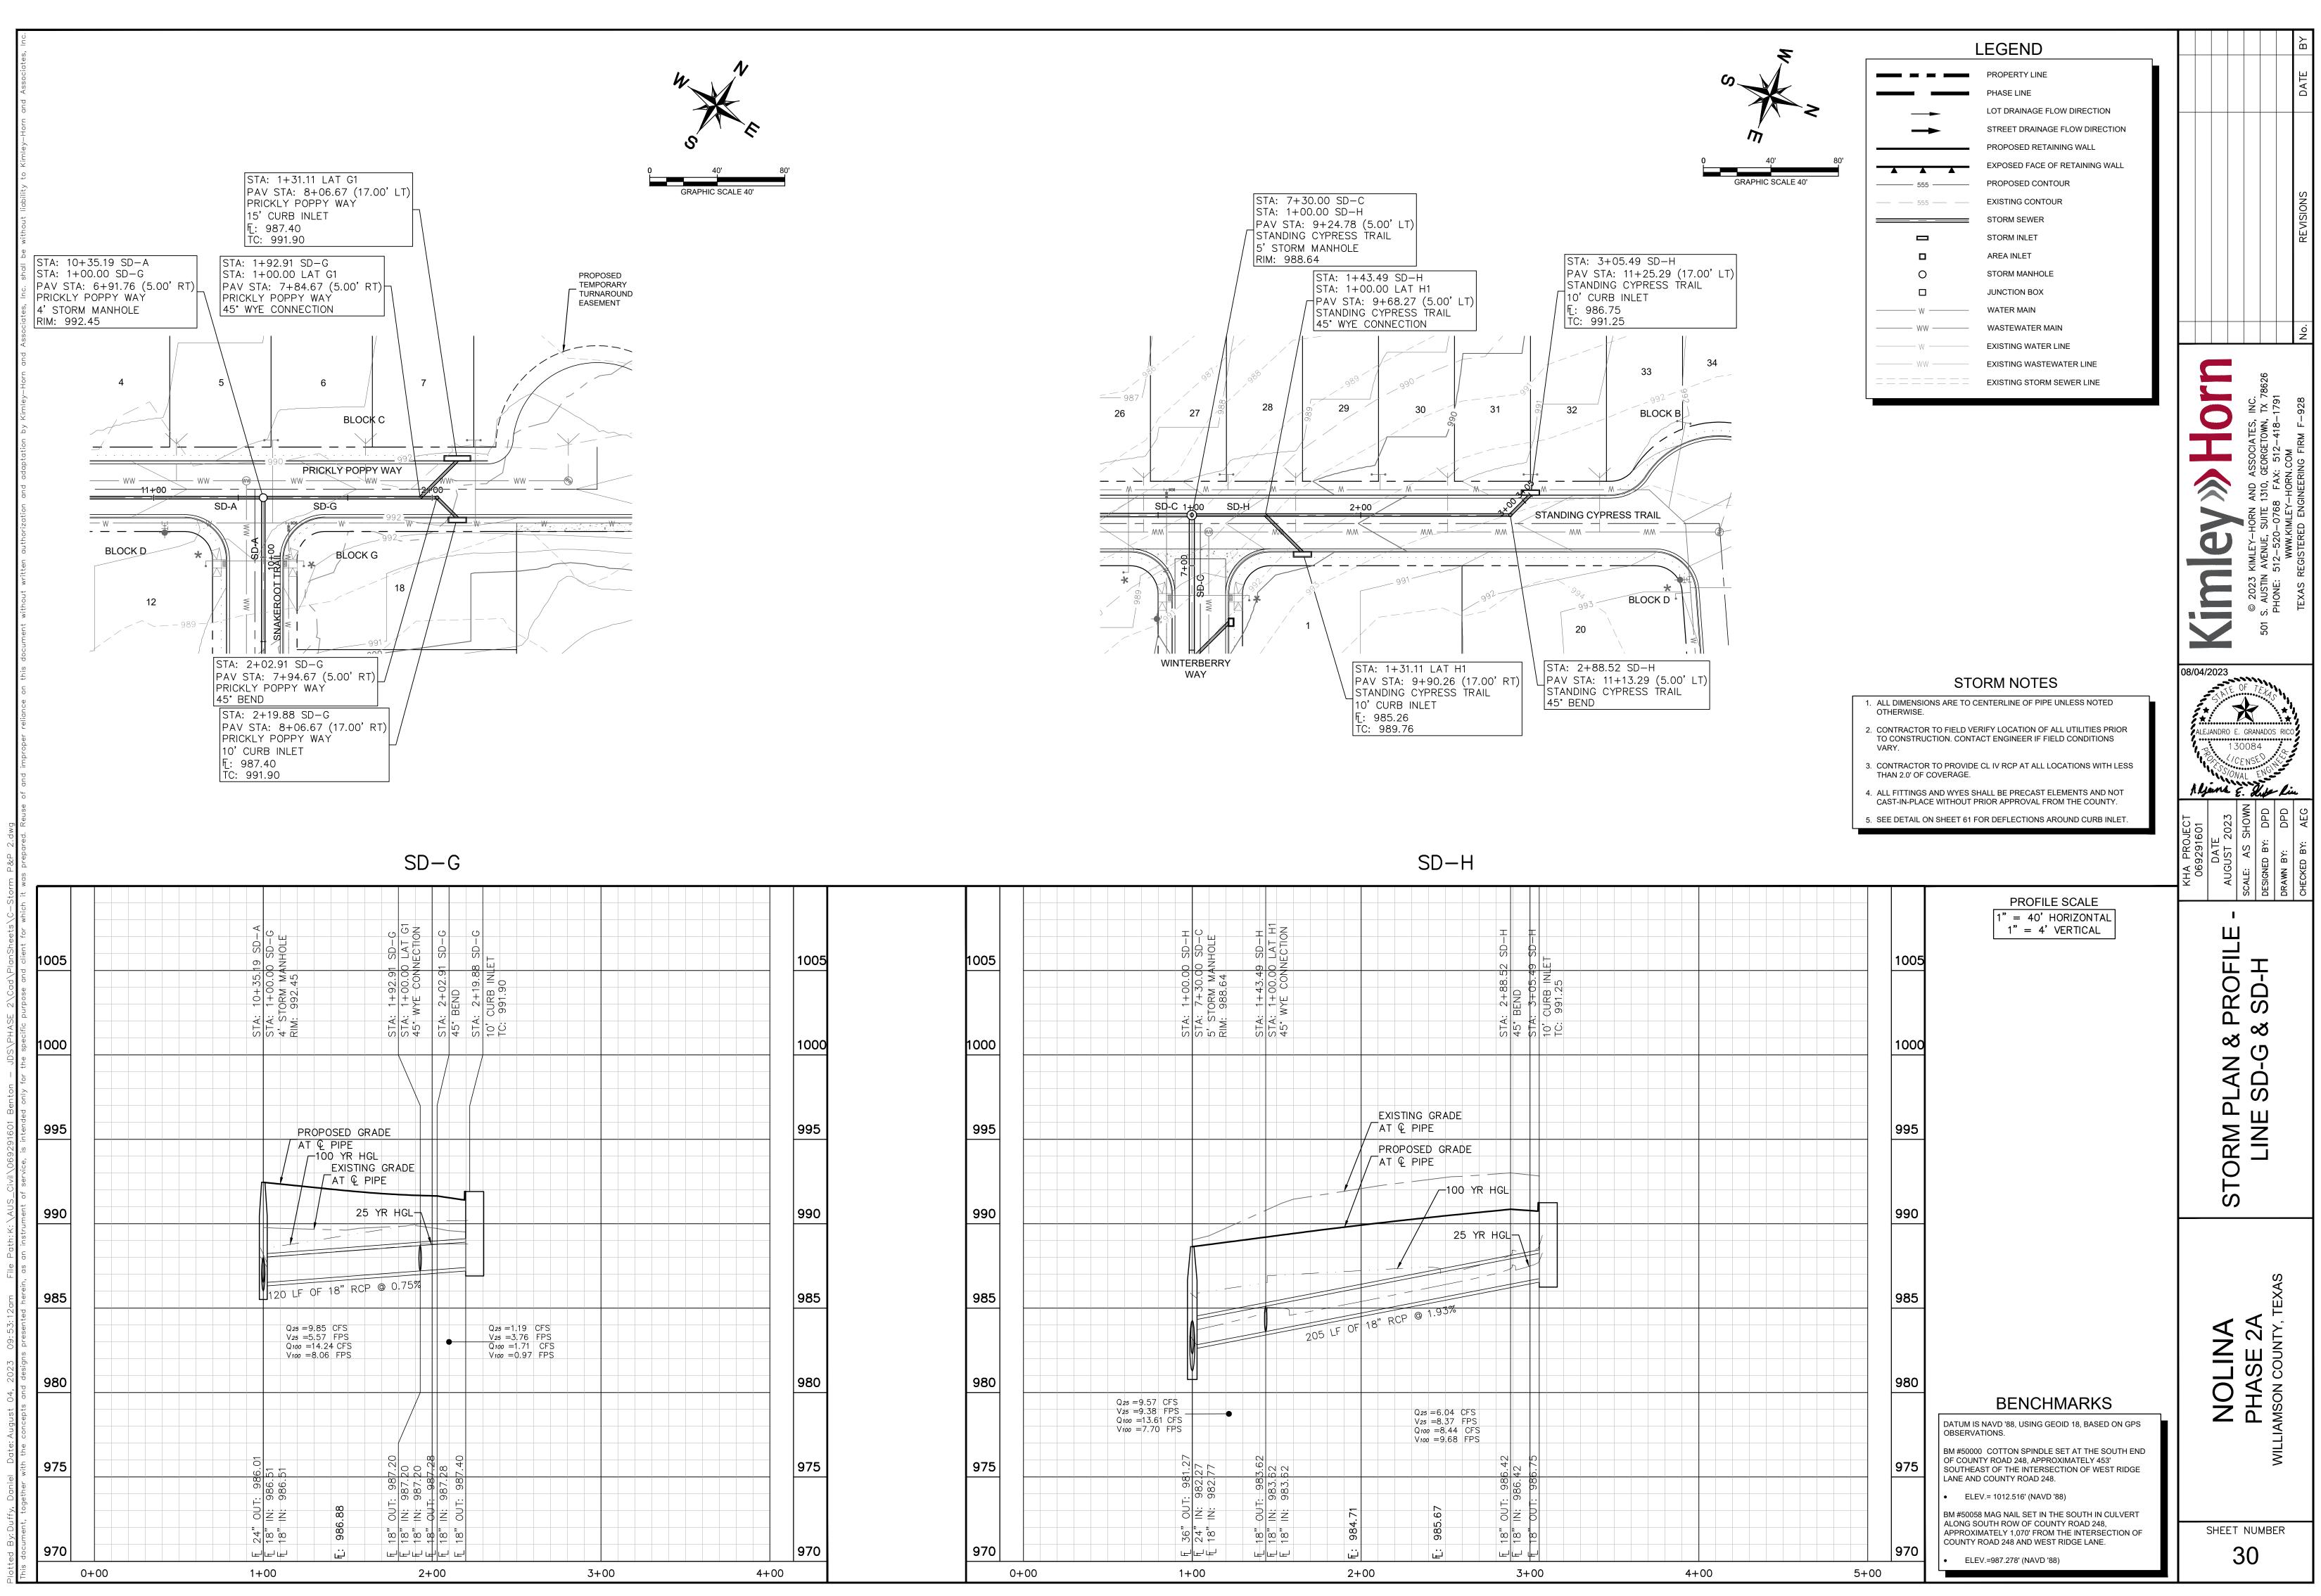

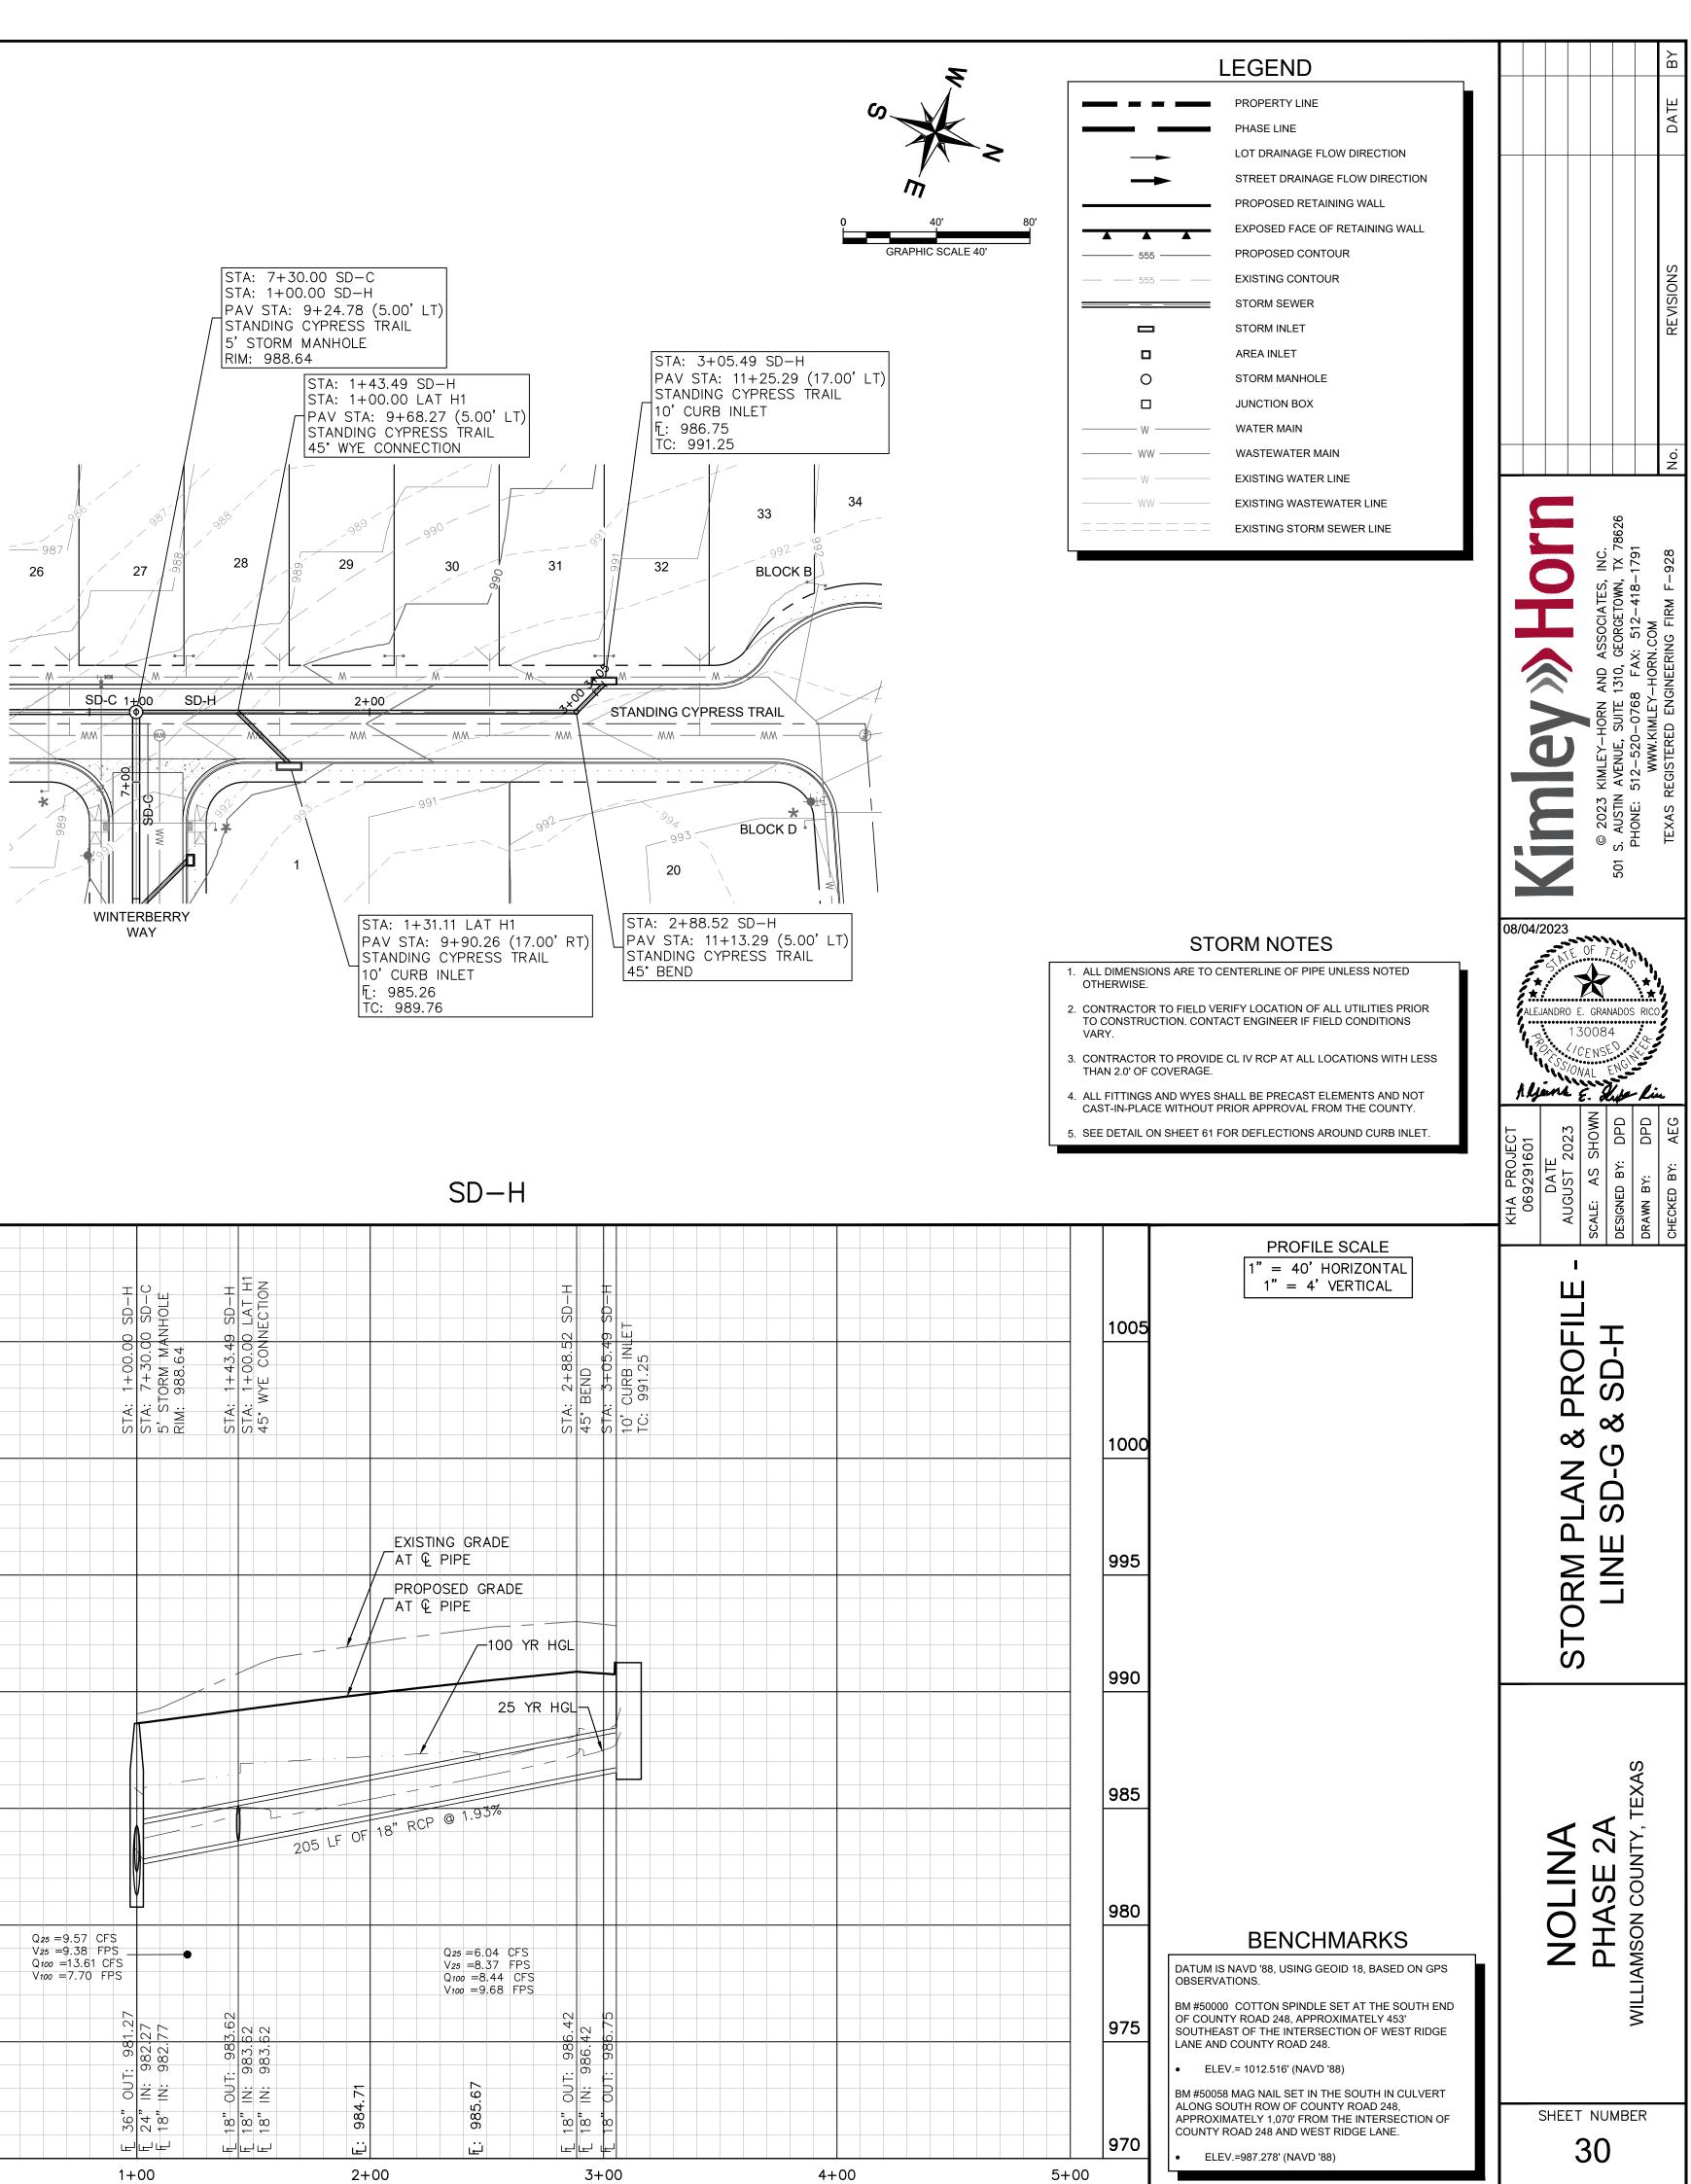


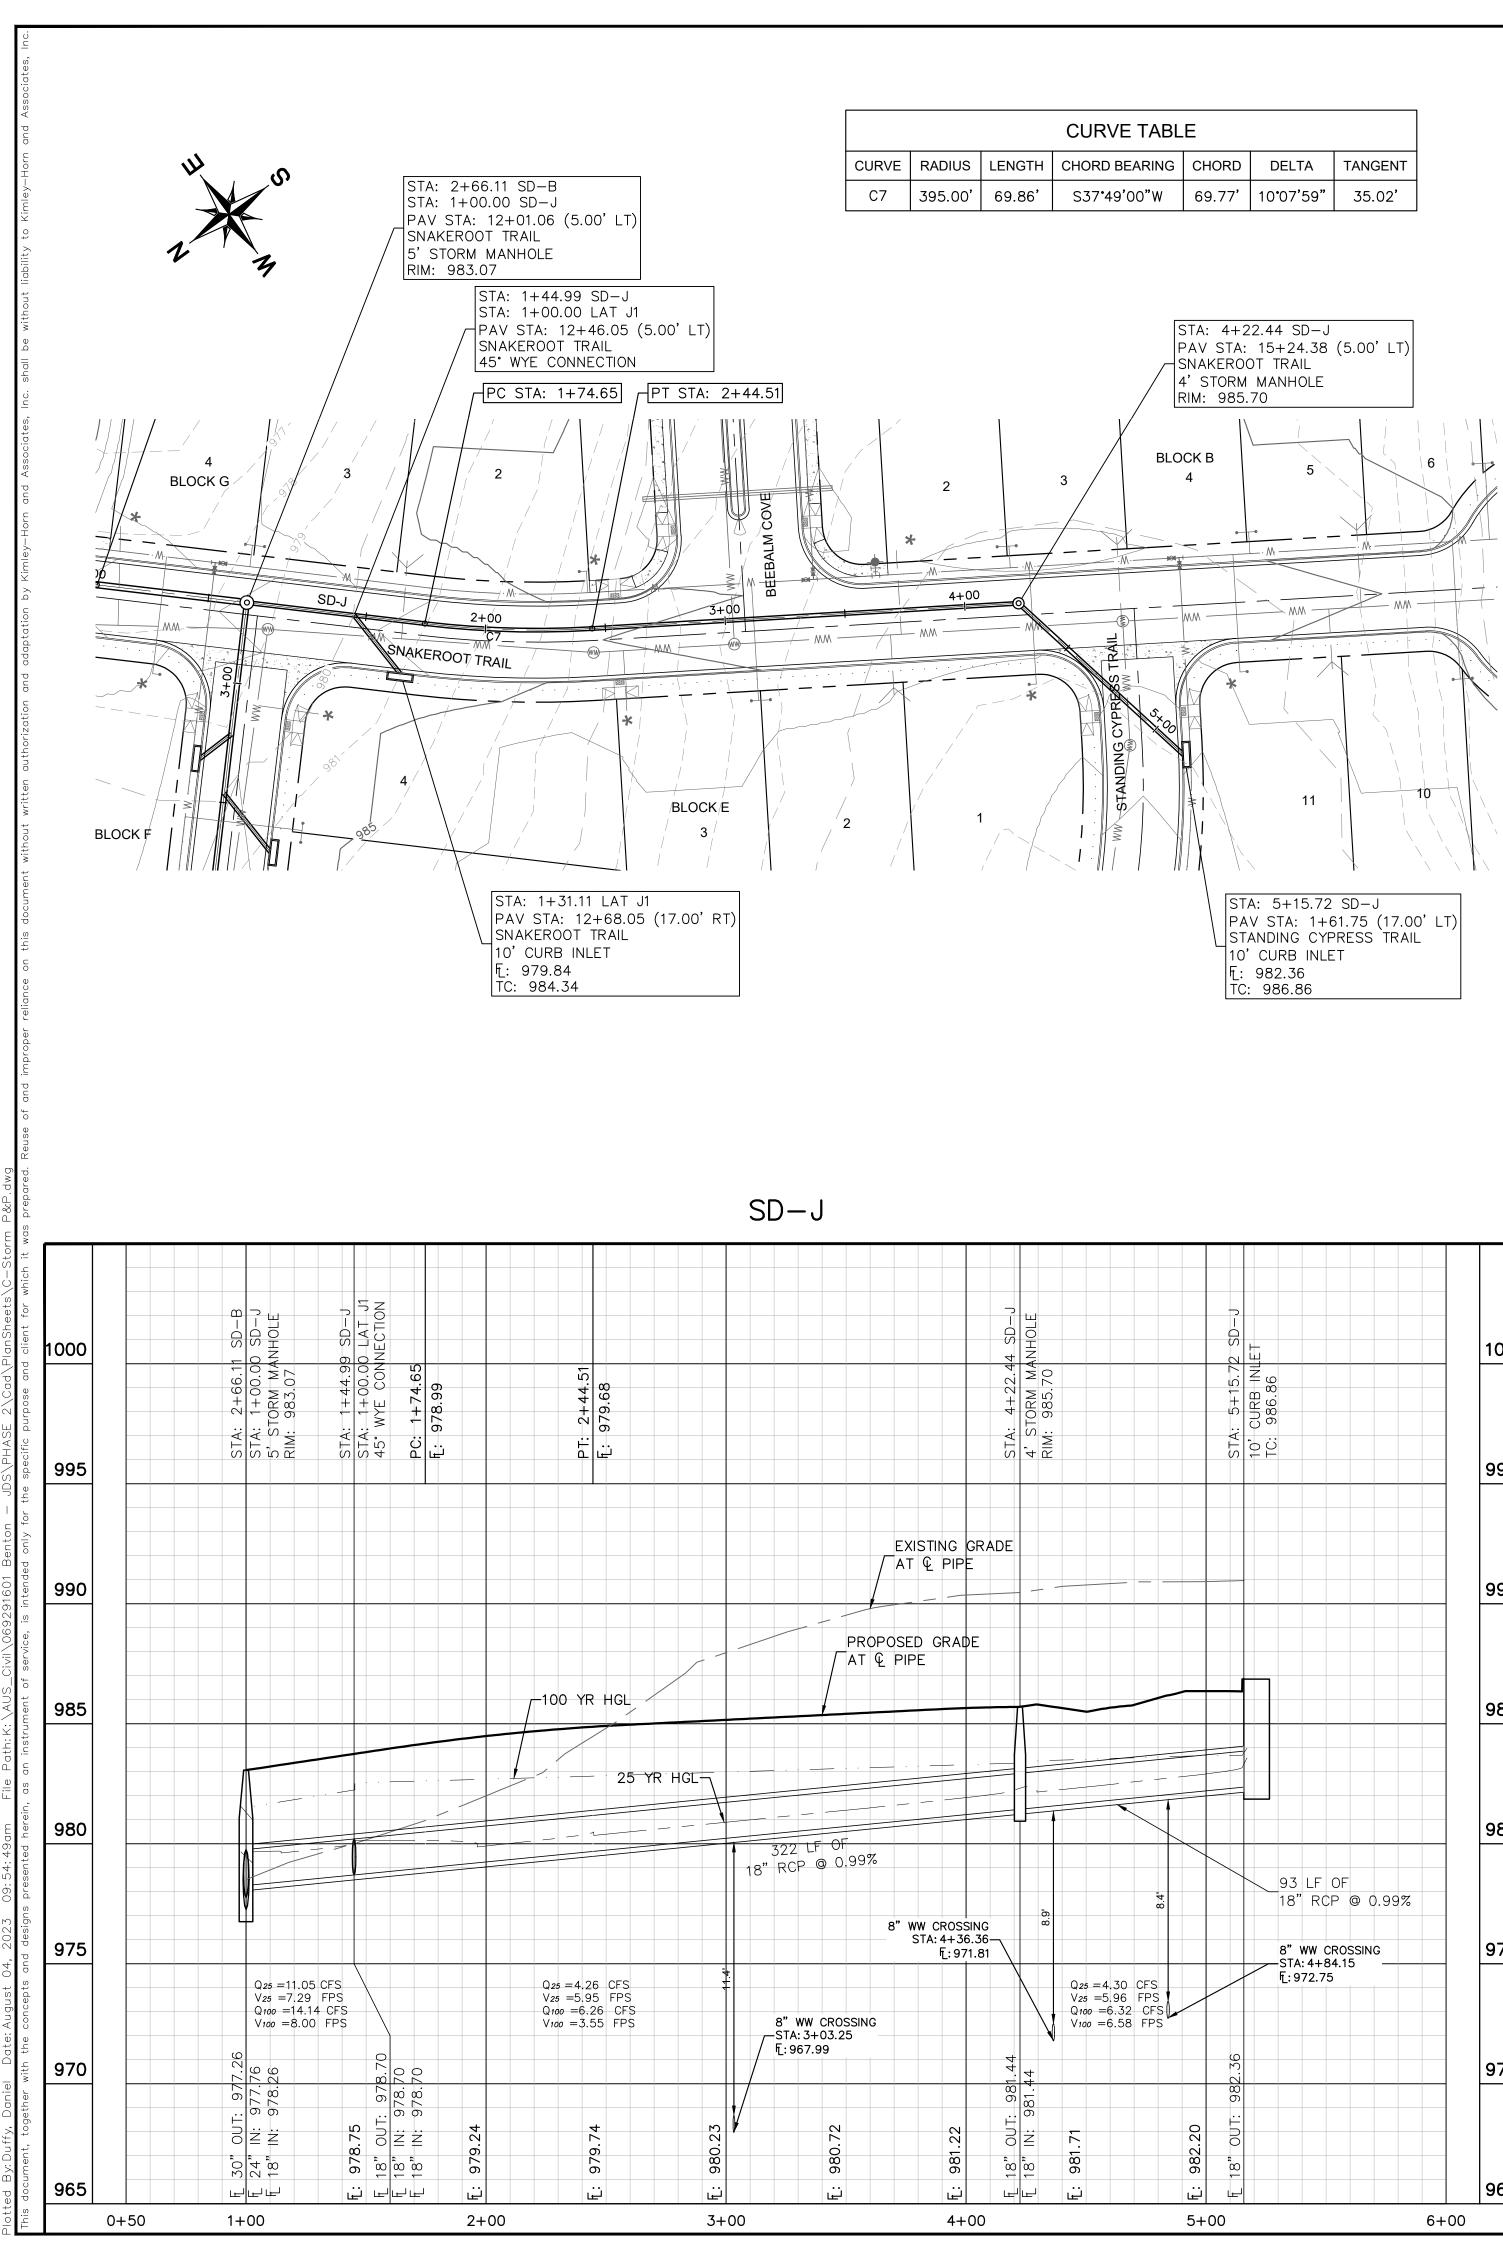


CURVE TABL	E								
CHORD BEARING	CHORD	DELTA	TANGENT						
S37°49'00"W 69.77' 10°07'59" 35.02'									

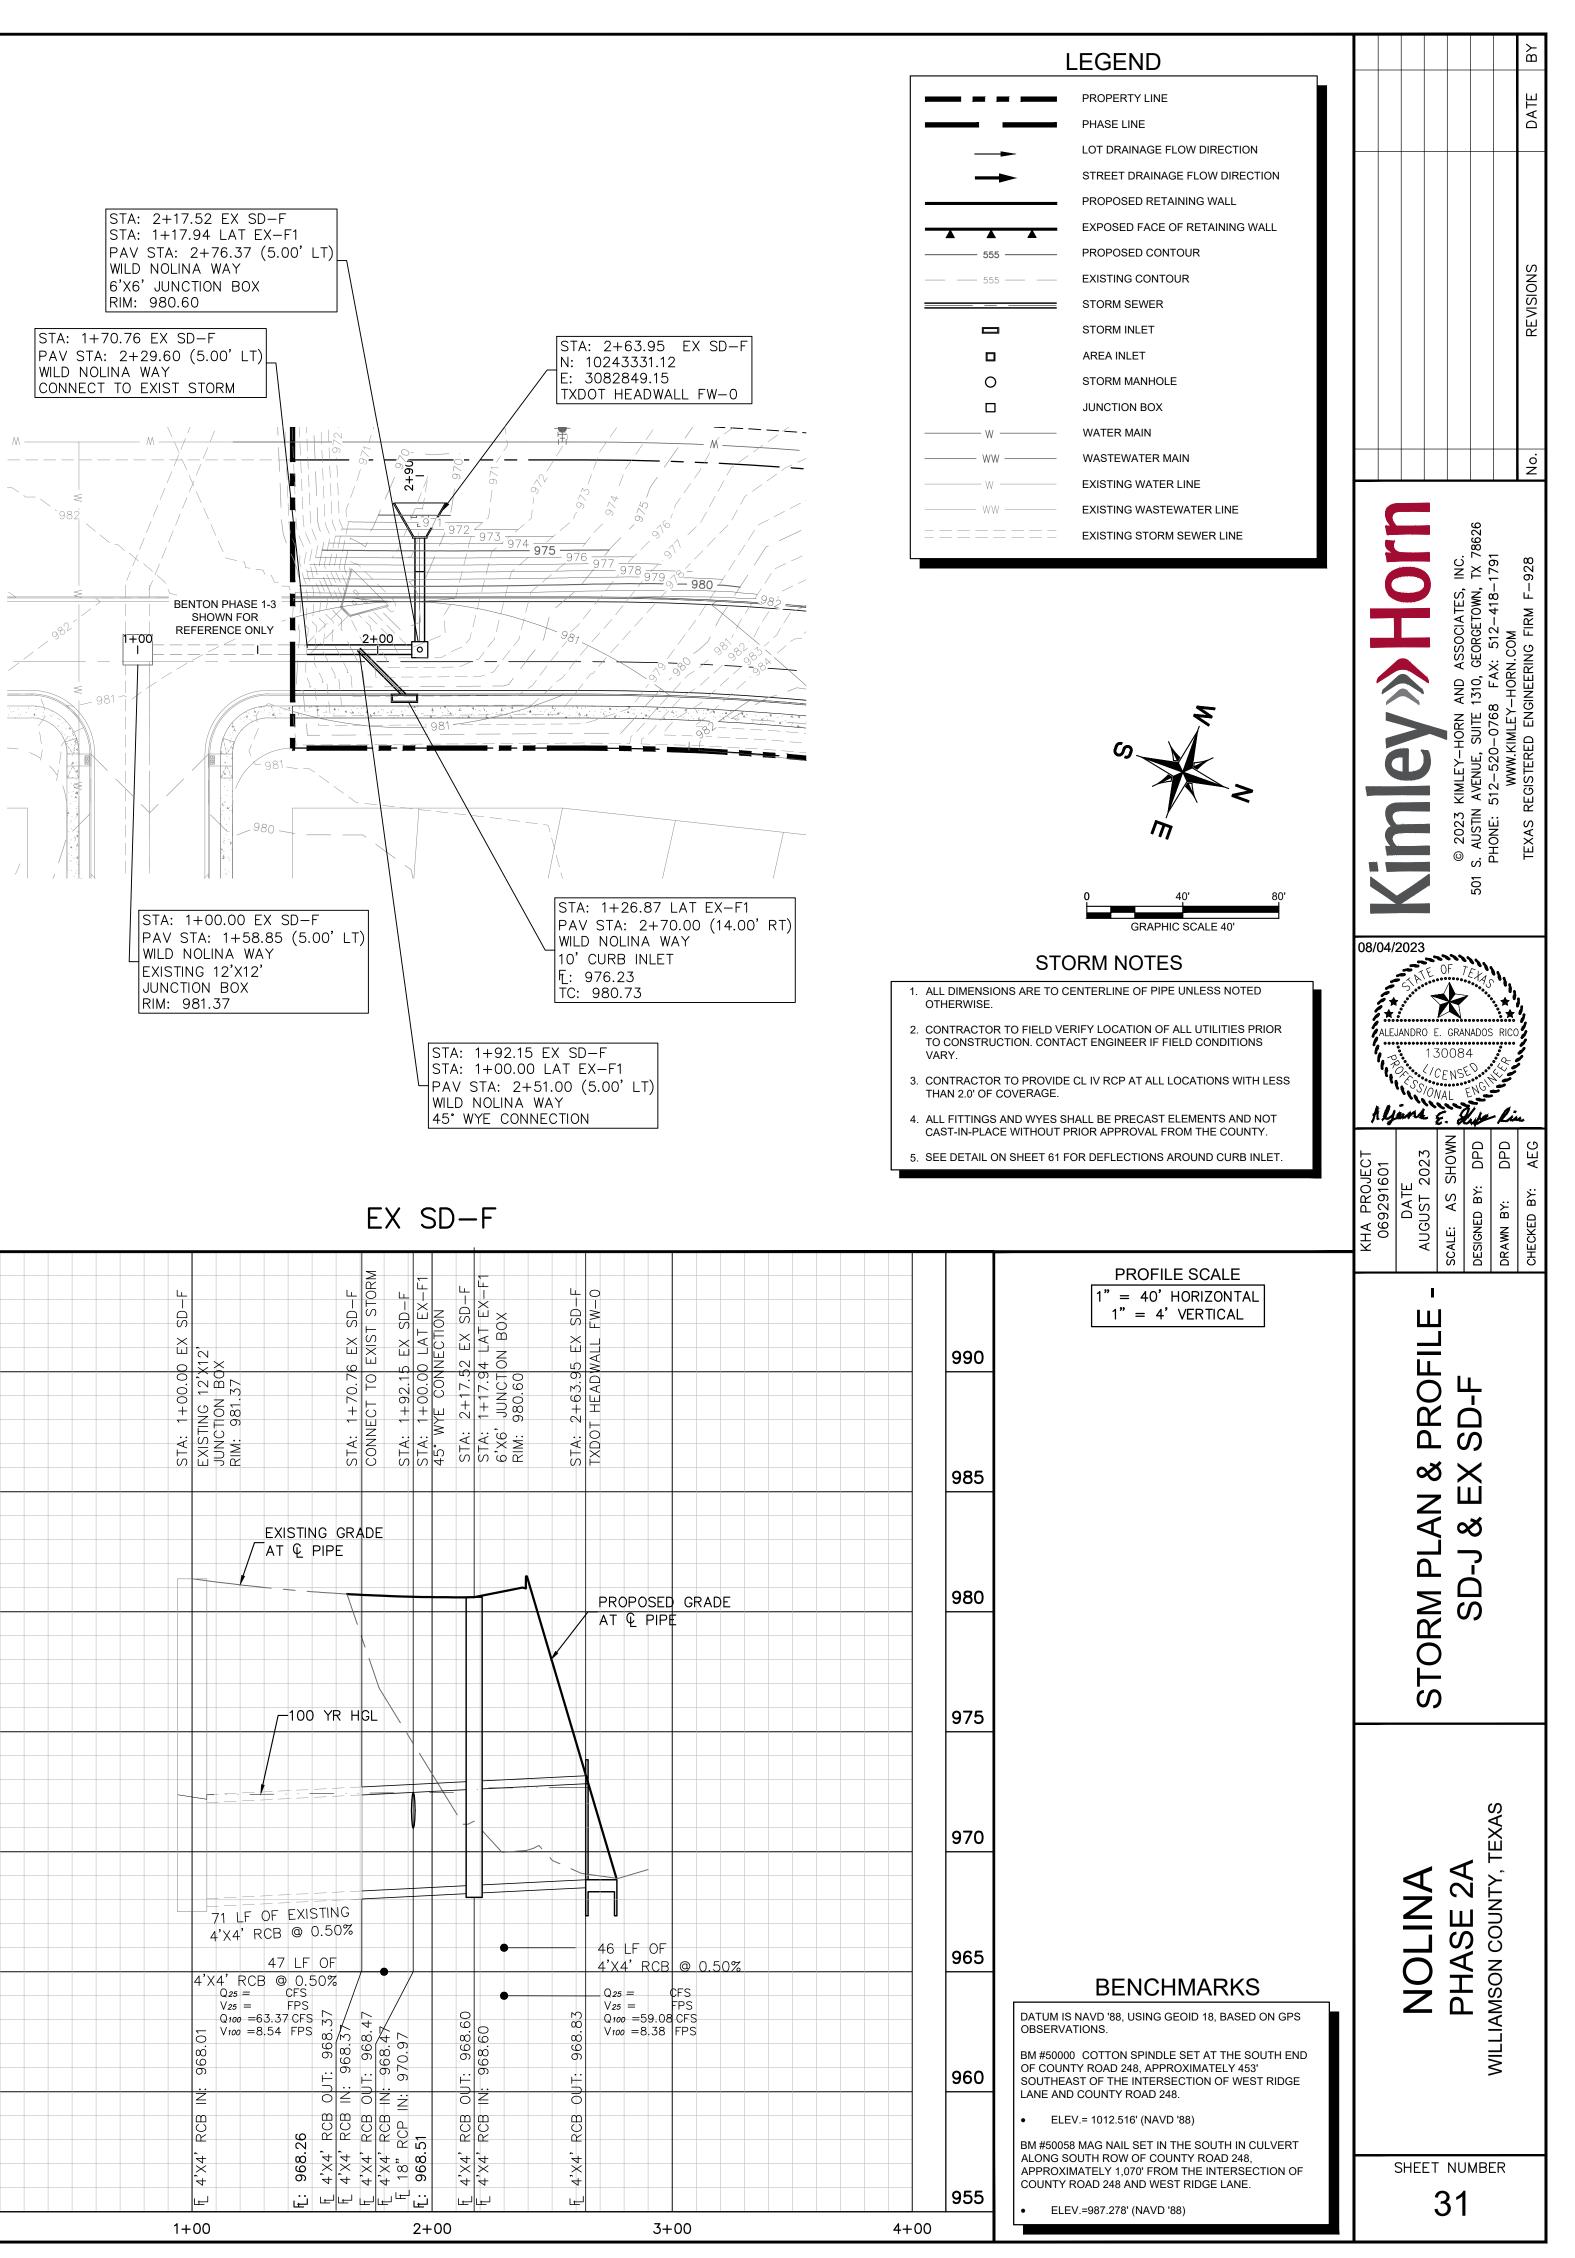


0+00

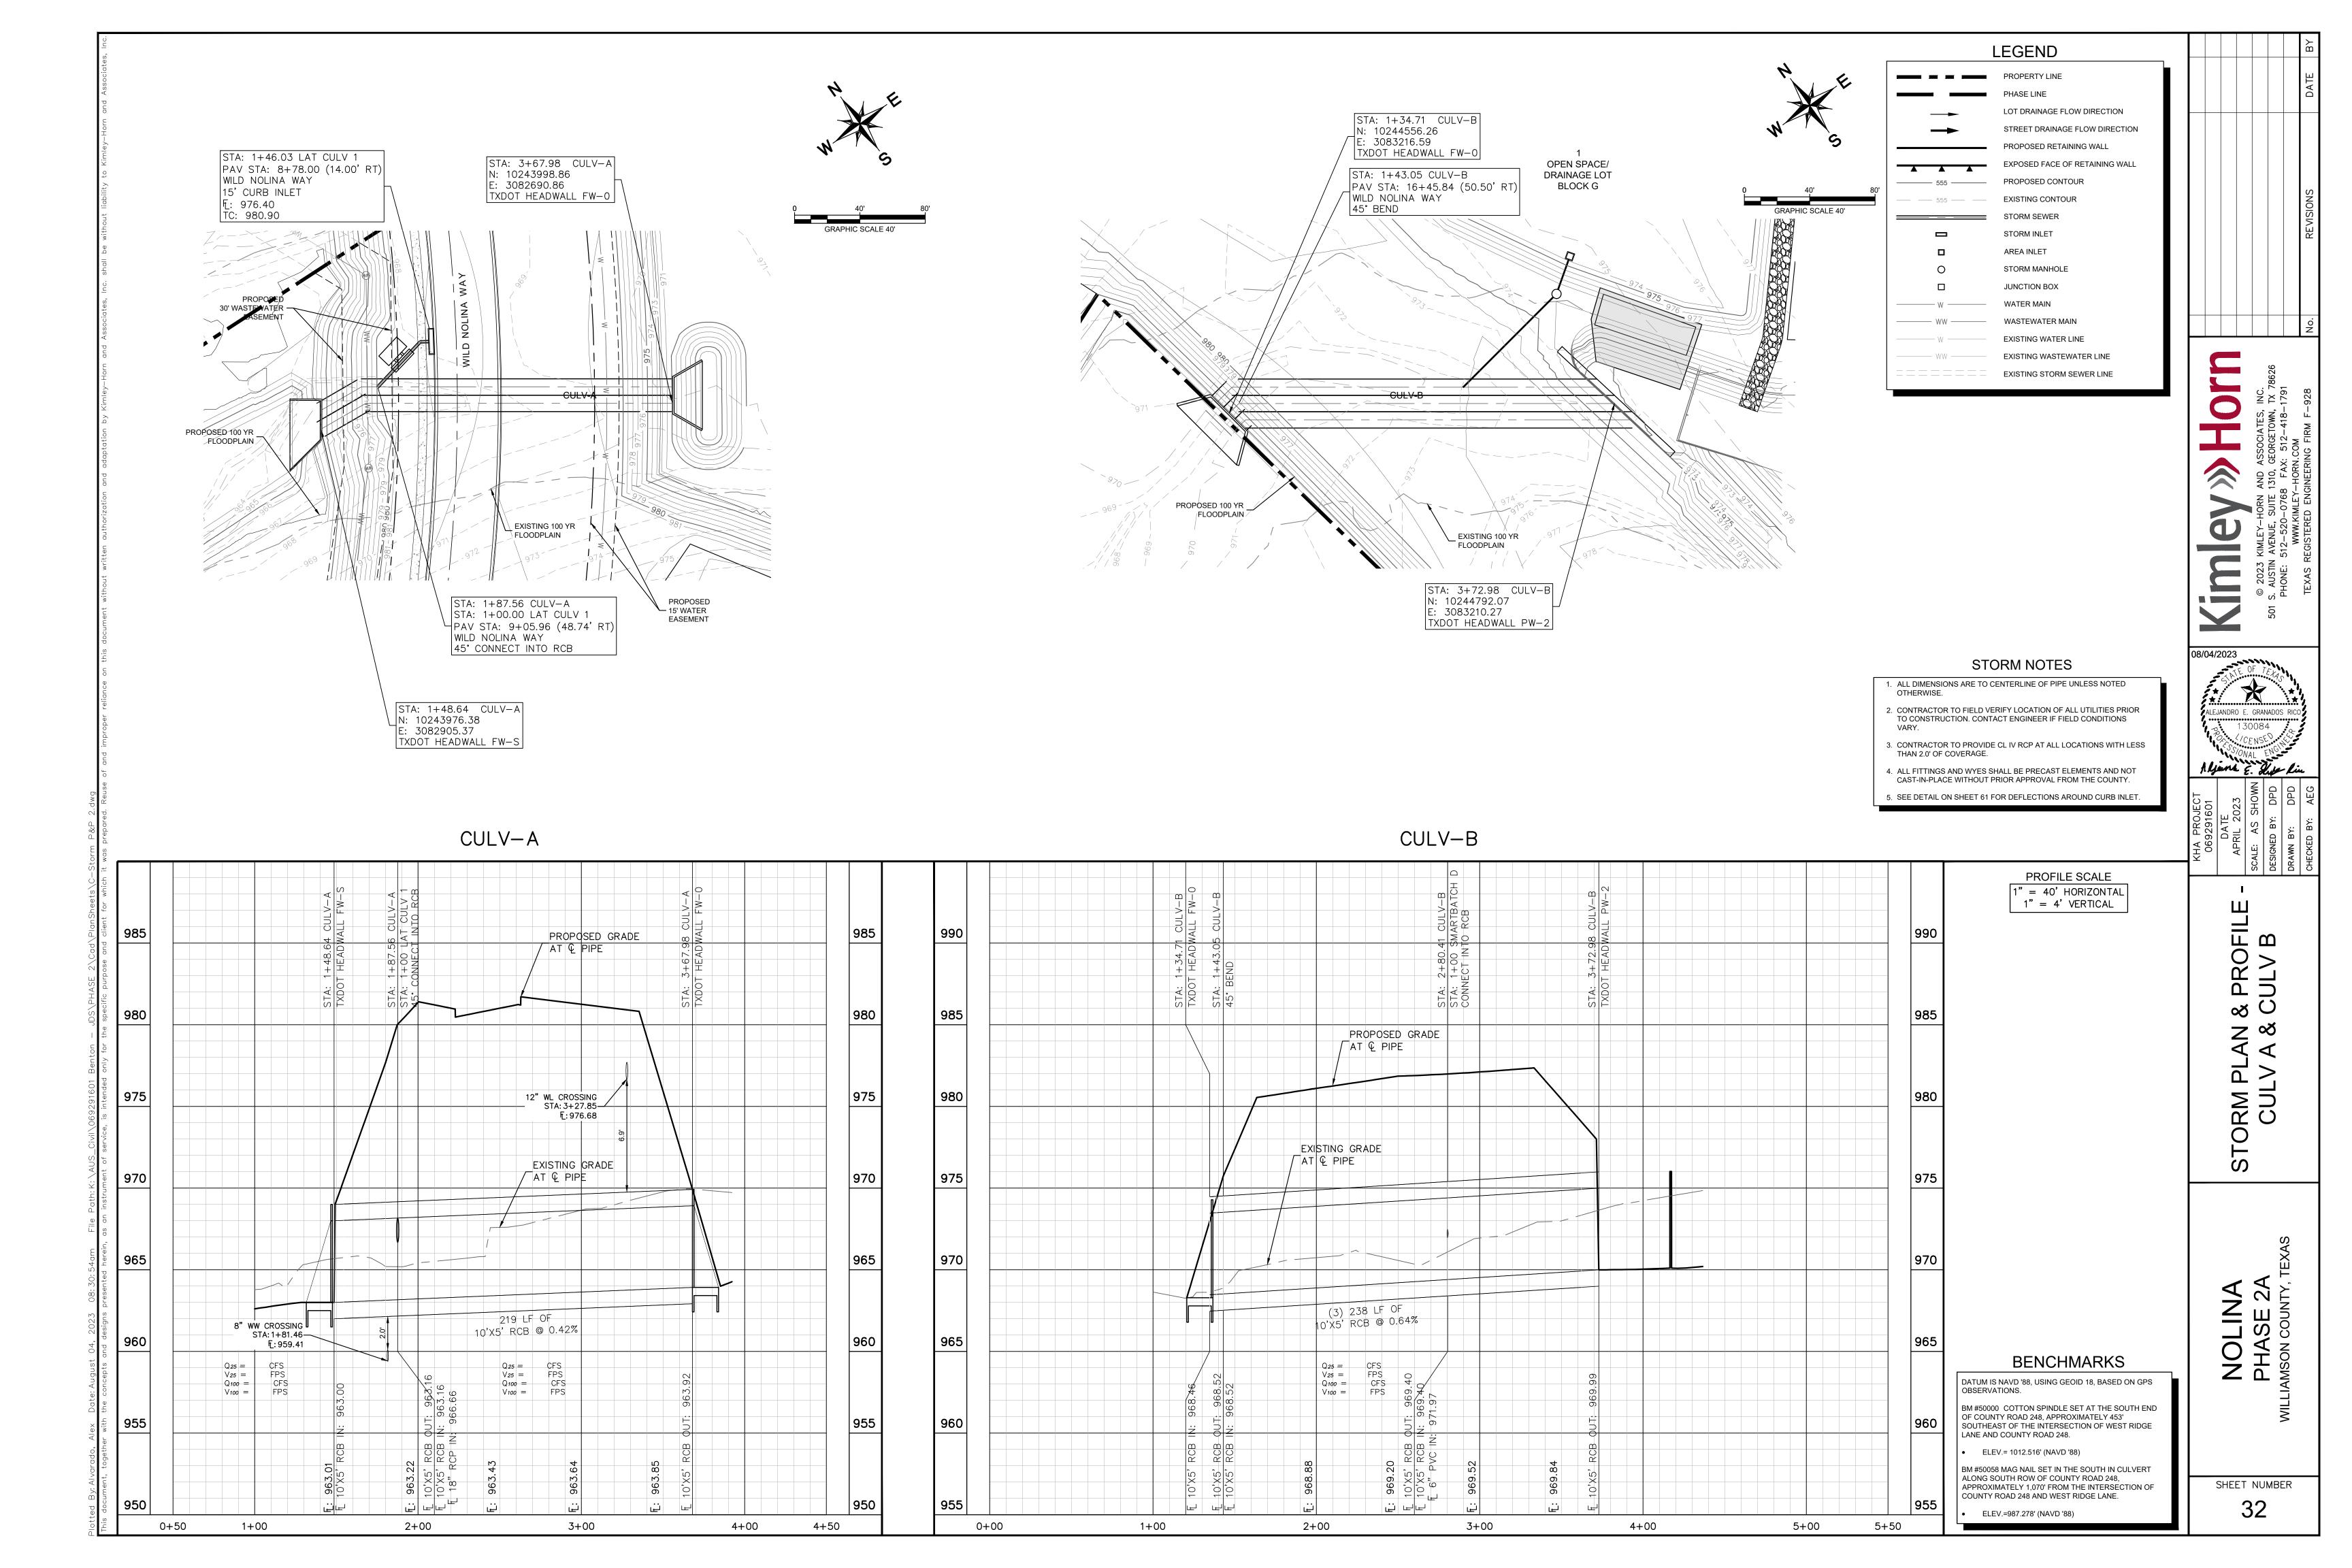


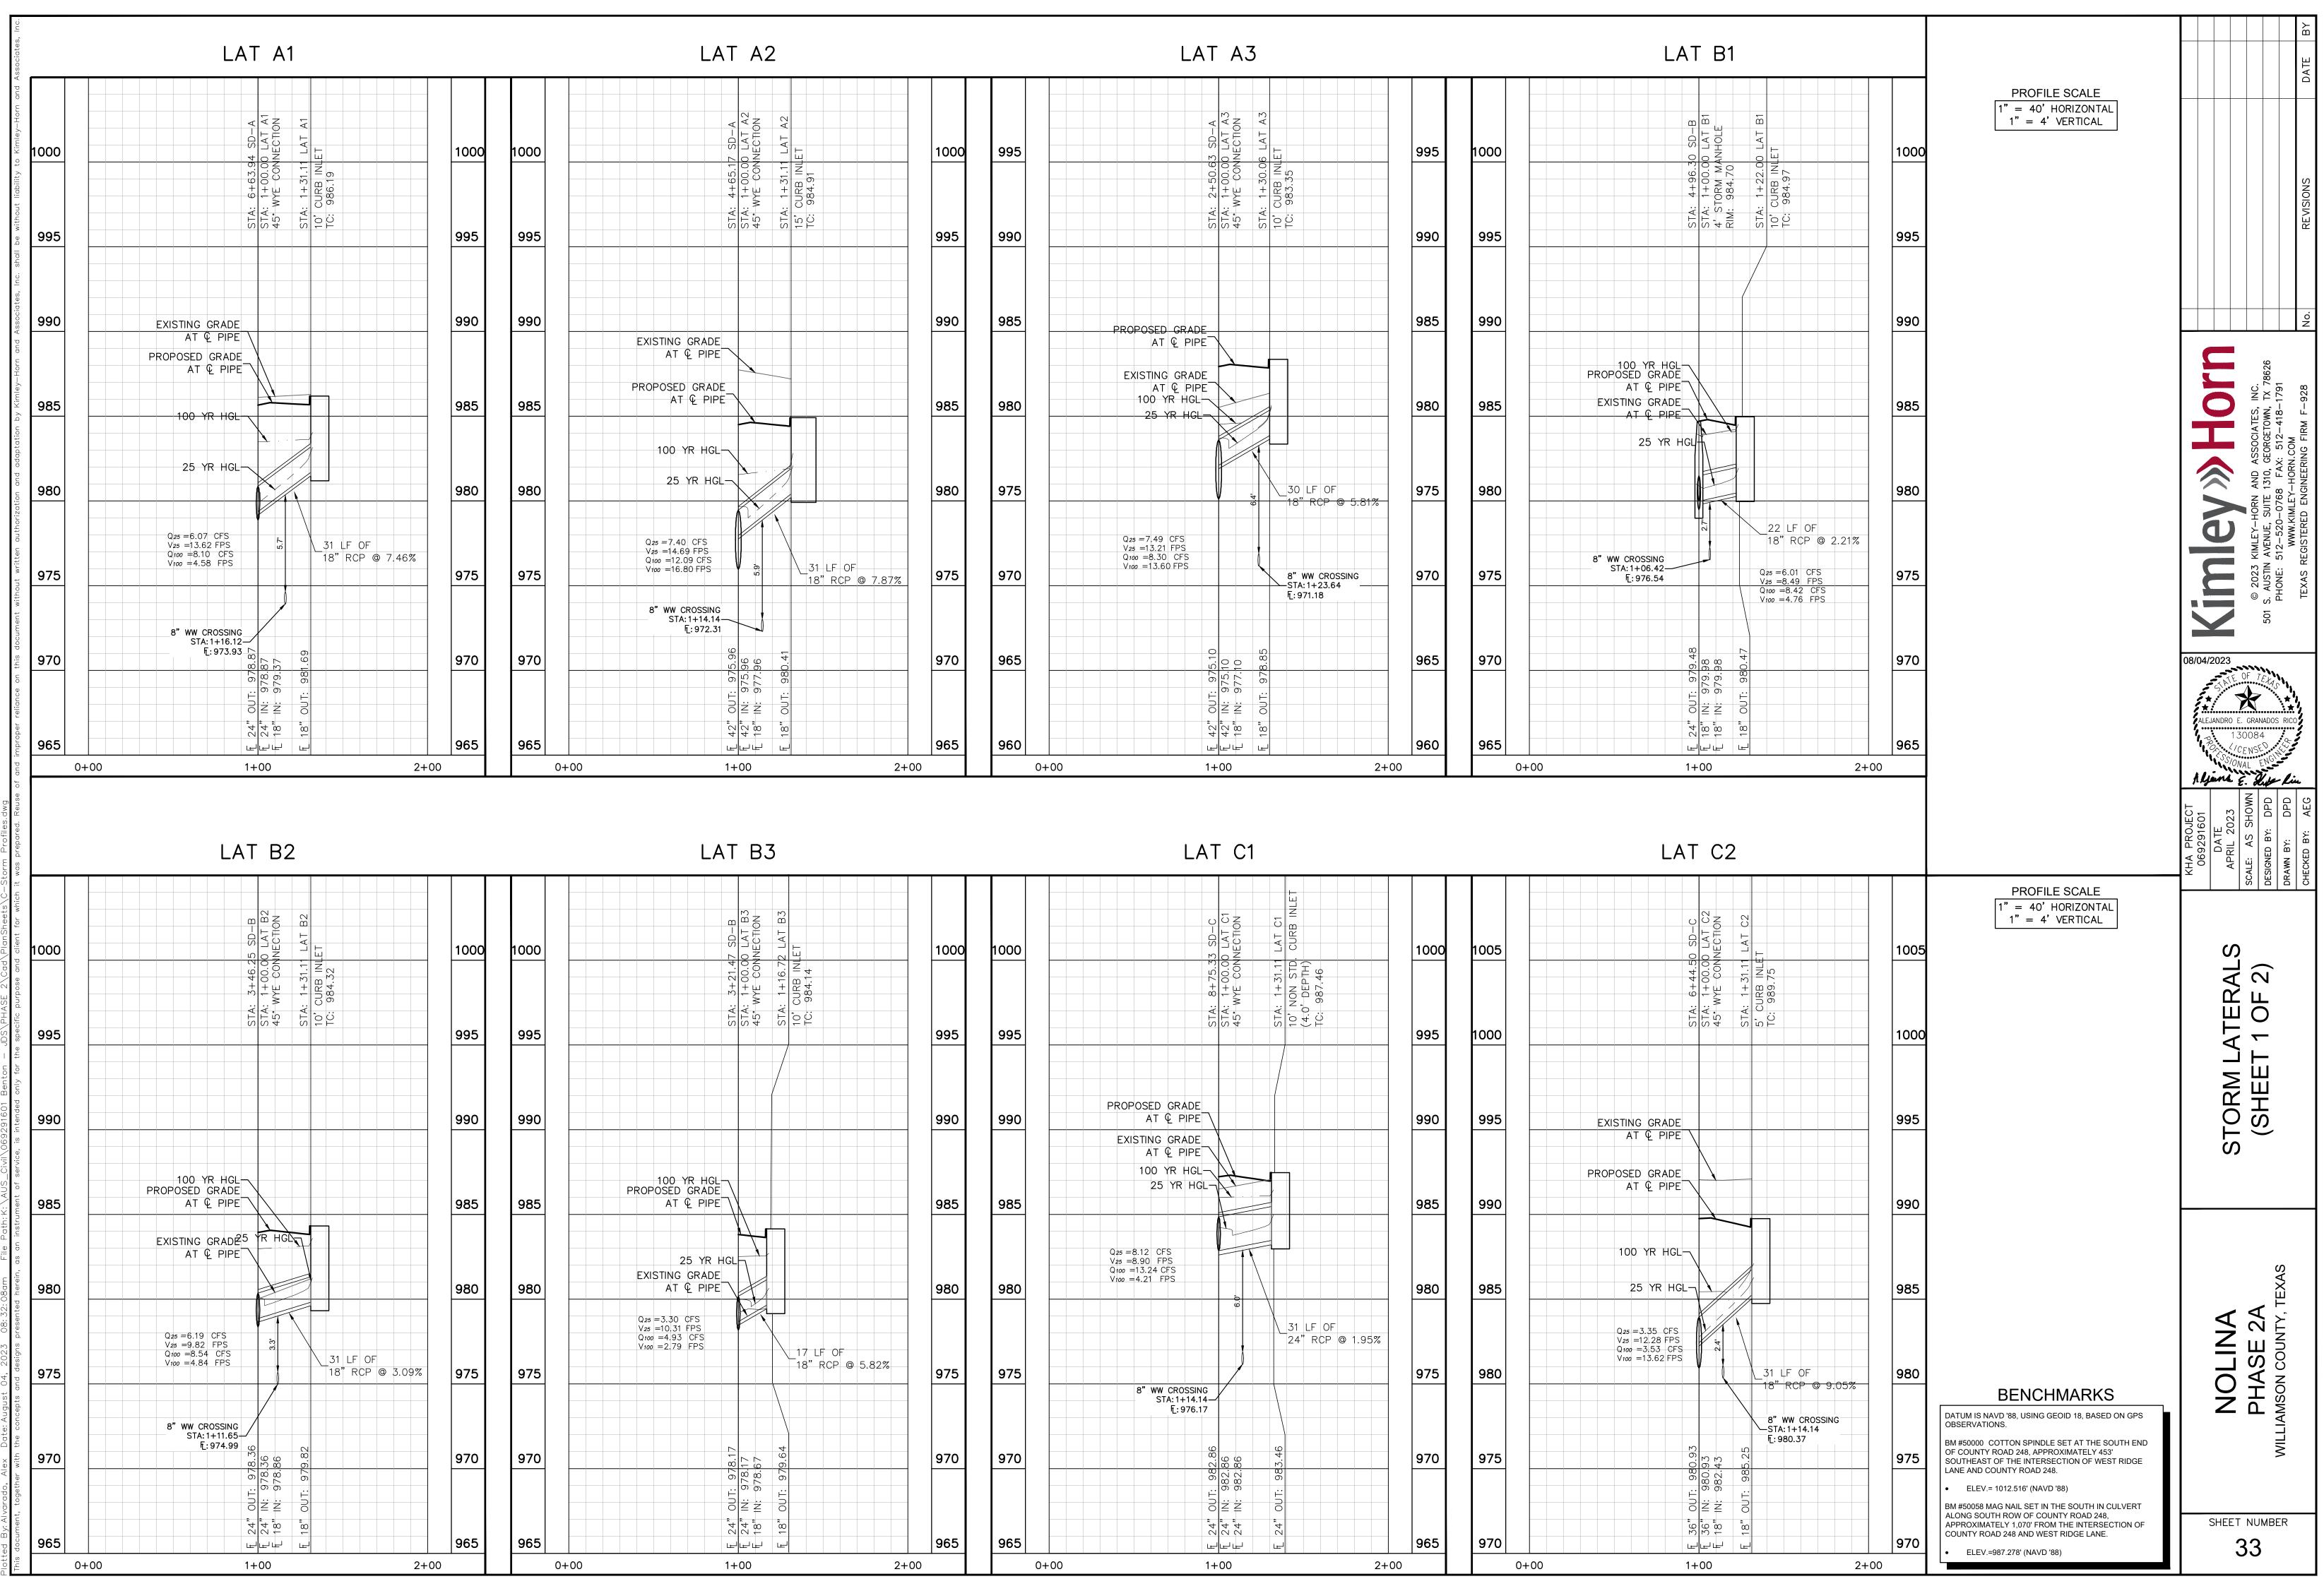

6 10, CURB IN 6 10, CURB IN 6 10, CURB IN	000 1000 995 995 990 990 985 985		PROPOSED GR AT Q EXISTING GR AT Q 100 YR 25 YF	PIPE RADE PIPE	STA: 1+31.11 LAT C 10' NON STD. CURB		1000 995 990	1005 1000 995	
	990 990		AT Q EXISTING GR AT Q 100 YR	RADE PIPE RADE PIPE HGL					
9			AT Q EXISTING GR AT Q 100 YR	PIPE RADE PIPE HGL			990	995	
9	85 985		100 YR	HGL-					
							985	990	
	80 980		Q ₂₅ =8.12 CFS V ₂₅ =8.90 FPS Q ₁₀₀ =13.24 CFS V ₁₀₀ =4.21 FPS				980	985	
17 LF OF				9 9 1	31 L 24"	.F OF RCP @ 1.95%	7.		
18" RCP @ 5.82% 9	975 975		8" WW CR STA: 1 [:	ROSSING 1+14.14 : 976.17			975	980	
979 979	970 970			1: 982.86 982.86 982.86 982.86 982.86	T: 983.46		970	975	
30 11 1<	965 965	0+00		1+00 1-24	F 24" OUT:		965 2+00	970	

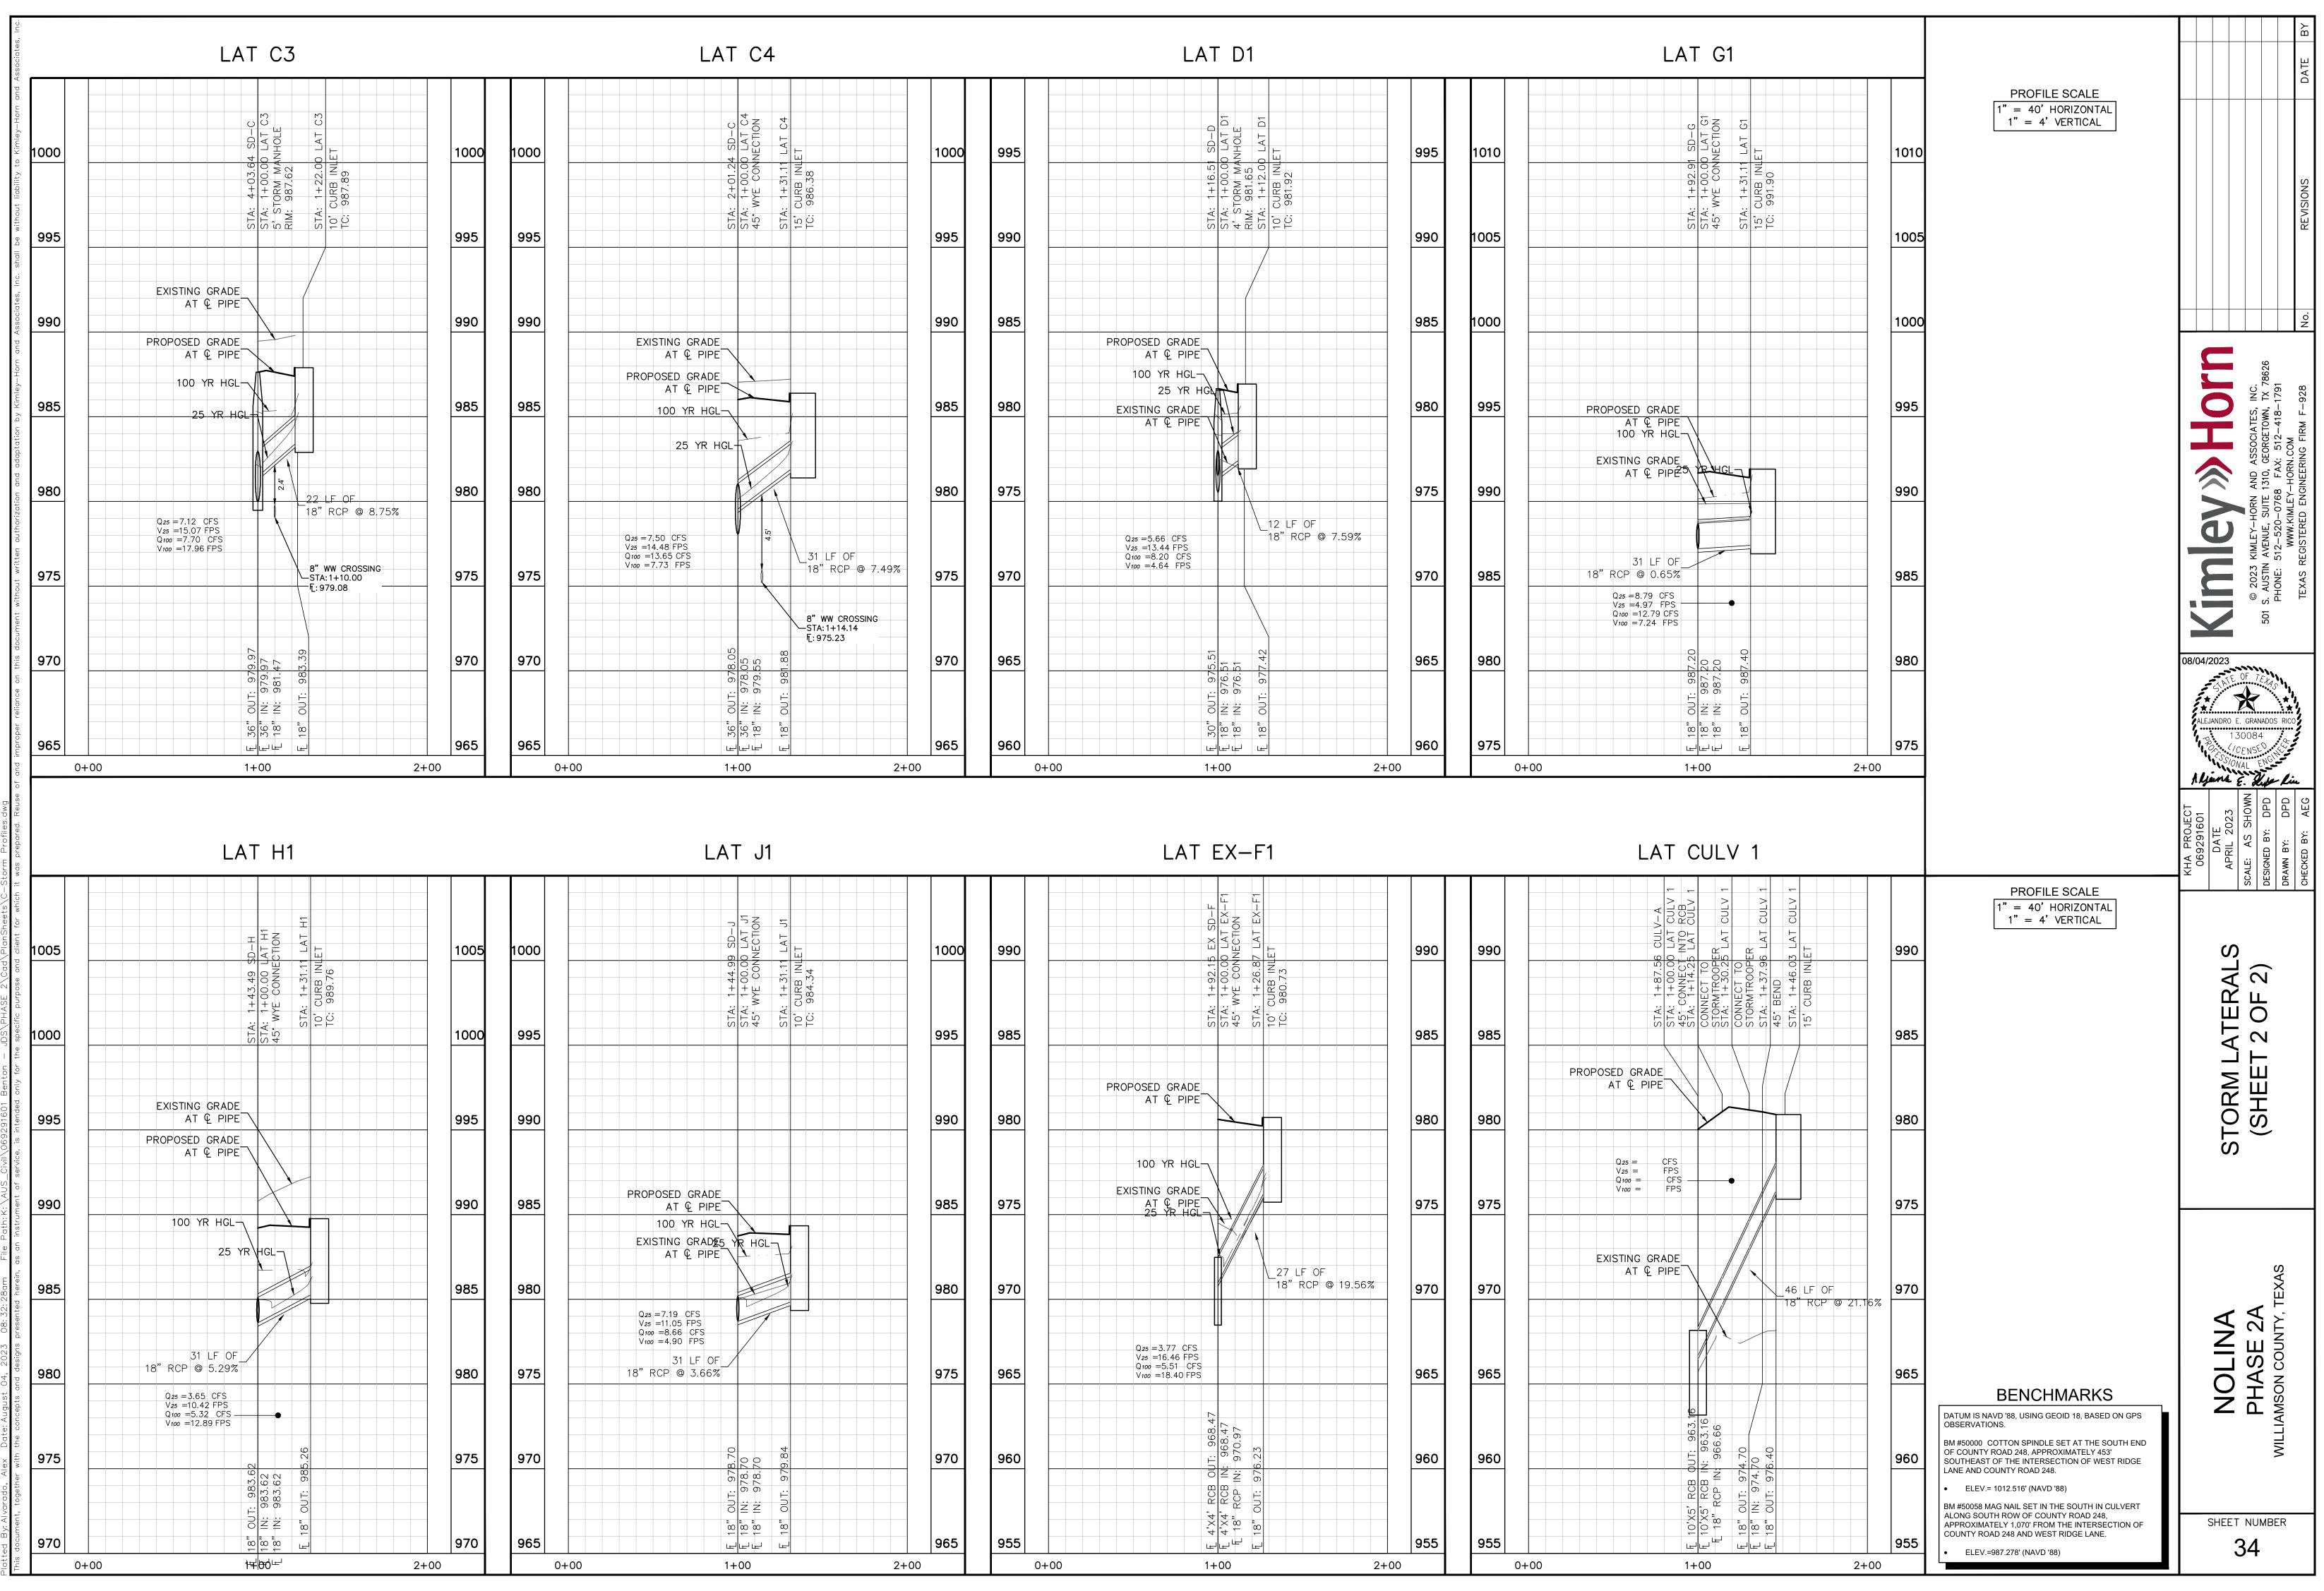

0	2+00	0+00		00	0+00	
F 18" 1N: 978.70 F 18" 0UT: 979.84	970	960	F 4'X4' RCB OUT: 968.47 F 4'X4' RCB IN: 968.47 F 4'X4' RCB IN: 976.23 F 18" RCP IN: 976.23	960 955	960	
	975	965	Q25 = 3.77 CFS V25 =16.46 FPS Q100 =5.51 CFS V100 =18.40 FPS	965	965	
HGL ,	980	970		970	970	EX
	985	975	100 YR HGL EXISTING GRADE AT & PIPE 25 YR HGL	975	975	
	990	980	PROPOSED GRADE AT & PIPE	980	980	PROPOS
45° WYE CONNECTION STA: 1+31.11 LAT J1 10' CURB INLET TC: 984.34	995	985	STA: 1+92.15 STA: 1+92.15 STA: 1+00.00 STA: 1+00.00 STA: 1+26.87 TC: 980.73	985	985	
	1000	990	5 EX SD-F 5 EX SD-F 00 LAT EX-F1 NNECTION 157 LAT EX-F1 LET EX-F1	990	990	
				_	· · ·	

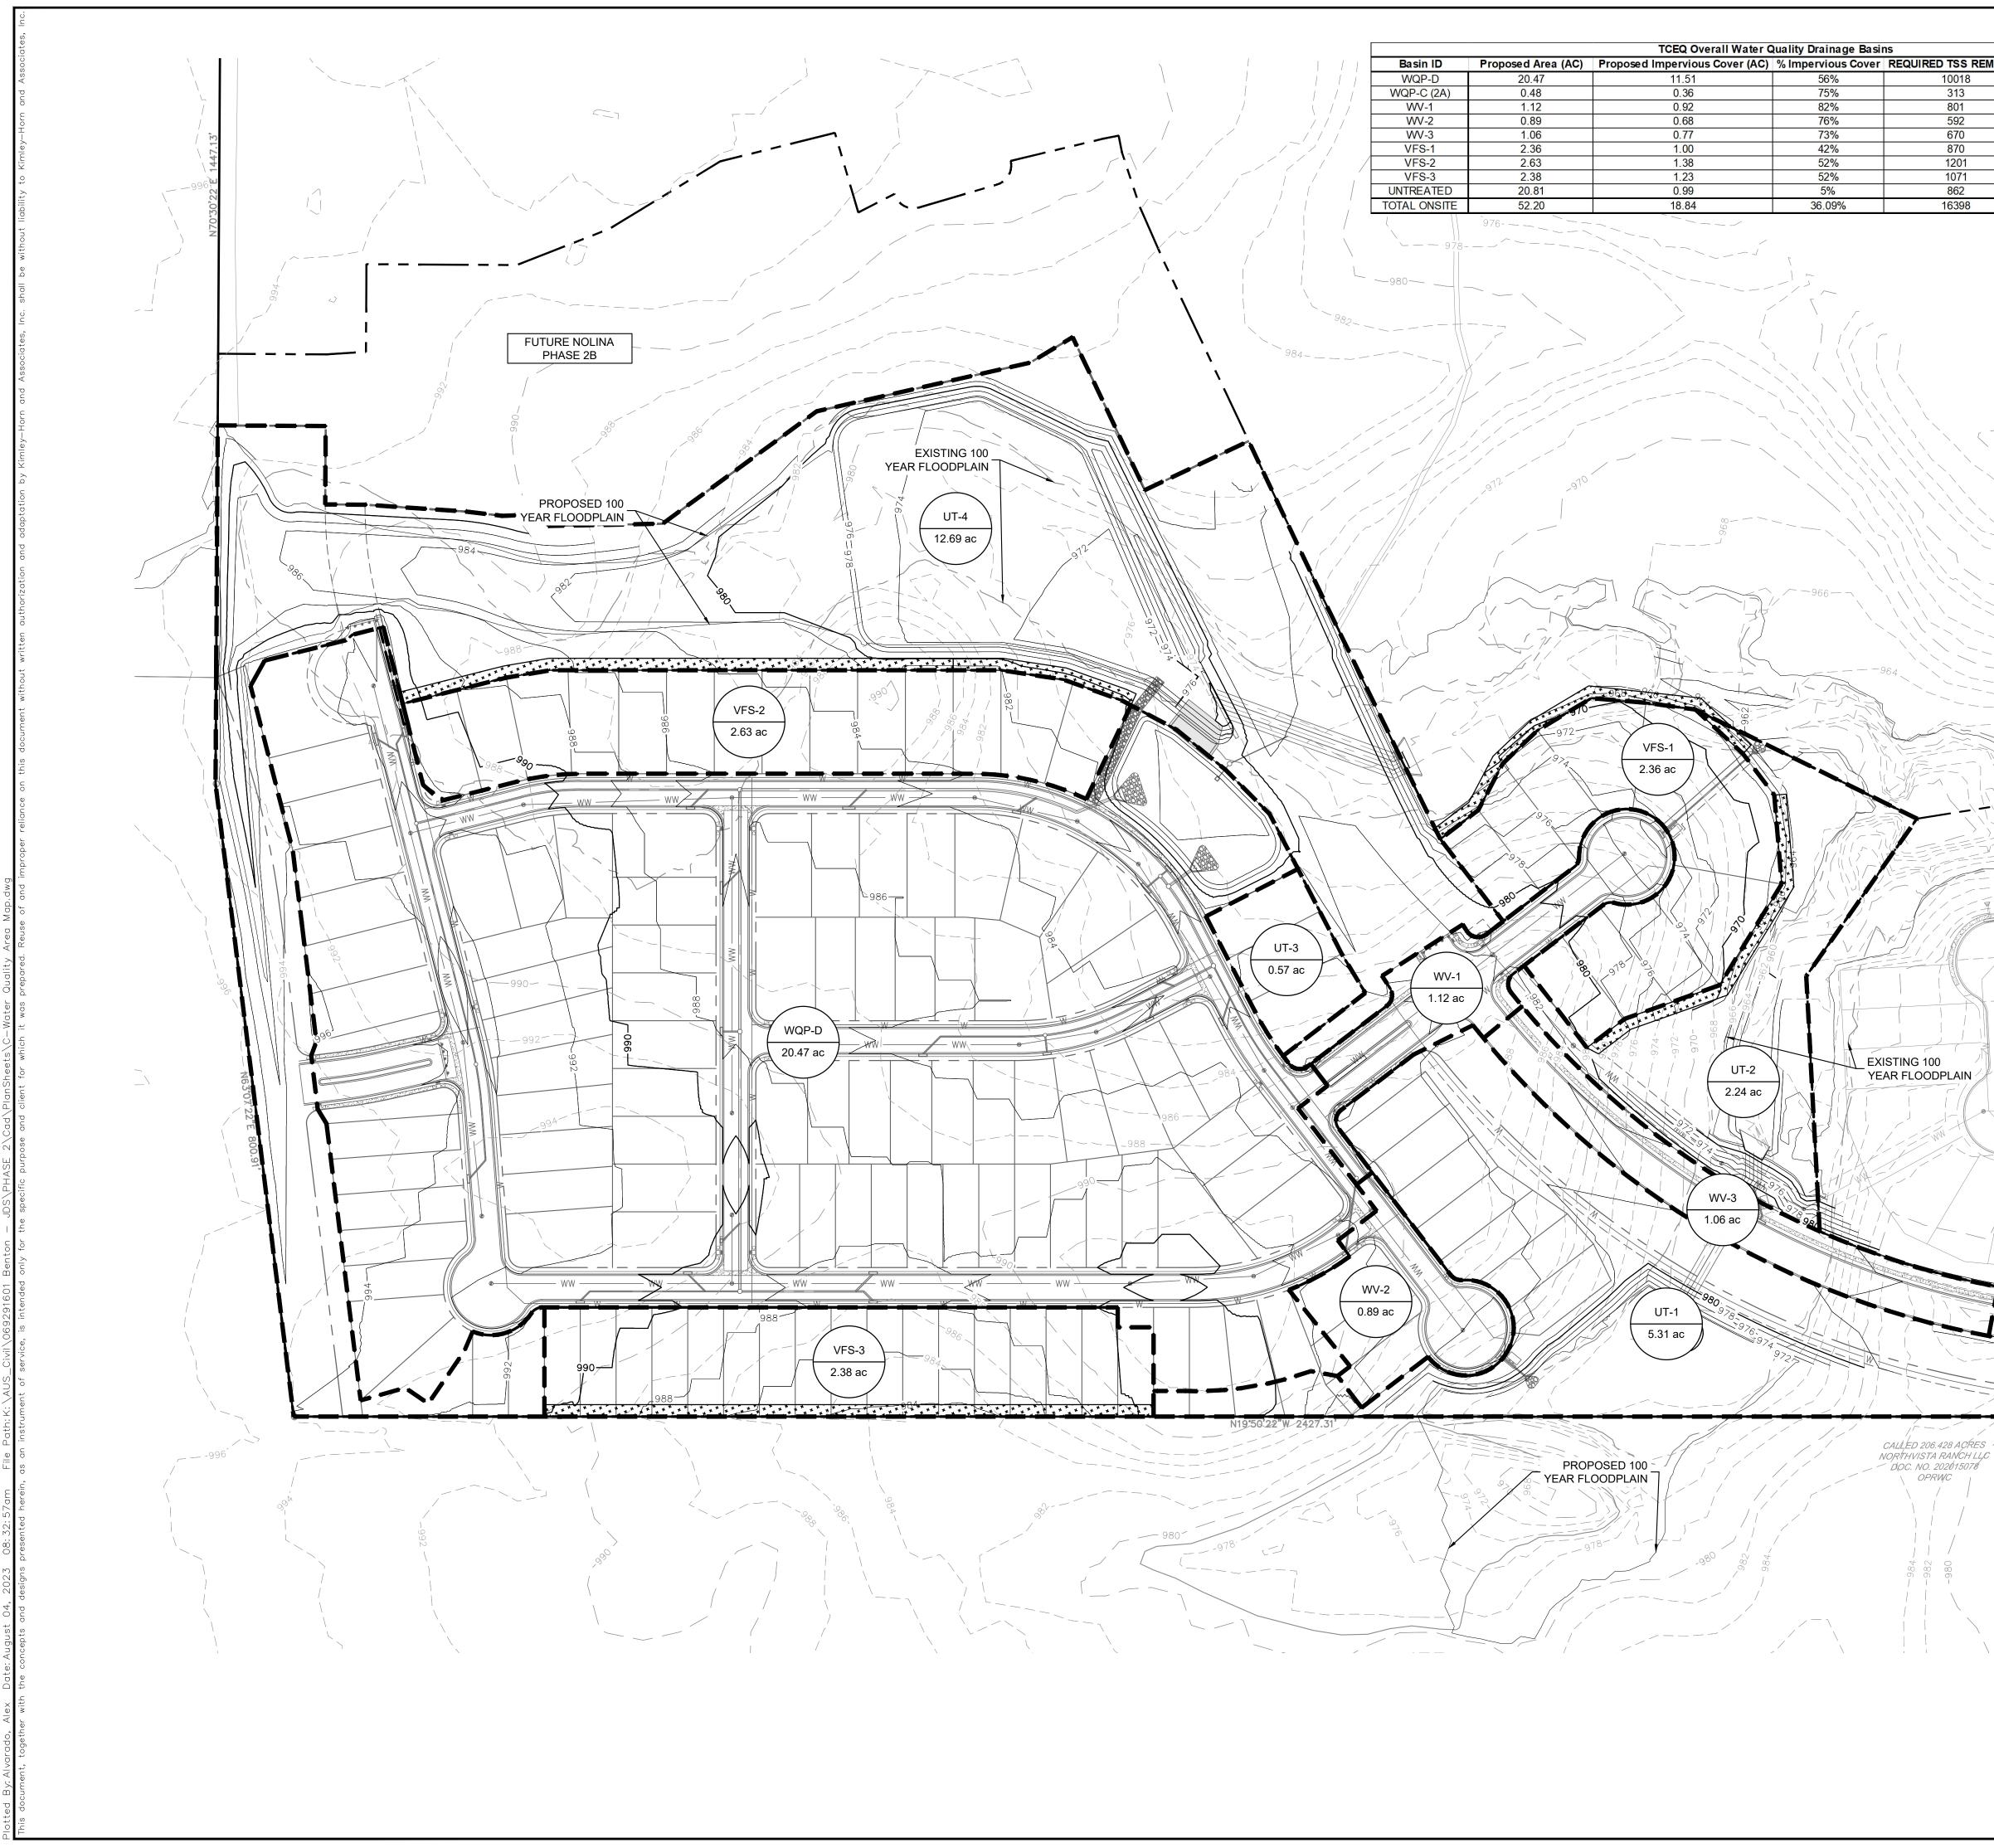

1	ns	
	REQUIRED TSS REMOVAL	PROPOSED TSS REMOVAL
	10018	11090
	313	313
	801	797
	592	610
	670	695
	870	870
	1201	1201
	1071	1071
	862	0
	16398	16647

BENTON PHASE 1-3


SHOWN FOR REFERENCE ONLY

WQP-C (2

0.48 a

OPRWC

-

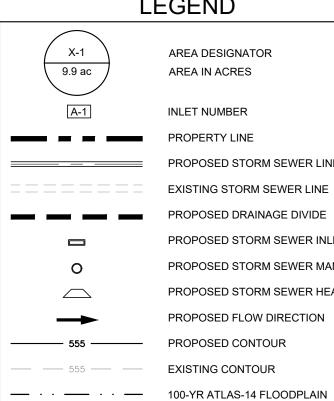


LEGEND



INLET NUMBER PROPERTY LINE PROPOSED STORM SEWER LINE EXISTING STORM SEWER LINE PROPOSED DRAINAGE DIVIDE PROPOSED STORM SEWER INLET PROPOSED STORM SEWER MANHOLE PROPOSED STORM SEWER HEADWAL PROPOSED FLOW DIRECTION PROPOSED CONTOUR EXISTING CONTOUR



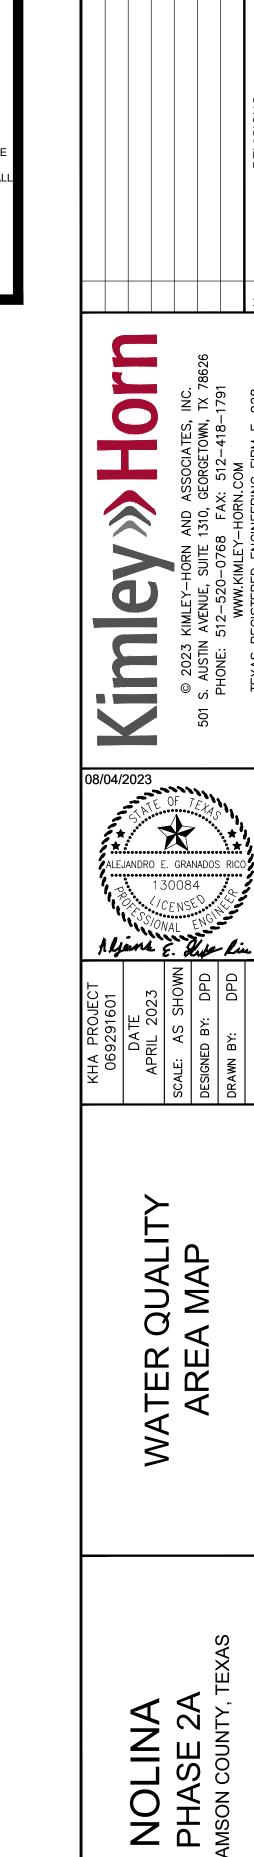

SHEET NUMBER

WILL

exas Commission on Environmental Quality					Texas Cor	nmission on Environmental Quality				Texas Commiss
SS Removal Calculations 04-20-2009			Project Name: Date Prepared:	Nolina Phase 2A 6/13/2023	TSS Remov	al Calculations 04-20-2009	Project Name: Date Prepared:	Nolina Phas 6/13/2023	e 2A	TSS Removal Cal
Additional information is provided for cells with a red triang	le in the up	per right co	orner. Place the	cursor over the cell.	Additional i	nformation is provided for cells with a red triangle in the up	per right corner. Place the	cursor over 1	the cell.	Additional inform
ext shown in blue indicate location of instructions in the Technica						n blue indicate location of instructions in the Technical Guidance				Text shown in blue Characters show
Characters shown in red are data entry fields.	ngos to the	so fields y	vill romovo the o	rustions used in the aprendation		shown in red are data entry fields. shown in black (Bold) are calculated fields. Changes to the	so fields will romove the e	austions uso	d in the spreadsheet	Characters show
Characters shown in black (Bold) are calculated fields. Cha	inges to the	ese neias v	viii remove the ed	quations used in the spreadsheet	. Characters	Shown in black (Bold) are calculated helds. Changes to the	ese neids will remove the e	qualions use	u în the spreadsheet.	1. The Required Load
The Required Load Reduction for the total project:	Calculations fr	rom RG-348		Pages 3-27 to 3-30	1. The Require	ed Load Reduction for the total project: Calculations f	rom RG-348	Pages 3-27 to 3	-30	
Page 3-29 Equation 3.3: L _M =	27.2(A _N x P)					Page 3-29 Equation 3.3: L _M = 27.2(A _N x P)				
where:	Required TSS	removal resul	ting from the propose	d development = 80% of increased load	where:	LA TOTAL DOD FOT = Required TSS	removal resulting from the propose	d development =	80% of increased load	where:
			area for the project				in impervious area for the project			
P =	Average annua	al precipitatior	i, inches			P = Average annu	al precipitation, inches			Site Data: Detern
Site Data: Determine Required Load Removal Based on the Entire Project					Site Data:	Determine Required Load Removal Based on the Entire Project				
County = Total project area included in plan * =	Williamson 52.20		(41.62 Platted Area)			County = Williamson Total project area included in plan * = 52.20	acres (41.62 Platted Area)			Predevel
Predevelopment impervious area within the limits of the plan * =	0.00 18.84	acres				redevelopment impervious area within the limits of the plan * = 0.00 st-development impervious area within the limits of the plan* = 18.84	acres acres			Total post-deve
Total post-development impervious area within the limits of the plan* = Total post-development impervious cover fraction * =	0.36	acres				Total post-development impervious cover fraction * = 0.36				
P =	32	inches				P = 32	inches			
L _{M TOTAL PROJECT} =	16398	lbs.				L _{M TOTAL PROJECT} = 16398	lbs.			* The values entere
The values entered in these fields should be for the total project area					* The values e	entered in these fields should be for the total project area.				Number o
Number of drainage basins / outfalls areas leaving the plan area =	7				Nur	mber of drainage basins / outfalls areas leaving the plan area = 7				
										2. Drainage Basin P
Drainage Basin Parameters (This information should be provided for	each basin):				2. Drainage Ba	asin Parameters (This information should be provided for each basin):				
Drainage Basin/Outfall Area No. =	WQP-D	•				Drainage Basin/Outfall Area No. = WQP-C (2A)				
Total drainage basin/outfall area =		acres				Total drainage basin/outfall area = 0.48	acres			Predevelopm Post-developm
Predevelopment impervious area within drainage basin/outfall area =	0.00	acres				velopment impervious area within drainage basin/outfall area = 0.00	acres			Post-developmen
Post-development impervious area within drainage basin/outfall area = Post-development impervious fraction within drainage basin/outfall area =		acres				evelopment impervious area within drainage basin/outfall area = 0.36 opment impervious fraction within drainage basin/outfall area = 0.75	acres			
$L_{\rm M}$ THIS BASIN =		lbs.				L _{M THIS BASIN} = 313	lbs.			
. Indicate the proposed BMP Code for this basin.					3. Indicate the	proposed BMP Code for this basin.				
Proposed BMP = Removal efficiency =		percent	n			Proposed BMP = Batch Extend Removal efficiency = 91	percent			
				Aqualogic Cartridge Filter				Aqualogic Cartri Bioretention	dge Filter	
				Bioretention Contech StormFilter				Contech StormF		
				Constructed Wetland Extended Detention				Constructed We Extended Deten		
				Grassy Swale				Grassy Swale		
				Retention / Irrigation Sand Filter				Retention / Irriga Sand Filter	ation	
				Stormceptor				Stormceptor	Otrina	
				Vegetated Filter Strips Vortechs				Vegetated Filter Vortechs	Strips	
				Wet Basin				Wet Basin Wet Vault		
. Calculate Maximum TSS Load Removed (L _R) for this Drainage Basin	by the select	ed BMP Type		Wet Vault	4. Calculate M	aximum TSS Load Removed (L _R) for this Drainage Basin by the select	ed BMP Type.	vvet vauit		
						RG-348 Page 3-33 Equation 3.7: L _R = (BMP efficience	$(A \times 34.6 \pm 4.54)$			
RG-348 Page 3-33 Equation 3.7: L _R =	(BIMP emclend	су) х Р х (А _I х	34.6 + A _P X 0.54)			NO-546 Flage 5-55 Equation 5.7. ER - (Divin enlicient				
		-	in the BMP catchme		where:		drainage area in the BMP catchme			
· · · · · · · · · · · · · · · · · · ·			the BMP catchment			· · · · · · · · · · · · · · · · · · ·	ea proposed in the BMP catchment remaining in the BMP catchment a			
·		•	he BMP catchment a catchment area by t			· ·	noved from this catchment area by		P	
			,							
A _C =		acres				$A_{\rm C} = 0.48$ $A_{\rm I} = 0.36$	acres			_
A ₁ = A _P =		acres acres				· ·	acres			
L _R =						L _R = 365	lbs			
. Calculate Fraction of Annual Runoff to Treat the drainage basin / out	fall area				5. Calculate Fi	raction of Annual Runoff to Treat the drainage basin / outfall area				
Desired L _{M THIS BASIN} =	11090	lbs.				Desired L _{M THIS BASIN} = 313	lbs.			
F =	0.94	•				F = 0.86				
. Calculate Capture Volume required by the BMP Type for this drainag		allara	Calculations from RG	-348 Pages 3-34 to 3-36	6. Calculate Ca	apture Volume required by the BMP Type for this drainage basin / out	fall area. Calculations from RG	6-348	Pages 3-34 to 3-36	
. Calculate Capture volume required by the BMP Type for this drainag	je dasin / outi	all area.	Calculations from RG	-348 Pages 3-34 to 3-36						
Rainfall Depth =	2.40	inches				Rainfall Depth = 1.38	inches			
Post Development Runoff Coefficient =	0.39					Post Development Runoff Coefficient = 0.56	aubia faat			
On-site Water Quality Volume =	70360	cubic feet				On-site Water Quality Volume = 1347	cubic feet			
	Colouist					Calculations f	rom RG-348 Pages 3-36 to 3-37			_
	Calculations fr	om KG-348	Pages 3-36 to 3-37							
Off-site area draining to BMP =		acres				Off-site area draining to BMP = 0.00 Off-site Impervious cover draining to BMP = 0.00	acres acres			
Off-site Impervious cover draining to BMP = Impervious fraction of off-site area =	0	acres				Impervious fraction of off-site area = 0				
Off-site Runoff Coefficient = Off-site Water Quality Volume =		cubic feet				Off-site Runoff Coefficient =0.00Off-site Water Quality Volume =0	cubic feet			
On-site vialer Quality voluite -	~					Storage for Sediment = 269				
						Storage for Sediment = 269				
Storage for Sediment =		oubio fest			Total Ca	•	cubic feet			
Storage for Sediment = Total Capture Volume (required water quality volume(s) x 1.20) = he following sections are used to calculate the required water quality he values for BMP Types not selected in cell C45 will show NA.	84432	cubic feet	I BMP.		The following	-				

						1		
n on Environmental Quality								A TF
ations 04-20-2009			Project Name: Date Prepared:	Nolina Phas 6/13/2023	se 2A			
n is provided for cells with a red triang	le in the up	per right co	rner. Place the	cursor over	the cell.			
cate location of instructions in the Technica red are data entry fields.	al Guidance N	Manual - RG	-348.					
black (Bold) are calculated fields. Cha	anges to the	ese fields w	ill remove the e	quations use	d in the sp	oreadsheet.		
duction for the total project:	Calculations fr	rom RG-348		Pages 3-27 to 3	4-30			<u></u>
				1 4903 5 21 10 0				REVISIONS
Page 3-29 Equation 3.3: L_M =	27.2(A _N x P)							
L _{M TOTAL PROJECT} =	Required TSS	removal result	ing from the propose	d development =	80% of increa	ased load		
	Net increase in Average annua		rea for the project					
		al precipitation,	Inches					
Required Load Removal Based on the Entire Proje County =	ct Williamson	•						
Total project area included in plan * = ent impervious area within the limits of the plan * =	52.20	acres acres						
ent impervious area within the limits of the plan* =	18.84	acres						Z
tal post-development impervious cover fraction * = P =		inches						
								8626
L _{M TOTAL PROJECT} = hese fields should be for the total project area	1	lbs.						INC. TX 78 1791 928
in the initial should be for the total project dies							orn	E 8 8. − 8 1. 5 9 1. 1 1. 1
age basins / outfalls areas leaving the plan area =	7							DCIATE CGETOW 12-418 M FIRM
								512 512 512 50M 512 512 512
eters (This information should be provided for	each basin):							AND ASSOCIA 1310, GEORGET FAX: 512– HORN.COM INEERING FIR
Drainage Basin/Outfall Area No. =	UNTREATED	1						~~~ ()
Total drainage basin/outfall area =	20.81	acres						ALEY-HORN ENUE, SUITE 2-520-0768 WWW.KIMLEY ISTERED EN(
npervious area within drainage basin/outfall area =	0.00	acres					mley	KIMLEY-HC N AVENUE, SU 512-520-0 WWW.KIM REGISTERED
npervious area within drainage basin/outfall area = ervious fraction within drainage basin/outfall area =		acres						/LE/ /ENU 2-5 WWV iSTE
L _{M THIS BASIN} =	862	lbs.						© 2023 KIN S. AUSTIN AV PHONE: 511 TEXAS REG
							08/04/2023	501
							00/04/2023	OF TEXAS
							ALEJANDRO E.	. GRANADOS RICO
							POR LIC	SOO84 CENSEO
								E. Supe Lin
							PROJECT 291601 ATE 2023	NAS SHOWN BY: DPD : DPD BY: AFC
							KHA PROJ 0692916 DATE APRIL 20	SCALE: AS DESIGNED BY DRAWN BY: CHFCKFD RY
								SC/ DES DR/
								' 0 -
								CALCULATIONS (SHEET 1 OF 3)
) L	ЭĔ
								= 0
							ן איי	< -
								L F.
								Ч Ш
								<u>Ч</u> Ч
								א גי גי
							$ \geq 0$	\mathcal{C}
							 	
								AS

NOLINA	PHASE 2A	WILLIAMSON COUNTY, T
--------	----------	----------------------

SHEET NUMBER

			nmission on Environmental Quality		Texas Comm	nission on Environmental Quality		
TSS Removal Calculations 04-20-2009	Project Name: Nolina Phase 2A Date Prepared: 6/13/2023	TSS Remov	al Calculations 04-20-2009	Project Name: Nolina Phase 2A Date Prepared: 6/13/2023	TSS Removal	Calculations 04-20-2009	Project Name: Nolina Phase 2A Date Prepared: 6/13/2023	
ditional information is provided for cells with a red triangle in the upper right co	mer. Place the cursor over the cell.	Additional	nformation is provided for cells with a red triangle in the up	per right corner. Place the cursor over the cell.	Additional info	rmation is provided for cells with a red triar	gle in the upper right corner. Place the cursor over the cell.	
t shown in blue indicate location of instructions in the Technical Guidance Manual - RG- aracters shown in red are data entry fields.	348.		n blue indicate location of instructions in the Technical Guidance N shown in red are data entry fields.	Manual - RG-348.		ue indicate location of instructions in the Techni own in red are data entry fields.	cal Guidance Manual - RG-348.	
naracters shown in black (Bold) are calculated fields. Changes to these fields wi	ll remove the equations used in the spreadsheet.		shown in black (Bold) are calculated fields. Changes to the	se fields will remove the equations used in the spreadsh		· · · · · · · · · · · · · · · · · · ·	nanges to these fields will remove the equations used in the spreadsheet.	
The Required Load Reduction for the total project: Calculations from RG-348	Pages 3-27 to 3-30	1. The Require	ed Load Reduction for the total project: Calculations fr	om RG-348 Pages 3-27 to 3-30	<u>1. The Required L</u>	.oad Reduction for the total project:	Calculations from RG-348 Pages 3-27 to 3-30	
Page 3-29 Equation 3.3: L _M = 27.2(A _N x P)			Page 3-29 Equation 3.3: L _M = 27.2(A _N x P)			Page 3-29 Equation 3.3: L _M	= 27.2(A _N x P)	
where: L _{M TOTAL PROJECT} = Required TSS removal resulting	ng from the proposed development = 80% of increased load	where:	M TOTAL BROUFOT = Required TSS	removal resulting from the proposed development = 80% of increased load	d where:		= Required TSS removal resulting from the proposed development = 80% of increased load	
A _N = Net increase in impervious are	ea for the project		A _N = Net increase in	n impervious area for the project		A _N	= Net increase in impervious area for the project	
P = Average annual precipitation,				al precipitation, inches			= Average annual precipitation, inches	
Site Data: Determine Required Load Removal Based on the Entire Project County = Williamson		Site Data:	Determine Required Load Removal Based on the Entire Project County = Williamson		Site Data: De	,	= Williamson	
Total project area included in plan * =52.20acresPredevelopment impervious area within the limits of the plan * =0.00acres				acres		* Total project area included in plan * evelopment impervious area within the limits of the plan	= 0.00 acres	
Total post-development impervious area within the limits of the plan* = 18.84 acres Total post-development impervious cover fraction * = 0.36		Total po	ost-development impervious area within the limits of the plan* = 18.84 Total post-development impervious cover fraction * = 0.36		Total post-c	development impervious area within the limits of the plan* Total post-development impervious cover fraction *	= 0.36	
P = 32 inches			P = 32	inches		Р	= 32 inches	
L _{M TOTAL PROJECT} = 16398 lbs. The values entered in these fields should be for the total project area. 16398 lbs.		*	L _{M TOTAL PROJECT} = 16398	lbs.			= 16398 lbs.	
		° The values e	entered in these fields should be for the total project area.			ered in these fields should be for the total project ar	ea.	
Number of drainage basins / outfalls areas leaving the plan area = 7		Nur	mber of drainage basins / outfalls areas leaving the plan area = 7		Numbe	r of drainage basins / outfalls areas leaving the plan area	= 7	
Drainage Basin Parameters (This information should be provided for each basin):		2. Drainage Ba	asin Parameters (This information should be provided for each basin):		2. Drainage Basin	Parameters (This information should be provided f		\approx
Total drainage basin/outfall area = 2.36 aeros			Drainage Basin/Outfall Area No. = VFS-2			Drainage Basin/Outfall Area No.		
Total drainage basin/outfall area = 2.36 acres Predevelopment impervious area within drainage basin/outfall area = 0.00 acres Best doublement impensious area within drainage basin/outfall area = 1.00 acres			evelopment impervious area within drainage basin/outfall area = 0.00	acres acres		Total drainage basin/outfall area opment impervious area within drainage basin/outfall area	= 0.00 acres	
Post-development impervious area within drainage basin/outfall area = 1.00 acres Post-development impervious fraction within drainage basin/outfall area = 0.42 1.00			opment impervious fraction within drainage basin/outfall area = 0.52	acres		opment impervious area within drainage basin/outfall area nent impervious fraction within drainage basin/outfall area	= 0.52	
L _{M THIS BASIN} = 870 Ibs.			L _{M THIS BASIN} = 1201	lbs.		L _{M THIS} BASIN	= 1071 lbs.	
Indicate the proposed BMP Code for this basin.		3. Indicate the	proposed BMP Code for this basin.		3. Indicate the pro	oposed BMP Code for this basin.		
Proposed BMP = Vegetated Filter Strips Removal efficiency = 85 percent			Proposed BMP = Vegetated Fi Removal efficiency = 85	percent		Proposed BMP Removal efficiency	= Vegetated Filter Strips = 85 percent	
	Aqualogic Cartridge Filter Bioretention			Aqualogic Cartridge Filter Bioretention			Aqualogic Cartridge Filter Bioretention	
	Contech StormFilter Constructed Wetland			Contech StormFilter Constructed Wetland			Contech StormFilter Constructed Wetland	08/04/2023
	Extended Detention Grassy Swale			Extended Detention Grassy Swale			Extended Detention Grassy Swale	STATE
	Retention / Irrigation Sand Filter			Retention / Irrigation Sand Filter			Retention / Irrigation Sand Filter	ALEJANDRO E
	Stormceptor Vegetated Filter Strips			Stormceptor Vegetated Filter Strips			Stormceptor Vegetated Filter Strips	
	Vortechs Wet Basin			Vortechs Wet Basin			Vegetated Filter Strips Vortechs Wet Basin	
Calculate Maximum TSS Load Removed (L _R) for this Drainage Basin by the selected BMP Type.	Wet Vault	4. Coloulate M	laximum TSS Load Removed (L _R) for this Drainage Basin by the selecte	Wet Vault	4. Calculate Maxi	mum TSS Load Demoved (L.) for this Drainage Pas	Wet Vault	Aljana
RG-348 Page 3-33 Equation 3.7: L _R = (BMP efficiency) x P x (A _I x 3	24 6 ± 0 ≤ 4)	4. Calculate M			4. Calculate Maxi	mum TSS Load Removed (L _R) for this Drainage Bas		
			RG-348 Page 3-33 Equation 3.7: L _R = (BMP efficienc	y) x P x (A _I x 34.6 + A _P x 0.54)		RG-348 Page 3-33 Equation 3.7: L _R	= (BMP efficiency) x P x (A ₁ x 34.6 + A _P x 0.54)	80JE 9160 7E 202
where: A _C = Total On-Site drainage area in A ₁ = Impervious area proposed in t		where:		drainage area in the BMP catchment area	where:		 Total On-Site drainage area in the BMP catchment area Impervious area proposed in the BMP catchment area 	A PF 0692(DA PRIL
A _P = Pervious area remaining in the	e BMP catchment area catchment area by the proposed BMP		A _P = Pervious area	remaining in the BMP catchment area		A _P	= Pervious area remaining in the BMP catchment area	A KH
				oved from this catchment area by the proposed BMP			= TSS Load removed from this catchment area by the proposed BMP	
$A_{C} = \frac{2.36}{\text{acres}} \text{ acres}$ $A_{I} = \frac{1.00}{\text{acres}} \text{ acres}$			$A_{\rm C} = \frac{2.63}{A_{\rm I}}$				= 2.38 acres = 1.23 acres	
A _P = 1.36 acres L _R = 961 lbs			A _P = 1.25	acres		Ap	= 1.15 acres	
			L _R = 1317	lbs		L _R	= 1174 lbs	
Coloulate Exaction of Annual Dunoff to Tract the during up having / outfall area				Image:				
Calculate Fraction of Annual Runoff to Treat the drainage basin / outfall area		<u>5. Calculate Fr</u>	raction of Annual Runoff to Treat the drainage basin / outfall area	Image: Constraint of the second sec	<u>5. Calculate Fract</u>	tion of Annual Runoff to Treat the drainage basin / o		
Desired L _{M THIS BASIN} = 870 Ibs.			Desired L _{M THIS BASIN} = 1201	lbs.		Desired L _{M THIS BASIN}	= 1071 lbs.	
F = 0.91			F = 0.91			F	= 0.91	2 2 2 2
. Vegetated Filter Strips Designed as Required in RG-	348 Pages 3-55 to 3-57	16. Vegetated	Filter Strips Designed as R	Required in RG-348 Pages 3-55 to 3-57	16. Vegetated Filt	er Strips	Designed as Required in RG-348 Pages 3-55 to 3-57	— І Ш (
ere are no calculations required for determining the load or size of vegetative filter strips. In 80% removal is provided when the contributing drainage area does not exceed 72 feet (directi			calculations required for determining the load or size of vegetative filte val is provided when the contributing drainage area does not exceed a			ulations required for determining the load or size o is provided when the contributing drainage area do		
ne sheet flow leaving the impervious cover is directed across 15 feet of engineered filter strips wit cross 50 feet of natural vegetation with a maximum slope of 10% There can be a break in grade		the sheet flow	leaving the impervious cover is directed across 15 feet of engineered of natural vegetation with a maximum slope of 10% There can be a b	filter strips with maximum slope of 20% or	the sheet flow lea	ving the impervious cover is directed across 15 fee	c of engineered filter strips with maximum slope of 20% or here can be a break in grade as long as no slope exceeds 20%.	MA
	as long as no slope exceeds 20%.						nere can be a break in grade as long as no slope exected 2070.	

Texas Commission on Environmental Quality TSS Required Load Reduction Calculations

Project Name: Nolina Phase 2A Project Location: Williamson County, TX Date Prepared: 6/13/2023 Prepared For: Alex Granados

3 WV-3 1.06 73.6%

0.78

0.00

 $Lm = 27.2(AN \times P)$

Lm = Required TSS removal where: An = Net increase in impervious area for site P = Average annual precipitation, inches Site Data: County = Williamson Stormwater Quality Structure = Wet Vault Total site area = 3.07 acres Pre-development impervious area = 0.00 acres Post-development impervious area = 2.370 acres Post-development impervious fraction = 0.77 P = 32 inches Total Project Required Removal Lm = **2063** lbs. Pre-Dev. An for Runoff Pervious Runott Composite Coef. Pervious Coef. Runoff Runoff Composite Effective Required StormTrooper Total Impervious Impervious Calculated Drainage Pollutant Outfall Intensity (I) Flow (Q) Basin Area Cover Area Area Area (C) (C) Coef. (C) Removal Cover Area [ID] [ac] [%] [ac] [ac] [ac] [ac] [ac] [in/hr] [cfs] L_m in [lbs] WV-1 82.1% 0.00 0.92 0.9 0.20 0.03 0.74 0.83 1.12 0.92 1.1 0.92 0.21 0.62 WV-2 0.89 76.4% 0.68 0.00 0.68 0.9 0.03 0.69 1.1 0.68 2

Texas Commission on Environmental Quality TSS Removal Calculations


0.78 0.9 0.28 0.03

0.67

0.71

1.1

AREA WV-1	DRAINAGE BASIN 1		TOTAL SITE	
			-	Nolina Phase 2A
STEP ONE: Required TSS Removal	<u>.</u>		-	Williamson County, TX
EQUATION 3.3			Date Prepared	Alex Granados
$L_{\rm m} = 27.2(A_{\rm n} \times P)$		Total Pro	ject Area to be Treated =	
		-	-	
L _m = Required TSS Removal (pounds)			pment Impervious Area =	
A _n = Net Increase in Impervius Area (a			pment Impervious Area =	
P = Average Annual Precipitation (inch	es)	•	site Run-Off Coefficient =	
	A area	Requi	ired TSS Removal L _m =	
Drainage Basin = 1.12	Acres		County =	Williamson
Pre-Dev. Imp. Area = 0.00 Post-Dev. Imp. Area = 0.92	Acres			
Pervious Area = 0.92	Acres			
P = 32	Inches	STO	RMTROOPER	1
$L_{m} = 800$	Lbs	Model	E.A. @ 80%	1
L ^m - 000		5	< 0.13	
STEP TWO: Select an Appropriate	BMP	10	0.14 - 0.20	
		20	0.21 - 0.33	
Effective Area =	= 0.83 EA = (Ai x 0.9) + (Ap x 0.03)	25	0.34 - 0.50	
StormTrooper SWAQ		40	0.51 - 0.79	
Unit Surface Area =	= 588 Sq. Ft.	70	0.80 - 0.98	
EQUATION 3.4		110	0.99 - 1.23	
Q = CiA, where:				
C = 0.74	Composite Run-Off Coefficient			
i = 1.10	Stormwater Quality Intensity			
A = 1.12	Drainage Basin Acreage			
Q = 0.92	Required Treatment Flow			
EQUATION 3.5 $V_{\rm eff} = O/A$ where:				
$V_{OR} = Q/A$, where:	Required Treatment Flow			
Q = 0.92 A = 588	Required Treatment Flow Unit Surface Area			
$V_{OR} = 1.56E-03$	Overflow Rate			
BMP Effeciency = 78%				
STEP THREE: Calculate Fraction of	Annual Runoff to be Treated			
Unit By-Pass Flowrate = 5.01	cfs			
Treated Intensity = 1.10	in/hr			
Annual Volume Treated = 90%	Volume of Run-Off Entering Unit			
Treatment Reduction = 1.00	BMP Effeciency Reduction Factor			
Actual BMP Effeciency = 78%	,			
Actual Divil Electency - 7070				
	emoved by BMPs			
STEP FOUR: Calculate TSS Load R	emoved by BMPs			
STEP FOUR: Calculate TSS Load R				
<u>STEP FOUR:</u> Calculate TSS Load R EQUATION 3.8 L _r = (BMP Efficiency) x P x (A _i x 34.6 -				
STEP FOUR: Calculate TSS Load R <u>EQUATION 3.8</u> $L_r = (BMP Efficiency) \times P \times (A_i \times 34.6 - L_r)$ $L_r = Load Removed by BMP$	+ A _p x 0.54)			
STEP FOUR: Calculate TSS Load R <u>EQUATION 3.8</u> $L_r = (BMP Efficiency) \times P \times (A_i \times 34.6 - L_r = Load Removed by BMP BMP Efficiency = TSS Removal Efficie$	+ A _p x 0.54) ncy			
STEP FOUR: Calculate TSS Load R <u>EQUATION 3.8</u> $L_r = (BMP Efficiency) \times P \times (A_i \times 34.6 - L_r)$ $L_r = Load Removed by BMP$	+ A _p x 0.54) ncy MP (ac)			
STEP FOUR: Calculate TSS Load R EQUATION 3.8 $L_r = (BMP Efficiency) \times P \times (A_i \times 34.6 - C_i + C_$	+ A _p x 0.54) ncy MP (ac)			
STEP FOUR: Calculate TSS Load R <u>EQUATION 3.8</u> $L_r = (BMP Efficiency) \times P \times (A_i \times 34.6 - L_r) = Load Removed by BMP BMP Efficiency = TSS Removal Efficie A_i = Impervious Tributary Area to the BMA_p = Pervious Tributary Area to the BM$	+ A _p x 0.54) ncy MP (ac)			

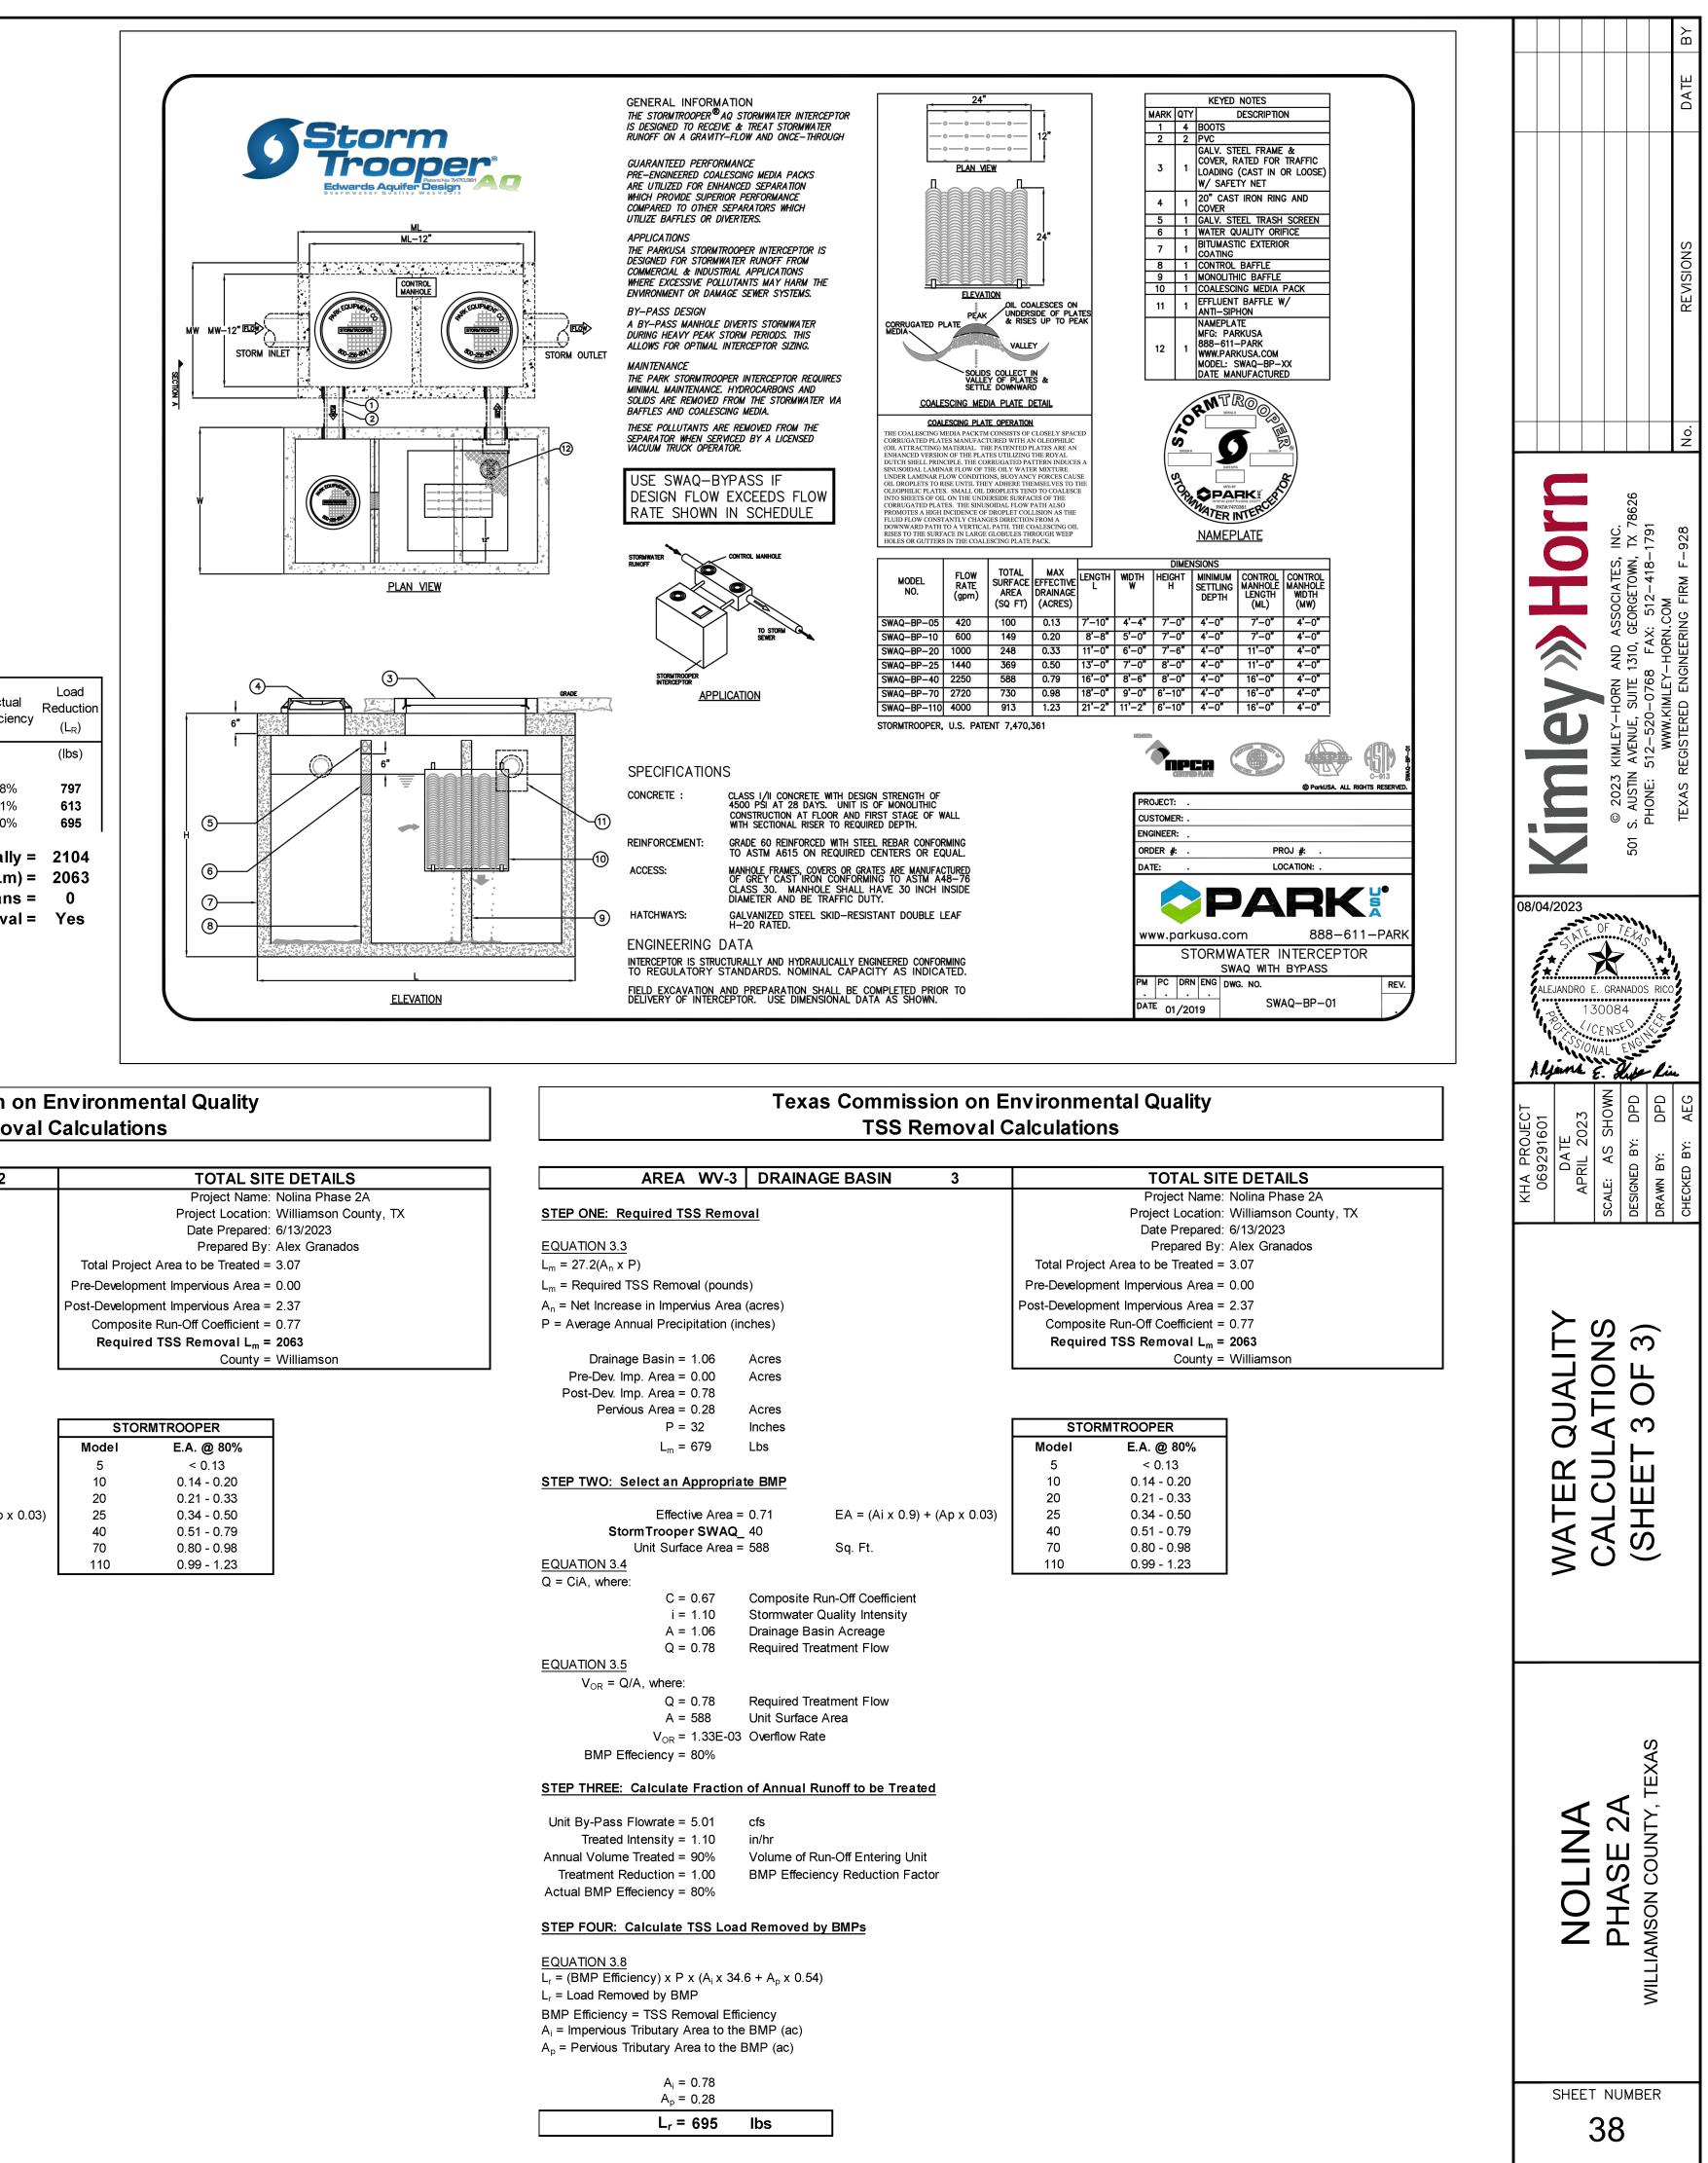

Unit Surface Area	By- Pass Flowrat e	Intensity Treated	Fraction of Flow Treated (F)	F/0.9	Overflow Rate (ft/s)	Removal Effeciency	Actual Effeciency	Load Reduction (L _R)
(sf)	(cfs)	[in/hr]	[Figure 3-11]			[Figure 3-10]]	(lbs)
588 588 588	5.01 5.01 5.01	1.10 1.10 1.10	0.90 0.90 0.90	1.00 1.00 1.00	1.56E-03 1.16E-03 1.33E-03	78% 81% 80%	78% 81% 80%	797 613 695
		Т	otal TSS F	Remo	ved by E	3MP's Ar	nually =	2104

Model


40


800


592


679


0.78

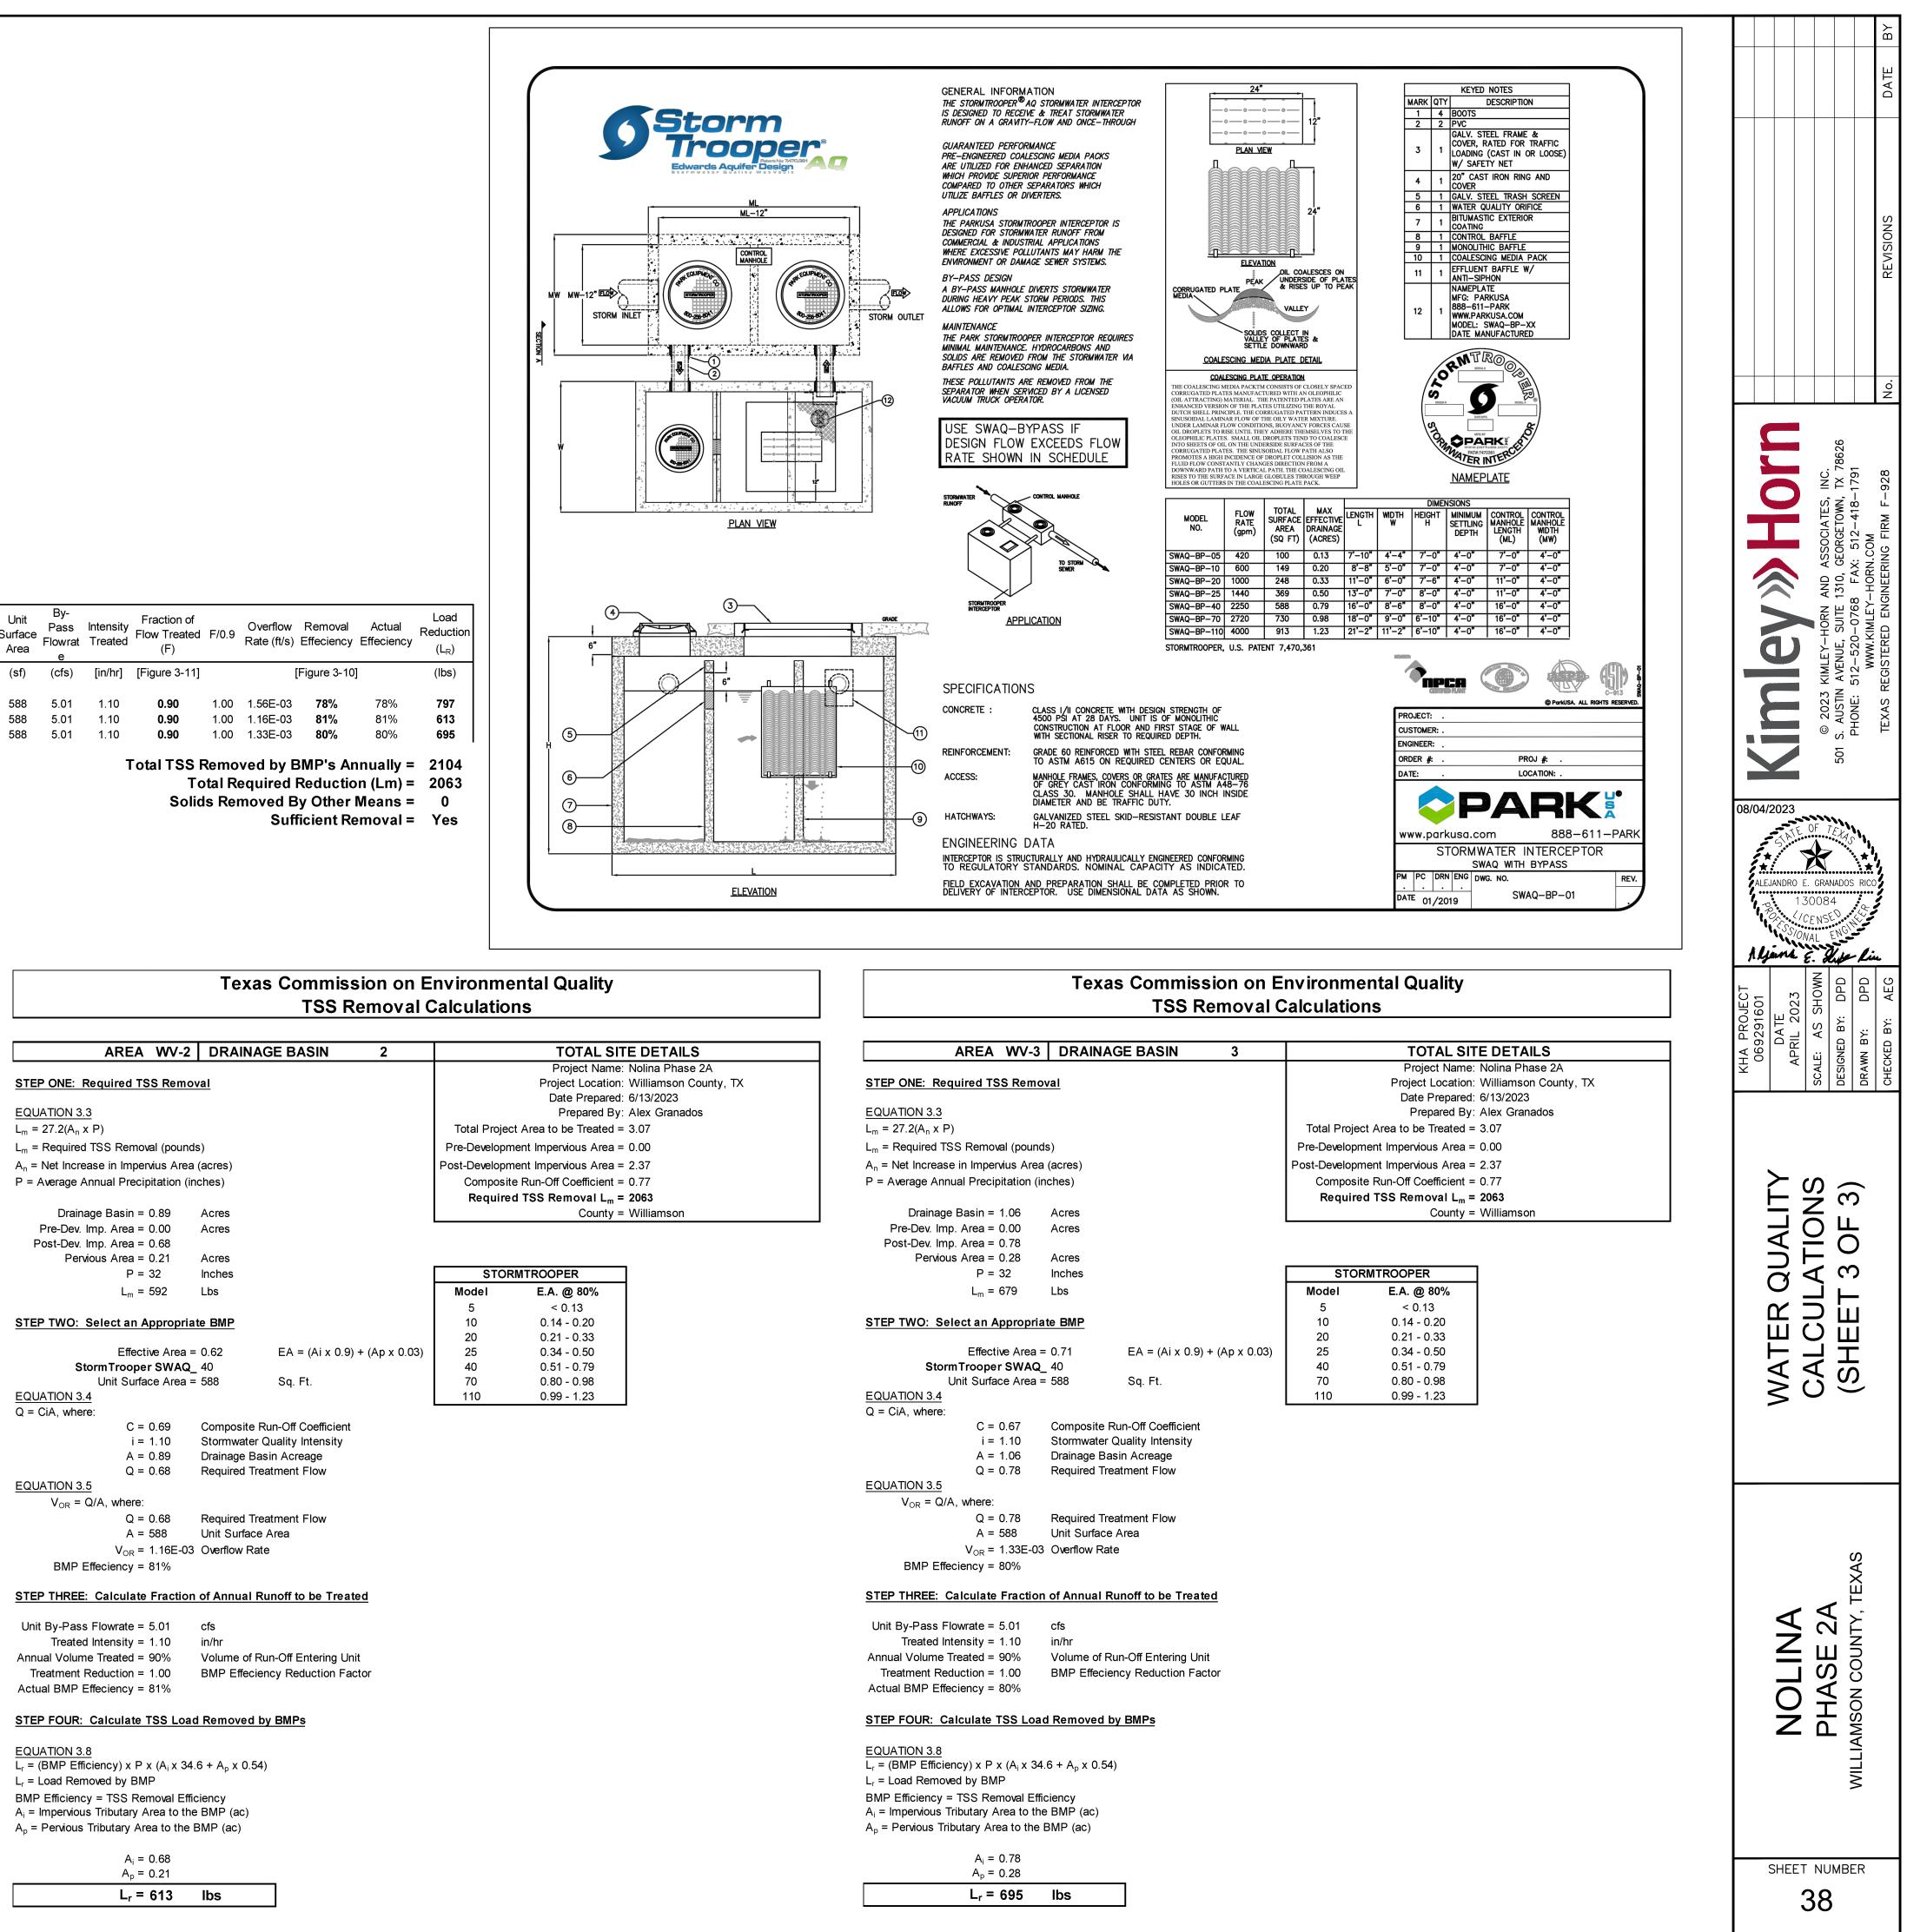

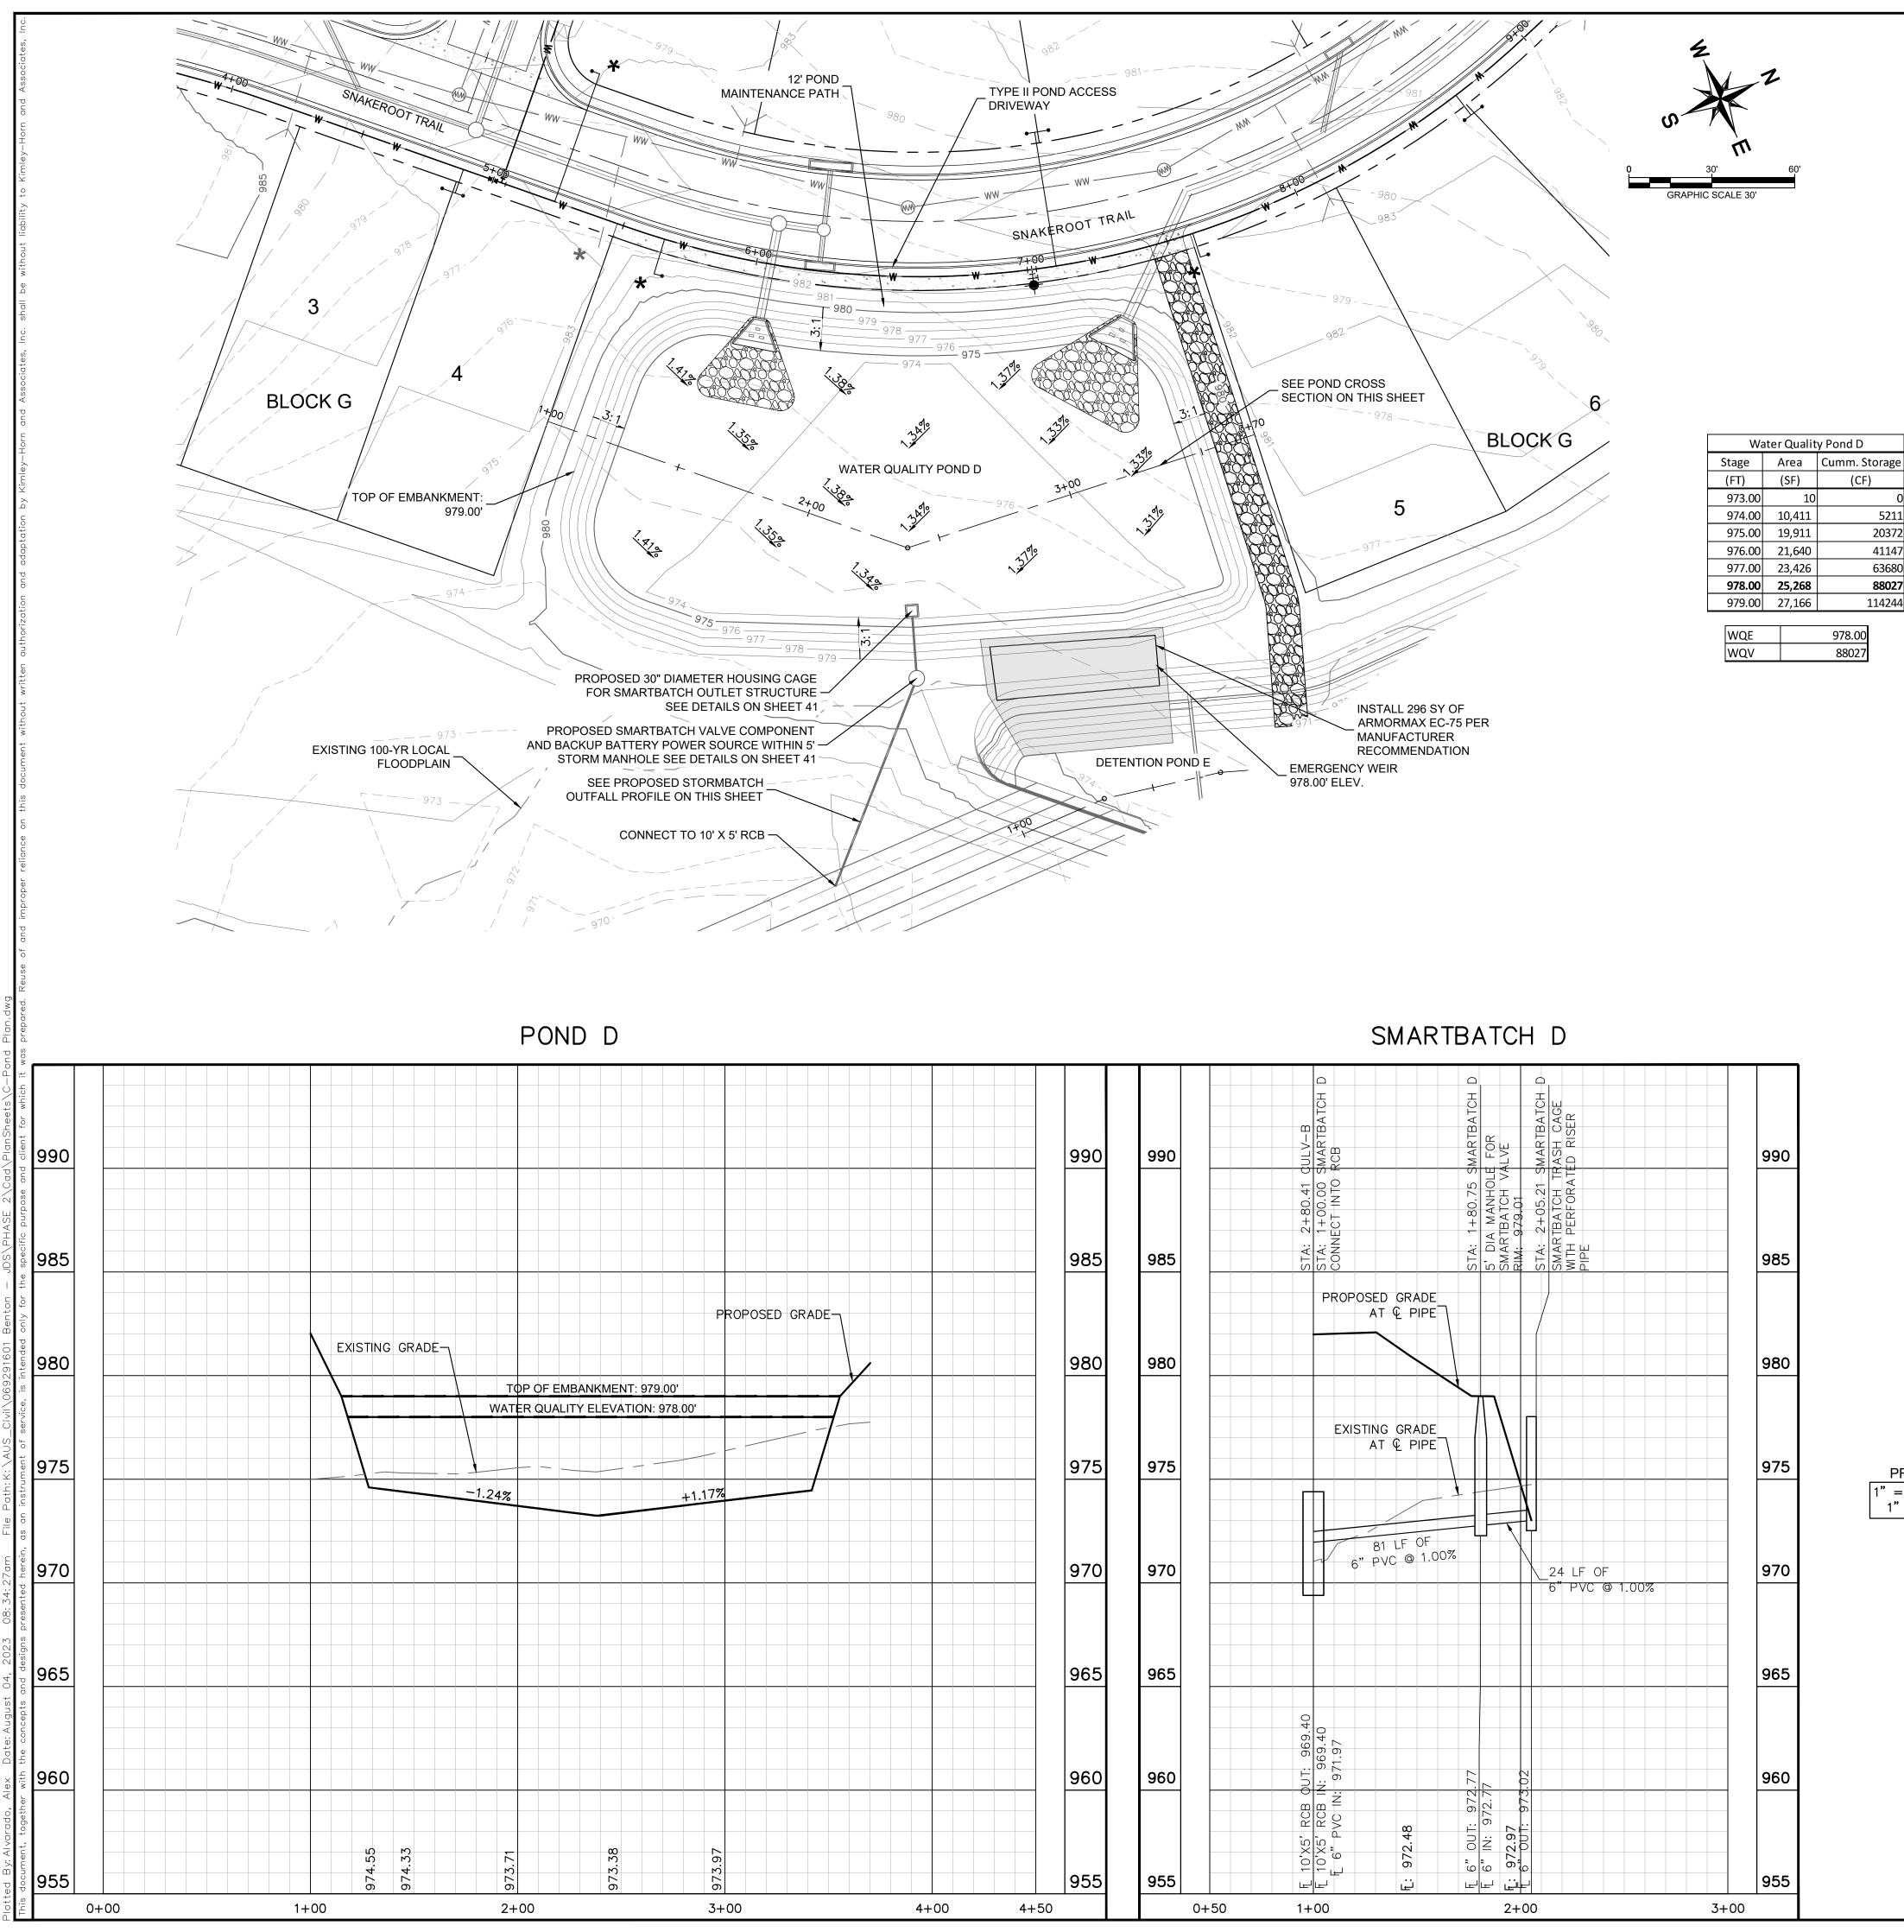

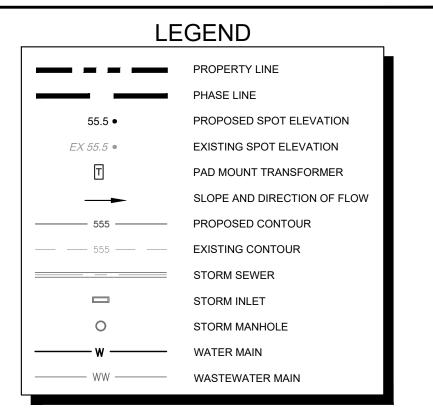

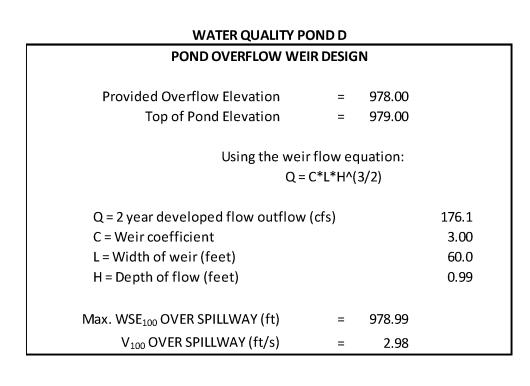

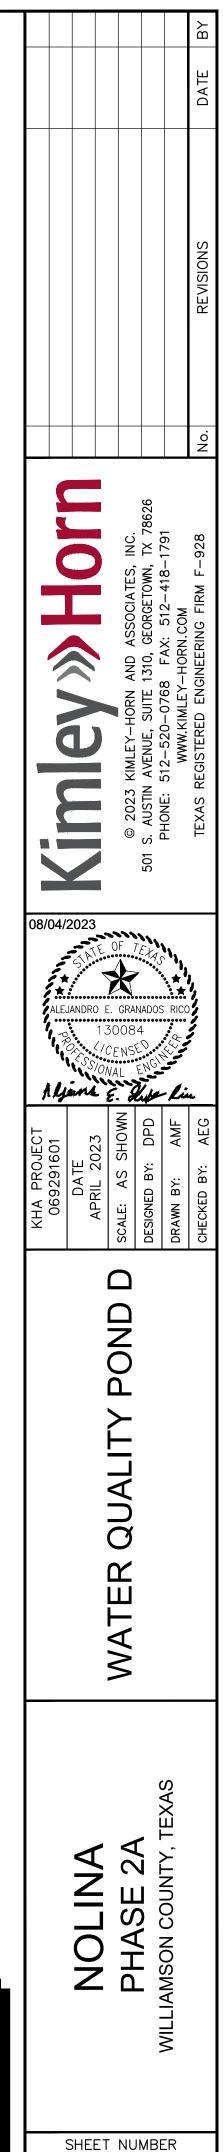

39

BATCH DETENTION POND REVEGETATION PLAN


IMMEDIATELY FOLLOWING COMPLETION OF CONSTRUCTION, EXCESS SPOIL AND DEBRIS SHALL BE REMOVED AND THE CONSTRUCTION AREA SHALL BE GRADED TO THE CONTOURS AS SHOWN ON THE PLANS. THE SURFACE OF THE GROUND SHOULD BE SMOOTH WITH NO LARGE ROCKS, STUMPS, OR OTHER DEBRIS. TOPSOIL OF SANDY LOAM, LOAM, CLAY LOAM OR EQUIVALENT AND FREE OF TREE ROOTS, ROCKS GREATER THAN 2 INCHES IN DIAMETER AND OTHER DEBRIS SHALL THEN BE UNIFORMLY SPREAD OVER ALL DISTURBED AREAS TO A MINIMUM DEPTH OF 6 INCHES. THE TOPSOIL SHOULD BE COMPACTED BY TRACKING A BULLDOZER WITH CLEATED TREADS VERTICALLY ON THE SLOPES TO CREATE HORIZONTAL EROSION CHECKS IN THE SURFACE.

2. RE-SEEDING SHALL IMMEDIATELY FOLLOW TOPSOILING WITH THE FOLLOWING MIXTURE OF GRASSES. BROADCAST SEEDING:

- A. FROM SEPTEMBER 15 TO MARCH 1, SEEDING SHALL BE WITH A COMBINATION OF 2 POUNDS PER 1000 SF OF UNHULLED TYPE 7 (SPECIAL PROVISION 164-WC 001) -STANDARD SHORT NATIVE GRASS SEED MIX
- AND 7 POUNDS PER 1000 SF OF WINTER RYE WITH A PURITY OF 95% WITH 90% GERMINATION. B. FROM MARCH 2 TO SEPTEMBER 14, SEEDING SHALL BE WITH
- HULLED TYPE 7 (SPECIAL PROVISION 164-WC 001) -STANDARD SHORT NATIVE GRASS SEED MIX AT A RATE OF 2 POUNDS PER 1000 SF WITH A PURITY OF OF 95% WITH 85% GERMINATION.
- C. FERTILIZER SHALL BE A PELLETED OR GRANULAR SLOW RELEASE WITH AN ANALYSIS OF 15-15-15 TO BE APPLIED ONCE AT PLANTING AND ONCE DURING THE PERIOD OF ESTABLISHMENT AT A RATE OF 1 POUND PER 1000 SF.

3. THE SEEDED AREA SHALL BE IRRIGATED OR SPRINKLED IN A MANNER THAT WILL NOT ERODE THE TOPSOIL, AT 10-DAY INTERVALS DURING THE FIRST TWO MONTHS FOLLOWING PLANTING AT A RATE SUFFICIENT TO THOROUGHLY SOAK THE SOIL TO A DEPTH OF 6 INCHES. RAINFALL OCCURRENCES OF ONE-HALF INCH OR GREATER SHALL POSTPONE THE WATERING SCHEDULE 10 DAYS. RESTORATION SHALL BE ACCEPTABLE WHEN THE GRASS HAS GROWN AT LEAST 1-1/2 INCHES HIGH WITH 95% COVERAGE AND NO BARE SPOT LARGER THAN 16 SQUARE FEET EXIST.

- 1. BOTTOM OF SEDIMENTATION AND DETENTION BASINS SHALL BE GRASS
- 2. BARRIER FENCE SHALL BE INSTALLED ON ANY WALLS IN EXCESS OF 30" TALL
- 3. ALL POND BOTTOMS, SIDE SLOPES, AND EARTHEN EMBANKMENTS SHALL BE COMPACTED TO 95% MAXIMUM DENSITY PER GEOTECH REPORT. EXPANSION JOINTS ON FREE STANDING WALLS SHALL HAVE WATER TIGHT
- SEALS AS NEEDED. CONTRACTOR SHALL SUBMIT STRUCTURAL DESIGN TO THE DESIGN
- ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION ON THIS STRUCTURE.



BENCHMARKS


DATUM IS NAVD '88, USING GEOID 18, BASED ON GPS OBSERVATIONS.

BM #50000 COTTON SPINDLE SET AT THE SOUTH END OF COUNTY ROAD 248, APPROXIMATELY 453' SOUTHEAST OF THE INTERSECTION OF WEST RIDGE LANE AND COUNTY ROAD 248.

ELEV.= 1012.516' (NAVD '88)


BM #50058 MAG NAIL SET IN THE SOUTH IN CULVERT ALONG SOUTH ROW OF COUNTY ROAD 248, APPROXIMATELY 1,070' FROM THE INTERSECTION OF COUNTY ROAD 248 AND WEST RIDGE LANE.

ELEV.=987.278' (NAVD '88)

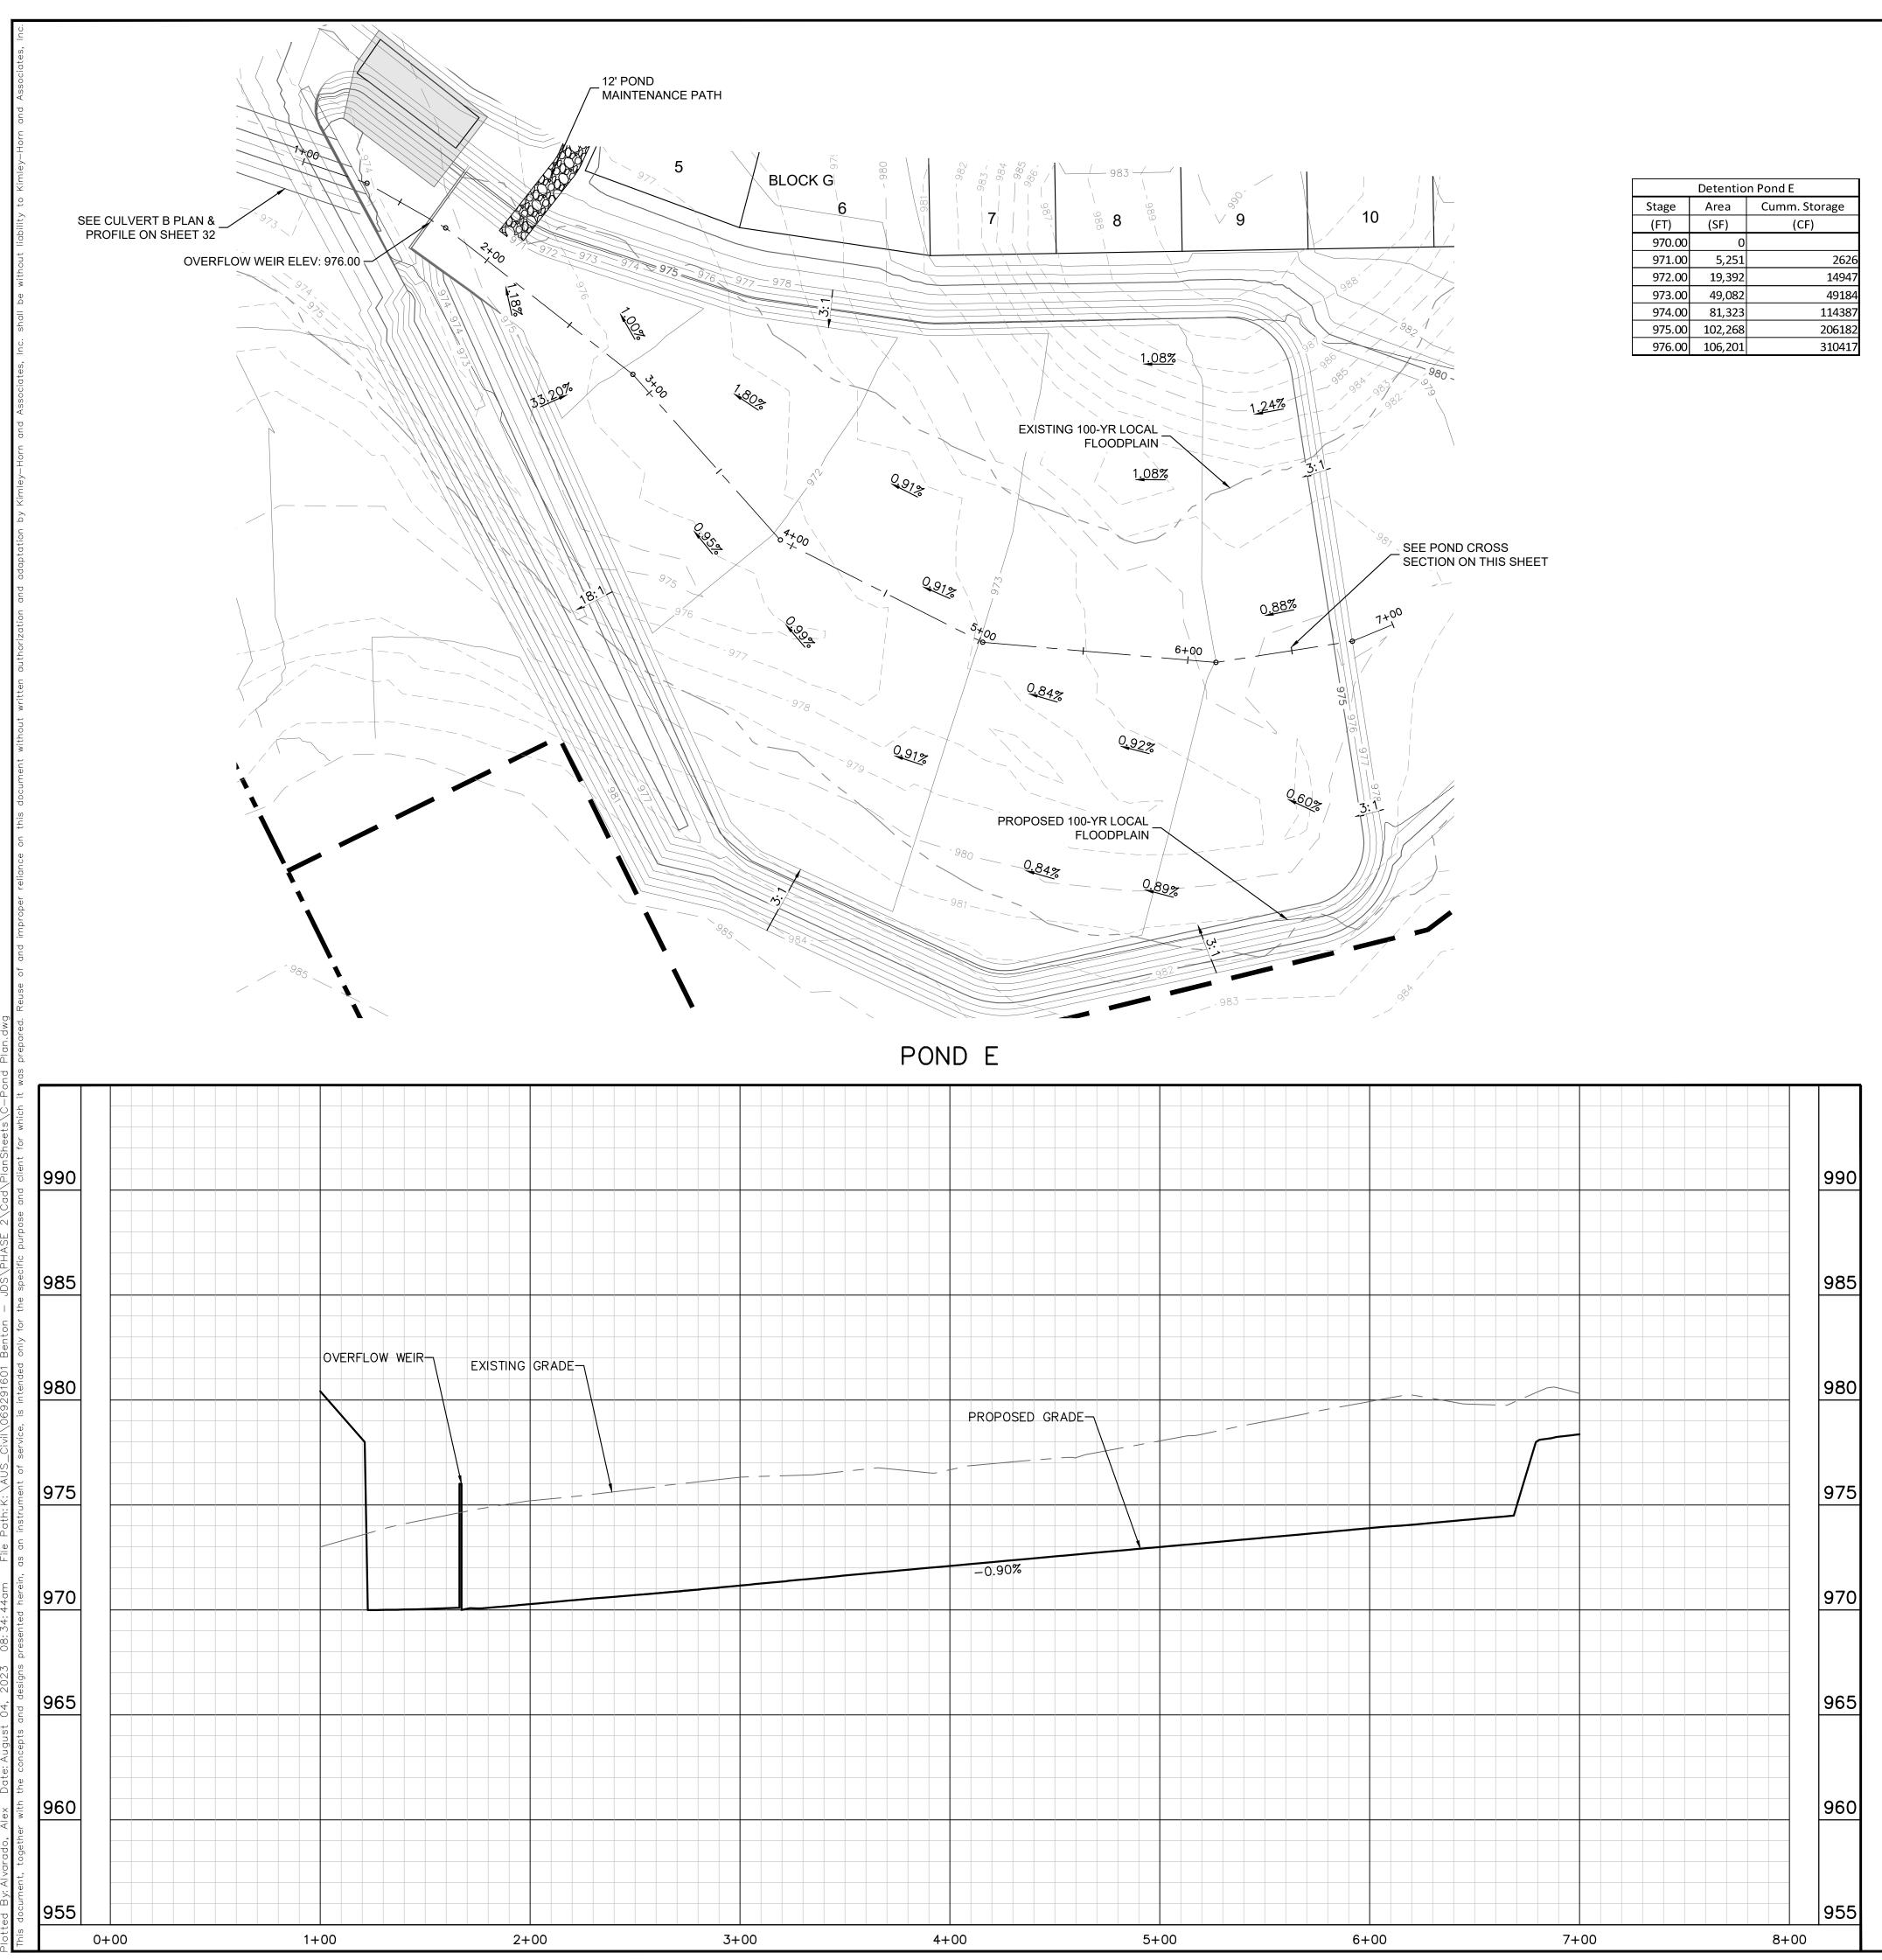

	Detentio	n Pond E
Stage	Area	Cumm. Storage
(FT)	(SF)	(CF)
970.00	0	
971.00	5,251	2626
972.00	19,392	14947
973.00	49,082	49184
974.00	81,323	114387
975.00	102,268	206182
976.00	106,201	310417


PROFILE SCALE 1" = 40' HORIZONTAL 1" = 4' VERTICAL

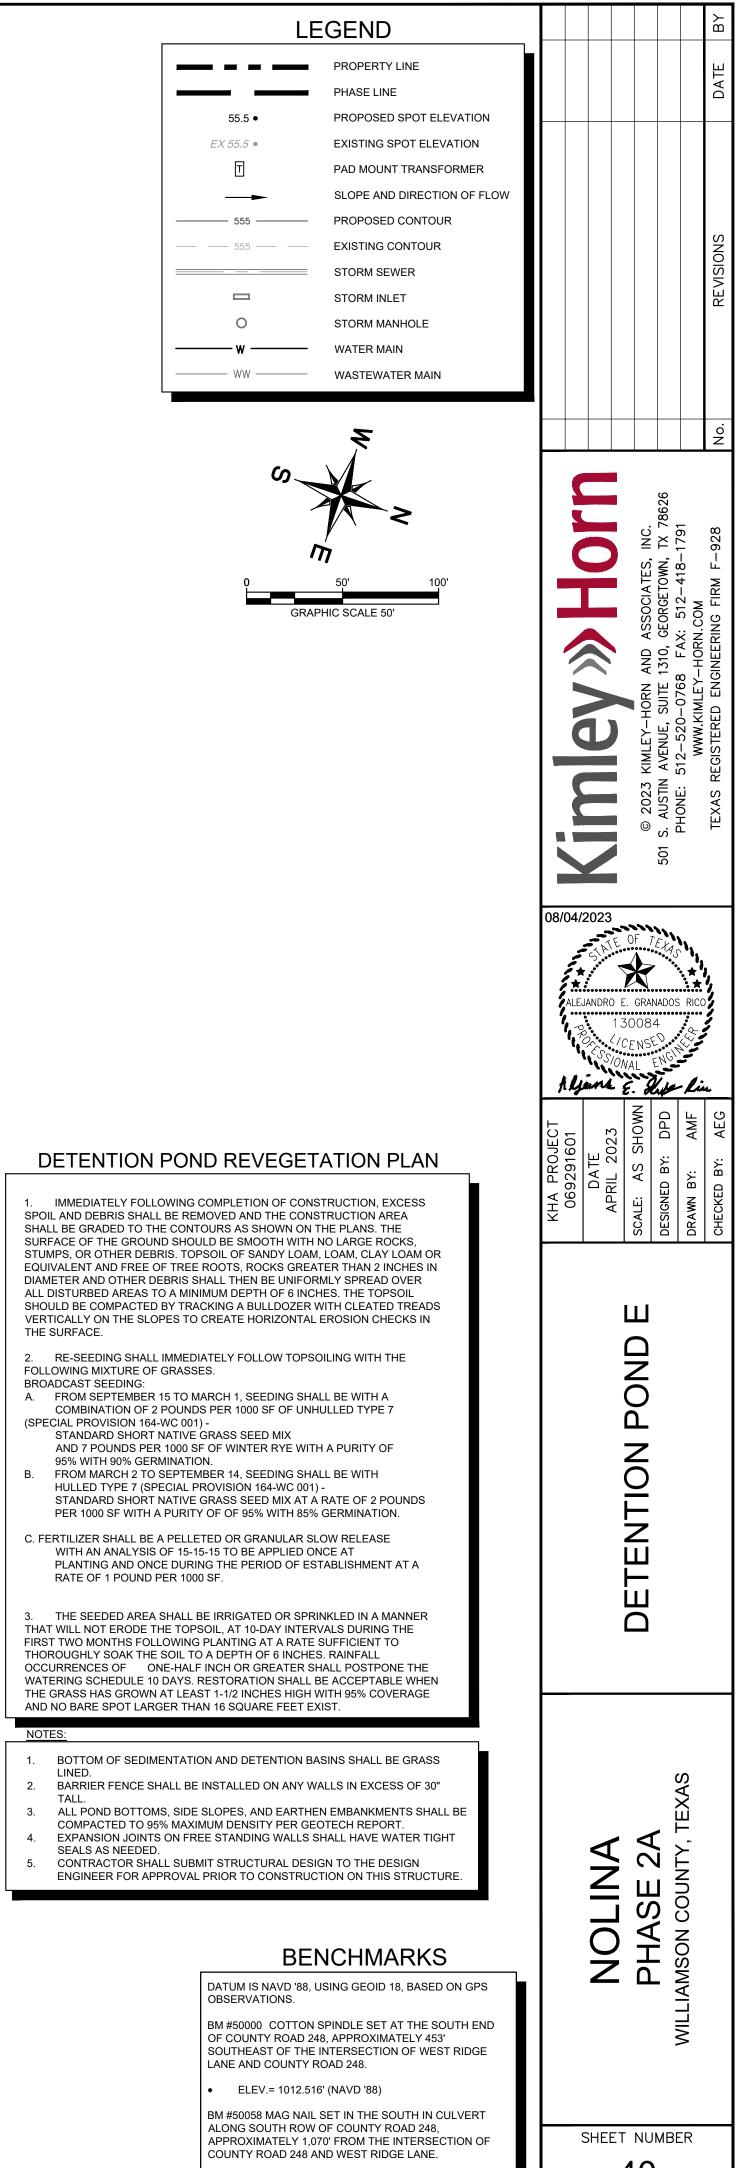



ELEV.=987.278' (NAVD '88)

40

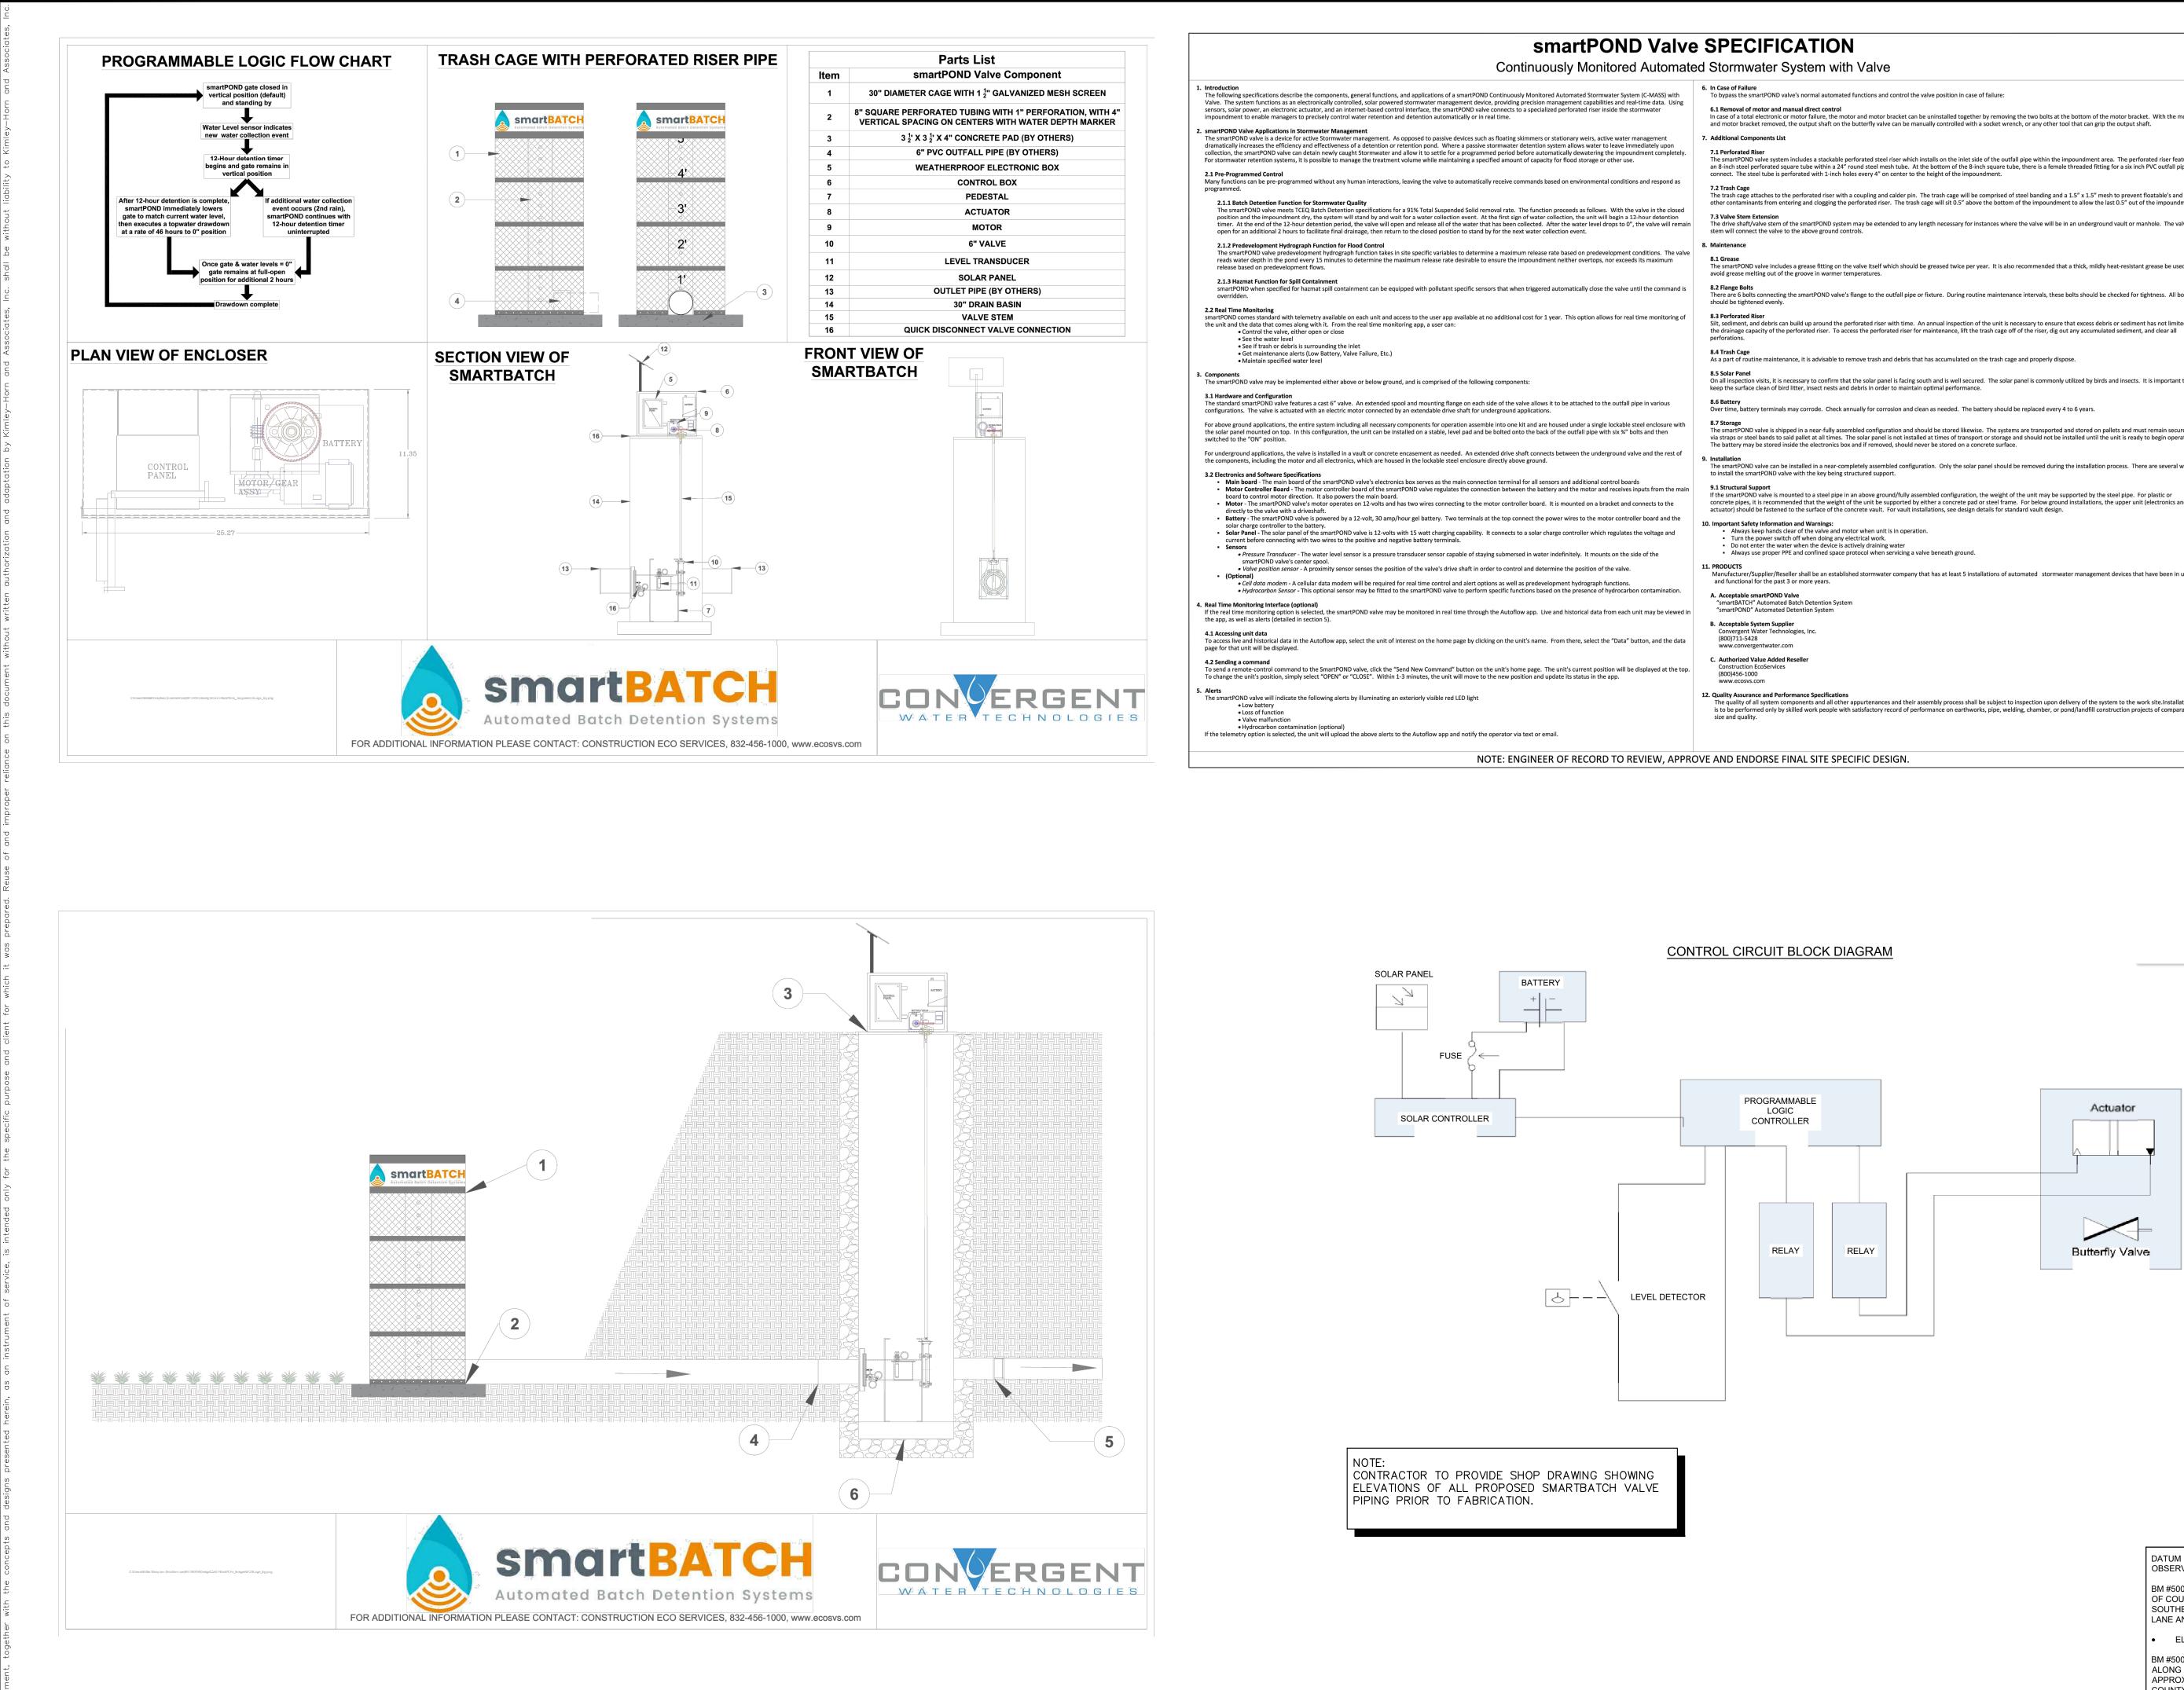

ICATION	6	
r System with Valve		Cont
ND valve's normal automated functions and control the valve position in case of failure:		<u>j</u>
and manual direct control onic or motor failure, the motor and motor bracket can be uninstalled together by removing the two bolts at the bottom of the motor bracket. With the motor oved, the output shaft on the butterfly valve can be manually controlled with a socket wrench, or any other tool that can grip the output shaft.	Ģ	
s List		Stor
ystem includes a stackable perforated steel riser which installs on the inlet side of the outfall pipe within the impoundment area. The perforated riser features ed square tube within a 24" round steel mesh tube. At the bottom of the 8-inch square tube, there is a female threaded fitting for a six inch PVC outfall pipe to is perforated with 1-inch holes every 4" on center to the height of the impoundment.		
to the perforated riser with a coupling and calder pin. The trash cage will be comprised of steel banding and a 1.5" x 1.5" mesh to prevent floatable's and m entering and clogging the perforated riser. The trash cage will sit 0.5" above the bottom of the impoundment to allow the last 0.5" out of the impoundment.		SIN utoma
on em of the smartPOND system may be extended to any length necessary for instances where the valve will be in an underground vault or manhole. The valve alve to the above ground controls.		
ncludes a grease fitting on the valve itself which should be greased twice per year. It is also recommended that a thick, mildly heat-resistant grease be used to It of the groove in warmer temperatures.	FOR ADDITIONAL INFO	ORMATION PLEASE
ecting the smartPOND valve's flange to the outfall pipe or fixture. During routine maintenance intervals, these bolts should be checked for tightness. All bolts enly.		ION ECO SER -456-1000 .ecosvs.com
ris can build up around the perforated riser with time. An annual inspection of the unit is necessary to ensure that excess debris or sediment has not limited f the perforated riser. To access the perforated riser for maintenance, lift the trash cage off of the riser, dig out any accumulated sediment, and clear all	földen Mittel forskes stocker over	WHORE Included Final Statement Co.
intenance, it is advisable to remove trash and debris that has accumulated on the trash cage and properly dispose.		
it is necessary to confirm that the solar panel is facing south and is well secured. The solar panel is commonly utilized by birds and insects. It is important to of bird litter, insect nests and debris in order to maintain optimal performance.		
ninals may corrode. Check annually for corrosion and clean as needed. The battery should be replaced every 4 to 6 years.		
s shipped in a near-fully assembled configuration and should be stored likewise. The systems are transported and stored on pallets and must remain secured s to said pallet at all times. The solar panel is not installed at times of transport or storage and should not be installed until the unit is ready to begin operation. red inside the electronics box and if removed, should never be stored on a concrete surface.	Valve	v
an be installed in a near-completely assembled configuration. Only the solar panel should be removed during the installation process. There are several ways D valve with the key being structured support.	V a	
is mounted to a steel pipe in an above ground/fully assembled configuration, the weight of the unit may be supported by the steel pipe. For plastic or ommended that the weight of the unit be supported by either a concrete pad or steel frame. For below ground installations, the upper unit (electronics and tened to the surface of the concrete vault. For vault installations, see design details for standard vault design.	ND	i t c
mation and Warnings: nds clear of the valve and motor when unit is in operation. switch off when doing any electrical work. e water when the device is actively draining water ser PPE and confined space protocol when servicing a valve beneath ground.	martPON	necific
/Reseller shall be an established stormwater company that has at least 5 installations of automated stormwater management devices that have been in use past 3 or more years.	ar	ם ע
DND Valve nated Batch Detention System ated Detention System	Sm	
Supplier echnologies, Inc.		
ter.com dded Reseller vices		
Performance Specifications m components and all other appurtenances and their assembly process shall be subject to inspection upon delivery of the system to the work site.Installation ly by skilled work people with satisfactory record of performance on earthworks, pipe, welding, chamber, or pond/landfill construction projects of comparable	REV	DATE
		6/2020 HEET NO.
E FINAL SITE SPECIFIC DESIGN.		

BENCHMARKS


DATUM IS NAVD '88, USING GEOID 18, BASED ON GPS OBSERVATIONS.


BM #50000 COTTON SPINDLE SET AT THE SOUTH END OF COUNTY ROAD 248, APPROXIMATELY 453' SOUTHEAST OF THE INTERSECTION OF WEST RIDGE LANE AND COUNTY ROAD 248.

ELEV.= 1012.516' (NAVD '88)

BM #50058 MAG NAIL SET IN THE SOUTH IN CULVERT ALONG SOUTH ROW OF COUNTY ROAD 248, APPROXIMATELY 1,070' FROM THE INTERSECTION OF COUNTY ROAD 248 AND WEST RIDGE LANE.

ELEV.=987.278' (NAVD '88)

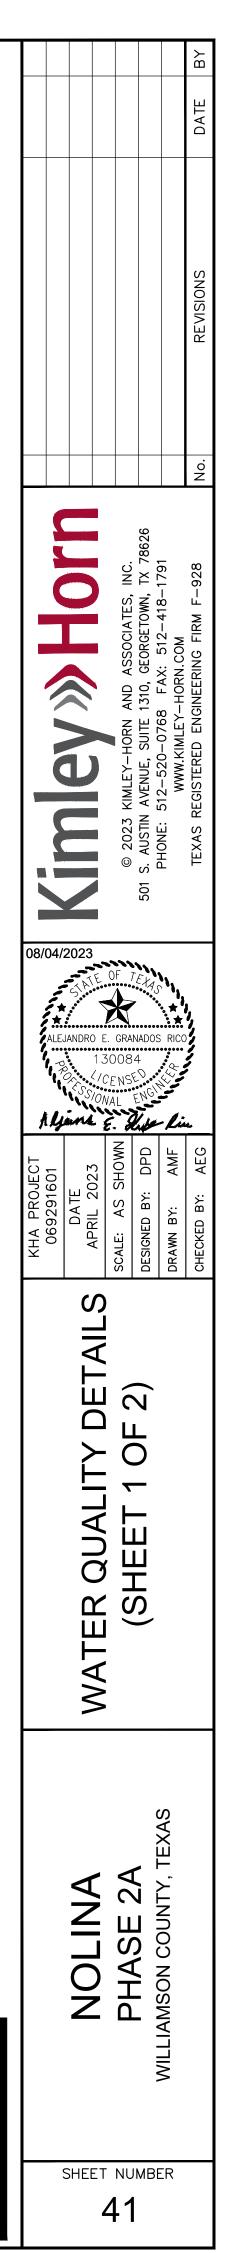

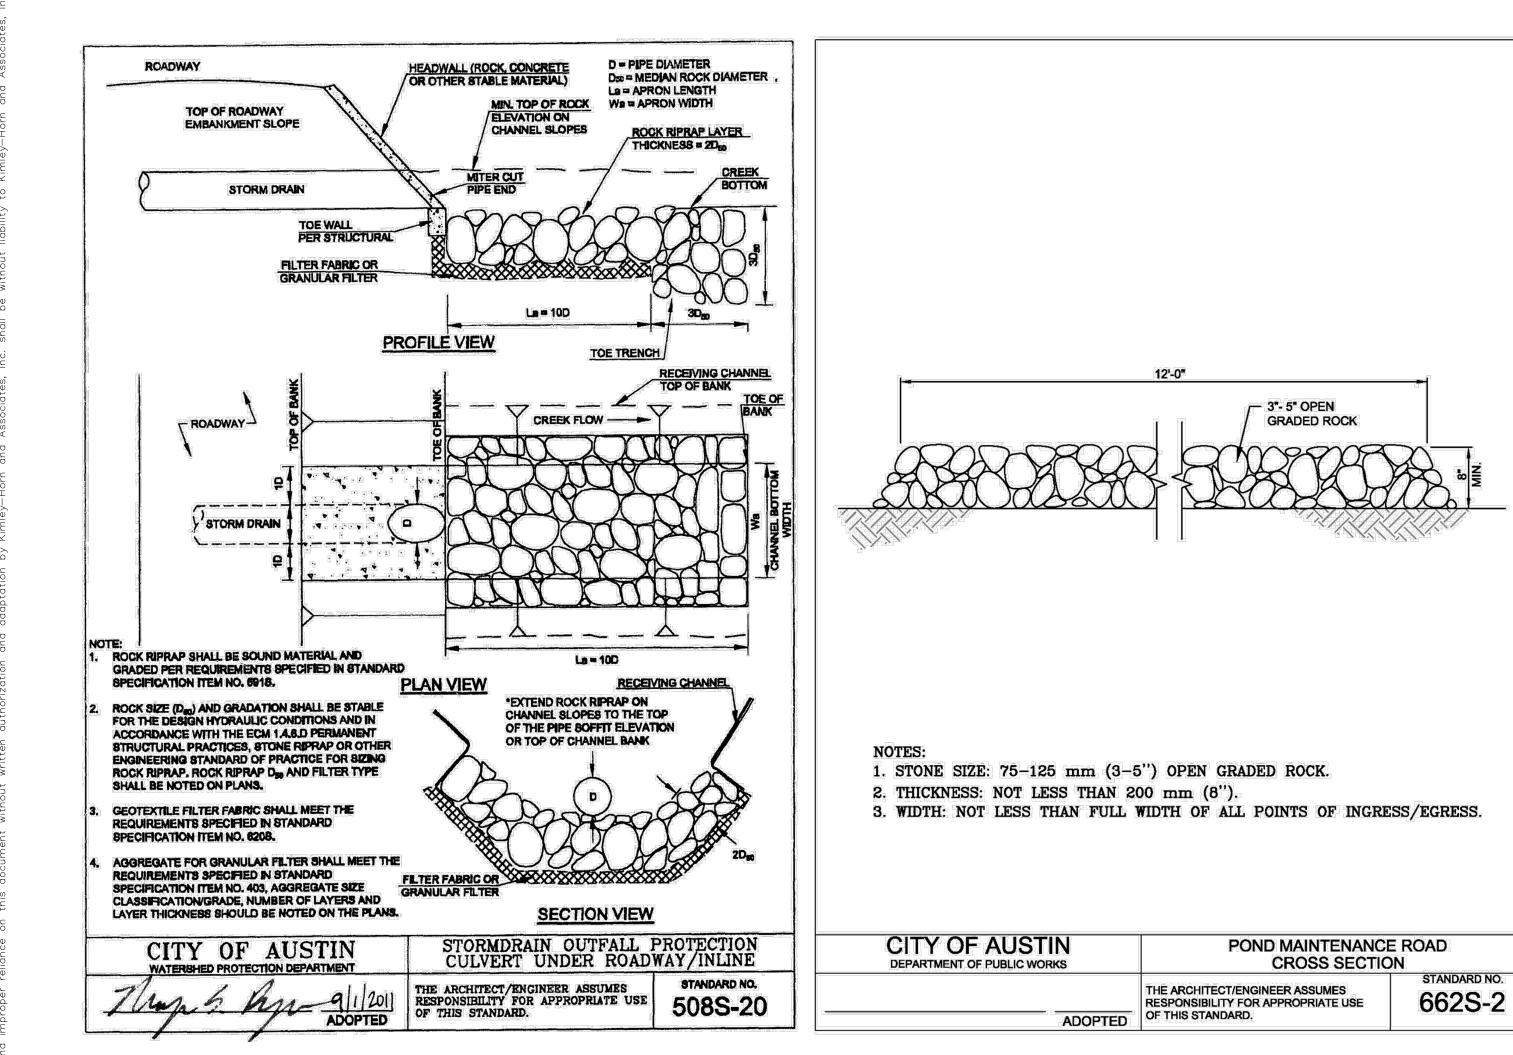



	STOR		ALL DES	IGN - POND D
Nolina Phase 2A				
		IN	IPUT VALUI	ES
	SD-A	SD-B	Unit	Source
Discharge (Q) =	100.06	56.55	cfs	StormCAD Model
Velocity at Outfall (V ₁) =	10.4	8	ft/s	StormCAD Model
Outlet Pipe Diameter (D) =	3.5	3.0	ft	Required Size for Conveyance
		ŀ		1
Headwall Length (L) =	10.50	9.00	ft	COA Detail 508S-13, Based on Outlet Diameter
Headwall Width (C) =	17.5	15	ft	COA Detail 508S-13, Based on Outlet Diameter
Depth of Flow at End of Headwall (d) =	0.74	0.60	ft	Based on Manning's Equation, using Goal Seek in Excel to solve for depth
Velocity at End of Headwall (V ₂) =	7.78	6.33	ft/sec	$V = \frac{Q}{A}$, where $A = Cd$
			RIPRAP	
	0.72	0.47	ft	$D_{50} = 0.0105 V_2^{2.06}$ (ECM 1.4.6.D.5)
Riprap Size (D ₅₀) =	9.00	6.00	in	Rounded up to Nearest Diameter Size in City of Austin ECM, 591S.3 Rock Riprap Gradation Table
Riprap Classification =	II	I		Based on City of Austin ECM, 591S.3 Rock Riprap Gradation Table
Apron Width =	19.50	17.00	ft	Apron Width = $C + 2$
	37.25	31.50	ft	Apron Length = $3D_{50}$ + La (10*D) (508S-20)
Apron Length =				

FIN	POND MAINTENANCE ROAD					
DRKS	CROSS SECTION					
ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO.				

BENCHMARKS

DATUM IS NAVD '88, USING GEOID 18, BASED ON GPS OBSERVATIONS.

BM #50000 COTTON SPINDLE SET AT THE SOUTH END OF COUNTY ROAD 248, APPROXIMATELY 453' SOUTHEAST OF THE INTERSECTION OF WEST RIDGE LANE AND COUNTY ROAD 248.

• ELEV.= 1012.516' (NAVD '88)

BM #50058 MAG NAIL SET IN THE SOUTH IN CULVERT ALONG SOUTH ROW OF COUNTY ROAD 248, APPROXIMATELY 1,070' FROM THE INTERSECTION OF COUNTY ROAD 248 AND WEST RIDGE LANE.

ELEV.=987.278' (NAVD '88)



NOLINA PHASE 2A AMSON COUNTY, T

TEXAS

512 .COM

-0768 MLEY-

5

° ⊙

ALEJANDRO E. GRANADOS RIO

Aljana E

S

DETAIL F 2)

WATER QUALITY (SHEET 2 (

л С

1.30084

DR DF S


08/04/2023

GEORGET

The Architect/Engineer assi		
responsibility for appropriat use of this standard.	e	REVISION NOTE:
<u>f</u>	CITY OF GEORGETOWN CONSTRUCTION STANDARDS AND DETAILS	ADOPTED 6/21/2006
GEORGETOWN	TEMPORARY EROSION AND SEDIMENTATION CONTROL GUIDELINES	SCALE: DATE: NTS 1/2003
Georgetown Utility Systems Your Community Owned Utility		DRAWW BY: APPROVED BY: MRS TRB
EXISTING ROAD	50' MIN. 50'	
GR		GE KISTING ROAD
	XTILE FABRIC PPROVED BY THE CITY	
- CLEAR THE AREA OF DEBRIS,		
INSPECTIONS AND MAINTENANCE	GUIDELINES:	
RIGHTS-OF-WAY. THIS MAY REQU CLEANOUT OF ANY MEASURES USE - ALL SEDIMENT SPILLED, DROPPED, CONTRACTOR. - WHEN NECESSARY, WHEELS SHOUL	WASHED OR TRACKED ON TO PUBLIC RIGHTS-OF-WAY SHO D BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE	ONDITIONS DEMAND AND REPAIR AND/OR DULD BE REMOVED IMMEDIATELY BY ONTO PUBLIC RIGHTS-OF-WAY.
SEDIMENT TRAP OR SEDIMENT BAS	HOULD BE DONE ON AN AREA STABILIZED WITH CRUSHED S N. ITED FROM ENTERING ANY STORM DRAIN, DITCH OR WATER	
The Architect/Engineer assu		
responsibility for appropriat	e	
use of this standard.		REVISION NOTE: ADOPTED 6/21/2006
J.	CITY OF GEORGETOWN CONSTRUCTION STANDARDS AND DETAILS	EC06

STABILIZED CONSTRUCTION ENTRANCE

		OCCURRENCES OF 1/2 INCH OR GREATER TO POSTPONE THE WATERING SCHEDULE ONE W
	7.	RESTORATION TO BE ACCEPTABLE WHEN THE GRASS HAS GROWN AT LEAST $1\!-\!1/2$ INCHES PROVIDED NO BARE SPOTS LARGER THAN 25 SQUARE FEET EXIST.
		A MINIMUM OF FOUR (4) INCHES OF TOPSOIL TO BE PLACED IN ALL AREAS DISTURBED B
		THE CONTRACTOR TO HYDROMULCH OR SOD (AS SHOWN ON PLANS) ALL EXPOSED CUTS / OF CONSTRUCTION.
	10.	EROSION AND SEDIMENTATION CONTROLS TO BE INSTALLED OR MAINTAINED IN A MANNER V SOIL BUILDUP WITHIN TREE DRIPLINE.
	11.	TO AVOID SOIL COMPACTION, CONTRACTOR SHALL NOT ALLOW VEHICULAR TRAFFIC, PARKING EQUIPMENT OR MATERIALS IN THE TREE DRIPLINE AREAS.
	12.	WHERE A FENCE IS CLOSER THAN FOUR (4) FEET TO A TREE TRUNK, PROTECT THE TRUN PLANKING TO A HEIGHT OF EIGHT (8) FEET (OR TO THE LIMITS OF LOWER BRANCHING) IN
		TREES TO BE REMOVED IN A MANNER WHICH DOES NOT IMPACT TREES TO BE PRESERVED
	14.	ANY ROOT EXPOSED BY CONSTRUCTION ACTIVITY TO BE PRUNED FLUSH WITH THE SOIL, BA GOOD QUALITY TOPSOIL AS SOON AS POSSIBLE. IF EXPOSED ROOT AREAS ARE NOT BACKF COVER THEM WITH ORGANIC MATERIAL IN A MANNER WHICH REDUCES SOIL TEMPERATURE / DUE TO EVAPORATION.
	15.	CONTRACTOR TO PRUNE VEGETATION TO PROVIDE CLEARANCE FOR STRUCTURES, VEHICULAF BEFORE DAMAGE OCCURS (RIPPING OF BRANCHES, ETC.). ALL FINISHED PRUNING TO BE D RECOGNIZED, APPROVED STANDARDS OF THE INDUSTRY (REFERENCE THE "NATIONAL ARBOR STANDARDS FOR SHADE TREES").
	16.	THE CONTRACTOR IS TO INSPECT THE CONTROLS AT WEEKLY INTERVALS AND AFTER EVERY INCH TO VERIFY THAT THEY HAVE NOT BEEN SIGNIFICANTLY DISTURBED. ANY ACCUMULATED SIGNIFICANT RAINFALL TO BE REMOVED AND PLACED IN THE OWNER DESIGNATED SPOIL DIS TO CONDUCT PERIODIC INSPECTIONS OF ALL ERSION/SEDIMENTATION CONTROLS AND TO I
	17.	MODIFICATIONS NECESSARY TO ASSURE CONTINUED EFFECTIVE OPERATION OF EACH DEVICE. WHERE THERE IS TO BE AN APPROVED GRADE CHANGE, IMPERMEABLE PAVING SURFACE, TI SITE DEVELOPMENT IMMEDIATELY ADJACENT TO A PROTECTED TREE, ERECT THE FENCE APP
		FEET (2'-4') BEHIND THE AREA IN QUESTION.
		NO ABOVE AND/OR BELOW GROUND TEMPORARY FUEL STORAGE FACILITIES TO BE STORED IF EROSION AND SEDIMENTATION CONTROL SYSTEMS ARE EXISTING FROM PRIOR CONTRACTS REPRESENTATIVE AND THE CONTRACTOR TO EXAMINE THE EXISTING EROSION AND SEDIMENT FOR DAMAGE PRIOR TO CONSTRUCTION. ANY DAMAGE TO PREEXISTING EROSION AND SEDI
		TO BE REPAIRED AT OWNERS EXPENSE.
	20.	INTENTIONAL RELEASE OF VEHICLE OR EQUIPMENT FLUIDS ONTO THE GROUND IS NOT ALLC RESULTING FROM ACCIDENTAL SPILL TO BE REMOVED AND DISPOSED OF PROPERLY.
		The
		rest
		use
		REV
		CONSTRUCTION STANDARDS AND DETAILS
		GEORGETOWN TEXAS etom: Utility Systems trommatify owned Utility
	Y	ur Community Owned Utility
1		
		\bigwedge
		ř / Jýž

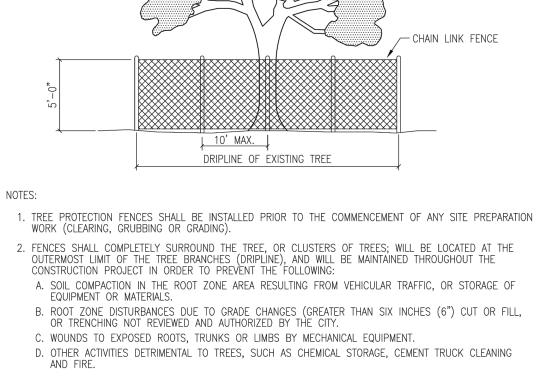

- 3. EXCEPTIONS TO INSTALLING FENCES AT TREE DRIPLINES MAY BE PERMITTED IN THE FOLLOWING CASES:
- A. WHERE PERMEABLE PAVING IS TO BE INSTALLED, ERECT THE FENCE AT THE OUTER LIMITS OF THE PERMEABLE PAVING AREA. B. WHERE TREES ARE CLOSE TO PROPOSED BUILDINGS, ERECT THE FENCE NO CLOSER THAN SIX FEET (6'-0") TO BUILDING.

The Architect/Engineer assumes responsibility for appropriate use of this standard.

DRAWN BY: APPROVED BY:

H	CITY OF GEORGETOWN CONSTRUCTION STANDARDS AND DETAILS	ľ
GEORGETOWN	TREE PROTECTION – CHAIN LINK FENCE	-
TEXAS Georgetown Utility Systems Your Community Owned Utility		-

	GUIDELINE	S	FOR	D	ESIGN	AND	INSTALLAT	ION	OF	
TEN	MPORARY	ER	OSIO	N	AND	SEDIM	1ENTATION	CON	TROL	\$

REACH LENGTH

N/A

200 FEET

100 FEET

50 FEET

100 FEET

50 FEET

500 FEET

FOR ROCK BERM DESIGN WHERE PARAMETERS ARE OTHER THAN STATED, DRAINAGE

AREA CALCULATIONS AND ROCK BERM DESIGN MUST BE SUBMITTED FOR REVIEW.

** HIGH SERVICE ROCK BERMS MAY BE REQUIRED IN AREAS OF ENVIRONMENTAL

SIGNIFICANCE AS DETERMINED BY THE CITY OF GEORGETOWN.

TYPE OF STRUCTURE

SILT FENCE

TRIANGLE FILTER DIKE

ROCK BERM *, **

MAXIMUM DRAINAGE AREA

2 ACRES

2 ACRES

1 ACRE

1/2 ACRE

1/2 ACRE

1/4 ACRE

< 5 ACRES

SLOPE

0 - 10%

10 - 20%


20 - 30%

> 30%

< 30% SLOPE

> 30% SLOPE

0 - 10%

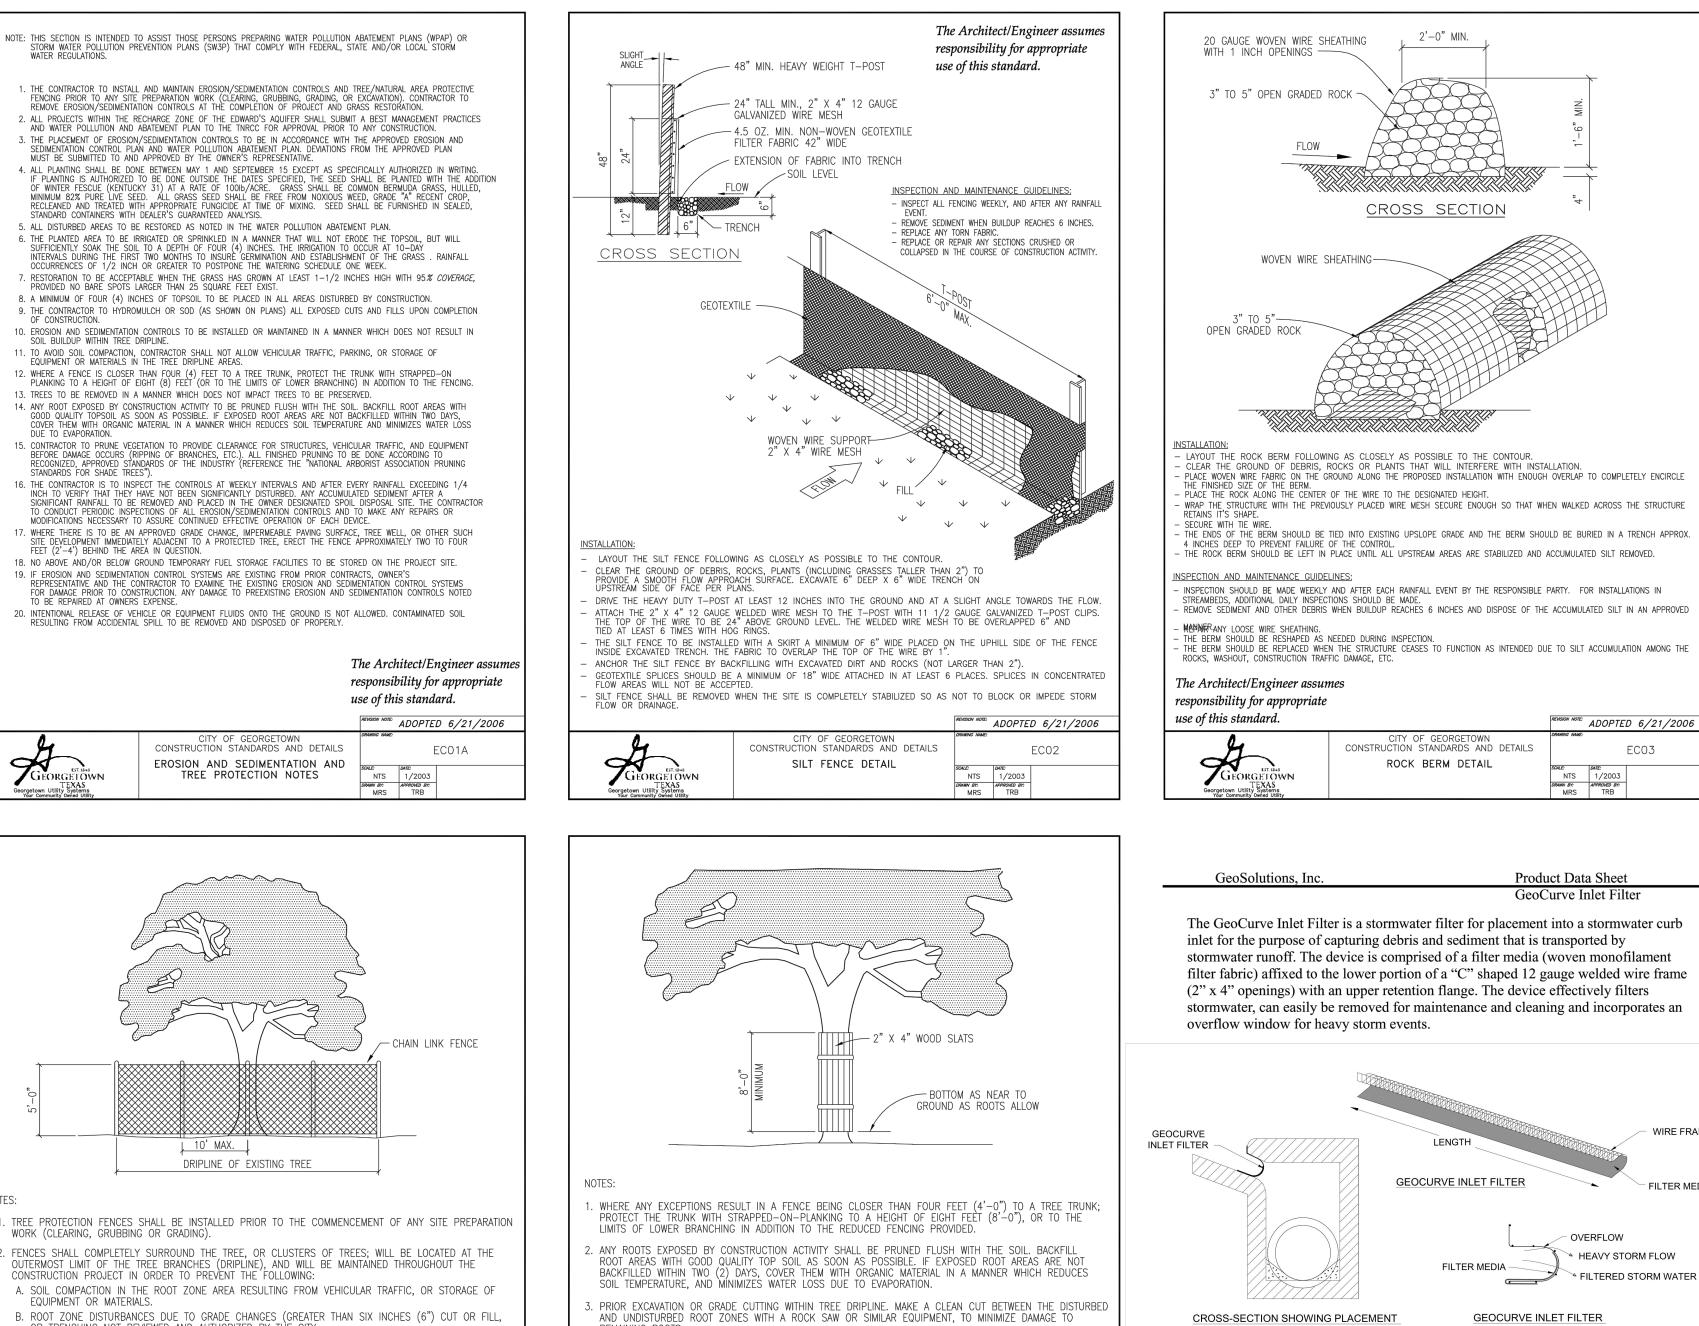

GEOCURVE INLET FILTER CROSS-SECTION

FILTER MEDIA PROPERTIES: Mono-filament Woven Filter Fabric

CROSS-SECTION SHOWING PLACEMENT

OF GEOCURVE IN CURB INLET

ASTM TEST	A LA LA LIE
METHOD	VALUE
D 3776	4.5 oz/sy
D 4632	170 lbs
D 3786	410 lbs/sq in
D 4355	80 %
D 4491	325 gal/min/sf
	METHOD D 3776 D 4632 D 3786 D 4355

GeoSolutions, Inc. 4417 Burleson Road Austin, Texas 78744

The Architect/Engineer assumes *responsibility for appropriate* use

BEFORE CONSTRUCTION BEGINS.

REMAINING ROOTS.

1	REVISION NOTE:	ADOPTE	D 6/21/2006	-	use of this standard.
	DRAWING NAME:		EC09	1	4
	DRAWN BY: MRS	DATE: 1/2003 APPROVED BY: TRB			Georgetown Utility Systems Your Community Owned Utility
	MING	IND		_	Your Community Owned Utility

e of this standard.		REVISION NOTE:		
2		REVISION HOLE.	ADOPTE	D 6/21/2006
H	CITY OF GEORGETOWN CONSTRUCTION STANDARDS AND DETAILS TREE PROTECTION - WOOD SLATS	DRAWING NAME:		EC10
GEORGETOWN TEXAS Georgetown Utility Systems Your Community Owned Utility	TREE TROTECTION - WOOD SEATS	scale: NTS drawn by: MRS	DATE: 1/2003 APPROVED BY: TRB	


4. TREES MOST HEAVILY IMPACTED BY CONSTRUCTION ACTIVITIES SHOULD BE WATERED DEEPLY ONCE A WEEK DURING PERIODS OF HOT, DRY WEATHER. TREE CROWNS SHOULD BE SPRAYED WITH WATER PERIODICALLY TO REDUCE DUST ACCUMULATION ON THE LEAVES.

5. ANY TRENCHING REQUIRED FOR THE INSTALLATION OF LANDSCAPE IRRIGATION SHALL BE PLACED AS FAR FROM EXISTING TREE TRUNKS AS POSSIBLE.


. NO LANDSCAPE TOPSOIL DRESSING GREATER THE FOUR INCHES (4") SHALL BE PERMITTED WITHIN THE


PRUNING TO PROVIDE CLEARANCE FOR STRUCTURES, VEHICULAR TRAFFIC AND EQUIPMENT SHALL TAKE PLACE


DRIPLINE OF A TREE. NO SOIL IS PERMITTED ON THE ROOT FLARE OF ANY TREE.

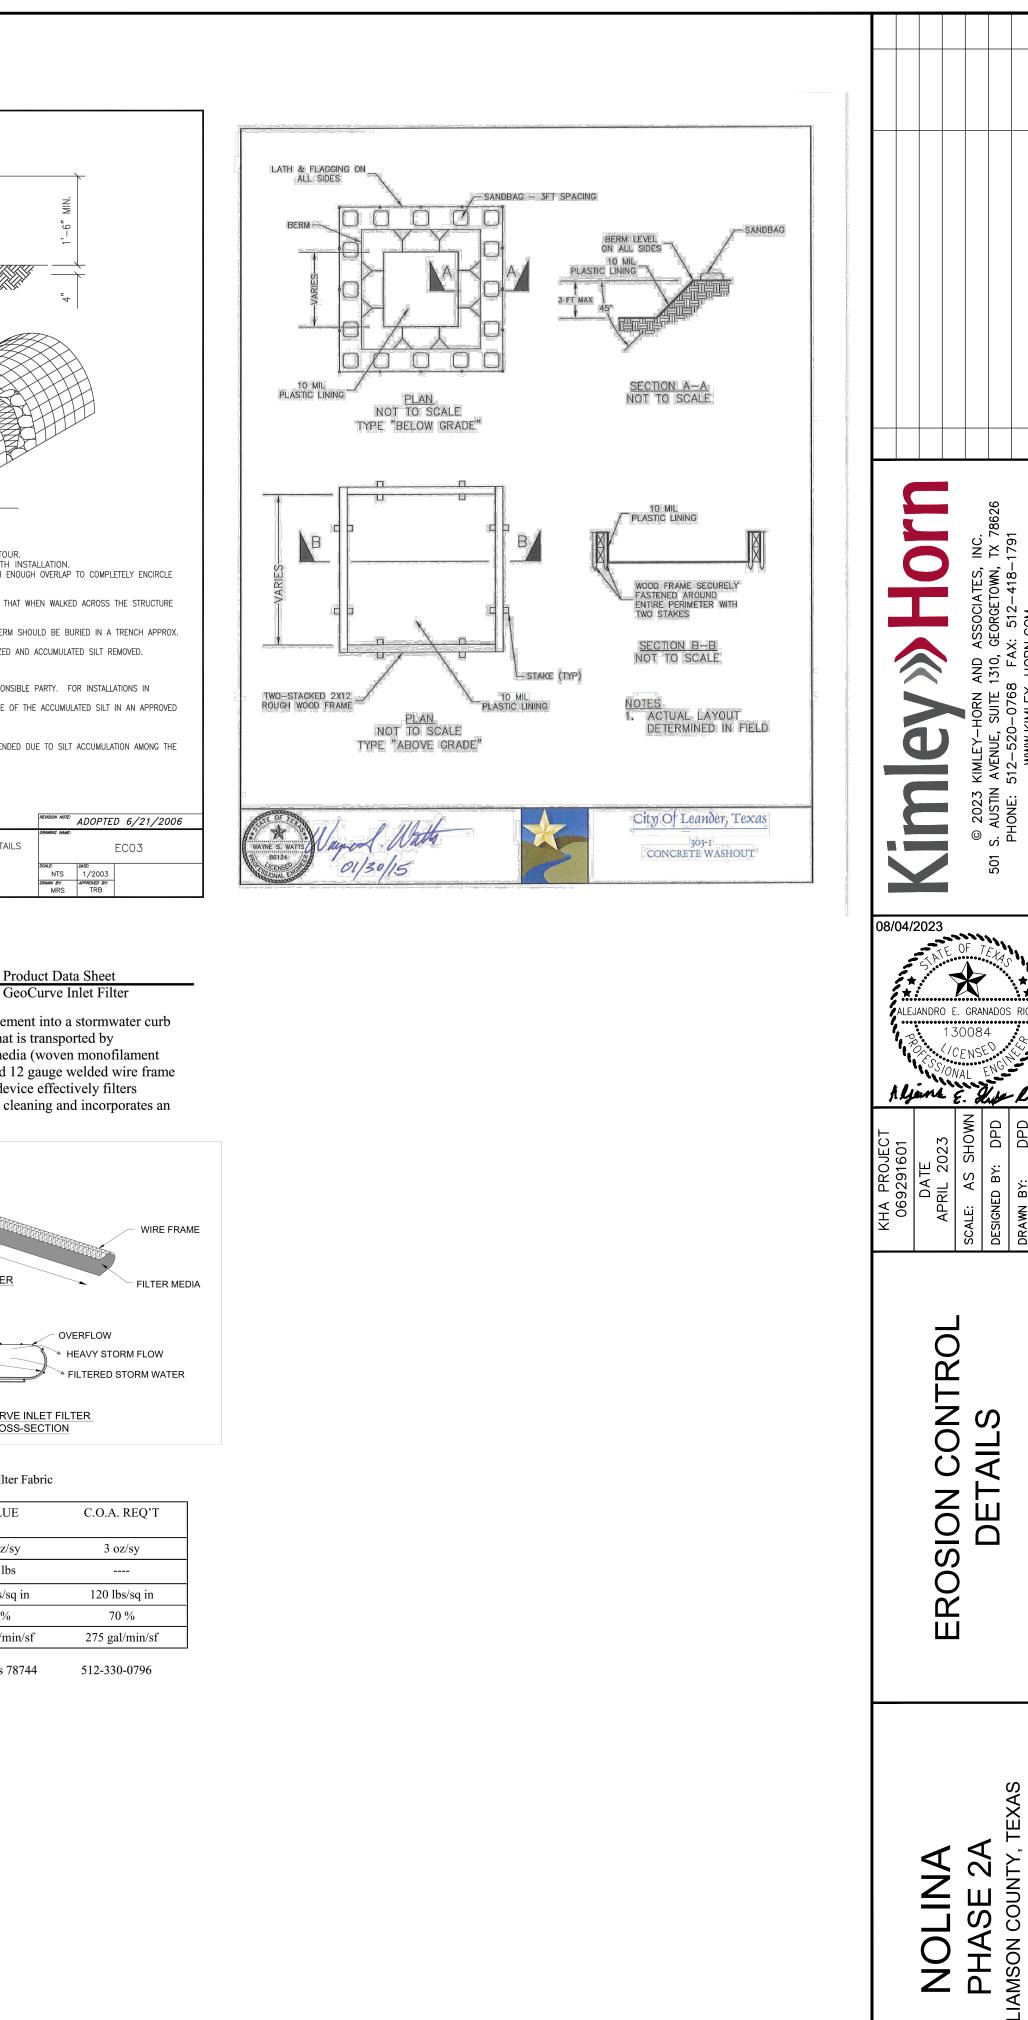

SHEET NUMBER

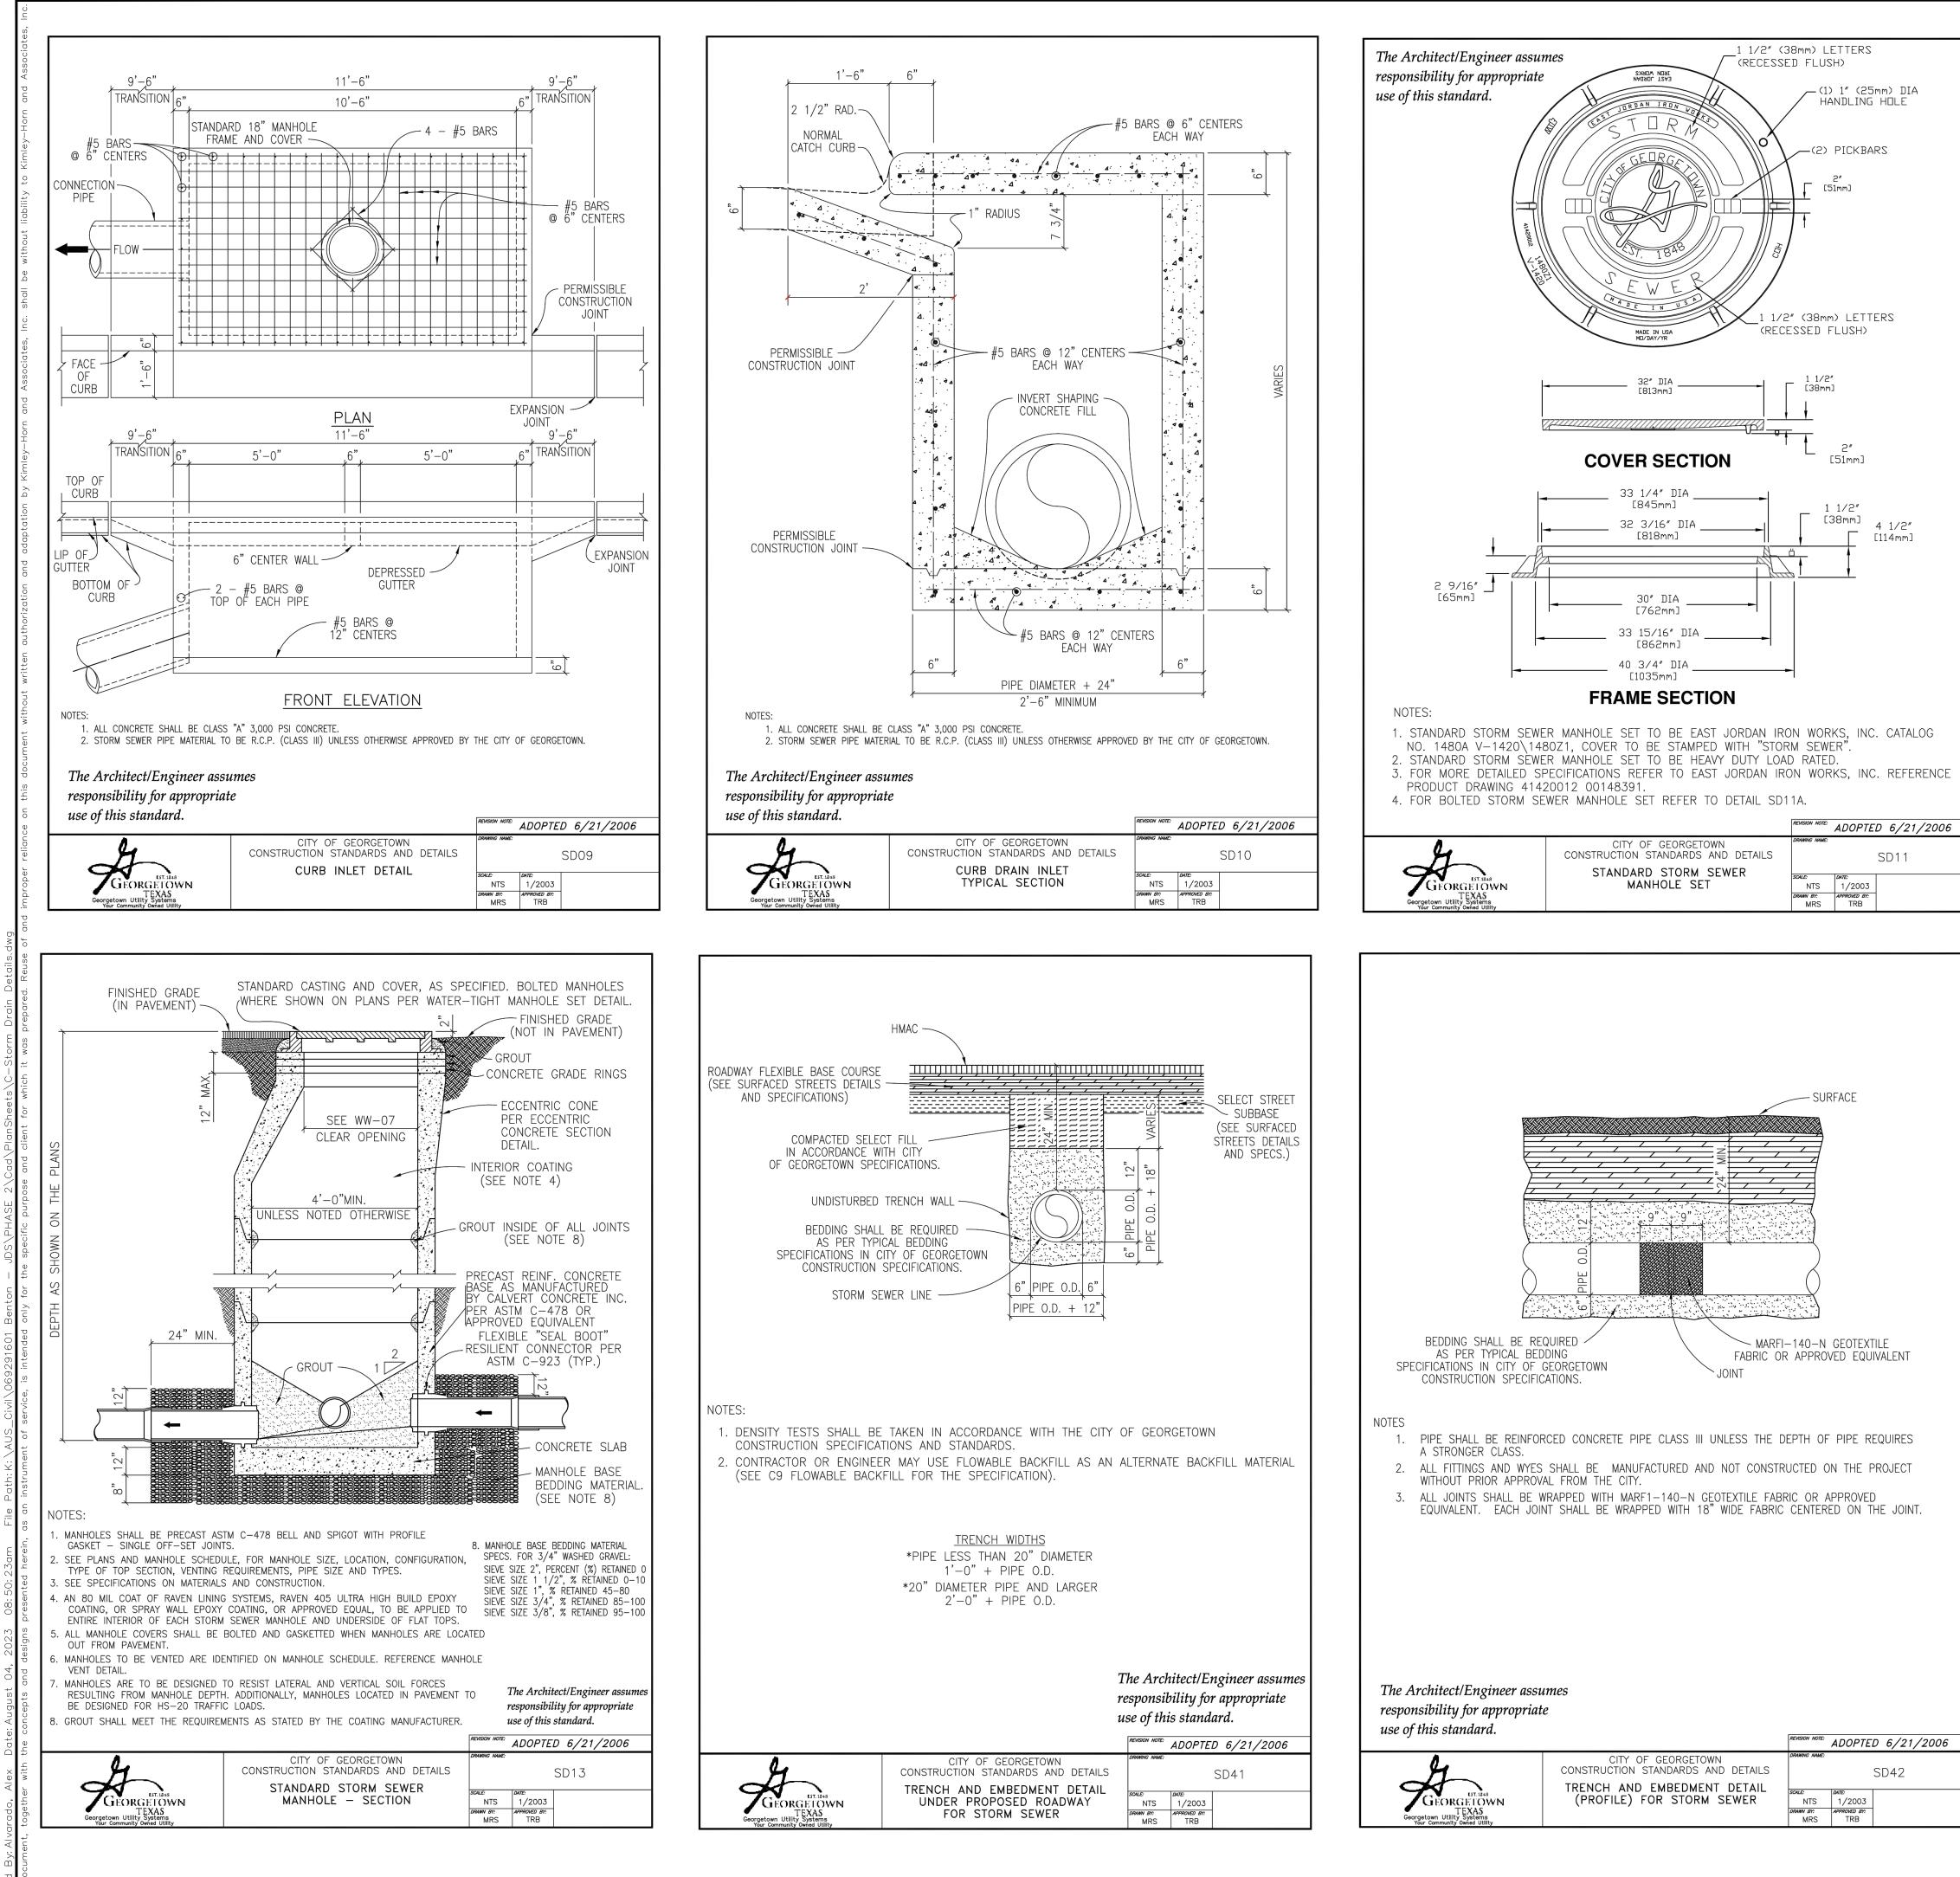

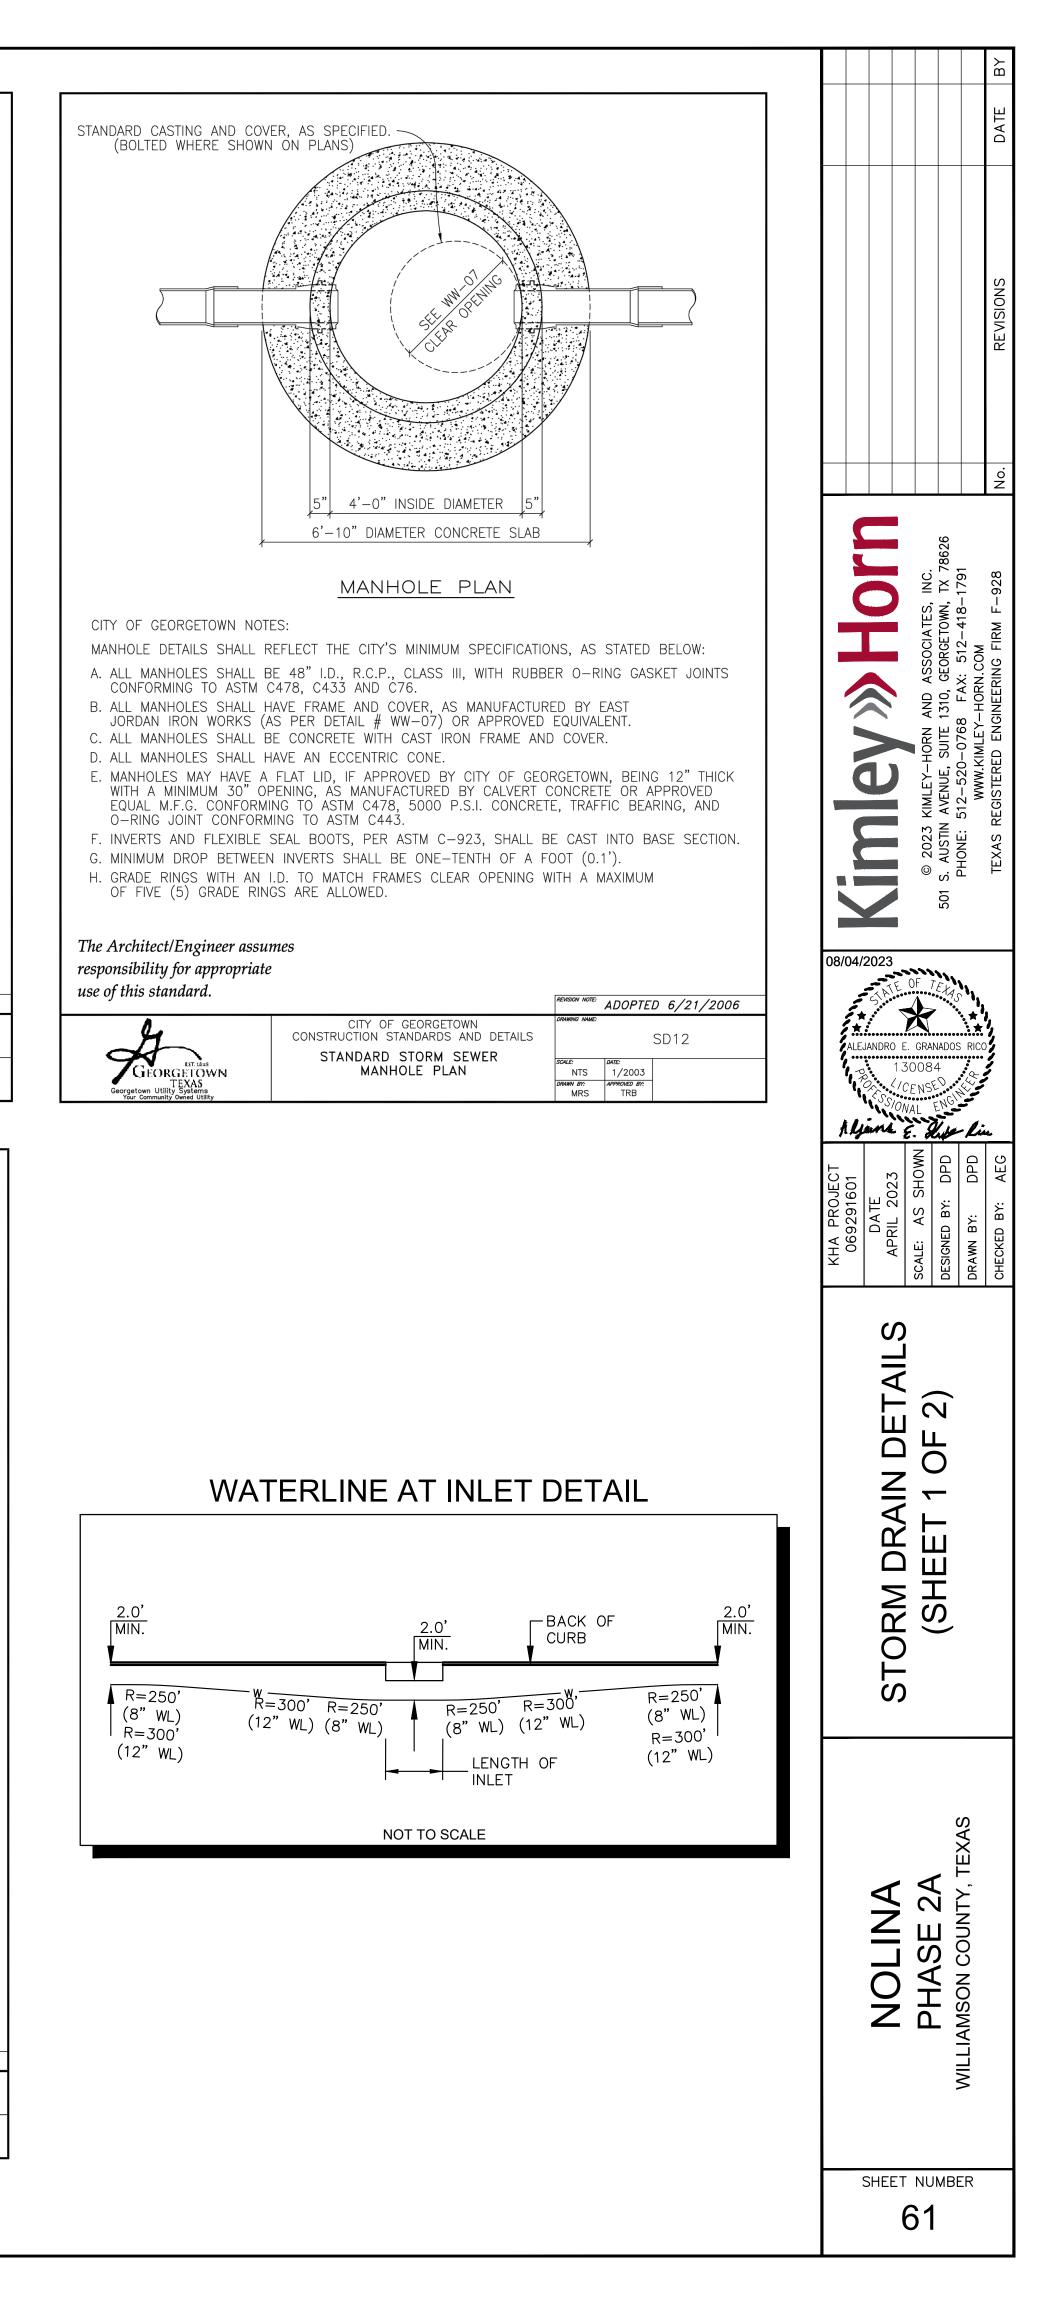

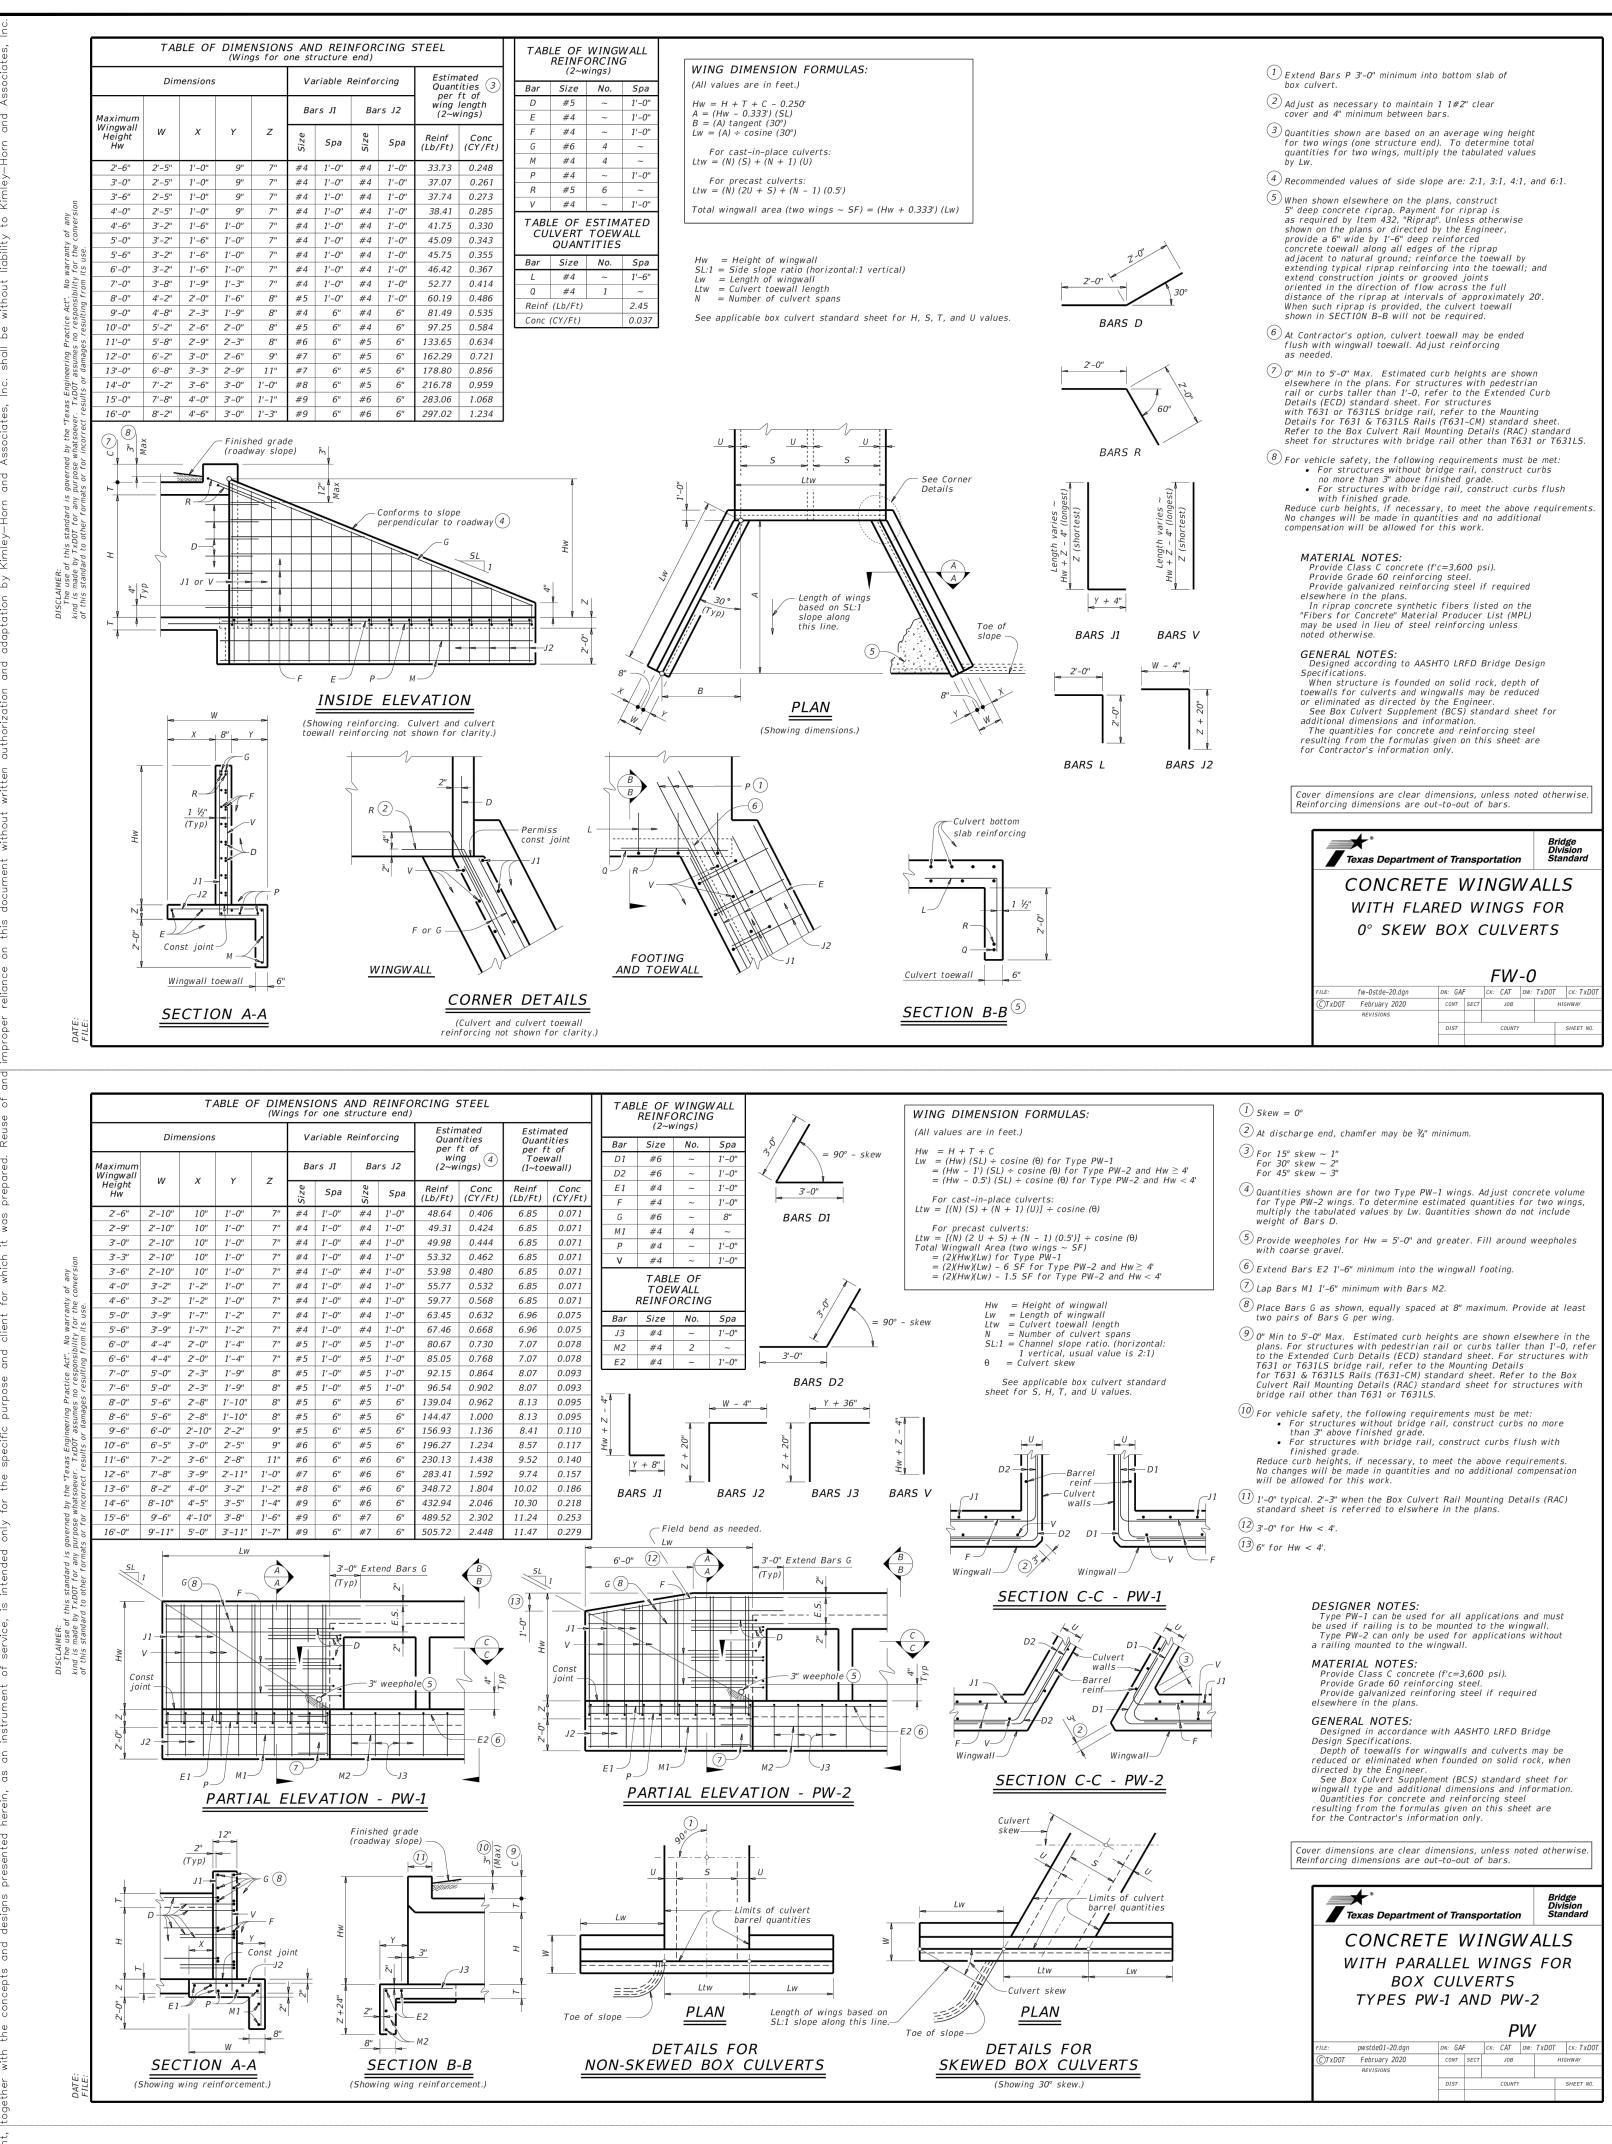

							DATE BY
							REVISIONS
							No.
08/				© 2023 KIMLEY-HORN AND ASSOCIATES, INC.	501 S. AUSTIN AVENUE, SUITE 1310, GEORGETOWN, TX 78626	PHONE: 512-520-0768 FAX: 512-418-1791 WWW.KIMLEY-HORN.COM	TEXAS REGISTERED ENGINEERING FIRM F-928
08/	ALEL	2023	/CE</th <th>)084 NSF</th> <th>Etas IADOS 1 NGV</th> <th>RICC</th> <th></th>)084 NSF	Etas IADOS 1 NGV	RICC	
KHA PROJECT	069291601			SCALE: AS SHOWN	DESIGNED BY: DPD	DRAWN BY: DPD	снескер ву: АЕС
				PHASE 2A		WILLIAMSON COUNTY, LEXAS	
	ç	SHEI		NU		ER	

Inspection, Maintenance, Repair and Retrofit Plan for Nolina Phase 2A



CONTRIBUTING ZONE PLAN ATTACHMENT N

INSPECTION, MAINTENANCE, REPAIR AND RETROFIT PLAN

The following sections address inspection and maintenance taken from the TNRCC Manual, "Complying with Edward Aquifer Rules: Technical Guidance on Best Management Practices."

Silt Fence:

1. Inspection shall be made weekly and after each rainfall event, in accordance with Section 1.4.3 of RG-348.

2. Tom fabric shall be replaced or a second line of fencing parallel to the tom section shall be implemented as needed.

3. Accumulated silt shall be removed when it reaches a depth of six (6) inches. The silt shall be disposed of on an approved site and in such a manner that will not contribute to additional siltation.

4. Silt fence shall be removed when the site is completely stabilized so as not to block or impede storm flow or drainage.

Inlet Protection:

1. Daily inspection shall be made by the Contractor and silt accumulation must be removed when depth reaches 50 mm (two (2) inches).

2. Contractor shall monitor the performance of inlet protection during each rainfall event and immediately remove the inlet protections if the stormwater begins to overtop the curb.

3. Inlet protections shall be removed as soon as the source of sediment is stabilized.

Stabilized Construction Entrance:

1. The entrance shall be maintained in a condition that will prevent tracking or flowing of sediment onto public roadway. This may require periodic top dressing with additional stone as conditions demand. As well as repair and clean out of any measure device used to trap sediment. All sediments that are spilled, dropped, washed or tracked onto public roadway must be removed immediately.

2. Entrance shall be properly graded to prevent run-off from leaving the construction site.

Concrete Washout Area:

1. Routine inspection in accordance with Section 1.4.18 of RG-348 of the area to ensure that sufficient quantity and volume remain to contain all liquid and concrete waste generated by washout operations.

2. Plastic lining material should be a minimum of 10 mil in polyethylene sheeting and should be free of holes, tears, or other defects that compromise the impermeability of the material.

3. When temporary concrete washout facilities are no longer required for the work, the hardened concrete should be removed and disposed of. Materials used to construct temporary concrete washout facilities should be removed from the site of the work and disposed of. Holes, depressions or other ground disturbance caused by the removal of the temporary concrete washout facilities should be backfilled and repaired.

Batch Detention Basin

- 1. Inspections: Basins should be inspected at least twice a year (once during or immediately following wet weather) to evaluate facility operation. When possible, inspections should be conducted during wet weather to determine if the pond is meeting the target detention times. In particular, the extended detention control device should be regularly inspected for evidence of clogging, or conversely, for too rapid a release. If the design drawdown times are exceeded by more than 24 hours, then repairs should be scheduled immediately. The upper stage pilot channel, if any, and its flow path to the lower stage should be checked for erosion problems. During each inspection, erosion areas inside and downstream of the BMP should be identified and repaired or revegetated immediately.
- 2. Mowing. The upper stage, side slopes, embankment, and emergency spillway of an extended detention basin must be mowed regularly to discourage woody growth and control weeds. Grass areas in and around basins should be mowed at least twice annually to limit vegetation height to 18 inches. More frequent mowing to maintain aesthetic appeal may be necessary in landscaped areas. When mowing of grass is performed, a mulching mower should be used, or grass clippings should be caught and removed.
- Debris and Litter Removal. Debris and litter will accumulate near the extended detention control device and should be removed during regular mowing operations and inspections. Particular attention should be paid to floating debris that can eventually clog the control device or riser.
- 4. Erosion Control. The pond side slopes, emergency spillway, and embankment all may periodically suffer from slumping and erosion, although this should not occur often if the soils are properly compacted during construction. Regrading and revegetation may be required to correct the problems. Similarly, the channel connecting an upper stage with a lower stage may periodically need to be replaced or repaired. g: Grass areas in and around sand filters must be mowed at least twice annually to limit vegetation height to 18 inches. More frequent mowing to maintain aesthetic appeal may be necessary in landscape areas. Vegetation on the pond embankments should be mowed as appropriate to prevent the establishment of woody vegetation
- 5. Structural Repairs and Replacement. With each inspection, any damage to the structural elements of the system (pipes, concrete drainage structures, retaining walls, etc.) should be identified and repaired immediately. These repairs should include patching of cracked concrete, sealing of voids, and removal of vegetation from cracks and joints. The various inlet/outlet and riser works in a basin will eventually deteriorate and must be replaced. Public works experts have estimated that corrugated metal pipe (CMP) has a useful life of about 25 yr, whereas reinforced concrete barrels and risers may last from 50 to 75 yr.
- 6. Nuisance Control. Standing water (not desired in a extended detention basin) or soggy conditions within the lower stage of the basin can create nuisance conditions for nearby residents. Odors, mosquitoes, weeds, and litter are all occasionally perceived to be problems. Most of these problems are generally a sign that regular inspections and

maintenance are not being performed (e.g., mowing, debris removal, clearing the outlet control device).

7. Sediment Removal. When properly designed, dry extended detention basins will accumulate quantities of sediment over time. Sediment accumulation is a serious maintenance concern in extended detention dry ponds for several reasons. First, the sediment gradually reduces available stormwater management storage capacity within the basin. Second, unlike wet extended detention basins (which have a permanent pool to conceal deposited sediments), sediment accumulation can make dry extended detention basins very unsightly. Third, and perhaps most importantly, sediment tends to accumulate around the control device. Sediment deposition increases the risk that the orifice will become clogged, and gradually reduces storage capacity reserved for pollutant removal. Sediment can also be resuspended if allowed to accumulate over time and escape through the hydraulic control to downstream channels and streams. For these reasons, accumulated sediment needs to be removed from the lower stage when sediment buildup fills 20% of the volume of the basin or at least every 10 years.

Rock Berm

1. Inspection should be made weekly and after each rainfall in accordance to Section 1.4.5 of RG-348. If placed in streambeds, inspection should occur on a daily basis.

2. Accumulated silt shall be removed when it reaches a depth of six (6) inches. The silt shall be disposed of on an approved site and in such a manner that will not contribute to additional siltation.

3. Loose wire sheathing shall be repaired immediately when necessary and the berm shall be reshaped as needed during inspection.

4. Berm shall be replaced if the structure ceases to function as initially intended due to factors such as silt accumulation, washout, construction traffic damage, etc.

5. When all upstream areas are stabilized and the accumulated silt has been removed, the rock berm should be removed and disposed of.

VEGETATIVE FILTER STRIPS

VEGETATIVE FILTER STRIPS

First Two Months: The first two months are the most important for vegetative filter strips, or until they are well established. The following guidelines should be followed most closely during this time period. After the vegetative filter strips have been well established, little additional maintenance is necessary.

Pest Management: An Integrated Pest Management (IPM) Plan should be developed for vegetated areas. This plan should specify how problem insects and weeds will be controlled with minimal or no use of insecticides and herbicides.

Seasonal Mowing and Lawn Care: If the filter strip is made up of turf grass, it should be mowed as needed to limit vegetation height to 18 inches, using a mulching mower (or removal of clippings). If native grasses are used, the filter may require less frequent mowing, but a minimum of twice annually. Grass clippings and brush debris should not be deposited on vegetated filter strip area Regular mowing should also include weed control practices, however herbicide use should be kept to a minimum (Urbonas et al., 1992). Healthy grass can be maintained without using fertilizers

because runoff usually contains sufficient nutrients. Irrigation of the site can help assure a dense and healthy vegetative cover.

Inspection: Inspect filter strips at least twice annually for erosion or damage to vegetation; however, additional inspection after periods of heavy runoff is most desirable. The strip should be checked for uniformity of grass cover, debris and litter, and areas of sediment accumulation. More frequent inspections of the grass cover during the first few years after establishment will help to determine if any problems are developing, and to plan for long-term restorative maintenance needs. Bare spots and areas of erosion identified during semi-annual inspections must be replanted and restored to meet specifications. Construction of a level spreader device may be necessary to reestablish shallow overland flow.

Debris and Litter Removal: Trash tends to accumulate in vegetated areas, particularly along highways. Any filter strip structures (i.e. level spreaders) should be kept free of obstructions to reduce floatables being flushed downstream, and for aesthetic reasons. The need for this practice is determined through periodic inspection, but should be performed no less than 4 times per year.

Sediment Removal: Sediment removal is not normally required in filter strips, since the vegetation normally grows through it and binds it to the soil. However, sediment may accumulate along the upstream boundary of the strip preventing uniform overland flow. Excess sediment should be removed by hand or with flat-bottomed shovels.

Grass Reseeding and Mulching: A healthy dense grass should be maintained on the filter strip. If areas are eroded, they should be filled, compacted, and reseeded so that the final grade is level. Grass damaged during the sediment removal process should be promptly replaced using the same seed mix used during filter strip establishment. If possible, flow should be diverted from the damaged areas until the grass is firmly established. Bare spots and areas of erosion identified during semi-annual inspections must be replanted and restored to meet specifications. Corrective maintenance such as weeding or replanting should be done more frequently in the first two to three years after installation to ensure stabilization. Dense vegetation may require irrigation immediately after planting, and during particularly dry periods, particularly as the vegetation is initially established

STORMTROOPER[™] SWAQ-40

MAINTENANCE GUIDELINES

A preventative maintenance cleanout schedule is the most valuable tool for maintaining the proper operation of StormTrooper[™]. Separator maintenance costs will be greatly reduced if a good housekeeping plan for the property is developed i.e. trash pickup, lawn maintenance, dumpster control, etc.

StormTrooper[™] separators have no moving parts and no filter cartridges. The manufacturer recommends quarterly ongoing inspections for accumulated pollutants. Pollutant deposition may vary from year to year. Quarterly inspections ensure that the system is serviced at the appropriate times. Table 4 lists recommended maximum capacities of oil and sediment. Professional vacuum services should be considered when capacities exceed these recommended levels.

StormTrooper [™] Maintenance Levels					
Model Number	Oil Depth	Sediment Depth			
SWAQ-40	12"	12"			

Inspection Procedures

1. Easiest observation and maintenance is best accomplished during non-flow (dry weather) conditions 3-4 days after the most recent rain.

2. Remove interceptor covers or open hatchway to observe conditions. Remove hatchway safety net ("EnterNet"). Observe for trash and debris and remove if necessary. This is the most important maintenance requirement. If absorbent pillows are utilized, observe their condition. Uniform browning or gray color of the pillow means they should be replaced. Observe baffle debris screen and clean if necessary.

3. Coalescing plates are self-cleaning and seldom require maintenance unless damaged. Do not walk on or stand on plate packs. Call ParkUSA (888-611-PARK) for replacement parts.

4. Check of the depth (level) of oil and sediment with a tank sampler devise designed for this purpose. The tank sampler requires a dipstick tube equipped with a ball valve (typically a Sludge Judge[®] or Core Pro[®]).

5. Make sure the dipstick tube goes completely to the bottom. Lift the dipstick tube out of the unit and keep it in a vertical position and read the level of sediment and oils from the gauge on the dipstick. Record pollutant levels on your StormTrooper[™] Monitoring/Maintenance Report. If either pollutant(s) in the dipstick tube (sediments or oils) exceed the levels indicated on Table 1, maintenance of the StormTrooper[™] is required. Upon completing the recording of pollutant levels, the dipstick tube is then drained back into the inlet side of the StormTrooper[™]. This ensures that the pollutants in the dipstick tube do not leave the unit.

Maintenance Procedures

• Park Environmental Equipment, manufacturers of StormTrooper[™], recommends that a professional pumping contractor licensed to remove and dispose waste from underground utilities be used to pump out the interceptor.

• Pull all manhole covers. Be sure all sections of the interceptor are cleaned. If a control/bypass manhole is part of the system, it should be inspected and serviced with the interceptor.

• If the coalescing media option is utilized, visually inspected the plates for any heavy build-up of oil, grease or sludge. Typically, the plates are self-cleaning and require little maintenance. If

buildup of material is evident, either remove the media from the frame or clean the plate pack in place. Removing media is accomplished by attaching a lifting device in the lifting lug provided (top center of the frame), and then pull straight up. Media plates may be cleaned in place with special steam cleaning nozzle attachment that provides a flat spray.

• Facet's MPak® plates are designed to be cleaned in place using a special cleaning wand and city water pressure. The wand has a connection just like an ordinary garden hose and is equipped with a small conical strainer in the connection so that solids in the inlet water will not clog the cleaning holes.

For cleaning in place, connect a pressure water hose (at least 60 psig) to the special cleaning wand. Provide a vacuum truck (or other means of disposing of the sludge and dirt) in the vessel. Turn on the water to produce a spray from the wand and insert the tip of the wand slowly into each hole of the plate pack, starting at the upstream end. As the water flushes the dirt out of the plate packs, it should be removed by the vacuum hose or directed to an oil water sewer if one is available. For cleaning outside of the vessel, remove the plate packs and other internals (except bolted-in internals). Flush with hose and cleaning wand to oil water drain.

(**NOTE:** The cleaning wand produces a vigorous spray. Operators should wear waterproof clothing and goggles or face mask.)

Typically, the vacuum truck will skim off the oil and other floatables. In most geographic areas the sediment can be disposed of in a sanitary landfill once dewatered. Pollutants are not allowed to be discharged back into the sanitary or storm sewer systems.

• After cleaning via vacuum truck, pumping contractor can refill the StormTrooper[™] with water previously drawn out of unit, or haul water to disposal facility and let natural rainfall recharge the unit during future rain events. Replace manhole covers.

• After cleanout is accomplished, obtain a copy of the service truck manifest. Update the StormTrooper[™] Monitoring/Maintenance Report and attach a copy of the manifest to the report.

NOLINA PHASE 2A CONTRIBUTING ZONE PLAN

Responsible Party for	Maintenance:JDS RR LLC
Address:	5005 Riverway Drive Ste. 500
City, State, Zip:	Houston, TX 77056
Telephone Number:	(512) 496-4070
Signature of Respons	sible Party:
PROJECT NAME:	Nolina Phase 2A
ADDRESS:	Approximately 1.80 miles northwest of the intersection of Ronald Regan
	Blvd. and CR 248
CITY, STATE ZIP:	Williamson County, Texas 78633

MEASURES FOR MINIMIZING SURFACE STREAM CONTAMINATION

During construction, Best Management Practices include the use of silt fence and inlet protection to capture sediment from the construction area contained within the storm water runoff. Silt fence will be installed along the downstream portion of the property and inlet protection will be installed around all existing and proposed inlet structures (once constructed). After construction, all disturbed areas on the site will be re-vegetated and runoff from the proposed improvements will be captured by the proposed inlets and conveyed to BMP's. Nolina Phase 2A has a total of 9 onsite water quality basins, 2 batch detention pond areas, 3 VFS areas, 3 WV areas, and 1 untreated area. The water quality drainage basins are piped into proposed storm sewer pipe and sent to two batch detention pond D; WQP-C (2A) is sent to Batch Detention Pond C built with Benton Phase 1, section 3; WV-1, Wv-2, and WV-3 are sent to an appropriately sized Stormtrooper. VFS, VFS-2, and VFS-3 are sent to vegetative filter strips. All proposed water quality BMP's are shown in the construction drawings under sheet 35. The TSS Removal calculations are shown on the Water Quality Calculations sheets 35-38. Please refer to the Erosion and Sedimentation Control for proposed temporary BMPs proposed on Sheet 6.

Kimley »Horn

SECTION 3: STORM WATER POLLUTION PREVENTION PLAN

STORM WATER POLLUTION PREVENTION PLAN (SWP3)

Nolina Phase 2A

Williamson County, Texas

JUNE 2023

Project Owner:

JDS RR LLC 5005 Riverway Drive, Ste 500 Houston, TX 77056

Project Contractor:

TBD

Prepared By:

KIMLEY-HORN AND ASSOCIATES, INC.

501 S. Austin Avenue, Suite 1310 Georgetown, Texas 78626 (512) 520-0768

TBPE Firm No. 928 KHA Project No. 069291601


TABLE OF CONTENTS

1.0	INTRODUCTION	1
2.0	 A. Project Name and Location	1222344455 6666
	E. Information on Soil Types	6
	F. Receiving Waters and WetlandsG. Threatened and Endangered Species	
	H. Discharges to the Edwards Aquifer Recharge Zone	
3.0	BEST MANAGEMENT PRACTICE MEASURES AND CONTROLS	9
A.	Minimize Disturbed Area and Protect Natural Features and Soil	9
В.	Phase Construction Activity	9
C.	Control Stormwater Flowing onto and through the Project1	0
D.	Stabilize Soils 1	0
E.	Protect Slopes1	2
F.	Protect Storm Drain Inlets	2
G.	Establish Perimeter Controls and Sediment Barriers1	2
Н.	Retain Sediment On-Site1	3
	diment basins are proposed for the site. Sediments will remain on-site by use of eter controls and sediment barriers are described in the preceding section1	3
I.	Establish Stabilized Construction Exits1	3
J.	Additional BMPs1	4
4.0	EXAMPLE PRACTICES1	4
	 A. Example Stabilization Practices	4

	D. Timing of Controls/Measures	18
5.0	RELEASES OF REPORTABLE QUANTITIES	19
6.0	STATE AND LOCAL PROGRAMS	20
7.0	INSPECTION AND MAINTENANCE	20
	A. Inspection Schedule	20
	B. Inspection Reports	21
	C. Final Stabilization	
8.0	RECORD RETENTION	22
9.0	CONCRETE BATCH PLANTS (IF APPLICABLE)	23
	A. Storm Water Runoff from Concrete Batch Plants	
	B. Benchmark Sampling Requirements	
	C. Additional BMP and SWP3 Requirements	23
10.0	CONCRETE TRUCK WASH OUT (IF APPLICABLE)	25
	A. Wash Out Requirements	25
11.0	REFERENCES	26

APPENDICES

APPENDIX A	Project Maps
APPENDIX B	Construction Activity Schedule
APPENDIX C	Best Management Practice Checklist and Fact Sheets
APPENDIX D	Inspection and Maintenance Reports
APPENDIX E	Roles and Responsibilities Checklist and Certification Statement
APPENDIX F	TPDES General Permit (TXR150000) for Storm Water Discharges from Construction Activities
APPENDIX G	Site Notice, Notice of Intent, Notice of Change, and Notice of Termination Forms
APPENDIX H	Record of Temporary/Permanent Ceasing of Construction Activities
APPENDIX I	Delegation of Signatories
APPENDIX J	Material Management Practices
APPENDIX K	Non-Storm Water Discharge Inventory
APPENDIX L	Reportable Quantities of Hazardous Substances
APPENDIX M	Sedimentation Basin Information
APPENDIX N	Local Requirements

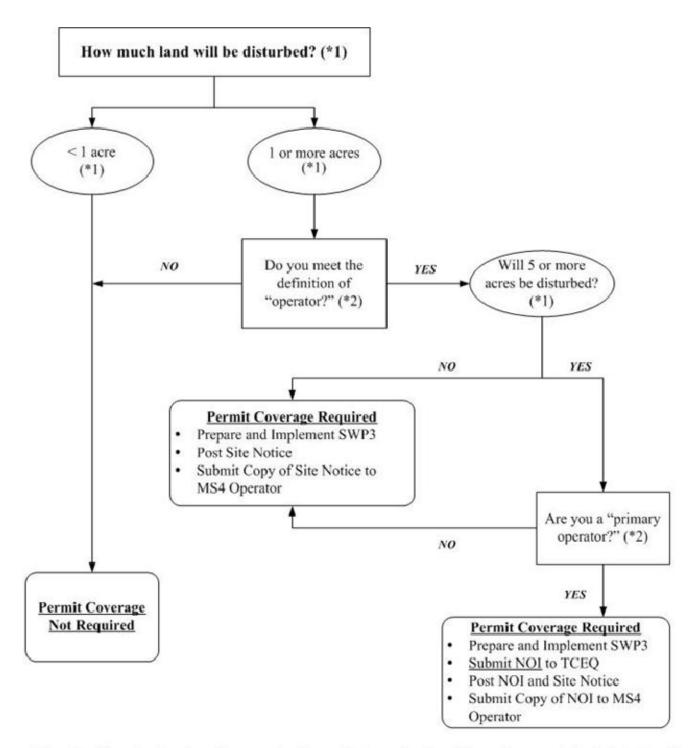

- (*1) To determine the size of the construction project, use the size of the entire area to be disturbed, and include the size of the larger common plan of development or sale, if the project is part of a larger project (refer to Part I.B., "Definitions," for an explanation of "larger common plan of development or sale").
- (*2) Refer to the definitions for "operator," "primary operator," and "secondary operator" in Part I., Section B. of this permit.

STORM WATER POLLUTION PREVENTION PLAN REVISIONS

Provide a general description and document the date of any revisions to the storm water pollution prevention plan during the course of this construction project. Revisions may be necessary as a result of site inspections or because of a change in the circumstances of the construction project (such as schedule change or a modification in design).

The Storm Water Pollution Prevention Plan (SWP3) must be modified based on the results of inspections, as necessary, to better control pollutants in runoff. Revisions to the SWP3 must be completed within seven (7) calendar days following the inspection. If existing best management practices (BMPs) are modified or if additional BMPs are necessary, an implementation schedule must be described in the SWP3 and wherever possible those changes implemented before the next storm event. If implementation before the next anticipated storm event is impracticable, these changes must be implemented as soon as practicable.

REVISION (Refer to attachments if necessary)	DATE	SIGNATURE

1.0 INTRODUCTION

On April 10, 2003, responsibility for the administration of storm water protection associated with construction activities in Texas was delegated by the U.S. Environmental Protection Agency (EPA) to the Texas Commission on Environmental Quality (TCEQ). The Texas Pollutant Discharge Elimination System (TPDES) program in Texas meets or exceeds the National Pollutant Discharge Elimination System (NPDES) standards established on a federal level. This SWP3 has been developed in accordance with the TPDES requirements. Additional local requirements may apply and this SWP3 should be updated accordingly (Appendix O).

The purpose of the SWP3 is to provide guidelines for preventing or minimizing sediment and other pollutants that may originate on the site from flowing into municipal storm systems or jurisdictional waters during the construction period. This plan also addresses the principal activities known to disturb significant amounts of ground surface during construction. Stabilization measures must begin within fourteen (14) days of stoppage of construction activities (Appendix I). The permit coverage requirements terminate when areas disturbed for this project reach full stabilization (i.e., when disturbed areas are paved or achieve 70 percent native background vegetative coverage). Revisions to this plan will be made as necessary to accurately reflect project activities and storm water pollution prevention measures.

The storm water management controls included in this SWP3 focus on providing control of pollutant discharges with practical approaches that use readily available techniques, expertise, materials, and equipment. The necessary forms for implementing the SWP3 are found in the appendices of this document, including the Inspector's Qualifications, Inspection Form, Notice of Intent (NOI), Notice of Termination (NOT), and construction site notice. The SWP3 must be implemented prior to the start of construction activities.

The Project Owner's and the Contractor's roles and responsibilities for implementation and maintenance of the elements of the SWP3 are shown in a checklist in Appendix F of this document. Appendix F also includes a description of primary and secondary operators, along with associated responsibilities. The Project Owner and each Contractor must complete the checklist in Appendix F and sign the included certification statement. The certification statement indicates that each operator understands and accepts their roles and responsibilities with respect to storm water pollution prevention for this project.

A. Project Name and Location

Nolina Phase 2A - Williamson County, Texas (See Appendix A for a project location map).

B. Owner Information

JDS RR LLC 5005 Riverway Dr., Ste 500
Houston, TX 77056
: L. Michael Cox
Vice President
(713) 960-9977
· ·

C. Contractor Information

Name: Address:	
Representative:	
Title:	
Telephone:	
Fax:	

D. Subcontractor Information

Name: Address:	
Representative: Title: Telephone: Fax:	· · · · · · · · · · · · · · · · · · ·
Name: Address:	
Representative: Title: Telephone: Fax:	

E. Discharges Eligible for Authorization

The general permit for construction activities allows for storm water discharges from construction activities, construction support activities, and authorized non-storm water discharges. Under the general permit, construction support activities include, but are not limited to:

- concrete and asphalt batch plants,
- rock crushers,
- equipment staging areas,
- material storage yards,
- material borrow areas, and
- excavated material disposal areas.

Storm water discharges from these construction support activities are authorized under the general permit for construction activities provided:

- the activity is located within one mile of the permitted construction site and is directly supporting the construction activities,
- the SWP3 for the permitted construction activities is developed to include the controls and measures to reduce erosion and discharge of pollutants in storm water runoff from the construction support activities, and

 the construction support activities either do not operate beyond the completion date of the construction activity or, at the time that they do, are authorized under separate Texas Pollutant Discharge Elimination System (TPDES) authorization.

The following non-storm water discharges are also authorized under the general permit for construction activities:

- Discharges from firefighting activities,
- Uncontaminated fire hydrant flushings,
- Water from routine external washing of vehicles, the external portion of buildings or structures, and pavement (where detergents and soaps are not used),
- Uncontaminated water used to control dust,
- Potable water sources, including waterline flushings,
- Uncontaminated air conditioning condensate,
- Uncontaminated groundwater or spring water, and
- Lawn watering and similar Irrigation drainage.

Part II.A.3 of the general permit contains additional information and requirements for non-storm water discharges. Discharges of storm water runoff from concrete batch plants may be authorized provided that the benchmark sampling and associated requirements located in Part V of the general permit are met. The wash out of concrete trucks associated with off-site facilities may be conducted in accordance with the requirements of Part V of the general permit. The Operator will be responsible for updating the SWP3 to meet Part V requirements, if applicable. A non-storm water discharge inventory is located in Appendix L.

F. Obtaining Coverage under the General Permit

Construction activities, including the activities associated with this project, disturbing five (5) acres or more (definition of a large construction activity) are required to comply with the following requirements of the general permit to obtain permit coverage:

- a) Develop a SWP3 according to the provisions of the general permit that covers either the entire site or all portions of the site for which the applicant is the operator and implement that plan prior to commencing construction activities.
- b) Primary operators must submit a NOI:
 - 1) at least seven days prior to commencing construction activities if mailing a paper NOI, or
 - 2) prior to commencing construction activities if utilizing electronic submittal.

A copy of the NOI form is located in Appendix H. Instructions for NOI submittal relating to primary operator additions or changes are also located in Appendix H.

- c) Post a site notice where it is safely and readily available for viewing by the general public, local, state, and federal authorities prior to commencing construction. The site notice must be maintained until completion of the construction activity.
 - For linear construction activities, the site notice must be placed in a publicly accessible location near where construction is actively underway. A copy of the construction site notice is located in Appendix H.

- d) All primary operators must also post a copy of the signed NOI at the construction site in a location where it is readily available for viewing by the general public, local, state, and federal authorities prior to starting construction activities until completion of the construction activity. If multiple crews will be conducting construction activities under the general permit simultaneously, copies of the signed NOI should be posted at each separate construction site.
- e) All primary operators must provide a copy of the signed NOI at least seven days prior to commencement of construction activities to any secondary operator and to the operator of any municipal separate storm sewer system (MS4) receiving construction site discharge. The names and addresses of all MS4 operators receiving a copy of the NOI are to be recorded in this SWP3 (Appendix H).
- f) Secondary operators are regulated under the general construction permit but are not required to submit a NOI provided that:
 - 1) a primary operator(s) at the site has submitted a NOI, or
 - 2) another operator(s) is required to submit a NOI and the secondary operator has provided notification to the operator(s) of the need to obtain coverage.

Additional information for secondary operators seeking alternative coverage is located in the general permit.

Questions about the TPDES construction permit program can be directed to the TCEQ Storm Water and General Permits Team at (512) 239-4515. A copy of the TPDES General Permit (TXR150000) for Storm Water Discharges from Construction Activities has been included in Appendix G for reference.

G. Notice of Change Letter

If the Operator becomes aware that he/she failed to submit any relevant facts, or submitted incorrect information in a NOI, the correct information must be provided to the TCEQ in a Notice of Change (NOC) letter within fourteen (14) days after discovery. In addition, if relevant information provided in the NOI changes, a NOC letter must be submitted to the TCEQ within fourteen (14) days of the change. A copy of the NOC must be provided to the operator of any MS4 receiving discharge from the construction activity. The names and addresses of all MS4 operators receiving a copy of the NOC must be included in this SWP3 (Appendix H).

H. Notice of Termination

Authorization under the general permit must be terminated by submitting a completed and signed NOT form provided in Appendix H. The NOT must be submitted to the TCEQ, and a copy of the NOT must be provided to the operator of any municipal separate storm sewer system (MS4) receiving the discharge within thirty (30) days after final stabilization has been achieved on all portions of the site that are the responsibility of the permittee, or another permitted contractor has assumed control over all areas of the site that have not been finally stabilized. The names and addresses of all MS4 operators receiving a copy of the NOT must be recorded in this SWP3 (Appendix H).

I. Termination of Coverage for Secondary Operators

Each operator that obtained authorization of the general permit without submitting a NOI must remove the site notice and complete the applicable portion of the notice related to removal of the notice. A copy of

the completed notice must be submitted to the operator of any MS4 receiving site discharge within 30 days of any the following conditions:

- a) final stabilization has been achieved on all portions of the site that are the responsibility of the permittee,
- b) a transfer of operational control has occurred, or
- c) the operator has obtained alternative authorization under an individual TPDES permit or alternative TPDES general permit.

J. SWP3 Availability

This SWP3 must be retained on-site at the construction site, or if the site is inactive or does not have an on-site location to store the plan, a notice must be posted describing the location of the SWP3. This SWP3 must be made readily available at the time of an on-site inspection.

K. Hazardous Materials

The following potential pollutant sources may be present at the site due to the nature of the construction activities. An inventory of materials is located in Appendix L. Controls for potential pollutants are listed and described in Appendices C and D.

- Solvents
- Stains/paints
- Fuels
- Oils
- Grease
- Pesticides
- Fertilizer
- Sediment/total suspended solids

- Trash
- Paving
- Concrete curing compound
- Glue adhesives
- Joint compound
- Concrete, painting, and brick wash
- Excavation pump-out water
- Concrete

2.0 SITE DESCRIPTION

A. General Site Description

The construction site is located in Williamson County, Texas outside all jurisdictions and ETJs (Appendix A). The site covers an area of approximately 52.20-acres and is a part of a known larger common plan of development. The construction site is generally located northwest of the intersection of Ronald Reagan Blvd. and CR 248. Coordinates for the site are approximately 30.745 latitude and -97.832 longitude (1983 North American Datum (NAD83) Coordinates).

This site is located over the Edwards Aquifer Contributing Zone and is not located on Indian Country Lands. If information about the Edwards Aquifer Zone or Indian Country Lands changes, the Operator should update this SWP3 accordingly.

B. Nature of Construction Activity

The purpose of the construction project is to construct roadways, water quality/detention pond, and civil improvements (water, wastewater, storm sewer) to serve the proposed single-family development. The table in Appendix B should be updated to depict the anticipated schedule for the project.

C. Estimate of Total Site Area and Disturbed Area

The amount of area involved in the project is estimated to be 52.20-acres of platted area. The total disturbed areas are projected to total approximately 50.51-acres.

D. Storm Water Discharge Locations and Quality Data

No data is available describing quality of storm water discharges from the site. Information will be added to this plan as it is received.

E. Information on Soil Types

A soils map showing the project site and surrounding area is included in Appendix A. The predominant soil types found on the project site are Brackett gravelly clay loam (BkE), 3 to 12 percent slopes; Denton silty clay (DnB), 1 to 3 percent slopes; and Doss silty clay, moist (DoC), 1 to 5 percent slopes. A description of these soils is located in Appendix A (USDA, 2019).

F. Receiving Waters and Wetlands

The site lies to the north of the North Fork San Gabriel River, the sites receiving body of water. This portion of the river is not listed on the 2008 Texas 303(d) list of impaired waters.

New sources or new discharges of the constituents of concern to impaired waters are not authorized by the general construction permit (unless otherwise allowable under 30 TAC Chapter 305 and applicable state law). Impaired waters are those that do not meet applicable water quality standards and are listed on the EPA approved CWA 303(d) list. Pollutants of concern are those for which the water body is listed as impaired.

If discharges are expected to enter into a receiving water body located on the 303(d) list, constituents of concern are those for which the water body is listed as impaired. Discharges of the constituents of concern to impaired water bodies for which there is a total maximum daily load (TMDL) are not eligible for the general permit unless they are consistent with the approved TMDL. The receiving water does not have a known published TMDL. Permittees must incorporate the conditions and requirements applicable to their discharges, including monitoring frequency and reporting required by TCEQ rules, into this SWP3 in order to be eligible for coverage under the general permit.

There are no known wetlands on the site. If any wetlands are identified on the site, the Operator should update this SWP3 accordingly.

G. Threatened and Endangered Species

Are endangered or threatened species and critical habitats on or near the project area?

🛛 Yes 🗌 No

Describe how this determination was made:

In the environmental study performed by ACI Consulting, as potential habitat for the golden-cheeked warbler, portions of Nolina Phase 2A were identified as possible habitat for the golden-cheeked warbler. These studies were performed by ACI Consulting and no areas within the construction area require any action to preserve endangered species or their habitat.

If yes, describe the species and/or critical habitat:

Golden-Cheeked Warbler

If yes, describe or refer to documentation that determines the likelihood of an impact on identified species and/or habitat and the steps taken to address that impact. (Note, if species are on or near your project site, EPA strongly recommends that the site operator work closely with the appropriate field office of the U.S. Fish and Wildlife Service or National Marine Fisheries Service. For concerns related to state or tribal listing of species, please contact a state or tribal official.)

H. Discharges to the Edwards Aquifer Recharge Zone

Discharges cannot be authorized by the general permit where prohibited by 30 Texas Administrative Code (TAC) Chapter 213.

1. New Discharges

For new discharges located within the Edwards Aquifer Recharge Zone, or within that area upstream from the recharge zone and defined as the Contributing Zone, operators must meet all applicable requirements of, and operate according to, 30 TAC Chapter 213 (Edwards Aquifer Rule) in addition to the provisions and requirements of the general construction permit. A copy of 30 TAC Chapter 213 is located in Appendix Q.

2. Existing Discharges

For existing discharges, the requirements of the agency-approved Water Pollution Abatement Plan under the Edwards Aquifer Rules are in addition to the requirements of the general construction permit. Best management practices and maintenance schedules for structural storm water controls, for example, may be required as a provision of the rule. All applicable requirements of the Edwards Aquifer Rule for reductions of suspended solids in storm water runoff are in addition to the requirements in the general construction permit. A copy of the 30 TAC Chapter 213 is located in Appendix Q.

For discharges from large construction activities located on the Edwards Aquifer recharge zone or the Edwards Aquifer contributing zone, applicants must also submit a copy of the NOI to the appropriate TCEQ regional office. For discharges from large construction activities by operators not required to submit a NOI, a copy of the construction site notice must be submitted to the appropriate TCEQ regional office.

Counties:

Comal, Bexar, Medina, Uvalde, and Kinney

Contact:

TCEQ Water Program Manager San Antonio Regional Office 14250 Judson Road San Antonio, Texas (210) 490-3096

Williamson, Travis, and Hays

TCEQ

Water Program Manager Austin Regional Office 2800 South IH 35, Suite 100 Austin, Texas 78704-5712 (512) 339-2929

3.0BEST MANAGEMENT PRACTICE MEASURES AND CONTROLS

A. MINIMIZE DISTURBED AREA AND PROTECT NATURAL FEATURES AND SOIL

The entire limits of construction, detailed in the Erosion and Sedimentation Control Plan, are subject to disturbance during construction activities. The construction will have one (1) staging and spoils area located within the limits of construction that will be used to store and save topsoil and trenching materials. The contractor will try to minimize disturbance of the natural ground as much as possible during the construction process and will not leave the designated limits of construction for the project.

B. PHASE CONSTRUCTION ACTIVITY

This project is proposed to be constructed in one single phase. The contractor will install all silt fencing prior to beginning any construction or demolition. An exception will be made with the proposed J-hooks, as identified on the Erosion and Sedimentation Control Plan found in site's construction plan set. J-hooks are to be installed over trenched areas after soils have been replaced, compacted and graded. Specific areas where J-hooks are to be utilized are shown on the Erosion and Sedimentation Control Plan. Soil stabilization will take place after J Hooks have been installed.

The sequence of major activities for Nolina Phase 2A of the development will be as follows:

Phase 1 (total disturbed area approximately 50.51 acres):

- 1) Install tree protection and initiate tree mitigation measures.
- 2) Install erosion controls as indicated on approved plan.
- 3) Contact Williamson County to schedule the preconstruction coordination meeting.
- 4) Evaluate temporary erosion control installation. Review construction schedule with the erosion control plan.
- 5) Rough grade site. Proposed batch detention pond grading to be performed before rough grading remainder of the site, as these ponds will act as a storage for storm water during construction. Inspect and maintain all controls as per general notes. Total area disturbed with this phase will be entire site approximately 50.51 acres.
- 6) Construct site utilities and paving.

Phase 2 (total disturbed area approximately 50.51 acres):

- 7) Complete construction and install landscaping and/or re-vegetation.
- 8) Re-vegetate disturbed areas or complete a developer's contract for the re-vegetation along with the engineer's concurrence letter.
- 9) Project engineer inspects job and writes concurrence letter to the County. Final inspection is scheduled upon receipt of letter.

Final Phase (all temporary E&S to be removed, and no disturbed area)

10) Upon re-vegetation per Williamson County requirements, remove temporary erosion/sedimentation controls.

C. CONTROL ST	CONTROL STORMWATER FLOWING ONTO AND THROUGH THE PROJECT		
BMP Description: Silt Fence –	BMP Description: Silt Fence – Perimeter and J-Hooks		
Installation Schedule:	Prior to commencing construction activities.		
Maintenance and Inspection:	If a standard standard fabric is used it as he wishers all it as a she		
Responsible Staff:	TBD		

BMP Description: Rock Berms – Check Dam			
Installation Schedule:		Prior to commencing construction activities.	
Maintenance Inspection:	and	Inspect the berm after every rainfall to make sure sediment has not built up and that vehicles have not damaged it. It is important to make repairs at the first sign of deterioration to keep the berm functioning properly.	
Responsible Staff:		TBD	

D. STABILIZE SOILS

BMP Description: Seeding

🛛 Permanent	🖂 Temporary		
Installation Schedule:	After final grading in areas not to be landscaped. Bare soils should be stabilized within 14 calendar days after final grading or where construction activity has temporarily ceased for more than 21 days.		
Maintenance and Inspection:	Low-maintenance areas are mowed infrequently or not at all and do not receive lime or fertilizer regularly. Plants must be able to persist with minimal maintenance over long periods of time. Use grass and legume mixtures for these sites because legumes fix nitrogen from the atmosphere. Sites suitable for low-maintenance vegetation include steep slopes, stream or channel banks, some commercial properties, and "utility" turf areas such as road banks.		

	 Grasses should emerge within 4-28 days and legumes 5-28 days after seeding, with legumes following grasses. A successful stand has the following characteristics: Vigorous dark green or bluish green (not yellow) seedlings Uniform density, with nurse plants, legumes, and grasses well
	 intermixed Green leaves that remain green throughout the summerat least at the plant bases
	Inspect seeded areas for failure and, if needed, reseed and repair them as soon as possible. If a stand has inadequate cover, reevaluate the choice of plant materials and quantities of lime and fertilizer. Depending on the condition of the stand, repair by overseeding or reseeding after complete seedbed preparation. If timing is bad, overseed with rye grain or German millet to thicken the stand until a suitable time for seeding perennials. Consider seeding temporary, annual species if the season is not appropriate for permanent seeding. If vegetation fails to grow, test the soil to determine if low pH or nutrient imbalances are responsible.
	On a typical disturbed site, full plant establishment usually requires refertilization in the second growing season. Use soil tests to determine if more fertilizer needs to be added. Do not fertilize cool season grasses in late May through July. Grass that looks yellow might be nitrogen deficient. Do not use nitrogen fertilizer if the stand contains
	more than 20% legumes.
Responsible Staff:	TBD

BMP Description: Soil Roughening		
Permanent		🖂 Temporary
Installation Schedule:		After interim and rough grading activities, prior to final site work or utility construction
Maintenance a Inspection:	and	Inspect roughened areas after storms to see if re-roughening is needed. Regular inspection should indicate where additional erosion and sediment control measures are needed. If rills (small watercourses that have steep sides and are usually only a few inches deep) appear, fill, regrade, and reseed them immediately.
Responsible Staff:		TBD

BMP Description: Hydro-mulching

___ Permanent

Temporary

Installation Schedule:	Bare soils should be stabilized within 14 calendar days after final grading or where construction activity has temporarily ceased for more than 21 days.
Maintenance and Inspection:	Anchor mulches to resist wind displacement. When protection is no longer needed, remove netting and compost it or dispose of it in a landfill. Inspect mulched areas frequently to identify areas where it has loosened or been removed, especially after rainstorms. Reseed these areas, if necessary, and replace the mulch cover immediately. Apply mulch binders at rates recommended by the manufacturer. If washout, breakage, or erosion occurs, repair, reseed and remulch surfaces, and install new netting. Continue inspections until vegetation is firmly established.
Responsible Staff:	TBD

E. PROTECT SLOPES

There are no excessive slopes located within the construction area; therefore, no additional controls are proposed to protect slopes

I. INOILOIDI	JAW DRAW WELTS
BMP Description: Bagged Gravel Inlet Filter	
Installation Schedule:	Prior to stabilization of associated drainage areas
Maintenance and Inspection:	Inspection should be made weekly and after each rainfall. Repair or replacement should be made promptly as needed by the contractor. Remove sediment when buildup reaches a depth of three (3) inches. Removed sediment should be deposited in a suitable area and in such a manner that it will not erode. Check placement of device to prevent gaps between device and curb. Inspect filter fabric and patch or replace if torn or missing. Structures should be removed and the area stabilized only after the remaining drainage area has been properly stabilized.
Responsible Staff:	TBD

F. PROTECT STORM DRAIN INLETS

There are no storm drain inlets located within the construction area for the public wastewater line; therefore, no controls are proposed to protect storm drain inlets at the time of its construction.

G. ESTABLISH PERIMETER CONTROLS AND SEDIMENT BARRIERS

BMP Description: Silt Fence – Perimeter and J-Hooks		
Installation Schedule:		Prior to commencing construction activities.
Maintenance ar Inspection:	nd	If a standard-strength fabric is used, it can be reinforced with wire mesh behind the filter fabric. This increases the effective life of the fence. The maximum life expectancy for synthetic fabric silt fences is about six (6) months, depending on the amount of rainfall and runoff. Burlap fences

	have a much shorter useful life span, usually up to two (2) months. Inspect silt fences regularly and frequently, as well as after each rainfall event, to make sure that they are intact and that there are no gaps where the fence meets the ground or tears along the length of the fence. If you find gaps or tears, repair or replace the fabric immediately. Remove accumulated sediments from the fence base when the sediment reaches one-third (1/3) to one-half (1/2) the fence height. Remove sediment more frequently if accumulated sediment is creating noticeable strain on the fabric and the fence might fail from a sudden storm event. When you remove the silt fence,
Responsible Staff:	remove the accumulated sediment as well. TBD

BMP Description: Rock Berms – Check Dam		
Installation Schedule:		Prior to commencing construction activities.
Maintenance a Inspection:	and	Inspect the berm after every rainfall to make sure sediment has not built up and that vehicles have not damaged it. It is important to make repairs at the first sign of deterioration to keep the berm functioning properly.
Responsible Staff:		TBD

H. RETAIN SEDIMENT ON-SITE .

BMP Description: Sediment Basin	
Installation Schedule:	Prior to commencing construction activities.
Maintenance and Inspection:	Sediment basins should be inspected regularly (at least as often as required by the TPDES Construction General Permit) to check for damage and to ensure that obstructions are not diminishing the effectiveness of the structure. Sediment shall be removed and the basin shall be re-graded to its original dimensions when the sediment storage capacity of the impoundment has been reduced by 20 percent. The removed sediment may be stockpiled or redistributed onsite in areas that are protected by erosion and sediment controls. Inspect temporary stabilization of the embankment and graded basin and the velocity dissipaters at the outlet and spillway for signs of erosion. Repair any eroded areas that are found. Install additional erosion controls if erosion is frequently evident.
Responsible Staff:	TBD

I. ESTABLISH STABILIZED CONSTRUCTION EXITS

BMP Description: Stabilized Construction Entrance/Exit

Installation Schedule:	Prior to commencing construction activities.
Maintenance and Inspection:	Maintain stabilization of the site entrances until the rest of the construction site has been fully stabilized. You might need to add stone and gravel periodically to each stabilized construction site entrance to

	keep the entrance effective. Sweep up soil tracked offsite immediately for proper disposal. For sites with wash racks at each site entrance, construct sediment traps and maintain them for the life of the project. Periodically remove sediment from the traps to make sure they keep working
Responsible Staff:	TBD

J. ADDITIONAL BMPS

No additional BMPs proposed.

4.0 EXAMPLE PRACTICES

A. Example Stabilization Practices

1. Temporary Stabilization

Top soil stock piles and disturbed portions of the site where construction activity temporarily ceases for at least 21 days will be stabilized with temporary seed and mulch no later than 14 days from the last construction activity in that area. Areas of the site which are to be paved will be temporarily stabilized until pavement can be applied.

2. Permanent Stabilization

Disturbed portions of the site where construction activities permanently cease shall be stabilized with permanent seed no later than 14 days after the last construction activity.

B. Example Structural Practices

1. Interceptor Swale

An interceptor swale is a small v-shaped or parabolic channel which collects runoff and directs it to a desired location. It can either have a natural grass lining or, depending upon slope and design velocity, a protective lining of erosion matting, stone or concrete. The interceptor swale can either be used to direct sediment-laden flow from disturbed areas into a controlled outlet or to direct "clean" runoff around disturbed areas. Since the swale is easy to install during early grading operations, it can serve as the first line of defense in reducing runoff across disturbed areas. As a method of reducing runoff across the disturbed construction area, it reduces the requirements of structural measures to capture sediment from runoff since the flow is reduced. By intercepting sediment-laden flow downstream of the disturbed area, runoff can be directed into a sediment basin or other BMP for sedimentation as opposed to long runs of silt fence, straw bales or other filtration method.

2. Silt Fence

A silt fence consists of geotextile fabric supported by poultry netting or other backing stretched between either wooden or metal posts with the lower edge of the fabric securely embedded in the soil. The fence is typically located downstream of disturbed areas to intercept runoff in the form of sheet flow. Silt fence provides both filtration and time for sedimentation to reduce sediment and the

velocity of the runoff. Properly designed silt fence is economical since it can be relocated during construction and reused on other projects. Silt fence is normally used as perimeter control located downstream of disturbed areas. It is only feasible for non-concentrated, sheet flow conditions.

3. Fiber Roll/Sediment Log

Fiber rolls/sediment logs are tightly compacted tubular cylinders composed of straw, flax, coconut fiber, or other similar types of material wrapped with a fiber mesh. They must be secured with stakes. When installed at the base of an embankment or on a slope, fiber rolls are effective at controlling sediment and reducing erosion rates. They achieve this by intercepting storm water runoff, thereby reducing the velocity of the flow and dispersing concentrated runoff as sheet flows. Fiber rolls are also water-permeable and are effective at trapping eroded sediment. It is important not to crush fiber rolls when they are installed. If more than one sock is placed in a row, the socks should be overlapped; not abutted.

4. Inlet Control

Inlet protection consists of a variety of methods of intercepting sediment at low point inlets through the use of stone, filter fabric and other materials. This is normally located at the inlet, providing either detention or filtration to reduce sediment and floatable materials in storm water. Inlet protection is normally used as a secondary defense in site erosion control due to the limited effectiveness and applicability of the technique. It is normally used in new developments that include new inlets or roads with new curb inlets or during major repairs to existing roadways. Inlet protection has limited use in developed areas due to the potential for loading, traffic safety and pedestrian safety and maintenance problems. Inlet protection can reduce sediment in a storm sewer system by serving as a back system to onsite controls or by reducing sediment loads from controls with limited effectiveness such as straw bale dikes.

5. Check Dams

Check dams are small barriers consisting of straw bales, rock, or earth berms placed across a drainage swale or ditch. They reduce the velocity of small concentrated flows, provide a limited barrier for sediment and help disperse concentrated flows, reducing potential erosion. Check dams are used for long drainage swales or ditches in which permanent vegetation may not be established and erosive velocities are present. They are typically used in conjunction with other techniques such as inlet protection, rip rap or other sediment reduction techniques. Check dams provide limited treatment. They are more useful in reducing flow to acceptable levels.

6. Erosion Control Mats

An erosion control mat (ECM) is a geomembrane or biodegradable fabric placed over disturbed areas to limit the effects of erosion due to rainfall and runoff across barren soil. Erosion control mats are manufactured by a wide variety of vendors addressing a wide variety of conditions such as vegetation establishment and high velocity flow. Types of matting include organic (jute, straw) and synthetic (plastic and glass fiber) materials. Mats can provide both temporary and/or permanent stabilization for disturbed soil or barren areas. It is used for difficult areas to stabilize such as steep slopes, temporary or permanent drainage swales, embankments or high traffic (pedestrian) areas. Some mats are reusable, reducing the initial cost of the installation.

7. Stabilized Construction Entrance

A stabilized construction entrance consists of a pad consisting of gravel, crushed stone, recycled concrete or other rock like material on top of geotextile filter cloth to facilitate the wash down and removal of sediment and other debris from construction equipment prior to exiting the construction site. For added effectiveness, a wash rack area can be incorporated into the design to further reduce sediment tracking. For long term projects, cattle guards or other type of permanent rack system can be used in conjunction with a wash rack. This directly addresses the problem of silt and mud deposition in roadways used for construction site access. Stabilized construction entrances are used primarily for sites in which significant truck traffic occurs on a daily basis. It reduces the need to remove sediment from streets. If used properly, it also directs the majority of traffic to a single location, reducing the number and quantity of disturbed areas on the site and providing protection for other structural controls through traffic control.

8. Earth Dike

An earth dike is constructed along the uphill perimeter of a site. A portion of the dike will divert run-on around the construction site. The remaining portion of the dike will collect runoff from the disturbed area and direct the runoff to the sediment basin.

9. Triangular Sediment Filter Dike

A triangular sediment filter dike is a self-contained silt fence consisting of filter fabric wrapped around welded wire fabric shaped into a triangular cross section. While similar in use to a silt fence, the dike is reusable, sturdier, transportable, and can be used on paved areas in situations where it is impractical to install embedded posts for support. Triangular filter dikes are used in place of silt fence, treating sediment flow at the perimeter of construction areas and at the perimeter of the site. Also, the dikes can serve as stream protection devices by preventing sediment from entering the streams or as check dams in small swales. Triangular sediment filter dikes are especially useful for construction areas surrounded by pavement, where silt fence or hay bale installation is impracticable. Since they can be anchored without penetration (through the use of rock), pavement damage can be minimized. Triangular dikes are used to provide perimeter control by detaining sediment on a disturbed site with drainage that would otherwise flow onto adjacent properties. Triangular dikes also serve as sediment trapping devices when used in areas of sheet flow across disturbed areas or are placed along stream banks to prevent sediment-laden sheet flow from entering the stream. The dikes can be subjected to more concentrated flows and a higher flow rate than silt fence.

10. Sediment Basin

Sediment basins are required, where feasible, for sites with drainage areas of ten (10) or more acres. Additional information for sedimentation basins is located in Appendix M.

11. Tree Protection

Tree protection prevents the disturbance of existing trees and their roots on a construction site. Trees are not the same shape below ground as they are above, so it is difficult to predict the length or location of their roots. One common method used to identify the critical root zone is to define the tree's "drip line" – the area directly below the branches of the tree. Many roots extend beyond the longest branches a distance equal to two or more times the height of the tree. For this reason, it is recommended to protect as much of the area beyond the drip line as feasible. An example of tree protection is to tie continuous nylon string with two-foot tundra weight orange streamers to eight-foot minimum metal t-posts driven two feet into the ground. Four-foot minimum orange plastic fencing per manufacturer's recommendations will surround the critical root zone to keep equipment off the rooting area. If a fence cannot be erected, cushion the rooting area with six inches of wood chips, wood, or brick paths. Where root areas must be graded, cut large roots instead of tearing them with equipment.

C. Waste Control and Disposal

1. Waste Materials

All waste materials will be collected and stored in a securely lidded metal dumpster rented from a local waste management company, which is a licensed solid waste management company. The dumpster will meet all local and any State solid waste management regulations. All trash and construction debris from the site will be deposited in the dumpster. The dumpster will be emptied periodically or more often if necessary, and the trash will be hauled to an appropriate waste management facility. No construction waste materials will be buried onsite. Staging areas for construction materials should have secondary containment. All personnel will be instructed regarding the correct procedure for waste disposal. Notices stating these practices will be posted in the office trailer. The individual who manages the day-to-day site operations will be responsible for seeing that these procedures are followed.

2. Hazardous Waste

All hazardous waste materials will be disposed of in the manner specified by local or State regulations or by the manufacturer. Site personnel will be instructed in these practices and the individual who manages day-to-day site operations will be responsible for seeing that these practices are followed.

3. Sanitary Waste

All sanitary waste will be collected from the portable units periodically by a licensed sanitary waste management contractor, as required by local regulation.

4. Offsite Vehicle Tracking and Dust Control

A stabilized construction entrance has been provided to help reduce vehicle tracking of sediments. The paved street adjacent to the site entrance will be swept to remove any excess mud, dirt or rock tracked from the site. Dump trucks hauling material from the construction site will be covered with a tarpaulin. If dust is visible when dump trucks are leaving the site due to construction activities, dust suppression techniques such as wetting the soil will be employed.

D. Timing of Controls/Measures

The contractor and the operator shall review the SWP3 requirements prior to beginning construction activities. The following is a sample erosion control sequence:

- <u>Site Mobilization</u>: Prior to any construction on the site a stabilized construction entrance shall be installed.
- <u>Clearing and Rough Grading</u>: Prior to any grading of the site, erosion control measures shall be installed. These controls may include but are not limited to silt fences, sedimentation ponds and vegetated swales. The installation is required to prevent sediment from leaving disturbed areas.
- <u>Storm Drain Installation</u>: In addition to maintaining the devices installed during initial grading, supplemental control measures will need to be installed. These devices will include devices shown on the plan such as storm drain inlet protection and sediment traps. Inlet protection devices prevent sedimentation from entering the inlet and subsequently, the storm sewer system

as well as the receiving water body. Other devices may be required as shown on the erosion control plan or requested by the inspector or operator.

- <u>Installation of Public Utilities:</u> Additional control measures are likewise not required during installation of public utilities. However, maintenance of existing control measures installed during previous phases must continue.
- <u>Pavement Installation</u>: In addition to maintaining the control measures installed during initial grading and storm drain installation phases, supplemental measures should be installed. Upon completion of paving and curb backfill operations, control measures should be installed behind curbs at handicap ramps and along parkways where sediment could enter streets and/or paved areas.
- <u>Final Grading</u>: Additional control measures are not required during final grading. However, maintenance of existing control measures installed during previous phases will continue.
- Building Construction: In addition to maintaining previously installed control measures, a strict
 policy will be enacted which minimizes vehicle traffic from entering non-paved areas.
 Construction materials will be unloaded from existing paved surfaces where possible, thereby
 preventing disturbing control measures already in place and reducing sediment tracking into
 paved areas. Areas where construction activity temporarily ceases for more than 21 days will be
 stabilized with a temporary seed and mulch within 14 days of the last disturbance. Once
 construction activity ceases permanently in an area, that area will be stabilized with permanent
 seed and mulch. After the entire site is stabilized, the accumulated sediment will be removed and
 the erosion control measures will be removed.

5.0 RELEASES OF REPORTABLE QUANTITIES

Because construction activities may handle certain hazardous substances over the course of the project, spills of these substances in amounts that equal or exceed Reportable Quantity (RQ) levels are a possibility. Material management practice guidelines are located in Appendix K.

EPA has issued regulations that define what reportable quantity levels are for oil and hazardous substances. These regulations are found at 40 CFR Part 110 Part 117, or 40 CFR Part 302. A list of RQs are included in Appendix M. If there is a RQ release during the construction period, then you must take the following steps:

- Notify TCEQ immediately at (800) 832-8224.
- Notify the National Response Center immediately at (800) 424-8802.
- Within fourteen (14) days, submit a written description of the release to TCEQ providing the date and circumstances of the release and the steps to be taken to prevent another release.
- Modify the pollution prevention plan to include the date of release, the circumstances leading to the release, and steps taken to prevent reoccurrence of the release.

6.0 STATE AND LOCAL PROGRAMS

The TPDES program meets or exceeds the NPDES standards established on a federal level. This SWP3 has been developed in accordance with the requirements of the TPDES requirements. Information for Williamson County has been included in Appendix N. Additional local requirements may apply and this SWP3 should be updated accordingly.

Storm water from the project construction area discharges into the storm sewer system of Williamson County (MS4).

Construction projects that discharge storm water to an MS4 are required to:

- submit a copy of the signed NOI to the operator of the MS4 at least seven days prior to the commencement of construction activities,
- post a copy of the signed NOI and construction site notice at the project site at all times,
- submit a copy of any NOCs to the operator of the MS4,
- submit a copy of the NOT to the operator of the MS4, and
- keep and maintain a list of the names and address of MS4s that receive NOI, NOT, and/or NOC forms (Appendix H).

7.0 INSPECTION AND MAINTENANCE

A. Inspection Schedule

- 1. All disturbed areas, as well as all erosion and sediment control devices, will be inspected according to one of the following schedules:
 - a) at least every seven (7) calendar days and within 24 hours after a rainfall of 0.5 inch or greater, or
 - b) every seven (7) days on the same day of the week each week, regardless of whether or not there has been a rainfall event since the previous inspection.
- 2. Inspections may occur on either schedule provided that this SWP3 reflects the current schedule and that any changes are in accordance with the following:
 - a) the schedule is changed a maximum of one time each month,
 - b) the schedule change must be implemented at the beginning of a calendar month, and
 - c) the reason for the schedule change must be documented in this SWP3 (an inspection schedule form is located in Appendix E).

B. Inspection Reports

- 1. Completed inspection reports (Appendix E) will include the following information:
 - a) scope of the inspection,
 - b) date of the inspection,
 - c) name(s) of personnel making the inspection,
 - d) reference to qualifications of inspection personnel,
 - e) observed major construction activities, and
 - f) actions taken as a result of the inspection.
- 2. All disturbed areas (on and off-site), areas for material storage locations where vehicles enter or exit the site, and all of the erosion and sediment controls that were identified as part of the SWP3 must be inspected. The inspection report must state whether the site was in compliance or identify any incidents of non-compliance. The report will be signed by the qualified inspector in accordance with the TPDES general permit and filed in the SWP3. A sample Inspection Report is included in Appendix E, along with an Inspector Qualification Form. All reports and inspections required by the general construction permit will be completed by a duly authorized representative. A copy of a Delegation of Signatories to Reports letter is included in Appendix J.
- 3. The operator should correct any damage or deficiencies as soon as practicable after the inspection, but in no case later than seven (7) calendar days after the inspection. If existing BMPs are modified or if additional BMPs are necessary, an implementation schedule must be described in the SWP3, and wherever possible, those changes implemented before the next storm event or as soon as practicable. A list of maintenance guidelines is included in Appendix E.
- 4. Inspection reports will be kept in the Operator's file, along with the SWP3, for at least three years from the date that the NOT is submitted to the TCEQ for the construction site.

C. Final Stabilization

Final stabilization of the construction site has been achieved when all soil disturbing activities at the site have been completed, and a uniform (e.g., evenly distributed, without large bare areas) perennial vegetative cover with a density of 70 percent of the native background vegetative cover for the area has been established on all unpaved areas and areas not covered by permanent structures. If a vegetative cover cannot be established, equivalent permanent stabilization measures (such as riprap, gabions, or geotextiles) can be employed. When these conditions have been met, BMPs can be removed from the construction area.

8.0 RECORD RETENTION

The permittee must retain the following records for a minimum period of three (3) years from the date that a NOT is submitted. Records include:

- A copy of the SWP3,
- All data used to complete the NOI, if an NOI is required for coverage under this general permit,
- All reports and actions required by this permit, including a copy of the construction site notice, and
- All records of submittal of forms submitted to the operator of any MS4 receiving the discharge and to the secondary operator of a large construction site, if applicable.

9.0 CONCRETE BATCH PLANTS (IF APPLICABLE)

A. Storm Water Runoff from Concrete Batch Plants

Discharges of storm water runoff from concrete batch plants may be authorized under the general permit provided that the requirements in Part IV of the permit are met (Appendix G). If discharges are not covered under the general permit, then discharges must be authorized under an alternative permit. Authorization for discharge or land disposal of concrete batch plant wastewater must be obtained under an alternative permit.

B. Benchmark Sampling Requirements

Operators of concrete batch plants must sample the storm water runoff from the concrete batch plant according to the requirements of the general permit. A table of benchmark monitoring values is located in Part IV.A. of the general permit. Analytical results that exceed a benchmark value are not a violation of the general construction permit. Results of analyses are indicators that modifications of the SWP3 should be assessed and may be necessary to protect water quality. Benchmark sampling records should be included in Appendix P.

C. Additional BMP and SWP3 Requirements

The following items are additional requirements for concrete batch plants. The Operator is responsible for updating the SWP3 as appropriate. Additional information for concrete batch plant requirements is located in Part IV of the general construction permit. Records and information for the concrete batch plant should be included in Appendix P.

- 1. A description of potential pollutant sources associated with the concrete batch plant must be kept in the SWP3.
- 2. The site map in Appendix A must include the following information:
 - a) the location of all outfalls for storm water discharges associated with concrete batch plants;
 - b) a depiction of the drainage area and the direction of flow to the outfall(s);
 - c) structural controls used within the drainage area(s);
 - d) the locations of the following areas associated with concrete batch plants that are exposed to precipitation: vehicle and equipment maintenance activity areas; areas used for the treatment, storage, or disposal of wastes; liquid storage tanks; material process and storage areas; and loading and unloading areas; and
 - e) the locations of the following: any bag house or other dust control device(s); recycle/sedimentation pond, clarifier or other device used for the treatment of facility wastewater; areas with significant materials; and areas where major spills or leaks have occurred.

- 3. A list of materials handled at the concrete batch plant that may be exposed to storm water and that have a potential to affect the quality of storm water discharges associated with concrete batch plants must be kept in this SWP3.
- 4. A list of significant spills and leaks of toxic or hazardous pollutants that occurred in areas exposed to storm water and that drain to storm water outfalls associated with concrete batch plants must be developed, maintained, and updated.
- 5. A summary of existing storm water discharge sampling data must be maintained if available.
- 6. Good housekeeping measures must be developed and implemented in the area(s) associated with concrete batch plants.
- 7. Areas where potential spills that can contribute pollutants to storm water runoff, and the drainage areas from these locations must be identified. Include material handling procedures, storage requirements, and use of equipment information. Procedures for cleaning up spills must be identified and made available to the appropriate personnel.
- 8. Qualified facility personnel must be identified to inspect designated equipment and areas of the facility specified in this SWP3. Inspection frequency must be specified based upon a consideration of the level of concrete production but must be a minimum of once per month while the facility is in operation. The inspection must take place while the facility is in operation and include all areas that are exposed to storm water at the site. Records of inspections must be maintained in Appendix P.
- 9. An employee training program must be developed to educate personnel. At a minimum, training must occur prior to the initiation of operation of the concrete batch plant.
- 10. A description of spills and similar incidents, plus additional information that is obtained regarding the quality and quantity of storm water discharges must be included with this SWP3.
- 11. Include a narrative consideration for reducing the volume of runoff from concrete batch plants by diverting runoff or otherwise managing runoff, including use of infiltration, detention ponds, retention ponds, or reusing of runoff.
- 12. At least once per year, one or more qualified personnel shall conduct a compliance evaluation of the plant. Evaluation requirements are listed in Part IV.B.3 of the general permit.

10.0 CONCRETE TRUCK WASH OUT (IF APPLICABLE)

The wash out of concrete trucks at the construction site is authorized, provided that the requirements in Part V of the general permit are met. Authorization is limited to the land disposal of wash out water from concrete trucks. Any other direct discharge of concrete production waste eater must be authorized under a separate general permit or individual permit.

A. Wash Out Requirements


- 1. Direct discharge of concrete truck wash-out water to surface water in the state, including discharge to storm sewers, is prohibited by the general permit.
- 2. Concrete truck wash-out water should be discharged to areas at the construction site where structural controls have been established to prevent direct discharge to surface waters, or to areas that have minimal slope that allow infiltration and filtering of wash out water to prevent direct discharge to surface waters. Structural controls may consist of temporary berms, temporary shallow pits, temporary storage tanks with slow rate release, or other reasonable measures to prevent runoff from the site.
- 3. Wash out of concrete trucks during rainfall events shall be minimized. The direct discharge of concrete wash out water is prohibited at all times, and the operator should have BMPs sufficient to prevent the discharge of concrete truck wash out as the result of rain.
- 4. The discharge of wash out water should not cause or contribute to groundwater contamination.
- 5. The Operator is responsible for showing concrete wash out areas on a map (Appendix A).


11.0 REFERENCES

- North Central Texas Council of Governments (NCTCOG). 2010. Integrated Storm Water Management Technical Manual. http://iswm.nctcog.org/technical_manual.asp.
- Texas Commission on Environmental Quality (TCEQ). 2014. "2014 Texas Water Quality Inventory and 303(d) List." [Online] (accessed on June 27, 2016). Available URL: http://www.tceq.texas.gov/assets/public/waterquality/swqm/assess/14txir/2014_basin12.pdf.
- United States Department of Agriculture (USDA). 2016. Soil Survey of Williamson County, Texas. "Web Soil Survey." [Online] (accessed on June 27, 2016). Available URL: http://websoilsurvey.nrcs. usda.gov/app/

APPENDIX A

PROJECT MAPS

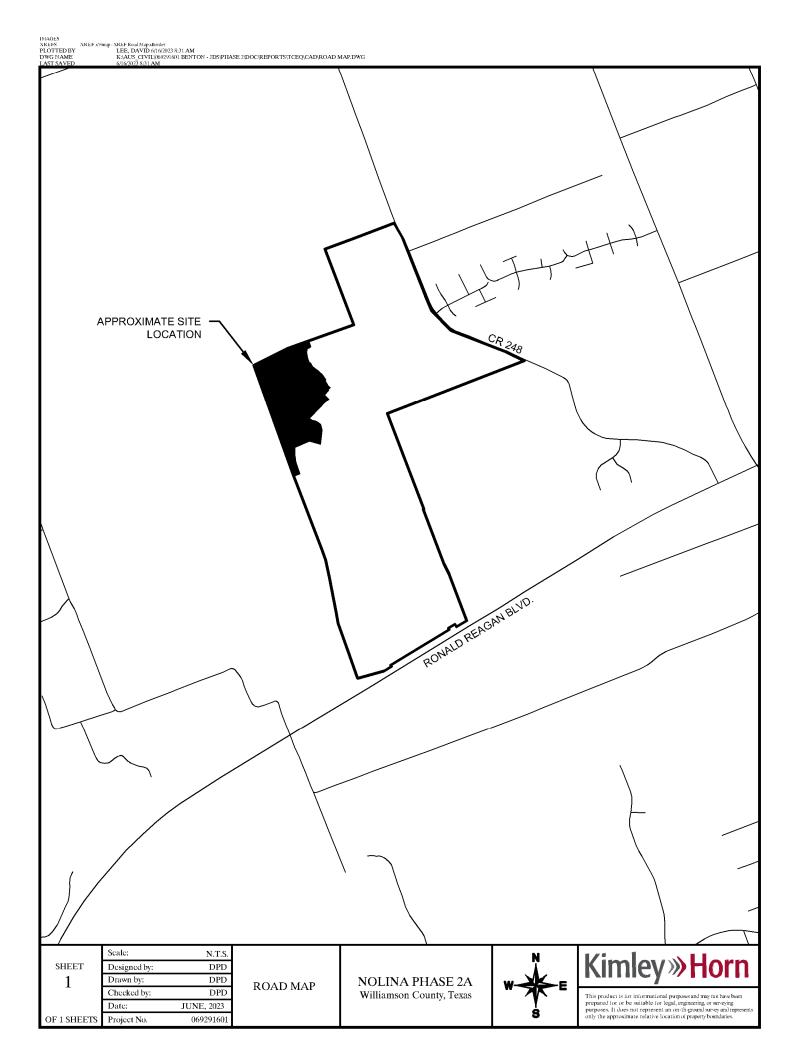

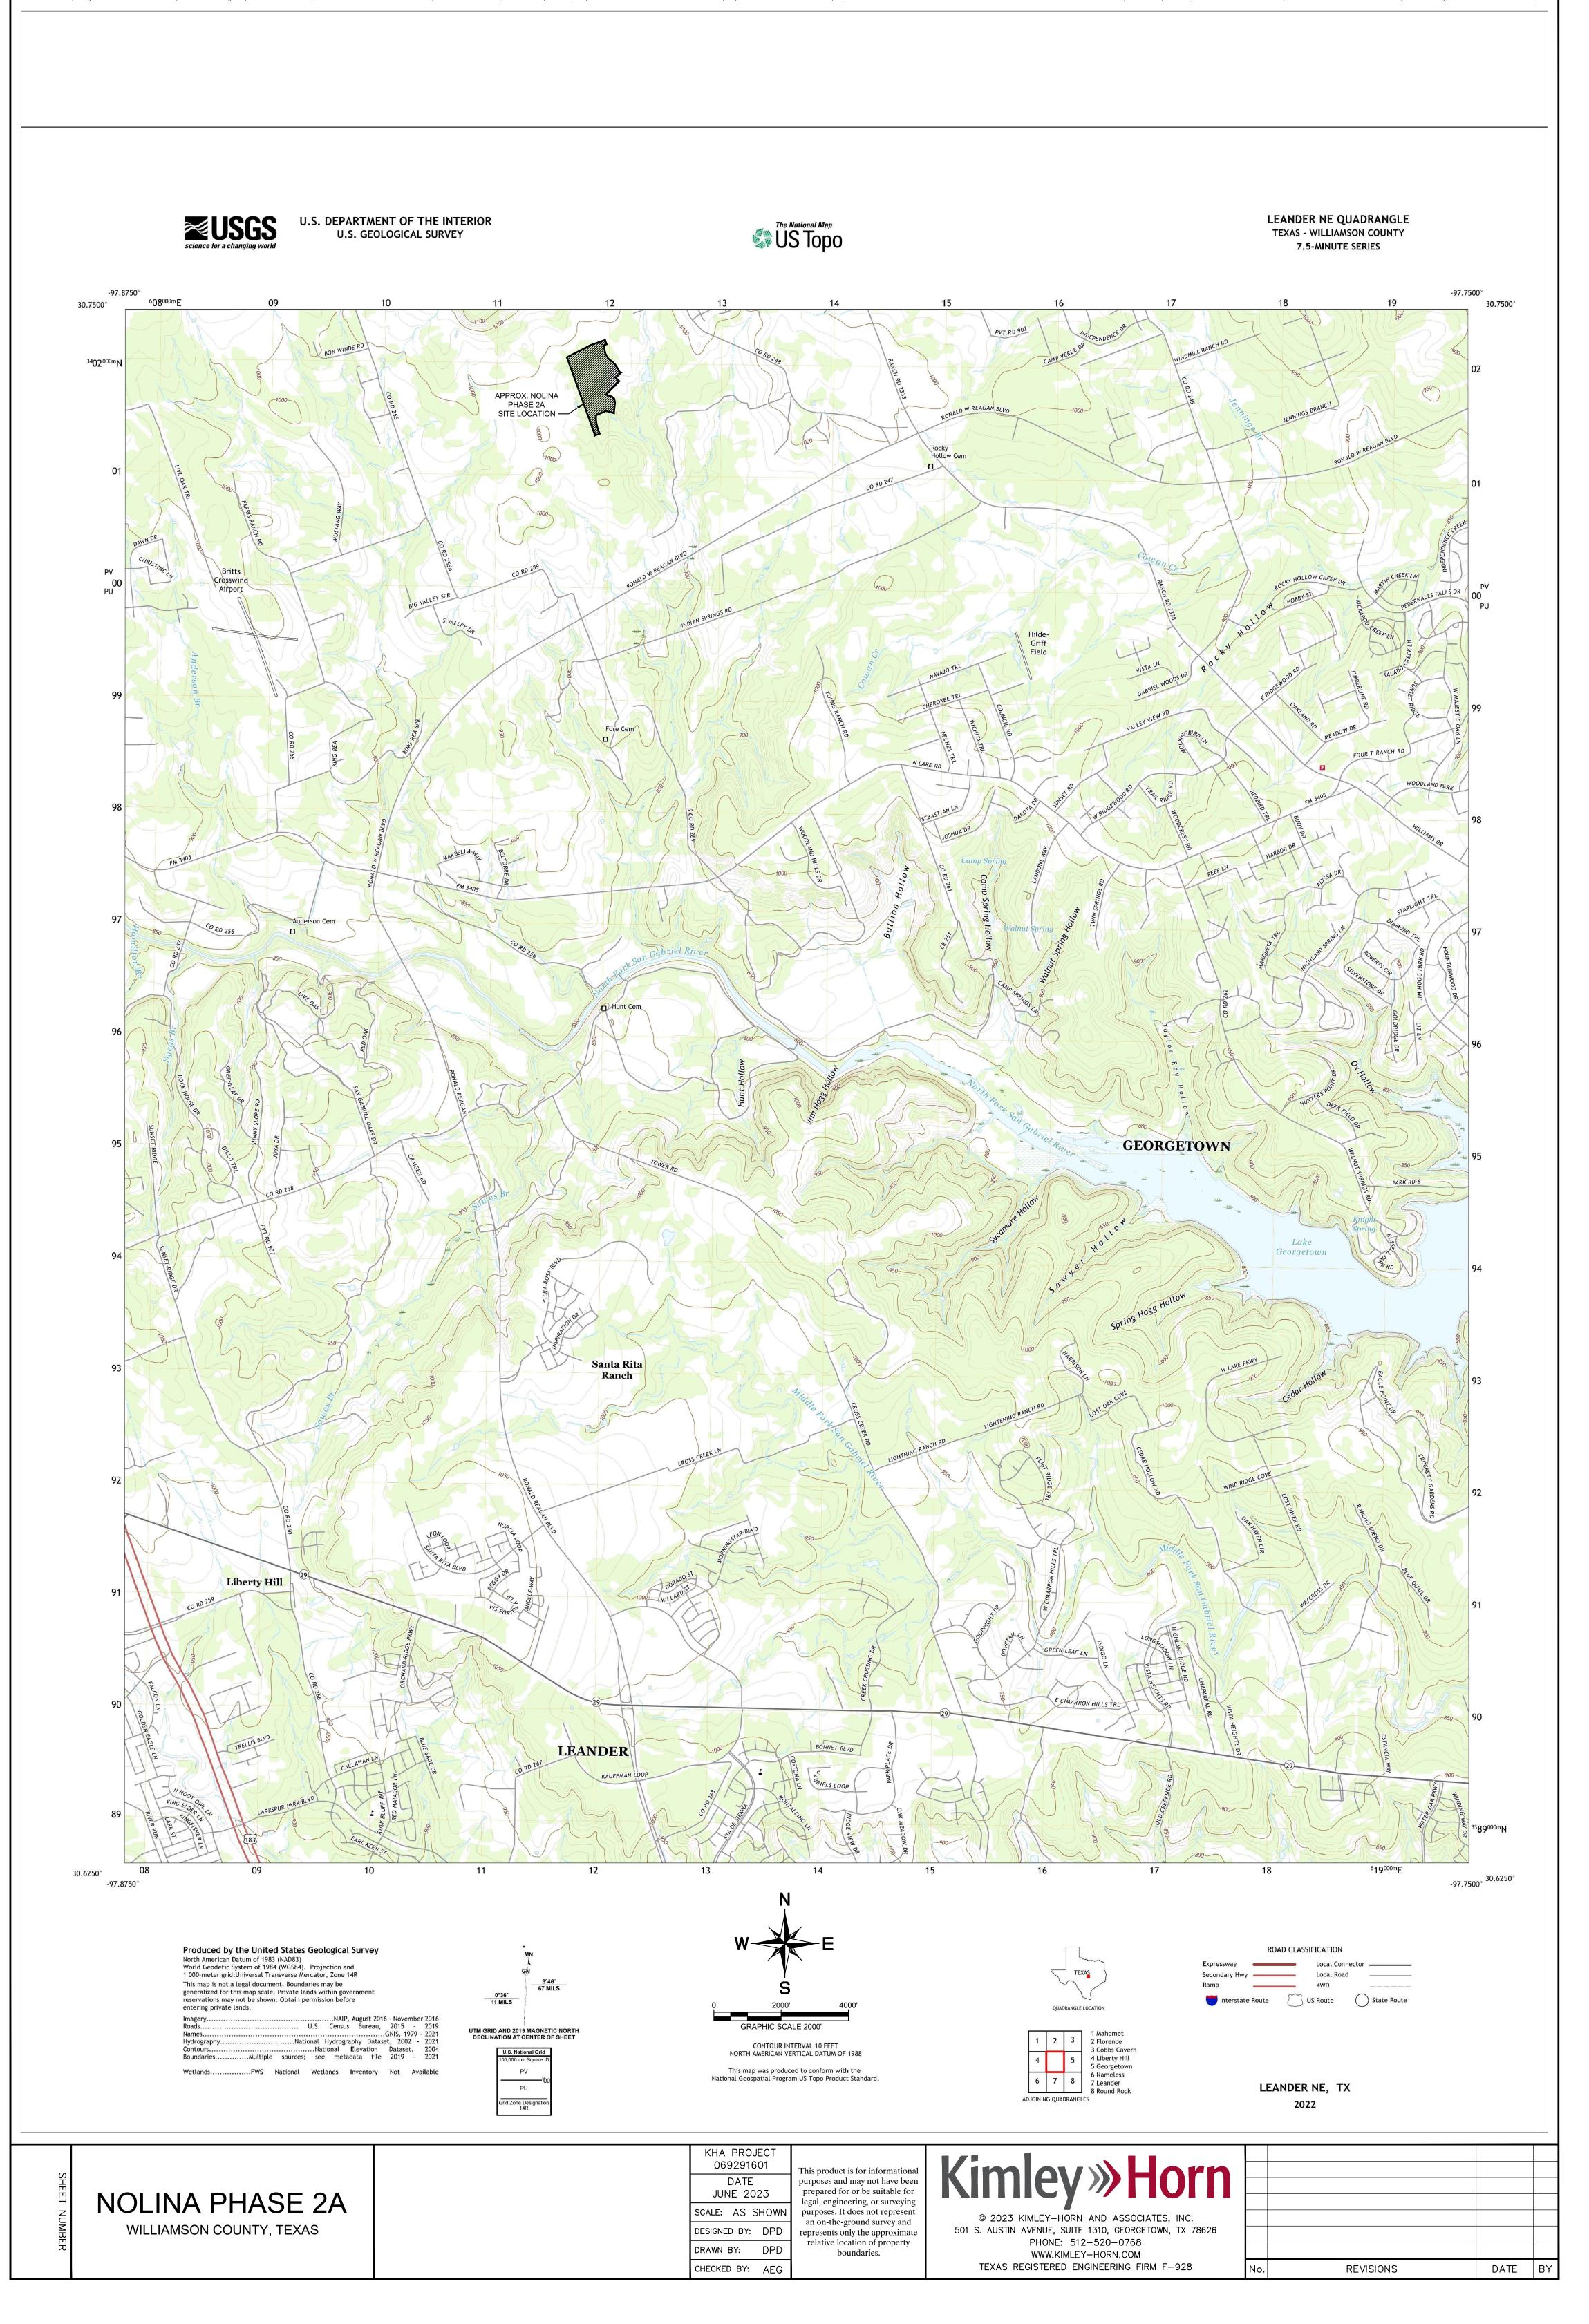

This document, together with the concepts and designs presented herein, as an instrument of service, is intended only for the specific purpose and client for which it was prepared. Reuse of and improper reliance on this document without written authorization and adaptation by Kimley-Horn and Associates, Inc. shall be without liability to Kimley-Horn and Associates, Inc.

Plotted By:Lee, David Date: June 16, 2023 08: 34: 25am File Path:K: \AUS_Civil\069291601 Benton - JDS\PHASE 2\Doc\Reports\TCEQ\CAD\USGS Map.dwg




United States Department of Agriculture

Natural Resources Conservation

Service

A product of the National Cooperative Soil Survey, a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local participants

Custom Soil Resource Report for Williamson County, Texas

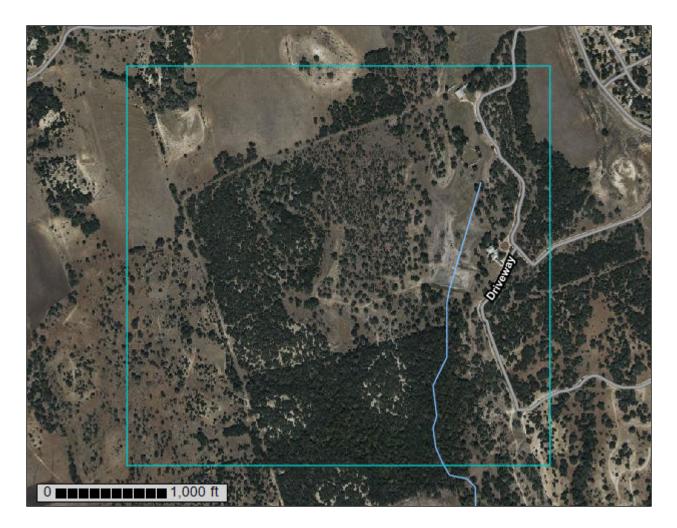

Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (https://offices.sc.egov.usda.gov/locator/app?agency=nrcs) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/? cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	
Soil Map	9
Legend	10
Map Unit Legend	11
Map Unit Descriptions	11
Williamson County, Texas	
BkE—Brackett gravelly clay loam, 3 to 12 percent slopes	13
BktD—Brackett association, 1 to 8 percent slopes	14
DnB—Denton silty clay, 1 to 3 percent slopes	16
DoC—Doss silty clay, moist, 1 to 5 percent slopes	17
EaD—Eckrant cobbly clay, 1 to 8 percent slopes	19
FaB—Fairlie clay, 1 to 2 percent slopes	21
Soil Information for All Uses	
Soil Properties and Qualities	23
Soil Qualities and Features	23
Hydrologic Soil Group (Nolina Phase 2A)	23
References	

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.


Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

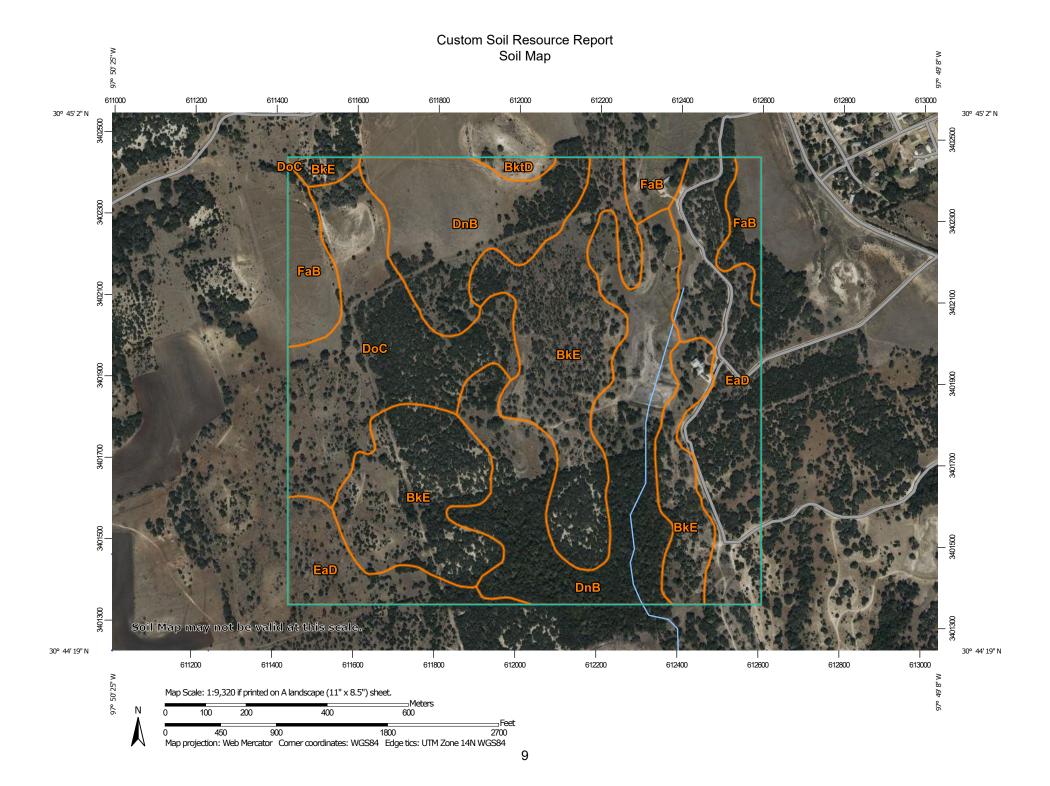

MAP LEGEND			MAP INFORMATION		
Area of Interest (AOI)		100	Spoil Area	The soil surveys that comprise your AOI were mapped at	
	Area of Interest (AOI)	۵	Stony Spot	1:20,000.	
Soils	Soil Map Unit Polygons	0	Very Stony Spot	Warning: Soil Map may not be valid at this scale.	
~	Soil Map Unit Lines	Ŷ	Wet Spot	Enlargement of maps beyond the scale of mapping can cause	
	Soil Map Unit Points	\triangle	Other	misunderstanding of the detail of mapping and accuracy of soil	
_	Point Features	, * *	Special Line Features	line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed	
o	Blowout	Water Fea		scale.	
	Borrow Pit	\sim	Streams and Canals		
*	Clay Spot	Transporta	ation Rails	Please rely on the bar scale on each map sheet for map measurements.	
\diamond	Closed Depression	~	Interstate Highways		
X	Gravel Pit	~	US Routes	Source of Map: Natural Resources Conservation Service Web Soil Survey URL:	
0 0 0	Gravelly Spot	~	Major Roads	Coordinate System: Web Mercator (EPSG:3857)	
0	Landfill	~	Local Roads	Maps from the Web Soil Survey are based on the Web Mercator	
٨.	Lava Flow	Backgrou		projection, which preserves direction and shape but distorts	
عله	Marsh or swamp	Buckgrou	Aerial Photography	distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more	
~	Mine or Quarry			accurate calculations of distance or area are required.	
0	Miscellaneous Water			This product is generated from the USDA-NRCS certified data as	
0	Perennial Water			of the version date(s) listed below.	
\vee	Rock Outcrop			Soil Survey Area: Williamson County, Texas	
+	Saline Spot			Survey Area Data: Version 23, Aug 24, 2022	
°.°	Sandy Spot			Soil map units are labeled (as space allows) for map scales	
-	Severely Eroded Spot			1:50,000 or larger.	
\diamond	Sinkhole			Date(s) aerial images were photographed: Data not available.	
∌	Slide or Slip				
ø	Sodic Spot			The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.	

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
BkE	Brackett gravelly clay loam, 3 to 12 percent slopes	95.5	30.0%
BktD	Brackett association, 1 to 8 percent slopes	2.0	0.6%
DnB	Denton silty clay, 1 to 3 percent slopes	94.3	29.6%
DoC	Doss silty clay, moist, 1 to 5 percent slopes	50.0	15.7%
EaD	Eckrant cobbly clay, 1 to 8 percent slopes	55.8	17.5%
FaB	Fairlie clay, 1 to 2 percent slopes	20.7	6.5%
Totals for Area of Interest		318.3	100.0%

Map Unit Legend

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it

was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Williamson County, Texas

BkE—Brackett gravelly clay loam, 3 to 12 percent slopes

Map Unit Setting

National map unit symbol: 2t2m5 Elevation: 700 to 1,450 feet Mean annual precipitation: 30 to 36 inches Mean annual air temperature: 66 to 69 degrees F Frost-free period: 230 to 265 days Farmland classification: Not prime farmland

Map Unit Composition

Brackett and similar soils: 92 percent Minor components: 8 percent Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Brackett

Setting

Landform: Ridges Landform position (two-dimensional): Backslope, footslope, summit, shoulder Landform position (three-dimensional): Interfluve, side slope Down-slope shape: Convex Across-slope shape: Linear Parent material: Residuum weathered from limestone

Typical profile

A - 0 to 5 inches: gravelly clay loam Bk - 5 to 16 inches: clay loam Cr - 16 to 60 inches: bedrock

Properties and qualities

Slope: 3 to 12 percent
Surface area covered with cobbles, stones or boulders: 3.0 percent
Depth to restrictive feature: 6 to 20 inches to paralithic bedrock
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to high (0.06 to 1.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 90 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water supply, 0 to 60 inches: Very low (about 1.9 inches)

Interpretive groups

Land capability classification (irrigated): None specified Land capability classification (nonirrigated): 6e Hydrologic Soil Group: D Ecological site: R081CY355TX - Adobe 29-35 PZ Hydric soil rating: No

Minor Components

Sunev

Percent of map unit: 6 percent Landform: Drainageways Landform position (two-dimensional): Backslope, footslope Landform position (three-dimensional): Base slope Down-slope shape: Linear Across-slope shape: Concave Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

Austin

Percent of map unit: 2 percent Landform: Ridges Landform position (two-dimensional): Backslope, footslope, summit, shoulder Landform position (three-dimensional): Interfluve, side slope Down-slope shape: Concave Across-slope shape: Linear Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

BktD—Brackett association, 1 to 8 percent slopes

Map Unit Setting

National map unit symbol: 2t26h Elevation: 550 to 1,920 feet Mean annual precipitation: 30 to 35 inches Mean annual air temperature: 64 to 68 degrees F Frost-free period: 210 to 240 days Farmland classification: Not prime farmland

Map Unit Composition

Brackett and similar soils: 87 percent Minor components: 13 percent Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Brackett

Setting

Landform: Ridges Landform position (two-dimensional): Backslope, footslope, summit, shoulder Landform position (three-dimensional): Interfluve, side slope Down-slope shape: Convex Across-slope shape: Linear Parent material: Residuum weathered from limestone

Typical profile

A - 0 to 5 inches: clay loam Bk - 5 to 14 inches: clay loam

Cr - 14 to 60 inches: bedrock

Properties and qualities

Slope: 1 to 8 percent
Depth to restrictive feature: 5 to 20 inches to paralithic bedrock
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to high (0.06 to 1.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 80 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water supply, 0 to 60 inches: Very low (about 2.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified Land capability classification (nonirrigated): 4e Hydrologic Soil Group: D Ecological site: R081CY355TX - Adobe 29-35 PZ Hydric soil rating: No

Minor Components

Eckrant

Percent of map unit: 5 percent Landform: Ridges Landform position (two-dimensional): Summit, shoulder, backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Convex Ecological site: R081CY360TX - Low Stony Hill 29-35 PZ Hydric soil rating: No

Bolar

Percent of map unit: 3 percent Landform: Ridges on plateaus Landform position (two-dimensional): Shoulder, backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Convex Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

Doss

Percent of map unit: 3 percent Landform: Ridges Landform position (two-dimensional): Backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Linear Ecological site: R081CY574TX - Shallow 29-35 PZ Hydric soil rating: No

Krum

Percent of map unit: 2 percent

Custom Soil Resource Report

Landform: Stream terraces on plateaus Landform position (three-dimensional): Riser, tread Down-slope shape: Concave Across-slope shape: Linear Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

DnB—Denton silty clay, 1 to 3 percent slopes

Map Unit Setting

National map unit symbol: 2t26l Elevation: 570 to 1,870 feet Mean annual precipitation: 31 to 36 inches Mean annual air temperature: 65 to 68 degrees F Frost-free period: 220 to 260 days Farmland classification: All areas are prime farmland

Map Unit Composition

Denton and similar soils: 88 percent Minor components: 12 percent Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Denton

Setting

Landform: Hillslopes Landform position (two-dimensional): Toeslope Landform position (three-dimensional): Base slope Down-slope shape: Convex Across-slope shape: Linear Parent material: Silty and clayey slope alluvium over residuum weathered from limestone

Typical profile

A - 0 to 14 inches: silty clay Bw - 14 to 25 inches: silty clay Bk - 25 to 33 inches: silty clay Ck - 33 to 36 inches: gravelly silty clay R - 36 to 80 inches: bedrock

Properties and qualities

Slope: 1 to 3 percent
Depth to restrictive feature: 22 to 60 inches to lithic bedrock
Drainage class: Well drained
Runoff class: High
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None

Calcium carbonate, maximum content: 80 percent *Maximum salinity:* Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm) *Available water supply, 0 to 60 inches:* Low (about 4.3 inches)

Interpretive groups

Land capability classification (irrigated): None specified Land capability classification (nonirrigated): 3s Hydrologic Soil Group: D Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

Minor Components

Krum

Percent of map unit: 6 percent Landform: Drainageways Landform position (two-dimensional): Toeslope Landform position (three-dimensional): Tread Down-slope shape: Linear Across-slope shape: Concave Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

Doss

Percent of map unit: 4 percent Landform: Hillslopes Landform position (two-dimensional): Backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Linear Ecological site: R081BY343TX - Shallow 23-31 PZ Hydric soil rating: No

Anhalt

Percent of map unit: 2 percent Landform: Hillslopes Landform position (two-dimensional): Toeslope Landform position (three-dimensional): Base slope Down-slope shape: Linear Across-slope shape: Linear Ecological site: R081CY358TX - Deep Redland 29-35 PZ Hydric soil rating: No

DoC—Doss silty clay, moist, 1 to 5 percent slopes

Map Unit Setting

National map unit symbol: 2s0st Elevation: 630 to 1,840 feet Mean annual precipitation: 30 to 36 inches Mean annual air temperature: 66 to 68 degrees F Frost-free period: 210 to 240 days Farmland classification: Not prime farmland

Map Unit Composition

Doss and similar soils: 85 percent Minor components: 15 percent Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Doss

Setting

Landform: Hillslopes Landform position (two-dimensional): Backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Linear Parent material: Residuum weathered from limestone

Typical profile

A - 0 to 9 inches: silty clay Bk - 9 to 17 inches: silty clay Cr - 17 to 80 inches: bedrock

Properties and qualities

Slope: 1 to 5 percent
Depth to restrictive feature: 11 to 20 inches to paralithic bedrock
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.57 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 70 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water supply, 0 to 60 inches: Very low (about 2.4 inches)

Interpretive groups

Land capability classification (irrigated): None specified Land capability classification (nonirrigated): 4e Hydrologic Soil Group: D Ecological site: R081CY574TX - Shallow 29-35 PZ Hydric soil rating: No

Minor Components

Brackett

Percent of map unit: 7 percent Landform: Ridges Landform position (two-dimensional): Backslope, footslope, shoulder Landform position (three-dimensional): Side slope Down-slope shape: Linear Across-slope shape: Convex Ecological site: R081CY362TX - Steep Adobe 29-35 PZ Hydric soil rating: No

Bolar

Percent of map unit: 5 percent

Landform: Ridges Landform position (two-dimensional): Shoulder Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Convex Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

Eckrant

Percent of map unit: 1 percent Landform: Ridges Landform position (two-dimensional): Shoulder Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Convex Ecological site: R081CY360TX - Low Stony Hill 29-35 PZ Hydric soil rating: No

Purves

Percent of map unit: 1 percent Landform: Plains Landform position (two-dimensional): Backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Linear Ecological site: R081CY574TX - Shallow 29-35 PZ Hydric soil rating: No

Denton

Percent of map unit: 1 percent Landform: Plains Landform position (two-dimensional): Backslope Landform position (three-dimensional): Side slope Down-slope shape: Linear Across-slope shape: Linear Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

EaD—Eckrant cobbly clay, 1 to 8 percent slopes

Map Unit Setting

National map unit symbol: 2t0sg Elevation: 650 to 1,900 feet Mean annual precipitation: 30 to 35 inches Mean annual air temperature: 65 to 69 degrees F Frost-free period: 210 to 250 days Farmland classification: Not prime farmland

Map Unit Composition

Eckrant and similar soils: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Eckrant

Setting

Landform: Ridges Landform position (two-dimensional): Summit, shoulder, backslope Landform position (three-dimensional): Interfluve, side slope Down-slope shape: Convex Across-slope shape: Convex Parent material: Residuum weathered from limestone

Typical profile

A1 - 0 to 4 inches: cobbly clay A2 - 4 to 11 inches: very cobbly clay R - 11 to 80 inches: bedrock

Properties and qualities

Slope: 1 to 8 percent
Surface area covered with cobbles, stones or boulders: 2.3 percent
Depth to restrictive feature: 4 to 20 inches to lithic bedrock
Drainage class: Well drained
Runoff class: Medium
Capacity of the most limiting layer to transmit water (Ksat): Moderately low to moderately high (0.06 to 0.57 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 10 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Sodium adsorption ratio, maximum: 1.0
Available water supply, 0 to 60 inches: Very low (about 1.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified Land capability classification (nonirrigated): 6s Hydrologic Soil Group: D Ecological site: R081CY360TX - Low Stony Hill 29-35 PZ Hydric soil rating: No

Minor Components

Brackett

Percent of map unit: 7 percent Landform: Ridges Landform position (two-dimensional): Backslope Landform position (three-dimensional): Side slope Down-slope shape: Convex Across-slope shape: Convex Ecological site: R081CY355TX - Adobe 29-35 PZ Hydric soil rating: No

Bexar

Percent of map unit: 5 percent Landform: Ridges Landform position (two-dimensional): Footslope Landform position (three-dimensional): Base slope Down-slope shape: Linear Across-slope shape: Linear Ecological site: R081CY361TX - Redland 29-35 PZ Hydric soil rating: No

Krum

Percent of map unit: 3 percent Landform: Ridges Landform position (two-dimensional): Toeslope Landform position (three-dimensional): Base slope Down-slope shape: Linear Across-slope shape: Linear Ecological site: R081CY357TX - Clay Loam 29-35 PZ Hydric soil rating: No

FaB—Fairlie clay, 1 to 2 percent slopes

Map Unit Setting

National map unit symbol: djq1 Elevation: 550 to 850 feet Mean annual precipitation: 30 to 42 inches Mean annual air temperature: 64 to 68 degrees F Frost-free period: 230 to 260 days Farmland classification: All areas are prime farmland

Map Unit Composition

Fairlie and similar soils: 100 percent *Estimates are based on observations, descriptions, and transects of the mapunit.*

Description of Fairlie

Setting

Landform: Ridges Landform position (two-dimensional): Footslope, toeslope Landform position (three-dimensional): Base slope Down-slope shape: Linear Across-slope shape: Convex Parent material: Residuum weathered from austin chalk formation

Typical profile

H1 - 0 to 8 inches: clay

H2 - 8 to 46 inches: clay

H3 - 46 to 54 inches: bedrock

Properties and qualities

Slope: 1 to 2 percent Depth to restrictive feature: 40 to 60 inches to paralithic bedrock Drainage class: Moderately well drained Runoff class: Very high

Custom Soil Resource Report

Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.06 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 20 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Available water supply, 0 to 60 inches: Moderate (about 7.8 inches)

Interpretive groups

Land capability classification (irrigated): None specified Land capability classification (nonirrigated): 2e Hydrologic Soil Group: D Ecological site: R086AY011TX - Southern Blackland Hydric soil rating: No

Soil Information for All Uses

Soil Properties and Qualities

The Soil Properties and Qualities section includes various soil properties and qualities displayed as thematic maps with a summary table for the soil map units in the selected area of interest. A single value or rating for each map unit is generated by aggregating the interpretive ratings of individual map unit components. This aggregation process is defined for each property or quality.

Soil Qualities and Features

Soil qualities are behavior and performance attributes that are not directly measured, but are inferred from observations of dynamic conditions and from soil properties. Example soil qualities include natural drainage, and frost action. Soil features are attributes that are not directly part of the soil. Example soil features include slope and depth to restrictive layer. These features can greatly impact the use and management of the soil.

Hydrologic Soil Group (Nolina Phase 2A)

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:


Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.


Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

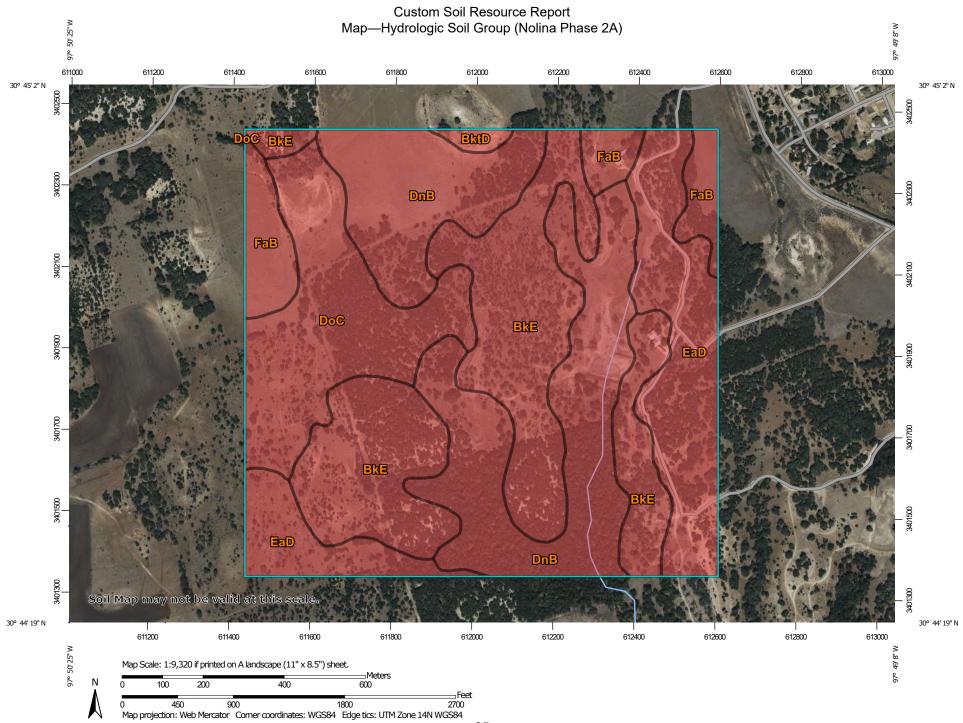

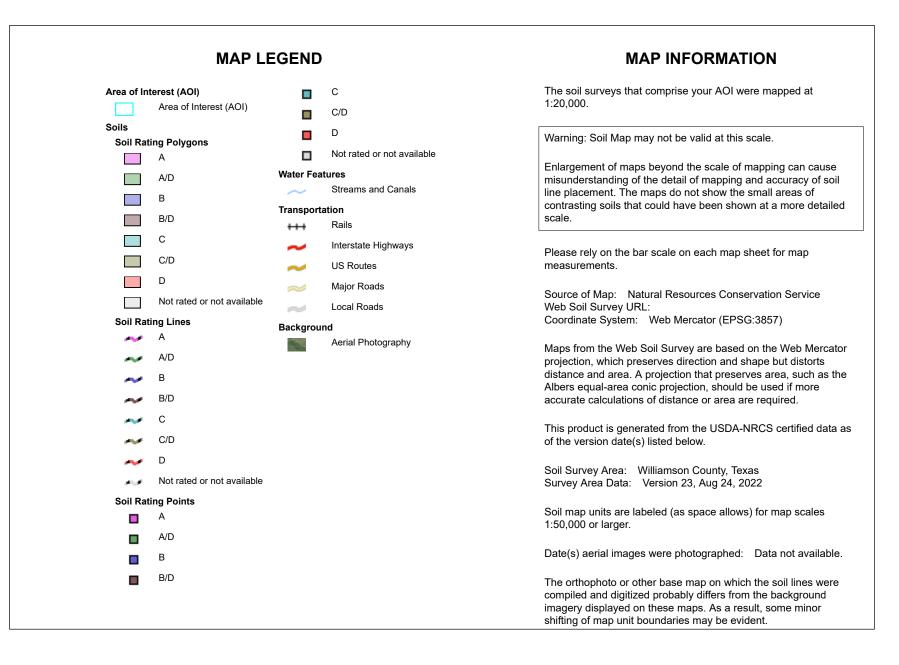

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
BkE	Brackett gravelly clay loam, 3 to 12 percent slopes	D	95.5	30.0%
BktD	Brackett association, 1 to 8 percent slopes	D	2.0	0.6%
DnB	Denton silty clay, 1 to 3 percent slopes	D	94.3	29.6%
DoC	Doss silty clay, moist, 1 to 5 percent slopes	D	50.0	15.7%
EaD	Eckrant cobbly clay, 1 to 8 percent slopes	D	55.8	17.5%
FaB	Fairlie clay, 1 to 2 percent slopes	D	20.7	6.5%
Totals for Area of Interest		318.3	100.0%	

Table—Hydrologic Soil Group (Nolina Phase 2A)

Rating Options—Hydrologic Soil Group (Nolina Phase 2A)

Aggregation Method: Dominant Condition Component Percent Cutoff: None Specified Tie-break Rule: Higher

References

American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.

American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.

Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.

Federal Register. July 13, 1994. Changes in hydric soils of the United States.

Federal Register. September 18, 2002. Hydric soils of the United States.

Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.

National Research Council. 1995. Wetlands: Characteristics and boundaries.

Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/ nrcs/detail/national/soils/?cid=nrcs142p2_054262

Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577

Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2 053580

Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.

United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.

United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/ home/?cid=nrcs142p2 053374

United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. http://www.nrcs.usda.gov/wps/portal/nrcs/ detail/national/landuse/rangepasture/?cid=stelprdb1043084

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/? cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

Map/Figure Notes:

- The Operator is solely responsible for selection, implementation, maintenance, and effectiveness of all BMPs.
- Best management practices shown on the attached figures are suggested controls only. The Operator will record BMPs (whether called out on the original SWP3 or not) directly on the site map.
- If information is not shown or if site conditions change from the attached figures, the Operator is responsible for updating the maps. The following information should be included on maps.
 - drainage patterns and approximate slopes anticipated after major grading activities,
 - areas where soil disturbance will occur,
 - locations of all major structural controls either planned or in place,
 - locations where stabilization practices are expected to be used,
 - locations of off-site material, waste, borrow, fill, or equipment storage areas,
 - surface waters (including wetlands) either adjacent or in close proximity,
 - locations where storm water discharges from the site directly to a surface water body or a MS4, and
 - vehicle wash areas
 - designated points on the site where vehicles will exit onto paved roads
- Where the amount of information required to be included on the map would result in a single map being difficult to interpret, the operator shall develop a series of maps that collectively include the required information.

APPENDIX B

CONSTRUCTION ACTIVITY SCHEDULE

Construction Activity Schedule

Activities	Start Date	Finish Date
1.		
2.		
3.		
4.		
5.		
6.		
7.		
8.		
9.		
10.		
11.		

*Construction activity sequences for linear projects may be conducted on a rolling basis. As a result, construction activities may be at different stages at different locations in the project area. The Contractor is required to complete and update the schedule and adjust as necessary.

APPENDIX C

BEST MANAGEMENT PRACTICE CHECKLIST AND FACT SHEETS

EROSION AND SEDIMENT CONTROL CHECKLIST

Instructions: Check each item and fill in the blanks below to evaluate compliance for each drainage area and location.

Stabilization Practices:

- Stabilization will be initiated on all disturbed areas where construction activity will not occur for a period of more than 21 calendar days by the 14th day after construction activity has permanently or temporarily ceased. Stabilization measures to be used include:
 - □ Temporary Seeding
 - Permanent Seeding
 - □ Mulching

- □ Sod Stabilization
- □ Geotextiles
- Other _____

Structural Practices

- Flows from upstream areas will be diverted from exposed soils to the degree attainable. Measures to be used include:
 - □ Earth Dike
 - □ Drainage Swale
 - □ Interceptor Dike and Swale
 - Pipe Slope Drain
 - Other _

For Drainage locations serving less than 10 disturbed acres, Sediment Basin will be installed and will include:

- □ Sediment Trap
- □ Silt Fence or equivalent along all sideslopes & downstream boundaries

For Drainage locations serving 10 or more disturbed acres, a Sediment Basin will be installed (See Appendix N), if a Sediment Basin is not attainable on-site, Sediment Controls will be installed & will include:

- □ Sediment Trap
- □ Silt Fence or equivalent along all sideslopes & downstream boundaries
- □ Sediment Basin


FINAL STABILIZATION / TERMINATION CHECKLIST

- 1. All soil disturbing activities are complete.
- 2. Temporary erosion and sediment control measures have been, or will be, removed at an appropriate time.
- 3. All areas of the construction site not otherwise covered by a permanent pavement or structure have been stabilized with a uniform perennial vegetative cover with a density of 70% or equivalent measures have been employed.

2.0 Erosion Controls

2.1 Check Dam

Erosion Control

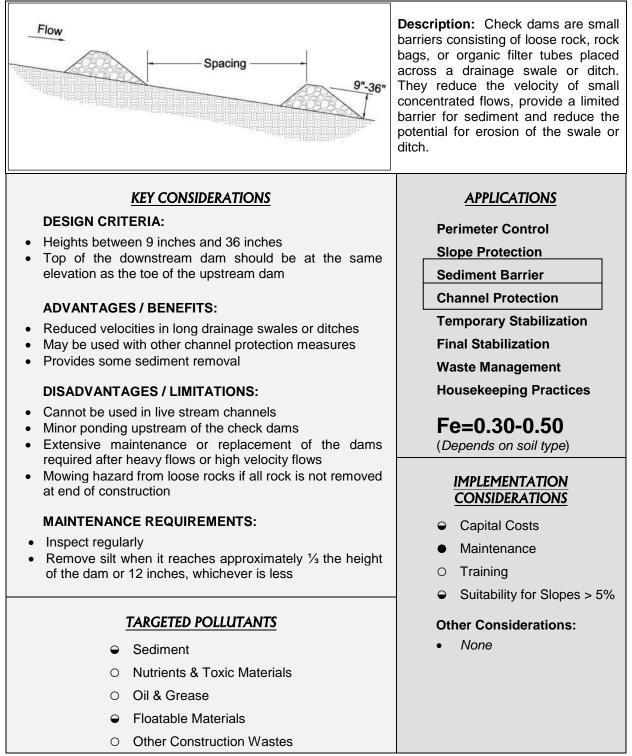

2.1.1 Primary Use

Check dams are used in long drainage swales or ditches to reduce erosive velocities. They are typically used in conjunction with other channel protection techniques such as vegetation lining and turf reinforcement mats. Check dams provide limited treatment to sediment-laden flows. They are more useful in reducing flow velocities to acceptable levels for stabilization methods. Check dams may be used in combination with stone outlet sediment traps, where the check dams prevent erosion of the swale while the sediment trap captures sediment at the downstream end of the swale.

2.1.2 Applications

Check dams are typically used in swales and drainage ditches along linear projects such as roadways. They can also be used in short swales down a steep slope, such as swales down a highway embankment, to reduce velocities. Check dams shall not be used in live stream channels.

Check dams should be installed before the contributing drainage area is disturbed, so as to mitigate the effects on the swale from the increase in runoff. If the swale itself is graded as part of the construction activities, check dams are installed immediately upon completion of grading to control velocities in the swale until stabilization is completed.

2.1.3 Design Criteria

General Criteria

- Typically, the dam height should be between 9 inches and 36 inches, depending on the material of which they are made. The height of the check dam shall always be less than one-third the depth of the channel.
- Dams should be spaced such that the top of the downstream dam is at the same elevation as the toe of the upstream dam. On channel grades flatter than 0.4 percent, check dams should be placed at a distance that allows small pools to form between each check dam.
- The top of the side of the check dam shall be a minimum of 12 inches higher than the middle of the dam. In addition, the side of the dams shall be embedded a minimum of 18 inches into the side of the drainage ditch, swale or channel to minimize the potential for flows to erode around the side of the dam.
- Larger flows (greater than 2-year, 24-hour design storm) must pass the check dam without causing excessive upstream flooding.
- Check dams should be used in conjunction with other sediment reduction techniques prior to releasing flow offsite.
- Use geotextile filter fabric under check dams of 12 inches in height or greater. The fabric shall meet the following minimum criteria:
 - Tensile Strength, ASTM D4632 Test Method for Grab Breaking Load and Elongation of Geotextiles, 250-lbs.
 - Puncture Rating, ASTM D4833 Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products, 135-lbs.
 - Mullen Burst Rating, ASTM D3786 Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method, 420-psi.
 - Apparent Opening Size, ASTM D4751 Test Method for Determining Apparent Opening Size of a Geotextile, U.S. Sieve No. 20 (max).
- Loose, unconfined soil, wood chips, compost, and other material that can float or be transported by runoff shall not be used to construct check dams.

Rock Check Dams

- Stone shall be well graded with stone size ranging from 3 to 6 inches in diameter for a check dam height of 24 inches or less. The stone size range for check dams greater than 24 inches is 4 to 8 inches in diameter.
- Rock check dams shall have a minimum top width of 2 feet with side slopes of 2:1 or flatter.

Rock Bag Check Dams

- Rock bag check dams should have a minimum top width of 16 inches.
- Bag length shall be 24 inches to 30 inches, width shall be 16 inches to 18 inches and thickness shall be 6 inches to 8 inches and having a minimum weight of 40 pounds.
- Minimum rock bag dam height of 12 inches would consist of one row of bags stacked on top of two rows of bag. The dam shall always be one more row wide than it is high, stacked pyramid fashion.
- Bags should be filled with pea gravel, filter stone, or aggregate that is clean and free of deleterious material.
- Sand bags shall not be used for check dams, due to their propensity to break and release sand that is transported by the concentrated flow in the drainage swale or ditch.
- Bag material shall be polypropylene, polyethylene, polyamide or cotton burlap woven fabric, minimum unit weight 4-ounces-per-square-yard, Mullen burst strength exceeding 300-psi as determined by ASTM D3786, Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method, and ultraviolet stability exceeding 70 percent.
- PVC pipes may be installed through the dam to allow for controlled flow through the dam. Pipe should be schedule 40 or heavier polyvinyl chloride (PVC) having a nominal internal diameter of 2 inches.

Sack Gabion Check Dams

- Sack gabion check dams may be used in channels with a contributing drainage area of 5 acres or less.
- Sack gabions shall be wrapped in galvanized steel, woven wire mesh. The wire shall be 20 gauge with 1 inch diameter, hexagonal openings.
- Wire mesh shall be one piece, wrapped around the rock, and secured to itself on the downstream side using wire ties or hog rings.
- Sack gabions shall be staked with ³/₄ inch rebar at a maximum spacing of three feet. Each wire sack shall have a minimum of two stakes.
- Stone shall be well graded with a minimum size range from 3 to 6 inches in diameter.

Organic Filter Tube Check Dams

- Organic filter tubes may be used as check dams in channels with a contributing drainage area of 5 acres or less.
- Organic filter tubes shall be a minimum of 12 inches in diameter.
- Filter material used within tubes to construct check dams shall be limited to coir, straw, aspen fiber and other organic material with high cellulose content. The material should be slow to decay or leach nutrients in standing water.
- Staking of filter tubes shall be at a maximum of 4 foot spacing and shall alternate through the tube and on the downstream face of the tube.
- Unless superseded by requirements in this section, filter tubes and filter material shall comply with the

criteria in Section 3.6 Organic Filter Tubes.

2.1.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.9 Check Dam (Rock). Specifications are also available in the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT 2004), Item 506.2.A and Item 506.4.C.1.

2.1.5 Inspection and Maintenance Requirements


Check dams should be inspected regularly (at least as often as required by the TPDES Construction General Permit). Silt must be removed when it reaches approximately 1/3 the height of the dam or 12 inches, whichever is less. Inspectors should monitor the edges of the dam where it meets the sides of the drainage ditch, swale or channel for evidence of erosion due to bypass or high flows. Eroded areas shall be repaired. If erosion continues to be a problem, modifications to the check dam or additional controls are needed.

Care must be used when taking out rock check dams in order to remove as much rock as possible. Loose rock can create an extreme hazard during mowing operations once the area has been stabilized.

2.1.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

The schematics are **not for construction**. They may serve as a starting point for creating a construction detail, but they must be adapted for the site by the designer. Dimensions and notes appropriate for the application must also be added by the designer.

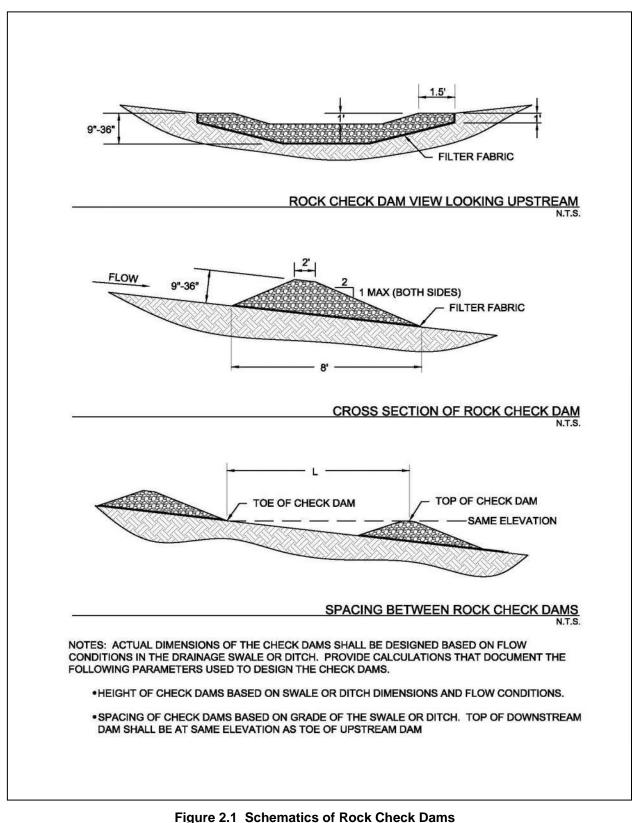

(Source: Modified from Stormwater Management Manual for Western Washington)

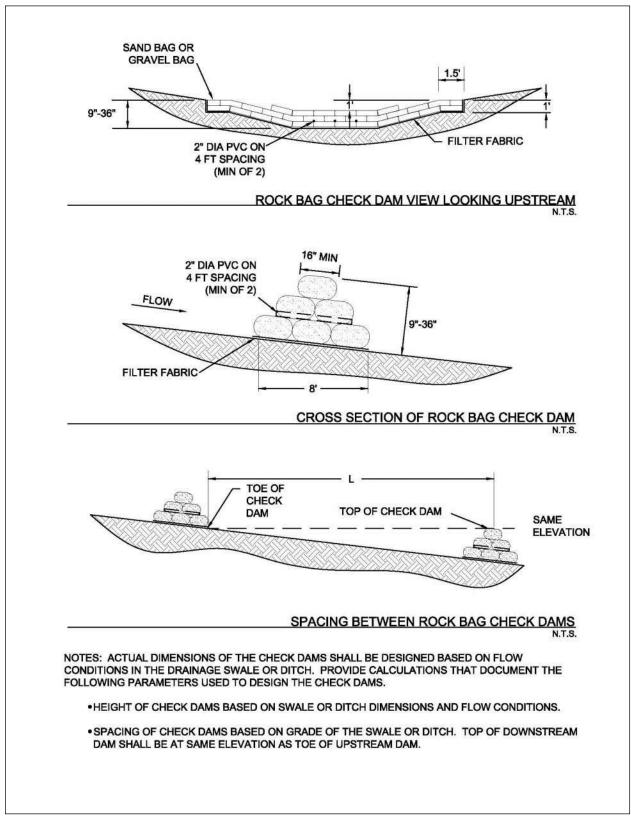


Figure 2.2 Schematics of Rock Bag Check Dams



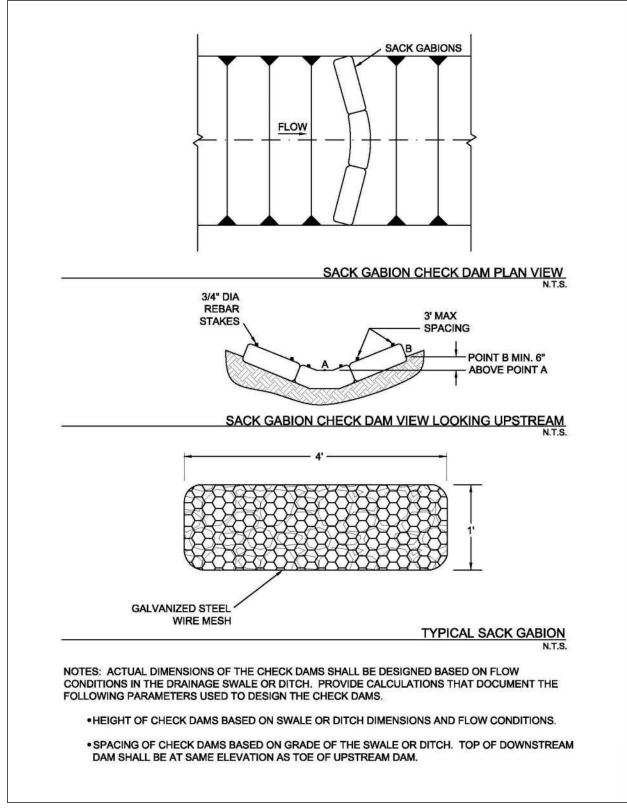


Figure 2.3 Schematics of Sack Gabion Check Dams (Source: Modified from Texas Department of Transportation Detail Sheet EC (2)-93)

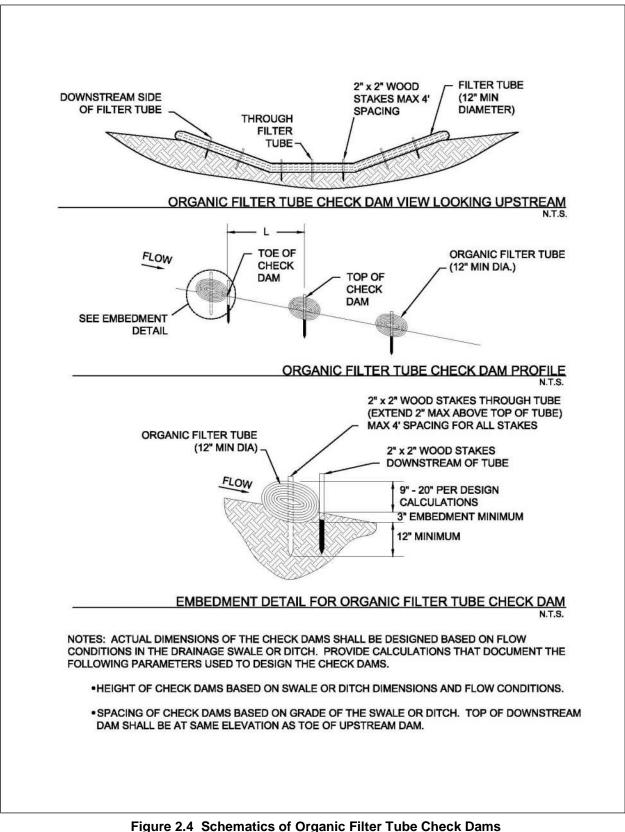

(Source: Modified from City of Plano BMP S-7)

2.3 Erosion Control Blankets

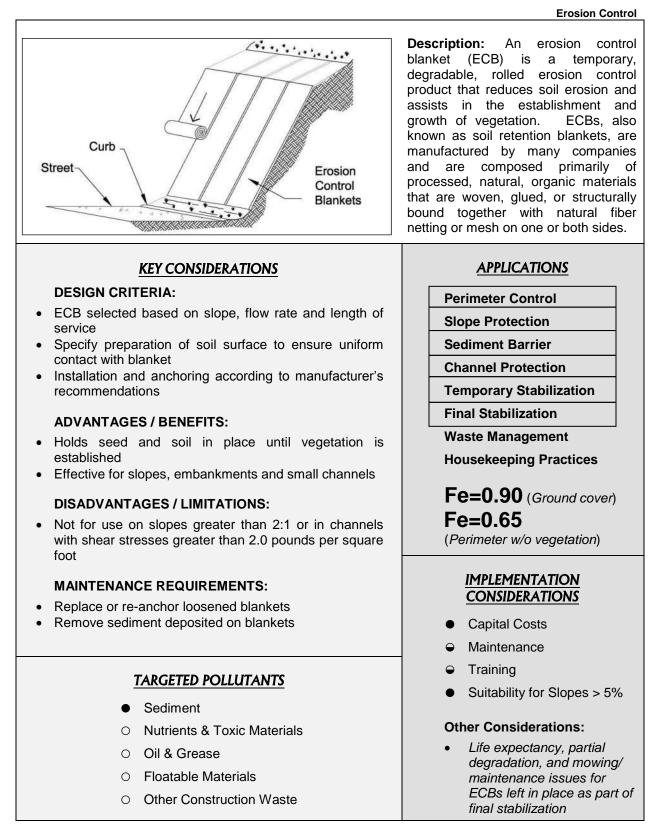

2.3.1 Primary Use

Erosion control blankets (ECBs) are used to hold seed and soil in place until vegetation is established on disturbed areas. They can be used on many types of disturbed areas, but are particularly effective for slopes and embankments and in small drainage swales.

ECBs seeded for vegetation may be used as a perimeter control. When used in combination with other sediment barriers, such as silt fence or organic filter tubes, blankets may be used as a perimeter control with or without vegetation.

2.3.2 Applications

ECBs may be used on many types of disturbed areas but are most applicable on gradual to steep (2:1) cut/fill slopes and in swales and channels with low to moderate flow velocities. In these applications they may provide temporary stabilization by themselves or may be used with seeding to provide final stabilization. ECBs are also used to establish vegetation in channels where velocities are less than 6.0 feet per second.

When seeded for establishment of vegetation, ECBs can be an effective perimeter along the down slope side of linear construction projects (roads and utilities). ECBs with vegetation are also used as perimeter controls for new development, particularly at the front on residential lots in new subdivisions. ECBs are an effective aid in establishing vegetated filter strips.

2.3.3 Design Criteria

- The designer shall specify the manufacturer, type of erosion control blanket to be used, and dimensioned limits of installation based on the site topography and drainage.
- The type and class of erosion control blanket must be specified in accordance with the manufacturer's guidance for the slope of the area to be protected, the flow rate (sheet flow on cut/fill slopes) or velocity (concentrated flow in swales) of stormwater runoff in contact in with the ECB, and the anticipated length of service.
- ECBs should meet the applicable "Minimum Performance Standards for TxDOT" as published by TxDOT in its "Erosion Control Report" and/or be listed on the most current annual "Approved Products List for TxDOT" applicable to TxDOT Item 169 Soil Retention Blanket and its Special Provisions.
- ECBs shall be installed vertically down slope (across contours) on cut/fill slopes and embankments and along the contours (parallel to flow) in swales and drainage ditches.
- ECBs designed to remain onsite as part of final stabilization shall have netting or mesh only on one side (the exposed side) of the ECB. The ECB shall be installed with the side that does not have netting or mesh in contact with the soil surface. All materials in the ECB, including anchors, should be 100 percent biodegradable within three years.
- On cut/fill slopes and drainage ditches or swales designed to receive erosion control blankets for temporary or final stabilization, installation of the ECBs shall be initiated immediately after completing grading of the slope or drainage way, and in no case later than 14 days after completion of grading these features. Do not delay installation of ECBs on these highly-erodible areas until completion of construction activities and stabilization of the remainder of the site.
- Unless the ECB is seeded to establish vegetation, perimeter control applications shall be limited to thirty foot wide drainage areas (i.e. linear construction projects) for an 8 foot width of ECB. When seeded for vegetation, use of ECBs for perimeter control shall follow the criteria in the Section 3.15 Vegetated Filter Strips and Buffers.
- Prior to the installation of the ECB, all rocks, dirt clods, stumps, roots, trash and any other obstructions that would prevent the ECB from lying in direct contact with the soil shall be removed.

- Anchor trenching shall be located along the top of slope of the installation area, except for small areas with less than 2 percent slope.
- Installation and anchoring shall conform to the recommendations shown within the manufacturer's published literature for the erosion control blanket. Anchors (staples) shall be a minimum of 6 inches in length and 1 inch wide. They shall be made of 11-gauge wire, or equivalent, unless the ECB is intended to remain in place with final stabilization and biodegrade.
- Particular attention must be paid to joints and overlapping material. Overlap along the sides and at the ends of ECBs should be per the manufacturer's recommendations for site conditions and the type of ECB being installed. At a minimum, the end of each roll of ECB shall overlap the next roll by 3 feet and the sides of rolls shall overlap 4 inches.
- After installation, the blankets should be checked for uniform contact with the soil, security of the lap joints, and flushness of the staples with the ground.
- When ECBs are installed to assist with establishing vegetation, seeding shall be completed before installation of the ECB. Criteria for seeding are provided in *Section 2.9 Vegetation*.
- Turf Reinforcement Mats should be used instead of ECBs for permanent erosion control and for stabilizing slopes greater than 2:1.
- ECBs are limited to use in swales and channels that have shear stresses of less than 2.0 pounds per square foot. Turf reinforcement mats shall be used in open channels with higher shear stresses.

2.3.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.15 Erosion Control Blankets and in Item 169 of the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT, 2004).

2.3.5 Inspection and Maintenance Requirements

Erosion control blankets should be inspected regularly (at least as often as required by the TPDES Construction General Permit) for bare spots caused by weather or other events. Missing or loosened blankets must be replaced or re-anchored.

Check for excess sediment deposited from runoff. Remove sediment and/or replace blanket as necessary. In addition, determine the source of excess sediment and implement appropriate measures to control the erosion. Also check for rill erosion developing under the blankets. If found, repair the eroded area. Determine the source of water causing the erosion and add controls to prevent its reoccurrence.

2.3.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

The schematics are **not for construction**. The designer is responsible for working with ECB manufacturers to ensure the proper ECB is specified based on the site topography and drainage. Installation measures should be dictated by the ECB manufacturer and are dependent on the type of ECB installed. Manufacturer's recommendations for overlap, anchoring, and stapling shall always be followed. Criteria shown here are applicable only when they are more stringent than those provided by the manufacturer.


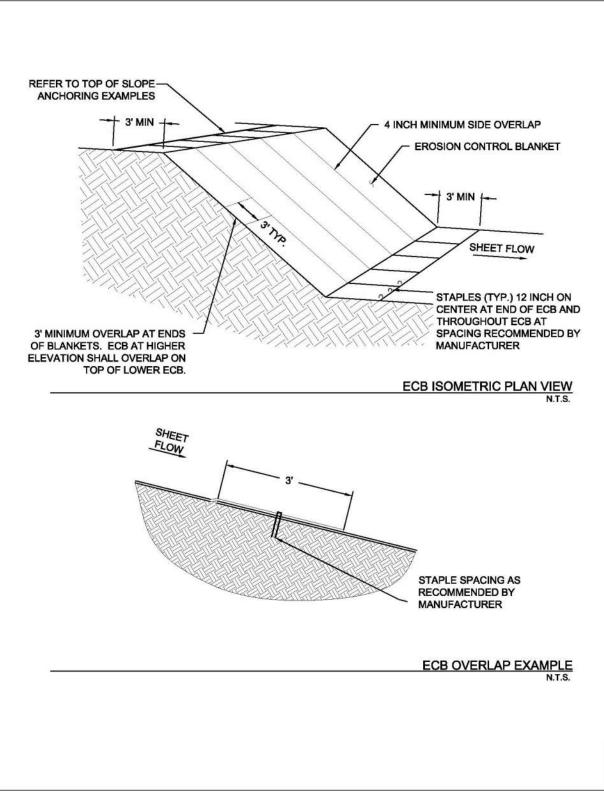


Figure 2.7 Schematics of Erosion Control Blankets



(Sources: American Excelsior Company and Western Excelsior Corporation)

2.5 Mulching

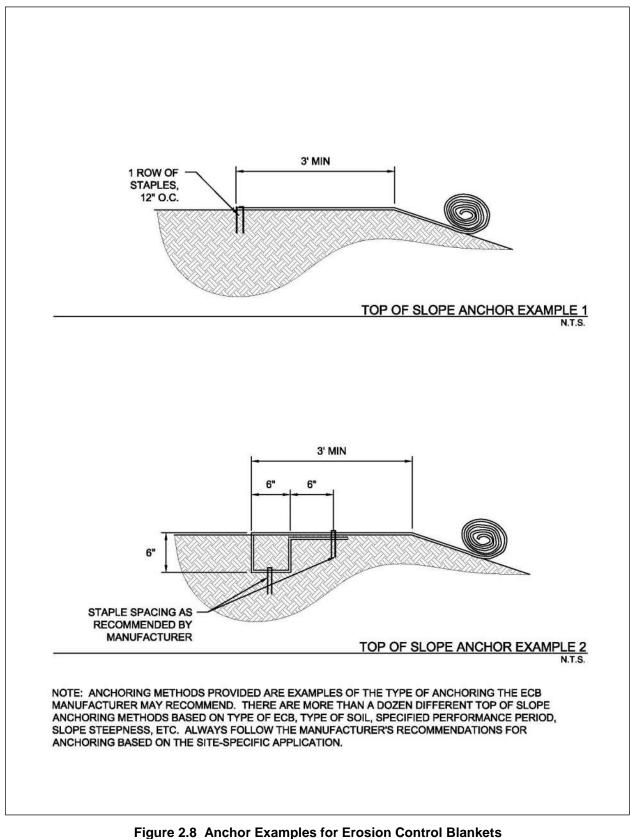

2.5.1 Primary Use

Mulch may be used by itself to temporarily stabilize bare areas or with seed to establish final stabilization of bare areas. Mulch protects the soil from erosion and moisture loss by lessening the effects of wind, water, and sunlight. It also decreases the velocity of sheet flow, thereby reducing the volume of sediment-laden water flow leaving the mulched area.

2.5.2 Applications

Mulch may be applied on most areas disturbed by construction that require surface protection including:

- Freshly seeded or planted areas;
- Disturbed areas at risk of erosion due to the time period being unsuitable for growing vegetation;
- Disturbed areas that are not conducive to vegetation for temporary stabilization; or
- Steep slopes of 3:1 to 1.5:1, provided the mulch is anchored to the soil by use of soil stabilizers, netting, or crimping.

Mulch is frequently applied with seeding for vegetation. In these cases, refer to Section 2.9 Vegetation for related criteria that may affect mulching.

Mulch may also be applied with commercially available polymers for soil surface treatment to bind the mulch with the soil. This method is particularly useful on steep slopes. Related criteria are available in *Section 2.7 Soil Surface Treatments*.

2.5.3 Design Criteria

General

- Specific design information is required for the use of this control. The designer shall specify the type of mulch to be used, the application rate and/or thickness, and the type of anchoring (if applicable) based on site conditions.
- Choice of mulch depends largely on slope and soil type, in addition to availability of materials.
- Netting, adhesive polymers, or other methods of anchoring the mulch are required on slopes of 3:1 to 1.5:1. Do not use mulch on slopes steeper than 1.5:1.
- Mulch should be applied in an even and uniform manner where concentrated water flow is negligible. Do not apply mulch within the ordinary high-water mark of natural surface waters or within the design flow depth of constructed ditches and channels.
- Hay should not be used as mulch.
- Organic mulches may be distributed by hand or by mechanical means, provided a uniform thickness is achieved.
- When mulch is used with vegetation for final stabilization, fertilization and soil treatment for vegetation establishment should be done prior to placement of mulch, with the exception of hydroseeding or when seed is distributed following straw mulch spread during winter months.
- Table 2.1 on the following page contains a summary of mulch types and general guidelines.

Table 2.1 Mulch Standards and Guidelines					
Mulch Material	Quality Standards	Application Rates	Remarks		
Straw	Air-dried, free of mold and not rotten. Certified Weed Free.	1.5 to 2 tons per acre	Cost-effective when applied with adequate thickness. Straw must be held in place by crimping, netting, or soil stabilizer.		
Chipped Site Vegetation	Should include gradation from fine to coarse to promote interlocking properties. Must be free of waste materials such as plastic bags, metal debris, etc.	10 to 12 tons per acre	Cost-effective method to dispose of vegetative debris from site. Best application is for temporary stabilization where construction will resume. Use cautiously on areas where vegetation will be established, as wood chips will deplete soil nitrogen.		
Erosion Control Compost (Wood Chip and Compost Mixture)	Shall meet the Physical Requirements in Table 1 of TxDOT Special Specification 1001.	Approx. 10 tons per acre	Special caution is advised regarding the source and composition of wood mulches. Ensure compost is free of herbicides. Ensure wood chips are from unpainted and untreated wood.		
Hydraulic Mulch	Must not contain sawdust, cardboard, paper, paper byproducts, plastics, or synthetics. No petroleum- based tackifiers.	Follow the manufacturer's recommendations. Application rate increases with slope steepness.	May be particularly effective on slopes steeper than 3:1. Ensure wood fibers are from unpainted and untreated wood.		

Straw Mulch

- Straw mulch shall be free of weed and grass seed.
- Straw mulch shall be air-dried, free of mold, and not rotten.
- Straw fibers shall be a minimum of 4 inches and a maximum of 8 inches in length.
- Straw mulch must be anchored by using a tractor-drawn crimper to punch into the soil, by placing degradable netting above the mulch, or by application of a soil stabilizer (*Section 2.7 Soil Surface Treatments*).

Chipped Site Vegetation

- Chipped site vegetation is suitable mulch for temporary stabilization before construction will resume in an area of the construction site.
- Ensure the cleared vegetation is free of trash, litter, and debris prior to chipping.

- Chipped pieces shall be a minimum of 2 inches and a maximum of 6 inches in length.
- Chipped woody vegetation that is greater than 50% wood chips by volume may result in mulch that depletes nitrogen in the soil. It is useful as mulch for temporary stabilization where construction activity will resume and result in removal of the mulch. However, it should be used with care on areas where vegetation will be established for final stabilization.
- Chipped vegetation that is greater than 50 percent wood chips by volume may require treatment with a nitrogen fertilizer when used for mulch with seeding.
- Chipped vegetation that includes green matter will include seeds. It should not be used on areas that have specific landscaping requirements.

Erosion Control Compost (Wood Chip and Compost Mixture)

- Wood chip and compost mixture used for mulch shall meet the criteria for Erosion Control Compost in TxDOT Special Specification 1001.
- Wood chips for the mixture shall be less than or equal to 5 inches in length with 95 percent passing a 2 inch screen and less than 30 percent passing a 1 inch screen. Mulch should not contain chipped manufactured boards or chemically treated wood such as particleboard, railroad ties, or similar treated wood.
- Compost for the mixture shall meet the Physical Requirements specified in Table 1 of 2004 TxDOT Special Specification 1001, Compost. It must be free of herbicides and other chemicals.
- Mixing of the Erosion Control Compost into the soil surface is allowed when vegetation is established for final stabilization, except for drill seeding, in which case it is best to leave the mulch as an undisturbed top layer.

Hydraulic Mulch (Including Bonded Fiber Matrix)

- Hydraulic mulch shall consist of a mixture of shredded wood fiber and a stabilizing binder. The mulch must not contain sawdust, cardboard, paper or paper byproducts.
- Shredded wood fiber shall be long strand, whole wood fibers that are:
 - Minimum of 25 percent of fibers 3/8 inch long;
 - Minimum of 50 percent held on a No. 25 sieve;
 - Free from paint, printing ink, varnish, petroleum products, seed germination inhibitors; and
 - Free from synthetic or plastic materials.
- Mulch binders may be organic or inorganic polymers. Asphaltic emulsions and other petroleumbased tackifiers shall not be used.
- The stabilizing emulsion must be nonflammable, non-toxic to aquatic organisms, and free from growth or germination inhibiting factors.
- Areas hydraulically mulched shall be protected from all traffic, including foot traffic, a minimum of 24 hours to allow the mulch to dry and cure. Depending on the mulch, up to 48 hours of protection may be required. Always follow manufacturer's recommendations.
- Hydraulic mulch provides limited to no protection until cured. Do not apply when rain is forecast within the next 24 hours.
- Hydraulic mulch may be particularly effective on slopes steeper than 3:1.

2.5.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.16 Mulching. Specifications for

compost may be found in Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges (TxDOT 2004) Item 161.

2.5.5 Inspection and Maintenance Requirements

Mulched areas should be inspected regularly (at least as often as required by the TPDES Construction General Permit) for thin or bare spots caused by natural decomposition or weather related events. Mulch in high traffic areas should be replaced on a regular basis to maintain uniform protection. Excess mulch should be brought to the site and stockpiled for use during the maintenance period to dress problem spots.

2.9 Vegetation

Erosion Control



2.9.1 Primary Use

Vegetation is used as a temporary or final stabilization measure for areas disturbed by construction. As a temporary control, vegetation is used to stabilize stockpiles, earthen dikes, and barren areas that are inactive for longer than two weeks. As a final control at the end of construction, grasses and other vegetation provide good protection from erosion along with some filtering for overland runoff. Subjected to acceptable runoff velocities, vegetation can provide a positive method of long-term stormwater management as well as a visual amenity to the site.

Other control measures may be required to assist during the establishment of vegetation. These other controls include erosion control blankets, mulching, swales, and dikes to direct flow around newly seeded areas and proper grading to limit runoff velocities during construction.

2.9.2 Applications

Vegetation effectively reduces erosion in channels and swales and on stockpiles, dikes, and mild to medium slopes. Vegetative strips can provide some protection and sediment trapping when used as a perimeter control for utility and site development construction. Refer to *Section 3.15 Vegetated Filter Strips and Buffers* for more information.

In many cases, the initial cost of temporary seeding may be high compared to tarps or covers for stockpiles or other barren areas subject to erosion. This initial cost should be weighed with the amount of time the area is to remain inactive, since vegetation is more effective and the maintenance cost for vegetated areas is much less than most structural controls.

2.9.3 Design Criteria

General

- Vegetation is a highly effective erosion control when the vegetation is fully established. Until then, additional controls are needed. Sediment controls should not be removed from vegetated areas until the vegetation is established.
- On grades steeper than 20:1 (5 percent), anchored mulch or erosion control blankets are required to protect seeded areas until vegetation is established. Refer to *Section 2.5 Mulching* and *Section 2.3 Erosion Control Blankets* for design criteria.
- Vegetation may be used by itself for channel protection when the channel grade is less than 2 percent and the temporary control design storm (2-year, 24-hour) and the conveyance storm (25-year, 24-hour) flow velocities are less than 6 feet per second.
- If the velocity of the temporary control design storm is greater than 2 feet per second, erosion control blankets shall be used in the channel while vegetation is being established. Turf reinforcement mats are required when the velocity exceeds 6 feet per second. Refer to Section 2.3 Erosion Control Blankets and Section 2.8 Turf Reinforcement Mats for design criteria.
- Stabilization of channels with vegetation is limited to channels that have side slopes of 3:1 or flatter.
- On cut/fill slopes and channels designed to receive temporary or final vegetation, establishment of
 vegetation shall be initiated immediately after completing grading of the cut/fill slope or channel, and
 in no case later than 14 days after completion of grading on these features. It is not acceptable to
 delay establishing vegetation on these highly-erodible areas until completion of construction activities
 and stabilization of the remainder of the site.

Surface Preparation

Unless infeasible, remove and stockpile existing topsoil at the start of grading activities. Store topsoil
in a series of small stockpiles instead of one large stockpile to decrease the loss of aerobic soil microorganisms during stockpiling.

- Interim or final grading must be completed prior to seeding or sodding.
- To minimize soil compaction of areas to be vegetated, limit vehicle and equipment traffic in these areas to the minimum necessary to accomplish grading.
- Install all necessary erosion structures such as dikes, swales, diversions, etc. prior to seeding or sodding.
- Spread stockpiled topsoil evenly over the disturbed area to be vegetated.
- Depth of topsoil shall be a minimum of 4 inches, with 6 inches required where the topsoil is over rock, gravel or otherwise unsuitable material for root growth. After spreading stockpiled topsoil, provide additional top soil as needed to achieve these depths.
- Compost Manufactured Topsoil as specified in TxDOT Special Specification 1001 may be used to achieve the specified depths or when it's infeasible to stockpile topsoil. Topsoil may also be acquired from another construction site if there is no space to stockpile the topsoil at that site.
- Topsoil shall have an organic content of 10 to 20 percent using ASTM D2974 Standard Test Methods for Moisture, Ash, and Organic Matter of Peat and Other Organic Soils.
- Topsoil that does not meet the organic content requirement shall be amended with General Use Compost as specified in TxDOT Special Specification 1001. Amendment should be three parts of topsoil to one part compost by volume thoroughly blended.
- Seed bed should be well pulverized and loosened to a minimum depth of 3 inches and then raked to have a uniform surface.
- When establishing vegetation from seed, groove or furrow slopes steeper than 3:1 on the contour line before seeding.

Plant Selection, Fertilization and Seeding

- Use only high quality, USDA certified seed.
- Use an appropriate species or species mixture adapted to the local climate, onsite soil conditions and the season as shown below, or consult with the local office of the Natural Resource Conservation Service (NRCS) or Texas AgriLife Extension Service for selection of proper species and application technique in this area.
- Seeding rate should be in accordance with the Tables 2.4, 2.5 and 2.6 as follow in this section or as recommended by the Natural Resources Conservation Service (NRCS) or Texas AgriLife Extension Service.
- Chemical fertilization is not recommended at the time of seeding, because it typically stimulates and is consumed by fast growing weeds that out-compete the slower growing grasses and legumes. If the topsoil has not been amended by compost as discussed above, an 0.5 inch layer of General Use Compost (TxDOT Special Specification 1001) is recommended as a surface treatment to protect the seed and provide slow release nutrients
- Evenly apply seed using a seed drill, cultipacker, terraseeding, or hydroseeder.
- Hydro-seeding should not be used on slopes of 5:1 or steeper unless Bonded Fiber Matrix is used.
- Seeded areas shall be thoroughly watered immediately after planting. Water shall be applied at a rate that moistens the top 6 inches of soil without causing runoff. Provide water daily for the first 14 days after seeding and thereafter as needed to aid in establishment of vegetation.
- Use appropriate mulching techniques (*Section 2.5 Mulching*) where necessary, especially during cold periods of the year. Mulch consisting of chipped site vegetation is discouraged, since the wood content may result in depleting nitrogen from the soil.

Sodding

- Use of sod should be limited to planned landscapes due to the relatively high water use of most types of sod grass.
- When sod is necessary to achieve immediate stabilization, buffalograss (*Buchloe dactyloides*) is recommended. Other types of sod may be used in landscaping when specified by a landscape architect for a commercial property or a homebuyer for a residential lot.
- The sod should be mowed prior to sod cutting so that the height of the grass shall not exceed 3 inches and should not be harvested or planted when its moisture condition is so excessively wet or dry that its survival shall be affected.
- Sod shall have a healthy, virile, system of dense, thickly matted roots throughout a minimum soil thickness of 0.75 inch.
- Sod shall be planted within 3 days after it is excavated.
- In areas subject to direct sunlight, pre-moisten prepared sod bed by watering immediately prior to placing sod.
- Sodded areas shall be thoroughly watered immediately after they are planted.

Temporary Vegetation

The following table lists recommended plant species for the North Central Texas region depending on the season for planting.

Table 2.4 Recommended Grass Mixture for Temporary Erosion Control					
Season	Common Name	Pure Live Seed Rate (Lbs/Acre)			
Sep 1 - Nov 30	Tall Fescue Western Wheat Grass Wheat (Red, Winter)	4.5 5.6 34.0			
May 1 - Aug 31	Foxtail Millet	34.0			
Feb 15 – May 31 Sep 1 – Dec 31	Annual Rye	20.0			

Areas receiving temporary seeding and vegetation shall be landscaped, re-seeded or sodded with perennial species to establish final vegetation at the end of construction.

Vegetation for Final Stabilization

Sodding or seeding may be used to establish vegetation for final stabilization of areas disturbed by construction activity. The vegetation must achieve a cover that is 70 percent of the native background vegetative cover to be considered final stabilization. Sod will achieve this coverage quicker than seeding; however, sod is usually more expensive than seeding. Sod is most cost-effective for small areas or areas of concentrated flow or heavy pedestrian traffic where it will be difficult to establish vegetation by seeding.

Grass seed for establishing final stabilization can be sown at the same time as seeding for temporary (annual) vegetation. Drought tolerant native vegetation is recommended rather than exotics as a long-term water conservation measure. Native grasses can be planted as seed or placed as sod. Buffalo 609, for example, is a hybrid grass that is placed as sod. Fertilizers are not normally used to establish native grasses, but mulching is effective in retaining soil moisture for the native plants.

Table 2.5 Recommended Grass Mixture for Final Stabilization of Upland in Rural Areas					
County	Planting	Clay Soils Species and Pure Live Seed Rate (Lbs/Acre)		Sandy Soils Species and Pure Live Seed Rate (Lbs/Acre)	
	Date				
Erath Hood Johnson Palo Pinto Parker Somervell Tarrant Wise	February 1 – May 15	Green Sprangletop Sideoats Grama (El Reno) Bermudagrass Little Bluestem (Native) Blue Grama (Hachita) Illinois Bundleflower	0.3 2.7 0.9 1.0 0.9 1.0	Green Sprangletop Sand Lovegrass Bermudagrass Weeping Lovegrass (Ermelo) Sand Dropseed Partridge Peal	0.3 0.5 1.8 0.8 0.4 1.0
Collin Dallas Denton Ellis Kaufman Navarro Rockwell	February 1 – May 15	Green Sprangletop Bermudagrass Sideoats Grama (El Reno) Little Bluestem (Native) Buffalograss (Texoka) Illinois Bundleflower	0.3 1.2 2.7 2.0 1.6 1.0	Green Sprangletop Bermudagrass Weeping Lovegrass (Ermelo) Sand Lovegrass Sand Dropseed Partridge Pea	0.3 1.8 0.6 0.6 0.4 1.0
Hunt	February 1 – May 15	Green Sprangletop Sideoats Grama (El Reno) Bermudagrass Little Bluestem (Native) Illinois Bundleflower	0.3 3.2 1.8 1.7 1.0	Green Sprangletop Bermudagrass Bahiagrass (Pensacola) Sand Lovegrass Weeping Lovegrass (Ermelo) Partridge Pea	0.3 1.5 6.0 0.6 0.8 1.0

(Source: TxDOT Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges, Item 164)

Table 2.6 Recommended Grass Mixture for Final Stabilization of Upland in Urban Areas					
County	Planting	Clay Soils		Sandy Soils	
	Date	Species and Pure Live Seed (Lbs/Acre)	d Rate	Species and Pure Live Seed Rate (Lbs/Acre)	
Erath Hood Johnson Palo Pinto Parker Somervell Tarrant Wise	February 1 – May 15	Green Sprangletop Sideoats Grama (El Reno) Bermudagrass Buffalograss (Texoka)	0.3 3.6 2.4 1.6	Green Sprangletop Sideoats Grama (El Reno) Bermudagrass Sand Dropseed	0.3 3.6 2.1 0.3
Collin Dallas Denton Ellis Kaufman Navarro Rockwell	February 1 – May 15	Green Sprangletop Sideoats Grama (El Reno) Buffalograss (Texoka) Bermudagrass	0.3 3.6 1.6 2.4	Green Sprangletop Buffalograss (Texoka) Bermudagrass Sand Dropseed	0.3 1.6 3.6 0.4
Hunt	February 1 – May 15	Green Sprangletop Bermudagrass Sideoats Grama (Haskell)	0.3 2.4 4.5	Green Sprangletop Bermudagrass	0.3 5.4

(Source: TxDOT Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges, Item 164)

Vegetation for final stabilization of channels requires grasses that are tolerant of periodic inundation, such as Bermuda grass, Kentucky bluegrass or a grass-legume mixture.

Additional Considerations

- Conditions for establishing vegetation vary significantly from site to site. Therefore, specifics of the vegetation design should be prepared based on the soil, slopes, drainage patterns, and the purpose of the vegetation at a each site.
- For construction activities that include landscaping in the development plans, the landscape architect should be consulted when specifying vegetation for temporary or final stabilization of disturbed areas.
- Vegetation is easier to establish if equipment and vehicle traffic is managed onsite to minimize soil compaction by traffic in the disturbed area that will be vegetated.
- Establishing a good vegetative cover is dependent on the season of the year. Projects that commence in the fall of the year may not be candidates for using vegetation as an erosion control.
- Where vegetation is used in swales and channels it may be necessary to use sod, rather than seeding, to establish an erosion resistant surface that accommodates rainfall runoff flows.
- Mulch should be used to enhance vegetative growth, in that mulch protects seeds from heat, prevents soil moisture loss, and provides erosion protection until the vegetation is established. Compost mulch has the additional benefit of providing some slow-release nutrients.
- Fertilizers have both beneficial and adverse effects. Fertilizers provide nutrients to the vegetation, but fertilizers are also a source of unwanted nutrients in streams and lakes. In this latter regard, they are a pollutant. The use of native vegetation rather than exotics reduces the need for fertilizers. Organic fertilizers, such as compost mulch, are generally preferred over chemical fertilizers. They provide a slow release of nutrients over a longer period of time and are less likely to cause environmental problems.
- Steep slopes represent a problem for establishing vegetation. Hydraulic mulches are useful for establishing vegetation on slopes. Refer to *Section 2.5 Mulching*.

2.9.4 Design Guidance and Specifications

Additional criteria for the application of vegetation in channels are in *Section 3.6.3 of the iSWM Criteria Manual* and design guidance is in *Section 3.2 of the Hydraulics Technical Manual*.

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Item 202 Landscaping. Additional specifications for the following components of this item are in the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT 2004):

- Topsoil, Item 160.
- Compost, Item 161.
- Sodding for Erosion Control, Item 162.
- Seeding for Erosion Control, Item 163.
- Fertilization, Item 164.
- Vegetative Watering 165.

2.9.5 Inspection and Maintenance Requirements


Protect newly seeded areas from excessive runoff and traffic until vegetation is established. Include a watering and fertilizing schedule in the iSWM Construction Plan facilitate the establishment of the vegetation. Vegetation for final stabilization must be maintained until the vegetative cover is 70 percent of the native background vegetative cover.

Vegetation should be inspected regularly (at least as often as required by the TPDES Construction General Permit) to ensure that the plant material is established properly and remains healthy. Bare spots shall be reseeded and/or protected from erosion by mulch or other measures. Accumulated sediment

deposited by runoff should be removed to prevent smothering of the vegetation. In addition, determine the source of excess sediment and implement appropriate measures to control the erosion.

Sediment Control

3.4 Inlet Protection

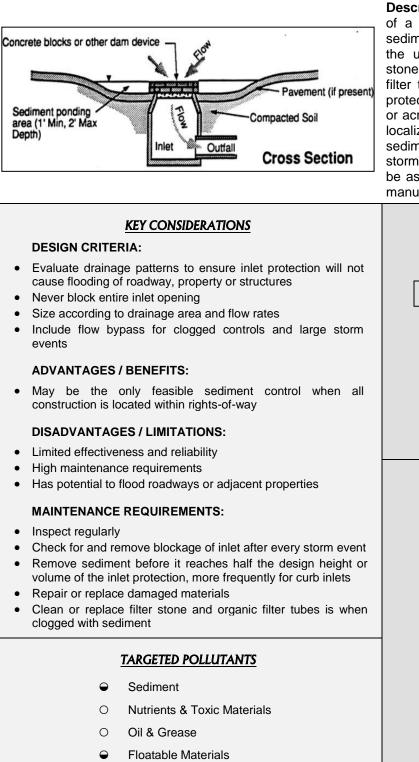

O Other Construction Wastes

Description: Inlet protection consists of a variety of methods to intercept sediment at low point inlets through the use of depressed grading, filter stone, filter fabric, inlet inserts, organic filter tubes and other materials. The protection devices are placed around or across the inlet openings to provide localized detention or filtration of sediment and floatable materials in stormwater. Protection devices may be assembled onsite or purchased as manufactured assemblies.

APPLICATIONS

Perimeter Control

Slope Protection Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=0.35-0.65

(Depends on soil type)

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- Maintenance
- Training
- Suitability for Slopes > 5%

Other Considerations:

- Traffic hazards
- Passage of larger storm events without causing flooding
- Flow diversion to other inlets or drainage points

3.4.1 Primary Use

Inlet protection is typically used as a <u>secondary</u> sediment barrier, due to its limited effectiveness and numerous disadvantages. It is used to reduce sediment in storm sewer systems by serving as a back-up system for areas that have newly applied erosion controls or for other sediment controls that cannot achieve adequate sediment removal by themselves.

Inlet protection may be used as a primary sediment control only when all other primary controls are infeasible because of site configuration or the type of construction activity.

3.4.2 Applications

Inlet protection is best applied at low point (sump) inlets where stormwater runoff will pond behind the protection measure, and then either filter through the protection measure or flow over a weir created by it. Most inlet protection measures depend on ponding to be effective. These types of inlet protection are not applicable to on-grade curb inlets, where the inlet protection will cause stormwater runoff to bypass the inlet and overload downstream inlets. Only inlet protection measures that allow for use of the inlet opening (e.g. inlet inserts) are applicable as inlet protection for on-grade inlets.

Inlet protection is normally used in new developments with new inlets and roads that are not in public use. It has limited applications in developed areas due to the potential for flooding, traffic safety, pedestrian safety, and maintenance problems. Potential applications in developed areas are on parking lot inlets where water can pond without causing damage and during major repairs to existing roadways where no other controls are viable.

The application of inlet protection is highly variable due to the wide variety of inlet configurations (existing and new) and site conditions. The schematics in Section 6 show example applications; however, applications in most cases must be site adapted. Different methods and materials may be used. It is the responsibility of the designer to ensure that the methods and materials applied for inlet protection are appropriate to the site and flow conditions following the design criteria in Section 3.

3.4.3 Design Criteria

General

- Drainage patterns shall be evaluated to ensure inlet protection will not divert flow or flood the roadway or adjacent properties and structures.
- Inlet protection measures or devices that completed block the inlet are prohibited. They must also include a bypass capability in case the protection measures are clogged.
- Inlet protection must be designed to pass the conveyance storm (25-year, 24-hour) without creating a road hazard or damaging adjacent property. This may be accomplished by any of the following measures:
 - An overflow weir on the protection measure.
 - An existing positive overflow swale on the inlet.
 - Sufficient storage volume around the inlet to hold the ponded water until it can all filter into the inlet.
 - Other engineered method.
- Positive overflow drainage is critical in the design of inlet protection. If overflow is not provided for at the inlet, temporary means shall be provided to route excess flows through established swales, streets, or other watercourses to minimize damage due to flooding.
- Filter fabric and wire mesh used for inlet protection shall meet the material requirements specified in *Section 3.10 Silt Fence*.

- Block and gravel (crushed stone or recycled concrete) protection is used when flows exceed 0.5 cubic feet per second and it is necessary to allow for overtopping to prevent flooding.
- The tube and filler for organic filter tubes shall be in accordance with the criteria in Section 3.6 Organic Filter Tube.
- Bags used to secure inlet protection devices on pavement shall be filled with aggregate, filter stone, or crushed rock that is less likely than sand to be washed into an inlet if the bag is broken. Filled bags shall be 24 to 30 inches long, 16 to 18 inches wide, and 6 to 8 inches thick. Bags shall be polypropylene, polyethylene, or polyamide woven fabric with a minimum unit weight of 4 ounces per square yard and meet the following criteria:
 - Greater than 300 psi Mullen Burst Strength using ASTM D3786 Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method.
 - Greater than 70 percent UV Stability using ASTM D4355 Standard Test Method for Deterioration of Geotextiles by Exposure to Light, Moisture, and Heat in a Xenon Arc Type Apparatus.

Curb Inlet Protection

- Municipality approval is required before installing inlet protection on public streets.
- Special caution must be exercised when installing curb inlet protection on publicly traveled streets or in developed areas. Ensure that inlet protection is properly designed, installed and maintained to avoid flooding of the roadway or adjacent properties and structures.
- A two inch overflow gap or weir is required on all curb inlet protection devices.
- Traffic cones, warning signs, or other measures shall be installed to warn motorists when the inlet protection measures extend beyond the gutter line.
- 2 inch X 4 inch Weir Protection:
 - Bend wire mesh around the 2 inch x 4 inch board and staple to the board. Bend wire mesh around the bottom of the board, the curb opening, and along the pavement to form a cage for the rock.
 - Rock bags shall be placed perpendicular to the curb, at both ends of the wooden frame, to disrupt the flow and direct water into the rock filter. Stack the bags two high if needed.
- Organic Filter Tube Protection:
 - The diameter of the tube shall be at least 2 inches less than the height of the inlet opening. The tube should not be allowed to block the entire opening, since it will clog.
 - The tube shall be placed on 4 inch x 4 inch or 2 inch x 4 inch wire mesh to prevent the tube from sagging into the inlet.
 - The tube should be long enough to extend a minimum of 12 inches past the curb opening on each side of the inlet.
- Hog Wire Weir Protection:
 - The filter fabric and wire mesh shall extend a minimum of 12 inches past the curb opening on each side of the inlet.
 - Filter fabric shall be placed on 2 inch x 4 inch wire mesh to prevent the tube from sagging into the inlet.
 - Rock bags are used to hold the wire mesh and filter fabric in contact with the pavement. At least one bag shall be placed on either side of the opening, parallel to and up against the concrete curb. The bags are in intended to disrupt and slow the flow and ensure it does not go under the fabric. Add bags if needed.

- If a board is used to anchor the wire mesh and fabric instead of rock bags, the board shall be secured with concrete nails at 3 inches on center. Upon removal clean any dirt or debris from the nailing locations, apply chemical sanding agent, and apply non-shrink grout flush with surface of concrete.
- Block and Gravel Protection:
 - Concrete blocks shall be standard 8 inch x 8 inch x 16 inch concrete masonry units and shall be in accordance with ASTM C139, Concrete Masonry Units for Construction. Filter gravel shall be ³/₄ inch washed stone containing no fines. Angular shaped stone is preferable to rounded shapes.
 - Concrete blocks are to be placed on their sides in a single row around the perimeter of the inlet, with ends abutting. Openings in the blocks should face outward, not upward. ½ inch x ½ inch wire mesh shall then be placed over the outside face of the blocks covering the holes. Filter gravel shall then be piled against the wire mesh to the top of the blocks with the base of the stone being a minimum of 18 inches from the blocks.
 - Alternatively, where loose stone is a concern (streets, etc.), the filter gravel may be placed in appropriately sized filter fabric bags.
 - Periodically, when the gravel filter becomes clogged, the gravel must be removed and cleaned in a proper manner or replaced with new gravel and piled back against the wire mesh.
- Organic Filter Tube On-Grade Protection:
 - Organic filter tubes may be used to provide sediment control at on-grade curb inlets where the tube will not be a traffic hazard, such as on residential streets where the pavement adjacent to the curb is allocated to parked cars. Tubes should not be used in this manner where they will extend into an active travel lane.
 - The filter tube shall be secured in a U-shape by rock bags. Runoff flowing in the gutter will pond within the U until it filters through the tube or overflows around the end.
- Inlet protection shall be phased on curb inlets being constructed. Controls shall be installed on the pipe inlet at the bottom of the catch basin as soon as it is installed and while the inlet box and top are being formed or placed.

Area Inlet Protection

- Installation methods for protection on area inlets vary depending on the type of inlet (drop, "Y," or other) and the type and use of the surface surrounding the inlet (parking lot, playground, etc.). It is the responsibility of the designer to appropriately adapt inlet protection measures and their installation methods for each site condition. Several types may be needed on one project.
- Filter Fabric Protection:
 - Filter fabric protection is appropriate where the drainage area is less than one acre and the basin slope is less than five (5) percent. Filter fabric, posts, and wire mesh shall meet the material requirements specified in *Section 3.10 Silt Fence*.
 - A 6 inch wide trench is to be cut 6 inches deep at the toe of the fence to allow the fabric to be laid below the surface and backfilled with compacted earth or gravel. This entrenchment prevents any bypass of runoff under the fence.
 - Stone overflow structures, according to the criteria in *Section 3.10 Silt Fence* shall be installed where flow to the inlet is concentrated and more than 1 cubic feet per second.
- Excavated Impoundment Protection:
 - Excavated inlet protection is usually the most effective type of area inlet protection; however, it is only applicable to drop inlets. It should not be applied to Y inlets because it will undermine the concrete pad surrounding the inlet opening. Nor can it be used for inlets on pavement.

- With this protection method, it is necessary to install weep holes to allow the impoundment to drain completely.
- The impoundment shall be sized such that the volume of excavation is equal to or exceeds the runoff volume from the temporary control design storm (2-year, 24-hour) for the inlet's drainage area.
- The trap shall have a minimum depth of one foot and a maximum depth of 2 feet as measured from the top of the inlet and shall have side slopes of 2:1 or flatter.
- Block and Gravel Protection:
 - Block and gravel inlet protection is the most stable area inlet protection and can handle more concentrated flows. It may be installed on paved or vegetated surfaces. Loose stone shall be carefully removed from vegetated surfaces at the end of construction to prevent the stone from becoming a mowing hazard.
 - The inlet protection may be one or two blocks high. Single block heights are applicable for drainage areas up to 3 acres in size. The double block height shall be used for larger drainage areas.
 - Concrete blocks shall be standard 8 inch x 8 inch x 16 inch concrete masonry units and shall be in accordance with ASTM C139, Concrete Masonry Units for Construction. Filter gravel shall be ³/₄ inch washed stone containing no fines. Angular shaped stone is preferable to rounded shapes.
- Organic Filter Tube Protection:
 - Organic filter tubes may be used on paved or unpaved surfaces.
 - On paved surfaces, tubes shall be secured in place by rock bags. On unpaved surfaces, the tubes shall be embedded in the ground a minimum of 3 inches and staked at 4 foot spacing.
 - Designer shall provide calculations and specify the diameter of tube to be used based on the inlet's drainage area and the flow rate of runoff to the inlet. The minimum allowable diameter is 12 inches.

Proprietary Inlet Protection

- Numerous proprietary protection devices are available from commercial vendors. The devices often have the advantage of being reusable on several projects if they are maintained in good condition.
- It is the policy of this manual not to recommend any specific commercial vendors for proprietary controls. However, this subsection is included in order to provide municipalities with a rationale for approving the use of a proprietary inlet protection device within their jurisdiction.
- The designer shall work with the supplier to provide the municipality with flow calculations or independent third-party tests that document the device's performance for conditions similar to the ones in which it is proposed to be installed. The conditions that should be considered include: type and size of inlet, inlet configuration, size of contributing drainage area, design flow rate, soil particle sizes to be removed, and other pollutants to be removed.
- The designer or vendor of the proprietary device shall provide a minimum of three references for projects where the device has been installed and maintained in operation at a construction site for at least six months. Local references are preferred; but references from other regions can be accepted if a similarity between the reference project and the proposed application can be demonstrated.
- Proprietary devices must not completely block the inlet. The device shall have a minimum of a 2 inch wide opening for the length of the inlet when it will be used in areas that water can safely pond to depths deeper than the design depths for the inlet. If ponding is not an option, then the device must have overflow capacity equal to the inlet design flow rate.
- Some proprietary devices are available with replaceable pads or filters. These pads or filters have the added benefit or removing pollutants such as metals and oils in addition to removing sediment.

These types of inserts are recommended in applications where prior or current land use in or adjacent to the construction areas may result in the discharge of pollutants.

• Proprietary protection devices shall be in accordance with the General criteria at the beginning of this section and any criteria listed under Curb Inlet Protection and Area Inlet Protection that are not specific to an inlet protection method.

3.4.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.15 Inlet Protection.

3.4.5 Inspection and Maintenance Requirements

Inlet protection should be inspected regularly (at least as often as required by the TPDES Construction General Permit). Inlet controls should also be inspected after every storm event to check for collapse into the inlet or other damages that may block flow in the inlet. In addition to routine inspection, inlet protection devices should be observed and monitored during larger storm events to verify that they are not ponding or diverting water in a manner that floods a roadway or damages property.

Floatable debris and other trash caught by the inlet protection should be removed after each storm event. Sediment should also be removed from curb inlet protection after each storm event because of the limited storage area associated with curb inlets.

Sediment collected at area inlet protection should be removed before it reaches half the height of the protection device. Sediment should be removed from inlets with excavated impoundment protection before the volume of the excavation is reduced by 50 percent. In addition, the weep holes should be checked and kept clear of blockage.

Concrete blocks, 2 inch x 4 inch boards, stakes, and other materials used to construct inlet protection should be checked for damaged and repaired or replaced if damaged.


When filter fabric or organic filter tubes are used, they should be cleaned or replaced when the material becomes clogged. For systems using filter stone, when the filter stone becomes clogged with sediment, the stones must be pulled away from the inlet and cleaned or replaced.


Because of the potential for inlet protection to divert runoff or cause localized flooding, remove inlet protection as soon as the drainage area contributing runoff to the inlet is stabilized. Ensure that all inlet protection devices are removed at the end of the construction.

3.4.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

The schematics are **not for construction**. They may serve as a starting point for creating a construction detail, but they must be site adapted by the designer. In addition, dimensions and notes appropriate for the application must be added by the designer.

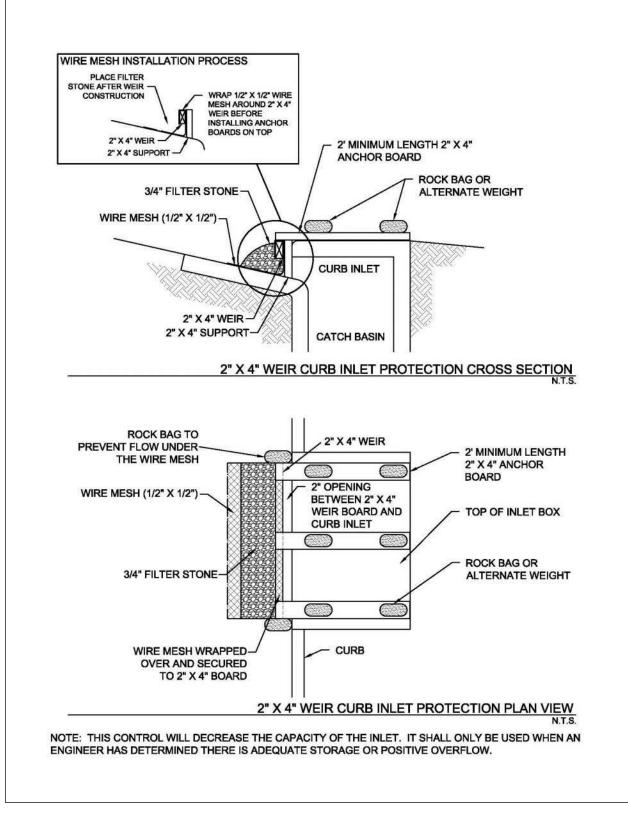

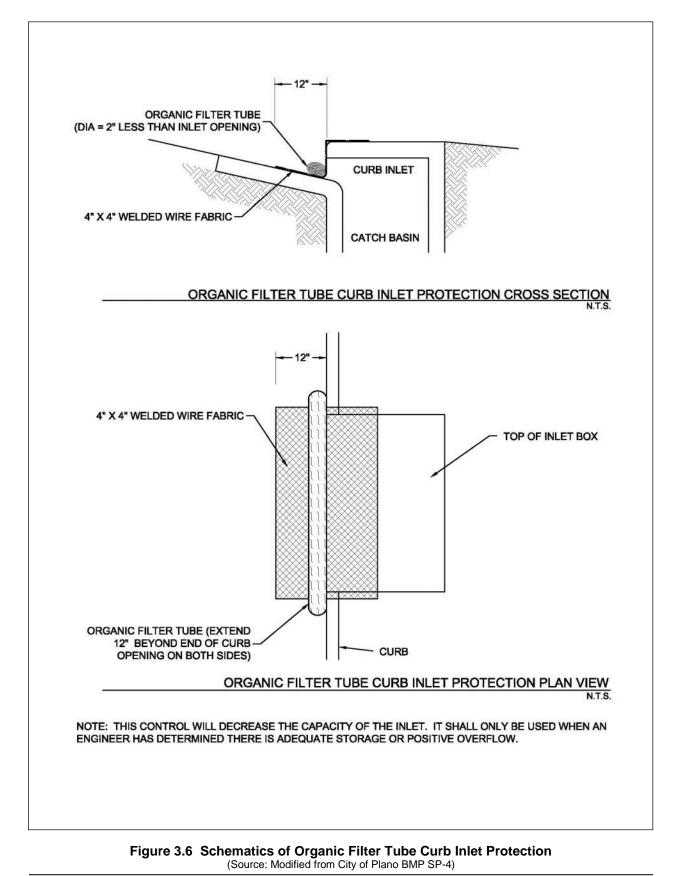

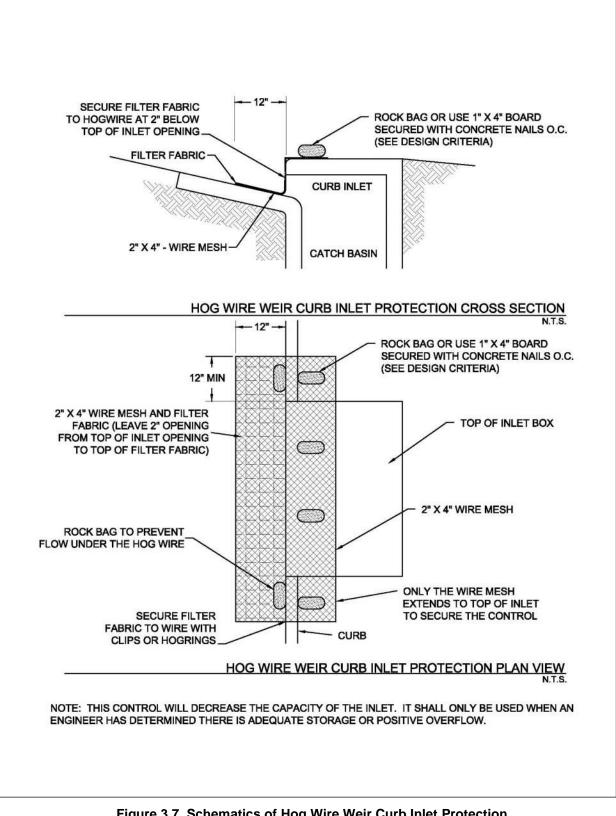


Figure 3.7 Schematics of Hog Wire Weir Curb Inlet Protection (Source: Modified from City of Round Rock Detail E-03)

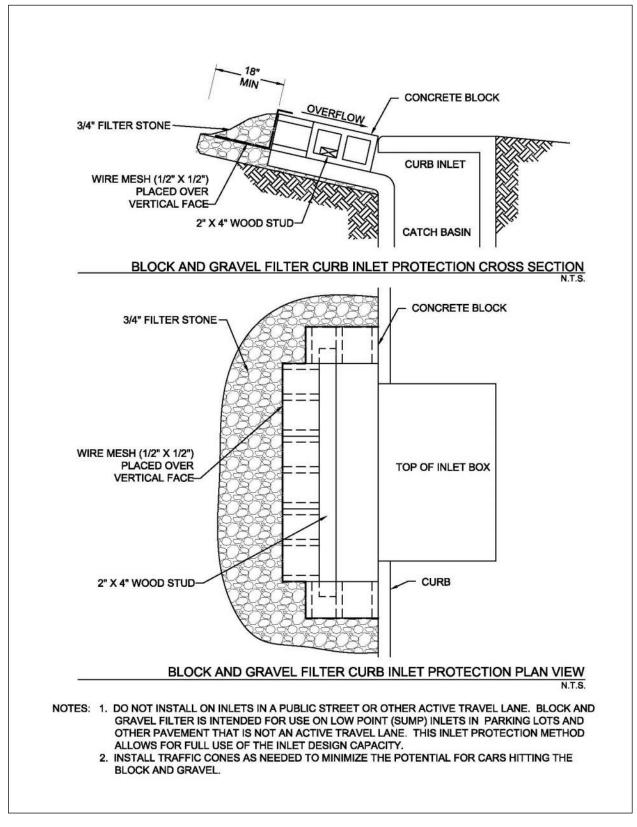


Figure 3.8 Schematics of Block and Gravel Filter Curb Inlet Protection

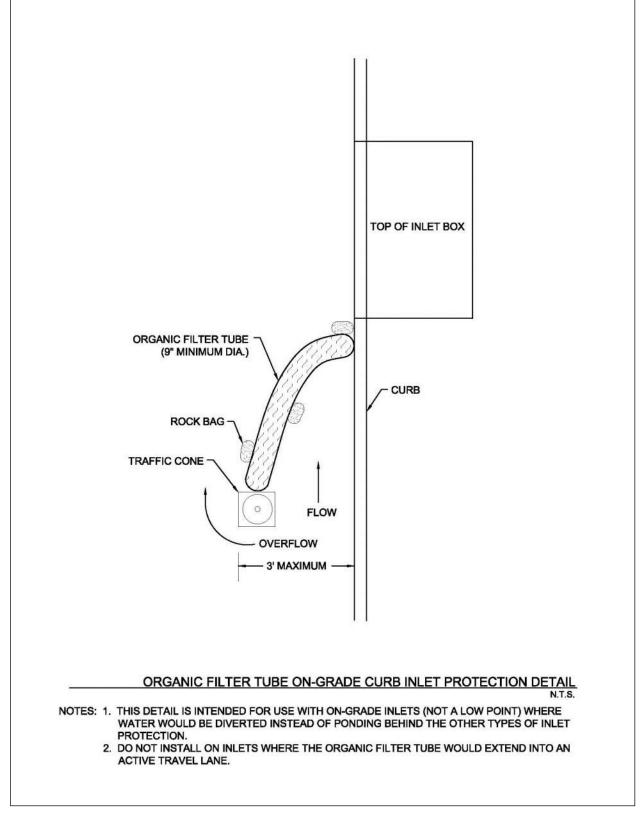


Figure 3.9 Schematic of Organic Filter Tube On-Grade Curb Inlet Protection

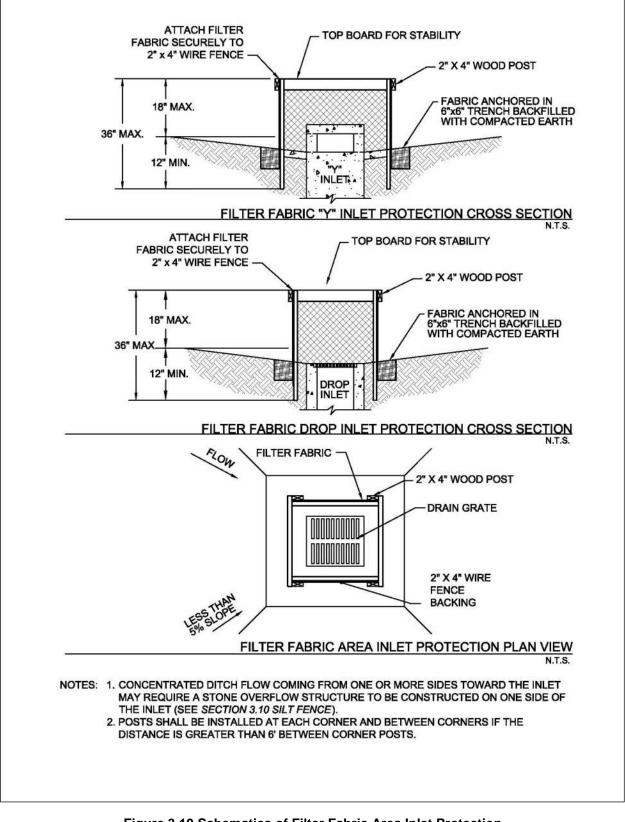


Figure 3.10 Schematics of Filter Fabric Area Inlet Protection

(Source: City of Plano BMP SP-4)

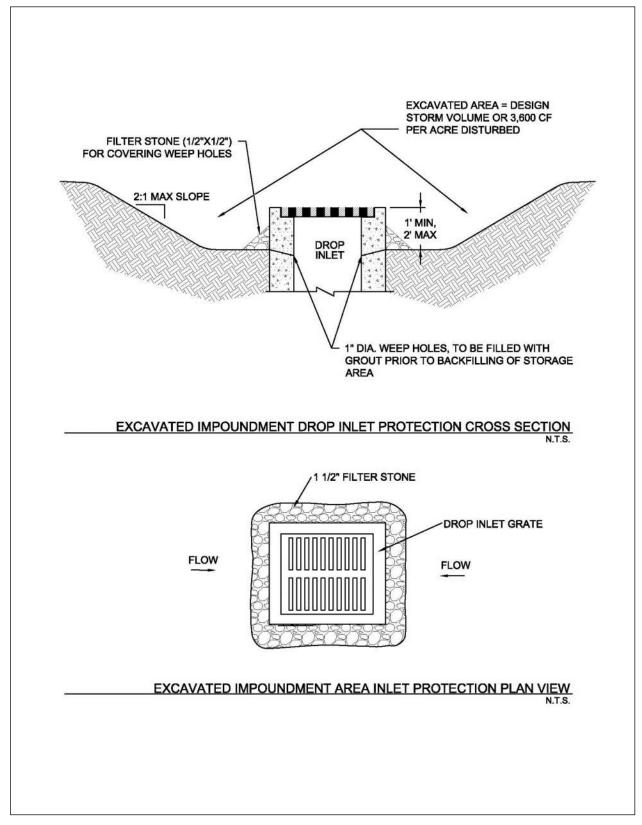


Figure 3.11 Schematics of Excavated Impoundment Area Inlet Protection

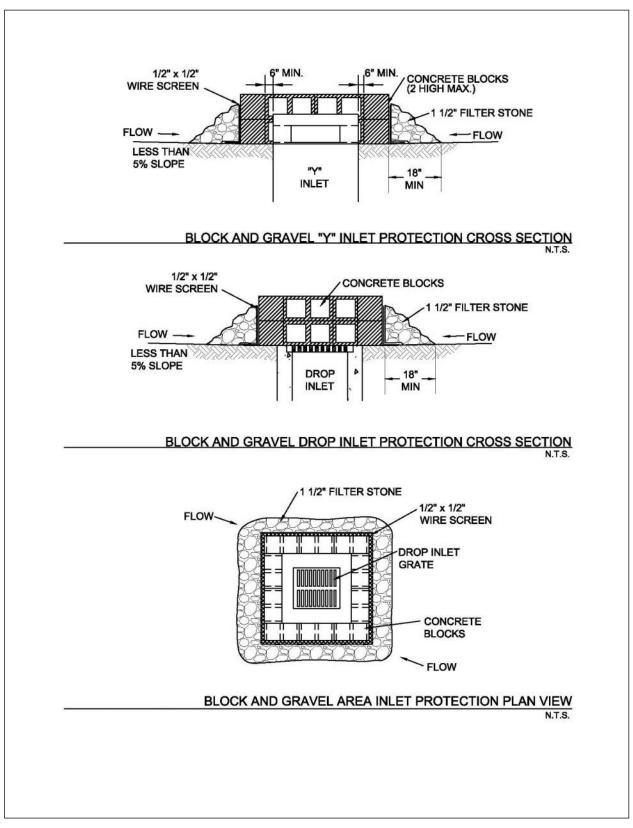


Figure 3.12 Schematics of Block and Gravel Area Inlet Protection (Source: Modified from City of Plano BMP SP-4)


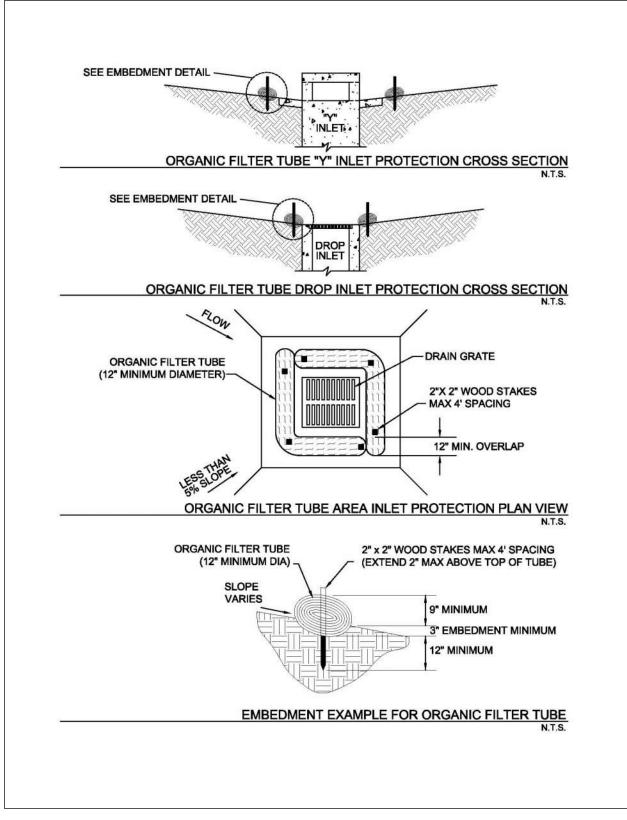


Figure 3.13 Schematics of Organic Filter Tube Area Inlet Protection

3.5 Organic Filter Berm

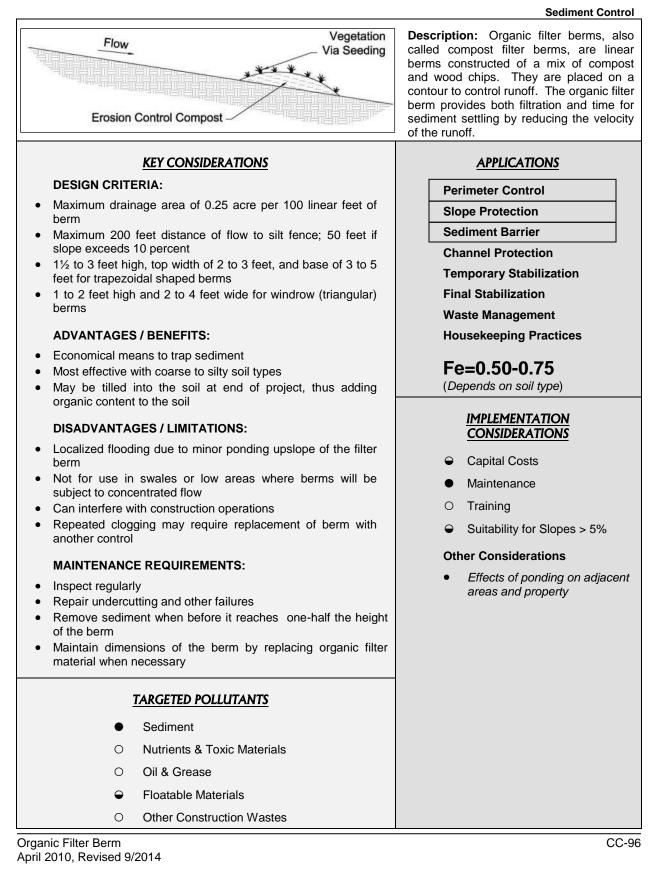

3.5.1 Primary Use

Organic filter berms are used as perimeter controls down slope of disturbed areas and on side slopes where stormwater may runoff the area. They are very well suited to sites with small disturbed drainage areas that are not subjected to concentrated flows and that will ultimately be seeded, sodded, or landscaped.

3.5.2 Applications

Properly designed, the organic filter berm is economical due to the ease of installation and because it can be tilled into the soil at the end of project, limiting the cost of removal and adding to the organic content of the soil. The berms are used as perimeter control devices for both development sites and linear (roadway) type projects. They are most effective with coarse to silty soil types. Additional controls, such as a passive treatment system, may be needed to remove fine silts and clay soils suspended in stormwater.

3.5.3 Design Criteria

- Filter berms are to be constructed along a line of constant elevation (along a contour line) where possible.
- Berms can interfere with construction operations; therefore planning of access routes onto the site is critical.
- Maximum drainage area shall be 0.25 acre per 100 linear feet of filter berm.
- Maximum flow to any 20 foot section of filter berm shall be 1 cubic feet per second.
- Maximum distance of flow to berm shall be 200 feet or less. If the slope exceeds 10 percent the flow distance shall be less than 50 feet.
- Maximum slope adjacent to the filter berm shall be 4:1.
- Trapezoidal shaped berms should be 1½ to 3 feet high with a top width of 2 to 3 feet and a base of 3 to 6 feet wide.
- Windrow (triangular) shaped berms should be 1 to 2 feet high and 2 to 4 feet wide.
- Berm side slopes shall be 2:1 or flatter.
- Roughen the soil surface before placing the berm to increase adherence of the compost.
- Compost shall conform to the requirements for Erosion Control Compost in Item 161 of the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT 2004).
- Organic filter berms should be stabilized by seeding if there are no other sediment controls down slope of the filter berm. Seeding shall be as specified in *Section 2.9 Vegetation* at a seed loading of 1 lb. per 10 linear feet for small berms (1ft. by 2 ft.) or 2.25 lbs per 10 linear ft. for larger berms (1.5 ft. by 3 ft.)

3.5.4 Design Guidance and Specifications

Specifications for Erosion Control Compost to be used as filter material may be found in Item 161 of the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT 2004).

3.5.5 Inspection and Maintenance Requirements

Filter berms should be inspected regularly (at least as often as required by the TPDES Construction General Permit) for buildup of excess sediment, undercutting, and other failures. Silt must be removed

when before it reaches half the height of the berm. Silt may be raked from the disturbed side of the device to clean side the berm for the first few times that it becomes clogged to prevent ponding. Repeated clogging of the berm at one location will require replacement of the organic filter material or may require installation of another control to prevent failure of the berm.

Dimensions of the berm must be maintained by replacing organic filter material when necessary. Typically excess material is stockpiled onsite for repairs to berms disturbed by construction activity.

There shall be no signs of erosion, breeching or runoff around or under the berm.

3.5.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

The schematics are **not for construction**. They may serve as a starting point for creating a construction detail, but they must be site adapted by the designer. In addition, dimensions and notes appropriate for the application must be added by the designer.


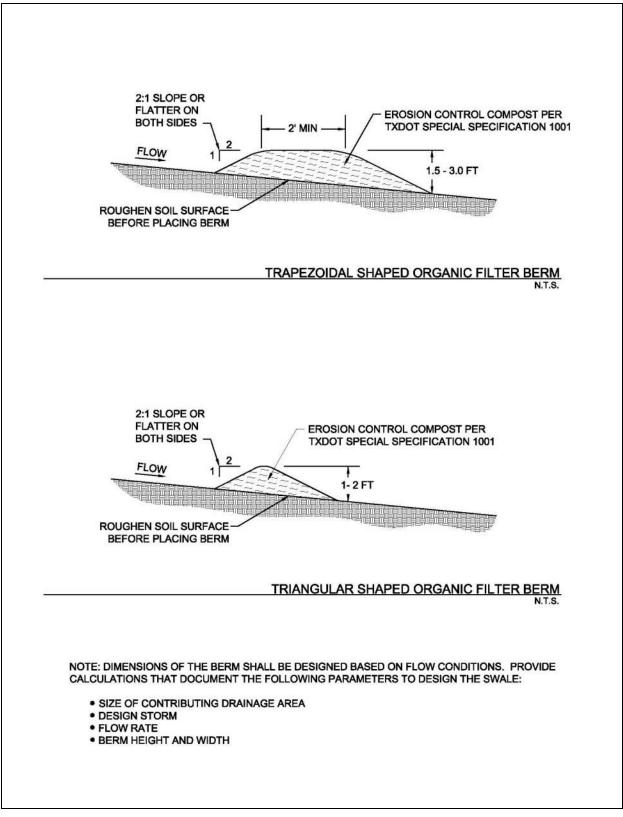


Figure 3.14 Schematics of Organic Filter Berm

3.6 Organic Filter Tubes

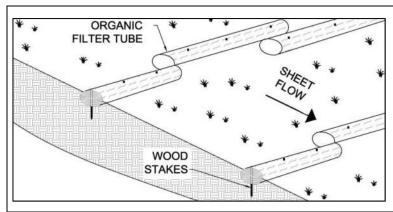

KEY CONSIDERATIONS

DESIGN CRITERIA:

- Tube diameter when filled shall be specified on the plans
- 3 inch minimum embedment in soil
- 18 inch minimum overlap at ends of tubes
- Spacing based on drainage area and slope
- Must be staked on soil and secured with rockbags on pavement
- Turn ends of tube lines upslope a minimum of 10 feet

ADVANTAGES / BENEFITS:

- Effective means to treat sheet flow over a short distance
- Relatively easy to install
- May be used on steep slopes
- Can provide perimeter control on paved surfaces or where soil type prevents embedment of other controls
- Work well as perimeter controls around stockpiles

DISADVANTAGES / LIMITATIONS:

- Difficult to remove when wet and/or filled with sediment
 - Relatively small effective areas for sediment capture

MAINTENANCE REQUIREMENTS:

• Inspect regularly

•

- Repair eroded areas underneath the organic filter tubes
- Re-align and stake tubes that are dislodged by flow
- Remove sediment before it reaches half the height of the exposed tube

TARGETED POLLUTANTS

- Sediment
- O Nutrients & Toxic Materials
- Oil & Grease
- O Floatable Materials
- O Other Construction Wastes

Description: Organic filter tubes are comprised of an open weave, mesh tube that is filled with a filter material (compost, wood chips, straw, coir, aspen fiber, or a mixture of materials). The tube may be constructed of geosynthetic material, plastic, or natural materials. Organic filter tubes are also called fiber rolls, fiber logs, wattles, mulch socks, and/or coir rolls. Filter tubes detain flow and capture sediment as linear controls along the contours of a slope or as a perimeter control down-slope of a disturbed area.

APPLICATIONS

Perimeter Control

Slope Protection

Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=0.50-0.75

(Depends on soil type)

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- Maintenance
- O Training
- Suitability for Slopes > 5%

Other Considerations:

• None

Sediment Control

3.6.1 Primary Use

Organic filter tubes are long, flexible controls that are used along a line of constant elevation (along a contour) on slopes. They are used as perimeter controls down slope of disturbed areas, around temporary stockpiles and on side slopes where stormwater may runoff the area. The tubes maintain sheet flow, slow velocities, and capture sediment. When used in series on slopes, they also shorten the slope length and protect the slope from erosion.

3.6.2 Applications

Organic filter tubes include a wide variety of tube and filter materials. Organic filter tubes are used as a perimeter sediment barrier, similar to silt fence, for development projects and linear projects, such as roadways and utilities. They work well on individual residential lots and on lots being re-developed, where space may be limited. Organic filter tubes are most effective with coarse to silty soil types. Additional controls may be needed to remove fine silts and clay soils suspended in stormwater.

Organic filter tubes can be used on paved surfaces where it's not possible to stake a silt fence. Applications on paved surfaces include perimeter controls for soil stockpiles, pavement repair areas, utility trenching, and building demolition. When compost filter material is used in tubes on pavement, the material has the added benefit of removing some oil and grease from stormwater runoff.

Applications on slopes include temporary sediment control during construction and erosion control of the disturbed soil on the slope. Organic filter tubes may be used to control sheet flow on slopes when final stabilization measures are being applied and established.

Organic filter tubes may also be used for inlet protection and, in limited cases, as check dams in small drainage swales. Refer to *Section 3.4 Inlet Protection* and *Section 2.1 Check Dam* for the design criteria to use organic filter tubes in these applications.

3.6.3 Design Criteria

General Criteria

- Filter tubes should be installed along the contour.
- Tubes shall be staked with 2 inch by 2 inch wooden stakes at a maximum spacing of 4 feet. Rebar or similar metal stakes may be used instead of wooden stakes.
- When placed on pavement, sand or rock bags shall be placed abutting the down-slope side of the tubes to prevent runoff from dislodging the tubes. At a minimum, bags shall be placed one foot from each end of the tube and at the middle of the tube.
- Filter tubes shall be embedded a minimum of three inches when placed on soil. Placement on rock shall be designed as placement on pavement.
- The end of tubes shall overlap a minimum of 18 inches when multiple tubes are connected to form a linear control along a contour or a perimeter.
- Loose mulch material shall be placed against the log on the upstream side to facilitate contact with the ground.
- The last 10 feet (or more) at the ends of a line of tubes shall be turned upslope to prevent bypass by stormwater. Additional upslope lengths of tubes may be needed every 200 to 400 linear feet, depending on the traverse slope along the line of tubes.
- The most common sizes of tubes are 6 to 24 inches in diameter; however, tubes are available in sizes as small as 4 inches and up to 36 inches in diameter. The designer shall specify a diameter based on the site application. Tubes less than 8 inches in diameter when filled will require more frequent maintenance if used.

- Manufactured organic filter tube products shall have documentation of a minimum 75 percent soil retention using ASTM D7351 Standard Test Method for Determination of Sediment Retention Device Effectiveness in Sheet Flow Applications.
- When using manufactured tubes, the manufacturer's recommendations for diameter and spacing based on slope, flow velocities, and other site conditions shall be followed when they are more stringent than the design criteria in this section.
- When used as a perimeter control on grades of 10:1 or less, criteria in the following table shall be used as a guide for the size and installation rate of the organic filter tube.

Table 3.1 Perimeter Control A	pplications*	
Drainage Area (Max)	Max Flow Length to the Tube	Tube Diameter (Min)
1/3 Acre per 100 feet	145 feet	18 inches
1/4 Acre per 100 feet	110 feet	15 inches
1/5 Acre per 100 feet	85 feet	12 inches
1/8 Acre per 100 feet	55 feet	9 inches

(Source: Modified and expanded from City of Plano Fact Sheet SP-13) *Applicable on grades of 10:1 or flatter.

• When installing organic filter tubes along contours on slopes, criteria in the following table shall be used as a general guide for size and spacing of the tubes. Actual tube diameter and spacing shall be specified by the designer. The designer shall consider the tube manufacturers recommendations, the soil type, flow volume on the slope, required performance life, and erosion control measures that may be used in conjunction with the tubes.

Table 3.2 Maximum S	pacing for Slope Pro	otection		
		Tube Diam	eter (Min)	
Slope (H:V)	9 Inches	12 Inches	18 Inches	24 Inches
5:1 to 10:1	35 feet	40 feet	55 feet	60 feet
4:1	30 feet	40 feet	50 feet	50 feet
3:1	25 feet	35 feet	40 feet	40 feet
2:1	20 feet	25 feet	30 feet	30 feet
1:1	10 feet	15 feet	20 feet	20 feet

(Source: Modified and expanded from Iowa Statewide Urban Design and Specifications Standards for Filter Socks)

Tube Material

- The designer shall specify the type of mesh based on the required life of the tube. At a minimum, the mesh shall have a rated life of one year under field conditions.
- If the tubes will be left onsite as part of the final stabilization, they must be constructed of 100 percent biodegradable jute, coir, sisal or similar natural fiber or 100 percent UV photodegradable plastic, polyester or geosynthetic material.
- Mesh tubes may be oval or round in cross-section.
- Mesh for the tubes shall be open and evenly woven. Size of weave openings shall be specified based on filter material. Openings may range from ½ inch for Erosion Control Compost to 2 inches for straw and coir.
- Mesh openings should not exceed 1/2 inch in diameter.

Filter Material

- Different filter materials have different properties and will affect sheet flow differently. The designer shall specify the type of material to be used (or excluded) on a particular site.
- Straw filter material shall be Certified Weed Free Forage. The straw must be in good condition, airdried, and not rotten or moldy.
- Compost shall conform to the requirements for Erosion Control Compost in Item 161 of the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT 2004).
- Compost may provide some oil and grease removal; however, the large percentage of fines in compost will result in less filtering and more ponding of stormwater.
- Wood chips shall be 100 percent untreated chips and free of inorganic debris, such as plastic, glass, metal, etc. Wood chip size shall not be smaller than 1 inch and shall not exceed 3 inches in diameter. Shavings shall not be more than 5% of the total mass.

3.6.4 Design Guidance and Specifications

Specifications for Erosion Control Compost to be used as filter material may be found in Item 161 of the Standard Specifications for Construction and Maintenance of Highways, Streets, and Bridges (TxDOT 2004).

3.6.5 Inspection and Maintenance Requirements

Organic filter tubes should be inspected regularly (at least as often as required by the TPDES Construction General Permit). The filter tube should be checked to ensure that it is in continuous contact with the soil at the bottom of the embedment trench. Closely check for rill erosion that may develop under the filter tubes. Eroded spots must be repaired and monitored to prevent reoccurrence. If erosion under the tube continues, additional controls are needed.

Staking shall be checked to ensure that the filter tubes are not moving due to stormwater runoff. Repair and re-stake slumping filter tubes. Tubes that are split, torn or unraveling shall be repaired or replaced.

Check the filter tube material to make sure that it has not become clogged with sediment or debris. Clogged filter tubes usually lead to standing water behind the filter tube after the rain event. Sediment shall be removed from behind the filter tube before it reaches half the height of the exposed portion of the tube.

When sediment control is no longer needed on the site, the tubes may be split open and the filter material may be used for mulching during establishment of vegetation for final stabilization if it meets the criteria in *Section 2.5 Mulching*.

3.6.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

The schematics are **not for construction**. They may serve as a starting point for creating a construction detail, but they must be site adapted by the designer. In addition, dimensions and notes appropriate for the application must be added by the designer.

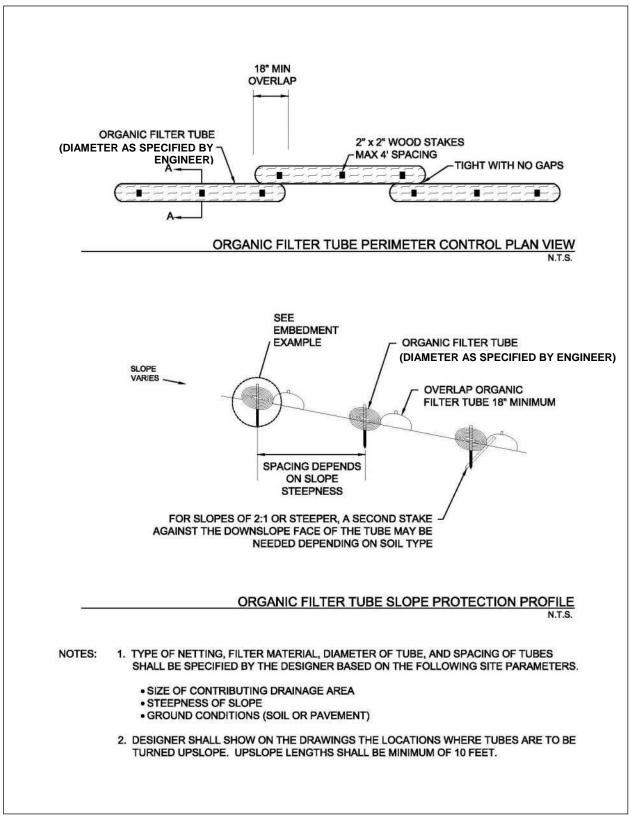


Figure 3.15 Schematics of Organic Filter Tubes


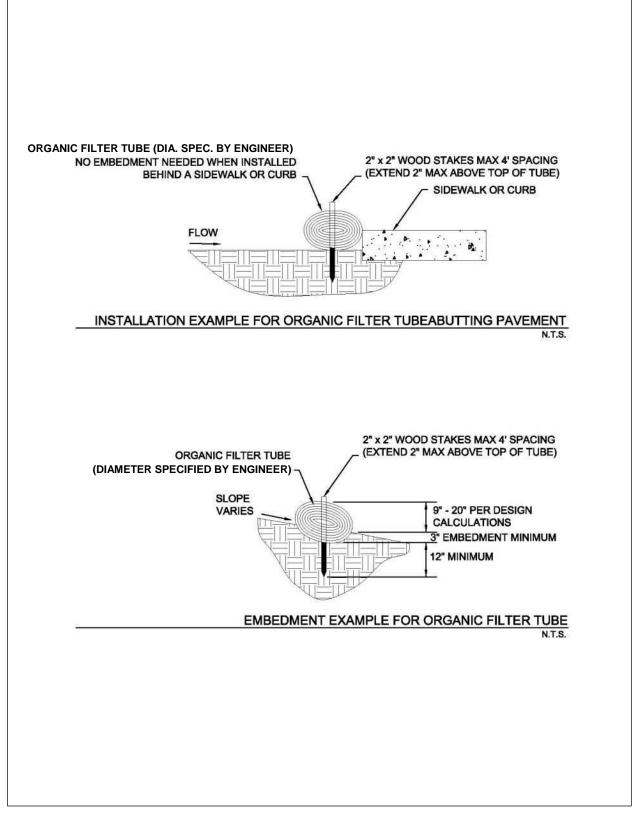


Figure 3.16 Examples of Organic Filter Tube Installation Methods

3.9 Sediment Basin

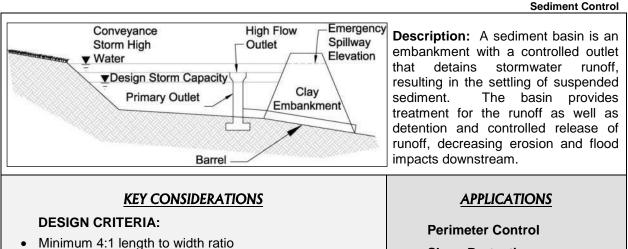

- Maximum embankment height and storage capacity limited by TCEQ requirements
- Minimum dewatering time of 36 hours
- Safely pass 25-year, 24-hour storm event without structure damage

ADVANTAGES / BENEFITS:

- Effective at removing suspended sand and loam
- May be both a temporary and permanent control
- Can be used in combination with passive treatment

DISADVANTAGES / LIMITATIONS:

- Effectiveness depends on type of outlet
- Limited effectiveness in removing fine silt and clay
- May require a relatively large portion of the site
- Storm events that exceed the design storm event may damage the structure and cause downstream impacts

MAINTENANCE REQUIREMENTS:

- Inspect regularly
- Remove obstructions from discharge structures
- Remove sediment and re-grade basin when storage capacity reduced by 20 percent

TARGETED POLLUTANTS

- Sediment
- Nutrients & Toxic Materials
- O Oil & Grease
- Floatable Materials
- O Other Construction Wastes

Slope Protection

Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=0.50-0.90

(Depends on soil type)

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- Maintenance
- Training
- Suitability for Slopes > 5%

Other Considerations:

- Public safety
- Mosquito breeding habitat
- Requires comprehensive planning and design

3.9.1 Primary Use

Sediment basins should be used for all sites with adequate open space for a basin and where the site topography directs a majority of the site drainage to one point. Sediment basins are necessary as either temporary or permanent controls for sites with disturbed areas of 10 acres and larger that are part of a common drainage area unless specific site conditions limit their use.

3.9.2 Applications

Sediment basins serve as treatment devices that can be used on a variety of project types. They are normally used in site development projects in which large areas of land are available for the basin, a minor stream or off-line drainage way crosses the site, or a specific water feature is planned for the site. Sediment basins are highly effective at reducing sediment and other pollutants for design storm conditions. Sediment basins are typically easier to maintain than other structural controls (e.g. silt fences, etc).

A sediment basin by itself does not typically remove a sufficient percentage of fine silts and clays to be an effective sediment barrier. Table 3.3 provides a summary of sediment basin effectiveness based on soil type.

Table 3.3 Sedime	nt Basin Effectivene	ess for Different Soil	Types	
Soil Type	Runoff Potential	Settling Rate	Sediment Basin Effectiveness	Efficiency Rating (Fe)
Sand	Low	High	High	0.90
Sandy Loam	Low	High	High	0.90
Sandy Silt Loam	Moderate	Moderate	Moderate	0.75
Silt Loam	Moderate	Moderate	Moderate	0.75
Silty Clay Loam	Moderate	Low	Low	0.75
Clay Loam	Great	Low	Low	0.50
Clay	Great	Low	Low	0.50

(Source: Michigan Department of Environmental Quality Soil Erosion and Sedimentation Control Training Manual)

When the disturbed area contains a high percentage of fine silt or clay soil types, the sediment basin may be used with a passive or active treatment system to remove these finer suspended solids. Design criteria may be found in *Section 3.1 Active Treatment System* and *Section 3.7 Passive Treatment System*.

3.9.3 Design Criteria

Texas Administrative Code Title 30, Chapter 299 (30 TAC 299), Dams and Reservoirs, contains specific requirements for dams that:

- Have a height greater than or equal to 25 feet and a maximum storage capacity greater than or equal to 15 acre-feet; or
- Have a height greater than six feet and a maximum storage capacity greater than or equal to 50 acre feet.

If the size of the detention basin meets or exceeds the above applicability, the design must be in accordance with state criteria, and the final construction plans and specifications must be submitted to the TCEQ for review and approval.

The following design criteria are for temporary sediment basins that are smaller than the TCEQ thresholds. The sediment basin shall be designed by a licensed engineer in the State of Texas. The criteria and schematics are the minimum and, in some cases, only concept level. It is the responsibility of the engineer to design and size the embankment, outfall structures, overflow spillway, and downstream

energy dissipaters and stabilization measures. Alternative designs may be acceptable if submitted to the reviewing municipality with supporting design calculations.

Sediment Basin Location and Planning

- Design of the sediment basin should be coordinated with design of the permanent drainage infrastructure for the development.
- The basin shall not be located within a mapped 100-year floodplain unless its effects on the floodplain are modeled, and the model results are approved by the reviewing municipality.
- Basins shall not be located on a live stream that conveys stormwater from upslope property through the construction site.
- Basins may be located at the discharge point of a drainage swale that collects runoff from construction activities, or the basin may be located off-channel with a swale or dike constructed to divert runoff from disturbed areas to the basin. Design criteria for these controls are in Section 2.2 Diversion Dike and Section 2.4 Interceptor Swale.
- Sediment basins must be designed, constructed, and maintained to minimize mosquito breeding habitats by minimizing the creation of standing water.
- Temporary stabilization measures should be specified for all areas disturbed to create the basin.

Basin Size

- Minimum capacity of the basin shall be the calculated volume of runoff from a 2-year, 24-hour duration storm event plus sediment storage capacity of at least 1,000 cubic feet.
- The basin must be laid out such that the effective flow length to width ratio of the basin is a minimum of 4:1. Settling efficiencies are dependent on flow velocity, basin length, and soil type. Smaller particle sizes require slower velocities and longer basins. Basin dimensions should be designed based on flow velocities and anticipated particle sizes.
- Stoke's equation for settling velocities, as modified to Newton's equation for turbulent flow, may be used to estimate length required based on depth of the basin.

Settling Velocity (ft/s) = 1.74 $[(\rho_{p} - \rho)gd/\rho]^{1/2}$ (3.1)

Where:

- ρ_{p} = density of particles (lb/ ft³)
- ρ = density of water (lb/ft³)
- g = gravitational acceleration (ft/s^2)
- d = diameter of particles (ft)
- The effective length of sediment basins may be increased with baffles. Baffles shall be spaced at a minimum distance of 100 feet. Spacing should be proportional to the flow rate, with greater spacing for higher flow rates. Check the flow velocity in the cross section created by the baffles to ensure settling will occur.
- Baffles may be constructed by using excavated soil to create a series of berms within the basin; however, porous baffles are recommended. Porous baffles may consist of coir fiber, porous geotextiles, porous turbidity barriers, and similar materials. Porous materials disrupt the flow patterns, decrease velocities, and increase sedimentation.
- Basins have limited effectiveness on suspended clay soil particles. The basin's length to width ratio typically should be 10:1 to effectively remove suspended clay particles. The use of passive treatment systems can significantly reduce this ratio and improve removal rates. Criteria are in *Section 3.7 Passive Treatment System*.

Embankment

- Top width shall be determined by the engineer based on the total height of the embankment as measured from the toe of the slope on the downstream side.
- Embankment side slopes shall be 3:1 or flatter.
- The embankment shall be constructed with clay soil, minimum Plasticity Index of 30 using ASTM D4318 Standard Test for Liquid Limit, Plastic Limit, and Plasticity Index of Soils.
- Clay soil for the embankment shall be placed in 8 inch lifts and compacted to 95 percent Standard Proctor Density at optimum moisture content using ASTM D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort.
- The embankment should be stabilized with rock riprap or temporary vegetation.

Outlet and Spillway

- The primary outlet shall have a minimum design dewatering time of 36 hours for the temporary control design storm (2-year, 24-hour).
- Whenever possible, the outlet shall be designed to drain the basin in less than 72 hours to minimize the potential for breeding mosquitoes.
- The basin's primary outlet and spillway shall be sized to pass the difference between the conveyance storm (25-year, 24-hour) and the temporary control design storm without causing damage to the embankment and structures.
- Unless infeasible, the primary outlet structure should withdraw water from the surface of the impounded water. Outlet structures that do this include surface skimmers, solid risers (non-perforated), flashboard risers, and weirs.
- Surface skimmers use a floating orifice to discharge water from the basin. Skimmers have the advantage of being able to completely drain the detention basin. Skimmers typically result in the greatest sediment removal efficiency for a basin, because they allow for a slower discharge rate than other types of surface outlets. Due to this slower discharge rate, a high flow riser may still be needed to discharge the conveyance storm if a large enough spillway is not feasible due to site constraints.
- Discharge rates for surface skimmers are dependent on the orifice configuration in the skimmer. Use manufacturer's flow rate charts to select the skimmer based on the flow rate needed to discharge the design storm from the basin within a selected time period (i.e. Q=Volume/time).
- Risers shall be designed using the procedures in *Section 3.9.7 Design Procedures*.
- Weir outlets should be designed using the guidance in Section 2.2.2 of the Hydraulics Technical Manual.
- Use of overflow risers and weirs result in a pool of water that should be accounted for in the design capacity of the basin. These outlet structures are good options when the temporary sediment basin will be retained as a permanent site feature upon completion of construction. If the basin is temporary and standing water is not acceptable during construction, the construction plans shall include procedures for dewatering the basin following criteria in *Section 3.3 Dewatering Controls*.
- Flashboard risers function like an overflow riser pipe, but they contain a series of boards that allow for adjustment of the pool level. The boards may be removed for draining the basin to a lower level. However, this operation can be difficult and a safety hazard when done manually.
- A perforated riser may be used as an outlet when surface discharge is not feasible. A perforated rise has the advantage of dewatering the basin; however, it also results in the lowest sediment removal efficiency. Perforated risers provide a relatively rapid drawdown of the pool, and they discharge water from the entire water column, resulting in more suspended sediment being discharged than with a surface outlet.

- Size and spacing of the orifices on a perforated riser shall be designed to provide the minimum detention time while allowing for the drawdown of detained water.
- Gravel (1½ to 3 inches) may be placed around the perforated riser to aid sediment removal, particularly the removal of fine soil particles, and to keep trash from plugging the perforations. The gravel is most effective when the basin will be used for less than a year. When installed for longer periods of time, the gravel may become clogged with fine sediments and require cleaning while submerged.
- The outlet of the outfall pipe (barrel) shall be stabilized with riprap or other materials designed using the conveyance storm flow rate and velocity. Velocity dissipation measures shall be used to reduce outfall velocities in excess of 5 feet per second.
- The outfall pipe through the embankment shall be provided with anti-seep collars connected to the exterior of the pipe section or at a normal joint of the pipe material. The anti-seep collar material shall be compatible with the pipe material used and shall have a watertight bond to the exterior of the pipe section. The size and number of collars shall be selected by the designer in accordance with the following formula and table:

Collar Outside Dimension = X + Diameter of pipe in feet

Example: Pipe Length = 45 feet Barrel Pipe Diameter = 12 inches = 1 foot 2 anti-seep collars

> Anti-seep Collar Dimensions: 3.4 feet (from table) + 1.0 foot (Pipe dia.) = 4.4 feet Use 2 anti-seep collars each being 4.4 feet square or 4.4 feet diameter if round.

		X Value	es - Feet	
Pipe Length		Number of Ar	nti-Seep Collars	
	1	2	3	4
40	6.0	3.0		
45	6.8	3.4		
50	7.5	3.8	2.5	
55		4.2	2.8	
60		4.5	3.0	
65		4.9	3.3	
70		5.3	3.5	2.6
75		5.6	3.8	2.8
80		6.0	4.0	3.0

- Risers used to discharge high flows shall be equipped with an anti-vortex device and trash rack.
- Spillways shall be constructed in undisturbed soil material (not fill) and shall not be placed on the embankment that forms the basin.

3.9.4 Design Guidance and Specifications

Design guidance for temporary sediment basins is in *Section 3.9.7 Design Procedures*. Criteria for sediment basins that will become permanent detention basins are in *Section 3.6.3 of the iSWM Criteria Manual*. Additional design guidance for different types of outlet structures is in *Section 2.2 of the Hydraulics Technical Manual*.

No specification for construction of this item is currently available in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments.

3.9.5 Inspection and Maintenance Requirements

Sediment basins should be inspected regularly (at least as often as required by the TPDES Construction General Permit) to check for damage and to insure that obstructions are not diminishing the effectiveness of the structure. Sediment shall be removed and the basin shall be re-graded to its original dimensions when the sediment storage capacity of the impoundment has been reduced by 20 percent. The removed sediment may be stockpiled or redistributed onsite in areas that are protected by erosion and sediment controls.

Inspect temporary stabilization of the embankment and graded basin and the velocity dissipaters at the outlet and spillway for signs of erosion. Repair any eroded areas that are found. Install additional erosion controls if erosion is frequently evident.

3.9.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

The schematics are **not for construction**. Dimensions of the sediment basin, embankment, and appurtenances shall be designed by an engineer licensed in the State of Texas. Construction drawings submitted to the municipality for review shall include, but are not limited to, the following information and supporting calculations.

- Embankment height, side slopes and top width.
- Dimensions of the skimmer, riser, weir or other primary outlet.
- Diameter of outfall pipe (barrel).
- Pool elevation for the temporary control design storm and conveyance storm.
- Outfall pipe flow rate and velocity for the temporary control design storm and conveyance storm.
- Spillway cross section, slope, flow rate, and velocity for the conveyance storm.
- Depth, width, length, and mean stone diameter for riprap apron or other velocity dissipation device at the outfall pipe and spillway discharge points.

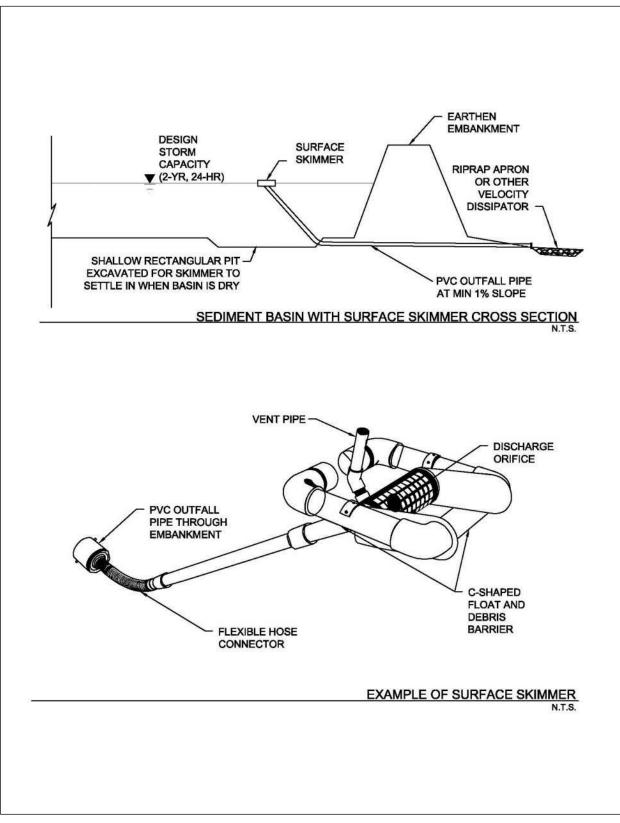


Figure 3.19 Schematics of Sediment Basin with Surface Skimmer (Source: J.W. Faircloth & Son, Inc.)

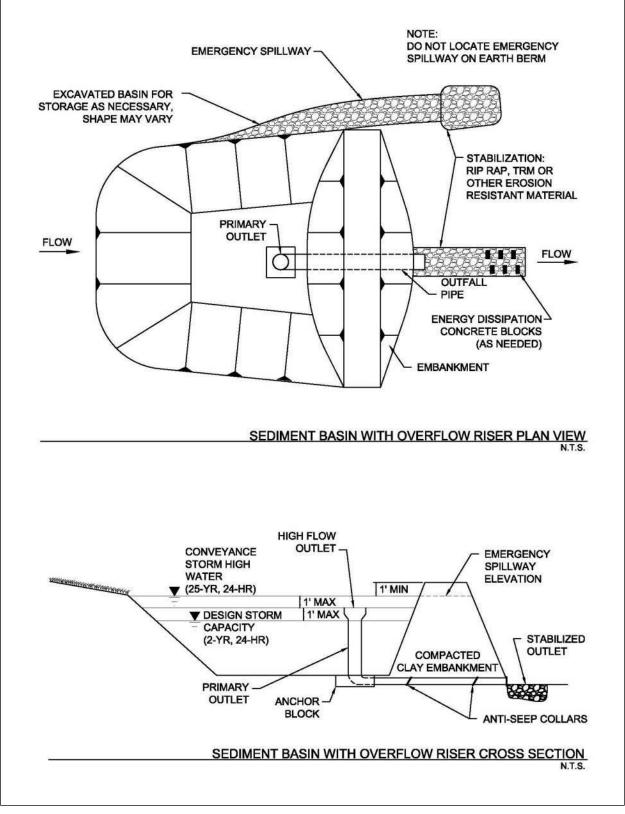


Figure 3.20 Schematics of Sediment Basin with Overflow Riser

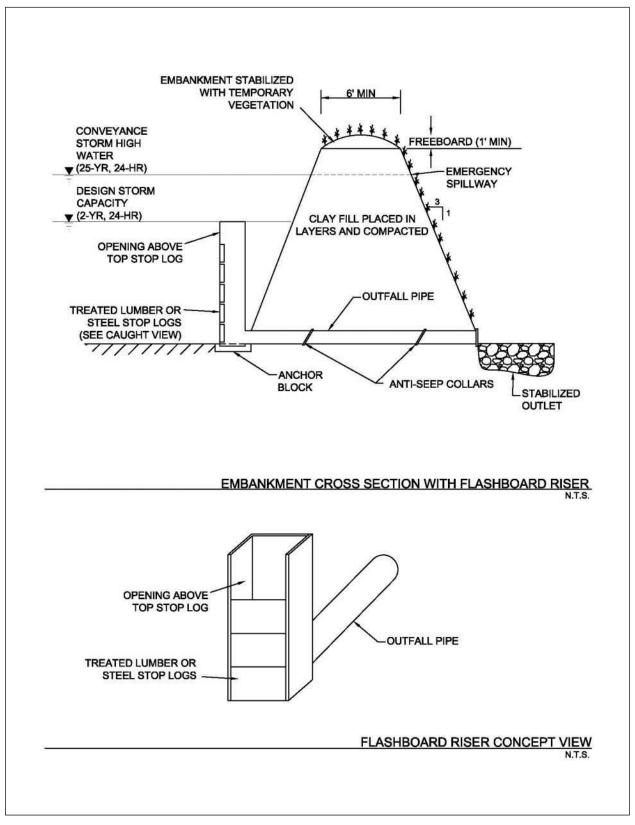


Figure 3.21 Schematics of Basin Embankment with Flashboard Riser

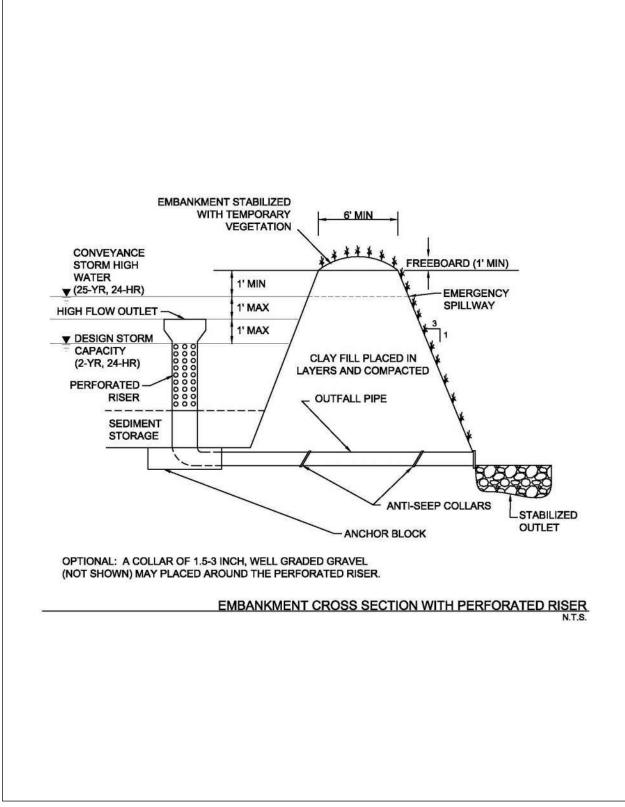


Figure 3.22 Schematic of Basin Embankment with Perforated Riser

3.9.7 Design Procedures

The following procedures provide a step-by-step method for the design of a temporary sediment basin that is smaller than the TCEQ thresholds for state requirements to apply. Criteria in *Section 3.8 of the iSWM Criteria Manual* should be used for the design of permanent basins (dry detention/extended dry detention) and stormwater ponds. *Section 3.9.8 Design Form* should be used to document the design values calculated for the temporary sediment basin.

These design procedures are provided as an example of the steps required to design a temporary sediment basin and are based on a specific type of primary outlet. When designing a sediment basin for a construction site, it's the engineer's responsibility to select the type of outlet that is appropriate based on criteria in the preceding sections and to modify the following procedures as needed to use appropriate calculations for the selected outlet, particularly in Steps 12, 13, and 14.

Step 1 Determine the required basin volume.

The basin volume shall be the calculated volume of runoff from the temporary control design storm (2-year, 24-hour) from each disturbed acre draining to the basin. When rainfall data is not available, a design volume of 3600 cubic feet of storage per acre drained may be used.

For a natural basin, the storage volume may be approximated as follows:

$$V_1 = 0.4 \times A_1 \times D_1$$
 (3.2)

where:

- V_1 = the storage volume in cubic feet
- A₁ = the surface area of the flooded area at the crest of the basin outlet, in square feet
- D₁ = the maximum depth in feet, measured from the low point in the basin to the crest of the basin riser
- Note 1: The volumes may be computed from more precise contour information or other suitable methods.
- Note 2: Conversion between cubic feet and cubic yards is as follows:

Number of cubic feet x 0.037 = number of cubic yards

If the volume of the basin is inadequate or embankment height becomes excessive, pursue the use of excavation to obtain the required volume.

Step 2 Determine the basin shape.

The shape of the basin must be such that the length-to-width ratio is at least 4 to 1 according to the following equation:

Length-to-width Ratio =
$$\underline{L}$$
 (3.3)
We

where:

We = A/L = the effective width

- A = the surface area of the normal pool
- L = the length of the flow path from the inflow to the outflow. If there is more than one inflow point, any inflow that carries more than 30 percent of the peak rate of inflow must meet these criteria.

The correct basin length can be obtained by proper site selection, excavation, or the use of baffles. Baffles increase the flow length by interrupting flow and directing it through the basin in a circuitous path to prevent short-circuiting. Porous baffles are recommended. Spacing of baffles should be wide enough to not cause a channeling effect within the basin. Analyze the

flow cross section and velocity between baffles to ensure that velocities are not too fast for settling to occur.

Step 3 Design the embankment.

The side slopes of the embankment should be 3:1 or flatter.

Top width shall be determined by the engineer based on the total height of the embankment.

The area under the embankment should be cleared, grubbed, and stripped of topsoil to remove trees, vegetation, roots, or other objectionable materials. The pool area should also be cleared of all brush and trees.

The embankment fill material should be clay soil from an approved borrow area. It should be clean soil, free from roots, woody vegetation, oversized stones, and rocks.

Step 4 Select the type(s) of outlet(s).

The outlets for the basin may consist of a combination of a primary outlet and emergency spillway or a primary outlet alone. In either case, the outlet(s) must pass the peak runoff expected from the drainage area for the conveyance storm (25-year, 24-hour) without damage to the embankment, structures, or basin.

Step 5 Determine whether the basin will have a separate emergency spillway.

A side channel emergency spillway is required for sediment basins receiving stormwater from more than 10 acres.

- Step 6 Determine the elevation of the crest of the basin outlet riser for the required volume.
- Step 7 Estimate the elevation of the conveyance storm and the required height of the dam.
 - (a) If an emergency spillway is included, the crest of the basin outlet riser must be at least 1.0 foot below the crest of the emergency spillway.
 - (b) If an emergency spillway is included, the elevation of the peak flow through the emergency spillway (which will be the design high water for the conveyance storm) must be at least 1.0 foot below the top of embankment.
 - (c) If an emergency spillway is not included, the crest of the basin outlet riser must be at least 3 feet below the top of the embankment.
 - (d) If an emergency spillway is not included, the elevation of the design high water for the conveyance storm must be 2.0 feet below the top of the embankment.
- Step 8 Determine the peak rate of runoff for a 25-year storm.

Using SCS TR 55 Urban Hydrology for Small Watersheds or other methods, determine the peak rate of runoff expected from the drainage area of the basin for the conveyance storm. The "C" factor or "CN" value used in the runoff calculation should be derived from analysis of the contributing drainage area at the peak of land disturbance (condition which will create greatest peak runoff).

- Step 9 Design the basin outlet.
 - (a) If an emergency spillway is included, the basin outfall must at least pass the peak rate of runoff from the basin drainage area for the temporary control design storm (2-year, 24-hour).
 - Q_p = the 2-year peak rate of runoff.
 - (b) If an emergency spillway is not included, the basin outfall must pass the peak rate of runoff from the basin drainage area for the conveyance storm (25-year, 24-hour).

 Q_{25} = the 25-year peak rate of runoff.

- (c) Refer to Figure 3.23, where h is the difference between the elevation of the crest of the basin outlet riser and the elevation of the crest of the emergency spillway.
- (d) Enter Figure 3.24 with Q_p. Choose the smallest riser which will pass the required flow with the available head, h.
- (e) Refer to Figure 3.23, where H is the difference in elevation of the centerline of the outlet of the outfall and the crest of the emergency spillway. L is the length of the barrel through the embankment.
- (f) Enter Table 3.5 or Table 3.6 with H. Choose the smallest size outlet that will pass the flow provided by the riser. If L is other than 70 feet, make the necessary correction.
- (g) The basin riser shall consist of a solid (non-perforated), vertical pipe or box of corrugated metal joined by a watertight connection to a horizontal pipe (outfall) extending through the embankment and discharging beyond the downstream toe of the fill. Another approach is to utilize a perforated vertical riser section surrounded by filter stone.
- (h) The basin outfall, which extends through the embankment, shall be designed to carry the flow provided by the riser with the water level at the crest of the emergency spillway. The connection between the riser and the outfall must be watertight. The outlet of the outfall must be protected to prevent erosion or scour of downstream areas.
- (i) Weirs, skimmers and other types of outlets may be used if accompanied with appropriate calculations.
- Step 10 Design the emergency spillway.
 - (a) The emergency spillway must pass the remainder of the 25-year peak rate of runoff not carried by the basin outlet.
 - (b) Compute: $Q_e = Q_{25} Q_p$
 - (c) Refer to Figure 3.25 and Table 3.7.
 - (d) Determine approximate permissible values for b, the bottom width; s, the slope of the exit channel; and X, minimum length of the exit channel.
 - (e) Enter Table 3.7 and choose the exit channel cross-section which passes the required flow and meets the other constraints of the site.
 - (f) Notes:
 - 1. The maximum permissible velocity for vegetated waterways must be considered when designing an exit channel.
 - For a given Hp, a decrease in the exit slope from S as given in the table decreases spillway discharge, but increasing the exit slope from S does not increase discharge. If an exit slope (Se) steeper than S is used, then the exit should be considered an open channel and analyzed using the Manning's Equation.
 - 3. Data to the right of heavy vertical lines should be used with caution, as the resulting sections will be either poorly proportioned or have excessive velocities.
 - (g) The emergency spillway should not be constructed over fill material.
 - (h) The emergency spillway should be stabilized with rock riprap or temporary vegetation upon completion of the basin.

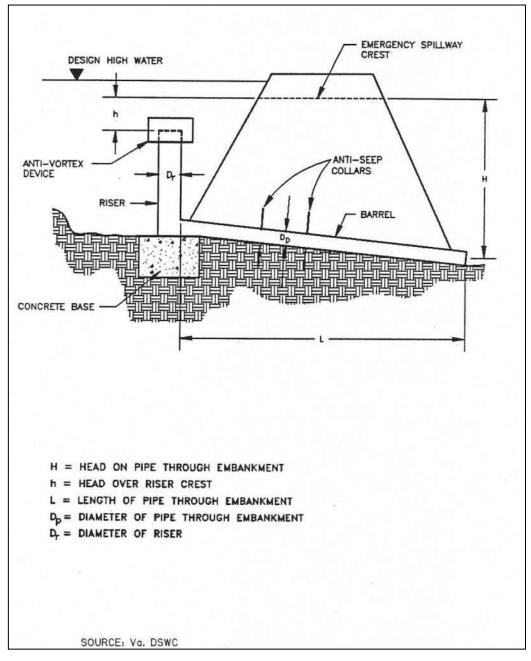


Figure 3.23 Example of Basin Outlet Design

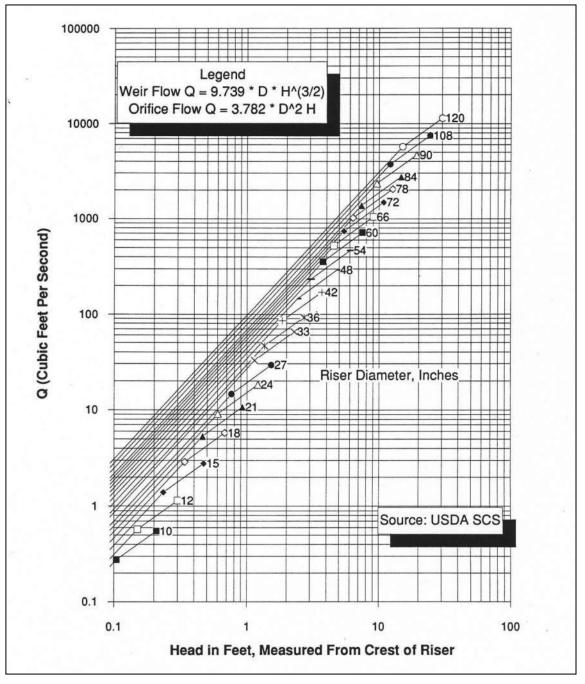


Figure 3.24 Riser Inflow Curves for Basin Outlet Design

Head		and the second	8					Pipe Dia	Pipe Diameter in Inches	Inches								
(In feet)	12	15	18	21	24	30	36	42	48	54	60	66	72	78	84	90	96	102
-	3.22	5.44	8.29	11.8	15.9	26	38.6	53.8	71.4	91.5	114	139	167	197	229	264	302	342
2	4.55	7.69	11.7	16.7	22.5	36.8	54.6		101	129	161	197	236	278	324	374	427	483
3	5.57	9.42		20.4	27.5	45	66.9	93.1	124	159	198	241	289	341	397	458	523	593
4	6.43	10.9		23.5	31.8	52	77.3		143	183	228	278	334	394	459	529	604	88
5	7.19	12.2		26.3	35.5	58.1	86.4		160	205	255	311	373	440	513	591	675	164
6	7.88	13.3		28.8	38.9	63.7	94.6		175	224	280	341	409	482	562	647	739	837
7	8.51	14.4		31.1	42	68.8	102	142	189	242	302	368	441	521	607	669	798	904
8	9.1	15.4		33.3	44.9	73.5	109	152	202	259	323	394	472	557	685	748	854	996
9	9.65	16.3		35.3	47.7	78	116	161	214	275	342	418	500	590	688	793	905	1025
10		17.2	26.2	37.2	50.2	82.2	122	170	226	289	361	440	527	622	725	836	954	1080
11	10.7	18		39	52.7	86.2	128	178	237	304	379	462	553	653	761	877	1001	1133
12	1.11	18.9		40.8	55	90.1	134	186	247	317	395	482	578	682	794	916	1045	Ŧ
13	11.6	19.6		42.4	57.3	93.7	139	194	257	330	411	502	601	710	827	953	1088	123
14	12	20.4	31	44.1	59.4	97.3	145	201	267	342	427	521	624	736	858	989	1129	127
15		21.1	32.1	45.6	61.5	101	150	208	277	354	442	539	646	762	888	1024	1169	132
16		21.8	33.2	47.1	63.5	104	155	215	286	366	457	557	667	787	917	1057	1207	₽
17	13.3	22.4		48.5	65.5	107	159	222	294	377	471	574	688	812	946	1090	1244	140
18		23.1		49.9	67.4	110	164	228	303	388	484	591	708	835	973	1121	1280	-
19		23.7		51.3	69.2	113	168	234	311	399	497	607	- 727	858	1000	1152	1315	148
20		24.3	37.1	52.6	11	116	173	240	319	409	510	623	746	880	1026	1182	1350	1521
21		24.9		53.9	72.8	119	171	246	327	419	523	638	764	902	1051	1211	1383	156
22		25.5		55.2	74.5	122	181	252	335	429	535	653	782	923	1076	1240	1415	160
23	15.4	26.1		56.5	76.2	125	186	258	342	439	547	668	800	944	1100	1268	1447	163
24		26.7		57.7	77.8	127	189		350	448	559	682	817	964	1123	1295	1478	167
25		27.2	41.5	58.9	79.4	130	193		357	458	571	696	834	984	1147	1322	1509	1708
26		27.7		60	81	133	197		364	467	582	710	850	1004	1169	1348	1539	174
27	-	28.3		61.2	82.5	135	201	279	371	476	593	723	867	1023	1192	1373	1568	111
28		28.8		62.3	84.1	138			378	484	604	737	883	1041	1214	1399	1597	1806
29	17.3	29.3		63.4	85.5	140	208	290	384	493	615	750	898		1235	1423	1625	1840
30		29.8	45.4	64.5	87	142			391	501				10/01	1256	1448	1653	181
									Correction	-	위		ē		Ì	I	I	
20		1.24	1.21	1.18	1.15	1.12	1.1	1.08	1.07	1.06	1.05	1.05		1.04	1.03	1.03	1.03	1.03
30	1.22	1.18		1.13	1.12	1.09		1.06	1.05	1.05	1.04	1.04	1.03		1.03	1.02	1.02	1.02
40		1.13			1.08	1.07			1.04	1.03	1.03	1.03			1.02	1.02	1.02	1.02
50		1.08		1.06	1.05	1.04			1.03	1.02	1.02	1.02		1.01	1.01	1.01	1.01	1.01
60		1.04	1.03	1.03	1.03	1.02	1.02		1.01	1.01	1.01	1.01	1.01	1.01	1.01	1.01	1.01	1.01
70		-	-	-	-	-			-	-	-	-			-	-	-	
80		76.0		16.0	0.98	0.98		0.99	0.99	0.99	0.99	0.99			0.99	66.0	66.0	0.99
96		0.94		0.95	0.95	0.96			0.98	96.0	0.98	0.98			0.99	66.0	0.99	0.99
100		0.91		0.93	0.93	0.95			0.97	16.0	16.0	0.98			0.98	0.98	0.98	0.99
120		0.86	0.87	0.89	6.0	0.91		0.94	0.94	0.95	0.96	0.96		0.97	0.97	0.97	10.97	0.98
140	0.8	0.82	_	0.85	0.96	0.88	0.9		0.92	0.93	0.94		0.95	0.95	0.98	0.96	96.0	0.97
a la			l					1								-	100	

Table 3.5 Pipe Flow Chart, n=0.013

Heed								Pipe Dia	Pipe Diameter in Inches	1 Inches											
(in feet)	9	8	10	12	15	18	21	24	30	36	42	48	54	60	99	72	78	84	00	96	103
-	0.33	0.7	1.25	1.98		5.47	7.99	11	18.8	28.8	41.1	55.7	72.6	91.8	113	137	163	191	000	255	
2	0.47	0.99	1.76	2.8		7.74	11.3	15.6	26.6	40.8	58.2	78.8	103	130	160	194	1231	116	314	260	DR7
3	0.58	1.22	2.16	3.43		9.48	13.8	19.1	32.6	49.9	71.2	96.5	126	159	196	237	282	331	384	441	
4	0.67	1.4	2.49	3.97		10.9	16	22.1	37.6	57.7	82.3	111	145	184	226	274	326	383	444	1012	200
5	0.74	1.57	2.79	4.43		12.2	17.9	24.7	42.1	64.5	92	125	162	205	253	306	365	428	496	570	64B
9	0.82	1.72	3.05	4.86		13.4	19.6	27	46.1	70.6	101	136	178	225	277	336	399	469	544	624	
2	0.88	1.86	3.3	5.25	9.2	14.5	21.1	29.2	49.8	76.3	109	147	192	243	300	362	431	506	587	674	787
8	0.94	1.99	3.53	5.61	9.84	15.5	22.6	31.2	53.2	81.5	116	158	205	260	320	388	461	541	8CB	101	
6	-	2.11	3.74	5.95	10.4	16.4	24	33.1	56.4	86.5	123	167	218	275	340	411	489	574	666	764	
10	1.05	2.22	3.94	6.27	11	17.3	25.3	34.9	59.5	91.2	130	176	230	290	358	433	516	605	702	BOR	017
=		2.33	4.13	6.58	11.5	18.2	26.5	36.6	62.4	95.6	136	185	241	304	376	454	541	635	736	BAS	1
12	1.15	2.43	4.32	6.87	12.1	19	27.7	38.2	65.2	99.9	142	193	252	318	392	475	565	663	769	RR3	1004
13	1.2	2.53	4.49	7.15	12.6	19.7	28.8	39.8	67.8	104	148	201	262	331	408	494	588	069	BOD	010	T
14	1.25	2.63	4.66	7.42	13	20.5	29.9	41.3	70.4	108	154	208	272	343	424	513	610	716	830	0530	ADA
15	1.29	2.72	4.83	7.68	13.5	21.2	30.9	42.8	72.8	112	159	216	281	355	439	531	183	741	BED	200	1000
16	1.33	2.81	4.99	7.93	13.9	21.9	32	44.2	75.2	115	165	223	290	367	453	548	652	765	ARR	1010	1160
17	1.37	2.9	5.14	8.18	14.3	22.6	32.9	45.5	77.5	119	170	230	300	378	467	565	672	780	015	1051	
18	1.41	2.98	5.29	8.41	14.8	23.2	33.9	46.8	79.8	120	174	236	308	389	480	581	602	812	CVO	100	1
19		3.06	5.43	8.64	15.2	23.9	34.8	48.1	82	126	179	243	316	400	494	597	711	824	240	1111	1201
20	1.49	3.14	5.57	8.87	15.6	24.5	35.7	49.4	84.1	129	184	249	325	410	506	613	720	REG	000	1120	1001
21	1.53	3.22	5.71	9.09	15.9	25.1	36.6	50.6	86.2	132	188	255	333	421	519	628	747	877	1017	1168	1220
22	1.56	3.29	5.85	9.3	16.3	25.7	37.5	51.8	88.2	135	193	261	341	430	531	643	765	898	1041	1105	1360
23	1.6	3.37	5.98	9.51	16.7	26.2	38.3	53	90.2	138	197	267	348	440	543	657	782	918	1064	1222	1300
24	1.63	3.44	6.11	9.72	17	26.8	39.1	54.1	92.1	141	201	273	356	450	555	671	799	937	1087	1248	1420
25	1.66	3.51	6.23	9.92	17.4	27.4	39.9	55.2	8	144	206	279	363	459	566	685	815	957	1110	1274	1450
26	1.7	3.58	6.36	10.1	17.7	27.9	40.7	56.3	95.9	147	210	284	370	468	577	669	831	976	1132	1299	1478
27	1.73	3.65	6.48	10.3	18.1	28.4	41.5	57.4	97.7	150	214	290	377	477	588	712	847	994	1153	1324	1507
28	1.76	3.72	6.6	10.5	18.4	29	42.3	58.4	99.5	153	218	295	384	486	599	725	863	1013	1174	1348	1534
29	1.79	3.78	6.71	10.7	18.7	29.5	43	59.5	101	155	221	300	391	494	610	738	878	1030	1195	1372	1561
30	1.82	3.85	6.83	10.9	19.1	30	43.7	60.5	103	158	225	305	398	503	620	750	893	1048	1216	1396	1588
									Correctio	Correction Factors	s for Oth	ter Pipe	Lengths					t	t	ſ	
20	1.69	1.63	1.58	1.53	1.47	1.42	1.37	1.34	1.28	1.24	1.2	1.18	1.16	1.14	1.13	1.11	1.1	1.1	1.09	1 08	1 08
30	1.44	1.41	1.39	1.36	1.32	1.29	1.27	1.24	1.21	1.18	1.15	1.13	1.12	1.11	1.1	1.09	1.08	1.07	1.07	1 06	1 06
40	1.28	1.27	1.25	1.23	1.21	1.2	1.18	1.17	1.14	1.12	1.11	1.1	1.09	1.08	1.07	1.06	1.06	1.05	1.05	1.05	1.04
50	1.16	1.16	1.15	1.14	1.13	1.12	1.11	1.1	1.09	1.08	1.07	1.06	1.06	1.05	1.05	1.04	1.04	1.04	1.03	1 03	1 03
60	1.07	1.07	1.07	1.06	1.06	1.05	1.05	1.05	1.04	1.04	1.03	1.03	1.03	1.02	1.02	1.02	1.02	1.02	1.02	1.02	1.01
70	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	+	-	-	-	
80	0.94	0.94	0.95	0.95	0.95	0.95	0.96	0.96	0.96	0.97	0.97	0.97	0.98	0.98	0.98	0.98	0.98	0.98	0.99	0.99	0.99
06	0.89	0.89	0.0	0.9	0.91	0.91	0.92	0.92	0.93	0.94	0.94	0.95	0.95	96.0	96.0	0.96	76.0	76.0	0.97	0.97	0.94
100	0.85	0.85	0.86	0.86	0.87	0.88	0.89	0.89	0.9	0.91	0.92	0.93	0.93	0.94	0.94	0.95	0.95	0.95	0.96	0.96	0.94
120	0.78	0.79	0.79	0.8	0.81	0.82	0.83	0.83	0.85	0.86	0.87	0.89	0.89	0.9	0.91	0.91	0.92	0.93	0.93	0.94	l°
140	0.72	0./3	0.74	0.75	0.76	0.77	0.78	0.79	0.81	0.82	0.84	0.85	0.86	0.87	0.88	0.86	0.89	0.9	0.91	0.91	0.92
1 60	0.68	0.69	0.69	0.7	0.71	0.73	074	0 75	CL V	02.0		000					11.	A STATE OF			

Table 3.6 Pipe Flow Chart, n=0.025

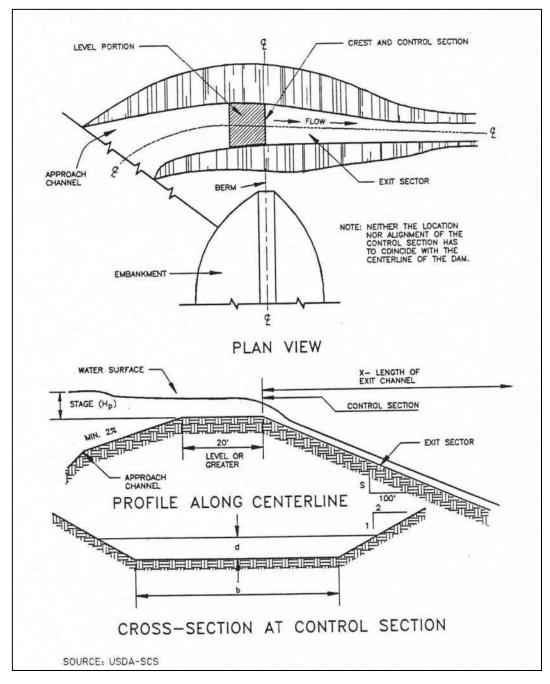


Figure 3.25 Example of Excavated Earth Spillway Design

Stage (Hp)	Spillway							Botto	om W	idth (b) in I	Feet						
In Feet	Variables	8	10	12	14	16	18	20	22	24	26	28	30	32	34	36	38	40
	Q	6	7	8	10	11	13	14	15	17	18	20	21	22	24	25	27	28
0.5	V	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
	S	3.9	3.9	3.9	3.9	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8
	X	32	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33	33
	Q	8	10	12	14	16	18	20	22	24	26	28	30	32	34	35	37	39
0.6	V	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
	S	3.7	3.7	3.7	3.7	3.6	3.7	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
	Х	36	36	36	36	36	36	37	37	37	37	37	37	37	37	37	37	37
	Q	11	13	16	18	20	23	25	28	30	33	35	38	41	43	44	46	48
0.7	V	3.2	3.2	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3	3.3
15.11	S	3.5	3.5	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4	3.4
-	X	39	40	40	40	41	41	41	41	41	41	41	41	41	41	41	41	41
	Q	13	16	19	22	26	29	32	35	38	42	45	46	48	51	54	57	60
0.8	V	3.5	3.5	3.5	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6	3.6
	S	3.3	3.3	3.3	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
	X	44	44	44	44	44	45	45	45	45	45	45	45	45	45	45	45	45
	Q	17	20	24	28	32	35	39	43	47	51	53	57	60	64	68	71	75
0.9	V	3.7	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8	3.8
	S	3.2	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	3.1	. 3.1	3.1	3.1	3.1	3.1	3.1
	X	47	47	48	48	48	48	48	48	48	48	49	49	49	49	49	49	49
	Q	20	24	29	33	38	42	47	51	56	61	63	68	72	77	81	86	90
1	V	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4
	S	3.1	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
	X	51	51	51	51	52	52	52	52	52	52	52	52	52	52	52	52	52
	Q	23	28	34	39	44	49	54	60	65	70	74	79	84	89	95	100	105
1.1	V	4.2	4.2	4.2	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
	S	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.9	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8
	X	55	55	55	55	55	55	55	56	56	56	56	56	56	56	56	56	56
	Q	28	33	40	45	51	58	64	69	76	80	86	92	98	104	110	116	122
1.2	V	4.4	4.4	4.4	4.4	4.4	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5	4.5
	S	2.9	2.9	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8	2.8
	X	58	58	59	59	59	59	59	59	60	60	60	60	60	60	60	60	60
	Q	32	38	46	53	58	65	73	80	86	91	99	106	112	119	125	133	140
1.3	V	4.5	4.6	4.6	4.6	4.6	4.6	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7	4.7
	S	2.8	2.8	2.8	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7	2.7
	X	62	62	62	63	63	63	63	63	63	63	63	64	64	64	64	64	64
	Q	37	44	51	59	66	74	82	90	96	103	111	119	127	134	143	150	158
1.4	V	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.9	4.9	4.9	4.9	4.9	4.9	4.9	4.9
	S	2.8	2.7	2.7	2.7	2.7	2.7	2.7	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
	X	65	66	66	66	66	67	67	67	67	67	67	68	68	68	68	68	69

 Table 3.7 Design Data for Earth Spillways

	Spillway			-						,	b) In I							
In Feet	Variables			12	14	16		20	22	24	. 26	28	30	32	34			
2011 Tazing	Q	41	50	58	66	75	85	92	101	108	116	125	133	142	150	160	169	178
1.5	V	4.8	4.9	5	5	5	5	5	5	5	5	5	5	5	5	5.1	5.1	5.1
	S	2.7	2.7	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.5	2.5	2.5
	X	69	69	70	70	71	71	71	71	71	71	71	72	72	72	72	72	72
	Q	46	56	65	75	84	94	104	112	122	132	142	149	158	168	178	187	197
1.6	V	5	5.1	5.1	5.1	5.1	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2	5.2
	S	2.6	2.6	2.6	2.6	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	X	72	74	74	75	75	76	76	76	76	76	76	76	76	76	76	76	76
	Q	52	62	72	83	94	105	115	126	135	145	156	167	175	187	196	206	217
1.7	V	5.2	5.2	5.2	5.3	5.3	5.3	5.3	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4
	S	2.6	2.6	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
	X	76	78	79	80	80	80	80	80	80	80	80	80	80	80	80	80	80
	Q	58	69	81	93	104	116	127	138	150	160	171	182	194	204	214	226	233
1.8	V	5.3	5.4	5.4	5.5	5.5	5.5	5.5	5.5	5.5	5.5	5.5	5.6	5.6	5.6	5.6	5.6	5.6
	S	2.5	2.5	2.5	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
	X	80	82	83	84	84	84	84	84	84	84	84	84	84	84	84	84	84
	Q	64	76	88	102	114	127	140	152	164	175	188	201	213	225	235	248	260
1.9	V	5.5	5.5	5.5	5.6	5.6	5.6	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7
	S	2.5	2.5	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.4
	X	84	85	86	87	88	88	88	88	88	88	88	88	88	88	88	88	88
	Q	71	83	97	111	125	138	153	164	178	193	204	218	232	245	256	269	283
2	V	5.6	5.7	5.7	5.7	5.8	5.8	5.8	5.8	5.8	5.8	5.8	5.9	5.9	5.9	5.9	5.9	5.9
	S	2.5	2.4	2.4	2.4	2.4	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
	X	88	90	91	91	91	91	92	92	92	92	92	92	92	92	92	92	92
	Q	77	91	107	122	135	149	162	177	192	207	220	234	250	267	276	291	305
2.1	V	5.7	5.8	5.9	5.9	5.9	5.9	5.9	6	6	6	6	6	6	6	6	6	6
	S	2.4	2.4	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
	Х	92	93	95	95	95	95	95	95	95	96	96	96	96	96	96	96	96
	Q	84	100	116	131	146	163	177	194	210	224	238	253	269	288	301	314	330
2.2	V	5.9	5.9	6	6	6	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.1	6.2	6.2	6.2	6.2
1	S	2.4	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
	x	96	98	99	99	99	99	99	100	100	100	100	100	100	100	100	100	100
	Q	90	108	124	140	158	175	193	208	226	243	258	275	292	306	323	341	354
2.3	V	6	6.1	6.1	6.1	6.2	6.2	6.2	6.2	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.3	6.3
	S	2.4	2.4	2.3	2.3	2.3	2.3	2.3	2.3	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
	x	100	102	102		103	103			104			105			105		105
	Q	99	116	136	152	170	189		224	241	260	275	294	312	327	346	364	378
2.4	v	6.1	6.2	6.2	6.3	6.3	6.3	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4	6.4
	S	2.3	2.3	2.3	2.3	2.3	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2	2.2
	x	105		106			108			108			109		109	109		109

Table 3.7 Design Data for Earth Spillways (continued)

- Step 11 Re-estimate the elevation of the design high water and the top of the dam based upon the design of the basin outlet and the emergency spillway.
- Step 12 Design the anti-vortex device and trash rack.

If an outfall riser is used, an anti-vortex device and trash rack shall be attached to the top of the basin riser to improve the flow of water into the outfall and prevent floating debris from being carried out of the basin.

This design procedure for the anti-vortex device and trash rack refers only to round riser pipes of corrugated metal. There are numerous ways to provide protection for concrete pipe; these include various hoods and grates and rebar configurations which should be a part of project-specific design and will frequently be a part of a permanent structure.

Refer to Figure 3.26 and Table 3.8. Choose cylinder size, support bars, and top requirements from Table 3.8 based on the diameter of the riser pipe.

Step 13 Design the anchoring for the basin outlet.

The basin outlet must be firmly anchored to prevent its floating.

If the riser is 10 feet or less in height, choose one of the two methods in Figure 3.27 to anchor the basin outlet.

Determine the number and spacing of anti-seep collars for the outfall pipe through the embankment.

- Step 14 Provide for dewatering.
 - (a) Use a modified version of the discharge equation for a vertical orifice and a basic equation for the area of a circular orifice.

Naming the variables:

- A = flow area of orifice, in square feet
- D = diameter of circular orifice, in inches
- h = average driving head (maximum possible head measured from radius of orifice to crest of basin outlet divided by 2), in feet
- Q = volumetric flow rate through orifice needed to achieve approximate 6-hour drawdown, cubic feet per second
- S = total storage available in dry storage area, cubic feet
- Q = S/21,600 seconds
- (b) An alternative approach for dewatering is the use of a perforated riser (0.75" to 1" diameter holes spaced every 12 inch horizontally and 8 inch vertically) with $1\frac{1}{2}$ inch to 2 inch filter stone stacked around the exterior.

Use S for basin and find Q. Then substitute in calculated Q and find A:

$$A = (0.6) \times (64.32 \times \underline{h})$$
(3.4)

Then, substitute in calculated A and find d:

$$d^{*} = 2 \times (\underline{A})$$
(3.5)

Diameter of the dewatering orifice should never be less than 3 inches in order to help prevent clogging by soil or debris.

Flexible tubing should be at least 2 inches larger in diameter than the calculated orifice to promote improved flow characteristics.

Additional design guidance for orifices and perforated risers are in Section 2.2.2 of the *Hydraulics Technical Manual*.

(c) If a surface skimmer is used as the basin's primary outlet, it may also be used to dewater the basin. Orifice flowrates for the skimmer will be provided by the manufacturer.

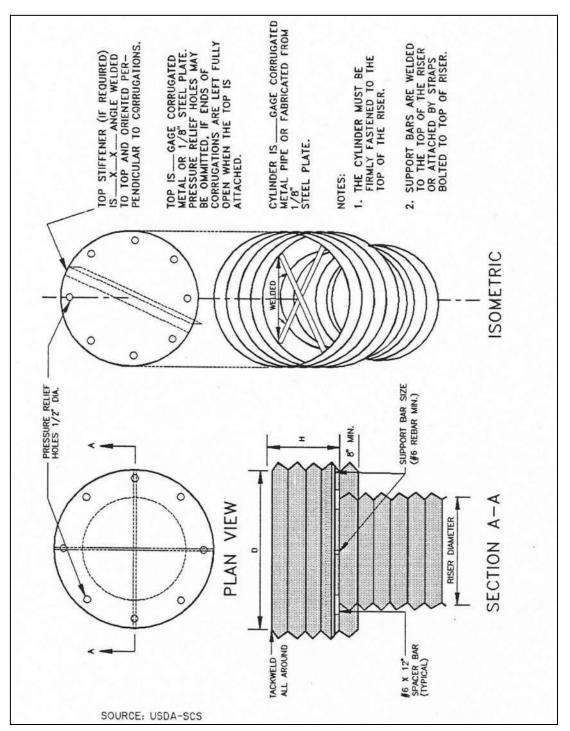


Figure 3.26 Example of Anti-Vortex Design for Corrugated Metal Pipe Riser

Riser	Cy	linder			Minim	um Top
Diam., in.	Diameter inches	Thickness gage	Height inches	Minimum Size Support Bar	Thickness	Stiffener
12	18	16	6	#6 Rebar or 1 ½ x 1 ½ x 3/16 angle	16 ga. (F&C)	-
15	21	16	7			
18	27	16	8			-
21	30	16	11		16 ga.(C), 14 ga.(F)	-
24	36	16	13			-
27	42	16	13			-
36	54	14	17	#8 Rebar	14 ga.(C), 12 ga.(F)	-
42	60	16	19			-
48	72	16	21	1 ¼" pipe or 1 ½ x 1 ½ x ¼ angle	14 ga.(C), 10 ga.(F)	•
54	78	16	25			-
60	90	14	29	1 ½" pipe or 1 ½ x 1 ½ x ¼ angle	12 ga.(C), 8 ga.(F)	-
66	96	14	33	2" pipe or 2 x 2 x 3/16 angle	12 ga.(C), 8	2 x 2 x ¼ angle
72	102	14	36			2 ½ x 2 ½ x ¼ angle
78	114	14	39	2 ½" pipe or 2 ½ x ¾ angle		
84	120	12	42	2 ½" pipe or 2 ½ x 2 ½ x ½ angle		2 ½ x 2 ½ x 5/16 angle
qual to or g lote ₂ : Corr	reater than the a	rea inside the rise 6" pipe measures	er. Therefore	between the inside of the o , the above table is invalid or 42"-84" the corrugation	for use with concret	e pipe risers.

Table 3.8 Trash Rack and Anti-Vo	ortex Device Design Table
----------------------------------	---------------------------

Source: Adapted from USDA-SCS and Carl M. Henshaw Drainage Products Information.

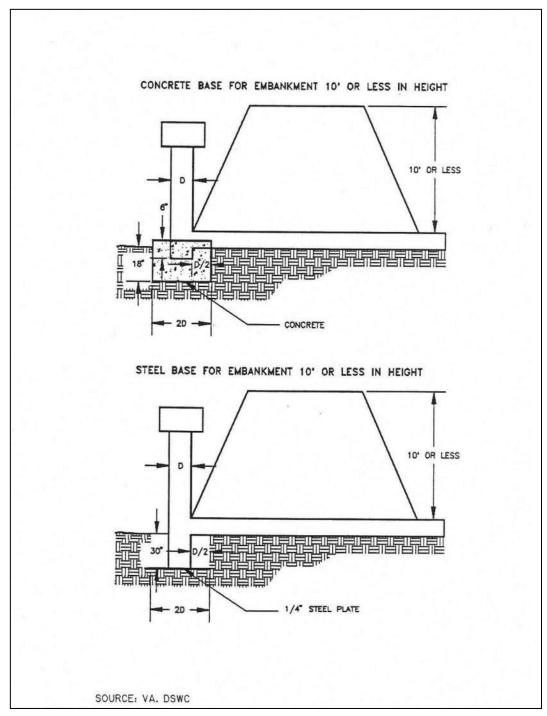


Figure 3.27 Riser Pipe Base Design for Embankment Less Than 10 Feet High

3.9.8 Design Form

Note: This design form is for basins designed with a riser as its primary outlet. It is provided as an example of the type of documentation required for a sediment basin. Different calculations will be needed for other types of outlets.

Pro	oject
Ba	sin # Location
To	tal area draining to basin: acres.
То	tal disturbed area draining to basin: acres.
Ba	sin Volume Design
1.	Minimum required volume is the lesser of
	a.) (3600 cu. ft. x total drainage acres) / 27 = cu. yds.
	b.) 2 yr, 24 hr storm volume in cubic yards = cu. yds.
2.	Total available basin volume at crest of riser* = cu. yds. at elevation (From Storage - Elevation Curve)
	* Minimum = Lesser of 3600 cubic feet/acre of Total Drainage Area or 2yr. 24 hr. storm volume from Disturbed Area drained
3.	Excavate cu. yds. to obtain required volume*.
	*Elevation corresponding to required volume = invert of the dewatering orifice.
4.	Diameter of dewatering orifice = in.
5.	Diameter of flexible tubing = in. (diameter of dewatering orifice plus 2 inches).
<u>Pre</u>	eliminary Design Elevations
6.	Crest of Riser =
	Top of Dam =
	Design High Water =
	Upstream Toe of Dam =

Basin Shape

7.	Length of FlowL=Effective WidthWe
	If > 2, baffles are not required
	If < 2, baffles are required
<u>Ru</u>	noff
8.	Q ₂ = cfs (From TR-55)
9.	Q ₂₅ = cfs (From TR-55)
Bas	sin Outlet Design
10.	With emergency spillway, required basin outlet capacity $Q_p = Q_2 = _$ cfs. (riser and outfall)
	Without emergency spillway, required basin outlet capacity $Q_p = Q_{25} = _$ cfs. (riser and outfall)
11.	With emergency spillway:
	Assumed available head (h) = ft. (Using Q_2)
	h = Crest of Emergency Spillway Elevation - Crest of Riser Elevation
	Without emergency spillway:
	h = Design High Water Elevation - Crest of Riser Elevation
12.	Riser diameter (D_r) = in. Actual head (h) =ft.
	(Figure 3.23)
	Note: Avoid orifice flow conditions.
13.	Barrel length (I) = ft.
	Head (H) on outfall through embankment = ft.
	(Figure 3.24)
14.	Barrel Diameter = in.
	(From Table 3.5 [concrete pipe] or Table 3.6 [corrugated pipe]).

15. Trash rack and anti-vortex device

Diameter = _____ inches.

Height = _____ inches.

(From Table 3.8).

Emergency Spillway Design

- 16. Required spillway capacity $Q_e = Q_{25} Q_p =$ _____cfs.
- 17. Bottom width (b) = _____ ft.; the slope of the exit channel(s) = _____ ft./foot; and the minimum length of the exit channel (x) = _____ ft. (From Figure 3.25 and Table 3.7).

Final Design Elevations

- 18. Top of Dam = _____
 - Design High Water = _____
 - Emergency Spillway Crest = _____


Basin Riser Crest = _____

Dewatering Orifice Invert =	
Dewatering Office invert =	

Elevation of Upstream Toe of Dam (if excavation was performed) = _____

Sediment Control

3.10 Silt Fence

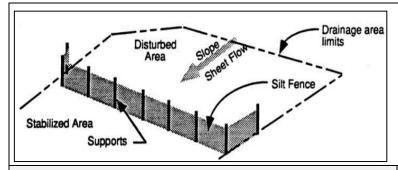

KEY CONSIDERATIONS

DESIGN CRITERIA:

- Maximum drainage area of 0.25 acre per 100 linear feet of silt fence
- Maximum 200 feet distance of flow to silt fence; 50 feet if slope exceeds 10 percent
- Minimum fabric overlap of 3 feet at abutting ends; join fabric to prevent leakage
- Turn end of silt fence line upslope a minimum of 10 feet
- Install stone overflow structure at low points or spaced at approximately 300 feet if no apparent low point

ADVANTAGES / BENEFITS:

- Economical means to treat sheet flow
- Most effective with coarse to silty soil types

DISADVANTAGES / LIMITATIONS:

- Limited effectiveness with clay soils due to clogging
- Localized flooding due to minor ponding at the upslope side of the silt fence
- Not for use as check dams in swales or low areas subject to concentrated flow
- Not for use where soil conditions prevent a minimum toe-in depth of 6 inches or installation of support posts to a depth of 12 inches
- Can fail structurally under heavy storm flows, creating maintenance problems and reducing effectiveness

MAINTENANCE REQUIREMENTS:

- Inspect regularly
- Repair undercutting, sags and other fence failures
- Remove sediment before it reaches half the height of the fence
- Repair or replace damaged or clogged filter fabric

TARGETED POLLUTANTS

- Sediment
- O Nutrients & Toxic Materials
- O Oil & Grease
- Floatable Materials
- O Other Construction Wastes

Description: A silt fence consists of geotextile fabric supported by wire mesh netting or other backing stretched between metal posts with the lower edge of the fabric securely embedded six-inches in the soil. The fence is typically located downstream of disturbed areas to intercept runoff in the form of sheet flow. A silt fence provides both filtration and time for sediment settling by reducing the velocity of the runoff.

APPLICATIONS

Perimeter Control

Slope Protection

Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=0.50-0.75

(Depends on soil type)

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- Maintenance
- O Training
- ♀ Suitability for Slopes > 5%

Other Considerations:

 Effects of ponding or the redirection of flow onto adjacent areas and property

3.10.1 Primary Use

Silt fence is normally used as a perimeter control on the down slope side of disturbed areas and on side slopes where stormwater may runoff the area. It is only feasible for non-concentrated, sheet flow conditions. If it becomes necessary to place a silt fence where concentrated flows may be occur (e.g. where two silt fences join at an angle, or across minor channels or gullies), it will be necessary to reinforce the silt fence at that area by a rock berm or sand bag berm, or other structural measures that will support the silt fence.

3.10.2 Applications

Silt fence is an economical means to treat overland, non-concentrated flows for all types of projects. Silt fences are used as perimeter control devices for both site developers and linear (roadway) type projects. They are most effective with coarse to silty soil types. Due to the potential of clogging and limited effectiveness, silt fences should be used with caution in areas that have predominantly clay soil types. In this latter instance, a soils engineer or soil scientist should confirm the suitability of silt fence for that application. Additional controls may be needed to remove fine silts and clay soils suspended in stormwater.

3.10.3 Design Criteria

- Fences are to be constructed along a line of constant elevation (along a contour line) where possible.
- Silt fence can interfere with construction operations; therefore, planning of access routes onto the site is critical.
- Maximum drainage area shall be 0.25 acre per 100 linear feet of silt fence.
- Maximum flow to any 20 foot section of silt fence shall be 1 CFS.
- Maximum distance of flow to silt fence shall be 200 feet or less. If the slope exceeds 10 percent the flow distance shall be less than 50 feet.
- Maximum slope adjacent to the fence shall be 2:1.
- Silt fences shall not be used where there is a concentration of water in a channel, drainage ditch or swale, nor should it be used as a control on a pipe outfall.
- If 50 percent or less soil, by weight, passes the U.S. Standard Sieve No. 200; select the apparent opening size (A.O.S.) to retain 85percent of the soil.
- If 85 percent or more of soil by weight, passes the U.S. Standard Sieve No. 200, silt fences shall not be used unless the soil mass is evaluated and deemed suitable by a soil scientist or geotechnical engineer concerning the erodiblity of the soil mass, dispersive characteristics, and the potential grain-size characteristics of the material that is likely to be eroded.
- Stone overflow structures or other outlet control devices shall be installed at all low points along the fence or spaced at approximately 300 feet if there is no apparent low point.
- Filter stone for overflow structure shall be 1 ½ inches washed stone containing no fines. Angular shaped stone is preferable to rounded shapes.
- Silt fence fabric must meet the following minimum criteria:
 - Tensile Strength, ASTM D4632 Test Method for Grab Breaking Load and Elongation of Geotextiles, 90-lbs.
 - Puncture Rating, ASTM D4833 Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products, 60-lbs.
 - Mullen Burst Rating, ASTM D3786 Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method, 280-psi.

- Apparent Opening Size, ASTM D4751 Test Method for Determining Apparent Opening Size of a Geotextile, U.S. Sieve No. 30(max) to No. 100 (min).
- Ultraviolet Resistance, ASTM D4355 Standard Test Method for Deterioration of Geotextiles by Exposure to Light, Moisture, and Heat in a Xenon Arc Type Apparatus, Minimum 70 percent.
- Fence posts shall be steel and may be T-section or L-section, 1.3 pounds per linear foot minimum, and 4 feet in length minimum. Wood posts may be used depending on anticipated length of service and provided they are 4 feet in length minimum and have a nominal cross section of 2 inches by 4 inches for pine or 2 inches by 2 inches for hardwoods.
- Silt fence shall be supported by steel wire fence fabric as follows:
 - 4 inch x 4 inch mesh size, W1.4 /1.4, minimum 14 gauge wire fence fabric;
 - Hog wire, 12 gauge wire, small openings installed at bottom of silt fence;
 - Standard 2 inch x 2 inch chain link fence fabric; or
 - Other welded or woven steel fabrics consisting of equal or smaller spacing as that listed herein and appropriate gauge wire to provide support.
- Silt Fence shall consist of synthetic fabric supported by wire mesh and steel posts set a minimum of 1-foot depth and spaced not more than 6-feet on center.
- A 6 inch wide trench is to be cut 6 inches deep at the toe of the fence to allow the fabric to be laid below the surface and backfilled with compacted earth or gravel to prevent bypass of runoff under the fence. Fabric shall overlap at abutting ends a minimum of 3 feet and shall be joined such that no leakage or bypass occurs. If soil conditions prevent a minimum toe-in depth of 6 inches or installation of support post to depth of 12 inches, silt fences shall not be used.
- Sufficient room for the operation of sediment removal equipment shall be provided between the silt fence and other obstructions in order to properly maintain the fence.
- The last 10 feet (or more) at the ends of a line of silt fence shall be turned upslope to prevent bypass of stormwater. Additional upslope runs of silt fence may be needed every 200 to 400 linear feet, depending on the traverse slope along the line of silt fence.

3.10.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.5 Silt Fence and in the Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges (TxDot 2004) Item 506.2.J and Item 506.4.C.9.


The American Society for Testing and Materials has established standard specifications for silt fence materials (ASTM D6461) and silt fence installation (ASTM D6462).

3.10.5 Inspection and Maintenance Requirements

Silt fence should be inspected regularly (at least as often as required by the TPDES Construction General Permit) for buildup of excess sediment, undercutting, sags, and other failures. Sediment should be removed before it reaches half the height of the fence. In addition, determine the source of excess sediment and implement appropriate measures to control the erosion. Damaged or clogged fabric must be repaired or replaced as necessary.

3.10.6 Example Schematics


The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

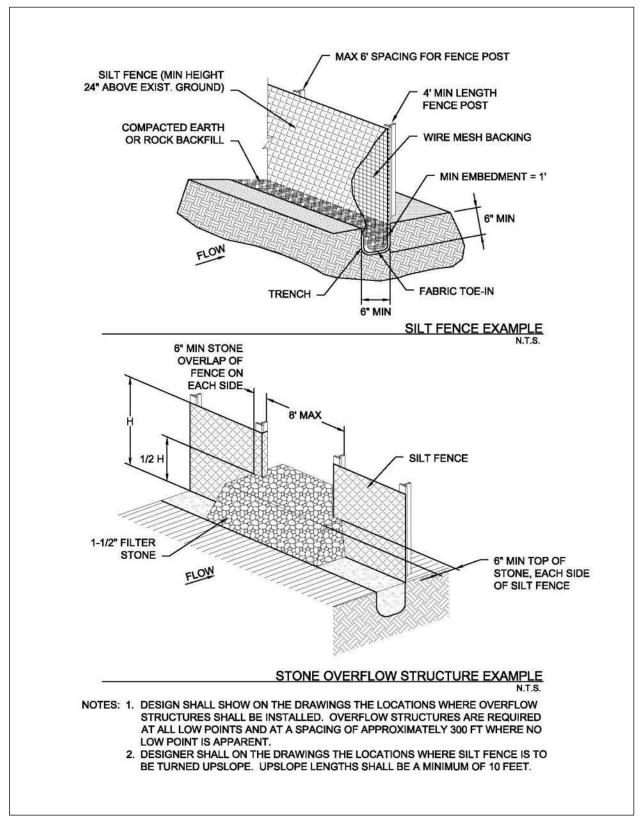



Sediment Control

3.11 Stabilized Construction Exit

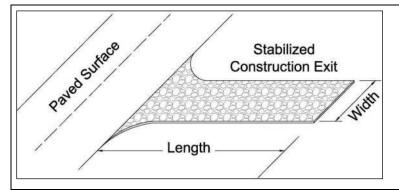

KEY CONSIDERATIONS

DESIGN CRITERIA:

- Slope exit away from offsite paved surface
- Minimum width and length dependent on size of disturbed area, which correlates to traffic volume
- 6 inches minimum thickness of stone layer
- Stone of 3 to 5 inches in size
- Add a wheel cleaning system when inspections reveal the stabilized exit does not prevent tracking

ADVANTAGES / BENEFITS:

- Reduces tracking of soil onto public streets
- Directs traffic to a controlled access point
- Protects other sediment controls by limiting the area disturbed

DISADVANTAGES / LIMITATIONS:

- Effectiveness dependent on limiting ingress and egress to the stabilized exit
- A wheel washing system may also be required to remove clay soil from tires, particularly in wet conditions

MAINTENANCE REQUIREMENTS:

- Inspect regularly
- Replace rock when sediment in the void area between the rocks is visible on the surface
- Periodically re-grade and top dress with additional stone to maintain efficiency

TARGETED POLLUTANTS

- Sediment
- O Nutrients & Toxic Materials
- O Oil & Grease
- O Floatable Materials
- O Other Construction Wastes

Description: A stabilized construction exit is a pad of crushed stone, recycled concrete or other rock material placed on geotextile filter cloth to dislodge soil and other debris from construction equipment and vehicle tires prior to exiting the construction site. The object is to minimize the tracking of soil onto public roadways where it will be suspended by stormwater runoff.

APPLICATIONS

Perimeter Control

Slope Protection

Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=N/A

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- ⊖ Maintenance
- O Training
- Suitability for Slopes > 5%

Other Considerations:

None

3.11.1 Primary Use

Stabilized construction exits are used to remove soil, mud and other matter from vehicles that drive off of a construction site onto public streets. Stabilized exits reduce the need to remove sediment from streets. When used properly, they also control traffic by directing vehicles a single (or two for larger sites) location. Controlling traffic onto and off of the site reduces the number and quantity of disturbed areas and provides protection for other sediment controls by decreasing the potential for vehicles to drive over the control.

3.11.2 Applications

Stabilized construction exits are used on all construction sites with a disturbed area of one acre or larger and are a recommended practice for smaller construction sites. A stabilized exit is used on individual residential lots until the driveway is placed. Stabilized construction exits may be used in conjunction with wheel cleaning systems as described in *Section 3.16 Wheel Cleaning Systems*.

3.11.3 Design Criteria

- Limit site access to one route during construction, if possible; two routes for linear and larger projects.
- Prevent traffic from avoiding or shortcutting the full length of the construction exit by installing barriers. Barriers may consist of silt fence, construction safety fencing, or similar barriers.
- Design the access point(s) to be at the upslope side of the construction site. Do not place construction access at the lowest point on the construction site.
- Stabilized construction exits are to be constructed such that drainage across the exit is directed to a controlled, stabilized outlet onsite with provisions for storage, proper filtration, and removal of wash water.
- The exit must be sloped away from the paved surface so that stormwater from the site does not discharge through the exit onto roadways.
- Minimum width of exit shall be 15 feet.
- The construction exit material shall be a minimum thickness of 6 inches. The stone or recycled concrete used shall be 3 to 5 inches in size with little or no fines.
- The geotextile fabric must meet the following minimum criteria:
 - Tensile Strength, ASTM D4632 Test Method for Grab Breaking Load and Elongation of Geotextiles, 300 lbs.
 - Puncture Strength, ASTM D4833 Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products, 120 lbs.
 - Mullen Burst Rating, ASTM D3786 Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method, 600 psi.
 - Apparent Opening Size, ASTM D4751 Test Method for Determining Apparent Opening Size of a Geotextile, U.S. Sieve No. 40 (max).
- Rock by itself may not be sufficient to remove clay soils from wheels, particularly in wet conditions. When necessary, vehicles must be cleaned to remove sediment prior to entering paved roads, streets, or parking lots. Refer to *Section 3.16 Wheel Cleaning Systems* for additional controls.
- Using water to wash sediment from streets is prohibited
- Minimum dimensions for the stabilized exit shall be as follows:

Table 3.9 Minimum Exit Dimensions				
Disturbed Area	Min. Width of Exit	Min. Length of Exit		
< 1 Acre	15 feet	20 feet		
≥ 1 Acre but < 5 Acres	25 feet	50 feet		
≥ 5 Acres	30 feet	50 feet		

• If a wheel cleaning system is used, the width of the stabilized exit may be reduced to funnel traffic into the system. Refer to Section 3.16 Wheel Cleaning.

3.11.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.10 Stabilized Construction Entrance and in the Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges (TxDOT 2004) Item 506.2.E and Item 506.4.C.5.

3.11.5 Inspection and Maintenance Requirements

Construction exits should be inspected regularly (at least as often as required by the TPDES Construction General Permit). The stabilized construction exit shall be maintained in a condition that prevents tracking or flow of sediment onto paved surfaces. Periodic re-grading and top dressing with additional stone must be done to keep the efficiency of the exit from diminishing. The rock shall be re-graded when ruts appear. Additional rock shall be added when soil is showing through the rock surface.

Additional controls are needed if inspections reveal a properly installed and maintained exit, but tracking of soil outside the construction area is still evident. Additional controls may be daily sweeping of all soil spilled, dropped, or tracked onto public rights-of-way or the installation of a wheel cleaning system.

3.11.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.


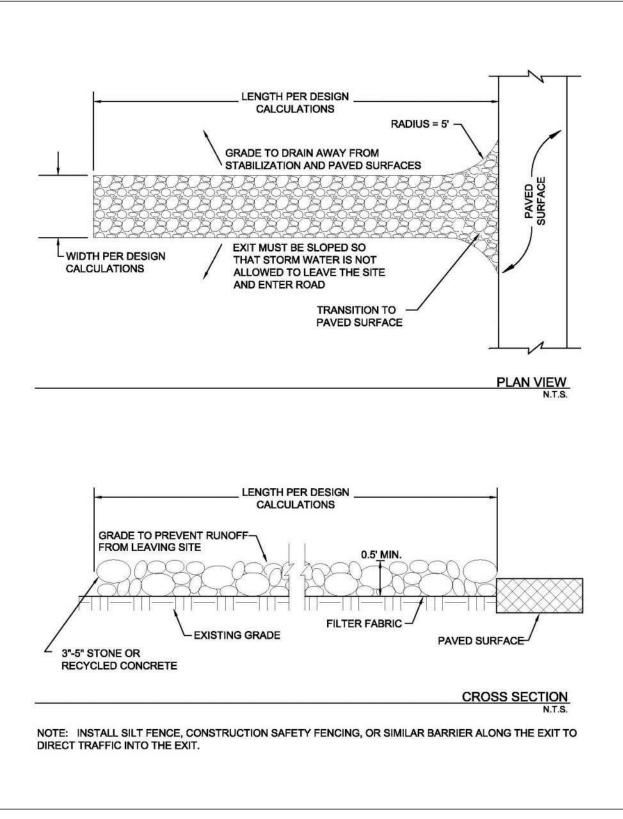


Figure 3.29 Schematics of Stabilized Construction Exit

3.12 Stone Outlet Sediment Trap

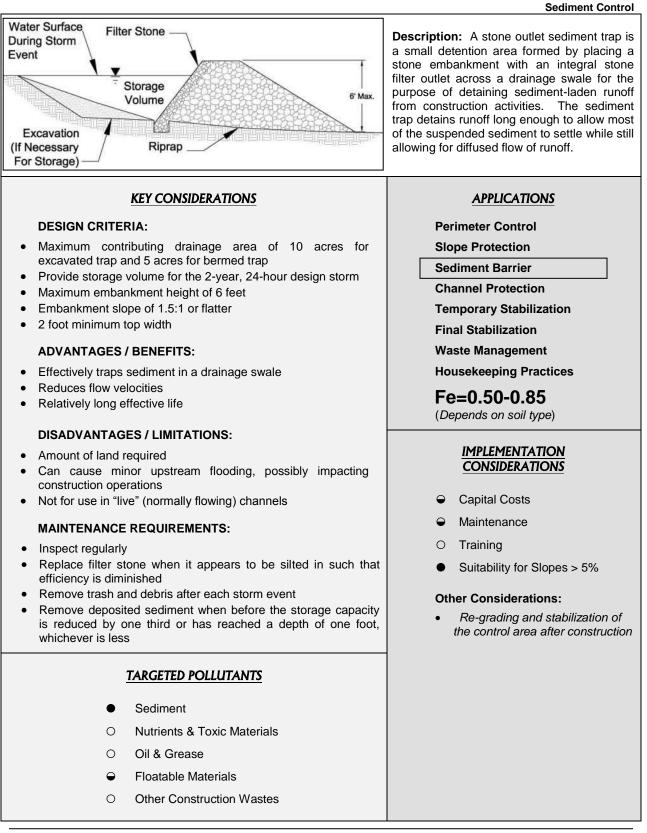

3.12.1 Primary Use

A sediment trap is used where flows are concentrated in a drainage swale or channel. The sediment trap detains and temporarily impounds stormwater, which allows for settling of sediment as the water is slowly discharged from the trap. Sediment traps may be used in combination with check dams when erosive velocities exist in the swale upstream of the sediment trap.

3.12.2 Applications

Temporary stone outlet sediment traps are installed at locations where concentrated flows require a protected outlet to contain sediment or spread flow prior to discharge. They are an effective, long term (12 - 18 months) application for sediment control on large construction sites where a sediment basin is not feasible due to site or construction method restrictions. Several traps may be used to control sediment on drainage sub-basins within the construction site, instead of one large sediment basin at the discharge point from the entire construction site. Sediment traps may also be used with a passive treatment system to provide better removal of fine silt and clay soil particles.

3.12.3 Design Criteria

- Design calculations are required for the use of this control. The designer shall provide drainage computations and dimensions for the stone outlet, berms, and excavated areas associated with this control.
- The maximum drainage area contributing to the trap shall be less than 10 acres for the excavated stone outlet sediment trap and 5 acres or less for the bermed trap.
- The minimum storage volume shall be the volume of runoff from the temporary control design storm (2-year, 24 hour) for the sediment trap's drainage area.
- The surface area of the design storage area shall not be less than 1 percent of the area draining to the device.
- The maximum height of the rock shall be 6 feet, as measured from the toe of the slope on the downstream side to the low point in the rock dam.
- Minimum width of the rock dam at the top shall be 2 feet.
- Rock dam slope shall be 1.5:1 or flatter.
- The rock dam shall have a depressed area, over the center of swale, to serve as the outlet with a minimum width of 4 feet.
- A six inch minimum thickness layer of 1½ inch filter stone shall be placed on the upstream face of the stone embankment when the stormwater runoff contains fine silt and clay soil particles.
- The embankment shall be comprised of well graded stone with a size range of 6 to 12 inches in diameter. The stone may be enclosed in wire mesh or gabion basket and anchored to the channel bottom to prevent washing away.
- The dam shall consist of stone riprap or a combination of compacted fill with a stone riprap outlet.
- Fill placed to constrict the swale for construction of the excavated stone outlet sediment trap and fill placed for the berm in the bermed stone outlet sediment trap shall consist of clay material, minimum Plasticity Index of 30, using ASTM D4318 Standard Test for Liquid Limit, Plastic Limit, and Plasticity Index of Soils.
- Fill shall be placed in 8 inch loose lifts (maximum) and compacted to 95% Standard Proctor Density at optimum moisture content using ASTM D698 Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort.
- The outlet shall be designed to have a minimum freeboard of 6" at design flow.

- Rock shall be placed on geotextilefilter fabric meeting the following minimum criteria:
 - Tensile Strength, ASTM D4632 Test Method for Grab Breaking Load and Elongation of Geotextiles, 250-lbs.
 - Puncture Rating, ASTM D4833 Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products, 135-lbs.
 - Mullen Burst Rating, ASTM D3786 Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method, 420-psi.
 - Apparent Opening Size, ASTM D4751 Test Method for Determining Apparent Opening Size of a Geotextile, U.S. Sieve No. 20 (max).
- The geotextile fabric, covered with a layer of stone, shall extend past the base of the embankment on the downstream side a minimum of 2 feet.

3.12.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.12 Stone Outlet Sediment Trap.


3.12.5 Inspection and Maintenance Requirements

The stone outlet sediment trap should be inspected regularly (at least as often as required by the TPDES Construction General Permit) to check for clogging of the void spaces between stones. If the filter stone appears to be clogged, such that the basin will not completely drain, then the filter stone will require maintenance. If the filter stone is not completely clogged it may be raked with a garden rake to allow the water to release from the basin. If filter stone is completely clogged with mud and sediment, then the filter stone will have to be removed and replaced. Failure to keep the filter stone material properly maintained will lead to clogging of the stone riprap embankment. When this occurs, the entire stone rip-rap structure will need to be replaced. If the aggregate appears to be silted in such that efficiency is diminished, the stone should be replaced.

Trash and debris should be removed from the trap after each storm event to prevent it from plugging the rock. Deposited sediment shall be removed before the storage capacity is decreased by one-third, or sediment has reached a depth of one foot, whichever is less. The removed sediment shall be stockpiled or redistributed in areas that are protected with erosion and sediment controls.

3.12.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

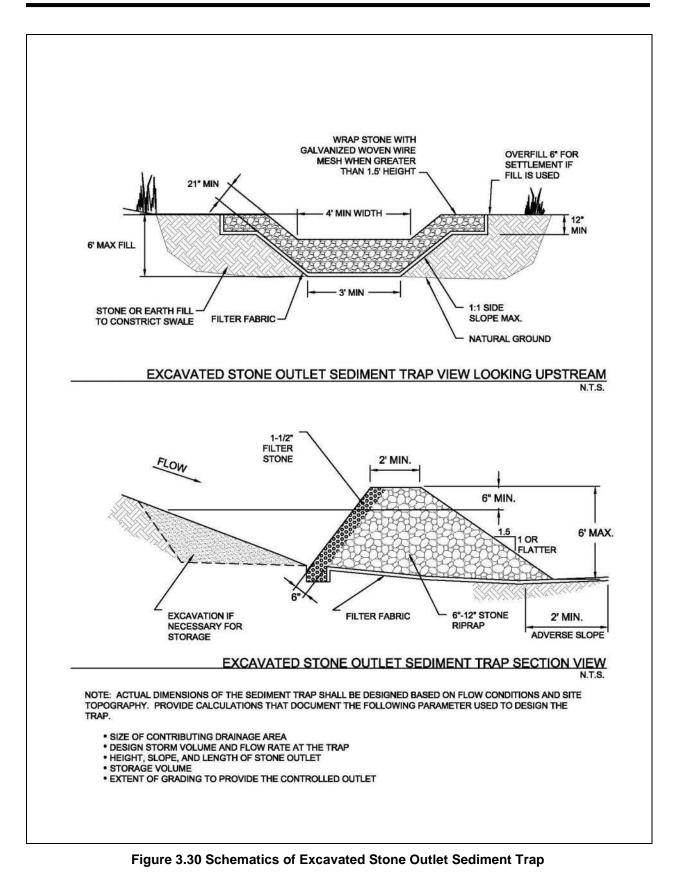


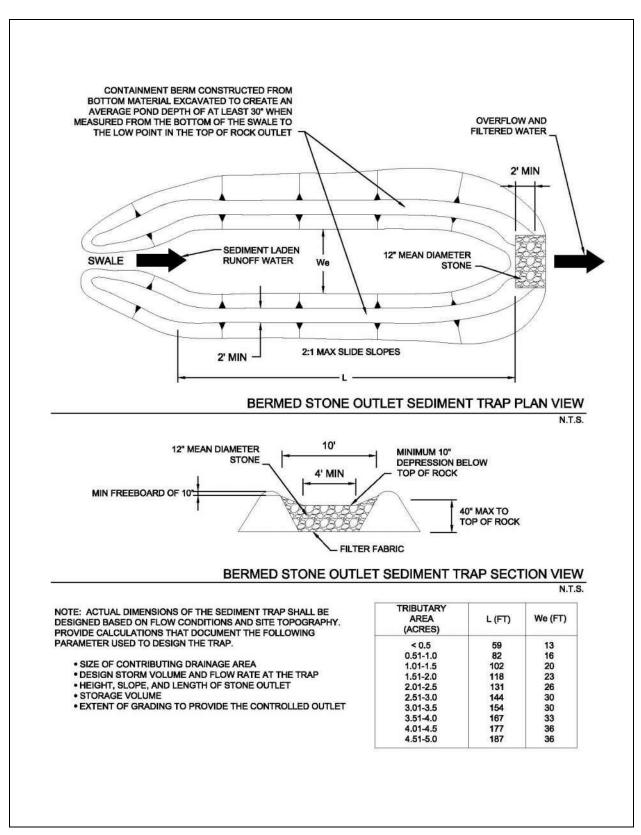


Figure 3.31 Schematics of Bermed Stone Outlet Sediment Trap

(Source: City of Chesterfield Department of Public Works Detail SC 7.2)

Sediment Control

3.13 Triangular Sediment Filter Dike

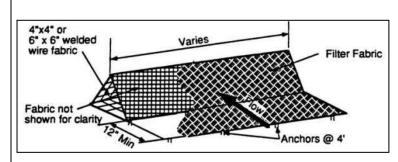

Description: A triangular sediment filter dike is a self-contained silt fence consisting of filter fabric wrapped around welded wire fabric and shaped into a triangular cross section. While similar in use to a silt fence, the dike is reusable, sturdier, transportable, and can be used on paved areas or in situations where it is impractical to install embedded posts for support.

KEY CONSIDERATIONS

DESIGN CRITERIA:

- Maximum drainage area of 0.25 acre per 100 linear feet
 of dike
- Maximum 200 feet distance of flow to filter dike; 50 feet if slope exceeds 10 percent
- Overlap ends of filter material 6 inches to cover dike-todike junction; secure with shoat rings

ADVANTAGES / BENEFITS:

- Can be installed on paved surfaces or where the soil type prevents embedment of other controls
- Withstands more concentrated flow and higher flow rates than silt fence

DISADVANTAGES / LIMITATIONS:

- Localized flooding due to minor ponding at the upslope side of the filter dike
- Not effective where there are substantial concentrated flows
- Not effective along contours due to the potential for flow concentration and overtopping

MAINTENANCE REQUIREMENTS:

- Inspect regularly
- Remove sediment before it reaches 6 inches in depth
- Clean or replace fabric if clogged
- Repair or replace dike when structural deficiencies are found

TARGETED POLLUTANTS

- Sediment
- Nutrients & Toxic Materials
- O Oil & Grease
- Floatable Materials
- O Other Construction Wastes

APPLICATIONS

Perimeter Control

Slope Protection

Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=0.50-0.75

(Depends on soil type)

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- Maintenance
- Training
- Suitability for Slopes > 5%

Other Considerations:

 Effects of ponding on adjacent areas and property

3.13.1 Primary Use

Triangular filter dikes are used in place of silt fence, treating sediment flow at the perimeter of construction areas and at the perimeter of the site. Also, the dikes can serve as stream protection devices by preventing sediment from entering the streams or as check dams in small swales.

Triangular sediment filter dikes are especially useful for construction areas surrounded by pavement, where silt fence, filter berm, or other sediment control installations are impractical.

3.13.2 Applications

Triangular dikes are used to provide perimeter control by detaining sediment on a disturbed site with drainage that would otherwise flow onto adjacent properties. Triangular dikes function as sediment trapping devices when used in areas of sheet flow across disturbed areas or are placed along stream banks to prevent sediment-laden sheet flow from entering the stream. The dikes can be subjected to more concentrated flows and a higher flow rate than silt fence.

Dikes can be used on a variety of surfaces where other controls are not effective. They may be installed on paved surfaces and where the soil type prevents embedment of other sediment controls.

3.13.3 Design Criteria

- Dikes are to be installed along a line of constant elevation (along a contour line).
- Maximum drainage area shall be 0.25 acre per 100 linear feet of dike.
- Maximum flow to any 20 foot section of dike shall be 1 CFS.
- Maximum distance of flow to dike shall be 200 feet or less. If the slope exceeds 10 percent, the flow distance shall be less than 50 feet.
- Maximum slope adjacent to the dike shall be 2:1.
- If 50 percent or less of soil, by weight, passes the U.S. Standard Sieve No. 200, select the apparent opening size (A.O.S.) to retain 85 percent of the soil.
- If 85 percent or more of soil, by weight, passes the U.S. Standard Sieve No. 200, triangular sediment dike shall not be used due to clogging.
- The filter fabric shall meet the following minimum criteria:
 - Tensile Strength, ASTM D4632 Test Method for Grab Breaking Load and Elongation of Geotextiles 90-lbs.
 - Puncture Rating, ASTM D4833 Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products, 60-lbs.
 - Mullen Burst Rating, ASTM D3786 Standard Test Method for Hydraulic Bursting Strength of Textile Fabrics-Diaphragm Bursting Strength Tester Method, 280-psi.
 - Apparent Opening Size, ASTM D4751 Test Method for Determining Apparent Opening Size of a Geotextile, U.S. Siev No. 30 (max) to 100 (min).
 - Ultraviolet Resistance, ASTM D4355 Standard Test Method for Deterioration of Geotextiles by Exposure to Light, Moisture, and Heat in a Xenon Arc Type Apparatus, Minimum 70 percent.
- The internal support for the dike structure shall be 6-gauge 6 inch x 6 inch wire mesh or 6-guage 4 inch x 4 inch welded wire fabric folded into triangular form eighteen (18) inches on each side.
- Tie-in to the existing grade should be accomplished by:

(i) embedding the fabric six-inches below the top of ground on the upslope side;

(ii) extending the fabric to form a 12 inch skirt on the upstream slope and covering it with 3 to 5 inches of $1\frac{1}{2}$ inch washed filter stone; or

(iii) entrenching the base of the triangular dike four inches below ground.

For (ii) above, the skirt and the upslope portion of the triangular dike skeleton should be anchored by metal staples on two-foot centers, driven a minimum of six inches into the ground (except where crossing pavement or exposed limestone). When installed on pavement, the washed rock in option (ii) may be replaced by bags filled with 1½ inch washed filter stone placed at 4 foot spacing to anchor the end of the filter fabric to the pavement.

- Filter material shall lap over ends six (6) inches to cover dike-to-dike junction; each junction shall be secured by shoat rings. Where the dike is placed on pavement, two rock bags shall be used to anchor the overlap to the pavement. Additional bags shall be used as needed to ensure continuous contact with the pavement (no gaps).
- Sand bags or large rock should be used as ballast inside the triangular dike section to stabilize the dike against the effects of high flows.
- Sufficient room for the operation of sediment removal equipment shall be provided between the dike and other obstructions in order to properly remove sediment.
- The ends of the dike shall be turned upgrade to prevent bypass of stormwater.
- When used as a perimeter control on drainage areas larger than 0.5 acres, a stone overflow structure, similar to the one shown in *Section 3.10 Silt Fence*, may be necessary at low points to act as a controlled overflow point in order to prevent localized flooding and failure of the dike.
- If used as check dams in small swales (drainage areas less than 3 acres), the dikes shall be installed according to the spacing and other criteria in *Section 2.1 Check Dam*.

3.13.4 Design Guidance and Specifications

Specifications for construction of this item may be found in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments, Section 201.8 Triangular Sediment Filter Dike.

3.13.5 Inspection and Maintenance Requirements

Triangular sediment filter dikes should be inspected regularly (at least as often as required by the TPDES Construction General Permit). Sediment should be removed before it reaches 6 inches in depth. If the fabric becomes clogged, it should be cleaned or, if necessary, replaced. If structural deficiencies are found, the dike should be immediately repaired or replaced.

The integrity of the filter fabric is important to the effectiveness of the dike. Overlap between dike sections must be checked on a regular basis and repaired if deficient.

3.13.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.



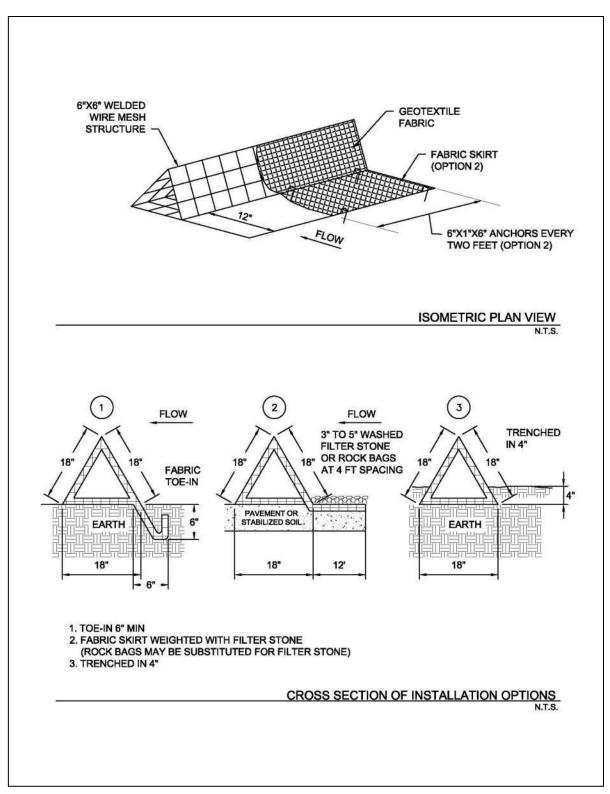


Figure 3.32 Schematics of Triangular Sediment Filter Dike

3.15 Vegetated Filter Strips and Buffers



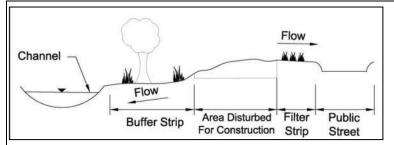

Description: Buffer strips (existing vegetation) and filter strips (planted vegetation) are sections of vegetated land adjacent to disturbed areas. They are designed with low slopes to convey sheet flow runoff from disturbed areas, resulting in the removal of sediment and other pollutants as the runoff passes through vegetation and infiltration occurs.

APPLICATIONS

Perimeter Control

Slope Protection

Sediment Barrier

Channel Protection

Temporary Stabilization

Final Stabilization

Waste Management

Housekeeping Practices

Fe=0.35-0.85

(Depends on many conditions in addition to soil type)

IMPLEMENTATION CONSIDERATIONS

- ⊖ Capital Costs
- O Maintenance
- O Training

Other Considerations:

 Coordination with final landscaping

KEY CONSIDERATIONS

DESIGN CRITERIA:

- Minimum width (direction of flow across the vegetation) dependent on slope of disturbed area
- Maximum ratio of disturbed area to vegetated area dependent on slope
- Existing vegetation must meet criteria for type and coverage
- Dense grass required for planted vegetation
- Demarcate limits of vegetation and protect from traffic

ADVANTAGES / BENEFITS:

- Effective secondary control for removing clay particles
- Disperses flow and slows velocities to decrease erosion potential in receiving water
- Preserves the character of existing riparian corridor
- May become part of the permanent stormwater controls

DISADVANTAGES / LIMITATIONS:

- Appropriate as a primary control only for drainage areas of 2 acres or less and under certain site conditions
- Maximum 150 feet of flow to vegetated strip or buffer is used as a primary control
- Cannot treat large volumes or concentrated flows
- Not effective as a perimeter control when the perimeter cuts across contours instead of following contours
- Must limit access to vegetated portion of the site

MAINTENANCE REQUIREMENTS:

- Inspect regularly
- Rake accumulations of sediment from the vegetation
- Repair bare areas

TARGETED POLLUTANTS

- Sediment
- Nutrients & Toxic Materials
- O Oil & Grease
- Floatable Materials
- O Other Construction Wastes

3.15.1 Primary Use

Vegetated filter strips and buffers are used to reduce the velocity of sheet flow and reduce the volume of runoff through infiltration. In the process, sediment is removed as the runoff is filtered through the vegetation and infiltration occurs.

Vegetated filter strips and buffers are frequently used a secondary sediment control, since their performance is highly variable. They may be used as a primary sediment control only for small areas and under select site conditions.

3.15.2 Applications

Vegetated buffers are most applicable on development projects that are adjacent or near to floodplains, wetlands, streams and other natural waterways. Vegetated strips may be established along roads and property lines as a perimeter control for development. They are also applicable along the down slope side of utility line projects.

Vegetated buffers may be a primary sediment control for small areas where the conditions meet design criteria. They are also commonly used as a secondary control with other perimeter controls to provide higher levels of sediment removal. Vegetated areas have more capability to remove fine particle sizes than many conventional sediment controls. Combinations such as an organic filter tube or silt fence at the upslope edge of a vegetated strip are very effective.

In addition to perimeter control, vegetated strips are applicable for slope protection. Strips may be established at regular intervals to interrupt long or steep slopes. The strips maintain sheet flow, decrease velocities, and decrease erosion on the slopes.

3.15.3 Design Criteria

Vegetated buffers should be preserved along existing floodplains, wetlands, channels, and other natural waters whenever possible, even when the buffer is not a primary sediment control. Check for local requirements, as many municipalities mandate a vegetated buffer to maintain the character of the riparian corridor along a natural waterway. Vegetated buffers are encouraged to protect existing waterways by decreasing velocities, dispersing flow, and attenuating volume before the runoff reaches the waterway. If the development plans necessitate disturbing the riparian corridor, phase the development (when possible) to retain a vegetated buffer until final grading and landscaping at the end construction.

The evaluation and use of vegetated strips and buffers for use as a sediment control are unique to each site. The designer should carefully consider slope, vegetation, soils, depth to impermeable layer, depth to ground water, and runoff sediment characteristics before specifying a vegetated strip or buffer as a primary sediment control. This consideration is especially true for buffer strips of existing vegetation. If the buffer is not correctly planned, the first storm event can damage the natural vegetation beyond repair.

Design criteria in this section are only applicable when a vegetated strip or buffer is intended to be a primary or secondary sediment control for the construction site. As discussed above, a vegetated buffer may be preserved for other reasons that do not necessitate the use of these criteria if other sediment controls are provided for the construction site.

General

- Maximum slope of the vegetated strip or buffer shall be 5% across the width of the vegetation in the direction of flow.
- To maintain sheet flow, maximum distance of flow to the vegetated filter shall be 150 feet.
- Vegetated buffers and strips may only serve as a primary sediment control when the contributing drainage area has a slope of 15% or less. On steeper slopes, another perimeter control (e.g. organic filter tube, silt fence) may be installed at the upslope edge of the vegetated buffer or strip as a primary control, with the vegetation serving as a secondary control.

- Maximum disturbed area contributing runoff to the vegetated strip or buffer shall be 2 acres.
- Vegetated filter strips and buffers shall be a minimum of 15 feet wide. Width shall be increased based on the slope of the disturbed area as shown in the following table. Although the slope of the disturbed area may be up 15%, the slope of the vegetated strip or buffer is still limited to 5% maximum if used as a primary control for sediment.

Table 3.10 Sizing of Vegetated Buffers and Strips					
Maximum Slope of Contributing Drainage Area	Maximum Ratio of Disturbed Area to Vegetated Area	Minimum Width of Vegetated Area (Direction of Flow)			
5%	8:1	15 feet			
10%	5:1	30 feet			
15%	3:1	50 feet			

- Access to vegetated buffers and strips shall be prohibited. These areas shall be protected from all traffic. No activities should occur in these areas, including no parking of the workers' vehicles, no eating of lunch, etc.
- Install controlled and stabilized ingress/egress points to manage traffic and direct it away from vegetation. Fence the vegetation or provide other means of protection to prevent vehicles and equipment from driving on the vegetated areas.
- Vegetated buffers and filter strips should not be used when high ground water, shallow depth to bedrock, or low soil permeability will inhibit infiltration of runoff.

Buffers of Existing Vegetation

- Fencing, flagged stakes spaced at a maximum of 6 feet, or other measures shall be used to clearly mark existing vegetation that is being preserved as a buffer before the start of any clearing, grubbing, or grading.
- Existing vegetation must be well established to be used as a vegetated buffer. It may be a mix of trees, sapling/shrubs, vines and herbaceous plants. However, the herbaceous plants shall cover at least 80 percent of the ground area.
- Bare soil shall not be visible within the buffer. Area between herbaceous plants shall be covered with a natural litter of organic matter (e.g. leaves, dead grass).
- Lots with a thick stand of existing grasses may preserve strips of the grasses as perimeter control in addition to using vegetation as a buffer along a natural waterway.

Strips of Planted Vegetation

- Vegetated strips should only be used when the site perimeter is along (parallel to) contours. Erosion of the vegetated strip will be a problem when the strip is placed along roads or site perimeters that cut across contours, resulting in runoff flowing along, instead of across, the filter strip.
- Minimize vehicle and equipment traffic and other activities that could compact soils on areas that will be planted for vegetated strips.
- Sod is required when the strip is intended to immediately function as a sediment control.
- Erosion control blankets (ECBs) should be used to prevent erosion and provide sediment control while establishing vegetation for a filter strip. If ECBs are not used, than another perimeter control is required until the vegetation is mature. Refer to Section 2.3 Erosion Control Blankets.
- Refer to the Section 2.9 Vegetation for criteria on establishing vegetation.
- When using vegetated strips for slope protection, spacing of the strips should be designed based on

slope steepness and type of soil. The strips may be planted directly on the slope grade when the slope is flatter than 2:1. For slopes of 2:1 and steeper, vegetation should be established on terraces. Terraces shall have a transverse slope of 1 percent in the opposite direction of the slope (i.e. back into the ground).

3.15.4 Design Guidance and Specifications

Guidance for analysis of the hydraulic loading on filter strips is in Section 13.3 of the Stormwater Controls Technical Manual.

No specification for vegetated filter strips and buffers is currently available in the Standard Specifications for Public Works Construction – North Central Texas Council of Governments.

3.15.5 Inspection and Maintenance Requirements

Vegetated filter strips and buffers should be inspected regularly (at least as often as required by the TPDES Construction General Permit). If rill erosion is developing, additional controls are needed to spread the flow before it enters the vegetated area. Rake light accumulations of sediment from the vegetation. Remove trash that accumulates in the vegetation. Additional sediment controls (e.g. a line of organic filter tubes or silt fence), are needed if sediment accumulations are large enough to bury the vegetation.

Inspect established planted vegetation for bare areas and place sod or install seeded erosion control blankets, as appropriate. Mow as needed after planted vegetation is mature.

3.15.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

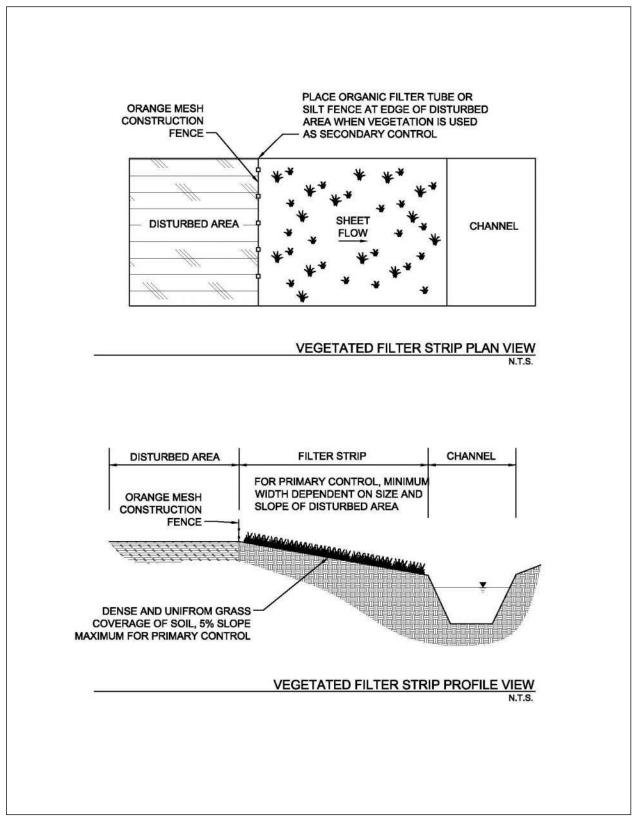


Figure 3.35 Schematics of Vegetated Filter Strip

4.3 Concrete Waste Management

Waste Control

Description: Concrete waste at construction sites comes in two forms: 1) excess fresh concrete mix, including residual mix washed from trucks and equipment, and 2) concrete dust and concrete debris resulting from demolition. Both forms have the potential to impact water quality through stormwater runoff contact with the waste. The objective of concrete waste management is to dispose of these wastes in a manner that protects surface and ground water.

KEY CONSIDERATIONS

DESIGN CRITERIA:

- Prohibit the discharge of untreated concrete washout water
- Prohibit dumping waste concrete anywhere except at pre-determined, regulated, recycling or disposal sites
- Provide a washout containment with a minimum of 6 cubic feet of containment volume for every 10 cubic yards of concrete placed
- Minimum 1 foot freeboard on containment
- Minimum 10 mil plastic lining of containment
- Washout water evaporation and concrete recycling are the recommended disposal methods
- Educate drivers and operators on proper disposal and equipment cleaning procedures

LIMITATIONS:

• Does not address concrete sawcutting waste

MAINTENANCE REQUIREMENTS:

- Inspect regularly
- Check for and repair any damage to washout containment areas
- Clean up any overflow of washout pits
- Regularly remove and properly dispose of concrete
 waste

TARGETED POLLUTANTS

- Sediment
- Nutrients & Toxic Materials
- O Oil & Grease
- O Floatable Materials
- Other Construction Wastes

APPLICATIONS

- **Perimeter Control**
- **Slope Protection**
- Sediment Barrier
- **Channel Protection**
- **Temporary Stabilization**
- **Final Stabilization**
- Waste Management
- **Housekeeping Practices**

IMPLEMENTATION CONSIDERATIONS

- Capital Costs
- Maintenance
- Training
- \bigcirc Suitability for Slopes > 5%

Other Considerations:

• None

4.3.1 Primary Use

Concrete waste management is used to prevent the discharge of concrete wash water and waste into stormwater runoff. A number of water quality parameters can be affected by the introduction of concrete, especially fresh concrete. Concrete affects the pH of runoff, causing significant chemical changes in water bodies and harming aquatic life. Suspended solids in the form of both cement and aggregated dust are also generated from both fresh and demolished concrete waste.

4.3.2 Applications

Concrete waste management is applicable to all construction sites where existing concrete is being demolished or new concrete is being placed, regardless of the size of the total area disturbed. It is also applicable on repair and maintenance projects that may not be required to implement erosion and sediment controls.

4.3.3 Design Criteria

- The discharge of washout water to an inlet, swale, or any portion of the storm drainage system or a natural drainage system (e.g. channel) shall be prohibited.
- Construction plan notes shall state that the discharge of concrete washout to anything except a designated containment area is prohibited.
- Show the location of the concrete washout containment on the drawings, or require the contractor to provide this information.
- The contractor should be required to designate the site superintendent, foreman, or other person who is responsible for concrete placement to also be responsible for concrete waste management.

Unacceptable Waste Concrete Disposal Practices

- Dumping in vacant areas on the job-site.
- Illicit dumping onto off-site lots or any other placed not permitted to receive construction demoliotion debris.
- Dumping into ditches, drainage facilities, or natural water ways.
- Using concrete waste as fill material or bank stabilization.

Recommended Disposal Procedures

- Identify pre-determined, regulated, facilities for disposal of solid concrete waste. Whenever possible, haul the concrete waste to a recycling facility. Disposal facilities must have a Class IV (or more stringent) municipal solid waste permit from the TCEQ.
- A concrete washout pit or other containment shall be installed a minimum of 50 feet away from inlets, swales, drainage ways, channels, and other waters, if the site configuration provides sufficient space to do so. In no case shall concrete washout occur closer than 20 feet from inlets, swales, drainage ways, channels and other waters.
- Provide a washout area with a minimum of 6 cubic feet of containment volume for every 10 cubic yards of concrete poured. Alternatively, the designer may provide calculations sizing the containment based on the number of concrete trucks and pumps to be washed out.
- The containment shall be lined with plastic (minimum 10 millimeters thick) or an equivalent measure to prevent seepage to groundwater.
- Mosquitoes do not typically breed in the high pH of concrete washout water. However, the concrete washout containment should be managed in a manner that prevents the collection of other water that could be a potential breeding habitat.

- Do not excavate the washout area until the day before the start of concrete placement to minimize the potential for collecting stormwater.
- Do not discharge any water or wastewater into the containment except for concrete washout to prevent dilution of the high pH environment that is hostile to mosquitoes.
- Remove the waste concrete and grade the containment closed within a week of completing concrete placement. Do not leave it open to collect stormwater.
- If water must be pumped from the containment, it shall be collected in a tank, neutralized to lower the pH, and then hauled to a treatment facility for disposal. Alternatively, it may be hauled to a batch plant that has an onsite collection facility for concrete washout water.
- Do <u>not</u> pump water directly from the containment to the Municipal Separate Storm Sewer System or a natural drainage way without treating for removal of fine particles and neutralization of the pH.
- Multiple concrete washout areas may be needed for larger projects to allow for drying time and proper disposal of the washout water and waste concrete.
- Portable, pre-fabricated, concrete washout containers are commercially available and are an acceptable alternative to excavating a washout area.
- Evaporation of the washout water and recycling of the concrete waste is the preferred disposal method. After the water has evaporated from the washout containment, the remaining cuttings and fine sediment shall be hauled from the site to a concrete recycling facility or a solid waste disposal facility.
- Remove waste concrete when the washout containment is half full. Always maintain a minimum of one foot freeboard.
- Use waste and recycling haulers and facilities approved by the local municipality.
- When evaporation of the washout water is not feasible, discharge from the collection area shall only be allowed if a passive treatment system is used to remove the fines. Criteria are in Section 3.7 Passive Treatment System. Mechanical mixing is required within the containment for passive treatment to be effective. The pH must be tested, and discharge is allowed only if the pH does not exceed 8.0. The pH may be lowered by adding sulfuric acid to the water. Dewatering of the collection area after treatment shall follow the criteria in Section 3.3 Dewatering Controls.
- Care shall be exercised when treating the concrete washout water for discharge. Monitoring must be implemented to verify that discharges do not violate groundwater or surface water quality standards.
- On large projects that are using a nearby batch plant, a washout facility associated with the plant and under the plant's TPDES Multi-Sector General Permit may be used instead of installing an onsite containment area for truck washout.

Education

- Drivers and equipment operators should be instructed on proper disposal and equipment washing practices (see above).
- Supervisors must be made aware of the potential environmental consequences of improperly handled concrete waste.

Enforcement

- The construction site manager or foreman must ensure that employees and pre-mix companies follow proper procedures for concrete disposal and equipment washing.
- Employees violating disposal or equipment cleaning directives must be re-educated or disciplined if necessary.

Demolition Practices

- Monitor weather and wind direction to ensure concrete dust is not entering drainage structures and surface waters.
- Spray water on structures being demolished to wet them before start of demolition operations. Reapply water whenever dust is observed.
- Construct sediment traps or other types of sediment detention devices downstream of demolition activities to capture and treat runoff from demolition wetting operations.

4.3.4 Design Guidance and Specifications

No specification for concrete waste management is currently available in the Standard Specifications for Public Works – North Central Texas Council of Governemtns.

4.3.5 Inspection and Maintenance Requirements

Concrete waste management controls should be inspected regularly (at least as often as required by the TPDES Construction General Permit) for proper handling of concrete waste. Check concrete washout pits and make repairs as needed. Washout pits should not be allowed to overflow. Maintain a schedule to regularly remove concrete waste and prevent over-filling.

If illicit dumping of concrete is found, remove the waste and reinforce proper disposal methods through education of employees.

4.3.6 Example Schematics

The following schematics are example applications of the construction control. They are intended to assist in understanding the control's design and function.

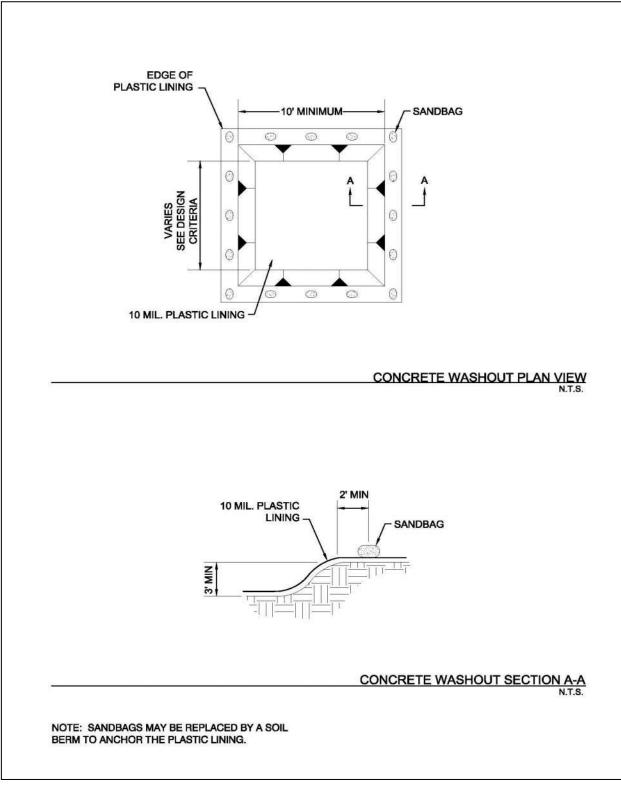


Figure 4.1 Schematics of Concrete Washout Containment

APPENDIX D

INSPECTION AND MAINTENANCE REPORTS

Inspector Qualifications*

Inspector Name:				
Qualifications (Check as appropriate and provide description):				
Training Course				
Supervised Experience				
Inspector Name:				
Qualifications (Check as appropriate and provide description):				
Training Course				
Supervised Experience				
Inspector Name:				
Qualifications (Check as appropriate and provide description):				
Training Course				
Supervised Experience				

*Personnel conducting inspections must be knowledgeable of the general permit, familiar with the construction site, and knowledgeable of the SWP3 for the site.

INSPECTION SCHEDULE

Inspections must be conducted:

- Option 1 at least once every 14 calendar days and within 24 hours of the end of a storm event of 0.5 inch or greater
- **Option 2** at least once every 7 calendar days, regardless of whether or not there has been a rainfall event since the previous inspection.

Any changes to the schedule are conducted in accordance with the following:

- the schedule is changed a maximum of one time each month,
- the schedule change must be implemented at the beginning of a calendar month, and
- the reason for the schedule change must be documented below.

Date	Schedule Option	Reason for Schedule Change

Construction Site SWP3 Inspection Report

Complies	
□ Warning	No.
Project Shutdown	
	□ Warning

~	On-	Site	Up-to-date		
SWP3	Yes	No ¹	Yes	No ²	
0,					

	Project:	Date:	
al tion	Address:	Inspector:	
neral matio		Qualifications: see Appendix E of SWP3	
Ge		Weather Conditions:	
<u> </u>	Owner:	Contractor:	

BMP	BN In U Yes	lse	Maint. Req'd		Comments
		No	Yes ²	No	

¹The SWP3 must be retained on-site at the construction site or, if the site is inactive or does not have an on-site location to store the plan, a notice must be posted describing the location of the SWP3.

²Items marked in this column need to be addressed in the Actions to be Taken table.

ACTIONS TO BE TAKEN	RESPONSIBLE PERSON(S)	DUE DATE	DATE COMPLETED	INITIALS

NOTE: These reports will be kept on file as part of the Storm Water Pollution Prevention Plan for at least three years. A copy of the SWP3 will be kept at the site at all times during construction.

CERTIFICATION STATEMENT: *"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."*

Name:

Address:

Telephone:

Site Location:

Inspector Signature:

Date:

MAINTENANCE GUIDELINES

- 1. Below are some maintenance practices to be used to maintain erosion and sediment controls:
 - All control measures will be inspected according to the schedule identified in Appendix E.
 - All measures will be maintained in good working order. The operator should correct any damage or deficiencies as soon as practicable after the inspection, but in no case later than seven (7) calendar days after the inspection.
 - BMP Maintenance (as applicable)
 - Sediment must be removed from sediment traps and sedimentation ponds no later than the time that design capacity has been reduced by 50%. For perimeter controls such as silt fences, berms, etc., the trapped sediment must be removed before it reaches 50% of the above-ground height.
 - Silt fence will be inspected for depth of sediment, tears, to see of the fabric is securely attached to the fence posts, and to see that the fence posts are firmly in the ground.
 - Drainage swale will be inspected and repaired as necessary.
 - Inlet control will be inspected and repaired as necessary.
 - Check dam will be inspected and repaired as necessary.
 - Straw bale dike will be inspected and repaired as necessary.
 - Diversion dike will be inspected and any breaches promptly repaired.
 - Temporary and permanent seeding and planting will be inspected for bare spots, washouts, and healthy growth.
 - If sediment escapes the site, accumulations must be removed at a frequency that minimizes off-site impacts, and prior to the next rain event, if feasible. If the permittee does not own or operate the off-site conveyance, then the permittee must to work with the owner or operator of the property to remove the sediment.
 - Locations where vehicles enter or exit the site must be inspected for evidence of off-site sediment tracking.
- 2. To maintain the above practices, the following will be performed:
 - Maintenance and repairs will be conducted before the next anticipated storm event or as necessary to maintain the continued effectiveness of storm water controls. Following an inspection, deficiencies should be corrected no later than seven (7) calendar days after the inspection.
 - Any necessary revisions to the SWP3 as a result of the inspection must be completed within seven (7) calendar days following the inspection. If existing BMPs are modified or if additional BMPs are necessary, an implementation schedule must be described in the SWP3 and wherever possible those changes implemented before the next storm event.
 - Personnel selected for inspection and maintenance responsibilities must be knowledgeable of the general permit, familiar with the construction site, and knowledgeable of the SWP3 for the site.

APPENDIX E

ROLES AND RESPONSIBILITIES CHECKLIST AND CERTIFICATION STATEMENT

PRIMARY AND SECONDARY OPERATOR GENERAL RESPONSIBILITIES

DEFINITIONS:

<u>Operator</u> - The person or persons associated with a large or small construction activity that is either a primary or secondary operator as defined below:

<u>Primary Operator</u> – the person or persons associated with a large or small construction activity that meets either of the following two criteria:

- (a.) the person or persons have operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications, or
- (b.) the person or persons have day-to-day operational control of those activities at a construction site that are necessary to ensure compliance with a storm water pollution prevention plan (SWP3) for the site or other permit conditions (e.g., they are authorized to direct workers at a site to carry out activities required by the SWP3 or comply with other permit conditions).

<u>Secondary Operator</u> – The person whose operational control is limited to the employment of other operators or to the ability to approve or disapprove changes to plans and specifications. A secondary operator is also defined as a primary operator and must comply with the permit requirements for primary operators if there are no other operators at the construction site.

Please note that both Owners and Contractors can meet the definition of being an Operator and will need to fulfill the associated requirements. The Roles and Responsibilities Checklist and Certification Statement located in Appendix F are to be completed and signed by the Owner and Contractor(s).

Secondary Operators and Primary Operators with Control Over Construction Plans and Specifications

All secondary operators and primary operators with control over construction plans and specifications must:

- (a.) ensure the project specifications allow or provide that adequate BMPs are developed to meet the requirements of the general permit,
- (b.) ensure that the SWP3 indicates the areas of the project where they have control over project specifications, including the ability to make modifications in specifications,
- (c.) ensure all other operators affected by modifications in project specifications are notified in a timely manner so that those operators may modify their best management practices as necessary to remain compliant with the conditions of this general permit, and
- (d.) ensure that the SWP3 for portions of the project where they are operators indicates the name and site-specific TPDES authorization numbers for permittees with the day-to-day operational control over those activities necessary to ensure compliance with the SWP3 and other permit conditions. If the party with day-to-day operational control has not been authorized or has abandoned

the site, the person with control over project specifications is considered to be the responsible party until the authority is transferred to another party and the SWP3 is updated.

Primary Operators with Day-to-Day Operational Control

Primary Operators with day-to-day operational control of those activities at a project that are necessary to ensure compliance with the SWP3 and other permit conditions must ensure that the SWP3 accomplishes the following requirements:

- (a.) meets the requirements of the general permit for those portions of the project where they are operators,
- (b.) the parties responsible for implementation of BMPs described in the SWP3,
- (c.) indicates areas of the project where they have operational control over day-today activities, and
- (d.) includes, for areas where they have operational control over day-to-day activities, the name and site-specific TPDES authorization number of the parties with control over project specifications, including the ability to make modifications in specifications.

Roles and Responsibilities Checklist

Role/Responsibility	Project Owner*	Primary Operator	Secondary Operator
Development of initial design specifications			
Payment for proposed construction activity			
Maintain SWP3 records for three years from the date that a NOT is submitted			
Complete, sign, and postmark NOI at least seven days prior to beginning of construction activity, or Complete, sign, and electronically submit NOI prior to the beginning of construction activity			
Post a copy of the signed NOI at project site and maintain through duration of project			
Post copy of completed construction site notice(s) at project site through duration of project			
Provide a copy of the signed NOI to any secondary operator and to the operator of any MS4 receiving construction site discharge, at least seven days prior to commencing construction activities			
Maintain schedule of major construction activities, keep a copy with SWP3, and retain a copy of the SWP3 at the construction site at all times			
Update SWP3 to reflect daily operations (e.g., revisions, installation dates, grading operation dates, BMP maintenance, and inspection information)			
Update SWP3 to reflect changes in the Contractor's contact information			
Identify, maintain and modify BMPs (as necessary) to control erosion and sedimentation due to construction activities throughout life of project			
Provide stabilized construction entrances and sediment barriers, and clean existing rock and/or add rock to prevent mud and dirt from entering streets or alleys			
Maintain and/or replace sediment barriers and silt traps (if installed), etc. throughout life of project			
Maintain erosion control on stockpiles without blocking drainage paths			
Perform SWP3 inspections in accordance with TPDES General Permit, and keep inspection reports with SWP3			
Based on inspection results, modify SWP3 and pollution prevention controls to maintain that storm water (or identified non-storm water discharges) are the only discharges leaving the site			

Role/Responsibility	Project Owner*	Primary Operator	Secondary Operator
Provide proper management of project-generated trash and debris, including debris collected from storm water protection devices			
Stabilize all disturbed areas related to construction for temporary or permanent ceasing of activities			
Comply with all State and local sanitary sewer or septic system regulations			
Provide copies of all SWP3 records to the Project Owner			
Complete, sign, and submit NOT form to the TCEQ and MS4 Operators when the project has been completed and stabilized			
Complete applicable portion of the site notice related to removal of the notice and submit to the operator of any MS4 receiving site discharge			

*Please note that the Project Owner can meet the definition of an operator. Please refer to the definitions of "primary operator" and "secondary operator" for more information.

Each operator engaged in activities that disturb surface soils must be identified and must sign the following certification statement. Signatory requirement guidance and an additional certification statement form are attached (Appendix F).

Certification Statement:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code §305.44 to sign this document and can provide documentation in proof of such authorization upon request."

General Contractor		
Name:		
_ Operator Type:		
Subcontractor (as appropriate)		
Subcontractor (as appropriate)		
Subcontractor (as appropriate)		
Subcontractor (as appropriate)Name:Title:		
Subcontractor (as appropriate) Name: Title: Company:		
Subcontractor (as appropriate)Name:Title:		
	_ Company: Signature: Date:	

1	NOTICE OF INTENT (NOI) LO	G	
Name	Company	Date Submitted NOI	TPDES Permit No.

APPENDIX F

TPDES GENERAL PERMIT (TXR150000) FOR STORM WATER DISCHARGES FROM CONSTRUCTION ACTIVITIES

Texas Commission on Environmental Quality

P.O. Box 13087, Austin, Texas 78711-3087



GENERAL PERMIT TO DISCHARGE UNDER THE

TEXAS POLLUTANT DISCHARGE ELIMINATION SYSTEM

under provisions of Section 402 of the Clean Water Act and Chapter 26 of the Texas Water Code

This permit supersedes and replaces TPDES General Permit No. TXR150000, effective March 5, 2018, and amended January 28, 2022

Construction sites that discharge stormwater associated with construction activity located in the state of Texas may discharge to surface water in the state only according to monitoring requirements and other conditions set forth in this general permit, as well as the rules of the Texas Commission on Environmental Quality (TCEQ or Commission), the laws of the State of Texas, and other orders of the Commission of the TCEQ. The issuance of this general permit does not grant to the permittee the right to use private or public property for conveyance of stormwater and certain non-stormwater discharges along the discharge route. This includes property belonging to but not limited to any individual, partnership, corporation or other entity. Neither does this general permit authorize any invasion of personal rights nor any violation of federal, state, or local laws or regulations. It is the responsibility of the permittee to acquire property rights as may be necessary to use the discharge route.

This general permit and the authorization contained herein shall expire at midnight, on March 5, 2028.

EFFECTIVE DATE: March 5, 2023

ISSUED DATE: Febrary 27, 2023

For the Commission

TPDES GENERAL PERMIT NUMBER TXR150000

RELATING TO STORMWATER DISCHARGES ASSOCIATED WITH CONSTRUCTION ACTIVITIES

Table of Contents

Part I.	Flow (Chart and Definitions	5
Sectio	on A.	Flow Chart to Determine Whether Coverage is Required	5
Sectio	n B.	Definitions	6
Part II.	Permi	t Applicability and Coverage	12
Sectio	on A.	Discharges Eligible for Authorization	12
1.	Storm	water Associated with Construction Activity	12
2.	Disch	arges of Stormwater Associated with Construction Support Activities	12
3.	Non-S	Stormwater Discharges	12
4.	Other	Permitted Discharges	13
Sectio	on B.	Concrete Truck Wash Out	13
Sectio	on C.	Limitations on Permit Coverage	13
1.	Post C	Construction Discharges	13
2.	Prohil	pition of Non-Stormwater Discharges	13
3.	Comp	liance with Water Quality Standards	14
4.		red Receiving Waters and Total Maximum Daily Load (TMDL) Requirem	
			•
5.		arges to the Edwards Aquifer Recharge or Contributing Zone	
6.		arges to Specific Watersheds and Water Quality Areas	
7.		ction of Streams and Watersheds by Other Governmental Entities	-
8.		n Country Lands	-
9.	-	pt Oil and Gas Activities	
10.		water Discharges from Agricultural Activities	
11.		ngered Species Act	
12.	Storag	ge of High-Level Radioactive Waste	16
13.			
Sectio		Deadlines for Obtaining Authorization to Discharge	
1.	U	Construction Activities	
2.	Small	Construction Activities	
Sectio		Obtaining Authorization to Discharge	-
1.		natic Authorization for Small Construction Activities with Low Potential f	
2.	Auton	natic Authorization for Small Construction Activities	18


3.	Autho	rization for Large Construction Activities 19
4.	Waive	ers for Small Construction Activities:
5.	Effect	ive Date of Coverage
6.	Conte	nts of the NOI22
7.	Notice	e of Change (NOC)22
8.	0	tory Requirement for NOI Forms, NOT Forms, NOC Forms, and Construction fotices
Sectio	n F.	Terminating Coverage24
1.	Notice	e of Termination (NOT) Required24
2.	Minin	num Contents of the NOT24
3.		nation of Coverage for Small Construction Sites and for Secondary Operators ge Construction Sites25
4.	Trans	fer of Day-to-Day Operational Control25
Sectio	n G.	Waivers from Coverage
1.	Waive	er Applicability and Coverage26
2.	Steps	to Obtaining a Waiver27
3.	Effect	ive Date of an LREW27
4.	Activi	ties Extending Beyond the LREW Period28
Sectio	n H.	Alternative TPDES Permit Coverage
1.	Indivi	dual Permit Alternative28
2.	Gener	al Permit Alternative28
3.	Indivi	dual Permit Required28
Sectio	n I.	Permit Expiration29
Part III.	Storm	water Pollution Prevention Plans (SWP3)29
Sectio	n A.	Shared SWP3 Development
Sectio	n B.	Responsibilities of Operators
1.		dary Operators and Primary Operators with Control Over Construction Plans pecifications
2.	Prima	ry Operators with Day-to-Day Operational Control
Sectio	n C.	Deadlines for SWP3 Preparation, Implementation, and Compliance
Sectio	n D.	Plan Review and Making Plans Available
Sectio	n E.	Revisions and Updates to SWP3s
Sectio	n F.	Contents of SWP3
Part IV.	Erosio	on and Sediment Control Requirements Applicable to All Sites43
Sectio	n A.	Erosion and Sediment Controls43
Sectio	n B.	Soil Stabilization
Sectio	n C.	Dewatering44

Section D.	Pollution Prevention Measures44
Section E.	Prohibited Discharges45
Section F.	Surface Outlets45
Part V. Stor	rmwater Runoff from Concrete Batch Plants45
Section A.	Benchmark Sampling Requirements46
Section B.	Best Management Practices (BMPs) and SWP3 Requirements47
Section C.	Prohibition of Wastewater Discharges50
Part VI. Con	crete Truck Wash Out Requirements50
Part VII. Ret	ention of Records50
Part VIII. Sta	andard Permit Conditions
Part IX. Fee	s52
Appendix A:	Automatic Authorization53
Appendix B:	Storm Erosivity (EI) Zones in Texas55
Appendix C:	Isoerodent Map56
Appendix D:	Erosivity Indices for EI Zones in Texas

Flow Chart and Definitions Part I.

Section A. Flow Chart to Determine Whether Coverage is Required

When calculating the acreage of land area disturbed, include the disturbed land-area of all construction and construction support activities.

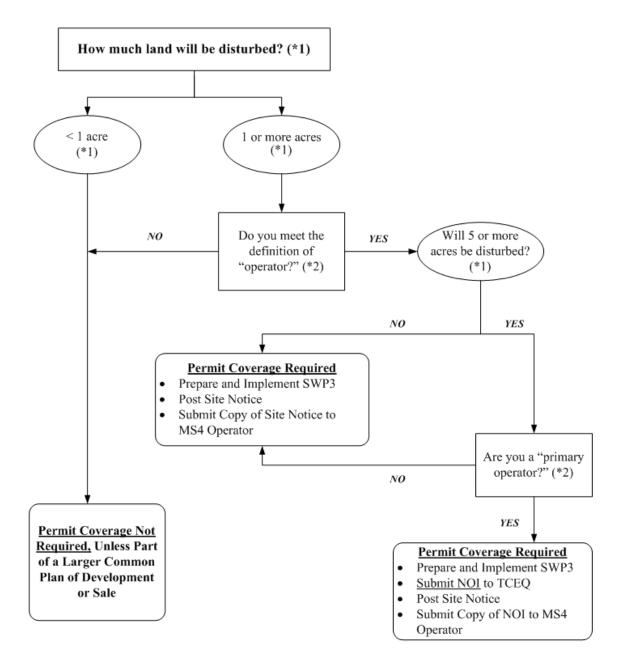

- (*1) To determine the size of the construction project, use the size of the entire area to be disturbed, and include the size of the larger common plan of development or sale, if the project is part of a larger project (refer to Part I.B., "Definitions," for an explanation of "common plan of development or sale"). Refer to the definitions for "operator," "primary operator," and "secondary operator" in Part I.,
- (*2)Section B. of this permit.

Section B. Definitions

Arid Areas – Areas with an average annual rainfall of zero (0) to ten (10) inches.

Best Management Practices (BMPs) – Schedules of activities, prohibitions of practices, maintenance procedures, structural controls, local ordinances, and other management practices to prevent or reduce the discharge of pollutants. BMPs also include treatment requirements, operating procedures, and practices to control construction site runoff, spills or leaks, waste disposal, or drainage from raw material storage areas.

Commencement of Construction – The initial disturbance of soils associated with clearing, grading, or excavation activities, as well as other construction-related activities (e.g., demolition; grubbing; stockpiling of fill material; placement of raw materials at the site).

Common Plan of Development – A construction activity that is completed in separate stages, separate phases, or in combination with other construction activities. A common plan of development (also known as a "common plan of development or sale") is identified by the documentation for the construction project that identifies the scope of the project, and may include plats, blueprints, marketing plans, contracts, building permits, a public notice or hearing, zoning requests, or other similar documentation and activities. A common plan of development does not necessarily include all construction projects within the jurisdiction of a public entity (e.g., a city or university). Construction of roads or buildings in different parts of the jurisdiction would be considered separate "common plans," with only the interconnected parts of a project being considered part of a "common plan" (e.g., a building and its associated parking lot and driveways, airport runway and associated taxiways, a building complex, etc.). Where discrete construction projects occur within a larger common plan of development or sale but are located one quarter (1/4) mile or more apart, and the area between the projects is not being disturbed, each individual project can be treated as a separate plan of development or sale, provided that any interconnecting road, pipeline or utility project that is part of the same "common plan" is not included in the area to be disturbed.

Construction Activity – Includes soil disturbance activities, including clearing, grading, excavating, construction-related activity (e.g., stockpiling of fill material, demolition), and construction support activity. This does not include routine maintenance that is performed to maintain the original line and grade, hydraulic capacity, or original purpose of the site (e.g., the routine grading of existing dirt roads, asphalt overlays of existing roads, the routine clearing of existing rights-of-way, and similar maintenance activities). Regulated construction activity is defined in terms of small and large construction activity.

Construction Support Activity – A construction-related activity that specifically supports construction activity, which can involve earth disturbance or pollutant-generating activities of its own, and can include, but are not limited to, activities associated with concrete or asphalt batch plants, rock crushers, equipment staging or storage areas, chemical storage areas, material storage areas, material borrow areas, and excavated material disposal areas. Construction support activity must only directly support the construction activity authorized under this general permit.

Dewatering – The act of draining accumulated stormwater or groundwater from building foundations, vaults, trenches, and other similar points of accumulation.

Discharge – For the purposes of this permit, the drainage, release, or disposal of pollutants in stormwater and certain non-stormwater from areas where soil disturbing activities (e.g., clearing, grading, excavation, stockpiling of fill material, and demolition), construction materials or equipment storage or maintenance (e.g., fill piles, borrow area, concrete truck wash out, fueling), or other industrial stormwater directly related to the construction process (e.g., concrete or asphalt batch plants) are located.

Drought-Stricken Area – For the purposes of this permit, an area in which the National Oceanic and Atmospheric Administration's U.S. Seasonal Drought Outlook indicates for the period during which the construction will occur that any of the following conditions are likely: (1) "Drought to persist or intensify", (2) "Drought ongoing, some improvement", (3) "Drought likely to improve, impacts ease", or (4) "Drought development likely". See http://www.cpc.ncep.noaa.gov/products/expert_assessment/seasonal_drought.html.

Edwards Aquifer – As defined under Texas Administrative Code (TAC) § 213.3 of this title (relating to the Edwards Aquifer), that portion of an arcuate belt of porous, water-bearing, predominantly carbonate rocks known as the Edwards and Associated Limestones in the Balcones Fault Zone trending from west to east to northeast in Kinney, Uvalde, Medina, Bexar, Comal, Hays, Travis, and Williamson Counties; and composed of the Salmon Peak Limestone, McKnight Formation, West Nueces Formation, Devil's River Limestone, Person Formation, Kainer Formation, Edwards Formation, and Georgetown Formation. The permeable aquifer units generally overlie the less-permeable Glen Rose Formation to the south, overlie the less-permeable Comanche Peak and Walnut Formations north of the Colorado River, and underlie the less-permeable Del Rio Clay regionally.

Edwards Aquifer Recharge Zone – Generally, that area where the stratigraphic units constituting the Edwards Aquifer crop out, including the outcrops of other geologic formations in proximity to the Edwards Aquifer, where caves, sinkholes, faults, fractures, or other permeable features would create a potential for recharge of surface waters into the Edwards Aquifer. The recharge zone is identified as that area designated as such on official maps located in the offices of the Texas Commission on Environmental Quality (TCEQ) and the appropriate regional office. The Edwards Aquifer Map Viewer, located at https://www.tceq.texas.gov/gis/edwards-viewer.html

Edwards Aquifer Contributing Zone – The area or watershed where runoff from precipitation flows downgradient to the recharge zone of the Edwards Aquifer. The contributing zone is located upstream (upgradient) and generally north and northwest of the recharge zone for the following counties: all areas within Kinney County, except the area within the watershed draining to Segment No. 2304 of the Rio Grande Basin; all areas within Uvalde, Medina, Bexar, and Comal Counties; all areas within Hays and Travis Counties, except the area within the watersheds draining to the Colorado River above a point 1.3 miles upstream from Tom Miller Dam, Lake Austin at the confluence of Barrow Brook Cove, Segment No. 1403 of the Colorado River Basin; and all areas within Williamson County, except the area within the watersheds draining to the Lampasas River above the dam at Stillhouse Hollow reservoir, Segment No. 1216 of the Brazos River Basin. The contributing zone is illustrated on the Edwards Aquifer map viewer at https://www.tceq.texas.gov/gis/edwards-viewer.html

Effluent Limitations Guideline (ELG) – Defined in 40 Code of Federal Regulations (CFR) § 122.2 as a regulation published by the Administrator under § 304(b) of the Clean Water Act (CWA) to adopt or revise effluent limitations.

Facility or Activity – For the purpose of this permit, referring to a construction site, the location of construction activity, or a construction support activity that is regulated under this general permit, including all contiguous land and fixtures (for example, ponds and materials stockpiles), structures, or appurtenances used at a construction site or industrial site.

Final Stabilization – A construction site status where any of the following conditions are met:

- (a) All soil disturbing activities at the site have been completed and a uniform (that is, evenly distributed, without large bare areas) perennial vegetative cover with a density of at least 70% of the native background vegetative cover for the area has been established on all unpaved areas and areas not covered by permanent structures, or equivalent permanent stabilization measures (such as the use of riprap, or gabions) have been employed.
- (b) For individual lots in a residential construction site by either:
 - (1) the homebuilder completing final stabilization as specified in condition (a) above; or
 - (2) the homebuilder establishing temporary stabilization for an individual lot prior to the time of transfer of the ownership of the home to the buyer and after informing the homeowner of the need for, and benefits of, final stabilization. If temporary stabilization is not feasible, then the homebuilder may fulfill this requirement by retaining perimeter controls or BMPs, and informing the homeowner of the need for removal of temporary controls and the establishment of final stabilization. Fulfillment of this requirement must be documented in the homebuilder's stormwater pollution prevention plan (SWP3).
- (c) For construction activities on land used for agricultural purposes (such as pipelines across crop or range land), final stabilization may be accomplished by returning the disturbed land to its preconstruction agricultural use. Areas disturbed that were not previously used for agricultural activities, such as buffer strips immediately adjacent to surface water and areas that are not being returned to their preconstruction agricultural use must meet the final stabilization conditions of condition (a) above.
- (d) In arid, semi-arid, and drought-stricken areas only, all soil disturbing activities at the site have been completed and both of the following criteria have been met:
 - (1) temporary erosion control measures (for example, degradable rolled erosion control product) are selected, designed, and installed along with an appropriate seed base to provide erosion control for at least three years without active maintenance by the operator, and
 - (2) the temporary erosion control measures are selected, designed, and installed to achieve 70% of the native background vegetative coverage within three years.

High-Level Radioactive Waste – Meaning as assigned by 42 United States Code (U.S.C.) Section 10101 (12) and includes spent nuclear fuel as defined by 42 U.S.C. Section 10101 (23).

Hyperchlorination of Waterlines – Treatment of potable water lines or tanks with chlorine for disinfection purposes, typically following repair or partial replacement of the waterline or tank, and subsequently flushing the contents.

Impaired Water – A surface water body that is identified as impaired on the latest approved CWA § 303(d) List or waters with an EPA-approved or established total maximum daily load (TMDL) that are found on the latest EPA approved *Texas Integrated Report of Surface Water Quality for CWA Sections 305(b) and 303(d)*, which lists the category 4 and 5 water bodies.

Indian Country Land – (1) All land within the limits of any Indian reservation under the jurisdiction of the United States government, notwithstanding the issuance of any patent, and, including rights-of-way running through the reservation; (2) all dependent Indian communities with the borders of the United States whether within the originally or subsequently acquired territory thereof, and whether within or without the limits of a state; and (3) all Indian allotments, the Indian titles to which have not been extinguished, including rights-of-way running through the same. (40 CFR § 122.2)

Construction General Permit

Indian Tribe – Any Indian Tribe, band, group, or community recognized by the Secretary of the Interior and exercising governmental authority over a Federal Indian Reservation (40 CFR § 122.2).

Infeasible – Not technologically possible, or not economically practicable and achievable in light of best industry practices. (40 CFR § 450.11(b)).

Large Construction Activity – Construction activities including clearing, grading, and excavating that result in land disturbance of equal to or greater than five (5) acres of land. Large construction activity also includes the disturbance of less than five (5) acres of total land area that is part of a larger common plan of development or sale if the larger common plan will ultimately disturb equal to or greater than five (5) acres of land. Large construction activity does not include routine maintenance that is performed to maintain the original line and grade, hydraulic capacity, or original purpose of the site (for example, the routine grading of existing dirt roads, asphalt overlays of existing roads, the routine clearing of existing right-of-ways, and similar maintenance activities).

Linear Project – Includes the construction of roads, bridges, conduits, substructures, pipelines, sewer lines, towers, poles, cables, wires, connectors, switching, regulating and transforming equipment and associated ancillary facilities in a long, narrow area.

Low Rainfall Erosivity Waiver (LREW) – A written submission to the executive director from an operator of a construction site that is considered as small construction activity under the permit, which qualifies for a waiver from the requirements for small construction activities, only during the period of time when the calculated rainfall erosivity factor is less than five (5).

Minimize – To reduce or eliminate to the extent achievable using stormwater controls that are technologically available and economically practicable and achievable in light of best industry practices.

Municipal Separate Storm Sewer System (MS4) – A separate storm sewer system owned or operated by the United States, a state, city, town, county, district, association, or other public body (created by or pursuant to state law) having jurisdiction over the disposal of sewage, industrial wastes, stormwater, or other wastes, including special districts under state law such as a sewer district, flood control or drainage district, or similar entity, or an Indian tribe or an authorized Indian tribal organization, that discharges to surface water in the state.

Notice of Change (NOC) – Written notification to the executive director from a discharger authorized under this permit, providing changes to information that was previously provided to the agency in a notice of intent form.

Notice of Intent (NOI) – A written submission to the executive director from an applicant requesting coverage under this general permit.

Notice of Termination (NOT) – A written submission to the executive director from a discharger authorized under this general permit requesting termination of coverage.

Operator – The person or persons associated with a large or small construction activity that is either a primary or secondary operator as defined below:

Primary Operator – The person or persons associated with construction activity that meets either of the following two criteria:

(a) the person or persons have on-site operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications; or

(b) the person or persons have day-to-day operational control of those activities at a construction site that are necessary to ensure compliance with a Stormwater Pollution Prevention Plan (SWP3) for the site or other permit conditions (for example, they are authorized to direct workers at a site to carry out activities required by the SWP3 or comply with other permit conditions).

Secondary Operator – The person or entity, often the property owner, whose operational control is limited to:

- (a) the employment of other operators, such as a general contractor, to perform or supervise construction activities; or
- (b) the ability to approve or disapprove changes to construction plans and specifications, but who does not have day-to-day on-site operational control over construction activities at the site.

Secondary operators must either prepare their own SWP3 or participate in a shared SWP3 that covers the areas of the construction site, where they have control over the construction plans and specifications.

If there is not a primary operator at the construction site, then the secondary operator is defined as the primary operator and must comply with the requirements for primary operators.

Outfall – For the purpose of this permit, a point source at the point where stormwater runoff associated with construction activity discharges to surface water in the state and does not include open conveyances connecting two municipal separate storm sewers, or pipes, tunnels, or other conveyances that connect segments of the same stream or other water of the U.S. and are used to convey waters of the U.S.

Permittee – An operator authorized under this general permit. The authorization may be gained through submission of a notice of intent, by waiver, or by meeting the requirements for automatic coverage to discharge stormwater runoff and certain non-stormwater discharges from construction activity.

Point Source – Any discernible, confined, and discrete conveyance, including but not limited to, any pipe, ditch, channel, tunnel, conduit, well, discrete fissure, container, rolling stock concentrated animal feeding operation, landfill leachate collection system, vessel or other floating craft from which pollutants are, or may be, discharged. This term does not include return flows from irrigated agriculture or agricultural stormwater runoff (40 CFR § 122.2).

Pollutant – Dredged spoil, solid waste, incinerator residue, sewage, garbage, sewage sludge, filter backwash, munitions, chemical wastes, biological materials, radioactive materials, heat, wrecked or discarded equipment, rock, sand, cellar dirt, and industrial, municipal, and agricultural waste discharged into any surface water in the state. The term "pollutant" does not include tail water or runoff water from irrigation or rainwater runoff from cultivated or uncultivated rangeland, pastureland, and farmland. For the purpose of this permit, the term "pollutant" includes sediment.

Pollution – The alteration of the physical, thermal, chemical, or biological quality of, or the contamination of, any surface water in the state that renders the water harmful, detrimental, or injurious to humans, animal life, vegetation, or property or to public health, safety, or welfare, or impairs the usefulness or the public enjoyment of the water for any lawful or reasonable purpose (Texas Water Code (TWC) § 26.001(14)).

Rainfall Erosivity Factor (R factor) – The total annual erosive potential that is due to climatic effects, and is part of the Revised Universal Soil Loss Equation (RUSLE).

Receiving Water – A "Water of the United States" as defined in 40 CFR § 122.2 or a surface water in the state into which the regulated stormwater discharges.

Semi-arid Areas – Areas with an average annual rainfall of 10 to 20 inches.

Separate Storm Sewer System – A conveyance or system of conveyances (including roads with drainage systems, streets, catch basins, curbs, gutters, ditches, man-made channels, or storm drains), designed or used for collecting or conveying stormwater; that is not a combined sewer, and that is not part of a publicly owned treatment works (POTW).

Small Construction Activity – Construction activities including clearing, grading, and excavating that result in land disturbance of equal to or greater than one (1) acre and less than five (5) acres of land. Small construction activity also includes the disturbance of less than one (1) acre of total land area that is part of a larger common plan of development or sale if the larger common plan will ultimately disturb equal to or greater than one (1) and less than five (5) acres of land. Small construction activity does not include routine maintenance that is performed to maintain the original line and grade, hydraulic capacity, or original purpose of the site (for example, the routine grading of existing dirt roads, asphalt overlays of existing roads, the routine clearing of existing right-of-ways, and similar maintenance activities).

Steep Slopes – Where a state, Tribe, local government, or industry technical manual (e.g., stormwater BMP manual) has defined what is to be considered a "steep slope", this permit's definition automatically adopts that definition. Where no such definition exists, steep slopes are automatically defined as those that are 15 percent or greater in grade.

Stormwater (or Stormwater Runoff) – Rainfall runoff, snow melt runoff, and surface runoff and drainage.

Stormwater Associated with Construction Activity – Stormwater runoff, as defined above, from a construction activity.

Structural Control (or Practice) – A pollution prevention practice that requires the construction of a device, or the use of a device, to reduce or prevent pollution in stormwater runoff. Structural controls and practices may include but are not limited to: silt fences, earthen dikes, drainage swales, sediment traps, check dams, subsurface drains, storm drain inlet protection, rock outlet protection, reinforced soil retaining systems, gabions, and temporary or permanent sediment basins.

Surface Water in the State – Lakes, bays, ponds, impounding reservoirs, springs, rivers, streams, creeks, estuaries, wetlands, marshes, inlets, canals, the Gulf of Mexico inside the territorial limits of the state (from the mean high water mark (MHWM) out 10.36 miles into the Gulf), and all other bodies of surface water, natural or artificial, inland or coastal, fresh or salt, navigable or non-navigable, and including the beds and banks of all water-courses and bodies of surface water, that are wholly or partially inside or bordering the state or subject to the jurisdiction of the state; except that waters in treatment systems which are authorized by state or federal law, regulation, or permit, and which are created for the purpose of waste treatment are not considered to be water in the state.

Temporary Stabilization – A condition where exposed soils or disturbed areas are provided a protective cover or other structural control to prevent the migration of pollutants. Temporary stabilization may include temporary seeding, geotextiles, mulches, and other techniques to reduce or eliminate erosion until either permanent stabilization can be achieved or until further construction activities take place.

Thawing Conditions – For the purposes of this permit, thawing conditions are expected based on the historical likelihood of two (2) or more days with daytime temperatures greater than 32 degrees Fahrenheit (°F). This date can be determined by looking at historical weather data.

NOTE: The estimation of thawing conditions is for planning purposes only. During construction, the permittee will be required to conduct site inspections based upon actual conditions (i.e., if thawing conditions occur sooner than expected, the permittee will be required to conduct inspections at the regular frequency).

Total Maximum Daily Load (TMDL) – The total amount of a pollutant that a water body can assimilate and still meet the Texas Surface Water Quality Standards.

Turbidity – A condition of water quality characterized by the presence of suspended solids and/or organic material.

Waters of the United States – Waters of the United States or waters of the U.S. means the term as defined in 40 CFR § 122.2.

Part II. Permit Applicability and Coverage

Section A. Discharges Eligible for Authorization

1. Stormwater Associated with Construction Activity

Discharges of stormwater runoff and certain non-stormwater discharges from small and large construction activities may be authorized under this general permit, except as described in Part II.C. of this permit.

2. Discharges of Stormwater Associated with Construction Support Activities

Discharges of stormwater runoff and certain non-stormwater discharges from construction support activities as defined in Part I.B. of this general permit may be authorized, provided that the following conditions are met:

- (a) the construction support activities are located within one (1) mile from the boundary of the construction site where the construction activity authorized under the permit is being conducted that requires the support of these activities;
- (b) an SWP3 is developed and implemented for the permitted construction site according to the provisions in Part III.F. of this general permit, including appropriate controls and measures to reduce erosion and the discharge of pollutants in stormwater runoff according to the provisions in Part IV. of this general permit;
- (c) the activities are directly related to the construction site;
- (d) the activities are not a commercial operation, nor serve other unrelated construction projects; and
- (e) the activities do not continue to operate beyond the completion of the construction activity at the project it supports.

Construction support activities that operate outside the terms provided in (a) through (e) above must obtain authorization under a separate Texas Pollutant Discharge Elimination System (TPDES) permit, which may include the TPDES Multi-Sector General Permit (MSGP), TXR050000 (related to stormwater discharges associated with industrial activity), an alternative general permit (if available), or an individual water quality permit.

3. Non-Stormwater Discharges

The following non-stormwater discharges from sites authorized under this general permit are also eligible for authorization under this general permit:

- (a) discharges from emergency fire-fighting activities (emergency fire-fighting activities do not include washing of trucks, run-off water from training activities, test water from fire suppression systems, or similar activities);
- (b) uncontaminated fire hydrant flushings (excluding discharges of hyperchlorinated water, unless the water is first dechlorinated and discharges are not expected to adversely affect aquatic life), which include flushings from systems that utilize potable water, surface water, or groundwater that does not contain additional pollutants (uncontaminated fire hydrant flushings do not include systems utilizing reclaimed wastewater as a source water);
- (c) water from the routine external washing of vehicles, the external portion of buildings or structures, and pavement, where solvents, detergents, and soaps are not used, where spills or leaks of toxic or hazardous materials have not occurred (unless spilled materials have been removed; and if local state, or federal regulations are applicable, the materials are removed according to those regulations), and where the purpose is to remove mud, dirt, or dust;
- (d) uncontaminated water used to control dust;
- (e) potable water sources, including waterline flushings, but excluding discharges of hyperchlorinated water, unless the water is first dechlorinated and discharges are not expected to adversely affect aquatic life;
- (f) uncontaminated air conditioning condensate;
- (g) uncontaminated ground water or spring water, including foundation or footing drains where flows are not contaminated with industrial materials such as solvents; and
- (h) lawn watering and similar irrigation drainage.
- 4. Other Permitted Discharges

Any discharge authorized under a separate National Pollutant Discharge Elimination System (NPDES), TPDES, or TCEQ permit may be combined with discharges authorized by this general permit, provided those discharges comply with the associated permit.

Section B. Concrete Truck Wash Out

The wash out of concrete trucks at regulated construction sites must be performed in accordance with the requirements of Part VI of this general permit.

Section C. Limitations on Permit Coverage

1. Post Construction Discharges

Discharges that occur after construction activities have been completed, and after the construction site and any supporting activity site have undergone final stabilization, are not eligible for coverage under this general permit. Discharges originating from the sites are not authorized under this general permit following the submission of the Notice of Termination (NOT) or removal of the appropriate TCEQ site notice, as applicable, for the regulated construction activity.

2. Prohibition of Non-Stormwater Discharges

Except as otherwise provided in Part II.A. of this general permit, only discharges that are composed entirely of stormwater associated with construction activity may be authorized under this general permit.

3. Compliance with Water Quality Standards

Discharges to surface water in the state that would cause, have the reasonable potential to cause, or contribute to a violation of water quality standards or that would fail to protect and maintain existing designated uses of surface water in the state are not eligible for coverage under this general permit. The executive director may require an application for an individual permit or alternative general permit (see Parts II.H.2. and 3.) to authorize discharges to surface water in the state if the executive director determines that any activity will cause, has the reasonable potential to cause, or contribute to a violation of water quality standards or is found to cause, has the reasonable potential to cause, or contribute to, the impairment of a designated use. The executive director may also require an application for an individual permit considering factors described in Part II.H.3. of this general permit.

4. Impaired Receiving Waters and Total Maximum Daily Load (TMDL) Requirements

The permittee shall determine whether the authorized discharge is to an impaired water body on the latest EPA-approved CWA § 303(d) List or waters with an EPA-approved or established TMDL that are found on the latest EPA-approved *Texas Integrated Report of Surface Water Quality for CWA Sections 305(b) and 303(d)*, which lists the category 4 and 5 water bodies.

New sources or new discharges of the pollutants of concern to impaired waters are not authorized by this permit unless otherwise allowable under 30 TAC Chapter 305 and applicable state law. Impaired waters are those that do not meet applicable water quality standard(s) and are listed as category 4 or 5 in the current version of the *Texas Integrated Report of Surface Water Quality for CWA Sections 305(b) and 303(d)*, and waterbodies listed on the CWA § 303(d) List. Pollutants of concern are those for which the water body is listed as impaired.

Discharges of the pollutants of concern to impaired water bodies for which there is a TMDL are not eligible for coverage under this general permit unless they are consistent with the approved TMDL. Permittees must incorporate the conditions and requirements applicable to their discharges into their SWP3, in order to be eligible for coverage under this general permit. For consistency with the construction stormwater-related items in an approved TMDL, the SWP3 must be consistent with any applicable condition, goal, or requirement in the TMDL, TMDL Implementation Plan (I-Plan), or as otherwise directed by the executive director.

5. Discharges to the Edwards Aquifer Recharge or Contributing Zone

Discharges cannot be authorized by this general permit where prohibited by 30 TAC Chapter 213 (relating to Edwards Aquifer). In addition, commencement of construction (see definition for commencement of construction in Part I.B. above)) at a site regulated under 30 TAC Chapter 213, may not begin until the appropriate Edwards Aquifer Protection Plan (EAPP) has been approved by the TCEQ's Edwards Aquifer Protection Program.

(a) For new discharges located within the Edwards Aquifer Recharge Zone, or within that area upstream from the recharge zone and defined as the Contributing Zone (CZ), operators must meet all applicable requirements of, and operate according to, 30 TAC Chapter 213 (Edwards Aquifer Rule) in addition to the provisions and requirements of this general permit.

- (b) For existing discharges located within the Edwards Aquifer Recharge Zone, the requirements of the agency-approved Water Pollution Abatement Plan (WPAP) under the Edwards Aquifer Rule are in addition to the requirements of this general permit. BMPs and maintenance schedules for structural stormwater controls, for example, may be required as a provision of the rule. All applicable requirements of the Edwards Aquifer Rule for reductions of suspended solids in stormwater runoff are in addition to the requirements in this general permit for this pollutant.
- (c) For discharges located within ten (10) stream miles upstream of the Edwards Aquifer recharge zone, applicants shall also submit a copy of the NOI to the appropriate TCEQ regional office.

Counties: Comal, Bexar, Medina, Uvalde, and Kinney

- Contact: TCEQ Water Program Manager San Antonio Regional Office 14250 Judson Road San Antonio, Texas 78233-4480 (210) 490-3096 Counties: Williamson, Travis, and Hays
- Contact: TCEQ Water Program Manager Austin Regional Office 12100 Park 35 Circle Room 179, Building A Austin, Texas 78753 (512) 339-2929
- 6. Discharges to Specific Watersheds and Water Quality Areas

Discharges otherwise eligible for coverage cannot be authorized by this general permit where prohibited by 30 TAC Chapter 311 (relating to Watershed Protection) for water quality areas and watersheds.

7. Protection of Streams and Watersheds by Other Governmental Entities

This general permit does not limit the authority or ability of federal, other state, or local governmental entities from placing additional or more stringent requirements on construction activities or discharges from construction activities.

8. Indian Country Lands

Stormwater runoff from construction activities occurring on Indian Country lands are not under the authority of the TCEQ and are not eligible for coverage under this general permit. If discharges of stormwater require authorization under federal NPDES regulations, authority for these discharges must be obtained from the U.S. Environmental Protection Agency (EPA).

9. Exempt Oil and Gas Activities

The CWA § 402(l)(2) provides that stormwater discharges from construction activities related to oil and gas exploration, production, processing, or treatment, or transmission facilities are exempt from regulation under this permit. The term "oil and gas exploration, production, processing, or treatment operations, or transmission facilities" is defined in 33 U.S.C. Annotated § 1362 (24).

The exemption in CWA § 402(l)(2) *includes* stormwater discharges from construction activities regardless of the amount of disturbed acreage, which are necessary to prepare a site for drilling and the movement and placement of drilling equipment, drilling waste management pits, in field treatment plants, and in field transportation infrastructure (e.g., crude oil pipelines, natural gas treatment plants, and both natural gas transmission pipeline compressor and crude oil pumping stations) necessary for the operation of most producing oil and gas fields. Construction activities are defined in 33 U.S. Code § 1362(24) and interpreted by EPA in the final rule. *See* June 12, 2006 Amendments to the NPDES Regulations for Storm Water Discharges Associated with Oil and Gas Exploration, Production, Processing, or Treatment Operations or Transmission Facilities (71 FR 33628, Part V. Terminology).

The exemption *does not include* stormwater discharges from the construction of administrative buildings, parking lots, and roads servicing an administrative building at an oil and gas site, as these are considered traditional construction activities.

As described in 40 CFR § 122.26(c)(1)(iii) [*regulations prior to 2006*], discharges from oil and gas construction activities are waived from CWA § 402(l)(2) permit coverage *unless* the construction activity (or construction support activity) has had a discharge of stormwater resulting in the discharge of a reportable quantity of oil or hazardous substances or the discharge contributes to a violation of water quality standards.

Exempt oil and gas activities which have lost their exemption as a result of one of the above discharges, must obtain permit coverage under this general permit, an alternative general permit, or a TPDES individual permit prior to the next discharge.

10. Stormwater Discharges from Agricultural Activities

Stormwater discharges from agricultural activities that are not point source discharges of stormwater are not subject to TPDES permit requirements. These activities may include clearing and cultivating ground for crops, construction of fences to contain livestock, construction of stock ponds, and other similar agricultural activities. Discharges of stormwater runoff associated with the construction of facilities that are subject to TPDES regulations, such as the construction of concentrated animal feeding operations, would be point sources regulated under this general permit.

11. Endangered Species Act

Discharges that would adversely affect a listed endangered or threatened aquatic or aquatic-dependent species or its critical habitat are not authorized by this permit, unless the requirements of the Endangered Species Act are satisfied. Federal requirements related to endangered species apply to all TPDES permitted discharges and site-specific controls may be required to ensure that protection of endangered or threatened species is achieved. If a permittee has concerns over potential impacts to listed species, the permittee may contact TCEQ for additional information.

12. Storage of High-Level Radioactive Waste

Discharges of stormwater from construction activities associated with the construction of a facility that is licensed for the storage of high-level radioactive waste by the United States Nuclear Regulatory Commission under 10 CFR Part 72 are not authorized by this general permit. Texas Health and Safety Code (THSC) § 401.0525 prohibits TCEQ from issuing any TPDES authorizations for the construction or operation of these facilities.

Discharges of stormwater from the construction activities associated with the construction of a facility located at the site of currently or formerly operating nuclear power reactors and currently or formerly operating nuclear research and test reactors operated by a university are not prohibited under THSC § 401.0525 and continue to be regulated under this general permit.

13. Other

Nothing in Part II. of the general permit is intended to negate any person's ability to assert *force majeure* (act of God, war, strike, riot, or other catastrophe) defenses found in 30 TAC § 70.7

Section D. Deadlines for Obtaining Authorization to Discharge

- 1. Large Construction Activities
 - (a) New Construction Discharges from sites where the commencement of construction activity occurs on or after the effective date of this general permit must be authorized, either under this general permit or a separate TPDES permit, prior to the commencement of those construction activities.
 - (b) Ongoing Construction Operators of large construction activities continuing to operate after the effective date of this permit, and authorized under the TPDES Construction General Permit (CGP) TXR150000 (effective on March 5, 2018, and amended on January 28, 2022), must submit an NOI to renew authorization or an NOT to terminate coverage under this general permit within 90 days of the effective date of this general permit. During this interim or grace period, as a requirement of this TPDES permit, the operator must continue to meet the conditions and requirements of the issued and amended 2018 TPDES CGP.
- 2. Small Construction Activities
 - (a) New Construction Discharges from sites where the commencement of construction activity occurs on or after the effective date of this general permit must be authorized, either under this general permit or a separate TPDES permit, prior to the commencement of those construction activities.
 - (b) Ongoing Construction Discharges from ongoing small construction activities that commenced prior to the effective date of this general permit, and that do not meet the conditions to qualify for termination of this permit as described in Part II.F. of this general permit, must meet the requirements to be authorized, either under this general permit or a separate TPDES permit, within 90 days of the effective date of this general permit. During this interim period, as a requirement of this TPDES permit, the operator must continue to meet the conditions and requirements of the issued and amended 2018 TPDES CGP.

Section E. Obtaining Authorization to Discharge

1. Automatic Authorization for Small Construction Activities with Low Potential for Erosion

Operators of small construction activity, as defined in Part I.B. of this general permit, shall not submit an NOI for coverage, unless otherwise required by the executive director.

Operators of small construction activities, which occur in certain counties and during periods of low potential for erosion that do not meet the conditions of the waiver described in Part II.G. of this general permit, may be automatically authorized under this general permit if all the following conditions are met prior to the commencement of construction.

(a) The construction activity occurs in a county and during the corresponding date range(s) listed in Appendix A;

- (b) The construction activity is initiated and completed, including either final or temporary stabilization of all disturbed areas, within the time frame identified in Appendix A for the location of the construction site;
- (c) All temporary stabilization is adequately maintained to effectively reduce or prohibit erosion, permanent stabilization activities have been initiated, and a condition of final stabilization is completed no later than 30 days following the end date of the time frame identified in Appendix A for the location of the construction site; the permittee signs a completed TCEQ Small Construction Site Notice for low potential for erosion (Form TCEQ-20964), including the certification statement;
- (d) A signed and certified copy of the TCEQ Small Construction Site Notice for low potential for erosion is posted at the construction site in a location where it is readily available for viewing by the general public, local, state, and federal authorities prior to commencing construction activities, and maintained in that location until final stabilization has been achieved;

NOTE: Posted TCEQ site notices may have a redacted signature as long as there is an original signed and certified TCEQ site notice, with a viewable signature, located on-site and available for review by any applicable regulatory authority.

- (e) A copy of the signed and certified TCEQ Small Construction Site Notice for low potential for erosion is provided to the operator of any MS4 receiving the discharge at least two (2) days prior to commencement of construction activities;
- (f) Discharges of stormwater runoff or other non-stormwater discharges from any supporting concrete batch plant or asphalt batch plant is separately authorized under an individual TPDES permit, another TPDES general permit, or under an individual TCEQ permit where stormwater and non-stormwater is disposed of by evaporation or irrigation (discharges are adjacent to water in the state); and
- (g) Any non-stormwater discharges are either authorized under a separate permit or authorization, are not considered by TCEQ to be a wastewater, or are captured and routed for disposal at a publicly operated treatment works or licensed waste disposal facility.

If all of the conditions in (a) - (h) above are met, then the operator(s) of small construction activities with low potential for erosion are not required to develop a SWP3.

If an operator is conducting small construction activities and any of the above conditions (a) - (h) are not met, the operator cannot declare coverage under the automatic authorization for small construction activities with low potential for erosion and must meet the requirements for automatic authorization (all other) small construction activities, described below in Part II.E.2.

For small construction activities that occur during a period with a low potential for erosion, where automatic authorization under this section is not available, an operator may apply for and obtain a waiver from permitting (Low Rainfall Erosivity Waiver – LREW), as described in Part II.G. of this general permit. Waivers from coverage under the LREW do not allow for any discharges of non-stormwater and the operator must ensure that discharges on non-stormwater are either authorized under a separate permit or authorization.

2. Automatic Authorization for Small Construction Activities

Operators of small construction activities as defined in Part I.B. of this general permit shall not submit an NOI for coverage, unless otherwise required by the executive director.

Operators of small construction activities, as defined in Part I.B. of this general permit or as defined but who do not meet in the conditions and requirements located in Part II.E.1 above, may be automatically authorized for small construction activities, provided that they meet all of the following conditions:

- (a) develop a SWP3 according to the provisions of this general permit, that covers either the entire site or all portions of the site for which the applicant is the operator, and implement the SWP3 prior to commencing construction activities;
- (b) all operators of regulated small construction activities must post a copy of a signed and certified TCEQ Small Construction Site Notice (Form TCEQ-20963), the notice must be posted at the construction site in a location where it is safely and readily available for viewing by the general public, local, state, and federal authorities, at least two (2) days prior to commencing construction activity , and maintain the notice in that location until completion of the construction activity (for linear construction activities, e.g. pipeline or highway, the TCEQ site notice must be placed in a publicly accessible location near where construction is actively underway; notice for these linear sites may be relocated, as necessary, along the length of the project, and the notice must be safely and readily available for viewing by the general public; local, state, and federal authorities);
- (c) operators must maintain a posted TCEQ Small Construction Site Notice on the approved TCEQ form at the construction site until final stabilization has been achieved; and

NOTE: Posted TCEQ site notices may have a redacted signature as long as there is an original signed and certified TCEQ Small Construction Site Notice, with a viewable signature, located on-site and available for review by an applicable regulatory authority.

- (d) provide a copy of the signed and certified TCEQ Small Construction Site Notice to the operator of any municipal separate storm sewer system (MS4) receiving the discharge at least two (2) days prior to commencement of construction activities.
- (e) if signatory authority is delegated by an authorized representative, then a Delegation of Signatory form must be submitted as required by 30 TAC § 305.128 (relating to Signatories to Reports). Operators for small construction activities must submit this form via mail following the instructions on the approved TCEQ paper form. A new Delegation of Signatory form must be submitted if the delegation changes to another individual or position.

As described in Part I.B of this general permit, large construction activities include those that will disturb less than five (5) acres of land, but that are part of a larger common plan of development or sale that will ultimately disturb five (5) or more acres of land and must meet the requirements of Part II.E.3. below.

3. Authorization for Large Construction Activities

Operators of large construction activities that qualify for coverage under this general permit must meet all of the following conditions:

- (a) develop a SWP3 according to the provisions of this general permit that covers either the entire site or all portions of the site where the applicant is the operator. The SWP3 must be developed and implemented prior to obtaining coverage and prior to commencing construction activities;
- (b) primary operators of large construction activities must submit an NOI prior to commencing construction activity at a construction site. A completed NOI must be submitted to TCEQ electronically using the online ePermits system on TCEQ's website.

Operators with an electronic reporting waiver must submit a completed paper NOI to TCEQ at least seven (7) days prior to commencing construction activity to obtain provisional coverage 48-hours from the postmark date for delivery to the TCEQ. An authorization is no longer provisional when the executive director finds the NOI is administratively complete, and an authorization number is issued to the permittee for the construction site indicated on the NOI.

If an additional primary operator is added after the initial NOI is submitted, the additional primary operator must meet the same requirements for existing primary operator(s), as indicated above.

If the primary operator changes due to responsibility at the site being transferred from one primary operator to another after the initial NOI is submitted, the new primary operator must submit an electronic NOI, unless they request and obtain a waiver from electronic reporting, at least ten (10) days prior to assuming operational control of a construction site and commencing construction activity.

- (c) all operators of large construction activities must post a TCEQ Large Construction Site Notice on the approved TCEQ form (Form TCEQ-20961) in accordance with Part III.D.2. of this permit. The TCEQ site notice must be located where it is safely and readily available for viewing by the general public, local, state, and federal authorities prior to commencing construction activities, and must be maintained in that location until final stabilization has been achieved. For linear construction activities, e.g., pipeline or highway, the TCEQ site notice must be placed in a publicly accessible location near where construction is actively underway; notice for these linear sites may be relocated, as necessary, along the length of the project, and the notice must be safely and readily available for viewing by the general public, local, state, and federal authorities;
- (d) two days prior to commencing construction activities, all primary operators must:
 - i. provide a copy of the signed NOI to the operator of any MS4 receiving the discharge and to any secondary construction operator, and
 - ii. list in the SWP3 the names and addresses of all MS4 operators receiving a copy;
- (e) if signatory authority is delegated by an authorized representative, then a Delegation of Signatories form must be submitted as required by 30 TAC § 305.128 (relating to Signatories to Reports). Primary operators must submit this form electronically using the State of Texas Environmental Electronic Reporting System (STEERS), TCEQ's online permitting system, or by paper if the permittee requested and obtained an electronic reporting waiver. A new Delegation of Signatories form must be submitted, if the delegation changes to another individual or position;
- (f) all persons meeting the definition of "secondary operator" in Part I of this permit are hereby notified that they are regulated under this general permit, but are not required to submit an NOI, provided that a primary operator at the site has submitted an NOI, or prior to commencement of construction activities, a primary operator is required to submit an NOI and the secondary operator has provided notification to the operator(s) of the need to obtain coverage (with records of notification available upon request). Any secondary operator notified under this provision may alternatively submit an NOI under this general permit, may seek coverage under an alternative TPDES individual permit, or may seek coverage under an alternative TPDES general permit if available; and

(g) all secondary operators of large construction activities must post a copy of the signed and certified TCEQ Large Construction Site Notice for Secondary Operators on the approved TCEQ form (Form TCEQ-20962) and provide a copy of the signed and certified TCEQ site notice to the operator of any MS4 receiving the discharge at least two (2) days prior to the commencement construction activities.

> NOTE: Posted TCEQ site notices may have a redacted signature as long as there is an original signed and certified TCEQ Large Construction Site Notice for Secondary Operators, with a viewable signature, located on-site and available for review by an applicable regulatory authority.

Applicants must submit an NOI using the online ePermits system (accessed using STEERS) available through the TCEQ website, or request and obtain a waiver from electronic reporting from the TCEQ. Waivers from electronic reporting are not transferrable and expire on the same date as the authorization to discharge.

4. Waivers for Small Construction Activities:

Operators of certain small construction activities may obtain a waiver from coverage under this general permit, if applicable. The requirements are outlined in Part II.G. below.

- 5. Effective Date of Coverage
 - (a) Operators of small construction activities as described in either Part II.E.1. or II.E.2. above are authorized immediately following compliance with the applicable conditions of Part II.E.1. or II.E.2. Secondary operators of large construction activities as described in Part II.E.3. above are authorized immediately following compliance with the applicable conditions in Part II.E.3. For activities located in areas regulated by 30 TAC Chapter 213, related to the Edwards Aquifer, this authorization to discharge is separate from the requirements of the operator's responsibilities under that rule. Construction may not commence for sites regulated under 30 TAC Chapter 213 until all applicable requirements of that rule are met.
 - (b) Primary operators of large construction activities as described in Part II.E.3. above that electronically submit an NOI are authorized immediately following confirmation of receipt of the electronic form by the TCEQ, unless otherwise notified by the executive director.

Operators with an electronic reporting waiver are provisionally authorized 48-hours from the date that a completed paper NOI is postmarked for delivery to the TCEQ, unless otherwise notified by the executive director. An authorization is no longer provisional when the executive director finds the NOI is administratively complete and an authorization number is issued to the permittee for the construction site indicated on the NOI.

For construction activities located in areas regulated by 30 TAC Chapter 213, related to the Edwards Aquifer, this authorization to discharge is separate from the requirements of the operator's responsibilities under that rule. Construction activities may not commence for sites regulated under 30 TAC Chapter 213 until all applicable requirements of that rule are met.

(c) Operators are not prohibited from submitting late NOIs or posting late site notices to obtain authorization under this general permit. The TCEQ reserves the right to take appropriate enforcement action for any unpermitted activities that may have occurred between the time construction commenced and authorization under this general permit was obtained.

- (d) If operators that submitted NOIs have active authorizations for construction activities that are ongoing when this general permit expires on March 5, 2028, and a new general permit is issued, a 90-day interim (grace) period is granted to provide coverage that is administratively continued until operators with active authorizations can obtain coverage under the newly issued CGP. The 90-day grace period starts on the effective date of the newly issued CGP.
- 6. Contents of the NOI

The NOI form shall require, at a minimum, the following information:

- (a) the TPDES CGP authorization number for existing authorizations under this general permit, where the operator submits an NOI to renew coverage within 90 days of the effective date of this general permit;
- (b) the name, address, and telephone number of the operator filing the NOI for permit coverage;
- (c) the name (or other identifier), address, county, and latitude/longitude of the construction project or site;
- (d) the number of acres that will be disturbed by the applicant;
- (e) the estimated construction project start date and end date;
- (f) confirmation that the project or site will not be located on Indian Country lands;
- (g) confirmation if the construction activity is associated with an oil and gas exploration, production, processing, or treatment, or transmission facility (see Part II.C.9.)
- (h) confirmation that the construction activities are not associated with the construction of a facility that is licensed for the storage of high-level radioactive waste by the United States Nuclear Regulatory Commission under 10 CFR Part 72 (see Part II.C.12.);
- (i) confirmation that a SWP3 has been developed in accordance with all conditions of this general permit, that it will be implemented prior to commencement of construction activities, and that it is compliant with any applicable local sediment and erosion control plans; for multiple operators who prepare a shared SWP3, the confirmation for an operator may be limited to its obligations under the SWP3 provided all obligations are confirmed by at least one operator;
- (j) name of the receiving water(s);
- (k) the classified segment number for each classified segment that receives discharges from the regulated construction activity (if the discharge is not directly to a classified segment, then the classified segment number of the first classified segment that those discharges reach); and
- (l) the name of all surface waters receiving discharges from the regulated construction activity that are on the latest EPA-approved CWA § 303(d) List of impaired waters or *Texas Integrated Report of Surface Water Quality for CWA Sections 305(b) and 303(d)* as not meeting applicable state water quality standards.
- 7. Notice of Change (NOC)
 - (a) If relevant information provided in the NOI changes, the operator that has submitted the NOI must submit an NOC to TCEQ at least fourteen (14) days before the change occurs. Where a 14-day advance notice is not possible, the operator must submit an NOC to TCEQ within fourteen (14) days of discovery of the change. If the operator becomes aware that it failed to submit any relevant facts or submitted

incorrect information in an NOI, the correct information must be submitted to TCEQ in an NOC within fourteen (14) days after discovery.

- (b) Information on an NOC may include, but is not limited to, the following:
 - i. a change in the description of the construction project;
 - ii. an increase in the number of acres disturbed (for increases of one (1) or more acres);
 - iii. or the name of the operator (where the name of the operator has changed).
- (c) Electronic NOC.

Applicants must submit an NOC using the online ePermits system available through the TCEQ website, or request and obtain a waiver from electronic reporting from the TCEQ. All waivers from electronic reporting are not transferrable. Electronic reporting waivers expire on the same date as the authorization to discharge, except for temporary waivers that expire one (1) year from issuance. A copy of the NOC form or letter must also be placed in the SWP3 and provided to the operator of any MS4 receiving the discharge. Operators are authorized immediately following confirmation of receipt of the electronic form by the TCEQ, unless otherwise notified by the executive director.

(d) Paper NOC.

Applicants who request and obtain an electronic reporting waiver shall submit the NOC on a paper form provided by the executive director, or by letter if an NOC form is not available.

- (e) A copy of the NOC form or letter must also be placed in the SWP3 and provided to the operator of any MS4 receiving the discharge. A list that includes the names and addresses of all MS4 operators receiving a copy of the NOC (or NOC letter) must be included in the SWP3. Information that may not be included on an NOC includes but is not limited to the following:
 - i. transfer of operational control from one operator to another, including a transfer of the ownership of a company. A transfer of ownership of a company includes changes to the structure of a company, such as changing from a partnership to a corporation or changing corporation types, so that the filing or charter number that is on record with the Texas Secretary of State (SOS) must be changed.
 - ii. coverage under this general permit is not transferable from one operator to another. Instead, the new operator will need to submit an NOI or LREW, as applicable, and the previous operator will need to submit an NOT.
 - iii. a decrease in the number of acres disturbed. This information must be included in the SWP3 and retained on site.
- 8. Signatory Requirement for NOI Forms, NOT Forms, NOC Forms, and Construction Site Notices

NOI forms, NOT forms, NOC forms, and Construction Site Notices that require a signature must be signed according to 30 TAC § 305.44 (relating to Signatories for Applications).

Section F. Terminating Coverage

1. Notice of Termination (NOT) Required

Each operator that has submitted an NOI for authorization of large construction activities under this general permit must apply to terminate that authorization following the conditions described in this section of the general permit.

Authorization of large construction must be terminated by submitting an NOT electronically via the online ePermits system available through the TCEQ website, or on a paper NOT form to TCEQ supplied by the executive director with an approved waiver from electronic reporting. Authorization to discharge under this general permit terminates at midnight on the day a paper NOT is postmarked for delivery to the TCEQ or immediately following confirmation of the receipt of the NOT submitted electronically by the TCEQ.

Applicants must submit an NOT using the online ePermits system available through the TCEQ website, or request and obtain a waiver from electronic reporting from the TCEQ. Waivers from electronic reporting are not transferrable and expire on the same date as the authorization to discharge, except for temporary waivers that expire one (1) year from issuance.

The NOT must be submitted to TCEQ, and a copy of the NOT provided to the operator of any MS4 receiving the discharge (with a list in the SWP3 of the names and addresses of all MS4 operators receiving a copy), within 30 days after any of the following conditions are met:

- (a) final stabilization has been achieved on all portions of the site that are the responsibility of the operator;
- (b) a transfer of operational control has occurred (See Section II.F.4. below); or
- (c) the operator has obtained alternative authorization under an individual TPDES permit or alternative TPDES general permit.

Compliance with the conditions and requirements of this permit is required until the NOT is submitted and approved by TCEQ.

2. Minimum Contents of the NOT

The NOT form shall require, at a minimum, the following information:

- (a) if authorization for construction activity was granted following submission of an NOI, the permittee's site-specific TPDES authorization number for a specific construction site;
- (b) an indication of whether final stabilization has been achieved at the site and a NOT has been submitted or if the permittee is simply no longer an operator at the site;
- (c) the name, address, and telephone number of the permittee submitting the NOT;
- (d) the name (or other identifier), address, county, and location (latitude/longitude) of the construction project or site; and
- (e) a signed certification that either all stormwater discharges requiring authorization under this general permit will no longer occur, or that the applicant is no longer the operator of the facility or construction site, and that all temporary structural erosion controls have either been removed, will be removed on a schedule defined in the SWP3, or have been transferred to a new operator if the new operator has applied for permit coverage. Erosion controls that are designed to remain in place for an indefinite period, such as mulches and fiber mats, are not required to be removed or scheduled for removal.

- 3. Termination of Coverage for Small Construction Sites and for Secondary Operators at Large Construction Sites
 - (a) Each operator that has obtained automatic authorization for small construction or is a secondary operator for large construction must perform the following when terminating coverage under the permit:
 - i. remove the TCEQ site notice;
 - ii. complete the applicable portion of the TCEQ site notice related to removal of the TCEQ site notice; and
 - iii. submit a copy of the completed TCEQ site notice to the operator of any MS4 receiving the discharge (or provide alternative notification as allowed by the MS4 operator, with documentation of such notification included in the SWP3).
 - (b) The activities described in Part II.F.3.(a) above must be completed by the operator within 30 days of meeting any of the following conditions:
 - i. final stabilization has been achieved on all portions of the site that are the responsibility of the operator;
 - ii. a transfer of day-to-day operational control over activities necessary to ensure compliance with the SWP3 and other permit conditions has occurred (See Section II.F.4. below); or
 - iii. the operator has obtained alternative authorization under an individual or general TPDES permit.

For Small Construction Sites and Secondary Operators at Large Construction Sites, authorization to discharge under this general permit terminates immediately upon removal of the applicable TCEQ construction site notice. Compliance with the conditions and requirements of this permit is required until the TCEQ construction site notice is removed. The construction site notice cannot be removed until final stabilization has been achieved.

- 4. Transfer of Day-to-Day Operational Control
 - (a) When the primary operator of a large construction activity changes or operational control over activities necessary to ensure compliance with the SWP3 and other permit conditions is transferred to another primary operator, the original operator must do the following:
 - submit an NOT within ten (10) days prior to the date that responsibility for operations terminates, and the new operator must submit an NOI at least ten (10) days prior to the transfer of operational control, in accordance with condition (c) below; and
 - ii. submit a copy of the NOT from the primary operator terminating its coverage under the permit and its operational control of the construction site and submit a copy of the NOI from the new primary operator to the operator of any MS4 receiving the discharge in accordance with Part II.F.1. above.
 - (b) For transfer of operational control, operators of small construction activities and secondary operators of large construction activities who are not required to submit an NOI must do the following:
 - i. the existing operator must remove the original TCEQ construction site notice, and the new operator must post the required TCEQ construction site notice prior to the transfer of operational control, in accordance with the conditions in Part II.F.4.(c) i or ii below; and

- ii. a copy of the TCEQ construction site notice, which must be completed and provided to the operator of any MS4 receiving the discharge, in accordance with Part II.F.3. above.
- (c) Each operator is responsible for determining its role as an operator as defined in Part I.B. and obtaining authorization under the permit, as described above in Part II.E. 1. - 3. Where authorization has been obtained by submitting an NOI for coverage under this general permit, permit coverage is not transferable from one operator to another. A transfer of operational control can include changes to the structure of a company, such as changing from a partnership to a corporation, or changing to a different corporation type such that a different filing (or charter) number is established with the Texas Secretary of State (SOS). A transfer of operational control can also occur when one of the following criteria is met, as applicable:
 - i. another operator has assumed control over all areas of the site that do not meet the definition for final stabilization;
 - ii. all silt fences and other temporary erosion controls have either been removed, scheduled for removal as defined in the SWP3, or transferred to a new operator, provided that the original permitted operator has attempted to notify the new operator in writing of the requirement to obtain permit coverage. Records of this notification (or attempt at notification) shall be retained by the operator transferring operational control to another operator in accordance with Part VI of this permit. Erosion controls that are designed to remain in place for an indefinite period, such as mulches and fiber mats, are not required to be removed or scheduled for removal; or
 - iii. a homebuilder has purchased one (1) or more lots from an operator who obtained coverage under this general permit for a common plan of development or sale. The homebuilder is considered a new operator and shall comply with the requirements of this permit. Under these circumstances, the homebuilder is only responsible for compliance with the general permit requirements as they apply to the lot(s) it has operational control over in a larger common plan of development, and the original operator remains responsible for common controls or discharges, and must amend its SWP3 to remove the lot(s) transferred to the homebuilder.

Section G. Waivers from Coverage

The executive director may waive the otherwise applicable requirements of this general permit for stormwater discharges from small construction activities under the terms and conditions described in this section.

1. Waiver Applicability and Coverage

Operators of small construction activities may apply for and receive a waiver from the requirements to obtain authorization under this general permit, when the calculated rainfall erosivity (R) factor for the entire period of the construction project is less than five (5).

The operator must submit a Low Rainfall Erosivity Waiver (LREW) certification form to the TCEQ electronically via the online ePermits system available through the TCEQ website. The LREW form is a certification by the operator that the small construction activity will commence and be completed within a period when the value of the calculated R factor is less than five (5).

Applicants who request and obtain an electronic reporting waiver shall submit the LREW on a paper form provided by the executive director at least seven (7) days prior to commencing construction activity to obtain provisional coverage 48-hours from the postmark date for delivery to the TCEQ. An authorization is no longer provisional when the executive director finds the LREW is administratively complete, and an authorization number is issued to the permittee for the construction site indicated on the LREW. Waivers from electronic reporting are not transferrable and expire on the same date as the authorization to discharge, except for temporary waivers that expire one (1) year from issuance.

This LREW from coverage does not apply to any non-stormwater discharges, including what is allowed under this permit. The operator must ensure that all non-stormwater discharges are either authorized under a separate permit or authorization or are captured and routed to an authorized treatment facility for disposal.

2. Steps to Obtaining a Waiver

The construction site operator may calculate the R factor to request a waiver using the following steps:

- (a) estimate the construction start date and the construction end date. The construction end date is the date that final stabilization will be achieved.
- (b) find the appropriate Erosivity Index (EI) zone in Appendix B of this permit.
- (c) find the EI percentage for the project period by adding the results for each period of the project using the table provided in Appendix D of this permit, in EPA Fact Sheet 2.1, or in USDA Handbook 703, by subtracting the start value from the end value to find the percent EI for the site.
- (d) refer to the Isoerodent Map (Appendix C of this permit) and interpolate the annual isoerodent value for the proposed construction location.
- (e) multiply the percent value obtained in Step (c) above by the annual isoerodent value obtained in Step (d). This is the R factor for the proposed project. If the value is less than five (5), then a waiver may be obtained. If the value is five (5) or more, then a waiver may not be obtained, and the operator must obtain coverage under Part II.E.2. of this permit.

Alternatively, the operator may calculate a site-specific R factor utilizing the following online calculator: <u>https://lew.epa.gov/</u>, or using another available resource.

A copy of the LREW certification form is not required to be posted at the small construction site.

3. Effective Date of an LREW

Unless otherwise notified by the executive director, operators of small construction activities seeking coverage under an LREW are provisionally waived from the otherwise applicable requirements of this general permit 48-hours from the date that a completed paper LREW certification form is postmarked for delivery to TCEQ, or immediately upon receiving confirmation of approval of an electronic submittal, made via the online ePermits system available through the TCEQ website.

Applicants seeking coverage under an LREW must submit an application for an LREW using the online ePermits system available through the TCEQ website, or request and obtain a waiver from electronic reporting from the TCEQ. Waivers from electronic reporting are not transferrable and expire on the same date as the authorization to discharge.

4. Activities Extending Beyond the LREW Period

If a construction activity extends beyond the approved waiver period due to circumstances beyond the control of the operator, the operator must either:

- (a) recalculate the R factor using the original start date and a new projected ending date, and if the R factor is still under five (5), submit a new LREW form at least two(2) days before the end of the original waiver period; or
- (b) obtain authorization under this general permit according to the requirements for automatic authorization for small construction activities in Part II.E.2. of this permit, prior to the end of the approved LREW period.

Section H. Alternative TPDES Permit Coverage

1. Individual Permit Alternative

Any discharge eligible for coverage under this general permit may alternatively be authorized under an individual TPDES permit according to 30 TAC Chapter 305 (relating to Consolidated Permits). Applications for individual permit coverage must be submitted at least 330 days prior to commencement of construction activities to ensure timely authorization. Existing coverage under this general permit should not be terminated until an individual permit is issued and in effect.

2. General Permit Alternative

Any discharges eligible for authorization under this general permit may alternatively be authorized under a separate general permit according to 30 TAC Chapter 205 (relating to General Permits for Waste Discharges), as applicable.

3. Individual Permit Required

The executive director may require an operator of a construction site, otherwise eligible for authorization under this general permit, to apply for an individual TPDES permit in the following circumstances:

- (a) the conditions of an approved TMDL or TMDL I-Plan on the receiving water;
- (b) the activity being determined to cause, has a reasonable potential to cause, or contribute to a violation of water quality standards or being found to cause, or contribute to, the loss of a designated use of surface water in the state; and
- (c) any other consideration defined in 30 TAC Chapter 205 (relating to General Permits for Waste Discharges) including 30 TAC § 205.4(c)(3)(D), which allows the commission to deny authorization under the general permit and require an individual permit if a discharger has been determined by the executive director to have been out of compliance with any rule, order, or permit of the commission, including non-payment of fees assessed by the executive director.

A discharger with a TCEQ compliance history rating of "unsatisfactory" is ineligible for coverage under this general permit. In that case, 30 TAC § 60.3 requires the executive director to deny or suspend an authorization to discharge under a general permit. However, per TWC § 26.040(h), a discharger is entitled to a hearing before the commission prior to having an authorization denied or suspended for having an "unsatisfactory" compliance history.

Denial of authorization to discharge under this general permit or suspension of a permittee's authorization under this general permit for reasons other than compliance history shall be done according to commission rules in 30 TAC Chapter 205 (relating to General Permits for Waste Discharges).

Section I. Permit Expiration

- 1. This general permit is effective for a term not to exceed five (5) years. All active discharge authorizations expire on the date provided on page one (1) of this permit. Following public notice and comment, as provided by 30 TAC § 205.3 (relating to Public Notice, Public Meetings, and Public Comment), the commission may amend, revoke, cancel, or renew this general permit. All authorizations that are active at the time the permit term expires will be administratively continued as indicated in Part II.I.2. below and in Part II.D.1.(b) and D.2.(b) of this permit.
- 2. If the executive director publishes a notice of the intent to renew or amend this general permit before the expiration date, the permit will remain in effect for existing, authorized discharges until the commission takes final action on the permit. Upon issuance of a renewed or amended permit, permittees may be required to submit an NOI within 90 days following the effective date of the renewed or amended permit, unless that permit provides for an alternative method for obtaining authorization.
- 3. If the commission does not propose to reissue this general permit within 90 days before the expiration date, permittees shall apply for authorization under an individual permit or an alternative general permit. If the application for an individual permit is submitted before the expiration date, authorization under this expiring general permit remains in effect until the issuance or denial of an individual permit. No new NOIs will be accepted nor new authorizations honored under the general permit after the expiration date.

Part III. Stormwater Pollution Prevention Plans (SWP3)

All regulated construction site operators shall prepare an SWP3, prior to submittal of an NOI, to address discharges authorized under Parts II.E.2. and II.E.3. of this general permit that will reach waters of the U.S. This includes discharges to MS4s and privately owned separate storm sewer systems that drain into surface water in the state or waters of the U.S.

Individual operators at a site may develop separate SWP3s that cover only their portion of the project, provided reference is made to the other operators at the site. Where there is more than one (1) SWP3 for a site, operators must coordinate to ensure that BMPs and controls are consistent and do not negate or impair the effectiveness of each other. Regardless of whether a single comprehensive SWP3 is developed or separate SWP3s are developed for each operator, it is the responsibility of each operator to ensure compliance with the terms and conditions of this general permit in the areas of the construction site where that operator has control over construction plans and specifications or day-to-day operations.

An SWP3 must describe the implementation of practices that will be used to minimize to the extent practicable the discharge of pollutants in stormwater associated with construction activity and non-stormwater discharges described in Part II.A.3., in compliance with the terms and conditions of this permit.

An SWP3 must also identify any potential sources of pollution that have been determined to cause, have a reasonable potential to cause, or contribute to a violation of water quality standards or have been found to cause or contribute to the loss of a designated use of surface water in the state from discharges of stormwater from construction activities and construction support activities. Where potential sources of these pollutants are present at a construction site, the SWP3 must also contain a description of the management practices that will be used to prevent these pollutants from being discharged into surface water in the state or waters of the U.S.

NOTE: Construction support activities can also include vehicle repair areas, fueling areas, etc. that are present at a construction site solely for the support construction activities and are only used by operators at the construction site.

The SWP3 is intended to serve as a road map for how the construction operator will comply with the effluent limits and other conditions of this permit. Additional portions of the effluent limits are established in Part IV. of the permit.

Section A. Shared SWP3 Development

For more effective coordination of BMPs and opportunities for cost sharing, a cooperative effort by the different operators at a site is encouraged. Operators of small and large construction activities must independently obtain authorization under this permit but may work together with other regulated operators at the construction site to prepare and implement a single, comprehensive SWP3, which can be shared by some or all operators, for the construction activities that each of the operators are performing at the entire construction site.

- 1. The SWP3 must include the following:
 - (a) for small construction activities the name of each operator that participates in the shared SWP3;
 - (b) for large construction activities the name of each operator that participates in the shared SWP3, the general permit authorization numbers of each operator (or the date that the NOI was submitted to TCEQ by each operator that has not received an authorization number for coverage under this permit); and
 - (c) for large and small construction activities the signature of each operator participating in the shared SWP3.
- 2. The SWP3 must clearly indicate which operator is responsible for satisfying each shared requirement of the SWP3. If the responsibility for satisfying a requirement is not described in the plan, then each permittee is entirely responsible for meeting the requirement within the boundaries of the construction site where they perform construction activities. The SWP3 must clearly describe responsibilities for meeting each requirement in shared or common areas.
- 3. The SWP3 may provide that one operator is responsible for preparation of a SWP3 in compliance with the CGP, and another operator is responsible for implementation of the SWP3 at the project site.

Section B. Responsibilities of Operators

1. Secondary Operators and Primary Operators with Control Over Construction Plans and Specifications

All secondary operators and primary operators with control over construction plans and specifications shall:

- (a) ensure the project specifications allow or provide that adequate BMPs are developed to meet the requirements of Part III of this general permit;
- (b) ensure that the SWP3 indicates the areas of the project where they have control over project specifications, including the ability to make modifications in specifications;
- (c) ensure that all other operators affected by modifications in project specifications are notified in a timely manner so that those operators may modify their BMP s as necessary to remain compliant with the conditions of this general permit; and

- (d) ensure that the SWP3 for portions of the project where each operator has control indicates the name and site-specific TPDES authorization number(s) for operators with the day-to-day operational control over those activities necessary to ensure compliance with the SWP3 and other permit conditions. If a primary operator has not been authorized or has abandoned the site, the secondary operator is considered to be the responsible party and must obtain authorization as a primary operator under the permit, until the authority for day-to-day operational control is transferred to another primary operator. The new primary operator must update or develop a new SWP3 that will reflect the transfer of operational control and include any additional updates to the SWP3 to meet requirements of the permit.
- 2. Primary Operators with Day-to-Day Operational Control

Primary operators with day-to-day operational control of those activities at a project that are necessary to ensure compliance with an SWP3 and other permit conditions must ensure that the SWP3 accomplishes the following requirements:

- (a) meets the requirements of this general permit for those portions of the project where they are operators;
- (b) identifies the parties responsible for implementation of BMPs described in the SWP3;
- (c) indicates areas of the project where they have operational control over day-to-day activities; and
- (d) the name and site-specific TPDES authorization number of the parties with control over project specifications, including the ability to make modifications in specifications for areas where they have operational control over day-to-day activities.

Section C. Deadlines for SWP3 Preparation, Implementation, and Compliance

The SWP3 must be prepared prior to obtaining authorization under this general permit, and implemented prior to commencing construction activities that result in soil disturbance. The SWP3 must be prepared so that it provides for compliance with the terms and conditions of this general permit.

Section D. Plan Review and Making Plans Available

1. The SWP3 must be retained on-site at the construction site or, if the site is inactive or does not have an on-site location to store the plan, a notice must be posted describing the location of the SWP3. The SWP3 must be made readily available at the time of an on-site inspection to: the executive director; a federal, state, or local agency approving sediment and erosion plans, grading plans, or stormwater management plans; local government officials; and the operator of a municipal separate storm sewer receiving discharges from the site. If the SWP3 is retained off-site, then it shall be made available as soon as reasonably possible. In most instances, it is reasonable that the SWP3 shall be made available within 24 hours of the request.

NOTE: The SWP3 may be prepared and kept electronically, rather than in paper form, if the records are: (a) in a format that can be read in a similar manner as a paper record; (b) legally valid with no less evidentiary value than their paper equivalent; and (c) immediately accessible to the inspector during an inspection to the same extent as a paper copy stored at the site would be, if the records were stored in paper form.

2. Operators with authorization for construction activity under this general permit must post a TCEQ site notice at the construction site at a place readily available for viewing by the general public, and local, state, and federal authorities.

- (a) Primary and secondary operators of large construction activities must each post a TCEQ construction site notice, respective to their role as an operator at the construction site, as required above and according to requirements in Part II.E.3. of this general permit.
- (b) Primary and secondary operators of small construction activities must post the TCEQ site notice as required in Part III.D.2.(a) above and for the specific type of small construction described in Part II.E.1. and 2. of the permit.
- (c) If the construction project is a linear construction project, such as a pipeline or highway, the notices must be placed in a publicly accessible location near where construction is actively underway. TCEQ construction site notices for small and large construction activities at these linear construction sites may be relocated, as necessary, along the length of the project, but must still be readily available for viewing by the general public; local, state, and federal authorities; and contain the following information:
 - i. the site-specific TPDES authorization number for the project if assigned;
 - ii. the operator name, contact name, and contact phone number;
 - iii. a brief description of the project; and
 - iv. the location of the SWP3.
- 3. This permit does not provide the general public with any right to trespass on a construction site for any reason, including inspection of a site; nor does this permit require that permittees allow members of the general public access to a construction site.

Section E. Revisions and Updates to SWP3s

The permittee must revise or update the SWP3, including the site map, within seven (7) days of when any of the following occurs:

- 1. a change in design, construction, operation, or maintenance that has a significant effect on the discharge of pollutants and that has not been previously addressed in the SWP3;
- 2. changing site conditions based on updated plans and specifications, new operators, new areas of responsibility, and changes in BMPs; or
- 3. results of inspections or investigations by construction site personnel authorized by the permittee, operators of a municipal separate storm sewer system receiving the discharge, authorized TCEQ personnel, or a federal, state or local agency approving sediment and erosion plans indicate the SWP3 is proving ineffective in eliminating or significantly minimizing pollutants in discharges authorized under this general permit.

Section F. Contents of SWP3

The SWP3 must be developed and implemented by primary operators of small and large construction activities and include, at a minimum, the information described in this section and must comply with the construction and development effluent guidelines in Part IV. of the general permit.

- 1. A site or project description, which includes the following information:
 - (a) a description of the nature of the construction activity;
 - (b) a list of potential pollutants and their sources;
 - (c) a description of the intended schedule or sequence of activities that will disturb soils for major portions of the site, including estimated start dates and duration of activities;

- (d) the total number of acres of the entire property and the total number of acres where construction activities will occur, including areas where construction support activities (defined in Part I.B. of this general permit) occur;
- (e) data describing the soil or the quality of any discharge from the site;
- (f) a map showing the general location of the site (e.g., a portion of a city or county map);
- (g) a detailed site map (or maps) indicating the following:
 - i. property boundary(ies);
 - ii. drainage patterns and approximate slopes anticipated before and after major grading activities;
 - iii. areas where soil disturbance will occur (note any phasing), including any demolition activities;
 - iv. locations of all controls and buffers, either planned or in place;
 - v. locations where temporary or permanent stabilization practices are expected to be used;
 - vi. locations of construction support activities, including those located off-site;
 - vii. surface waters (including wetlands) either at, adjacent, or in close proximity to the site, and also indicate whether those waters are impaired;

NOTE: Surface waters adjacent to or in close proximity to the site means any receiving waters within the site and all receiving waters within one mile downstream of the site's discharge point(s).

- viii. locations where stormwater discharges from the site directly to a surface water body or a municipal separate storm sewer system;
- ix. vehicle wash areas; and
- x. designated points on the site where vehicles will exit onto paved roads (for instance, this applies to construction transition from unstable dirt areas to exterior paved roads).

Where the amount of information required to be included on the map would result in a single map being difficult to read and interpret, the operator shall develop a series of maps that collectively include the required information.

- (h) the location and description of support activities authorized under the permittee's NOI, including asphalt plants, concrete plants, and other activities providing support to the construction site that is authorized under this general permit;
- (i) the name of receiving waters at or near the site that may be disturbed or that may receive discharges from disturbed areas of the project;
- (j) a copy of this TPDES general permit (an electronic copy of this TPDES general permit or a current link to this TPDES general permit on the TCEQ webpage is acceptable);
- (k) the NOI and the acknowledgement of provisional and non-provisional authorization for primary operators of large construction sites, and the TCEQ site notice for small construction sites and for secondary operators of large construction sites;
- (l) if signatory authority is delegated by an authorized representative, then a copy of the formal notification to TCEQ, as required by 30 TAC 305.128 relating to Signatories to Reports must be filed in the SWP3 and made available for review upon request by TCEQ or local MS4 Operator. For primary operators of large construction activities, the formal notification to TCEQ must be submitted either electronically through

STEERS, TCEQ's electronic reporting system, or, if qualifying for an electronic reporting waiver, by paper on a Delegation of Signatories form. For operators or small construction activities, the formal notification to TCEQ must be submitted by paper on a Delegation of Signatories form.

- (m) stormwater and allowable non-stormwater discharge locations, including storm drain inlets on site and in the immediate vicinity of the construction site where construction support activities will occur; and
- (n) locations of all pollutant-generating activities at the construction site and where construction support activities will occur, such as the following: Paving operations; concrete, paint and stucco washout and water disposal; solid waste storage and disposal; and dewatering operations.
- 2. A description of the BMPs that will be used to minimize pollution in runoff.

The description must identify the general timing or sequence for installation and implementation. At a minimum, the description must include the following components:

- (a) General Requirements
 - i. Erosion and sediment controls must be designed to retain sediment on-site to the extent practicable with consideration for local topography, soil type, and rainfall.
 - ii. Control measures must be properly selected, installed, and maintained according to good engineering practices, and the manufacturer's or designer's specifications.
 - iii. Controls must be developed to minimize the offsite transport of litter, construction debris, construction materials, and other pollutants required of Part IV.D.
- (b) Erosion Control and Stabilization Practices

The SWP3 must include a description of temporary and permanent erosion control and stabilization practices for the construction site, where small or large construction activity will occur. The erosion control and stabilization practices selected by the permittee must be compliant with the requirements for sediment and erosion control, located in Part IV. of this permit. The description of the SWP3 must also include a schedule of when the practices will be implemented. Site plans must ensure that existing vegetation at the construction site is preserved where it is possible.

- i. Erosion control and stabilization practices may include but are not limited to: establishment of temporary or permanent vegetation, mulching, geotextiles, sod stabilization, vegetative buffer strips, protection of existing trees and vegetation, slope texturing, temporary velocity dissipation devices, flow diversion mechanisms, and other similar measures.
- ii. The following records must be maintained and either attached to or referenced in the SWP3, and made readily available upon request to the parties listed in Part III.D.1 of this general permit:
 - (A) the dates when major grading activities occur;
 - (B) the dates when construction activities temporarily or permanently cease on a portion of the site; and
 - (C) the dates when stabilization measures are initiated.
- iii. Erosion control and stabilization measures must be initiated immediately in portions of the site where construction activities have temporarily ceased and will not resume for a period exceeding fourteen (14) calendar days. Stabilization

measures that provide a protective cover must be initiated immediately in portions of the site where construction activities have permanently ceased. The term "immediately" is used to define the deadline for initiating stabilization measures. In the context of this requirement, "immediately" means as soon as practicable, but no later than the end of the next work day, following the day when the earth-disturbing activities have temporarily or permanently ceased. Except as provided in (A) through (D) below, these measures must be completed as soon as practicable, but no more than fourteen (14) calendar days after the initiation of soil stabilization measures:

- (A) where the immediate initiation of vegetative stabilization measures after construction activity has temporarily or permanently ceased due to frozen conditions, non-vegetative controls must be implemented until thawing conditions (as defined in Part I.B. of this general permit) are present, and vegetative stabilization measures can be initiated as soon as practicable.
- (B) in arid areas, semi-arid areas, or drought-stricken areas, as they are defined in Part I.B. of this general permit, where the immediate initiation of vegetative stabilization measures after construction activity has temporarily or permanently ceased or is precluded by arid conditions, other types of erosion control and stabilization measures must be initiated at the site as soon as practicable. Where vegetative controls are infeasible due to arid conditions, and within fourteen (14) calendar days of a temporary or permanent cessation of construction activity in any portion of the site, the operator shall immediately install non-vegetative erosion controls in areas of the construction site where construction activity is complete or has ceased. If non-vegetative controls are infeasible, the operator shall install temporary sediment controls as required in Part III.F.2.(b)iii.(C) below.
- (C) in areas where non-vegetative controls are infeasible, the operator may alternatively utilize temporary perimeter controls. The operator must document in the SWP3 the reason why stabilization measures are not feasible, and must demonstrate that the perimeter controls will retain sediment on site to the extent practicable. The operator must continue to inspect the BMPs at the frequencies established in Part III.F.8.(c) for unstabilized sites.
- (D) the requirement for permittees to initiate stabilization is triggered as soon as it is known with reasonable certainty that construction activity at the site or in certain areas of the site will be stopped for 14 or more additional calendar days. If the initiation or completion of vegetative stabilization is prevented by circumstances beyond the control of the permittee, the permittee must employ and implement alternative stabilization measures immediately. When conditions at the site changes that would allow for vegetative stabilization, then the permittee must initiate or complete vegetative stabilization as soon as practicable.
- iv. Final stabilization must be achieved prior to termination of permit coverage.
- v. TCEQ does not expect that temporary or permanent stabilization measures to be applied to areas that are intended to be left un-vegetated or un-stabilized following construction (e.g., dirt access roads, utility pole pads, areas being used for storage of vehicles, equipment, or materials).

(c) Sediment Control Practices

The SWP3 must include a description of any sediment control practices used to remove eroded soils from stormwater runoff, including the general timing or sequence for implementation of controls. Controls selected by the permittee must be compliant with the requirements in Part IV. of this permit.

- i. Sites With Drainage Areas of Ten (10) or More Acres
 - (A) Sedimentation Basin(s) or Impoundments
 - A sedimentation basin or similar impoundment is required, where (1) feasible, for a common drainage location that serves an area with ten (10) or more acres disturbed at one time. A sedimentation basin or impoundment may be temporary or permanent, and must provide sufficient storage to contain a calculated volume of runoff from a 2vear, 24-hour storm from each disturbed acre drained. When calculating the volume of runoff from a 2-year, 24-hour storm event, it is not required to include the flows from offsite areas and flow from onsite areas that are either undisturbed or have already undergone permanent stabilization, if these flows are diverted around both the disturbed areas of the site and the sediment basin or similar impoundment. Capacity calculations shall be included in the SWP3. Sedimentation basins must be designed for and appropriate for controlling runoff at the site and existing detention or retention ponds at the site may not be appropriate.
 - (2) Where rainfall data is not available, or a calculation cannot be performed, the sedimentation basin must provide at least 3,600 cubic feet of storage per acre drained until final stabilization of the site.
 - (3) If a sedimentation basin or impoundment is not feasible, then the permittee shall provide equivalent control measures until final stabilization of the site. In determining whether installing a sediment basin or impoundment is feasible, the permittee may consider factors such as site soils, slope, available area, public safety, precipitation patterns, site geometry, site vegetation, infiltration capacity, geotechnical factors, depth to groundwater, and other similar considerations. The permittee shall document the reason that the sediment basins or impoundments are not feasible, and shall utilize equivalent control measures, which may include a series of smaller sediment basins or impoundments.
 - (4) Unless infeasible, when discharging from sedimentation basins and impoundments, the permittee shall utilize outlet structures that withdraw water from the surface.
 - (B) Perimeter Controls: At a minimum, silt fences, vegetative buffer strips, or equivalent sediment controls are required for all down slope boundaries of the construction area, and for those side slope boundaries deemed appropriate as dictated by individual site conditions.
- ii. Controls for Sites with Drainage Areas Less than Ten (10) Acres:
 - (A) Sediment traps and sediment basins may be used to control solids in stormwater runoff for drainage locations serving less than ten (10) acres. At a minimum, silt fences, vegetative buffer strips, or equivalent sediment controls are required for all down slope boundaries of the construction area, and for those side slope boundaries deemed appropriate as dictated by individual site conditions.

- (B) Alternatively, a sediment basin that provides storage for a calculated volume of runoff from a 2-year, 24-hour storm from each disturbed acre drained may be utilized. Where rainfall data is not available or a calculation cannot be performed, a temporary or permanent sediment basin providing 3,600 cubic feet of storage per acre drained may be provided. If a calculation is performed, then the calculation shall be included in the SWP3.
- (C) If sedimentation basins or impoundments are used, the permittee shall comply with the requirements in Part IV.F. of this general permit.
- 3. Description of Permanent Stormwater Controls

A description of any stormwater control measures that will be installed during the construction process to control pollutants in stormwater discharges that may occur after construction operations have been completed must be included in the SWP3. Permittees are responsible for the installation and maintenance of stormwater management measures, as follows:

- (a) permittees authorized under the permit for small construction activities are responsible for the installation and maintenance of stormwater control measures prior to final stabilization of the site; or
- (b) permittees authorized under the permit for large construction activities are responsible for the installation and maintenance of stormwater control measures prior to final stabilization of the site and prior to submission of an NOT.
- 4. Other Required Controls and BMPs
 - (a) Permittees shall minimize, to the extent practicable, the off-site vehicle tracking of sediments and dust. The SWP3 shall include a description of controls utilized to control the generation of pollutants that could be discharged in stormwater from the site.
 - (b) The SWP3 must include a description of construction and waste materials expected to be stored on-site and a description of controls to minimize pollutants from these materials.
 - (c) The SWP3 must include a description of potential pollutant sources in discharges of stormwater from all areas of the construction site where construction activity, including construction support activities, will be located, and a description of controls and measures that will be implemented at those sites to minimize pollutant discharges.
 - (d) Permittees shall place velocity dissipation devices at discharge locations and along the length of any outfall channel (i.e., runoff conveyance) to provide a non-erosive flow velocity from the structure to a water course, so that the natural physical and biological characteristics and functions are maintained and protected.
 - (e) Permittees shall design and utilize appropriate controls in accordance with Part IV. of this permit to minimize the offsite transport of suspended sediments and other pollutants if it is necessary to pump or channel standing water from the site.
 - (f) Permittees shall ensure that all other required controls and BMPs comply with all of the requirements of Part IV. of this general permit.
 - (g) For demolition of any structure with at least 10,000 square feet of floor space that was built or renovated before January 1, 1980, and the receiving waterbody is impaired for polychlorinated biphenyls (PCBs):
 - i. implement controls to minimize the exposure of PCB-containing building materials, including paint, caulk, and pre-1980 fluorescent lighting fixtures to precipitation and to stormwater; and

- ii. ensure that disposal of such materials is performed in compliance with applicable state, federal, and local laws.
- 5. Documentation of Compliance with Approved State and Local Plans
 - (a) Permittees must ensure that the SWP3 is consistent with requirements specified in applicable sediment and erosion site plans or site permits, or stormwater management site plans or site permits approved by federal, state, or local officials.
 - (b) SWP3s must be updated as necessary to remain consistent with any changes applicable to protecting surface water resources in sediment erosion site plans or site permits, or stormwater management site plans or site permits approved by state or local official for which the permittee receives written notice.
 - (c) If the permittee is required to prepare a separate management plan, including but not limited to a WPAP or Contributing Zone Plan in accordance with 30 TAC Chapter 213 (related to the Edwards Aquifer), then a copy of that plan must be either included in the SWP3 or made readily available upon request to authorized personnel of the TCEQ. The permittee shall maintain a copy of the approval letter for the plan in its SWP3.
- 6. Maintenance Requirements
 - (a) All protective measures identified in the SWP3 must be maintained in effective operating condition. If, through inspections or other means, as soon as the permittee determines that BMPs are not operating effectively, then the permittee shall perform maintenance as necessary to maintain the continued effectiveness of stormwater controls, and prior to the next rain event if feasible. If maintenance prior to the next anticipated storm event is impracticable, the reason shall be documented in the SWP3 and maintenance must be scheduled and accomplished as soon as practicable. Erosion and sediment controls that have been intentionally disabled, run-over, removed, or otherwise rendered ineffective must be replaced or corrected immediately upon discovery.
 - (b) If periodic inspections or other information indicates a control has been used incorrectly, is performing inadequately, or is damaged, then the operator shall replace or modify the control as soon as practicable after making the discovery.
 - (c) Sediment must be removed from sediment traps and sedimentation ponds no later than the time that design capacity has been reduced by 50%. For perimeter controls such as silt fences, berms, etc., the trapped sediment must be removed before it reaches 50% of the above-ground height.
 - (d) If sediment escapes the site, accumulations must be removed at a frequency that minimizes off-site impacts, and prior to the next rain event, if feasible. If the permittee does not own or operate the off-site conveyance, then the permittee shall work with the owner or operator of the property to remove the sediment.
- 7. Observation and Evaluation of Dewatering Controls Pursuant to Part IV.C. of this General Permit
 - (a) Personnel provided by the permittee must observe and evaluate dewatering controls at a minimum of once per day on the days where dewatering discharges from the construction site occur. Personnel conducting these evaluations must be knowledgeable of this general permit, the construction activities at the site, and the SWP3 for the site. Personnel conducting these evaluations are not required to have signatory authority for reports under 30 TAC § 305.128 (relating to Signatories to Reports).

- (b) Requirements for Observations and Evaluations
 - i. A report summarizing the scope of any observation and evaluation must be completed within 24-hours following the evaluation. The report must also include, at a minimum, the following:
 - (A) date of the observations and evaluation;
 - (B) name(s) and title(s) of personnel making the observations and evaluation;
 - (C) approximate times that the dewatering discharge began and ended on the day of evaluation, or if the dewatering discharge is a continuous discharge that continues after normal business hours, indicate that the discharge is continuous (this information can be reported by personnel initiating the dewatering discharge);
 - (D) estimates of the rate (in gallons per day) of discharge on the day of evaluation;
 - (E) whether or not any indications of pollutant discharge were observed at the point of discharge (e.g., foam, oil sheen, noticeable odor, floating solids, suspended sediments, or other obvious indicators of stormwater pollution); and
 - (F) major observations, including: the locations of where erosion and discharges of sediment or other pollutants from the site have occurred; locations of BMPs that need to be maintained; locations of BMPs that failed to operate as designed or proved inadequate for a particular location; and locations where additional BMPs are needed.
 - ii. Actions taken as a result of evaluations, including the date(s) of actions taken, must be described within, and retained as a part of, the SWP3. Reports must identify any incidents of non-compliance. Where a report does not identify any incidents of non-compliance, the report must contain a certification that the facility or site is in compliance with the SWP3 and this permit. The report must be retained as part of the SWP3 and signed by the person and in the manner required by 30 TAC § 305.128 (relating to Signatories to Reports).
 - iii. The names and qualifications of personnel making the evaluations for the permittee may be documented once in the SWP3 rather than being included in each report.
- 8. Inspections of All Controls
 - (a) Personnel provided by the permittee must inspect disturbed areas (cleared, graded, or excavated) of the construction site that do not meet the requirements of final stabilization in this general permit, all locations where stabilization measures have been implemented, areas of construction support activity covered under this permit, stormwater controls (including pollution prevention controls) for evidence of, or the potential for, the discharge of pollutants, areas where stormwater typically flows within the construction site, and points of discharge from the construction site.
 - i. Personnel conducting these inspections must be knowledgeable of this general permit, the construction activities at the site, and the SWP3 for the site.
 - ii. Personnel conducting these inspections are not required to have signatory authority for inspection reports under 30 TAC § 305.128 (relating to Signatories to Reports).

- (b) Requirements for Inspections
 - i. Inspect all stormwater controls (including sediment and erosion control measures identified in the SWP3) to ensure that they are installed properly, appear to be operational, and minimizing pollutants in discharges, as intended.
 - ii. Identify locations on the construction site where new or modified stormwater controls are necessary.
 - iii. Check for signs of visible erosion and sedimentation that can be attributed to the points of discharge where discharges leave the construction site or discharge into any surface water in the state flowing within or adjacent to the construction site.
 - iv. Identify any incidents of noncompliance observed during the inspection.
 - v. Inspect locations where vehicles enter or exit the site for evidence of off-site sediment tracking.
 - vi. If an inspection is performed when discharges from the construction site are occurring: identify all discharge points at the site, and observe and document the visual quality of the discharge (i.e., color, odor, floating, settled, or suspended solids, foam, oil sheen, and other such indicators of pollutants in stormwater).
 - vii. Complete any necessary maintenance needed, based on the results of the inspection and in accordance with the requirements listed in Part III.F.6. above.
- (c) Inspection frequencies:
 - i. Inspections of construction sites must be conducted at least once every fourteen (14) calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater, unless as otherwise provided below in Part III.F.8.(c)ii. v. below.
 - (A) If a storm event produces 0.5 inches or more of rain within a 24-hour period (including when there are multiple, smaller storms that alone produce less than 0.5 inches but together produce 0.5 inches or more in 24 hours), you are required to conduct one inspection within 24 hours of when 0.5 inches of rain or more has fallen. When the 24-hour inspection time frame occurs entirely outside of normal working hours, you must conduct an inspection by no later than the end of the next business day.
 - (B) If a storm event produces 0.5 inches or more of rain within a 24-hour period on the first day of a storm and continues to produce 0.5 inches or more of rain on subsequent days, you must conduct an inspection within 24 hours of the first day of the storm and within 24 hours after the last day of the storm that produces 0.5 inches or more of rain (i.e., only two (2) inspections would be required for such a storm event). When the 24-hour inspection time frame occurs entirely outside of normal working hours, you must conduct an inspection by no later than the end of the next business day.
 - ii. Inspection frequencies must be conducted at least once every month in areas of the construction site that meet final stabilization or have been temporarily stabilized.
 - iii. Inspection frequencies for construction sites, where runoff is unlikely due to the occurrence of frozen conditions at the site, must be conducted at least once every month until thawing conditions begin to occur (see definitions for thawing conditions in Part I.B.). The SWP3 must also contain a record of the approximate beginning and ending dates of when frozen conditions occurred at the site, which resulted in inspections being conducted monthly, while those

conditions persisted, instead of at the interval of once every fourteen (14) calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater.

- iv. In arid, semi-arid, or drought-stricken areas, inspections must be conducted at least once every month and within 24 hours after the end of a storm event of 0.5 inches or greater. The SWP3 must also contain a record of the total rainfall measured, as well as the approximate beginning and ending dates of when drought conditions occurred at the site, which resulted in inspections being conducted monthly, while those conditions persisted, instead of at the interval of once every fourteen (14) calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater.
- v. As an alternative to the inspection schedule in Part III.F.8.(c)i. above, the SWP3 may be developed to require that these inspections will occur at least once every seven (7) calendar days. If this alternative schedule is developed, then the inspection must occur regardless of whether or not there has been a rainfall event since the previous inspection.
- vi. The inspection procedures described in Part III.F.8.(c)i. v above can be performed at the frequencies and under the applicable conditions indicated for each schedule option, provided that the SWP3 reflects the current schedule and that any changes to the schedule are made in accordance with the following provisions: the inspection frequency schedule can only be changed a maximum of once per calendar month and implemented within the first five (5) business days of a calendar month; and the reason for the schedule change documented in the SWP3 (e.g., end of "dry" season and beginning of "wet" season).
- (d) Utility line installation, pipeline construction, and other examples of long, narrow, linear construction activities may provide inspection personnel with limited access to the areas described in Part III.F.8.(a) above.
 - i. Inspection of linear construction sites could require the use of vehicles that could compromise areas of temporary or permanent stabilization, cause additional disturbance of soils, and result in the increase the potential for erosion. In these circumstances, controls must be inspected at least once every fourteen (14) calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater, but representative inspections may be performed.
 - ii. For representative inspections, personnel must inspect controls along the construction site for 0.25 mile above and below each access point where a roadway, undisturbed right-of-way, or other similar feature intersects the construction site and allows access to the areas described in Part III.F.8.(a) above. The conditions of the controls along each inspected 0.25-mile portion may be considered as representative of the condition of controls along that reach extending from the end of the 0.25-mile portion to either the end of the next 0.25-mile inspected portion, or to the end of the project, whichever occurs first.

As an alternative to the inspection schedule described in Part III.F.8.(c)i. above, the SWP3 may be developed to require that these inspections will occur at least once every seven (7) calendar days. If this alternative schedule is developed, the inspection must occur regardless of whether or not there has been a rainfall event since the previous inspection.

- iii. the SWP3 for a linear construction site must reflect the current inspection schedule. Any changes to the inspection schedule must be made in accordance with the following provisions:
 - (A) the schedule may be changed a maximum of one time each month;

- (B) the schedule change must be implemented at the beginning of a calendar month, and
- (C) the reason for the schedule change must be documented in the SWP3 (e.g., end of "dry" season and beginning of "wet" season).
- (e) Adverse Conditions.

Requirements for inspections may be temporarily suspended for adverse conditions. Adverse conditions are conditions that are either dangerous to personnel (e.g., high wind, excessive lightning) or conditions that prohibit access to the site (e.g., flooding, freezing conditions). Adverse conditions that result in the temporary suspension of a permit requirement to inspect must be documented and included as part of the SWP3. Documentation must include:

- i. the date and time of the adverse condition,
- ii. names of personnel that witnessed the adverse condition, and
- iii. a narrative for the nature of the adverse condition.
- (f) In the event of flooding or other adverse conditions which prohibit access to the inspection sites, inspections must be conducted as soon as access is practicable. Inspection Reports.
 - i. A report summarizing the scope of any inspection must be completed within 24-hours following the inspection. The report must also include the date(s) of the inspection and major observations relating to the implementation of the SWP3. Major observations in the report must include: the locations of where erosion and discharges of sediment or other pollutants from the site have occurred; locations of BMPs that need to be maintained; locations of BMPs that failed to operate as designed or proved inadequate for a particular location; and locations where additional BMPs are needed.
 - ii. Actions taken as a result of inspections, including the date(s) of actions taken, must be described within, and retained as a part of, the SWP3. Reports must identify any incidents of non-compliance. Where a report does not identify any incidents of non-compliance, the report must contain a certification that the facility or site is in compliance with the SWP3 and this permit. The report must be retained as part of the SWP3 and signed by the person and in the manner required by 30 TAC § 305.128 (relating to Signatories to Reports).
 - iii. The names and qualifications of personnel making the inspections for the permittee may be documented once in the SWP3 rather than being included in each report.
- (g) The SWP3 must be modified based on the results of inspections, as necessary, to better control pollutants in runoff. Revisions to the SWP3 must be completed within seven (7) calendar days following the inspection. If existing BMPs are modified or if additional BMPs are necessary, an implementation schedule must be described in the SWP3 and wherever possible those changes implemented before the next storm event. If implementation before the next anticipated storm event is impracticable, these changes must be implemented as soon as practicable. If necessary, modify your site map to reflect changes to your stormwater controls that are no longer accurately reflected on the current site map.
- 9. The SWP3 must identify and ensure the implementation of appropriate pollution prevention measures for all eligible non-stormwater components of the discharge, as listed in Part II.A.3. of this permit.
- 10. The SWP3 must include the information required in Part III.B. of this general permit.

11. The SWP3 must include pollution prevention procedures that comply with Part IV.D. of this general permit.

Part IV. Erosion and Sediment Control Requirements Applicable to All Sites

Except as provided in 40 CFR §§ 125.30-125.32, any discharge regulated under this general permit, with the exception of sites that obtained waivers based on low rainfall erosivity, must achieve, at a minimum, the following effluent limitations representing the degree of effluent reduction attainable by application of the best practicable control technology currently available (BPT). The BPT are also required by and must satisfy the Effluent Limitations Guideline (ELG) permitting requirement for application of 40 CFR § 450.24 New Source Performance Standards (NSPS), 40 CFR § 450.22 Best Available Technology Economically Achievable (BAT), and 40 CFR § 450.23 Best Conventional Pollutant Control Technology (BCT).

Section A. Erosion and Sediment Controls

Design, install, and maintain effective erosion controls and sediment controls to minimize the discharge of pollutants. At a minimum, such controls must be designed, installed, and maintained to:

- 1. control stormwater volume and velocity within the site to minimize soil erosion in order to minimize pollutant discharges;
- 2. control stormwater discharges, including both peak flowrates and total stormwater volume, to minimize channel and streambank erosion and scour in the immediate vicinity of discharge point(s);
- 3. minimize the amount of soil exposed during construction activity;
- 4. minimize the disturbance of steep slopes;
- 5. minimize sediment discharges from the site. The design, installation, and maintenance of erosion and sediment controls must address factors such as the amount, frequency, intensity and duration of precipitation, the nature of resulting stormwater runoff, and soil characteristics, including the range of soil particle sizes expected to be present on the site;
- 6. provide and maintain appropriate natural buffers around surface water in the state. Direct stormwater to vegetated areas and maximize stormwater infiltration to reduce pollutant discharges, unless infeasible. If providing buffers is infeasible, the permittee shall document the reason that natural buffers are infeasible and shall implement additional erosion and sediment controls to reduce sediment load;
- 7. preserve native topsoil at the site, unless the intended function of a specific area of the site dictates that the topsoil be disturbed or removed, or it is infeasible; and
- 8. minimize soil compaction. In areas of the construction site where final vegetative stabilization will occur or where infiltration practices will be installed, either:
 - (a) restrict vehicle and equipment use to avoid soil compaction; or
 - (b) prior to seeding or planting areas of exposed soil that have been compacted, use techniques that condition the soils to support vegetative growth, if necessary and feasible.

Minimizing soil compaction is not required where the intended function of a specific area of the site dictates that it be compacted.

9. TCEQ does not consider stormwater control features (e.g., stormwater conveyance channels, storm drain inlets, sediment basins) to constitute "surface water" for the purposes of triggering the buffer requirement in Part IV.A.(6) above.

Section B. Soil Stabilization

Stabilization of disturbed areas must, at a minimum, be initiated immediately whenever any clearing, grading, excavating, or other earth disturbing activities have permanently ceased on any portion of the site, or temporarily ceased on any portion of the site and will not resume for a period exceeding fourteen (14) calendar days. In the context of this requirement, "immediately" means as soon as practicable, but no later than the end of the next workday, following the day when the earth-disturbing activities have temporarily or permanently ceased. Temporary stabilization must be completed no more than fourteen (14) calendar days after initiation of soil stabilization measures, and final stabilization must be achieved prior to termination of permit coverage. In arid, semi-arid, and drought-stricken areas where initiating vegetative stabilization measures immediately is infeasible, alternative non-vegetative stabilization measures must be employed as soon as practicable. Refer to Part III.F.2.(b) for complete erosion control and stabilization practice requirements. In limited circumstances, stabilization may not be required if the intended function of a specific area of the site necessitates that it remain disturbed.

Section C. Dewatering

Discharges from dewatering activities, including discharges from dewatering of trenches and excavations, are prohibited, unless managed by appropriate controls to address sediment and prevent erosion. Operators must observe and evaluate the dewatering controls once per day while the dewatering discharge occurs as described in Part III.F.7. of this general permit.

Section D. Pollution Prevention Measures

Design, install, implement, and maintain effective pollution prevention measures to minimize the discharge of pollutants. At a minimum, such measures must be designed, installed, implemented, and maintained to:

- 1. minimize the discharge of pollutants from equipment and vehicle washing, wheel wash water, and other wash waters. Wash waters must be treated in a sediment basin or alternative control that provides equivalent or better treatment prior to discharge;
- 2. minimize the exposure of building materials, building products, construction wastes, trash, landscape materials, fertilizers, pesticides, herbicides, detergents, sanitary waste, and other materials present on the site to precipitation and to stormwater;
- 3. minimize the exposure of waste materials by closing waste container lids at the end of the workday and during storm events. For waste containers that do not have lids, where the container itself is not sufficiently secure enough to prevent the discharge of pollutants absent a cover and could leak, the permittee must provide either a cover (e.g., a tarp, plastic sheeting, temporary roof) to minimize exposure of wastes to precipitation, stormwater, and wind, or a similarly effective means designed to minimize the discharge of pollutants (e.g., secondary containment). Minimization of exposure is not required in cases where the exposure to precipitation and to stormwater will not result in a discharge of pollutants, or where exposure of a specific material or product poses little risk of stormwater contamination (such as final products and materials intended for outdoor use);
- 4. minimize exposure of wastes by implementing good housekeeping measures. Wastes must be cleaned up and disposed of in designated waste containers on days of operation at the site. Wastes must be cleaned up immediately if containers overflow;

- 5. minimize the discharge of pollutants from spills and leaks and implement chemical spill and leak prevention and response procedures. Where a leak, spill, or other release containing a hazardous substance or oil in an amount equal to or in excess of a reportable quantity established under either 40 CFR Part 110, 40 CFR Part 117, or 40 CFR Part 302 occurs during a 24-hour period, you must notify the National Response Center (NRC) at (800) 424-8802 in accordance with the requirements of 40 CFR Part 110, 40 CFR Part 117, and 40 CFR Part 302 as soon as you have knowledge of the release. You must also, within seven (7) calendar days of knowledge of the release, provide a description of the release, the circumstances leading to the release, and the date of the release; and
- 6. minimize exposure of sanitary waste by positioning portable toilets so that they are secure and will not be tipped or knocked over, and so that they are located away from surface water in the state and stormwater inlets or conveyances.

Section E. Prohibited Discharges

The following discharges are prohibited:

- 1. wastewater from wash out of concrete, unless managed by an appropriate control;
- 2. wastewater from wash out and cleanout of stucco, paint, form release oils, curing compounds and other construction materials;
- 3. fuels, oils, or other pollutants used in vehicle and equipment operation and maintenance;
- 4. soaps or solvents used in vehicle and equipment washing; and
- 5. toxic or hazardous substances from a spill or other release.

Section F. Surface Outlets

When discharging from basins and impoundments, utilize outlet structures that withdraw water from the surface, unless infeasible. If infeasible, the permittee must provide documentation in the SWP3 to support the determination, including the specific conditions or time periods when this exception will apply.

Part V. Stormwater Runoff from Concrete Batch Plants

Discharges of stormwater runoff from concrete batch plants present at regulated construction sites and operated as a construction support activity may be authorized under the provisions of this general permit, provided that the following requirements are met for concrete batch plant(s) authorized under this permit. Only the discharges of stormwater runoff and non-stormwater from concrete batch plants that meet the requirements of a construction support activity can be authorized under this permit (see the requirements for "Non-Stormwater Discharges" in Part II.A.3. and "Discharges of Stormwater Associated with Construction Support Activity" in Part II.A.2.).

If discharges of stormwater runoff or non-stormwater from concrete batch plants are not authorized under this general permit, then discharges must be authorized under an alternative general permit or individual permit [see the requirement in Part II.A.2.(c)].

This permit does not authorize the discharge or land disposal of any wastewater from concrete batch plants at regulated construction sites. Authorization for these wastes must be obtained under an individual permit or an alternative general permit.

Section A. Benchmark Sampling Requirements

1. Operators of concrete batch plants authorized under this general permit shall sample the stormwater runoff from the concrete batch plants according to the requirements of this section of this general permit, and must conduct evaluations on the effectiveness of the SWP3 based on the following benchmark monitoring values:

Benchmark	Benchmark Value	Sampling	Sample Type		
Parameter		Frequency			
Oil and Grease (*1)	15 mg/L	1/quarter (*2) (*3)	Grab (*4)		
Total Suspended Solids (*1)	50 mg/L	1/quarter (*2) (*3)	Grab (*4)		
pН	6.0 – 9.0 Standard Units	1/quarter (*2) (*3)	Grab (*4)		
Total Iron (*1)	1.3 mg/L	1/quarter (*2) (*3)	Grab (*4)		

Table 1. Benchmark Parameters

- (*1) All analytical results for these parameters must be obtained from a laboratory that is accredited based on rules located in 30 TAC § 25.4 (a) or through the National Environmental Laboratory Accreditation Program (NELAP). Analysis must be performed using sufficiently sensitive methods for analysis that comply with the rules located in 40 CFR §§ 136.1(c) and 122.44(i)(1)(iv).
- (*2) When discharge occurs. Sampling is required within the first 30 minutes of discharge. If it is not practicable to take the sample, or to complete the sampling, within the first 30 minutes, sampling must be completed within the first hour of discharge. If sampling is not completed within the first 30 minutes of discharge, the reason must be documented and attached to all required reports and records of the sampling activity.
- (*3) Sampling must be conducted at least once during each of the following periods. The first sample must be collected during the first full quarter that a stormwater discharge occurs from a concrete batch plant authorized under this general permit.
 - January through March
 - April through June
 - July through September
 - October through December

For projects lasting less than one full quarter, a minimum of one sample shall be collected, provided that a stormwater discharge occurred at least once following submission of the NOI or following the date that automatic authorization was obtained under Part II.E.2., and prior to terminating coverage.

(*4) A grab sample shall be collected from the stormwater discharge resulting from a storm event that is at least 0.1 inches of measured precipitation that occurs at least 72 hours from the previously measurable storm event. The sample shall be collected downstream of the concrete batch plant, and where the discharge exits any BMPs utilized to handle the runoff from the batch plant, prior to commingling with any other water authorized under this general permit. 2. The permittee must compare the results of sample analyses to the benchmark values above, and must include this comparison in the overall assessment of the SWP3's effectiveness. Analytical results that exceed a benchmark value are not a violation of this permit, as these values are not numeric effluent limitations. Results of analyses are indicators that modifications of the SWP3 should be assessed and may be necessary to protect water quality. The operator must investigate the cause for each exceedance and must document the results of this investigation in the SWP3 by the end of the quarter following the sampling event.

The operator's investigation must identify the following:

- (a) any additional potential sources of pollution, such as spills that might have occurred;
- (b) necessary revisions to good housekeeping measures that are part of the SWP3;
- (c) additional BMPs, including a schedule to install or implement the BMPs; and
- (d) other parts of the SWP3 that may require revisions in order to meet the goal of the benchmark values.

Background concentrations of specific pollutants may also be considered during the investigation. If the operator is able to relate the cause of the exceedance to background concentrations, then subsequent exceedances of benchmark values for that pollutant may be resolved by referencing earlier findings in the SWP3. Background concentrations may be identified by laboratory analyses of samples of stormwater run-on to the permitted facility, by laboratory analyses of samples of stormwater run-off from adjacent non-industrial areas, or by identifying the pollutant is a naturally occurring material in soils at the site.

Section B. Best Management Practices (BMPs) and SWP3 Requirements

Minimum SWP3 Requirements – The following are required in addition to other SWP3 requirements listed in this general permit, which include, but are not limited to the applicable requirements located in Part III.F.8. of this general permit, as follows:

1. Description of Potential Pollutant Sources – The SWP3 must provide a description of potential sources (activities and materials) that can cause, have a reasonable potential to cause or contribute to a violation of water quality standards or have been found to cause, or contribute to, the loss of a designated use of surface water in the state in stormwater discharges associated with concrete batch plants authorized under this permit. The SWP3 must describe the implementation of practices that will be used to minimize to the extent practicable the discharge of pollutants in stormwater discharges associated with industrial activity and non-stormwater discharges (described in Part II.A.3. of this general permit), in compliance with the terms and conditions of this general permit, including the protection of water quality, and must ensure the implementation of these practices.

The following must be developed, at a minimum, in support of developing this description:

- (a) Drainage The site map must include the following information:
 - i. the location of all outfalls for stormwater discharges associated with concrete batch plants that are authorized under this permit;
 - ii. a depiction of the drainage area and the direction of flow to the outfall(s);
 - iii. structural controls used within the drainage area(s);

- iv. the locations of the following areas associated with concrete batch plants that are exposed to precipitation: vehicle and equipment maintenance activities (including fueling, repair, and storage areas for vehicles and equipment scheduled for maintenance); areas used for the treatment, storage, or disposal of wastes; liquid storage tanks; material processing and storage areas; and loading and unloading areas; and
- v. the locations of the following: any bag house or other dust control device(s); recycle/sedimentation pond, clarifier or other device used for the treatment of facility wastewater (including the areas that drain to the treatment device); areas with significant materials; and areas where major spills or leaks have occurred.
- (b) Inventory of Exposed Materials A list of materials handled at the concrete batch plant that may be exposed to stormwater and precipitation and that have a potential to affect the quality of stormwater discharges associated with concrete batch plants that are authorized under this general permit.
- (c) Spills and Leaks A list of significant spills and leaks of toxic or hazardous pollutants that occurred in areas exposed to stormwater and precipitation and that drain to stormwater outfalls associated with concrete batch plants authorized under this general permit must be developed, maintained, and updated as needed.
- (d) Sampling Data A summary of existing stormwater discharge sampling data must be maintained, if available.
- 2. Measures and Controls The SWP3 must include a description of management controls to regulate pollutants identified in the SWP3's "Description of Potential Pollutant Sources" from Part V.B.1. of this permit, and a schedule for implementation of the measures and controls. This must include, at a minimum:
 - (a) Good Housekeeping Good housekeeping measures must be developed and implemented in the area(s) associated with concrete batch plants.
 - i. Operators must prevent or minimize the discharge of spilled cement, aggregate (including sand or gravel), settled dust, or other significant materials from paved portions of the site that are exposed to stormwater. Measures used to minimize the presence of these materials may include regular sweeping or other equivalent practices. These practices must be conducted at a frequency that is determined based on consideration of the amount of industrial activity occurring in the area and frequency of precipitation, and shall occur at least once per week when cement or aggregate is being handled or otherwise processed in the area.
 - ii. Operators must prevent the exposure of fine granular solids, such as cement, to stormwater. Where practicable, these materials must be stored in enclosed silos, hoppers or buildings, in covered areas, or under covering.
 - (b) Spill Prevention and Response Procedures Areas where potential spills that can contribute pollutants to stormwater runoff and precipitation, and the drainage areas from these locations, must be identified in the SWP3. Where appropriate, the SWP3 must specify material handling procedures, storage requirements, and use of equipment. Procedures for cleaning up spills must be identified in the SWP3 and made available to the appropriate personnel.
 - (c) Inspections Qualified facility personnel (i.e., a person or persons with knowledge of this general permit, the concrete batch plant, and the SWP3 related to the concrete batch plant(s) for the site) must be identified to inspect designated equipment and areas of the facility specified in the SWP3. Personnel conducting these inspections are not required to have signatory authority for inspection reports under 30 TAC § 305.128. Inspections of facilities in operation must be performed

once every seven (7) days. Inspections of facilities that are not in operation must be performed at a minimum of once per month. The current inspection frequency being implemented at the facility must be recorded in the SWP3. The inspection must take place while the facility is in operation and must, at a minimum, include all areas that are exposed to stormwater at the site, including material handling areas, above ground storage tanks, hoppers or silos, dust collection/containment systems, truck wash down and equipment cleaning areas. Follow-up procedures must be used to ensure that appropriate actions are taken in response to the inspections. Records of inspections must be maintained and be made readily available for inspection upon request.

- (d) Employee Training An employee training program must be developed to educate personnel responsible for implementing any component of the SWP3, or personnel otherwise responsible for stormwater pollution prevention, with the provisions of the SWP3. The frequency of training must be documented in the SWP3, and at a minimum, must consist of one (1) training prior to the initiation of operation of the concrete batch plant.
- (e) Record Keeping and Internal Reporting Procedures A description of spills and similar incidents, plus additional information that is obtained regarding the quality and quantity of stormwater discharges, must be included in the SWP3. Inspection and maintenance activities must be documented and records of those inspection and maintenance activities must be incorporated in the SWP3.
- (f) Management of Runoff The SWP3 shall contain a narrative consideration for reducing the volume of runoff from concrete batch plants by diverting runoff or otherwise managing runoff, including use of infiltration, detention ponds, retention ponds, or reusing of runoff.
- 3. Comprehensive Compliance Evaluation At least once per year, one or more qualified personnel (i.e., a person or persons with knowledge of this general permit, the concrete batch plant, and the SWP3 related to the concrete batch plant(s) for the site) shall conduct a compliance evaluation of the plant. The evaluation must include the following:
 - (a) visual examination of all areas draining stormwater associated with regulated concrete batch plants for evidence of, or the potential for, pollutants entering the drainage system. These include, but are not limited to: cleaning areas, material handling areas, above ground storage tanks, hoppers or silos, dust collection/containment systems, and truck wash down and equipment cleaning areas. Measures implemented to reduce pollutants in runoff (including structural controls and implementation of management practices) must be evaluated to determine if they are effective and if they are implemented in accordance with the terms of this permit and with the permittee's SWP3. The operator shall conduct a visual inspection of equipment needed to implement the SWP3, such as spill response equipment.
 - (b) based on the results of the evaluation, the following must be revised as appropriate within two (2) weeks of the evaluation: the description of potential pollutant sources identified in the SWP3 (as required in Part V.B.1., "Description of Potential Pollutant Sources"); and pollution prevention measures and controls identified in the SWP3 (as required in Part V.B.2., "Measures and Controls"). The revisions may include a schedule for implementing the necessary changes.
 - (c) the permittee shall prepare and include in the SWP3 a report summarizing the scope of the evaluation, the personnel making the evaluation, the date(s) of the evaluation, major observations relating to the implementation of the SWP3, and actions taken in response to the findings of the evaluation. The report must identify any incidents of noncompliance. Where the report does not identify incidences of noncompliance, the report must contain a statement that the evaluation did not identify any

incidence(s), and the report must be signed according to 30 TAC § 305.128 (relating to Signatories to Reports).

(d) the Comprehensive Compliance Evaluation may substitute for one of the required inspections delineated in Part V.B.2.(c) of this general permit.

Section C. Prohibition of Wastewater Discharges

Wastewater discharges associated with concrete production including wastewater disposal by land application are not authorized under this general permit. These wastewater discharges must be authorized under an alternative TCEQ water quality permit or otherwise disposed of in an authorized manner. Discharges of concrete truck wash out at construction sites may be authorized if conducted in accordance with the requirements of Part VI of this general permit.

Part VI. Concrete Truck Wash Out Requirements

This general permit authorizes the land disposal of wash out from concrete trucks at construction sites regulated under this general permit, provided the following requirements are met. Any discharge of concrete production wastewater to surface water in the state must be authorized under a separate TCEQ general permit or individual permit.

- **A.** Discharge of concrete truck wash out water to surface water in the state, including discharge to storm sewers, is prohibited by this general permit.
- **B.** Concrete truck wash out water shall be disposed in areas at the construction site where structural controls have been established to prevent discharge to surface water in the state, or to areas that have a minimal slope that allow infiltration and filtering of wash out water to prevent discharge to surface water in the state. Structural controls may consist of temporary berms, temporary shallow pits, temporary storage tanks with slow rate release, or other reasonable measures to prevent runoff from the construction site.
- **C.** Wash out of concrete trucks during rainfall events shall be minimized. The discharge of concrete truck wash out water is prohibited at all times, and the operator shall insure that its BMPs are sufficient to prevent the discharge of concrete truck wash out as the result of rainfall or stormwater runoff.
- **D.** The disposal of wash out water from concrete trucks, made under authorization of this general permit must not cause or contribute to groundwater contamination.
- **E.** If a SWP3 is required to be implemented, the SWP3 shall include concrete wash out areas on the associated site map.

Part VII. Retention of Records

The permittee must retain the following records for a minimum period of three (3) years from the date that a NOT is submitted as required in Part II.F.1. and 2. of this permit. For activities in which an NOT is not required, records shall be retained for a minimum period of three (3) years from the date that the operator terminates coverage under Section II.F.3. of this permit. Records include:

- **A.** a copy of the SWP3;
- **B.** all reports and actions required by this permit, including a copy of the TCEQ construction site notice;
- **C.** all data used to complete the NOI, if an NOI is required for coverage under this general permit; and
- **D.** all records of submittal of forms submitted to the operator of any MS4 receiving the discharge and to the secondary operator of a large construction site, if applicable.

Part VIII. Standard Permit Conditions

- **A.** The permittee has a duty to comply with all permit conditions. Failure to comply with any permit condition is a violation of the permit and statutes under which it was issued (CWA and TWC), and is grounds for enforcement action, for terminating, revoking and reissuance, or modification, or denying coverage under this general permit, or for requiring a discharger to apply for and obtain an individual TPDES permit, based on rules located in TWC § 23.086, 30 TAC § 305.66, and 40 CFR § 122.41 (a).
- **B.** Authorization under this general permit may be modified, suspended, revoked and reissued, terminated or otherwise suspended for cause, based on rules located in TWC § 23.086, 30 TAC § 305.66, and 40 CFR § 122.41(f). Filing a notice of planned changes or anticipated non-compliance by the permittee does not stay any permit condition. The permittee must furnish to the executive director, upon request and within a reasonable time, any information necessary for the executive director to determine whether cause exists for modifying, revoking and reissuing, terminating or, otherwise suspending authorization under this permit, based on rules located in TWC § 23.086, 30 TAC § 305.66, and 40 CFR § 122.41 (h). Additionally, the permittee must provide to the executive director, upon request, copies of all records that the permittee is required to maintain as a condition of this general permit.
- **C.** It is not a defense for a discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity to maintain compliance with the permit conditions.
- **D.** Inspection and entry shall be allowed under TWC Chapters 26-28, Texas Health and Safety Code §§ 361.032-361.033 and 361.037, and 40 CFR § 122.41(i). The statement in TWC § 26.014 that commission entry of a facility shall occur according to an establishment's rules and regulations concerning safety, internal security, and fire protection is not grounds for denial or restriction of entry to any part of the facility or site, but merely describes the commission's duty to observe appropriate rules and regulations during an inspection.
- **E.** The discharger is subject to administrative, civil, and criminal penalties, as applicable, under TWC Chapter 7 for violations including but not limited to the following:
 - 1. negligently or knowingly violating the federal CWA §§ 301, 302, 306, 307, 308, 318, or 405, or any condition or limitation implementing any sections in a permit issued under CWA § 402, or any requirement imposed in a pretreatment program approved under CWA §§ 402(a)(3) or 402(b)(8);
 - 2. knowingly making any false statement, representation, or certification in any record or other document submitted or required to be maintained under a permit, including monitoring reports or reports of compliance or noncompliance; and
 - 3. knowingly violating CWA §303 and placing another person in imminent danger of death or serious bodily injury.
- **F.** All reports and other information requested by the executive director must be signed by the person and in the manner required by 30 TAC § 305.128 (relating to Signatories to Reports).
- **G.** Authorization under this general permit does not convey property or water rights of any sort and does not grant any exclusive privilege.
- **H.** The permittee shall take all reasonable steps to minimize or prevent any discharge in violation of this permit that has a reasonable likelihood of adversely affecting human health or the environment.

- **I.** The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) that are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems that are installed by a permittee only when the operation is necessary to achieve compliance with the conditions of the permit.
- **J.** The permittee shall comply with the monitoring and reporting requirements in 40 CFR § 122.41(j) and (l), as applicable.
- **K.** Analysis must be performed using sufficiently sensitive methods for analysis that comply with the rules located in 40 CFR §§ 136.1(c) and 122.44(i)(1)(iv).

Part IX. Fees

A. A fee of must be submitted along with the NOI:

- 1. \$225 if submitting an NOI electronically, or
- 2. \$325 if submitting a paper NOI.
- **B.** Fees are due upon submission of the NOI. An NOI will not be declared administratively complete unless the associated fee has been paid in full.
- **C.** No separate annual fees will be assessed for this general permit. The Water Quality Annual Fee has been incorporated into the NOI fees as described above.

Appendix A: Automatic Authorization

Periods of Low Erosion Potential by County - Eligible Date Ranges

Andrews: Nov. 15 - Apr. 30 Archer: Dec. 15 - Feb. 14 Armstrong: Nov. 15 - Apr. 30 Bailey: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Baylor: Dec. 15 - Feb. 14 Borden: Nov. 15 - Apr. 30 Brewster: Nov. 15 - Apr. 30 Briscoe: Nov. 15 - Apr. 30 Brown: Dec. 15 - Feb. 14 Callahan: Dec. 15 - Feb. 14 Carson: Nov. 15 - Apr. 30 Castro: Nov. 15 - Apr. 30 Childress: Dec. 15 - Feb. 14 Cochran: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Coke: Dec. 15 - Feb. 14 Coleman: Dec. 15 - Feb. 14 Collingsworth: Jan. 1 - Mar. 30, or Dec. 1 - Feb. 28 Concho: Dec. 15 - Feb. 14 Cottle: Dec. 15 - Feb. 14 Crane: Nov. 15 - Apr. 30 Crockett: Nov. 15 - Jan. 14, or Feb. 1 - Mar. 30 Crosby: Nov. 15 - Apr. 30 Culberson: Nov. 1 - May 14 Dallam: Nov. 1 - Apr. 14, or Nov. 15 - Apr. 30 Dawson: Nov. 15 - Apr. 30 Deaf Smith: Nov. 15 - Apr. 30 Dickens: Nov. 15 - Jan. 14, or Feb. 1 - Mar. 30 Dimmit: Dec. 15 - Feb. 14 Donley: Jan. 1 - Mar. 30, or Dec. 1 - Feb. 28 Eastland: Dec. 15 - Feb. 14 Ector: Nov. 15 - Apr. 30 Edwards: Dec. 15 - Feb. 14 El Paso: Jan. 1 - Jul. 14, or May 15 - Jul. 31, or Jun. 1 - Aug. 14, or Jun. 15 - Sept. 14, or Jul. 1 - Oct. 14, or Jul. 15 - Oct. 31, or Aug. 1 - Apr. 30, or Aug. 15 - May 14, or Sept. 1 - May 30, or Oct. 1 - Jun. 14, or Nov. 1 -Jun. 30, or Nov. 15 - Jul. 14 Fisher: Dec. 15 - Feb. 14 Floyd: Nov. 15 - Apr. 30

Foard: Dec. 15 - Feb. 14 Gaines: Nov. 15 - Apr. 30 Garza: Nov. 15 - Apr. 30 Glasscock: Nov. 15 - Apr. 30 Hale: Nov. 15 - Apr. 30 Hall: Feb. 1 - Mar. 30 Hansford: Nov. 15 - Apr. 30 Hardeman: Dec. 15 - Feb. 14 Hartley: Nov. 15 - Apr. 30 Haskell: Dec. 15 - Feb. 14 Hockley: Nov. 1 - Apr. 14, or Nov. 15 - Apr. 30 Howard: Nov. 15 - Apr. 30 Hudspeth: Nov. 1 - May 14 Hutchinson: Nov. 15 - Apr. 30 Irion: Dec. 15 - Feb. 14 Jeff Davis: Nov. 1 - Apr. 30 or Nov. 15 - May 14 Jones: Dec. 15 - Feb. 14 Kent: Nov. 15 - Jan. 14 or Feb. 1 - Mar. 30 Kerr: Dec. 15 - Feb. 14 Kimble: Dec. 15 - Feb. 14 King: Dec. 15 - Feb. 14 Kinney: Dec. 15 - Feb. 14 Knox: Dec. 15 - Feb. 14 Lamb: Nov. 1 - Apr. 14, or Nov. 15 - Apr. 30 Loving: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Lubbock: Nov. 15 - Apr. 30 Lynn: Nov. 15 - Apr. 30 Martin: Nov. 15 - Apr. 30 Mason: Dec. 15 - Feb. 14 Maverick: Dec. 15 - Feb. 14 McCulloch: Dec. 15 - Feb. 14 Menard: Dec. 15 - Feb. 14 Midland: Nov. 15 - Apr. 30 Mitchell: Nov. 15 - Apr. 30 Moore: Nov. 15 - Apr. 30 Motley: Nov. 15 - Jan. 14, or Feb. 1 - Mar. 30 Nolan: Dec. 15 - Feb. 14 Oldham: Nov. 15 - Apr. 30

Parmer: Nov. 1 - Apr. 14, or Nov. 15 - Apr. 30 Pecos: Nov. 15 - Apr. 30 Potter: Nov. 15 - Apr. 30 Presidio: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Randall: Nov. 15 - Apr. 30 Reagan: Nov. 15 - Apr. 30 Real: Dec. 15 - Feb. 14 Reeves: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Runnels: Dec. 15 - Feb. 14 Schleicher: Dec. 15 - Feb. 14 Scurry: Nov. 15 - Apr. 30 Shackelford: Dec. 15 - Feb. 14 Sherman: Nov. 15 - Apr. 30 Stephens: Dec. 15 - Feb. 14 Sterling: Nov. 15 - Apr. 30 Stonewall: Dec. 15 - Feb. 14 Sutton: Dec. 15 - Feb. 14

Swisher: Nov. 15 - Apr. 30 Taylor: Dec. 15 - Feb. 14 Terrell: Nov. 15 - Apr. 30 Terry: Nov. 15 - Apr. 30 Throckmorton: Dec. 15 - Feb. 14 Tom Green: Dec. 15 - Feb. 14 Upton: Nov. 15 - Apr. 30 Uvalde: Dec. 15 - Feb. 14 Val Verde: Nov. 15 - Jan. 14, or Feb. 1 - Mar. 30 Ward: Nov. 1 - Apr. 14, or Nov. 15 - Apr. 30 Wichita: Dec. 15 - Feb. 14 Wilbarger: Dec. 15 - Feb. 14 Winkler: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Yoakum: Nov. 1 - Apr. 30, or Nov. 15 - May 14 Young: Dec. 15 - Feb. 14 Wheeler: Jan. 1 - Mar. 30, or Dec. 1 - Feb. 28 Zavala: Dec. 15 - Feb. 14

Appendix B: Storm Erosivity (EI) Zones in Texas

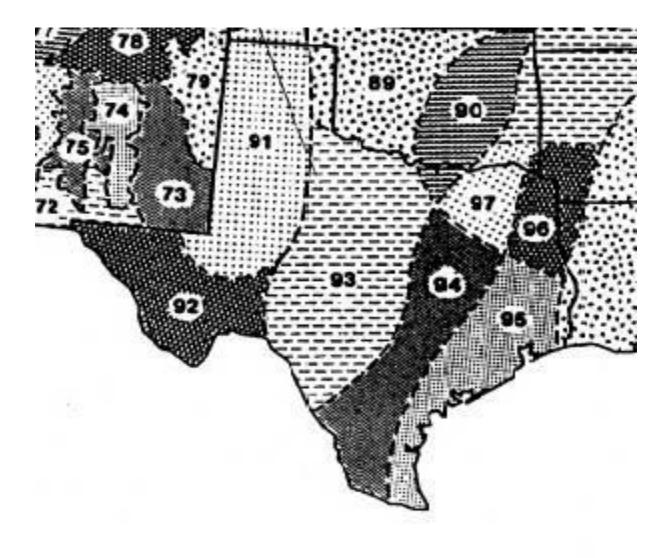


Figure B. EI Distribution Zones

Adapted from Chapter 2 of USDA Agriculture Handbook 703: "Predicting Soil Erosion by Water: A Guide to Conservation Planning With the Revised Universal Soil Loss Equation (RUSLE)," U.S. Department of Agriculture, Agricultural Research Service

Appendix C: Isoerodent Map

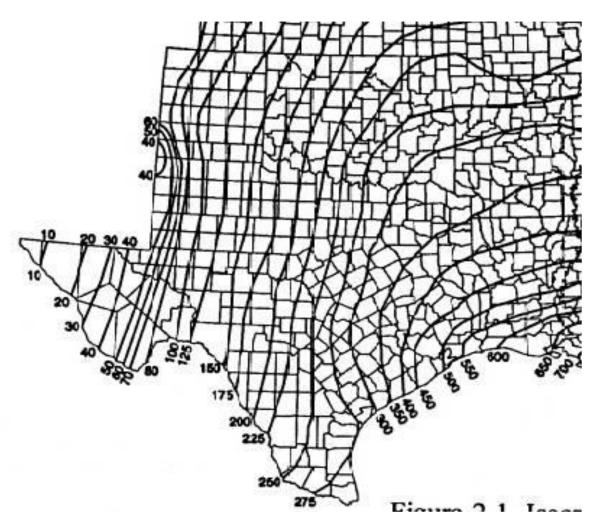


Figure C. Isoerodent Map of Texas. Units are hundreds ft*tonf*in(ac*h*yr)-1

Adapted from Chapter 2 of USDA Agriculture Handbook 703: "Predicting Soil Erosion by Water: A Guide to Conservation Planning With the Revised Universal Soil Loss Equation (RUSLE)," U.S. Department of Agriculture, Agricultural Research Service

Appendix D: Erosivity Indices for EI Zones in Texas

Table D. EI as percentage of average annual computed selected geographic areas (EI number) by date period (month/day).

Date Periods* (Month/Day)

EI #	1/1	1/16	1/31	2/15	3/1	3/16	3/31	4/15	4/30	5/15	5/30	6/14	6/29	7/14	7/29	8/13	8/28	9/12	9/27	10/12	10/27	11/11	11/26	12/11	12/31
89	0	1	1	2	3	4	7	2	8	27	38	48	55	62	69	76	83	90	94	97	98	99	100	100	100
90	0	1	2	3	4	6	8	13	21	29	37	46	54	60	65	69	74	81	87	92	95	97	98	99	100
91	0	0	0	0	1	1	1	2	6	16	29	39	46	53	60	67	74	81	88	95	99	99	100	100	100
92	0	0	0	0	1	1	1	2	6	16	29	39	46	53	60	67	74	81	88	95	99	99	100	100	100
93	0	1	1	2	3	4	6	8	13	25	40	49	56	62	67	72	76	80	85	91	97	98	99	99	100
94	0	1	2	4	6	8	10	15	21	29	38	47	53	57	61	65	70	76	83	88	91	94	96	98	100
95	0	1	3	5	7	9	11	14	18	27	35	41	46	51	57	62	68	73	79	84	89	93	96	98	100
96	0	2	4	6	9	12	17	23	30	37	43	49	54	58	62	66	70	74	78	82	86	90	94	97	100
97	0	1	3	5	7	10	14	20	28	37	48	56	61	64	68	72	77	81	86	89	92	95	98	99	100
106	0	3	6	9	13	17	21	27	33	38	44	49	55	61	67	71	75	78	81	84	86	90	94	97	100

*Each period begins on the date listed in the table above and lasts until the day before the following period. The final period begins on December 11 and ends on December 31.

Table adapted from Chapter 2 of USDA Agriculture Handbook 703: "Predicting Soil Erosion by Water: A Guide to Conservation Planning With the Revised Universal Soil Loss Equation (RUSLE)," U.S. Department of Agriculture, Agricultural Research Service.

APPENDIX G

SITE NOTICE, NOTICE OF INTENT, NOTICE OF CHANGE AND NOTICE OF TERMINATION FORMS

Operator Notes

Construction Site Notice

The construction site notice located in Appendix H should be posted along with a signed copy of the Notice of Intent. The site notice must be located where it is safely and readily available for viewing by the general public, local, state, and federal authorities prior to commencing construction.

Notice of Intent (NOI)

The TPDES General Permit TXR 150000 requires that a NOI be submitted before construction activities begin. The NOI is essentially an application and contains items such as important information about your site, including site location, owner information, operator (general contractor) information, receiving water(s), and a brief description of the project.

TCEQ has developed a form to be used by industrial facilities and construction activities when they submit NOIs. This form indicates all the information that you are required to provide and must be used in order for the NOI to be processed correctly.

Primary Operators

Please note that both Owners and Contractors can meet the definition of being a "primary operator."

Primary operators must submit a NOI at least seven days prior to commencing construction activities, or if utilizing electronic submittal, prior to commencing construction activities.

If an additional primary operator is added after the initial NOI is submitted, the new primary operator must:

- submit a paper NOI at least seven days before assuming operational control, or
- submit an electronic NOI prior to assuming operational control.

If the primary operator changes after the initial NOI is submitted, the new primary operator must:

- submit a paper NOI at least ten days before assuming operational control, or
- submit an electronic NOI at least ten days before assuming operational control

All primary operators must post a copy of the signed NOI at the construction site in allocation where it is readily available for viewing by the general public, local, state, and federal authorities prior to commencing construction activities. A copy of the signed NOI must be submitted to the operator of any MS4 receiving the discharge and to any secondary operator, at least seven days prior to commencing construction activities. A list of the MS4 operators receiving a copy of the NOI is located in Appendix H.

Secondary Operators

Secondary operators are not required to submit a NOI, provided that another operator(s) at the site has submitted a NOI, or is required to submit a NOI and the secondary operator has provided notification to the operator(s) of the need to obtain coverage under the permit. Please refer to the general permit for more information.

NOI Fees

Please note the fees associated with NOI submission:

- \$325 if submitting a paper NOI, or
- \$225 if submitting an electronic NOI.

No separate annual fees will be assessed. The Water Quality Annual fee has been incorporated into the NOI fees.

It is anticipated that there will be projects where more than one entity (e.g., the owner, developer, or general contractor) will need to submit an NOI so that the requirements for an operator are met. In this case, those persons will share the Storm Water Pollution Plan, and the submittal of the NOI and the TPDES Permit Number will need to be recorded in the NOI log located in Appendix F.

Please refer to the general permit and NOI form instructions for more information.

Notice of Change (NOC)

The operators are responsible for updating the SWP3 to implement and maintain sediment controls and submit a Notice of Change (NOC) if off-site material, waste, borrow, fill or equipment storage areas are being utilized and are not under a separate permit. An operator must submit a NOC letter in conformance with TPDES General Permit TXR150000 if they become aware of any incorrect information in an NOI or failed to submit any relevant facts.

Information that may be included on an NOC includes, but is not limited to, the following: the description of the construction project, an increase in the number of acres disturbed (for increases of one or more acres), or the operator name. A transfer of operational control from one operator to another, including a transfer of the ownership of a company, may not be included in an NOC. A transfer of ownership of a company includes changes to the structure of a company, such as changing from a partnership to a corporation or changing corporation types, so that the filing number (or charter number) that is on record with the Texas Secretary of State must be changed.

An NOC is not required for notifying TCEQ of a decrease in the number of acres disturbed. This information must be included in the storm water pollution prevention plan (SWP3) and retained on site.

A list of the MS4 operators receiving a copy of the NOC is located in Appendix H.

Notice of Termination (NOT)

Any operator that has submitted a NOI must apply to terminate authorization of the general permit. The NOT is a form which should be completed and submitted to the TCEQ within 30 days of the following:

• final stabilization has been achieved on all portions of the site that are the responsibility of the permittee,

- a transfer of operational control has occurred, or
- the operator has obtained alternative authorization under an individual TPDES permit or alternative TPDES general permit.

Information to be included on the NOT includes the location of the construction site; the name, address, and telephone number of the operator terminating coverage; the TPDES General Permit Number; an indication of why coverage under the permit should be terminated for the operator; and a signed certification statement.

Authorization under the general permit terminates at midnight on the day the NOT is postmarked for delivery to the TCEQ. If the NOT is submitted electronically, the permit terminates immediately following confirmation of receipt of the NOT by TCEQ.

Note that when there is a change in operators of a construction activity, then the new operator must submit an NOI.

NOT's should be submitted to MS4 Operator(s). A list of the MS4 operator(s) receiving a copy of the NOT is located in Appendix H.

Record of Submittals to MS4s

Form Type	MS4 Name	Address	Date Submitted



LARGE CONSTRUCTION SITE NOTICE

FOR THE

Texas Commission on Environmental Quality (TCEQ) Storm Water Program

TPDES GENERAL PERMIT TXR150000

"PRIMARY OPERATOR" NOTICE

This notice applies to construction sites operating under Part II.E.3. of the TPDES General Permit Number TXR150000 for discharges of storm water runoff from construction sites equal to or greater than five acres, including the larger common plan of development. The information on this notice is required in Part III.D.2. of the general permit. This notice shall be posted along with a copy of the signed Notice of Intent (NOI), as applicable. Additional information regarding the TCEQ storm water permit program may be found on the internet at:

http://www.tceq.state.tx.us/nav/permits/sw_permits.html

Site-Specific TPDES Authorization Number:	
Operator Name:	
Contact Name and Phone Number:	
Project Description: <i>Physical address or description of the site</i> 's <i>location, and estimated start date and projected end date, or date that disturbed soils will be stabilized.</i>	
Location of Storm Water Pollution Prevention Plan:	



LARGE CONSTRUCTION SITE NOTICE

FOR THE Texas Commission on Environmental Quality (TCEQ) Storm Water Program TPDES GENERAL PERMIT TXR150000 "SECONDARY OPERATOR" NOTICE

This notice applies to secondary operators of construction sites operating under Part II.E.3. of the TPDES General Permit Number TXR150000 for discharges of storm water runoff from construction sites equal to or greater than five acres, including the larger common plan of development. The information on this notice is required in Part III.D.2. of the general permit. Additional information regarding the TCEQ storm water permit program may be found on the internet at:

http://www.tceq.state.tx.us/nav/permits/sw_permits.html

Site-Specific TPDES Authorization Number:	TXR150000
Operator Name:	
Contact Name and Phone Number:	
Project Description: Physical address or description of the site's location, and estimated start date and projected end date, or date that disturbed soils will be stabilized.	
Location of Storm Water Pollution Prevention Plan (SWP3):	

For Large Construction Activities Authorized Under Part II.E.3. (Obtaining Authorization to Discharge) the following certification must be completed:

I _______ (Typed or Printed Name Person Completing This Certification) certify under penalty of law that I have read and understand the eligibility requirements for claiming an authorization under Part II.E.3. of TPDES General Permit TXR150000 and agree to comply with the terms of this permit. A storm water pollution prevention plan has been developed and will be implemented prior to construction, according to permit requirements. A copy of this signed notice is supplied to the operator of the MS4 if discharges enter an MS4. I am aware there are significant penalties for providing false information or for conducting unauthorized discharges, including the possibility of fine and imprisonment for knowing violations.

Signature and Title_____

Date _____

_____Date Notice Removed ____MS4 operator notified per Part II.F.3.

TCEQOffice Use Only Permit No: CN: RN:



Notice of Intent (NOI) for an Authorization for Stormwater Discharges Associated with Construction Activity under TPDES General Permit TXR150000

IMPORTANT INFORMATION

Please read and use the General Information and Instructions prior to filling out each question in the NOI form.

Use the NOI Checklist to ensure all required information is completed correctly. **Incomplete applications delay approval or result in automatic denial.**

Once processed your permit authorization can be viewed by entering the following link into your internet browser: http://www2.tceq.texas.gov/wq_dpa/index.cfm or you can contact TCEQ Stormwater Processing Center at 512-239-3700.

e PERMIT S

Effective September 1, 2018, this paper form must be submitted to TCEQ with a completed electronic reporting waiver form (TCEQ-20754).

To submit an NOI electronically, enter the following web address into your internet browser and follow the instructions: https://www3.tceq.texas.gov/steers/index.cfm

APPLICATION FEE AND PAYMENT

The application fee for submitting a paper NOI is \$325. The application fee for electronic submittal of a NOI through the TCEQ ePermits system (STEERS) is \$225.

Payment of the application fee can be submitted by mail or through the TCEQ ePay system. The payment and the NOI must be mailed to separate addresses. To access the TCEQ ePay system enter the following web address into your internet browser: http://www.tceq.texas.gov/epay.

Provide your payment information for verification of payment:

- If payment was mailed to TCEQ, provide the following:
 - Check/Money Order Number:
 - Name printed on Check:
- If payment was made via ePay, provide the following:
 - Voucher Number:
 - A copy of the payment voucher is attached to this paper NOI form.

RENEWAL (This portion of the NOI is not applicable after June 3, 2018)				
Is t	his NOI for a renewal of an existing authoriz	zation?	🗆 Yes 🛛] No
If Y	es, provide the authorization number here:	FXR15		xt.
NC	TE: If an authorization number is not provid	ed, a nev	w number will be as	signed.
SEG	CTION 1. OPERATOR (APPLICANT)			
a)	If the applicant is currently a customer with (CN) issued to this entity? CN	TCEQ, v	what is the Custome	er Number
	(Refer to Section 1.a) of the Instructions)			
b)	b) What is the Legal Name of the entity (applicant) applying for this permit? (The legal name must be spelled exactly as filed with the Texas Secretary of State, County, or in the legal document forming the entity.)			
c)	What is the contact information for the Ope	erator (R	lesponsible Authori	tv)?
,	Prefix (Mr. Ms. Miss):	i i		, ,
	First and Last Name:	Suffix:	Click here to enter t	ext
	Title: Credentials:		e to enter text.	
	Phone Number: Fax	Number	Click here to enter	text
	E-mail: Click here to entertext			
	Mailing Address:			
	City, State, and Zip Code:			
	Mailing Information if outside USA:			
	Territory: Click here to enter level			
	Country Code: Posta	al Code:	Click here to enter t	ext.
d)	Indicate the type of customer:			
	🗆 Individual	🗆 Fe	ederal Government	
	🗆 Limited Partnership		ounty Government	
	🗆 General Partnership	🗆 St	tate Government	
	🗖 Trust	🗆 Ci	ity Government	
	Sole Proprietorship (D.B.A.)		ther Government	
	□ Corporation		ther:	nter text.
	□ Estate			
e)	Is the applicant an independent operator?	□ Yes	□ No	

 $\label{eq:TCEQ-20022} \ensuremath{(3/6/2018)}\xspace$ Notice of Intent for Construction Stormwater Discharges under TXR150000

(If a governmental entity, a subsidiary, or part of a larger corporation, check No.)

- f) Number of Employees. Select the range applicable to your company.
 - □ 0-20

□ 251-500

□ 21-100

□ 501 or higher

- □ 101-250
- g) Customer Business Tax and Filing Numbers: (**Required** for Corporations and Limited Partnerships. **Not Required** for Individuals, Government, or Sole Proprietors.)

State Franchise Tax ID Number:

Federal Tax ID:

Texas Secretary of State Charter (filing) Number:

DUNS Number (if known):

SECTION 2. APPLICATION CONTACT

Is the application contact the same as the applicant identified above?

□ Yes, go to Section 3

□ No, complete this section

Prefix (Mr. Ms. Miss):	re to enter text.		
First and Last Name:	re to enter text Suffix: Click here to enter text		
Title: Click here to enter text	Credential:		
Organization Name:	re to entertext.		
Phone Number:	Fax Number.		
E-mail:			
Mailing Address:) enter text.		
Internal Routing (Mail Code, Etc.):			
City, State, and Zip Code:			
Mailing information if outside USA:			
Territory:			
Country Code:	Postal Code:		

SECTION 3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

a) If this is an existing permitted site, what is the Regulated Entity Number (RN) issued to this site? RN

(Refer to Section 3.a) of the Instructions)

- b) Name of project or site (the name known by the community where it's located):
- c) In your own words, briefly describe the type of construction occurring at the regulated site (residential, industrial, commercial, or other):
- d) County or Counties (if located in more than one):
- e) Latitude: Longitude:
- f) Site Address/Location

If the site has a physical address such as 12100 Park 35 Circle, Austin, TX 78753, complete *Section A*.

If the site does not have a physical address, provide a location description in *Section B*. Example: located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1.

Section A:

Street Number and Name:

City, State, and Zip Code:

Section B:

Location Description:

City (or city nearest to) where the site is located:

Zip Code where the site is located:

SECTION 4. GENERAL CHARACTERISTICS

- a) Is the project or site located on Indian Country Lands?
 - Yes, do not submit this form. You must obtain authorization through EPA Region 6.

□ No

- b) Is your construction activity associated with a facility that, when completed, would be associated with the exploration, development, or production of oil or gas or geothermal resources?
 - Yes. Note: The construction stormwater runoff may be under jurisdiction of the Railroad Commission of Texas and may need to obtain authorization through EPA Region 6.

□ No

- c) What is the Primary Standard Industrial Classification (SIC) Code that best describes the construction activity being conducted at the site?
- d) What is the Secondary SIC Code(s), if applicable?
- e) What is the total number of acres to be disturbed?
- f) Is the project part of a larger common plan of development or sale?

TCEQ-20022(3/6/2018)

🗆 Yes

□ No. The total number of acres disturbed, provided in e) above, must be 5 or more. If the total number of acres disturbed is less than 5, do not submit this form. See the requirements in the general permit for small construction sites.

g) What is the estimated start date of the project?

- h) What is the estimated end date of the project?
- i) Will concrete truck washout be performed at the site?
- j) What is the name of the first water body(ies) to receive the stormwater runoff or potential runoff from the site?
- k) What is the segment number(s) of the classified water body(ies) that the discharge will eventually reach?
- 1) Is the discharge into a Municipal Separate Storm Sewer System (MS4)?

□ Yes □ No

If Yes, provide the name of the MS4 operator:

Note: The general permit requires you to send a copy of this NOI form to the MS4 operator.

m) Is the discharge or potential discharge from the site within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer, as defined in 30 TAC Chapter 213?

□ Yes, complete the certification below.

□ No, go to Section 5

I certify that the copy of the TCEQ-approved Plan required by the Edward's Aquifer Rule (30 TAC Chapter 213) that is included or referenced in the Stormwater Pollution Prevention Plan will be implemented.

SECTION 5. NOI CERTIFICATION

- a) I certify that I have obtained a copy and understand the terms and conditions of the Construction General Permit (TXR150000).
- b) I certify that the full legal name of the entity applying for this permit has been provided and is legally authorized to do business in Texas.
- c) I understand that a Notice of Termination (NOT) must be submitted when this authorization is no longer needed.
- d) I certify that a Stormwater Pollution Prevention Plan has been developed, will be implemented prior to construction and to the best of my knowledge and belief is compliant with any applicable local sediment and erosion control plans, as required in the Construction General Permit (TXR150000).

Note: For multiple operators who prepare a shared SWP3, the confirmation of an operator may be limited to its obligations under the SWP3, provided all obligations are confirmed by at least one operator.

□ Yes

SECTION 6. APPLICANT CERTIFICATION SIGNATURE

Operator Signatory Name:

Operator Signatory Title:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code §305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature (use blue ink): Date:

NOTICE OF INTENT CHECKLIST (TXR150000)

Did you complete everything? Use this checklist to be sure!

Are you ready to mail your form to TCEQ? Go to the General Information Section of the Instructions for mailing addresses.

Confirm each item (or applicable item) in this form is complete. This checklist is for use by the applicant to ensure a complete application is being submitted. **Missing information may result in denial of coverage under the general permit.** (See NOI process description in the General Information and Instructions.)

APPLICATION FEE

If paying by check:

Check was mailed **separately** to the TCEQs Cashier's Office. (See Instructions for Cashier's address and Application address.)

Check number and name on check is provided in this application.

If using ePay:

□ The voucher number is provided in this application and a copy of the voucher is attached.

RENEWAL

□ If this application is for renewal of an existing authorization, the authorization number is provided.

OPERATOR INFORMATION

Customer Number (CN) issued by TCEQ Central Registry

- Legal name as filed to do business in Texas. (Call TX SOS 512-463-5555 to verify.)
- □ Name and title of responsible authority signing the application.
- □ Phone number and e-mail address
- □ Mailing address is complete & verifiable with USPS. <u>www.usps.com</u>
- □ Type of operator (entity type). Is applicant an independent operator?
- □ Number of employees.
- □ For corporations or limited partnerships Tax ID and SOS filing numbers.
- Application contact and address is complete & verifiable with USPS. <u>http://www.usps.com</u>

REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

- Regulated Entity Number (RN) (if site is already regulated by TCEQ)
- □ Site/project name and construction activity description

□ County

□ Latitude and longitude <u>http://www.tceq.texas.gov/gis/sqmaview.html</u>

□ Site Address/Location. Do not use a rural route or post office box.

GENERAL CHARACTERISTICS

- □ Indian Country Lands the facility is not on Indian Country Lands.
- Construction activity related to facility associated to oil, gas, or geothermal resources
- □ Primary SIC Code that best describes the construction activity being conducted at the site. <u>www.osha.gov/oshstats/sicser.html</u>
- Estimated starting and ending dates of the project.
- □ Confirmation of concrete truck washout.
- □ Acres disturbed is provided and qualifies for coverage through a NOI.
- □ Common plan of development or sale.
- □ Receiving water body or water bodies.
- □ Segment number or numbers.
- \square MS4 operator.
- \Box Edwards Aquifer rule.

CERTIFICATION

- □ Certification statements have been checked indicating Yes.
- □ Signature meets 30 Texas Administrative Code (TAC) §305.44 and is original.

Instructions for Notice of Intent (NOI) for Stormwater Discharges Associated with Construction Activity under TPDES General Permit (TXR150000)

GENERAL INFORMATION

Where to Send the Notice of Intent (NOI):

By Regular Mail: TCEQ Stormwater Processing Center (MC228) P.O. Box 13087 Austin, Texas 78711-3087 By Overnight or Express Mail: TCEQ Stormwater Processing Center (MC228) 12100 Park 35 Circle Austin, TX

Application Fee:

The application fee of \$325 is required to be paid at the time the NOI is submitted. Failure to submit payment at the time the application is filed will cause delays in acknowledgment or denial of coverage under the general permit. Payment of the fee may be made by check or money order, payable to TCEQ, or through EPAY (electronic payment through the web).

Mailed Payments:

Use the attached General Permit Payment Submittal Form. The application fee is submitted to a different address than the NOI. Read the General Permit Payment Submittal Form for further instructions, including the address to send the payment.

ePAY Electronic Payment: http://www.tceq.texas.gov/epay

When making the payment you must select Water Quality, and then select the fee category "General Permit Construction Storm Water Discharge NOI Application". You must include a copy of the payment voucher with your NOI. Your NOI will not be considered complete without the payment voucher.

TCEQ Contact List:

•	
Application – status and form questions:	512-239-3700, swpermit@tceq.texas.gov
Technical questions:	512-239-4671, swgp@tceq.texas.gov
Environmental Law Division:	512-239-0600
Records Management - obtain copies of forms:	512-239-0900
Reports from databases (as available):	512-239-DATA (3282)
Cashier's office:	512-239-0357 or 512-239-0187

Notice of Intent Process:

When your NOI is received by the program, the form will be processed as follows:

• Administrative Review: Each item on the form will be reviewed for a complete response. In addition, the operator's legal name must be verified with Texas Secretary of State as valid and active (if applicable). The address(es) on the form must be verified with the US Postal service as receiving regular mail delivery. Do not give an overnight/express mailing address.

- Notice of Deficiency: If an item is incomplete or not verifiable as indicated above, a notice of deficiency (NOD) will be mailed to the operator. The operator will have 30 days to respond to the NOD. The response will be reviewed for completeness.
- Acknowledgment of Coverage: An Acknowledgment Certificate will be mailed to the operator. This certificate acknowledges coverage under the general permit.

or

Denial of Coverage: If the operator fails to respond to the NOD or the response is inadequate, coverage under the general permit may be denied. If coverage is denied, the operator will be notified.

General Permit (Your Permit)

For NOIs submitted **electronically** through ePermits, provisional coverage under the general permit begins immediately following confirmation of receipt of the NOI form by the TCEQ.

For **paper** NOIs, provisional coverage under the general permit begins **7 days after a completed NOI is postmarked for delivery** to the TCEQ.

You should have a copy of your general permit when submitting your application. You may view and print your permit for which you are seeking coverage, on the TCEQ web site <u>http://www.tceq.texas.gov</u>. Search using keyword TXR150000.

Change in Operator

An authorization under the general permit is not transferable. If the operator of the regulated project or site changes, the present permittee must submit a Notice of Termination and the new operator must submit a Notice of Intent. The NOT and NOI must be submitted no later than 10 days prior to the change in Operator status.

TCEQ Central Registry Core Data Form

The Core Data Form has been incorporated into this form. Do not send a Core Data Form to TCEQ. After final acknowledgment of coverage under the general permit, the program will assign a Customer Number and Regulated Entity Number, if one has not already been assigned to this customer or site.

For existing customers and sites, you can find the Customer Number and Regulated Entity Number by entering the following web address into your internet browser. http://www15.tceq.texas.gov/crpub/ or you can contact the TCEQ Stormwater Processing Center at 512-239-3700 for assistance. On the website, you can search by your permit number, the Regulated Entity (RN) number, or the Customer Number (CN). If you do not know these numbers, you can select "Advanced Search" to search by permittee name, site address, etc.

The Customer (Permittee) is responsible for providing consistent information to the TCEQ, and for updating all CN and RN data for all authorizations as changes occur. For this permit, a Notice of Change form must be submitted to the program area.

INSTRUCTIONS FOR FILLING OUT THE NOI FORM

Renewal of General Permit. Dischargers holding active authorizations under the expired General Permit are required to submit a NOI to continue coverage. The existing permit number is required. If the permit number is not provided or has been terminated, expired, or denied, a new permit number will be issued.

Section 1. OPERATOR (APPLICANT)

a) Customer Number (CN)

TCEQ's Central Registry will assign each customer a number that begins with CN, followed by nine digits. This is not a permit number, registration number, or license number.

If the applicant is an existing TCEQ customer, the Customer Number is available at the following website: <u>http://www15.tceq.texas.gov/crpub/</u>. If the applicant is not an existing TCEQ customer, leave the space for CN blank.

b) Legal Name of Applicant

Provide the current legal name of the applicant. The name must be provided exactly as filed with the Texas Secretary of State (SOS), or on other legal documents forming the entity, as filed in the county. You may contact the SOS at 512-463-5555, for more information related to filing in Texas. If filed in the county, provide a copy of the legal documents showing the legal name.

c) Contact Information for the Applicant (Responsible Authority)

Provide information for the person signing the application in the Certification section. This person is also referred to as the Responsible Authority.

Provide a complete mailing address for receiving mail from the TCEQ. The mailing address must be recognized by the US Postal Service. You may verify the address on the following website: <u>https://tools.usps.com/go/ZipLookupAction!input.action</u>.

The phone number should provide contact to the applicant.

The fax number and e-mail address are optional and should correspond to the applicant.

d) Type of Customer (Entity Type)

Check only one box that identifies the type of entity. Use the descriptions below to identify the appropriate entity type. Note that the selected entity type also indicates the name that must be provided as an applicant for an authorization.

Individual

An individual is a customer who has not established a business, but conducts an activity that needs to be regulated by the TCEQ.

<u>Partnership</u>

A customer that is established as a partnership as defined by the Texas Secretary of State Office (TX SOS). If the customer is a 'General Partnership' or 'Joint Venture' filed in the county (not filed with TX SOS), the legal name of each partner forming the 'General Partnership' or 'Joint Venture' must be provided. Each 'legal entity' must apply as a co-applicant.

Trust or Estate

A trust and an estate are fiduciary relationships governing the trustee/executor with respect to the trust/estate property.

Sole Proprietorship (DBA)

A sole proprietorship is a customer that is owned by only one person and has not been incorporated. This business may:

- 1. be under the person's name
- 2. have its own name (doing business as or DBA)
- 3. have any number of employees.

If the customer is a Sole Proprietorship or DBA, the 'legal name' of the individual business 'owner' must be provided. The DBA name is not recognized as the 'legal name' of the entity. The DBA name may be used for the site name (regulated entity).

Corporation

A customer that meets all of these conditions:

- 1. is a legally incorporated entity under the laws of any state or country
- 2. is recognized as a corporation by the Texas Secretary of State
- 3. has proper operating authority to operate in Texas

The corporation's 'legal name' as filed with the Texas Secretary of State must be provided as applicant. An 'assumed' name of a corporation is not recognized as the 'legal name' of the entity.

Government

Federal, state, county, or city government (as appropriate)

The customer is either an agency of one of these levels of government or the governmental body itself. The government agency's 'legal name' must be provided as the applicant. A department name or other description of the organization is not recognized as the 'legal name'.

<u>Other</u>

This may include a utility district, water district, tribal government, college district, council of governments, or river authority. Provide the specific type of government.

e) Independent Entity

Check No if this customer is a subsidiary, part of a larger company, or is a governmental entity. Otherwise, check Yes.

f) Number of Employees

Check one box to show the number of employees for this customer's entire company, at all locations. This is not necessarily the number of employees at the site named in the application.

g) Customer Business Tax and Filing Numbers

These are required for Corporations and Limited Partnerships. These are not required for Individuals, Government, and Sole Proprietors.

State Franchise Tax ID Number

Corporations and limited liability companies that operate in Texas are issued a franchise tax identification number. If this customer is a corporation or limited liability company, enter the Tax ID number.

Federal Tax ID

All businesses, except for some small sole proprietors, individuals, or general partnerships should have a federal taxpayer identification number (TIN). Enter this number here. Use no prefixes, dashes, or hyphens. Sole proprietors, individuals, or general partnerships do not need to provide a federal tax ID.

TX SOS Charter (filing) Number

Corporations and Limited Partnerships required to register with the Texas Secretary of State are issued a charter or filing number. You may obtain further information by calling SOS at 512-463-5555.

DUNS Number

Most businesses have a DUNS (Data Universal Numbering System) number issued by Dun and Bradstreet Corp. If this customer has one, enter it here.

Section 2. APPLICATION CONTACT

Provide the name and contact information for the person that TCEQ can contact for additional information regarding this application.

Section 3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

a) Regulated Entity Number (RN)

The RN is issued by TCEQ's Central Registry to sites where an activity is regulated by TCEQ. This is not a permit number, registration number, or license number. Search TCEQ's Central Registry to see if the site has an assigned RN at http://www15.tceq.texas.gov/crpub/. If this regulated entity has not been assigned an RN, leave this space blank.

If the site of your business is part of a larger business site, an RN may already be assigned for the larger site. Use the RN assigned for the larger site.

If the site is found, provide the assigned RN and provide the information for the site to be authorized through this application. The site information for this authorization may vary from the larger site information.

An example is a chemical plant where a unit is owned or operated by a separate corporation that is accessible by the same physical address of your unit or facility. Other examples include industrial parks identified by one common address but different corporations have control of defined areas within the site. In both cases, an RN would be assigned for the physical address location and the permitted sites would be identified separately under the same RN.

b) Name of the Project or Site

Provide the name of the site or project as known by the public in the area where the site is located. The name you provide on this application will be used in the TCEQ Central Registry as the Regulated Entity name.

c) Description of Activity Regulated

In your own words, briefly describe the primary business that you are doing that requires this authorization. Do not repeat the SIC Code description.

d) County

Provide the name of the county where the site or project is located. If the site or project is located in more than one county, provide the county names as secondary.

e) Latitude and Longitude

Enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. For help obtaining the latitude and longitude, go to: <u>http://www.tceq.texas.gov/gis/sqmaview.html</u>.

f) Site Address/Location

If a site has an address that includes a street number and street name, enter the complete address for the site in *Section A*. If the physical address is not recognized as a USPS delivery address, you may need to validate the address with your local police (911 service) or through an online map site used to locate a site. Please confirm this to be a complete and valid address. Do not use a rural route or post office box for a site location.

If a site does not have an address that includes a street number and street name, provide a complete written location description in *Section B*. For example: "The site is located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1."

Provide the city (or nearest city) and zip code of the site location.

Section 4. GENERAL CHARACTERISTICS

a) Indian Country Lands

If your site is located on Indian Country Lands, the TCEQ does not have authority to process your application. You must obtain authorization through EPA Region 6, Dallas. Do not submit this form to TCEQ.

b) Construction activity associated with facility associated with exploration, development, or production of oil, gas, or geothermal resources

If your activity is associated with oil and gas exploration, development, or production, you may be under jurisdiction of the Railroad Commission of Texas (RRC) and may need to obtain authorization from EPA Region 6.

Construction activities associated with a facility related to oil, gas or geothermal resources may include the construction of a well site; treatment or storage facility; underground hydrocarbon or natural gas storage facility; reclamation plant; gas processing facility; compressor station; terminal facility where crude oil is stored prior to refining and at which refined products are stored solely for use at the facility; a

carbon dioxide geologic storage facility; and a gathering, transmission, or distribution pipeline that will transport crude oil or natural gas, including natural gas liquids, prior to refining of such oil or the use of the natural gas in any manufacturing process or as a residential or industrial fuel.

Where required by federal law, discharges of stormwater associated with construction activities under the RRC's jurisdiction must be authorized by the EPA and the RRC, as applicable. Activities under RRC jurisdiction include construction of a facility that, when completed, would be associated with the exploration, development, or production of oil or gas or geothermal resources, such as a well site; treatment or storage facility; underground hydrocarbon or natural gas storage facility; reclamation plant; gas processing facility; compressor station; terminal facility where crude oil is stored prior to refining and at which refined products are stored solely for use at the facility; a carbon dioxide geologic storage facility under the jurisdiction of the RRC; and a gathering, transmission, or distribution pipeline that will transport crude oil or natural gas, including natural gas liquids, prior to refining of such oil or the use of the natural gas in any manufacturing process or as a residential or industrial fuel. The RRC also has jurisdiction over stormwater from land disturbance associated with a site survey that is conducted prior to construction of a facility that would be regulated by the RRC. Under 33 U.S.C. §1342(l)(2) and §1362(24), EPA cannot require a permit for discharges of stormwater from field activities or operations associated with {oil and gas} exploration, production, processing, or treatment operations, or transmission facilities, including activities necessary to prepare a site for drilling and for the movement and placement of drilling equipment, whether or not such field activities or operations may be considered to be construction activities unless the discharge is contaminated by contact with any overburden, raw material, intermediate product, finished product, by product, or waste product located on the site of the facility. Under §3.8 of this title (relating to Water Protection), the RRC prohibits operators from causing or allowing pollution of surface or subsurface water. Operators are encouraged to implement and maintain best management practices (BMPs) to minimize discharges of pollutants, including sediment, in stormwater during construction activities to help ensure protection of surface water quality during storm events.

For more information about the jurisdictions of the RRC and the TCEQ, read the Memorandum of Understanding (MOU) between the RRC and TCEQ at 16 Texas Administrative Code, Part 1, Chapter 3, Rule 3.30, by entering the following link into an internet browser:

http://texreg.sos.state.tx.us/public/readtac\$ext.TacPage?sl=R&app=9&p_dir=&p_rloc=&p_tloc=&p_ploc=&pg=1&p_tac=&ti=16&pt=1&ch=3&rl=30 or contact the TCEQ Stormwater Team at 512-239-4671 for additional information.

c) Primary Standard Industrial Classification (SIC) Code

Provide the SIC Code that best describes the construction activity being conducted at this site.

Common SIC Codes related to construction activities include:

- 1521 Construction of Single Family Homes
- 1522 Construction of Residential Buildings Other than Single Family Homes
- 1541 Construction of Industrial Buildings and Warehouses

- 1542 Construction of Non-residential Buildings, other than Industrial Buildings and Warehouses
- 1611 Highway and Street Construction, except Highway Construction
- 1622 Bridge, Tunnel, and Elevated Highway Construction
- 1623 Water, Sewer, Pipeline and Communications, and Power Line Construction

For help with SIC Codes, enter the following link into your internet browser: <u>http://www.osha.gov/pls/imis/sicsearch.html</u> or you can contact the TCEQ Small Business and Local Government Assistance Section at 800-447-2827 for assistance.

d) Secondary SIC Code

Secondary SIC Code(s) may be provided. Leave this blank if not applicable. For help with SIC Codes, enter the following link into your internet browser: <u>http://www.osha.gov/pls/imis/sicsearch.html</u> or you can contact the TCEQ Small Business and Environmental Assistance Section at 800-447-2827 for assistance.

e) Total Number of Acres Disturbed

Provide the approximate number of acres that the construction site will disturb. Construction activities that disturb less than one acre, unless they are part of a larger common plan that disturbs more than one acre, do not require permit coverage. Construction activities that disturb between one and five acres, unless they are part of a common plan that disturbs more than five acres, do not require submission of an NOI. Therefore, the estimated area of land disturbed should not be less than five, unless the project is part of a larger common plan that disturbs five or more acres. Disturbed means any clearing, grading, excavating, or other similar activities.

If you have any questions about this item, please contact the stormwater technical staff by phone at 512-239-4671 or by email at swgp@tceq.texas.gov.

f) Common Plan of Development

Construction activities that disturb less than five acres do not require submission of an NOI unless they are part of a common plan of development or for sale where the area disturbed is five or more acres. Therefore, the estimated area of land disturbed should not be less than five, unless the project is part of a larger common plan that disturbs five or more acres. Disturbed means any clearing, grading, excavating, or other similar activities.

For more information on what a common plan of development is, refer to the definition of "Common Plan of Development" in the Definitions section of the general permit or enter the following link into your internet browser: www.tceq.texas.gov/permitting/stormwater/common_plan_of_development_steps.html

For further information, go to the TCEQ stormwater construction webpage enter the following link into your internet browser: <u>www.tceq.texas.gov/goto/construction</u> and search for "Additional Guidance and Quick Links". If you have any further questions about the Common Plan of Development you can contact the TCEQ Stormwater Team at 512-239-4671 or the TCEQ Small Business and Environmental Assistance at 800-447-2827.

g) Estimated Start Date of the Project

This is the date that any construction activity or construction support activity is initiated at the site. If renewing the permit provide the original start date of when construction activity for this project began.

h) Estimated End Date of the Project

This is the date that any construction activity or construction support activity will end and final stabilization will be achieved at the site.

i) Will concrete truck washout be performed at the site?

Indicate if you expect that operators of concrete trucks will washout concrete trucks at the construction site.

j) Identify the water body(s) receiving stormwater runoff

The stormwater may be discharged directly to a receiving stream or through a MS4 from your site. It eventually reaches a receiving water body such as a local stream or lake, possibly via a drainage ditch. You must provide the name of the water body that receives the discharge from the site (a local stream or lake).

If your site has more than one outfall you need to include the name of the first water body for each outfall, if they are different.

k) Identify the segment number(s) of the classified water body(s)

Identify the classified segment number(s) receiving a discharge directly or indirectly. Enter the following link into your internet browser to find the segment number of the classified water body where stormwater will flow from the site: <u>www.tceq.texas.gov/waterquality/monitoring/viewer.html</u> or by contacting the TCEQ Water Quality Division at (512) 239-4671 for assistance.

You may also find the segment number in TCEQ publication GI-316 by entering the following link into your internet browser: <u>www.tceq.texas.gov/publications/gi/gi-316</u> or by contacting the TCEQ Water Quality Division at (512) 239-4671 for assistance.

If the discharge is into an unclassified receiving water and then crosses state lines prior to entering a classified segment, select the appropriate watershed:

- 0100 (Canadian River Basin)
- 0200 (Red River Basin)
- 0300 (Sulfur River Basin)
- 0400 (Cypress Creek Basin)
- 0500 (Sabine River Basin)

Call the Water Quality Assessments section at 512-239-4671 for further assistance.

l) Discharge into MS4 - Identify the MS4 Operator

The discharge may initially be into a municipal separate storm sewer system (MS4). If the stormwater discharge is into an MS4, provide the name of the entity that operates the MS4 where the stormwater discharges. An MS4 operator is often a city, town, county, or utility district, but possibly can be another form of government. Please note that the Construction General Permit requires the Operator to supply the MS4 with a copy of the NOI submitted to TCEQ. For assistance, you may call the technical staff at 512-239-4671.

m) Discharges to the Edwards Aquifer Recharge Zone and Certification

The general permit requires the approved Contributing Zone Plan or Water Pollution Abatement Plan to be included or referenced as a part of the Stormwater Pollution Prevention Plan.

See maps on the TCEQ website to determine if the site is located within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer by entering the following link into an internet browser: <u>www.tceq.texas.gov/field/eapp/viewer.html</u> or by contacting the TCEQ Water Quality Division at 512-239-4671 for assistance.

If the discharge or potential discharge is within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer, a site-specific authorization approved by the Executive Director under the Edwards Aquifer Protection Program (30 TAC Chapter 213) is required before construction can begin.

For questions regarding the Edward's Aquifer Protection Program, contact the appropriate TCEQ Regional Office. For projects in Hays, Travis and Williamson Counties: Austin Regional Office, 12100 Park 35 Circle, Austin, TX 78753, 512-339-2929. For Projects in Bexar, Comal, Kinney, Medina and Uvalde Counties: TCEQ San Antonio Regional Office, 14250 Judson Rd., San Antonio, TX 78233-4480, 210-490-3096.

Section 5. NOI CERTIFICATION

Note: Failure to indicate Yes to all of the certification items may result in denial of coverage under the general permit.

a) Certification of Understanding the Terms and Conditions of Construction General Permit (TXR1 50000)

Provisional coverage under the Construction General Permit (TXR150000) begins 7 days after the completed paper NOI is postmarked for delivery to the TCEQ. Electronic applications submitted through ePermits have immediate provisional coverage. You must obtain a copy and read the Construction General Permit before submitting your application. You may view and print the Construction General Permit for which you are seeking coverage at the TCEQ web site by entering the following link into an internet browser: www.tceq.texas.gov/goto/construction or you may contact the TCEQ Stormwater processing Center at 512-239-3700 for assistance.

b) Certification of Legal Name

The full legal name of the applicant as authorized to do business in Texas is required. The name must be provided exactly as filed with the Texas Secretary of State (SOS), or on other legal documents forming the entity, that is filed in the county where doing business. You may contact the SOS at 512-463 5555, for more information related to filing in Texas.

c) Understanding of Notice of Termination

A permittee shall terminate coverage under the Construction General Permit through the submittal of a NOT when the operator of the facility changes, final stabilization has been reached, the discharge becomes authorized under an individual permit, or the construction activity never began at this site.

d) Certification of Stormwater Pollution Prevention Plan

The SWP3 identifies the areas and activities that could produce contaminated runoff at your site and then tells how you will ensure that this contamination is mitigated. For example, in describing your mitigation measures, your site's plan might identify the devices that collect and filter stormwater, tell how those devices are to be maintained, and tell how frequently that maintenance is to be carried out. You must develop this plan in accordance with the TCEQ general permit requirements. This plan must be developed and implemented before you complete this NOI. The SWP3 must be available for a TCEQ investigator to review on request.

Section 6. APPLICANT CERTIFICATION SIGNATURE

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code (TAC) §305.44.

If you are a corporation:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(1) (see below). According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

If you are a municipality or other government entity:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(3) (see below). According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statute(s) under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a)(3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer may be requested by the TCEQ.

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the TCEQ's Environmental Law Division at 512-239-0600.

30 Texas Administrative Code

§305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the

corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

Texas Commission on Environmental Quality General Permit Payment Submittal Form

Use this form to submit your Application Fee only if you are mailing your payment.

Instructions:

- Complete items 1 through 5 below:
- Staple your check in the space provided at the bottom of this document.
- Do not mail this form with your NOI form.
- Do not mail this form to the same address as your NOI.

Mail this form and your check to either of the following:

By Regular U.S. Mail	By Overnight or Express Mail
Texas Commission on Environmental Quality	Texas Commission on Environmental Quality
Financial Administration Division	Financial Administration Division
Cashier's Office, MC-214	Cashier's Office, MC-214
P.O. Box 13088	12100 Park 35 Circle
Austin, TX 78711-3088	Austin, TX 78753

Fee Code: GPA General Permit: TXR150000

- 1. Check or Money Order No:
- 2. Amount of Check/Money Order:
- 3. Date of Check or Money Order.
- 4. Name on Check or Money Order.
- 5. NOI Information:

If the check is for more than one NOI, list each Project or Site (RE) Name and Physical Address exactly as provided on the NOI. **Do not submit a copy of the NOI with this form, as it could cause duplicate permit application entries!**


If there is not enough space on the form to list all of the projects or sites the authorization will cover, then attach a list of the additional sites.

Project/Site (RE) Name:

Project/Site (RE) Physical Address:

Staple the check or money order to this form in this space.

TCEQ Office Use Only Permit No.: RN: CN: Region:

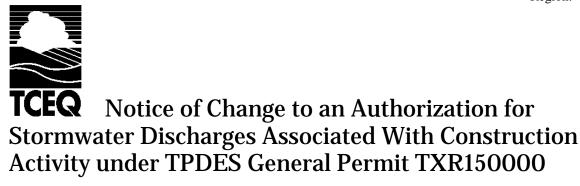

IMPORTANT – Please read the following information and <u>INSTRUCTIONS</u> before filling out this form.

ePERMITS: Sign up now for online NOC: <u>https://www3.tceq.texas.gov/steers/index.cfm</u>

This form will be returned for any of the following reasons:

- 1) The permit number is not provided, is invalid, or is no longer active,
- 2) Wet ink signature of person meeting signatory requirements is not provided,
- 3) The current permittee is not the applicant, and;
- 4) A requested change in operator name is not a legal name change.

This form cannot be used for a change in operator. Refer to your general permit for information.

What is the permit number of the authorization to be changed?

TXR15_____ or TXRCW_____

1) APPLICANT INFORMATION

- a) What is the full Legal Name of the current operator as on the authorization?
- **b)** What is the Customer Number (CN) assigned to this operator? You may search for your CN at: <u>http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch</u>

CN_____

c) What is the name and title of the person signing the application? (The person must be an executive official meeting signatory requirements in TAC 305.44(a).)

Prefix (Mr. Ms. Miss):	_
First/Last Name:	Suffix:
Title:	Credential:

d) What is the Regulated Entity Reference Number (RN) assigned to this site?

RN_____

2) APPLICATION CONTACT

If TCEQ needs additional information regarding this application, who should be contacted?

Prefix (Mr. Ms. Miss):		
First/Last Name:		Suffix:
Title:		
Organization Name:		
Phone Number:	Extension:	Fax Number:
E-mail Address:		
Mailing Address:		
Internal Routing (Mail Code, Etc.):		
City:	State:	ZIP Code:
Mailing Information if outside USA:		
Territory:	Country Code:	Postal Code:

3) REQUESTED CHANGE TO PERMITTED INFORMATION

What information has changed or needs to be corrected? Check one or more of the following options and enter the new information below.

Operator legal name change with Texas Secretary of State (TX SOS).

Fill out sections a) and b) as applicable.

Note: Permits are not transferable. If a change in entity has occurred, this NOC will not be processed.

Address and contact information for the operator. Fill out section b).

Site Information (Regulated Entity). Fill out section c).

Note: Permits under a general permit are site specific. If a change in site location has occurred, this NOC will not be processed.

General characteristics relating to the regulated activity. Fill out section d).

- a) Operator Legal Name Change
 - i. What is the NEW active Legal Name with TX SOS or on other legal document? New Legal Name: ______
 - What is the TX SOS Filing Number for us to confirm this official name change? This is only applicable to Limited Partnerships or Corporations. TX SOS Filing number:
- **b)** Address and Contact Information for Operator Verify mailing addresses with USPS: <u>http://zip4.usps.com/zip4/welcome.jsp</u>.

Prefix (Mr. Ms. Miss):	
First/Last Name:	Suffix:
Title:	Credential:
Organization Name:	

Ph	one Number:	Extension:	Fax Number:
E- :	mail Address:		
Ma	ailing Address:		
In	ternal Routing (Mail Code, Et	tc.):	
Cit	ty:	State:	ZIP Code:
Ma	ailing Information if outside I	USA:	
Te	rritory:	Country Code:	Postal Code:
c) Re	gulated Entity (Site) Informa	tion Correction	
i.	Is this a change to the locati Yes This NOC will not No Continue with NO	be processed since the aut	y? horizations are site specific.
ii.	Corrected Name of Project of	or Site:	
iii.	Updated Physical Address (Street Number:		
	City:	State:	ZIP Code:
iv.	Corrected location access de name):	escription, if no physical ad	ddress (street number/street
v.	Corrected Latitude:	N	
vi.	Corrected Longitude:	W	
vii.	Corrected County (Counties	if >1):	
Ide	ange in General Characterist entify the specific change and eded, please reference it belo	l provide the updates infor	orm mation. If an attachment is

4) OPERATOR CERTIFICATION

I, _

Typed or printed name

Title

certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code 305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature:

Date:

(Use blue ink)

Notice of Change (NOC) for Authorizations for Stormwater Discharges Associated with Construction Activity under TPDES General Permit (TXR150000)

General Information and Instructions

GENERAL INFORMATION

Where to Send the NOC:	
BY REGULAR U.S. MAIL	BY OVERNIGHT/EXPRESS MAIL
Texas Commission on Environmental Quality	Texas Commission on Environmental Quality
Stormwater Processing Center (MC228)	Stormwater Processing Center (MC228)
P.O. Box 13087	12100 Park 35 Circle
Austin, Texas 78711-3087	Austin, TX 78753
TCEO Contact list	

Application – status and form questions: Technical questions: Environmental Law Division: Records Management - obtain copies of forms: Reports from databases (as available): Cashier's office:

512/239-3700, swpermit@tceq.texas.gov 512/239-4671, swgp@tceq.texas.gov 512/239-0600 512/239-0900 512/239-DATA (3282) 512/239-0357 or 512/239-0187

NOC Process:

1. Administrative Review: The form will be reviewed to ensure the request is from the permittee (operator) on the authorization, the permit is active and initial coverage was acknowledged. Each item on the form will be reviewed for a complete response. In addition, the operator's legal name change must be verified with Texas Secretary of State (if applicable). The address(s) on the form must be verified with the US Postal Service (USPS) as an address receiving regular mail delivery. Never give an overnight/express mailing address. If an item is incomplete or not verifiable, the operator may be notified by letter, phone call or email. In some instances as noted at the beginning of the form, the request may simply be returned.

2. NOC Confirmation: An updated Acknowledgment Certificate will be mailed to the operator <u>only</u> if the NOC is to change information provided on the acknowledgment certificate. The original coverage effective date will not change.

General Permit (Your Permit) and Forms

You may view and print your general permit on the TCEQ web site <u>http://www.tceq.texas.gov</u>. Search using key word TXR150000. General Permit Forms (NOI, Waiver, NOT, and NOC) and instructions are available on the TCEQ web site <u>http://www.tceq.texas.gov</u>.

Change in Operator

An authorization under the general permit is not transferable. If the operator of the regulated entity changes, the present permittee must submit a NOT and the new operator must submit a NOI. The NOI must be submitted not later than 10 days prior to the change in Operator status. Note that the NOT is effective on the postmarked date. It may be necessary to not terminate the existing permit until coverage by the new entity is confirmed.

TCEQ Central Registry Core Data Form

The Core Data Form has been incorporated into this form. Do not send a Core Data Form to TCEQ. You can find the information on the Central Registry web site at <u>http://www12.tceq.texas.gov/crpub/index.cfm</u>.

You can search by the Regulated Entity (RN), Customer Number (CN) or Name (Permittee), or by your permit number under the search field labeled "Additional ID".

The Customer (Permittee) is responsible for providing consistent information to the TCEQ, and for updating all CN and RN data for all associated authorizations as changes occur. For General Permits, a Notice of Change form must be submitted to the program area for approval to update the CN and RN data in central registry.

INSTRUCTIONS FOR FILLING OUT THE NOC FORM

1) APPLICANT INFORMATION

a) Legal Name

Provide the current legal name of the permittee, as on the permit.

b) Customer Number (CN)

TCEQ's Central Registry will assign each customer a number that begins with CN, followed by nine digits. You may search for your CN at: <u>http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch</u>.

If the name(s) provided do not match the current permittee name(s), this form will be returned. It is the responsibility of the permittee(s) to comply with the general permit.

Note: If a change is being made to the CN and the CN has other TCEQ authorization types, it is the entity's responsibility to update those authorizations at the same time. If an authorization has been cancelled or terminated, the name cannot be changed on the permit. Because of this, a new CN may be issued for the new name.

c) Person Signing this Application

Provide the name and title of the person signing the application. The person must be an executive official meeting signatory requirements in TAC §305.44.

d) Regulated Entity Reference Number (RN)

This is a number issued by TCEQ's Central Registry to sites (a location where a regulated activity occurs) regulated by TCEQ. This is not a permit number, registration number, or license number. Search for your

RN: http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=regent.RNSearch.

If the site has changed or the information provided indicates a new location, this form will be returned. It is the responsibility of the permittee to comply with the general permit.

2) APPLICATION CONTACT

Provide the name, title and contact information of the person that TCEQ can contact for additional information regarding this application.

3) REQUESTED CHANGE TO PERMITTED INFORMATION

Check one or more of the available options indicating the information in the form that is to be updated. Provide the updated information in 3 a) for Legal Name Change, 3 b) for Address and Contact Information Change, 3 c) for Regulated Entity Site Information Change, or 3 d) for General Characteristics Change, as applicable.

a) Legal Name Change

Provide the new legal name. If the entity is a Limited Partnership or Corporation, the name change must be verifiable with Texas Secretary of State. The TX SOS filing number must be provided to verify only a name change occurred. You may contact the SOS at (512)463 5555, for more information related to filing in Texas. If filed in the county where doing business, provide a copy of the legal documents showing the legal name change.

Legal name changes of a Corporation and Limited Partnership will be verified with Texas Secretary of State. If the entity is filed as a new entity with a new filing number, then the change cannot be made through a NOC. The permits are not transferable. If the operator changes, the old entity must terminate their permit and the new entity must submit a form for a new permit.

b) Address and Contact Information Change

Indicate the type of address and contact information for the operator that has changed from the original NOI or last NOC submitted to TCEQ.

Verify mailing addresses with USPS <u>http://zip4.usps.com/zip4/welcome.jsp</u> for regular mail delivery (not overnight express mail). If you find that the address is not verifiable please indicate the address is used by the USPS for regular mail delivery. Failure to provide a valid mailing address will delay or prohibit us from updating the permit.

Please note that address updates relating to a general permit authorization can ONLY be made through a Notice of Change. Address changes submitted through any other form cannot be processed.

c) Regulated Entity Site Information Change

The NOC form is only for use to update or correct information submitted on the original application or last NOC for the authorization. The authorization under a general permit is site specific. If this change is related to a new location, a Notice of Change will not be processed.

Provide the updated site name, updated site addresses, corrected latitude and longitude, and/or corrected county, as applicable to your NOC request. A new physical address for an existing location is usually the result of a newly assigned 911 address for emergencies.

If providing a corrected latitude and longitude, enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. For help obtaining the latitude and longitude, go to <u>http://www.tceq.texas.gov/gis/sqmaview.html</u> or <u>http://nationalmap.gov/ustopo/</u>.

d) Change in General Characteristics Provided on Original Form

Describe any other change that is not addressed through any question in this section of the application.

4) OPERATOR CERTIFICATION

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code (TAC) §305.44.

IF YOU ARE A CORPORATION:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a) (see below). According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

IF YOU ARE A MUNICIPALITY OR OTHER GOVERNMENT ENTITY:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a) (see below). According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statute(s) under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a)(3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code.

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the Texas Commission on Environmental Quality's Environmental Law Division at 512/239-0600.


30 Texas Administrative Code §305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

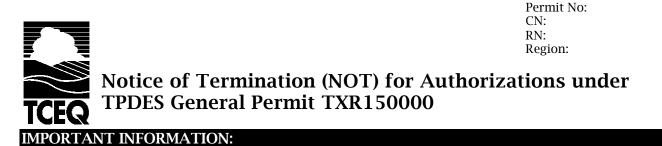

Please read and use the General Information and Instructions prior to filling out each question in the form.

Effective September 1, 2018, this paper form must be submitted to TCEQ with a completed electronic reporting waiver form (TCEQ-20754).

ePermits: This form is available on our online permitting system. Sign up for online permitting at: <u>https://www3.tceq.texas.gov/steers/</u>

What is the permit number to be terminated?

TXR15 TXRCW

Section 1. OPERATOR (Permittee)

- a) What is the Customer Number (CN) issued to this entity? CN
- b) What is the Legal Name of the current permittee?
- c) Provide the contact information for the Operator (Responsible Authority).

Prefix (Mr. Ms. or Miss):

First and Last Name: Suffix:

Title: Credentials:

Phone Number: Fax Number:

Email:

Mailing Address:

City, State, and Zip Code:

Country Mailing Information, if outside USA:

Section 2. APPLICATION CONTACT

This is the person TCEQ will contact if additional information is needed regarding this application.

Is the application contact the same as the permittee identified above?

 \Box Yes, go to Section 3.

□ No, complete section below

Prefix (Mr. Ms. or Miss):

TCEQ Office Use Only

First and Last Name: Suffix: Title: Credentials: Phone Number: Fax Number: Email: Mailing Address: City, State, and Zip Code: Country Mailing Information, if outside USA:

Section 3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

- a) TCEQ issued RE Reference Number (RN): RN
- b) Name of project or site as known by the local community:
- c) County, or counties if more than 1:
- d) Latitude: Longitude:
- e) Site Address/Location:

If the site has a physical address such as 12100 Park 35 Circle, Austin, TX 78753, complete Section 3A.

If the site does not have a physical address, provide a location description in Section 3B. Example: located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1.

Section 3A: Physical Address of Project or Site:

Street Number and Name:

City, State, and Zip Code:

Section 3B: Site Location Description:

Location description:

City where the site is located or, if not in a city, what is the nearest city: Zip Code where the site is located:

Section 4. REASON FOR TERMINATION

Check the reason for termination:

- Final stabilization has been achieved on all portions of the site that are the responsibility of the Operator and all silt fences and other temporary erosion controls have been removed, or scheduled for removal as defined in the SWP3.
- Another permitted Operator has assumed control over all areas of the site that have not been finally stabilized, and temporary erosion controls that have been identified in the SWP3 have been transferred to the new Operator.
- □ The discharge is now authorized under an alternate TPDES permit.
- □ The activity never began at this site that is regulated under the general permit.

Signatory Name:

Signatory Title:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code §305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature (use blue ink): Date:			
	· · · · · · · · · · · · · · · · ·	Deter	
	ionanire ilice nille inkly	Liate.	
	ignature (use blue mik).	Duic.	

Instructions for Notice of Termination (NOT) for Authorizations under TPDES General Permit TXR150000

GENERAL INFORMATION				
Where to Send the Notice of Termination (NOT):				
BY REGULAR U.S. MAIL: Texas Commission on Environmental Quality Stormwater Processing Center (MC-228) P.O. Box 13087 Austin, Texas 78711-3087	BY OVERNIGHT/EXPRESS MAIL: Texas Commission on Environmental Quality Stormwater Processing Center (MC-228) 12100 Park 35 Circle Austin, TX 78753			
TCEQ Contact List:				
Application status and form questions: Technical questions: Environmental Law Division: Records Management - obtain copies of forms: Reports from databases (as available): Cashier's office:	512-239-3700, <u>swpermit@tceq.texas.gov</u> 512-239-4671, <u>swgp@tceq.texas.gov</u> 512-239-0600 512-239-0900 512-239-DATA (3282) 512-239-0357 or 512-239-0187			

Notice of Termination Process:

A Notice of Termination is effective on the date postmarked for delivery to TCEQ.

When your NOT is received by the program, the form will be processed as follows:

- 1) Administrative Review: The form will be reviewed to confirm the following:
 - the permit number is provided;
 - the permit is active and has been approved;
 - the entity terminating the permit is the current permittee;
 - the site information matches the original permit record; and
 - the form has the required original signature with title and date.
- 2) Notice of Deficiency: If an item is incomplete or not verifiable as indicated above, a phone call will be made to the applicant to clear the deficiency. A letter will not be sent to the permittee if unable to process the form.
- 3) Confirmation of Termination: A Notice of Termination Confirmation letter will be mailed to the operator.

Change in Operator:

An authorization under the general permit is not transferable. If the operator of the regulated entity changes, the present permittee must submit a Notice of Termination and the new operator must submit a Notice of Intent. The NOT and NOI must be submitted not later than 10 days prior to the change in Operator status.

INSTRUCTIONS FOR FILLING OUT THE FORM

The majority of permit information related to the current operator and regulated entity are available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.

Section 1. Operator (Current Permittee):

a) Customer Number (CN)

TCEQ's Central Registry assigns each customer a number that begins with CN, followed by nine digits. This is not a permit number, registration number, or license number. The Customer Number, for the current permittee, is available at the following website: http://www2.tceq.texas.gov/wq_dpa/index.cfm.

b) Legal Name of Operator

The operator must be the same entity as previously submitted on the original Notice of Intent for the permit number provided. The current operator name, as provided on the current authorization, is available at the following website: http://www2.tceq.texas.gov/wq_dpa/index.cfm.

c) Contact Information for the Operator (Responsible Authority) Provide information for person signing the NOT application in the Certification section. This person is also referred to as the Responsible Authority.

Provide a complete mailing address for receiving mail from the TCEQ. Update the address if different than previously submitted for the Notice of Intent or Notice of Change. The mailing address must be recognized by the US Postal Service. You may verify the address on the following website: <u>https://tools.usps.com/go/ZipLookupAction!input.action.</u>

The phone number should provide contact to the operator.

The fax number and e-mail address are optional and should correspond to the operator.

Section 2. Application Contact:

Provide the name, title and contact information of the person that TCEQ can contact for additional information regarding this application.

Section 3. Regulated Entity (RE) Information on Project or Site:

- a) Regulated Entity Reference Number (RN) A number issued by TCEQ's Central Registry to sites where an activity regulated by TCEQ. This is not a permit number, registration number, or license number. The Regulated Entity Reference Number is available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.
- b) Name of the Project or Site Provide the name of the site as known by the public in the area where the site is located.
- c) County Identify the county or counties in which the regulated entity is located.
- d) Latitude and Longitude

Enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. The latitude and longitude as provided on the current authorization is available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.

e) Site/Project (RE) Physical Address/Location Information The physical address/location information, as provided on the current authorization, is available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.

- Section 3A. If a site has an address that includes a street number and street name, enter the complete address for the site. If the physical address is not recognized as a USPS delivery address, you may need to validate the address with your local police (911 service) or through an online map site used to locate the site. Please confirm this to be a complete and valid address. Do not use a rural route or post office box for a site location.
- Section 3B. If a site does not have an address that includes a street number and street name, provide a complete written location description. For example: "The site is located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1."

Provide the city (or nearest city) and Zip Code of the facility location.

Section 4. Reason for Termination:

The Notice of Termination form is only for use to terminate the authorization (permit). The Permittee must indicate the specific reason for terminating by checking one of the options. If the reason is not listed then provide an attachment that explains the reason for termination.

Please read your general permit carefully to determine when to terminate your permit. Permits will not be reactivated after submitting a termination form. The termination is effective on the date postmarked for delivery to TCEQ.

Section 5. Certification:

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code §305.44.

IF YOU ARE A CORPORATION:

The regulation that controls who may sign an application form is 30 Texas Administrative Code §305.44(a), which is provided below. According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

IF YOU ARE A MUNICIPALITY OR OTHER GOVERNMENT ENTITY:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a), which is provided below. According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statutes under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a) (3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the Texas Commission on Environmental Quality's Environmental Law Division at 512-239-0600.

30 Texas Administrative Code §305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

APPENDIX H

RECORD OF TEMPORARY/PERMANENT CEASING OF CONSTRUCTION ACTIVITIES

Record of Temporary/Permanent Ceasing of Construction Activities

Project Activity Area	Date Activities Ceased	Temporary* or Permanent	Date Soil Stabilization Implemented	Date Activities Resumed	Initials

* "Temporarily Ceased" means inactive for less than 21 consecutive days.

APPENDIX I

DELEGATION OF SIGNATORIES

Executive Director Texas Commission on Environmental Quality Storm Water and Pretreatment Team P.O. Box 13087, MC-148 Austin, TX 78711-3087

Subject: Delegation of Signatories to Reports

 Facility/Company/Site Name:

 TPDES Permit Number:

Dear Executive Director:

This letter serves to designate the following people or positions as authorized personnel for signing reports, storm water pollution prevention plans, certifications or other information requested by the Executive Director or required by the general permit, as set forth by 30 TAC §305.128 (see page 2).

Name or Position	
Name or Position	
Name or Position	
Name or Position	

I understand that this authorization does not extend to the signing of a Notice of Intent for obtaining coverage under a storm water general permit.

By signing this authorization, I confirm that I meet the requirements to make such a designation as set forth in 30 TAC §305.44 (see page 2).

Sincerely,

Name

Title

Date

Delegation of Signatories to Reports Page 2

RELEVANT PROVISIONS

305.128(a) All reports requested by permits and other information requested by the executive director shall be signed by a person described in §305.44(a) of this title (relating to Signatories to Applications) or by a duly authorized representative of that person. A person is a duly authorized representative only if:

(1) the authorization is made in writing by a person described in §305.44(a) of this title (relating to Signatories to Applications);

(2) the authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity or for environmental matters for the applicant, such as the position of plant manager, operator of a well or well field, environmental manager, or a position of equivalent responsibility. (A duly authorized representative may thus be either a named individual or any individual occupying a named position); and

(3) the written authorization is submitted to the executive director.

(b) If an authorization under this section is no longer accurate because of a change in individuals or position, a new authorization satisfying the requirements of this section must be submitted to the executive director prior to or together with any reports, information, or applications to be signed by an authorized representative.

(c) Any person signing a report required by a permit shall make the certification set forth in §305.44(b) of this title (relating to Signatories to Applications).

305.44(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

(b) A person signing an application shall make the following certification: "I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

APPENDIX J

MATERIAL MANAGEMENT PRACTICES

MATERIAL MANAGEMENT PRACTICES

The following are the material management practices that will be used to reduce risk of spills or other accidental exposure of materials and substances to storm water runoff:

- 1. <u>Good Housekeeping:</u> The following good housekeeping practices will be followed onsite during the construction project:
 - An effort will be made to store only enough product required to do the job.
 - All materials stored on-site will be stored in a neat, orderly manner in their appropriate containers and, if possible, under a roof or other enclosure.
 - Products will be kept in their original containers with the original manufacturer's label.
 - Substances will not be mixed with one another unless recommended by the manufacturer.
 - Whenever possible, all of a product will be used up before disposing of the container.
 - Manufacturers' recommendations for proper use and disposal will be followed.
 - Designated areas for equipment maintenance and repair (control of oil, grease and fuel spills).
 - Waste receptacles with regular collection for litter and construction debris.
 - Equipment washdown area on-site with appropriate control of wash waters (including concrete truck wash down).
 - Protected storage areas for chemicals, paints, solvents, fertilizers and other potentially toxic materials.
 - Adequately maintained sanitary facilities.
 - Proper control of raw materials stored on-site (for example, sand, aggregate and cement used in the manufacture of concrete or stockpiles of topsoil).
 - Street sweeping or cleaning.
 - Removal of inlet protection barriers during major rainfall events if flooding occurs and verification that reinforced filter fabric fences are in proper condition prior to all rainfall events.
 - The site superintendent will ensure proper use and disposal of materials onsite.
- 2. <u>Hazardous Products</u>: The following practices are used to reduce the risks associated with hazardous materials.
 - Products will be kept in original containers unless they are not re-sealable.
 - Paints, solvents, fertilizer, fuel (small containers), and other stored chemical substances will be kept within an enclosure to protect the containers and the floor of the enclosure, from wind, precipitation, and storm water runoff.
 - Fuel storage and filling areas will be bermed off to provide collection of any spills and prevent exposure to storm water runoff.
 - Original labels and Material Safety Data Sheets (MSDS) will be retained on-site and available for review by workers.
 - If surplus product must be disposed of, manufacturers' or local and State recommended methods for proper disposal will be followed.

PRODUCT SPECIFIC PRACTICES

The following product specific practices will be followed onsite:

- 1. <u>Petroleum Products</u>: All onsite vehicles will be monitored for leaks and receive regular preventive maintenance to reduce the chance of leakage. Petroleum products will be stored in tightly sealed containers, which are clearly labeled. Any asphalt substances used onsite will be applied according to the manufacturer's recommendations.
- 2. <u>Fertilizers:</u> Fertilizers used will be applied only in the minimum amounts recommended by the manufacturer. Storage will be in a covered shed.
- 3. <u>Paints:</u> All containers will be tightly sealed and stored when not required for use. Excess paint will not be discharged to the storm sewer system but will be properly disposed of according to manufacturers' instructions or State and local regulations.
- 4. <u>Concrete Trucks:</u> Discharges of concrete truck wash out at construction sites may be authorized if conducted in accordance with the requirements of Part V of the general permit.

SPILL CONTROL PRACTICES

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup:

- Manufacturers' recommended methods for spill cleanup will be maintained on-site in the material data sheets (MSDS) and site personnel will be made aware of the procedures and the location of the information and cleanup supplies.
- Materials and equipment necessary for spill cleanup will be kept in the material storage area onsite. Equipment and materials will include but not be limited to brooms, dust pans, mops, rags, gloves, goggles, kitty litter, sand, sawdust and plastic and metal trash containers specifically for this purpose.
- All spills will be cleaned up immediately after discovery.
- The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with a hazardous substance.
- Contact the MS4 Operator, TCEQ (800-832-8224), and the National Response Center (800-424-8802) to inform of any spill of toxic or hazardous material regardless of the size.

The spill prevention plan will be adjusted to include measures to prevent this type of spill from recurring and how to clean up the spill if there is another one. A description of the spill, what caused it, and the cleanup measures will also be included.

APPENDIX K

NON-STORM WATER DISCHARGE INVENTORY

NON-STORM WATER DISCHARGE INVENTORY

Mark the materials or substances listed below expected to be present onsite during construction:

Concrete	Detergents	Paints (enamel/latex)
Metal Studs	Fuels	Lubricants
Fertilizers	Petroleum Based Products	Cleaning Solvents
Masonry Block	Electrical Equipment and Materials	Asphalt and Asphalt Related Products
Tar	Roof Shingles	Wood
Steel Products		

AUTHORIZED NON STORMWATER DISCHARGES ANTICIPATED DURING THE PROJECT

Mark the following non-storm water discharges expected to occur from the site during the construction period (refer to general permit in Appendix G for additional information):

- □ discharges from firefighting activities,
- uncontaminated fire hydrant flushings, which include flushings from systems that utilize potable water, surface water, or groundwater that does not contain additional pollutants,
- water from the routine external washing of vehicles, the external portion of buildings or structures, and pavement, where detergents and soaps are not used and where spills or leaks of toxic or hazardous materials have not occurred and where the purpose is to remove mud, dirt, or dust,
- □ uncontaminated water used to control dust,
- □ potable water sources including waterline flushings,
- uncontaminated air conditioning condensate,
- □ uncontaminated ground water or spring water, including foundation or footing drains where flows are not contaminated with industrial materials such as solvents,
- □ lawn watering and similar irrigation drainage,
- □ runoff from concrete batch plants (refer to Part IV of general permit),
- □ concrete truck wash out (refer to Part V of general permit).

APPENDIX L

REPORTABLE QUANTITIES OF HAZARDOUS SUBSTANCES

The Reportable Quantities link is provided below. A table to help with determining if a reportable discharge or spill has occurred can be found through this link.

https://www.tceq.texas.gov/response/spills/spill_rq.html

Each substance in Table 117.3 that is listed in Table 302.4, 40 CFR part 302, is assigned the reportable quantity listed in Table 302.4 for that substance.

TABLE 117.3 -- REPORTABLE QUANTITIES OF HAZARDOUS SUBSTANCES DESIGNATED PURSUANT TO SECTION 311 OF THE CLEAN WATER ACT

Note: The first number under the column headed "RQ" is the reportable quantity in pounds. The number in parentheses is the metric equivalent in kilograms. For convenience, the table contains a column headed "Category" which lists the code letters "X", "A", "B", "C", and "D" associated with reportable quantities of 1, 10, 100, 1000, and 5000 pounds, respectively.

Material	Category	RQ in pounds (kilograms)
Acetaldehyde. Acetic acid. Acetic anhydride. Acetone cyanohydrin. Acetyl bromide. Acetyl bromide. Acetyl chloride. Acrolein. Acrylonitrile. Adipic acid. Aldrin. Allyl alcohol. Allyl alcohol. Allyl chloride. Aluminum sulfate. Ammonia. Ammonia acetate. Ammonium benzoate. Ammonium bicarbonate. Ammonium biclarbonate. Ammonium bisulfite. Ammonium carbamate. Ammonium carbamate. Ammonium carbonate. Ammonium carbonate. Ammonium carbonate. Ammonium carbonate. Ammonium carbonate. Ammonium carbonate. Ammonium chloride. Ammonium chloride. Ammonium fluoborate. Ammonium fluoride.	C D	$\begin{array}{c} 1,000 & (454) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 10 & (4.54) \\ 5,000 & (2,270) \\ 1 & (0.454) \\ 100 & (454) \\ 100 & (454) \\ 100 & (454) \\ 100 & (454) \\ 1,000 & (454) \\ 5,000 & (2,270) \\ 100 & (454) \\ 5,000 & (2,270) \\ 100 & (45.4) \\ 5,000 & (2,270) \\ 100 & (45.4) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 5,000 & (2,270) \\ 10 & (4.54) \\ 5,000 & (2,270) \\ 10 & (4.54) \\ 5,000 & (2,270) \\ 100 & (45.4) \\ \end{array}$
Ammonium hydroxide Ammonium oxalate Ammonium silicofluoride Ammonium sulfamate	C D C D	1,000 (454) 5,000 (2,270) 1,000 (454) 5,000 (2,270)

Table 117.3_Reportable Quantities of Hazardous Substances Designated Pursuant to Section 311 of the Clean Water Act

Ammonium sulfide	В	100 (45.4)
Ammonium sulfite	D	5,000 (2,270)
Ammonium tartrate	D	5,000 (2,270)
Ammonium thiocyanate	D	5,000 (2,270)
Amyl acetate	D	5,000 (2,270)
Aniline	D	5,000 (2,270)
Antimony pentachloride	С	1,000 (454)
Antimony potassium tartrate	В	100 (45.4)
Antimony tribromide	С	1,000 (454)
Antimony trichloride	С	1,000 (454)
Antimony trifluoride	С	1,000 (454)
Antimony trioxide	C	1,000 (454)
Arsenic disulfide	X	1 (0.454)
Arsenic pentoxide	X	1 (0.454)
Arsenic trichloride	х	1 (0.454)
Arsenic trioxide	X	1 (0.454)
Arsenic trisulfide	X	1 (0.454)
Barium cyanide	A	10 (4.54)
Benzene	A	10 (4.54)
Benzoic acid	D	5,000 (2,270)
Benzonitrile	D	5,000 (2,270)
Benzoyl chloride	C	1,000 (454)
Benzyl chloride	B	100 (45.4)
Beryllium chloride	Х	1 (0.454)
Beryllium fluoride	х	1 (0.454)
Beryllium nitrate	X	1 (0.454)
Butyl acetate	D	5,000 (2,270)
Butylamine	С	1,000 (454)
n-Butyl phthalate	A	10 (4.54)
Butyric acid	D	5,000 (2,270)
Cadmium acetate	A	10 (4.54)
Cadmium bromide	A	10 (4.54)
Cadmium chloride	A	10 (4.54)
Calcium arsenate	Х	1 (0.454)
Calcium arsenite	Х	1 (0.454)
Calcium carbide	A	10 (4.54)
Calcium chromate	A	10 (4.54)
Calcium cyanide	A	10 (4.54)
Calcium dodecylbenzenesulfonate.	С	1,000 (454)
Calcium hypochlorite	A	10 (4.54)
Captan	A	10 (4.54)
Carbaryl	В	100 (45.4)
Carbofuran	A	10 (4.54)
Carbon disulfide	В	100 (45.4)
Carbon tetrachloride	A	10 (4.54)
Chlordane	Х	1 (0.454)
Chlorine	A	10 (4.54)
Chlorobenzene	В	100 (45.4)
Chloroform	A	10 (4.54)
Chlorosulfonic acid	C	1,000 (454)
Chlorpyrifos	Х	1 (0.454)
Chromic acetate	C	1,000 (454)
Chromic acid	A	10 (4.54)
Chromic sulfate	C	1,000 (454)
Chromous chloride	C	1,000 (454)

Cobaltous bromide	C	1,000 (454)
Cobaltous formate	C	1,000 (454)
Cobaltous sulfamate	C	1,000 (454)
Coumaphos	A	10 (4.54)
Cresol	В	100 (45.4)
Crotonaldehyde	В	100 (45.4)
Cupric acetate	В	100 (45.4)
Cupric acetoarsenite	Х	1 (0.454)
Cupric chloride	A	10 (4.54)
Cupric nitrate	В	100 (45.4)
Cupric oxalate	B	100 (45.4)
Cupric sulfate	A	10 (4.54)
Cupric sulfate, ammoniated	B	100 (45.4)
Cupric tartrate	В	100 (45.4)
Cyanogen chloride	A	10 (4.54)
Cyclohexane	С	1,000 (454)
2,4-D Acid	В	100 (45.4)
2,4-D Esters	В	100 (45.4)
DDT	Б Х	1 (0.454)
Diazinon	X	1 (0.454)
Dicamba	C B	1,000 (454)
Dichlobenil	В Х	100 (45.4)
Dichlone		1 (0.454)
Dichlorobenzene	B	100 (45.4)
Dichloropropane	C	1,000 (454)
Dichloropropene	B	100 (45.4)
Dichloropropene-Dichloropropane	B	100 (45.4)
(mixture).	5	
2,2-Dichloropropionic acid	D	5,000 (2,270)
Dichlorvos	A	10 (4.54)
Dicofol	A	10 (4.54)
Dieldrin	X	1 (0.454)
Diethylamine	В	100 (45.4)
Dimethylamine	C	1,000 (454)
Dinitrobenzene (mixed)	В	100 (45.4)
Dinitrophenol	Α	10 (45.4)
Dinitrotoluene	Α	10 (4.54)
Diquat	C	1,000 (454)
Disulfoton	X	1 (0.454)
Diuron	B	100 (45.4)
Dodecylbenzenesulfonic acid	C	1,000 (454)
Endosulfan	X	1 (0.454)
Endrin	X	1 (0.454)
Epichlorohydrin	Β	100 (45.4)
Ethion	A	10 (4.54)
Ethylbenzene	C	1,000 (454)
Ethylenediamine	D	5,000 (2,270)
Ethylenediamine-tetraacetic acid (EDTA).	D	5,000 (2,270)
Ethylene dibromide	Х	1 (0.454)
Ethylene dichloride	В	100 (45.4)
Ferric ammonium citrate	C	1,000 (454)
Ferric ammonium oxalate	C	1,000 (454)
Ferric chloride	C	1,000 (454)
Ferric fluoride	В	100 (45.4)
Ferric nitrate	C	1,000 (454)

Ferric sulfate	C	1,000 (454)
Ferrous ammonium sulfate	C	1,000 (454)
Ferrous chloride	В	100 (45.4)
Ferrous sulfate	С	1,000 (454)
Formaldehyde	В	100 (45.4)
Formic acid	D	5,000 (2,270)
Fumaric acid	D	5,000 (2,270)
Furfural	D	5,000 (2,270)
Guthion	X	1 (0.454)
Heptachlor	XX	1 (0.454)
-		
Hexachlorocyclopentadiene	A	10 (4.54)
Hydrochloric acid	D	5,000 (2,270)
Hydrofluoric acid	В	100 (45.4)
Hydrogen cyanide	Α	10 (4.54)
Hydrogen sulfide	В	100 (45.4)
Isoprene	В	100 (45.4)
Isopropanolamine	С	1,000 (454)
dodecylbenzenesulfonate.		
Kepone	Х	1 (0.454)
Lead acetate	A	10 (4.54)
Lead arsenate	X	1 (0.454)
Lead chloride	A	10 (4.54)
Lead fluoborate	A	10 (4.54)
Lead fluoride	A	10 (4.54)
Lead iodide		
Lead nitrate	A	- (-)
	A	10 (4.54)
Lead stearate	A	10 (4.54)
Lead sulfate	A	10 (4.54)
Lead sulfide	A	10 (4.54)
Lead thiocyanate	A	10 (4.54)
Lindane	Х	1 (0.454)
Lithium chromate	A	10 (4.54)
Malathion	В	100 (45.4)
Maleic acid	D	5,000 (2,270)
Maleic anhydride	D	5,000 (2,270)
Mercaptodimethur	Α	10 (4.54)
Mercuric cyanide	X	1 (0.454)
Mercuric nitrate	A	10 (4.54)
Mercuric sulfate	A	10 (4.54)
Mercuric thiocyanate	A	10 (4.54)
Mercurous nitrate	A	10 (4.54)
Methoxychlor	Х	1 (0.454)
Methyl mercaptan	В	100 (45.4)
Methyl methacrylate	C	1,000 (454)
Methyl parathion	В	100 (45.4)
Mevinphos	A	10 (4.54)
Mexacarbate	C	1,000 (454)
Monoethylamine	В	100 (45.4)
Monomethylamine	В	100 (45.4)
Naled	A	10 (4.54)
Naphthalene	B	100 (45.4)
Naphthenic acid	B	100 (45.4)
Nickel ammonium sulfate	B	100 (45.4)
Nickel chloride	B	100 (45.4)
Nickel hydroxide	A	10 (4.54)
<u> </u>	· · · · · · · · · · · · · · · · · · ·	

Nickel nitrate	В	100 (45.4)
Nickel sulfate	В	100 (45.4)
Nitric acid	C	1,000 (454)
Nitrobenzene	С	1,000 (454)
Nitrogen dioxide	A	10 (4.54)
Nitrophenol (mixed)	В	100 (45.4)
Nitrotoluene	C	1,000 (454)
Paraformaldehyde	C	1,000 (454)
Parathion	A	10 (4.54)
Pentachlorophenol	A	10 (4.54)
Phenol	А	1,000 (454)
		1,000(4.54) 10(4.54)
Phospene	A	· ,
Phosphoric acid	D	5,000 (2,270)
Phosphorus	X	1 (0.454)
Phosphorus oxychloride	C	1,000 (454)
Phosphorus pentasulfide	В	100 (45.4)
Phosphorus trichloride	C	1,000 (454)
Polychlorinated biphenyls	Χ	1 (0.454)
Potassium arsenate	Χ	1 (0.454)
Potassium arsenite	Χ	1 (0.454)
Potassium bichromate	A	10 (4.54)
Potassium chromate	A	10 (4.54)
Potassium cyanide	A	10 (4.54)
Potassium hydroxide	C	1,000 (454)
Potassium permanganate	В	100 (45.4)
Propargite	A	10 (4.54)
Propionic acid	D	5,000 (2,270)
Propionic anhydride	D	5,000 (2,270)
Propylene oxide	В	100 (45.4)
Pyrethrins	Х	1 (0.454)
Quinoline	D	5,000 (2,270)
Resorcinol	D	5,000 (2,270)
Selenium oxide	A	10 (4.54)
Silver nitrate	Х	1 (0.454)
Sodium	A	10 (4.54)
Sodium arsenate	Х	1 (0.454)
Sodium arsenite	Х	1 (0.454)
Sodium bichromate	A	10 (4.54)
Sodium bifluoride	В	100 (45.4)
Sodium bisulfite	D	5,000 (2,270)
Sodium chromate	A	10 (4.54)
Sodium cyanide	A	10 (4.54)
Sodium dodecylbenzenesulfonate	C	1,000 (454)
Sodium fluoride	C	1,000 (454)
Sodium hydrosulfide	D	5,000 (2,270)
Sodium hydroxide	C	1,000 (454)
Sodium hypochlorite	B	100 (45.4)
Sodium methylate	C	1,000 (454)
Sodium nitrite	В	100 (45.4)
Sodium phosphate, dibasic	D	5,000 (2,270)
Sodium phosphate, tribasic	D	5,000 (2,270)
Sodium phosphate, tilbasic	B	100 (45.4)
Strontium chromate	A	10 (4.54)
Strychnine	A	10 (4.54)
Styrene	C	1,000 (454)
Sulfuric acid	C	1,000 (454)
	····	-,000 (HJH)

	a	1 000 (454)
Sulfur monochloride	C	1,000 (454)
2,4,5-T acid	С	1,000 (454)
2,4,5-T amines	D	5,000 (2,270)
2,4,5-T esters	С	1,000 (454)
2,4,5-T salts	С	1,000 (454)
TDE	Х	1 (0.454)
2,4,5-TP acid	В	100 (45.4)
2,4,5-TP acid esters	B	100 (45.4)
Tetraethyl lead	A	10 (4.54)
	A	
Tetraethyl pyrophosphate		10 (4.54)
Thallium sulfate	B	100 (45.4)
Toluene	C	1,000 (454)
Toxaphene	Х	1 (0.454)
Trichlorfon	В	100 (45.4)
Trichloroethylene	В	100 (45.4)
Trichlorophenol	A	10 (4.54)
Triethanolamine	С	1,000 (454)
dodecylbenzenesulfonate.		
Triethylamine	D	5,000 (2,270)
Trimethylamine	В	100 (45.4)
Uranyl acetate	B	100 (45.4)
Uranyl nitrate	B	100 (45.4)
Vanadium pentoxide	С	1,000 (454)
Vanadyl sulfate	С	1,000 (454)
Vinyl acetate	D	5,000 (2,270)
Vinylidene chloride	В	100 (45.4)
Xylene (mixed)	В	100 (45.4)
Xylenol	C	1,000 (454)
Zinc acetate	C	1,000 (454)
Zinc ammonium chloride	С	1,000 (454)
Zinc borate	С	1,000 (454)
Zinc bromide	С	1,000 (454)
Zinc carbonate	С	1,000 (454)
Zinc chloride	C	1,000 (454)
Zinc cyanide	A	10 (4.54)
Zinc fluoride	C	1,000 (454)
Zinc formate	C	1,000 (454)
Zinc hydrosulfite	C	1,000 (454)
Zinc nitrate	C	1,000 (454)
Zinc phenolsulfonate	D	5,000 (2,270)
Zinc phosphide	B	100 (45.4)
Zinc silicofluoride	D	5,000 (2,270)
Zinc sulfate	C	1,000 (454)
Zirconium nitrate	D	5,000 (2,270)
Zirconium potassium fluoride	C	1,000 (454)
Zirconium sulfate	D	5,000 (2,270)
Zirconium tetrachloride	D	5,000 (2,270)
		5,000 (2,270)

[50 FR 13513, Apr. 4, 1985, as amended at 51 FR 34547, Sept. 29, 1986; 54 FR 33482, Aug. 14, 1989; 58 FR 35327, June 30, 1993; 60 FR 30937, June 12, 1995]

APPENDIX M

SEDIMENTATION BASIN INFORMATION

Sites With Drainage Areas of Ten or More Acres

A sedimentation basin is required, where feasible, for a common drainage location that serves an area with ten (10) or more acres disturbed at one time.

A sedimentation basin may be temporary or permanent and must provide sufficient storage to contain a calculated volume of runoff from a 2-year, 24-hour storm from each disturbed acre drained. When calculating the volume of runoff from a 2-year, 24-hour storm event, it is not required to include the flows from offsite areas and flow from onsite areas that are either undisturbed or have already undergone permanent stabilization, if these flows are diverted around both the disturbed areas of the site and the sediment basin. Capacity calculations shall be included in Appendix M of this SWP3.

Where rainfall data is not available or a calculation cannot be performed, the sedimentation basin must provide at least 3,600 cubic feet of storage per acre drained until final stabilization of the site.

If a sedimentation basin is not feasible, then the permittee shall provide equivalent control measures until final stabilization of the site. In determining whether installing a sediment basin is feasible, the permittee may consider factors such as site soils, slope, available area, public safety, precipitation patterns, site geometry, site vegetation, infiltration capacity, geotechnical factors, depth to groundwater, and other similar considerations. The permittee shall document the reason that the sediment basins are not feasible, and shall utilize equivalent control measures, which may include a series of smaller sediment basins.

Sites With Drainage Areas Less than Ten Acres

Sediment traps and sediment basins may be used to control solids in storm water runoff for drainage locations serving less than ten (10) acres.

Alternatively, a sediment basin that provides storage for a calculated volume of runoff from a 2year, 24-hour storm from each disturbed acre drained may be utilized. Where rainfall data is not available or a calculation cannot be performed, a temporary or permanent sediment basin providing 3,600 cubic feet of storage per acre drained may be provided. If a calculation is performed, then the calculation shall be included in Appendix N of this SWP3.

Proposed Sedimentation Basin Calculations

For Nolina Phase 2A, the proposed onsite batch detention pond will serve as a storage for onsite drainage. The basins will be designed to contain the 3,600 cubic feet per acre of disturbed area draining to the pond.

Temporary Sedimentation:

The batch detention pond will serve as storage for on-site drainage for Nolina Phase 2A (as shown on sheet 35 of the construction drawings) during the construction phase. The total drainage area includes 20.47 acres and generates a volume of 84,432 ft³. The proposed detention pond will contain a volume of 88,027 ft³, thus the constructed pond will be adequality sized required for sedimentation purposes. Batch Detention Pond D will be able to store a volume of 114,224, ft³. Refer to the detention plan sheets in construction plans for details.

Kimley **»Horn**

SECTION 4: ADDITIONAL FROMS

Copy of Notice of Intent

TCEQOffice Use Only Permit No: CN: RN:



Notice of Intent (NOI) for an Authorization for Stormwater Discharges Associated with Construction Activity under TPDES General Permit TXR150000

IMPORTANT INFORMATION

Please read and use the General Information and Instructions prior to filling out each question in the NOI form.

Use the NOI Checklist to ensure all required information is completed correctly. **Incomplete applications delay approval or result in automatic denial.**

Once processed your permit authorization can be viewed by entering the following link into your internet browser: http://www2.tceq.texas.gov/wq_dpa/index.cfm or you can contact TCEQ Stormwater Processing Center at 512-239-3700.

e PERMIT S

Effective September 1, 2018, this paper form must be submitted to TCEQ with a completed electronic reporting waiver form (TCEQ-20754).

To submit an NOI electronically, enter the following web address into your internet browser and follow the instructions: https://www3.tceq.texas.gov/steers/index.cfm

APPLICATION FEE AND PAYMENT

The application fee for submitting a paper NOI is \$325. The application fee for electronic submittal of a NOI through the TCEQ ePermits system (STEERS) is \$225.

Payment of the application fee can be submitted by mail or through the TCEQ ePay system. The payment and the NOI must be mailed to separate addresses. To access the TCEQ ePay system enter the following web address into your internet browser: http://www.tceq.texas.gov/epay.

Provide your payment information for verification of payment:

- If payment was mailed to TCEQ, provide the following:
 - Check/Money Order Number:
 - Name printed on Check:
- If payment was made via ePay, provide the following:
 - Voucher Number:
 - A copy of the payment voucher is attached to this paper NOI form.

RE	NEWAL (This portion of the NOI is not applied	cable aft	ter June 3, 2018)	
Is t	his NOI for a renewal of an existing authoriz	zation?	🗆 Yes 🛛] No
If Y	es, provide the authorization number here:	FXR15		xt.
NC	TE: If an authorization number is not provid	ed, a nev	w number will be as	signed.
SEG	CTION 1. OPERATOR (APPLICANT)			
a)	If the applicant is currently a customer with (CN) issued to this entity? CN	TCEQ, v	what is the Custome	er Number
	(Refer to Section 1.a) of the Instructions)			
b)	What is the Legal Name of the entity (applic legal name must be spelled exactly as filed of County, or in the legal document forming the	with the '	Texas Secretary of S	
c)	What is the contact information for the Ope	erator (R	lesponsible Authori	tv)?
,	Prefix (Mr. Ms. Miss):	i i		, ,
	First and Last Name:	Suffix:	Click here to enter t	ext
	Title: Credentials:		e to enter text.	
	Phone Number: Fax	Number	Click here to enter	text
	E-mail: Click here to entertext			
	Mailing Address:			
	City, State, and Zip Code:	text.		
	Mailing Information if outside USA:			
	Territory:			
	Country Code: Posta	al Code:	Click here to enter t	ext.
d)	Indicate the type of customer:			
	🗆 Individual	🗆 Fe	ederal Government	
	🗆 Limited Partnership		ounty Government	
	🗆 General Partnership	🗆 St	tate Government	
	🗖 Trust	🗆 Ci	ity Government	
	Sole Proprietorship (D.B.A.)		ther Government	
	□ Corporation		ther:	nter text.
	□ Estate			
e)	Is the applicant an independent operator?	□ Yes	□ No	

 $\label{eq:TCEQ-20022} \ensuremath{(3/6/2018)}\xspace$ Notice of Intent for Construction Stormwater Discharges under TXR150000

(If a governmental entity, a subsidiary, or part of a larger corporation, check No.)

- f) Number of Employees. Select the range applicable to your company.
 - □ 0-20

□ 251-500

□ 21-100

□ 501 or higher

- □ 101-250
- g) Customer Business Tax and Filing Numbers: (**Required** for Corporations and Limited Partnerships. **Not Required** for Individuals, Government, or Sole Proprietors.)

State Franchise Tax ID Number:

Federal Tax ID:

Texas Secretary of State Charter (filing) Number:

DUNS Number (if known):

SECTION 2. APPLICATION CONTACT

Is the application contact the same as the applicant identified above?

□ Yes, go to Section 3

□ No, complete this section

Prefix (Mr. Ms. Miss):	re to enter text.
First and Last Name:	re to enter text Suffix: Click here to enter text
Title: Click here to enter text	Credential:
Organization Name:	re to entertext.
Phone Number:	Fax Number.
E-mail:	
Mailing Address:) enter text.
Internal Routing (Mail Code, F	Etc.): Click here to enter text
City, State, and Zip Code:	k here to enter text.
Mailing information if outside	e USA:
Territory:	
Country Code:	Postal Code:

SECTION 3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

a) If this is an existing permitted site, what is the Regulated Entity Number (RN) issued to this site? RN

(Refer to Section 3.a) of the Instructions)

- b) Name of project or site (the name known by the community where it's located):
- c) In your own words, briefly describe the type of construction occurring at the regulated site (residential, industrial, commercial, or other):
- d) County or Counties (if located in more than one):
- e) Latitude: Longitude:
- f) Site Address/Location

If the site has a physical address such as 12100 Park 35 Circle, Austin, TX 78753, complete *Section A*.

If the site does not have a physical address, provide a location description in *Section B*. Example: located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1.

Section A:

Street Number and Name:

City, State, and Zip Code:

Section B:

Location Description:

City (or city nearest to) where the site is located:

Zip Code where the site is located:

SECTION 4. GENERAL CHARACTERISTICS

- a) Is the project or site located on Indian Country Lands?
 - Yes, do not submit this form. You must obtain authorization through EPA Region 6.

□ No

- b) Is your construction activity associated with a facility that, when completed, would be associated with the exploration, development, or production of oil or gas or geothermal resources?
 - Yes. Note: The construction stormwater runoff may be under jurisdiction of the Railroad Commission of Texas and may need to obtain authorization through EPA Region 6.

□ No

- c) What is the Primary Standard Industrial Classification (SIC) Code that best describes the construction activity being conducted at the site?
- d) What is the Secondary SIC Code(s), if applicable?
- e) What is the total number of acres to be disturbed?
- f) Is the project part of a larger common plan of development or sale?

TCEQ-20022(3/6/2018)

🗆 Yes

□ No. The total number of acres disturbed, provided in e) above, must be 5 or more. If the total number of acres disturbed is less than 5, do not submit this form. See the requirements in the general permit for small construction sites.

g) What is the estimated start date of the project?

- h) What is the estimated end date of the project?
- i) Will concrete truck washout be performed at the site?
- j) What is the name of the first water body(ies) to receive the stormwater runoff or potential runoff from the site?
- k) What is the segment number(s) of the classified water body(ies) that the discharge will eventually reach?
- 1) Is the discharge into a Municipal Separate Storm Sewer System (MS4)?

□ Yes □ No

If Yes, provide the name of the MS4 operator:

Note: The general permit requires you to send a copy of this NOI form to the MS4 operator.

m) Is the discharge or potential discharge from the site within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer, as defined in 30 TAC Chapter 213?

□ Yes, complete the certification below.

□ No, go to Section 5

I certify that the copy of the TCEQ-approved Plan required by the Edward's Aquifer Rule (30 TAC Chapter 213) that is included or referenced in the Stormwater Pollution Prevention Plan will be implemented.

SECTION 5. NOI CERTIFICATION

- a) I certify that I have obtained a copy and understand the terms and conditions of the Construction General Permit (TXR150000).
- b) I certify that the full legal name of the entity applying for this permit has been provided and is legally authorized to do business in Texas.
- c) I understand that a Notice of Termination (NOT) must be submitted when this authorization is no longer needed.
- d) I certify that a Stormwater Pollution Prevention Plan has been developed, will be implemented prior to construction and to the best of my knowledge and belief is compliant with any applicable local sediment and erosion control plans, as required in the Construction General Permit (TXR150000).

Note: For multiple operators who prepare a shared SWP3, the confirmation of an operator may be limited to its obligations under the SWP3, provided all obligations are confirmed by at least one operator.

□ Yes

SECTION 6. APPLICANT CERTIFICATION SIGNATURE

Operator Signatory Name:

Operator Signatory Title:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code §305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature (use blue ink): Date:

NOTICE OF INTENT CHECKLIST (TXR150000)

Did you complete everything? Use this checklist to be sure!

Are you ready to mail your form to TCEQ? Go to the General Information Section of the Instructions for mailing addresses.

Confirm each item (or applicable item) in this form is complete. This checklist is for use by the applicant to ensure a complete application is being submitted. **Missing information may result in denial of coverage under the general permit.** (See NOI process description in the General Information and Instructions.)

APPLICATION FEE

If paying by check:

Check was mailed **separately** to the TCEQs Cashier's Office. (See Instructions for Cashier's address and Application address.)

Check number and name on check is provided in this application.

If using ePay:

□ The voucher number is provided in this application and a copy of the voucher is attached.

RENEWAL

□ If this application is for renewal of an existing authorization, the authorization number is provided.

OPERATOR INFORMATION

Customer Number (CN) issued by TCEQ Central Registry

- Legal name as filed to do business in Texas. (Call TX SOS 512-463-5555 to verify.)
- □ Name and title of responsible authority signing the application.
- □ Phone number and e-mail address
- □ Mailing address is complete & verifiable with USPS. <u>www.usps.com</u>
- □ Type of operator (entity type). Is applicant an independent operator?
- □ Number of employees.
- □ For corporations or limited partnerships Tax ID and SOS filing numbers.
- Application contact and address is complete & verifiable with USPS. <u>http://www.usps.com</u>

REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

- Regulated Entity Number (RN) (if site is already regulated by TCEQ)
- □ Site/project name and construction activity description

□ County

□ Latitude and longitude <u>http://www.tceq.texas.gov/gis/sqmaview.html</u>

□ Site Address/Location. Do not use a rural route or post office box.

GENERAL CHARACTERISTICS

- □ Indian Country Lands the facility is not on Indian Country Lands.
- Construction activity related to facility associated to oil, gas, or geothermal resources
- □ Primary SIC Code that best describes the construction activity being conducted at the site. <u>www.osha.gov/oshstats/sicser.html</u>
- Estimated starting and ending dates of the project.
- □ Confirmation of concrete truck washout.
- □ Acres disturbed is provided and qualifies for coverage through a NOI.
- □ Common plan of development or sale.
- □ Receiving water body or water bodies.
- □ Segment number or numbers.
- \square MS4 operator.
- \Box Edwards Aquifer rule.

CERTIFICATION

- □ Certification statements have been checked indicating Yes.
- □ Signature meets 30 Texas Administrative Code (TAC) §305.44 and is original.

Instructions for Notice of Intent (NOI) for Stormwater Discharges Associated with Construction Activity under TPDES General Permit (TXR150000)

GENERAL INFORMATION

Where to Send the Notice of Intent (NOI):

By Regular Mail: TCEQ Stormwater Processing Center (MC228) P.O. Box 13087 Austin, Texas 78711-3087 By Overnight or Express Mail: TCEQ Stormwater Processing Center (MC228) 12100 Park 35 Circle Austin, TX

Application Fee:

The application fee of \$325 is required to be paid at the time the NOI is submitted. Failure to submit payment at the time the application is filed will cause delays in acknowledgment or denial of coverage under the general permit. Payment of the fee may be made by check or money order, payable to TCEQ, or through EPAY (electronic payment through the web).

Mailed Payments:

Use the attached General Permit Payment Submittal Form. The application fee is submitted to a different address than the NOI. Read the General Permit Payment Submittal Form for further instructions, including the address to send the payment.

ePAY Electronic Payment: http://www.tceq.texas.gov/epay

When making the payment you must select Water Quality, and then select the fee category "General Permit Construction Storm Water Discharge NOI Application". You must include a copy of the payment voucher with your NOI. Your NOI will not be considered complete without the payment voucher.

TCEQ Contact List:

•	
Application – status and form questions:	512-239-3700, swpermit@tceq.texas.gov
Technical questions:	512-239-4671, swgp@tceq.texas.gov
Environmental Law Division:	512-239-0600
Records Management - obtain copies of forms:	512-239-0900
Reports from databases (as available):	512-239-DATA (3282)
Cashier's office:	512-239-0357 or 512-239-0187

Notice of Intent Process:

When your NOI is received by the program, the form will be processed as follows:

• Administrative Review: Each item on the form will be reviewed for a complete response. In addition, the operator's legal name must be verified with Texas Secretary of State as valid and active (if applicable). The address(es) on the form must be verified with the US Postal service as receiving regular mail delivery. Do not give an overnight/express mailing address.

- Notice of Deficiency: If an item is incomplete or not verifiable as indicated above, a notice of deficiency (NOD) will be mailed to the operator. The operator will have 30 days to respond to the NOD. The response will be reviewed for completeness.
- Acknowledgment of Coverage: An Acknowledgment Certificate will be mailed to the operator. This certificate acknowledges coverage under the general permit.

or

Denial of Coverage: If the operator fails to respond to the NOD or the response is inadequate, coverage under the general permit may be denied. If coverage is denied, the operator will be notified.

General Permit (Your Permit)

For NOIs submitted **electronically** through ePermits, provisional coverage under the general permit begins immediately following confirmation of receipt of the NOI form by the TCEQ.

For **paper** NOIs, provisional coverage under the general permit begins **7 days after a completed NOI is postmarked for delivery** to the TCEQ.

You should have a copy of your general permit when submitting your application. You may view and print your permit for which you are seeking coverage, on the TCEQ web site <u>http://www.tceq.texas.gov</u>. Search using keyword TXR150000.

Change in Operator

An authorization under the general permit is not transferable. If the operator of the regulated project or site changes, the present permittee must submit a Notice of Termination and the new operator must submit a Notice of Intent. The NOT and NOI must be submitted no later than 10 days prior to the change in Operator status.

TCEQ Central Registry Core Data Form

The Core Data Form has been incorporated into this form. Do not send a Core Data Form to TCEQ. After final acknowledgment of coverage under the general permit, the program will assign a Customer Number and Regulated Entity Number, if one has not already been assigned to this customer or site.

For existing customers and sites, you can find the Customer Number and Regulated Entity Number by entering the following web address into your internet browser. http://www15.tceq.texas.gov/crpub/ or you can contact the TCEQ Stormwater Processing Center at 512-239-3700 for assistance. On the website, you can search by your permit number, the Regulated Entity (RN) number, or the Customer Number (CN). If you do not know these numbers, you can select "Advanced Search" to search by permittee name, site address, etc.

The Customer (Permittee) is responsible for providing consistent information to the TCEQ, and for updating all CN and RN data for all authorizations as changes occur. For this permit, a Notice of Change form must be submitted to the program area.

INSTRUCTIONS FOR FILLING OUT THE NOI FORM

Renewal of General Permit. Dischargers holding active authorizations under the expired General Permit are required to submit a NOI to continue coverage. The existing permit number is required. If the permit number is not provided or has been terminated, expired, or denied, a new permit number will be issued.

Section 1. OPERATOR (APPLICANT)

a) Customer Number (CN)

TCEQ's Central Registry will assign each customer a number that begins with CN, followed by nine digits. **This is not a permit number, registration number, or license number**.

If the applicant is an existing TCEQ customer, the Customer Number is available at the following website: <u>http://www15.tceq.texas.gov/crpub/</u>. If the applicant is not an existing TCEQ customer, leave the space for CN blank.

b) Legal Name of Applicant

Provide the current legal name of the applicant. The name must be provided exactly as filed with the Texas Secretary of State (SOS), or on other legal documents forming the entity, as filed in the county. You may contact the SOS at 512-463-5555, for more information related to filing in Texas. If filed in the county, provide a copy of the legal documents showing the legal name.

c) Contact Information for the Applicant (Responsible Authority)

Provide information for the person signing the application in the Certification section. This person is also referred to as the Responsible Authority.

Provide a complete mailing address for receiving mail from the TCEQ. The mailing address must be recognized by the US Postal Service. You may verify the address on the following website: <u>https://tools.usps.com/go/ZipLookupAction!input.action</u>.

The phone number should provide contact to the applicant.

The fax number and e-mail address are optional and should correspond to the applicant.

d) Type of Customer (Entity Type)

Check only one box that identifies the type of entity. Use the descriptions below to identify the appropriate entity type. Note that the selected entity type also indicates the name that must be provided as an applicant for an authorization.

Individual

An individual is a customer who has not established a business, but conducts an activity that needs to be regulated by the TCEQ.

<u>Partnership</u>

A customer that is established as a partnership as defined by the Texas Secretary of State Office (TX SOS). If the customer is a 'General Partnership' or 'Joint Venture' filed in the county (not filed with TX SOS), the legal name of each partner forming the 'General Partnership' or 'Joint Venture' must be provided. Each 'legal entity' must apply as a co-applicant.

Trust or Estate

A trust and an estate are fiduciary relationships governing the trustee/executor with respect to the trust/estate property.

Sole Proprietorship (DBA)

A sole proprietorship is a customer that is owned by only one person and has not been incorporated. This business may:

- 1. be under the person's name
- 2. have its own name (doing business as or DBA)
- 3. have any number of employees.

If the customer is a Sole Proprietorship or DBA, the 'legal name' of the individual business 'owner' must be provided. The DBA name is not recognized as the 'legal name' of the entity. The DBA name may be used for the site name (regulated entity).

Corporation

A customer that meets all of these conditions:

- 1. is a legally incorporated entity under the laws of any state or country
- 2. is recognized as a corporation by the Texas Secretary of State
- 3. has proper operating authority to operate in Texas

The corporation's 'legal name' as filed with the Texas Secretary of State must be provided as applicant. An 'assumed' name of a corporation is not recognized as the 'legal name' of the entity.

Government

Federal, state, county, or city government (as appropriate)

The customer is either an agency of one of these levels of government or the governmental body itself. The government agency's 'legal name' must be provided as the applicant. A department name or other description of the organization is not recognized as the 'legal name'.

<u>Other</u>

This may include a utility district, water district, tribal government, college district, council of governments, or river authority. Provide the specific type of government.

e) Independent Entity

Check No if this customer is a subsidiary, part of a larger company, or is a governmental entity. Otherwise, check Yes.

f) Number of Employees

Check one box to show the number of employees for this customer's entire company, at all locations. This is not necessarily the number of employees at the site named in the application.

g) Customer Business Tax and Filing Numbers

These are required for Corporations and Limited Partnerships. These are not required for Individuals, Government, and Sole Proprietors.

State Franchise Tax ID Number

Corporations and limited liability companies that operate in Texas are issued a franchise tax identification number. If this customer is a corporation or limited liability company, enter the Tax ID number.

Federal Tax ID

All businesses, except for some small sole proprietors, individuals, or general partnerships should have a federal taxpayer identification number (TIN). Enter this number here. Use no prefixes, dashes, or hyphens. Sole proprietors, individuals, or general partnerships do not need to provide a federal tax ID.

TX SOS Charter (filing) Number

Corporations and Limited Partnerships required to register with the Texas Secretary of State are issued a charter or filing number. You may obtain further information by calling SOS at 512-463-5555.

DUNS Number

Most businesses have a DUNS (Data Universal Numbering System) number issued by Dun and Bradstreet Corp. If this customer has one, enter it here.

Section 2. APPLICATION CONTACT

Provide the name and contact information for the person that TCEQ can contact for additional information regarding this application.

Section 3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

a) Regulated Entity Number (RN)

The RN is issued by TCEQ's Central Registry to sites where an activity is regulated by TCEQ. This is not a permit number, registration number, or license number. Search TCEQ's Central Registry to see if the site has an assigned RN at http://www15.tceq.texas.gov/crpub/. If this regulated entity has not been assigned an RN, leave this space blank.

If the site of your business is part of a larger business site, an RN may already be assigned for the larger site. Use the RN assigned for the larger site.

If the site is found, provide the assigned RN and provide the information for the site to be authorized through this application. The site information for this authorization may vary from the larger site information.

An example is a chemical plant where a unit is owned or operated by a separate corporation that is accessible by the same physical address of your unit or facility. Other examples include industrial parks identified by one common address but different corporations have control of defined areas within the site. In both cases, an RN would be assigned for the physical address location and the permitted sites would be identified separately under the same RN.

b) Name of the Project or Site

Provide the name of the site or project as known by the public in the area where the site is located. The name you provide on this application will be used in the TCEQ Central Registry as the Regulated Entity name.

c) Description of Activity Regulated

In your own words, briefly describe the primary business that you are doing that requires this authorization. Do not repeat the SIC Code description.

d) County

Provide the name of the county where the site or project is located. If the site or project is located in more than one county, provide the county names as secondary.

e) Latitude and Longitude

Enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. For help obtaining the latitude and longitude, go to: <u>http://www.tceq.texas.gov/gis/sqmaview.html</u>.

f) Site Address/Location

If a site has an address that includes a street number and street name, enter the complete address for the site in *Section A*. If the physical address is not recognized as a USPS delivery address, you may need to validate the address with your local police (911 service) or through an online map site used to locate a site. Please confirm this to be a complete and valid address. Do not use a rural route or post office box for a site location.

If a site does not have an address that includes a street number and street name, provide a complete written location description in *Section B*. For example: "The site is located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1."

Provide the city (or nearest city) and zip code of the site location.

Section 4. GENERAL CHARACTERISTICS

a) Indian Country Lands

If your site is located on Indian Country Lands, the TCEQ does not have authority to process your application. You must obtain authorization through EPA Region 6, Dallas. Do not submit this form to TCEQ.

b) Construction activity associated with facility associated with exploration, development, or production of oil, gas, or geothermal resources

If your activity is associated with oil and gas exploration, development, or production, you may be under jurisdiction of the Railroad Commission of Texas (RRC) and may need to obtain authorization from EPA Region 6.

Construction activities associated with a facility related to oil, gas or geothermal resources may include the construction of a well site; treatment or storage facility; underground hydrocarbon or natural gas storage facility; reclamation plant; gas processing facility; compressor station; terminal facility where crude oil is stored prior to refining and at which refined products are stored solely for use at the facility; a

carbon dioxide geologic storage facility; and a gathering, transmission, or distribution pipeline that will transport crude oil or natural gas, including natural gas liquids, prior to refining of such oil or the use of the natural gas in any manufacturing process or as a residential or industrial fuel.

Where required by federal law, discharges of stormwater associated with construction activities under the RRC's jurisdiction must be authorized by the EPA and the RRC, as applicable. Activities under RRC jurisdiction include construction of a facility that, when completed, would be associated with the exploration, development, or production of oil or gas or geothermal resources, such as a well site; treatment or storage facility; underground hydrocarbon or natural gas storage facility; reclamation plant; gas processing facility; compressor station; terminal facility where crude oil is stored prior to refining and at which refined products are stored solely for use at the facility; a carbon dioxide geologic storage facility under the jurisdiction of the RRC; and a gathering, transmission, or distribution pipeline that will transport crude oil or natural gas, including natural gas liquids, prior to refining of such oil or the use of the natural gas in any manufacturing process or as a residential or industrial fuel. The RRC also has jurisdiction over stormwater from land disturbance associated with a site survey that is conducted prior to construction of a facility that would be regulated by the RRC. Under 33 U.S.C. §1342(l)(2) and §1362(24), EPA cannot require a permit for discharges of stormwater from field activities or operations associated with {oil and gas} exploration, production, processing, or treatment operations, or transmission facilities, including activities necessary to prepare a site for drilling and for the movement and placement of drilling equipment, whether or not such field activities or operations may be considered to be construction activities unless the discharge is contaminated by contact with any overburden, raw material, intermediate product, finished product, byproduct, or waste product located on the site of the facility. Under §3.8 of this title (relating to Water Protection), the RRC prohibits operators from causing or allowing pollution of surface or subsurface water. Operators are encouraged to implement and maintain best management practices (BMPs) to minimize discharges of pollutants, including sediment, in stormwater during construction activities to help ensure protection of surface water quality during storm events.

For more information about the jurisdictions of the RRC and the TCEQ, read the Memorandum of Understanding (MOU) between the RRC and TCEQ at 16 Texas Administrative Code, Part 1, Chapter 3, Rule 3.30, by entering the following link into an internet browser:

http://texreg.sos.state.tx.us/public/readtac\$ext.TacPage?sl=R&app=9&p_dir=&p_rloc= &p_tloc=&p_ploc=&pg=1&p_tac=&ti=16&pt=1&ch=3&rl=30 or contact the TCEQ Stormwater Team at 512-239-4671 for additional information.

c) Primary Standard Industrial Classification (SIC) Code

Provide the SIC Code that best describes the construction activity being conducted at this site.

Common SIC Codes related to construction activities include:

- 1521 Construction of Single Family Homes
- 1522 Construction of Residential Buildings Other than Single Family Homes
- 1541 Construction of Industrial Buildings and Warehouses

- 1542 Construction of Non-residential Buildings, other than Industrial Buildings and Warehouses
- 1611 Highway and Street Construction, except Highway Construction
- 1622 Bridge, Tunnel, and Elevated Highway Construction
- 1623 Water, Sewer, Pipeline and Communications, and Power Line Construction

For help with SIC Codes, enter the following link into your internet browser: <u>http://www.osha.gov/pls/imis/sicsearch.html</u> or you can contact the TCEQ Small Business and Local Government Assistance Section at 800-447-2827 for assistance.

d) Secondary SIC Code

Secondary SIC Code(s) may be provided. Leave this blank if not applicable. For help with SIC Codes, enter the following link into your internet browser: <u>http://www.osha.gov/pls/imis/sicsearch.html</u> or you can contact the TCEQ Small Business and Environmental Assistance Section at 800-447-2827 for assistance.

e) Total Number of Acres Disturbed

Provide the approximate number of acres that the construction site will disturb. Construction activities that disturb less than one acre, unless they are part of a larger common plan that disturbs more than one acre, do not require permit coverage. Construction activities that disturb between one and five acres, unless they are part of a common plan that disturbs more than five acres, do not require submission of an NOI. Therefore, the estimated area of land disturbed should not be less than five, unless the project is part of a larger common plan that disturbs five or more acres. Disturbed means any clearing, grading, excavating, or other similar activities.

If you have any questions about this item, please contact the stormwater technical staff by phone at 512-239-4671 or by email at swgp@tceq.texas.gov.

f) Common Plan of Development

Construction activities that disturb less than five acres do not require submission of an NOI unless they are part of a common plan of development or for sale where the area disturbed is five or more acres. Therefore, the estimated area of land disturbed should not be less than five, unless the project is part of a larger common plan that disturbs five or more acres. Disturbed means any clearing, grading, excavating, or other similar activities.

For more information on what a common plan of development is, refer to the definition of "Common Plan of Development" in the Definitions section of the general permit or enter the following link into your internet browser: www.tceq.texas.gov/permitting/stormwater/common_plan_of_development_steps.html

For further information, go to the TCEQ stormwater construction webpage enter the following link into your internet browser: <u>www.tceq.texas.gov/goto/construction</u> and search for "Additional Guidance and Quick Links". If you have any further questions about the Common Plan of Development you can contact the TCEQ Stormwater Team at 512-239-4671 or the TCEQ Small Business and Environmental Assistance at 800-447-2827.

g) Estimated Start Date of the Project

This is the date that any construction activity or construction support activity is initiated at the site. If renewing the permit provide the original start date of when construction activity for this project began.

h) Estimated End Date of the Project

This is the date that any construction activity or construction support activity will end and final stabilization will be achieved at the site.

i) Will concrete truck washout be performed at the site?

Indicate if you expect that operators of concrete trucks will washout concrete trucks at the construction site.

j) Identify the water body(s) receiving stormwater runoff

The stormwater may be discharged directly to a receiving stream or through a MS4 from your site. It eventually reaches a receiving water body such as a local stream or lake, possibly via a drainage ditch. You must provide the name of the water body that receives the discharge from the site (a local stream or lake).

If your site has more than one outfall you need to include the name of the first water body for each outfall, if they are different.

k) Identify the segment number(s) of the classified water body(s)

Identify the classified segment number(s) receiving a discharge directly or indirectly. Enter the following link into your internet browser to find the segment number of the classified water body where stormwater will flow from the site: <u>www.tceq.texas.gov/waterquality/monitoring/viewer.html</u> or by contacting the TCEQ Water Quality Division at (512) 239-4671 for assistance.

You may also find the segment number in TCEQ publication GI-316 by entering the following link into your internet browser: <u>www.tceq.texas.gov/publications/gi/gi-316</u> or by contacting the TCEQ Water Quality Division at (512) 239-4671 for assistance.

If the discharge is into an unclassified receiving water and then crosses state lines prior to entering a classified segment, select the appropriate watershed:

- 0100 (Canadian River Basin)
- 0200 (Red River Basin)
- 0300 (Sulfur River Basin)
- 0400 (Cypress Creek Basin)
- 0500 (Sabine River Basin)

Call the Water Quality Assessments section at 512-239-4671 for further assistance.

l) Discharge into MS4 - Identify the MS4 Operator

The discharge may initially be into a municipal separate storm sewer system (MS4). If the stormwater discharge is into an MS4, provide the name of the entity that operates the MS4 where the stormwater discharges. An MS4 operator is often a city, town, county, or utility district, but possibly can be another form of government. Please note that the Construction General Permit requires the Operator to supply the MS4 with a copy of the NOI submitted to TCEQ. For assistance, you may call the technical staff at 512-239-4671.

m) Discharges to the Edwards Aquifer Recharge Zone and Certification

The general permit requires the approved Contributing Zone Plan or Water Pollution Abatement Plan to be included or referenced as a part of the Stormwater Pollution Prevention Plan.

See maps on the TCEQ website to determine if the site is located within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer by entering the following link into an internet browser: <u>www.tceq.texas.gov/field/eapp/viewer.html</u> or by contacting the TCEQ Water Quality Division at 512-239-4671 for assistance.

If the discharge or potential discharge is within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer, a site-specific authorization approved by the Executive Director under the Edwards Aquifer Protection Program (30 TAC Chapter 213) is required before construction can begin.

For questions regarding the Edward's Aquifer Protection Program, contact the appropriate TCEQ Regional Office. For projects in Hays, Travis and Williamson Counties: Austin Regional Office, 12100 Park 35 Circle, Austin, TX 78753, 512-339-2929. For Projects in Bexar, Comal, Kinney, Medina and Uvalde Counties: TCEQ San Antonio Regional Office, 14250 Judson Rd., San Antonio, TX 78233-4480, 210-490-3096.

Section 5. NOI CERTIFICATION

Note: Failure to indicate Yes to all of the certification items may result in denial of coverage under the general permit.

a) Certification of Understanding the Terms and Conditions of Construction General Permit (TXR1 50000)

Provisional coverage under the Construction General Permit (TXR150000) begins 7 days after the completed paper NOI is postmarked for delivery to the TCEQ. Electronic applications submitted through ePermits have immediate provisional coverage. You must obtain a copy and read the Construction General Permit before submitting your application. You may view and print the Construction General Permit for which you are seeking coverage at the TCEQ web site by entering the following link into an internet browser: www.tceq.texas.gov/goto/construction or you may contact the TCEQ Stormwater processing Center at 512-239-3700 for assistance.

b) Certification of Legal Name

The full legal name of the applicant as authorized to do business in Texas is required. The name must be provided exactly as filed with the Texas Secretary of State (SOS), or on other legal documents forming the entity, that is filed in the county where doing business. You may contact the SOS at 512-463 5555, for more information related to filing in Texas.

c) Understanding of Notice of Termination

A permittee shall terminate coverage under the Construction General Permit through the submittal of a NOT when the operator of the facility changes, final stabilization has been reached, the discharge becomes authorized under an individual permit, or the construction activity never began at this site.

d) Certification of Stormwater Pollution Prevention Plan

The SWP3 identifies the areas and activities that could produce contaminated runoff at your site and then tells how you will ensure that this contamination is mitigated. For example, in describing your mitigation measures, your site's plan might identify the devices that collect and filter stormwater, tell how those devices are to be maintained, and tell how frequently that maintenance is to be carried out. You must develop this plan in accordance with the TCEQ general permit requirements. This plan must be developed and implemented before you complete this NOI. The SWP3 must be available for a TCEQ investigator to review on request.

Section 6. APPLICANT CERTIFICATION SIGNATURE

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code (TAC) §305.44.

If you are a corporation:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(1) (see below). According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

If you are a municipality or other government entity:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(3) (see below). According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statute(s) under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a)(3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer may be requested by the TCEQ.

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the TCEQ's Environmental Law Division at 512-239-0600.

30 Texas Administrative Code

§305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the

corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

Texas Commission on Environmental Quality General Permit Payment Submittal Form

Use this form to submit your Application Fee only if you are mailing your payment.

Instructions:

- Complete items 1 through 5 below:
- Staple your check in the space provided at the bottom of this document.
- Do not mail this form with your NOI form.
- Do not mail this form to the same address as your NOI.

Mail this form and your check to either of the following:

By Regular U.S. Mail	By Overnight or Express Mail
Texas Commission on Environmental Quality	Texas Commission on Environmental Quality
Financial Administration Division	Financial Administration Division
Cashier's Office, MC-214	Cashier's Office, MC-214
P.O. Box 13088	12100 Park 35 Circle
Austin, TX 78711-3088	Austin, TX 78753

Fee Code: GPA General Permit: TXR150000

- 1. Check or Money Order No:
- 2. Amount of Check/Money Order:
- 3. Date of Check or Money Order.
- 4. Name on Check or Money Order.
- 5. NOI Information:

If the check is for more than one NOI, list each Project or Site (RE) Name and Physical Address exactly as provided on the NOI. **Do not submit a copy of the NOI with this form, as it could cause duplicate permit application entries!**


If there is not enough space on the form to list all of the projects or sites the authorization will cover, then attach a list of the additional sites.

Project/Site (RE) Name:

Project/Site (RE) Physical Address:

Staple the check or money order to this form in this space.

TCEQ Office Use Only Permit No.: RN: CN: Region:

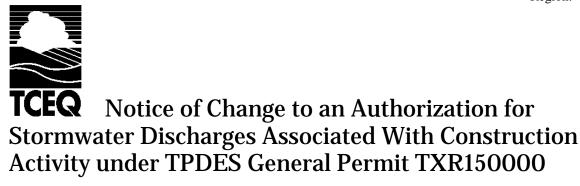

IMPORTANT – Please read the following information and <u>INSTRUCTIONS</u> before filling out this form.

ePERMITS: Sign up now for online NOC: <u>https://www3.tceq.texas.gov/steers/index.cfm</u>

This form will be returned for any of the following reasons:

- 1) The permit number is not provided, is invalid, or is no longer active,
- 2) Wet ink signature of person meeting signatory requirements is not provided,
- 3) The current permittee is not the applicant, and;
- 4) A requested change in operator name is not a legal name change.

This form cannot be used for a change in operator. Refer to your general permit for information.

What is the permit number of the authorization to be changed?

TXR15_____ or TXRCW_____

1) APPLICANT INFORMATION

- a) What is the full Legal Name of the current operator as on the authorization?
- **b)** What is the Customer Number (CN) assigned to this operator? You may search for your CN at: <u>http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch</u>

CN_____

c) What is the name and title of the person signing the application? (The person must be an executive official meeting signatory requirements in TAC 305.44(a).)

Prefix (Mr. Ms. Miss):	_
First/Last Name:	Suffix:
Title:	Credential:

d) What is the Regulated Entity Reference Number (RN) assigned to this site?

RN_____

2) APPLICATION CONTACT

If TCEQ needs additional information regarding this application, who should be contacted?

Prefix (Mr. Ms. Miss):		
First/Last Name:		Suffix:
Title:		
Organization Name:		
Phone Number:	Extension:	Fax Number:
E-mail Address:		
Mailing Address:		
Internal Routing (Mail Code, Etc.):		
City:	State:	ZIP Code:
Mailing Information if outside USA:		
Territory:	Country Code:	Postal Code:

3) REQUESTED CHANGE TO PERMITTED INFORMATION

What information has changed or needs to be corrected? Check one or more of the following options and enter the new information below.

Operator legal name change with Texas Secretary of State (TX SOS).

Fill out sections a) and b) as applicable.

Note: Permits are not transferable. If a change in entity has occurred, this NOC will not be processed.

Address and contact information for the operator. Fill out section b).

Site Information (Regulated Entity). Fill out section c).

Note: Permits under a general permit are site specific. If a change in site location has occurred, this NOC will not be processed.

General characteristics relating to the regulated activity. Fill out section d).

- a) Operator Legal Name Change
 - i. What is the NEW active Legal Name with TX SOS or on other legal document? New Legal Name: ______
 - ii. What is the TX SOS Filing Number for us to confirm this official name change? This is only applicable to Limited Partnerships or Corporations. TX SOS Filing number: _____
- **b)** Address and Contact Information for Operator Verify mailing addresses with USPS: <u>http://zip4.usps.com/zip4/welcome.jsp</u>.

Prefix (Mr. Ms. Miss):	
First/Last Name:	Suffix:
Title:	Credential:
Organization Name:	

Ph	one Number:	Extension:	Fax Number:
E- :	mail Address:		
Ma	ailing Address:		
In	ternal Routing (Mail Code, Et	tc.):	
Cit	ty:	State:	ZIP Code:
Ma	ailing Information if outside I	USA:	
Te	rritory:	Country Code:	Postal Code:
c) Re	gulated Entity (Site) Informa	tion Correction	
i.	Is this a change to the locati Yes This NOC will not No Continue with NO	be processed since the aut	y? horizations are site specific.
ii.	Corrected Name of Project of	or Site:	
iii.	Updated Physical Address (Street Number:		
	City:	State:	ZIP Code:
iv.	Corrected location access de name):	escription, if no physical ad	ddress (street number/street
v.	Corrected Latitude:	N	
vi.	Corrected Longitude:	W	
vii.	Corrected County (Counties	if >1):	
Ide	ange in General Characterist entify the specific change and eded, please reference it belo	l provide the updates infor	orm mation. If an attachment is

4) OPERATOR CERTIFICATION

I, _

Typed or printed name

Title

certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code 305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature:

Date:

(Use blue ink)

Notice of Change (NOC) for Authorizations for Stormwater Discharges Associated with Construction Activity under TPDES General Permit (TXR150000)

General Information and Instructions

GENERAL INFORMATION

Where to Send the NOC:	
BY REGULAR U.S. MAIL	BY OVERNIGHT/EXPRESS MAIL
Texas Commission on Environmental Quality	Texas Commission on Environmental Quality
Stormwater Processing Center (MC228)	Stormwater Processing Center (MC228)
P.O. Box 13087	12100 Park 35 Circle
Austin, Texas 78711-3087	Austin, TX 78753
TCEO Contact list	

Application – status and form questions: Technical questions: Environmental Law Division: Records Management - obtain copies of forms: Reports from databases (as available): Cashier's office:

512/239-3700, swpermit@tceq.texas.gov 512/239-4671, swgp@tceq.texas.gov 512/239-0600 512/239-0900 512/239-DATA (3282) 512/239-0357 or 512/239-0187

NOC Process:

1. Administrative Review: The form will be reviewed to ensure the request is from the permittee (operator) on the authorization, the permit is active and initial coverage was acknowledged. Each item on the form will be reviewed for a complete response. In addition, the operator's legal name change must be verified with Texas Secretary of State (if applicable). The address(s) on the form must be verified with the US Postal Service (USPS) as an address receiving regular mail delivery. Never give an overnight/express mailing address. If an item is incomplete or not verifiable, the operator may be notified by letter, phone call or email. In some instances as noted at the beginning of the form, the request may simply be returned.

2. NOC Confirmation: An updated Acknowledgment Certificate will be mailed to the operator <u>only</u> if the NOC is to change information provided on the acknowledgment certificate. The original coverage effective date will not change.

General Permit (Your Permit) and Forms

You may view and print your general permit on the TCEQ web site <u>http://www.tceq.texas.gov</u>. Search using key word TXR150000. General Permit Forms (NOI, Waiver, NOT, and NOC) and instructions are available on the TCEQ web site <u>http://www.tceq.texas.gov</u>.

Change in Operator

An authorization under the general permit is not transferable. If the operator of the regulated entity changes, the present permittee must submit a NOT and the new operator must submit a NOI. The NOI must be submitted not later than 10 days prior to the change in Operator status. Note that the NOT is effective on the postmarked date. It may be necessary to not terminate the existing permit until coverage by the new entity is confirmed.

TCEQ Central Registry Core Data Form

The Core Data Form has been incorporated into this form. Do not send a Core Data Form to TCEQ. You can find the information on the Central Registry web site at <u>http://www12.tceq.texas.gov/crpub/index.cfm</u>.

You can search by the Regulated Entity (RN), Customer Number (CN) or Name (Permittee), or by your permit number under the search field labeled "Additional ID".

The Customer (Permittee) is responsible for providing consistent information to the TCEQ, and for updating all CN and RN data for all associated authorizations as changes occur. For General Permits, a Notice of Change form must be submitted to the program area for approval to update the CN and RN data in central registry.

INSTRUCTIONS FOR FILLING OUT THE NOC FORM

1) APPLICANT INFORMATION

a) Legal Name

Provide the current legal name of the permittee, as on the permit.

b) Customer Number (CN)

TCEQ's Central Registry will assign each customer a number that begins with CN, followed by nine digits. You may search for your CN at: <u>http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch</u>.

If the name(s) provided do not match the current permittee name(s), this form will be returned. It is the responsibility of the permittee(s) to comply with the general permit.

Note: If a change is being made to the CN and the CN has other TCEQ authorization types, it is the entity's responsibility to update those authorizations at the same time. If an authorization has been cancelled or terminated, the name cannot be changed on the permit. Because of this, a new CN may be issued for the new name.

c) Person Signing this Application

Provide the name and title of the person signing the application. The person must be an executive official meeting signatory requirements in TAC §305.44.

d) Regulated Entity Reference Number (RN)

This is a number issued by TCEQ's Central Registry to sites (a location where a regulated activity occurs) regulated by TCEQ. This is not a permit number, registration number, or license number. Search for your

RN: http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=regent.RNSearch.

If the site has changed or the information provided indicates a new location, this form will be returned. It is the responsibility of the permittee to comply with the general permit.

2) APPLICATION CONTACT

Provide the name, title and contact information of the person that TCEQ can contact for additional information regarding this application.

3) REQUESTED CHANGE TO PERMITTED INFORMATION

Check one or more of the available options indicating the information in the form that is to be updated. Provide the updated information in 3 a) for Legal Name Change, 3 b) for Address and Contact Information Change, 3 c) for Regulated Entity Site Information Change, or 3 d) for General Characteristics Change, as applicable.

a) Legal Name Change

Provide the new legal name. If the entity is a Limited Partnership or Corporation, the name change must be verifiable with Texas Secretary of State. The TX SOS filing number must be provided to verify only a name change occurred. You may contact the SOS at (512)463 5555, for more information related to filing in Texas. If filed in the county where doing business, provide a copy of the legal documents showing the legal name change.

Legal name changes of a Corporation and Limited Partnership will be verified with Texas Secretary of State. If the entity is filed as a new entity with a new filing number, then the change cannot be made through a NOC. The permits are not transferable. If the operator changes, the old entity must terminate their permit and the new entity must submit a form for a new permit.

b) Address and Contact Information Change

Indicate the type of address and contact information for the operator that has changed from the original NOI or last NOC submitted to TCEQ.

Verify mailing addresses with USPS <u>http://zip4.usps.com/zip4/welcome.jsp</u> for regular mail delivery (not overnight express mail). If you find that the address is not verifiable please indicate the address is used by the USPS for regular mail delivery. Failure to provide a valid mailing address will delay or prohibit us from updating the permit.

Please note that address updates relating to a general permit authorization can ONLY be made through a Notice of Change. Address changes submitted through any other form cannot be processed.

c) Regulated Entity Site Information Change

The NOC form is only for use to update or correct information submitted on the original application or last NOC for the authorization. The authorization under a general permit is site specific. If this change is related to a new location, a Notice of Change will not be processed.

Provide the updated site name, updated site addresses, corrected latitude and longitude, and/or corrected county, as applicable to your NOC request. A new physical address for an existing location is usually the result of a newly assigned 911 address for emergencies.

If providing a corrected latitude and longitude, enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. For help obtaining the latitude and longitude, go to <u>http://www.tceq.texas.gov/gis/sqmaview.html</u> or <u>http://nationalmap.gov/ustopo/</u>.

d) Change in General Characteristics Provided on Original Form

Describe any other change that is not addressed through any question in this section of the application.

4) OPERATOR CERTIFICATION

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code (TAC) §305.44.

IF YOU ARE A CORPORATION:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a) (see below). According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

IF YOU ARE A MUNICIPALITY OR OTHER GOVERNMENT ENTITY:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a) (see below). According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statute(s) under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a)(3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the administrative code.

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the Texas Commission on Environmental Quality's Environmental Law Division at 512/239-0600.


30 Texas Administrative Code §305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

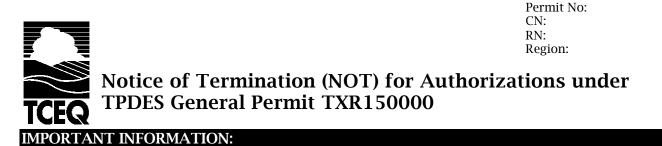

Please read and use the General Information and Instructions prior to filling out each question in the form.

Effective September 1, 2018, this paper form must be submitted to TCEQ with a completed electronic reporting waiver form (TCEQ-20754).

ePermits: This form is available on our online permitting system. Sign up for online permitting at: <u>https://www3.tceq.texas.gov/steers/</u>

What is the permit number to be terminated?

TXR15 TXRCW

Section 1. OPERATOR (Permittee)

- a) What is the Customer Number (CN) issued to this entity? CN
- b) What is the Legal Name of the current permittee?
- c) Provide the contact information for the Operator (Responsible Authority).

Prefix (Mr. Ms. or Miss):

First and Last Name: Suffix:

Title: Credentials:

Phone Number: Fax Number:

Email:

Mailing Address:

City, State, and Zip Code:

Country Mailing Information, if outside USA:

Section 2. APPLICATION CONTACT

This is the person TCEQ will contact if additional information is needed regarding this application.

Is the application contact the same as the permittee identified above?

 \Box Yes, go to Section 3.

□ No, complete section below

Prefix (Mr. Ms. or Miss):

TCEQ Office Use Only

First and Last Name: Suffix: Title: Credentials: Phone Number: Fax Number: Email: Mailing Address: City, State, and Zip Code: Country Mailing Information, if outside USA:

Section 3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

- a) TCEQ issued RE Reference Number (RN): RN
- b) Name of project or site as known by the local community:
- c) County, or counties if more than 1:
- d) Latitude: Longitude:
- e) Site Address/Location:

If the site has a physical address such as 12100 Park 35 Circle, Austin, TX 78753, complete Section 3A.

If the site does not have a physical address, provide a location description in Section 3B. Example: located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1.

Section 3A: Physical Address of Project or Site:

Street Number and Name:

City, State, and Zip Code:

Section 3B: Site Location Description:

Location description:

City where the site is located or, if not in a city, what is the nearest city: Zip Code where the site is located:

Section 4. REASON FOR TERMINATION

Check the reason for termination:

- Final stabilization has been achieved on all portions of the site that are the responsibility of the Operator and all silt fences and other temporary erosion controls have been removed, or scheduled for removal as defined in the SWP3.
- Another permitted Operator has assumed control over all areas of the site that have not been finally stabilized, and temporary erosion controls that have been identified in the SWP3 have been transferred to the new Operator.
- □ The discharge is now authorized under an alternate TPDES permit.
- □ The activity never began at this site that is regulated under the general permit.

Signatory Name:

Signatory Title:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code §305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature (use blue ink): Date:			
		Deter	
	ionanire ilice hille inkly	Liate	
	ignature (use blue mik).	Duit.	

Instructions for Notice of Termination (NOT) for Authorizations under TPDES General Permit TXR150000

GENERAL INFORMATION	
Where to Send the Notice of Termination (NO	Γ):
BY REGULAR U.S. MAIL: Texas Commission on Environmental Quality Stormwater Processing Center (MC-228) P.O. Box 13087 Austin, Texas 78711-3087	BY OVERNIGHT/EXPRESS MAIL: Texas Commission on Environmental Quality Stormwater Processing Center (MC-228) 12100 Park 35 Circle Austin, TX 78753
TCEQ Contact List:	
Application status and form questions: Technical questions: Environmental Law Division: Records Management - obtain copies of forms: Reports from databases (as available): Cashier's office:	512-239-3700, <u>swpermit@tceq.texas.gov</u> 512-239-4671, <u>swgp@tceq.texas.gov</u> 512-239-0600 512-239-0900 512-239-DATA (3282) 512-239-0357 or 512-239-0187

Notice of Termination Process:

A Notice of Termination is effective on the date postmarked for delivery to TCEQ.

When your NOT is received by the program, the form will be processed as follows:

- 1) Administrative Review: The form will be reviewed to confirm the following:
 - the permit number is provided;
 - the permit is active and has been approved;
 - the entity terminating the permit is the current permittee;
 - the site information matches the original permit record; and
 - the form has the required original signature with title and date.
- 2) Notice of Deficiency: If an item is incomplete or not verifiable as indicated above, a phone call will be made to the applicant to clear the deficiency. A letter will not be sent to the permittee if unable to process the form.
- 3) Confirmation of Termination: A Notice of Termination Confirmation letter will be mailed to the operator.

Change in Operator:

An authorization under the general permit is not transferable. If the operator of the regulated entity changes, the present permittee must submit a Notice of Termination and the new operator must submit a Notice of Intent. The NOT and NOI must be submitted not later than 10 days prior to the change in Operator status.

INSTRUCTIONS FOR FILLING OUT THE FORM

The majority of permit information related to the current operator and regulated entity are available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.

Section 1. Operator (Current Permittee):

a) Customer Number (CN)

TCEQ's Central Registry assigns each customer a number that begins with CN, followed by nine digits. This is not a permit number, registration number, or license number. The Customer Number, for the current permittee, is available at the following website: http://www2.tceq.texas.gov/wq_dpa/index.cfm.

b) Legal Name of Operator

The operator must be the same entity as previously submitted on the original Notice of Intent for the permit number provided. The current operator name, as provided on the current authorization, is available at the following website: http://www2.tceq.texas.gov/wq_dpa/index.cfm.

c) Contact Information for the Operator (Responsible Authority) Provide information for person signing the NOT application in the Certification section. This person is also referred to as the Responsible Authority.

Provide a complete mailing address for receiving mail from the TCEQ. Update the address if different than previously submitted for the Notice of Intent or Notice of Change. The mailing address must be recognized by the US Postal Service. You may verify the address on the following website: <u>https://tools.usps.com/go/ZipLookupAction!input.action.</u>

The phone number should provide contact to the operator.

The fax number and e-mail address are optional and should correspond to the operator.

Section 2. Application Contact:

Provide the name, title and contact information of the person that TCEQ can contact for additional information regarding this application.

Section 3. Regulated Entity (RE) Information on Project or Site:

- a) Regulated Entity Reference Number (RN)
 A number issued by TCEQ's Central Registry to sites where an activity regulated by TCEQ.
 This is not a permit number, registration number, or license number. The Regulated Entity Reference Number is available at the following website:
 <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.
- b) Name of the Project or Site Provide the name of the site as known by the public in the area where the site is located.
- c) County Identify the county or counties in which the regulated entity is located.
- d) Latitude and Longitude

Enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. The latitude and longitude as provided on the current authorization is available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.

e) Site/Project (RE) Physical Address/Location Information The physical address/location information, as provided on the current authorization, is available at the following website: <u>http://www2.tceq.texas.gov/wq_dpa/index.cfm</u>.

- Section 3A. If a site has an address that includes a street number and street name, enter the complete address for the site. If the physical address is not recognized as a USPS delivery address, you may need to validate the address with your local police (911 service) or through an online map site used to locate the site. Please confirm this to be a complete and valid address. Do not use a rural route or post office box for a site location.
- Section 3B. If a site does not have an address that includes a street number and street name, provide a complete written location description. For example: "The site is located on the north side of FM 123, 2 miles west of the intersection of FM 123 and Highway 1."

Provide the city (or nearest city) and Zip Code of the facility location.

Section 4. Reason for Termination:

The Notice of Termination form is only for use to terminate the authorization (permit). The Permittee must indicate the specific reason for terminating by checking one of the options. If the reason is not listed then provide an attachment that explains the reason for termination.

Please read your general permit carefully to determine when to terminate your permit. Permits will not be reactivated after submitting a termination form. The termination is effective on the date postmarked for delivery to TCEQ.

Section 5. Certification:

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code §305.44.

IF YOU ARE A CORPORATION:

The regulation that controls who may sign an application form is 30 Texas Administrative Code §305.44(a), which is provided below. According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

IF YOU ARE A MUNICIPALITY OR OTHER GOVERNMENT ENTITY:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a), which is provided below. According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statutes under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a) (3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer as required by the

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the Texas Commission on Environmental Quality's Environmental Law Division at 512-239-0600.

30 Texas Administrative Code §305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

Agent Authorization Form

For Required Signature Edwards Aquifer Protection Program Relating to 30 TAC Chapter 213 Effective June 1, 1999

I	L. Michael Cox	
	Print Name	,
	Vice President_	,
	Title - Owner/President/Other	
of	JDS RR, LLC Corporation/Partnership/Entity Name	,
have authorized	Alex Granados, P.E. Print Name of Agent/Engineer	
of	Kimley-Horn and Associates, Inc. Print Name of Firm	

to represent and act on the behalf of the above named Corporation, Partnership, or Entity for the purpose of preparing and submitting this plan application to the Texas Commission on Environmental Quality (TCEQ) for the review and approval consideration of regulated activities.

I also understand that:

- 1. The applicant is responsible for compliance with 30 Texas Administrative Code Chapter 213 and any condition of the TCEQ's approval letter. The TCEQ is authorized to assess administrative penalties of up to \$10,000 per day per violation.
- 2. For those submitting an application who are not the property owner, but who have the right to control and possess the property, additional authorization is required from the owner.
- 3. Application fees are due and payable at the time the application is submitted. The application fee must be sent to the TCEQ cashier or to the appropriate regional office. The application will not be considered until the correct fee is received by the commission.
- 4. A notarized copy of the Agent Authorization Form must be provided for the person preparing the application, and this form must accompany the completed application.
- 5. No person shall commence any regulated activity on the Edwards Aquifer Recharge Zone, Contributing Zone or Transition Zone until the appropriate application for the activity has been filed with and approved by the Executive Director.


SIGNATURE PAGE: Applicant's Signature

THE STATE OF TEXAS §

County of Harris §

BEFORE ME, the undersigned authority, on this day personally appeared <u>L. Michael Cox</u> known to me to be the person whose name is subscribed to the foregoing instrument, and acknowledged to me that (s)he executed same for the purpose and consideration therein expressed.

GIVEN under my hand and seal of office on this <u>25th</u> day of July 2023.



Olaria Elaine Kine NOTARY PUBLIC

Diana Elaine Pine Typed or Printed Name of Notary

MY COMMISSION EXPIRES: October 9, 2025

Application Fee Form

Texas Commission on Environment Name of Proposed Regulated Entity: <u>N</u> Regulated Entity Location: <u>Southwest</u> Name of Customer: J <u>DS RR, LLC</u> Corr Phone: (512) 496-4070 Customer Ref Regulated Entity Reference Number (i	<u>Volina Phase 2A</u> of Ronald Reagan Blvd. ar itact Person: <u>L.Michael Co</u> ference Number (if issued)	x	unty, TX
Austin Regional Office (3373)	T Travia		
Hays San Antonio Regional Office (3362)	Travis	🖾 Willi	amson
		[]	
☐ Bexar ☐ Comal	Medina Kinney	🗌 Uva	lae
Application fees must be paid by chec Environmental Quality. Your cancel your fee payment. This payment is b	ed check will serve as yo	ey order, payable to the T ur receipt. This form m	Fexas Commission on ust be submitted with
 Austin Regional Office Mailed to: TCEQ - Cashier Revenues Section Mail Code 214 P.O. Box 13088 Austin TX 20214 2020 		San Antonio Regional Of nt Delivery to: TCEQ - Ca 12100 Park 35 Circle Building A, 3rd Floor Austin, TX 78753	
Austin, TX 78711-3088 (512)239-0357 Site Location (Check All That Apply):			
Recharge Zone	Contributing Zone	🗌 Tran	sition Zone
Type of Pla	n	Size	Fee Due
Water Pollution Abatement Plan, One Single Family Residential Dwel		N/A Acres	\$0
Water Pollution Abatement Plan, Multiple Single Family Residential a		52.20 Acres	\$ 6,500
Water Pollution Abatement Plan, Non-residential	Contributing Zone Plan:	N/A Acres	\$0
Sewage Collection System		N/A L.F.	\$ 0
Lift Stations without sewer lines		N/A Acres	\$0
Underground or Aboveground Stora	ge Tank Facility	N/A Tanks	\$0
Piping System(s)(only)		N/A Each	\$0
Exception		N/A Each	\$0
Extension of Time		N/A Each	\$ 0

Signature: Alejandro E. Granda Rico

Date: June 13, 2023 Application Fee Schedule

Application Fee Schedule

Texas Commission on Environmental Quality Edwards Aquifer Protection Program 30 TAC Chapter 213 (effective 05/01/2008)

Water Pollution Abatement Plants and Modifications

Contributing Zone Plans and Modifications

Project	Project Area in Acres	Fee
One Single Family Residential Dwelling	< 5	\$650
Multiple Single Family Residential and Parks	< 5 5 < 10 10 < 40 40 < 100 100 < 500 ≥ 500	\$1,500 \$3,000 \$4,000 \$6,500 \$8,000 \$10,000
Non-residential (Commercial, industrial, institutional, multi-family residential, schools, and other sites where regulated activities will occur)	< 1 1 < 5 5 < 10 10 < 40 40 < 100 ≥ 100	\$3,000 \$4,000 \$5,000 \$6,500 \$8,000 \$10,000

Organized Sewage Collection Systems and Modifications

Project	Cost per Linear Foot	Minimum Fee- Maximum Fee
Sewage Collection Systems	\$0.50	\$650 - \$6,500

Underground and Aboveground Storage Tank System Facility Plans and Modifications

Project	Cost per Tank or Piping System	Minimum Fee- Maximum Fee	
Underground and Aboveground Storage Tank Facility	\$650	\$650 - \$6,500	

Exception Requests

Project	Fee			
Exception Request	\$500			

Extension of Time Requests

Project	Fee
Extension of Time Request	\$150

Check Payable to the "Texas Commission on Environmental Quality"

Core Data Form

Additional Forms TCEQ-10400 (Rev. 11-22)



TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

SECTION I: General Information

1. Reason for Submission (If other is checked please describe in space provided.)						
New Permit, Registration or Authorization (<i>Core Data Form should be submitted with the program application.</i>)						
Renewal (Core Data Form should be submitted with the	Renewal (Core Data Form should be submitted with the renewal form) Other					
2. Customer Reference Number (if issued)	Follow this link to search for CN or RN numbers in	3. Regulated Entity Reference Number (if issued)				
CN 606006823	RN					

SECTION II: Customer Information

4. General Customer Information	er Information	Information Updates (mm/dd/yyyy) 6/19/			6/19/2023	
New Customer Legal Name (Verifiable with the Te	Jpdate to Customer Information exas Secretary of State or Texas Com		ge in Regulated Ent c Accounts)	ity Own	ership	
The Customer Name submitted here may (SOS) or Texas Comptroller of Public Acco	,	ed on what is cu	urrent and active	with th	ne Texas Secre	etary of State
6. Customer Legal Name (If an individual, pr	int last name first: eg: Doe, John)		If new Customer, e	enter pro	evious Custome	<u>r below:</u>
JDS RR, LLC						
7. TX SOS/CPA Filing Number 0804044105	8. TX State Tax ID (11 digits) 3208955484			9. Federal Tax ID (9 digits)		umber <i>(if</i>
11. Type of Customer: 🛛 Corpora	tion	🗌 Individ	lual Partnership: 🗌 Gener		ral 🗌 Limited	
Government: 🗌 City 🗋 County 🗋 Federal 🗌	Local 🗌 State 🗌 Other	Sole Pr	Sole Proprietorship Other:			
12. Number of Employees			13. Independently Owned and Operated?			
☑ 0-20		🗆 Yes 🛛 No				
14. Customer Role (Proposed or Actual) – as	с ў	ed on this form.	Please check one of	the follo	owing	
Owner Operator Occupational Licensee Responsible Pa	Owner & Operator Orty OVCP/BSA Applicant		Other:			
5005 Riverway Drive						
Address:						
City Houston	ZIP	77056		ZIP + 4		
16. Country Mailing Information (if outside	e USA)	17. E-Mail Address (if applicable)				
		michael @johnsondev.com				
18. Telephone Number	19. Extension or Co	ode 20. Fax Number (if applicable)				

(712	۱	960-9977
(115)	900-9977

() -

SECTION III: Regulated Entity Information

21. General Regulated Entity Information (If 'New Regulated Entity" is selected, a new permit application is also required.)								
New Regulated Entity	🛛 New Regulated Entity 🛛 Update to Regulated Entity Name 🔄 Update to Regulated Entity Information							
The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).								
22. Regulated Entity Nan	ne (Enter name	e of the site where the	regulated action	n is taking pla	ce.)			
Nolina Phase 2A	Nolina Phase 2A							
23. Street Address of the Regulated Entity:								
<u>(No PO Boxes)</u>	City		State		ZIP		ZIP + 4	
24. County								
		If no Street Ad	dress is provid	ed, fields 2	5-28 are re	equired.		
25. Description to Physical Location: Approximately 1.8 miles Southwest of the intersection of Ronal Reagan Blvd. and CR 248								
26. Nearest City	26. Nearest City State Nearest ZIP Code							
Georgetown						ТХ	7863	33

Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).

27. Latitude (N) In Decim	al	30.745117		20 10	ngitude (W)	In Docimal:	97.83189	6
			20. LU	ngitude (w)	III Decimal.	97.03109	0	
Degrees	Minutes		Seconds	Degree	2S	Minutes	•	Seconds
30		44	42.4		97	49		54.8
29. Primary SIC Code	30.	Secondary SI	C Code	31. Primary	/ NAICS Code	e 32. Seco	ndary NAI	CS Code
(4 digits)	(4 c	ligits)		(5 or 6 digits		(5 or 6 dig	jits)	
6552	N/A	١		237210		N/A		
33. What is the Primary	33. What is the Primary Business of this entity? (Do not repeat the SIC or NAICS description.)							
Single-Family Homes								
	5005 Rive	rway Drive						
34. Mailing								
Address:								1
	City		State		ZIP		ZIP + 4	
35. E-Mail Address:	ton	nmyt@johnsonc	lev.com					
36. Telephone Number	·		37. Extension or	Code	38. Fax	Number (if applical	ble)	
(512) 496-4070					()	-		

39. TCEQ Programs and ID Numbers Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.

Dam Safety	Districts	Edwards Aquifer	Emissions Inventory Air	Industrial Hazardous Waste
Municipal Solid Waste	New Source Review Air		Petroleum Storage Tank	D PWS
Sludge	Storm Water	Title V Air		Used Oll
Voluntary Cleanup	U Wastewater	Wastewater Agriculture	Water Rights	Other:

SECTION IV: Preparer Information

40. Name: Alex Granados				41. Title:	Project Manager
42. Telephone	Number	43. Ext./Code	44. Fax Number	45, E-Mail	Address
(512) 782-0602	 		() -	alex.granado	s@kimley-horn.com

SECTION V: Authorized Signature

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

Company:	JDS RR, LLC	Job Title:	President			
Name (In Print):	L. Michael Cox		.	Phone:	(713) 960- 9977	
Signature:	Alechae M	je		Date:	7/25/23	• • •
Ĺ	Morent					

SHEET INDEX

SHEET NO.

1

2

- 3

DESCRIPTION OVERALL PRELIMINARY PLAT PRELIMINARY PLAT PRELIMINARY PLAT DETAILS

WATERSHED STATUS

THIS SITE IS LOCATED IN THE NORTH FORK OF THE SAN GABRIEL WATERSHED. THIS SITE IS LOCATED IN THE EDWARDS AQUIFER CONTRIBUTING ZONE.


FLOODPLAIN INFORMATION

NO LOT IN THIS SUBDIVISION IS ENCROACHED BY A SPECIAL FLOOD HAZARD AREA(S) INDICATED BY THE 100-YEAR (1% CHANCE) FLOOD AS IDENTIFIED BY THE U.S. FEDERAL EMERGENCY MANAGEMENT AGENCY FLOOD INSURANCE RATE MAP, COMMUNITY PANEL NO. 48491C0275E, EFFECTIVE DATE SEPTEMBER 26, 2008 FOR WILLIAMSON COUNTY, TEXAS.

GENERAL NOTES:


- THE OWNER UNDERSTANDS THAT IT IS THE RESPONSIBILITY OF THE OWNER. NOT THE CITY OR COUNTY TO ASSURE COMPLIANCE WITH THE PROVISIONS OF ALL APPLICABLE STATE, FEDERAL, AND LOCAL LAWS AND REGULATIONS RELATING TO THE ENVIRONMENT, INCLUDING, BUT NOT LIMITED TO THE ENDANGERED SPECIES ACT, STATE AQUIFER REGULATIONS. AND MUNICIPAL WATERSHED ORDINANCES. PROPERTY OWNER SHALL PROVIDE FOR ACCESS TO DRAINAGE EASEMENTS AS MAY BE NECESSARY AND SHALL NOT PROHIBIT ACCESS BY REGULATORY AUTHORITIES. ALL EASEMENTS ON PRIVATE PROPERTY SHALL BE MAINTAINED BY THE PROPERTY OWNER OR THEIR ASSIGNS MAINTENANCE OF THE DRAINAGE EASEMENTS SHALL BE THE RESPONSIBILITY OF THE PROPERTY OWNER. THE SUBDIVISION IS LOCATED WITHIN THE JURISDICTION OF WILLIAMSON COUNTY BUILDING SETBACK LINES SHALL BE IN ACCORDANCE WITH APPLICABLE OWNER RESTRICTIONS RECORDED IN COUNTY RECORDS AND WILLIAMSON COUNTY SUBDIVISION REGULATIONS OR APPLICABLE ORDINANCES BUT SHALL BE A MINIMUM OF 50 FEET FROM THE RIGHT-OF-WAY ALONG MAJOR ROADS AND 25 FEET FROM EDGE OF THE RIGHT-OF-WAY FROM ALL OTHER PUBLIC ROADS. FOR RIGHT-OF-WAY DEDICATION BEYOND 120 FEET IN OVERALL WIDTH, OR MAJOR HIGHWAYS AND ROADS, THE BUILDING SETBACK LINE OF 50 FEET MAY BE REDUCED BY THE WIDTH OF THE ADDITIONAL RIGHT-OF-WAY BEING DEDICATED BEYOND 120 FEET IN OVERALL WIDTH. HOWEVER, IN NO EVENT SHALL THE BUILDING SETBACK LINE BE LESS THAN 25 FEET FROM THE EDGE OF RIGHT-OF-WAY. DRIVEWAY ACCESS TO LOTS WITHIN THIS SUBDIVISION FROM SIDE STREETS IS PROHIBITED. NO STRUCTURE OR IMPROVEMENT OF ANY LOT IN THIS SUBDIVISION SHALL BE OCCUPIED UNTIL CONNECTED TO A WATER SUPPLY SYSTEM APPROVED BY THE TEXAS COMMISSION ON ENVIRONMENTAL QUALITY. NO STRUCTURE OR IMPROVEMENT ON ANY LOT IN THIS SUBDIVISION SHALL BE OCCUPIED UNTIL CONNECTED TO A WASTEWATER COLLECTION SYSTEM APPROVED BY THE TEXAS COMMISSION ON ENVIRONMENTAL QUALITY. 11. THE OWNER OF THIS SUBDIVISION AND HIS HEIRS, SUCCESSORS AND ASSIGNS ASSUMES THE RESPONSIBILITY FOR PLANS FOR CONSTRUCTION OF ALL SUBDIVISION IMPROVEMENTS WHICH SHALL COMPLY WITH APPLICABLE CODES, RULES AND REGULATIONS AND REQUIREMENTS OF WILLIAMSON COUNTY, TEXAS AND THE TEXAS COMMISSION ON ENVIRONMENTAL QUALITY WHICH ARE IN EFFECT AND APPLICABLE AT THE TIME THE IMPROVEMENTS ARE DESIGNED AND CONSTRUCTED AT THE OWNERS SOLE EXPENSE IF PLANS TO CONSTRUCT THIS SUBDIVISION DO NOT COMPLY WITH SUCH CODES AND REQUIREMENTS. 12. WATER SERVICE PROVIDED BY: CITY OF GEORGETOWN WASTEWATER SERVICE PROVIDED BY: CITY OF GEORGETOWN WATER AND WASTEWATER SYSTEMS SERVING THIS SUBDIVISION SHALL 13. BE DESIGNED AND INSTALLED IN ACCORDANCE WITH THE DESIGN AND CONSTRUCTION STANDARDS OF THE TEXAS COMMISSION ON ENVIRONMENTAL QUALITY (TCEQ) OR WILLIAMSON COUNTY. PLANS AND SPECIFICATIONS SHALL BE SUBMITTED TO TCEQ AND OTHER AGENCIES AS APPROPRIATE AT THE TIME SUCH PLANS ARE PREPARED. 14. ALL STREETS TO BE DEDICATED FOR PUBLIC USE. 15. THERE ARE NO CEMETERY SITES, EXISTING OR PROPOSED SCHOOL SITES OR OTHER PUBLIC SITES PROPOSED WITHIN THIS SUBDIVISION 16. THE MINIMUM STREET CENTERLINE RADIUS SHALL BE 180 FEET FOR LOCAL STREETS AND 470 FEET FOR COLLECTOR STREETS. THE MINIMUM STREET CENTERLINE RADIUS SHALL BE 1080 FEET FOR ARTERIAL STREETS. 17. ALL LOTS SHALL BE A MINIMUM OF 30 FEET WIDE AS MEASURED 25 FEET FROM THE FRONT PROPERTY LINE. 18. IF ANY SIDEWALKS ARE CONSTRUCTED IN THIS SUBDIVISION, THEY WILL BE MAINTAINED BY THE HOMEOWNER'S ASSOCIATION. 19. NO LOTS WITHIN THIS SUBDIVISION SHALL BE FURTHER SUBDIVIDED. 20. DRIVEWAYS SHALL ONLY CONNECT TO AN INTERNAL PLATTED ROAD AND NOT TO THE ADJACENT ARTERIAL ROADWAYS. 21. THE PURPOSE OF THIS PRELIMINARY PLAT IS TO SHOW THE PROPOSED IMPROVEMENTS TO THE OWNER'S PROPERTY, INCLUDING THE EXISTING TOPOGRAPHY, TO EVALUATE THE EXISTING AND PROPOSED DRAINAGE PATTERNS. THERE ARE NO IMPROVEMENTS OR SUBDIVISIONS OF LOT 1 BLOCK A, LOT 12 BLOCK A, LOT 1 BLOCK B, LOT 42 BLOCK B, LOT 1 BLOCK C, LOT 1 BLOCK G, AND LOT 1 BLOCK I, PROPOSED WITH THIS PRELIMINARY PLAT. (1) A SUBDIVISION OF THE TRACT, INCLUDING AN ADDITION; (2) LOTS; OR (3) STREETS, ALLEYS, SQUARES, PARKS, OR OTHER PARTS OF THE TRACT INTENDED TO BE DEDICATED TO PUBLIC USE OR FOR THE USE OF PURCHASERS OR OWNERS OF LOTS FRONTING ON OR ADJACENT TO THE STREETS, ALLEYS, SQUARES, PARKS, OR OTHER PARTS. A LOT IS ANY PARCEL OR TRACT OF LAND EXCLUSIVE OF ANY ADJOINING ROAD OR ROAD RIGHT-OF-WAY THAT IS SEPARATED FROM OTHER PARCELS BY A LEGAL DESCRIPTION, A SUBDIVISION OF RECORD, OR A SURVEY MAP. THE TERMS "STREET" OR "ROAD" ARE INTERCHANGEABLE AND ARE USED TO DESCRIBE ALL VEHICULAR WAYS, REGARDLESS OF ANY OTHER DESIGNATION THEY MAY CARRY OR WHETHER THE STREET OR ROAD WILL BE PUBLIC OR PRIVATELY OWNED 22. DEVELOPER AGREES TO DEDICATE RIGHT-OF-WAY FOR COUNTY ROAD 248 IN ORDER TO ACHIEVE A MINIMUM RIGHT-OF-WAY WIDTH OF 94' WITH THE FUTURE PHASES OF THIS DEVELOPMENT. 94' WIDTH IS BASED ON THE CITY OF GEORGETOWN'S CURRENT SUBDIVISION STANDARDS FOR A MAJOR COLLECTOR ROADWAY. 23. DEVELOPER AGREES DEDICATE RIGHT-OF-WAY IN FUTURE PHASES AS GENERALLY SHOWN ON THIS SHEET FOR FUTURE ARTERIALS IN ORDER TO ACHIEVE THE GOALS OF THE WILLIAMSON COUNTY LONG RANGE TRANSPORTATION PLAN. FOR FULL ARTERIAL RIGHT OF WAY DEDICATION, THE MINIMUM WIDTH SHALL BE 120'. 24. THIS SUBDIVISION IS VESTED TO THE WILLIAMSON COUNTY SUBDIVISION
- **REGULATIONS DATED DECEMBER 7, 2021** 25. THE 3B&J MUD WILL RETAIN OWNERSHIP AND MAINTENANCE RESPONSIBILITIES FOR VEGETATION IN ALL OPEN SPACE, DRAINAGE, AND LANDSCAPE LOTS. WILLIAMSON COUNTY TO BE MAINTAIN

STRUCTURES IN DRAINAGE LOTS WHICH WILL BE IN PUBLIC EASEMENTS.

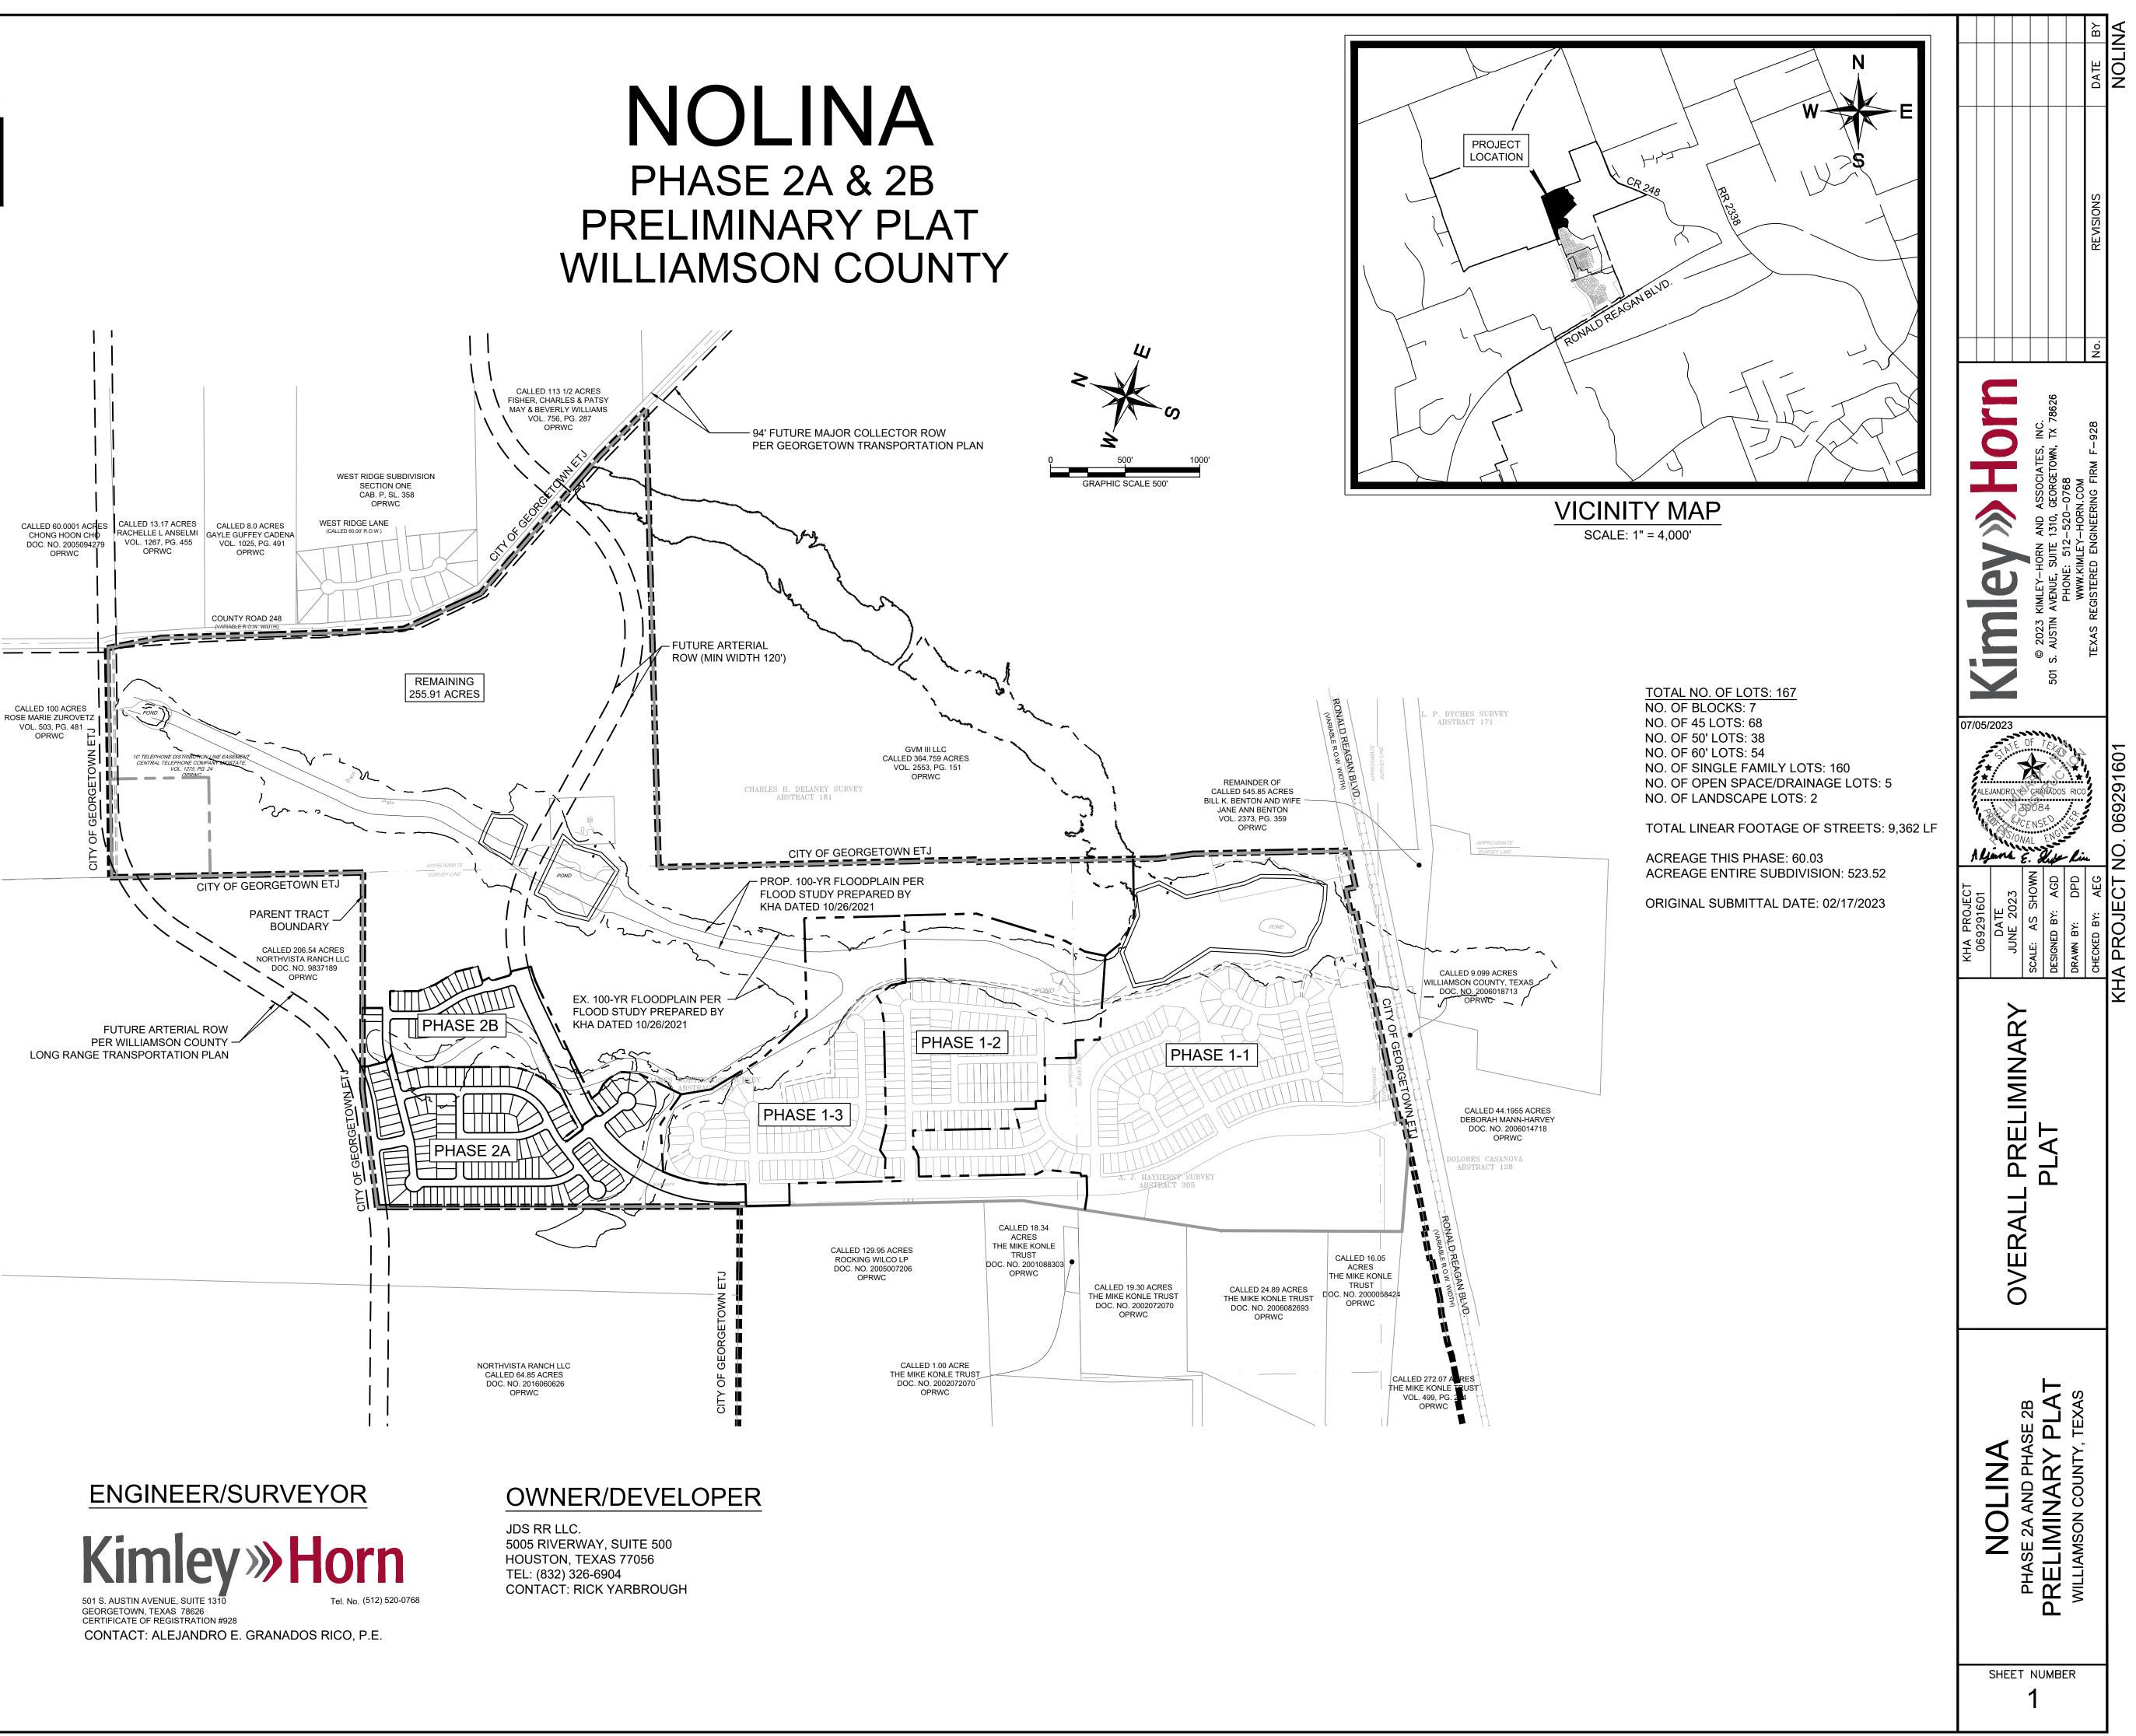





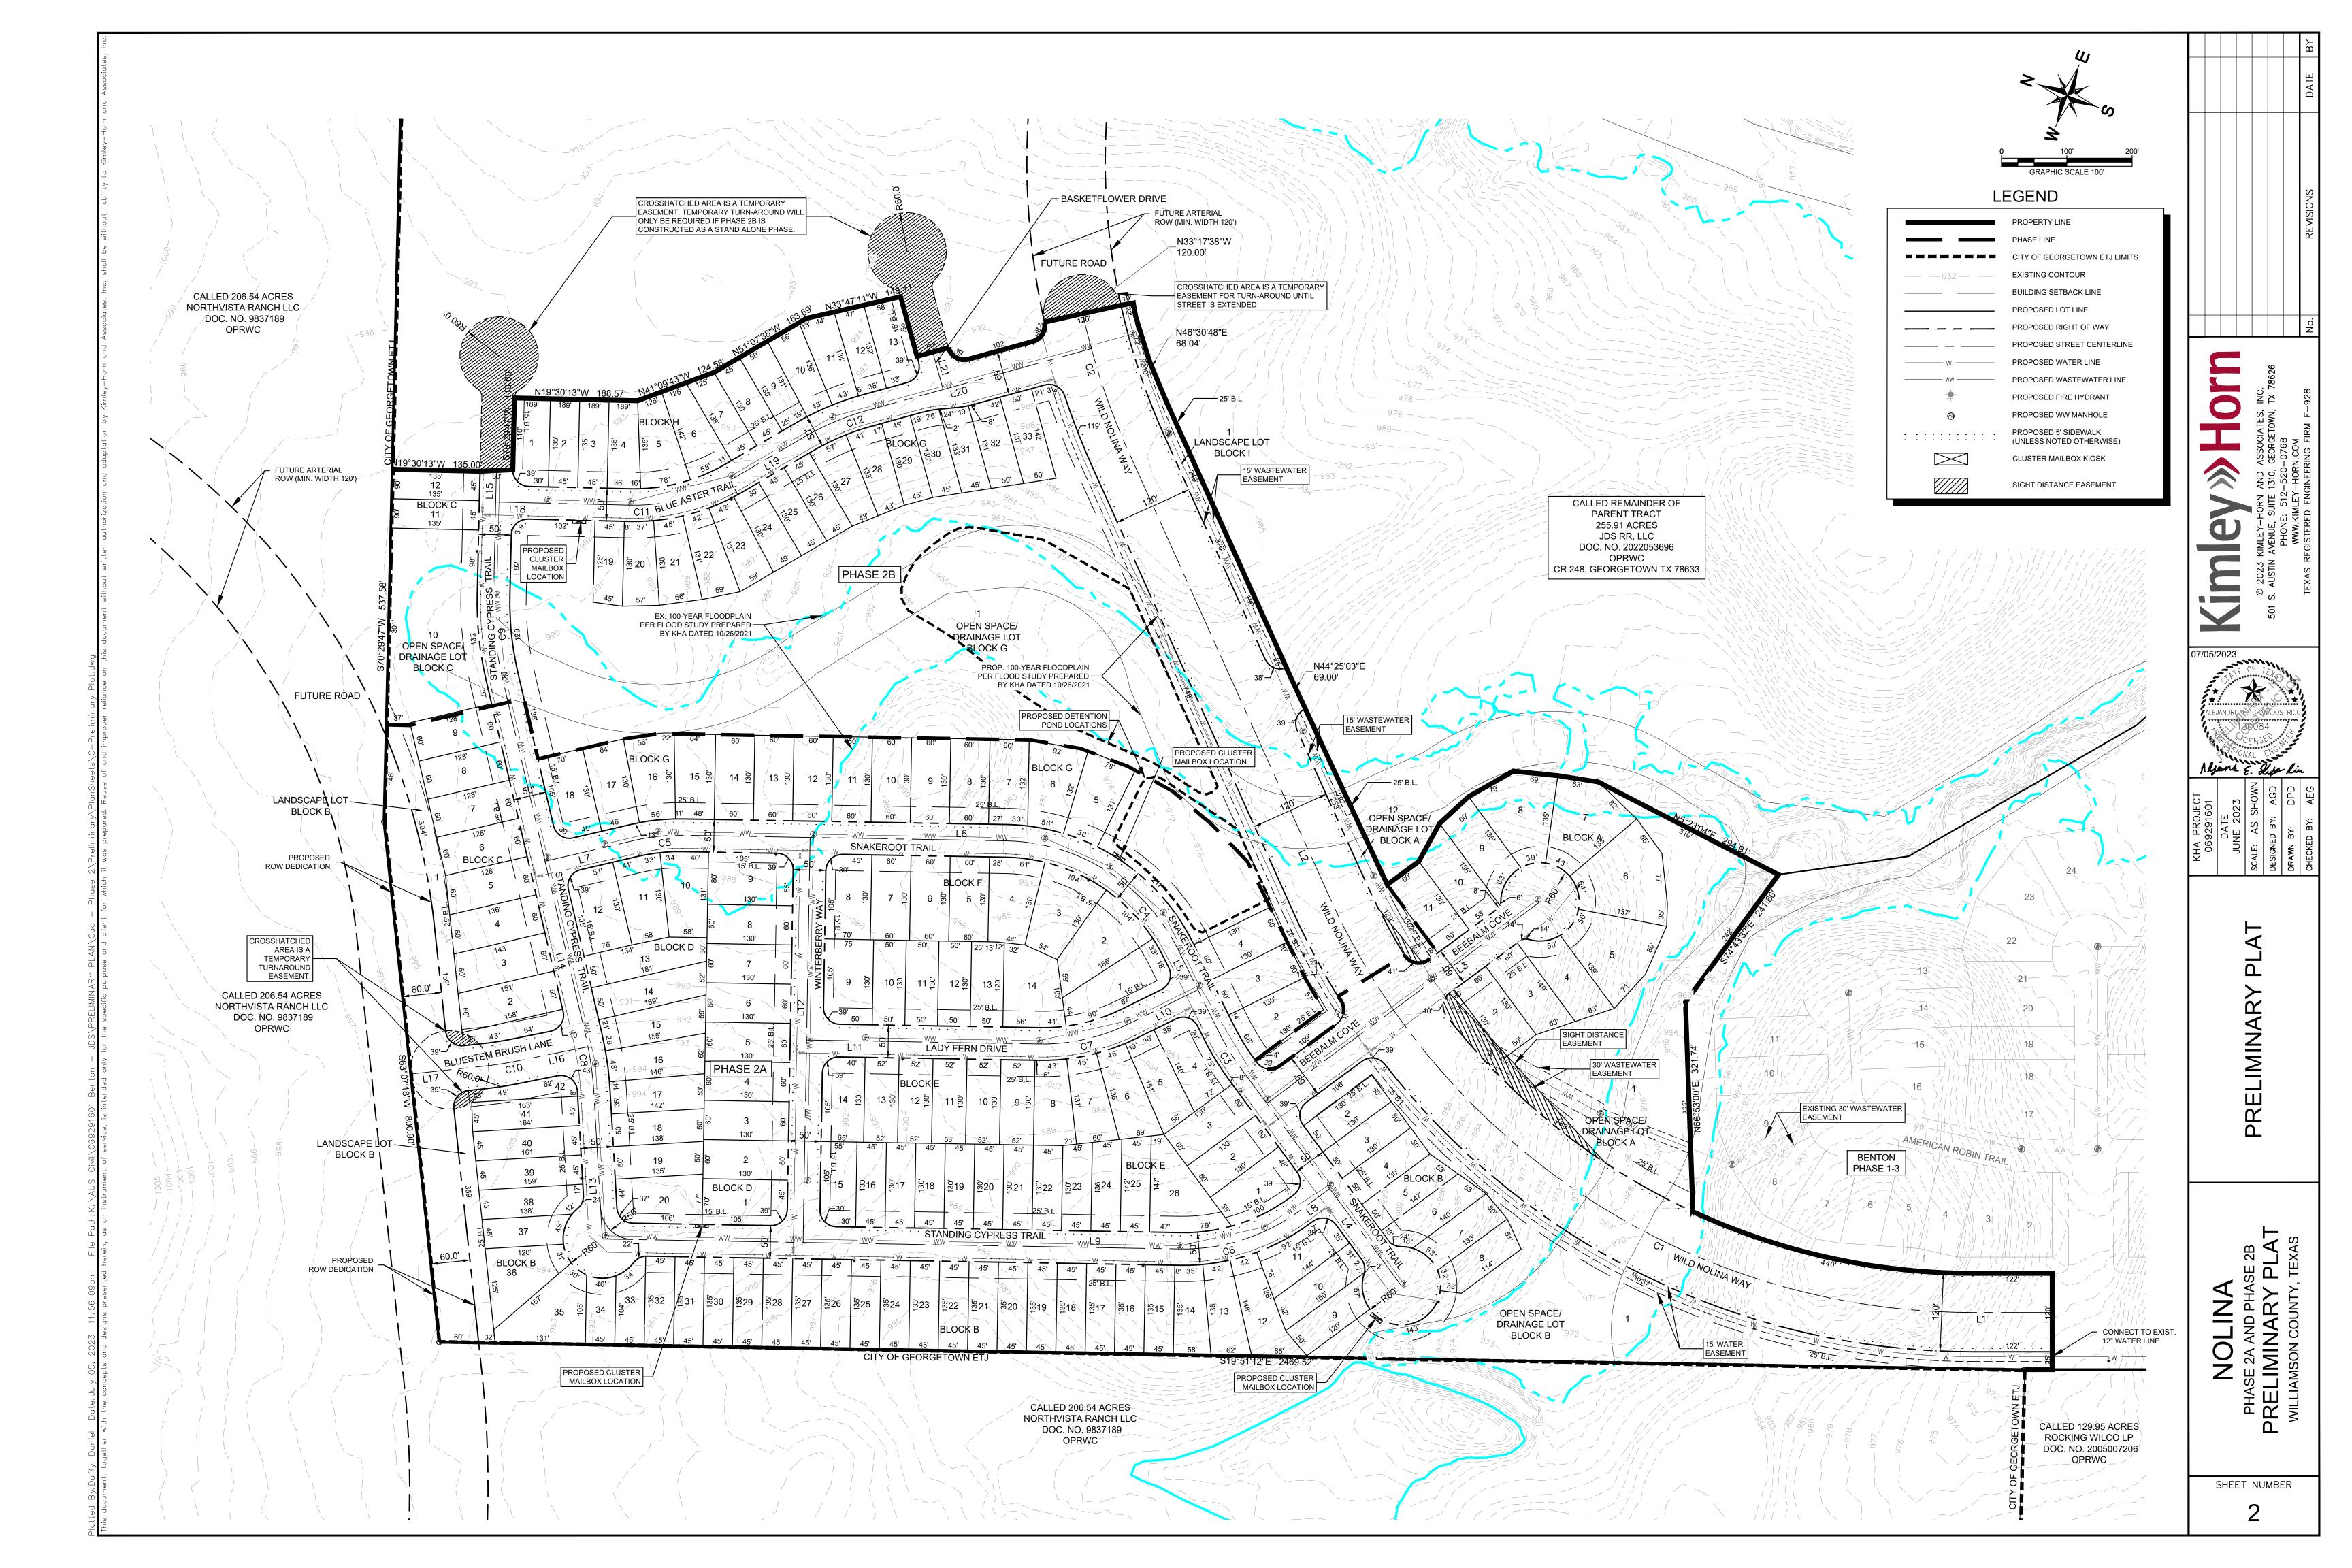

	LINE	TABLE
LINE	LENGTH	BEARING
L1	2530.24	N20*49'21.92"W
L2	748.20	N44°53'28.41"E
L3	278.73	S57°14'59.46"E
L4	410.71	N32°45'00.54"E
L5	67.85	N42°52'59.54"E
L6	494.88	N19*50'11.02"W
L7	141.19	N33*55'12.96"W
L8	56.80	S57°14'59.46"E
L9	884.44	S19*50'11.02"E
L10	117.44	S47°07'00.46"E
L11	355.64	S19*50'11.02"E
L12	620.00	N70°09'48.98"E
L13	225.26	N65°52'07.62"E
L14	566.67	N56°04'47.04"E
L15	190.22	N70°29'47.36"E
L16	115.92	S32°09'30.82"E
L17	112.81	S26°52'41.99"E
L18	205.51	N19°30'12.64"W
L19	125.91	N51°07'37.58"W
L20	356.41	N36°13'17.63"W
L21	54.75	N53°46'42.37"E

	CURVE TABLE							
CURVE	RADIUS	LENGTH	CHORD BEARING	CHORD	DE			
C1	1080.00'	1238.68'	N12°02'03"E	1171.90'	65 ° 4			
C2	1080.00'	1023.74'	N72°02'48"E	985.84'	54 °			
C3	400.00'	70.74'	N37 ° 49'00"E	70.65'	10°0			
C4	300.00'	328.40'	N11°31'24"E	312.25'	62*			
C5	300.00'	73.74'	N26°52'42"W	73.56'	14°C			
C6	300.00'	195.90'	S38•32'35"E	192.43'	37*2			
C7	300.00'	142.84'	S33•28'36"E	141.49'	27"			
C8	500.00'	85.43'	N60 ° 58'27"E	85.32'	9°4			
C9	500.00'	125.81'	N63°17'17"E	125.48'	14°2			
C10	500.00'	46.08'	S29°31'06"E	46.06'	5 ° 1			
C11	300.00'	165.58'	N35°18'55"W	163.49'	31°3			
C12	400.00'	104.06'	N43°40'28"W	103.77'	14°5			

STREET DESIGN TABLE										
STREET NAME	CLASSIFICATION	DESIGN SPEED	LENGTH	ROW WIDTH	PAVEMENT WIDTH	RURAL/URBAN	MAINTENANCE AUTHORITY	SIDEWALK		
WILD NOLINA WAY	ARTERIAL	45 MPH	2,331'	120' (MIN)	*24 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
BEEBALM COVE	MINOR COLLECTOR	35 MPH	279	60'	37 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
BEEBALIVICOVE	MINOR COLLECTOR	35 MPH	241'	69'	37 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
SNAKEROOT TRAIL	LOCAL	25 MPH	1657'	50'	30 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
STANDING CYPRESS TRAIL	LOCAL	25 MPH	2330'	50'	30 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
LADY FERN DRIVE	LOCAL	25 MPH	616'	50'	30 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
WINTERBERRY WAY	LOCAL	25 MPH	620'	50'	30 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
BLUESTEM BRUSH LANE	MINOR COLLECTOR	35 MPH	275'	69'	37 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
BLUE ASTER TRAIL	LOCAL	25 MPH	722'	50'	30 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
BLUE ASTER TRAIL	MINOR COLLECTOR	35 MPH	236'	69'	37 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
BASKETFLOWER DRIVE	LOCAL	25 MPH	55'	50'	30 LF (LOG-LOG)	URBAN	PUBLIC	5' BOTH SIDES		
NOTE: MINIMUM ROW WIDTH FOR MINOR COLLECTOR IS 60'.										
*PAVEMENT WIDTH BASED ON ESTIMATED AVERAGE DAILY TRIPS AND WILLIAMSON COUNTY SUBDIVISION REGULATIONS AS OF DECEMBER 7TH, 2021.										



