

Centex Materials, LLC

Aboveground Storage Tank (AST) Plan Application

Buda Plant Quarry
1100 Jack C Hays Trl
Buda, Texas 78610
Hays County

Submitted to: TCEQ Region 11, Austin

Prepared By:



Boerne, Texas
830-249-8284

Date: November 2023
Project No. 10079-124

-AK-



Signature: _____

Andrea Kidd

Andrea Kidd, P.E. - License No. 132541

TX PE Firm No. 4524

Date: 11/29/2023

Aboveground Storage Tank Facility Plan Checklist

- **Edwards Aquifer Application Cover Page (TCEQ-20705)**
- **General Information Form (TCEQ-0587)**
 - Attachment A - Road Map
 - Attachment B - USGS / Edwards Recharge Zone Map
 - Attachment C - Project Description
- **Geologic Assessment Form (TCEQ-0585)**
 - Attachment A - Geologic Assessment Table (TCEQ-0585-Table)
 - Attachment B - Stratigraphic Column
 - Attachment C - Site Geology
 - Attachment D - Site Geologic Map(s)
- **Aboveground Storage Tank Facility Plan (TCEQ-0575)**
 - Attachment A - Alternative Methods of Secondary Containment (if proposed)
 - Attachment B - Scaled Drawing(s) of Containment Structure
 - Attachment C - Exception to the Geologic Assessment (if requested)
 - Attachment D - Spill and Overfill Control
 - Attachment E - Response Actions to Spills
 - Site Plan
- **Temporary Stormwater Section (TCEQ-0602)**
 - Attachment A - Spill Response Actions
 - Attachment B - Potential Sources of Contamination
 - Attachment C - Sequence of Major Activities
 - Attachment D - Temporary Best Management Practices and Measures
 - Attachment E - Request to Temporarily Seal a Feature (if requested)
 - Attachment F - Structural Practices
 - Attachment G - Drainage Area Map
 - Attachment H - Temporary Sediment Pond(s) Plans and Calculations
 - Attachment I - Inspection and Maintenance for BMPs
 - Attachment J - Schedule of Interim and Permanent Soil Stabilization Practices
- **Agent Authorization Form (TCEQ-0599), if application submitted by agent**
- **Application Fee Form (TCEQ-0574)**
- **Check Payable to the “Texas Commission on Environmental Quality”**
- **Core Data Form (TCEQ-10400)**

Texas Commission on Environmental Quality

Edwards Aquifer Application Cover Page

Our Review of Your Application

The Edwards Aquifer Program staff conducts an administrative and technical review of all applications. The turnaround time for administrative review can be up to 30 days as outlined in 30 TAC 213.4(e). Generally administrative completeness is determined during the intake meeting or within a few days of receipt. The turnaround time for technical review of an administratively complete Edwards Aquifer application is 90 days as outlined in 30 TAC 213.4(e). Please know that the review and approval time is directly impacted by the quality and completeness of the initial application that is received. In order to conduct a timely review, it is imperative that the information provided in an Edwards Aquifer application include final plans, be accurate, complete, and in compliance with [30 TAC 213](#).

Administrative Review

1. [Edwards Aquifer applications](#) must be deemed administratively complete before a technical review can begin. To be considered administratively complete, the application must contain completed forms and attachments, provide the requested information, and meet all the site plan requirements. The submitted application and plan sheets should be final plans. Please submit one full-size set of plan sheets with the original application, and half-size sets with the additional copies.

To ensure that all applicable documents are included in the application, the program has developed tools to guide you and web pages to provide all forms, checklists, and guidance. Please visit the below website for assistance: <http://www.tceq.texas.gov/field/eapp>.

2. This Edwards Aquifer Application Cover Page form (certified by the applicant or agent) must be included in the application and brought to the administrative review meeting.
3. Administrative reviews are scheduled with program staff who will conduct the review. Applicants or their authorized agent should call the appropriate regional office, according to the county in which the project is located, to schedule a review. The average meeting time is one hour.
4. In the meeting, the application is examined for administrative completeness. Deficiencies will be noted by staff and emailed or faxed to the applicant and authorized agent at the end of the meeting, or shortly after. Administrative deficiencies will cause the application to be deemed incomplete and returned.

An appointment should be made to resubmit the application. The application is re-examined to ensure all deficiencies are resolved. The application will only be deemed administratively complete when all administrative deficiencies are addressed.

5. If an application is received by mail, courier service, or otherwise submitted without a review meeting, the administrative review will be conducted within 30 days. The applicant and agent will be contacted with the results of the administrative review. If the application is found to be administratively incomplete, it can be retrieved from the regional office or returned by regular mail. If returned by mail, the regional office may require arrangements for return shipping.
6. If the geologic assessment was completed before October 1, 2004 and the site contains “possibly sensitive” features, the assessment must be updated in accordance with the *Instructions to Geologists* (TCEQ-0585 Instructions).

Technical Review

1. When an application is deemed administratively complete, the technical review period begins. The regional office will distribute copies of the application to the identified affected city, county, and groundwater conservation district whose jurisdiction includes the subject site. These entities and the public have 30 days to provide comments on the application to the regional office. All comments received are reviewed by TCEQ.
2. A site assessment is usually conducted as part of the technical review, to evaluate the geologic assessment and observe existing site conditions. The site must be accessible to our staff. The site boundaries should be

clearly marked, features identified in the geologic assessment should be flagged, roadways marked and the alignment of the Sewage Collection System and manholes should be staked at the time the application is submitted. If the site is not marked the application may be returned.

3. We evaluate the application for technical completeness and contact the applicant and agent via Notice of Deficiency (NOD) to request additional information and identify technical deficiencies. There are two deficiency response periods available to the applicant. There are 14 days to resolve deficiencies noted in the first NOD. If a second NOD is issued, there is an additional 14 days to resolve deficiencies. If the response to the second notice is not received, is incomplete or inadequate, or provides new information that is incomplete or inadequate, the application must be withdrawn or will be denied. Please note that because the technical review is underway, whether the application is withdrawn or denied **the application fee will be forfeited**.
4. The program has 90 calendar days to complete the technical review of the application. If the application is technically adequate, such that it complies with the Edwards Aquifer rules, and is protective of the Edwards Aquifer during and after construction, an approval letter will be issued. Construction or other regulated activity may not begin until an approval is issued.

Mid-Review Modifications

It is important to have final site plans prior to beginning the permitting process with TCEQ to avoid delays.

Occasionally, circumstances arise where you may have significant design and/or site plan changes after your Edwards Aquifer application has been deemed administratively complete by TCEQ. This is considered a “Mid-Review Modification”. Mid-Review Modifications may require redistribution of an application that includes the proposed modifications for public comment.

If you are proposing a Mid-Review Modification, two options are available:

- If the technical review has begun your application can be denied/withdrawn, your fees will be forfeited, and the plan will have to be resubmitted.
- TCEQ can continue the technical review of the application as it was submitted, and a modification application can be submitted at a later time.

If the application is denied/withdrawn, the resubmitted application will be subject to the administrative and technical review processes and will be treated as a new application. The application will be redistributed to the affected jurisdictions.

Please contact the regional office if you have questions. If your project is located in Williamson, Travis, or Hays County, contact TCEQ’s Austin Regional Office at 512-339-2929. If your project is in Comal, Bexar, Medina, Uvalde, or Kinney County, contact TCEQ’s San Antonio Regional Office at 210-490-3096

Please fill out all required fields below and submit with your application.

1. Regulated Entity Name: Buda Plant Quarry					2. Regulated Entity No.: 102190592				
3. Customer Name: Centex Materials, LLC					4. Customer No.: 600397434				
5. Project Type: (Please circle/check one)	New		Modification		Extension		Exception		
6. Plan Type: (Please circle/check one)	WPAP	CZP	SCS	UST	AST	EXP	EXT	Technical Clarification	
7. Land Use: (Please circle/check one)	Residential		Non-residential		8. Site (acres):		~102		
9. Application Fee:	\$1,300		10. Permanent BMP(s):			N/A			
11. SCS (Linear Ft.):	N/A		12. AST/UST (No. Tanks):			Two (2)			
13. County:	Hays		14. Watershed:			Onion Creek – Colorado River			

Application Distribution

Instructions: Use the table below to determine the number of applications required. One original and one copy of the application, plus additional copies (as needed) for each affected incorporated city, county, and groundwater conservation district are required. Linear projects or large projects, which cross into multiple jurisdictions, can require additional copies. Refer to the “Texas Groundwater Conservation Districts within the EAPP Boundaries” map found at:

http://www.tceq.texas.gov/assets/public/compliance/field_ops/eapp/EAPP%20GWCD%20map.pdf

For more detailed boundaries, please contact the conservation district directly.

Austin Region			
County:	Hays	Travis	Williamson
Original (1 req.)	<input checked="" type="checkbox"/> _X_	<input type="checkbox"/> _	<input type="checkbox"/> _
Region (1 req.)	<input checked="" type="checkbox"/> _X_	<input type="checkbox"/> _	<input type="checkbox"/> _
County(ies)	<input checked="" type="checkbox"/> _X_	<input type="checkbox"/> _	<input type="checkbox"/> _
Groundwater Conservation District(s)	<input type="checkbox"/> _ Edwards Aquifer Authority <input checked="" type="checkbox"/> _X_ Barton Springs/ Edwards Aquifer <input type="checkbox"/> _ Hays Trinity <input type="checkbox"/> _ Plum Creek	<input type="checkbox"/> _ Barton Springs/ Edwards Aquifer	NA
City(ies) Jurisdiction	<input type="checkbox"/> _ Austin <input checked="" type="checkbox"/> _X_ Buda <input type="checkbox"/> _ Dripping Springs <input type="checkbox"/> _ Kyle <input type="checkbox"/> _ Mountain City <input type="checkbox"/> _ San Marcos <input type="checkbox"/> _ Wimberley <input type="checkbox"/> _ Woodcreek	<input type="checkbox"/> _ Austin <input type="checkbox"/> _ Bee Cave <input type="checkbox"/> _ Pflugerville <input type="checkbox"/> _ Rollingwood <input type="checkbox"/> _ Round Rock <input type="checkbox"/> _ Sunset Valley <input type="checkbox"/> _ West Lake Hills	<input type="checkbox"/> _ Austin <input type="checkbox"/> _ Cedar Park <input type="checkbox"/> _ Florence <input type="checkbox"/> _ Georgetown <input type="checkbox"/> _ Jerrell <input type="checkbox"/> _ Leander <input type="checkbox"/> _ Liberty Hill <input type="checkbox"/> _ Pflugerville <input type="checkbox"/> _ Round Rock

San Antonio Region					
County:	Bexar	Comal	Kinney	Medina	Uvalde
Original (1 req.)	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _
Region (1 req.)	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _
County(ies)	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _	<input type="checkbox"/> _
Groundwater Conservation District(s)	<input type="checkbox"/> _ Edwards Aquifer Authority <input type="checkbox"/> _ Trinity-Glen Rose	<input type="checkbox"/> _ Edwards Aquifer Authority	<input type="checkbox"/> _ Kinney	<input type="checkbox"/> _ EAA <input type="checkbox"/> _ Medina	<input type="checkbox"/> _ EAA <input type="checkbox"/> _ Uvalde
City(ies) Jurisdiction	<input type="checkbox"/> _ Castle Hills <input type="checkbox"/> _ Fair Oaks Ranch <input type="checkbox"/> _ Helotes <input type="checkbox"/> _ Hill Country Village <input type="checkbox"/> _ Hollywood Park <input type="checkbox"/> _ San Antonio (SAWS) <input type="checkbox"/> _ Shavano Park	<input type="checkbox"/> _ Bulverde <input type="checkbox"/> _ Fair Oaks Ranch <input type="checkbox"/> _ Garden Ridge <input type="checkbox"/> _ New Braunfels <input type="checkbox"/> _ Schertz	NA	<input type="checkbox"/> _ San Antonio ETJ (SAWS)	NA

I certify that to the best of my knowledge, that the application is complete and accurate. This application is hereby submitted to TCEQ for administrative review and technical review.

Andrea Kidd, P.E.

TX License No. 132541 | Firm No. 4524


Print Name of Engineer/Authorized Agent

Andrea Kidd

11/29/2023

Signature of Engineer/Authorized Agent

Date



****FOR TCEQ INTERNAL USE ONLY****

Date(s) Reviewed:		Date Administratively Complete:	
Received From:		Correct Number of Copies:	
Received By:		Distribution Date:	
EAPP File Number:		Complex:	
Admin. Review(s) (No.):		No. AR Rounds:	
Delinquent Fees (Y/N):		Review Time Spent:	
Lat./Long. Verified:		SOS Customer Verification:	
Agent Authorization Complete/Notarized (Y/N):		Fee Check:	Payable to TCEQ (Y/N):
Core Data Form Complete (Y/N):			Signed (Y/N):
Core Data Form Incomplete Nos.:			Less than 90 days old (Y/N):

General Information Form

Texas Commission on Environmental Quality

For Regulated Activities on the Edwards Aquifer Recharge and Transition Zones and Relating to 30 TAC §213.4(b) & §213.5(b)(2)(A), (B) Effective June 1, 1999

To ensure that the application is administratively complete, confirm that all fields in the form are complete, verify that all requested information is provided, consistently reference the same site and contact person in all forms in the application, and ensure forms are signed by the appropriate party.

Note: Including all the information requested in the form and attachments contributes to more streamlined technical reviews.

Signature

To the best of my knowledge, the responses to this form accurately reflect all information requested concerning the proposed regulated activities and methods to protect the Edwards Aquifer. This **General Information Form** is hereby submitted for TCEQ review. The application was prepared by:

Print Name of Engineer/Agent: Andrea Kidd, P.E.

TX License No. 132541 | TX Firm No. 4524

Date: 11/29/2023

Signature of Engineer/Agent:

Andrea Kidd



Project Information

1. Regulated Entity Name: Buda Plant Quarry
2. County: Hays
3. Stream Basin: Colorado River Basin
4. Groundwater Conservation District (If applicable): Barton Springs/Edwards Aquifer CD
5. Edwards Aquifer Zone:
☐ Recharge Zone
☒ Transition Zone
6. Plan Type:

<input type="checkbox"/> WPAP	<input checked="" type="checkbox"/> AST
<input type="checkbox"/> SCS	<input type="checkbox"/> UST
<input type="checkbox"/> Modification	<input type="checkbox"/> Exception Request

7. Customer (Applicant):

Contact Person: Rick Holmes

Entity: Centex Materials, LLC

Mailing Address: 3019 Alvin Devane, Bldg 1, Suite 100

City, State: Austin, TX

Zip: 78741

Telephone: (512) 501-5841

FAX: _____

Email Address: rholmes@centexmaterials.com

8. Agent/Representative (If any):

Contact Person: Andrea Kidd, P.E.

Entity: Westward Environmental, Inc.

Mailing Address: P.O. Box 2205

City, State: Boerne, TX

Zip: 78006

Telephone: (830) 249-8284

FAX: (830) 249-0221

Email Address: akidd@westwardenv.com

9. Project Location:

- ☐ The project site is located inside the city limits _____.
- ☒ The project site is located outside the city limits but inside the ETJ (extra-territorial jurisdiction) of City of Buda.
- ☐ The project site is not located within any city's limits or ETJ.

10. ☒ The location of the project site is described below. The description provides sufficient detail and clarity so that the TCEQ's Regional staff can easily locate the project and site boundaries for a field investigation.

1100 Jack C Hays Trl, Buda, TX 78610

11. ☒ **Attachment A – Road Map.** A road map showing directions to and the location of the project site is attached. The project location and site boundaries are clearly shown on the map.

12. ☒ **Attachment B - USGS / Edwards Recharge Zone Map.** A copy of the official 7 ½ minute USGS Quadrangle Map (Scale: 1" = 2000') of the Edwards Recharge Zone is attached. The map(s) clearly show:

- ☒ Project site boundaries.
- ☒ USGS Quadrangle Name(s).
- ☒ Boundaries of the Recharge Zone (and Transition Zone, if applicable).
- ☒ Drainage path from the project site to the boundary of the Recharge Zone.

13. ☒ **The TCEQ must be able to inspect the project site or the application will be returned.** Sufficient survey staking is provided on the project to allow TCEQ regional staff to locate the boundaries and alignment of the regulated activities and the geologic or manmade features noted in the Geologic Assessment.

☒ Survey staking will be completed by this date: Existing site is clearly defined by fencing.

14. ☒ **Attachment C – Project Description.** Attached at the end of this form is a detailed narrative description of the proposed project. The project description is consistent throughout the application and contains, at a minimum, the following details:

- ☒ Area of the site
- ☒ Offsite areas
- ☒ Impervious cover
- ☒ Permanent BMP(s)
- ☒ Proposed site use
- ☒ Site history
- ☒ Previous development
- ☒ Area(s) to be demolished

15. Existing project site conditions are noted below:

- ☐ Existing commercial site
- ☒ Existing industrial site
- ☐ Existing residential site
- ☒ Existing paved and/or unpaved roads
- ☒ Undeveloped (Cleared)
- ☒ Undeveloped (Undisturbed/Uncleared)
- ☐ Other: _____

Prohibited Activities

16. ☒ I am aware that the following activities are prohibited on the Recharge Zone and are not proposed for this project:

- (1) Waste disposal wells regulated under 30 TAC Chapter 331 of this title (relating to Underground Injection Control);
- (2) New feedlot/concentrated animal feeding operations, as defined in 30 TAC §213.3;
- (3) Land disposal of Class I wastes, as defined in 30 TAC §335.1;
- (4) The use of sewage holding tanks as parts of organized collection systems; and
- (5) New municipal solid waste landfill facilities required to meet and comply with Type I standards which are defined in §330.41(b), (c), and (d) of this title (relating to Types of Municipal Solid Waste Facilities).
- (6) New municipal and industrial wastewater discharges into or adjacent to water in the state that would create additional pollutant loading.

17. ☒ I am aware that the following activities are prohibited on the Transition Zone and are not proposed for this project:

- (1) Waste disposal wells regulated under 30 TAC Chapter 331 (relating to Underground Injection Control);

- (2) Land disposal of Class I wastes, as defined in 30 TAC §335.1; and
- (3) New municipal solid waste landfill facilities required to meet and comply with Type I standards which are defined in §330.41 (b), (c), and (d) of this title.

Administrative Information

18. The fee for the plan(s) is based on:



- ☐ For a Water Pollution Abatement Plan or Modification, the total acreage of the site where regulated activities will occur.
- ☐ For an Organized Sewage Collection System Plan or Modification, the total linear footage of all collection system lines.
- ☒ For a UST Facility Plan or Modification or an AST Facility Plan or Modification, the total number of tanks or piping systems.
- ☐ A request for an exception to any substantive portion of the regulations related to the protection of water quality.
- ☐ A request for an extension to a previously approved plan.

19. ☒ Application fees are due and payable at the time the application is filed. If the correct fee is not submitted, the TCEQ is not required to consider the application until the correct fee is submitted. Both the fee and the Edwards Aquifer Fee Form have been sent to the Commission's:

- ☒ TCEQ cashier **ePay**
- ☐ Austin Regional Office (for projects in Hays, Travis, and Williamson Counties)
- ☐ San Antonio Regional Office (for projects in Bexar, Comal, Kinney, Medina, and Uvalde Counties)

20. ☒ Submit one (1) original and one (1) copy of the application, plus additional copies as needed for each affected incorporated city, groundwater conservation district, and county in which the project will be located. The TCEQ will distribute the additional copies to these jurisdictions. The copies must be submitted to the appropriate regional office.

21. ☒ No person shall commence any regulated activity until the Edwards Aquifer Protection Plan(s) for the activity has been filed with and approved by the Executive Director.

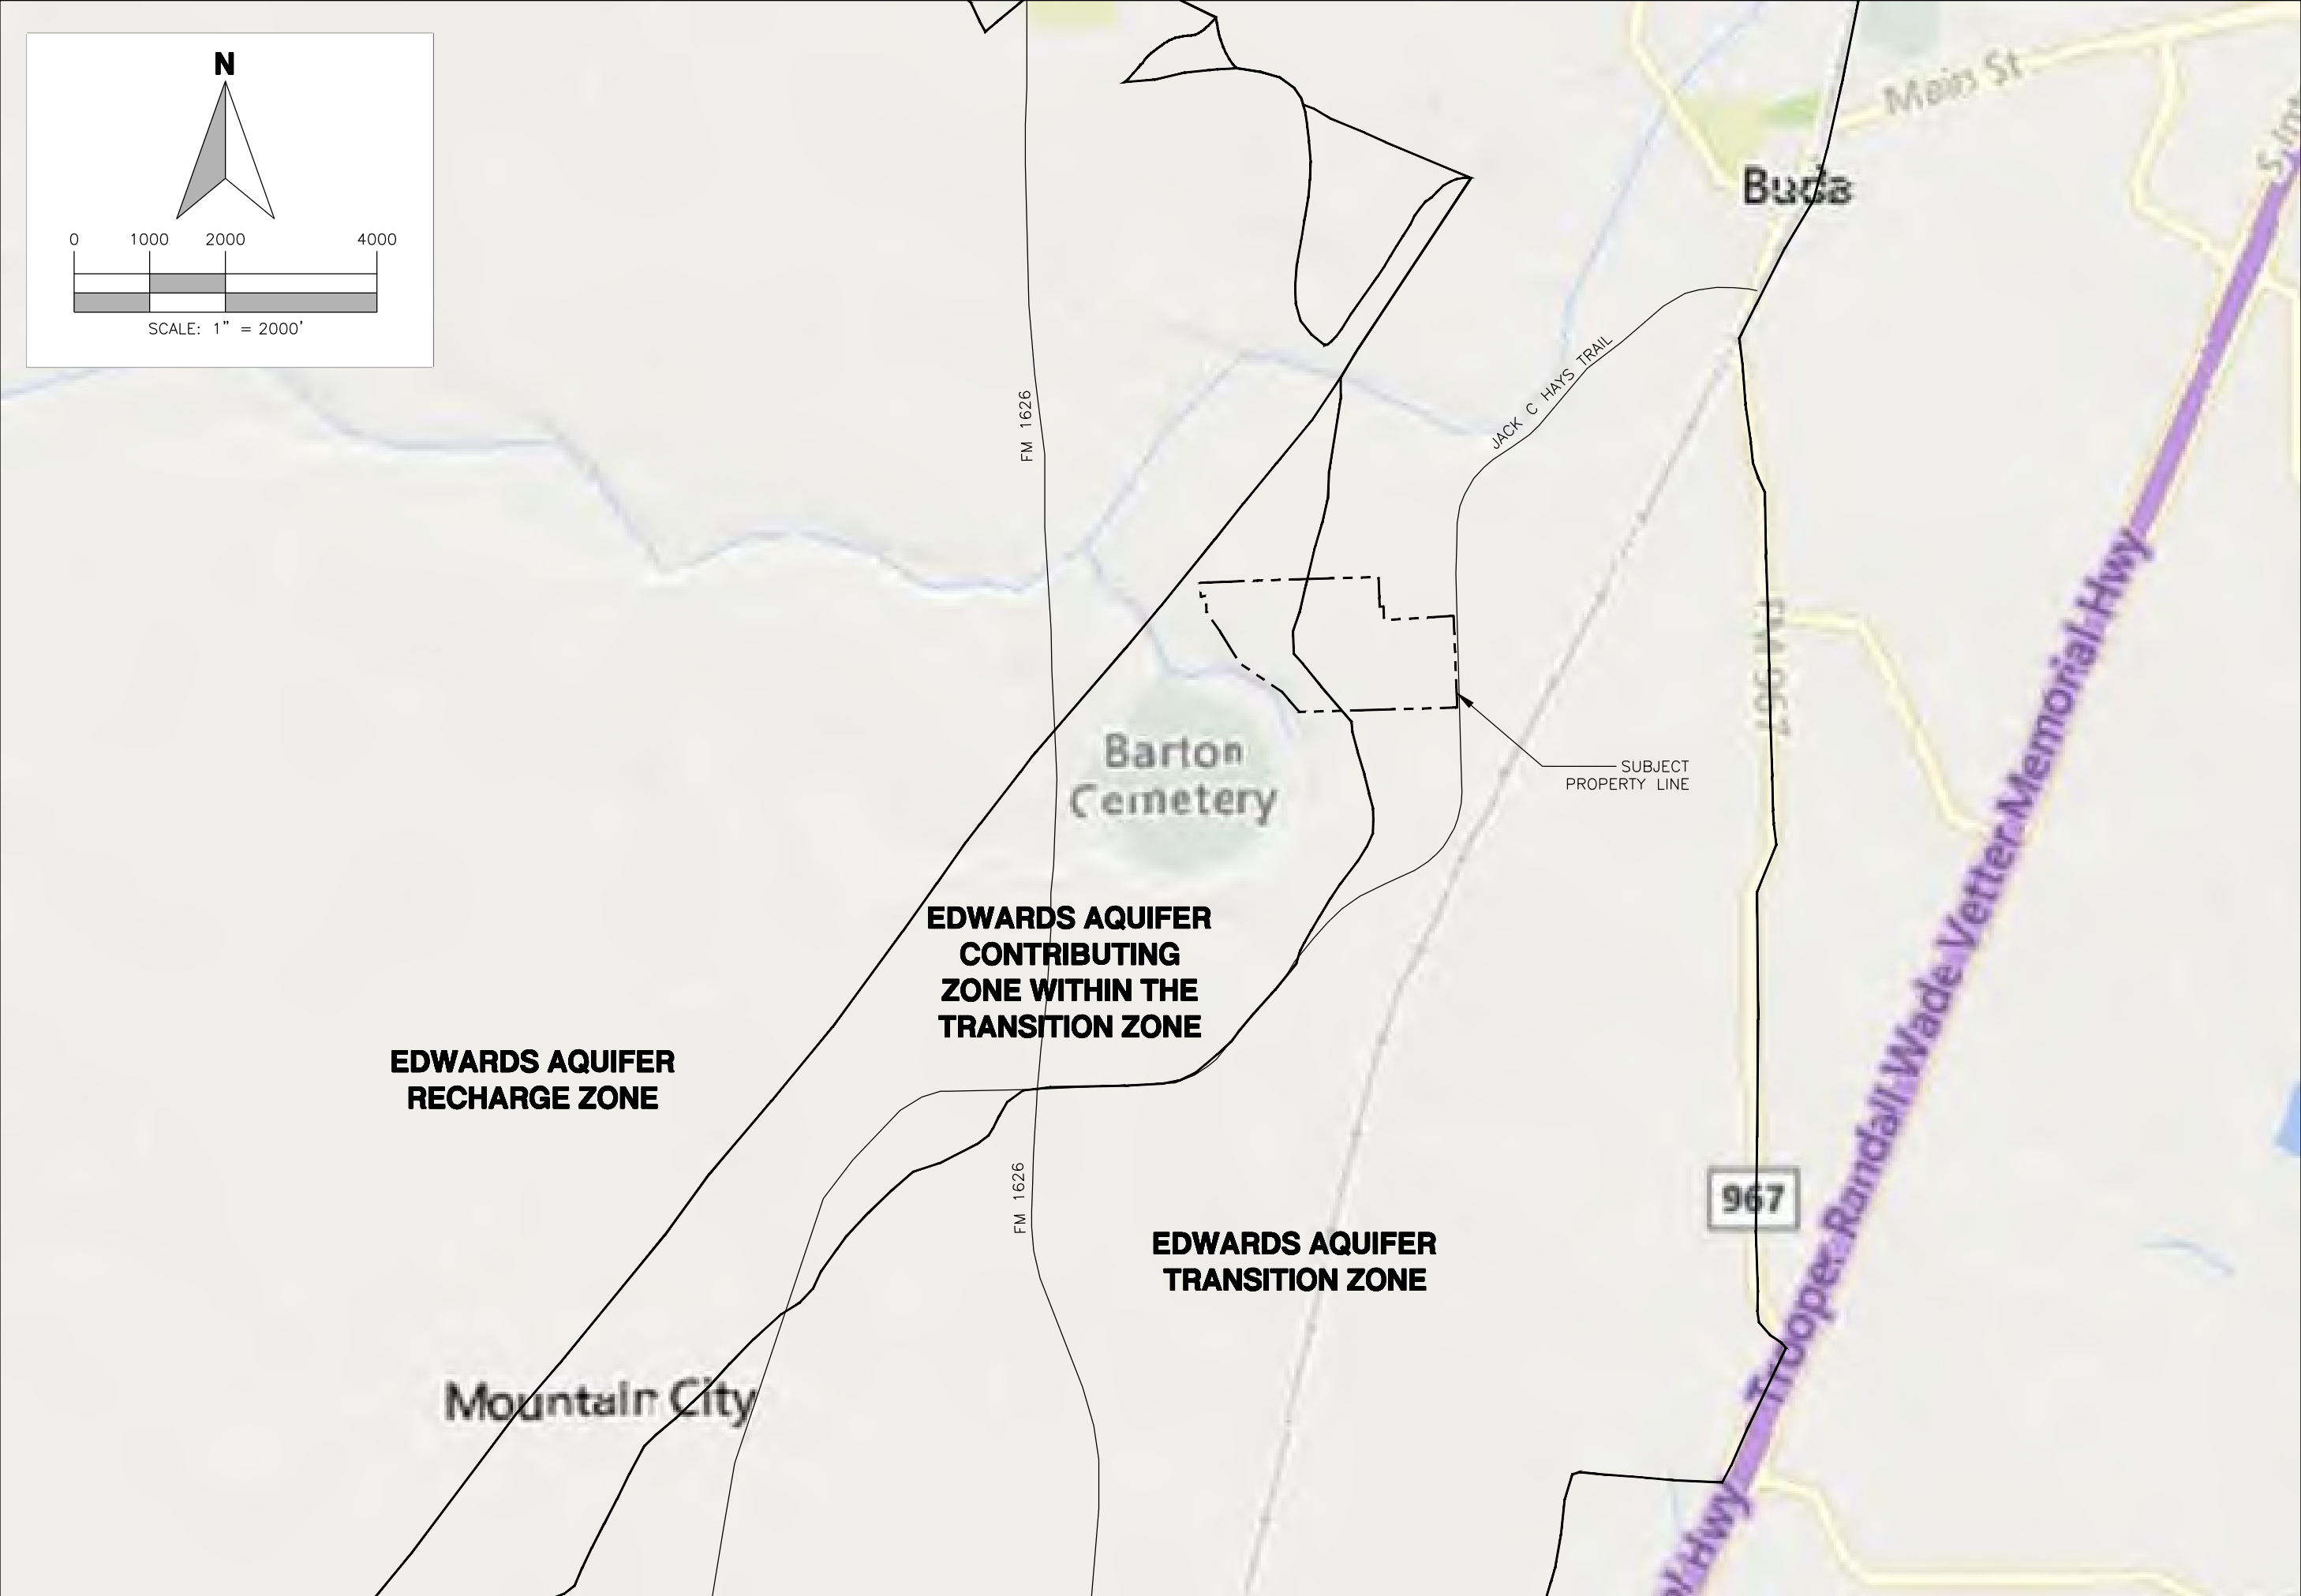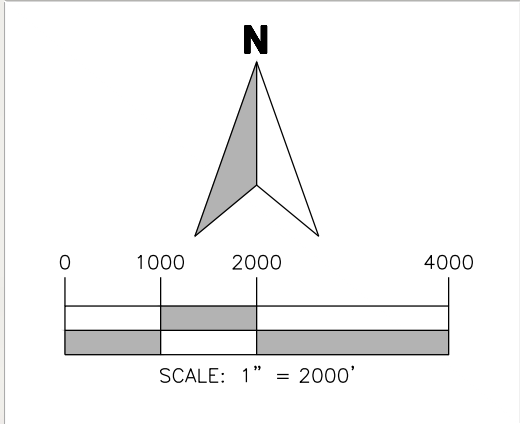

THIS PRODUCT IS FOR INFORMATIONAL PURPOSES AND MAY NOT HAVE BEEN PREPARED FOR OR BE SUITABLE FOR LEGAL, ENGINEERING, OR SURVEYING PURPOSES. IT DOES NOT REPRESENT AN ON-THE-GROUND SURVEY AND REPRESENTS ONLY THE LOCATION OF APPROXIMATE RELATIVE LOCATIONS OF PROPERTY BOUNDARIES.

ROAD MAP			
AST PLAN			
CENTEX MATERIALS, LLC			
BUDA, HAYS COUNTY, TEXAS			
REV.	DESCRIPTION	BY	DATE

IMAGE:	BING MAPS
ISSUE DATE:	10/24/2023
DRAWN BY:	AK
CHECKED BY:	CJF
SCALE:	1" = 2000'
JOB NO.:	10079-124



WESTWARD


Environmental. Engineering. Natural Resources.

P.O. Box 2205 Boerne, Texas 78006

(830) 249-8284 Fax: (830) 249-0221

TBPE REG. NO.: F-4524

TBPG REG. NO.: 50112

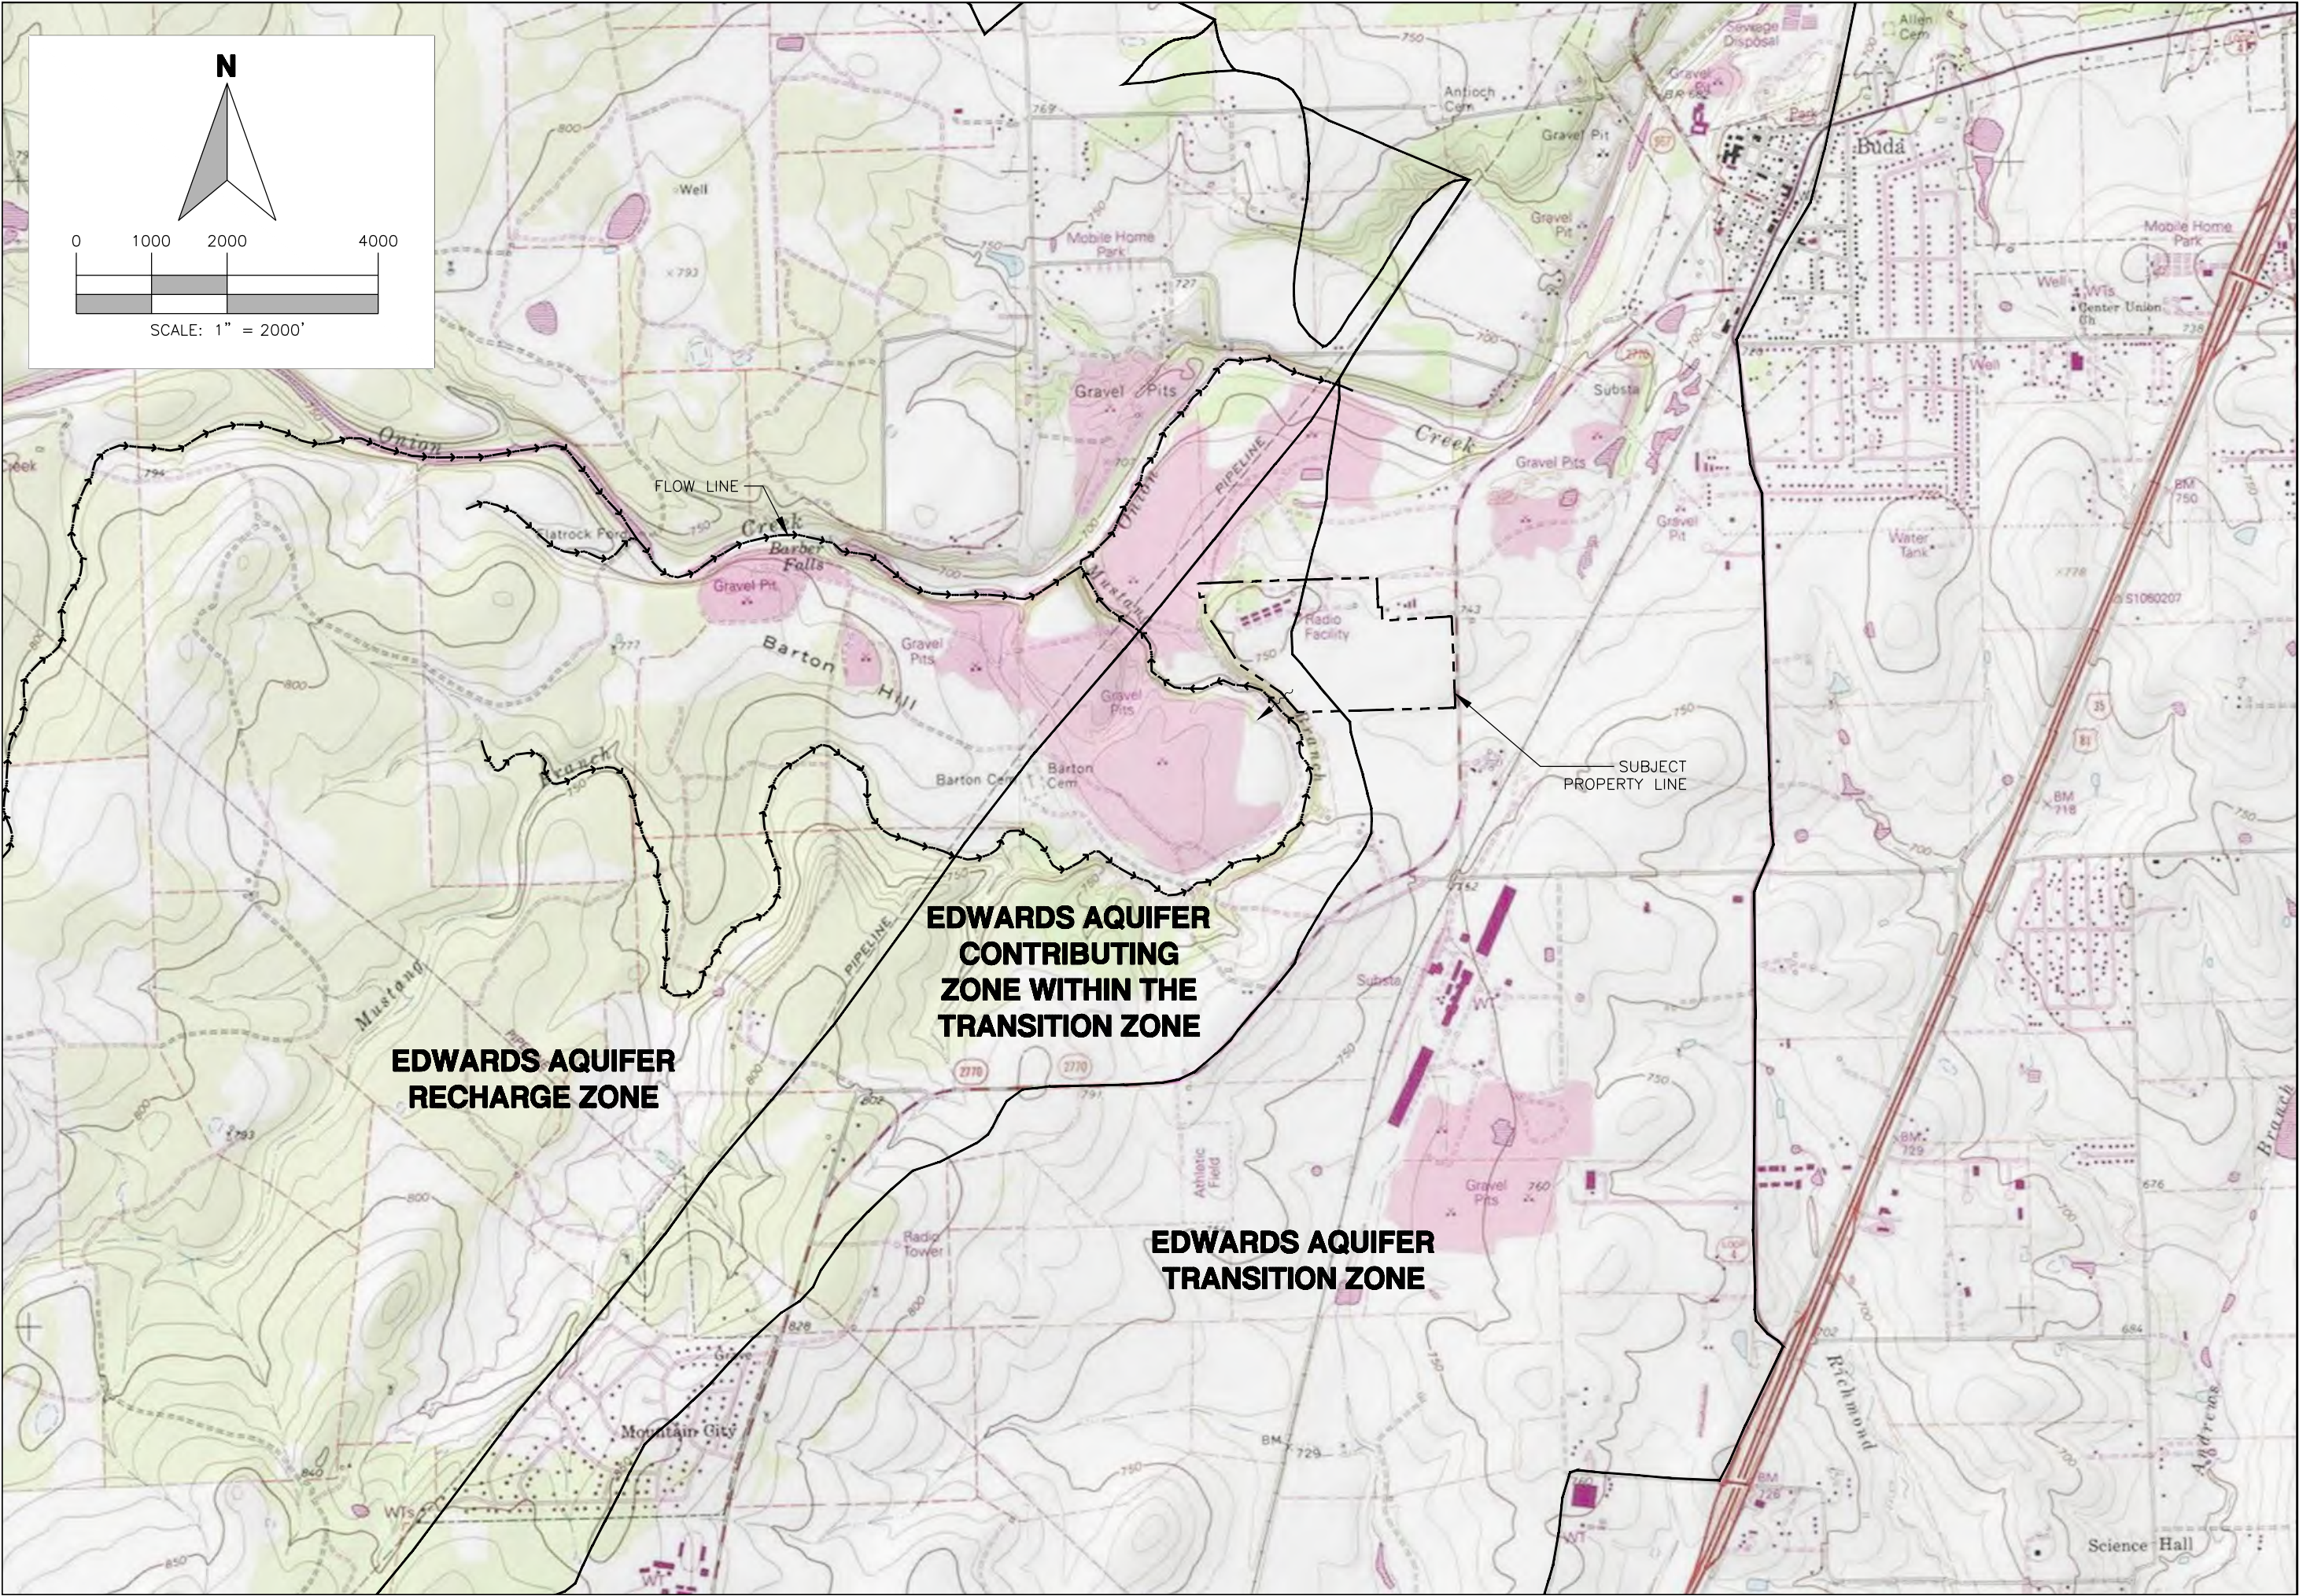

<div> <div>USGS MAP</div> <div>AST PLAN</div> <div>CENTEX MATERIALS, LLC</div> <div>BUDA, HAYS COUNTY, TEXAS</div> </div>			
REV.	DESCRIPTION	BY	DATE

IMAGE:	
BUDA & MOUNTAIN CITY	
ISSUE DATE:	10/24/2023
DRAWN BY:	AK
CHECKED BY:	CJF
SCALE: 1" =	2000'
JOB NO.:	10079-124

SHEET NO.:
1
OF 1

**Centex Materials, LLC
Buda Plant Quarry**

**General Information Form (TCEQ-0587)
Attachment C**

Project Description

This Aboveground Storage Tank (AST) Plan has been prepared on behalf of Centex Materials, LLC for who proposes to install two double-walled hydrocarbon storage tanks in support of an existing limestone quarry located at 1100 Jack C Hays Trl, Buda, Hays County, Texas. This project site encompasses 102.06 acres of property and is located within the Contributing Zone and Transition Zone of the Edwards Aquifer. The quarry has been operating at this site for about 40 years; industrial activity at this project site pre-dates 30 TAC 213 rules. Historical aerial imagery shows that the proposed tank locations have already been disturbed/paved.

This AST Plan includes the following storage tanks:

AST #	Size (gals)	Substance stored	Tank material
1	1,000	Used oil	Double-walled steel
2	15,000	Diesel	Double-walled steel

Each double-walled storage tank will sit on a curbed concrete pad. The concrete pad will serve as secondary containment for associated piping, dispensers, and catch potential drips and spills.

The drainage patterns of the site will not change, and no soil stabilization measures are necessary. Several of the attachments relating to stormwater BMPs (Temporary Stormwater Section Attachments C, D, E, F, G, H, I, and J) are not applicable to this project. There will be no grading activities resulting from this plan that will disturb soils, therefore temporary stormwater BMPs are not necessary. No areas are proposed to be demolished or disturbed.

A geologic assessment (GA), dated November 3, 2023, is included in this report. The 102.06-acre parcel is included in the GA. This GA identified four geologic features, one of which is an existing well, however none of the features are classified as sensitive features. Aboveground storage tanks will not be located within 150-foot of the existing water well.

Centex Materials, LLC

GEOLOGIC ASSESSMENT

Buda Quarry:102.06 Acre Tract
1100 Jack C Hays Trail
Buda, Texas 78610
Hays County

Submitted to: TCEQ Region 11, Austin

Prepared By:




Boerne, Texas

830-249-8284

Date: November 2023

Project No. 10079-124

-JJS-



Signature: _____

John J. Sackrider, P.G. - License No. 12654

TX PG Firm No. 50112

Date: 11/3/2023

Geologic Assessment

Texas Commission on Environmental Quality

For Regulated Activities on The Edwards Aquifer Recharge/transition Zones and Relating to 30 TAC §213.5(b)(3), Effective June 1, 1999

To ensure that the application is administratively complete, confirm that all fields in the form are complete, verify that all requested information is provided, consistently reference the same site and contact person in all forms in the application, and ensure forms are signed by the appropriate party.

Note: Including all the information requested in the form and attachments contributes to more streamlined technical reviews.

Signature

To the best of my knowledge, the responses to this form accurately reflect all information requested concerning the proposed regulated activities and methods to protect the Edwards Aquifer. My signature certifies that I am qualified as a geologist as defined by 30 TAC Chapter 213.



Print Name of Geologist: John J. Sackrider, P.G. Telephone: 830-249-8284

Date: 11/3/2023

Fax: _____

Representing: Westward Environmental, Inc. (TX P.G. Firm No. 50112)

Signature of Geologist:



Regulated Entity Name: Buda Quarry

Project Information

1. Date(s) Geologic Assessment was performed: June 22 & 30, 2021

2. Type of Project:

☐ WPAP
☐ SCS

☒ AST
☐ UST

3. Location of Project:

☐ Recharge Zone
☒ Transition Zone
☒ Contributing Zone within the Transition Zone

4. ☒ **Attachment A - Geologic Assessment Table.** Completed Geologic Assessment Table (Form TCEQ-0585-Table) is attached.
5. ☒ Soil cover on the project site is summarized in the table below and uses the SCS Hydrologic Soil Groups* (Urban Hydrology for Small Watersheds, Technical Release No. 55, Appendix A, Soil Conservation Service, 1986). If there is more than one soil type on the project site, show each soil type on the site Geologic Map or a separate soils map.

Table 1 - Soil Units, Infiltration Characteristics and Thickness

Soil Name	Group*	Thickness(feet)
ByA	D	0 - 6.66
ByB	D	0 - 6.66
GrC	D	0 - 6.66

** Soil Group Definitions (Abbreviated)*

- A. Soils having a high infiltration rate when thoroughly wetted.
- B. Soils having a moderate infiltration rate when thoroughly wetted.
- C. Soils having a slow infiltration rate when thoroughly wetted.
- D. Soils having a very slow infiltration rate when thoroughly wetted.

6. ☒ **Attachment B – Stratigraphic Column.** A stratigraphic column showing formations, members, and thicknesses is attached. The outcropping unit, if present, should be at the top of the stratigraphic column. Otherwise, the uppermost unit should be at the top of the stratigraphic column.
7. ☒ **Attachment C – Site Geology.** A narrative description of the site specific geology including any features identified in the Geologic Assessment Table, a discussion of the potential for fluid movement to the Edwards Aquifer, stratigraphy, structure(s), and karst characteristics is attached.
8. ☒ **Attachment D – Site Geologic Map(s).** The Site Geologic Map must be the same scale as the applicant's Site Plan. The minimum scale is 1": 400'
Applicant's Site Plan Scale: 1"= 200'
Site Geologic Map scale: 1" = 200'
Site Soils Map Scale (if more than 1 soil type): 1" = 200'
9. Method of collecting positional data:
 - ☒ Global Positioning System (GPS) technology.
 - ☐ Other method(s). Please describe method of data collection: _____
10. ☒ The project site and boundaries are clearly shown and labeled on the Site Geologic Map.
11. ☒ Surface geologic units are shown and labeled on the Site Geologic Map.

12. ☒ Geologic or manmade features were discovered on the project site during the field investigation. They are shown and labeled on the Site Geologic Map and are described in the attached Geologic Assessment Table.
- ☐ Geologic or manmade features were not discovered on the project site during the field investigation.
13. ☒ The Recharge Zone boundary is shown and labeled, if appropriate.
14. All known wells (test holes, water, oil, unplugged, capped and/or abandoned, etc.): If applicable, the information must agree with Item No. 20 of the WPAP Application Section.
- ☒ There are 1 (#) wells present on the project site and the locations are shown and labeled. (Check all of the following that apply.)
- ☐ The wells are not in use and have been properly abandoned.
- ☐ The wells are not in use and will be properly abandoned.
- ☒ The wells are in use and comply with 16 TAC Chapter 76.
- ☐ There are no wells or test holes of any kind known to exist on the project site.

Administrative Information

15. ☒ Submit one (1) original and one (1) copy of the application, plus additional copies as needed for each affected incorporated city, groundwater conservation district, and county in which the project will be located. The TCEQ will distribute the additional copies to these jurisdictions. The copies must be submitted to the appropriate regional office.

Attachment A

Geologic Assessment Table (Form TCEQ-0585)

GEOLOGIC ASSESSMENT TABLE						PROJECT NAME: Buda Shop															
LOCATION			FEATURE CHARACTERISTICS											EVALUATION			PHYSICAL SETTING				
1A	1B *	1C*	2A	2B	3	4			5	5A	6	7	8A	8B	9	10		11		12	
FEATURE ID	LATITUDE	LONGITUDE	FEATURE TYPE	POINTS	FORMATION	DIMENSIONS (FEET)			TREND (DEGREES)	DOW	DENSITY (NO/FT)	APERTURE (FEET)	INFILL	RELATIVE INFILTRATION RATE	TOTAL	SENSITIVITY		CATCHMENT AREA (ACRES)		TOPOGRAPHY	
						X	Y	Z		10							<40	>40	<1.6	>1.6	
S-1	30.067805	-97.862761	MB	30	Kau	0.5		797					N	5	35	X			X		Hillside
S-2	30.065753	-97.866189	F	20	Kbu/Kau	1250			35°	10			X	5	35	X			X		Hillside
S-3	30.065121	-97.865245	F	20	Kau	850			12°				X	5	25	X			X		Hillside
S-4	30.064136	-97.857125	CD	5	Kau	20	80	0.75	130°				F	5	10	X			X		Hillside
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
																0					
			</																		

Note: Fault coordinates recorded at western property boundary, length corresponds to the extent across the site.

* DATUM: NAD 83


2A TYPE	TYPE	2B POINTS
C	Cave	30
SC	Solution cavity	20
SF	Solution-enlarged fracture(s)	20
F	Fault	20
O	Other natural bedrock features	5
MB	Manmade feature in bedrock	30
SW	Swallow hole	30
SH	Sinkhole	20
CD	Non-karst closed depression	5
Z	Zone, clustered or aligned features	30

8A INFILLING	
N	None, exposed bedrock
C	Coarse - cobbles, breakdown, sand, gravel
O	Loose or soft mud or soil, organics, leaves, sticks, dark colors
F	Fines, compacted clay-rich sediment, soil profile, gray or red colors
V	Vegetation. Give details in narrative description
FS	Flowstone, cements, cave deposits
X	Other materials

12 TOPOGRAPHY	
Cliff, Hilltop, Hillside, Drainage, Floodplain, Streambed	

I have read, I understood, and I have followed the Texas Commission on Environmental Quality's Instructions to Geologists. The information presented here complies with that document and is a true representation of the conditions observed in the field. My signature certifies that I am qualified as a geologist as defined by 30 TAC Chapter 213.





Date 7/7/2021

Attachment B

Stratigraphic Column

Generalized Stratigraphic Column – Hays County, Texas

Hydrogeologic subdivision		Group, formation, or member	Hydro-logic function	Thickness (feet)	Lithology	Field identification	Cavern development	Porosity/ permeability type		
Upper Cretaceous	Upper confining units	Navarro and Taylor Groups, undivided	CU	600	Clay; chalky limestone	Gray-brown clay; marly limestone	None	Low porosity/ low permeability		
		Austin Group	CU; rarely AQ	130 – 150	White to gray limestone	White, chalky limestone; <i>Gryphæa aculeata</i>	None	Low porosity/ low permeability; rare water production from fractures		
		Hagle Ford Group	CU	30 – 50	Brown, flaggy, sandy shale and argillaceous limestone	Thin flagstones; petroliciferous	None	Primary porosity lost/ low permeability		
		Buda Limestone	CU	40 – 50	Buff, light gray, dense mudstone	Porcelaneous limestone	Minor surface karst	Low porosity/ low permeability		
		Del Rio Clay	CU	40 – 50	Blue-green to yellow-brown clay	Fossiliferous; <i>Dynatosyrina arletina</i>	None	None; primary upper confining unit		
Lower Cretaceous	I	Edwards Group	Person Formation	Georgetown Formation	CU	10 – 40	Gray to light tan marly limestone	Marker fossil: <i>Watsonella huacachensis</i>	None	Low porosity/ low permeability
	II			Cycle and marine members, undivided	AQ	80 – 100	Mudstone to packstone; <i>miloid</i> grainstone; chert	Boxwork vugs; light tan, massive; some <i>Tourasina</i> and <i>Capriolus</i>	Many caves; might be associated with earlier karst development	Laterally extensive; both fabric and not fabric/one of the more porous and permeable of the subdivisions
	III			Leached and collapsed members, undivided	AQ	80 – 100	Crystalline limestone; mudstone to grainstone; chert; collapsed breccia	Biostriated iron-stained beds separated by massive limestone beds; <i>Montastraea</i> (?) sp.	Extensive lateral development; large rooms	Majority not fabric/ probably the most permeable of the subdivisions
	IV			Regional dense member	CU	20 – 24	Dense, argillaceous mudstone	Wispiness iron-oxide stains	None; only vertical fracture enlargement	Not fabric/ low permeability; vertical barrier
	V		Grainstone member	AQ	50 – 60	<i>Miloid</i> grainstone; mudstone to wackestone; chert	White crossbedded grainstone; <i>Tourasina</i> and <i>Turritella</i>	Few caves	Not fabric/ recrystallization reduces permeability	
	VI		Kirschberg evaporite member	AQ	50 – 60	Crystalline limestone; chalky mudstone; chert	Boxwork voids, with neospar and travertine frame	Probably extensive cave development	Majority fabric/one of the more porous and permeable of the subdivisions	
	VII		Dolomitic member	AQ	110 – 130	Mudstone to grainstone; crystalline limestone; chert	Massively bedded light gray, <i>Tourasina</i> abundant	Caves related to structure or bedding planes	Mostly not fabric; some bedding-plane fabric/ locally permeable	
	VIII		Basal nodular member	Karst AQ; not karst CU	50 – 60	Shaly, nodular limestone; mudstone and <i>miloid</i> grainstone	Massive, nodular and mottled, <i>Eogyrus texanus</i>	Few caves	Fabric/low permeability	
		Lower confining unit	Upper member of the Glen Rose Limestone	CU; evaporite beds AQ	350 – 500	Yellowish tan, thinly bedded limestone and marl	Stair-step topography; alternating limestone and marl	Some surface cave development	Some water production at evaporite beds/ relatively impermeable	

Surface Unit Mapped Onsite

Adapted from Geologic Framework and Hydrogeologic Characteristics of the Edwards Aquifer Outcrop, Hays County, Texas, USGS Water-Resources Investigations Report 95-4265 (USGS, 1995)

Attachment C

Site Geology (Geologic Narrative)

Geologic Narrative for Buda Quarry in Hays County, Texas.

1.0 PURPOSE

Westward Environmental, Inc. (WESTWARD) was retained by Centex Materials, LLC (Client) to prepare a Geologic Assessment (GA) of a 102.06-acre parcel at their Buda Quarry (Site) near Buda, Hays County, Texas. This GA was prepared as a required attachment to an Aboveground Storage Tank (AST) Plan application for the Site as required by the Texas Commission on Environmental Quality (TCEQ).

2.0 REGULATORY GUIDANCE

Chapter 30 of the Texas Administrative Code

This report was prepared in accordance with *Instructions for Geologists for Geologic Assessments on the Edwards Aquifer Recharge/Transition Zones (TCEQ-0585 (Rev. 10-01-04))* and will be reviewed pursuant to Title 30, Chapter 213 of the Texas Administrative Code.

3.0 PROJECT LOCATION

The Site is located approximately 1.5 miles southwest of Buda, TX on Jack C. Hays Trail. Approximately 36% of the site is located over the Edwards Aquifer Contributing Zone within the Transition Zone (EATRZ), and the remaining 64% located over the Edwards Aquifer Transition Zone (EATZ).

4.0 METHODOLOGY

As part of the GA, WESTWARD performed a desktop review of selected published information, and conducted a field investigation in accordance with *(TCEQ-0585 (Rev. 10-01-04))*.

4.1 Desktop Review

WESTWARD geologists conducted a review of aerial imagery, the University of Texas Bureau of Economic Geology (BEG) Geologic Atlas of Texas (GAT) Austin Sheet, applicable U.S. Geological Survey (USGS) Topographic quadrangle(s), the Texas Natural Resources Information System (TNRIS), the Texas Water Development Board's (TWDB) Water Data Interactive Groundwater Data Viewer (Well Viewer), the Railroad Commission of Texas (RRC), and the U.S. Department of Agriculture (USDA) National Resource Conservation Service (NRCS) Web Soil Survey prior to the field investigation.

4.2 Field Investigation

A field investigation was performed at the Site by WESTWARD staff, under the direction of John J. Sackrider, P.G. (TBPG Lic. No.: 12654) on June 22 and 30, 2021. Field transects of the Site were completed in accordance with TCEQ-0585 (rev. 10-01-04).

5.0 DESKTOP REVIEW

The desktop review was utilized for preliminary planning of the field investigation. The accuracy of the desktop review was limited by the accessibility, scale, and age of the data available.

5.1 Published Surface Geology

A review of published geologic maps resulted in two (2) hydrostratigraphic units mapped at the Site which include the Austin Group (Kau) and Buda Limestone (Kbu). (USGS, 2018).

5.2 Published Structure

There are two (2) mapped faults at the Site. The westernmost fault runs generally southwest to northeast with an approximate trend of 35°. The easternmost fault runs generally from north to south with an approximate trend of 12°. For the purpose of this assessment, the dominant trend was estimated at 32° through averaging of multiple published faults in the area. The dominant trend range in this area is therefore approximated to be between 17° and 47°.

5.3 Karst Features

Mapped karst features were not encountered during the Desktop Review.

5.4 Non-Karst & Manmade Features

One (1) existing water well (State Well No.: 5858405) was identified through the TWDB Well Viewer. Drilled in 1961; the well is reported to be 797 feet deep with steel casing to 376 ft. bgs.

5.5 Soils

Three (3) soil units were identified on the Site through the NRCS Web Soil Survey. They are detailed below as well as included on the Geologic Assessment Form (TCEQ-0585 (Rev. 02-11-15)).

Published Soil Unit Descriptions			
<i>Soil Name</i>	<i>Group</i>	<i>Thickness (Inches)</i>	<i>Description</i>
Branyon Clay, 0 to 1 percent slopes (ByA)	D	0 – 80+	Moderately well drained with very low to moderately low (0.00 in/hr to 0.06 in.hr) Ksat values
Branyon Clay, 1 to 3 percent slopes (ByB)	D	0 – 80+	Moderately well drained with very low to moderately low (0.00 in/hr to 0.06 in.hr) Ksat values
Gruene Clay, 1 to 5 percent slopes (GrC)	D	0 – 80+	Well drained with moderately low to moderately high (0.06 in/hr to 0.57 in/hr) Ksat values

6.0 FIELD INVESTIGATION

The field investigation was performed on June 22 and 30, 2021 to verify the presence or absence of potential recharge features identified in the desktop review and to identify other potential recharge features not encountered during the desktop review. Field reconnaissance was performed in accordance with the (*TCEQ-0585-Instructions (Rev. 10-1-04)*).

6.1 Surface Geology

Observed site surface characteristics consisted of either compacted base, pavement, dense vegetation, or dark soils. Bedrock outcrops were not observed to verify surface deposits. A Site Geologic Map is included in Attachment D, showing published surface geology.

6.2 Structure

Direct evidence of the mapped faults identified in the Desktop Review was not observed due to surface conditions previously discussed. Additional evidence of faulting was not observed during the field investigation.

6.3 Karst Features

Karst features were not observed during the field investigation.

6.4 Non-Karst & Manmade Features

One manmade feature in bedrock (S-1) identified during the desktop review was observed during the field investigation. The feature is an in-use industrial water well. One non-karst closed depression (S-4) was identified during the field investigation.

6.5 Feature Descriptions

S-1 (MB)

Not Sensitive

Feature S-1 is a manmade feature in bedrock. It is an industrial water well (Well No.: 5858405). The well has a 12-inch steel casing from the surface down to approximately 376 feet bgs. A concrete pad exists around the wellhead and did not exhibit signs of significant deterioration. Available well documentation is provided in Attachment E. The interpreted probability of rapid infiltration is low. This feature is rated not sensitive.

S-2 (F)

Not Sensitive

Feature S-2 is a mapped fault identified during the Desktop Review. Direct evidence of the fault was not observed in the field. The fault runs generally northeast to southwest with a bearing of approximately 35° which is within the dominant trend range in this area. This fault juxtaposes the Kbu to the northwest and the Kau to the southeast. The interpreted probability of rapid infiltration is low. This feature is rated not sensitive.

S-3 (F)

Not Sensitive

Feature S-3 is a mapped fault identified during the Desktop Review. Direct evidence of the fault was not observed in the field. The fault runs generally north to south with a bearing of approximately 12° which falls outside the dominant trend range in this area. The Kau is mapped on both sides of the fault, with the northern end of the fault ending into

the S-2 fault in the northwest portion of the site. The interpreted probability of rapid infiltration is low. This feature is rated not sensitive.

S-4 (CD)

Not Sensitive

Feature S-4 is a non-karst closed depression. The feature is located at the downstream end of a shallow swale that traverses the field in the southern portion of the property. In interpreted origin of this feature is from grading and plowing related to farming activities. The interpreted probability of rapid infiltration is low. This feature is rated not sensitive.

7.0 REFERENCES

- (NRCS, 2021) National Resources Conservation Service, Web soil Survey
Accessed: June 17, 2021
<https://websoilsurvey.sc.egov.usda.gov/App/WebSoilSurvey.aspx>
- (RRC, 2021) Railroad Commission of Texas. Public GIS Viewer.
Accessed: June 18, 2021
<https://gis.rrc.texas.gov/GISViewer/>
- (TWDB, 2021) Texas Water Development Board. Water Data Interactive Groundwater Data Viewer
Accessed: June 18, 2021
<https://www3.twdb.texas.gov/apps/WaterDataInteractive/GroundwaterDataViewer/?map=sdr>
- (USGS, 2018) Pedraza, D.E., Clark, A.K., and Morris, R.R., 2018, Geospatial Dataset of the Geologic Framework and Hydrostratigraphy of the Edwards and Trinity Aquifers within Hays County, Texas at 1:24,000 scale: U.S. Geological Survey data release,
<https://doi.org/10.5066/P9IEJHMH>.
- (USGS, 1995) Hanson, J.A., and Small, T.A., 1995, Geologic Framework and Hydrogeologic Characteristics of the Edwards Aquifer Outcrop, Hays County, Texas: U.S. Geological Survey Water-Resources Investigations Report 95-4265
https://www.edwardsaquifer.org/wp-content/uploads/2019/05/1995_HansonSmall_HaysOutcrop.pdf

SELECT PHOTOGRAPHS




Feature S-1: Industrial Water Well.




Feature S-1: Industrial Water Well.

Attachment D

**Site Geologic Map
Site Soils Map**

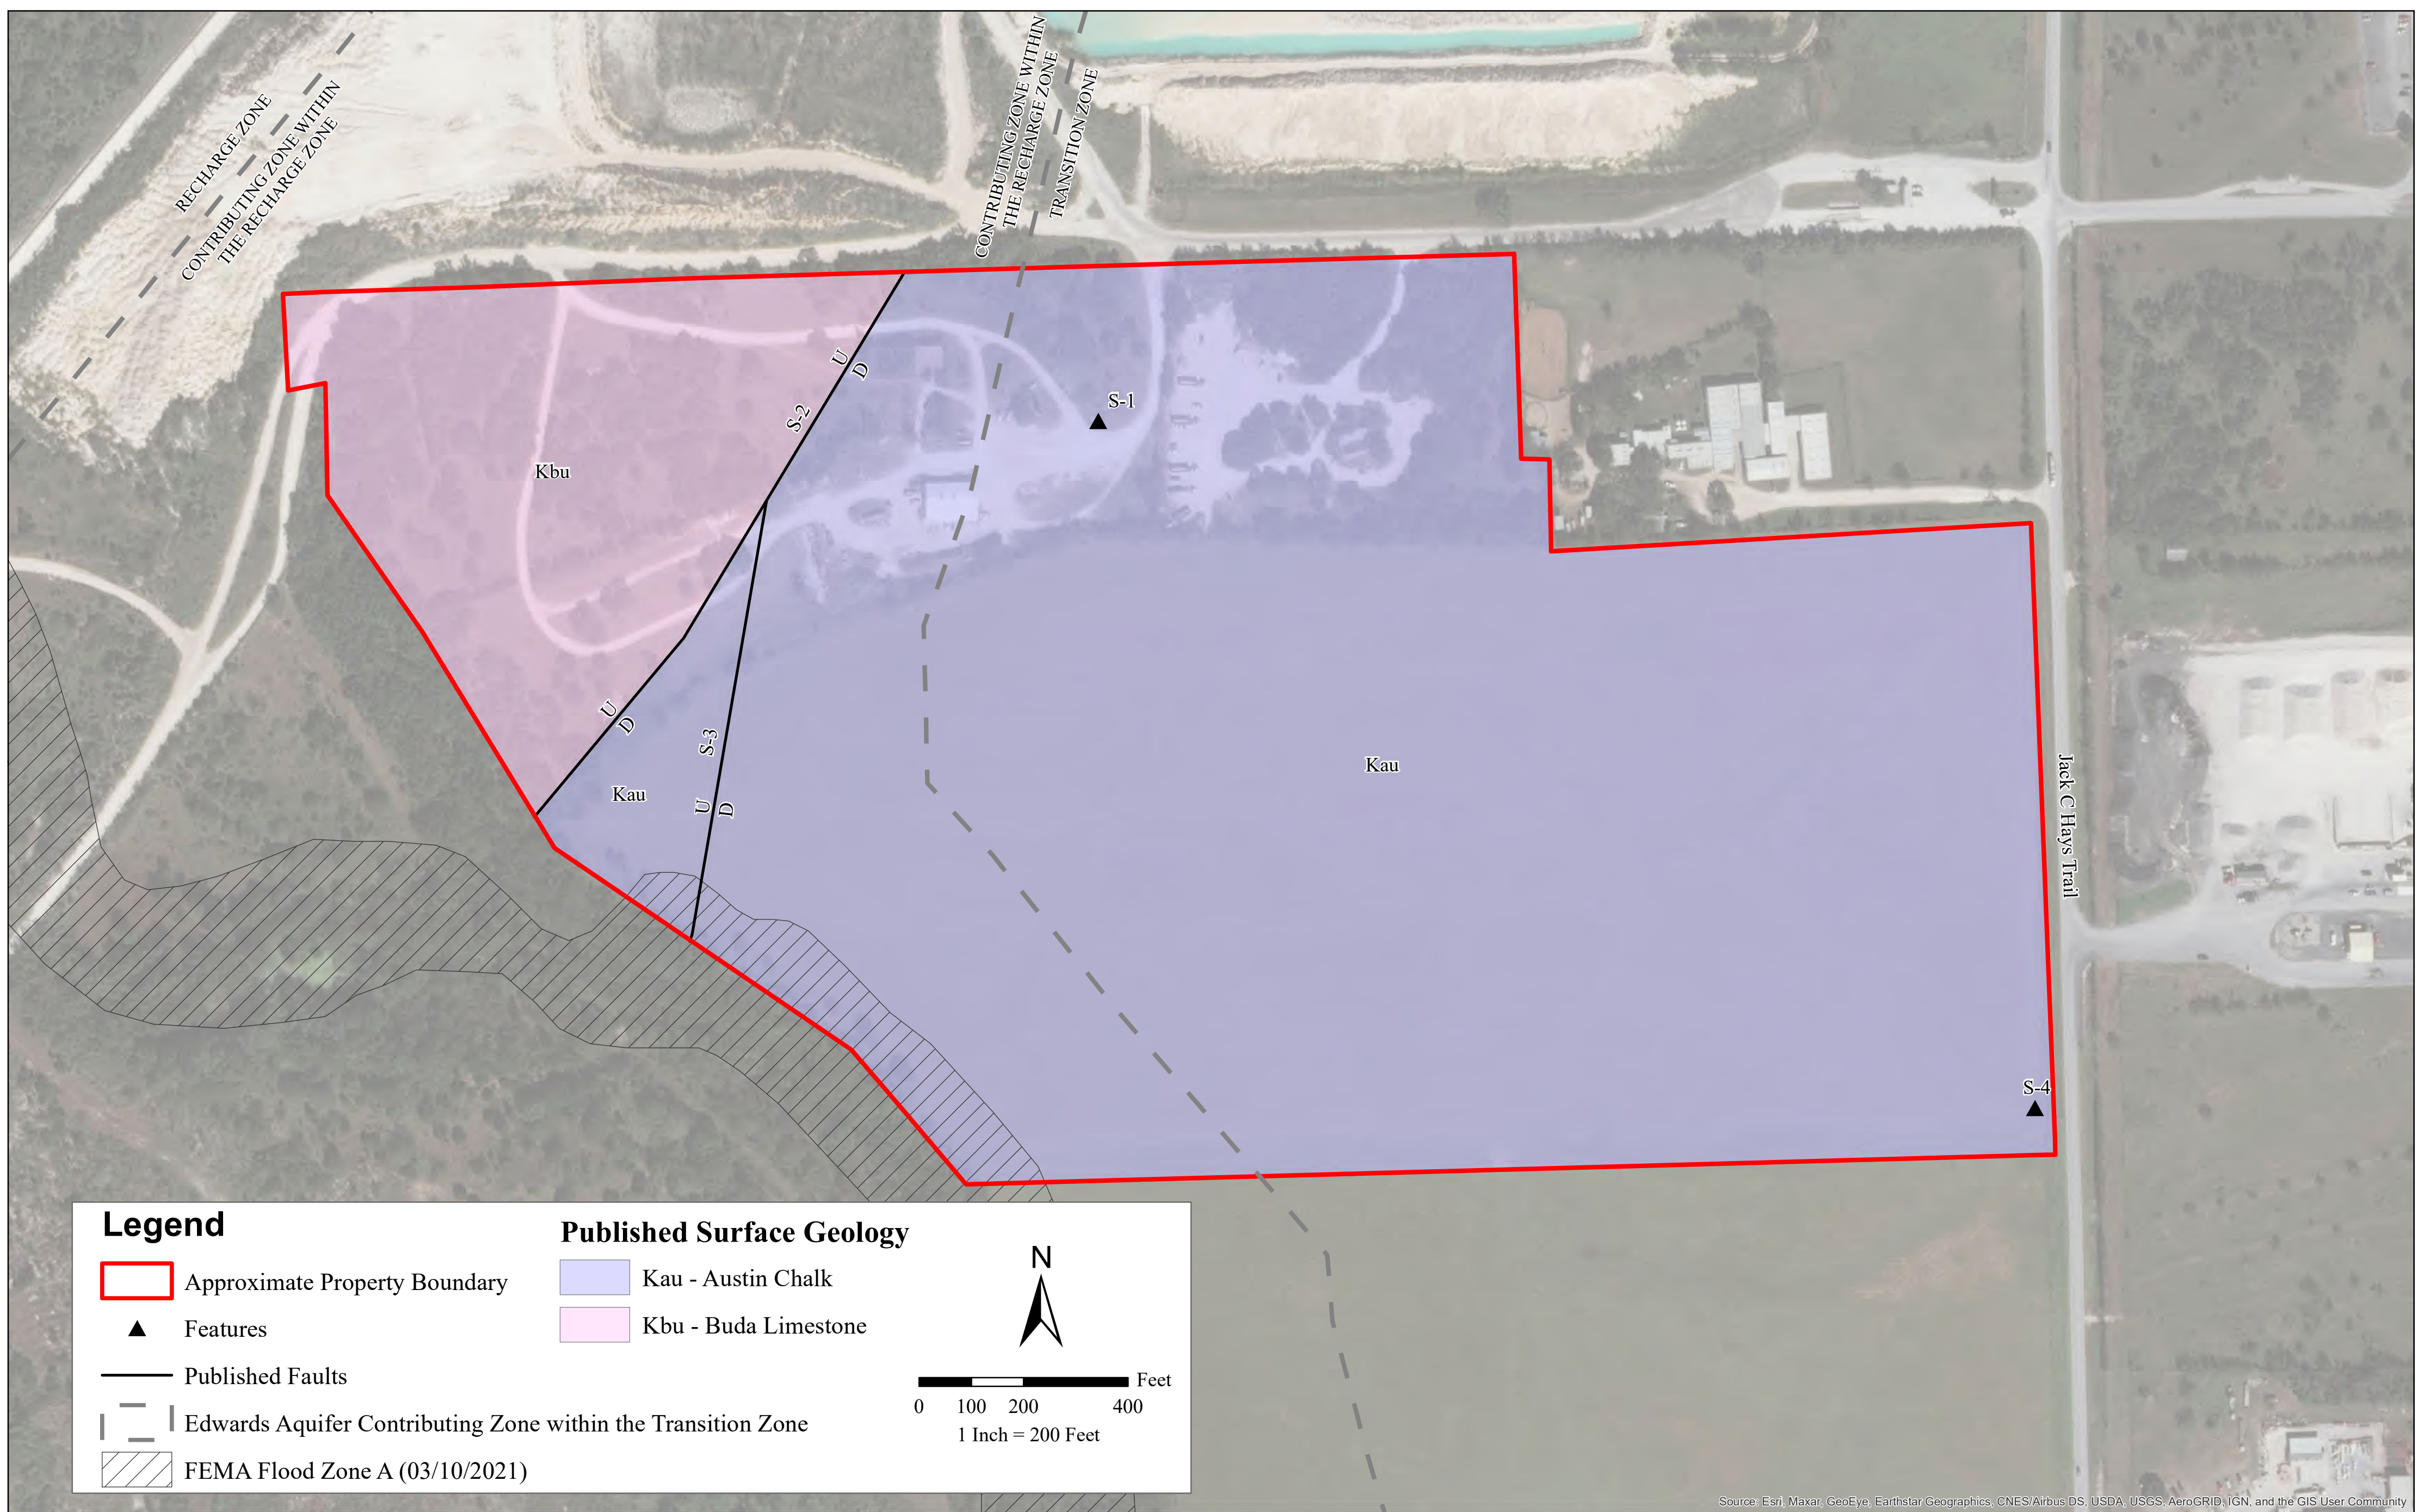


SITE GEOLOGIC MAP

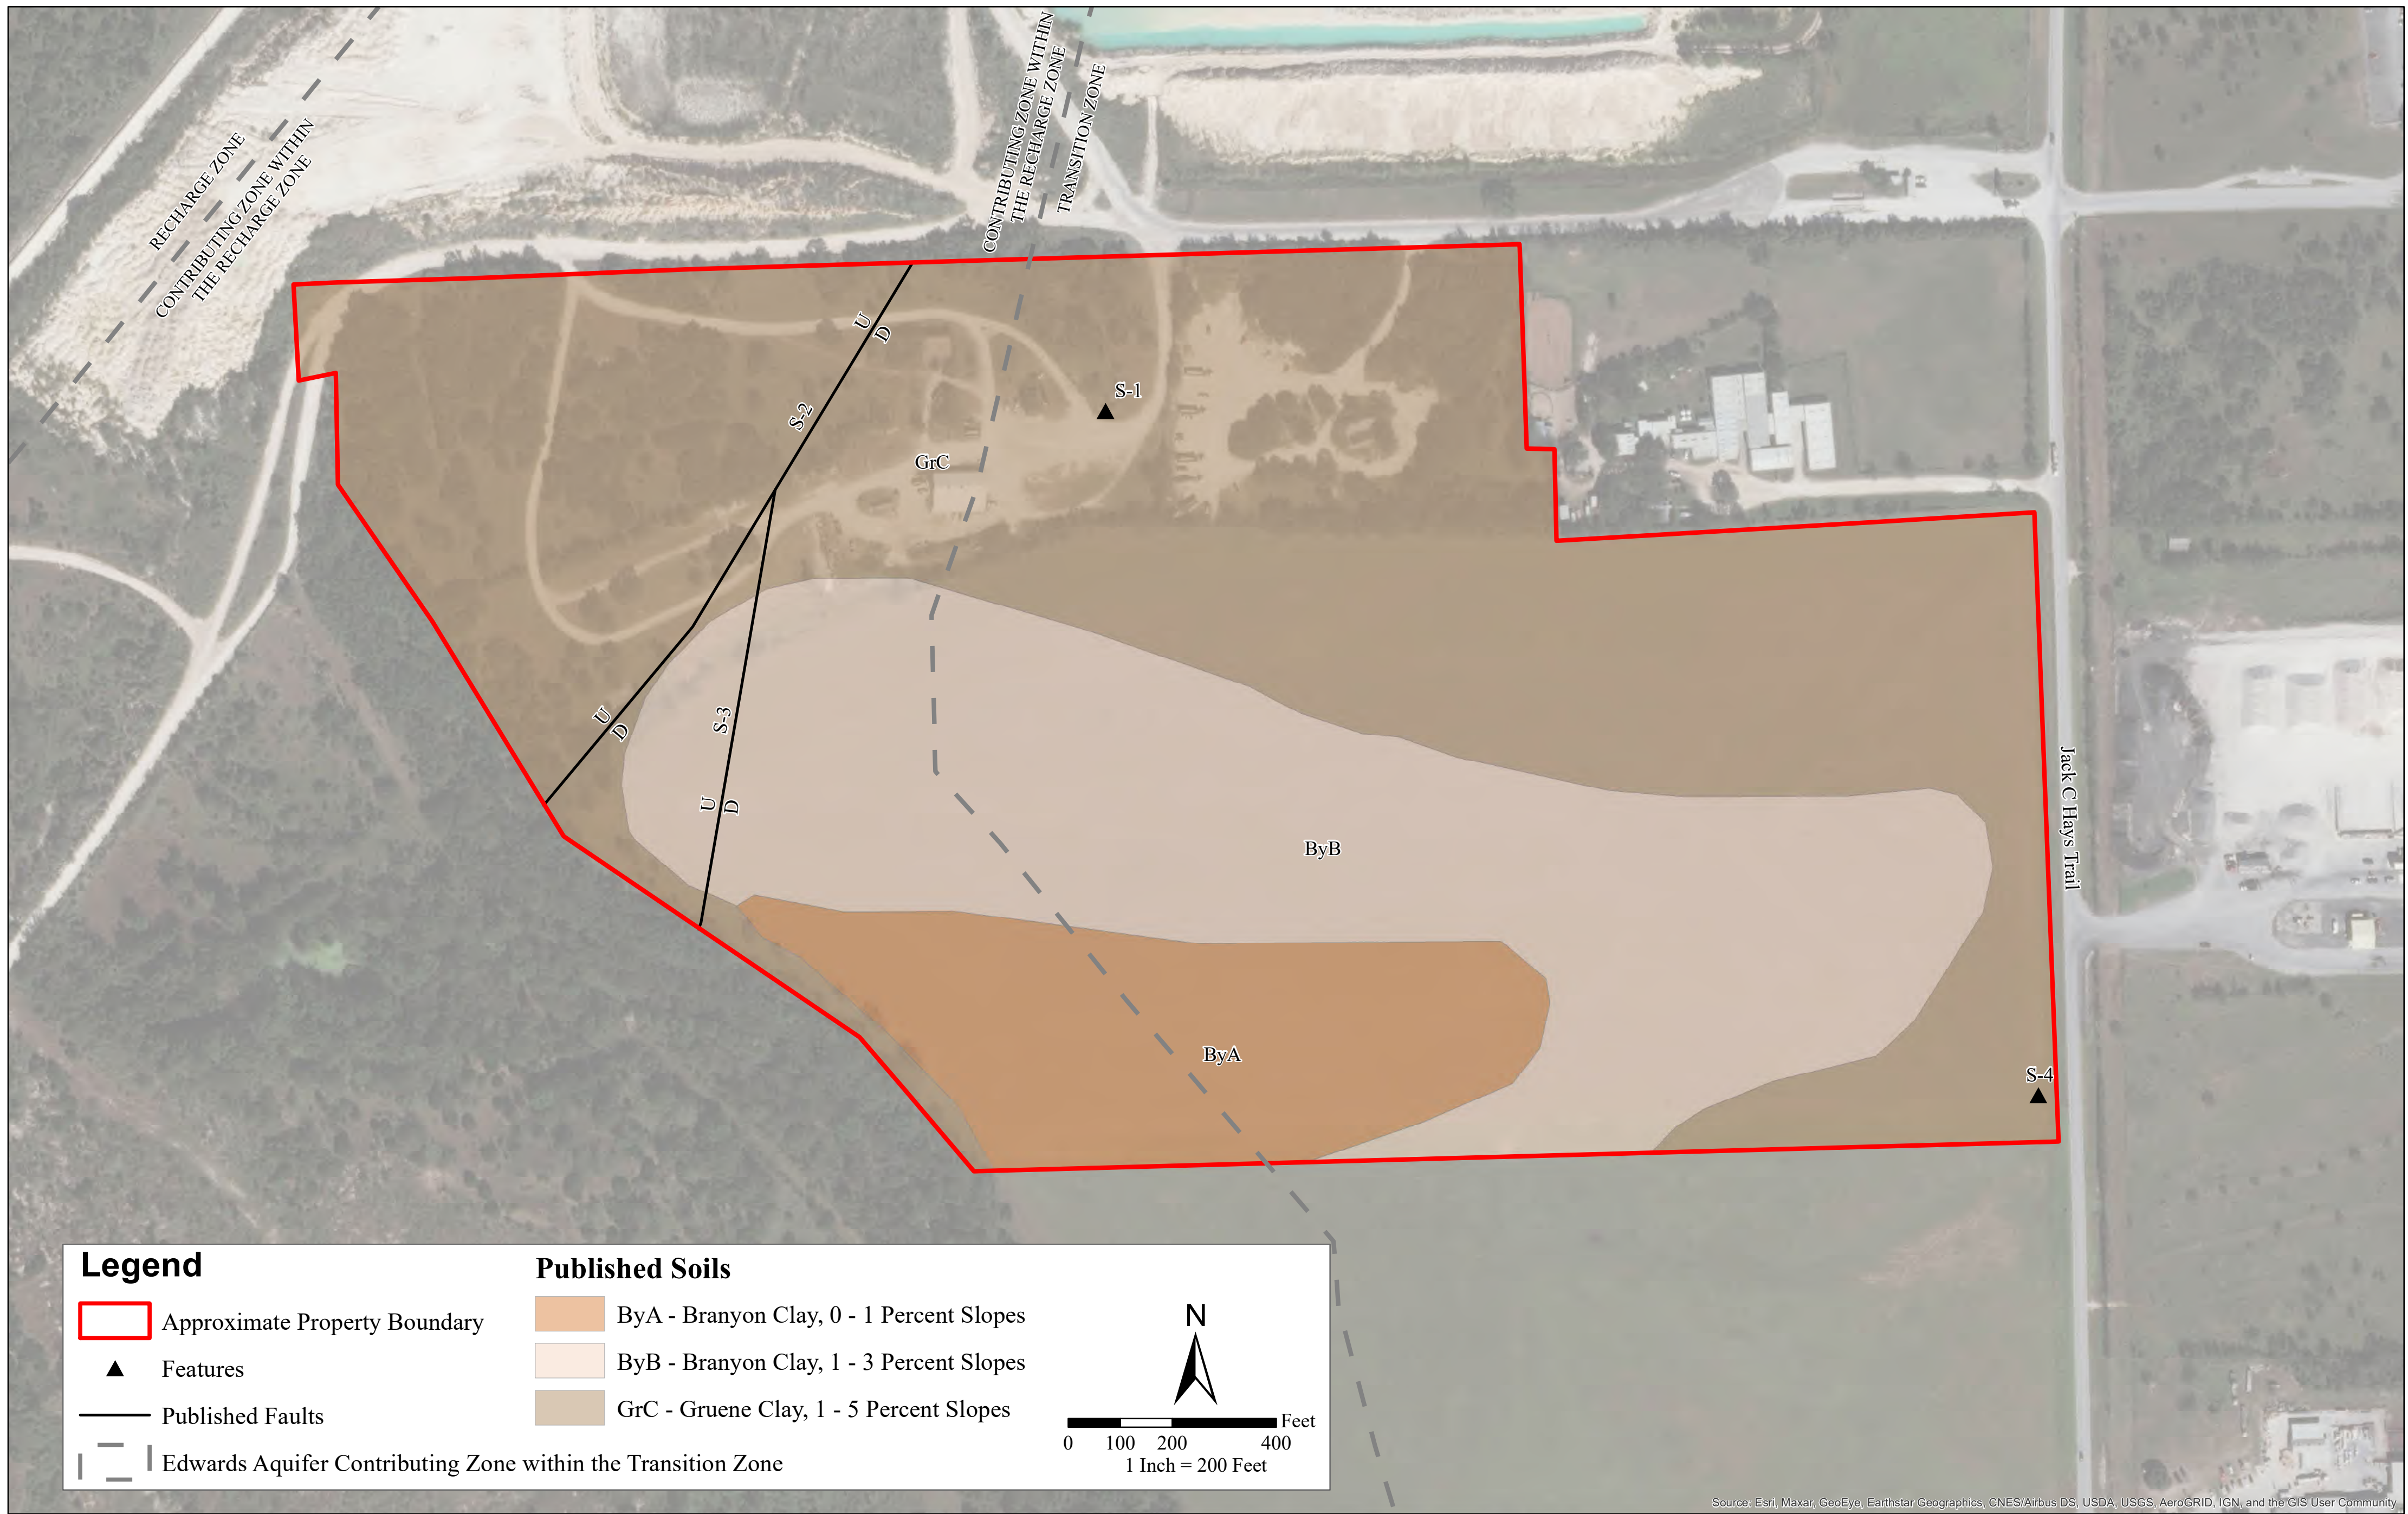

SITE SOILS MAP

SITE GEOLOGIC & SITE SOILS MAPS

GEOLOGIC ASSESSMENT - BUDA SHOP
CENTEX MATERIALS, LLC
1100 JACK C HAYS TRAIL, BUDA, HAYS COUNTY, TEXAS

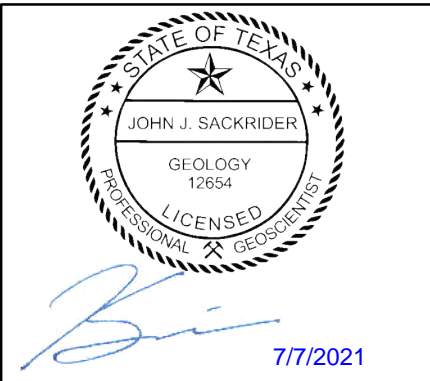

REV	DESCRIPTION	BY	DATE



IMAGE: ESRI BASEMAP	
ISSUE DATE:	07/07/2021
DRAWN BY:	JIS
CHECKED BY:	ML
SCALE: 1" =	200'
JOB NO.:	10079-104

SHEET NO.:

01

OF 01

Attachment E

Well Information Report for State Well Number 5858405 and Scanned Documents

[GWDB Reports and Downloads](#)
[Well Basic Details](#)
[Scanned Documents](#)

State Well Number	5858405
County	Hays
River Basin	Guadalupe
Groundwater Management Area	10
Regional Water Planning Area	K - Lower Colorado
Groundwater Conservation District	Barton Springs/Edwards Aquifer CD
Latitude (decimal degrees)	30.067778
Latitude (degrees minutes seconds)	30° 04' 04" N
Longitude (decimal degrees)	-97.863056
Longitude (degrees minutes seconds)	097° 51' 47" W
Coordinate Source	+/- 1 Second
Aquifer Code	218EDRDA - Edwards and Associated Limestones
Aquifer	Edwards (Balcones Fault Zone)
Aquifer Pick Method	
Land Surface Elevation (feet above sea level)	752
Land Surface Elevation Method	Digital Elevation Model -DEM
Well Depth (feet below land surface)	797
Well Depth Source	Driller's Log
Drilling Start Date	
Drilling End Date	0/0/1961
Drilling Method	Cable Tool
Borehole Completion	Open Hole

Well Type	Withdrawal of Water
Well Use	Industrial
Water Level Observation	Miscellaneous Measurements
Water Quality Available	No
Pump	Turbine
Pump Depth (feet below land surface)	
Power Type	Electric Motor
Annular Seal Method	
Surface Completion	
Owner	Centex Materials
Driller	J T Johnson
Other Data Available	Aquifer Test; Drillers Log
Well Report Tracking Number	
Plugging Report Tracking Number	
U.S. Geological Survey Site Number	
Texas Commission on Environmental Quality Source Id	
Groundwater Conservation District Well Number	
Owner Well Number	
Other Well Number	
Previous State Well Number	
Reporting Agency	U.S. Geological Survey
Created Date	11/21/1967
Last Update Date	2/24/2011

Remarks Original schedule by USGS in 1961. Mis-numbered by TWDB as 414 in 19- 88. Reported average yield 1285 GPM in 1991. Aquifer test observed by wells 404 and 416. Test data in TWDB files. Site 21 in BSEACD Report 2010-0701.

Casing

Diameter (in.)	Casing Type	Casing Material	Schedule	Gauge	Top Depth (ft.)	Bottom Depth (ft.)
12	Blank	Steel			0	376
	Open Hole				376	797

Well Tests - No Data

Lithology - No Data

Annular Seal Range - No Data


Borehole - No Data

Plugged Back - No Data

Filter Pack - No Data

Packers - No Data

Water Level Measurements

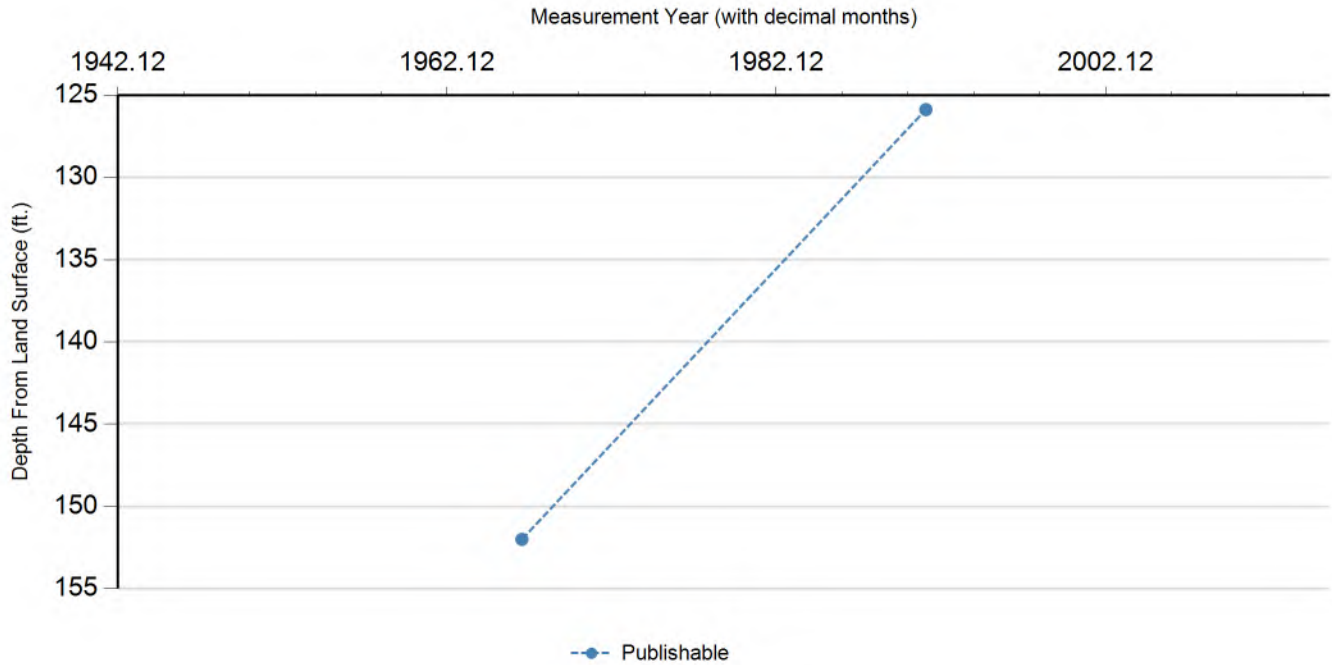

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	8/31/1966		152		600	1	U.S. Geological Survey	Steel Tape		
P	3/14/1991		125.88	(26.12)	626.12	1	Groundwater Consultant	Steel Tape		

Code Descriptions

Status Code	Status Description
P	Publishable

Water Quality Analysis - No Data Available

GWDB DISCLAIMER: Except where noted, all of the information provided in the Texas Water Development Board (TWDB) Groundwater Database (<http://www.twdb.texas.gov/groundwater/data/gwdbbrpt.asp>) is believed to be accurate and reliable; however, the TWDB assumes no responsibility for any errors appearing in rules or otherwise. Further, TWDB assumes no responsibility for the use of the information provided. PLEASE NOTE that users of these data are responsible for checking the accuracy, completeness, currency and/or suitability of all information themselves. TWDB makes no guarantees or warranties as to the accuracy, completeness, currency, or suitability of the information provided via the Groundwater Database (GWDB). TWDB specifically disclaims any and all liability for any claims or damages that may result from providing GWDB data or the information it contains. For additional information or answers to questions concerning the TWDB GWDB, contact the Groundwater Data Team at GroundwaterData@twdb.texas.gov.

WRD Exp. (GW)
April 1966

Well No. LR-58-58-405.

WELL SCHEDULE

U. S. DEPT. OF THE INTERIOR

GEOLOGICAL SURVEY

WATER RESOURCES DIVISION

MASTER CARD (T.V.K.)

Record by C. Puente Source of data Driller Date 11/2/67 Map Hays Co Hwy 1" = 2 mi

State Texas County 49 (or town) Hays Sequential number 1

Latitude: 30° 04' 03" N Longitude: 097° 51' 48" W

Lat-long accuracy: 3 T 3 S, R 3 W, Sec 3 T, 3 S, 3 W, 3 Sec

Local well number: LR-58-58-405 Other number: E-33

Local use: 3 Owner or name: J. R. Howe

Owner or name: J. R. Howe Address: Hays, Tex

Ownership: County, Fed Gov't, City, Corp or Co, Private State Agency, Water Dist P

Use of water: (A) Air cond, Bottling, Comm, Dewater, Power, Fire, Dom, Med, Ind, P S, Rec, (S) Stock, Instit, Unused, Repressure, Recharge, Desal-P S, Desal-other, Other I

Use of well: (A) Anode, Drain, Seismic, Heat Res, Obs, Oil-gas, Recharge, Test, Unused, Withdraw, Waste, Destroyed W

DATA AVAILABLE: Well data 5 Freq. W/L meas.: 3 Field aquifer char. 73

Hyd. lab. data: 73

Qual. water data; type: 74

Freq. sampling: 75 Pumpage inventory: yes no, period: 76

Aperture cards: 77

Log data: ST-Edw 376-797 D 78 79

WELL-DESCRIPTION CARD

SAME AS ON MASTER CARD Depth well: 797 ft Meas. 797 accuracy 3

Depth cased: 376 ft Casing type: steel Diam. 12 in

Finish: porous gravel w. gravel w. horiz. open perf., screen, sd. pt., shored, other X

Method: (A) air bored, (B) auger, (C) dug, (D) hvd jetted, (E) air reverse trenching, driven, drive wash, (F) percussion, rotary, (G) other C

Date Drilled: 1961 Pump intake setting: 561 ft

Driller: J. T. Johnson address San Antonio, Tex

Lift (type): (A) air, bucket, cent, jet, (B) multiple, (C) multiple, (D) multiple, (E) none, piston, rot, submerg, turb, other T Deep P Shallow 40

Power (type): diesel, elec, gas, gasoline, hand, gas, wind; H.P. 100 Trans. or meter no. 41

Descrip. MP above ft below LSD, Alt. MP 42

Alt. LSD: 160 Accuracy: 43

Water Level 160 ft above MP; Ft below LSD 160 Accuracy: 44

Date meas: 1967 Yield: 1300 gpm Method determined 45

Drawdown: 1300 ft Accuracy: 46 Pumping period 47 hrs 48

QUALITY OF WATER DATA: Iron 49 Sulfate 50 Chloride 51 Hard. 52

Sp. Conduct 53 K x 10 54 Temp. 55 Date sampled 56

Taste, color, etc. 57

Well No. LR-58-53-405

Latitude-longitude N
S
d m s d m s

HYDROGEOLOGIC CARD

SAME AS ON MASTER CARD

Physiographic
Province: Coastal Plains

Section: West Gulf

Coastal Plains

Drainage
Basin: F

52 I

Subbasin: 26

(D) (C) (E) (F) (H) (K) (L)
Topo of depression, stream channel, dunes, flat, hilltop, sink, swamp,
well site: (O) (P) (S) (T) (U) (V)
offshore, pediment, hillside, terrace, undulating, valley flat

MAJOR

AQUIFER: Cretaceous Louisiana V.1 Edwards E.A

Lithology: Fractured limestone 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

Length of well open to: 42 ft. Depth to top of: 376 ft.

MINOR

AQUIFER: system series 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

Lithology: 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

Length of well open to: 42 ft. Depth to top of: 376 ft.

Intervals

Screened: 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

Depth to consolidated rock: 60 ft. Source of data: 64


Depth to basement: 65 ft. Source of data: 69

Surface material: 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

Coefficient of Trans: 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

Coefficient of Storage: 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100


Perm: 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100



Well No.

58-58-405

J.R. Howe
817 National Bank of Comm.
SAN ANTONIO, TEXAS
Oct. 90 M. 3.9
Bob Johnson

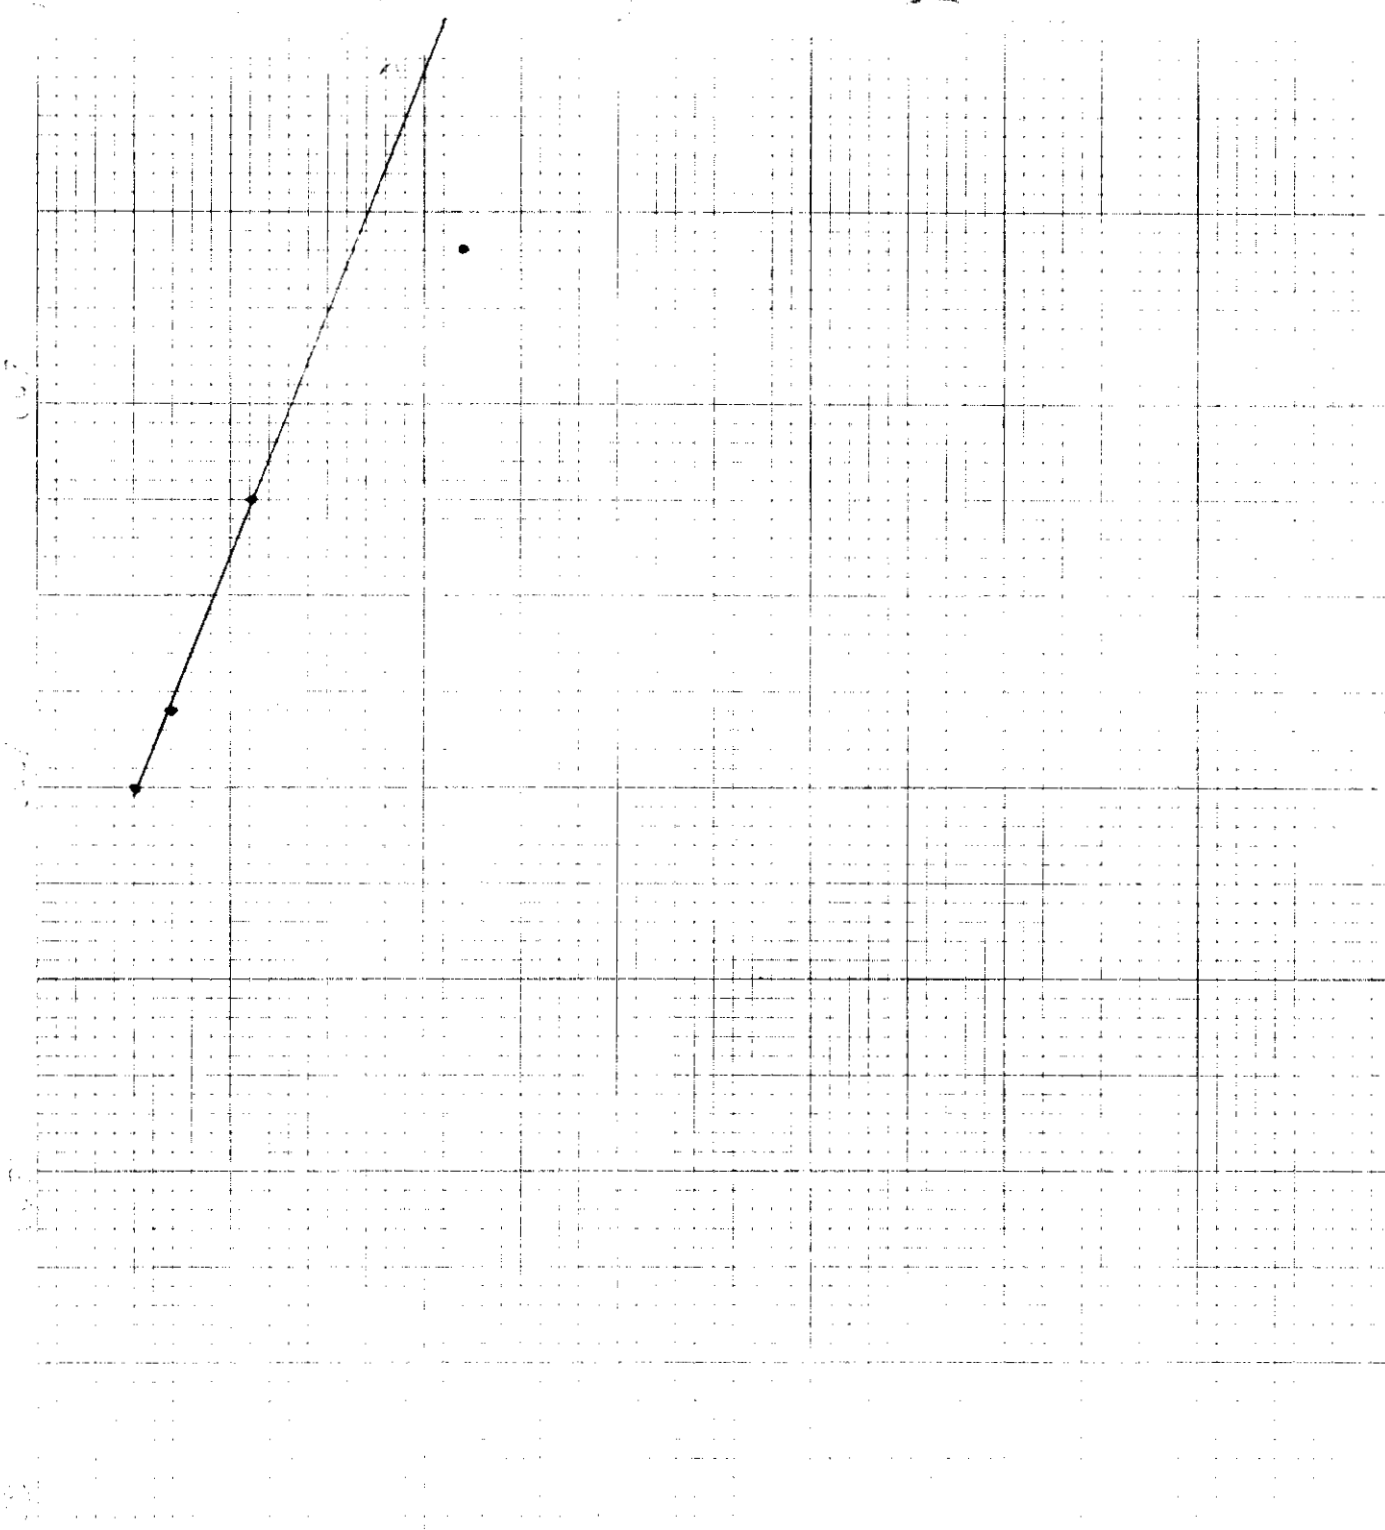

Aboveground Storage Tank Facility Plan Application

Texas Commission on Environmental Quality

For Permanent Storage on The Edwards Aquifer Recharge and Transition Zones And Relating to 30 TAC §213.5(e), Effective June 1, 1999

To ensure that the application is administratively complete, confirm that all fields in the form are complete, verify that all requested information is provided, consistently reference the same site and contact person in all forms in the application, and ensure forms are signed by the appropriate party.

Note: Including all the information requested in the form and attachments contributes to more streamlined technical reviews.

Signature

To the best of my knowledge, the responses to this form accurately reflect all information requested concerning the proposed regulated activities and methods to protect the Edwards Aquifer. This **Aboveground Storage Tank Facility Plan Application** is hereby submitted for TCEQ review and Executive Director approval. The application was prepared by:


Print Name of Engineer/Agent: Andrea Kidd, P.E.

TX License No. 132541 | TX Firm No. 4524

Date: 11/29/2023

Signature of Engineer/Agent :

Andrea Kidd



Regulated Entity Name: Buda Plant Quarry

Aboveground Storage Tank (AST) Facility Information

1. Tanks and substance stored:

Table 1 - Tank and Substance Storage

<i>AST Number</i>	<i>Size (Gallons)</i>	<i>Substance to be Stored</i>	<i>Tank Material</i>
1	1,000	Used oil	Double-walled steel
2	15,000	Diesel	Double-walled steel

Total x 1.5 = 24,000 Gallons

2. ☐ The AST will be placed within a containment structure that is sized to capture one and one-half (1 1/2) times the storage capacity of the system. For facilities with more than

one tank system, the containment structure is sized to capture one and one-half (1 1/2) times the cumulative storage capacity of all systems.

- ☒ **Attachment A - Alternative Methods of Secondary Containment.** Alternative methods for providing secondary containment are proposed. Specifications that show equivalent protection for the Edwards Aquifer are attached. **Discussion provided for piping and dispensers.**

3. Inside dimensions and capacity of containment structure(s):

Table 2 –Secondary Containment

<i>Length (L) (Ft.)</i>	<i>Width (W) (Ft.)</i>	<i>Height (H) (Ft.)</i>	<i>L x W x H = (Ft3)</i>	<i>Gallons</i>

Total: _____ Gallons

4. ☐ All piping, hoses, and dispensers will be located inside the containment structure.
- ☒ Some of the piping to dispensers or equipment will extend outside the containment structure.
- ☒ The piping will be aboveground
- ☐ The piping will be underground
5. ☒ The containment area must be constructed of and in a material impervious to the substance(s) being stored. The proposed containment structure will be constructed of the tanks are double-walled steel and the concrete pad provides containment for piping and dispensers.
6. ☒ **Attachment B - Scaled Drawing(s) of Containment Structure.** A scaled drawing of the containment structure that shows the following is attached:
- ☐ Interior dimensions (length, width, depth and wall and floor thickness).
- ☐ Internal drainage to a point convenient for the collection of any spillage.
- ☒ Tanks clearly labeled.
- ☒ Piping clearly labeled.
- ☒ Dispenser clearly labeled.

Site Plan Requirements

Items 7 - 18 must be included on the Site Plan.

7. ☒ The Site Plan must have a minimum scale of 1" = 400'.
- Site Plan Scale: 1" = 200'.

8. 100-year floodplain boundaries:

- ☒ Some part(s) of the project site is located within the 100-year floodplain. The floodplain is shown and labeled.
- ☐ No part of the project site is located within the 100-year floodplain.
- ☒ The 100-year floodplain boundaries are based on the following specific (including date of material) sources(s): FIRM Panel # 48209C0280F eff. 9/2/2005.
9. ☐ The layout of the development is shown with existing and finished contours at appropriate, but not greater than ten-foot contour intervals. Show lots, recreation centers, buildings, roads, etc.
- ☒ The layout of the development is shown with existing contours. Finished topographic contours will not differ from the existing topographic configuration and are not shown.
10. All known wells (oil, water, unplugged, capped and/or abandoned, test holes, etc.):
- ☒ There is 1 (#) well present on the project site and the locations are shown and labeled. (Check all of the following that apply):
- ☐ The wells are not in use and have been properly abandoned.
- ☐ The wells are not in use and will be properly abandoned.
- ☒ The wells are in use and comply with 16 TAC § 76.
- ☐ There are no wells or test holes of any kind known to exist on the project site.
11. Geologic or manmade features which are on the site:
- ☐ All sensitive geologic or manmade features identified in the Geologic Assessment are shown and labeled.
- ☒ No sensitive geologic or manmade features were identified in the Geologic Assessment.
- ☐ **Attachment C - Exception to the Geologic Assessment.** A request and justification for an exception to a portion of the Geologic Assessment is attached.
12. ☐ The drainage patterns and approximate slopes anticipated after major grading activities.
N/A – No grading activities
13. ☐ Areas of soil disturbance and areas which will not be disturbed. **N/A - None**
14. ☐ Locations of major structural and nonstructural controls. These are the temporary and permanent best management practices. **N/A - None**
15. ☐ Locations where soil stabilization practices are expected to occur. **N/A**
16. ☒ Surface waters (including wetlands).
☐ N/A
17. ☐ Locations where stormwater discharges to surface water or sensitive features.

☒ There will be no discharges to surface water or sensitive features.

18. ☒ Legal boundaries of the site are shown.

Best Management Practices

19. ☒ Any spills must be directed to a point convenient for collection and recovery. Spills from storage tank facilities must be removed from the controlled drainage area for disposal within 24 hours of the spill.

☒ In the event of a spill, any spillage will be removed from the containment structure within 24 hours of the spill and disposed of properly.

☐ In the event of a spill, any spillage will be drained from the containment structure through a drain and valve within 24 hours of the spill and disposed of properly. The drain and valve system are shown in detail on the scaled drawing.

20. ☐ All stormwater accumulating inside the containment structure will be disposed of through an authorized waste disposal contractor. **N/A**

☐ Containment area will be covered by a roof.

☐ Containment area will not be covered by a roof.

☐ A description of the alternate method of stormwater disposal is submitted for the executive director's review and approval and is attached.

21. ☒ **Attachment D - Spill and Overfill Control.** A site-specific description of the methods to be used at the facility for spill and overfill control is attached.

22. ☒ **Attachment E - Response Actions to Spills.** A site-specific description of the planned response actions to spills that will take place at the facility is attached.

Administrative Information

23. A Water Pollution Abatement Plan (WPAP) is required for construction of any associated commercial, industrial or residential project located on the Recharge Zone.

☐ The WPAP application for this project was approved by letter dated _____. A copy of the approval letter is attached at the end of this application.

☐ The WPAP application for this project was submitted to the TCEQ on _____, but has not been approved.

☐ A WPAP application is required for an associated project, but it has not been submitted.

☐ There will be no building or structure associated with this project. In the event a building or structure is needed in the future, the required WPAP will be submitted to the TCEQ.

☒ The proposed AST is located on the Transition Zone and a WPAP is not required. Information requested in 30 TAC 213.5 subsection (b) (4)(B) and (C) and (5) is provided with this application. (Forms TCEQ-0600 Permanent Stormwater Section

and TCEQ-0602 Temporary Stormwater Section or Stormwater Pollution Prevention Plan/SW3P).

- 24. ☒ This facility is subject to the requirements for the reporting and cleanup of surface spills and overfills pursuant to 30 TAC 334 Subchapter D relating to Release Reporting and Corrective Action.
- 25. ☒ Submit one (1) original and one (1) copy of the application, plus additional copies as needed for each affected incorporated city, groundwater conservation district, and county in which the project will be located. The TCEQ will distribute the additional copies to these jurisdictions. The copies must be submitted to the appropriate regional office.
- 26. ☒ Any modification of this AST Facility Plan application will require executive director approval, prior to construction, and may require submission of a revised application, with appropriate fees.

**Centex Materials, LLC
Buda Plant Quarry**

**AST Plan Application (TCEQ-0575)
Attachment A**

Alternative Methods of Secondary Containment

The two proposed tanks are double-walled steel tanks, which will each be placed on their own curbed concrete pad. Double-walled tanks are manufactured to provide secondary containment for their contents. The interstitial space between the steel walls serves as secondary containment. Discharges from the inner tank will flow into the outer wall that encloses it. Both tanks will be fabricated per UL-142 specifications with the Flameshield designation. Manufacturer drawings of the tanks have been included in this application.

The diesel tank (AST #2) has fill lines and dispensing lines plumbed to the top of the tank to prevent free outward flow of the tank contents. The four-inch height of the curb provides approximately 250 cubic feet of impervious containment (1087 gallons) to provide containment for associated piping, dispensers, hoses, nozzles, and potential drips.

The waste oil tank (AST #1) has no piping associated with it. The four-inch height of the curb provides approximately 19.5 cubic feet of impervious containment (145 gallons) to provide containment for potential drips.

The site will be subject to the Environmental Protection Agency's requirements as specified in 40 CFR Part 112 regarding Spills, Prevention, Control, and Countermeasures (SPCC). The site will maintain an SPCC Plan in accordance with applicable rules.

**AST Plan Application (TCEQ-0575)
Attachment B**

Scaled Drawing of Containment Structure

Included are drawings of the curbed concrete pads for the proposed tanks.

**AST Plan Application (TCEQ-0575)
Attachment D**

Spill and Overfill Control

Personnel in charge of loading/unloading tanks will be trained to utilize proper techniques and preventive measures to avoid spills. The tank levels will be checked prior to loading/unloading and the operator will be present at all times during tank loading/unloading. The tanks will be monitored as they are filled, either visually or in another manner, dependent upon the indicator present in the tank. Both tanks will be equipped with an interstitial monitor and overfill alarm.

**Centex Materials, LLC
Buda Plant Quarry**

**AST Plan Application (TCEQ-0575)
Attachment E**

Spill Response Actions

Education

- (1) Be aware that different materials pollute in different amounts. Make sure that each employee knows what a “significant spill” is for each material they use, and what is the appropriate response for “significant” and “insignificant” spills. Employees should also be aware of when spill must be reported to the TCEQ.
- (2) Educate employees and subcontractors on potential dangers to humans and the environment from spills and leaks.
- (3) Hold regular meetings to discuss and reinforce appropriate disposal procedures (incorporate into regular safety meetings).
- (4) Establish a continuing education program to indoctrinate new employees.
- (5) Have contractor’s superintendent or representative oversee and enforce proper spill prevention and control measures.

General Measures

- (1) To the extent that the work can be accomplished safely, spills of oil, petroleum products, substances listed under 40 CFR parts 110,117, and 302, and sanitary and septic wastes should be contained and cleaned up immediately.
- (2) Store hazardous materials and wastes in covered containers and protect from vandalism.
- (3) Place a stockpile of spill cleanup materials where it will be readily accessible.
- (4) Train employees in spill prevention and cleanup.
- (5) Designate responsible individuals to oversee and enforce control measures.
- (6) Spills should be covered and protected from stormwater run on during rainfall to the extent that it doesn’t compromise clean up activities.
- (7) Do not bury or wash spills with water.
- (8) Store and dispose of used clean up materials, contaminated materials, and recovered spill material that is no longer suitable for the intended purpose in conformance with the provisions in applicable BMPs.

Centex Materials, LLC
Buda Plant Quarry

- (9) Do not allow water used for cleaning and decontamination to enter storm drains or watercourses. Collect and dispose of contaminated water in accordance with applicable regulations.
- (10) Contain water overflow or minor water spillage and do not allow it to discharge into drainage facilities or watercourses.
- (11) Place Safety Data Sheets (SDS), as well as proper storage, cleanup, and spill reporting instructions for hazardous materials stored or used on the project site in an open, conspicuous, and accessible location.
- (12) Keep waste storage areas clean, well-organized, and equipped with ample cleanup supplies as appropriate for the materials being stored. Perimeter controls, containment structures, covers, and liners should be repaired or replaced as needed to maintain proper function.

Cleanup

- (1) Clean up leaks and spills immediately.
- (2) Any spills from an AST facility must be removed from the controlled drainage area for disposal within 24 hours of the spill.
- (3) Use a rag for small spills on paved surfaces, a damp mop for general cleanup, and absorbent material for larger spills. If the spilled material is hazardous, then the used cleanup materials are also hazardous and must be disposed of as hazardous waste.
- (4) Never hose down or bury dry material spills. Clean up as much of the material as possible and dispose of properly. See the waste management BMPs in this section for specific information.

Minor Spills

- (1) Minor spills typically involve small quantities of oil, gasoline, paint, etc. which can be controlled by the first responder at the discovery of the spill.
- (2) Use absorbent materials on small spills rather than hosing down or burying the spill.
- (3) Absorbent materials should be promptly removed and disposed of properly.
- (4) Follow the practice below for a minor spill:
- (5) Contain the spread of the spill.
- (6) Recover spilled materials.

Centex Materials, LLC
Buda Plant Quarry

(7) Clean the contaminated area and properly dispose of contaminated materials.

Semi-Significant Spills

Semi-significant spills still can be controlled by the first responder along with the aid of other personnel such as laborers and the foreman, etc. This response may require the cessation of all other activities.

Spills should be cleaned up immediately:

(1) Contain spread of the spill.

(2) Notify the project foreman as soon as possible.

(3) If the spill occurs on paved or impermeable surfaces, clean up using "dry" methods (absorbent materials, cat litter and/or rags). Contain the spill by encircling with absorbent materials and do not let the spill spread widely.

(4) If the spill occurs in dirt areas, as soon as possible contain the spill by constructing an earthen dike. Dig up and properly dispose of contaminated soil.

(5) If the spill occurs during rain, cover spill with tarps or other material to prevent contaminating runoff.

Significant/Hazardous Spills

For significant or hazardous spills that are in reportable quantities:

(1) Notify the TCEQ by telephone as soon as possible and within 24 hours at 512-339-2929 (Austin) or 210-490-3096 (San Antonio) between 8 AM and 5 PM. After hours, contact the Environmental Release Hotline at 1-800-832-8224. It is the contractor's responsibility to have all emergency phone numbers at the construction site.

(2) For spills of federal reportable quantities, in conformance with the requirements in 40 CFR parts 110, 119, and 302, the contractor should notify the National Response Center at (800) 424-8802.

(3) Notification should first be made by telephone and followed up with a written report.

(4) The services of a spills contractor or a Haz-Mat team should be obtained as soon as possible. Construction personnel should not attempt to clean up until the appropriate and qualified staffs have arrived at the job site.

(5) Other agencies which may need to be consulted include, but are not limited to, the City Police Department, County Sheriff Office, Fire Departments, etc.



Centex Materials, LLC
Buda Plant Quarry

In the event of a reportable spill, the following Emergency Response Agencies can be contacted for assistance. Always inform your supervisor of a reportable spill as soon as possible. Follow company policy when responding to an emergency.


State Emergency Response Commission	(512) 463-7727
National Response Center	(800) 424-8802
US EPA Region 6, Dallas, 24-hr Number	(866) 372-7745
National Weather Service	(281) 337-5074
TCEQ 24-hr	(800) 832-8224
TCEQ Region 11 Austin Office	(512) 339-2929

Vehicle and Equipment Fueling

- (1) If fueling must occur on site, use designated areas, located away from drainage courses, to prevent the run-on of stormwater and the runoff of spills.
- (2) Discourage “topping off” of fuel tanks.
- (3) Always use secondary containment, such as a drain pan, when fueling to catch spills/ leaks.
- (4) Fueling will occur over the impervious concrete slab. Drain pans, curbing and sumps will be used to control spills from fueling.

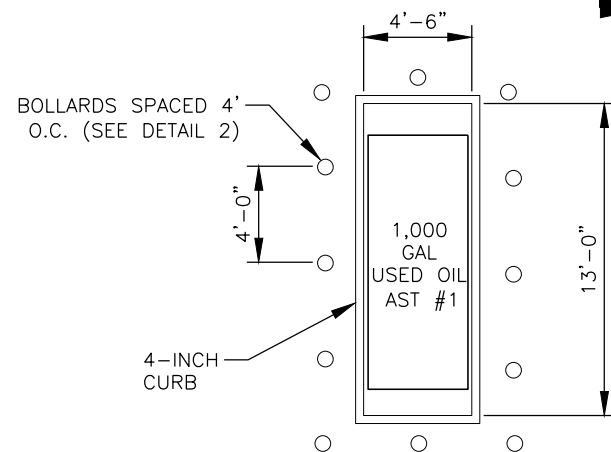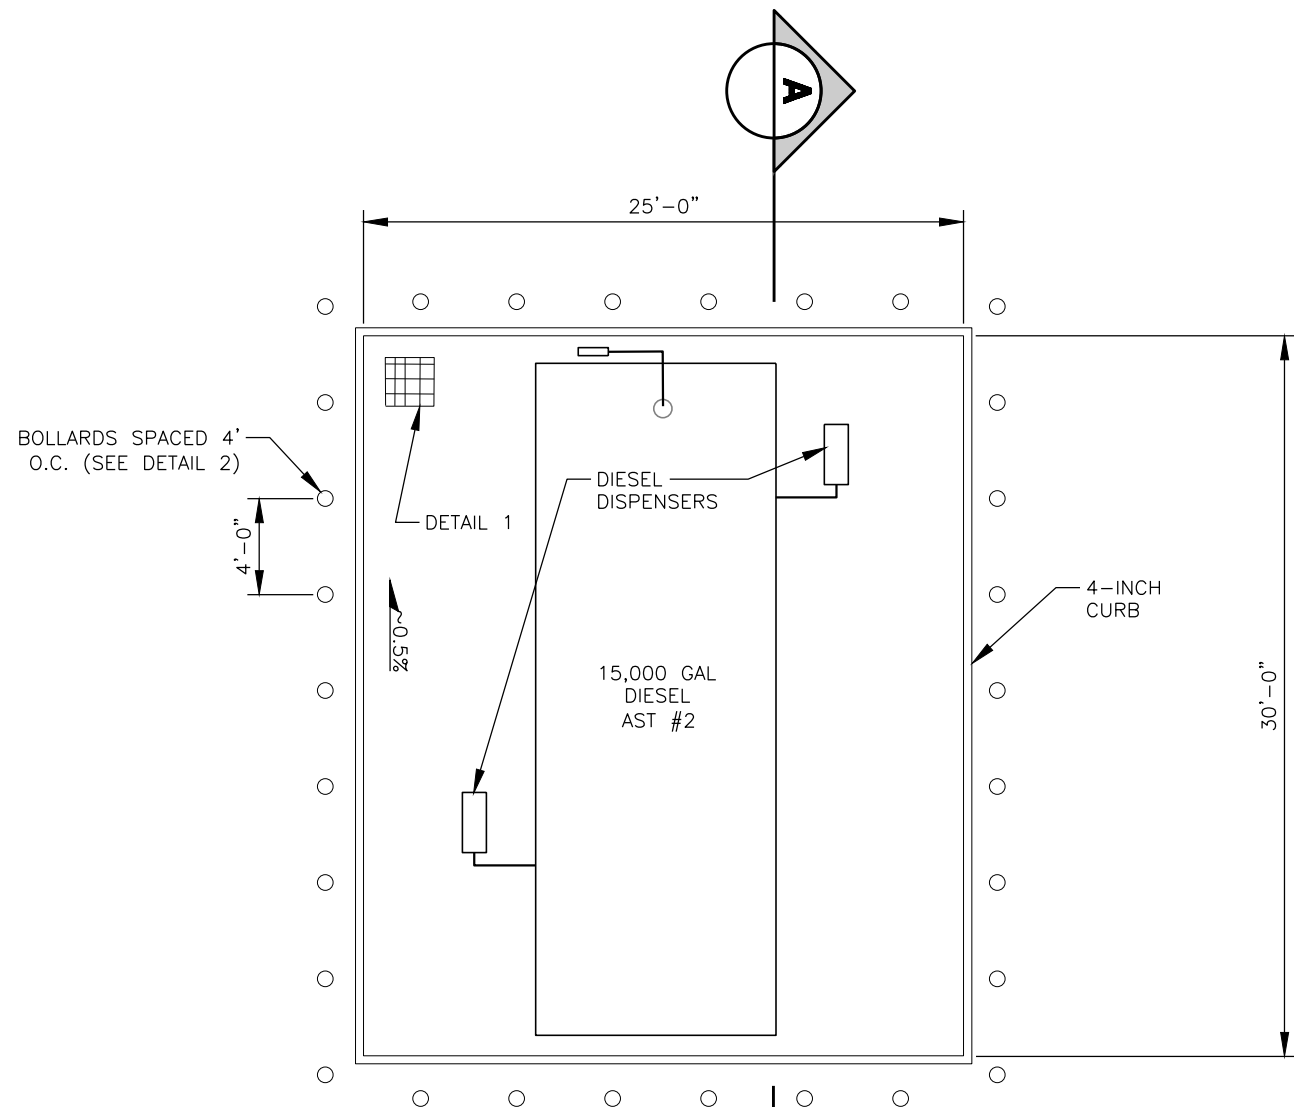


CURBED CONCRETE PADS
SCALE : 1/8" = 1'-0"

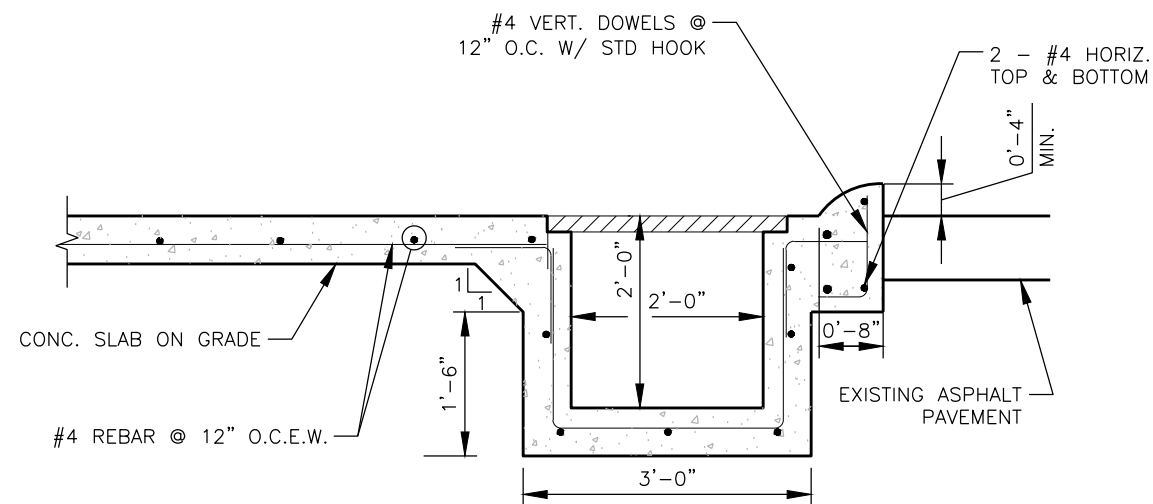

DETAIL 1 - SUMP


SCALE : 1/2" = 1'-0"

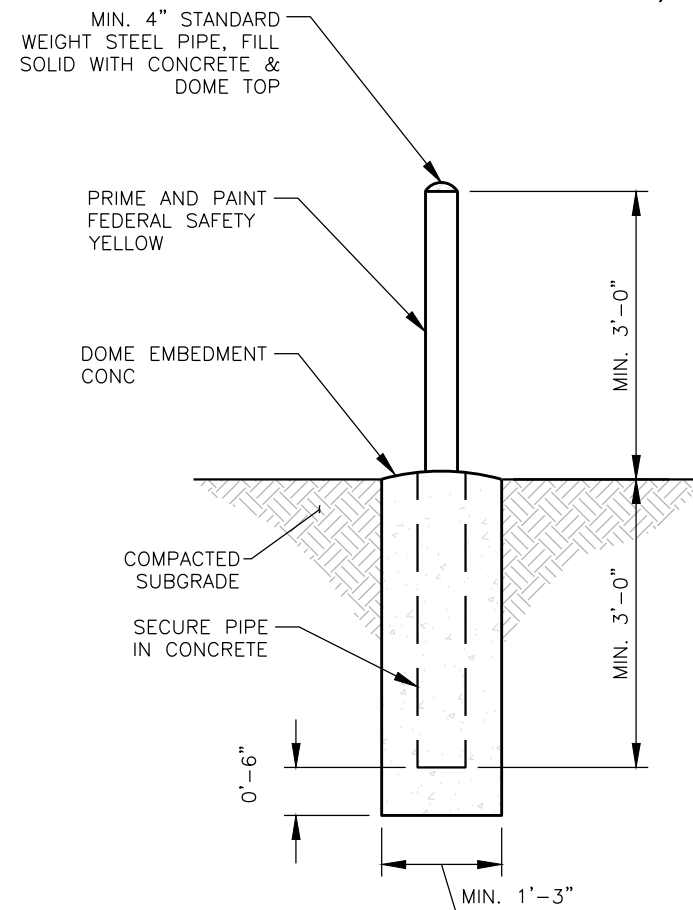


DETAIL 2 - BOLLARD (RECOMMENDED)

SCALE : 1/2" = 1'-0"

A CONCRETE PAD SECTION (TYP)
SCALE : 3/16" = 1'-0"

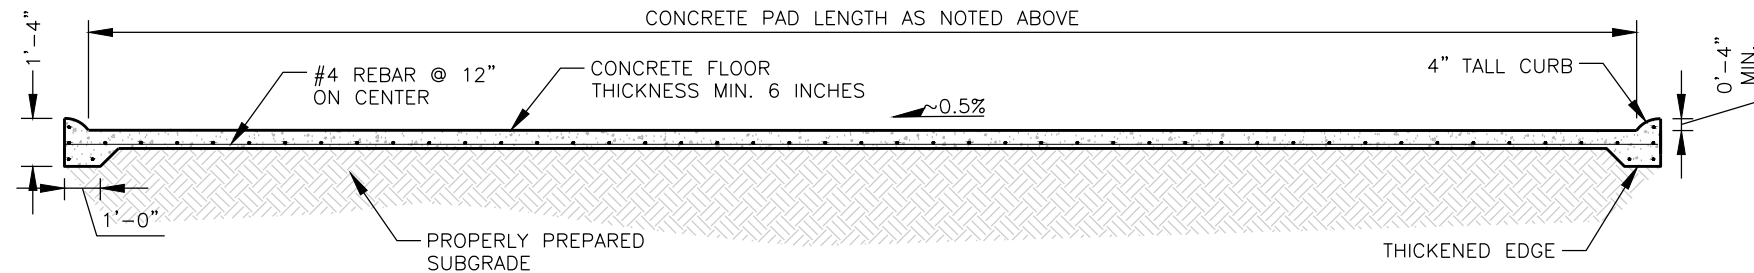

WESTWARD
Environmental Engineering, Natural Resources.
P.O. Box 2205 Boerne, Texas 78006
(830) 249-8284 Fax: (830) 249-0221
TBPE REG. NO.: F-4524
TBPG REG. NO.: 50112



Andrea Kidd

11/29/2023

CURBED CONCRETE PADS

REV.	DESCRIPTION	BY	DATE

IMAGE:	N/A
ISSUE DATE:	11/29/2023
DRAWN BY:	AK
CHECKED BY:	CJF
SCALE: 1" =	AS SHOWN
JOB NO.:	10079-124

SHEET NO.:

2

OF 3

THE FOLLOWING/LISTED "CONSTRUCTION NOTES" ARE INTENDED TO BE ADVISORY IN NATURE ONLY AND DO NOT CONSTITUTE AN APPROVAL OR CONDITIONAL APPROVAL BY THE EXECUTIVE DIRECTOR (ED), NOR DO THEY CONSTITUTE A COMPREHENSIVE LISTING OF RULES OR CONDITIONS TO BE FOLLOWED DURING CONSTRUCTION. FURTHER ACTIONS MAY BE REQUIRED TO ACHIEVE COMPLIANCE WITH TCEQ REGULATIONS FOUND IN TITLE 30, TEXAS ADMINISTRATIVE CODE (TAC), CHAPTERS 213 AND 217, AS WELL AS LOCAL ORDINANCES AND REGULATIONS PROVIDING FOR THE PROTECTION OF WATER QUALITY. ADDITIONALLY, NOTHING CONTAINED IN THE FOLLOWING/LISTED "CONSTRUCTION NOTES" RESTRICTS THE POWERS OF THE ED, THE COMMISSION OR ANY OTHER GOVERNMENTAL ENTITY TO PREVENT, CORRECT, OR CURTAIL ACTIVITIES THAT RESULT OR MAY RESULT IN POLLUTION OF THE EDWARDS AQUIFER OR HYDROLOGICALLY CONNECTED SURFACE WATERS. THE HOLDER OF ANY EDWARDS AQUIFER PROTECTION PLAN CONTAINING "CONSTRUCTION NOTES" IS STILL RESPONSIBLE FOR COMPLIANCE WITH TITLE 30, TAC, CHAPTERS 213 OR ANY OTHER APPLICABLE TCEQ REGULATION, AS WELL AS ALL CONDITIONS OF AN EDWARDS AQUIFER PROTECTION PLAN THROUGH ALL PHASES OF PLAN IMPLEMENTATION. FAILURE TO COMPLY WITH ANY CONDITION OF THE ED'S APPROVAL, WHETHER OR NOT IN CONTRADICTION OF ANY "CONSTRUCTION NOTES," IS A VIOLATION OF TCEQ REGULATIONS AND ANY VIOLATION IS SUBJECT TO ADMINISTRATIVE RULES, ORDERS, AND PENALTIES AS PROVIDED UNDER TITLE 30, TAC § 213.10 (RELATING TO ENFORCEMENT). SUCH VIOLATIONS MAY ALSO BE SUBJECT TO CIVIL PENALTIES AND INJUNCTION. THE FOLLOWING/LISTED "CONSTRUCTION NOTES" IN NO WAY REPRESENT AN APPROVED EXCEPTION BY THE ED TO ANY PART OF TITLE 30 TAC, CHAPTERS 213 AND 217, OR ANY OTHER TCEQ APPLICABLE REGULATION

- A WRITTEN NOTICE OF CONSTRUCTION MUST BE SUBMITTED TO THE TCEQ REGIONAL OFFICE AT LEAST 48 HOURS PRIOR TO THE START OF ANY GROUND DISTURBANCE OR CONSTRUCTION ACTIVITIES. THIS NOTICE MUST INCLUDE:
 - THE NAME OF THE APPROVED PROJECT;
 - THE ACTIVITY START DATE; AND
 - THE CONTACT INFORMATION OF THE PRIME CONTRACTOR.
- ALL CONTRACTORS CONDUCTING REGULATED ACTIVITIES ASSOCIATED WITH THIS PROJECT SHOULD BE PROVIDED WITH COMPLETE COPIES OF THE APPROVED AST PLAN AND THE TCEQ LETTER INDICATING THE SPECIFIC CONDITIONS OF ITS APPROVAL. DURING THE COURSE OF THESE REGULATED ACTIVITIES, THE CONTRACTOR(S) SHOULD KEEP COPIES OF THE APPROVED PLAN AND APPROVAL LETTER ON- SITE.
- NO HAZARDOUS SUBSTANCE STORAGE TANK SHALL BE INSTALLED WITHIN 150 FEET OF A WATER SUPPLY SOURCE, DISTRIBUTION SYSTEM, WELL, OR SENSITIVE FEATURE.
- PRIOR TO BEGINNING ANY CONSTRUCTION ACTIVITY, ALL TEMPORARY EROSION AND SEDIMENTATION (E&S) CONTROL MEASURES MUST BE PROPERLY INSTALLED AND MAINTAINED IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS. IF INSPECTIONS INDICATE A CONTROL HAS BEEN USED INAPPROPRIATELY, OR INCORRECTLY, THE APPLICANT MUST REPLACE OR MODIFY THE CONTROL FOR SITE SITUATIONS. THESE CONTROLS MUST REMAIN IN PLACE UNTIL THE DISTURBED AREAS HAVE BEEN PERMANENTLY STABILIZED.
- ANY SEDIMENT THAT ESCAPES THE CONSTRUCTION SITE MUST BE COLLECTED AND PROPERLY DISPOSED OF BEFORE THE NEXT RAIN EVENT TO ENSURE IT IS NOT WASHED INTO SURFACE STREAMS, SENSITIVE FEATURES, ETC.
- SEDIMENT MUST BE REMOVED FROM THE SEDIMENT TRAPS OR SEDIMENTATION BASINS WHEN IT OCCUPIES 50% OF THE BASIN'S DESIGN CAPACITY.
- LITTER, CONSTRUCTION DEBRIS, AND CONSTRUCTION CHEMICALS EXPOSED TO STORMWATER SHALL BE PREVENTED FROM BEING DISCHARGED OFFSITE.
- ALL EXCAVATED MATERIAL THAT WILL BE STORED ON-SITE MUST HAVE PROPER E&S CONTROLS.
- IF PORTIONS OF THE SITE WILL HAVE A CEASE IN CONSTRUCTION ACTIVITY LASTING LONGER THAN 14 DAYS, SOIL STABILIZATION IN THOSE AREAS SHALL BE INITIATED AS SOON AS POSSIBLE PRIOR TO THE 14TH DAY OF INACTIVITY. IF ACTIVITY WILL RESUME PRIOR TO THE 21ST DAY, STABILIZATION MEASURES ARE NOT REQUIRED. IF DROUGHT CONDITIONS OR INCLEMENT WEATHER PREVENT ACTION BY THE 14TH DAY, STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS POSSIBLE.
- THE FOLLOWING RECORDS SHOULD BE MAINTAINED AND MADE AVAILABLE TO THE TCEQ UPON REQUEST:
 - THE DATES WHEN MAJOR GRADING ACTIVITIES OCCUR;
 - THE DATES WHEN CONSTRUCTION ACTIVITIES TEMPORARILY OR PERMANENTLY CEASE ON A PORTION OF THE SITE; AND
 - THE DATES WHEN STABILIZATION MEASURES ARE INITIATED.
- THE HOLDER OF ANY APPROVED AST PLAN MUST NOTIFY THE APPROPRIATE REGIONAL OFFICE IN WRITING AND OBTAIN APPROVAL FROM THE EXECUTIVE DIRECTOR PRIOR TO INITIATING ANY OF THE FOLLOWING:
 - ANY PHYSICAL OR OPERATIONAL MODIFICATION OF ANY BEST MANAGEMENT PRACTICES (BMPS) OR STRUCTURE(S), INCLUDING BUT NOT LIMITED TO TEMPORARY OR PERMANENT PONDS, DAMS, BERMS, SILT FENCES, AND DIVERSIONARY STRUCTURES;
 - ANY CHANGE IN THE NATURE OR CHARACTER OF THE REGULATED ACTIVITY FROM THAT WHICH WAS ORIGINALLY APPROVED;
 - ANY CHANGE THAT WOULD SIGNIFICANTLY IMPACT THE ABILITY TO PREVENT POLLUTION OF THE EDWARDS AQUIFER; OR
 - ANY DEVELOPMENT OF LAND PREVIOUSLY IDENTIFIED AS UNDEVELOPED IN THE APPROVED CONTRIBUTING ZONE PLAN.

AUSTIN REGIONAL OFFICE
12100 PARK 35 CIRCLE, BUILDING A
AUSTIN, TEXAS 78753-1808
PHONE (512) 339-2929
FAX (512) 339-3795

SAN ANTONIO REGIONAL OFFICE
14250 JUDSON ROAD
SAN ANTONIO, TEXAS 78233-4480
PHONE (210) 490-3096
FAX (210) 545-4329

THESE GENERAL CONSTRUCTION NOTES MUST BE INCLUDED ON THE CONSTRUCTION PLANS PROVIDED TO THE CONTRACTOR AND ALL SUBCONTRACTORS.

GENERAL NOTES

- THE CONTRACTOR SHALL BE RESPONSIBLE AT ALL TIMES THROUGHOUT THE DURATION OF CONSTRUCTION FOR THE PROTECTION OF EXISTING AND NEWLY INSTALLED FACILITIES FROM DAMAGE OR DISRUPTION OF SERVICE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR TAKING SUCH MEASURES AS NECESSARY TO PROTECT THE HEALTH, SAFETY, AND WELFARE OF THOSE PERSONS HAVING ACCESS TO THE WORK SITE.
- FACILITIES PROPOSED HEREIN SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE APPROVED PLANS. DEVIATIONS FROM THE APPROVED PLANS MUST BE APPROVED IN ADVANCE BY THE ENGINEER OF RECORD.
- UPON COMPLETION OF CONSTRUCTION AND PRIOR TO FINAL ACCEPTANCE OF THE WORK, A FINAL INSPECTION SHALL VERIFY PROPER ADHERENCE TO ALL FACETS OF THE PLANS AND SPECIFICATIONS.
- AS-BUILT DRAWINGS SHALL BE PREPARED BY A REGISTERED LAND SURVEYOR, REGISTERED IN THE STATE OF TEXAS, AND SUBMITTED BY THE CONTRACTOR TO THE ENGINEER OF RECORD. CONTRACTOR TO PROVIDE RECORD INFORMATION WHICH LOCATES ALL UNDERGROUND UTILITIES, SITE GRADING AND CLEARANCE TO WATER MAIN FROM OTHER UTILITIES HORIZONTAL AND VERTICAL.
- CONTRACTOR SHALL NOTIFY TEXAS811 ONE CALL SYSTEM (1-800-344-8377) 48 HOURS IN ADVANCE OF CONSTRUCTION.
- ALL VEGETATION, DEBRIS, CONCRETE OR OTHER UNSUITABLE MATERIAL SHALL BE LEGALLY DISPOSED OF OFF-SITE IN AN APPROPRIATE AREA AT THE CONTRACTORS EXPENSE.
- CONTRACTOR SHALL UTILIZE CONSTRUCTION METHODS AND DEVICES, SUCH AS TURBIDITY SCREENS, CURTAINS AND FLOATING SILT BARRIERS WHERE NECESSARY IN ORDER TO COMPLY WITH ALL STATE AND LOCAL WATER QUALITY STANDARDS.
- ALL CONSTRUCTION SHALL BE DONE IN A SAFE MANNER, SPECIFICALLY, THE RULES AND REGULATIONS OF THE OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION AND THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES SHALL BE STRICTLY OBSERVED.
- MINIMUM COVER SHALL BE 3.0 FEET FOR ALL PIPES. (TYPICAL) UNLESS OTHERWISE NOTED ON DRAWINGS.
- ALL OPEN TRENCHES AND HOLES ADJACENT TO ROADWAY OR WALKWAYS SHALL BE PROPERLY MARKED AND BARRICADED TO ASSURE THE SAFETY OF BOTH VEHICULAR AND PEDESTRIAN TRAFFIC.
- CONTRACTOR SHALL MONITOR AND PROHIBIT THE DEFACING OF FRESHLY PLACED CONCRETE SURFACES. ANY CONCRETE SURFACES DEFACED SHALL BE REPLACED AT NO ADDITIONAL COST TO THE OWNER.
- CLEARING AND GRUBBING SHALL INCLUDE REMOVAL OF ALL VEGETATION AS REQUIRED TO CONSTRUCT THE REQUIRED IMPROVEMENTS.
- PROJECT SITE SAFETY:
 - THE ENGINEER/OWNER OR THEIR EMPLOYEES HAVE NO AUTHORITY TO EXERCISE ANY CONTROL OVER THE CONTRACTOR, ANY SUB-CONTRACTOR OR OTHER ENTITY OR THEIR EMPLOYEES IN CONNECTION WITH THEIR WORK OR ANY JOBSITE HEALTH OR SAFETY PRECAUTIONS.
 - THE CONTRACTOR IS SOLELY RESPONSIBLE FOR JOBSITE SAFETY, AND WARRANTS THAT THIS INTENT IS MADE EVIDENT BY THE AGREEMENT BETWEEN OWNER AND CONTRACTOR.
 - ALL EXISTING OVERHEAD AND UNDERGROUND UTILITIES SHOWN ON THESE DRAWINGS OR ENCOUNTERED THROUGH THE PROGRESSION OF WORK AT THIS PROJECT SITE ARE ASSUMED TO BE LIVE, CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SAFETY PRECAUTIONS WHEN WORKING AROUND EXISTING OVERHEAD OR UNDERGROUND UTILITIES.
- ALL CONCRETE SHALL DEVELOP A MINIMUM OF 4000 p.s.i. COMPRESSIVE STRENGTH AT 28 DAYS, UNLESS OTHERWISE STATED.
- THE SEQUENCE OF CONSTRUCTION SHALL BE SUCH THAT ALL UNDERGROUND INSTALLATION OF ANY KIND THAT WILL COME UNDER THE PAVEMENT OR WITHIN 10 FEET OF ITS EDGES SHALL BE INSTALLED PRIOR TO THE CONSTRUCTION OF THE BASE.
- TRENCHES SHALL BE DRY WHEN PIPES ARE INSTALLED. PIPES PLACED BELOW THE WATER TABLE SHALL BE BEDDED ON PEA GRAVEL AND WELL POINT SYSTEMS SHALL BE USED. ALL DEWATERING PERMITS ARE THE RESPONSIBILITY OF THE CONTRACTOR.
- SIX (6) COPIES OF ALL SHOP DRAWINGS SHALL BE SUBMITTED FOR APPROVAL PRIOR TO CONSTRUCTION. ALL REQUESTS FOR MATERIAL SUBSTITUTIONS MUST BE APPROVED PRIOR TO DELIVERY TO THE SITE. SHOP DRAWINGS SHALL BE SUBMITTED FOR ALL MANUFACTURED ITEMS.
- ALL ROOTS IN THE PAVED AREA MUST BE REMOVED ONE FOOT BELOW THE BOTTOM OF SUB GRADE.
- ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE STDS OF TCEQ
- CONTRACTOR SHALL PERFORM ALL WORK NECESSARY TO LOCATE, EXCAVATE AND PREPARE FOR CONNECTIONS TO THE EXISTING SYSTEMS AS SHOWN ON THE DRAWINGS.
- IF SOD IS USED ONSITE, IT SHALL BE PLACED 2" BELOW THE EDGES OF PAVEMENT TO ALLOW WATER TO DRAIN.
- CONTOURS SHOWN ARE PRE DEVELOPMENT CONTOURS
- COMPACTION NOTES:
 - FOR FILL AREAS WHERE WATER WILL BE IMPOUNDED:
- PLACE FILL IN LIFTS NO MORE THAN 12" DEEP AT NEAR OPT. MOISTURE CONTENT.
- COMPACT TO AT LEAST 95% RC (ASTM D698)
- COMPACT TO SLOPE OF FACE
 - FOR ON GRADE BERMS AND OTHER MISC. FILL
- PLACE CLEAN FILL IN 12" LIFTS
- COMPACT WITH ON-SITE HEAVY EQUIPMENT
- ALL CONCRETE SURFACES TO BE BROOM FINISH UNO
- DRAINAGE STRUCTURES TO MEET MIN. TxDOT SPECIFICATIONS FOR CONSTRUCTION AND PLACEMENT OF TYPE 3 DROP INLET
- CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS AND GRADING PRIOR TO CONSTRUCTION. ENGINEER OF RECORD SHALL BE NOTIFIED OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION.
- ALL RIP RAP SHALL BE COURSE GRADED ROCK AND SHALL BE SIZED IN ACCORDANCE WITH THE FOLLOWING TABLE

SLOPE	RIP RAP SIZE
0.5%-1%	4" ROCK
1.1% TO 2%	6" ROCK
2.1% TO 4%	8" ROCK
4.1% TO 5%	8"-12" ROCK

- MIN THICKNESS OF RIPRAP TO BE 1.5 TIMES THE STONE DIAMETER UNO
- GEOTEXTILE FABRIC (FILTER FABRIC) SHALL BE A MON-WOVEN POLYPROPALENE FABRIC DESIGNED SPECIFICALLY FOR USE AS A SOIL FILTRATION MEDIA w/ APPROX. WEIGHT 6 OZ/YD^2, A MULLEN BURST RATting OF 140 PSI, AND AN EQUIVALENT OPENING SIZE (ESO) GREATER THAN #50 SIEVE. TENCATE MIRFI N-SERIES OF APPROVED EQUAL.
- BASIN LINERS OVER THE RECHARGE ZONE SHALL COMPLY w/ RG-348 FOR COMPACTED CLAY LINERS.
- ALL DISTURBED AREAS TO BE SEEDED AND MULCHED FOR SLOPE STABILIZATION. SEED TO BE BERMUDA GRASS OR APPROVED ALTERNATES.
- ALL CONCRETE SLABS TO HAVE #5 BARS EACH WAY AT 12" c/c IN CENTER OF SLAB UNO.

BMP CONSTRUCTION NOTES

- COMPACTED EARTHEN BERM
INSTALLATION:
COMPRISED OF SOIL AND OVERBURDEN MATTER EITHER GENERATED ONSITE OR DELIVERED FROM OFFSITE. COMPACT WITH HEAVY EQUIPMENT IN 12" (MAX) LIFTS.

MAINTENANCE (TEMPORARY):
INSPECT BERMS ONCE A MONTH UNTIL SUFFICIENTLY VEGETATED. REPLACE AS NECESSARY.

- ROCK BERM
SHOULD BE SECURED WITH A WOVEN WIRE SHEATING, MAX. OPENING 1" AND MIN. WIRE DIA. 20 GAUGE GALVANIZED. SECURE WITH SHOAT RINGS.

INSTALLATION:
AGGREGATE USED SHOULD BE COMPRISED OF OPEN GRADED 3-5" DIAMETER ROCK. BERM SHOULD BE PLACED PERPENDICULAR TO FLOW LINE. SIDE SLOPE MUST BE 2:1 OR FLATTER. WIRE SHEATHING MUST BE SECURED WITH TIE WIRE SO THEY OVERLAP AT LEAST 2".
BERM SHOULD BE BURIED IN A TRENCH APPROX. 4" DEEP.

MAINTENANCE (TEMPORARY):
INSPECT BERMS ONCE A WEEK. REMOVE SEDIMENT AND OTHER DEBRIS WHEN BUILDUP REACHES 6". REPLACE WHEN ROCK BECOMES CLOGGED WITH SEDIMENT.

ALTERNATE #1 & #2 ROCK BERMS (WEI)

INSTALLATION:
AGGREGATE USED SHOULD BE COMPRISED OF OPEN GRADED 3-5" DIAMETER ROCK. BERM SHOULD BE PLACED PERPENDICULAR TO FLOW LINE.

MAINTENANCE (TEMPORARY):
INSPECT BERMS ONCE A WEEK. REMOVE SEDIMENT AND OTHER DEBRIS WHEN BUILDUP REACHES 6". REPLACE WHEN ROCK BECOMES CLOGGED WITH SEDIMENT.

- SILT FENCE W/ TRENCHED TOE
INSTALLATION:
 - STEEL POSTS SHOULD BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POSTS MUST BE EMBEDDED A MIN. OF 1' DEEP AND SPACED NOT MORE THAN 8' ON CENTER. WHERE WATER CONCENTRATES, THE MAX. SPACING SHOULD BE 6'.
 - LAY OUT FENCING DOWN SLOPE OF DISTURBED AREA, FOLLOWING THE CONTOUR AS CLOSELY AS POSSIBLE.
 - THE TOE OF THE SILT FENCE SHOULD BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWN-SLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (E.G. PAVEMENT OR ROCK OUTCROP), WEIGHT FABRIC FLAP WITH 3 IN. OF PEA GRAVEL ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER FENCE.
 - THE TRENCH MUST BE A MIN. OF 6 IN. DEEP AND 6 IN. WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL.

- SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IS IN TURN ATTACHED TO THE STEEL FENCE POST. THERE SHOULD BE A 3-FOOT OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC MEET.
- INSPECT SILT FENCES ONCE A WEEK. REMOVE SEDIMENT AND OTHER DEBRIS WHEN BUILDUP REACHES 6". REPLACE SILT FENCES WHEN TORN OR OTHERWISE UNABLE TO FILTER SEDIMENT.


- STABILIZED CONSTRUCTION ENTRANCE INSTALLATION:
 - AVOID CURVES ON PUBLIC ROADS AND STEEP SLOPES. REMOVE VEGETATION AND OTHER OBJECTIONABLE MATERIAL FROM THE FOUNDATION AREA. GRADE CROWN FOUNDATION FOR POSITIVE DRAINAGE.
 - THE MINIMUM WIDTH OF THE ENTRANCE/EXIT SHOULD BE 12' OR THE FULL WIDTH OF EXIT ROADWAY, WHICHEVER IS GREATER.
 - THE CONSTRUCTION ENTRANCE SHOULD BE 50' LONG.
 - IF THE SLOPE TOWARD THE ROAD EXCEEDS 2%, CONSTRUCT A RIDGE, 6-8" HIGHT WITH 3:1 (H:V) SIDE SLOPES, ACROSS THE FOUNDATION APPROXIMATELY 15 FEET FROM THE ENTRANCE TO DIVERT RUNOFF AWAY FROM THE PUBLIC ROAD.
 - PLACE GEOTEXTILE FABRIC AND GRADE FOUNDATION TO IMPROVE STABILITY, ESPECIALLY WHERE WET CONDITONS ARE ANTICIPATED.
 - PLACE STONE TO DIMENSION AND GRADE SHOWN ON PLANS. LEAVE SURFACE SMOOTH AND SLOPE FOR DRAINAGE.
 - INSTALL A PIPE UNDER PAD AS NEEDED TO MAINTAIN PROPER PUBLIC ROAD DRAINAGE.

MAINTENANCE: INSPECT WEEKLY. REPLACE STONE AS NECESSARY TO PREVENT TRACKING OFF-SITE.

GEOTEXTILE FABRIC PROPERTIES:

- MIN. 6 OZ/SQ. YD.; 140 LB/SQ. IN MULLEN BURST;
- EQUIVALENT OPENING SIZE MIN. 50 SIEVE.
- GRADE SLOPE TO DRAIN.
- ADD ADDITIONAL STONE AS REQUIRED.
- STABILIZED CONSTRUCTION EXIT SHOULD EXTEND FULL WIDTH OF ROAD.

WESTWARD
Environmental Engineering, Natural Resources.
P.O. Box 2205 Boerne, Texas 78006
(830) 249-8284 Fax: (830) 249-0221
TBPg REG. NO.: F-4524
TBPg REG. NO.: 50112

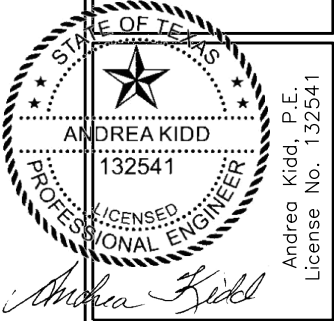

11/29/2023

CONSTRUCTION NOTES



AST PLAN		DATE	
CENTEX MATERIALS, LLC		BY	
BUDA, HAYS COUNTY, TEXAS		DATE	
REV.	DESCRIPTION	BY	DATE

IMAGE: N/A	ISSUE DATE: 11/29/2023	DRAWN BY: AK	CHECKED BY: CJF	SCALE: 1" = NTS	JOB NO.: 10079-124
---------------	---------------------------	-----------------	--------------------	--------------------	-----------------------

SHEET NO.:

Note: This drawing may not be reproduced in any form without the written permission of Hughes Tank Company, Inc. Customer is responsible for verifying correctness of size, location of fittings, accessories and coatings shown on this drawing. Hughes Tank Company, Inc. shall be responsible only for the items indicated in this fabrication drawing unless otherwise noted.

AST 1 - 1000 gallons

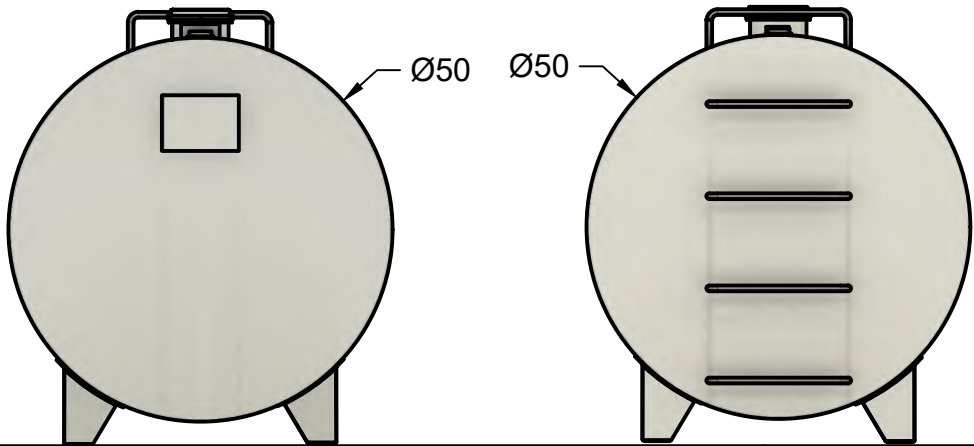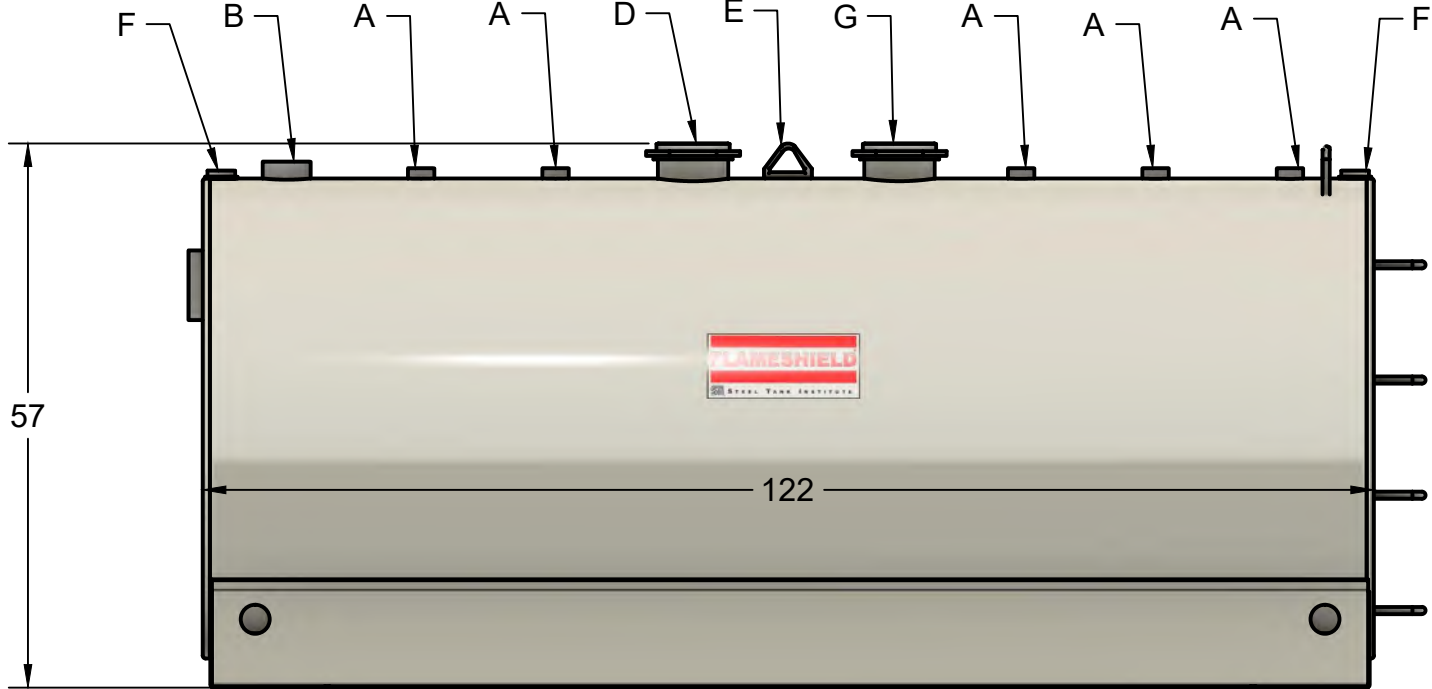

- Inspection: Hughes Tank Company, Inc
- Material: A36 Mild Carbon Steel
- Internal: Surface prep - Clean of Debris
- External: Surface prep - SSPC-SP6 (commercial blast)
- External: (WHITE) Enviroastic 940 LV Polyurthane
Test:
- Inner tank: 5PSIG Hydrostatic
- Outer tank: Hydrostatic
- Pressure Test: 3-5 PSI
Labels:
- UL 142
This drawing may contain **CONFIDENTIAL** information and is intended **ONLY** for the use of the specific individual to which it is addressed.

CUSTOMER APROVAL SIGNATURE: _____ DATE: _____	A	Coupling	2"	2" threaded fitting	Primary
	B	Coupling	4"	4" threaded fitting	Primary
	C	Coupling	6"	6" threaded fitting	Primary
	D	Emergency Vent	6"	6"emergency vent	Primary
	E	Lifting Lug	Med.	Medium lifting lug	Secondary
	F	Interstitial	2"	2" interstitial fitting	Secondary
	G	Emergency Vent	6"	6"emergency vent	Secondary
	H	Manhole	18"	18" manhole	Primary
Note: At no time shall the pressure in the secondary tank exceed the pressure in the primary tank.					
APPROVED Bobby Hughes					
CHECKED Paige Hughes					
DRAWN James Smith					
CUSTOMER: EXCELL					
PROJECT: 1K UL 142 DW FLAMESHIELD FLUSH SKID					
WEIGHT			REV		SHEET 1/1



HUGHES TANK COMPANY, INC.

O: (972) - 366 - 8684
F: (972) - 366 - 3130

2900 N. FM 157
VENUS, TX 76084

P.O. BOX 570
VENUS, TX 76084

DESIGN: Fabricated per UL 142 specifications double wall construction.

- Air test are no less than 3 PSI and no more than 5 PSI.
- Primary tank to be tested alone. Secondary tank to be pressure tested with primary tank. This shall be accomplished by bleeding air from the primary tank to the secondary tank.



- This drawing may contain **CONFIDENTIAL** information and is intended **ONLY** for the use of the specific individual to which it is addressed.

CUSTOMER:

EXCELL



P.O. BOX 570
VENUS, TX 76084

- Air test are no less than 3 PSI and no more than 5 PSI.
- Primary tank to be tested alone. Secondary tank to be pressure tested with primary tank. This shall be accomplished by bleeding air from the primary tank to the secondary tank.

Temporary Stormwater Section

Texas Commission on Environmental Quality

for Regulated Activities on the Edwards Aquifer Recharge Zone and Relating to 30 TAC §213.5(b)(4)(A), (B), (D)(I) and (G); Effective June 1, 1999

To ensure that the application is administratively complete, confirm that all fields in the form are complete, verify that all requested information is provided, consistently reference the same site and contact person in all forms in the application, and ensure forms are signed by the appropriate party.

Note: Including all the information requested in the form and attachments contributes to more streamlined technical reviews.

Signature

To the best of my knowledge, the responses to this form accurately reflect all information requested concerning the proposed regulated activities and methods to protect the Edwards Aquifer. This **Temporary Stormwater Section** is hereby submitted for TCEQ review and executive director approval. The application was prepared by:

Print Name of Engineer/Agent: Andrea Kidd, P.E.

TX License No. 132541 | TX Firm No. 4524

Date: 11/29/2023

Signature of Engineer/Agent:





Regulated Entity Name: Buda Plant Quarry

Project Information

Potential Sources of Contamination

Examples: Fuel storage and use, chemical storage and use, use of asphaltic products, construction vehicles tracking onto public roads, and existing solid waste.

1. Fuels for construction equipment and hazardous substances which will be used during construction:

☒ The following fuels and/or hazardous substances will be stored on the site: diesel and miscellaneous oils.

These fuels and/or hazardous substances will be stored in:

- ☐ Aboveground storage tanks with a cumulative storage capacity of less than 250 gallons will be stored on the site for less than one (1) year.
- ☐ Aboveground storage tanks with a cumulative storage capacity between 250 gallons and 499 gallons will be stored on the site for less than one (1) year.
- ☒ Aboveground storage tanks with a cumulative storage capacity of 500 gallons or more will be stored on the site. An Aboveground Storage Tank Facility Plan application must be submitted to the appropriate regional office of the TCEQ prior to moving the tanks onto the project.
- ☐ Fuels and hazardous substances will not be stored on the site.
- 2. ☒ **Attachment A - Spill Response Actions.** A site specific description of the measures to be taken to contain any spill of hydrocarbons or hazardous substances is attached.
- 3. ☒ Temporary aboveground storage tank systems of 250 gallons or more cumulative storage capacity must be located a minimum horizontal distance of 150 feet from any domestic, industrial, irrigation, or public water supply well, or other sensitive feature.
- 4. ☒ **Attachment B - Potential Sources of Contamination.** A description of any activities or processes which may be a potential source of contamination affecting surface water quality is attached.

Sequence of Construction

- 5. ☐ **Attachment C - Sequence of Major Activities.** A description of the sequence of major activities which will disturb soils for major portions of the site (grubbing, excavation, grading, utilities, and infrastructure installation) is attached. **N/A**
 - ☐ For each activity described, an estimate (in acres) of the total area of the site to be disturbed by each activity is given. **N/A**
 - ☐ For each activity described, include a description of appropriate temporary control measures and the general timing (or sequence) during the construction process that the measures will be implemented. **N/A**
- 6. ☐ Name the receiving water(s) at or near the site which will be disturbed or which will receive discharges from disturbed areas of the project: **N/A**

Temporary Best Management Practices (TBMPs)

Erosion control examples: tree protection, interceptor swales, level spreaders, outlet stabilization, blankets or matting, mulch, and sod. Sediment control examples: stabilized construction exit, silt fence, filter dikes, rock berms, buffer strips, sediment traps, and sediment basins. Please refer to the Technical Guidance Manual for guidelines and specifications. All structural BMPs must be shown on the site plan.

- 7. ☐ **Attachment D – Temporary Best Management Practices and Measures.** TBMPs and measures will prevent pollution of surface water, groundwater, and stormwater. The construction-phase BMPs for erosion and sediment controls have been designed to retain sediment on site to the extent practicable. **N/A**

8. The following information is attached: **N/A**

- ☐ A description of how BMPs and measures will prevent pollution of surface water, groundwater or stormwater that originates upgradient from the site and flows across the site.
- ☐ A description of how BMPs and measures will prevent pollution of surface water or groundwater that originates on-site or flows off site, including pollution caused by contaminated stormwater runoff from the site.
- ☐ A description of how BMPs and measures will prevent pollutants from entering surface streams, sensitive features, or the aquifer.
- ☐ A description of how, to the maximum extent practicable, BMPs and measures will maintain flow to naturally-occurring sensitive features identified in either the geologic assessment, TCEQ inspections, or during excavation, blasting, or construction.

9. ☐ The temporary sealing of a naturally-occurring sensitive feature which accepts recharge to the Edwards Aquifer as a temporary pollution abatement measure during active construction should be avoided.

- ☐ **Attachment E - Request to Temporarily Seal a Feature.** A request to temporarily seal a feature is attached. The request includes justification as to why no reasonable and practicable alternative exists for each feature.

- ☒ There will be no temporary sealing of naturally-occurring sensitive features on the site.

10. ☐ **Attachment F - Structural Practices.** A description of the structural practices that will be used to divert flows away from exposed soils, to store flows, or to otherwise limit runoff discharge of pollutants from exposed areas of the site is attached. Placement of structural practices in floodplains has been avoided. **N/A**

11. ☐ **Attachment G - Drainage Area Map.** A drainage area map supporting the following requirements is attached: **N/A**

- ☐ For areas that will have more than 10 acres within a common drainage area disturbed at one time, a sediment basin will be provided.
- ☐ For areas that will have more than 10 acres within a common drainage area disturbed at one time, a smaller sediment basin and/or sediment trap(s) will be used.
- ☐ For areas that will have more than 10 acres within a common drainage area disturbed at one time, a sediment basin or other equivalent controls are not attainable, but other TBMPs and measures will be used in combination to protect down slope and side slope boundaries of the construction area.
- ☐ There are no areas greater than 10 acres within a common drainage area that will be disturbed at one time. A smaller sediment basin and/or sediment trap(s) will be used in combination with other erosion and sediment controls within each disturbed drainage area.

- ☐ There are no areas greater than 10 acres within a common drainage area that will be disturbed at one time. Erosion and sediment controls other than sediment basins or sediment traps within each disturbed drainage area will be used.
12. ☐ **Attachment H - Temporary Sediment Pond(s) Plans and Calculations.** Temporary sediment pond or basin construction plans and design calculations for a proposed temporary BMP or measure have been prepared by or under the direct supervision of a Texas Licensed Professional Engineer. All construction plans and design information must be signed, sealed, and dated by the Texas Licensed Professional Engineer. Construction plans for the proposed temporary BMPs and measures are attached.
- ☒ N/A
13. ☐ **Attachment I - Inspection and Maintenance for BMPs.** A plan for the inspection of each temporary BMP(s) and measure(s) and for their timely maintenance, repairs, and, if necessary, retrofit is attached. A description of the documentation procedures, recordkeeping practices, and inspection frequency are included in the plan and are specific to the site and/or BMP. **N/A**
14. ☐ All control measures must be properly selected, installed, and maintained in accordance with the manufacturer's specifications and good engineering practices. If periodic inspections by the applicant or the executive director, or other information indicate a control has been used inappropriately, or incorrectly, the applicant must replace or modify the control for site situations. **N/A**
15. ☐ If sediment escapes the construction site, off-site accumulations of sediment must be removed at a frequency sufficient to minimize offsite impacts to water quality (e.g., fugitive sediment in street being washed into surface streams or sensitive features by the next rain). **N/A**
16. ☐ Sediment must be removed from sediment traps or sedimentation ponds not later than when design capacity has been reduced by 50%. A permanent stake will be provided that can indicate when the sediment occupies 50% of the basin volume. **N/A**
17. ☒ Litter, construction debris, and construction chemicals exposed to stormwater shall be prevented from becoming a pollutant source for stormwater discharges (e.g., screening outfalls, picked up daily).

Soil Stabilization Practices

Examples: establishment of temporary vegetation, establishment of permanent vegetation, mulching, geotextiles, sod stabilization, vegetative buffer strips, protection of trees, or preservation of mature vegetation.

18. ☐ **Attachment J - Schedule of Interim and Permanent Soil Stabilization Practices.** A schedule of the interim and permanent soil stabilization practices for the site is attached. **N/A – No grading to occur.**

19. ☐ Records must be kept at the site of the dates when major grading activities occur, the dates when construction activities temporarily or permanently cease on a portion of the site, and the dates when stabilization measures are initiated. **N/A**
20. ☐ Stabilization practices must be initiated as soon as practicable where construction activities have temporarily or permanently ceased. **N/A**

Administrative Information

21. ☐ All structural controls will be inspected and maintained according to the submitted and approved operation and maintenance plan for the project. **N/A**
22. ☒ If any geologic or manmade features, such as caves, faults, sinkholes, etc., are discovered, all regulated activities near the feature will be immediately suspended. The appropriate TCEQ Regional Office shall be immediately notified. Regulated activities must cease and not continue until the TCEQ has reviewed and approved the methods proposed to protect the aquifer from any adverse impacts.
23. ☐ Silt fences, diversion berms, and other temporary erosion and sediment controls will be constructed and maintained as appropriate to prevent pollutants from entering sensitive features discovered during construction. **N/A**

**Centex Materials, LLC
Buda Plant Quarry**

**Temporary Stormwater Section (TCEQ-0602)
Attachment A**

Spill Response Actions

Education

- (1) Be aware that different materials pollute in different amounts. Make sure that each employee knows what a “significant spill” is for each material they use, and what is the appropriate response for “significant” and “insignificant” spills. Employees should also be aware of when spill must be reported to the TCEQ.
- (2) Educate employees and subcontractors on potential dangers to humans and the environment from spills and leaks.
- (3) Hold regular meetings to discuss and reinforce appropriate disposal procedures (incorporate into regular safety meetings).
- (4) Establish a continuing education program to indoctrinate new employees.
- (5) Have contractor’s superintendent or representative oversee and enforce proper spill prevention and control measures.

General Measures

- (1) To the extent that the work can be accomplished safely, spills of oil, petroleum products, substances listed under 40 CFR parts 110,117, and 302, and sanitary and septic wastes should be contained and cleaned up immediately.
- (2) Store hazardous materials and wastes in covered containers and protect from vandalism.
- (3) Place a stockpile of spill cleanup materials where it will be readily accessible.
- (4) Train employees in spill prevention and cleanup.
- (5) Designate responsible individuals to oversee and enforce control measures.
- (6) Spills should be covered and protected from stormwater run on during rainfall to the extent that it doesn’t compromise clean up activities.
- (7) Do not bury or wash spills with water.
- (8) Store and dispose of used clean up materials, contaminated materials, and recovered spill material that is no longer suitable for the intended purpose in conformance with the provisions in applicable BMPs.

Centex Materials, LLC
Buda Plant Quarry

- (9) Do not allow water used for cleaning and decontamination to enter storm drains or watercourses. Collect and dispose of contaminated water in accordance with applicable regulations.
- (10) Contain water overflow or minor water spillage and do not allow it to discharge into drainage facilities or watercourses.
- (11) Place Safety Data Sheets (SDS), as well as proper storage, cleanup, and spill reporting instructions for hazardous materials stored or used on the project site in an open, conspicuous, and accessible location.
- (12) Keep waste storage areas clean, well-organized, and equipped with ample cleanup supplies as appropriate for the materials being stored. Perimeter controls, containment structures, covers, and liners should be repaired or replaced as needed to maintain proper function.

Cleanup

- (1) Clean up leaks and spills immediately.
- (2) Any spills from an AST facility must be removed from the controlled drainage area for disposal within 24 hours of the spill.
- (3) Use a rag for small spills on paved surfaces, a damp mop for general cleanup, and absorbent material for larger spills. If the spilled material is hazardous, then the used cleanup materials are also hazardous and must be disposed of as hazardous waste.
- (4) Never hose down or bury dry material spills. Clean up as much of the material as possible and dispose of properly. See the waste management BMPs in this section for specific information.

Minor Spills

- (1) Minor spills typically involve small quantities of oil, gasoline, paint, etc. which can be controlled by the first responder at the discovery of the spill.
- (2) Use absorbent materials on small spills rather than hosing down or burying the spill.
- (3) Absorbent materials should be promptly removed and disposed of properly.
- (4) Follow the practice below for a minor spill:
- (5) Contain the spread of the spill.

Centex Materials, LLC
Buda Plant Quarry

(6) Recover spilled materials.

(7) Clean the contaminated area and properly dispose of contaminated materials.

Semi-Significant Spills

Semi-significant spills still can be controlled by the first responder along with the aid of other personnel such as laborers and the foreman, etc. This response may require the cessation of all other activities.

Spills should be cleaned up immediately:

(1) Contain spread of the spill.

(2) Notify the project foreman as soon as possible.

(3) If the spill occurs on paved or impermeable surfaces, clean up using "dry" methods (absorbent materials, cat litter and/or rags). Contain the spill by encircling with absorbent materials and do not let the spill spread widely.

(4) If the spill occurs in dirt areas, as soon as possible contain the spill by constructing an earthen dike. Dig up and properly dispose of contaminated soil.

(5) If the spill occurs during rain, cover spill with tarps or other material to prevent contaminating runoff.

Significant/Hazardous Spills

For significant or hazardous spills that are in reportable quantities:

(1) Notify the TCEQ by telephone as soon as possible and within 24 hours at 512-339-2929 (Austin) or 210-490-3096 (San Antonio) between 8 AM and 5 PM. After hours, contact the Environmental Release Hotline at 1-800-832-8224. It is the contractor's responsibility to have all emergency phone numbers at the construction site.

(2) For spills of federal reportable quantities, in conformance with the requirements in 40 CFR parts 110, 119, and 302, the contractor should notify the National Response Center at (800) 424-8802.

(3) Notification should first be made by telephone and followed up with a written report.

(4) The services of a spills contractor or a Haz-Mat team should be obtained as soon as possible. Construction personnel should not attempt to clean up until the appropriate and qualified staffs have arrived at the job site.



**Centex Materials, LLC
Buda Plant Quarry**

(5) Other agencies which may need to be consulted include, but are not limited to, the City Police Department, County Sheriff Office, Fire Departments, etc.

In the event of a reportable spill, the following Emergency Response Agencies can be contacted for assistance. Always inform your supervisor of a reportable spill as soon as possible. Follow company policy when responding to an emergency.

State Emergency Response Commission	(512) 463-7727
National Response Center	(800) 424-8802
US EPA Region 6, Dallas, 24-hr Number	(866) 372-7745
National Weather Service	(281) 337-5074
TCEQ 24-hr	(800) 832-8224
TCEQ Region 11 Austin Office	(512) 339-2929

Vehicle and Equipment Fueling

- (1) If fueling must occur on site, use designated areas, located away from drainage courses, to prevent the run-on of stormwater and the runoff of spills.
- (2) Discourage “topping off” of fuel tanks.
- (3) Always use secondary containment, such as a drain pan, when fueling to catch spills/ leaks.
- (4) Fueling will occur over the impervious concrete slab. Drain pans, curbing and sumps will be used to control spills from fueling.

Portable Toilet BMPs:

If portable toilets are used at this site, they will be handled in accordance with the following guidelines:

- A licensed waste collector should service all the toilets. **The following tasks will be performed by the portable toilet supplier:**
 - Empty portable toilets before transporting them.
 - Securely fasten the toilets to the transport truck.
 - Use hand trucks, dollies, and power tailgates whenever possible.
 - Suppliers should carry bleach for disinfection in the event of a spill or leak.
 - Inspect the toilets frequently for leaks and have the units serviced and sanitized at time intervals that will maintain sanitary conditions of each toilet.
- Locate portable toilets at least 20 feet from the nearest storm-drain inlet or sensitive-feature filter strip area
- A berm will be constructed around all portable toilet facilities.
- Prepare a level ground surface with clear access to the toilets.

Secure all portable toilets to prevent tipping by accident, weather, or vandalism.



Centex Materials, LLC
Buda Plant Quarry

DETAILED TELEPHONE SPILL REPORT FORM

Date of Incident: _____

Location of Incident: _____

Description of material spilled: _____

Quantity of material spilled: _____

Cause of spill: _____

Authorities notified: _____

Remediation/clean-up action: _____

Corrective measures taken for prevention of reoccurrence: _____

Signature: _____

Notes: _____

Emergency Number for the National Response Center 1-800-424-8802



**Centex Materials, LLC
Buda Plant Quarry**

**Temporary Stormwater Section (TCEQ-0602)
Attachment B**

Potential Sources of Contamination

Potential sources of contamination in the project area are soil, fuels and lubricants from vehicles and trash/debris items.

**Temporary Stormwater Section (TCEQ-0602)
Attachments C, D, E, F, G, H, I & J**

The Temporary Stormwater Attachments C, D, E, F, G, H, I, and J are not necessary for this project as no grading activities are occurring as a result of this AST Plan application.





TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

SECTION I: General Information

1. Reason for Submission (If other is checked please describe in space provided.)		
<input checked="" type="checkbox"/> New Permit, Registration or Authorization (Core Data Form should be submitted with the program application.)		
<input type="checkbox"/> Renewal (Core Data Form should be submitted with the renewal form)	<input type="checkbox"/> Other	
2. Customer Reference Number (if issued)	Follow this link to search for CN or RN numbers in Central Registry**	3. Regulated Entity Reference Number (if issued)
CN 600397434		RN 102190592

SECTION II: Customer Information

4. General Customer Information		5. Effective Date for Customer Information Updates (mm/dd/yyyy)	
<input type="checkbox"/> New Customer		<input type="checkbox"/> Update to Customer Information	
<input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)		<input type="checkbox"/> Change in Regulated Entity Ownership	
The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).			
6. Customer Legal Name (If an individual, print last name first: eg: Doe, John)		If new Customer, enter previous Customer below:	
Centex Materials, LLC			
7. TX SOS/CPA Filing Number	8. TX State Tax ID (11 digits)	9. Federal Tax ID (9 digits)	10. DUNS Number (if applicable)
0706636323	17415007479		
11. Type of Customer:	<input checked="" type="checkbox"/> Corporation	<input type="checkbox"/> Individual	Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited
Government: <input type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> Local <input type="checkbox"/> State <input type="checkbox"/> Other	<input type="checkbox"/> Sole Proprietorship	<input type="checkbox"/> Other:	
12. Number of Employees	13. Independently Owned and Operated?		
<input type="checkbox"/> 0-20 <input type="checkbox"/> 21-100 <input checked="" type="checkbox"/> 101-250 <input type="checkbox"/> 251-500 <input type="checkbox"/> 501 and higher	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		
14. Customer Role (Proposed or Actual) – as it relates to the Regulated Entity listed on this form. Please check one of the following			
<input type="checkbox"/> Owner <input type="checkbox"/> Operator <input checked="" type="checkbox"/> Owner & Operator <input type="checkbox"/> Other:			
<input type="checkbox"/> Occupational Licensee <input type="checkbox"/> Responsible Party <input type="checkbox"/> VCP/BSA Applicant			
15. Mailing Address:	3019 Alvin Devane Blvd., Bldg 1, STE 100		
City	Austin	State	TX
ZIP	78741	ZIP + 4	
16. Country Mailing Information (if outside USA)		17. E-Mail Address (if applicable)	
		rholmes@centexmaterials.com	
18. Telephone Number	19. Extension or Code	20. Fax Number (if applicable)	
(512) 501-5841			

SECTION III: Regulated Entity Information

21. General Regulated Entity Information (If "New Regulated Entity" is selected, a new permit application is also required.)	
<input type="checkbox"/> New Regulated Entity <input type="checkbox"/> Update to Regulated Entity Name <input type="checkbox"/> Update to Regulated Entity Information	
The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).	
22. Regulated Entity Name (Enter name of the site where the regulated action is taking place.)	
Buda Plant Quarry	

23. Street Address of the Regulated Entity: (No PO Boxes)	1100 Jack C Hays Trl						
	City	Buda	State	TX	ZIP	78610	ZIP + 4
24. County	Hays						

If no Street Address is provided, fields 25-28 are required.

25. Description to Physical Location:							
26. Nearest City				State		Nearest ZIP Code	
Buda				Texas		78610	
Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).							
27. Latitude (N) In Decimal:		30.067418°		28. Longitude (W) In Decimal:		-97.862704°	
Degrees	Minutes	Seconds	Degrees	Minutes	Seconds		
30	04	02.71	97	51	45.73		
29. Primary SIC Code (4 digits)		30. Secondary SIC Code (4 digits)		31. Primary NAICS Code (5 or 6 digits)		32. Secondary NAICS Code (5 or 6 digits)	
1422				212312			
33. What is the Primary Business of this entity? (Do not repeat the SIC or NAICS description.)							
Construction Materials							
34. Mailing Address:		3019 Alvin Devane Blvd., Bldg 1, STE 100					
		City	Austin	State	TX	ZIP	78741
						ZIP + 4	
35. E-Mail Address:		rholmes@centexmaterials.com					
36. Telephone Number		37. Extension or Code		38. Fax Number (if applicable)			
(512) 501-5841							

39. TCEQ Programs and ID Numbers Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.


<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input checked="" type="checkbox"/> Edwards Aquifer	<input type="checkbox"/> Emissions Inventory Air	<input type="checkbox"/> Industrial Hazardous Waste
		New AST Plan		
<input type="checkbox"/> Municipal Solid Waste	<input type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
<input type="checkbox"/> Sludge	<input type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
<input type="checkbox"/> Voluntary Cleanup	<input type="checkbox"/> Wastewater	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:

SECTION IV: Preparer Information

40. Name:	Andrea Kidd, P.E.		41. Title:	Project Engineer
42. Telephone Number	43. Ext./Code	44. Fax Number	45. E-Mail Address	
(830) 249-8284		(830) 249-0221	akidd@westwardenv.com	

SECTION V: Authorized Signature

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

Company:	Centex Materials, LLC	Job Title:	Safety and Environmental Mgr.
Name (In Print):	Rick Holmes	Phone:	(512) 501-5841
Signature:		Date:	11/13/2023

Application Fee Form

Texas Commission on Environmental Quality

Name of Proposed Regulated Entity: Buda Plant Quarry

Regulated Entity Location: 1100 Jack C Hays Trl, Buda, TX 78610

Name of Customer: Centex Materials, LLC

Contact Person: Rick Holmes

Phone: (512) 501-5841

Customer Reference Number (if issued): CN 600397434

Regulated Entity Reference Number (if issued): RN 102190592

Austin Regional Office (3373)

☒ Hays

☐ Travis

☐ Williamson

San Antonio Regional Office (3362)

☐ Bexar

☐ Medina

☐ Uvalde

☐ Comal

☐ Kinney

Application fees must be paid by check, certified check, or money order, payable to the **Texas Commission on Environmental Quality**. Your canceled check will serve as your receipt. **This form must be submitted with your fee payment.** This payment is being submitted to:

☐ Austin Regional Office

☐ San Antonio Regional Office

☒ Mailed to: TCEQ - Cashier ePay

☐ Overnight Delivery to: TCEQ - Cashier

Revenues Section

Mail Code 214

P.O. Box 13088

Austin, TX 78711-3088

12100 Park 35 Circle

Building A, 3rd Floor

Austin, TX 78753

(512)239-0357

Site Location (Check All That Apply):

☐ Recharge Zone

☒ Contributing Zone

☒ Transition Zone

Type of Plan	Size	Fee Due
Water Pollution Abatement Plan, Contributing Zone Plan: One Single Family Residential Dwelling	Acres	\$
Water Pollution Abatement Plan, Contributing Zone Plan: Multiple Single Family Residential and Parks	Acres	\$
Water Pollution Abatement Plan, Contributing Zone Plan: Non-residential	Acres	\$
Sewage Collection System	L.F.	\$
Lift Stations without sewer lines	Acres	\$
Underground or Aboveground Storage Tank Facility	2 Tanks	\$ 1300
Piping System(s)(only)	Each	\$
Exception	Each	\$
Extension of Time	Each	\$

Signature: _____

Date: 11/13/2023

Application Fee Schedule

Texas Commission on Environmental Quality

Edwards Aquifer Protection Program 30 TAC Chapter 213 (effective 05/01/2008)

Water Pollution Abatement Plans and Modifications

Contributing Zone Plans and Modifications

<i>Project</i>	<i>Project Area in Acres</i>	<i>Fee</i>
One Single Family Residential Dwelling	< 5	\$650
Multiple Single Family Residential and Parks	< 5	\$1,500
	5 < 10	\$3,000
	10 < 40	\$4,000
	40 < 100	\$6,500
	100 < 500	\$8,000
	≥ 500	\$10,000
Non-residential (Commercial, industrial, institutional, multi-family residential, schools, and other sites where regulated activities will occur)	< 1	\$3,000
	1 < 5	\$4,000
	5 < 10	\$5,000
	10 < 40	\$6,500
	40 < 100	\$8,000
	≥ 100	\$10,000

Organized Sewage Collection Systems and Modifications

<i>Project</i>	<i>Cost per Linear Foot</i>	<i>Minimum Fee- Maximum Fee</i>
Sewage Collection Systems	\$0.50	\$650 - \$6,500

Underground and Aboveground Storage Tank System Facility Plans and Modifications

<i>Project</i>	<i>Cost per Tank or Piping System</i>	<i>Minimum Fee- Maximum Fee</i>
Underground and Aboveground Storage Tank Facility	\$650	\$650 - \$6,500

Exception Requests

<i>Project</i>	<i>Fee</i>
Exception Request	\$500

Extension of Time Requests

<i>Project</i>	<i>Fee</i>
Extension of Time Request	\$150

Edwards Aquifer Protection Program
Relating to 30 TAC Chapter 213
Effective June 1, 1999

Page 1 of 2

SIGNATURE PAGE:

Applicant's Signature


11/13/2023
Date

THE STATE OF Texas §

County of Travis §

BEFORE ME, the undersigned authority, on this day personally appeared Rick Holmes known to me to be the person whose name is subscribed to the foregoing instrument, and acknowledged to me that (s)he executed same for the purpose and consideration therein expressed.

GIVEN under my hand and seal of office on this 13 day of November, 2023


NOTARY PUBLIC

Marivel Valdez-Benitez
Typed or Printed Name of Notary

MY COMMISSION EXPIRES: April 6, 2027

