



# Administrative Package Cover Page

**This file contains the following documents:**

1. Summary of application (in plain language)
    - English
    - Alternative Language (Spanish)
  2. First Notice (NORI-Notice of Receipt of Application and Intent to Obtain a Permit)
    - English
    - Alternative Language (Spanish)
  3. Application materials
- 



# Portada de Paquete Administrativo

**Este archivo contiene los siguientes documentos:**

1. Resumen en lenguaje sencillo (PLS, por sus siglas en inglés) de la actividad propuesta
  - Inglés
  - Idioma alternativo (español)
2. Primer aviso (NORI, por sus siglas en inglés)
  - Inglés
  - Idioma alternativo (español)
3. Solicitud original



## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

### PLAIN LANGUAGE SUMMARY FOR TPDES OR TLAP PERMIT APPLICATIONS

#### Plain Language Summary Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary as required by [Title 30, Texas Administrative Code \(30 TAC\), Chapter 39, Subchapter H](#). Applicants may modify the template as necessary to accurately describe their facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how the applicant will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements.

If you are subject to the alternative language notice requirements in [30 TAC Section 39.426](#), **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package.** For your convenience, a Spanish template has been provided below.

#### ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS **INDUSTRIAL WASTEWATER/STORMWATER**

*The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.*

The City of Garland (CN600328694), operates the Garland Municipal Power - Ray Olinger Power Plant (RN100219203), a natural gas steam electric generating facility. The facility is located at 13835 County Road 489, in Nevada, Collin County, Texas 75173.

This application is for a renewal and amendment to discharge of once-through cooling water from Units 1, 2, and 3 and stormwater at a daily average flow not to exceed 404,000,000 gallons per day via Outfall 001. This amendment is to remove Internal Outfall 101.

Discharges from the facility are expected to contain chlorine. Additional pollutants are included in Worksheet 2.0 of the permit application package. Industrial wastewater is treated by using sodium hyperchlorate at the intake for algae control, and the circulating water is used for condenser cooling. Ammonia bisulfate is used for dechlorination at the condenser outlet to limit the chlorine residual.



## **PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP**

### **AGUAS RESIDUALES INDUSTRIALES /AGUAS PLUVIALES**

*El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.*

La ciudad de Garland (CN600328694) opera la planta eléctrica Garland Municipal Power - Ray Olinger (RN100219203), una instalación de generación de electricidad a vapor con gas natural. La instalación está ubicada en 13835 County Road 489, en Nevada, Condado de Collin, Texas 75173.

Esta solicitud es para una renovación y enmienda a la descarga de agua de enfriamiento de un solo paso de las Unidades 1, 2 y 3 y aguas pluviales con un flujo promedio diario que no exceda los 404,000,000 galones por día a través del Emisario 001. Esta enmienda es para eliminar el Emisario Interno 101.

Se espera que las descargas de la instalación contengan cloro. Se incluyen contaminantes adicionales en la Hoja de trabajo 2.0 del paquete de solicitud de permiso. Las aguas residuales industriales se tratan utilizando hipoclorato de sodio en la entrada para controlar las algas y el agua en circulación se utiliza para enfriar el condensador. El bisulfato de amoníaco se utiliza para la dicloración en la salida del condensador para limitar el cloro residual.

# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



## NOTICE OF RECEIPT OF APPLICATION AND INTENT TO OBTAIN WATER QUALITY PERMIT

### AMENDMENT

**PERMIT NO. WQ0001923000**

**APPLICATION.** City of Garland, 13835 County Road 489, Nevada, Texas 75173, which owns a natural gas steam electric generating facility, has applied to the Texas Commission on Environmental Quality (TCEQ) to amend Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0001923000 (EPA I.D. No. TX0001848) to authorize adding metal cleaning wastes to the evaporation pond Other Requirement No. 12 and removing internal Outfall 101. The facility is located at 13835 County Road 489, near the city of Nevada, in Collin County, Texas 75173. The discharge route is from the plant site directly to Lavon Lake. TCEQ received this application on August 8, 2024. The permit application will be available for viewing and copying at Wylie Municipal Complex, Office of City Secretary, 300 Country Club Road, Building 100, Wylie, Texas prior to the date this notice is published in the newspaper. The application, including any updates, and associated notices are available electronically at the following webpage: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For the exact location, refer to the application.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-96.4525,33.068055&level=18>

**ALTERNATIVE LANGUAGE NOTICE.** Alternative language notice in Spanish is available at: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

El aviso de idioma alternativo en español está disponible en

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

**ADDITIONAL NOTICE.** TCEQ's Executive Director has determined the application is administratively complete and will conduct a technical review of the application. After technical review of the application is complete, the Executive Director may prepare a draft permit and will issue a preliminary decision on the application. **Notice of the Application and Preliminary Decision will be published and mailed to those who are on the county-wide mailing list and to those who are on the mailing list for this application. That notice will contain the deadline for submitting public comments.**

**PUBLIC COMMENT / PUBLIC MEETING.** You may submit public comments or request a public meeting on this application. The purpose of a public meeting is to provide the opportunity to submit comments or to ask questions about the application. TCEQ will hold a public meeting if the Executive Director determines that there is a significant degree of public

interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

**OPPORTUNITY FOR A CONTESTED CASE HEARING.** After the deadline for submitting public comments, the Executive Director will consider all timely comments and prepare a response to all relevant and material, or significant public comments. **Unless the application is directly referred for a contested case hearing, the response to comments, and the Executive Director's decision on the application, will be mailed to everyone who submitted public comments and to those persons who are on the mailing list for this application.** If comments are received, the mailing will also provide instructions for requesting reconsideration of the Executive Director's decision and for requesting a contested case hearing. A contested case hearing is a legal proceeding similar to a civil trial in state district court.

**TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST:** your name, address, phone number; applicant's name and proposed permit number; the location and distance of your property/activities relative to the proposed facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; a list of all disputed issues of fact that you submit during the comment period and, the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify by name and physical address an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are relevant to the group's purpose.

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

The Commission may only grant a request for a contested case hearing on issues the requestor submitted in their timely comments that were not subsequently withdrawn. **If a hearing is granted, the subject of a hearing will be limited to disputed issues of fact or mixed questions of fact and law relating to relevant and material water quality concerns submitted during the comment period.**

**MAILING LIST.** If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be placed on: (1) the permanent mailing list for a specific applicant name and permit number; and/or (2) the mailing list for a specific county. If you wish to be placed on the permanent and/or the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

**INFORMATION AVAILABLE ONLINE.** For details about the status of the application, visit the Commissioners' Integrated Database at [www.tceq.texas.gov/goto/cid](http://www.tceq.texas.gov/goto/cid). Search the database using the permit number for this application, which is provided at the top of this notice.

**AGENCY CONTACTS AND INFORMATION.** All public comments and requests must be submitted either electronically at <https://www14.tceq.texas.gov/epic/eComment/>, or in writing to the Texas Commission on Environmental Quality, Office of the Chief Clerk, MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Please be aware that any contact information you provide, including your name, phone number, email address and physical address will become part of the agency's public record. For more information about this permit application or the permitting process, please call the TCEQ Public Education Program, Toll Free, at 1-800-687-4040 or visit their website at [www.tceq.texas.gov/goto/pep](http://www.tceq.texas.gov/goto/pep). Si desea información en Español, puede llamar al 1-800-687-4040.

Further information may also be obtained from City of Garland at the address stated above or by calling Mr. David Bernard, Production Director, Garland Power & Light, at 972-205-3831.

Issuance Date: September 17, 2024

# Comisión de Calidad Ambiental del Estado de Texas



## AVISO DE RECEPCIÓN DE LA SOLICITUD Y LA INTENCIÓN DE OBTENER CALIDAD DEL AGUA PERMISO MODIFICACION

### PERMISO NO. WQ0001923000

**SOLICITUD.** La ciudad de Garland, 13835 County Road 489, Nevada, Texas 75173, que posee un Planta de generación eléctrica de vapor de gas natural, ha solicitado a la Comisión de Calidad Ambiental de Texas (TCEQ) para modificar el Permiso No.WQ0001923000 (EPA I.D. No. TX0001848) del Sistema de Eliminación de Descargas de Contaminantes de Texas (TPDES) para autorizar la adición de desechos de limpieza de metales al estanque de evaporación Otro requisito N.º 12 y la eliminación del emisario interno 101. La planta está ubicada en 13835 County Road 489, cerca de la ciudad de Nevada, en el condado de Collin, Texas 75173. La TCEQ recibió esta solicitud el día 8 de agosto de 2024. La solicitud para el permiso estará disponible para leerla y copiarla en Wylie Municipal Complex, Office of City Secretary, 300 Country Club Road, Building 100, Wylie, Texas antes de la fecha de publicación de este aviso en el periódico. La solicitud (cualquier actualización y aviso inclusive) está disponible electrónicamente en la siguiente página web:

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. Este enlace a un mapa electrónico de la ubicación general del sitio o de la instalación es proporcionado como una cortesía y no es parte de la solicitud o del aviso. Para la ubicación exacta, consulte la solicitud.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-96.4525.33.068055&level=18>

**AVISO ADICIONAL.** El Director Ejecutivo de la TCEQ ha determinado que la solicitud es administrativamente completa y conducirá una revisión técnica de la solicitud. Después de completar la revisión técnica, el Director Ejecutivo puede preparar un borrador del permiso y emitirá una Decisión Preliminar sobre la solicitud. **El aviso de la solicitud y la decisión preliminar serán publicados y enviado a los que están en la lista de correo de las personas a lo largo del condado que desean recibir los avisos y los que están en la lista de correo que desean recibir avisos de esta solicitud.** El aviso dará la fecha límite para someter comentarios públicos.

**COMENTARIO PUBLICO / REUNION PUBLICA.** Usted puede presentar comentarios públicos o pedir una reunión pública sobre esta solicitud. El



propósito de una reunión pública es dar la oportunidad de presentar comentarios o hacer preguntas acerca de la solicitud. La TCEQ realiza una reunión pública si el Director Ejecutivo determina que hay un grado de interés público suficiente en la solicitud o si un legislador local lo pide. Una reunión pública no es una audiencia administrativa de lo contencioso.

**OPORTUNIDAD DE UNA AUDIENCIA ADMINISTRATIVA DE LO CONTENCIOSO.** Después del plazo para presentar comentarios públicos, el Director Ejecutivo considerará todos los comentarios apropiados y preparará una respuesta a todo los comentarios públicos esenciales, pertinentes, o significativos. **A menos que la solicitud haya sido referida directamente a una audiencia administrativa de lo contencioso, la respuesta a los comentarios y la decisión del Director Ejecutivo sobre la solicitud serán enviados por correo a todos los que presentaron un comentario público y a las personas que están en la lista para recibir avisos sobre esta solicitud. Si se reciben comentarios, el aviso también proveerá instrucciones para pedir una reconsideración de la decisión del Director Ejecutivo y para pedir una audiencia administrativa de lo contencioso.** Una audiencia administrativa de lo contencioso es un procedimiento legal similar a un procedimiento legal civil en un tribunal de distrito del estado.

**PARA SOLICITAR UNA AUDIENCIA DE CASO IMPUGNADO, USTED DEBE INCLUIR EN SU SOLICITUD LOS SIGUIENTES DATOS:** su nombre, dirección, y número de teléfono; el nombre del solicitante y número del permiso; la ubicación y distancia de su propiedad/actividad con respecto a la instalación; una descripción específica de la forma cómo usted sería afectado adversamente por el sitio de una manera no común al público en general; una lista de todas las cuestiones de hecho en disputa que usted presente durante el período de comentarios; y la declaración "[Yo/nosotros] solicito/solicitamos una audiencia de caso impugnado". Si presenta la petición para una audiencia de caso impugnado de parte de un grupo o asociación, debe identificar una persona que representa al grupo para recibir correspondencia en el futuro; identificar el nombre y la dirección de un miembro del grupo que sería afectado adversamente por la planta o la actividad propuesta; proveer la información indicada anteriormente con respecto a la ubicación del miembro afectado y su distancia de la planta o actividad propuesta; explicar cómo y porqué el miembro sería afectado; y explicar cómo los intereses que el grupo desea proteger son pertinentes al propósito del grupo.

Después del cierre de todos los períodos de comentarios y de petición que aplican, el Director Ejecutivo enviará la solicitud y cualquier petición para reconsideración o para una audiencia de caso impugnado a los Comisionados de la TCEQ para su consideración durante una reunión programada de la Comisión. La Comisión sólo puede conceder una solicitud de una audiencia de caso impugnado sobre los temas que el solicitante haya presentado en sus comentarios oportunos que no fueron retirados

**posteriormente. Si se concede una audiencia, el tema de la audiencia estará limitado a cuestiones de hecho en disputa o cuestiones mixtas de hecho y de derecho relacionadas a intereses pertinentes y materiales de calidad del agua que se hayan presentado durante el período de comentarios.**

**LISTA DE CORREO.** Si somete comentarios públicos, un pedido para una audiencia administrativa de lo contencioso o una reconsideración de la decisión del Director Ejecutivo, la Oficina del Secretario Principal enviará por correo los avisos públicos en relación con la solicitud. Además, puede pedir que la TCEQ ponga su nombre en una o más de las listas de correos siguientes (1) la lista de correo permanente para recibir los avisos de el solicitante indicado por nombre y número del permiso específico y/o (2) la lista de correo de todas las solicitudes en un condado específico. Si desea que se agregue su nombre en una de las listas designe cual lista(s) y envíe por correo su pedido a la Oficina del Secretario Principal de la TCEQ.

**CONTACTOS E INFORMACIÓN A LA AGENCIA.** Todos los comentarios públicos y solicitudes deben ser presentados electrónicamente vía <http://www14.tceq.texas.gov/epic/eComment/> o por escrito dirigidos a la Comisión de Texas de Calidad Ambiental, Oficial de la Secretaría (Office of Chief Clerk), MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Tenga en cuenta que cualquier información personal que usted proporcione, incluyendo su nombre, número de teléfono, dirección de correo electrónico y dirección física pasarán a formar parte del registro público de la Agencia. Para obtener más información acerca de esta solicitud de permiso o el proceso de permisos, llame al programa de educación pública de la TCEQ, gratis, al 1-800-687-4040. Si desea información en Español, puede llamar al 1-800-687-4040.

También se puede obtener información adicional de la ciudad de Garland a la dirección indicada arriba o llamando a Sr. David Bernard, Director de Producción de Garland Power & Light al 972-205-3831.

Fecha de emisión 17 de septiembre de 2024

August 26, 2024

[www.freese.com](http://www.freese.com)

Abesha Michael  
Water Quality Division (MC-148)  
Texas Commission on Environmental Quality  
P.O. Box 13087  
Austin, TX 78711-3087

Re: Response to TCEQ Notice of Deficiency  
Application to Amend/Renew Wastewater Permit No. WQ0001923000 (RN100219203)  
City of Garland (CN600328694)

Dear Ms. Michael:

The City of Garland and Freese and Nichols, Inc. (FNI) received a letter from the Texas Commission on Environmental Quality (TCEQ) dated August 17, 2024 that requested a written response to address the deficiency associated with the application to renew Wastewater Permit No. WQ0001923000. On behalf of the applicant, City of Garland, FNI offers the following responses to the TCEQ NOD.

1. ***Section I, item 2 on page 1 of the Core Data Form (CDF): Thank you for addressing the CN number, However the CN600130140 is incorrect. Per the existing permit, our records and the PLS provided, the correct CN is CN600328694. Please update and submit the revised page.***

An updated Core Data Form with the updated information is included with this correspondence.

2. ***Section II, item 6 on page 1 of the Core Data Form (CDF): Thank you for addressing the customer's legal name. However, the legal name provided is incorrect. Per the existing permit, our records and pages 1 & 2 of the application the correct legal name is City of Garland. Please update and submit a revised page 1 of CDF and SPIF item 1 on page 1/3.***

An updated Core Data Form, SPIF, Pages 1 and 2 of the application have been updated and included in this correspondence.

3. ***Section V, Authorized Signature on page 3 of the Core Data Form (CDF): the CDF is not signed. Please submit a signed CDF.***

An updated Core Data Form with the updated information is included with this correspondence.

4. ***Item 1F on page 2 of the administrative report: Item 1E checked for major amendment with renewal. However, the amendment or modification description indicated as NA. Please complete and submit a revised page.***

A revised Administrative Report is included with this correspondence.

5. ***Item 1G on page 3 of the administrative report: The application indicates that the application fee for \$1,250.00 is paid, which we are unable to location the proof of payment. AND as per our***

**records and EPA Classification, this permit is a major facility and the fee for major facility to process major amendment with renewal is \$2,050. Please pay \$2,050 to TCEQ revenue section and email the copy of any proof of payment with the response to this letter.**

The facility has historically been classified as a minor facility subject to EPA categorical effluent guidelines. The facility falls under 40 CFR Part 423. Please provide documentation that indicates a change in classification.

A payment of \$1,250 was paid via [REDACTED], 2024. The payment information is included in this correspondence.

6. ***Item 1, Affected Landowner Information on page 12 of the administrative report: Thank you for submitting the affected landowner's map. However, the map submitted is insufficient, if the discharge is to a lake or bay estuary, or affected by tides, the property boundaries of the landowners ½ miles up & downstream and those property owner across the lake along the shoreline that fall within a ½ mile radius of the point of discharge has to be delineated, this does not include all the landowners far from the shoreline. And the property owners surrounding the applicant's property boundaries has to be delineated. Please update the landowners map, the cross-referenced mailing list and the mailing labels accordingly (please email the labels in a Microsoft word format).***

Updated Affected Landowner Maps are included in this correspondence.

7. ***Item 11H on page 9 of the administrative report: The name of all the counties located within 100 statute miles downstream of the point(s) of discharge have to be identified for a daily average discharge of 5 MGD or more. As per the existing permit and our records the daily average flow for this permit 404 million gallons per day (MGD). Please update with the name of the counties and submit a revised page 9.***

A revised Administrative Report is included with this correspondence.

8. ***The following is a portion of the NORI which contains information relevant to your application. Please read it carefully and indicate if it contains any errors or omissions. The complete notice will be sent to you once the application is declared administratively complete.***

**APPLICATION.** City of Garland, 13835 County Road 489, Nevada, Texas 75173, which owns a natural gas steam electric generating facility, has applied to the Texas Commission on Environmental Quality (TCEQ) to amend Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0001923000 (EPA I.D. No. TX0001848) to authorize adding metal cleaning wastes to the evaporation pond Other Requirement No. 12 and removing internal Outfall ~~001~~ 101. The facility is located at 13835 County Road 489, near the city of Nevada, in Collin County, Texas 75173. The discharge route is from the plant site ~~to~~ directly to Lavon Lake. TCEQ received this application on August 8, 2024. The permit application will be available for viewing and copying at Wylie Municipal Complex, Office of City Secretary, 300 Country Club Road, Building 100, Wylie, Texas prior to the date this notice is published in the newspaper. The application, including any updates, and associated notices are available electronically at the following webpage: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For the exact location, refer to the application. <https://gisweb.tceq.texas.gov/LocationMapper/?marker=-96.4525,33.068055&level=18>

Further information may also be obtained from City of Garland at the address stated above or by calling Mr. David Bernard, Production ~~Manager~~ Director, Garland Power & Light, at 972-205-3831.

9. ***The application indicates that public notices in Spanish are required. After confirming the portion of the NORI above does not contain any errors or omissions, please use the attached template to translate the NORI into Spanish. Only the first and last paragraphs are unique to this application and require translation. Please provide the translated Spanish NORI in a Microsoft Word document.***

A translated NORI is included with this correspondence.

Additionally, the last set of lab results was received and has been added to the application. An updated version of the application has been uploaded to the TCEQ FTPS. Please feel free to contact me if you have any questions or require additional information.

Sincerely,

Cassandra Villarreal, M.S.  
Freese and Nichols, Inc.

cc: Mr. Micheal Burr, Garland Power and Light  
File GPL24350

Attachments



# MEMORANDUM



Innovative approaches  
Practical results  
Outstanding service

801 Cherry Street, Suite 2800 + Fort Worth, Texas 76102 + 817-735-7300 + FAX 817-735-7491

[www.freese.com](http://www.freese.com)

**TO:** Applications Review and Processing Team (MC 148)  
**FROM:** Cassie Villarreal, FNI  
**SUBJECT:** Garland Power and Light TPDES Application WQ0001923000  
**DATE:** 8/9/2024  
**PROJECT:** GPL24350

---

The TCEQ Applications Review and Processing Team contacted the permittee about an application submitted via STEERS on August 8, 2024. Although the application in STEERS is listed as a “new permit,” it is a renewal/major amendment for an existing facility (WQ0001923000). TCEQ staff discussed that they would work on making this change internally but suggested we submit a PDF copy to the TCEQ FTP Server with a memo of what was discussed. If needed, we can follow up with hard copies of the application.

Please let me know if you have any questions regarding the application.

Thank you,

Sincerely,

A handwritten signature in blue ink, appearing to read 'C Villarreal'.

Cassandra Villarreal, M.S.  
Freese and Nichols, Inc.  
[cassandra.villarreal@freese.com](mailto:cassandra.villarreal@freese.com)  
817-735-7294

Jon Niermann, *Chairman*  
Bobby Janecka, *Commissioner*  
Catarina R. Gonzales, *Commissioner*  
Kelly Keel, *Executive Director*



## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

*Protecting Texas by Reducing and Preventing Pollution*

August 8, 2024

Dear Applicant:

Re: Confirmation of Submission of the New Industrial Wastewater Individual Permit Application

This is an acknowledgement that you have successfully completed Industrial Wastewater Individual Permit Application.

ER Account Number: ER083325

Application Reference Number: 660831

Authorization Number: WQ0005464000

Site Name: Garland Municipal Power - Ray Olinger Plant

Regulated Entity: RN100219203 - GARLAND MUNICIPAL POWER - RAY OLINGER PLANT

Customer(s): CN600328694 - City of Garland

Please be aware that TCEQ staff may contact your designated contact for any additional information.

If you have any questions, you may contact the Applications Review and Processing Team by email at [WQ-ARPTeam@tceq.texas.gov](mailto:WQ-ARPTeam@tceq.texas.gov) or by telephone at (512) 239-4671.

Sincerely,  
Applications Review and Processing Team  
Water Quality Division



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

# INDUSTRIAL WASTEWATER PERMIT APPLICATION CHECKLIST

**Complete and submit this checklist with the industrial wastewater permit application.**

APPLICANT NAME: City of Garland

PERMIT NUMBER (If new, leave blank): WQ00 01923000

**Indicate if each of the following items is included in your application.**

	Y	N		Y	N
Administrative Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 8.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Administrative Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Worksheet 9.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>
SPIF	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 10.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Core Data Form	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Public Involvement Plan Form	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.1	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Plain Language Summary	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.2	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Technical Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.3	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original USGS Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 2.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Affected Landowners Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 3.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Landowner Disk or Labels	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 3.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Flow Diagram	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 3.2	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Site Drawing	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.3	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Original Photographs	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 4.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Design Calculations	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 4.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Solids Management Plan	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 5.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Water Balance	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 6.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 7.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			

For TCEQ Use Only

Segment Number \_\_\_\_\_ County \_\_\_\_\_  
Expiration Date \_\_\_\_\_ Region \_\_\_\_\_  
Permit Number \_\_\_\_\_



# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## INDUSTRIAL WASTEWATER PERMIT APPLICATION

### ADMINISTRATIVE REPORT 1.0

This report is required for all applications for TPDES permits and TLAPs, except applications for oil and gas extraction operations subject to 40 CFR Part 435. Contact the Applications Review and Processing Team at 512-239-4671 with any questions about completing this report.

Applications for oil and gas extraction operations subject to 40 CFR Part 435 must use the Oil and Gas Exploration and Production Administrative Report ([TCEQ Form-20893 and 20893-inst<sup>1</sup>](#)).

#### Item 1. Application Information and Fees (Instructions, Page 26)

- a. Complete each field with the requested information, if applicable.

Applicant Name: City of Garland

Permit No.: WQ0001923000

EPA ID No.: TX0001848

Expiration Date: February 5, 2025

- b. Check the box next to the appropriate authorization type.

☒ Industrial Wastewater (wastewater and stormwater)

☐ Industrial Stormwater (stormwater only)

- c. Check the box next to the appropriate facility status.

☒ Active

☐ Inactive

- d. Check the box next to the appropriate permit type.

☒ TPDES Permit

☐ TLAP

☐ TPDES with TLAP component

- e. Check the box next to the appropriate application type.

☐ New

☐ Renewal with changes

☐ Renewal without changes

☒ Major amendment with renewal

☐ Major amendment without renewal

☐ Minor amendment without renewal

☐ Minor modification without renewal

- f. If applying for an amendment or modification, describe the request: Removal of internal Outfall 101.

For TCEQ Use Only

Segment Number \_\_\_\_\_ County \_\_\_\_\_

Expiration Date \_\_\_\_\_ Region \_\_\_\_\_

<sup>1</sup> [https://www.tceq.texas.gov/publications/search\\_forms.html](https://www.tceq.texas.gov/publications/search_forms.html)

Permit Number \_\_\_\_\_

g. Application Fee

EPA Classification	New	Major Amend. (with or without renewal)	Renewal (with or without changes)	Minor Amend. / Minor Mod. (without renewal)
Minor facility not subject to EPA categorical effluent guidelines (40 CFR Parts 400-471)	<input type="checkbox"/> \$350	<input type="checkbox"/> \$350	<input type="checkbox"/> \$315	<input type="checkbox"/> \$150
Minor facility subject to EPA categorical effluent guidelines (40 CFR Parts 400-471)	<input type="checkbox"/> \$1,250	<input checked="" type="checkbox"/> \$1,250	<input type="checkbox"/> \$1,215	<input type="checkbox"/> \$150
Major facility	N/A <sup>2</sup>	<input type="checkbox"/> \$2,050	<input type="checkbox"/> \$2,015	<input type="checkbox"/> \$450

h. Payment Information

***Mailed***

Check or money order No.: [Click to enter text.](#)

Check or money order amt.: [Click to enter text.](#)

Named printed on check or money order: [Click to enter text.](#)

***Epay***

Voucher number: 716366/716367

Copy of voucher attachment: **AR-7**

**Item 2. Applicant Information (Instructions, Pages 26)**

a. Customer Number, if applicant is an existing customer: CN600328694

**Note:** Locate the customer number using the [TCEQ's Central Registry Customer Search](#)<sup>3</sup>.

b. Legal name of the entity (applicant) applying for this permit: City of Garland

**Note:** The owner of the facility must apply for the permit. The legal name must be spelled exactly as filed with the TX SOS, Texas Comptroller of Public Accounts, County, or in the legal documents forming the entity.

c. Name and title of the person signing the application. (**Note:** The person must be an executive official that meets signatory requirements in 30 TAC § 305.44.)

Prefix: Mr. Full Name (Last/First Name): Cline, Darrell

Title: General Manager & CEO Credential: N/A

d. Will the applicant have overall financial responsibility for the facility?

<sup>2</sup> All facilities are designated as minors until formally classified as a major by EPA.

<sup>3</sup> <https://www15.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch>



☒ Yes ☐ No

Note: The entity with overall financial responsibility for the facility must apply as a co-applicant, if not the facility owner.

### Item 3. Co-applicant Information (Instructions, Page 27)

☒ Check this box if there is no co-applicant.; otherwise, complete the below questions.

a. Legal name of the entity (co-applicant) applying for this permit: N/A

**Note:** The legal name must be spelled exactly as filed with the TX SOS, Texas Comptroller of Public Accounts, County, or in the legal documents forming the entity.

b. Customer Number (if applicant is an existing customer): CNN/A

**Note:** Locate the customer number using the TCEQ's Central Registry Customer Search.

c. Name and title of the person signing the application. (**Note:** The person must be an executive official that meets signatory requirements in 30 TAC § 305.44.)

Prefix: N/A Full Name (Last/First Name): N/A

Title: N/A Credential: N/A

d. Will the co-applicant have overall financial responsibility for the facility?

☐ Yes ☐ No

Note: The entity with overall financial responsibility for the facility must apply as a co-applicant, if not the facility owner.

### Item 4. Core Data Form (Instructions, Pages 27)

a. Complete one Core Data Form (TCEQ Form 10400) for each customer (applicant and co-applicant(s)) and include as an attachment. If the customer type selected on the Core Data Form is Individual, complete Attachment 1 of the Administrative Report. Attachment: AR-1

### Item 5. Application Contact Information (Instructions, Page 27)

Provide names of two individuals who can be contact for additional information about this application. Indicate if the individual can be contact about administrative or technical information, or both.

a. ☒ Administrative Contact ☒ Technical Contact

Prefix: Mr. Full Name (Last/First Name): Burr, Michael

Title: Environmental Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 County Road 489 City/State/Zip: Nevada, Texas, 75173

Phone No: 972-485-6453 Email: mburr@gpltexas.org

b. ☒ Administrative Contact ☒ Technical Contact

Prefix: Mrs. Full Name (Last/First Name): Leatherwood, Katie

Title: Environmental Scientist Credential: P.G.

Organization Name: Freese and Nichols, Inc

Mailing Address: 801 Cherry Street, Suite 2800 City/State/Zip: Fort Worth, TX 76102

Phone No: 817-735-7503 Email: katie.leatherwood@freese.com

Attachment: N/A

## Item 6. Permit Contact Information (Instructions, Page 28)

Provide two names of individuals that can be contacted throughout the permit term.

a. Prefix: Mr. Full Name (Last/First Name): Bernard, David

Title: Production Director Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

Phone No: 972-205-3831 Email: dbernard@gpltexas.org

b. Prefix: Mr. Full Name (Last/First Name): Burr, Michael

Title: Environmental Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

Phone No: 972-485-6458 Email: mburr@gpltexas.org

Attachment: N/A

## Item 7. Billing Contact Information (Instructions, Page 28)

The permittee is responsible for paying the annual fee. The annual fee will be assessed for permits **in effect on September 1 of each year**. The TCEQ will send a bill to the address provided in this section. The permittee is responsible for terminating the permit when it is no longer needed (form TCEQ-20029).

Provide the complete mailing address where the annual fee invoice should be mailed and the name and phone number of the permittee's representative responsible for payment of the invoice.

Prefix: Mr. Full Name (Last/First Name): Bernard, David

Title: Production Director Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

Phone No: 972-205-3831 Email: dbernard@gpltexas.org

## Item 8. DMR/MER Contact Information (Instructions, Page 28)

Provide the name and mailing address of the person delegated to receive and submit DMRs or MERs. **Note:** DMR data must be submitted through the NetDMR system. An electronic reporting account can be established once the facility has obtained the permit number.

Prefix: Mr. Full Name (Last/First Name): Bernard, David

Title: Production Director Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

**Item 9. Notice Information (Instructions, Pages 28)****a. Individual Publishing the Notices**Prefix: Mr. Full Name (Last/First Name): Bernard, DavidTitle: Production Director Credential: N/AOrganization Name: Garland Power & LightMailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173Phone No: 972-205-3831 Email: dbernard@gpltexas.org**b. Method for Receiving Notice of Receipt and Intent to Obtain a Water Quality Permit Package (only for NORI, NAPD will be sent via regular mail)**☒ E-mail: mburr@gpltexas.org; dbernard@gpltexas.org; katie.leatherwood@freese.com;☐ Fax: Click to enter text.☐ Regular Mail (USPS)Mailing Address: Click to enter text.City/State/Zip Code: Click to enter text.**c. Contact in the Notice**Prefix: Mr. Full Name (Last/First Name): Bernard, DavidTitle: Production Director Credential: N/AOrganization Name: Garland Power & LightPhone No: 972-205-3831 Email: dbernard@gpltexas.org**d. Public Viewing Location Information****Note:** If the facility or outfall is located in more than one county, provide a public viewing place for each county.Public building name: Wylie Municipal Complex Location within the building: Office of City SecretaryPhysical Address of Building: 300 Country Club Road, Building 100City: Wylie County: Collin**e. Bilingual Notice Requirements**

This information is required for new, major amendment, minor amendment or minor modification, and renewal applications.

This section of the application is only used to determine if alternative language notices will be needed. Complete instructions on publishing the alternative language notices will be in your public notice package.

Call the bilingual/ESL coordinator at the nearest elementary and middle schools and obtain the following information to determine if an alternative language notice(s) is required.

1. Is a bilingual education program required by the Texas Education Code at the elementary or middle school nearest to the facility or proposed facility?

☒ Yes ☐ No

If no, publication of an alternative language notice is not required; skip to Item 8 (Regulated Entity and Permitted Site Information.)

2. Are the students who attend either the elementary school or the middle school enrolled in a bilingual education program at that school?

☒ Yes ☐ No

3. Do the students at these schools attend a bilingual education program at another location?

☐ Yes ☒ No

4. Would the school be required to provide a bilingual education program, but the school has waived out of this requirement under 19 TAC §89.1205(g)?

☐ Yes ☐ No ☒ N/A

5. If the answer is yes to question 1, 2, 3, or 4, public notices in an alternative language are required. Which language is required by the bilingual program? Spanish

- f. Plain Language Summary Template – Complete the Plain Language Summary (TCEQ Form 20972) and include as an attachment. Attachment: AR-2
- g. Complete one Public Involvement Plan (PIP) Form (TCEQ Form 20960) for each application for a new permit or major amendment and include as an attachment. Attachment: AR-3

## Item 10. Regulated Entity and Permitted Site Information (Instructions Page 29)

- a. TCEQ issued Regulated Entity Number (RN), if available: RN100219203

**Note:** If your business site is part of a larger business site, a Regulated Entity Number (RN) may already be assigned for the larger site. Use the RN assigned for the larger site. Search the TCEQ's Central Registry to determine the RN or to see if the larger site may already be registered as a Regulated Entity. If the site is found, provide the assigned RN.

- b. Name of project or site (the name known by the community where located): Garland Municipal Power – Ray Olinger Plant

- c. Is the location address of the facility in the existing permit the same?

☒ Yes ☐ No ☐ N/A (new permit)

**Note:** If the facility is located in Bexar, Comal, Hays, Kinney, Medina, Travis, Uvalde, or Williamson County, additional information concerning protection of the Edwards Aquifer may be required.

- d. Owner of treatment facility:

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: City of Garland

Mailing Address: 13835 Country Road 489

City/State/Zip: Nevada, TX 75173

Phone No: 972-205-2650

Email: Click to enter text.

- e. Ownership of facility: ☒ Public ☐ Private ☐ Both ☐ Federal

f. Owner of land where treatment facility is or will be: N/A

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: City of Garland

Mailing Address: 13835 Country Road 489

City/State/Zip: Nevada, TX 75173

Phone No: 972-205-2650

Email: dbernard@gpltexas.org

**Note:** If not the same as the facility owner, attach a long-term lease agreement in effect for at least six years (In some cases, a lease may not suffice - see instructions). Attachment: N/A

g. Owner of effluent TLAP disposal site (if applicable): N/A

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: N/A

Mailing Address: N/A

City/State/Zip: N/A

Phone No: N/A

Email: N/A

**Note:** If not the same as the facility owner, attach a long-term lease agreement in effect for at least six years. Attachment: N/A

h. Owner of sewage sludge disposal site (if applicable):

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: N/A

Mailing Address: N/A

City/State/Zip: N/A

Phone No: N/A

Email: N/A

**Note:** If not the same as the facility owner, attach a long-term lease agreement in effect for at least six years. Attachment: N/A

## Item 11. TDPES Discharge/TLAP Disposal Information (Instructions, Page 31)

a. Is the facility located on or does the treated effluent cross Native American Land?

☐ Yes ☒ No

b. Attach an original full size USGS Topographic Map (or an 8.5"×11" reproduced portion for renewal or amendment applications) with all required information. Check the box next to each item below to confirm it has been included on the map.

☒ One-mile radius

☒ Three-miles downstream information

☒ Applicant's property boundaries

☒ Treatment facility boundaries

☒ Labeled point(s) of discharge

☒ Highlighted discharge route(s)

☐ Effluent disposal site boundaries

☒ All wastewater ponds

☐ Sewage sludge disposal site

☐ New and future construction

Attachment: AR-4

c. Is the location of the sewage sludge disposal site in the existing permit accurate?

☐ Yes ☐ No or New Permit N/A



If no, or a new application, provide an accurate location description: N/A

- d. Are the point(s) of discharge in the existing permit correct?

☒ Yes ☐ No or New Permit

If no, or a new application, provide an accurate location description: N/A

- e. Are the discharge route(s) in the existing permit correct?

☒ Yes ☐ No or New Permit

If no, or a new permit, provide an accurate description of the discharge route: N/A

- f. City nearest the outfall(s): Nevada

- g. County in which the outfalls(s) is/are located: Collin

- h. Is or will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch?

☐ Yes ☒ No

If yes, indicate by a check mark if: ☐ Authorization granted ☐ Authorization pending

For new and amendment applications, attach copies of letters that show proof of contact and provide the approval letter upon receipt. Attachment: N/A

For all applications involving an average daily discharge of 5 MGD or more, provide the names of all counties located within 100 statute miles downstream of the point(s) of discharge: Collin, Dallas, Rockwall, Kaufman, Ellis

- i. For TLAPs, is the location of the effluent disposal site in the existing permit accurate?

☐ Yes ☐ No or New Permit ☐ N/A

If no, or a new application, provide an accurate location description: N/A

- j. City nearest the disposal site: N/A

- k. County in which the disposal site is located: N/A

- l. For TLAPs, describe how effluent is/will be routed from the treatment facility to the disposal site: N/A

- m. For TLAPs, identify the nearest watercourse to the disposal site to which rainfall runoff might flow if not contained: N/A

## Item 12. Miscellaneous Information (Instructions, Page 33)

- a. Did any person formerly employed by the TCEQ represent your company and get paid for service regarding this application?

☐ Yes ☒ No

If yes, list each person: N/A

- b. Do you owe any fees to the TCEQ?

☐ Yes ☒ No

If yes, provide the following information:

Account no.: N/A

Total amount due: N/A

- c. Do you owe any penalties to the TCEQ?

☐ Yes ☒ No

If yes, provide the following information:

Enforcement order no.: N/A

Amount due: N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## ADMINISTRATIVE REPORT 1.1

The following information is required for new and amendment applications.

### Item 1. Affected Landowner Information (Instructions, Page 35)

- a. Attach a landowner map or drawing, with scale, as applicable. Check the box next to each item to confirm it has been provided.
- ☒ The applicant's property boundaries.
  - ☒ The facility site boundaries within the applicant's property boundaries.
  - ☒ The distance the buffer zone falls into adjacent properties and the property boundaries of the landowners located within the buffer zone.
  - ☒ The property boundaries of all landowners surrounding the applicant's property. (Note: if the application is a major amendment for a lignite mine, the map must include the property boundaries of all landowners adjacent to the new facility (ponds).)
  - ☒ The point(s) of discharge and highlighted discharge route(s) clearly shown for one mile downstream.
  - ☐ The property boundaries of the landowners located on both sides of the discharge route for one full stream mile downstream of the point of discharge.
  - ☒ The property boundaries of the landowners along the watercourse for a one-half mile radius from the point of discharge if the point of discharge is into a lake, bay, estuary, or affected by tides.
  - ☐ The boundaries of the effluent disposal site (e.g., irrigation area or subsurface drainfield site) and all evaporation/holding ponds within the applicant's property.
  - ☐ The property boundaries of all landowners surrounding the applicant's property boundaries where the effluent disposal site is located.
  - ☐ The boundaries of the sludge land application site (for land application of sewage sludge for beneficial use) and the property boundaries of landowners within one-quarter mile of the applicant's property boundaries where the sewage sludge land application site is located.
  - ☐ The property boundaries of landowners within one-half mile in all directions from the applicant's property boundaries where the sewage sludge disposal site (e.g., sludge surface disposal site or sludge monofil) is located.
- Attachment: [AR-5](#)
- b. Check the box next to the format of the landowners list:
- ☐ Readable/Writeable CD
  - ☒ Four sets of labels
- Attachment: [AR-5](#)
- d. Provide the source of the landowners' names and mailing addresses: Collin County CAD
- e. As required by Texas Water Code § 5.115, is any permanent school fund land affected by this application?
- ☐ Yes
  - ☒ No

If yes, provide the location and foreseeable impacts and effects this application has on the land(s): N/A

## **Item 2. Original Photographs (Instructions, Page 37)**

Provide original ground level photographs. Check the box next to each of the following items to indicate it is included.

- ☒ At least one original photograph of the new or expanded treatment unit location.
- ☒ At least two photographs of the existing/proposed point of discharge and as much area downstream (photo 1) and upstream (photo 2) as can be captured. If the discharge is to an open water body (e.g., lake, bay), the point of discharge should be in the right or left edge of each photograph showing the open water and with as much area on each respective side of the discharge as can be captured.
- ☐ At least one photograph of the existing/proposed effluent disposal site.
- ☒ A plot plan or map showing the location and direction of each photograph.

Attachment: **AR-6**

# **INDUSTRIAL WASTEWATER PERMIT APPLICATION**

## **SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)**

This form applies to TPDES permit applications only. Complete and attach the Supplemental Permit information Form (SPIF) (TCEQ Form 20971).

**Attachment:** SPIF-1 (SPIF Form), SPIF-2 (SPIF Topo Map)

# INDUSTRIAL WASTEWATER PERMIT APPLICATION CHECKLIST OF COMMON DEFICIENCIES

Below is a list of common deficiencies found during the administrative review of industrial wastewater permit applications. To ensure the timely processing of this application, please review the items below and indicate each item is complete and in accordance applicable rules at 30 TAC Chapters 21, 281, and 305 by checking the box next to the item. If an item is not required this application, indicate by checking N/A where appropriate. Please do not submit the application until all items below are addressed.

- ☒ Core Data Form (TCEQ Form No. 10400)  
*(Required for all applications types. Must be completed in its entirety and signed.  
Note: Form may be signed by applicant representative.)*
- ☒ Correct and Current Industrial Wastewater Permit Application Forms  
*(TCEQ Form Nos. 10055 and 10411. Version dated 5/10/2019 or later.)*
- ☒ Water Quality Permit Payment Submittal Form (Page 14) **EPAY**  
*(Original payment sent to TCEQ Revenue Section. See instructions for mailing address.)*
- ☒ 7.5 Minute USGS Quadrangle Topographic Map Attached  
*(Full-size map if seeking "New" permit.  
8 ½ x 11 acceptable for Renewals and Amendments.)*
- ☒ N/A ☐ Current/Non-Expired, Executed Lease Agreement or Easement Attached
- ☐ N/A ☒ Landowners Map  
*(See instructions for landowner requirements.)*

## Things to Know:

- All the items shown on the map must be labeled.
- The applicant's complete property boundaries must be delineated which includes boundaries of contiguous property owned by the applicant.
- The applicant cannot be its own adjacent landowner. You must identify the landowners immediately adjacent to their property, regardless of how far they are from the actual facility.
- If the applicant's property is adjacent to a road, creek, or stream, the landowners on the opposite side must be identified. Although the properties are not adjacent to applicant's property boundary, they are considered potentially affected landowners. If the adjacent road is a divided highway as identified on the USGS topographic map, the applicant does not have to identify the landowners on the opposite side of the highway.

- ☐ N/A ☒ Landowners Cross Reference List  
*(See instructions for landowner requirements.)*
- ☐ N/A ☒ Landowners Labels or CD-RW attached  
*(See instructions for landowner requirements.)*
- ☒ Original signature per 30 TAC § 305.44 – Blue Ink Preferred  
*(If signature page is not signed by an elected official or principle executive officer,  
a copy of signature authority/delegation letter must be attached.)*
- ☒ Plain Language Summary



# 4TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## INDUSTRIAL WASTEWATER PERMIT APPLICATION TECHNICAL REPORT 1.0

The following information **is required** for all applications for a TLAP or an individual TPDES discharge permit.

For **additional information** or clarification on the requested information, please refer to the [Instructions for Completing the Industrial Wastewater Permit Application](https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES_industrial_wastewater_steps.html)<sup>1</sup> available on the TCEQ website. Please contact the Industrial Permits Team at 512-239-4671 with any questions about this form.

If more than one outfall is included in the application, provide applicable information for each individual outfall. **If an item does not apply to the facility, enter N/A** to indicate that the item has been considered. Include separate reports or additional sheets as **clearly cross-referenced attachments** and provide the attachment number in the space provided for the item the attachment addresses.

**NOTE:** This application is for an industrial wastewater permit only. Additional authorizations from the TCEQ Waste Permits Division or the TCEQ Air Permits Division may be needed.

### Item 1. Facility/Site Information (Instructions, Page 39)

- a. Describe the general nature of the business and type(s) of industrial and commercial activities. Include all applicable SIC codes (up to 4).

Steam Electric Power Plant (SIC Code 4911 – Electric Services)

- b. Describe all wastewater-generating processes at the facility.

The Ray Olinger Plant burns natural gas to produce steam used to drive turbine generators producing electric power. It also has one combustion gas turbine for power peaking. Exhaust steam is condensed in non-contact heat exchangers using lake water as the cooling media. Boiler blowdown and demineralized wastewater goes to evaporation ponds with zero discharge.

<sup>1</sup>

[https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES\\_industrial\\_wastewater\\_steps.html](https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES_industrial_wastewater_steps.html)

- c. Provide a list of raw materials, major intermediates, and final products handled at the facility.

**Materials List**

Raw Materials	Intermediate Products	Final Products
Natural Gas	Steam	Electricity

**Attachment:** N/A

- d. Attach a facility map (drawn to scale) with the following information:

- Production areas, maintenance areas, materials-handling areas, waste-disposal areas, and water intake structures.
- The location of each unit of the WWTP including the location of wastewater collection sumps, impoundments, outfalls, and sampling points, if significantly different from outfall locations.

**Attachment:** TR-1

- e. Is this a new permit application for an existing facility?

☐ Yes ☒ No

If **yes**, provide background discussion: N/A

- f. Is/will the treatment facility/disposal site be located above the 100-year frequency flood level.

☒ Yes ☐ No

List source(s) used to determine 100-year frequency flood plain: FEMA Floodplain Map No. 48085Co430J

If **no**, provide the elevation of the 100-year frequency flood plain and describe what protective measures are used/proposed to prevent flooding (including tail water and rainfall run-on controls) of the treatment facility and disposal area: N/A

**Attachment:** N/A

- g. For **new** or **major amendment** permit applications, will any construction operations result in a discharge of fill material into a water in the state?



☐ Yes    ☒ No    ☐ N/A (renewal only)

h. If **yes** to Item 1.g, has the applicant applied for a USACE CWA Chapter 404 Dredge and Fill permit?

☐ Yes    ☐ No

If **yes**, provide the permit number: N/A

If **no**, provide an approximate date of application submittal to the USACE: N/A

## Item 2. Treatment System (Instructions, Page 40)

a. List any physical, chemical, or biological treatment process(es) used/proposed to treat wastewater at this facility. Include a description of each treatment process, starting with initial treatment and finishing with the outfall/point of disposal.

Sodium hyperchlorate is used at the intake to control algae in the circulating water used for condenser cooling. Ammonium bisulfate is used for dichlorination at the outlet of the condenser to limit the total residual chlorine to less than 0.1 mg/L when the water exits the outfall into the lake.

b. Attach a flow schematic **with a water balance** showing all sources of water and wastewater flow into the facility, wastewater flow into and from each treatment unit, and wastewater flow to each outfall/point of disposal.

Attachment: **TR-2**

## Item 3. Impoundments (Instructions, Page 40)

Does the facility use or plan to use any wastewater impoundments (e.g., lagoons or ponds?)

☒ Yes    ☐ No

If **no**, proceed to Item 4. If **yes**, complete **Item 3.a** for **existing** impoundments and **Items 3.a - 3.e** for **new or proposed** impoundments. **NOTE:** See instructions, Pages 40-42, for additional information on the attachments required by Items 3.a – 3.e.

a. Complete the table with the following information for each existing, new, or proposed impoundment. Attach additional copies of the Impoundment Information table, if needed.

**Use Designation:** Indicate the use designation for each impoundment as Treatment (T), Disposal (D), Containment (C), or Evaporation (E).

**Associated Outfall Number:** Provide an outfall number if a discharge occurs or will occur.

**Liner Type:** Indicate the liner type as Compacted clay liner (C), In-situ clay liner (I), Synthetic/plastic/rubber liner (S), or Alternate liner (A). **NOTE:** See instructions for further detail on liner specifications. If an alternate liner (A) is selected, include an attachment that provides a description of the alternate liner and any additional technical information necessary for an evaluation.

**Leak Detection System:** If any leak detection systems are in place/planned, enter Y for yes. Otherwise, enter N for no.

**Groundwater Monitoring Wells and Data:** If groundwater monitoring wells are in place/planned, enter Y for yes. Otherwise, enter N for no. Attach any existing groundwater monitoring data.

**Dimensions:** Provide the dimensions, freeboard, surface area, storage capacity of the impoundments, and the maximum depth (not including freeboard). For impoundments with irregular shapes, submit surface area instead of length and width.

**Compliance with 40 CFR Part 257, Subpart D:** If the impoundment is required to be in compliance with 40 CFR Part 257, Subpart D, enter Y for yes. Otherwise, enter N for no.

**Date of Construction:** Enter the date construction of the impoundment commenced (mm/dd/yy).

#### Impoundment Information

Parameter	Pond #1	Pond #2	Pond #3	Pond #4
Use Designation: (T) (D) (C) or (E)	E	E	E	E
Associated Outfall Number				
Liner Type (C) (I) (S) or (A)	C	C	C	S
Alt. Liner Attachment Reference				
Leak Detection System, Y/N				
Groundwater Monitoring Wells, Y/N				
Groundwater Monitoring Data Attachment				
Pond Bottom Located Above The Seasonal High-Water Table, Y/N				
Length (ft)	200	100	384	400
Width (ft)	184	90	274	321
Max Depth From Water Surface (ft), Not Including Freeboard	3	3	3	6
Freeboard (ft)	2	2	2	2
Surface Area (acres)	0.85	0.20	2.42	2.95
Storage Capacity (gallons)	1,376,416	336,623	3,935,352	5,762,992
40 CFR Part 257, Subpart D, Y/N				
Date of Construction				

**Attachment:** N/A

The following information (**Items 3.b – 3.e**) is required only for **new or proposed** impoundments.

- b. For new or proposed impoundments, attach any available information on the following items. If attached, check **yes** in the appropriate box. Otherwise, check **no** or **not yet designed**.

1. Liner data

☐ Yes      ☐ No      ☐ Not yet designed

2. Leak detection system or groundwater monitoring data

☐ Yes      ☐ No      ☐ Not yet designed

3. Groundwater impacts

☐ Yes      ☐ No      ☐ Not yet designed

**NOTE:** Item b.3 is required if the bottom of the pond is not above the seasonal high-water table in the shallowest water-bearing zone.

**Attachment:** N/A

**For TLAP applications: Items 3.c – 3.e are not required, continue to Item 4.**

- c. Attach a USGS map or a color copy of original quality and scale which accurately locates and identifies all known water supply wells and monitor wells within ½-mile of the impoundments.

**Attachment:** N/A

- d. Attach copies of State Water Well Reports (e.g., driller's logs, completion data, etc.), and data on depths to groundwater for all known water supply wells including a description of how the depths to groundwater were obtained.

**Attachment:** N/A

- e. Attach information pertaining to the groundwater, soils, geology, pond liner, etc. used to assess the potential for migration of wastes from the impoundments or the potential for contamination of groundwater or surface water.

**Attachment:** N/A

## **Item 4. Outfall/Disposal Method Information (Instructions, Page 42)**

Complete the following tables to describe the location and wastewater discharge or disposal operations for each outfall for discharge, and for each point of disposal for TLAP operations.

If there are more outfalls/points of disposal at the facility than the spaces provided, copies of pages 6 and/or numbered accordingly (i.e., page 6a, 6b, etc.) may be used to provide information on the additional outfalls.

**For TLAP applications:** Indicate the disposal method and each individual irrigation area **I**, evaporation pond **E**, or subsurface drainage system **S** by providing the appropriate letter designation for the disposal method followed by a numerical designation for each disposal area in the space provided for **Outfall** number (e.g. **E1** for evaporation pond 1, **I2** for irrigation area No. 2, etc.).

**Outfall Longitude and Latitude**

Outfall No.	Latitude (Decimal Degrees)	Longitude (Decimal Degrees)
001	33.068508	-96.454209

**Outfall Location Description**

Outfall No.	Location Description
001	Lake Lavon
Internal 101	Near water treatment units (to be removed)
Internal 102	Surrounding and near ROP1,2, and 3

**Description of Sampling Point(s) (if different from Outfall location)**

Outfall No.	Description of sampling point
001	Outfall location (33.068508, -96.454209)

**Outfall Flow Information - Permitted and Proposed**

Outfall No.	Permitted Daily Avg Flow (MGD)	Permitted Daily Max Flow (MGD)	Proposed Daily Avg Flow (MGD)	Proposed Daily Max Flow (MGD)	Anticipated Discharge Date (mm/dd/yy)
001	404	404			
Internal 101	Report	Report			

**Outfall Discharge - Method and Measurement**

Outfall No.	Pumped Discharge? Y/N	Gravity Discharge? Y/N	Type of Flow Measurement Device Used
001	Y	N	Meter
Internal 101	Y	N	Est.
Internal 102	N	Y	Est.

**Outfall Discharge - Flow Characteristics**

Outfall No.	Intermittent Discharge? Y/N	Continuous Discharge? Y/N	Seasonal Discharge? Y/N	Discharge Duration (hrs/day)	Discharge Duration (days/mo)	Discharge Duration (mo/yr)
001	N	Y	N	24	31	12
Internal 101	Y	N	N	Variable	Variable	Variable

Outfall No.	Intermittent Discharge? Y/N	Continuous Discharge? Y/N	Seasonal Discharge? Y/N	Discharge Duration (hrs/day)	Discharge Duration (days/mo)	Discharge Duration (mo/yr)
Internal 102	Y	N	N	Variable	Variable	Variable

#### Outfall Wastestream Contributions

##### Outfall No. **001**

Contributing Wastestream	Volume (MGD)	Percent (%) of Total Flow
ROP3 Condenser and Plant Service Water	86.903	59
ROP1 & ROP2 Condensers and Plant Service Water	61.198	41
Internal Outfall 101 - Filter Backwash and RO Reject	0.052	0
Internal Outfall 102 - Stormwater Run-off (gravity, seasonal)	0.014	0
<b>Total</b>	<b>148.167</b>	<b>100</b>

##### Outfall No. **Internal 101 (to be removed)**

Contributing Wastestream	Volume (MGD)	Percent (%) of Total Flow
Prefilter Backwash	0.03	0
RO Reject	0.022	0

##### Outfall No. **Internal 102**

Contributing Wastestream	Volume (MGD)	Percent (%) of Total Flow
Stormwater	0.014	0

Attachment: N/A

## Item 5. Blowdown and Once-Through Cooling Water Discharges (Instructions, Page 43)

a. Indicate if the facility currently or proposes to:

- ☐ Yes ☒ No Use cooling towers that discharge blowdown or other wastestreams
- ☐ Yes ☒ No Use boilers that discharge blowdown or other wastestreams
- ☒ Yes ☐ No Discharge once-through cooling water

**NOTE:** If the facility uses or plans to use cooling towers or once-through cooling water, Item 12 **is required**.

b. If **yes** to any of the above, attach an SDS with the following information for each chemical additive.

- Manufacturers Product Identification Number
- Product use (e.g., biocide, fungicide, corrosion inhibitor, etc.)
- Chemical composition including CASRN for each ingredient
- Classify product as non-persistent, persistent, or bioaccumulative
- Product or active ingredient half-life
- Frequency of product use (e.g., 2 hours/day once every two weeks)
- Product toxicity data specific to fish and aquatic invertebrate organisms
- Concentration of whole product or active ingredient, as appropriate, in wastestream.

In addition to each SDS, attach a summary of the above information for each specific wastestream and the associated chemical additives. Specify which outfalls are affected.

**Attachment:** **TR-3**

c. Cooling Towers and Boilers

If the facility currently or proposes to use cooling towers or boilers that discharge blowdown or other wastestreams to the outfall(s), complete the following table.

**Cooling Towers and Boilers**

Type of Unit	Number of Units	Daily Avg Blowdown (gallons/day)	Daily Max Blowdown (gallons/day)
Cooling Towers			
Boilers	3	34,022	48,916

## Item 6. Stormwater Management (Instructions, Page 44)

Will any existing/proposed outfalls discharge stormwater associated with industrial activities, as defined at 40 CFR § 122.26(b)(14), commingled with any other wastestream?

- ☒ Yes ☐ No

If **yes**, briefly describe the industrial processes and activities that occur outdoors or in a manner which may result in exposure of the activities or materials to stormwater: The ROPP facility has a current MSGP authorization (TXR05AX97). The exposed materials include diesel and gasoline storage, used oil, and sodium hypochlorite associated with the industrial process.

## Item 7. Domestic Sewage, Sewage Sludge, and Septage Management and Disposal (Instructions, Page 44)

**Domestic Sewage** - Waste and wastewater from humans or household operations that is discharged to a wastewater collection system or otherwise enters a treatment works.

- a. Check the box next to the appropriate method of domestic sewage and domestic sewage sludge treatment or disposal. Complete Worksheet 5.0 or Item 7.b if directed to do so.
- ☐ Domestic sewage is routed (i.e., connected to or transported to) to a WWTP permitted to receive domestic sewage for treatment, disposal, or both. Complete Item 7.b.
  - ☒ Domestic sewage disposed of by an on-site septic tank and drainfield system. Complete Item 7.b.
  - ☐ Domestic and industrial treatment sludge ARE commingled prior to use or disposal.
  - ☐ Industrial wastewater and domestic sewage are treated separately, and the respective sludge IS NOT commingled prior to sludge use or disposal. Complete Worksheet 5.0.
  - ☐ Facility is a POTW. Complete Worksheet 5.0.
  - ☐ Domestic sewage is not generated on-site.
  - ☐ Other (e.g., portable toilets), specify and Complete Item 7.b: [Click to enter text.](#)
- b. Provide the name and TCEQ, NPDES, or TPDES Permit No. of the waste-disposal facility which receives the domestic sewage/septage. If hauled by motorized vehicle, provide the name and TCEQ Registration No. of the hauler.

### Domestic Sewage Plant/Hauler Name

Plant/Hauler Name	Permit/Registration No.
AAA Septic Tank Service, Inc	TCEQ 24027
Nortex Septic Service	TCEQ 25282

## Item 8. Improvements or Compliance/Enforcement Requirements (Instructions, Page 45)

- a. Is the permittee currently required to meet any implementation schedule for compliance or enforcement?
- ☐ Yes ☒ No
- b. Has the permittee completed or planned for any improvements or construction projects?
- ☐ Yes ☒ No
- c. If **yes** to either 8.a or 8.b, provide a brief summary of the requirements and a status update: N/A

## Item 9. Toxicity Testing (Instructions, Page 45)

Have any biological tests for acute or chronic toxicity been made on any of the discharges or on a receiving water in relation to the discharge within the last three years?

☐ Yes ☒ No

If **yes**, identify the tests and describe their purposes: N/A

Additionally, attach a copy of all tests performed which **have not** been submitted to the TCEQ or EPA. **Attachment:** N/A

## Item 10. Off-Site/Third Party Wastes (Instructions, Page 45)

- a. Does or will the facility receive wastes from off-site sources for treatment at the facility, disposal on-site via land application, or discharge via a permitted outfall?

☐ Yes ☒ No

If **yes**, provide responses to Items 10.b through 10.d below.

If **no**, proceed to Item 11.

- b. Attach the following information to the application:

- List of wastes received (including volumes, characterization, and capability with on-site wastes).
- Identify the sources of wastes received (including the legal name and addresses of the generators).
- Description of the relationship of waste source(s) with the facility's activities.

**Attachment:** N/A

- c. Is or will wastewater from another TCEQ, NPDES, or TPDES permitted facility commingled with this facility's wastewater after final treatment and prior to discharge via the final outfall/point of disposal?

☐ Yes ☒ No

If **yes**, provide the name, address, and TCEQ, NPDES, or TPDES permit number of the contributing facility and a copy of any agreements or contracts relating to this activity.

**Attachment:** N/A

- d. Is this facility a POTW that accepts/will accept process wastewater from any SIU and has/is required to have an approved pretreatment program under the NPDES/TPDES program?

☐ Yes ☒ No

If **yes**, **Worksheet 6.0** of this application **is required**.

## Item 11. Radioactive Materials (Instructions, Page 46)

- a. Are/will radioactive materials be mined, used, stored, or processed at this facility?

☐ Yes ☒ No

If **yes**, use the following table to provide the results of one analysis of the effluent for all radioactive materials that may be present. Provide results in pCi/L.



**Radioactive Materials Mined, Used, Stored, or Processed**

Radioactive Material Name	Concentration (pCi/L)
N/A	

- b. Does the applicant or anyone at the facility have any knowledge or reason to believe that radioactive materials may be present in the discharge, including naturally occurring radioactive materials in the source waters or on the facility property?

☐ Yes ☒ No

If **yes**, use the following table to provide the results of one analysis of the effluent for all radioactive materials that may be present. Provide results in pCi/L. Do not include information provided in response to Item 11.a.

**Radioactive Materials Present in the Discharge**

Radioactive Material Name	Concentration (pCi/L)
N/A	

**Item 12. Cooling Water (Instructions, Page 46)**

- a. Does the facility use or propose to use water for cooling purposes?

☒ Yes ☐ No

If **no**, stop here. If **yes**, complete Items 12.b thru 12.f.

- b. Cooling water is/will be obtained from a groundwater source (e.g., on-site well).

☐ Yes ☒ No

If **yes**, stop here. If **no**, continue.

- c. Cooling Water Supplier

- Provide the name of the owner(s) and operator(s) for the CWIS that supplies or will supply water for cooling purposes to the facility.

**Cooling Water Intake Structure(s) Owner(s) and Operator(s)**

CWIS ID	Unit 1	Unit 2	Unit 3	
Owner	GP&L	GP&L	GP&L	
Operator	GP&L	GP&L	GP&L	

2. Cooling water is/will be obtained from a Public Water Supplier (PWS)

☒ Yes ☐ No

If **no**, continue. If **yes**, provide the PWS Registration No. and stop here: PWS No. 0430044

3. Cooling water is/will be obtained from a reclaimed water source?

☐ Yes ☒ No

If **no**, continue. If **yes**, provide the Reuse Authorization No. and stop here: N/A

4. Cooling water is/will be obtained from an Independent Supplier

☐ Yes ☒ No

If **no**, proceed to Item 12.d. If **yes**, provide the actual intake flow of the Independent Supplier's CWIS that is/will be used to provide water for cooling purposes and proceed: N/A

d. 316(b) General Criteria

1. The CWIS(s) used to provide water for cooling purposes to the facility has or will have a cumulative design intake flow of 2 MGD or greater.

☒ Yes ☐ No

2. At least 25% of the total water withdrawn by the CWIS is/will be used at the facility exclusively for cooling purposes on an annual average basis.

☒ Yes ☐ No

3. The CWIS(s) withdraw(s)/propose(s) to withdraw water for cooling purposes from surface waters that meet the definition of Waters of the United States in *40 CFR § 122.2*.

☒ Yes ☐ No

If **no**, provide an explanation of how the waterbody does not meet the definition of Waters of the United States in *40 CFR § 122.2*: N/A

If **yes** to all three questions in Item 12.d, the facility **meets** the minimum criteria to be subject to the full requirements of Section 316(b) of the CWA. Proceed to **Item 12.f**.

If **no** to any of the questions in Item 12.d, the facility **does not meet** the minimum criteria to be subject to the full requirements of Section 316(b) of the CWA; however, a determination is required based upon BPJ. Proceed to **Item 12.e**.

e. The facility does not meet the minimum requirements to be subject to the fill requirements of Section 316(b) **and uses/proposes to use cooling towers**.

☐ Yes ☐ No

If **yes**, stop here. If **no**, complete Worksheet 11.0, Items 1.a, 1.b.1-3 and 6, 2.b.1, and 3.a to allow for a determination based upon BPJ.

f. Oil and Gas Exploration and Production

1. The facility is subject to requirements at 40 CFR Part 435, Subparts A or D.

☐ Yes ☒ No

If **yes**, continue. If **no**, skip to Item 12.g.

2. The facility is an existing facility as defined at 40 CFR § 125.92(k) or a new unit at an existing facility as defined at 40 CFR § 125.92(u).

☐ Yes ☐ No

If **yes**, complete Worksheet 11.0, Items 1.a, 1.b.1-3 and 6, 2.b.1, and 3.a to allow for a determination based upon BPJ. If **no**, skip to Item 12.g.3.

g. Compliance Phase and Track Selection

1. Phase I – New facility subject to 40 CFR Part 125, Subpart I

☐ Yes ☒ No

If **yes**, check the box next to the compliance track selection, attach the requested information, and complete Worksheet 11.0, Items 2 and 3, and Worksheet 11.2.

☐ Track I – AIF greater than 2 MGD, but less than 10 MGD

- Attach information required by 40 CFR §§ 125.86(b)(2)-(4).

☐ Track I – AIF greater than 10 MGD

- Attach information required by 40 CFR § 125.86(b).

☐ Track II

- Attach information required by 40 CFR § 125.86(c).

**Attachment:** [Click to enter text.](#)

2. Phase II – Existing facility subject to 40 CFR Part 125, Subpart J

☒ Yes ☐ No

If **yes**, complete Worksheets 11.0 through 11.3, as applicable.

3. Phase III – New facility subject to 40 CFR Part 125, Subpart N

☐ Yes ☒ No

If **yes**, check the box next to the compliance track selection and provide the requested information.

☐ Track I – Fixed facility

- Attach information required by 40 CFR § 125.136(b) and complete Worksheet 11.0, Items 2 and 3, and Worksheet 11.2.

☐ Track I – Not a fixed facility

- Attach information required by 40 CFR § 125.136(b) and complete Worksheet 11.0, Item 2 (except CWIS latitude/longitude under Item 2.a).

☐ Track II – Fixed facility

- Attach information required by 40 CFR § 125.136(c) and complete Worksheet 11.0, Items 2 and 3.

**Attachment:** [Click to enter text.](#)

## Item 13. Permit Change Requests (Instructions, Page 48)

This item is only applicable to existing permitted facilities.

- a. Is the facility requesting a **major amendment** of an existing permit?

☒ Yes ☐ No

If **yes**, list each request individually and provide the following information: 1) detailed information regarding the scope of each request and 2) a justification for each request. Attach any supplemental information or additional data to support each request.

GP&L is requesting to remove internal Outfall 101 from the permit to eliminate separate sampling frequency from Outfall 001.

Other Requirement No. 12 (Evaporation Ponds) of the current permit lists that Pond No. 1 and No.3 can accept Meatal Cleaning Waste (MCW). However, the Draft Permit Rationale, Technology-Based Effluent Limitations/Conditions, states, "boiler blowdown, demineralized wastewater, and metal cleaning waste are routed to four evaporation ponds with zero discharge." GP&L would like to inquire about listing all four evaporation ponds to accept MCW.

- b. Is the facility requesting any **minor amendments** to the permit?

☐ Yes ☒ No

If **yes**, list and describe each change individually.

N/A - renewal

- c. Is the facility requesting any **minor modifications** to the permit?

☐ Yes ☒ No

If **yes**, list and describe each change individually.

N/A - renewal

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 1.0: EPA CATEGORICAL EFFLUENT GUIDELINES

This worksheet **is required** for all applications for TPDES permits for discharges of wastewaters subject to EPA categorical effluent limitation guidelines (ELGs).

### Item 1. Categorical Industries (Instructions, Page 53)

Is this facility subject to any 40 CFR categorical ELGs outlined on page 53 of the instructions?

☒ Yes ☐ No

If **no**, this worksheet is not required. If **yes**, provide the appropriate information below.

#### 40 CFR Effluent Guideline

Industry	40 CFR Part
Steam Electric Power Generating	423

### Item 2. Production/Process Data (Instructions, Page 54)

**NOTE:** For all TPDES permit applications requesting individual permit coverage for discharges of oil and gas exploration and production wastewater (discharges into or adjacent to water in the state, falling under the Oil and Gas Extraction Effluent Guidelines – 40 CFR Part 435), see Worksheet 12.0, Item 2 instead.

#### a. Production Data

Provide appropriate data for effluent guidelines with production-based effluent limitations.

##### Production Data

Subcategory	Actual Quantity/Day	Design Quantity/Day	Units
Once-through cooling water	404 Max (varies daily)	404	MGD

#### b. Organic Chemicals, Plastics, and Synthetic Fibers Manufacturing Data (40 CFR Part 414)

Provide each applicable subpart and the percent of total production. Provide data for metal-bearing and cyanide-bearing wastestreams, as required by *40 CFR Part 414, Appendices A and B*.

**Percentage of Total Production**

Subcategory	Percent of Total Production	Appendix A and B - Metals	Appendix A - Cyanide
N/A			

**c. Refineries (40 CFR Part 419)**

Provide the applicable subcategory and a brief justification.

N/A

### Item 3. Process/Non-Process Wastewater Flows (Instructions, Page 54)

Provide a breakdown of wastewater flow(s) generated by the facility, including both process and non-process wastewater flow(s). Specify which wastewater flows are to be authorized for discharge under this permit and the disposal practices for wastewater flows, excluding domestic, which are not to be authorized for discharge under this permit.

Process: Once-through cooling water and low-volume waste

Non-Process: Stormwater runoff from the site

### Item 4. New Source Determination (Instructions, Page 54)

Provide a list of all wastewater-generating processes subject to EPA categorical ELGs, identify the appropriate guideline Part and Subpart, and provide the date the process/construction commenced.

**Wastewater Generating Processes Subject to Effluent Guidelines**

Process	EPA Guideline Part	EPA Guideline Subpart	Date Process/Construction Commenced
Once-through cooling water	423	12	1975
Low volume waste	423	12	2011

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 2.0: POLLUTANT ANALYSIS

Worksheet 2.0 is **required** for all applications submitted for a TPDES permit. Worksheet 2.0 is not required for applications for a permit to dispose of all wastewater by land disposal or for discharges solely of stormwater associated with industrial activities.

### Item 1. General Testing Requirements (Instructions, Page 55)

- Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): 7/8/24 – 7/24/24
- ☒ Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- Read the general testing requirements in the instructions for important information about sampling, test methods, and MALs. If a contact laboratory was used, attach a list which includes the name, contact information, and pollutants analyzed for each laboratory/firm.  
**Attachment:** TR-4

### Item 2. Specific Testing Requirements (Instructions, Page 56)

Attach correspondence from TCEQ approving submittal of less than the required number of samples, if applicable. **Attachment:** N/A

#### TABLE 1 and TABLE 2 (Instructions, Page 58)

Completion of Tables 1 and 2 is required for all external outfalls for all TPDES permit applications.

Table 1 for Outfall No.: 001

Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (mg/L) 7/6/24	Sample 2 (mg/L) 7/8/24	Sample 3 (mg/L) 7/16/24	Sample 4 (mg/L) 7/24/24
BOD (5-day)	1.67	1.39	2.53	2.34
CBOD (5-day)	1.75	1.44	2.52	1.48
Chemical oxygen demand	25.4	19.0	22.2	22.2
Total organic carbon	11.5	11.2	5.34	4.99
Dissolved oxygen	8.77	10.2	7.77	9.72
Ammonia nitrogen	<0.0280	<0.0280	<0.0280	0.0292
Total suspended solids	5.93	6.20	<2.65	7.83
Nitrate nitrogen	<0.0480	<0.0480	<0.0480	4.86
Total organic nitrogen	1.03	0.343	0.478	0.721
Total phosphorus	0.101	0.0443	0.0442	0.0348
Oil and grease	0.780	<0.35	<0.35	0.490

<b>Pollutant</b>	<b>Sample 1 (mg/L) 7/6/24</b>	<b>Sample 2 (mg/L) 7/8/24</b>	<b>Sample 3 (mg/L) 7/16/24</b>	<b>Sample 4 (mg/L) 7/24/24</b>
Total residual chlorine	0.033	0.108	0.0420	0.0390
Total dissolved solids	184	159	219	213
Sulfate	27.1	23.3	27.3	25.0
Chloride	15.4	14.4	16.1	15.4
Fluoride	0.177	0.172	0.243	0.376
Total alkalinity (mg/L as CaCO3)	110	120	110	108
Temperature (°F)	86.45	83.9	86.05	4.3
pH (standard units)	8.21	7.83	8.35	8.40

**Table 2 for Outfall No.: 001**

Samples are (check one): ☐ Composite ☒ Grab

<b>Pollutant</b>	<b>Sample 1 (µg/L)</b>	<b>Sample 2 (µg/L)</b>	<b>Sample 3 (µg/L)</b>	<b>Sample 4 (µg/L)</b>	<b>MAL (µg/L)</b>
Aluminum, total	98.4	115	167	72.8	2.5
Antimony, total	<5	<5	<5	<5	5
Arsenic, total	4.8	5.18	5.28	5.21	0.5
Barium, total	39.3	65.9	34.1	38.5	3
Beryllium, total	<0.5	<0.5	<0.5	<0.5	0.5
Cadmium, total	<1	<1	<1	<1	1
Chromium, total	<3	<3	<3	<3	3
Chromium, hexavalent	<3	<3	<3	<3	3
Chromium, trivalent	<3	<3	<3	<3	N/A
Copper, total	6.18	6.09	2.57	2.03	2
Cyanide, available	<2	<2	<2	<2	2/10
Lead, total	<0.5	<0.5	<0.5	<0.5	0.5
Mercury, total	0.078	<0.0005	0.045	<0.0005	0.005/0.0005
Nickel, total	<2	<2	<2	<2	2
Selenium, total	<5	<5	<5	<5	5
Silver, total	<0.5	<0.5	<0.5	<0.5	0.5
Thallium, total	<0.5	<0.5	0.894	<0.5	0.5
Zinc, total	6.02	<5.0	<5.0	<5.0	5.0



TABLE 3 (Instructions, Page 58)

**Completion** of Table 3 is required for all **external outfalls** which discharge process wastewater.

**Partial completion** of Table 3 is required for all **external outfalls** which discharge non-process wastewater and stormwater associated with industrial activities commingled with other wastestreams (see instructions for additional guidance).

Table 3 for Outfall No.: **001**Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Acrylonitrile	<50	<50	<50	<50	50
Anthracene	<10	<10	<10	<10	10
Benzene	<10	<10	<10	<10	10
Benidine	<50	<50	<50	<50	50
Benzo(a)anthracene	<5	<5	<5	<5	5
Benzo(a)pyrene	<5	<5	<5	<5	5
Bis(2-chloroethyl)ether	<10	<10	<10	<10	10
Bis(2-ethylhexyl)phthalate	<10	<10	<10	<10	10
Bromodichloromethane [Dichlorobromomethane]	<10	<10	<10	<10	10
Bromoform	<10	<10	<10	<10	10
Carbon tetrachloride	<2	<2	<2	<2	2
Chlorobenzene	<10	<10	<10	<10	10
Chlorodibromomethane [Dibromochloromethane]	<10	<10	<10	<10	10
Chloroform	<10	<10	<10	<10	10
Chrysene	<5	<5	<5	<5	5
m-Cresol [3-Methylphenol]	<10	<10	<10	<10	10
o-Cresol [2-Methylphenol]	<10	<10	<10	<10	10
p-Cresol [4-Methylphenol]	<10	<10	<10	<10	10
1,2-Dibromoethane	<10	<10	<10	<10	10
m-Dichlorobenzene [1,3-Dichlorobenzene]	<10	<10	<10	<10	10
o-Dichlorobenzene [1,2-Dichlorobenzene]	<10	<10	<10	<10	10
p-Dichlorobenzene [1,4-Dichlorobenzene]	<10	<10	<10	<10	10
3,3'-Dichlorobenzidine	<5	<5	<5	<5	5
1,2-Dichloroethane	<10	<10	<10	<10	10

<b>Pollutant</b>	<b>Sample 1 (µg/L)*</b>	<b>Sample 2 (µg/L)*</b>	<b>Sample 3 (µg/L)*</b>	<b>Sample 4 (µg/L)*</b>	<b>MAL (µg/L)*</b>
1,1-Dichloroethene [1,1-Dichloroethylene]	<10	<10	<10	<10	10
Dichloromethane [Methylene chloride]	<20	<20	<20	<20	20
1,2-Dichloropropane	<10	<10	<10	<10	10
1,3-Dichloropropene [1,3-Dichloropropylene]	<10	<10	<10	<10	10
2,4-Dimethylphenol	<10	<10	<10	<10	10
Di-n-Butyl phthalate	<10	<10	<10	<10	10
Ethylbenzene	<10	<10	<10	<10	10
Fluoride	<500	<500	<500	<500	500
Hexachlorobenzene	<5	<5	<5	<5	5
Hexachlorobutadiene	<10	<10	<10	<10	10
Hexachlorocyclopentadiene	<10	<10	<10	<10	10
Hexachloroethane	<20	<20	<20	<20	20
Methyl ethyl ketone	<50	<50	<50	<50	50
Nitrobenzene	<10	<10	<10	<10	10
N-Nitrosodiethylamine	<20	<20	<20	<20	20
N-Nitroso-di-n-butylamine	<20	<20	<20	<20	20
Nonylphenol	<333	<333	<333	<333	333
Pentachlorobenzene	<20	<20	<20	<20	20
Pentachlorophenol	<5	<5	<5	<5	5
Phenanthrene	<10	<10	<10	<10	10
Polychlorinated biphenyls (PCBs) (**)	<0.2	<0.2	<0.2	<0.2	0.2
Pyridine	<20	<20	<20	<20	20
1,2,4,5-Tetrachlorobenzene	<20	<20	<20	<20	20
1,1,2,2-Tetrachloroethane	<10	<10	<10	<10	10
Tetrachloroethene [Tetrachloroethylene]	<10	<10	<10	<10	10
Toluene	<10	<10	<10	<10	10
1,1,1-Trichloroethane	<10	<10	<10	<10	10
1,1,2-Trichloroethane	<10	<10	<10	<10	10
Trichloroethene [Trichloroethylene]	<10	<10	<10	<10	10

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
2,4,5-Trichlorophenol	<50	<50	<50	<50	50
TTHM (Total trihalomethanes)	<10	<10	<10	<10	10
Vinyl chloride	<10	<10	<10	<10	10

(\*) Indicate units if different from µg/L.

(\*\*) Total of detects for PCB-1242, PCB-1254, PCB-1221, PCB-1232, PCB-1248, PCB-1260, and PCB-1016. If all non-detects, enter the highest non-detect preceded by a "<".

#### TABLE 4 (Instructions, Pages 58-59)

Partial completion of Table 4 **is required** for each **external outfall** based on the conditions below.

##### a. Tributyltin

Is this facility an industrial/commercial facility which currently or proposes to directly dispose of wastewater from the types of operations listed below or a domestic facility which currently or proposes to receive wastewater from the types of industrial/commercial operations listed below?

☐ Yes ☒ No

If **yes**, check the box next to each of the following criteria which apply and provide the appropriate testing results in Table 4 below (check all that apply).

- ☐ Manufacturers and formulators of tributyltin or related compounds.
- ☐ Painting of ships, boats and marine structures.
- ☐ Ship and boat building and repairing.
- ☐ Ship and boat cleaning, salvage, wrecking and scaling.
- ☐ Operation and maintenance of marine cargo handling facilities and marinas.
- ☐ Facilities engaged in wood preserving.
- ☐ Any other industrial/commercial facility for which tributyltin is known to be present, or for which there is any reason to believe that tributyltin may be present in the effluent.

##### b. Enterococci (discharge to saltwater)

This facility discharges/proposes to discharge directly into saltwater receiving waters **and** Enterococci bacteria are expected to be present in the discharge based on facility processes.

☐ Yes ☒ No

Domestic wastewater is/will be discharged.

☐ Yes ☒ No

If **yes to either** question, provide the appropriate testing results in Table 4 below.

c. **E. coli (discharge to freshwater)**

This facility discharges/proposes to discharge directly into freshwater receiving waters **and** *E. coli* bacteria are expected to be present in the discharge based on facility processes.

☐ Yes ☒ No

Domestic wastewater is/will be discharged.

☐ Yes ☒ No

If **yes to either** question, provide the appropriate testing results in Table 4 below.

Table 4 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1	Sample 2	Sample 3	Sample 4	MAL
Tributyltin (µg/L)					0.010
Enterococci (cfu or MPN/100 mL)					N/A
<i>E. coli</i> (cfu or MPN/100 mL)					N/A

TABLE 5 (Instructions, Page 59)

**Completion** of Table 5 **is required** for all **external outfalls** which discharge process wastewater from a facility which manufactures or formulates pesticides or herbicides or other wastewaters which may contain pesticides or herbicides.

If this facility does not/will not manufacture or formulate pesticides or herbicides and does not/will not discharge other wastewaters that may contain pesticides or herbicides, check N/A.

☒ N/A

Table 5 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Aldrin					0.01
Carbaryl					5
Chlordane					0.2
Chlorpyrifos					0.05
4,4'-DDD					0.1
4,4'-DDE					0.1
4,4'-DDT					0.02
2,4-D					0.7
Danitol [Fenpropathrin]					—
Demeton					0.20
Diazinon					0.5/0.1
Dicofol [Kelthane]					1
Dieldrin					0.02
Diuron					0.090

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Endosulfan I ( <i>alpha</i> )					0.01
Endosulfan II ( <i>beta</i> )					0.02
Endosulfan sulfate					0.1
Endrin					0.02
Guthion [Azinphos methyl]					0.1
Heptachlor					0.01
Heptachlor epoxide					0.01
Hexachlorocyclohexane ( <i>alpha</i> )					0.05
Hexachlorocyclohexane ( <i>beta</i> )					0.05
Hexachlorocyclohexane ( <i>gamma</i> ) [Lindane]					0.05
Hexachlorophene					10
Malathion					0.1
Methoxychlor					2.0
Mirex					0.02
Parathion (ethyl)					0.1
Toxaphene					0.3
2,4,5-TP [Silvex]					0.3

\* Indicate units if different from µg/L.

TABLE 6 (Instructions, Page 59)

Completion of Table 6 is required for all external outfalls.

Table 6 for Outfall No.: **001**

Samples are (check one): ☐ Composite ☒ Grab

Pollutants	Believed Present	Believed Absent	Sample 1 (mg/L)	Sample 2 (mg/L)	Sample 3 (mg/L)	Sample 4 (mg/L)	MAL (µg/L)*
Bromide	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.914	<400	0.116	5.16	400
Color (PCU)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.0	20.0	20.0	20.0	—
Nitrate-Nitrite (as N)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<0.048	<0.048	0.21	4.86	—
Sulfide (as S)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<0.023	<0.023	<0.023	<0.023	—
Sulfite (as SO <sub>3</sub> )	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<1.19	<1.19	<1.19	<1.19	—
Surfactants	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<0.36	<0.36	<0.36	<0.36	—
Boron, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	0.0707	0.0759	0.0702	0.0785	20
Cobalt, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	0.00021	0.000199	0.00305	0.0000126	0.3
Iron, total	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.0935	0.119	0.0153	0.0741	7
Magnesium, total	<input checked="" type="checkbox"/>	<input type="checkbox"/>	3.62	3.78	3.92	3.90	20
Manganese, total	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.0324	0.135	0.0439	0.0309	0.5
Molybdenum, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	0.000963	0.00103	0.00174	0.000743	1
Tin, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<5	<5	<5	<5	5
Titanium, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<30	<30	<30	<30	30

**TABLE 7 (Instructions, Page 60)**

Check the box next to any of the industrial categories applicable to this facility. If no categories are applicable, check N/A. If GC/MS testing is required, check the box provided to confirm the testing results for the appropriate parameters are provided with the application.

☐ N/A

**Table 7 for Applicable Industrial Categories**

Industrial Category	40 CFR Part	Volatiles Table 8	Acids Table 9	Bases/Neutrals Table 10	Pesticides Table 11
<input type="checkbox"/> Adhesives and Sealants		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Aluminum Forming	467	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Auto and Other Laundries		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Battery Manufacturing	461	<input type="checkbox"/> Yes	No	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Coal Mining	434	No	No	No	No
<input type="checkbox"/> Coil Coating	465	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Copper Forming	468	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Electric and Electronic Components	469	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Electroplating	413	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Explosives Manufacturing	457	No	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Foundries		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Gum and Wood Chemicals - Subparts A,B,C,E	454	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Gum and Wood Chemicals - Subparts D,F	454	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Inorganic Chemicals Manufacturing	415	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Iron and Steel Manufacturing	420	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Leather Tanning and Finishing	425	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Mechanical Products Manufacturing		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Nonferrous Metals Manufacturing	421,471	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Oil and Gas Extraction - Subparts A, D, E, F, G, H	435	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Ore Mining - Subpart B	440	No	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Organic Chemicals Manufacturing	414	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Paint and Ink Formulation	446,447	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Pesticides	455	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Petroleum Refining	419	<input type="checkbox"/> Yes	No	No	No
<input type="checkbox"/> Pharmaceutical Preparations	439	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Photographic Equipment and Supplies	459	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Plastic and Synthetic Materials Manufacturing	414	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Plastic Processing	463	<input type="checkbox"/> Yes	No	No	No
<input type="checkbox"/> Porcelain Enameling	466	No	No	No	No
<input type="checkbox"/> Printing and Publishing		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subpart C	430	<input type="checkbox"/> *	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts F, K	430	<input type="checkbox"/> *	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> *
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts A, B, D, G, H	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> *
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts I, J, L	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subpart E	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *
<input type="checkbox"/> Rubber Processing	428	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Soap and Detergent Manufacturing	417	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input checked="" type="checkbox"/> Steam Electric Power Plants	423	<input checked="" type="checkbox"/> Yes	<input checked="" type="checkbox"/> Yes	No	No
<input type="checkbox"/> Textile Mills (Not Subpart C)	410	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Timber Products Processing	429	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes

\* Test if believed present.

**TABLES 8, 9, 10, and 11 (Instructions, Page 60)**

Completion of Tables 8, 9, 10, and 11 **is required** as specified in Table 7 for all **external outfalls** that contain process wastewater.

Completion of Tables 8, 9, 10, and 11 **may be required** for types of industry not specified in Table 7 for specific parameters that are believed to be present in the wastewater.

**Table 8 for Outfall No.: 001**

Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Acrolein	<50	<50	<50	<50	50
Acrylonitrile	<50	<50	<50	<50	50
Benzene	<10	<10	<10	<10	10
Bromoform	<10	<10	<10	<10	10
Carbon tetrachloride	<2	<2	<2	<2	2
Chlorobenzene	<10	<10	<10	<10	10
Chlorodibromomethane	<10	<10	<10	<10	10
Chloroethane	<50	<50	<50	<50	50
2-Chloroethylvinyl ether	<10	<10	<10	<10	10
Chloroform	<10	<10	<10	<10	10
Dichlorobromomethane [Bromodichloromethane]	<10	<10	<10	<10	10
1,1-Dichloroethane	<10	<10	<10	<10	10
1,2-Dichloroethane	<10	<10	<10	<10	10
1,1-Dichloroethylene [1,1-Dichloroethene]	<10	<10	<10	<10	10
1,2-Dichloropropane	<10	<10	<10	<10	10
1,3-Dichloropropylene [1,3-Dichloropropene]	<10	<10	<10	<10	10
Ethylbenzene	<10	<10	<10	<10	10
Methyl bromide [Bromomethane]	<50	<50	<50	<50	50
Methyl chloride [Chloromethane]	<50	<50	<50	<50	50
Methylene chloride [Dichloromethane]	<20	<20	<20	<20	20
1,1,2,2-Tetrachloroethane	<10	<10	<10	<10	10
Tetrachloroethylene [Tetrachloroethene]	<10	<10	<10	<10	10
Toluene	<10	<10	<10	<10	10
1,2-Trans-dichloroethylene [1,2-Trans-dichloroethene]	<10	<10	<10	<10	10



Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
1,1,1-Trichloroethane	<10	<10	<10	<10	10
1,1,2-Trichloroethane	<10	<10	<10	<10	10
Trichloroethylene [Trichloroethene]	<10	<10	<10	<10	10
Vinyl chloride	<10	<10	<10	<10	10

\* Indicate units if different from µg/L.

Table 9 for Outfall No.: **001**

Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
2-Chlorophenol	<10	<10	<10	<10	10
2,4-Dichlorophenol	<10	<10	<10	<10	10
2,4-Dimethylphenol	<10	<10	<10	<10	10
4,6-Dinitro-o-cresol	<50	<50	<50	<50	50
2,4-Dinitrophenol	<50	<50	<50	<50	50
2-Nitrophenol	<20	<20	<20	<20	20
4-Nitrophenol	<50	<50	<50	<50	50
p-Chloro-m-cresol	<10	<10	<10	<10	10
Pentachlorophenol	<5	<5	<5	<5	5
Phenol	<10	<10	<10	<10	10
2,4,6-Trichlorophenol	<10	<10	<10	<10	10

\* Indicate units if different from µg/L.

Table 10 for Outfall No.: **N/A**

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Acenaphthene					10
Acenaphthylene					10
Anthracene					10
Benzidine					50
Benzo(a)anthracene					5
Benzo(a)pyrene					5
3,4-Benzofluoranthene [Benzo(b)fluoranthene]					10
Benzo(ghi)perylene					20
Benzo(k)fluoranthene					5
Bis(2-chloroethoxy)methane					10

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Bis(2-chloroethyl)ether					10
Bis(2-chloroisopropyl)ether					10
Bis(2-ethylhexyl)phthalate					10
4-Bromophenyl phenyl ether					10
Butylbenzyl phthalate					10
2-Chloronaphthalene					10
4-Chlorophenyl phenyl ether					10
Chrysene					5
Dibenzo(a,h)anthracene					5
1,2-Dichlorobenzene [o-Dichlorobenzene]					10
1,3-Dichlorobenzene [m-Dichlorobenzene]					10
1,4-Dichlorobenzene [p-Dichlorobenzene]					10
3,3'-Dichlorobenzidine					5
Diethyl phthalate					10
Dimethyl phthalate					10
Di-n-butyl phthalate					10
2,4-Dinitrotoluene					10
2,6-Dinitrotoluene					10
Di-n-octyl phthalate					10
1,2-Diphenylhydrazine (as Azobenzene)					20
Fluoranthene					10
Fluorene					10
Hexachlorobenzene					5
Hexachlorobutadiene					10
Hexachlorocyclopentadiene					10
Hexachloroethane					20
Indeno(1,2,3-cd)pyrene					5
Isophorone					10
Naphthalene					10
Nitrobenzene					10
N-Nitrosodimethylamine					50

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
N-Nitrosodi-n-propylamine					20
N-Nitrosodiphenylamine					20
Phenanthrene					10
Pyrene					10
1,2,4-Trichlorobenzene					10

\* Indicate units if different from µg/L.

Table 11 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Aldrin					0.01
alpha-BHC [alpha-Hexachlorocyclohexane]					0.05
beta-BHC [beta-Hexachlorocyclohexane]					0.05
gamma-BHC [gamma-Hexachlorocyclohexane]					0.05
delta-BHC [delta-Hexachlorocyclohexane]					0.05
Chlordane					0.2
4,4'-DDT					0.02
4,4'-DDE					0.1
4,4'-DDD					0.1
Dieldrin					0.02
Endosulfan I (alpha)					0.01
Endosulfan II (beta)					0.02
Endosulfan sulfate					0.1
Endrin					0.02
Endrin aldehyde					0.1
Heptachlor					0.01
Heptachlor epoxide					0.01
PCB 1242					0.2
PCB 1254					0.2
PCB 1221					0.2
PCB 1232					0.2
PCB 1248					0.2

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
PCB 1260					0.2
PCB 1016					0.2
Toxaphene					0.3

\* Indicate units if different from µg/L.

Attachment: N/A

#### TABLE 12 (DIOXINS/FURAN COMPOUNDS)

Complete of Table 12 **is required** for **external outfalls**, as directed below. (Instructions, Pages 59-60)

Indicate which compound(s) are manufactured or used at the facility and provide a brief description of the conditions of its/their presence at the facility (check all that apply).

- ☐ 2,4,5-trichlorophenoxy acetic acid (2,4,5-T) CASRN 93-76-5
- ☐ 2-(2,4,5-trichlorophenoxy) propanoic acid (Silvex, 2,4,5-TP) CASRN 93-72-1
- ☐ 2-(2,4,5-trichlorophenoxy) ethyl 2,2-dichloropropionate (Erbon) CASRN 136-25-4
- ☐ 0,0-dimethyl 0-(2,4,5-trichlorophenyl) phosphorothioate (Ronnell) CASRN 299-84-3
- ☐ 2,4,5-trichlorophenol (TCP) CASRN 95-95-4
- ☐ hexachlorophene (HCP) CASRN 70-30-4
- ☐ None of the above

Description: N/A

Does the applicant or anyone at the facility know or have any reason to believe that 2,3,7,8-tetrachlorodibenzo-p-dioxin (TCDD) or any congeners of TCDD may be present in the effluent proposed for discharge?

- ☐ Yes ☒ No

Description: Click to enter text.

If **yes** to either Items a **or** b, complete Table 12 as instructed.

Table 12 for Outfall No.: Click to enter text. Samples are (check one): ☐ Composite ☐ Grab

Compound	Toxicity Equivalent Factors	Wastewater Concentration (ppq)	Wastewater Toxicity Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Toxicity Equivalents (ppt)	MAL (ppq)
2,3,7,8-TCDD	1					10
1,2,3,7,8-PeCDD	1.0					50
2,3,7,8-HxCDDs	0.1					50
1,2,3,4,6,7,8-HpCDD	0.01					50

Compound	Toxicity Equivalent Factors	Wastewater Concentration (ppq)	Wastewater Toxicity Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Toxicity Equivalents (ppt)	MAL (ppq)
2,3,7,8-TCDF	0.1					10
1,2,3,7,8-PeCDF	0.03					50
2,3,4,7,8-PeCDF	0.3					50
2,3,7,8-HxCDFs	0.1					50
2,3,4,7,8-HpCDFs	0.01					50
OCDD	0.0003					100
OCDF	0.0003					100
PCB 77	0.0001					500
PCB 81	0.0003					500
PCB 126	0.1					500
PCB 169	0.03					500
Total						

**TABLE 13 (HAZARDOUS SUBSTANCES)**

Complete Table 13 **is required** for all **external outfalls** as directed below. (Instructions, Pages 60-61)

Are there any pollutants listed in the instructions (pages 55-62) believed present in the discharge?

☐ Yes ☒ No

Are there pollutants listed in Item 1.c. of Technical Report 1.0 which are believed present in the discharge and have not been analytically quantified elsewhere in this application?

☐ Yes ☒ No

If **yes** to either Items a or b, complete Table 13 as instructed.

Table 13 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	CASRN	Sample 1 (µg/L)	Sample 2 (µg/L)	Sample 3 (µg/L)	Sample 4 (µg/L)	Analytical Method

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 4.0: RECEIVING WATERS

This worksheet is **required** for all TPDES permit applications.

### Item 1. Domestic Drinking Water Supply (Instructions, Page 80)

- a. There is a surface water intake for domestic drinking water supply located within 5 (five) miles downstream from the point/proposed point of discharge.

☒ Yes ☐ No

If **no**, stop here and proceed to Item 2. If **yes**, provide the following information:

1. The legal name of the owner of the drinking water supply intake: North Texas Municipal Water District
2. The distance and direction from the outfall to the drinking water supply intake: 2.86 miles southwest

- b. Locate and identify the intake on the USGS 7.5-minute topographic map provided for Administrative Report 1.0.

☒ Check this box to confirm the above requested information is provided.

### Item 2. Discharge Into Tidally Influenced Waters (Instructions, Page 80)

If the discharge is to tidally influenced waters, complete this section. Otherwise, proceed to Item 3.

- a. Width of the receiving water at the outfall: N/A feet

- b. Are there oyster reefs in the vicinity of the discharge?

☐ Yes ☐ No

If **yes**, provide the distance and direction from the outfall(s) to the oyster reefs: N/A

- c. Are there sea grasses within the vicinity of the point of discharge?

☐ Yes ☐ No

If **yes**, provide the distance and direction from the outfall(s) to the grasses: N/A

### Item 3. Classified Segment (Instructions, Page 80)

The discharge is/will be directly into (or within 300 feet of) a classified segment.

☒ Yes ☐ No

If **yes**, stop here and do not complete Items 4 and 5 of this worksheet or Worksheet 4.1.

If **no**, complete Items 4 and 5 and Worksheet 4.1 may be required.

## Item 4. Description of Immediate Receiving Waters (Instructions, Page 80)

a. Name of the immediate receiving waters: N/A

b. Check the appropriate description of the immediate receiving waters:

☐ Lake or Pond

- Surface area (acres): Click to enter text.
- Average depth of the entire water body (feet): Click to enter text.
- Average depth of water body within a 500-foot radius of the discharge point (feet): Click to enter text.

☐ Man-Made Channel or Ditch

☐ Stream or Creek

☐ Freshwater Swamp or Marsh

☐ Tidal Stream, Bayou, or Marsh

☐ Open Bay

☐ Other, specify:

If **Man-Made Channel or Ditch** or **Stream or Creek** were selected above, provide responses to Items 4.c – 4.g below:

c. For **existing discharges**, check the description below that best characterizes the area **upstream** of the discharge.

For **new discharges**, check the description below that best characterizes the area **downstream** of the discharge.

☐ Intermittent (dry for at least one week during most years)

☐ Intermittent with Perennial Pools (enduring pools containing habitat to maintain aquatic life uses)

☐ Perennial (normally flowing)

Check the source(s) of the information used to characterize the area upstream (existing discharge) or downstream (new discharge):

☐ USGS flow records

☐ personal observation

☐ historical observation by adjacent landowner(s)

☐ other, specify: Click to enter text.

d. List the names of all perennial streams that join the receiving water within three miles downstream of the discharge point: Click to enter text.

e. The receiving water characteristics change within three miles downstream of the discharge (e.g., natural or man-made dams, ponds, reservoirs, etc.).

☐ Yes

☐ No

If **yes**, describe how: [Click to enter text.](#)

- f. General observations of the water body during normal dry weather conditions: [Click to enter text.](#)

Date and time of observation: [Click to enter text.](#)

- g. The water body was influenced by stormwater runoff during observations.

☐ Yes ☐ No

If **yes**, describe how: [Click to enter text.](#)

## Item 5. General Characteristics of Water Body (Instructions, Page 81)

- a. Is the receiving water upstream of the existing discharge or proposed discharge site influenced by any of the following (check all that apply):

<input type="checkbox"/> oil field activities	<input checked="" type="checkbox"/> urban runoff
<input type="checkbox"/> agricultural runoff	<input type="checkbox"/> septic tanks
<input checked="" type="checkbox"/> upstream discharges	<input type="checkbox"/> other, specify: <a href="#">Click to enter text.</a>

- b. Uses of water body observed or evidence of such uses (check all that apply):

<input type="checkbox"/> livestock watering	<input type="checkbox"/> industrial water supply
<input type="checkbox"/> non-contact recreation	<input type="checkbox"/> irrigation withdrawal
<input checked="" type="checkbox"/> domestic water supply	<input type="checkbox"/> navigation
<input type="checkbox"/> contact recreation	<input checked="" type="checkbox"/> picnic/park activities
<input checked="" type="checkbox"/> fishing	<input type="checkbox"/> other, specify: <a href="#">Click to enter text.</a>

- c. Description which best describes the aesthetics of the receiving water and the surrounding area (check only one):

☐ **Wilderness:** outstanding natural beauty; usually wooded or un-pastured area: water clarity exceptional

☒ **Natural Area:** trees or native vegetation common; some development evident (from fields, pastures, dwellings); water clarity discolored

☐ **Common Setting:** not offensive, developed but uncluttered; water may be colored or turbid

☐ **Offensive:** stream does not enhance aesthetics; cluttered; highly developed; dumping areas; water discolored



# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 6.0: INDUSTRIAL WASTE CONTRIBUTION

The following information is **required** for all applications for publicly-owned treatment works (POTWs).

For an explanation of the terms used in this worksheet, refer to the General Definitions on pages 4-12 and the Definitions Relating to Pretreatment on pages 13-14 of the Instructions.

### Item 1. All POTWs (Instructions, Page 86)

- a. Complete the following table with the number of each type of industrial users (IUs) that discharge to the POTW and the daily average flows from each.

#### Industrial User Information

Type of Industrial User	Number of Industrial Users	Daily Average Flow (gallons per day)
CIU	0 (zero)	0
SIU - Non-categorical	0 (zero)	0
Other IU	0 (zero)	0

- b. In the past three years, has the POTW experienced treatment plant interference?

☐ Yes ☒ No

If **yes**, identify the date(s), duration, nature of interference, and probable cause(s) and possible source(s) of each interference event. Include the names of the IU(s) that may have caused the interference: N/A

- c. In the past three years, has the POTW experienced pass-through?

☐ Yes ☒ No

If **yes**, identify the date(s), duration, pollutants passing through the treatment plant, and probable cause(s) and possible source(s) of each pass-through event. Include the names of the IU(s) that may have caused the pass-through: N/A

- d. Does the POTW have, or is it required to develop, an approved pretreatment program?

☐ Yes ☒ No

If **yes**, answer all questions in Item 2 and skip Item 3.

If **no**, skip Item 2 and answer all questions in Item 3 for each SIU and CIU.

### Item 2. POTWs With Approved Pretreatment Programs or Those Required To Develop A Pretreatment Program (Instructions, Page 86)

- a. Have there been any substantial modifications to the POTW's approved pretreatment program that have not been submitted to the Approval Authority (TCEQ) for approval according to 40 CFR § 403.18?

☐ Yes ☐ No

If **yes**, include an attachment which identifies all substantial modifications that have not been submitted to the TCEQ and the purpose of the modifications.

**Attachment:** N/A

- b. Have there been any non-substantial modifications to the POTW's approved pretreatment program that have not been submitted to the Approval Authority (TCEQ)?

☐ Yes      ☐ No

If **yes**, include an attachment which identifies all non-substantial modifications that have not been submitted to the TCEQ and the purpose of the modification.

**Attachment:** N/A

- c. List all parameters measured above the MAL in the POTW's effluent monitoring during the last three years:

**Effluent Parameters Measured Above the MAL**

Pollutant	Concentration	MAL	Units	Date

**Attachment:** N/A

- d. Has any SIU, CIU, or other IU caused or contributed to any other problems (excluding interference or pass-through) at the POTW in the past three years?

☐ Yes      ☐ No

If **yes**, provide a description of each episode, including date(s), duration, description of problems, and probable pollutants. Include the name(s) of the SIU(s)/CIU(s)/other IU(s) that may have caused or contributed to any of the problems: [Click to enter text.](#)

### Item 3. Significant Industrial User and Categorical Industrial User Information (Instructions, Pages 88-87)

POTWs that **do not** have an approved pretreatment program **are required** to provide the following information for each SIU and CIU:

- a. Mr. or Ms.: N/A First/Last Name: N/A

Organization Name: N/A

SIC Code: N/A

Phone number: N/A

Email address: N/A

Physical Address: N/A

City/State/ZIP Code: N/A

**Attachment:** N/A

- b. Describe the industrial processes or other activities that affect or contribute to the SIU(s) or CIU(s) discharge (e.g., process and non-process wastewater): N/A
- c. Provide a description of the principal products(s) or service(s) performed: N/A
- d. Flow rate information

**Flow Rate Information**

Effluent Type	Discharge Day (gallons per day)	Discharge Frequency (Continuous, batch, or intermittent)
Process Wastewater		
Non-process Wastewater		

e. Pretreatment Standards

1. Is the SIU or CIU subject to technology-based local limits as defined in the application instructions?

☐ Yes ☐ No

2. Is the SIU subject to categorical pretreatment standards?

☐ Yes ☐ No

If **yes**, provide the category and subcategory or subcategories in the SIUs Subject To Categorical Pretreatment Standards table.

**SIUs Subject to Categorical Pretreatment Standards**

Category in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR

- f. Has the SIU or CIU caused or contributed to any problem(s) (e.g., interferences, pass through, odors, corrosion, blockages) at the POTW in the past three years?

☐ Yes ☐ No

If **yes**, provide a description of each episode, including dates, duration, description of problems, and probable pollutants, and include the name(s) of the SIU(s)/CIU(s) that may have caused or contributed to the problem(s): N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 7.0: STORMWATER DISCHARGES ASSOCIATED WITH INDUSTRIAL ACTIVITIES

This worksheet **is required** for all TPDES permit applications requesting individual permit coverage for discharges consisting of **either**: 1) solely of stormwater discharges associated with industrial activities, as defined in *40 CFR § 122.26(b)(14)(i-xi)*, **or** 2) stormwater discharges associated with industrial activities and any of the listed allowable non-stormwater discharges, as defined in the MSGP (TXR05000), Part II, Section A, Item 6.

Discharges of stormwater as defined in *40 CFR § 122.26 (b)(13)* are not required to obtain authorization under a TPDES permit (see exceptions at *40 CFR §§ 122.26(a)(1)* and *(9)*). Authorization for discharge may be required from a local municipal separate storm sewer system.

### Item 1. Applicability (Instructions, Page 89)

Do discharges from any of the existing/proposed outfalls consist either 1) solely of stormwater discharges associated with industrial activities **or** 2) stormwater discharges associated with industrial activities and any of the allowable non-stormwater discharges?

☐ Yes ☒ No

If **no**, stop here. If **yes**, proceed as directed.

### Item 2. Stormwater Coverage (Instructions, Page 89)

List each existing/proposed stormwater outfall at the facility and indicate which type of authorization covers or is proposed to cover discharges.

#### Authorization Coverage

Outfall	Authorization under MSGP	Authorized Under Individual Permit
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>

If **all** existing/proposed outfalls which discharge stormwater associated with industrial activities (and any of the allowable non-stormwater discharges) are **authorized under the MSGP**, **stop** here.

If **seeking authorization** for any outfalls which discharge stormwater associated with industrial activities (and any of the allowable non-stormwater discharges) **under an individual permit**, **proceed**.

**NOTE: The following information is required for each existing/proposed stormwater outfall for which the facility is seeking individual permit authorization under this application**

### **Item 3. Site Map (Instructions, Page 90)**

Attach a site map or maps (drawn to scale) of the entire facility with the following information.

- the location of each stormwater outfall to be covered by the permit
- an outline of the drainage area that is within the facility's boundary and that contributes stormwater to each outfall to be covered by the permit
- connections or discharge points to municipal separate storm sewer systems
- locations of all structures (e.g. buildings, garages, storage tanks)
- structural control devices that are designed to reduce pollution in discharges of stormwater associated with industrial activities
- process wastewater treatment units (including ponds)
- bag house and other air treatment units exposed to stormwater (stormwater runoff, snow melt runoff, and surface runoff and drainage)
- landfills; scrapyards; surface water bodies (including wetlands)
- vehicle and equipment maintenance areas
- physical features of the site that may influence discharges of stormwater associated with industrial activities or contribute a dry weather flow
- locations where spills or leaks of reportable quality (as defined in *30 TAC § 327.4*) have occurred during the three years before this application was submitted to obtain coverage under an individual permit
- processing areas, storage areas, material loading/unloading areas, and other locations where significant materials are exposed to stormwater (stormwater runoff, snow melt runoff, and surface runoff and drainage)

☐ Check the box to confirm all above information was provided on the facility site map(s).

**Attachment:** N/A

### **Item 4. Facility/Site Information (Instructions, Page 90)**

- a. Provide the area of impervious surface and the total area drained by each stormwater outfall requested for authorization by this permit application.

#### **Impervious Surfaces**

<b>Outfall</b>	<b>Area of Impervious Surface (include units)</b>	<b>Total Area Drained (include units)</b>

- b. Provide the following local area rainfall information and the source of the information.  
Wettest month: N/A  
Average rainfall for wettest month (total inches): N/A  
25-year, 24-hour rainfall (inches): N/A  
Source: N/A
- c. Attach an inventory, or list, of materials currently handled at the facility that may be exposed to precipitation. **Attachment:** N/A
- d. Attach narrative descriptions of the industrial processes and activities involving the materials in the above-listed inventory that occur outdoors or in some manner that may result in exposure of the materials to precipitation or runoff (see instructions for guidance). **Attachment:** N/A
- e. Describe any BMPs and controls the facility uses/proposes to prevent or effectively reduce pollution in stormwater discharges from the facility: N/A

## Item 5. Pollutant Analysis (Instructions, Page 91)

- a. Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): N/A
- b. ☐ Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- c. Complete Table 17 as directed on page 92 of the Instructions.

Table 17 for Outfall No.: N/A

Pollutant	Grab Sample* Maximum (mg/L)	Composite Sample** Maximum (mg/L)	Grab Sample* Average (mg/L)	Composite Sample** Average (mg/L)	Number of Storm Events Sampled	MAL (mg/L)
pH (standard units)	(max)	—	(min)	—		—
Total suspended solids						—
Chemical oxygen demand						—
Total organic carbon						—
Oil and grease						—
Arsenic, total						0.0005
Barium, total						0.003
Cadmium, total						0.001
Chromium, total						0.003
Chromium, trivalent						—
Chromium, hexavalent						0.003
Copper, total						0.002



## Item 6. Storm Event Data (Instructions, Page 93)

Provide the following data for the storm event(s) which resulted in the maximum values for the analytical data submitted:

Date of storm event: N/A

Duration of storm event (minutes): N/A

Total rainfall during storm event (inches): N/A

Number of hours the between beginning of the storm measured and the end of the previous measurable storm event (hours): N/A

Maximum flow rate during rain event (gallons/minute): N/A

Total stormwater flow from rain event (gallons): N/A

Provide a description of the method of flow measurement or estimate:



# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.0: COOLING WATER SYSTEM INFORMATION

This worksheet is **required** for all TPDES permit applications that meet the conditions outlined in Technical Report 1.0, Item 12.

### Item 1. Cooling Water System Data (Instructions, Page 104)

a. Complete the following table with information regarding the cooling water system.

**Cooling Water System Data**

Parameter	Volume (include units)
Total DIF	357 MGD
Total AIF	147.13 MGD
Intake Flow Use(s) (%)	
Contact cooling	0.01
Non-contact cooling	99.9
Process Wastewater	0
Other	0

b. Attach the following information:

1. A narrative description of the design and annual operation of the facility's cooling water system and its relationship to the CWIS(s).
2. A scaled map depicting the location of each CWIS, impoundment, intake pipe, and canals, pipes, or waterways used to convey cooling water to, or within, the cooling water system. Provide the latitude and longitude for each CWIS and any intake pipe(s) on the map. Indicate the position of the intake pipe within the water column.
3. A description of water reuse activities, if applicable, reductions in total water withdrawals, if applicable, and the proportion of the source waterbody withdrawn (on a monthly basis).
4. Design and engineering calculations prepared by a qualified professional and data to support the information provided in above item a.
5. Previous year (a minimum of 12 months) of AIF data.
6. A narrative description of existing or proposed impingement and entrainment technologies or operation measures and a summary of their performance, including, but not limited to, reductions in impingement mortality and entrainment due to intake location and reductions in total water withdrawals and usage.

**Attachment:** **TR-5**

## Item 2. Cooling Water Intake Structure(s) Data (Instructions, Page 105)

- a. Complete the following table with information regarding each cooling water intake structure (this includes primary and make-up CWIS(s)).

**Cooling Water Intake Structure(s) Data**

CWIS ID	Primary (Once-through)	Make-up (none)		
DIF (include units)	357 MGD	N/A		
AIF (include units)	148.1722	N/A		
Intake Flow Use(s) (%)				
Contact cooling	0.01	N/A		
Non-contact cooling	99.9	N/A		
Process Wastewater	0	N/A		
Other	0	N/A		
Latitude (decimal degrees)	33.065381	N/A		
Longitude (decimal degrees)	96.453139	N/A		

- b. Attach the following information regarding the CWIS(s):
1. A narrative description of the configuration of each CWIS, annual and daily operation, including any seasonal changes, and where it is located in the water body and in the water column.
  2. Engineering calculations for each CWIS.

Attachment: **TR-6**

## Item 3. Source Water Physical Data (Instructions, Page 105)

- a. Complete the following table with information regarding the CWIS(s) source waterbody (this includes primary and make-up CWIS(s)).

**Source Waterbody Data**

CWIS ID	Primary (Once-through)			
Source Waterbody	Lake Lavon			
Mean Annual Flow	Surface area: 20,559 acres  Storage capacity:			

CWIS ID	Primary (Once-through)			
Source Waterbody	Lake Lavon			
	409,360 acre-feet  Watershed size: 770 square miles			
Source	Texas Water Development Board			

b. Attach the following information regarding the source waterbody.

1. A narrative description of the source water for each CWIS, including areal dimensions, depths, salinity and temperature regimes, and other documentation that supports this determination of the water body type where each cooling water intake structure is located.
2. A narrative description of the source waterbody's hydrological and geomorphological features.
3. Scaled drawings showing the physical configuration of all source water bodies used by the facility, including the source waterbody's hydrological and geomorphological features. **NOTE:** The source waterbody's hydrological and geomorphological features may be included on the map submitted for item 1.b.ii of this worksheet.
4. A description of the methods used to conduct any physical studies to determine the intake's area of influence within the waterbody and the results of such studies.

Attachment: **TR-7**

## Item 4. Operational Status (Instructions, Page 106)

a. Is this application for a power production or steam generation facility?

☒ Yes    ☐ No

If **no**, proceed to Item 4.b. If **yes**, provide the following information as an attachment:

1. Describe the operating status of each individual unit, including age, capacity utilization rate (or equivalent) for the previous five years (a minimum of 60 months), and any seasonal changes in operation.
2. Describe any extended or unusual outages or other factors which significantly affect current data for flow, impingement, entrainment.
3. Identify any operating unit with a capacity utilization rate of less than 8 percent averaged over a contiguous period of two years (a minimum of 24 months).
4. Describe any major upgrades completed within the last 15 years, including but not limited to boiler replacement, condenser replacement, turbine replacement, or changes

of fuel type.

**Attachment:** **TR-8**

**b. Process Units**

1. Is this application for a facility which has process units that use cooling water (other than for power production or steam generation)?

☐ Yes      ☒ No

If **no**, proceed to Item 4.c. If **yes**, continue.

2. Does the facility use or intend to use reductions in flow or changes in operations to meet the requirements of *40 CFR § 125.94(c)*?

☐ Yes      ☐ No

If **no**, proceed to Item 4.c. If **yes**, attach descriptions of the following information:

- Individual production processes and product lines
- The operating status, including age of each line and seasonal operation
- Any extended or unusual outages that significantly affect current data for flow, impingement, entrainment, or other factors
- Any major upgrades completed within the last 15 years and plans or schedules for decommissioning or replacement of process units or production processes and product lines.

**Attachment:** N/A

**c. Is this an application for a nuclear power production facility?**

☐ Yes      ☒ No

If **no**, proceed to Item 4.d. If **yes**, attach a description of completed, approved, or scheduled upgrades and the Nuclear Regulatory Commission relicensing status for each unit at the facility.

**Attachment:** N/A

**d. Is this an application for a manufacturing facility?**

☐ Yes      ☒ No

If **no**, proceed to Worksheet 11.1. If **yes**, attach descriptions of current and future production schedules and any plans or schedules for any new units planned within the next five years (a minimum of 60 mos)

**Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.1: IMPINGEMENT MORTALITY

This worksheet is **required** for all TPDES permit applications that meet the conditions outlined in **Technical Report 1.0, Item 12**. Complete one copy of this worksheet for each individual CWIS the facility uses or proposes to use.

CWIS ID: Primary

### Item 1. Impingement Compliance Technology Selection (Instructions, Page 107)

Check the box next to the method of compliance for the Impingement Mortality Standard selected by the facility.

- ☐ Closed-cycle recirculating system (CCRS) [40 CFR § 125.94(c)(1)]
- ☐ 0.5 ft/s Through-Screen Design Velocity [40 CFR § 125.94(c)(2)] – Proceed to Worksheet 11.2
- ☐ 0.5 ft/s Through Screen Actual Velocity [40 CFR § 125.94(c)(3)]
- ☐ Existing offshore velocity cap [40 CFR § 125.94(c)(4)] – Proceed to Worksheet 11.2
- ☐ Modified traveling screens [40 CFR § 125.94(c)(5)]
- ☐ System of technologies [40 CFR § 125.94(c)(6)]
- ☐ Impingement mortality performance standard [40 CFR § 125.94(c)(7)]
- ☒ De minimis rate of impingement [40 CFR § 125.94(c)(11)]
- ☒ Low capacity utilization power-generation facilities [40 CFR § 125.94(c)(12)]

If 0.5 ft/s Through-Screen Design Velocity [40 CFR § 125.94(c)(2)] or existing offshore velocity cap [40 CFR § 125.94(c)(4)] was selected, proceed to Worksheet 11.2. Otherwise, continue to Item 2.

### Item 2. Impingement Compliance Technology Information (Instructions, Page 107)

Complete the following sections based on the selection made for item 1 above.

a. CCRS [40 CFR § 125.94(c)(1)]

- ☐ Check this box to confirm the CWS meets the definition of CCRS located at 40 CFR § 125.91(c) and provide a response to the following questions.

1. Does the facility use or propose to use a CWIS to replenish water losses to the CWS?

- ☐ Yes      ☐ No

If **no**, proceed to item a.2. If **yes**, provide the following information as an attachment and continue.

- CWIS ID
- 12 months of intake flow data for any CWIS used for make-up intake flows to replenish cooling water losses, excluding intakes for losses due to blowdown, drift, or evaporation.

- A narrative description of any physical or operational measures taken to minimize make-up withdraws.

**Attachment:** N/A

**NOTE:** Do not complete a separate Worksheet 11.1 for a make-up CWIS.

2. Does the facility use or propose to use cooling towers?

☐ Yes      ☐ No

If **no**, proceed to Worksheet 11.2. If **yes**, provide the following information and proceed to Worksheet 11.2.

- Average number of cycles of concentration (COCs) prior to blowdown:

**Average COCs Prior to Blowdown**

Cooling Tower ID				
COCs				

- Attach COC monitoring data for each cooling tower from the previous year (a minimum of 12 months): N/A
- Maximum number of COCs each cooling tower can accomplish based on design of the system.

**Calculated COCs Prior to Blowdown**

Cooling Tower ID				
COCs				

- Describe conditions that may limit the number of COCs prior to blowdown, if any, including but not limited to permit conditions: N/A

b. 0.5 ft/s Through Screen Actual Velocity [40 CFR § 125.94(c)(3)]

Provide daily intake flow measurement monitoring data from the previous year (a minimum of 12 months) as an attachment and proceed to Worksheet 11.2.

**Attachment:** N/A

c. Modified traveling screens [40 CFR § 125.94(c)(5)]

Provide the following information as an attachment and proceed to Worksheet 11.2.

1. A description of the modified traveling screens and associated equipment.
2. A site-specific impingement technology performance optimization study that includes a narrative description of the biological data collection methods
3. Biological sampling data from the previous two years (a minimum of 24 months).

**Attachment:** N/A

d. System of technologies [40 CFR § 125.94(c)(6)] or impingement mortality performance standard [40 CFR § 125.94(c)(7)]

Provide the following information as an attachment and proceed to Worksheet 11.2.

1. A description of the system of technologies used or proposed for use by the facility to

achieve compliance with the impingement mortality standard.

2. A site-specific impingement technology performance optimization study that includes a narrative description of the biological data collection methods.
3. Biological sampling data from the previous two years (a minimum of 24 months).

**Attachment:** N/A

- e. De minimis rate of impingement [*40 CFR § 125.94(c)(11)*]

Provide the following information and proceed to Worksheet 11.2.

1. Attach monitoring data from the previous year (a minimum of 12 months) of intake flow measured at a frequency of 1/day on days of operation.

**Attachment:** TR-5 (Table 4)

2. If the rate of impingement caused by the CWIS is extremely low (at an organism or age-one equivalent count), attach supplemental information to Worksheet 11.0, item 1.b.6. to support this determination.

**Attachment:** TR-5 (Item 6)

- f. Low capacity utilization power-generation facilities [*40 CFR § 125.94(c)(12)*]

Attach monthly utilization data from the previous 2 years (a minimum of 24 months) for each operating unit and proceed to Worksheet 11.2.

**Attachment:** TR-8

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.2: SOURCE WATER BIOLOGICAL DATA

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** source waterbody of a CWIS for which a facility has selected an Impingement Mortality Technology Option described at *40 CFR §§ 125.94(c)(1)-(7)*.

Name of source waterbody: Lake Lavon

### Item 1. Species Management (Instructions, Page 109)

- a. The facility has obtained an incidental take permit for its cooling water intake structure(s) from the USFWS or the NMFS.

☐ Yes ☒ No

If yes, attach any information submitted in order to obtain that permit, which may be used to supplement the permit application information requirements of paragraph *40 CFR § 125.95(f)*.

**Attachment:** N/A

- b. Is the facility requesting a waiver from application requirements at *40 CFR § 122.21(r)(4)* in accordance with *40 CFR § 125.95* for any CWIS(s) that withdraw from a man-made reservoir that is stocked and managed by a state or federal natural resources agency or the equivalent?

☒ Yes ☐ No

If **yes**, attach a copy of the most recent managed fisheries report to TPWD, or equivalent.

**Attachment:** TR-9

- c. There are no federally listed threatened or endangered species or critical habitat designations within the source water body.

☒ True ☐ False

### Item 2. Source Water Biological Data (Instructions, Page 109)

New Facilities (Phase I, Track I and II)

- Provide responses to all items in this section and stop.

Existing Facilities (Phase II)

- If the answer to **1.b.** above was **no**, provide responses to all items in this section and proceed to Worksheet 11.3.
- If the answer to **1.b.** was **yes** and **1.c.** was **true**, do not complete any items in this section and proceed to Worksheet 11.3.
- If the answer to **1.b.** was **yes** and **1.c.** was **false**, attach a response for any item in this section that is not contained within the most recent TPWD, or equivalent and proceed to Worksheet 11.3.

**Attachment:** N/A



- a. A list of the data requested at *40 CFR § 122.21(r)(4)(ii)* through (vi) that are not available, and efforts made to identify sources of the data.
- b. Provide a list of species (or relevant taxa) in the vicinity of the CWIS and identify the following information regarding each species listed.
  - all life stages and their relative abundance,
  - identification of all species and life stages that would be most susceptible to impingement and entrainment,
  - forage base,
  - significance to commercial fisheries,
  - significance to recreational fisheries,
  - primary period of reproduction,
  - larval recruitment, and
  - period of peak abundance for relevant taxa.
- c. Data representative of the seasonal and daily activities (e.g., feeding and water column migration) of biological organisms in the vicinity of the CWIS(s).
- d. Identify all threatened, endangered, and other protected species that might be susceptible to impingement and entrainment at the CWIS(s).
- e. Documentation of any public participation or consultation with federal or state agencies undertaken.

The following is required for existing facilities only. Include the following information with the above listed attachment.

- f. Identify any protective measures and stabilization activities that have been implemented and provide a description of how these measures and activities affected the baseline water condition in the vicinity of the intake.
- g. A list of fragile species, as defined at *40 CFR § 125.92(m)*, at the facility. The applicant need only identify those species not already identified as fragile at *40 CFR § 125.92(m)*.

**NOTE:** New units at an existing facility are not required to resubmit this information if the cooling water withdrawals for the operation of the new unit are from an existing intake.

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.3: ENTRAINMENT

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** individual CWIS the facility uses or proposes to use.

CWIS ID: Primary

### Item 1. Applicability (Instructions, Page 111)

Is the AIF of the CWIS identified above greater than, or equal to, 125 MGD?

☒ Yes ☐ No

- If **no** or the facility has selected **CCRS** [40 CFR § 125.94(c)(1)] for the impingement mortality compliance method, complete Item 2 and stop here.
- If **yes** and the facility is **seeking a waiver** from application requirements in accordance with 40 CFR § 125.95 for any CWIS(s) that withdraw from a man-made reservoir that is stocked and managed by a state or federal natural resources agency or the equivalent, complete item 2 and stop.
- If **yes** and the facility is **not seeking a waiver** from application requirements in accordance with 40 CFR § 125.95, complete item 2 and provide any required and completed studies listed in item 3. For any required studies in item 3 that are not complete, provide a detailed explanation for the delay and an anticipated schedule for completion and submittal.

### Item 2. Existing Entrainment Performance Studies (Instructions, Page 111)

Attach any previously conducted studies or studies obtained from other facilities addressing technology efficacy, through-facility entrainment survival, and other entrainment studies.

Attachment: TR-10

### Item 3. Facility Entrainment Performance Studies (Instructions, Page 111)

- Attach an entrainment characterization study, as described at 40 CFR § 122.21(r)(9): N/A
- Attach a comprehensive feasibility study, as described as 40 CFR § 122.21(r)(10): N/A
- Attach a benefits valuation study, as described as 40 CFR § 122.21(r)(11): N/A
- Attach a non-water quality environmental and other impacts study, as described as 40 CFR § 122.21(r)(12): N/A
- Attach a peer review analysis, as described as 40 CFR § 122.21(r)(13): N/A

# **ATTACHMENT AR-1**

Core Data Form



# TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

## SECTION I: General Information

<b>1. Reason for Submission</b> (If other is checked please describe in space provided.)		
<input type="checkbox"/> New Permit, Registration or Authorization (Core Data Form should be submitted with the program application.)		
<input checked="" type="checkbox"/> Renewal (Core Data Form should be submitted with the renewal form)		<input type="checkbox"/> Other
<b>2. Customer Reference Number</b> (if issued)	<a href="#">Follow this link to search for CN or RN numbers in Central Registry**</a>	<b>3. Regulated Entity Reference Number</b> (if issued)
CN 600328694		RN 100219203

## SECTION II: Customer Information

<b>4. General Customer Information</b>		<b>5. Effective Date for Customer Information Updates</b> (mm/dd/yyyy)		7/31/2024	
<input type="checkbox"/> New Customer <input checked="" type="checkbox"/> Update to Customer Information <input type="checkbox"/> Change in Regulated Entity Ownership					
<input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)					
<i>The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).</i>					
<b>6. Customer Legal Name</b> (If an individual, print last name first: eg: Doe, John)				<i>If new Customer, enter previous Customer below:</i>	
City of Garland					
<b>7. TX SOS/CPA Filing Number</b>		<b>8. TX State Tax ID</b> (11 digits)		<b>9. Federal Tax ID</b> (9 digits)	<b>10. DUNS Number</b> (if applicable)
<b>11. Type of Customer:</b>		<input type="checkbox"/> Corporation		<input type="checkbox"/> Individual	Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited
Government: <input checked="" type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> Local <input type="checkbox"/> State <input type="checkbox"/> Other		<input type="checkbox"/> Sole Proprietorship		<input type="checkbox"/> Other:	
<b>12. Number of Employees</b>				<b>13. Independently Owned and Operated?</b>	
<input type="checkbox"/> 0-20 <input type="checkbox"/> 21-100 <input type="checkbox"/> 101-250 <input checked="" type="checkbox"/> 251-500 <input type="checkbox"/> 501 and higher				<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
<b>14. Customer Role</b> (Proposed or Actual) – as it relates to the Regulated Entity listed on this form. Please check one of the following					
<input type="checkbox"/> Owner <input type="checkbox"/> Operator <input checked="" type="checkbox"/> Owner & Operator <input type="checkbox"/> Other:					
<input type="checkbox"/> Occupational Licensee <input type="checkbox"/> Responsible Party <input type="checkbox"/> VCP/BSA Applicant					
<b>15. Mailing Address:</b>	13835 County Rd. 489				
	City	Nevada	State	TX	ZIP 75173 ZIP + 4
<b>16. Country Mailing Information</b> (if outside USA)				<b>17. E-Mail Address</b> (if applicable)	
<b>18. Telephone Number</b>		<b>19. Extension or Code</b>		<b>20. Fax Number</b> (if applicable)	

**SECTION III: Regulated Entity Information**

<b>21. General Regulated Entity Information</b> (If 'New Regulated Entity' is selected, a new permit application is also required.)							
<input type="checkbox"/> New Regulated Entity <input type="checkbox"/> Update to Regulated Entity Name <input checked="" type="checkbox"/> Update to Regulated Entity Information							
<i>The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).</i>							
<b>22. Regulated Entity Name</b> (Enter name of the site where the regulated action is taking place.)							
Garland Municipal Power - Ray Olinger Plant							
<b>23. Street Address of the Regulated Entity:</b>  (No PO Boxes)	13835 County Rd. 489						
	City	Nevada	State	TX	ZIP	75173	ZIP + 4
<b>24. County</b>	Collin						

If no Street Address is provided, fields 25-28 are required.

<b>25. Description to Physical Location:</b>							
<b>26. Nearest City</b>				<b>State</b>		<b>Nearest ZIP Code</b>	
Nevada				TX		75173	
<i>Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).</i>							
<b>27. Latitude (N) In Decimal:</b>		33.068056		<b>28. Longitude (W) In Decimal:</b>		-96.452500	
Degrees	Minutes	Seconds		Degrees	Minutes	Seconds	
33	04	05		-96	27	09	
<b>29. Primary SIC Code</b> (4 digits)		<b>30. Secondary SIC Code</b> (4 digits)		<b>31. Primary NAICS Code</b> (5 or 6 digits)		<b>32. Secondary NAICS Code</b> (5 or 6 digits)	
4911							
<b>33. What is the Primary Business of this entity?</b> (Do not repeat the SIC or NAICS description.)							
Electric Power Plant							
<b>34. Mailing Address:</b>	13835 County Rd.						
	City	Nevada	State	TX	ZIP	75173	ZIP + 4
<b>35. E-Mail Address:</b>		MBurr@gpltexas.org					
<b>36. Telephone Number</b>				<b>37. Extension or Code</b>		<b>38. Fax Number</b> (if applicable)	
( 972 ) 205-2650						( ) -	

**39. TCEQ Programs and ID Numbers** Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.


<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input type="checkbox"/> Edwards Aquifer	<input checked="" type="checkbox"/> Emissions Inventory Air	<input checked="" type="checkbox"/> Industrial Hazardous Waste
			CP0026M	TXP490355593
<input type="checkbox"/> Municipal Solid Waste	<input checked="" type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input checked="" type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
	PSDTX935		59661	
<input type="checkbox"/> Sludge	<input checked="" type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
	TXR05AX97			
<input type="checkbox"/> Voluntary Cleanup	<input checked="" type="checkbox"/> Wastewater	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:
	WQ0001923000			

#### **SECTION IV: Preparer Information**

<b>40. Name:</b>	Cassandra Villarreal	<b>41. Title:</b>	Environmental Scientist
<b>42. Telephone Number</b>	<b>43. Ext./Code</b>	<b>44. Fax Number</b>	<b>45. E-Mail Address</b>
( 817 ) 735-7294		( 817 ) 735-7492	cassandra.villarreal@freese.com

#### **SECTION V: Authorized Signature**

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

<b>Company:</b>	Freese and Nichols, Inc.	<b>Job Title:</b>	Environmental Scientist
<b>Name (In Print):</b>	Cassandra Villarreal	<b>Phone:</b>	( 817 ) 735- 7294
<b>Signature:</b>		<b>Date:</b>	8/21/2024

## **ATTACHMENT AR-2**

### Plain Language Summary



## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

### PLAIN LANGUAGE SUMMARY FOR TPDES OR TLAP PERMIT APPLICATIONS

#### Plain Language Summary Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary as required by [Title 30, Texas Administrative Code \(30 TAC\), Chapter 39, Subchapter H](#). Applicants may modify the template as necessary to accurately describe their facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how the applicant will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements.

If you are subject to the alternative language notice requirements in [30 TAC Section 39.426](#), **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package**. For your convenience, a Spanish template has been provided below.

#### ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS **INDUSTRIAL** WASTEWATER/STORMWATER

*The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.*

The City of Garland (CN600328694), operates the Garland Municipal Power - Ray Olinger Power Plant (RN100219203), a natural gas steam electric generating facility. The facility is located at 13835 County Road 489, in Nevada, Collin County, Texas 75173.

This application is for a renewal and amendment to discharge of once-through cooling water from Units 1, 2, and 3 and stormwater at a daily average flow not to exceed 404,000,000 gallons per day via Outfall 001. This amendment is to remove Internal Outfall 101.

Discharges from the facility are expected to contain chlorine. Additional pollutants are included in Worksheet 2.0 of the permit application package. Industrial wastewater is treated by using sodium hyperchlorate at the intake for algae control, and the circulating water is used for condenser cooling. Ammonia bisulfate is used for dechlorination at the condenser outlet to limit the chlorine residual.



# PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

## AGUAS RESIDUALES INDUSTRIALES /AGUAS PLUVIALES

*El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.*

La ciudad de Garland (CN600328694) opera la planta eléctrica Garland Municipal Power - Ray Olinger (RN100219203), una instalación de generación de electricidad a vapor con gas natural. La instalación está ubicada en 13835 County Road 489, en Nevada, Condado de Collin, Texas 75173.

Esta solicitud es para una renovación y enmienda a la descarga de agua de enfriamiento de un solo paso de las Unidades 1, 2 y 3 y aguas pluviales con un flujo promedio diario que no exceda los 404,000,000 galones por día a través del Emisario 001. Esta enmienda es para eliminar el Emisario Interno 101.

Se espera que las descargas de la instalación contengan cloro. Se incluyen contaminantes adicionales en la Hoja de trabajo 2.0 del paquete de solicitud de permiso. Las aguas residuales industriales se tratan utilizando hipoclorato de sodio en la entrada para controlar las algas y el agua en circulación se utiliza para enfriar el condensador. El bisulfato de amoníaco se utiliza para la dicloración en la salida del condensador para limitar el cloro residual.

## INSTRUCTIONS

1. Enter the name of applicant in this section. The applicant name should match the name associated with the customer number.
2. Enter the Customer Number in this section. Each Individual or Organization is issued a unique 11-digit identification number called a CN (e.g. CN123456789).
3. Choose "operates" in this section for existing facility applications or choose "proposes to operate" for new facility applications.
4. Enter the name of the facility in this section. The facility name should match the name associated with the regulated entity number.
5. Enter the Regulated Entity number in this section. Each site location is issued a unique 11-digit identification number called an RN (e.g. RN123456789).
6. Choose the appropriate article (a or an) to complete the sentence.
7. Enter a description of the facility in this section. For example: steam electric generating facility, nitrogenous fertilizer manufacturing facility, etc.
8. Choose "is" for an existing facility or "will be" for a new facility.
9. Enter the location of the facility in this section.
10. Enter the City nearest the facility in this section.

11. Enter the County nearest the facility in this section.
12. Enter the zip code for the facility address in this section.
13. Enter a summary of the application request in this section. For example: renewal to discharge 25,000 gallons per day of treated domestic wastewater, new application to discharge process wastewater and stormwater on an intermittent and flow-variable basis, or major amendment to reduce monitoring frequency for pH, etc. If more than one outfall is included in the application, provide applicable information for each individual outfall.
14. List all pollutants expected in the discharge from this facility in this section. If applicable, refer to the pollutants from any federal numeric effluent limitations that apply to your facility.
15. Enter the discharge types from your facility in this section (e.g., stormwater, process wastewater, once through cooling water, etc.)
16. Choose the appropriate verb tense to complete the sentence.
17. Enter a description of the wastewater treatment used at your facility. Include a description of each process, starting with initial treatment and finishing with the outfall/point of disposal. Use additional lines for individual discharge types if necessary.

Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at [WO-ARPTeam@tceq.texas.gov](mailto:WO-ARPTeam@tceq.texas.gov) or by phone at (512) 239-4671.

**ATTACHMENT AR-3**  
Public Involvement Plan



Texas Commission on Environmental Quality

## Public Involvement Plan Form for Permit and Registration Applications

The Public Involvement Plan is intended to provide applicants and the agency with information about how public outreach will be accomplished for certain types of applications in certain geographical areas of the state. It is intended to apply to new activities; major changes at existing plants, facilities, and processes; and to activities which are likely to have significant interest from the public. This preliminary screening is designed to identify applications that will benefit from an initial assessment of the need for enhanced public outreach.

All applicable sections of this form should be completed and submitted with the permit or registration application. For instructions on how to complete this form, see TCEQ-20960-inst.

### Section 1. Preliminary Screening

- ☐ New Permit or Registration Application  
☒ New Activity – modification, registration, amendment, facility, etc. (see instructions)

**If neither of the above boxes are checked, completion of the form is not required and does not need to be submitted.**

### Section 2. Secondary Screening

- ☒ Requires public notice,  
☐ Considered to have significant public interest, and  
☒ Located within any of the following geographical locations:

- Austin
- Dallas
- Fort Worth
- Houston
- San Antonio
- West Texas
- Texas Panhandle
- Along the Texas/Mexico Border
- Other geographical locations should be decided on a case-by-case basis

**If all the above boxes are not checked, a Public Involvement Plan is not necessary.  
Stop after Section 2 and submit the form.**

- ☒ Public Involvement Plan not applicable to this application. Provide **brief** explanation.

This permit has not had significant public interest in the last permit cycles. Therefore, the remaining sections of the form are not applicable.

### Section 3. Application Information

#### Type of Application (check all that apply):

Air ☐ Initial ☐ Federal ☐ Amendment ☐ Standard Permit ☐ Title V  
Waste ☐ Municipal Solid Waste ☐ Industrial and Hazardous Waste ☐ Scrap Tire  
☐ Radioactive Material Licensing ☐ Underground Injection Control

#### Water Quality

☐ Texas Pollutant Discharge Elimination System (TPDES)  
☐ Texas Land Application Permit (TLAP)  
☐ State Only Concentrated Animal Feeding Operation (CAFO)  
☐ Water Treatment Plant Residuals Disposal Permit  
☐ Class B Biosolids Land Application Permit  
☐ Domestic Septage Land Application Registration

#### Water Rights New Permit

☐ New Appropriation of Water  
☐ New or existing reservoir

#### Amendment to an Existing Water Right

☐ Add a New Appropriation of Water  
☐ Add a New or Existing Reservoir  
☐ Major Amendment that could affect other water rights or the environment

### Section 4. Plain Language Summary

Provide a brief description of planned activities.

N/A

## Section 5. Community and Demographic Information

Community information can be found using EPA's EJ Screen, U.S. Census Bureau information, or generally available demographic tools.

**Information gathered in this section can assist with the determination of whether alternative language notice is necessary. Please provide the following information.**

(City)

(County)

(Census Tract)

Please indicate which of these three is the level used for gathering the following information.

☐

City

☐

County

☐

Census Tract

(a) Percent of people over 25 years of age who at least graduated from high school

(b) Per capita income for population near the specified location

(c) Percent of minority population and percent of population by race within the specified location

(d) Percent of Linguistically Isolated Households by language within the specified location

(e) Languages commonly spoken in area by percentage

(f) Community and/or Stakeholder Groups

(g) Historic public interest or involvement

## Section 6. Planned Public Outreach Activities

(a) Is this application subject to the public participation requirements of Title 30 Texas Administrative Code (30 TAC) Chapter 39?

☐ Yes ☐ No

(b) If yes, do you intend at this time to provide public outreach other than what is required by rule?

☐ Yes ☐ No

If Yes, please describe.

**If you answered "yes" that this application is subject to 30 TAC Chapter 39, answering the remaining questions in Section 6 is not required.**

(c) Will you provide notice of this application in alternative languages?

☐ Yes ☐ No

**Please refer to Section 5. If more than 5% of the population potentially affected by your application is Limited English Proficient, then you are required to provide notice in the alternative language.**

If yes, how will you provide notice in alternative languages?

- ☐ Publish in alternative language newspaper
- ☐ Posted on Commissioner's Integrated Database Website
- ☐ Mailed by TCEQ's Office of the Chief Clerk
- ☐ Other (specify)

(d) Is there an opportunity for some type of public meeting, including after notice?

☐ Yes ☐ No

(e) If a public meeting is held, will a translator be provided if requested?

☐ Yes ☐ No

(f) Hard copies of the application will be available at the following (check all that apply):

- ☐ TCEQ Regional Office ☐ TCEQ Central Office
- ☐ Public Place (specify)

## Section 7. Voluntary Submittal

For applicants voluntarily providing this Public Involvement Plan, who are not subject to formal public participation requirements.

Will you provide notice of this application, including notice in alternative languages?

☐ Yes ☐ No


What types of notice will be provided?

- ☐ Publish in alternative language newspaper
- ☐ Posted on Commissioner's Integrated Database Website
- ☐ Mailed by TCEQ's Office of the Chief Clerk
- ☐ Other (specify)

## **ATTACHMENT AR-4**


USGS Topographic Map



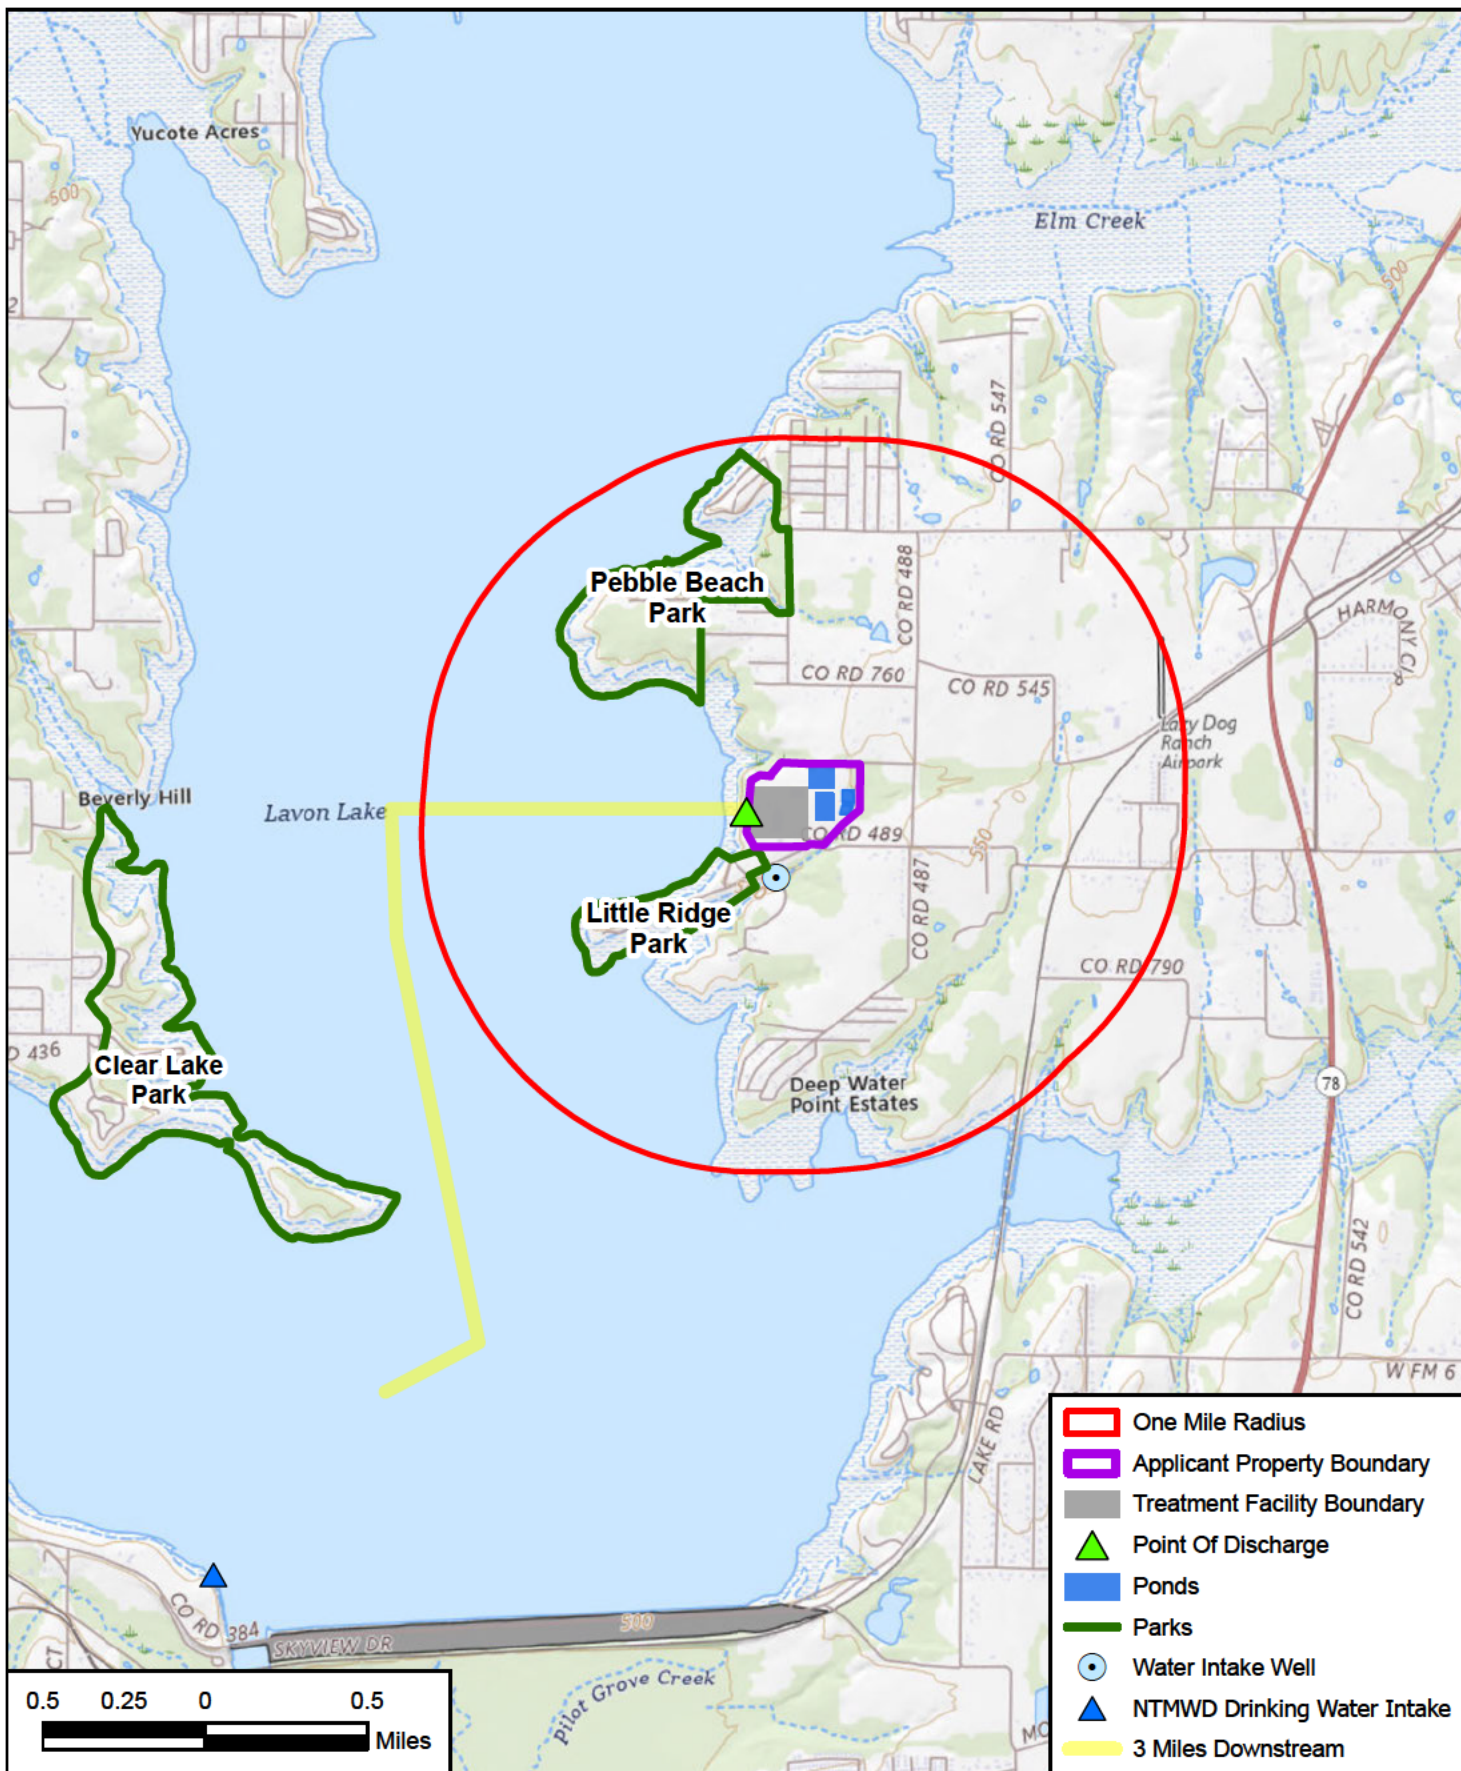

## **ATTACHMENT AR-5**

Affected Landowners

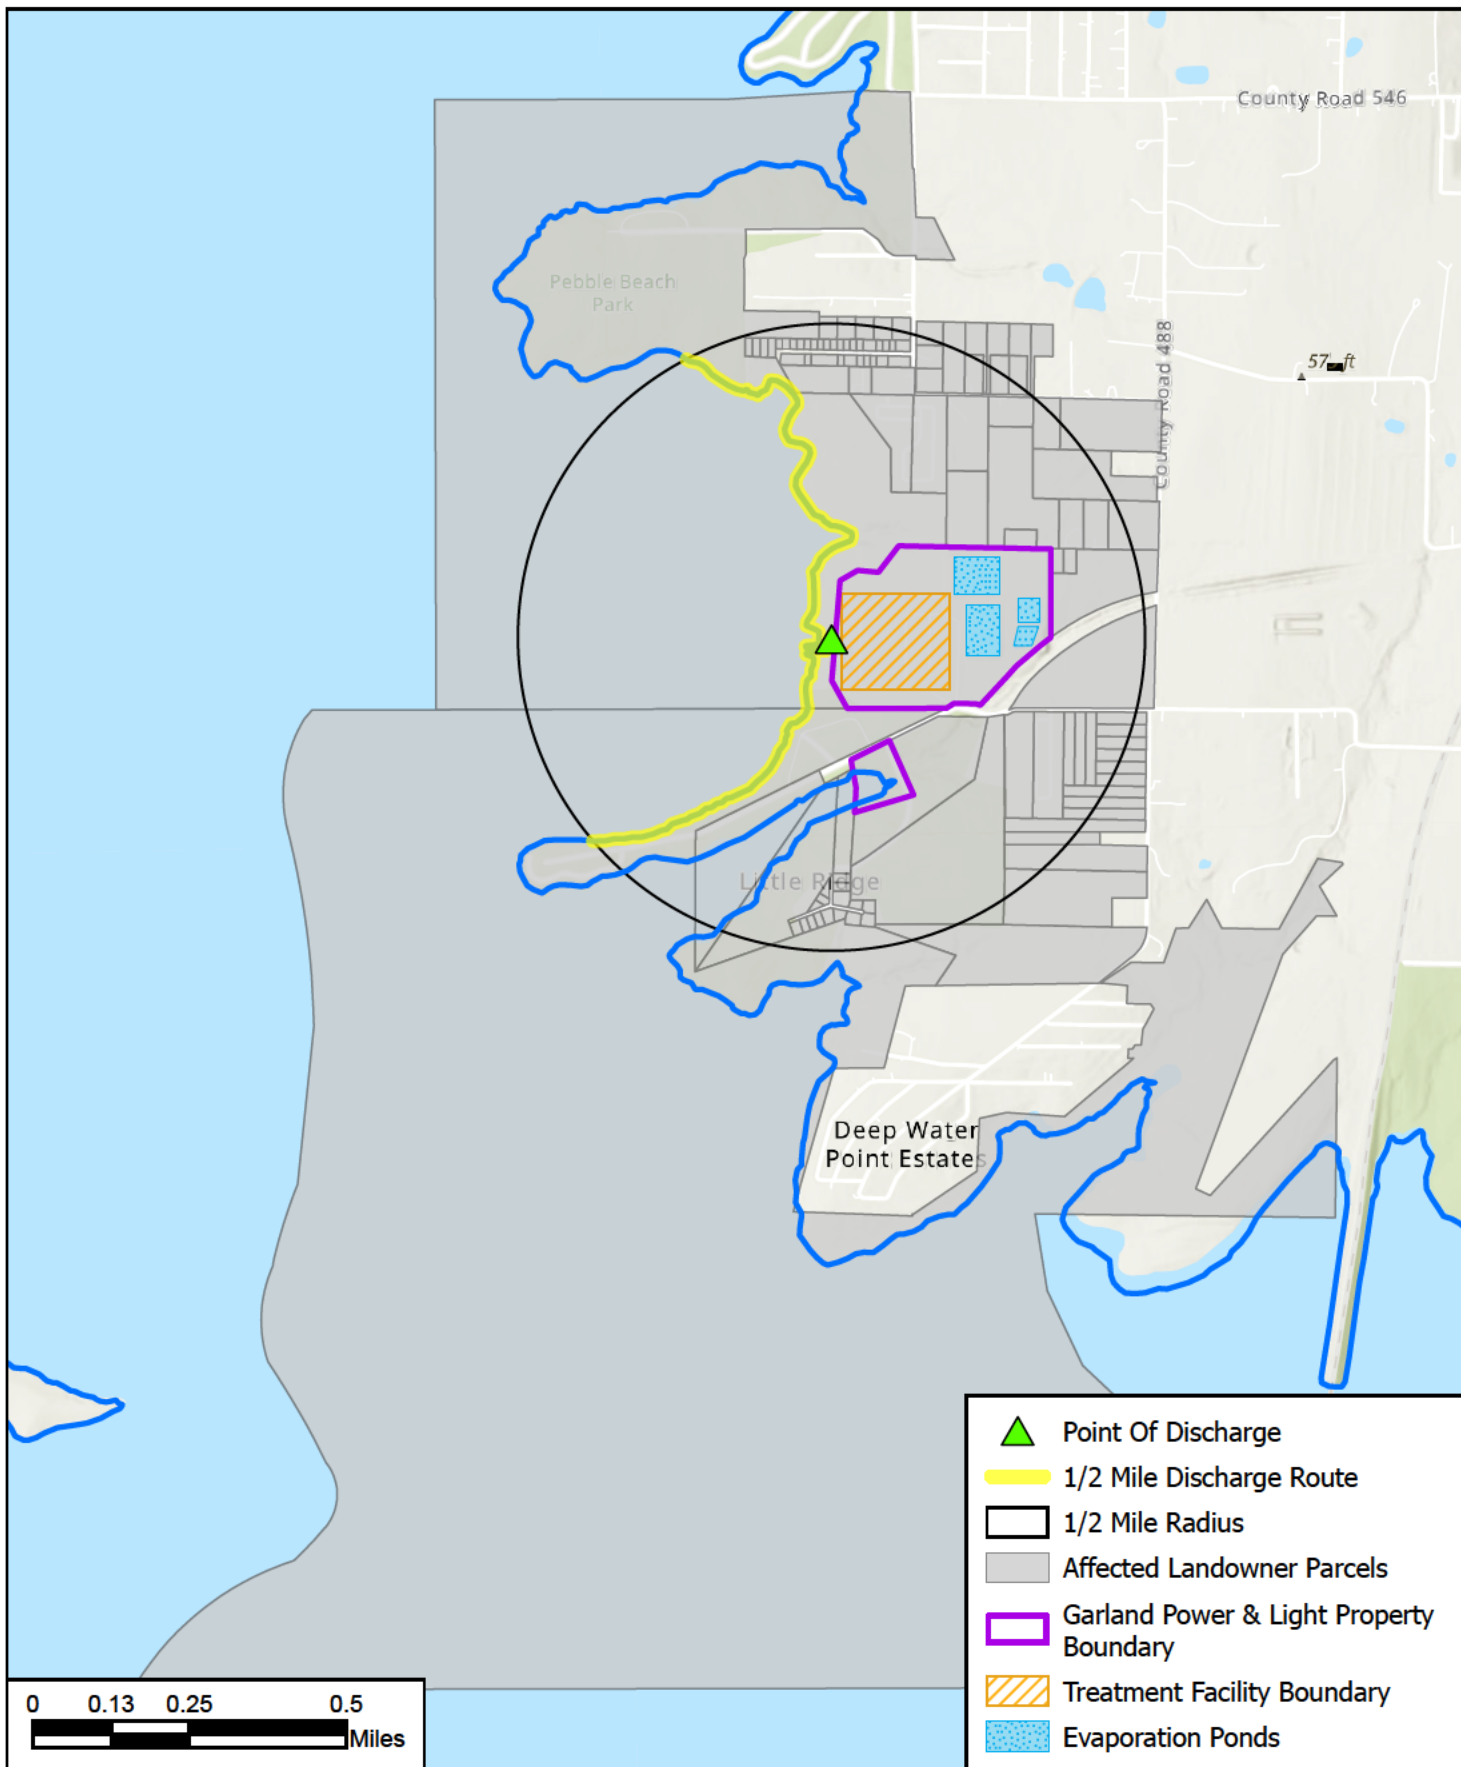

**FRESE AND NICHOLS**  
 FRESE AND NICHOLS, INC  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland

**Ray Olinger Power Plant**


**Affected Landowners**

PN JOB NO  
 FILE NAME  
 DATE  
 SCALE  
 DESIGNED  
 DRAFTED

GPL24350  
 GP&L TPDES Renewal.mxd  
 8/2/2024  
 1:9,300  
 CLV  
 08245

**3a**


**FIGURE**

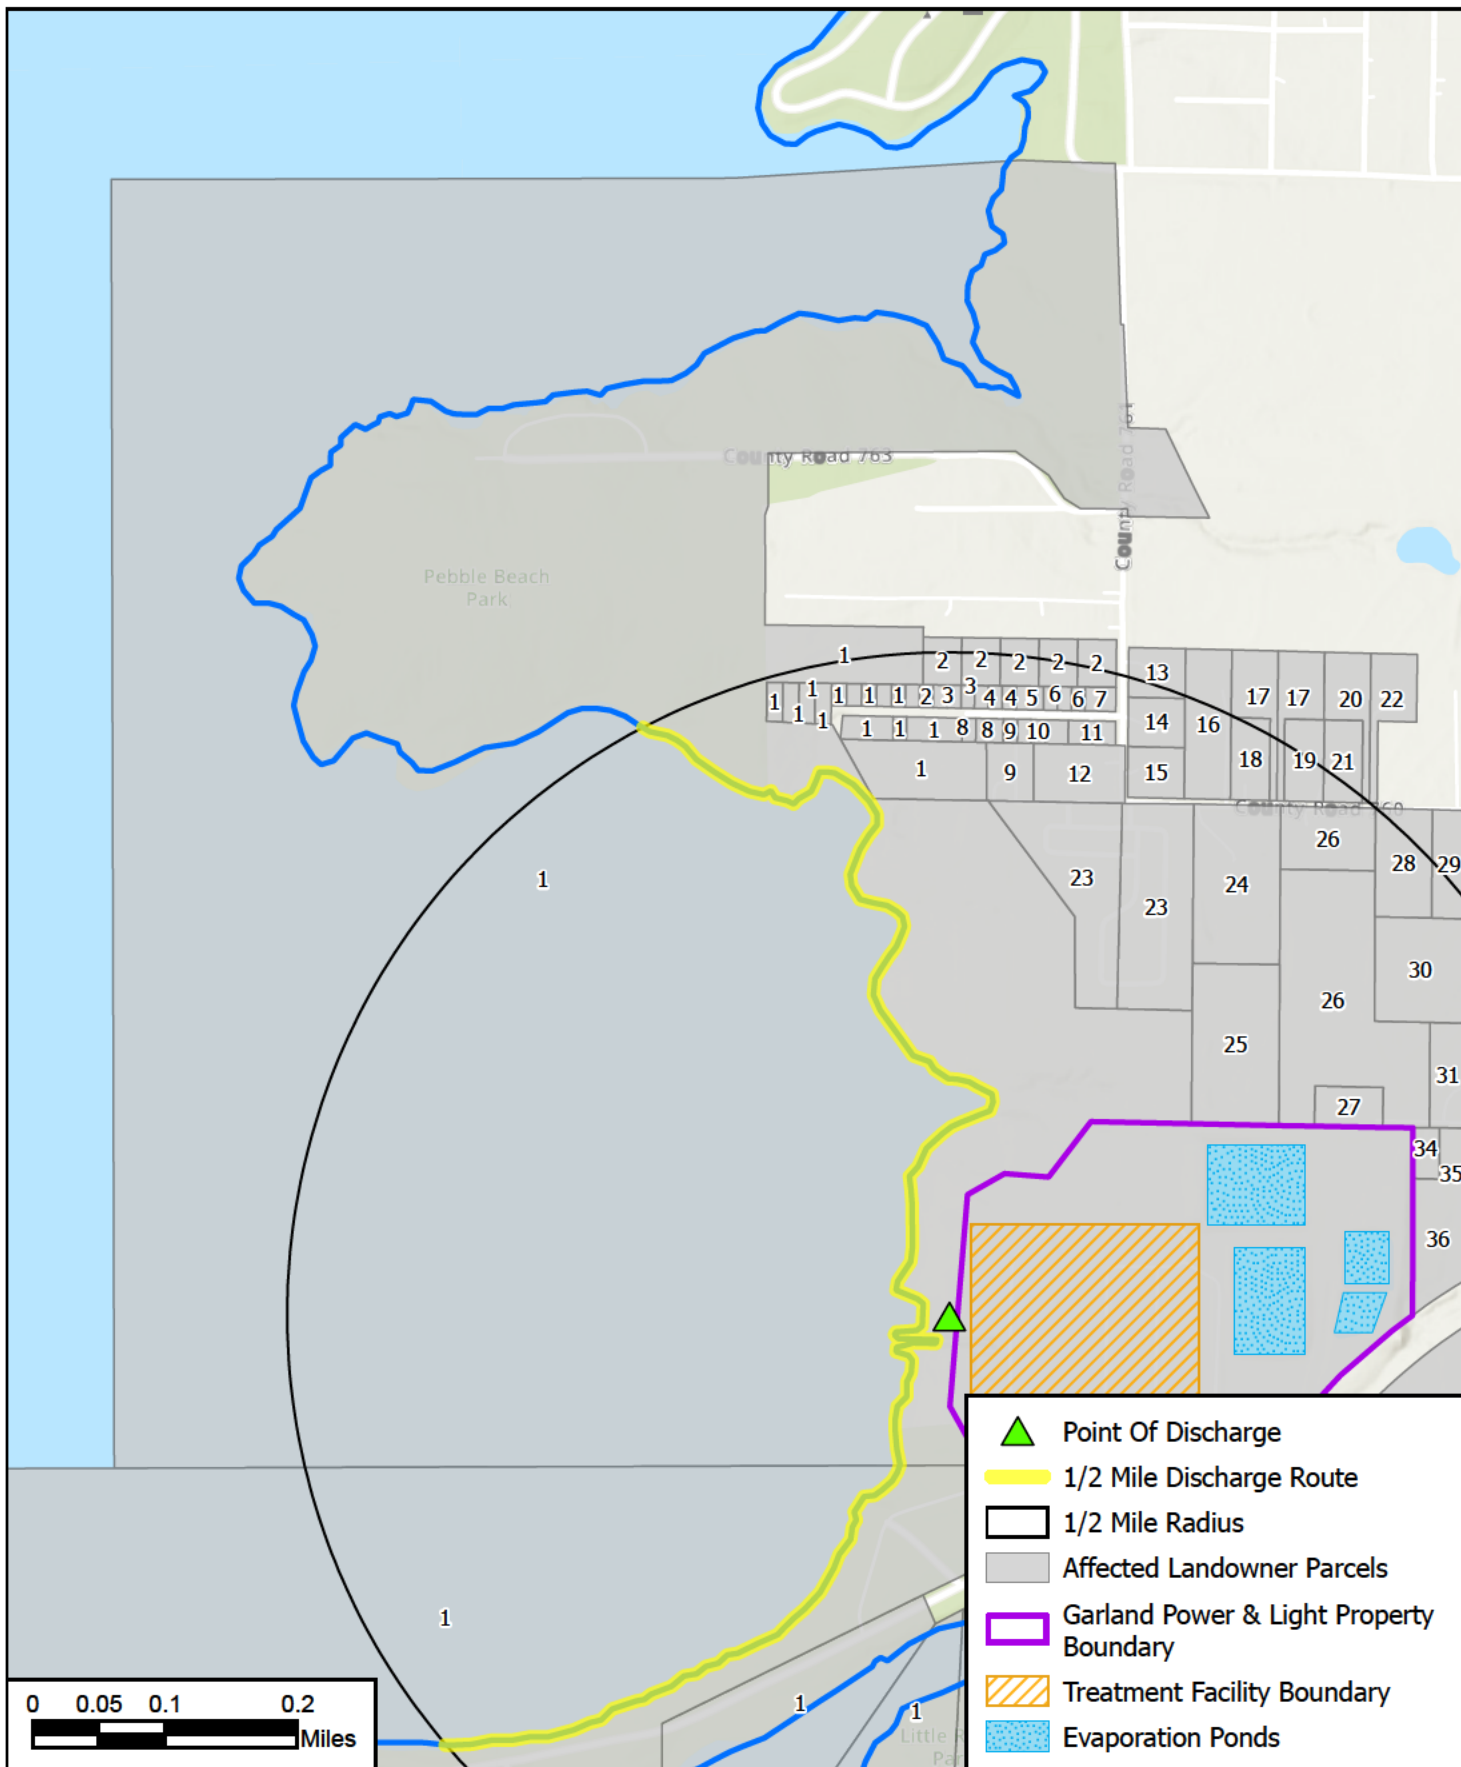

- Point Of Discharge
- 1/2 Mile Discharge Route
- 1/2 Mile Radius
- Affected Landowner Parcels
- Garland Power & Light Property Boundary
- Treatment Facility Boundary
- Evaporation Ponds

<p><b>FREESE AND NICHOLS, INC.</b> 801 Cherry Street, Suite 2800 Fort Worth, TX 76102 Phone - (817) 735 - 7300</p>		<p>City of Garland</p> <p><b>Ray Olinger Power Plant</b></p> <p><b>Affected Landowners</b></p>		<p>PN JOB NO. GPL24350</p>	<p><b>3b</b></p> <p><b>FIGURE</b></p>
				<p>FILE NAME GP&amp;L TPDES Renewal.mxd</p>	
				<p>DATE 8/2/2024</p>	
				<p>SCALE 1:9,186</p>	
				<p>DESIGNED CLV</p>	
			<p>DRAFTED 08245</p>		



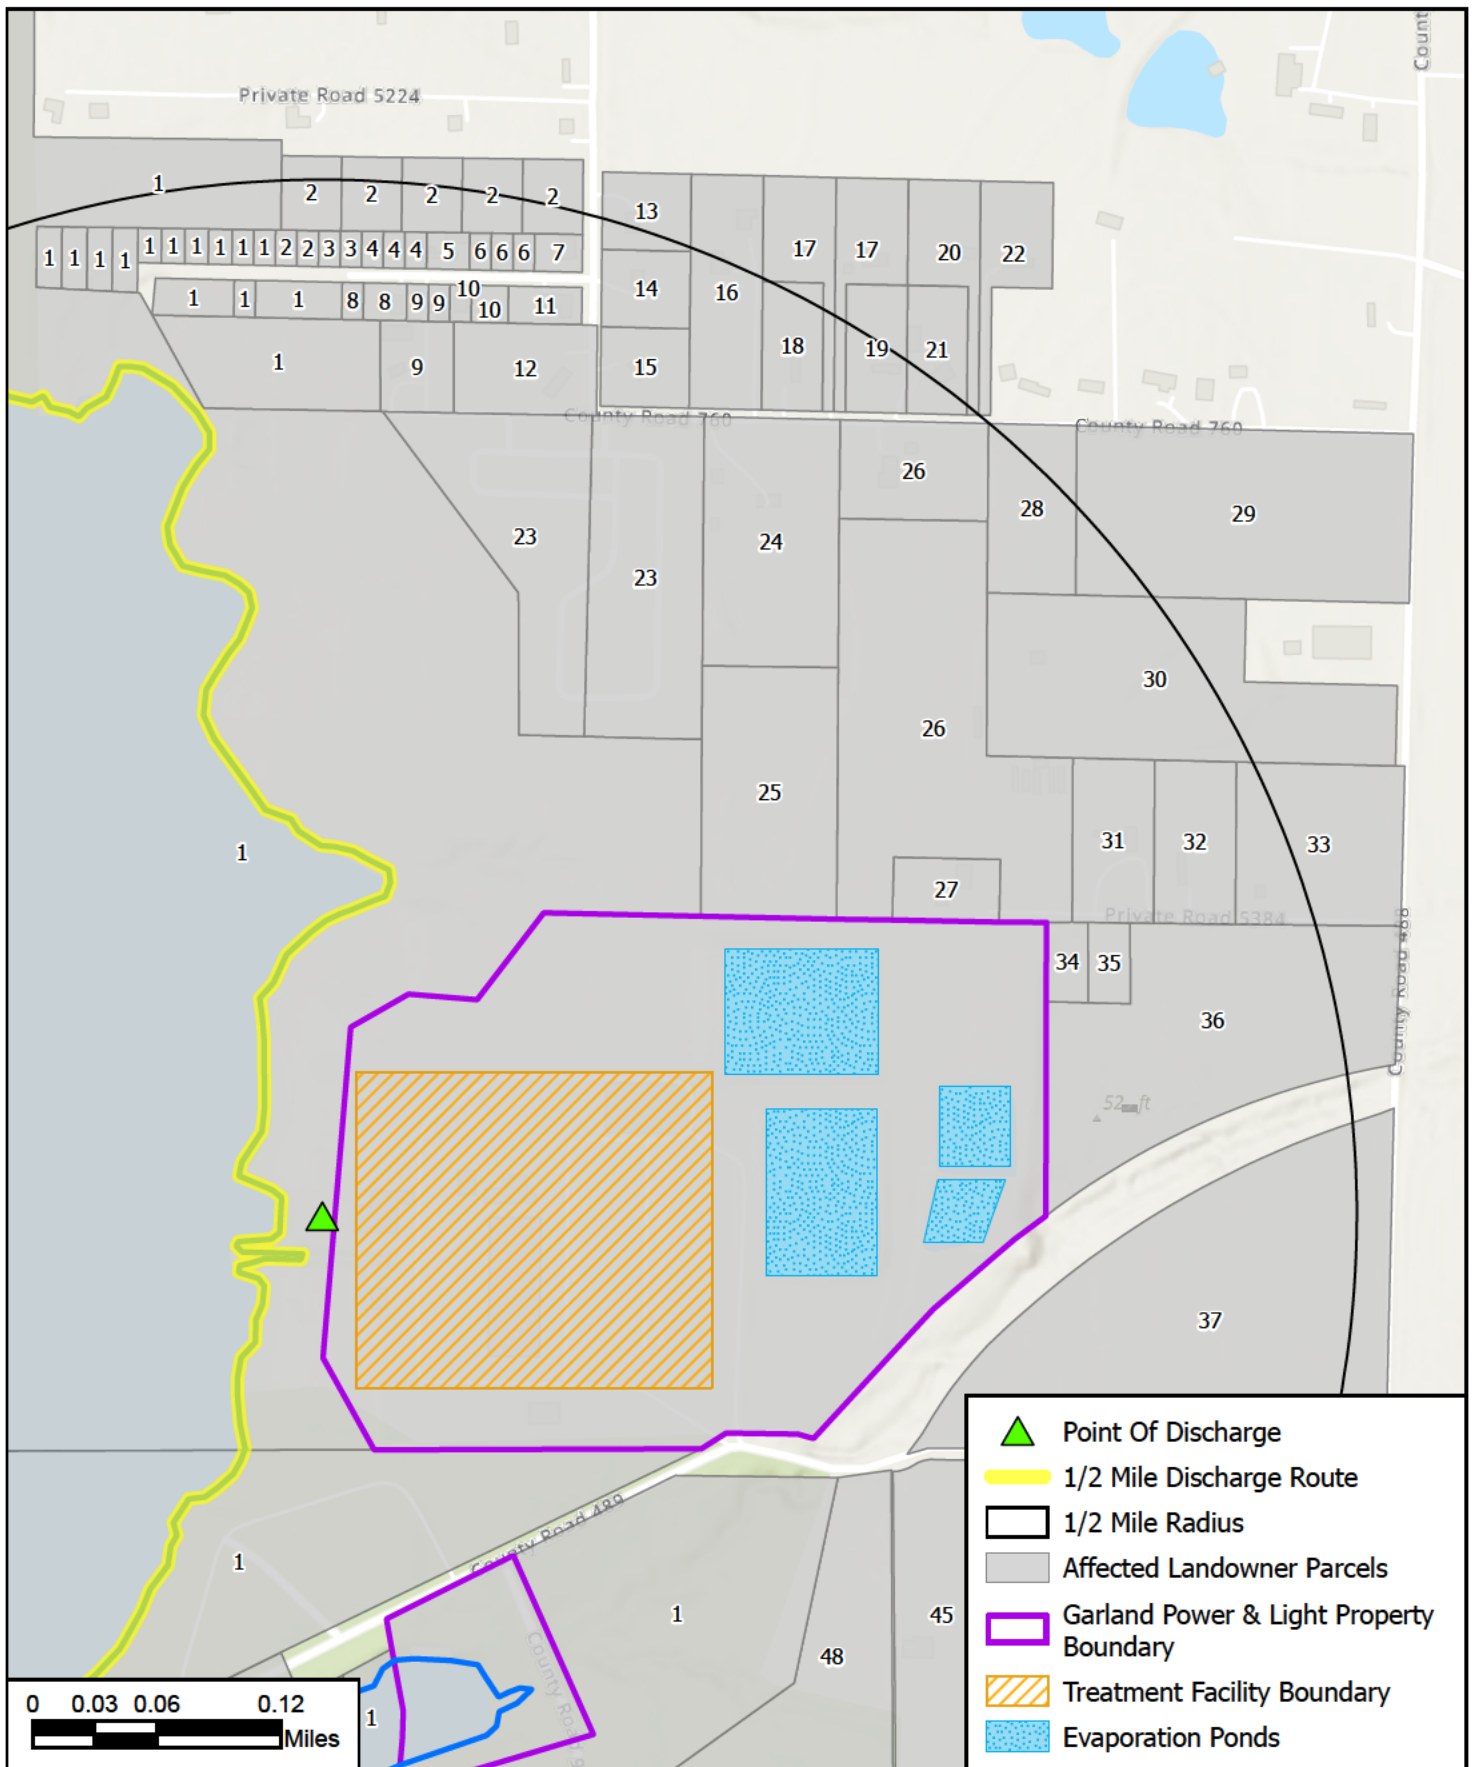

**FREES & NICHOLS**  
 FREES AND NICHOLS, INC.  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300




City of Garland


# Ray Olinger Power Plant

## Affected Landowners

FW JOB NO. GPL24350  
 FILE NAME GP&L TPDES Renewal.mxd  
 DATE 8/2/2024  
 SCALE 1:9,188  
 DESIGNED CLV  
 DRAFTED 08245

**3c**  
**FIGURE**

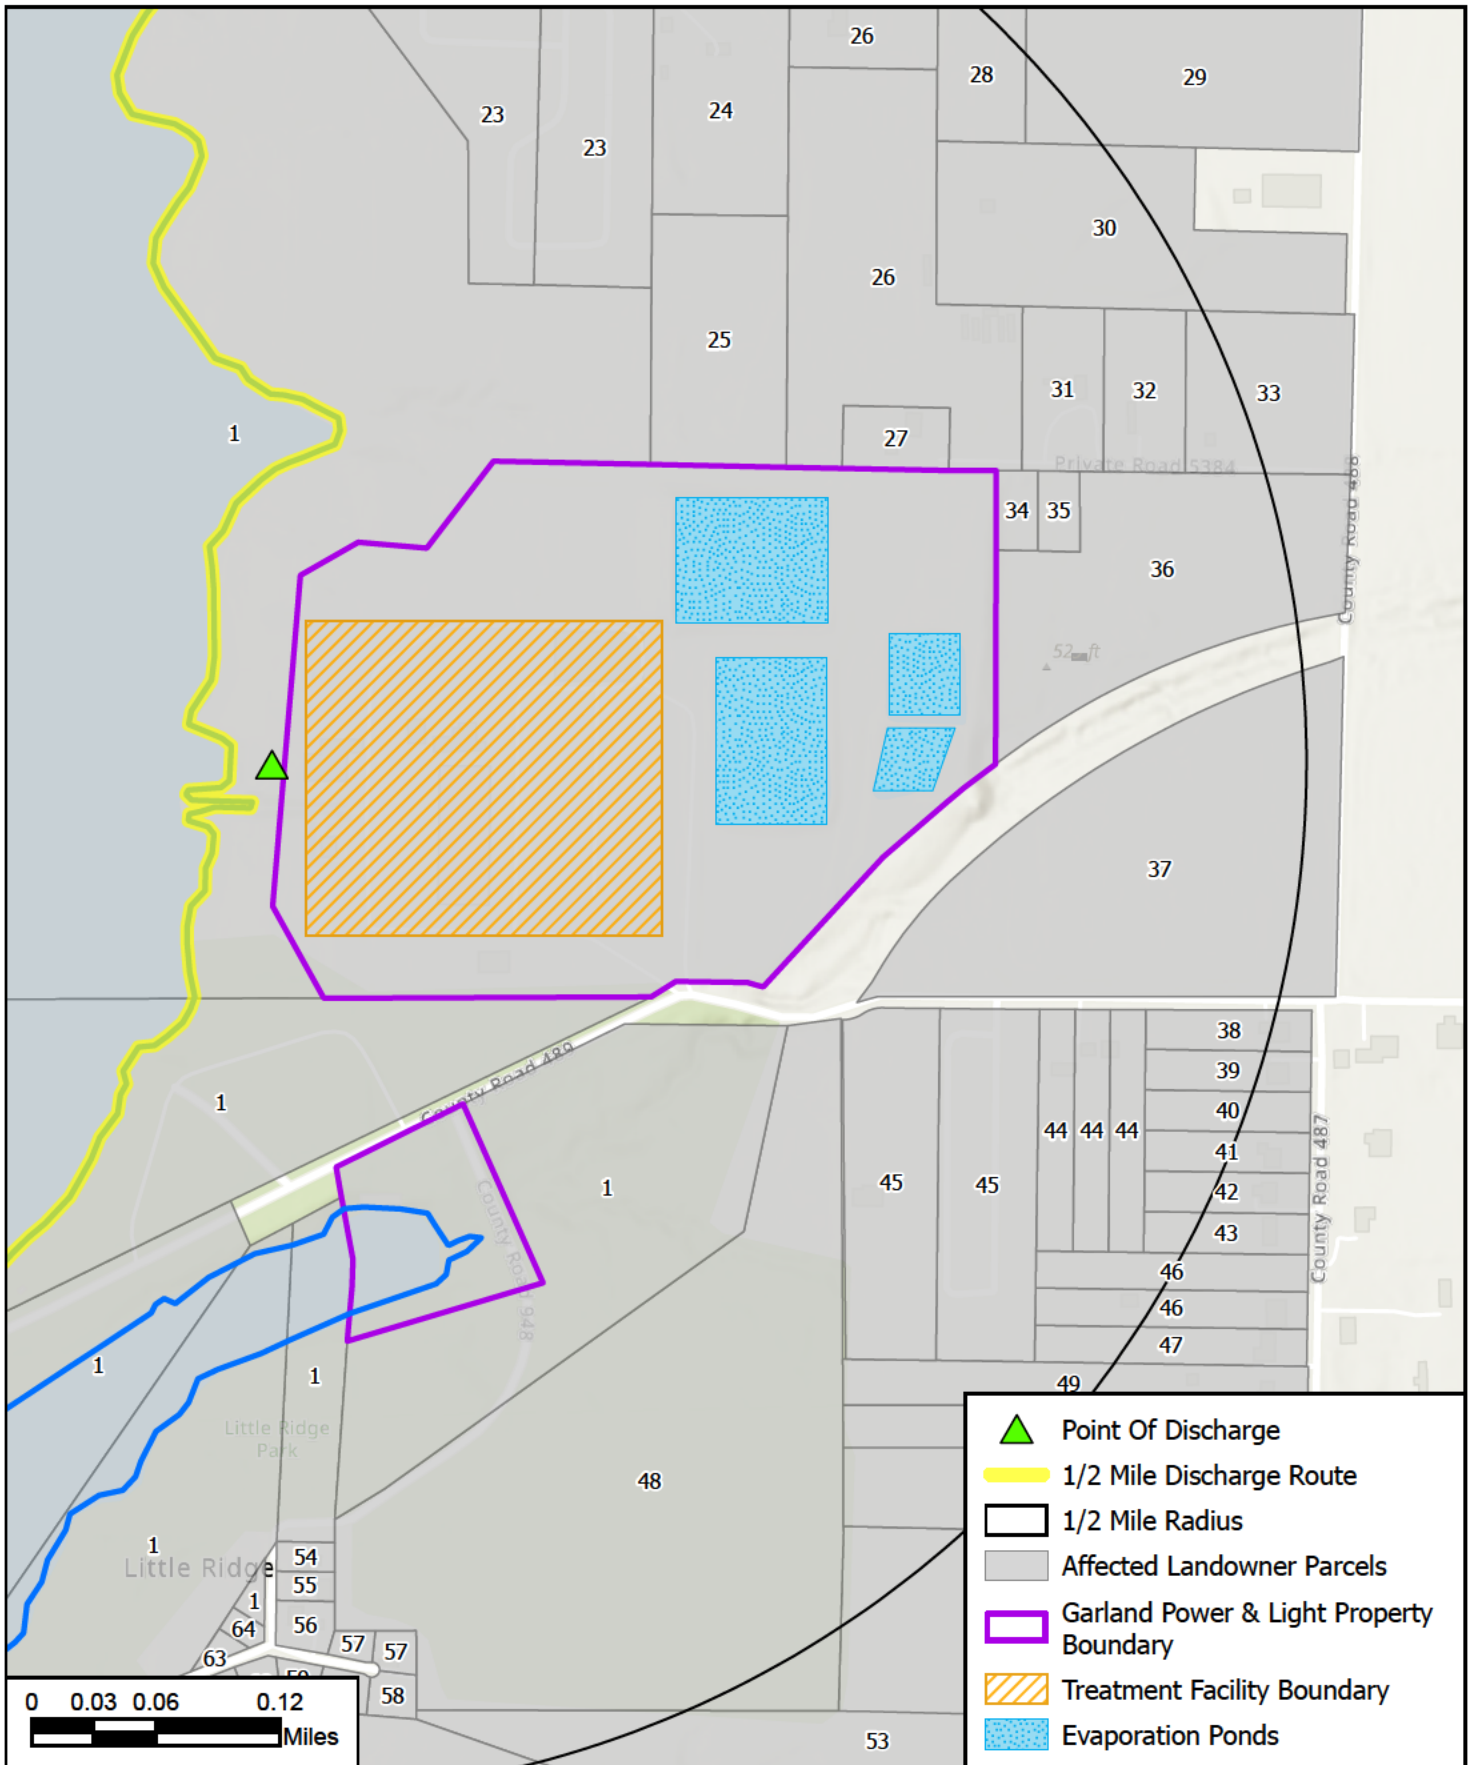

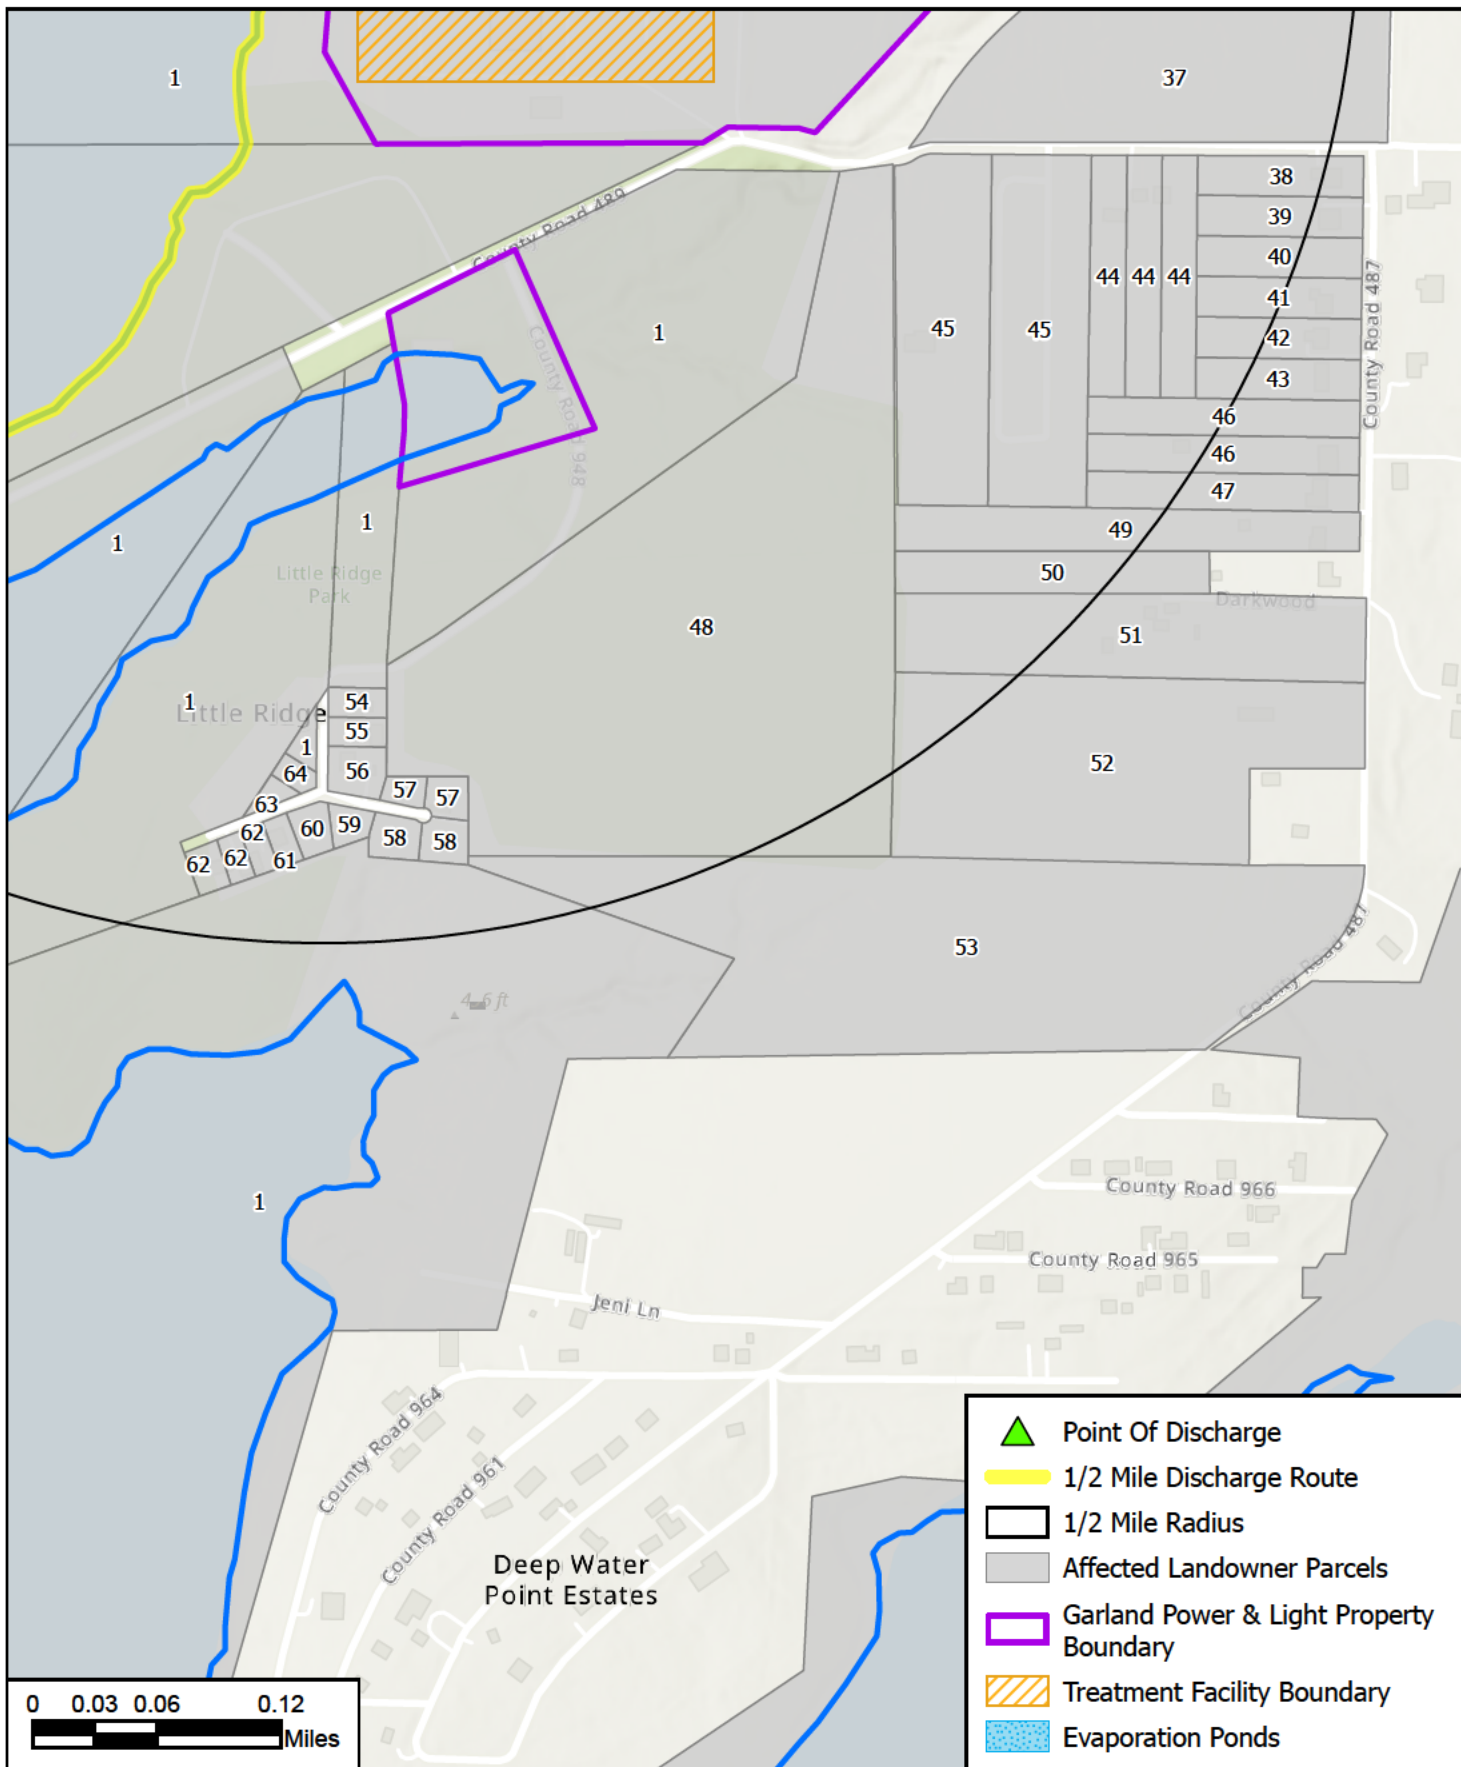

**0 0.03 0.06 0.12**  
Miles

**FRESE AND NICHOLS, INC.**  
801 Cherry Street, Suite 2800  
Fort Worth, TX 76102  
Phone - (817) 735 - 7300

N  
W E  
S

City of Garland


# Ray Olinger Power Plant

## Affected Landowners

PN JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	8/2/2024
SCALE	1:9,186
DESIGNED	CLV
DRAFTED	08245

**3e**

**FIGURE**

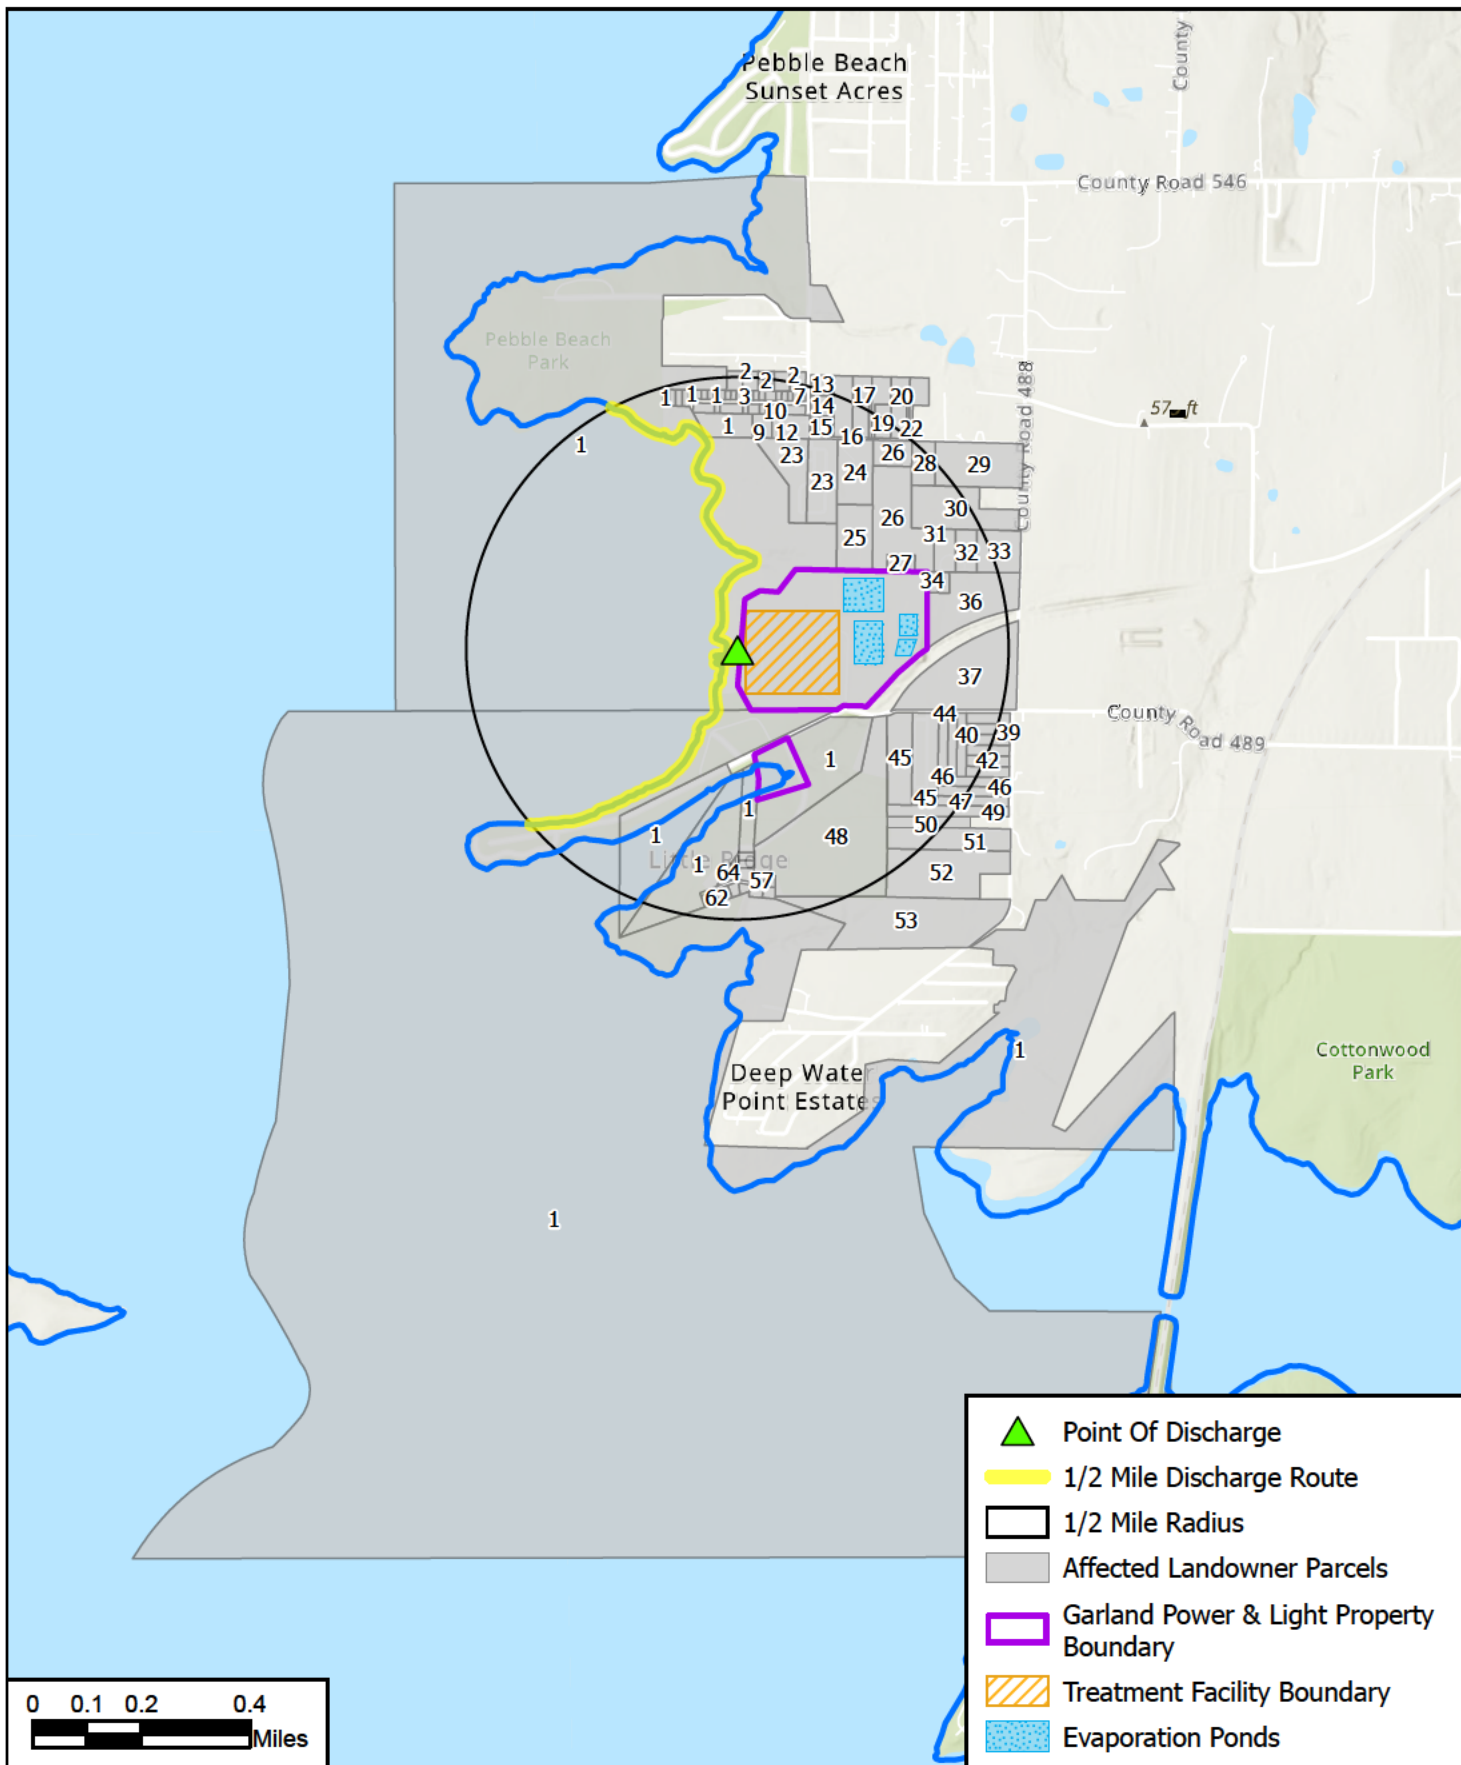



## Affected Landowner Map Cross Referenced List

USA	
1	US Army Core of Engineers Fort Worth District PO Box 17300 Fort Worth, TX 76102 Mcintire Robin & Shannon
2	6172 County Road 761 Nevada, TX 75173-6116
3	888 Ma Ltd 3324 Sandy Trail Ln Plano, TX 75023-5656
4	Escalona Jose Luis Ontiveros 630 Stoneybrook Dr Wylie, TX 75098-4036
5	Benites Rodolfo Garcia & Herlinda Vasquez 13521 County Road 762 Nevada, TX 75173-6121
6	Mcguire Buddy Pierce Jr & Lawanna Ann 13539 County Road 762 Nevada, TX 75173-6121
7	Riggall Marvin V Jr 13569 County Road 762 Nevada, TX 75173-6121
8	Karczmarski Christopher Marc 13510 County Road 762 Nevada, TX 75173-6120
9	Lavonland LLC 13527 County Road 760 Nevada, TX 75173-6109
10	Dauksavage-Deloach Sonja & Billy Joe Dauksavage 13540 County Road 762 Nevada, TX 75173-6120
11	Mcintire Legacy Trust 6172 County Road 761 Nevada, TX 75173-6116
13	Riggall Marvin Vale Jr & Laura 6191 County Road 761 Nevada, TX 75173-6165
14	Dickeson Wayne & Freda Po Box 326 Copeville, TX 75121-0326
15	Iriarte Dianne D & Tyre Wade Allen 6285 County Road 761 Nevada, TX 75173-6119
16	Bretado Rayo Elizabeth & Carlos Cruz Ruiz 13731 County Road 760 Nevada, TX 75173-6111
17	Rios Humberto & Maria Del Carmen Rios 13771 County Road 760 Nevada, TX 75173-6111
18	Sutton James Robert & Sutton Jane Ann Po Box 5 Weston, TX 75097-0005
19	Wilson Marcus G Po Box 233 Copeville, TX 75121-0233
20	Ramirez-Macareno Agustin Jaime & Jazmin Ramirez 13823 County Road 760 Nevada, TX 75173-6113
21	Pelham Troy V & Barbara 13809 County Road 760 Nevada, TX 75173-6113
22	Flores Lazaro & Sulema 13849 County Road 760 Nevada, TX 75173-6113
23	Fritts Enterprises Inc 1322 Briar Hollow Ln Garland, TX 75043-1614

12	Huang Doris 3936 Dalston Ln Plano, TX 75023-1027	24	Emery Jody J 13700 County Road 760 Nevada, TX 75173-6110
25	Fritts James C DbA Crossed Palms Rv Resort 1322 Briar Hollow Ln Garland, TX 75043-1614	38	Orr Rebecca Kathleen & Michael Alan Parks 14128 County Road 489 Nevada, TX 75173-6038
26	Stone Rose Properties LLC Po Box 92341 Southlake, TX 76092-0135	39	Choctaw American Insurance Inc 10900 Ne 4Th St Ste 2300 Bellevue, WA 98004-5882
27	Proctor A O Po Box 3 Copeville, TX 75121-0003	40	Munroe Patricia 6782 County Road 487 Nevada, TX 75173-6088
28	Arteaga Felix Jose Jr 13888 County Road 760 Nevada, TX 75173-6138	41	Bryant Matthew & Lisa Bryant 6800 County Road 487 Nevada, TX 75173-6026
29	Arteaga Felix Jose & Marbella 6310 County Road 488 Nevada, TX 75173-6355	42	Moody Christopher & Crystal Dawn Moody 6822 County Road 487 Nevada, TX 75173-6026
30	Turner Rocky 6364 County Road 488 Nevada, TX 75173-6355	43	Aquatero John Po Box 336 Lavon, TX 75166-0336
31	Small Michael & Jessica Po Box 226 Copeville, TX 75121-0226	44	Burnett Julianna 3321 Carriage Ct Richardson, TX 75082-3663
32	Boughner Tamara Jean & Bruce Raymond Po Box 212 Copeville, TX 75121-0212	45	Chp Northeast LP 550 S Watters Rd Ste 127 Allen, TX 75013-5225
33	Gonzalez Jose Lira & Lorena Arteaga-Degonzalez 3015 Elm Grove Rd Wylie, TX 75098-6251	46	Taylor Roy Lee & Elizabeth Kern 6860 County Road 487 Nevada, TX 75173-6026
34	White Wayne M Po Box 365 Shamrock, TX 79079-0365	47	Ferrell Douglas 6900 County Road 487 Nevada, TX 75173-6028
35	Eaker Jeanie Po Box 44 Copeville, TX 75121-0044	48	Jewish Family Service of Dallas Inc 5402 Arapaho Rd Ste 102 Dallas, TX 75248-7098
36	Massengale Pat J Elliott 9623 Park Highlands Dr Dallas, TX 75238-2959	49	Unknown
37	Garland City Of 200 N 5Th St Garland, TX 75040-6314	50	Barlett Bruce A & Michelle M 6932 County Road 487 Nevada, TX 75173-6028

- Choudhary Harsh  
51 6956 County Road 487  
Nevada, TX 75173-6028  
Nix Ronald Dean
- 52 7022 County Road 487  
Nevada, TX 75173-6030  
Wolverton William Dale
- 53 6953 Cotner Rd  
Nevada, TX 75173-6303  
Wallace Kevin & Alesa
- 54 18693 Hilltop Ln  
Nevada, TX 75173-8165  
Nix Marjorie Jean
- 55 7214 County Road 1207  
Nevada, TX 75173-6232  
Ramirez Miguel Lindo & Maricela Zavala
- 56 105 Glen Knoll Dr  
Wylie, TX 75098-5004  
White Donald &  
Janice White
- 57 7294 County Road 1207  
Nevada, TX 75173-6232  
Brown Vicki
- 58 807 S China St  
Brady, TX 76825-5437  
Nix Marjorie Jean - Cle &  
Estate of Robert L Nix
- 59 7214 County Road 1207  
Nevada, TX 75173-6232  
Lessig Kimberly
- 60 7241 County Road 1208  
Nevada, TX 75173-6235  
Lessig Kenneth Allen
- 61 7241 County Road 1208  
Nevada, TX 75173-6235  
Thompson Deborah Elaine
- 62 Po Box 380  
Copeville, TX 75121-0380  
White Shawn Marie
- 63 7252 County Road 1208  
Nevada, TX 75173-6234  
Rademacher Ronald Ray
- 64 7224 County Road 1208  
Nevada, TX 75173-6234

USA US Army Core of Engineers Fort Worth District PO Box 17300 Fort Worth, TX 76102	McIntire Robin & Shannon 6172 County Road 761 Nevada, TX 75173-6116	888 Ma Ltd 3324 Sandy Trail Ln Plano, TX 75023-5656
Escalona Jose Luis Ontiveros 630 Stoneybrook Dr Wylie, TX 75098-4036	Benites Rodolfo Garcia & Herlinda Vasquez 13521 County Road 762 Nevada, TX 75173-6121	McGuire Buddy Pierce Jr & Lawanna Ann 13539 County Road 762 Nevada, TX 75173-6121
Riggall Marvin V Jr 13569 County Road 762 Nevada, TX 75173-6121	Karczmarski Christopher Marc 13510 County Road 762 Nevada, TX 75173-6120	Lavonland LLC 13527 County Road 760 Nevada, TX 75173-6109
Dauksavage-Deloach Sonja & Billy Joe Dauksavage 13540 County Road 762 Nevada, TX 75173-6120	McIntire Legacy Trust 6172 County Road 761 Nevada, TX 75173-6116	Huang Doris 3936 Dalston Ln Plano, TX 75023-1027
Riggall Marvin Vale Jr & Laura 6191 County Road 761 Nevada, TX 75173-6165	Dickeson Wayne & Freda Po Box 326 Copeville, TX 75121-0326	Iriarte Dianne D & Tyre Wade Allen 6285 County Road 761 Nevada, TX 75173-6119
Iriarte Dianne D & Tyre Wade Allen 6285 County Road 761 Nevada, TX 75173-6119	Bretado Rayo Elizabeth & Carlos Cruz Ruiz 13731 County Road 760 Nevada, TX 75173-6111	Rios Humberto & Maria Del Carmen Rios 13771 County Road 760 Nevada, TX 75173-6111
Sutton James Robert & Sutton Jane Ann Po Box 5 Weston, TX 75097-0005	Wilson Marcus G Po Box 233 Copeville, TX 75121-0233	Ramirez-Macareno Agustin Jaime & Jazmin Ramirez 13823 County Road 760 Nevada, TX 75173-6113
Pelham Troy V & Barbara 13809 County Road 760 Nevada, TX 75173-6113	Flores Lazaro & Sulema 13849 County Road 760 Nevada, TX 75173-6113	Fritts Enterprises Inc 1322 Briar Hollow Ln Garland, TX 75043-1614
Emery Jody J 13700 County Road 760 Nevada, TX 75173-6110	Fritts James C DbA Crossed Palms Rv Resort 1322 Briar Hollow Ln Garland, TX 75043-1614	Stone Rose Properties LLC Po Box 92341 Southlake, TX 76092-0135
Proctor A O Po Box 3 Copeville, TX 75121-0003	Arteaga Felix Jose Jr 13888 County Road 760 Nevada, TX 75173-6138	Arteaga Felix Jose & Marbella 6310 County Road 488 Nevada, TX 75173-6355

Turner Rocky  
6364 County Road 488  
Nevada, TX 75173-6355

Small Michael & Jessica  
Po Box 226  
Copeville, TX 75121-0226

Boughner Tamara Jean & Bruce  
Raymond  
Po Box 212  
Copeville, TX 75121-0212

Gonzalez Jose Lira &  
Lorena Arteaga-Degonzalez  
3015 Elm Grove Rd  
Wylie, TX 75098-6251

White Wayne M  
Po Box 365  
Shamrock, TX 79079-0365

Eaker Jeanie  
Po Box 44  
Copeville, TX 75121-0044

Massengale Pat J Elliott  
9623 Park Highlands Dr  
Dallas, TX 75238-2959

Garland City Of  
200 N 5Th St  
Garland, TX 75040-6314

Orr Rebecca Kathleen &  
Michael Alan Parks  
14128 County Road 489  
Nevada, TX 75173-6038

Choctaw American Insurance Inc  
10900 Ne 4Th St Ste 2300  
Bellevue, WA 98004-5882

Munroe Patricia  
6782 County Road 487  
Nevada, TX 75173-6088

Bryant Matthew &  
Lisa Bryant  
6800 County Road 487  
Nevada, TX 75173-6026

Moody Christopher &  
Crystal Dawn Moody  
6822 County Road 487  
Nevada, TX 75173-6026

Aquatero John  
Po Box 336  
Lavon, TX 75166-0336

Burnett Julianna  
3321 Carriage Ct  
Richardson, TX 75082-3663

Chp Northeast LP  
550 S Watters Rd Ste 127  
Allen, TX 75013-5225

Taylor Roy Lee & Elizabeth Kern  
6860 County Road 487  
Nevada, TX 75173-6026

Ferrell Douglas  
6900 County Road 487  
Nevada, TX 75173-6028

Jewish Family Service of Dallas Inc  
5402 Arapaho Rd Ste 102  
Dallas, TX 75248-7098

Barlett Bruce A & Michelle M  
6932 County Road 487  
Nevada, TX 75173-6028

Choudhary Harsh  
6956 County Road 487  
Nevada, TX 75173-6028

Nix Ronald Dean  
7022 County Road 487  
Nevada, TX 75173-6030

Wolverton William Dale  
6953 Cotner Rd  
Nevada, TX 75173-6303

Wallace Kevin & Alesa  
18693 Hilltop Ln  
Nevada, TX 75173-8165

Nix Marjorie Jean  
7214 County Road 1207  
Nevada, TX 75173-6232

Ramirez Miguel Lindo & Maricela  
Zavala  
105 Glen Knoll Dr  
Wylie, TX 75098-5004

White Donald &  
Janice White  
7294 County Road 1207  
Nevada, TX 75173-6232

Brown Vicki  
807 S China St  
Brady, TX 76825-5437

Nix Marjorie Jean - Cle &  
Estate of Robert L Nix  
7214 County Road 1207  
Nevada, TX 75173-6232

Ramirez Miguel Lindo & Maricela  
Zavala  
105 Glen Knoll Dr  
Wylie, TX 75098-5004

White Donald &  
Janice White  
7294 County Road 1207  
Nevada, TX 75173-6232

Brown Vicki  
807 S China St  
Brady, TX 76825-5437

Lessig Kimberly  
7241 County Road 1208  
Nevada, TX 75173-6235

Lessig Kenneth Allen  
7241 County Road 1208  
Nevada, TX 75173-6235

Thompson Deborah Elaine  
Po Box 380  
Copeville, TX 75121-0380

White Shawn Marie  
7252 County Road 1208  
Nevada, TX 75173-6234

Rademacher Ronald Ray  
7224 County Road 1208  
Nevada, TX 75173-6234

## **ATTACHMENT AR-6**

Original Photographs



**Photo 1:** Facing South Towards Intake Pumps



**Photo 2:** Facing South Towards Water Intake





**Photo 3:** Facing East Toward Units 1, 2, and 3



**Photo 4:** Outfall 001 (south) facing west towards Lake Lavon.





**Photo 5:** Outfall 001 (south) facing southeast towards the facility.



**Photo 6:** Outfall 001 (north) facing northwest towards Lake Lavon.

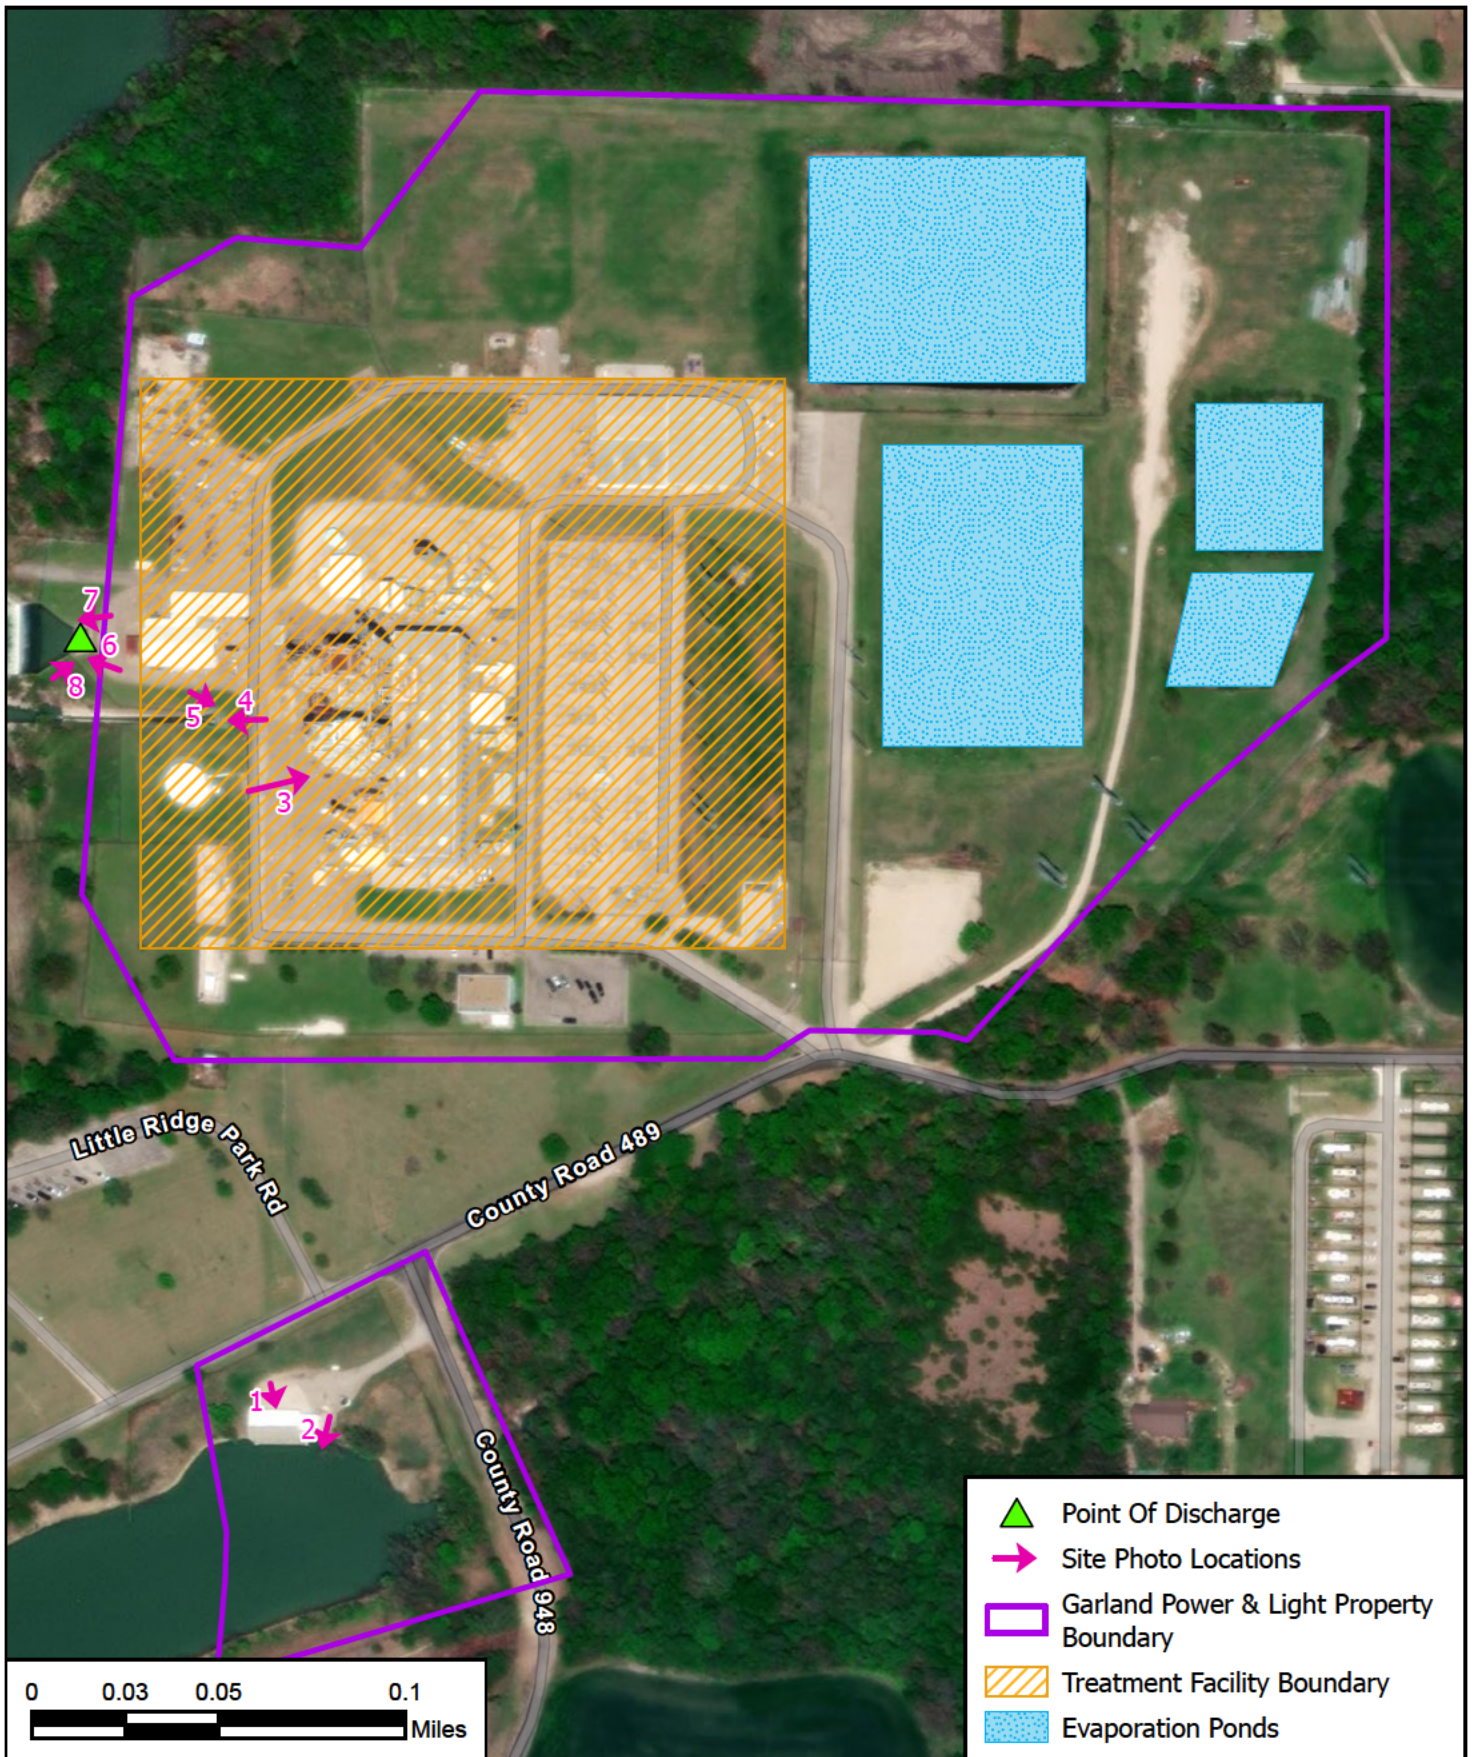


**Photo 7:** Outfall 001 (north) facing southwest towards Lake Lavon.



**Photo 8:** Outfall 001 (north) facing northeast towards facility.





**FREES AND NICHOLS, INC.**  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland

# Ray Olinger TPDES Permit Renewal

## Original Site Photo Locations

FW JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	8/2/2024
SCALE	
DESIGNED	CLV
DRAFTED	08245

**4**

**FIGURE**

# **ATTACHMENT SPIF-1**

SPIF Form

# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)

### FOR AGENCIES REVIEWING DOMESTIC OR INDUSTRIAL TPDES WASTEWATER PERMIT APPLICATIONS

**TCEQ USE ONLY:**

Application type: \_\_\_\_Renewal \_\_\_\_Major Amendment \_\_\_\_Minor Amendment \_\_\_\_New

County: \_\_\_\_\_ Segment Number: \_\_\_\_\_

Admin Complete Date: \_\_\_\_\_

## Agency Receiving SPIF:

\_\_\_\_ Texas Historical Commission

\_\_\_\_ U.S. Fish and Wildlife

\_\_\_\_ Texas Parks and Wildlife Department

\_\_\_\_ U.S. Army Corps of Engineers

**This form applies to TPDES permit applications only.** (Instructions, Page 53)

Complete this form as a separate document. TCEQ will mail a copy to each agency as required by our agreement with EPA. If any of the items are not completely addressed or further information is needed, we will contact you to provide the information before issuing the permit. Address each item completely.

**Do not refer to your response to any item in the permit application form.** Provide each attachment for this form separately from the Administrative Report of the application. The application will not be declared administratively complete without this SPIF form being completed in its entirety including all attachments. Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at [WQ-ARPTeam@tceq.texas.gov](mailto:WQ-ARPTeam@tceq.texas.gov) or by phone at (512) 239-4671.

The following applies to all applications:

1. Permittee: Ray Olinger Steam Electric Station

Permit No. WQ00 01923000EPA ID No. TX 0001848

Address of the project (or a location description that includes street/highway, city/vicinity, and county):

13835 County Rd 489, Nevada, TX 75173

Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.

Prefix (Mr., Ms., Miss): Mr.

First and Last Name: David Bernard

Credential (P.E, P.G., Ph.D., etc.): N/A

Title: Production Manager

Mailing Address: 13835 Co Rd 489

City, State, Zip Code: Nevada, TX 75173

Phone No.: 972-205-3831 Ext.: N /A Fax No.: 972-485-6485

E-mail Address: dbernard@gpltexas.org

2. List the county in which the facility is located: Collin
3. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.

N/A

4. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the classified segment number.

From the plant site through a channel to Lake Lavon in Segment No. 0821 of the Trinity River Basin.

5. Please provide a separate 7.5-minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required in addition to the map in the administrative report).

Provide original photographs of any structures 50 years or older on the property.

Does your project involve any of the following? Check all that apply.

- ☐ Proposed access roads, utility lines, construction easements
- ☐ Visual effects that could damage or detract from a historic property's integrity
- ☐ Vibration effects during construction or as a result of project design
- ☐ Additional phases of development that are planned for the future
- ☐ Sealing caves, fractures, sinkholes, other karst features

☐ Disturbance of vegetation or wetlands

1. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features):

N/A

2. Describe existing disturbances, vegetation, and land use:

Land is currently used for steam electric plant directly adjacent to Lake Lavon.

THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

3. List construction dates of all buildings and structures on the property:

1967 - 1975


4. Provide a brief history of the property, and name of the architect/builder, if known.

ROPP Unit 1 was constructed in 1967, Unit 2 in 1971, and Unit 3 in 1975.



## **ATTACHMENT SPIF-2**

SPIF USGS Topographic Map

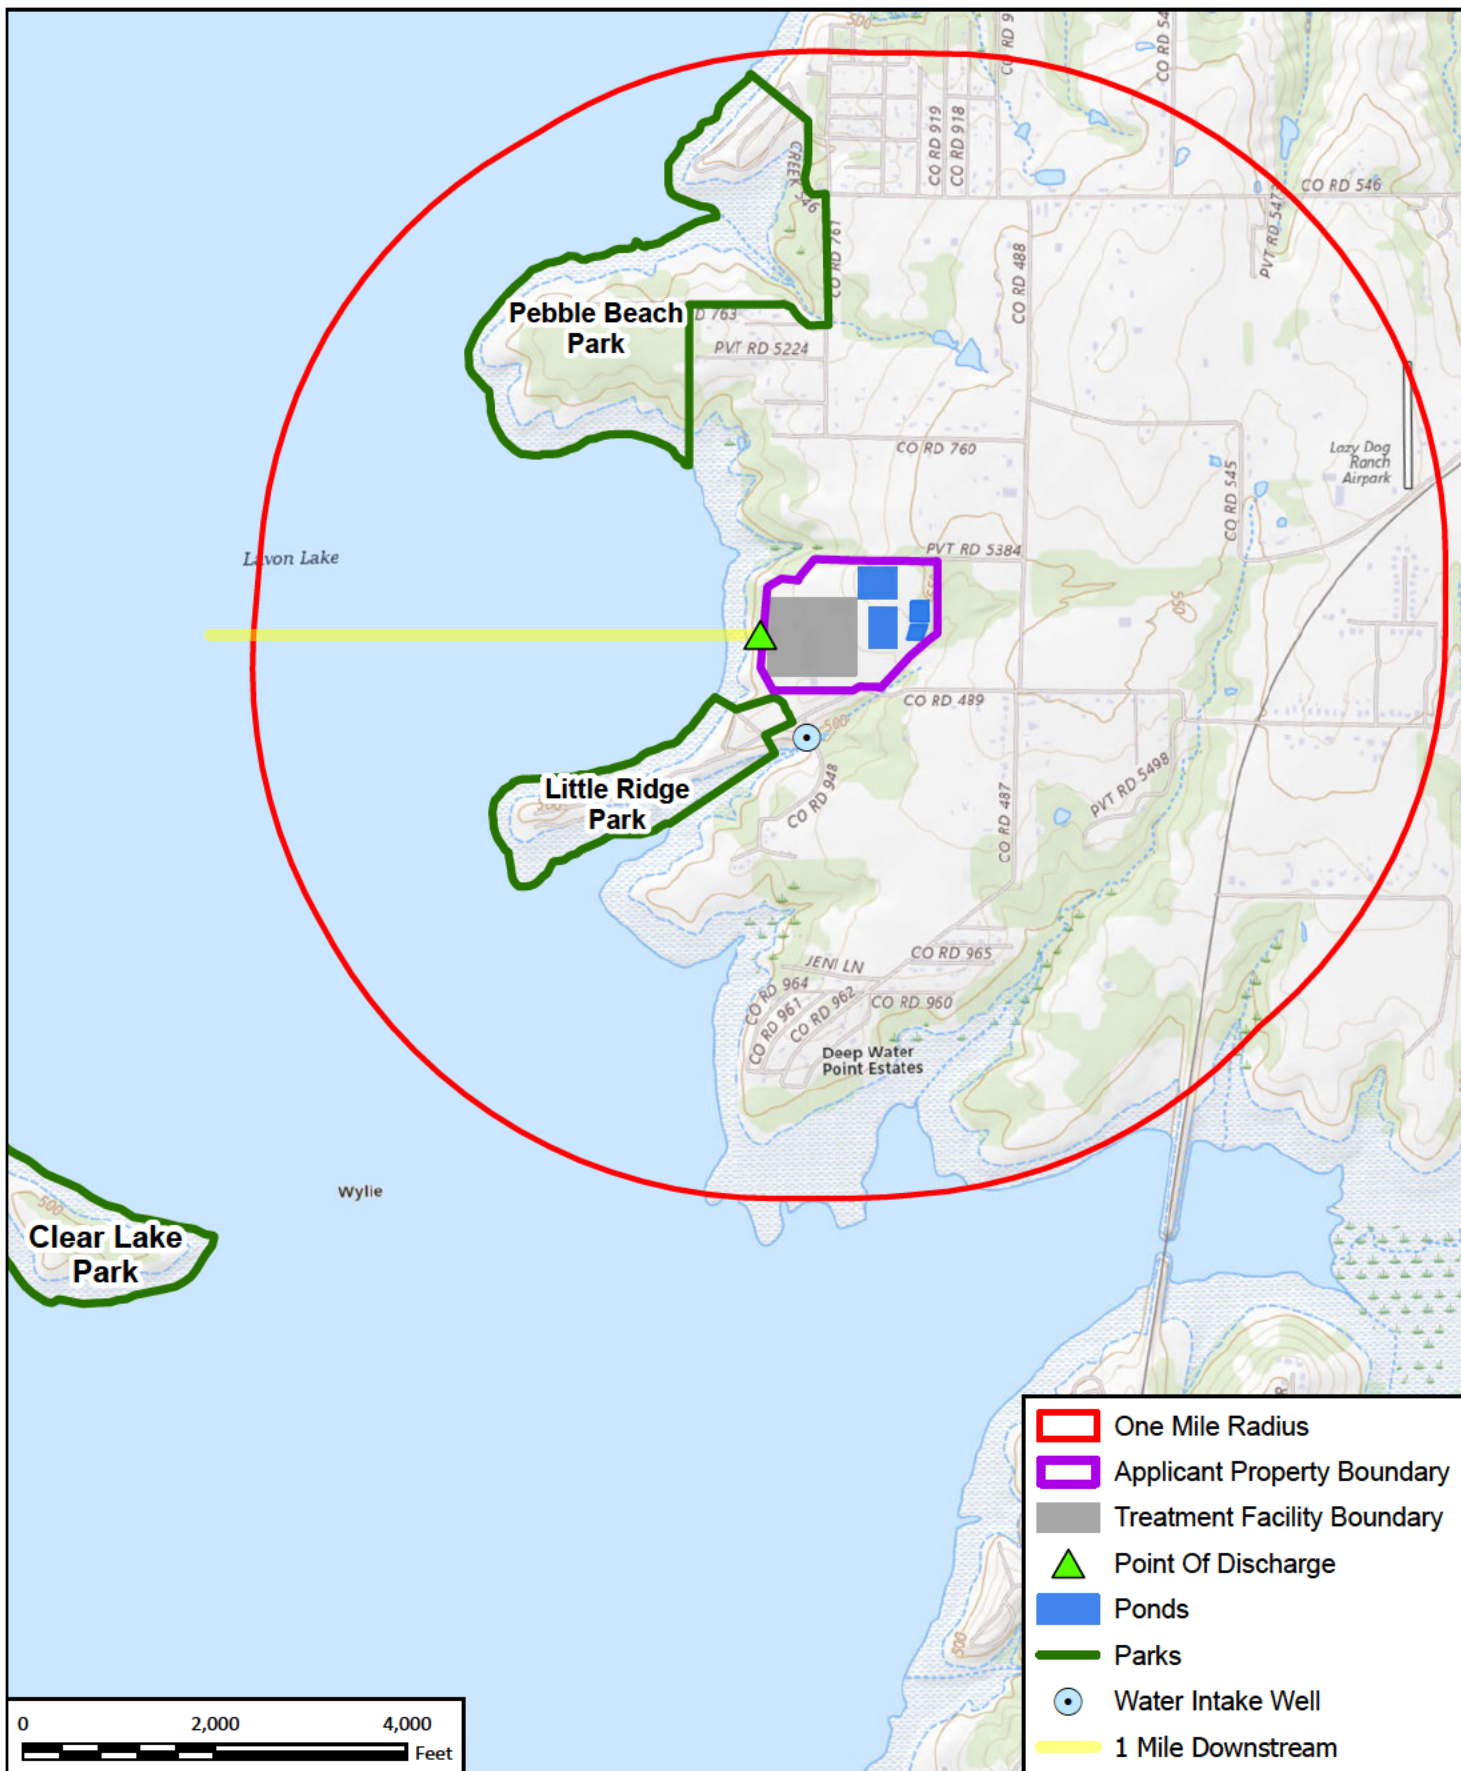


<p><b>FREASE AND NICHOLS, INC.</b> 801 Cherry Street, Suite 2800 Fort Worth, TX 76102 Phone - (817) 735 - 7300</p>		City of Garland		FN JOB NO GPL24350	<b>1</b>  <b>FIGURE</b>
		Ray Olinger TPDES Permit Renewal		FILE NAME GP&L TPDES Renewal.mxd	
		SPIF USGS Topographic Map		DATE 8/1/2024	
				SCALE 1:24,000	
				DESIGNED CLV	
			DRAFTED 08245		

# **ATTACHMENT TR-1**

## Facility Map



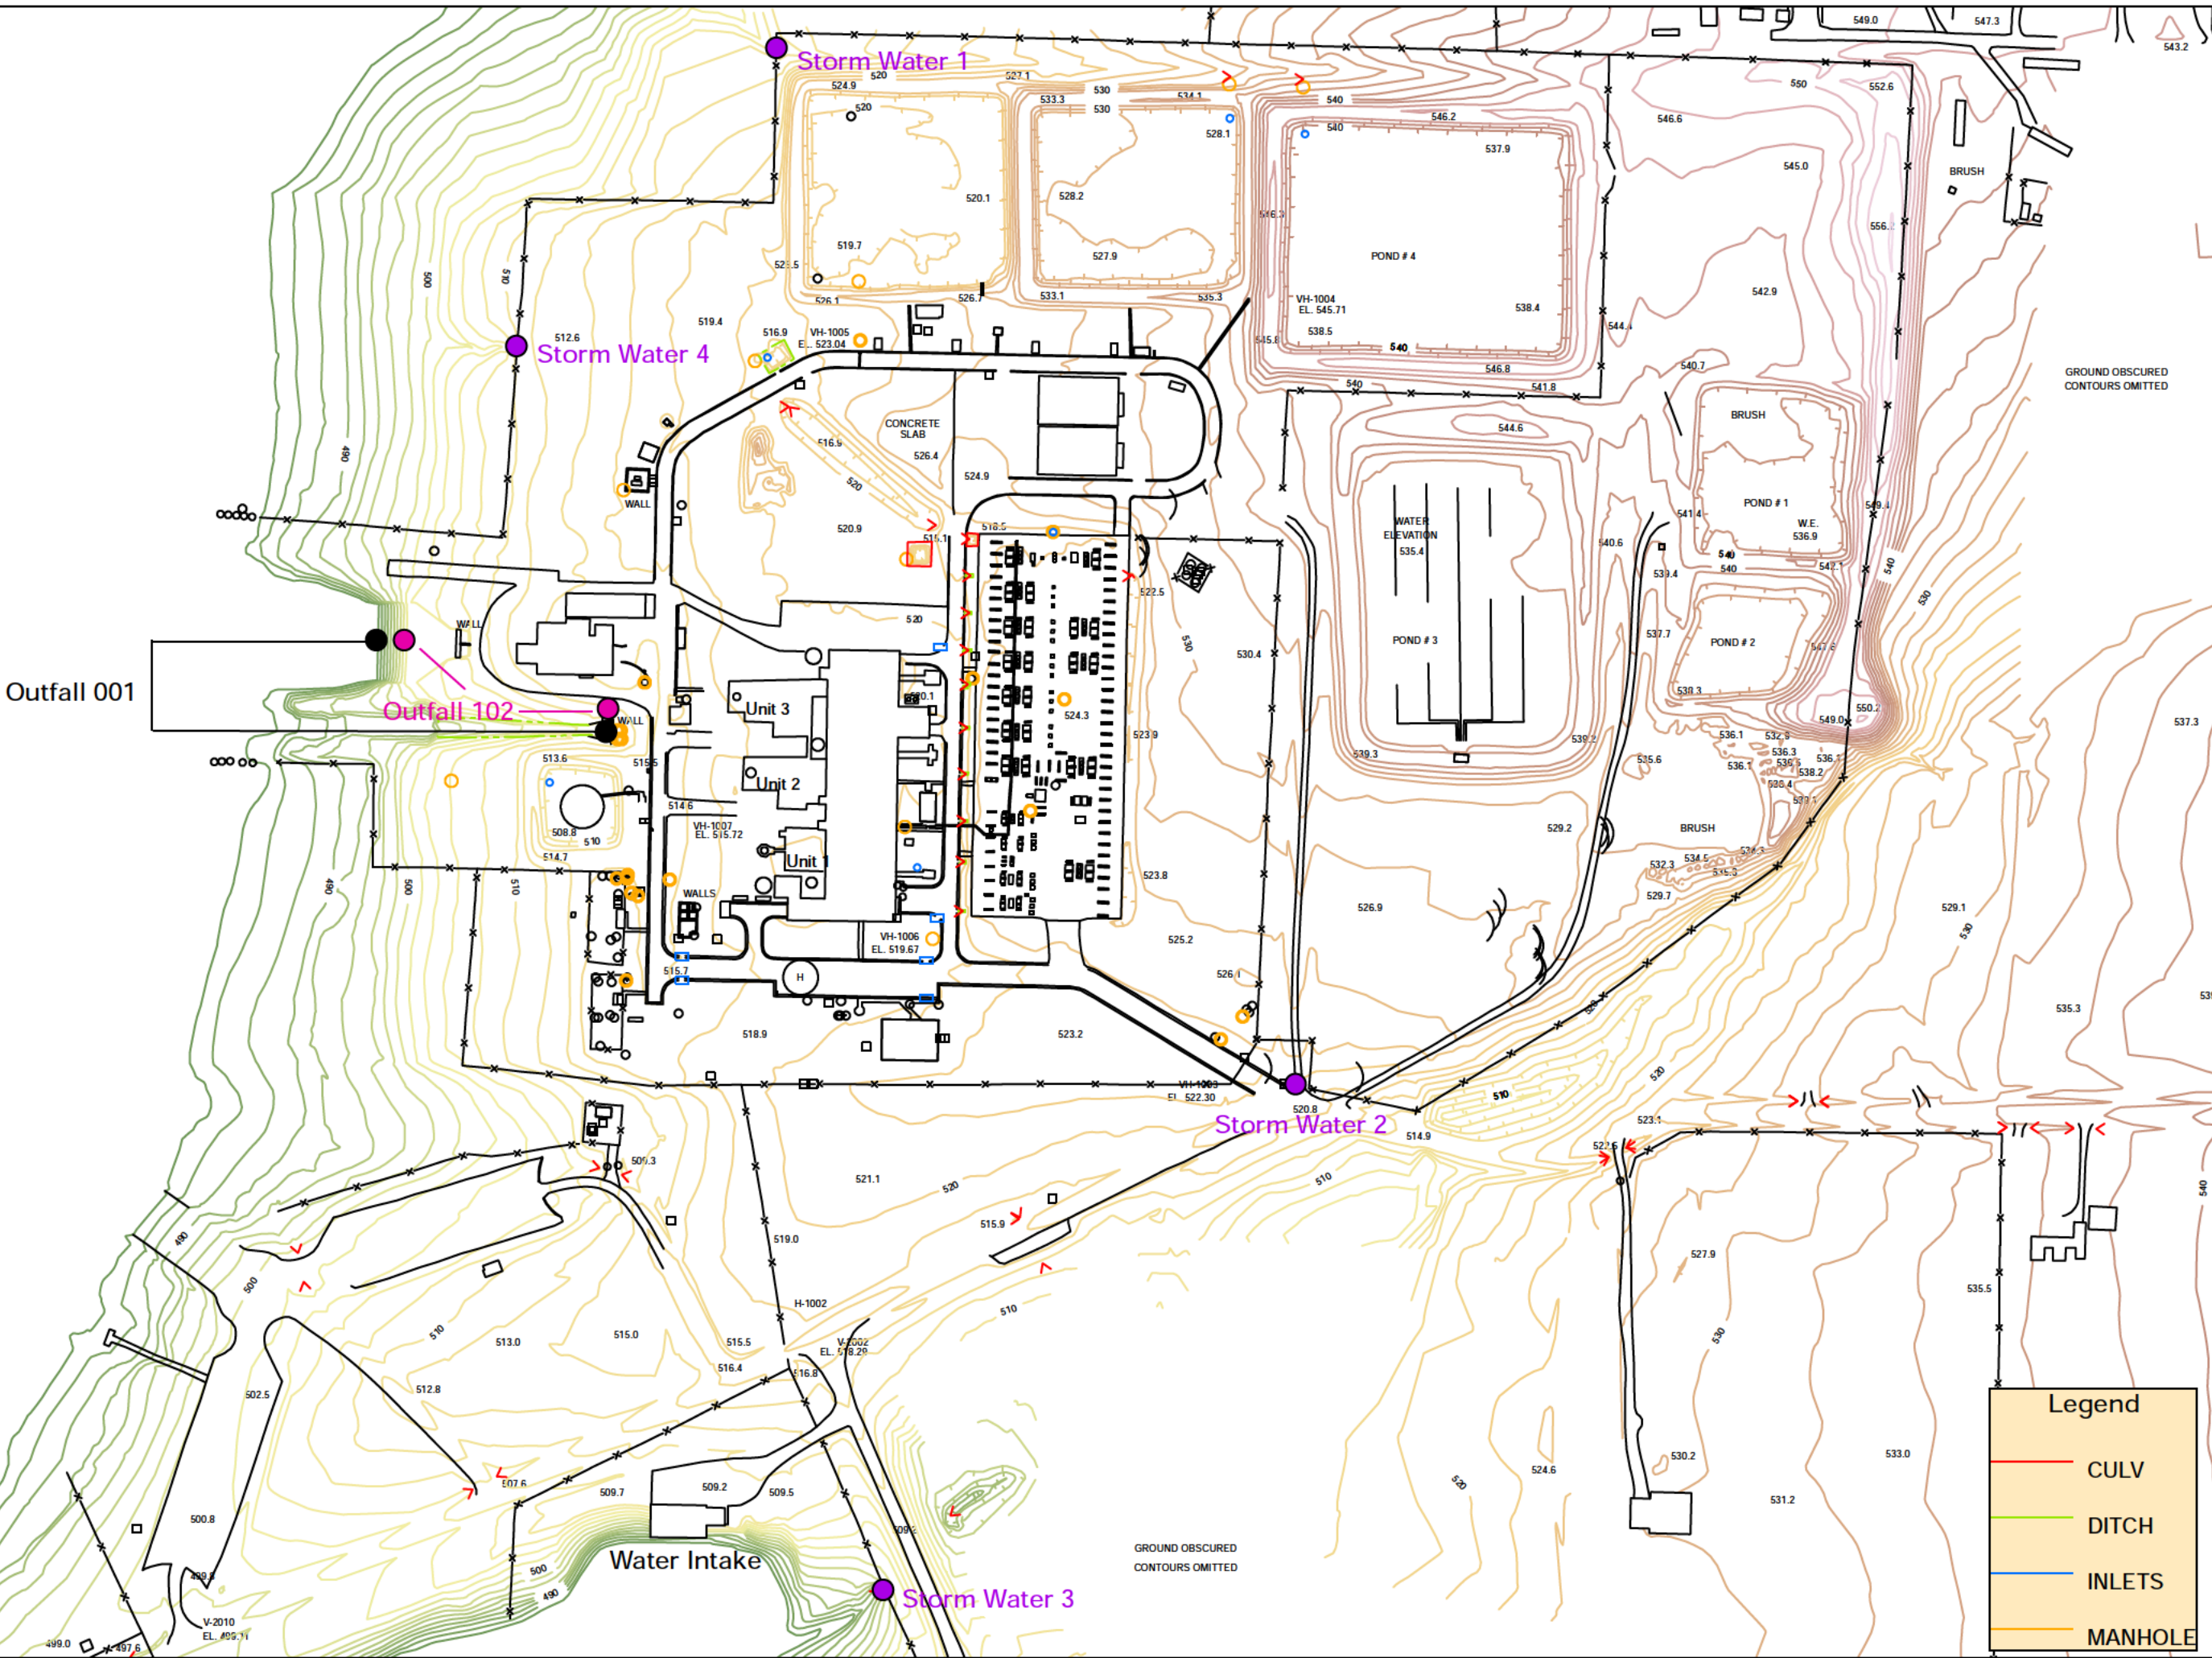


Legend

- CULV
- DITCH
- INLETS
- MANHOLE

# **ATTACHMENT TR-2**

## Flow Schematic

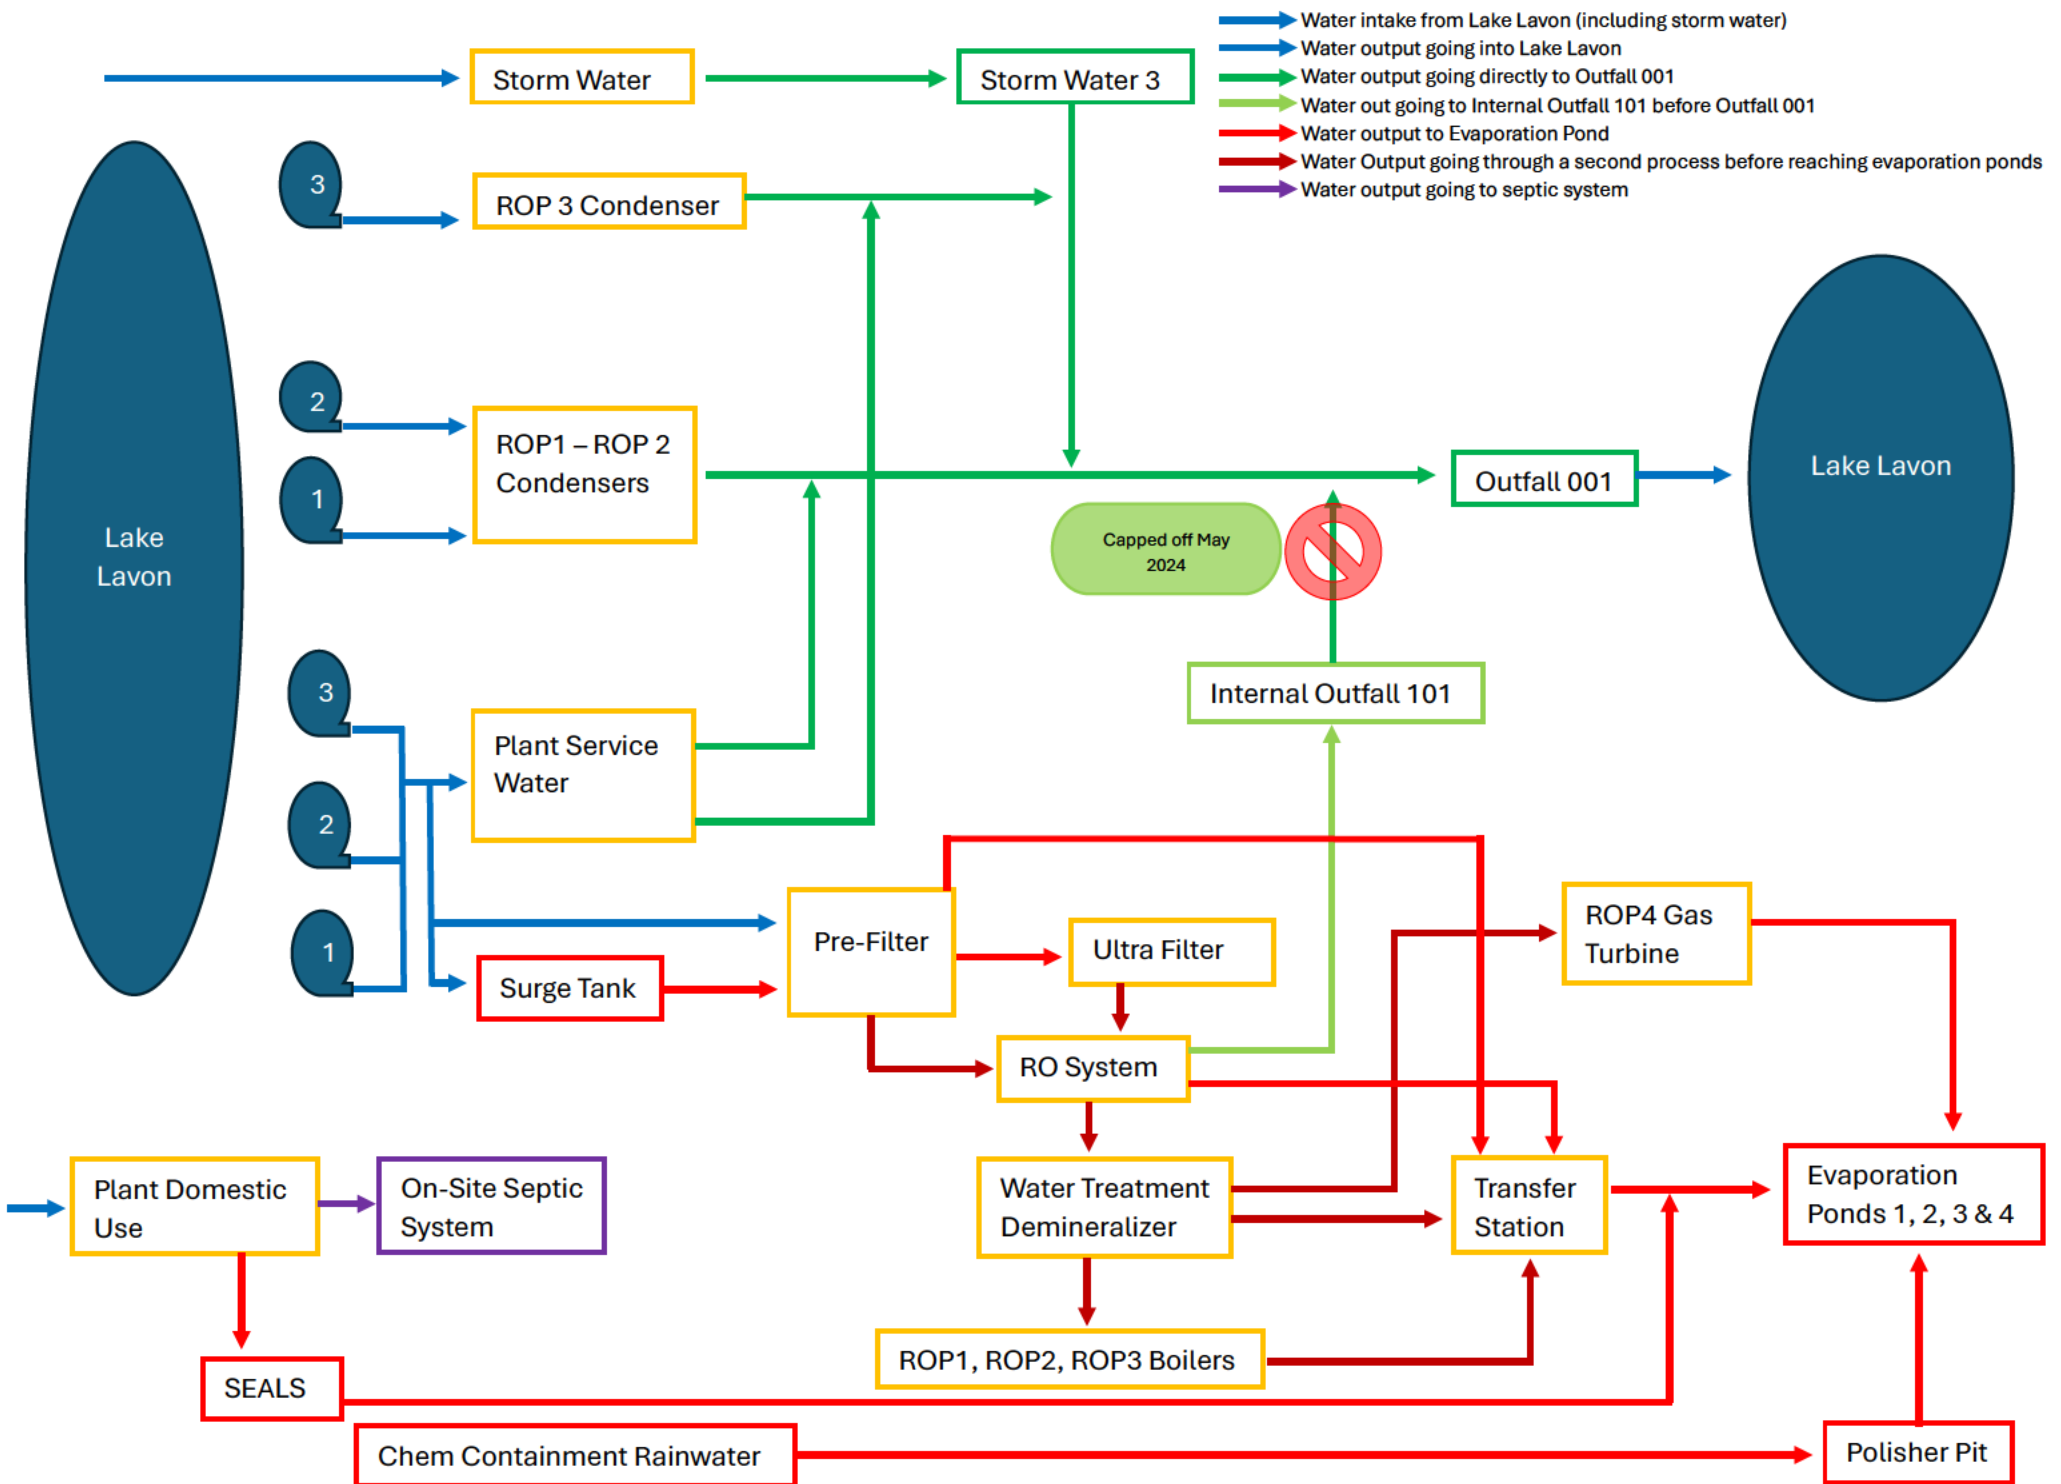

# **ATTACHMENT TR-3**

SDS

## **Technical Report 1.0**

### **Industrial**

#### **Section 5.c. Blowdown and Once-Through Cooling Water Discharges**

Product Identification: Disodium Phosphate Anhydrous

Product Use: pH control and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 7558-79-4

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Twice a week

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Trisodium Phosphate Anhydrous

Product Use: pH control and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 7601-54-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Morpholine <35%

Product Use: pH control and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 110-91-8

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Hydroquinone <10%

Product Use: oxygen scavenger and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 123-31-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Hydrate Line >95% slaked Line, Calcium Hydroxide

Product Use: Used to elevate pH in makeup water to precipitate calcium, magnesium and other impurities for water purification. Waste would be blown down to waster pit and pumped to evaporation pond.

CAS Number: 1305-78-8

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS



## **Technical Report 1.0**

### **Industrial**

#### **Section 5.c. Blowdown and Once-Through Cooling Water Discharges**

Product Identification: Bleach 10%, sodium hypochlorite

Product Use: bacterial algae control in once through condensers, reduced with ammonium bisulfate when discharged.

CAS Number: 7681-52-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Three times a week

Product Toxicity to Fish or Aquatic Invertebrate Organisms: product may be toxic to aquatic life in immediate area of accidental spill according to MSDS

Product Identification: Ammonium Bisulfite 45-70%

Product Use: Product used to reduce residual and total chlorine in once through condensers

CAS Number: 10192-30-0

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Three times a week

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Use: Product is used to regenerate cation beds of demineralizer for water purification. Waste is drained to waste pit and pumped to evaporation pond.

CAS Number: 7664-93-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Sodium Hydroxide 50%

Product Use: Product used to regenerate anion beds of the demineralizer used in water purification. The waste is drained into the waste pit and pumped to the evaporation pond.

CAS Number: 1310-73-2

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

# **ATTACHMENT TR-4**

## Lab Reports

**Garland Power & Light**

Sample Delivery Group: L1754191

Samples Received: 07/08/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By:



Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1754191-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	17
Wet Chemistry by Method 351.2	18
Wet Chemistry by Method 353.2	19
Wet Chemistry by Method 360.1	20
Wet Chemistry by Method 4500Cl G-2011	21
Wet Chemistry by Method 4500CN-E	22
Wet Chemistry by Method 4500P-E	23
Wet Chemistry by Method 4500-S2 D	24
Wet Chemistry by Method 4500SO3 B-2011	25
Wet Chemistry by Method 5210 B-2016	26
Wet Chemistry by Method 5220D	28
Wet Chemistry by Method 5310C	29
Wet Chemistry by Method 5540C	30
Wet Chemistry by Method SM 4500-H+B	31
Wet Chemistry by Method SM4500NH3H	32
Mercury by Method 245.1	33
Metals (ICP) by Method 200.7	34
Metals (ICPMS) by Method 200.8	35
Volatile Organic Compounds (GC/MS) by Method 624.1	38
Polychlorinated Biphenyls (GC) by Method EPA-608.3	41
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	42
Gl: Glossary of Terms	45
Al: Accreditations & Locations	46
Sc: Sample Chain of Custody	47

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc

# SAMPLE SUMMARY

OUTFALL 001 L1754191-01 WW

Collected by

Collected date/time

Received date/time

07/06/24 23:09

07/08/24 09:51

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2317944	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Calculated Results	WG2323027	1	07/15/24 20:10	07/15/24 20:10	EIG	Allen, TX
Gravimetric Analysis by Method 2540C	WG2320714	1	07/10/24 16:26	07/10/24 17:12	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2320499	1	07/10/24 13:12	07/10/24 16:33	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2319853	1	07/11/24 09:09	07/11/24 15:24	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2320288	1	07/10/24 10:40	07/10/24 10:40	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2319489	1	07/09/24 09:39	07/09/24 09:39	SEN	Allen, TX
Wet Chemistry by Method 300.0	WG2320313	1	07/10/24 21:19	07/10/24 21:19	JDG	Mt. Juliet, TN
Wet Chemistry by Method 3500Cr-B	WG2322157	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Wet Chemistry by Method 351.2	WG2323027	1	07/15/24 11:10	07/15/24 20:10	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2321792	1	07/12/24 12:54	07/12/24 12:54	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2324067	1	07/16/24 14:05	07/16/24 14:05	JBS	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2322664	1	07/14/24 12:14	07/14/24 12:14	CAH	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2321047	1	07/11/24 11:30	07/11/24 16:58	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2323646	1	07/16/24 16:14	07/16/24 16:14	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2319455	1	07/10/24 10:11	07/10/24 10:11	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2319662	1	07/09/24 15:00	07/09/24 15:00	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2323050	1	07/15/24 11:20	07/15/24 11:20	JAR	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2319171	1	07/08/24 15:09	07/13/24 09:39	SEN	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2319172	1	07/08/24 15:30	07/13/24 10:03	SEN	Allen, TX
Wet Chemistry by Method 5220D	WG2319514	1	07/09/24 09:59	07/09/24 12:02	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2320357	2	07/11/24 20:39	07/11/24 20:39	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2319936	1	07/09/24 18:54	07/09/24 19:02	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2321035	1	07/11/24 09:01	07/11/24 09:01	JBS	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2321326	1	07/11/24 16:41	07/11/24 16:41	EIG	Allen, TX
Mercury by Method 245.1	WG2320254	1	07/10/24 09:46	07/10/24 16:05	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2320626	1	07/10/24 16:30	07/11/24 15:39	SKW	Allen, TX
Metals (ICPMS) by Method 200.8	WG2317944	1	07/09/24 13:25	07/10/24 21:56	NA	Allen, TX
Metals (ICPMS) by Method 200.8	WG2317944	1	07/09/24 13:25	07/11/24 17:29	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2319924	1	07/09/24 18:02	07/09/24 18:02	NSR	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2322292	1	07/13/24 19:04	07/14/24 06:14	LJD	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2320434	1	07/10/24 12:55	07/13/24 15:45	XLY	Allen, TX

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager

## Sample Delivery Group (SDG) Narrative

The following analysis were performed from an unpreserved, insufficiently or inadequately preserved sample.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	4500-S2 D, 4500CN-E

The Laboratory is not accredited for specific analytes on the associated Sample/Method. These analytes are flagged in the Sample Results section of the report with an asterisk (\*).


<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	300.0

Analysis was filtered in the laboratory.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B

No extra volume received to perform Matrix Spike samples.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	625.1



Calculated Results

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Trivalent	0.000525	J	0.000510	0.00300	1	07/12/2024 19:03	WG2317944
Organic Nitrogen	1.03		0.0280	0.100	1	07/15/2024 20:10	WG2323027

Cp

Tc

Ss

Cn

Sr

Qc

Gl

Al

Sc

Gravimetric Analysis by Method 2540C

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Total Dissolved Solids	184		25.0	1	07/10/2024 17:12	WG2320714

Gravimetric Analysis by Method 2540D

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Suspended Solids	5.93		2.65	1	07/10/2024 16:33	WG2320499

Wet Chemistry by Method 1664A

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Oil & Grease (Hexane Extr)	0.780	J	0.350	5.00	1	07/11/2024 15:24	WG2319853

Wet Chemistry by Method 2120B

Analyte	Result units	Qualifier	RDL units	Dilution	Analysis date / time	Batch
Color	20.0	T8	5.00	1	07/10/2024 10:40	WG2320288

Sample Narrative:  
L1754191-01 WG2320288: 7

Wet Chemistry by Method 2320B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Alkalinity	110		20.0	20.0	1	07/09/2024 09:39	WG2319489

Wet Chemistry by Method 300.0

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
*Bromide	0.914	J	0.353	1.00	1	07/10/2024 21:19	WG2320313
Chloride	15.4		0.379	1.00	1	07/10/2024 21:19	WG2320313
Fluoride	0.177		0.0640	0.150	1	07/10/2024 21:19	WG2320313
Nitrate as (N)	U	Q	0.0480	0.100	1	07/10/2024 21:19	WG2320313
Sulfate	27.1		0.594	5.00	1	07/10/2024 21:19	WG2320313

Wet Chemistry by Method 3500Cr-B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Hexavalent	U	T8	0.00200	0.00300	1	07/12/2024 19:03	WG2322157

Wet Chemistry by Method 351.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Kjeldahl Nitrogen, TKN	1.03	J5	0.140	0.250	1	07/15/2024 20:10	WG2323027



## OUTFALL 001

Collected date/time: 07/06/24 23:09

## SAMPLE RESULTS - 01

L1754191

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	07/12/2024 12:54	<a href="#">WG2321792</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	8.77	<a href="#">T8</a>	1	1	1	07/16/2024 14:05	<a href="#">WG2324067</a>

## Wet Chemistry by Method 4500CI G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.0330	<a href="#">J T8</a>	0.0260	0.100	1	07/14/2024 12:14	<a href="#">WG2322664</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/11/2024 16:58	<a href="#">WG2321047</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00350	0.0100	1	07/16/2024 16:14	WG2323646

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.101		0.0152	0.0500	1	07/10/2024 10:11	<a href="#">WG2319455</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/09/2024 15:00	<a href="#">WG2319662</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	07/15/2024 11:20	<a href="#">WG2323050</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	1.67		1.00	1	1	07/13/2024 09:39	<a href="#">WG2319171</a>
CBOD	1.75		1.00	1	1	07/13/2024 10:03	<a href="#">WG2319172</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	25.4	<a href="#">J</a>	16.1	35.0	1	07/09/2024 12:02	<a href="#">WG2319514</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------



Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	11.5		0.540	1.40	2	07/11/2024 20:39	<a href="#">WG2320357</a>

1  
Cp

2  
Tc

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">T8</a>	0.360	0.500	1	07/09/2024 19:02	<a href="#">WG2319936</a>

3  
Ss

4  
Cn

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	8.21	<a href="#">T8</a>	1	07/11/2024 09:01	<a href="#">WG2321035</a>

5  
Sr

6  
Qc

Sample Narrative:

L1754191-01 WG2321035: 8.21 at 19.1C

7  
Gl

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	U		0.0280	0.100	1	07/11/2024 16:41	<a href="#">WG2321326</a>

8  
Al

9  
Sc

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	0.0000780	<a href="#">B J</a>	0.0000450	0.000200	1	07/10/2024 16:05	<a href="#">WG2320254</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0707	<a href="#">J</a>	0.0186	0.100	1	07/11/2024 15:39	<a href="#">WG2320626</a>
Tin	U		0.00240	0.0250	1	07/11/2024 15:39	<a href="#">WG2320626</a>
Titanium	U		0.00835	0.100	1	07/11/2024 15:39	<a href="#">WG2320626</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.0984		0.00186	0.00250	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Antimony	U		0.000580	0.00500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Arsenic	0.00448		0.000100	0.000500	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Barium	0.0393		0.000440	0.00300	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Beryllium	0.0000935	<a href="#">J</a>	0.0000600	0.000500	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Cadmium	U		0.000120	0.00100	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Chromium	0.000525	<a href="#">J</a>	0.000510	0.00300	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Cobalt	0.000210	<a href="#">B J</a>	0.0000400	0.000300	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Copper	0.00618		0.000900	0.00200	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Iron	0.0935		0.00432	0.00700	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Lead	U		0.000140	0.000500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Magnesium	3.62		0.0121	0.0200	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Manganese	0.0324		0.000330	0.000500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Molybdenum	0.000963	<a href="#">J</a>	0.000530	0.00100	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Nickel	0.00166	<a href="#">J</a>	0.000640	0.00200	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Selenium	U		0.000740	0.00500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Silver	U		0.0000800	0.000500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Thallium	0.000363	<a href="#">J</a>	0.000190	0.000500	1	07/11/2024 17:29	<a href="#">WG2317944</a>

## OUTFALL 001

Collected date/time: 07/06/24 23:09

## SAMPLE RESULTS - 01

L1754191

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	0.00602		0.00265	0.00500	1	07/11/2024 17:29	<a href="#">WG2317944</a>

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
2-Butanone (MEK)	U		0.00822	0.0250	1	07/09/2024 18:02	<a href="#">WG2319924</a>
2-Chloroethyl vinyl ether	U	<a href="#">J6</a>	0.00652	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Acrolein	U		0.00544	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Acrylonitrile	U		0.00709	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Benzene	U		0.00207	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Bromoform	U		0.000960	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Bromomethane	U		0.00347	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chlorobenzene	U		0.00276	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chloroethane	U		0.00296	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chloroform	U		0.00212	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chloromethane	U		0.00361	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Ethylbenzene	U		0.000401	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Methylene Chloride	U		0.0117	0.0200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Toluene	U		0.00219	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Trichloroethene	U		0.00262	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Vinyl chloride	U		0.00466	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
(S) 1,2-Dichloroethane-d4	93.9			70.0-130		07/09/2024 18:02	<a href="#">WG2319924</a>
(S) 4-Bromofluorobenzene	94.4			70.0-130		07/09/2024 18:02	<a href="#">WG2319924</a>
(S) Toluene-d8	97.8			70.0-130		07/09/2024 18:02	<a href="#">WG2319924</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1221	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1232	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1242	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1248	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1254	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1260	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
Total PCBs	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
(S) Decachlorobiphenyl	31.2			10.0-144		07/14/2024 06:14	<a href="#">WG2322292</a>
(S) Tetrachloro-m-xylene	60.3			10.0-135		07/14/2024 06:14	<a href="#">WG2322292</a>

## OUTFALL 001


Collected date/time: 07/06/24 23:09

## SAMPLE RESULTS - 01

L1754191

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2-Chlorophenol	U		0.000307	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2-Methylphenol	U		0.000238	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2-Nitrophenol	U		0.000247	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	07/13/2024 15:45	<a href="#">WG2320434</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
4-Nitrophenol	U		0.00123	0.0100	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Anthracene	U		0.000168	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Benzidine	U		0.000350	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Chrysene	U		0.000257	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachlorobenzene	U		0.000307	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachloroethane	U		0.000247	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Nitrobenzene	U		0.000314	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Nonylphenol	U		0.000168	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Pentachlorobenzene	U		0.000247	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Pentachlorophenol	U		0.000283	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Phenanthrene	U		0.000200	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Phenol	U		0.000500	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Pyridine	U		0.00174	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Total Cresols	U		0.00153	0.00800	1	07/13/2024 15:45	<a href="#">WG2320434</a>
(S) 2,4,6-Tribromophenol	49.6			29.0-132		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) 2-Fluorobiphenyl	76.0			26.0-102		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) 2-Fluorophenol	67.0	<u>J1</u>		10.0-66.0		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) Nitrobenzene-d5	75.5			15.0-106		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) p-Terphenyl-d14	84.5			10.0-120		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) Phenol-D6	61.0	<u>J1</u>		10.0-54.0		07/13/2024 15:45	<a href="#">WG2320434</a>



Method Blank (MB)

(MB) R4092654-1 07/10/24 17:12

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Total Dissolved Solids	U		25.0	25.0

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/10/24 17:12 • (DUP) R4092654-3 07/10/24 17:12

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	184	196	1	6.32		10

Laboratory Control Sample (LCS)

(LCS) R4092654-2 07/10/24 17:12

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Total Dissolved Solids	2410	2410	100	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092588-1 07/10/24 16:33

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
Suspended Solids	U		2.50	2.50

Laboratory Control Sample (LCS)

(LCS) R4092588-2 07/10/24 16:33

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Suspended Solids	879	803	91.4	85.0-115	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093012-1 07/11/24 15:24

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4093012-2 07/11/24 15:24 • (LCSD) R4093012-3 07/11/24 15:24

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	35.1	36.2	87.8	90.5	78.0-114			3.09	18

L1753541-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1753541-02 07/11/24 15:24 • (MS) R4093012-4 07/11/24 15:24

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	36.8	92.0	1	78.0-114	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092474-1 07/10/24 10:40

Analyte	MB Result units	<u>MB Qualifier</u>	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:  
BLANK: 7

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/10/24 10:40 • (DUP) R4092474-2 07/10/24 10:40

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	<u>DUP Qualifier</u>	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:  
OS: 7  
DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091456-1 07/09/24 09:39

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/09/24 09:39 • (DUP) R4091456-3 07/09/24 09:39

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	110	113	1	2.25		20

Laboratory Control Sample (LCS)

(LCS) R4091456-2 07/09/24 09:39

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	242	96.8	90.0-110	

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc



Method Blank (MB)

(MB) R4093158-1 07/10/24 19:59

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.353	1.00
Chloride	U		0.379	1.00
Fluoride	U		0.0640	0.150
Nitrate as (N)	U		0.0480	0.100
Sulfate	U		0.594	5.00

L1747043-13 Original Sample (OS) • Duplicate (DUP)

(OS) L1747043-13 07/10/24 20:26 • (DUP) R4093158-3 07/10/24 20:39

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	1.84	1.79	1	2.94		15
Chloride	67.4	64.7	1	4.05		15
Fluoride	0.125	0.116	1	7.49	J	15
Nitrate as (N)	2.69	2.58	1	4.08		15
Sulfate	95.6	91.0	1	4.92		15

L1754873-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754873-01 07/11/24 02:15 • (DUP) R4093158-6 07/11/24 02:28

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	0.637	0.595	1	6.79	J	15
Chloride	10.5	10.4	1	1.21		15
Fluoride	0.103	0.142	1	32.4	J P1	15
Nitrate as (N)	U	U	1	0.000		15
Sulfate	142	139	1	1.74		15

Laboratory Control Sample (LCS)

(LCS) R4093158-2 07/10/24 20:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	40.0	40.4	101	90.0-110	
Chloride	40.0	40.3	101	90.0-110	
Fluoride	8.00	8.11	101	90.0-110	
Nitrate as (N)	8.00	7.79	97.4	90.0-110	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4093158-2 07/10/24 20:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Sulfate	40.0	40.9	102	90.0-110	

L1747043-13 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1747043-13 07/10/24 20:26 • (MS) R4093158-4 07/10/24 20:53 • (MSD) R4093158-5 07/10/24 21:06

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Bromide	40.0	1.84	41.2	40.7	98.4	97.2	1	80.0-120			1.19	15
Chloride	40.0	67.4	93.0	91.9	64.0	61.4	1	80.0-120	J6	J6	1.12	15
Fluoride	8.00	0.125	8.34	7.99	103	98.4	1	80.0-120			4.18	15
Nitrate as (N)	8.00	2.69	10.1	9.98	92.6	91.1	1	80.0-120			1.15	15
Sulfate	40.0	95.6	115	112	48.9	42.2	1	80.0-120	J6	J6	2.36	15

L1754873-01 Original Sample (OS) • Matrix Spike (MS)

(OS) L1754873-01 07/11/24 02:15 • (MS) R4093158-7 07/11/24 02:42

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>
Bromide	40.0	0.637	40.6	99.9	1	80.0-120	
Chloride	40.0	10.5	48.9	96.1	1	80.0-120	
Fluoride	8.00	0.103	8.07	99.5	1	80.0-120	
Nitrate as (N)	8.00	U	8.83	110	1	80.0-120	
Sulfate	40.0	142	149	17.3	1	80.0-120	J6

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093286-1 07/12/24 19:03

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

Laboratory Control Sample (LCS)

(LCS) R4093286-2 07/12/24 19:03

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.195	97.7	85.0-115	

L1756127-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756127-01 07/12/24 19:03 • (MS) R4093286-3 07/12/24 19:03 • (MSD) R4093286-4 07/12/24 19:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.204	0.202	102	101	1	10.0-120			0.842	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4094061-1 07/15/24 20:06

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Kjeldahl Nitrogen, TKN	U		0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4094061-2 07/15/24 20:07

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Kjeldahl Nitrogen, TKN	4.00	4.27	107	90.0-110	

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/15/24 20:10 • (MS) R4094061-3 07/15/24 20:44 • (MSD) R4094061-4 07/15/24 20:45

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	4.00	1.03	5.64	6.51	115	137	1	90.0-110	J5	J5	14.3	20

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 20:11 • (MS) R4094061-5 07/15/24 20:46 • (MSD) R4094061-6 07/15/24 20:48

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	4.00	0.343	4.88	4.63	113	107	1	90.0-110	J5		5.26	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093045-1 07/12/24 12:50

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4093045-2 07/12/24 12:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Nitrate-Nitrite	2.50	2.40	96.0	90.0-110	

L1754182-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754182-01 07/12/24 12:51 • (MS) R4093045-3 07/12/24 12:59 • (MSD) R4093045-4 07/12/24 13:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	0.794	3.13	3.11	93.4	92.6	1	90.0-110			0.641	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/16/24 14:05 • (DUP) R4094367-1 07/16/24 14:05

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	<u>DUP Qualifier</u>	DUP RPD Limits %
Dissolved Oxygen	7.77	8.25	1	5.99		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093561-1 07/14/24 11:59

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chlorine,residual	U		0.0260	0.100

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/14/24 12:14 • (DUP) R4093561-3 07/14/24 12:15

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Chlorine,residual	0.0330	0.0340	1	2.99	J	20

Laboratory Control Sample (LCS)

(LCS) R4093561-2 07/14/24 12:13

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chlorine,residual	1.00	0.960	96.0	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092740-1 07/11/24 16:58

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4092740-2 07/11/24 16:58

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Cyanide	0.100	0.0908	90.8	85.0-115	

L1754359-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754359-01 07/11/24 16:58 • (MS) R4092740-3 07/11/24 16:58 • (MSD) R4092740-4 07/11/24 16:58

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	U	0.0928	0.0928	92.8	92.8	1	85.0-115			0.000	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc



Method Blank (MB)

(MB) R4091941-1 07/10/24 10:09

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4091941-2 07/10/24 10:09

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phosphorus,Total	0.500	0.522	104	80.0-120	

L1753186-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753186-01 07/10/24 10:09 • (MS) R4091941-3 07/10/24 10:11 • (MSD) R4091941-4 07/10/24 10:11

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	2.51	2.70	2.79	38.4	55.9	5	80.0-120	V	V	3.18	20

L1753974-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753974-01 07/10/24 10:10 • (MS) R4091941-5 07/10/24 10:11 • (MSD) R4091941-6 07/10/24 10:11

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.0327	0.564	0.548	106	103	1	80.0-120			2.93	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091612-1 07/09/24 15:00

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4091612-2 07/09/24 15:00

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Sulfide	0.800	0.850	106	80.0-120	

L1753522-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753522-01 07/09/24 15:00 • (MS) R4091612-3 07/09/24 15:03 • (MSD) R4091612-4 07/09/24 15:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Sulfide	0.800	U	0.772	0.769	96.5	96.1	1	80.0-120			0.453	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093789-1 07/15/24 11:20

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/15/24 11:20 • (DUP) R4093789-3 07/15/24 11:20

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	U	U	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4093789-2 07/15/24 11:20

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 11:20 • (MS) R4093789-4 07/15/24 11:20 • (MSD) R4093789-5 07/15/24 11:20

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	19.0	18.5	95.0	92.5	1	85.0-115			2.67	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093354-1 07/13/24 09:30

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
BOD	U		0.200	0.200

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

L1754142-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754142-01 07/13/24 09:40 • (DUP) R4093354-3 07/13/24 09:44

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
BOD	349	332	1	5.11		20

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

Laboratory Control Sample (LCS)

(LCS) R4093354-2 07/13/24 09:36

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
BOD	198	188	95	85-115	

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093367-1 07/13/24 09:54

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
CBOD	U		0.200	0.200

L1754163-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1754163-02 07/13/24 10:21 • (DUP) R4093367-3 07/13/24 10:22

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
CBOD	1.57	1.62	1	3.13		20

Laboratory Control Sample (LCS)

(LCS) R4093367-2 07/13/24 09:59

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
CBOD	198	189	95.3	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091496-1 07/09/24 12:02

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

Laboratory Control Sample (LCS)

(LCS) R4091496-2 07/09/24 12:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
COD	500	509	102	80.0-120	

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/09/24 12:02 • (MS) R4091496-3 07/09/24 12:02 • (MSD) R4091496-4 07/09/24 12:02

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
COD	500	25.4	526	532	100	101	1	80.0-120			1.20	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092962-1 07/11/24 16:22

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4092962-2 07/11/24 16:42

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
TOC (Total Organic Carbon)	10.0	10.4	104	90.0-110	

L1754776-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754776-01 07/11/24 17:08 • (MS) R4092962-3 07/11/24 17:54 • (MSD) R4092962-4 07/11/24 18:14

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
TOC (Total Organic Carbon)	100	30.8	127	127	96.3	96.3	10	80.0-120			0.000	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092475-1 07/09/24 19:02

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4092475-2 07/09/24 19:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
MBAS	1.00	1.17	117	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/09/24 19:02 • (MS) R4092475-3 07/09/24 19:02 • (MSD) R4092475-4 07/09/24 19:02

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
MBAS	1.00	U	1.20	1.25	120	125	1	80.0-120		J5	3.87	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc



L1754340-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754340-01 07/11/24 09:01 • (DUP) R4092476-2 07/11/24 09:01

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	su	su		%		%
pH	7.61	7.62	1	0.131		20

Sample Narrative:  
OS: 7.61 at 19.6C  
DUP: 7.62 at 19.3C

Laboratory Control Sample (LCS)

(LCS) R4092476-1 07/11/24 09:01

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	su	su	%	%	
pH	6.00	5.99	99.8	99.0-101	

Sample Narrative:  
LCS: 5.99 at 22C

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092766-1 07/11/24 16:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	0.0285	⬇	0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4092766-2 07/11/24 16:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.28	106	80.0-120	

L1754163-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754163-02 07/11/24 16:39 • (MS) R4092766-3 07/11/24 16:32 • (MSD) R4092766-4 07/11/24 16:34

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.369	5.44	5.43	101	101	1	80.0-120			0.184	20

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/11/24 16:41 • (MS) R4092766-5 07/11/24 16:36 • (MSD) R4092766-6 07/11/24 16:37

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	U	5.12	5.15	102	103	1	80.0-120			0.584	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092198-3 07/10/24 16:35

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Mercury	0.0000450	J	0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4092198-4 07/10/24 16:37

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Mercury	0.00250	0.00227	90.8	85.0-115	

L1753552-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753552-01 07/10/24 16:40 • (MS) R4092198-5 07/10/24 16:42 • (MSD) R4092198-6 07/10/24 16:44

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	0.0000520	0.00170	0.00171	65.9	66.3	1	70.0-130	J6	J6	0.587	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092733-2 07/11/24 13:15

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4092733-1 07/11/24 13:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.962	96.2	85.0-115	
Tin	1.00	0.999	99.9	85.0-115	
Titanium	1.00	0.996	99.6	85.0-115	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092396-1 07/10/24 19:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Antimony	U		0.000580	0.00500
Arsenic	0.000137	U	0.000100	0.000500
Barium	U		0.000440	0.00300
Beryllium	U		0.0000600	0.000500
Cadmium	U		0.000120	0.00100
Chromium	U		0.000510	0.00300
Cobalt	0.0000413	U	0.0000400	0.000300
Iron	0.00498	U	0.00432	0.00700
Lead	U		0.000140	0.000500
Magnesium	U		0.0121	0.0200
Manganese	0.000528		0.000330	0.000500
Molybdenum	U		0.000530	0.00100
Nickel	U		0.000640	0.00200
Selenium	U		0.000740	0.00500
Silver	U		0.0000800	0.000500

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092655-1 07/11/24 14:06

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Aluminum	0.00824		0.00186	0.00250
Copper	U		0.000900	0.00200
Thallium	U		0.000190	0.000500
Zinc	U		0.00265	0.00500

Laboratory Control Sample (LCS)

(LCS) R4092396-2 07/10/24 19:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Antimony	0.100	0.0953	95.3	85.0-115	
Arsenic	0.100	0.0925	92.5	85.0-115	
Barium	0.100	0.0975	97.5	85.0-115	
Beryllium	0.100	0.0906	90.6	85.0-115	
Cadmium	0.100	0.0946	94.6	85.0-115	
Chromium	0.100	0.0950	95.0	85.0-115	
Cobalt	0.100	0.0927	92.7	85.0-115	
Iron	1.00	0.940	94.0	85.0-115	

Laboratory Control Sample (LCS)

(LCS) R4092396-2 07/10/24 19:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Lead	0.100	0.0928	92.8	85.0-115	
Magnesium	1.00	0.959	95.9	85.0-115	
Manganese	0.100	0.0958	95.8	85.0-115	
Molybdenum	0.100	0.0960	96.0	85.0-115	
Nickel	0.100	0.0908	90.8	85.0-115	
Selenium	0.100	0.0938	93.8	85.0-115	
Silver	0.0500	0.0477	95.3	85.0-115	

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

Laboratory Control Sample (LCS)

(LCS) R4092655-2 07/11/24 14:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Aluminum	1.00	0.973	97.3	85.0-115	
Copper	0.100	0.102	102	85.0-115	
Thallium	0.100	0.0921	92.1	85.0-115	
Zinc	0.100	0.0972	97.2	85.0-115	

L1752768-10 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1752768-10 07/10/24 20:10 • (MS) R4092396-3 07/10/24 20:16 • (MSD) R4092396-4 07/10/24 20:22

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Antimony	0.100	0.000718	0.0936	0.0921	92.9	91.3	1	70.0-130			1.66	20
Arsenic	0.100	0.00198	0.0912	0.0924	89.2	90.4	1	70.0-130			1.35	20
Barium	0.100	0.0649	0.156	0.157	90.8	91.7	1	70.0-130			0.574	20
Beryllium	0.100	U	0.0895	0.0896	89.5	89.6	1	70.0-130			0.215	20
Cadmium	0.100	U	0.0859	0.0894	85.9	89.4	1	70.0-130			3.93	20
Chromium	0.100	0.000624	0.0883	0.0890	87.7	88.3	1	70.0-130			0.752	20
Cobalt	0.100	0.000235	0.0864	0.0882	86.1	88.0	1	70.0-130			2.08	20
Iron	1.00	0.0356	0.891	0.912	85.5	87.6	1	70.0-130			2.33	20
Lead	0.100	U	0.0870	0.0869	87.0	86.9	1	70.0-130			0.0364	20
Magnesium	1.00	14.9	15.1	15.7	16.7	73.0	1	70.0-130	V		3.66	20
Manganese	0.100	0.0249	0.110	0.113	84.9	88.6	1	70.0-130			3.30	20
Molybdenum	0.100	0.00356	0.0956	0.0981	92.0	94.6	1	70.0-130			2.62	20
Nickel	0.100	0.00232	0.0862	0.0876	83.9	85.2	1	70.0-130			1.59	20
Selenium	0.100	0.00164	0.0918	0.0942	90.2	92.6	1	70.0-130			2.53	20
Silver	0.0500	U	0.0443	0.0452	88.5	90.4	1	70.0-130			2.12	20

L1753977-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753977-02 07/10/24 21:31 • (MS) R4092396-5 07/10/24 21:38 • (MSD) R4092396-6 07/10/24 21:44

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Antimony	0.100	U	0.103	0.0995	103	99.5	1	70.0-130			3.92	20
Barium	0.100	0.0577	0.162	0.157	104	99.2	1	70.0-130			3.09	20
Cadmium	0.100	U	0.102	0.0985	102	98.5	1	70.0-130			3.77	20
Chromium	0.100	0.00109	0.105	0.102	104	101	1	70.0-130			3.07	20
Lead	0.100	0.000216	0.101	0.0982	101	98.0	1	70.0-130			2.79	20
Manganese	0.100	0.171	0.274	0.268	103	97.6	1	70.0-130			2.02	20
Molybdenum	0.100	0.00727	0.113	0.110	105	103	1	70.0-130			2.31	20
Selenium	0.100	U	0.0945	0.105	94.5	105	1	70.0-130			10.0	20
Silver	0.0500	U	0.0507	0.0494	101	98.8	1	70.0-130			2.50	20

L1752768-10 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1752768-10 07/11/24 14:31 • (MS) R4092655-3 07/11/24 14:37 • (MSD) R4092655-4 07/11/24 14:43

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Aluminum	1.00	0.0394	0.972	0.996	93.3	95.7	1	70.0-130			2.43	20
Copper	0.100	0.00526	0.102	0.104	97.1	98.3	1	70.0-130			1.17	20
Thallium	0.100	U	0.0893	0.0923	89.3	92.3	1	70.0-130			3.28	20
Zinc	0.100	0.0484	0.141	0.142	92.3	93.7	1	70.0-130			1.02	20

L1753977-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753977-02 07/11/24 17:03 • (MS) R4092655-5 07/11/24 17:10 • (MSD) R4092655-6 07/11/24 17:17

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Arsenic	0.100	0.00126	0.0982	0.0969	96.9	95.7	1	70.0-130			1.25	20
Beryllium	0.100	U	0.0979	0.0965	97.9	96.5	1	70.0-130			1.45	20
Cobalt	0.100	0.000213	0.0996	0.0988	99.4	98.6	1	70.0-130			0.823	20
Copper	0.100	U	0.101	0.100	101	100	1	70.0-130			0.503	20
Iron	1.00	0.538	1.51	1.47	97.0	93.5	1	70.0-130			2.37	20
Magnesium	1.00	3.86	4.82	4.73	96.1	86.6	1	70.0-130			1.99	20
Nickel	0.100	0.00152	0.102	0.0996	100	98.1	1	70.0-130			2.11	20
Thallium	0.100	U	0.0888	0.0907	88.8	90.7	1	70.0-130			2.15	20
Zinc	0.100	U	0.0953	0.0957	95.3	95.7	1	70.0-130			0.385	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091976-2 07/09/24 17:32

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Butanone (MEK)	U		0.00822	0.0250
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	0.00317	U	0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	93.5			70.0-130
(S) 4-Bromofluorobenzene	99.6			70.0-130
(S) Toluene-d8	97.4			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



Laboratory Control Sample (LCS)

(LCS) R4091976-1 07/09/24 16:24

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0200	0.0201	101	70.0-130	
1,1,2,2-Tetrachloroethane	0.0200	0.0185	92.5	60.0-140	
1,1,2-Trichloroethane	0.0200	0.0190	95.0	70.0-130	
1,1-Dichloroethene	0.0200	0.0195	97.5	50.0-150	
1,1-Dichloroethane	0.0200	0.0203	102	70.0-130	
1,2-Dibromoethane	0.0200	0.0186	93.0	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0203	102	65.0-135	
1,2-Dichloroethane	0.0200	0.0202	101	70.0-130	
1,2-Dichloropropane	0.0200	0.0181	90.5	35.0-165	
1,3-Dichlorobenzene	0.0200	0.0195	97.5	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0192	96.0	65.0-135	
2-Butanone (MEK)	0.100	0.0829	82.9	70.0-130	
2-Chloroethyl vinyl ether	0.100	0.0529	52.9	1.00-225	
Acrolein	0.100	0.105	105	64.0-139	
Acrylonitrile	0.100	0.104	104	67.0-136	
Benzene	0.0200	0.0197	98.5	65.0-135	
Bromodichloromethane	0.0200	0.0203	102	65.0-135	
Bromoform	0.0200	0.0233	117	70.0-130	
Bromomethane	0.0200	0.0329	165	15.0-185	
Carbon tetrachloride	0.0200	0.0216	108	70.0-130	
Chlorobenzene	0.0200	0.0196	98.0	65.0-135	
Chloroethane	0.0200	0.0214	107	40.0-160	
Chloroform	0.0200	0.0207	104	70.0-135	
Chloromethane	0.0200	0.0159	79.5	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0177	88.5	25.0-175	
Dibromochloromethane	0.0200	0.0202	101	70.0-135	
Ethylbenzene	0.0200	0.0197	98.5	60.0-140	
Methylene Chloride	0.0200	0.0221	111	60.0-140	
Tetrachloroethene	0.0200	0.0181	90.5	70.0-130	
Toluene	0.0200	0.0196	98.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0206	103	70.0-130	
Trichloroethene	0.0200	0.0201	101	65.0-135	
Vinyl chloride	0.0200	0.0208	104	5.00-195	
(S) 1,2-Dichloroethane-d4			95.4	70.0-130	
(S) 4-Bromofluorobenzene			91.3	70.0-130	
(S) Toluene-d8			99.6	70.0-130	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/09/24 18:02 • (MS) R4091976-3 07/09/24 18:26 • (MSD) R4091976-4 07/09/24 18:51

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0199	U	0.0200	0.0203	101	102	1	52.0-162			1.49	36
1,1,2,2-Tetrachloroethane	0.0201	U	0.0183	0.0188	91.0	93.5	1	46.0-157			2.70	61
1,1,2-Trichloroethane	0.0199	U	0.0194	0.0193	97.5	97.0	1	52.0-150			0.517	45
1,1-Dichloroethene	0.0200	U	0.0203	0.0203	102	102	1	1.00-234			0.000	32
1,1-Dichloroethane	0.0200	U	0.0214	0.0211	107	105	1	59.0-155			1.41	40
1,2-Dibromoethane	0.0200	U	0.0184	0.0187	92.0	93.5	1	70.0-130			1.62	20
1,2-Dichlorobenzene	0.0200	U	0.0212	0.0213	106	106	1	18.0-190			0.471	57
1,2-Dichloroethane	0.0200	U	0.0208	0.0209	104	105	1	49.0-155			0.480	49
1,2-Dichloropropane	0.0199	U	0.0185	0.0185	93.0	93.0	1	1.00-210			0.000	55
1,3-Dichlorobenzene	0.0199	U	0.0203	0.0205	102	103	1	59.0-156			0.980	43
1,4-Dichlorobenzene	0.0200	U	0.0201	0.0201	101	101	1	18.0-190			0.000	57
2-Butanone (MEK)	0.100	U	0.0762	0.0774	76.2	77.4	1	70.0-130			1.56	20
2-Chloroethyl vinyl ether	0.100	U	U	U	0.000	0.000	1	1.00-305	J6	J6	0.000	71
Acrolein	0.100	U	0.0936	0.0921	93.6	92.1	1	4.00-172			1.62	20
Acrylonitrile	0.100	U	0.0986	0.104	98.6	104	1	22.0-189			5.33	20
Benzene	0.0200	U	0.0204	0.0202	102	101	1	37.0-151			0.985	61
Bromodichloromethane	0.0199	U	0.0203	0.0199	102	100	1	35.0-155			1.99	56
Bromoform	0.0198	U	0.0225	0.0229	114	116	1	70.0-130			1.76	42
Bromomethane	0.0200	U	0.0261	0.0283	131	142	1	15.0-185			8.09	61
Carbon tetrachloride	0.0200	U	0.0224	0.0225	112	113	1	70.0-140			0.445	41
Chlorobenzene	0.0200	U	0.0203	0.0205	102	103	1	37.0-160			0.980	53
Chloroethane	0.0200	U	0.0203	0.0198	102	99.0	1	14.0-230			2.49	78
Chloroform	0.0200	U	0.0212	0.0215	106	108	1	51.0-138			1.41	54
Chloromethane	0.0200	U	0.0133	0.0137	66.5	68.5	1	1.00-273			2.96	20
cis-1,3-Dichloropropene	0.0200	U	0.0179	0.0181	89.5	90.5	1	1.00-227			1.11	58
Dibromochloromethane	0.0198	U	0.0204	0.0202	103	102	1	53.0-149			0.985	50
Ethylbenzene	0.0200	U	0.0211	0.0209	105	105	1	37.0-162			0.952	63
Methylene Chloride	0.0204	U	0.0193	0.0198	94.6	97.1	1	1.00-221	J	J	2.56	28
Tetrachloroethene	0.0200	U	0.0194	0.0193	97.0	96.5	1	64.0-148			0.517	39
Toluene	0.0200	U	0.0208	0.0206	104	103	1	47.0-150			0.966	41
trans-1,2-Dichloroethene	0.0200	U	0.0213	0.0213	106	106	1	54.0-156			0.000	45
Trichloroethene	0.0200	U	0.0215	0.0213	108	106	1	70.0-157			0.935	48
Vinyl chloride	0.0200	U	0.0189	0.0187	94.5	93.5	1	1.00-251			1.06	66
(S) 1,2-Dichloroethane-d4					97.2	97.9		70.0-130				
(S) 4-Bromofluorobenzene					90.3	91.8		70.0-130				
(S) Toluene-d8					101	100		70.0-130				

1

Cp

2

Tc

3

Ss

4

Cn

5

Sr

6

Qc

7

Gl

8

Al

9

Sc

Method Blank (MB)

(MB) R4093629-1 07/14/24 04:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
PCB 1016	U		0.000270	0.000500
PCB 1221	U		0.000270	0.000500
PCB 1232	U		0.000270	0.000500
PCB 1242	U		0.000270	0.000500
PCB 1248	U		0.000173	0.000500
PCB 1254	U		0.000173	0.000500
PCB 1260	U		0.000173	0.000500
Total PCBs	U		0.000173	0.000500
(S) Decachlorobiphenyl	40.9			10.0-144
(S) Tetrachloro-m-xylene	77.2			10.0-135

Laboratory Control Sample (LCS)

(LCS) R4093629-5 07/14/24 04:50

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00226	90.4	50.0-140	
PCB 1260	0.00250	0.00211	84.4	8.00-140	
(S) Decachlorobiphenyl			69.4	10.0-144	
(S) Tetrachloro-m-xylene			79.7	10.0-135	

L1754575-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754575-01 07/14/24 06:36 • (MS) R4093629-6 07/14/24 07:08 • (MSD) R4093629-7 07/14/24 07:20

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
PCB 1016	0.00250	U	0.00210	0.00204	84.0	81.6	1	50.0-140			2.90	36
PCB 1260	0.00250	U	0.00139	0.00146	55.6	58.4	1	8.00-140			4.91	38
(S) Decachlorobiphenyl					39.5	42.5		10.0-144				
(S) Tetrachloro-m-xylene					69.7	70.6		10.0-135				

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	55.0			29.0-132
(S) 2-Fluorobiphenyl	81.5			26.0-102
(S) 2-Fluorophenol	72.5	J1		10.0-66.0
(S) Nitrobenzene-d5	82.5			15.0-106
(S) p-Terphenyl-d14	95.0			10.0-120

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	69.0	J1		10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.141	70.5	31.0-120	
2,4,6-Trichlorophenol	0.200	0.175	87.5	37.0-144	
2,4-Dichlorophenol	0.200	0.168	84.0	39.0-135	
2,4-Dimethylphenol	0.200	0.171	85.5	32.0-120	
2,4-Dinitrophenol	0.200	0.123	61.5	100-191	
2-Chlorophenol	0.200	0.172	86.0	23.0-134	
2-Methylphenol	0.200	0.179	89.5	26.0-120	
2-Nitrophenol	0.200	0.160	80.0	29.0-182	
3&4-Methyl Phenol	0.200	0.169	84.5	27.0-120	
3,3-Dichlorobenzidine	0.400	0.401	100	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.152	76.0	100-181	
4-Chloro-3-methylphenol	0.200	0.170	85.0	22.0-147	
4-Nitrophenol	0.200	0.121	60.5	100-132	
Anthracene	0.200	0.184	92.0	27.0-133	
Benzidine	0.400	0.125	31.3	100-120	
Benzo(a)anthracene	0.200	0.189	94.5	33.0-143	
Benzo(a)pyrene	0.200	0.200	100	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.163	81.5	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.213	106	8.00-158	
Chrysene	0.200	0.178	89.0	17.0-168	
Di-n-butyl phthalate	0.200	0.196	98.0	100-120	
Hexachloro-1,3-butadiene	0.200	0.128	64.0	24.0-120	
Hexachlorobenzene	0.200	0.150	75.0	100-152	
Hexachlorocyclopentadiene	0.200	0.120	60.0	10.0-120	
Hexachloroethane	0.200	0.142	71.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.174	87.0	39.0-127	
n-Nitrosodiethylamine	0.200	0.182	91.0	10.0-142	
Nitrobenzene	0.200	0.169	84.5	35.0-180	
Nonylphenol	0.200	0.189	94.5	57.0-136	
Pentachlorobenzene	0.200	0.138	69.0	10.0-151	
Pentachlorophenol	0.200	0.163	81.5	14.0-176	
Phenanthrene	0.200	0.173	86.5	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.137	68.5	5.00-120	
Pyridine	0.200	0.0338	16.9	10.0-120	
Total Cresols	0.400	0.348	87.0	36.0-110	
(S) 2,4,6-Tribromophenol			67.5	29.0-132	
(S) 2-Fluorobiphenyl			81.5	26.0-102	
(S) 2-Fluorophenol			75.5	10.0-66.0	J1
(S) Nitrobenzene-d5			81.5	15.0-106	
(S) p-Terphenyl-d14			92.0	10.0-120	
(S) Phenol-d6			73.5	10.0-54.0	J1

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

### Qualifier Description

B	The same analyte is found in the associated blank.
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
P1	RPD value not applicable for sample concentrations less than 5 times the reporting limit.
Q	Sample was prepared and/or analyzed past holding time as defined in the method. Concentrations should be considered minimum values.
T8	Sample(s) received past/too close to holding time expiration.
V	The sample concentration is too high to evaluate accurate spike recoveries.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> GI

<sup>8</sup> AI

<sup>9</sup> Sc



# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey–NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio–VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA–Crypto	TN00003		


## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013

Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		


<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.





<div><b>CHAIN-OF-CUSTODY Analytical Request Document</b></div> <div>Chain-of-Custody is a LEGAL DOCUMENT - Complete all relevant fields</div>										LAB USE ONLY- Affix Workorder/Login Label Here or List Pace Workorder Number or MTJL Log-in Number Here														
Company: GPL					Billing Information:					ALL SHADED AREAS are for LAB USE ONLY														
Address: 13835 CR 489																								
Report To:					Email To:					Container Preservative Type **														
Copy To:					Site Collection Info/Address:					Lab Project Manager:														
Customer Project Name/Number:					State: County/City: Time Zone Collected: / [ ] PT [ ] MT [ ] CT [ ] ET					** Preservative Types: (1) nitric acid, (2) sulfuric acid, (3) hydrochloric acid, (4) sodium hydroxide, (5) zinc acetate, (6) methanol, (7) sodium bisulfate, (8) sodium thiosulfate, (9) hexane, (A) ascorbic acid, (B) ammonium sulfate, (C) ammonium hydroxide, (D) TSP, (U) Unpreserved, (O) Other														
Phone: Site/Facility ID #: Compliance Monitoring? [ ] Yes [ ] No					Email: [ ] Yes [ ] No					Analyses														
Collected By (print): Purchase Order #: DW PWS ID #: Quote #: DW Location Code:					Collected By (signature): Turnaround Date Required: Immediately Packed on Ice: [ ] Yes [ ] No					Lab Profile/Line:														
Sample Disposal: [ ] Dispose as appropriate [ ] Return [ ] Archive: [ ] Hold: Rush: [ ] Same Day [ ] Next Day [ ] 2 Day [ ] 3 Day [ ] 4 Day [ ] 5 Day (Expedite Charges Apply) Field Filtered (if applicable): [ ] Yes [ ] No Analysis:					Sample Disposal: [ ] Dispose as appropriate [ ] Return [ ] Archive: [ ] Hold: Rush: [ ] Same Day [ ] Next Day [ ] 2 Day [ ] 3 Day [ ] 4 Day [ ] 5 Day (Expedite Charges Apply) Field Filtered (if applicable): [ ] Yes [ ] No Analysis:					Lab Sample Receipt Checklist:														
* Matrix Codes (Insert in Matrix box below): Drinking Water (DW), Ground Water (GW), Wastewater (WW), Product (P), Soil/Solid (SL), Oil (OL), Wipe (WP), Air (AR), Tissue (TS), Bioassay (B), Vapor (V), Other (OT)										Custody Seals Present/Intact Y N NA Custody Signatures Present Y N NA Collector Signature Present Y N NA Bottles Intact Y N NA Correct Bottles Y N NA Sufficient Volume Y N NA Samples Received on Ice Y N NA VOA - Headspace Acceptable Y N NA USDA Regulated Soils Y N NA Samples in Holding Time Y N NA Residual Chlorine Present Y N NA Cl Strips: _____ Sample pH Acceptable Y N NA pH Strips: _____ Sulfide Present Y N NA Lead Acetate Strips: _____														
Customer Sample ID		Matrix *	Comp / Grab	Collected (or Composite Start)		Composite End		Res Cl	# of Ctns	See Attached														
Date				Date		Time																		
Outfall 002		WW	6			7/6/24 2307			44															
Customer Remarks / Special Conditions / Possible Hazards:										Type of Ice Used: Wet Blue Dry None					SHORT HOLDS PRESENT (<72 hours): Y N N/A					Lab Sample Temperature Info:				
EDA7 1.2+0.3=1.5										Packing Material Used:					Lab Tracking #: 2893516					Temp Blank Received: Y N NA Therm ID#: _____ Cooler 1 Temp Upon Receipt: _____ oC Cooler 1 Therm Corr. Factor: _____ oC Cooler 1 Corrected Temp: _____ oC Comments:				
										Radchem sample(s) screened (<500 cpm): Y N NA					Samples received via: FEDEX UPS Client Courier Pace Courier					Trip Blank Received: Y N NA HCL MeOH TSP Other				
Relinquished by/Company: (Signature)			Date/Time: 0951 7/8/24		Received by/Company: (Signature)			Date/Time: 7/8/24 0951		MTJL LAB USE ONLY														
Relinquished by/Company: (Signature)			Date/Time: 7/9/24 1700		Received by/Company: (Signature)			Date/Time: 7/9/24 1700		Table #:														
Relinquished by/Company: (Signature)			Date/Time:		Received by/Company: (Signature)			Date/Time:		Acctnum:														
										Template:														
										Prelogin:														
										PM:														
													Non Conformance(s):			Page: _____								



DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

## Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ AustinClient Name: G PL Project Work order (place label):Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒Received on ice: Wet ☒ Blue ☐ No ice ☐Receiving Lab 1 Thermometer Used: 1218 Cooler Temp °C: 7.9 (Recorded) 10.3 (Correction Factor) 8.2 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AR Date: 7/8

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Sulfide Present Lead Acetate Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas State Sampled: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Non-Conformance(s):	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Login Person: JW Date: 7/8

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

Time estimate: oh

Time spent: oh

## Members



Jeremy Watkins (responsible)



Dorothy Roberts

- ☐ 1. If Chain-of-custody (COC) is not received: contact client and if necessary, fill out a COC and indicate that it was filled out by lab personnel. Note issues on this NCF.
- ☐ 2. If COC is incomplete, check applicable issues below and add details where appropriate:
- ☐ \*Collection date/time missing or incorrect
- ☐ \*Analyses or analytes: missing or Clarification needed
- ☐ \*Samples listed on COC do not match samples recieved (missing, additional,etc.)
- ☐ \*Sample IDs on COC do not match sample Labels
- ☐ \*Required trip blanks were not received
- ☐ \*Required signatures are missing
- ☒ 3. Sample integrity issues: check applicable issues below and add details where appropriate:
- ☒ \*Samples: Past holding time
- ☐ \*Samples: Not Field Filtered
- ☐ \*samples: Insufficient volume received
- ☐ \*Samples: Cooler damaged or compromised
- ☐ \*Samples: contain Chlorine or Sulfide
- ☐ \*Samples: condition needs to be brought to lab personnel's attention (details below)
- ☐ \*Containers: Broken or compromised
- ☐ \*Containers: Incorrect
- ☐ \*Custody Seals: missing or compromised on samples, trip blanks or coolers
- ☐ \*Packing Material: Insufficient/Improper
- ☒ \*Preservation: improper
- ☐ \*Temperature: not within acceptance criteria (typically 0-6C)
- ☐ \*Temperature: Samples arrived frozen
- ☐ \*Vials received with improper headspace
- ☐ \*Other:
- ☐ 4. If Samples not preserved properly and Sample Receiving adjusts pH, add details below:
- ☐ Sample ID: \_\_\_\_\_
- ☐ Preserved by: \_\_\_\_\_
- ☐ Date/Time: \_\_\_\_\_
- ☐ Initial and Final pH: \_\_\_\_\_
- ☐ Amount/type pres added: \_\_\_\_\_
- ☐ Lot # of Pres added: \_\_\_\_\_
- ☐ 5. Client contact: If Client is Contacted for any issue listed above, fill in details below:
- ☒ Client:
- ☒ PM Initials: DPR
- ☒ Contacted per: JMcClain
- ☒ Date/Time: 7/9 1051

## Comments

*Jeremy Watkins*

*9 July 2024 8:48 AM*

1. MBAS, NITRATE, CR6 all out of hold
2. CN and SULFIDE recieved unpreserved.

*Dorothy Roberts*

*10 July 2024 9:34 AM*

Proceed / may not report if replacements can be collected

also sending replacement bottles to recollect T256352



**Garland Power & Light**

Sample Delivery Group: L1754283

Samples Received: 07/08/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By:



Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1754283-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	17
Wet Chemistry by Method 351.2	18
Wet Chemistry by Method 353.2	19
Wet Chemistry by Method 360.1	20
Wet Chemistry by Method 4500Cl G-2011	21
Wet Chemistry by Method 4500CN-E	22
Wet Chemistry by Method 4500P-E	23
Wet Chemistry by Method 4500-S2 D	24
Wet Chemistry by Method 4500SO3 B-2011	25
Wet Chemistry by Method 5210 B-2016	26
Wet Chemistry by Method 5220D	28
Wet Chemistry by Method 5310C	29
Wet Chemistry by Method 5540C	30
Wet Chemistry by Method SM 4500-H+B	31
Wet Chemistry by Method SM4500NH3H	32
Mercury by Method 245.1	33
Metals (ICP) by Method 200.7	34
Metals (ICPMS) by Method 200.8	35
Volatile Organic Compounds (GC/MS) by Method 624.1	38
Polychlorinated Biphenyls (GC) by Method EPA-608.3	41
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	42
Gl: Glossary of Terms	45
Al: Accreditations & Locations	46
Sc: Sample Chain of Custody	47

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc

# SAMPLE SUMMARY

OUTFALL 001 L1754283-01 WW

Collected by

Collected date/time

Received date/time

07/08/24 12:34

07/08/24 14:30

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2321072	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Calculated Results	WG2323027	1	07/15/24 20:11	07/15/24 20:11	EIG	Allen, TX
Gravimetric Analysis by Method 2540C	WG2321280	1	07/11/24 13:04	07/11/24 15:55	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2322092	1	07/12/24 15:40	07/12/24 17:30	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2320716	1	07/12/24 05:40	07/12/24 07:26	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2320288	1	07/10/24 10:40	07/10/24 10:40	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2320255	1	07/10/24 09:19	07/10/24 09:19	SEN	Allen, TX
Wet Chemistry by Method 300.0	WG2320279	1	07/10/24 23:07	07/10/24 23:07	DLH	Mt. Juliet, TN
Wet Chemistry by Method 3500Cr-B	WG2322157	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Wet Chemistry by Method 351.2	WG2323027	1	07/15/24 11:10	07/15/24 20:11	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2321792	1	07/12/24 12:55	07/12/24 12:55	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2324067	1	07/16/24 14:05	07/16/24 14:05	JBS	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2322664	1	07/14/24 12:15	07/14/24 12:15	CAH	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2321047	1	07/11/24 11:30	07/11/24 16:58	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2323646	1	07/16/24 16:14	07/16/24 16:14	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2320999	1	07/11/24 14:26	07/11/24 14:26	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2319662	1	07/09/24 15:00	07/09/24 15:00	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2323050	1	07/15/24 11:20	07/15/24 11:20	JAR	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2319546	1	07/09/24 14:09	07/14/24 13:01	QQT	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2319551	1	07/09/24 15:54	07/14/24 14:30	SEN	Allen, TX
Wet Chemistry by Method 5220D	WG2323013	1	07/15/24 10:31	07/15/24 13:10	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2320357	2	07/11/24 21:00	07/11/24 21:00	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2319936	1	07/09/24 18:54	07/09/24 19:02	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2321035	1	07/11/24 09:01	07/11/24 09:01	JBS	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2321326	1	07/11/24 16:43	07/11/24 16:43	EIG	Allen, TX
Mercury by Method 245.1	WG2320254	1	07/10/24 09:46	07/10/24 16:09	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2320626	1	07/10/24 16:30	07/11/24 15:43	TJG	Allen, TX
Metals (ICPMS) by Method 200.8	WG2321072	1	07/11/24 10:47	07/11/24 21:58	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2319924	1	07/09/24 19:15	07/09/24 19:15	ZST	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2322292	1	07/13/24 19:04	07/14/24 06:24	LJD	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2320434	1	07/10/24 12:55	07/13/24 16:14	XLY	Allen, TX

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager

## Sample Delivery Group (SDG) Narrative

The following analysis were performed from an unpreserved, insufficiently or inadequately preserved sample.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	4500-S2 D, 4500CN-E

The Laboratory is not accredited for specific analytes on the associated Sample/Method. These analytes are flagged in the Sample Results section of the report with an asterisk (\*).


<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	300.0

Analysis was filtered in the laboratory.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B

No extra volume received to perform Matrix Spike samples.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	625.1





Calculated Results

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Trivalent	U		0.000510	0.00300	1	07/12/2024 19:03	<a href="#">WG2321072</a>
Organic Nitrogen	0.343		0.0280	0.100	1	07/15/2024 20:11	<a href="#">WG2323027</a>

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Gravimetric Analysis by Method 2540C

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Total Dissolved Solids	159		25.0	1	07/11/2024 15:55	<a href="#">WG2321280</a>

Gravimetric Analysis by Method 2540D

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Suspended Solids	6.20		2.93	1	07/12/2024 17:30	<a href="#">WG2322092</a>

Wet Chemistry by Method 1664A

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Oil & Grease (Hexane Extr)	U		0.350	5.00	1	07/12/2024 07:26	<a href="#">WG2320716</a>

Wet Chemistry by Method 2120B

Analyte	Result units	Qualifier	RDL units	Dilution	Analysis date / time	Batch
Color	20.0		5.00	1	07/10/2024 10:40	<a href="#">WG2320288</a>

Sample Narrative:

L1754283-01 WG2320288: 7

Wet Chemistry by Method 2320B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Alkalinity	120		20.0	20.0	1	07/10/2024 09:19	<a href="#">WG2320255</a>

Wet Chemistry by Method 300.0

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
*Bromide	U		0.353	1.00	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Chloride	14.4		0.379	1.00	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Fluoride	0.172		0.0640	0.150	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Nitrate as (N)	U	<a href="#">Q</a>	0.0480	0.100	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Sulfate	23.3		0.594	5.00	1	07/10/2024 23:07	<a href="#">WG2320279</a>

Wet Chemistry by Method 3500Cr-B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Hexavalent	U		0.00200	0.00300	1	07/12/2024 19:03	<a href="#">WG2322157</a>

Sample Narrative:

L1754283-01 WG2322157: Sample preserved in lab w/in 24 hrs of collection

Wet Chemistry by Method 351.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Kjeldahl Nitrogen, TKN	0.343	<a href="#">J5</a>	0.140	0.250	1	07/15/2024 20:11	<a href="#">WG2323027</a>

## OUTFALL 001

Collected date/time: 07/08/24 12:34

## SAMPLE RESULTS - 01

L1754283

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	07/12/2024 12:55	<a href="#">WG2321792</a>

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	10.2	<a href="#">T8</a>	1	1	1	07/16/2024 14:05	<a href="#">WG2324067</a>

## Wet Chemistry by Method 4500CI G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.108	<a href="#">T8</a>	0.0260	0.100	1	07/14/2024 12:15	<a href="#">WG2322664</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/11/2024 16:58	<a href="#">WG2321047</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00350	0.0100	1	07/16/2024 16:14	WG2323646

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.0443	<a href="#">J</a>	0.0152	0.0500	1	07/11/2024 14:26	<a href="#">WG2320999</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/09/2024 15:00	<a href="#">WG2319662</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	07/15/2024 11:20	<a href="#">WG2323050</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	1.39		1.00	1	1	07/14/2024 13:01	<a href="#">WG2319546</a>
CBOD	1.44	<a href="#">B1</a>	1.00	1	1	07/14/2024 14:30	<a href="#">WG2319551</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	19.0	<a href="#">J</a>	16.1	35.0	1	07/15/2024 13:10	<a href="#">WG2323013</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	11.2		0.540	1.40	2	07/11/2024 21:00	<a href="#">WG2320357</a>

1  
Cp

2  
Tc

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">J5</a>	0.360	0.500	1	07/09/2024 19:02	<a href="#">WG2319936</a>

3  
Ss

4  
Cn

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	7.83	<a href="#">T8</a>	1	07/11/2024 09:01	<a href="#">WG2321035</a>

5  
Sr

6  
Qc

Sample Narrative:

L1754283-01 WG2321035: 7.83 at 19.6C

7  
Gl

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	U		0.0280	0.100	1	07/11/2024 16:43	<a href="#">WG2321326</a>

8  
Al

9  
Sc

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	U		0.0000450	0.000200	1	07/10/2024 16:09	<a href="#">WG2320254</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0759	<a href="#">J</a>	0.0186	0.100	1	07/11/2024 15:43	<a href="#">WG2320626</a>
Tin	U		0.00240	0.0250	1	07/11/2024 15:43	<a href="#">WG2320626</a>
Titanium	U		0.00835	0.100	1	07/11/2024 15:43	<a href="#">WG2320626</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.115		0.00186	0.00250	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Antimony	U		0.000580	0.00500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Arsenic	0.00518		0.000100	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Barium	0.0659		0.000440	0.00300	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Beryllium	U		0.0000600	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Cadmium	U		0.000120	0.00100	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Chromium	U		0.000510	0.00300	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Cobalt	0.000199	<a href="#">B J</a>	0.0000400	0.000300	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Copper	0.00609		0.000900	0.00200	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Iron	0.119		0.00432	0.00700	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Lead	U		0.000140	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Magnesium	3.78		0.0121	0.0200	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Manganese	0.135		0.000330	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Molybdenum	0.00103		0.000530	0.00100	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Nickel	0.00161	<a href="#">J</a>	0.000640	0.00200	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Selenium	U		0.000740	0.00500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Silver	U		0.0000800	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Thallium	U		0.000190	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>

## OUTFALL 001

Collected date/time: 07/08/24 12:34

## SAMPLE RESULTS - 01

L1754283

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	U		0.00265	0.00500	1	07/11/2024 21:58	<a href="#">WG2321072</a>

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
2-Butanone (MEK)	U		0.00822	0.0250	1	07/09/2024 19:15	<a href="#">WG2319924</a>
2-Chloroethyl vinyl ether	U		0.00652	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Acrolein	U		0.00544	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Acrylonitrile	U		0.00709	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Benzene	U		0.00207	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Bromoform	U		0.000960	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Bromomethane	U		0.00347	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chlorobenzene	U		0.00276	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chloroethane	U		0.00296	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chloroform	U		0.00212	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chloromethane	U		0.00361	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Ethylbenzene	U		0.000401	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Methylene Chloride	U		0.0117	0.0200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Toluene	U		0.00219	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Trichloroethene	U		0.00262	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Vinyl chloride	U		0.00466	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
(S) 1,2-Dichloroethane-d4	93.2			70.0-130		07/09/2024 19:15	<a href="#">WG2319924</a>
(S) 4-Bromofluorobenzene	93.1			70.0-130		07/09/2024 19:15	<a href="#">WG2319924</a>
(S) Toluene-d8	100			70.0-130		07/09/2024 19:15	<a href="#">WG2319924</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1221	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1232	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1242	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1248	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1254	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1260	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
Total PCBs	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
(S) Decachlorobiphenyl	43.0			10.0-144		07/14/2024 06:24	<a href="#">WG2322292</a>
(S) Tetrachloro-m-xylene	71.7			10.0-135		07/14/2024 06:24	<a href="#">WG2322292</a>

## OUTFALL 001

## SAMPLE RESULTS - 01

Collected date/time: 07/08/24 12:34

L1754283

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2-Chlorophenol	U		0.000307	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2-Methylphenol	U		0.000238	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2-Nitrophenol	U		0.000247	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	07/13/2024 16:14	<a href="#">WG2320434</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
4-Nitrophenol	U		0.00123	0.0100	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Anthracene	U		0.000168	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Benzidine	U		0.000350	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Chrysene	U		0.000257	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachlorobenzene	U		0.000307	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachloroethane	U		0.000247	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Nitrobenzene	U		0.000314	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Nonylphenol	U		0.000168	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Pentachlorobenzene	U		0.000247	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Pentachlorophenol	U		0.000283	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Phenanthrene	U		0.000200	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Phenol	U		0.000500	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Pyridine	U		0.00174	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Total Cresols	U		0.00153	0.00800	1	07/13/2024 16:14	<a href="#">WG2320434</a>
(S) 2,4,6-Tribromophenol	48.6			29.0-132		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) 2-Fluorobiphenyl	74.5			26.0-102		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) 2-Fluorophenol	63.5			10.0-66.0		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) Nitrobenzene-d5	73.5			15.0-106		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) p-Terphenyl-d14	84.5			10.0-120		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) Phenol-D6	56.5	<a href="#">J1</a>		10.0-54.0		07/13/2024 16:14	<a href="#">WG2320434</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4093133-1 07/11/24 15:55

	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Total Dissolved Solids	U		25.0	25.0

L1754251-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754251-01 07/11/24 15:55 • (DUP) R4093133-3 07/11/24 15:55

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	467	416	1	11.6	J3	10

L1754251-03 Original Sample (OS) • Duplicate (DUP)

(OS) L1754251-03 07/11/24 15:55 • (DUP) R4093133-4 07/11/24 15:55

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	450	475	1	5.41		10

Laboratory Control Sample (LCS)

(LCS) R4093133-2 07/11/24 15:55

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	mg/l	mg/l	%	%	
Total Dissolved Solids	2410	2440	101	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4093943-1 07/12/24 17:30

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Suspended Solids	U		2.50	2.50

L1754525-04 Original Sample (OS) • Duplicate (DUP)

(OS) L1754525-04 07/12/24 17:30 • (DUP) R4093943-3 07/12/24 17:30

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	15400	15400	1	0.260		10

L1754525-06 Original Sample (OS) • Duplicate (DUP)

(OS) L1754525-06 07/12/24 17:30 • (DUP) R4093943-4 07/12/24 17:30

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	15700	15700	1	0.000		10

Laboratory Control Sample (LCS)

(LCS) R4093943-2 07/12/24 17:30

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Suspended Solids	879	844	96.0	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093066-1 07/12/24 07:26

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4093066-2 07/12/24 07:26 • (LCSD) R4093066-3 07/12/24 07:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	39.8	37.9	99.5	94.8	78.0-114			4.89	18

L1753717-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1753717-02 07/12/24 07:26 • (MS) R4093066-4 07/12/24 07:26

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	39.6	99.0	1	78.0-114	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4092474-1 07/10/24 10:40

Analyte	MB Result units	MB Qualifier	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:  
BLANK: 7

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/10/24 10:40 • (DUP) R4092474-2 07/10/24 10:40

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:  
OS: 7  
DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091926-1 07/10/24 09:19

	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/10/24 09:19 • (DUP) R4091926-3 07/10/24 09:19

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	120	118	1	2.11		20

Laboratory Control Sample (LCS)

(LCS) R4091926-2 07/10/24 09:19

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	240	96.0	90.0-110	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092616-3 07/10/24 19:14

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.353	1.00
Chloride	U		0.379	1.00
Fluoride	U		0.0640	0.150
Nitrate as (N)	U		0.0480	0.100
Sulfate	U		0.594	5.00

L1754251-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754251-01 07/10/24 21:50 • (DUP) R4092616-5 07/10/24 22:03

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	U	U	1	0.000		15
Chloride	112	112	1	0.610		15
Fluoride	0.393	0.408	1	3.67		15
Nitrate as (N)	0.155	0.244	1	44.5	P1	15
Sulfate	22.2	22.2	1	0.105		15

L1754732-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754732-01 07/11/24 01:02 • (DUP) R4092616-8 07/11/24 01:15

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	U	U	1	0.000		15
Chloride	2.86	2.84	1	0.806		15
Fluoride	0.653	0.643	1	1.58		15
Nitrate as (N)	0.0661	0.0653	1	1.22	J	15
Sulfate	1.27	1.32	1	3.37	J	15

Laboratory Control Sample (LCS)

(LCS) R4092616-4 07/10/24 19:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	40.0	40.0	99.9	90.0-110	
Chloride	40.0	39.3	98.3	90.0-110	
Fluoride	8.00	8.20	102	90.0-110	
Nitrate as (N)	8.00	7.87	98.4	90.0-110	

Cp

Tc

Ss

Cn

Sr

Qc

Gl

Al

Sc

Laboratory Control Sample (LCS)

(LCS) R4092616-4 07/10/24 19:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Sulfate	40.0	39.3	98.1	90.0-110	

L1754251-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754251-01 07/10/24 21:50 • (MS) R4092616-6 07/10/24 22:16 • (MSD) R4092616-7 07/10/24 22:29

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Bromide	40.0	U	40.4	40.9	101	102	1	80.0-120			1.03	15
Chloride	40.0	112	130	130	45.8	46.8	1	80.0-120	J6	J6	0.313	15
Fluoride	8.00	0.393	9.14	8.41	109	100	1	80.0-120			8.31	15
Nitrate as (N)	8.00	0.155	8.04	8.09	98.5	99.2	1	80.0-120			0.661	15
Sulfate	40.0	22.2	57.6	58.7	88.4	91.3	1	80.0-120			2.00	15

L1754732-01 Original Sample (OS) • Matrix Spike (MS)

(OS) L1754732-01 07/11/24 01:02 • (MS) R4092616-9 07/11/24 01:28

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>
Bromide	40.0	U	39.7	99.2	1	80.0-120	
Chloride	40.0	2.86	42.2	98.5	1	80.0-120	
Fluoride	8.00	0.653	8.69	100	1	80.0-120	
Nitrate as (N)	8.00	0.0661	8.00	99.2	1	80.0-120	
Sulfate	40.0	1.27	40.3	97.7	1	80.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093286-1 07/12/24 19:03

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

1  
Cp

2  
Tc

3  
Ss

Laboratory Control Sample (LCS)

(LCS) R4093286-2 07/12/24 19:03

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.195	97.7	85.0-115	

4  
Cn

5  
Sr

L1756127-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756127-01 07/12/24 19:03 • (MS) R4093286-3 07/12/24 19:03 • (MSD) R4093286-4 07/12/24 19:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.204	0.202	102	101	1	10.0-120			0.842	20

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4094061-1 07/15/24 20:06

	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Kjeldahl Nitrogen, TKN	U		0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4094061-2 07/15/24 20:07

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	mg/l	mg/l	%	%	
Kjeldahl Nitrogen, TKN	4.00	4.27	107	90.0-110	

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/15/24 20:10 • (MS) R4094061-3 07/15/24 20:44 • (MSD) R4094061-4 07/15/24 20:45

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Kjeldahl Nitrogen, TKN	4.00	1.03	5.64	6.51	115	137	1	90.0-110	J5	J5	14.3	20

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 20:11 • (MS) R4094061-5 07/15/24 20:46 • (MSD) R4094061-6 07/15/24 20:48

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Kjeldahl Nitrogen, TKN	4.00	0.343	4.88	4.63	113	107	1	90.0-110	J5		5.26	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093045-1 07/12/24 12:50

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4093045-2 07/12/24 12:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Nitrate-Nitrite	2.50	2.40	96.0	90.0-110	

L1754182-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754182-01 07/12/24 12:51 • (MS) R4093045-3 07/12/24 12:59 • (MSD) R4093045-4 07/12/24 13:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	0.794	3.13	3.11	93.4	92.6	1	90.0-110			0.641	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/16/24 14:05 • (DUP) R4094367-1 07/16/24 14:05

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	<u>DUP Qualifier</u>	DUP RPD Limits %
Dissolved Oxygen	7.77	8.25	1	5.99		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



Method Blank (MB)

(MB) R4093561-1 07/14/24 11:59

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chlorine,residual	U		0.0260	0.100

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/14/24 12:14 • (DUP) R4093561-3 07/14/24 12:15

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Chlorine,residual	0.0330	0.0340	1	2.99	J	20

Laboratory Control Sample (LCS)

(LCS) R4093561-2 07/14/24 12:13

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chlorine,residual	1.00	0.960	96.0	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092740-1 07/11/24 16:58

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4092740-2 07/11/24 16:58

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Cyanide	0.100	0.0908	90.8	85.0-115	

L1754359-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754359-01 07/11/24 16:58 • (MS) R4092740-3 07/11/24 16:58 • (MSD) R4092740-4 07/11/24 16:58

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Cyanide	0.100	U	0.0928	0.0928	92.8	92.8	1	85.0-115			0.000	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092631-1 07/11/24 14:26

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4092631-2 07/11/24 14:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phosphorus,Total	0.500	0.526	105	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/11/24 14:26 • (MS) R4092631-3 07/11/24 14:27 • (MSD) R4092631-4 07/11/24 14:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.0443	0.569	0.562	105	104	1	80.0-120			1.20	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4091612-1 07/09/24 15:00

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4091612-2 07/09/24 15:00

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Sulfide	0.800	0.850	106	80.0-120	

L1753522-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753522-01 07/09/24 15:00 • (MS) R4091612-3 07/09/24 15:03 • (MSD) R4091612-4 07/09/24 15:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Sulfide	0.800	U	0.772	0.769	96.5	96.1	1	80.0-120			0.453	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093789-1 07/15/24 11:20

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/15/24 11:20 • (DUP) R4093789-3 07/15/24 11:20

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	U	U	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4093789-2 07/15/24 11:20

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 11:20 • (MS) R4093789-4 07/15/24 11:20 • (MSD) R4093789-5 07/15/24 11:20

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	19.0	18.5	95.0	92.5	1	85.0-115			2.67	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093582-1 07/14/24 12:45

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
BOD	U		0.200	0.200

L1754172-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754172-01 07/14/24 12:55 • (DUP) R4093582-3 07/14/24 13:42

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
BOD	3.30	ND	1	200	P1	20

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/14/24 13:01 • (DUP) R4093582-4 07/14/24 13:44

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
BOD	1.39	1.45	1	4.23		20

Laboratory Control Sample (LCS)

(LCS) R4093582-2 07/14/24 12:52

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
BOD	198	187	94.6	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093709-1 07/14/24 14:20

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
CBOD	0.220	B1	0.200	0.200

L1754373-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754373-01 07/14/24 14:46 • (DUP) R4093709-3 07/14/24 14:54

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
CBOD	1.04	7.58	1	200	J3	20

Laboratory Control Sample (LCS)

(LCS) R4093709-2 07/14/24 14:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
CBOD	198	183	92.5	85-115	

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093841-1 07/15/24 13:10

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

Laboratory Control Sample (LCS)

(LCS) R4093841-2 07/15/24 13:10

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
COD	500	511	102	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 13:10 • (MS) R4093841-3 07/15/24 13:10 • (MSD) R4093841-4 07/15/24 13:10

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
COD	500	19.0	517	524	99.7	101	1	80.0-120			1.22	20

L1754768-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754768-01 07/15/24 13:10 • (MS) R4093841-5 07/15/24 13:10 • (MSD) R4093841-6 07/15/24 13:10

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
COD	500	67.6	524	526	91.2	91.7	1	80.0-120			0.402	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



Method Blank (MB)

(MB) R4092962-1 07/11/24 16:22

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4092962-2 07/11/24 16:42

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
TOC (Total Organic Carbon)	10.0	10.4	104	90.0-110	

L1754776-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754776-01 07/11/24 17:08 • (MS) R4092962-3 07/11/24 17:54 • (MSD) R4092962-4 07/11/24 18:14

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
TOC (Total Organic Carbon)	100	30.8	127	127	96.3	96.3	10	80.0-120			0.000	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092475-1 07/09/24 19:02

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4092475-2 07/09/24 19:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
MBAS	1.00	1.17	117	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/09/24 19:02 • (MS) R4092475-3 07/09/24 19:02 • (MSD) R4092475-4 07/09/24 19:02

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
MBAS	1.00	U	1.20	1.25	120	125	1	80.0-120		J5	3.87	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

L1754340-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754340-01 07/11/24 09:01 • (DUP) R4092476-2 07/11/24 09:01

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	su	su		%		%
pH	7.61	7.62	1	0.131		20

Sample Narrative:  
OS: 7.61 at 19.6C  
DUP: 7.62 at 19.3C

Laboratory Control Sample (LCS)

(LCS) R4092476-1 07/11/24 09:01

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	su	su	%	%	
pH	6.00	5.99	99.8	99.0-101	

Sample Narrative:  
LCS: 5.99 at 22C

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092766-1 07/11/24 16:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	0.0285	⬇	0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4092766-2 07/11/24 16:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.28	106	80.0-120	

L1754163-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754163-02 07/11/24 16:39 • (MS) R4092766-3 07/11/24 16:32 • (MSD) R4092766-4 07/11/24 16:34

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.369	5.44	5.43	101	101	1	80.0-120			0.184	20

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/11/24 16:41 • (MS) R4092766-5 07/11/24 16:36 • (MSD) R4092766-6 07/11/24 16:37

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	U	5.12	5.15	102	103	1	80.0-120			0.584	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092198-3 07/10/24 16:35

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Mercury	0.0000450	J	0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4092198-4 07/10/24 16:37

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Mercury	0.00250	0.00227	90.8	85.0-115	

L1753552-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753552-01 07/10/24 16:40 • (MS) R4092198-5 07/10/24 16:42 • (MSD) R4092198-6 07/10/24 16:44

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	0.0000520	0.00170	0.00171	65.9	66.3	1	70.0-130	J6	J6	0.587	20

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4092733-2 07/11/24 13:15

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4092733-1 07/11/24 13:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.962	96.2	85.0-115	
Tin	1.00	0.999	99.9	85.0-115	
Titanium	1.00	0.996	99.6	85.0-115	

L1754731-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754731-01 07/11/24 13:19 • (MS) R4092733-3 07/11/24 13:23 • (MSD) R4092733-4 07/11/24 13:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	0.0190	0.980	0.983	96.1	96.4	1	70.0-130			0.357	20
Tin	1.00	0.00833	1.00	1.01	99.2	99.8	1	70.0-130			0.598	20
Titanium	1.00	0.0438	1.04	1.04	99.3	99.6	1	70.0-130			0.289	20

L1754768-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754768-01 07/11/24 14:11 • (MS) R4092733-5 07/11/24 14:15 • (MSD) R4092733-6 07/11/24 14:19

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	1.72	2.62	2.65	89.9	93.5	1	70.0-130			1.37	20
Tin	1.00	U	0.947	0.958	94.7	95.8	1	70.0-130			1.11	20
Titanium	1.00	U	0.977	0.995	97.7	99.5	1	70.0-130			1.73	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092690-1 07/11/24 15:02

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l	
Aluminum	0.00743		0.00186	0.00250	
Antimony	U		0.000580	0.00500	
Arsenic	0.000222	U	0.000100	0.000500	<sup>1</sup> Cp
Barium	U		0.000440	0.00300	<sup>2</sup> Tc
Beryllium	0.000152	U	0.0000600	0.000500	<sup>3</sup> Ss
Cadmium	U		0.000120	0.00100	<sup>4</sup> Cn
Chromium	U		0.000510	0.00300	<sup>5</sup> Sr
Cobalt	0.000117	U	0.0000400	0.000300	<sup>6</sup> Qc
Copper	U		0.000900	0.00200	<sup>7</sup> Gl
Iron	0.00776		0.00432	0.00700	<sup>8</sup> Al
Lead	U		0.000140	0.000500	<sup>9</sup> Sc
Magnesium	U		0.0121	0.0200	
Manganese	U		0.000330	0.000500	
Molybdenum	U		0.000530	0.00100	
Nickel	U		0.000640	0.00200	
Selenium	U		0.000740	0.00500	
Silver	0.0000896	U	0.0000800	0.000500	
Thallium	0.000232	U	0.000190	0.000500	
Zinc	U		0.00265	0.00500	

Laboratory Control Sample (LCS)

(LCS) R4092690-2 07/11/24 15:08

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Aluminum	1.00	0.969	96.9	85.0-115	
Antimony	0.100	0.0971	97.1	85.0-115	
Arsenic	0.100	0.0983	98.3	85.0-115	
Barium	0.100	0.0963	96.3	85.0-115	
Beryllium	0.100	0.0990	99.0	85.0-115	
Cadmium	0.100	0.0998	99.8	85.0-115	
Chromium	0.100	0.0995	99.5	85.0-115	
Cobalt	0.100	0.0999	99.9	85.0-115	
Copper	0.100	0.101	101	85.0-115	
Iron	1.00	0.971	97.1	85.0-115	
Lead	0.100	0.0951	95.1	85.0-115	
Magnesium	1.00	1.00	100	85.0-115	
Manganese	0.100	0.0981	98.1	85.0-115	
Molybdenum	0.100	0.100	100	85.0-115	

Laboratory Control Sample (LCS)

(LCS) R4092690-2 07/11/24 15:08

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Nickel	0.100	0.101	101	85.0-115	
Selenium	0.100	0.101	101	85.0-115	
Silver	0.0500	0.0505	101	85.0-115	
Thallium	0.100	0.0900	90.0	85.0-115	
Zinc	0.100	0.0963	96.3	85.0-115	

L1752148-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1752148-01 07/11/24 15:15 • (MS) R4092690-3 07/11/24 15:21 • (MSD) R4092690-4 07/11/24 15:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Aluminum	1.00	0.0185	0.981	0.958	96.3	93.9	1	70.0-130			2.39	20
Antimony	0.100	0.000615	0.0978	0.0991	97.2	98.5	1	70.0-130			1.39	20
Arsenic	0.100	0.0149	0.113	0.113	97.7	97.8	1	70.0-130			0.0911	20
Barium	0.100	0.427	0.523	0.529	96.4	102	1	70.0-130			1.08	20
Beryllium	0.100	0.000212	0.0935	0.0912	93.3	91.0	1	70.0-130			2.44	20
Cadmium	0.100	0.000135	0.0926	0.0923	92.5	92.1	1	70.0-130			0.419	20
Chromium	0.100	0.0179	0.114	0.112	96.4	94.1	1	70.0-130			2.02	20
Cobalt	0.100	0.000261	0.0957	0.0961	95.5	95.8	1	70.0-130			0.341	20
Copper	0.100	0.0163	0.110	0.110	93.7	94.2	1	70.0-130			0.435	20
Iron	1.00	0.149	1.08	1.07	92.9	91.9	1	70.0-130			0.897	20
Lead	0.100	0.000194	0.0913	0.0906	91.1	90.4	1	70.0-130			0.834	20
Magnesium	1.00	33.8	35.1	34.4	125	54.6	1	70.0-130		V	2.02	20
Manganese	0.100	0.00562	0.101	0.0990	95.6	93.4	1	70.0-130			2.17	20
Molybdenum	0.100	0.00292	0.103	0.103	99.8	99.8	1	70.0-130			0.0476	20
Nickel	0.100	0.0466	0.140	0.140	93.1	92.9	1	70.0-130			0.152	20
Selenium	0.100	0.0173	0.117	0.115	99.3	98.1	1	70.0-130			0.986	20
Silver	0.0500	0.000107	0.0474	0.0468	94.5	93.4	1	70.0-130			1.17	20
Thallium	0.100	0.000987	0.0860	0.0863	85.0	85.3	1	70.0-130			0.438	20
Zinc	0.100	0.00409	0.0947	0.0940	90.6	89.9	1	70.0-130			0.793	20

L1754390-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754390-06 07/11/24 22:48 • (MS) R4092690-5 07/11/24 22:55 • (MSD) R4092690-6 07/11/24 23:01

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Antimony	0.100	U	0.0992	0.0970	99.2	97.0	1	70.0-130			2.24	20
Arsenic	0.100	0.000533	0.0977	0.0956	97.1	95.0	1	70.0-130			2.16	20
Barium	0.100	0.0429	0.145	0.143	102	99.8	1	70.0-130			1.67	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



L1754390-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754390-06 07/11/24 22:48 • (MS) R4092690-5 07/11/24 22:55 • (MSD) R4092690-6 07/11/24 23:01

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Beryllium	0.100	U	0.0938	0.102	93.8	102	1	70.0-130			8.31	20
Cadmium	0.100	0.000379	0.0952	0.0955	94.8	95.1	1	70.0-130			0.298	20
Chromium	0.100	U	0.0948	0.0957	94.8	95.7	1	70.0-130			0.921	20
Cobalt	0.100	0.00123	0.0992	0.0972	98.0	96.0	1	70.0-130			2.07	20
Copper	0.100	0.290	0.419	0.409	129	119	1	70.0-130			2.41	20
Iron	1.00	0.00434	0.930	0.940	92.6	93.5	1	70.0-130			0.996	20
Lead	0.100	0.00217	0.0951	0.0936	92.9	91.4	1	70.0-130			1.60	20
Magnesium	1.00	3.50	4.78	4.77	128	127	1	70.0-130			0.0436	20
Manganese	0.100	0.256	0.374	0.375	118	119	1	70.0-130			0.191	20
Molybdenum	0.100	0.000975	0.102	0.0997	101	98.8	1	70.0-130			2.54	20
Nickel	0.100	0.304	0.439	0.431	135	127	1	70.0-130	J5		1.79	20
Selenium	0.100	U	0.0991	0.104	99.1	104	1	70.0-130			4.71	20
Silver	0.0500	U	0.0483	0.0485	96.6	97.1	1	70.0-130			0.481	20
Thallium	0.100	U	0.0907	0.0885	90.7	88.5	1	70.0-130			2.46	20
Zinc	0.100	1.14	1.37	1.34	221	199	1	70.0-130	V	V	1.61	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091976-2 07/09/24 17:32

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Butanone (MEK)	U		0.00822	0.0250
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	0.00317	U	0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	93.5			70.0-130
(S) 4-Bromofluorobenzene	99.6			70.0-130
(S) Toluene-d8	97.4			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4091976-1 07/09/24 16:24

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0200	0.0201	101	70.0-130	
1,1,2,2-Tetrachloroethane	0.0200	0.0185	92.5	60.0-140	
1,1,2-Trichloroethane	0.0200	0.0190	95.0	70.0-130	
1,1-Dichloroethene	0.0200	0.0195	97.5	50.0-150	
1,1-Dichloroethane	0.0200	0.0203	102	70.0-130	
1,2-Dibromoethane	0.0200	0.0186	93.0	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0203	102	65.0-135	
1,2-Dichloroethane	0.0200	0.0202	101	70.0-130	
1,2-Dichloropropane	0.0200	0.0181	90.5	35.0-165	
1,3-Dichlorobenzene	0.0200	0.0195	97.5	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0192	96.0	65.0-135	
2-Butanone (MEK)	0.100	0.0829	82.9	70.0-130	
2-Chloroethyl vinyl ether	0.100	0.0529	52.9	1.00-225	
Acrolein	0.100	0.105	105	64.0-139	
Acrylonitrile	0.100	0.104	104	67.0-136	
Benzene	0.0200	0.0197	98.5	65.0-135	
Bromodichloromethane	0.0200	0.0203	102	65.0-135	
Bromoform	0.0200	0.0233	117	70.0-130	
Bromomethane	0.0200	0.0329	165	15.0-185	
Carbon tetrachloride	0.0200	0.0216	108	70.0-130	
Chlorobenzene	0.0200	0.0196	98.0	65.0-135	
Chloroethane	0.0200	0.0214	107	40.0-160	
Chloroform	0.0200	0.0207	104	70.0-135	
Chloromethane	0.0200	0.0159	79.5	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0177	88.5	25.0-175	
Dibromochloromethane	0.0200	0.0202	101	70.0-135	
Ethylbenzene	0.0200	0.0197	98.5	60.0-140	
Methylene Chloride	0.0200	0.0221	111	60.0-140	
Tetrachloroethene	0.0200	0.0181	90.5	70.0-130	
Toluene	0.0200	0.0196	98.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0206	103	70.0-130	
Trichloroethene	0.0200	0.0201	101	65.0-135	
Vinyl chloride	0.0200	0.0208	104	5.00-195	
(S) 1,2-Dichloroethane-d4			95.4	70.0-130	
(S) 4-Bromofluorobenzene			91.3	70.0-130	
(S) Toluene-d8			99.6	70.0-130	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/09/24 18:02 • (MS) R4091976-3 07/09/24 18:26 • (MSD) R4091976-4 07/09/24 18:51

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0199	U	0.0200	0.0203	101	102	1	52.0-162			1.49	36
1,1,2,2-Tetrachloroethane	0.0201	U	0.0183	0.0188	91.0	93.5	1	46.0-157			2.70	61
1,1,2-Trichloroethane	0.0199	U	0.0194	0.0193	97.5	97.0	1	52.0-150			0.517	45
1,1-Dichloroethene	0.0200	U	0.0203	0.0203	102	102	1	1.00-234			0.000	32
1,1-Dichloroethane	0.0200	U	0.0214	0.0211	107	105	1	59.0-155			1.41	40
1,2-Dibromoethane	0.0200	U	0.0184	0.0187	92.0	93.5	1	70.0-130			1.62	20
1,2-Dichlorobenzene	0.0200	U	0.0212	0.0213	106	106	1	18.0-190			0.471	57
1,2-Dichloroethane	0.0200	U	0.0208	0.0209	104	105	1	49.0-155			0.480	49
1,2-Dichloropropane	0.0199	U	0.0185	0.0185	93.0	93.0	1	1.00-210			0.000	55
1,3-Dichlorobenzene	0.0199	U	0.0203	0.0205	102	103	1	59.0-156			0.980	43
1,4-Dichlorobenzene	0.0200	U	0.0201	0.0201	101	101	1	18.0-190			0.000	57
2-Butanone (MEK)	0.100	U	0.0762	0.0774	76.2	77.4	1	70.0-130			1.56	20
2-Chloroethyl vinyl ether	0.100	U	U	U	0.000	0.000	1	1.00-305	J6	J6	0.000	71
Acrolein	0.100	U	0.0936	0.0921	93.6	92.1	1	4.00-172			1.62	20
Acrylonitrile	0.100	U	0.0986	0.104	98.6	104	1	22.0-189			5.33	20
Benzene	0.0200	U	0.0204	0.0202	102	101	1	37.0-151			0.985	61
Bromodichloromethane	0.0199	U	0.0203	0.0199	102	100	1	35.0-155			1.99	56
Bromoform	0.0198	U	0.0225	0.0229	114	116	1	70.0-130			1.76	42
Bromomethane	0.0200	U	0.0261	0.0283	131	142	1	15.0-185			8.09	61
Carbon tetrachloride	0.0200	U	0.0224	0.0225	112	113	1	70.0-140			0.445	41
Chlorobenzene	0.0200	U	0.0203	0.0205	102	103	1	37.0-160			0.980	53
Chloroethane	0.0200	U	0.0203	0.0198	102	99.0	1	14.0-230			2.49	78
Chloroform	0.0200	U	0.0212	0.0215	106	108	1	51.0-138			1.41	54
Chloromethane	0.0200	U	0.0133	0.0137	66.5	68.5	1	1.00-273			2.96	20
cis-1,3-Dichloropropene	0.0200	U	0.0179	0.0181	89.5	90.5	1	1.00-227			1.11	58
Dibromochloromethane	0.0198	U	0.0204	0.0202	103	102	1	53.0-149			0.985	50
Ethylbenzene	0.0200	U	0.0211	0.0209	105	105	1	37.0-162			0.952	63
Methylene Chloride	0.0204	U	0.0193	0.0198	94.6	97.1	1	1.00-221	J	J	2.56	28
Tetrachloroethene	0.0200	U	0.0194	0.0193	97.0	96.5	1	64.0-148			0.517	39
Toluene	0.0200	U	0.0208	0.0206	104	103	1	47.0-150			0.966	41
trans-1,2-Dichloroethene	0.0200	U	0.0213	0.0213	106	106	1	54.0-156			0.000	45
Trichloroethene	0.0200	U	0.0215	0.0213	108	106	1	70.0-157			0.935	48
Vinyl chloride	0.0200	U	0.0189	0.0187	94.5	93.5	1	1.00-251			1.06	66
(S) 1,2-Dichloroethane-d4					97.2	97.9		70.0-130				
(S) 4-Bromofluorobenzene					90.3	91.8		70.0-130				
(S) Toluene-d8					101	100		70.0-130				

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093629-1 07/14/24 04:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l	
PCB 1016	U		0.000270	0.000500	
PCB 1221	U		0.000270	0.000500	
PCB 1232	U		0.000270	0.000500	
PCB 1242	U		0.000270	0.000500	
PCB 1248	U		0.000173	0.000500	
PCB 1254	U		0.000173	0.000500	
PCB 1260	U		0.000173	0.000500	
Total PCBs	U		0.000173	0.000500	
(S) Decachlorobiphenyl	40.9			10.0-144	
(S) Tetrachloro-m-xylene	77.2			10.0-135	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4093629-5 07/14/24 04:50

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00226	90.4	50.0-140	
PCB 1260	0.00250	0.00211	84.4	8.00-140	
(S) Decachlorobiphenyl			69.4	10.0-144	
(S) Tetrachloro-m-xylene			79.7	10.0-135	

L1754575-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754575-01 07/14/24 06:36 • (MS) R4093629-6 07/14/24 07:08 • (MSD) R4093629-7 07/14/24 07:20

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
PCB 1016	0.00250	U	0.00210	0.00204	84.0	81.6	1	50.0-140			2.90	36
PCB 1260	0.00250	U	0.00139	0.00146	55.6	58.4	1	8.00-140			4.91	38
(S) Decachlorobiphenyl					39.5	42.5		10.0-144				
(S) Tetrachloro-m-xylene					69.7	70.6		10.0-135				

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	55.0			29.0-132
(S) 2-Fluorobiphenyl	81.5			26.0-102
(S) 2-Fluorophenol	72.5	J1		10.0-66.0
(S) Nitrobenzene-d5	82.5			15.0-106
(S) p-Terphenyl-d14	95.0			10.0-120

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	69.0	J1		10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.141	70.5	31.0-120	
2,4,6-Trichlorophenol	0.200	0.175	87.5	37.0-144	
2,4-Dichlorophenol	0.200	0.168	84.0	39.0-135	
2,4-Dimethylphenol	0.200	0.171	85.5	32.0-120	
2,4-Dinitrophenol	0.200	0.123	61.5	100-191	
2-Chlorophenol	0.200	0.172	86.0	23.0-134	
2-Methylphenol	0.200	0.179	89.5	26.0-120	
2-Nitrophenol	0.200	0.160	80.0	29.0-182	
3&4-Methyl Phenol	0.200	0.169	84.5	27.0-120	
3,3-Dichlorobenzidine	0.400	0.401	100	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.152	76.0	100-181	
4-Chloro-3-methylphenol	0.200	0.170	85.0	22.0-147	
4-Nitrophenol	0.200	0.121	60.5	100-132	
Anthracene	0.200	0.184	92.0	27.0-133	
Benzidine	0.400	0.125	31.3	100-120	
Benzo(a)anthracene	0.200	0.189	94.5	33.0-143	
Benzo(a)pyrene	0.200	0.200	100	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.163	81.5	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.213	106	8.00-158	
Chrysene	0.200	0.178	89.0	17.0-168	
Di-n-butyl phthalate	0.200	0.196	98.0	100-120	
Hexachloro-1,3-butadiene	0.200	0.128	64.0	24.0-120	
Hexachlorobenzene	0.200	0.150	75.0	100-152	
Hexachlorocyclopentadiene	0.200	0.120	60.0	10.0-120	
Hexachloroethane	0.200	0.142	71.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.174	87.0	39.0-127	
n-Nitrosodiethylamine	0.200	0.182	91.0	10.0-142	
Nitrobenzene	0.200	0.169	84.5	35.0-180	
Nonylphenol	0.200	0.189	94.5	57.0-136	
Pentachlorobenzene	0.200	0.138	69.0	10.0-151	
Pentachlorophenol	0.200	0.163	81.5	14.0-176	
Phenanthrene	0.200	0.173	86.5	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.137	68.5	5.00-120	
Pyridine	0.200	0.0338	16.9	10.0-120	
Total Cresols	0.400	0.348	87.0	36.0-110	
(S) 2,4,6-Tribromophenol			67.5	29.0-132	
(S) 2-Fluorobiphenyl			81.5	26.0-102	
(S) 2-Fluorophenol			75.5	10.0-66.0	J1
(S) Nitrobenzene-d5			81.5	15.0-106	
(S) p-Terphenyl-d14			92.0	10.0-120	
(S) Phenol-d6			73.5	10.0-54.0	J1

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
ND	Not detected at the Reporting Limit (or MDL where applicable).
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier	Description
B	The same analyte is found in the associated blank.
B1	The blank depletion was greater than the recommended maximum depletion of 0.2mg/L.
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J3	The associated batch QC was outside the established quality control range for precision.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
P1	RPD value not applicable for sample concentrations less than 5 times the reporting limit.
Q	Sample was prepared and/or analyzed past holding time as defined in the method. Concentrations should be considered minimum values.
T8	Sample(s) received past/too close to holding time expiration.
V	The sample concentration is too high to evaluate accurate spike recoveries.

1	Cp
2	Tc
3	Ss
4	Cn
5	Sr
6	Qc
7	Gi
8	Al
9	Sc

# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey-NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio-VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		

## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013

Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn


<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

<div><b>CHAIN-OF-CUSTODY Analytical Request Document</b></div> <div>Chain-of-Custody is a LEGAL DOCUMENT - Complete all relevant fields</div>										LAB USE ONLY- Affix Workorder/Login Label Here or List Pace Workorder Number or MTJL Log-In Number Here														
Company: <b>GP</b>					Billing Information:					<b>ALL SHADED AREAS are for LAB USE ONLY</b>														
Address: <b>13835 CL 485</b>																								
Report To:					Email To:					Container Preservative Type **														
Copy To:					Site Collection Info/Address:					Lab Project Manager:														
Customer Project Name/Number:					State: County/City: Time Zone Collected: [ ] PT [ ] MT [ ] CT [ ] ET					** Preservative Types: (1) nitric acid, (2) sulfuric acid, (3) hydrochloric acid, (4) sodium hydroxide, (5) zinc acetate, (6) methanol, (7) sodium bisulfate, (8) sodium thiosulfate, (9) hexane, (A) ascorbic acid, (B) ammonium sulfate, (C) ammonium hydroxide, (D) TSP, (U) Unpreserved, (O) Other														
Phone:			Site/Facility ID #:			Compliance Monitoring?			Analyses															
Email:						[ ] Yes [ ] No																		
Collected By (print):			Purchase Order #: Quote #:			DW PWS ID #: DW Location Code:			Lab Profile/Line:															
Collected By (signature):			Turnaround Date Required:			Immediately Packed on Ice: [ ] Yes [ ] No																		
Sample Disposal:			Rush:			Field Filtered (if applicable):			Lab Sample Receipt Checklist:															
[ ] Dispose as appropriate [ ] Return [ ] Archive: [ ] Hold:			[ ] Same Day [ ] Next Day [ ] 2 Day [ ] 3 Day [ ] 4 Day [ ] 5 Day (Expedite Charges Apply)			[ ] Yes [ ] No Analysis:																		
* Matrix Codes (Insert in Matrix box below): Drinking Water (DW), Ground Water (GW), Wastewater (WW), Product (P), Soil/Solid (SL), Oil (OL), Wipe (WP), Air (AR), Tissue (TS), Bioassay (B), Vapor (V), Other (OT)															Custody Seals Present/Intact Y N NA Custody Signatures Present Y N NA Collector Signature Present Y N NA Bottles Intact Y N NA Correct Bottles Y N NA Sufficient Volume Y N NA Samples Received on Ice Y N NA VOA - Headspace Acceptable Y N NA USDA Regulated Soils Y N NA Samples in Holding Time Y N NA Residual Chlorine Present Y N NA Cl Strips: _____ Sample pH Acceptable Y N NA pH Strips: _____ Sulfide Present Y N NA Lead Acetate Strips: _____  LAB USE ONLY: Lab Sample # / Comments:									
Customer Sample ID		Matrix *	Comp / Grab	Collected (or Composite Start)		Composite End		Res Cl	# of Ctns															
OUTFALL CO1		NW	G	Date Time		Date Time				See Attached														
Customer Remarks / Special Conditions / Possible Hazards:										Type of Ice Used: Wet Blue Dry None					SHORT HOLDS PRESENT (<72 hours): Y N N/A					Lab Sample Temperature Info:				
EDA7 1.2+0.3=1.5										Packing Material Used:					Lab Tracking #: 2893476					Temp Blank Received: Y N NA Therm ID#: _____ Cooler 1 Temp Upon Receipt: _____ oC Cooler 1 Therm Corr. Factor: _____ oC Cooler 1 Corrected Temp: _____ oC Comments:				
										Radchem sample(s) screened (<500 cpm): Y N NA					Samples received via: FEDEX UPS Client Courier Pace Courier					MTJL LAB USE ONLY				
Relinquished by/Company: (Signature)					Date/Time: 1430 7/8/24					Received by/Company: (Signature)					Date/Time: 1430 7/8/24					Table #:				
Relinquished by/Company: (Signature)					Date/Time: 7/9/24 1700					Received by/Company: (Signature)					Date/Time: 7/9/24 1700					Acctnum:				
Relinquished by/Company: (Signature)					Date/Time:					Received by/Company: (Signature)					Date/Time:					Template:				
																				Prelogin:				
																				PM:				
																				Non Conformance(s):				
																				Page: _____				





DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

## Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ AustinClient Name: GPL Project Work order (place label):Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☒ No ☐Received on ice: Wet ☒ Blue ☐ No ice ☐Receiving Lab 1 Thermometer Used: IR-18 Cooler Temp °C: 26.9 (Recorded) 10.3 (Correction Factor) 28.2 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AG Date: 7/9/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6.402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Sulfide Present Lead Acetate Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas State Sampled: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Non-Conformance(s):	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: JW Date: 7/8/24

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

Time estimate: oh

Time spent: oh

## Members



Jeremy Watkins (responsible)



Dorothy Roberts

☐ 1. If Chain-of-custody (COC) is not received: contact client and if necessary, fill out a COC and indicate that it was filled out by lab personnel. Note issues on this NCF.

☐ 2. If COC is incomplete, check applicable issues below and add details where appropriate:

☐ \*Collection date/time missing or incorrect

☐ \*Analyses or analytes: missing or Clarification needed

☐ \*Samples listed on COC do not match samples recieved (missing, additional,etc.)

☐ \*Sample IDs on COC do not match sample Labels

☐ \*Required trip blanks were not received

☐ \*Required signatures are missing

☒ 3. Sample integrity issues: check applicable issues below and add details where appropriate:

☐ \*Samples: Past holding time

☐ \*Samples: Not Field Filtered

☐ \*samples: Insufficient volume received

☐ \*Samples: Cooler damaged or compromised

☐ \*Samples: contain Chlorine or Sulfide

☐ \*Samples: condition needs to be brought to lab personnel's attention (details below)

☐ \*Containers: Broken or compromised

☐ \*Containers: Incorrect

☐ \*Custody Seals: missing or compromised on samples, trip blanks or coolers

☐ \*Packing Material: Insufficient/Improper

☒ \*Preservation: improper

☐ \*Temperature: not within acceptance criteria (typically 0-6C)

☐ \*Temperature: Samples arrived frozen

☐ \*Vials received with improper headspace

☐ \*Other:

☐ 4. If Samples not preserved properly and Sample Receiving adjusts pH, add details below:

☐ Sample ID: \_\_\_\_\_

☐ Preserved by: \_\_\_\_\_

☐ Date/Time: \_\_\_\_\_

☐ Initial and Final pH: \_\_\_\_\_

☐ Amount/type pres added: \_\_\_\_\_

☐ Lot # of Pres added: \_\_\_\_\_

☐ 5. Client contact: If Client is Contacted for any issue listed above, fill in details below:

☒ Client:

☒ PM Initials: DPR

☒ Contacted per: JMcClain

☒ Date/Time: 07/09/24 1050

## Comments

*Jeremy Watkins*

*9 July 2024 10:21 AM*

CN and SULFIDE recieved unpreserved.

*Dorothy Roberts*

*10 July 2024 9:35 AM*

Proceed / may not report if replacements can be collected

also sending replacement bottles T256352

**Garland Power & Light**

Sample Delivery Group: L1756836

Samples Received: 07/16/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By:



Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1756836-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	16
Wet Chemistry by Method 351.2	17
Wet Chemistry by Method 353.2	18
Wet Chemistry by Method 360.1	19
Wet Chemistry by Method 4500Cl G-2011	20
Wet Chemistry by Method 4500CN-E	21
Wet Chemistry by Method 4500P-E	22
Wet Chemistry by Method 4500-S2 D	23
Wet Chemistry by Method 4500SO3 B-2011	24
Wet Chemistry by Method 5210 B-2016	25
Wet Chemistry by Method 5220D	27
Wet Chemistry by Method 5310C	28
Wet Chemistry by Method 5540C	29
Wet Chemistry by Method SM 4500-H+B	30
Wet Chemistry by Method SM4500NH3H	31
Mercury by Method 245.1	32
Metals (ICP) by Method 200.7	33
Metals (ICPMS) by Method 200.8	34
Volatile Organic Compounds (GC/MS) by Method 624.1	36
Polychlorinated Biphenyls (GC) by Method EPA-608.3	39
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	40
Gl: Glossary of Terms	43
Al: Accreditations & Locations	44
Sc: Sample Chain of Custody	45

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc



# SAMPLE SUMMARY

OUTFALL 001 L1756836-01 WW

Collected by

Collected date/time

Received date/time

07/16/24 08:18

07/16/24 09:42

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2327774	1	07/22/24 16:22	07/22/24 16:22	EIG	Allen, TX
Calculated Results	WG2329841	1	07/26/24 14:40	07/26/24 14:40	NA	Allen, TX
Gravimetric Analysis by Method 2540C	WG2325834	1	07/18/24 15:18	07/18/24 17:02	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2328064	1	07/23/24 06:21	07/23/24 07:41	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2324487	1	07/18/24 13:00	07/19/24 09:53	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2324656	1	07/17/24 13:58	07/17/24 13:58	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2327704	1	07/22/24 12:47	07/22/24 12:47	JBS	Allen, TX
Wet Chemistry by Method 300.0	WG2323759	1	07/16/24 17:30	07/16/24 17:30	SMC	Allen, TX
Wet Chemistry by Method 300.0	WG2323759	5	07/16/24 22:34	07/16/24 22:34	SMC	Allen, TX
Wet Chemistry by Method 3500Cr-B	WG2324738	1	07/17/24 15:16	07/17/24 15:16	KCM	Allen, TX
Wet Chemistry by Method 351.2	WG2326234	1	07/19/24 10:40	07/19/24 20:41	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2325801	1	07/18/24 15:59	07/18/24 15:59	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2324067	1	07/16/24 14:05	07/16/24 14:05	JBS	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2325082	1	07/18/24 12:43	07/18/24 12:43	JAR	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2325383	1	07/18/24 11:00	07/18/24 18:49	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2328176	1	07/23/24 15:25	07/23/24 15:25	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2327473	1	07/22/24 16:34	07/22/24 16:34	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2324648	1	07/17/24 13:40	07/17/24 13:40	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2328484	1	07/23/24 15:00	07/23/24 15:00	CAH	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2323729	1	07/16/24 15:58	07/21/24 11:53	JBS	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2323730	1	07/16/24 17:37	07/21/24 13:30	JBS	Allen, TX
Wet Chemistry by Method 5220D	WG2324533	1	07/17/24 08:52	07/17/24 11:53	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2323910	2	07/16/24 20:56	07/16/24 20:56	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2324658	1	07/17/24 17:24	07/17/24 17:29	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2325390	1	07/18/24 08:46	07/18/24 08:46	SEN	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2327774	1	07/22/24 16:22	07/22/24 16:22	EIG	Allen, TX
Mercury by Method 245.1	WG2325148	1	07/18/24 12:44	07/18/24 17:47	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2325465	1	07/18/24 16:25	07/19/24 10:56	SKW	Allen, TX
Metals (ICPMS) by Method 200.8	WG2329841	1	07/25/24 15:11	07/26/24 14:40	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2324214	1	07/16/24 22:36	07/16/24 22:36	ZST	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2325314	1	07/18/24 20:00	07/19/24 02:59	NWH	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2324634	1	07/17/24 09:31	07/19/24 15:22	XLY	Allen, TX

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager

## Sample Delivery Group (SDG) Narrative

**Analysis was filtered in the laboratory.**

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1756836-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B

**No extra volume received to perform Matrix Spike samples.**

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1756836-01</a>	<a href="#">OUTFALL 001</a>	625.1



Calculated Results

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Trivalent	U		0.000510	0.00300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Organic Nitrogen	0.478		0.0280	0.100	1	07/22/2024 16:22	<a href="#">WG2327774</a>

1  
Cp

2  
Tc

3  
Ss

Gravimetric Analysis by Method 2540C

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Total Dissolved Solids	219	<a href="#">J3</a>	25.0	1	07/18/2024 17:02	<a href="#">WG2325834</a>

4  
Cn

5  
Sr

Gravimetric Analysis by Method 2540D

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Suspended Solids	ND		5.00	1	07/23/2024 07:41	<a href="#">WG2328064</a>

6  
Qc

7  
Gl

Wet Chemistry by Method 1664A

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Oil & Grease (Hexane Extr)	U		0.350	5.00	1	07/19/2024 09:53	<a href="#">WG2324487</a>

8  
Al

9  
Sc

Wet Chemistry by Method 2120B

Analyte	Result units	Qualifier	RDL units	Dilution	Analysis date / time	Batch
Color	20.0		5.00	1	07/17/2024 13:58	<a href="#">WG2324656</a>

Sample Narrative:

L1756836-01 WG2324656: 7

Wet Chemistry by Method 2320B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Alkalinity	110		20.0	20.0	1	07/22/2024 12:47	<a href="#">WG2327704</a>

Wet Chemistry by Method 300.0

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Bromide	0.116	<a href="#">J</a>	0.0668	0.400	1	07/16/2024 17:30	<a href="#">WG2323759</a>
Chloride	16.1	<a href="#">J5</a>	1.62	4.00	5	07/16/2024 22:34	<a href="#">WG2323759</a>
Fluoride	0.243	<a href="#">J</a>	0.0947	0.500	1	07/16/2024 17:30	<a href="#">WG2323759</a>
Nitrate	U		0.379	0.500	1	07/16/2024 17:30	<a href="#">WG2323759</a>
Sulfate	27.3	<a href="#">V</a>	1.06	3.50	5	07/16/2024 22:34	<a href="#">WG2323759</a>

Wet Chemistry by Method 3500Cr-B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Hexavalent	U		0.00200	0.00300	1	07/17/2024 15:16	<a href="#">WG2324738</a>

Sample Narrative:

L1756836-01 WG2324738: Sample preserved in lab w/in 24 hrs of collection

Wet Chemistry by Method 351.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Kjeldahl Nitrogen, TKN	0.478		0.140	0.250	1	07/19/2024 20:41	<a href="#">WG2326234</a>

## OUTFALL 001

Collected date/time: 07/16/24 08:18

## SAMPLE RESULTS - 01

L1756836

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	07/18/2024 15:59	<a href="#">WG2325801</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	7.77	<a href="#">T8</a>	1	1	1	07/16/2024 14:05	<a href="#">WG2324067</a>

## Wet Chemistry by Method 4500CI G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.0420	<a href="#">J T8</a>	0.0260	0.100	1	07/18/2024 12:43	<a href="#">WG2325082</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/18/2024 18:49	<a href="#">WG2325383</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00350	0.0100	1	07/23/2024 15:25	WG2328176

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.0442	<a href="#">J</a>	0.0152	0.0500	1	07/22/2024 16:34	<a href="#">WG2327473</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/17/2024 13:40	<a href="#">WG2324648</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	07/23/2024 15:00	<a href="#">WG2328484</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	2.53		1.00	1	1	07/21/2024 11:53	<a href="#">WG2323729</a>
CBOD	2.52		1.00	1	1	07/21/2024 13:30	<a href="#">WG2323730</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	22.2	<a href="#">J</a>	16.1	35.0	1	07/17/2024 11:53	<a href="#">WG2324533</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------

OUTFALL 001

SAMPLE RESULTS - 01

Collected date/time: 07/16/24 08:18

L1756836

Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	5.34		0.540	1.40	2	07/16/2024 20:56	<a href="#">WG2323910</a>

1  
Cp

2  
Tc

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">J5</a>	0.360	0.500	1	07/17/2024 17:29	<a href="#">WG2324658</a>

3  
Ss

4  
Cn

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	8.35	<a href="#">T8</a>	1	07/18/2024 08:46	<a href="#">WG2325390</a>

5  
Sr

6  
Qc

Sample Narrative:

L1756836-01 WG2325390: 8.35 at 23.6C

7  
Gl

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	U		0.0280	0.100	1	07/22/2024 16:22	<a href="#">WG2327774</a>

8  
Al

9  
Sc

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	0.0000450	<a href="#">J</a>	0.0000450	0.000200	1	07/18/2024 17:47	<a href="#">WG2325148</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0702	<a href="#">J</a>	0.0186	0.100	1	07/19/2024 10:56	<a href="#">WG2325465</a>
Tin	U		0.00240	0.0250	1	07/19/2024 10:56	<a href="#">WG2325465</a>
Titanium	U		0.00835	0.100	1	07/19/2024 10:56	<a href="#">WG2325465</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.167		0.00186	0.00250	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Antimony	U		0.000580	0.00500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Arsenic	0.00528		0.000100	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Barium	0.0341		0.000440	0.00300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Beryllium	0.0000927	<a href="#">J</a>	0.0000600	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Cadmium	U		0.000120	0.00100	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Chromium	U		0.000510	0.00300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Cobalt	0.00305		0.0000400	0.000300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Copper	0.00257		0.000900	0.00200	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Iron	0.153		0.00432	0.00700	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Lead	0.000221	<a href="#">J</a>	0.000140	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Magnesium	3.92	<a href="#">J6</a>	0.0121	0.0200	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Manganese	0.0439		0.000330	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Molybdenum	0.00174		0.000530	0.00100	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Nickel	0.00163	<a href="#">J</a>	0.000640	0.00200	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Selenium	U		0.000740	0.00500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Silver	U		0.0000800	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Thallium	0.000894	<a href="#">B</a>	0.000190	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>

## OUTFALL 001

Collected date/time: 07/16/24 08:18

## SAMPLE RESULTS - 01

L1756836

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	U		0.00265	0.00500	1	07/26/2024 14:40	<a href="#">WG2329841</a>

<sup>1</sup> Cp<sup>2</sup> Tc<sup>3</sup> Ss<sup>4</sup> Cn<sup>5</sup> Sr<sup>6</sup> Qc<sup>7</sup> Gl<sup>8</sup> Al<sup>9</sup> Sc

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
2-Butanone (MEK)	U	<a href="#">J6</a>	0.00822	0.0250	1	07/16/2024 22:36	<a href="#">WG2324214</a>
2-Chloroethyl vinyl ether	U		0.00652	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Acrolein	U		0.00544	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Acrylonitrile	U		0.00709	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Benzene	U		0.00207	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Bromoform	U		0.000960	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Bromomethane	U		0.00347	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chlorobenzene	U		0.00276	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chloroethane	U		0.00296	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chloroform	U		0.00212	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chloromethane	U		0.00361	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Ethylbenzene	U		0.000401	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Methylene Chloride	U		0.0117	0.0200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Toluene	U		0.00219	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Trichloroethene	U		0.00262	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Vinyl chloride	U		0.00466	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
(S) 1,2-Dichloroethane-d4	101			70.0-130		07/16/2024 22:36	<a href="#">WG2324214</a>
(S) 4-Bromofluorobenzene	101			70.0-130		07/16/2024 22:36	<a href="#">WG2324214</a>
(S) Toluene-d8	100			70.0-130		07/16/2024 22:36	<a href="#">WG2324214</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1221	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1232	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1242	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1248	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1254	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1260	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
Total PCBs	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
(S) Decachlorobiphenyl	15.8			10.0-144		07/19/2024 02:59	<a href="#">WG2325314</a>
(S) Tetrachloro-m-xylene	32.2			10.0-135		07/19/2024 02:59	<a href="#">WG2325314</a>



## OUTFALL 001

## SAMPLE RESULTS - 01

Collected date/time: 07/16/24 08:18

L1756836

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2-Chlorophenol	U		0.000307	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2-Methylphenol	U		0.000238	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2-Nitrophenol	U		0.000247	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	07/19/2024 15:22	<a href="#">WG2324634</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
4-Nitrophenol	U		0.00123	0.0100	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Anthracene	U		0.000168	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Benzidine	U		0.000350	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Chrysene	U		0.000257	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachlorobenzene	U		0.000307	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachloroethane	U		0.000247	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Nitrobenzene	U		0.000314	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Nonylphenol	U		0.000168	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Pentachlorobenzene	U		0.000247	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Pentachlorophenol	U		0.000283	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Phenanthrene	U		0.000200	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Phenol	U		0.000500	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Pyridine	U		0.00174	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Total Cresols	U		0.00153	0.00800	1	07/19/2024 15:22	<a href="#">WG2324634</a>
(S) 2,4,6-Tribromophenol	60.4			29.0-132		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) 2-Fluorobiphenyl	70.3			26.0-102		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) 2-Fluorophenol	64.8			10.0-66.0		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) Nitrobenzene-d5	74.7			15.0-106		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) p-Terphenyl-d14	87.9			10.0-120		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) Phenol-D6	57.1	<a href="#">J1</a>		10.0-54.0		07/19/2024 15:22	<a href="#">WG2324634</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4096041-1 07/18/24 17:02

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Total Dissolved Solids	U		25.0	25.0

L1756796-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756796-01 07/18/24 17:02 • (DUP) R4096041-3 07/18/24 17:02

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Total Dissolved Solids	411	399	1	2.96		10

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/18/24 17:02 • (DUP) R4096041-4 07/18/24 17:02

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Total Dissolved Solids	219	178	1	20.7	J3	10

Laboratory Control Sample (LCS)

(LCS) R4096041-2 07/18/24 17:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Total Dissolved Solids	2410	2500	104	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4097307-1 07/23/24 07:41

	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Suspended Solids	U		2.50	2.50

L1756933-05 Original Sample (OS) • Duplicate (DUP)

(OS) L1756933-05 07/23/24 07:41 • (DUP) R4097307-3 07/23/24 07:41

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	14300	14200	1	0.840		10

L1756933-06 Original Sample (OS) • Duplicate (DUP)

(OS) L1756933-06 07/23/24 07:41 • (DUP) R4097307-4 07/23/24 07:41

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	14300	14100	1	1.83		10

Laboratory Control Sample (LCS)

(LCS) R4097307-2 07/23/24 07:41

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	mg/l	mg/l	%	%	
Suspended Solids	879	820	93.3	85.0-115	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4096035-1 07/19/24 09:53

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4096035-2 07/19/24 09:53 • (LCSD) R4096035-3 07/19/24 09:53

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	35.3	36.2	88.3	90.5	78.0-114			2.52	18

L1756705-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1756705-02 07/19/24 09:53 • (MS) R4096035-4 07/19/24 09:53

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	34.0	85.1	1	78.0-114	

Method Blank (MB)

(MB) R4094918-1 07/17/24 13:58

Analyte	MB Result units	MB Qualifier	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:  
BLANK: 7

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/17/24 13:58 • (DUP) R4094918-2 07/17/24 13:58

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:  
OS: 7  
DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096806-1 07/22/24 12:47

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/22/24 12:47 • (DUP) R4096806-3 07/22/24 12:47

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	110	112	1	1.80		20

<sup>7</sup>Gl

<sup>8</sup>Al

Laboratory Control Sample (LCS)

(LCS) R4096806-2 07/22/24 12:47

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	240	96.0	90.0-110	

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4094668-1 07/16/24 16:19

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.0668	0.400
Chloride	U		0.325	0.800
Fluoride	U		0.0947	0.500
Nitrate	U		0.379	0.500
Sulfate	U		0.211	0.700

Laboratory Control Sample (LCS)

(LCS) R4094668-2 07/16/24 16:37

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	5.00	5.38	108	90.0-110	
Chloride	5.00	5.19	104	90.0-110	
Fluoride	5.00	5.33	107	90.0-110	
Nitrate	5.00	5.17	103	90.0-110	
Sulfate	5.00	5.37	107	90.0-110	

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/16/24 17:30 • (MS) R4094668-3 07/16/24 21:58 • (MSD) R4094668-4 07/16/24 22:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Bromide	5.00	0.116	5.50	5.53	108	108	1	90.0-110			0.508	20
Fluoride	5.00	0.243	5.66	5.66	108	108	1	90.0-110			0.0689	20
Nitrate	5.00	U	5.24	5.25	105	105	1	90.0-110			0.286	20

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/16/24 22:34 • (MS) R4094668-5 07/16/24 22:52 • (MSD) R4094668-6 07/16/24 23:09

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chloride	5.00	16.1	43.4	43.6	546	550	5	90.0-110	J5	J5	0.393	20
Sulfate	5.00	27.3	55.1	55.2	556	560	5	90.0-110	V	V	0.333	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4094993-1 07/17/24 15:16

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

Laboratory Control Sample (LCS)

(LCS) R4094993-2 07/17/24 15:16

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.200	100	85.0-115	

L1754173-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754173-02 07/17/24 15:16 • (MS) R4094993-3 07/17/24 15:16 • (MSD) R4094993-4 07/17/24 15:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	0.00460	0.208	0.210	102	103	1	10.0-120			0.825	20

Sample Narrative:

OS: Sample preserved in lab w/in 24 hrs of collection

L1754768-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754768-01 07/17/24 15:16 • (MS) R4094993-5 07/17/24 15:16 • (MSD) R4094993-6 07/17/24 15:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.198	0.197	98.8	98.4	1	10.0-120			0.437	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096223-1 07/19/24 20:26

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Kjeldahl Nitrogen, TKN	U		0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4096223-2 07/19/24 20:29

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Kjeldahl Nitrogen, TKN	4.00	3.78	94.5	90.0-110	

L1754376-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754376-02 07/19/24 20:31 • (MS) R4096223-3 07/19/24 20:59 • (MSD) R4096223-4 07/19/24 21:00

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Kjeldahl Nitrogen, TKN	20.0	76.7	104	97.3	137	103	10	90.0-110	E J5		6.66	20

L1754397-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754397-01 07/19/24 20:33 • (MS) R4096223-5 07/19/24 21:01 • (MSD) R4096223-6 07/19/24 21:03

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Kjeldahl Nitrogen, TKN	20.0	27.6	50.1	47.0	113	97.0	10	90.0-110	J5		6.39	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4095809-1 07/18/24 15:56

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4095809-2 07/18/24 15:57

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Nitrate-Nitrite	2.50	2.41	96.4	90.0-110	

L1755904-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1755904-01 07/18/24 15:57 • (MS) R4095809-3 07/18/24 16:05 • (MSD) R4095809-4 07/18/24 16:06

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	0.934	3.24	3.23	92.2	91.8	1	90.0-110			0.309	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc



L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/16/24 14:05 • (DUP) R4094367-1 07/16/24 14:05

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	<u>DUP Qualifier</u>	DUP RPD Limits %
Dissolved Oxygen	7.77	8.25	1	5.99		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4095472-1 07/18/24 12:41

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chlorine,residual	U		0.0260	0.100

L1756487-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756487-01 07/18/24 12:42 • (DUP) R4095472-4 07/18/24 12:42

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Chlorine,residual	0.192	0.191	1	0.522		20

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4095472-2 07/18/24 12:41 • (LCSD) R4095472-3 07/18/24 12:41

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Chlorine,residual	1.00	0.975	0.978	97.5	97.8	85.0-115			0.307	20

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4095810-1 07/18/24 18:49

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4095810-2 07/18/24 18:49

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Cyanide	0.100	0.103	103	85.0-115	

L1757293-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757293-02 07/18/24 18:49 • (MS) R4095810-3 07/18/24 18:49 • (MSD) R4095810-4 07/18/24 18:49

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	U	0.0507	0.0507	50.7	50.7	1	85.0-115	J6	J6	0.000	20

L1757408-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757408-06 07/18/24 18:49 • (MS) R4095810-5 07/18/24 18:49 • (MSD) R4095810-6 07/18/24 18:49

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	0.00474	0.0900	0.0940	90.0	94.0	1	85.0-115			4.34	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4096931-1 07/22/24 16:34

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4096931-2 07/22/24 16:34

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phosphorus,Total	0.500	0.513	103	80.0-120	

L1757284-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757284-02 07/22/24 16:34 • (MS) R4096931-3 07/22/24 16:35 • (MSD) R4096931-4 07/22/24 16:35

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.164	0.686	0.666	104	100	1	80.0-120			3.01	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4094911-1 07/17/24 13:38

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4094911-2 07/17/24 13:38

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Sulfide	0.800	0.877	110	80.0-120	

L1756950-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756950-02 07/17/24 13:40 • (MS) R4094911-3 07/17/24 13:40 • (MSD) R4094911-4 07/17/24 13:40

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Sulfide	0.800	0.0269	0.591	0.567	70.5	67.5	1	80.0-120	J6	J6	4.07	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4097393-1 07/23/24 15:00

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1757021-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1757021-02 07/23/24 15:00 • (DUP) R4097393-3 07/23/24 15:00

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	6.50	6.50	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4097393-2 07/23/24 15:00

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1757021-03 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757021-03 07/23/24 15:00 • (MS) R4097393-4 07/23/24 15:00 • (MSD) R4097393-5 07/23/24 15:00

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	17.5	18.0	87.5	90.0	1	85.0-115			2.82	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096615-1 07/21/24 11:11

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
BOD	U		0.200	0.200

L1756776-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756776-01 07/21/24 11:42 • (DUP) R4096615-3 07/21/24 11:54

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	7.12	7.08	1	0.563		20

L1756822-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756822-01 07/21/24 11:48 • (DUP) R4096615-4 07/21/24 11:59

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	ND	ND	1	0		20

Laboratory Control Sample (LCS)

(LCS) R4096615-2 07/21/24 11:17

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
BOD	198	194	98.1	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096616-1 07/21/24 12:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
CBOD	U		0.200	0.200

L1756689-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756689-01 07/21/24 12:55 • (DUP) R4096616-3 07/21/24 13:45

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
CBOD	3.79	3.71	1	2.13		20

L1756933-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756933-01 07/21/24 13:39 • (DUP) R4096616-4 07/21/24 13:49

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
CBOD	ND	ND	1	0		20

Laboratory Control Sample (LCS)

(LCS) R4096616-2 07/21/24 12:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
CBOD	198	198	100	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4094848-1 07/17/24 11:53

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

Laboratory Control Sample (LCS)

(LCS) R4094848-2 07/17/24 11:53

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
COD	500	516	103	80.0-120	

L1756038-04 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756038-04 07/17/24 11:53 • (MS) R4094848-3 07/17/24 11:53 • (MSD) R4094848-4 07/17/24 11:53

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
COD	500	28.5	518	531	98.0	100	1	80.0-120			2.39	20

L1756465-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756465-01 07/17/24 11:53 • (MS) R4094848-5 07/17/24 11:53 • (MSD) R4094848-6 07/17/24 11:53

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
COD	500	51.5	531	543	95.9	98.4	1	80.0-120			2.34	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4094841-1 07/16/24 15:35

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4094841-2 07/16/24 15:54

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
TOC (Total Organic Carbon)	10.0	10.2	102	90.0-110	

L1756680-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756680-01 07/16/24 17:14 • (MS) R4094841-3 07/16/24 18:08 • (MSD) R4094841-4 07/16/24 18:36

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
TOC (Total Organic Carbon)	50.0	28.5	79.8	84.1	103	111	5	80.0-120			5.19	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4095086-1 07/17/24 17:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4095086-2 07/17/24 17:29

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
MBAS	1.00	1.12	112	80.0-120	

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/17/24 17:29 • (MS) R4095086-3 07/17/24 17:29 • (MSD) R4095086-4 07/17/24 17:29

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
MBAS	1.00	U	1.25	1.13	125	113	1	80.0-120	J5		10.4	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1756869-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756869-01 07/18/24 08:46 • (DUP) R4095234-2 07/18/24 08:46

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	su	su		%		%
pH	8.99	8.99	1	0.000		20

Sample Narrative:  
OS: 8.99 at 21.7C  
DUP: 8.99 at 21.6C

Laboratory Control Sample (LCS)

(LCS) R4095234-1 07/18/24 08:46

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	su	su	%	%	
pH	6.00	5.97	99.5	99.0-101	

Sample Narrative:  
LCS: 5.97 at 21.2C

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4096965-1 07/22/24 15:38

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	U		0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4096965-2 07/22/24 15:39

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.04	101	80.0-120	

L1755609-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1755609-01 07/22/24 15:57 • (MS) R4096965-3 07/22/24 15:50 • (MSD) R4096965-4 07/22/24 15:52

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.0469	4.91	4.90	97.3	97.1	1	80.0-120			0.204	20

L1756014-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756014-01 07/22/24 15:59 • (MS) R4096965-5 07/22/24 15:53 • (MSD) R4096965-6 07/22/24 15:55

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.120	4.96	4.98	96.8	97.2	1	80.0-120			0.402	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4095624-5 07/18/24 17:12

	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Mercury	U		0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4095624-2 07/18/24 16:54

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	mg/l	mg/l	%	%	
Mercury	0.00250	0.00255	102	85.0-115	

L1756002-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756002-06 07/18/24 16:56 • (MS) R4095624-3 07/18/24 16:58 • (MSD) R4095624-4 07/18/24 17:00

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Mercury	0.00250	0.000119	0.00246	0.00243	93.6	92.4	1	70.0-130			1.23	20

L1756002-04 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756002-04 07/18/24 17:56 • (MS) R4095624-6 07/18/24 17:58 • (MSD) R4095624-7 07/18/24 18:00

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Mercury	0.00250	0.000237	0.00273	0.00270	99.7	98.5	1	70.0-130			1.10	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4095885-1 07/19/24 10:24

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4095885-2 07/19/24 10:28

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.936	93.6	85.0-115	
Tin	1.00	0.994	99.4	85.0-115	
Titanium	1.00	0.979	97.9	85.0-115	

L1756433-03 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756433-03 07/19/24 10:32 • (MS) R4095885-3 07/19/24 10:36 • (MSD) R4095885-4 07/19/24 10:40

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	0.283	1.22	1.19	93.6	91.2	1	70.0-130			1.99	20
Tin	1.00	0.00980	0.974	0.964	96.4	95.4	1	70.0-130			1.10	20
Titanium	1.00	U	0.982	0.954	98.2	95.4	1	70.0-130			2.87	20

1

Cp

2

Tc

3

Ss

4

Cn

5

Sr

6

Qc

7

Gl

8

Al

9

Sc

Method Blank (MB)

(MB) R4098986-1 07/26/24 14:22

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Aluminum	0.00428		0.00186	0.00250
Antimony	U		0.000580	0.00500
Arsenic	0.000112	J	0.000100	0.000500
Barium	U		0.000440	0.00300
Beryllium	U		0.0000600	0.000500
Cadmium	U		0.000120	0.00100
Chromium	U		0.000510	0.00300
Cobalt	U		0.0000400	0.000300
Copper	U		0.000900	0.00200
Iron	0.00462	J	0.00432	0.00700
Lead	U		0.000140	0.000500
Magnesium	U		0.0121	0.0200
Manganese	U		0.000330	0.000500
Molybdenum	U		0.000530	0.00100
Nickel	U		0.000640	0.00200
Selenium	U		0.000740	0.00500
Silver	U		0.0000800	0.000500
Thallium	0.000202	J	0.000190	0.000500
Zinc	U		0.00265	0.00500

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4098986-2 07/26/24 14:34

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Aluminum	1.00	1.03	103	85.0-115	
Antimony	0.100	0.0972	97.2	85.0-115	
Arsenic	0.100	0.103	103	85.0-115	
Barium	0.100	0.0943	94.3	85.0-115	
Beryllium	0.100	0.103	103	85.0-115	
Cadmium	0.100	0.106	106	85.0-115	
Chromium	0.100	0.105	105	85.0-115	
Cobalt	0.100	0.104	104	85.0-115	
Copper	0.100	0.105	105	85.0-115	
Iron	1.00	1.07	107	85.0-115	
Lead	0.100	0.104	104	85.0-115	
Magnesium	1.00	1.08	108	85.0-115	
Manganese	0.100	0.104	104	85.0-115	
Molybdenum	0.100	0.109	109	85.0-115	



Laboratory Control Sample (LCS)

(LCS) R4098986-2 07/26/24 14:34

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Nickel	0.100	0.103	103	85.0-115	
Selenium	0.100	0.105	105	85.0-115	
Silver	0.0500	0.0530	106	85.0-115	
Thallium	0.100	0.0980	98.0	85.0-115	
Zinc	0.100	0.103	103	85.0-115	

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/26/24 14:40 • (MS) R4098986-3 07/26/24 14:59 • (MSD) R4098986-4 07/26/24 15:05

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Aluminum	1.00	0.167	1.06	1.03	89.2	86.1	1	70.0-130			2.97	20
Antimony	0.100	U	0.0847	0.0830	84.7	83.0	1	70.0-130			2.08	20
Arsenic	0.100	0.00528	0.0963	0.0954	91.1	90.1	1	70.0-130			1.02	20
Barium	0.100	0.0341	0.112	0.111	78.2	76.5	1	70.0-130			1.50	20
Beryllium	0.100	0.0000927	0.0964	0.0966	96.3	96.5	1	70.0-130			0.186	20
Cadmium	0.100	U	0.0908	0.0898	90.8	89.8	1	70.0-130			1.12	20
Chromium	0.100	U	0.0915	0.0880	91.5	88.0	1	70.0-130			3.91	20
Cobalt	0.100	0.00305	0.0895	0.0877	86.5	84.6	1	70.0-130			2.06	20
Copper	0.100	0.00257	0.0935	0.0913	91.0	88.7	1	70.0-130			2.40	20
Iron	1.00	0.153	1.18	1.06	103	90.8	1	70.0-130			11.0	20
Lead	0.100	0.000221	0.0913	0.0896	91.1	89.4	1	70.0-130			1.90	20
Magnesium	1.00	3.92	4.50	4.29	58.9	37.8	1	70.0-130	J6	J6	4.79	20
Manganese	0.100	0.0439	0.129	0.124	85.0	79.8	1	70.0-130			4.12	20
Molybdenum	0.100	0.00174	0.0961	0.0951	94.4	93.4	1	70.0-130			1.04	20
Nickel	0.100	0.00163	0.0913	0.0889	89.7	87.3	1	70.0-130			2.60	20
Selenium	0.100	U	0.0974	0.0996	97.4	99.6	1	70.0-130			2.26	20
Silver	0.0500	U	0.0465	0.0465	93.0	93.0	1	70.0-130			0.0109	20
Thallium	0.100	0.000894	0.0919	0.0893	91.0	88.4	1	70.0-130			2.83	20
Zinc	0.100	U	0.0937	0.0896	93.7	89.6	1	70.0-130			4.46	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4095202-2 07/16/24 20:34

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Butanone (MEK)	U		0.00822	0.0250
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	U		0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	101			70.0-130
(S) 4-Bromofluorobenzene	100			70.0-130
(S) Toluene-d8	100			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4095202-1 07/16/24 18:55

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0200	0.0208	104	70.0-130	
1,1,2,2-Tetrachloroethane	0.0200	0.0185	92.5	60.0-140	
1,1,2-Trichloroethane	0.0200	0.0203	102	70.0-130	
1,1-Dichloroethene	0.0200	0.0202	101	50.0-150	
1,1-Dichloroethane	0.0200	0.0195	97.5	70.0-130	
1,2-Dibromoethane	0.0200	0.0200	100	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0204	102	65.0-135	
1,2-Dichloroethane	0.0200	0.0193	96.5	70.0-130	
1,2-Dichloropropane	0.0200	0.0194	97.0	35.0-165	
1,3-Dichlorobenzene	0.0200	0.0201	101	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0197	98.5	65.0-135	
2-Butanone (MEK)	0.100	0.0999	99.9	70.0-130	
2-Chloroethyl vinyl ether	0.100	0.0974	97.4	1.00-225	
Acrolein	0.100	0.103	103	64.0-139	
Acrylonitrile	0.100	0.0991	99.1	67.0-136	
Benzene	0.0200	0.0199	99.5	65.0-135	
Bromodichloromethane	0.0200	0.0202	101	65.0-135	
Bromoform	0.0200	0.0189	94.5	70.0-130	
Bromomethane	0.0200	0.0235	117	15.0-185	
Carbon tetrachloride	0.0200	0.0197	98.5	70.0-130	
Chlorobenzene	0.0200	0.0199	99.5	65.0-135	
Chloroethane	0.0200	0.0195	97.5	40.0-160	
Chloroform	0.0200	0.0199	99.5	70.0-135	
Chloromethane	0.0200	0.0173	86.5	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0192	96.0	25.0-175	
Dibromochloromethane	0.0200	0.0196	98.0	70.0-135	
Ethylbenzene	0.0200	0.0200	100	60.0-140	
Methylene Chloride	0.0200	0.0197	98.5	60.0-140	U
Tetrachloroethene	0.0200	0.0197	98.5	70.0-130	
Toluene	0.0200	0.0196	98.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0202	101	70.0-130	
Trichloroethene	0.0200	0.0215	108	65.0-135	
Vinyl chloride	0.0200	0.0197	98.5	5.00-195	
(S) 1,2-Dichloroethane-d4			107	70.0-130	
(S) 4-Bromofluorobenzene			100	70.0-130	
(S) Toluene-d8			101	70.0-130	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/16/24 22:36 • (MS) R4095202-3 07/16/24 23:00 • (MSD) R4095202-4 07/16/24 23:25

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0200	U	0.0217	0.0194	109	97.0	1	52.0-162			11.2	36
1,1,2,2-Tetrachloroethane	0.0200	U	0.0178	0.0174	89.0	87.0	1	46.0-157			2.27	61
1,1,2-Trichloroethane	0.0200	U	0.0198	0.0189	99.0	94.5	1	52.0-150			4.65	45
1,1-Dichloroethene	0.0200	U	0.0225	0.0206	113	103	1	1.00-234			8.82	32
1,2-Dibromoethane	0.0200	U	0.0187	0.0186	93.5	93.0	1	70.0-130			0.536	20
1,2-Dichlorobenzene	0.0200	U	0.0215	0.0199	108	99.5	1	18.0-190			7.73	57
1,2-Dichloroethane	0.0200	U	0.0200	0.0192	100	96.0	1	49.0-155			4.08	49
1,2-Dichloropropane	0.0200	U	0.0201	0.0183	101	91.5	1	1.00-210			9.37	55
1,3-Dichlorobenzene	0.0200	U	0.0208	0.0192	104	96.0	1	59.0-156			8.00	43
1,4-Dichlorobenzene	0.0200	U	0.0202	0.0198	101	99.0	1	18.0-190			2.00	57
2-Butanone (MEK)	0.100	U	0.0618	0.0625	61.8	62.5	1	70.0-130	J6	J6	1.13	20
2-Chloroethyl vinyl ether	0.100	U	0.0768	0.0713	76.8	71.3	1	1.00-305			7.43	71
Acrolein	0.100	U	0.0515	0.0489	51.5	48.9	1	4.00-172			5.18	20
Acrylonitrile	0.100	U	0.0908	0.0796	90.8	79.6	1	22.0-189			13.1	20
Benzene	0.0200	U	0.0215	0.0196	108	98.0	1	37.0-151			9.25	61
Bromodichloromethane	0.0200	U	0.0203	0.0184	102	92.0	1	35.0-155			9.82	56
Bromoform	0.0200	U	0.0171	0.0169	85.5	84.5	1	70.0-130			1.18	42
Bromomethane	0.0200	U	0.0199	0.0178	99.5	89.0	1	15.0-185			11.1	61
Carbon tetrachloride	0.0200	U	0.0212	0.0188	106	94.0	1	70.0-140			12.0	41
Chlorobenzene	0.0200	U	0.0201	0.0193	101	96.5	1	37.0-160			4.06	53
Chloroethane	0.0200	U	0.0169	0.0159	84.5	79.5	1	14.0-230			6.10	78
Chloroform	0.0200	U	0.0218	0.0199	109	99.5	1	51.0-138			9.11	54
Chloromethane	0.0200	U	0.0144	0.0140	72.0	70.0	1	1.00-273			2.82	20
cis-1,3-Dichloropropene	0.0200	U	0.0180	0.0174	90.0	87.0	1	1.00-227			3.39	58
Dibromochloromethane	0.0200	U	0.0190	0.0176	95.0	88.0	1	53.0-149			7.65	50
Ethylbenzene	0.0200	U	0.0210	0.0198	105	99.0	1	37.0-162			5.88	63
Methylene Chloride	0.0200	U	0.0185	0.0171	92.5	85.5	1	1.00-221	J	J	7.87	28
Tetrachloroethene	0.0200	U	0.0215	0.0201	108	101	1	64.0-148			6.73	39
Toluene	0.0200	U	0.0199	0.0193	99.5	96.5	1	47.0-150			3.06	41
trans-1,2-Dichloroethene	0.0200	U	0.0226	0.0204	113	102	1	54.0-156			10.2	45
Trichloroethene	0.0200	U	0.0229	0.0213	115	106	1	70.0-157			7.24	48
Vinyl chloride	0.0200	U	0.0177	0.0165	88.5	82.5	1	1.00-251			7.02	66
(S) 1,2-Dichloroethane-d4					104	100		70.0-130				
(S) 4-Bromofluorobenzene					100	99.0		70.0-130				
(S) Toluene-d8					100	101		70.0-130				

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096010-1 07/19/24 02:11

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
PCB 1016	U		0.000270	0.000500
PCB 1221	U		0.000270	0.000500
PCB 1232	U		0.000270	0.000500
PCB 1242	U		0.000270	0.000500
PCB 1248	U		0.000173	0.000500
PCB 1254	U		0.000173	0.000500
PCB 1260	U		0.000173	0.000500
Total PCBs	U		0.000173	0.000500
(S) Decachlorobiphenyl	22.5			10.0-144
(S) Tetrachloro-m-xylene	70.6			10.0-135

Laboratory Control Sample (LCS)

(LCS) R4096010-5 07/19/24 02:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00282	113	50.0-140	
PCB 1260	0.00250	0.00247	98.8	8.00-140	
(S) Decachlorobiphenyl			63.5	10.0-144	
(S) Tetrachloro-m-xylene			79.2	10.0-135	

L1756962-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756962-01 07/19/24 03:09 • (MS) R4096010-6 07/19/24 03:39 • (MSD) R4096010-7 07/19/24 03:48

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
PCB 1016	0.00250	U	0.0152	0.0214	608	856	1	50.0-140	J5 P	J5	33.9	36
PCB 1260	0.00250	U	0.0165	0.0238	660	952	1	8.00-140	J5 P	J5	36.2	38
(S) Decachlorobiphenyl					23.0	28.6		10.0-144				
(S) Tetrachloro-m-xylene					49.2	57.9		10.0-135				

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4096164-1 07/19/24 12:54

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	54.0			29.0-132
(S) 2-Fluorobiphenyl	68.0			26.0-102
(S) 2-Fluorophenol	59.0			10.0-66.0
(S) Nitrobenzene-d5	70.0			15.0-106
(S) p-Terphenyl-d14	80.0			10.0-120

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4096164-1 07/19/24 12:54

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	50.5			10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4096164-2 07/19/24 13:23

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.137	68.5	31.0-120	
2,4,6-Trichlorophenol	0.200	0.173	86.5	37.0-144	
2,4-Dichlorophenol	0.200	0.166	83.0	39.0-135	
2,4-Dimethylphenol	0.200	0.169	84.5	32.0-120	
2,4-Dinitrophenol	0.200	0.121	60.5	100-191	
2-Chlorophenol	0.200	0.168	84.0	23.0-134	
2-Methylphenol	0.200	0.174	87.0	26.0-120	
2-Nitrophenol	0.200	0.158	79.0	29.0-182	
3&4-Methyl Phenol	0.200	0.164	82.0	27.0-120	
3,3-Dichlorobenzidine	0.400	0.397	99.3	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.159	79.5	100-181	
4-Chloro-3-methylphenol	0.200	0.174	87.0	22.0-147	
4-Nitrophenol	0.200	0.121	60.5	100-132	
Anthracene	0.200	0.179	89.5	27.0-133	
Benzidine	0.400	0.175	43.8	100-120	
Benzo(a)anthracene	0.200	0.184	92.0	33.0-143	
Benzo(a)pyrene	0.200	0.198	99.0	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.162	81.0	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.207	104	8.00-158	
Chrysene	0.200	0.173	86.5	17.0-168	
Di-n-butyl phthalate	0.200	0.196	98.0	100-120	
Hexachloro-1,3-butadiene	0.200	0.130	65.0	24.0-120	
Hexachlorobenzene	0.200	0.145	72.5	100-152	
Hexachlorocyclopentadiene	0.200	0.106	53.0	10.0-120	
Hexachloroethane	0.200	0.138	69.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.172	86.0	39.0-127	
n-Nitrosodiethylamine	0.200	0.167	83.5	10.0-142	
Nitrobenzene	0.200	0.166	83.0	35.0-180	
Nonylphenol	0.200	0.184	92.0	57.0-136	
Pentachlorobenzene	0.200	0.144	72.0	10.0-151	
Pentachlorophenol	0.200	0.158	79.0	14.0-176	
Phenanthrene	0.200	0.166	83.0	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4096164-2 07/19/24 13:23

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.125	62.5	5.00-120	
Pyridine	0.200	0.0435	21.7	10.0-120	
Total Cresols	0.400	0.338	84.5	36.0-110	
(S) 2,4,6-Tribromophenol			71.0	29.0-132	
(S) 2-Fluorobiphenyl			80.5	26.0-102	
(S) 2-Fluorophenol			70.5	10.0-66.0	J1
(S) Nitrobenzene-d5			79.5	15.0-106	
(S) p-Terphenyl-d14			88.5	10.0-120	
(S) Phenol-d6			68.0	10.0-54.0	J1

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
ND	Not detected at the Reporting Limit (or MDL where applicable).
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier	Description
B	The same analyte is found in the associated blank.
E	The analyte concentration exceeds the upper limit of the calibration range of the instrument established by the initial calibration (ICAL).
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J3	The associated batch QC was outside the established quality control range for precision.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
P	RPD between the primary and confirmatory analysis exceeded 40%.
T8	Sample(s) received past/too close to holding time expiration.
V	The sample concentration is too high to evaluate accurate spike recoveries.

1	Cp
2	Tc
3	Ss
4	Cn
5	Sr
6	Qc
7	Gi
8	Al
9	Sc

# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey-NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio-VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		


## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013





Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable


\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.



Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173				Billing Information: <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173				Pres Chk	Analysis / Container / Preservative										Chain of Custody Page <u>  </u> of <u>  </u>	
Report to: <b>Jeff McClain</b>				Email To: mburr@gphtexas.org:jmcclain@gphtexas.org :gpienviro@gphtexas.org				No of Cntrs	608.3PCBONLY 100ml Amb NoPres ALL625.1RV 100ml Amb NoPres ALLCN 250mlHDPE-NaOH ALLOGHEX 1L-Amb-Add HCl ALLPHOS 500mlHDPE-Add H2SO4 ALLSULFIDE 500mlHDPE-NaOH+ZnAc ALLTIICP 250mlHDPE HNO3 ALLTOC 250mlAmb-H2SO4 ALLTSS 1L-HDPE-NoPres ALLV624.1NP 40mlClr-NoPres										 <b>Pace Analytical®</b> 190 Allen, TX 75013 <small>Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: https://info.paceanalytical.com/subs/pas-standard-terms.pdf</small>	
Project Description: <b>TPDES</b>		City/State Collected:		Please Circle: PT MT CT ET		SDG # <b>L756836</b>														
Phone: <b>972-485-6458</b>		Client Project #		Lab Project # <b>DSGARLWNTX-RENEW AL</b>		Table #														
Collected by (print):		Site/Facility ID #		P.O. #		Acctnum: <b>DSGARLWNTX</b>														
Collected by (signature):		<b>Rush?</b> (Lab MUST Be Notified) <input type="checkbox"/> Same Day <input type="checkbox"/> Five Day <input type="checkbox"/> Next Day <input type="checkbox"/> 5 Day (Rad Only) <input type="checkbox"/> Two Day <input type="checkbox"/> 10 Day (Rad Only) <input type="checkbox"/> Three Day		Quote #		Template: <b>T256244</b>														
Immediately Packed on ice N <input type="checkbox"/> Y <input type="checkbox"/>		Date Results Needed		No. of Cntrs		Prelogin: <b>P1088417</b> PM: <b>3565 - Dorothy P Roberts</b> PB:														
Sample ID		Comp/Grab	Matrix *	Depth	Date	Time	Shipped Via: <b>FedEX Priority</b>													
Remarks		Sample # (lab only)		No of Cntrs	608.3PCBONLY 100ml Amb NoPres ALL625.1RV 100ml Amb NoPres ALLCN 250mlHDPE-NaOH ALLOGHEX 1L-Amb-Add HCl ALLPHOS 500mlHDPE-Add H2SO4 ALLSULFIDE 500mlHDPE-NaOH+ZnAc ALLTIICP 250mlHDPE HNO3 ALLTOC 250mlAmb-H2SO4 ALLTSS 1L-HDPE-NoPres ALLV624.1NP 40mlClr-NoPres										Remarks		Sample # (lab only)			
* Matrix: SS - Soil   AIR - Air   F - Filter GW - Groundwater   B - Bioassay WW - WasteWater DW - Drinking Water OT - Other _____				Remarks: <b>TABLES 1,2,3,6,8,9</b>				pH _____ Temp _____ Flow _____ Other _____				Sample Receipt Checklist: COC Seal Present/Intact: <input type="checkbox"/> NP <input type="checkbox"/> Y <input type="checkbox"/> N COC Signed/Accurate: <input type="checkbox"/> Y <input type="checkbox"/> N Bottles arrive intact: <input type="checkbox"/> Y <input type="checkbox"/> N Correct bottles used: <input type="checkbox"/> Y <input type="checkbox"/> N Sufficient volume sent: <input type="checkbox"/> Y <input type="checkbox"/> N If Applicable: VOA Zero Headspace: <input type="checkbox"/> Y <input type="checkbox"/> N Preservation Correct/Checked: <input type="checkbox"/> Y <input type="checkbox"/> N RAD Screen <0.5 mR/hr: <input type="checkbox"/> Y <input type="checkbox"/> N								
Samples returned via: <input type="checkbox"/> UPS <input type="checkbox"/> FedEx <input type="checkbox"/> Courier				Tracking #				Trip Blank Received: Yes / No HCL / MeOH TBR				If preservation required by Login: Date/Time								
Relinquished by: (Signature) 				Date: <b>7/16/24</b>	Time: <b>0942</b>	Received by: (Signature) 				Temp: _____ °C Bottles Received:				Condition: NCF / OK						
Relinquished by: (Signature) <b>Aisen Ramos</b>				Date: <b>7/16/24</b>	Time: <b>1700</b>	Received by: (Signature) <b>FedEx</b>				Temp: _____ °C Bottles Received:				Condition: NCF / OK						
Relinquished by: (Signature) <b>FedEx</b>				Date: <b>07-17-24</b>	Time: <b>0900</b>	Received by: (Signature) 				Temp: _____ °C Bottles Received:				Condition: NCF / OK						



Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173			Billing Information: <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173			Pres Chk	Analysis / Container / Preservative										Chain of Custody Page 7 of 8		
Report to: <b>Jeff McClain</b>			Email To: mburr@gpiltexas.org; jmcclain@gpiltexas.org; gpilenviron@gpiltexas.org														 <b>Pace Analytical</b> 190 Allen, TX 75013		
Project Description: <b>TPDES</b>		City/State Collected:		Please Circle: PT MT CT ET													Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of Pace Terms and Conditions found at: <a href="https://info.pacelabs.com/hubfs/pas-standard-terms.pdf">https://info.pacelabs.com/hubfs/pas-standard-terms.pdf</a>		
Phone: <b>972-485-6458</b>		Client Project #		Lab Project # <b>DSGARLWNTX-RENEW AL</b>													SDG # <b>L756836</b>		
Collected by (print):		Site/Facility ID #		P.O. #													Table #		
Collected by (signature):		Rush? (Lab MUST Be Notified) ____ Same Day ____ Five Day ____ Next Day ____ 5 Day (Rad Only) ____ Two Day ____ 10 Day (Rad Only) ____ Three Day		Quote #													Acctnum: <b>DSGARLWNTX</b> Template: <b>T256244</b> Prelogin: <b>P1088417</b> PM: <b>3565 - Dorothy P Roberts</b> PB:		
Immediately Packed on Ice N ____ Y ____				Date Results Needed													Shipped Via: <b>FedEX Priority</b>		
Sample ID		Comp/Grab	Matrix *	Depth	Date	Time	No. of Cntrs	BOD CBOD MBAS TDS 1L-HDPE NoPres	BOD CBOD MBAS TDS 1L-HDPE-NoPres	Metals site spec 250mlHDPE HNO3	PAN CHLORR 250mlHDPE-NoPres	PAN SULFITE 250mlHDPE-NoPres	PAN-SULFITE, CHLORR 250mlHDPE NoPres	WetChem COD NH3 N/N 250mlHDPE-H2SO4	WetChem anions, ALK 125mlHDPE-NoPres	WetChem, color CR6, DO 500mlHDPE-NoPres			
OUTFALL 001		6	WW		7/16/24	0818	24	X	X	X	X	X	X	X	X	X	01		
* Matrix:		Remarks:																Sample Receipt Checklist	
SS - Soil AIR - Air F - Filter																		COC Seal Present/Intact: NP Y N	
GW - Groundwater B - Bioassay																		COC Signed/Accurate: Y N	
WW - WasteWater																		Bottles arrive intact: Y N	
DW - Drinking Water																		Correct bottles used: Y N	
OT - Other																		Sufficient volume sent: Y N	
Relinquished by : (Signature)		Date:		Time:		Received by: (Signature)		Trip Blank Received: Yes / No HCL / MeOH TBR										If preservation required by Login: Date/Time	
Relinquished by : (Signature)		Date:		Time:		Received by: (Signature)		Temp: °C Bottles Received:										RAD Screen <0.5 mR/hr: Y N	
Relinquished by : (Signature)		Date:		Time:		Received for lab by: (Signature)		Date: Time: S.S. 03 = S.0										Condition: NCF / OK	

1756836



DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

### Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ Austin

Client Name: Garland Power Light Project Work order (place label):

Courier: FedEx ☐ UPS ☐ USPS ☐ Client ☐ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒

Received on ice: Wet ☒ Blue ☐ No ice ☐

Receiving Lab 1 Thermometer Used: 1219 Cooler Temp °C: 3.3 (Recorded) +0.1 (Correction Factor) 34 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>



Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AG Date: 7/16/24


Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: <u>14820</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Sulfide Present Lead Acetate Strips: <u>14822</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas State Sampled: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Non-Conformance(s):	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>


Login Person: OC Date: 7/16

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173				Billing Information: <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173				Pres Chk	Analysis / Container / Preservative										Chain of Custody    Page <u>1</u> of <u>3</u>	
Report to: <b>Jeff McClain</b>				Email To: <a href="mailto:mburr@gpittexas.org">mburr@gpittexas.org</a> ; <a href="mailto:jmccclain@gpittexas.org">jmccclain@gpittexas.org</a> ; <a href="mailto:gplenviron@gpittexas.org">gplenviron@gpittexas.org</a>					608.3PCBONLY 100ml Amb NoPres ALL625.1RV 100ml Amb NoPres ALLCN 250mlHDPE-NaOH ALLCNAM 250mlHDPE-NaOH ALLOGHEX 1L-Amb-Add HCl ALLPH 125mlHDPE-NoPres ALLPHOS 500mlHDPE-Add H2SO4 ALLSULFIDE 500mlHDPE-NaOH+ZnAc ALLTIICP 250mlHDPE HNO3 ALLTKN 250mlHDPE-H2SO4										 400 W. Boundary Drive Suite 190 190 Allen, TX 75013  <small>Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: <a href="https://info.pacelabs.com/hubfs/pas-standard-terms.pdf">https://info.pacelabs.com/hubfs/pas-standard-terms.pdf</a></small>	
Project Description: <b>TPDES</b>		City/State Collected:		Please Circle: PT MT CT ET		SDG # <u>L17le 0920</u>														
Phone: <b>972-485-6458</b>		Client Project #		Lab Project # <b>DSGARLWNTX-RENEW AL</b>		Table #														
Collected by (print): <b>JEFFREY MCCLAIN</b>		Site/Facility ID #		P.O. #		Acctnum: <b>DSGARLWNTX</b>														
Collected by (signature): 		<b>Rush?</b> (Lab MUST Be Notified) <input type="checkbox"/> Same Day <input type="checkbox"/> Five Day <input type="checkbox"/> Next Day <input type="checkbox"/> 5 Day (Rad Only) <input type="checkbox"/> Two Day <input type="checkbox"/> 10 Day (Rad Only) <input type="checkbox"/> Three Day		Quote #		Template: <b>T256244</b>														
Immediately Packed on Ice N <input type="checkbox"/> Y <input type="checkbox"/>		Date Results Needed		No. of Cntrs		Prelogin: <b>P1090746</b>														
Sample ID		Comp/Grab	Matrix *	Depth	Date	Time	PM: <b>3665 - Dorothy P Roberts</b>													
<b>OUTFALL 001</b>		<b>G</b>	<b>WW</b>		<b>7/24/24 1358</b>	<b>27</b>	PB:													
							Shipped Via: <b>FedEX Priority</b>													
							Remarks    Sample # (lab only)													



Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173				Billing Information:  <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173				Pres Chk	Analysis / Container / Preservative												Chain of Custody Page 2 of 3				
Report to: <b>Jeff McClain</b>				Email To: mburr@gpiltexas.org;jmccain@gpiltexas.org ;gplenviron@gpiltexas.org																	 400 W. DeYoung Drive East 190 Allen, TX 75013  Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: <a href="https://info.pacelabs.com/hubfs/pas-standard-terms.pdf">https://info.pacelabs.com/hubfs/pas-standard-terms.pdf</a>				
Project Description: <b>TPDES</b>				City/State Collected:				Please Circle: PT MT CT ET																	
Phone: 972-485-6458				Client Project #				Lab Project # <b>DSGARLWNTX-RENEW AL</b>																	
Collected by (print):				Site/Facility ID #				P.O. #																	
Collected by (signature):				Rush? (Lab MUST Be Notified) ____ Same Day ____ Five Day ____ Next Day ____ 5 Day (Rad Only) ____ Two Day ____ 10 Day (Rad Only) ____ Three Day				Quote #																	
Immediately Packed on Ice N ____ Y ____								Date Results Needed																No. of Cntrs	
Sample ID				Comp/Grab	Matrix *	Depth	Date	Time		ALL TOC 250mlAmb-H2SO4	ALL TSS 1L-HDPE-NoPres	ALL V624.1NP 40mlClr-NoPres	BOD CBOD MBAS TDS 1L-HDPE NoPres	BOD CBOD MBAS TDS 1L-HDPE-NoPres	Metals site spec 250mlHDPE HNO3	PAN CHLOR 250mlHDPE-NoPres	PAN SULFITE 250mlHDPE-NoPres	PAN-SULFITE,CHLOR 250mlHDPE NoPres	WetChem COD NH3 N/N 250mlHDPE-H2SO4						
OUTFALL 001					WW				27	X	X	X	X	X	X	X	X	X	X						

Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173				Billing Information:  <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173				Pres Chk		Analysis / Container / Preservative										Chain of Custody Page 3 of 3									
Report to: <b>Jeff McClain</b>				Email To: mburr@gpiltexas.org;jmccclain@gpiltexas.org ;gplenviron@gpiltexas.org																 480 W. DeYoung Drive Suite 190 Allen, TX 75013  Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: <a href="https://info.pacelabs.com/hubfs/pas-standard-terms.pdf">https://info.pacelabs.com/hubfs/pas-standard-terms.pdf</a>									
Project Description: <b>TPDES</b>				City/State Collected:				Please Circle: PT MT CT ET																					
Phone: <b>972-485-6458</b>				Client Project #				Lab Project # <b>DSGARLWNTX-RENEW AL</b>												SDG # <b>U760920</b>									
Collected by (print):				Site/Facility ID #				P.O. #												Table #									
Collected by (signature):				<b>Rush?</b> (Lab MUST Be Notified) ____ Same Day ____ Five Day ____ Next Day ____ 5 Day (Rad Only) ____ Two Day ____ 10 Day (Rad Only) ____ Three Day				Quote #												Acctnum: <b>DSGARLWNTX</b> Template: <b>T256244</b> Prelogin: <b>P1090746</b> PM: <b>3565 - Dorothy P Roberts</b> PB:									
Immediately Packed on Ice N ____ Y ____				Date Results Needed				No. of Cntrs												Shipped Via: <b>FedEX Priority</b>									
Sample ID				Comp/Grab		Matrix *		Depth		Date		Time														Remarks		Sample # (lab only)	
OUTFALL 001						WW						27		X		X												01	





DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

## Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ AustinClient Name: Garland Power Flight Project Work order (place label):Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒Received on ice: Wet ☒ Blue ☐ No ice ☐Receiving Lab 1 Thermometer Used: 1819 Cooler Temp °C: 4.4 (Recorded) 10.1 (Correction Factor) 4.5 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AG Date: 7/26/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: <u>14880</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Sulfide Present Lead Acetate Strips: <u>148802</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas State Sampled: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Non-Conformance(s):	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: pe Date: 7/26

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

**Garland Power & Light**

Sample Delivery Group: L1760920

Samples Received: 07/26/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By: 

Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1760920-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	17
Wet Chemistry by Method 351.2	18
Wet Chemistry by Method 353.2	19
Wet Chemistry by Method 360.1	20
Wet Chemistry by Method 4500Cl G-2011	21
Wet Chemistry by Method 4500CN-E	22
Wet Chemistry by Method 4500P-E	23
Wet Chemistry by Method 4500-S2 D	24
Wet Chemistry by Method 4500SO3 B-2011	25
Wet Chemistry by Method 5210 B-2016	26
Wet Chemistry by Method 5220D	28
Wet Chemistry by Method 5310C	29
Wet Chemistry by Method 5540C	30
Wet Chemistry by Method SM 4500-H+B	31
Wet Chemistry by Method SM4500NH3H	32
Mercury by Method 245.1	33
Metals (ICP) by Method 200.7	34
Metals (ICPMS) by Method 200.8	35
Volatile Organic Compounds (GC/MS) by Method 624.1	38
Polychlorinated Biphenyls (GC) by Method EPA-608.3	42
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	43
Gl: Glossary of Terms	46
Al: Accreditations & Locations	48
Sc: Sample Chain of Custody	49

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc

# SAMPLE SUMMARY


OUTFALL 001 L1760920-01 WW

Collected by  
Jeffrey McClain

Collected date/time  
07/26/24 13:58

Received date/time  
07/26/24 15:40

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2331091	1	08/01/24 11:18	08/01/24 11:18	SMC	Allen, TX
Calculated Results	WG2332077	1	07/31/24 13:20	07/31/24 13:20	EIG	Allen, TX
Gravimetric Analysis by Method 2540C	WG2331171	1	07/27/24 11:24	07/27/24 13:35	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2334169	1	08/01/24 10:09	08/01/24 12:09	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2335365	1	08/05/24 09:15	08/05/24 19:10	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2330919	1	07/26/24 18:12	07/26/24 18:12	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2331904	1	07/29/24 10:07	07/29/24 10:07	SEN	Allen, TX
Wet Chemistry by Method 300.0	WG2330911	1	07/30/24 18:30	07/30/24 18:30	SMC	Allen, TX
Wet Chemistry by Method 300.0	WG2330911	5	07/30/24 19:53	07/30/24 19:53	SMC	Allen, TX
Wet Chemistry by Method 300.0	WG2334986	1	08/02/24 10:16	08/02/24 10:16	SMC	Allen, TX
Wet Chemistry by Method 3500Cr-B	WG2334103	1	08/01/24 11:18	08/01/24 11:18	SMC	Allen, TX
Wet Chemistry by Method 351.2	WG2332467	1	07/30/24 11:45	07/31/24 13:20	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2334132	1	08/01/24 12:54	08/01/24 12:54	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2334936	1	08/02/24 08:57	08/02/24 08:57	SEN	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2331631	1	07/29/24 10:19	07/29/24 10:19	JAR	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2333312	1	07/31/24 10:00	07/31/24 16:58	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2333312	1	07/31/24 16:58	07/31/24 16:58	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2331816	1	07/29/24 16:30	07/29/24 16:30	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2332666	1	07/30/24 15:43	07/30/24 15:43	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2336387	1	08/06/24 12:40	08/06/24 12:40	JAS	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2330512	1	07/26/24 17:11	07/31/24 13:16	SEN	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2331145	1	07/27/24 13:51	08/01/24 09:32	SEN	Allen, TX
Wet Chemistry by Method 5220D	WG2336401	1	08/05/24 10:39	08/05/24 13:31	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2332159	1	07/30/24 01:25	07/30/24 01:25	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2330916	1	07/26/24 17:28	07/26/24 17:42	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2333276	1	07/31/24 08:43	07/31/24 08:43	JBS	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2332077	1	07/29/24 17:59	07/29/24 17:59	EIG	Allen, TX
Mercury by Method 245.1	WG2332780	1	07/30/24 16:58	07/31/24 14:33	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2331087	1	07/27/24 10:00	07/29/24 15:04	SKW	Allen, TX
Metals (ICPMS) by Method 200.8	WG2331091	1	07/27/24 09:11	07/30/24 19:08	NA	Allen, TX
Metals (ICPMS) by Method 200.8	WG2331091	1	07/27/24 09:11	07/31/24 14:50	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2332271	1	07/29/24 17:20	07/29/24 17:20	NSR	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2332599	1	08/01/24 19:57	08/01/24 19:57	ZST	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2331033	1	07/27/24 06:54	07/27/24 19:52	HLA	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2334305	1	08/01/24 11:55	08/02/24 13:28	XLY	Allen, TX



# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager


## Sample Delivery Group (SDG) Narrative

**No extra volume received to perform Matrix Spike samples.**

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1760920-01</a>	<a href="#">OUTFALL 001</a>	625.1

**Analysis was filtered in the laboratory.**

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1760920-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B



Calculated Results

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Trivalent	0.000783	J	0.000710	0.00300	1	08/01/2024 11:18	WG2331091
Organic Nitrogen	0.721		0.0280	0.100	1	07/31/2024 13:20	WG2332077

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Gravimetric Analysis by Method 2540C

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Total Dissolved Solids	213		25.0	1	07/27/2024 13:35	WG2331171

Gravimetric Analysis by Method 2540D

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Suspended Solids	7.83		4.18	1	08/01/2024 12:09	WG2334169

Wet Chemistry by Method 1664A

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Oil & Grease (Hexane Extr)	0.490	J	0.350	5.00	1	08/05/2024 19:10	WG2335365

Wet Chemistry by Method 2120B

Analyte	Result units	Qualifier	RDL units	Dilution	Analysis date / time	Batch
Color	20.0		5.00	1	07/26/2024 18:12	WG2330919

Sample Narrative:

L1760920-01 WG2330919: 7

Wet Chemistry by Method 2320B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Alkalinity	108		20.0	20.0	1	07/29/2024 10:07	WG2331904

Wet Chemistry by Method 300.0

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Bromide	5.16	J3 J6	0.0668	0.400	1	07/30/2024 18:30	WG2330911
Chloride	15.4	J5	1.62	4.00	5	07/30/2024 19:53	WG2330911
Fluoride	0.376	J	0.0947	0.500	1	08/02/2024 10:16	WG2334986
Nitrate	4.86	J3 J6 Q	0.379	0.500	1	07/30/2024 18:30	WG2330911
Sulfate	25.0	V	1.06	3.50	5	07/30/2024 19:53	WG2330911

Wet Chemistry by Method 3500Cr-B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Hexavalent	U		0.00200	0.00300	1	08/01/2024 11:18	WG2334103

Sample Narrative:

L1760920-01 WG2334103: Sample preserved in lab w/in 24hrs of collection.

Wet Chemistry by Method 351.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Kjeldahl Nitrogen, TKN	0.750	B	0.140	0.250	1	07/31/2024 13:20	WG2332467



## OUTFALL 001

Collected date/time: 07/26/24 13:58

## SAMPLE RESULTS - 01

L1760920

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	08/01/2024 12:54	<a href="#">WG2334132</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	9.72	<a href="#">T8</a>	1	1	1	08/02/2024 08:57	<a href="#">WG2334936</a>

## Wet Chemistry by Method 4500CI G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.0390	<a href="#">J T8</a>	0.0260	0.100	1	07/29/2024 10:19	<a href="#">WG2331631</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/31/2024 16:58	<a href="#">WG2333312</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00430	0.0100	1	07/31/2024 16:58	<a href="#">WG2333312</a>

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.0348	<a href="#">J</a>	0.0152	0.0500	1	07/29/2024 16:30	<a href="#">WG2331816</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/30/2024 15:43	<a href="#">WG2332666</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	08/06/2024 12:40	<a href="#">WG2336387</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	2.34		1.00	1	1	08/01/2024 09:32	<a href="#">WG2331145</a>
CBOD	1.48		1.00	1	1	07/31/2024 13:16	<a href="#">WG2330512</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	22.2	<a href="#">J</a>	16.1	35.0	1	08/05/2024 13:31	<a href="#">WG2336401</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------

Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	4.99		0.270	0.700	1	07/30/2024 01:25	<a href="#">WG2332159</a>

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">J5</a>	0.360	0.500	1	07/26/2024 17:42	<a href="#">WG2330916</a>

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	8.40	<a href="#">T8</a>	1	07/31/2024 08:43	<a href="#">WG2333276</a>

Sample Narrative:

L1760920-01 WG2333276: 8.4 at 21.4C

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	0.0292	<a href="#">J</a>	0.0280	0.100	1	07/29/2024 17:59	<a href="#">WG2332077</a>

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	U		0.0000450	0.000200	1	07/31/2024 14:33	<a href="#">WG2332780</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0785	<a href="#">J</a>	0.0186	0.100	1	07/29/2024 15:04	<a href="#">WG2331087</a>
Tin	U		0.00240	0.0250	1	07/29/2024 15:04	<a href="#">WG2331087</a>
Titanium	U		0.00835	0.100	1	07/29/2024 15:04	<a href="#">WG2331087</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.0728	<a href="#">B</a>	0.00186	0.00250	1	07/31/2024 14:50	<a href="#">WG2331091</a>
Antimony	U		0.000580	0.00500	1	07/31/2024 14:50	<a href="#">WG2331091</a>
Arsenic	0.00521		0.000100	0.000500	1	07/31/2024 14:50	<a href="#">WG2331091</a>
Barium	0.0385		0.000440	0.00300	1	07/31/2024 14:50	<a href="#">WG2331091</a>
Beryllium	U		0.0000600	0.000500	1	07/31/2024 14:50	<a href="#">WG2331091</a>
Cadmium	U		0.000120	0.00100	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Chromium	U		0.000510	0.00300	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Cobalt	0.000126	<a href="#">B J</a>	0.0000400	0.000300	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Copper	0.00203		0.000900	0.00200	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Iron	0.0741		0.00432	0.00700	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Lead	U		0.000140	0.000500	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Magnesium	3.90		0.0121	0.0200	1	07/31/2024 14:50	<a href="#">WG2331091</a>
Manganese	0.0309		0.000330	0.000500	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Molybdenum	0.000743	<a href="#">J</a>	0.000530	0.00100	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Nickel	0.00144	<a href="#">J</a>	0.000640	0.00200	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Selenium	U		0.000740	0.00500	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Silver	U		0.0000800	0.000500	1	07/30/2024 19:08	<a href="#">WG2331091</a>
Thallium	U		0.000190	0.000500	1	07/30/2024 19:08	<a href="#">WG2331091</a>

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



## OUTFALL 001

Collected date/time: 07/26/24 13:58

## SAMPLE RESULTS - 01

L1760920

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	U		0.00265	0.00500	1	07/30/2024 19:08	<a href="#">WG2331091</a>

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
2-Butanone (MEK)	U		0.00822	0.0250	1	08/01/2024 19:57	<a href="#">WG2332599</a>
2-Chloroethyl vinyl ether	U		0.00652	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Acrolein	U		0.00544	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Acrylonitrile	U		0.00709	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Benzene	U		0.00207	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Bromoform	U		0.000960	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Bromomethane	U		0.00347	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Chlorobenzene	U		0.00276	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Chloroethane	U		0.00296	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Chloroform	U		0.00212	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Chloromethane	U		0.00361	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Ethylbenzene	U		0.000401	0.00200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Methylene Chloride	U		0.0117	0.0200	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Toluene	U		0.00219	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Trichloroethene	U		0.00262	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
Vinyl chloride	U		0.00466	0.00500	1	07/29/2024 17:20	<a href="#">WG2332271</a>
(S) 1,2-Dichloroethane-d4	98.7			70.0-130		07/29/2024 17:20	<a href="#">WG2332271</a>
(S) 1,2-Dichloroethane-d4	101			70.0-130		08/01/2024 19:57	<a href="#">WG2332599</a>
(S) 4-Bromofluorobenzene	94.7			70.0-130		07/29/2024 17:20	<a href="#">WG2332271</a>
(S) 4-Bromofluorobenzene	107			70.0-130		08/01/2024 19:57	<a href="#">WG2332599</a>
(S) Toluene-d8	94.5			70.0-130		07/29/2024 17:20	<a href="#">WG2332271</a>
(S) Toluene-d8	99.5			70.0-130		08/01/2024 19:57	<a href="#">WG2332599</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
PCB 1221	U		0.000270	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
PCB 1232	U		0.000270	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
PCB 1242	U		0.000270	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
PCB 1248	U		0.000173	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
PCB 1254	U		0.000173	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
PCB 1260	U		0.000173	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>

## OUTFALL 001

Collected date/time: 07/26/24 13:58

## SAMPLE RESULTS - 01

L1760920

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Total PCBs	U		0.000173	0.000500	1	07/27/2024 19:52	<a href="#">WG2331033</a>
(S) Decachlorobiphenyl	64.5			10.0-144		07/27/2024 19:52	<a href="#">WG2331033</a>
(S) Tetrachloro-m-xylene	66.6			10.0-135		07/27/2024 19:52	<a href="#">WG2331033</a>

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2-Chlorophenol	U		0.000307	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2-Methylphenol	U		0.000238	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
2-Nitrophenol	U		0.000247	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	08/02/2024 13:28	<a href="#">WG2334305</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	08/02/2024 13:28	<a href="#">WG2334305</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
4-Nitrophenol	U		0.00123	0.0100	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Anthracene	U		0.000168	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Benzidine	U		0.000350	0.00400	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Chrysene	U		0.000257	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Hexachlorobenzene	U		0.000307	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Hexachloroethane	U		0.000247	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Nitrobenzene	U		0.000314	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Nonylphenol	U		0.000168	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Pentachlorobenzene	U		0.000247	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Pentachlorophenol	U		0.000283	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Phenanthrene	U		0.000200	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Phenol	U		0.000500	0.00200	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Pyridine	U		0.00174	0.00400	1	08/02/2024 13:28	<a href="#">WG2334305</a>
Total Cresols	U		0.00153	0.00800	1	08/02/2024 13:28	<a href="#">WG2334305</a>
(S) 2,4,6-Tribromophenol	57.1			29.0-132		08/02/2024 13:28	<a href="#">WG2334305</a>
(S) 2-Fluorobiphenyl	78.0			26.0-102		08/02/2024 13:28	<a href="#">WG2334305</a>
(S) 2-Fluorophenol	65.9			10.0-66.0		08/02/2024 13:28	<a href="#">WG2334305</a>
(S) Nitrobenzene-d5	80.2			15.0-106		08/02/2024 13:28	<a href="#">WG2334305</a>
(S) p-Terphenyl-d14	91.2			10.0-120		08/02/2024 13:28	<a href="#">WG2334305</a>
(S) Phenol-D6	59.3	J1		10.0-54.0		08/02/2024 13:28	<a href="#">WG2334305</a>

Method Blank (MB)

(MB) R4100241-1 07/27/24 13:35

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Total Dissolved Solids	U		25.0	25.0

L1760676-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1760676-01 07/27/24 13:35 • (DUP) R4100241-3 07/27/24 13:35

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	21200	21300	1	0.801		10

L1760676-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1760676-02 07/27/24 13:35 • (DUP) R4100241-4 07/27/24 13:35

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	21700	21400	1	1.35		10

Laboratory Control Sample (LCS)

(LCS) R4100241-2 07/27/24 13:35

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Total Dissolved Solids	2410	2410	100	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4101923-1 08/01/24 12:09

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Suspended Solids	U		2.50	2.50

L1762006-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1762006-01 08/01/24 12:09 • (DUP) R4101923-3 08/01/24 12:09

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	10300	10500	1	2.11		10

L1762006-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1762006-02 08/01/24 12:09 • (DUP) R4101923-4 08/01/24 12:09

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	11600	11400	1	1.91		10

Laboratory Control Sample (LCS)

(LCS) R4101923-2 08/01/24 12:09

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Suspended Solids	879	827	94.1	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4103232-1 08/05/24 19:10

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4103232-2 08/05/24 19:10 • (LCSD) R4103232-3 08/05/24 19:10

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	36.7	35.9	91.8	89.8	78.0-114			2.20	18

L1759867-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1759867-02 08/05/24 19:10 • (MS) R4103232-4 08/05/24 19:10

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	36.4	90.9	1	78.0-114	

Method Blank (MB)

(MB) R4100402-1 07/26/24 18:12

Analyte	MB Result units	MB Qualifier	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:

BLANK: 7

L1760920-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1760920-01 07/26/24 18:12 • (DUP) R4100402-2 07/26/24 18:12

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:

OS: 7

DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4099699-1 07/29/24 10:07

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

1 Cp

2 Tc

3 Ss

L1760058-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1760058-01 07/29/24 10:07 • (DUP) R4099699-3 07/29/24 10:07

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	260	250	1	3.92		20

4 Cn

5 Sr

6 Qc

Laboratory Control Sample (LCS)

(LCS) R4099699-2 07/29/24 10:07

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	236	94.4	90.0-110	

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4100710-1 07/30/24 18:06

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.0668	0.400
Chloride	U		0.325	0.800
Nitrate	U		0.379	0.500
Sulfate	U		0.211	0.700

Laboratory Control Sample (LCS)

(LCS) R4100710-2 07/30/24 18:18

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	5.00	5.07	101	90.0-110	
Chloride	5.00	4.95	98.9	90.0-110	
Nitrate	5.00	4.88	97.5	90.0-110	
Sulfate	5.00	5.06	101	90.0-110	

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/30/24 18:30 • (MS) R4100710-3 07/30/24 18:42 • (MSD) R4100710-4 07/30/24 18:54

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Bromide	5.00	5.16	5.18	0.113	0.382	0.000	1	90.0-110	J6	J3 J6	191	20
Nitrate	5.00	4.86	4.88	U	0.426	0.000	1	90.0-110	J6	J3 J6	200	20

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/30/24 19:53 • (MS) R4100710-5 07/30/24 19:30 • (MSD) R4100710-6 07/30/24 19:42

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chloride	5.00	15.4	39.9	40.0	490	491	5	90.0-110	J5	J5	0.193	20
Sulfate	5.00	25.0	49.8	49.8	496	497	5	90.0-110	V	V	0.102	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4102621-1 08/02/24 09:52

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
Fluoride	U		0.0947	0.500

Laboratory Control Sample (LCS)

(LCS) R4102621-2 08/02/24 10:04

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Fluoride	5.00	5.31	106	90.0-110	

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 08/02/24 10:16 • (MS) R4102621-3 08/02/24 10:28 • (MSD) R4102621-4 08/02/24 10:40

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Fluoride	5.00	0.376	5.44	5.55	101	104	1	90.0-110			2.13	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4101312-1 08/01/24 11:18

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

Laboratory Control Sample (LCS)

(LCS) R4101312-2 08/01/24 11:18

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.190	94.8	85.0-115	

L1759345-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1759345-01 08/01/24 11:18 • (MS) R4101312-3 08/01/24 11:18 • (MSD) R4101312-4 08/01/24 11:18

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.162	0.162	81.2	80.8	1	10.0-120			0.526	20

Sample Narrative:

OS: Sample preserved in lab w/in 24hrs of collection.

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4100824-1 07/31/24 12:54

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Kjeldahl Nitrogen, TKN	0.180	<div></div>	0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4100824-2 07/31/24 12:55

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Kjeldahl Nitrogen, TKN	4.00	4.36	109	90.0-110	

L1760222-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760222-02 07/31/24 13:33 • (MS) R4100824-3 07/31/24 13:28 • (MSD) R4100824-4 07/31/24 13:29

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	20.0	114	149	133	179	95.0	25	90.0-110	<div></div>		11.9	20

L1760222-03 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760222-03 07/31/24 12:59 • (MS) R4100824-5 07/31/24 13:30 • (MSD) R4100824-6 07/31/24 13:32

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	20.0	32.3	61.5	62.0	146	149	5	90.0-110	<div></div>	<div></div>	0.810	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4101468-1 08/01/24 12:48

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4101468-2 08/01/24 12:49

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Nitrate-Nitrite	2.50	2.42	96.8	90.0-110	

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 08/01/24 12:54 • (MS) R4101468-3 08/01/24 12:58 • (MSD) R4101468-4 08/01/24 12:58

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	U	2.50	2.50	100	100	1	90.0-110			0.000	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1760920-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1760920-01 08/02/24 08:57 • (DUP) R4101780-1 08/02/24 08:57

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Dissolved Oxygen	9.72	9.65	1	0.723		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4099562-1 07/29/24 10:15

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Chlorine,residual	U		0.0260	0.100

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

L1759562-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1759562-01 07/29/24 10:16 • (DUP) R4099562-4 07/29/24 10:16

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Chlorine,residual	0.0530	0.0570	1	7.27	J	20

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4099562-2 07/29/24 10:16 • (LCSD) R4099562-3 07/29/24 10:16

	Spike Amount	LCS Result	LCSD Result	LCS Rec.	LCSD Rec.	Rec. Limits	LCS Qualifier	LCSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	%	%	%			%	%
Chlorine,residual	1.00	0.958	0.954	95.8	95.4	85.0-115			0.418	20

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4101035-1 07/31/24 16:58

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4101035-2 07/31/24 16:58

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Cyanide	0.100	0.0940	94.0	85.0-115	

L1760432-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760432-02 07/31/24 16:58 • (MS) R4101035-3 07/31/24 16:58 • (MSD) R4101035-4 07/31/24 16:58

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	0.00533	0.102	0.101	102	101	1	85.0-115			0.734	20

L1761574-03 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1761574-03 07/31/24 16:58 • (MS) R4101035-5 07/31/24 16:58 • (MSD) R4101035-6 07/31/24 16:58

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	U	U	U	0.000	0.000	1	85.0-115	J6	J6	0.000	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4099834-1 07/29/24 16:30

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4099834-2 07/29/24 16:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phosphorus,Total	0.500	0.517	103	80.0-120	

L1760717-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760717-02 07/29/24 16:30 • (MS) R4099834-3 07/29/24 16:31 • (MSD) R4099834-4 07/29/24 16:31

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.0180	0.529	0.532	102	103	1	80.0-120			0.632	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc



Method Blank (MB)

(MB) R4100325-1 07/30/24 15:43

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4100325-2 07/30/24 15:43

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfide	0.800	0.801	100	80.0-120	

L1761376-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1761376-01 07/30/24 15:43 • (MS) R4100325-3 07/30/24 15:43 • (MSD) R4100325-4 07/30/24 15:43

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfide	0.800	U	0.695	0.660	86.9	82.5	1	80.0-120			5.18	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4103238-1 08/06/24 12:40

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1761461-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1761461-01 08/06/24 12:40 • (DUP) R4103238-5 08/06/24 12:40

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	U	U	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4103238-2 08/06/24 12:40

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 08/06/24 12:40 • (MS) R4103238-3 08/06/24 12:40 • (MSD) R4103238-4 08/06/24 12:40

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	17.0	18.0	85.0	90.0	1	85.0-115			5.71	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4100806-1 07/31/24 12:40

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
CBOD	U		0.200	0.200

L1760717-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1760717-02 07/31/24 12:52 • (DUP) R4100806-3 07/31/24 13:20

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
CBOD	ND	ND	1	0		20

Laboratory Control Sample (LCS)

(LCS) R4100806-2 07/31/24 12:45

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
CBOD	198	195	98.2	85-115	

1

Cp

2

Tc

3

Ss

4

Cn

5

Sr

6

Qc

7

Gl

8

Al

9

Sc

Method Blank (MB)

(MB) R4101266-1 08/01/24 09:23

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
BOD	U		0.200	0.200

L1761112-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1761112-01 08/01/24 09:57 • (DUP) R4101266-3 08/01/24 10:08

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	7.68	9.30	1	19.1	K9	20

L1761113-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1761113-01 08/01/24 10:03 • (DUP) R4101266-4 08/01/24 10:11

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	ND	ND	1	0		20

Laboratory Control Sample (LCS)

(LCS) R4101266-2 08/01/24 09:28

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
BOD	198	190	96.2	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4102740-1 08/05/24 13:31

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

Laboratory Control Sample (LCS)

(LCS) R4102740-2 08/05/24 13:31

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
COD	500	510	102	80.0-120	

L1759588-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1759588-01 08/05/24 13:31 • (MS) R4102740-3 08/05/24 13:31 • (MSD) R4102740-4 08/05/24 13:31

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
COD	500	55.7	512	522	91.3	93.4	1	80.0-120			2.02	20

L1761126-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1761126-01 08/05/24 13:31 • (MS) R4102740-5 08/05/24 13:31 • (MSD) R4102740-6 08/05/24 13:31

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
COD	500	22.2	510	508	97.5	97.1	1	80.0-120			0.411	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4100631-1 07/29/24 17:49

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4100631-2 07/29/24 18:09

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
TOC (Total Organic Carbon)	10.0	10.0	100	90.0-110	

L1759581-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1759581-01 07/29/24 20:54 • (MS) R4100631-3 07/29/24 19:20 • (MSD) R4100631-4 07/29/24 19:43

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
TOC (Total Organic Carbon)	10.0	6.10	14.8	15.0	87.2	89.4	1	80.0-120			1.47	20

L1759885-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1759885-01 07/29/24 21:13 • (MS) R4100631-5 07/29/24 20:03 • (MSD) R4100631-6 07/29/24 20:23

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
TOC (Total Organic Carbon)	10.0	2.90	12.2	12.6	93.2	96.5	1	80.0-120			2.66	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4100406-1 07/26/24 17:42

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4100406-2 07/26/24 17:42

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
MBAS	1.00	1.15	115	80.0-120	

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/26/24 17:42 • (MS) R4100406-3 07/26/24 17:42 • (MSD) R4100406-4 07/26/24 17:42

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
MBAS	1.00	U	1.17	1.22	117	122	1	80.0-120		J5	3.96	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1761518-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1761518-01 07/31/24 08:43 • (DUP) R4100664-2 07/31/24 08:43

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	su	su		%		%
pH	7.86	7.88	1	0.254		20

Sample Narrative:  
OS: 7.86 at 22.4C  
DUP: 7.88 at 22.3C

Laboratory Control Sample (LCS)

(LCS) R4100664-1 07/31/24 08:43

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	su	su	%	%	
pH	6.00	5.95	99.2	99.0-101	

Sample Narrative:  
LCS: 5.95 at 23.1C

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4100180-1 07/29/24 17:07

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	U		0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4100180-2 07/29/24 17:09

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.25	105	80.0-120	

L1760087-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760087-01 07/29/24 17:18 • (MS) R4100180-3 07/29/24 17:11 • (MSD) R4100180-4 07/29/24 17:13

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.211	5.28	5.28	101	101	1	80.0-120			0.000	20

L1760106-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760106-01 07/29/24 17:20 • (MS) R4100180-5 07/29/24 17:14 • (MSD) R4100180-6 07/29/24 17:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.301	5.09	5.09	95.8	95.8	1	80.0-120			0.000	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4100874-1 07/31/24 14:18

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Mercury	U		0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4100874-2 07/31/24 14:20

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Mercury	0.00250	0.00238	95.2	85.0-115	

L1758363-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1758363-02 07/31/24 14:22 • (MS) R4100874-3 07/31/24 14:24 • (MSD) R4100874-4 07/31/24 14:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	U	0.00222	0.00223	88.8	89.2	1	70.0-130			0.449	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4099882-1 07/29/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4099882-2 07/29/24 14:49

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.966	96.6	85.0-115	
Tin	1.00	1.02	102	85.0-115	
Titanium	1.00	1.01	101	85.0-115	

L1760812-05 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760812-05 07/29/24 14:53 • (MS) R4099882-3 07/29/24 14:57 • (MSD) R4099882-4 07/29/24 15:01

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	0.0234	0.988	0.990	96.4	96.7	1	70.0-130			0.293	20
Tin	1.00	U	1.02	1.02	102	102	1	70.0-130			0.392	20
Titanium	1.00	0.192	1.27	1.26	107	107	1	70.0-130			0.237	20

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/29/24 15:04 • (MS) R4099882-5 07/29/24 15:08 • (MSD) R4099882-6 07/29/24 15:12

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	0.0785	1.04	1.04	95.9	96.1	1	70.0-130			0.193	20
Tin	1.00	U	1.02	1.02	102	102	1	70.0-130			0.589	20
Titanium	1.00	U	1.01	1.02	101	102	1	70.0-130			0.789	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4100601-1 07/30/24 17:47

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cadmium	U		0.000120	0.00100
Chromium	U		0.000510	0.00300
Cobalt	0.0000519	J	0.0000400	0.000300
Copper	U		0.000900	0.00200
Iron	0.00511	J	0.00432	0.00700
Lead	U		0.000140	0.000500
Manganese	U		0.000330	0.000500
Molybdenum	U		0.000530	0.00100
Nickel	U		0.000640	0.00200
Selenium	U		0.000740	0.00500
Silver	U		0.0000800	0.000500
Thallium	U		0.000190	0.000500
Zinc	U		0.00265	0.00500

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4100925-1 07/31/24 14:31

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Aluminum	0.0128		0.00186	0.00250
Antimony	U		0.000580	0.00500
Arsenic	U		0.000100	0.000500
Barium	U		0.000440	0.00300
Beryllium	U		0.0000600	0.000500
Magnesium	0.0238		0.0121	0.0200

Laboratory Control Sample (LCS)

(LCS) R4100601-2 07/30/24 17:53

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Aluminum	1.00	0.860	86.0	85.0-115	
Cadmium	0.100	0.0929	92.9	85.0-115	
Chromium	0.100	0.0913	91.3	85.0-115	
Cobalt	0.100	0.0946	94.6	85.0-115	
Copper	0.100	0.0953	95.3	85.0-115	
Iron	1.00	0.910	91.0	85.0-115	
Lead	0.100	0.0931	93.1	85.0-115	
Manganese	0.100	0.0911	91.1	85.0-115	

Laboratory Control Sample (LCS)

(LCS) R4100601-2 07/30/24 17:53

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Molybdenum	0.100	0.100	100	85.0-115	
Nickel	0.100	0.0929	92.9	85.0-115	
Selenium	0.100	0.0895	89.5	85.0-115	
Silver	0.0500	0.0474	94.7	85.0-115	
Thallium	0.100	0.0910	91.0	85.0-115	
Zinc	0.100	0.0919	91.9	85.0-115	

Laboratory Control Sample (LCS)

(LCS) R4100925-2 07/31/24 14:38

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Antimony	0.100	0.0966	96.6	85.0-115	
Arsenic	0.100	0.100	100	85.0-115	
Barium	0.100	0.0968	96.8	85.0-115	
Beryllium	0.100	0.0945	94.5	85.0-115	
Magnesium	1.00	1.04	104	85.0-115	

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/30/24 19:08 • (MS) R4100601-3 07/30/24 19:14 • (MSD) R4100601-4 07/30/24 19:20

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Cadmium	0.100	U	0.0925	0.0920	92.5	92.0	1	70.0-130			0.528	20
Chromium	0.100	U	0.0924	0.0932	92.4	93.2	1	70.0-130			0.866	20
Cobalt	0.100	0.000126	0.0940	0.0930	93.9	92.9	1	70.0-130			1.08	20
Copper	0.100	0.00203	0.0959	0.0963	93.9	94.3	1	70.0-130			0.429	20
Iron	1.00	0.0741	1.01	1.03	93.3	95.6	1	70.0-130			2.32	20
Lead	0.100	U	0.0930	0.0939	93.0	93.9	1	70.0-130			0.931	20
Manganese	0.100	0.0309	0.122	0.122	91.6	90.7	1	70.0-130			0.731	20
Molybdenum	0.100	0.000743	0.101	0.0992	100	98.4	1	70.0-130			1.69	20
Nickel	0.100	0.00144	0.0946	0.0937	93.2	92.2	1	70.0-130			0.974	20
Selenium	0.100	U	0.0921	0.0930	92.1	93.0	1	70.0-130			0.965	20
Silver	0.0500	U	0.0472	0.0478	94.5	95.5	1	70.0-130			1.11	20
Thallium	0.100	U	0.0903	0.0908	90.3	90.8	1	70.0-130			0.557	20
Zinc	0.100	U	0.0942	0.0910	94.2	91.0	1	70.0-130			3.44	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/31/24 14:50 • (MS) R4100925-3 07/31/24 14:56 • (MSD) R4100925-4 07/31/24 15:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Aluminum	1.00	0.0728	1.05	1.07	97.8	99.4	1	70.0-130			1.55	20
Antimony	0.100	U	0.0931	0.0946	93.1	94.6	1	70.0-130			1.57	20
Arsenic	0.100	0.00521	0.103	0.105	97.8	99.7	1	70.0-130			1.83	20
Barium	0.100	0.0385	0.129	0.133	90.9	94.3	1	70.0-130			2.55	20
Beryllium	0.100	U	0.0958	0.0995	95.8	99.5	1	70.0-130			3.80	20
Magnesium	1.00	3.90	4.76	4.83	86.2	93.1	1	70.0-130			1.44	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4100132-2 07/29/24 16:56

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	U		0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	97.7			70.0-130
(S) 4-Bromofluorobenzene	80.6			70.0-130
(S) Toluene-d8	94.9			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4100132-1 07/29/24 16:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0199	0.0190	95.5	70.0-130	
1,1,2,2-Tetrachloroethane	0.0201	0.0176	87.6	60.0-140	
1,1,2-Trichloroethane	0.0199	0.0185	93.0	70.0-130	
1,1-Dichloroethene	0.0198	0.0232	117	50.0-150	
1,1-Dichloroethane	0.0200	0.0176	88.0	70.0-130	
1,2-Dibromoethane	0.0200	0.0184	92.0	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0211	105	65.0-135	
1,2-Dichloroethane	0.0199	0.0197	99.0	70.0-130	
1,2-Dichloropropane	0.0199	0.0199	100	35.0-165	
1,3-Dichlorobenzene	0.0199	0.0209	105	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0207	104	65.0-135	
2-Chloroethyl vinyl ether	0.100	0.0544	54.4	1.00-225	
Acrolein	0.100	0.0882	88.2	64.0-139	
Acrylonitrile	0.100	0.0826	82.6	67.0-136	
Benzene	0.0200	0.0168	84.0	65.0-135	
Bromodichloromethane	0.0199	0.0208	105	65.0-135	
Bromoform	0.0198	0.0196	99.0	70.0-130	
Bromomethane	0.0200	0.0197	98.5	15.0-185	
Carbon tetrachloride	0.0199	0.0192	96.5	70.0-130	
Chlorobenzene	0.0198	0.0202	102	65.0-135	
Chloroethane	0.0200	0.0204	102	40.0-160	
Chloroform	0.0198	0.0187	94.4	70.0-135	
Chloromethane	0.0200	0.0174	87.0	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0158	79.0	25.0-175	
Dibromochloromethane	0.0198	0.0205	104	70.0-135	
Ethylbenzene	0.0201	0.0192	95.5	60.0-140	
Methylene Chloride	0.0204	0.0166	81.4	60.0-140	J
Tetrachloroethene	0.0199	0.0207	104	70.0-130	
Toluene	0.0200	0.0190	95.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0188	94.0	70.0-130	
Trichloroethene	0.0200	0.0218	109	65.0-135	
Vinyl chloride	0.0200	0.0238	119	5.00-195	
(S) 1,2-Dichloroethane-d4			101	70.0-130	
(S) 4-Bromofluorobenzene			88.0	70.0-130	
(S) Toluene-d8			97.3	70.0-130	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



L1760920-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1760920-01 07/29/24 17:20 • (MS) R4100132-3 07/29/24 17:45 • (MSD) R4100132-4 07/29/24 18:09

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0199	U	0.0210	0.0209	106	105	1	52.0-162			0.477	36
1,1,2,2-Tetrachloroethane	0.0201	U	0.0163	0.0169	81.1	84.1	1	46.0-157			3.61	61
1,1,2-Trichloroethane	0.0199	U	0.0167	0.0171	83.9	85.9	1	52.0-150			2.37	45
1,1-Dichloroethene	0.0198	U	0.0244	0.0250	123	126	1	1.00-234			2.43	32
1,1-Dichloroethane	0.0200	U	0.0177	0.0182	88.5	91.0	1	59.0-155			2.79	40
1,2-Dibromoethane	0.0200	U	0.0174	0.0171	87.0	85.5	1	70.0-130			1.74	20
1,2-Dichlorobenzene	0.0200	U	0.0199	0.0197	99.5	98.5	1	18.0-190			1.01	57
1,2-Dichloroethane	0.0199	U	0.0187	0.0185	94.0	93.0	1	49.0-155			1.08	49
1,2-Dichloropropane	0.0199	U	0.0174	0.0172	87.4	86.4	1	1.00-210			1.16	55
1,3-Dichlorobenzene	0.0199	U	0.0204	0.0203	103	102	1	59.0-156			0.491	43
1,4-Dichlorobenzene	0.0200	U	0.0201	0.0199	101	99.5	1	18.0-190			1.00	57
2-Chloroethyl vinyl ether	0.100	U	0.0398	0.0491	39.8	49.1	1	1.00-305			20.9	71
Acrolein	0.100	U	0.0819	0.0865	81.9	86.5	1	4.00-172			5.46	20
Acrylonitrile	0.100	U	0.0798	0.0815	79.8	81.5	1	22.0-189			2.11	20
Benzene	0.0200	U	0.0181	0.0170	90.5	85.0	1	37.0-151			6.27	61
Bromodichloromethane	0.0199	U	0.0188	0.0182	94.5	91.5	1	35.0-155			3.24	56
Bromoform	0.0198	U	0.0180	0.0187	90.9	94.4	1	70.0-130			3.81	42
Bromomethane	0.0200	U	0.0207	0.0211	104	105	1	15.0-185			1.91	61
Carbon tetrachloride	0.0199	U	0.0214	0.0205	108	103	1	70.0-140			4.30	41
Chlorobenzene	0.0198	U	0.0196	0.0197	99.0	99.5	1	37.0-160			0.509	53
Chloroethane	0.0200	U	0.0207	0.0214	104	107	1	14.0-230			3.33	78
Chloroform	0.0198	U	0.0184	0.0181	92.9	91.4	1	51.0-138			1.64	54
Chloromethane	0.0200	U	0.0175	0.0152	87.5	76.0	1	1.00-273			14.1	20
cis-1,3-Dichloropropene	0.0200	U	0.0146	0.0151	73.0	75.5	1	1.00-227			3.37	58
Dibromochloromethane	0.0198	U	0.0193	0.0193	97.5	97.5	1	53.0-149			0.000	50
Ethylbenzene	0.0201	U	0.0188	0.0186	93.5	92.5	1	37.0-162			1.07	63
Methylene Chloride	0.0204	U	0.0148	0.0150	72.5	73.5	1	1.00-221	J	J	1.34	28
Tetrachloroethene	0.0199	U	0.0209	0.0205	105	103	1	64.0-148			1.93	39
Toluene	0.0200	U	0.0173	0.0185	86.5	92.5	1	47.0-150			6.70	41
trans-1,2-Dichloroethene	0.0200	U	0.0196	0.0188	98.0	94.0	1	54.0-156			4.17	45
Trichloroethene	0.0200	U	0.0200	0.0187	100	93.5	1	70.0-157			6.72	48
Vinyl chloride	0.0200	U	0.0234	0.0203	117	102	1	1.00-251			14.2	66
(S) 1,2-Dichloroethane-d4					107	99.4		70.0-130				
(S) 4-Bromofluorobenzene					86.5	87.7		70.0-130				
(S) Toluene-d8					94.9	94.9		70.0-130				

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4101891-2 08/01/24 18:20

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
2-Butanone (MEK)	U		0.00822	0.0250
(S) 1,2-Dichloroethane-d4	99.8			70.0-130
(S) 4-Bromofluorobenzene	107			70.0-130
(S) Toluene-d8	104			70.0-130

Laboratory Control Sample (LCS)

(LCS) R4101891-1 08/01/24 17:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
2-Butanone (MEK)	0.101	0.106	105	70.0-130	
(S) 1,2-Dichloroethane-d4			113	70.0-130	
(S) 4-Bromofluorobenzene			103	70.0-130	
(S) Toluene-d8			105	70.0-130	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4099993-1 07/27/24 18:47

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
PCB 1016	U		0.000270	0.000500
PCB 1221	U		0.000270	0.000500
PCB 1232	U		0.000270	0.000500
PCB 1242	U		0.000270	0.000500
PCB 1248	U		0.000173	0.000500
PCB 1254	U		0.000173	0.000500
PCB 1260	U		0.000173	0.000500
Total PCBs	U		0.000173	0.000500
(S) Decachlorobiphenyl	81.9			10.0-144
(S) Tetrachloro-m-xylene	95.7			10.0-135

Laboratory Control Sample (LCS)

(LCS) R4099993-2 07/27/24 19:06

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00158	63.2	50.0-140	
PCB 1260	0.00250	0.000970	38.8	8.00-140	
(S) Decachlorobiphenyl			13.3	10.0-144	
(S) Tetrachloro-m-xylene			63.4	10.0-135	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4102652-1 08/02/24 11:00

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	57.0			29.0-132
(S) 2-Fluorobiphenyl	83.5			26.0-102
(S) 2-Fluorophenol	67.5	J1		10.0-66.0
(S) Nitrobenzene-d5	87.0			15.0-106
(S) p-Terphenyl-d14	98.5			10.0-120

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4102652-1 08/02/24 11:00

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	61.5	J1		10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4102652-2 08/02/24 11:29

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.158	79.0	31.0-120	
2,4,6-Trichlorophenol	0.200	0.196	98.0	37.0-144	
2,4-Dichlorophenol	0.200	0.180	90.0	39.0-135	
2,4-Dimethylphenol	0.200	0.190	95.0	32.0-120	
2,4-Dinitrophenol	0.200	0.133	66.5	100-191	
2-Chlorophenol	0.200	0.182	91.0	23.0-134	
2-Methylphenol	0.200	0.190	95.0	26.0-120	
2-Nitrophenol	0.200	0.177	88.5	29.0-182	
3&4-Methyl Phenol	0.200	0.180	90.0	27.0-120	
3,3-Dichlorobenzidine	0.400	0.429	107	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.164	82.0	100-181	
4-Chloro-3-methylphenol	0.200	0.186	93.0	22.0-147	
4-Nitrophenol	0.200	0.131	65.5	100-132	
Anthracene	0.200	0.204	102	27.0-133	
Benzidine	0.400	0.229	57.3	100-120	
Benzo(a)anthracene	0.200	0.203	102	33.0-143	
Benzo(a)pyrene	0.200	0.218	109	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.180	90.0	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.233	117	8.00-158	
Chrysene	0.200	0.191	95.5	17.0-168	
Di-n-butyl phthalate	0.200	0.222	111	100-120	
Hexachloro-1,3-butadiene	0.200	0.151	75.5	24.0-120	
Hexachlorobenzene	0.200	0.161	80.5	100-152	
Hexachlorocyclopentadiene	0.200	0.131	65.5	10.0-120	
Hexachloroethane	0.200	0.164	82.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.195	97.5	39.0-127	
n-Nitrosodiethylamine	0.200	0.197	98.5	10.0-142	
Nitrobenzene	0.200	0.185	92.5	35.0-180	
Nonylphenol	0.200	0.212	106	57.0-136	
Pentachlorobenzene	0.200	0.157	78.5	10.0-151	
Pentachlorophenol	0.200	0.179	89.5	14.0-176	
Phenanthrene	0.200	0.189	94.5	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4102652-2 08/02/24 11:29

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.139	69.5	5.00-120	
Pyridine	0.200	0.0571	28.5	10.0-120	
Total Cresols	0.400	0.370	92.5	36.0-110	
(S) 2,4,6-Tribromophenol			78.0	29.0-132	
(S) 2-Fluorobiphenyl			92.5	26.0-102	
(S) 2-Fluorophenol			77.0	10.0-66.0	J1
(S) Nitrobenzene-d5			92.0	15.0-106	
(S) p-Terphenyl-d14			97.5	10.0-120	
(S) Phenol-d6			75.0	10.0-54.0	J1

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
ND	Not detected at the Reporting Limit (or MDL where applicable).
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier	Description
B	The same analyte is found in the associated blank.
E	The analyte concentration exceeds the upper limit of the calibration range of the instrument established by the initial calibration (ICAL).
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J3	The associated batch QC was outside the established quality control range for precision.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
K9	Test replicates show more than 30% difference between high and low values.
Q	Sample was prepared and/or analyzed past holding time as defined in the method. Concentrations should be considered minimum values.
T8	Sample(s) received past/too close to holding time expiration.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gi

<sup>8</sup> Al

<sup>9</sup> Sc

# GLOSSARY OF TERMS

Qualifier	Description
V	The sample concentration is too high to evaluate accurate spike recoveries.

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey–NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio–VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA–Crypto	TN00003		


## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013

Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		


<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.



[illegible]

Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173				Billing Information:  <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173				Pres Chk		Analysis / Container / Preservative												Chain of Custody Page 2 of 3									
Report to: <b>Jeff McClain</b>				Email To: mburr@gpiltexas.org;jmccain@gpiltexas.org ;gplenviron@gpiltexas.org																		 400 W. DeYoung Drive Suite 200 190 Allen, TX 75013 <small>Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: https://info.pacelabs.com/hubfs/pas-standard-terms.pdf</small>									
Project Description: <b>TPDES</b>				City/State Collected:				Please Circle: PT MT CT ET																							
Phone: <b>972-485-6458</b>				Client Project #				Lab Project # <b>DSGARLWNTX-RENEW AL</b>														SDG # <b>L17ne0920</b>									
Collected by (print):				Site/Facility ID #				P.O. #														Table #									
Collected by (signature):				<b>Rush?</b> (Lab MUST Be Notified) ____ Same Day ____ Five Day ____ Next Day ____ 5 Day (Rad Only) ____ Two Day ____ 10 Day (Rad Only) ____ Three Day				Quote #														Acctnum: <b>DSGARLWNTX</b> Template: <b>T256244</b> Prelogin: <b>P1090746</b> PM: <b>3565 - Dorothy P Roberts</b> PB:									
Immediately Packed on Ice N ____ Y ____								Date Results Needed		No. of Cntrs														Shipped Via: <b>FedEX Priority</b>							
Sample ID				Comp/Grab		Matrix *		Depth		Date		Time														Remarks		Sample # (lab only)			
OUTFALL 001						WW								27		X		X		X		X		X		X		X		01	

[illegible]

 ANALYTICAL SERVICES	DC#_ Title: ENV-FRM-ALLE-0017 v15_Sample Condition Upon Receipt
	Effective Date: 12/18/2023

Sample Condition Upon Receipt

Client Name: Garland Power, Light ☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ Austin  
Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_  
Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒

Received on ice: Wet ☒ Blue ☐ No ice ☐

Receiving Lab 1 Thermometer Used: 1819

Receiving Lab 2 Thermometer Used: \_\_\_\_\_

Cooler Temp °C: 4.4 (Recorded) 4.5 (Actual)  
Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.


Triage Person: Ag Date: 7/26/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
pH Strips: <u>1402-007</u>	
Residual Chlorine Present	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Cl Strips: <u>14800</u>	
Sulfide Present	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Lead Acetate Strips: <u>14802</u>	
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
State Sampled: _____	
Non-Conformance(s): _____	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: je Date: 7/26

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_




Company Name/Address: <b>Garland Power &amp; Light</b>  13835 County Rd 489 Nevada, TX 75173		Billing Information: <b>Michael Burr</b> 13835 County Rd 489 Nevada, TX 75173		Pres Chk		Analysis / Container / Preservative										Chain of Custody Page 1 of 3							
Report to: <b>Jeff McClain</b>		Email To: mburr@gpiltexas.org;jmccain@gpiltexas.org;gplenviron@gpiltexas.org		 Pace Analytical 190 Allen, TX 75013 Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of Pace Terms and Conditions found at: https://info.pacelabs.com/hubfs/pas-standard-terms.pdf																			
Project Description: <b>TPDES</b>		City/State Collected:		Please Circle: PT MT CT ET		608.3PCBONLY 100ml Amb NoPres ALL625.1RV 100ml Amb NoPres ALLCN 250mlHDPE-NaOH ALLCNAM 250mlHDPE-NaOH ALLOGHEX 1L-Amb-Add HCl ALLPH 125mlHDPE-NoPres ALLPHOS 500mlHDPE-Add H2SO4 ALLSULFIDE 500mlHDPE-NaOH+ZnAc ALLTIICP 250mlHDPE HNO3 ALLTKN 250mlHDPE-H2SO4										SDG # <b>1716 0920</b>							
Phone: <b>972-485-6458</b>		Client Project #		Lab Project # <b>DSGARLWNTX-RENEW</b>												Table #							
Collected by (print): <b>JEFFREY MCCLAIN</b>		Site/Facility ID #		P.O. #												Acctnum: <b>DSGARLWNTX</b>							
Collected by (signature):		Rush? (Lab MUST Be Notified) Same Day Five Day Next Day 5 Day (Rad Only) Two Day 10 Day (Rad Only) Three Day		Quote #												Template: <b>T256244</b>							
Immediately Packed on Ice N Y		Date Results Needed		No. of Cntrs		Prelogin: <b>P1090746</b> PM: <b>3665 - Dorothy P Roberts</b> PB: Shipped Via: <b>FedEX Priority</b>																	
Sample ID		Comp/Grab	Matrix *	Depth	Date	Time	Remarks Sample # (lab only)																
OUTFALL 001		G	WW		7/24/24	1358	27	01															
* Matrix: SS - Soil AIR - Air F - Filter GW - Groundwater B - Bioassay WW - WasteWater DW - Drinking Water OT - Other		Remarks: <b>James 7-27-24 0900 EDA9 4.0+0.3=4.3</b> Samples returned via: <u>US</u> <u>FedEx</u> <u>Courier</u> Tracking #														pH Temp Flow Other		Sample Receipt Checklist COC Seal Present/Intact: NP Y N COC Signed/Accurate: Y N Bottles arrive intact: Y N Correct bottles used: Y N Sufficient volume sent: Y N If Applicable VOA Zero Headspace: Y N Preservation Correct/Checked: Y N RAD Screen <0.5 mR/hr: Y N					
Relinquished by: (Signature) <b>Jeffrey McClain</b>		Date: 7/26/24	Time: 1540	Received by: (Signature) <b>Jeffrey McClain</b>		Trip Blank Received: Yes / No HCL / MeOH TBR		If preservation required by Login: Date/Time															
Relinquished by: (Signature) <b>Jeffrey McClain</b>		Date: 7/26/24	Time: 1700	Received by: (Signature) <b>FedEx</b>		Date: 7/26/24		Time: 1700		Hold: Condition: NCF / OK													

[illegible]

[illegible]



	DC#_Title: ENV-FRM-ALLE-0017 v15_Sample Condition Upon Receipt
	Effective Date: 12/18/2023

Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ Austin

Client Name: Garland Power Light Project Work order (place label):

Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other:

Tracking #:

Custody Seal on Cooler/Box: Yes ☐ No ☒

Received on ice: Wet ☐ Blue ☐ No ice ☐

Receiving Lab 1 Thermometer Used: 1819

Cooler Temp °C: 4.4 (Recorded) 4.5 (Actual)

Receiving Lab 2 Thermometer Used:

Cooler Temp °C: (Recorded) (Correction Factor)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: Ag

Date: 7/26/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
pH Strips: <u>1402007</u>	
Residual Chlorine Present	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Cl Strips: <u>14880</u>	
Sulfide Present	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Lead Acetate Strips: <u>14802</u>	
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
State Sampled:	
Non-Conformance(s):	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: pe Date: 7/26

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

## **ATTACHMENT TR-5**

### Cooling Water System Data

**Worksheet 11.0**  
**Cooling Water Intake Information**  
**Section 1.b. Cooling Water System Data**

**1. Description of the design and annual operation of the facility's cooling water system and its relationship to the CWIS(s)**

A description of ROPP and the cooling-water system of the facility is provided in the facility PIC (GP&L, 2006). ROPP is a 420-megawatt peaking, gas-fired facility consisting of four generating units. The power plant is located on the southeast shore of Lake Lavon in Collin County (Figures 1 and 2). Units 1, 2, and 3 use Lake Lavon water for once-through condenser cooling. Unit 4 is a gas turbine that uses an average of 0.0006 mgd of reservoir water for contact cooling; then it is discharged to evaporation ponds. Units 1, 2, and 3 each have two circulating-water (CW) pumps. The CW pumps for Unit 1 are each rated at 30,000 gallons per minute (gpm). The CW pumps for Unit 2 are each rated at 35,000 gpm. The CW pumps for Unit 3 are each rated at 54,000 gpm. Each CW pump is served by a single traveling-water screen (screen) with  $\frac{3}{8}$ -inch square steel mesh. The facility's maximum design cooling-water withdrawal volume (flow) is 248,000 gpm (357 mgd). One screen wash pump per unit also withdraws small volumes of water from Lake Lavon.

Figure 3 shows the 5-year flow history for ROPP. In general, the facility withdraws more cooling water during summer, followed by winter and less water during fall and spring. In the 5-year flow history, the facility has not operated at design capacity. As shown in Figure 3, the facility withdraws less than the design capacity most of the time. The annual cooling water utilization capacity over the past 5 years was about 43% of the design capacity.


Normal operating reservoir pool elevation (reservoir elevation) is 492.0 feet (ft) mean sea level [msl]). The minimum operating reservoir elevation is 483.3 ft msl. The wetted screen depth at normal reservoir elevation is 32 ft. The CW pumps are either off, with zero flow, or operating at design flow. Screen velocities (velocity) vary among units due to the different CW pump capacities. In addition, velocity varies with varying wetted screen area, resulting in changes in reservoir elevation.

Cooling water is withdrawn from the rear of a 700-foot-long excavated intake canal. However, the distance to the main body of the reservoir is approximately 2,500 ft. The shallowest depth of the canal is approximately 25 ft.


Screens are usually washed once per 8-hour shift when the units are in operation. The length of time the screen wash operates varies depending on the differential pressure loss. On occasion, the screens may be washed several times during a single day. Screen-wash water from each unit is transported through a sluice, then to a debris sump and basket, and then returned to the reservoir near the CWIS. The cooling water system is described below in Table 1.

**Table 1. ROPP CWIS Configuration.**

	<b>Unit 1</b>	<b>Unit 2</b>	<b>Unit 3</b>	<b>Facility</b>
Number of circulating water pumps	2	2	2	
Circulating water pump capacity (mgd) per pump	43.2	50.4	77.8	
Number of service water pumps	1	1	1	
Service water pump capacity (mgd)	4.32	4.32	5.76	
Number of screens	2	2	2	
Screen type	Traveling	Traveling	Traveling	
Screen mesh size (inch)	0.38	0.38	0.38	
Through-screen velocity (fps)	0.84	0.98	1.51	
Design flow (mgd)				357
Percent reservoir volume pumped/day at design				0.2
Megawatt rating (Units 1-3)				420
24-month capacity utilization (June 2022 – June 2024)	0.0%	3.4%	3.9%	3.6%

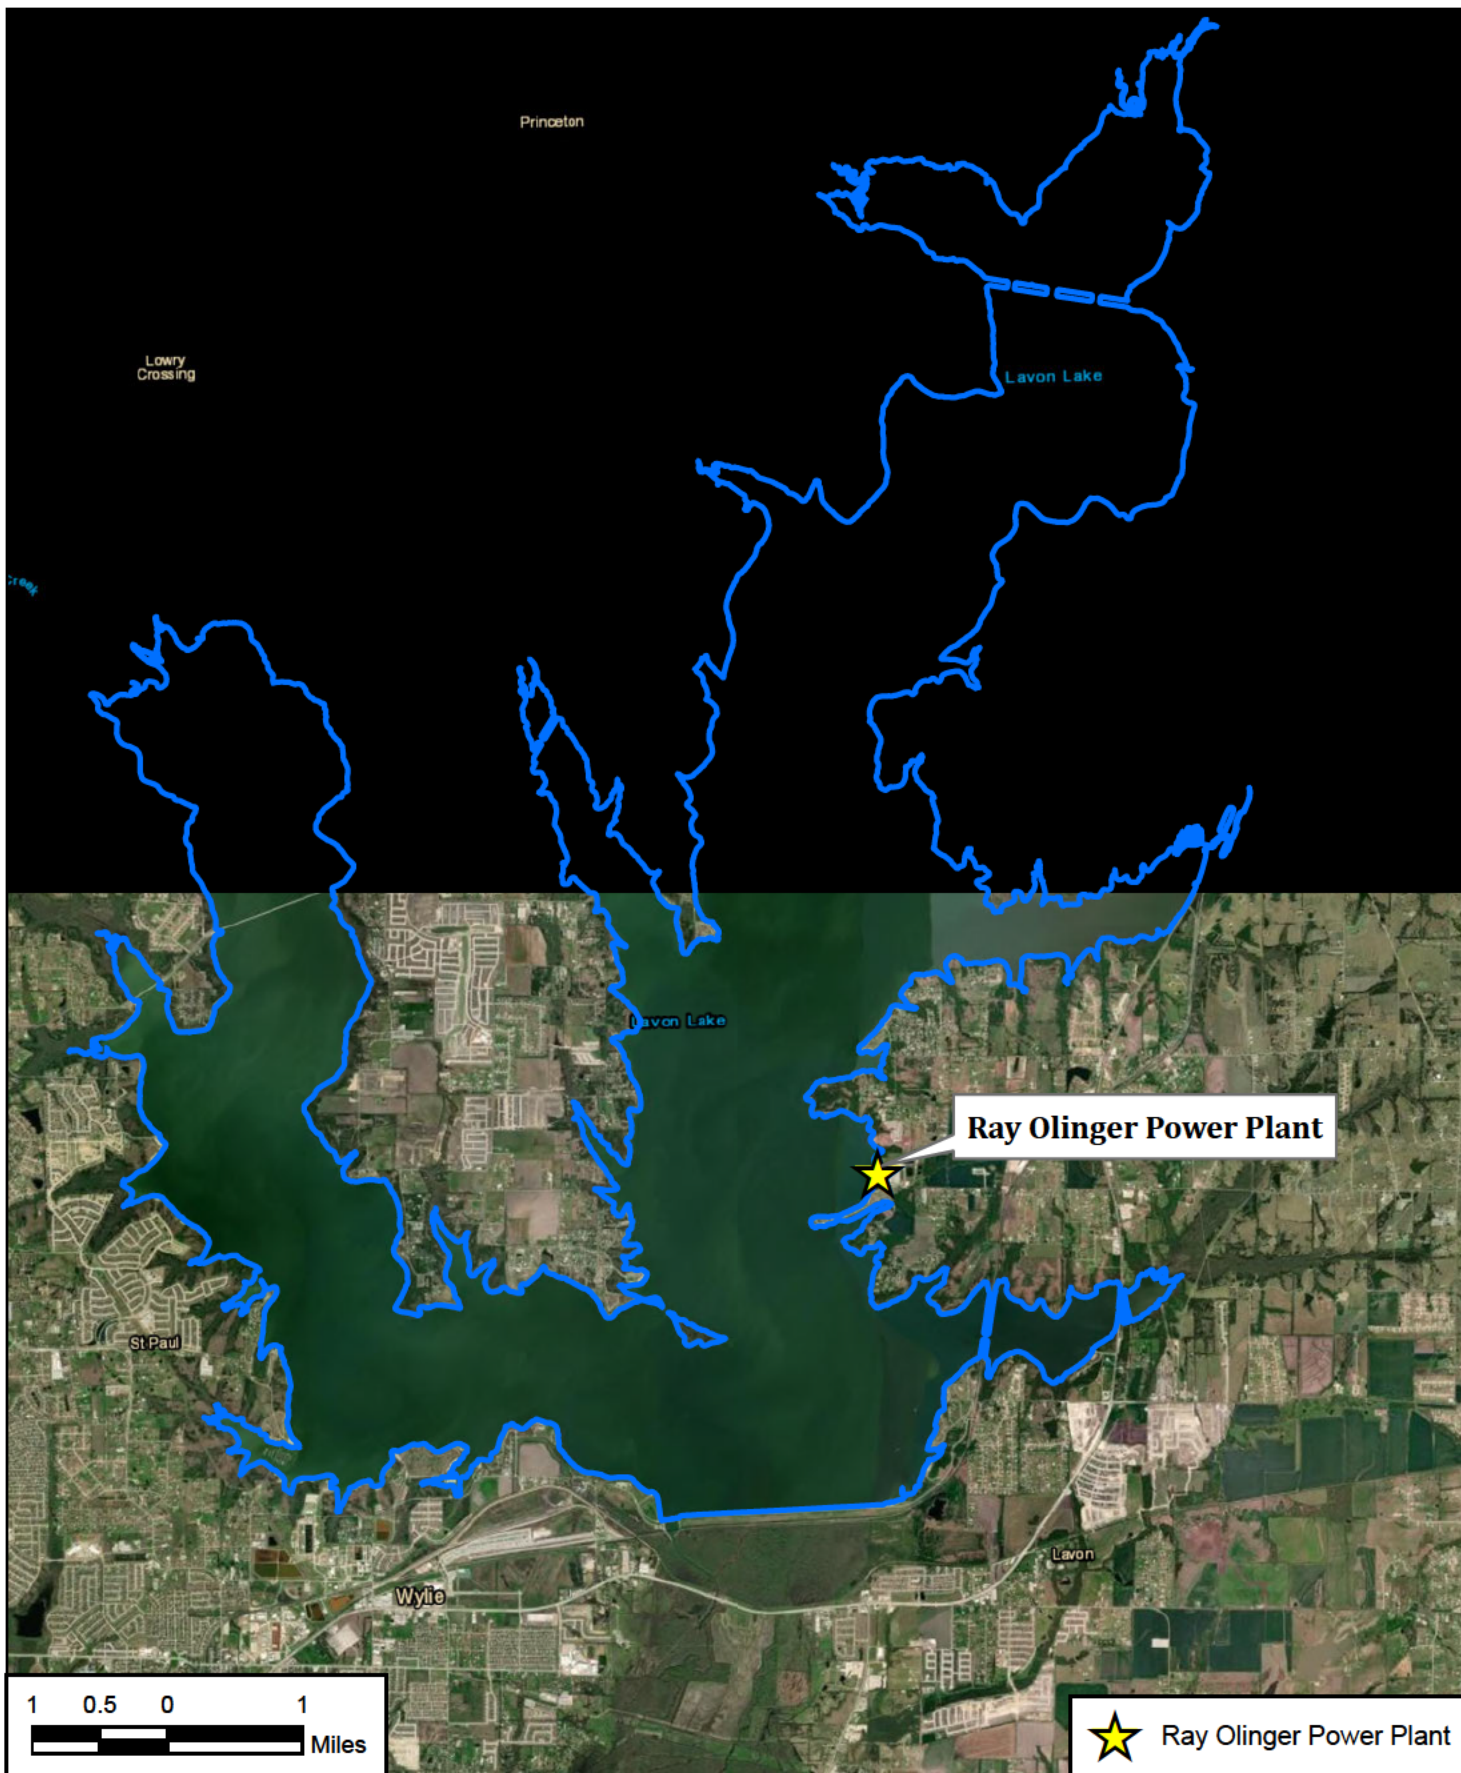

**FREESSE AND NICHOLS**  
 FREESSE AND NICHOLS, INC  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland

# Ray Olinger Power Plant

## Lake Lavon

FW JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	7/16/2024
SCALE	1:90,000
DESIGNED	CLV
DRAFTED	08245

**5**

**FIGURE**





**FRESE AND NICHOLS**  
 FREESE AND NICHOLS, INC  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland

**Ray Olinger Power Plant**


**Power Plant Facilities**

FW JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	7/18/2024
SCALE	1:7,372
DESIGNED	CLV
DRAFTED	08245

**5**

**FIGURE**

Figure 3. 5-year Flow History for ROPP

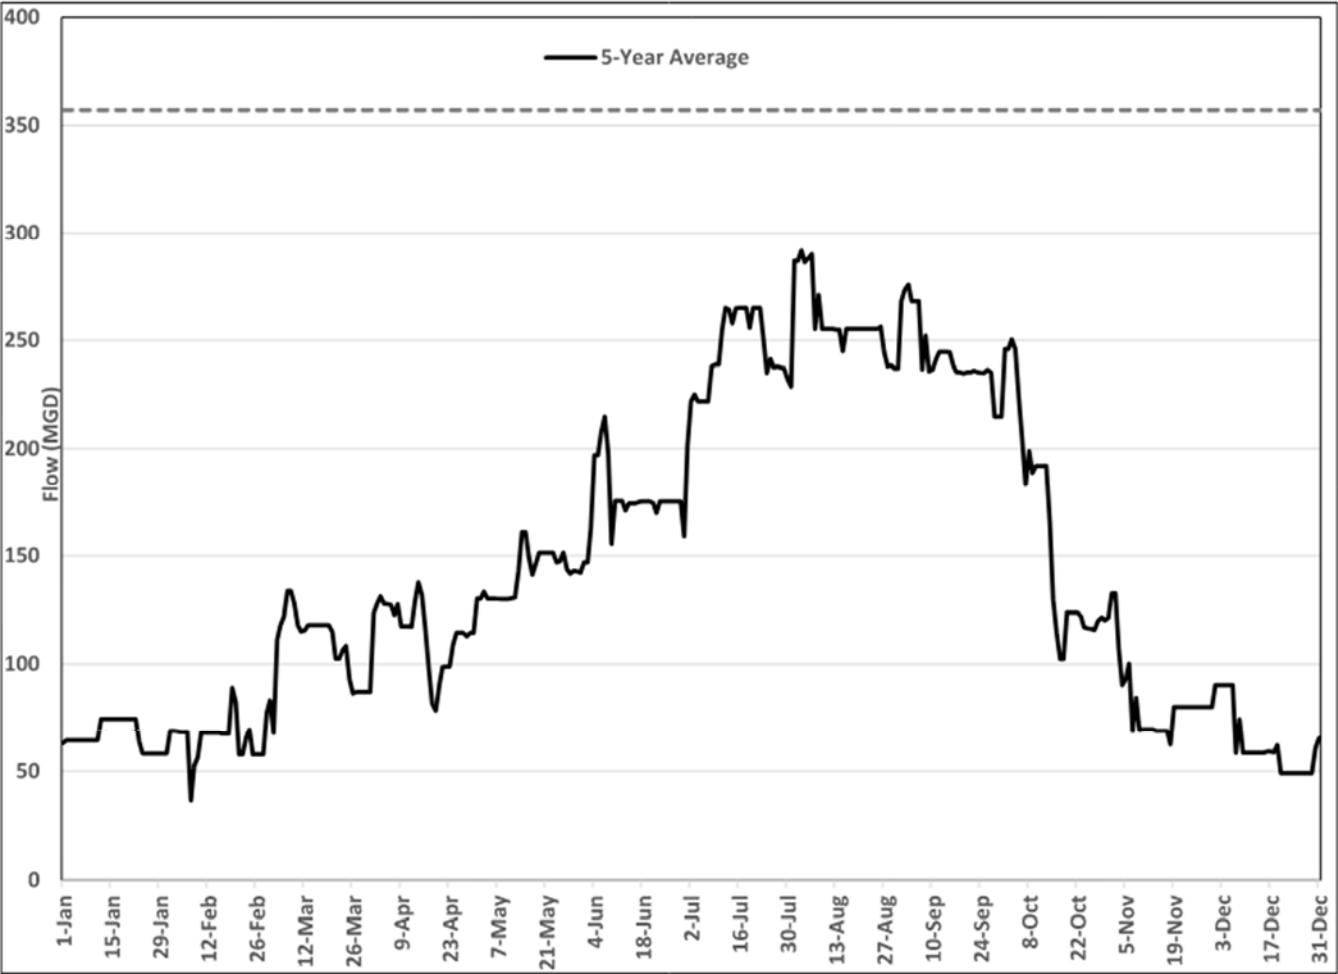

### **Section 1.b. Cooling Water System Data**

- 2. A scaled map depicting the location of each CWIS, impoundment, intake pipe, and canals, pipes, or waterways used to convey cooling water to, or within, the cooling water system. Provide the latitude and longitude for each CWIS and any intake pipe(s) on the map. Indicate the position of the intake pipe within the water column.**

Figures 1 and 2 provide aerial views of the CWIS and associated power plant facilities. The CWIS geographic location is at: 33° 03' 55.37" N, 96° 27' 11.30" W. The CWIS withdraws from the rear of an excavated channel that is approximately 34-feet deep at the CWIS. The floor of the CWIS is at 458.0 ft- msl. Normal pool elevation of Lake Lavon is 492.0 ft-msl. The traveling screens span from the floor of the CWIS to the top deck, allowing vertical integration of the water column. However, the CW pumps are vertical-shaft turbines with the impellers near the floor of the CWIS, and, therefore, a higher proportion of flow is generally from near the bottom.

- 3. A description of water reuse activities, if applicable.**

ROPP utilizes once-through cooling water from Lake Lavon. While cooling water is circulated within the reservoir, there is no reuse, such as reclaimed effluent to offset the use of surface water.

- 4. Design and engineering calculations prepared by a qualified professional and data to support the information provided in above item a.**

DIF is the compilation of all circulating and service water pump capacities (assumed zero head differential). AIF is the average discharge monitoring reported flows for the past 3 years (June 2021 – June 2024). Intake flow use percentage is the proportion of the reported flow for each use to the AIF. The proportion of contact cooling was derived from a 3-year average that is presented in the water balance. There is no process use of water at ROPP.



### Section 1.b. Cooling Water System Data

#### 5. Previous year (a minimum of 12 months) of AIF data.

**Table 4. Ray Olinger Power Plant actual intake flow, January 2023 – December 2023.**

Day	January	February	March	April	May	June	July	August	September	October	November	December
1	6.48	57.6	54.721	213.12	213.12	216	268.56	268.56	268.56	268.56	113.04	7.2
2	7.2	57.6	56.041	213.12	213.12	216	268.56	268.56	268.56	268.56	113.04	7.2
3	7.2	57.6	57.6	222	222	188.64	279.75	279.75	279.75	279.75	49.98	7.5
4	7.2	57.6	137.52	213.12	213.12	213.12	268.56	268.56	268.56	268.56	7.2	7.2
5	7.2	57.6	134.64	213.12	213.12	213.12	268.56	268.56	268.56	264.27	7.2	7.2
6	7.2	57.6	154.8	213.12	213.12	213.12	268.56	268.56	268.56	242.82	7.2	7.2
7	7.2	57.6	213.12	213.12	213.12	213.12	268.56	268.56	268.56	268.56	7.2	7.2
8	7.2	57.6	213.12	213.12	213.12	167.76	268.56	268.56	268.44	268.56	7.29	7.2
9	7.2	57.6	135.36	213.12	213.12	61.14	268.56	268.56	266.52	268.56	8.28	7.2
10	7.2	57.6	57.6	213.48	213.12	110.88	268.56	268.56	268.56	268.56	9.36	7.2
11	7.2	57.6	42.9	213.12	214.32	110.88	268.56	268.56	268.56	268.56	9.36	7.2
12	57.6	57.6	45	213.12	216	110.88	268.56	268.56	268.56	268.56	9.36	7.2
13	57.6	57.6	57.6	213.12	216	110.88	264.24	268.56	268.56	268.56	9.27	7.2
14	57.6	57.6	57.6	213.12	216	110.88	232.92	268.56	268.56	190.8	7.2	7.2
15	57.6	57.6	57.6	213.12	216	110.88	268.56	268.56	268.56	113.04	7.2	7.2
16	57.6	54.721	57.6	213.12	216	110.88	268.56	268.56	268.56	113.04	7.2	7.2
17	57.6	54.721	57.6	213.12	216	110.88	268.56	268.56	268.56	113.04	7.2	7.2
18	57.6	54.721	57.6	213.12	243.3	110.88	268.56	268.56	268.56	113.04	7.2	7.2
19	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	267.48	113.04	7.2	7.2
20	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
21	57.6	54.721	57.6	213.12	266.4	108.96	268.56	268.56	268.56	113.04	7.2	7.2
22	57.6	54.721	57.6	213.12	266.4	97.44	268.56	268.56	268.56	113.04	7.2	7.2
23	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
24	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
25	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
26	57.6	54.721	55.98	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
27	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	111.6	7.2	7.2
28	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	107.521	7.2	7.2
29	57.6		57.6	213.12	266.4	110.88	268.56	268.56	268.56	111.12	7.2	7.2
30	57.6		57.6	213.12	266.4	110.88	268.56	268.56	268.56	108.001	7.2	7.2
31	57.6		57.6		266.4		268.56	268.56		110.641		7.2
<b>AVG</b>	<b>39.6929</b>	<b>56.26332</b>	<b>77.26458</b>	<b>213.428</b>	<b>237.3194</b>	<b>133.838</b>	<b>267.6319</b>	<b>268.921</b>	<b>268.825</b>	<b>179.6324</b>	<b>16.006</b>	<b>7.209677</b>

**6. A narrative description of existing or proposed impingement and entrainment technologies or operation measures and a summary of their performance, including, but not limited to, reductions in impingement mortality and entrainment due to intake location and reductions in total water withdrawals and usage.**

There have been no technologies or operational measures recently employed to specifically reduce impingement mortality or entrainment at ROPP. From November 2006 through November 2007, biweekly impingement sampling was conducted at ROPP (Impingement Mortality Characterization Study, Ray Olinger Power Plant conducted by PBS&J, 2007). Over the course of that study, a total of 387 fish impinged, of which 88% were Threadfin (*Dorosoma petenense*) and Gizzard (*D. cepedianum*) shad, followed by Largemouth Bass (*Micropterus salmoides*) [5%], and Golden Shiner (*Notemigonus crysoleucas*) [3%]. The cooling water capacity factor (AIF/DIF x 100) was 43% during the study. Total impingement for the entire year was estimated at approximately 4,800, with the overwhelming majority of fish consisting of fragile (shad) [40 FCR 125.92(m)] or exotic (Golden Shiner) species.

The number of fish not considered fragile or exotic expected to be impinged at ROPP is exceptionally low (up to a few hundred annually) and the facility might qualify for the de minimis alternative (40 CFR 125.94[11]) to meet impingement mortality compliance standard. The low impingement rate results from the CWIS location and design. The U.S. Environmental Protection Agency's 2004 Final Regulations to Establish Requirements for Cooling Water Intake Structures at Phase II Existing Facilities Rule defines a "baseline" CWIS configuration as one that is oriented parallel to the shore and is absent impingement or entrainment control measures (otherwise, worst-case scenario). The CWIS at ROPP is located at the rear of a man-made, excavated canal that is 32-feet deep at normal reservoir pool elevation. The CWIS employs vertical-shaft turbine pumps that withdraw from near the floor of the CWIS (deep water), which is not the most biologically productive zone. In addition, screen velocities are relatively low, ranging from 0.8 (Unit 1) to 1.5 (Unit 3) fps at normal reservoir pool elevation. Therefore, the location and operation of the CWIS aids in reducing impingement mortality. It is also important to note that cooling water capacity is generally low, with a recent 3-year (2016-2018) average of 41%, indicating that current and likely future CWIS operations for ROPP would likely result in low impingement.

Entrainment has not been monitored at ROPP. Peak spawning (and juvenile life stage abundance) in Lake Lavon occurs in the spring and early summer. As indicated in Figure 3, power plant operations are greatly reduced in the spring, during spawning season. In addition, the CWIS is located at the rear of a deep, excavated channel which presumably has little, if any littoral habitat for spawning. As a result of this operational pattern and the location of the CWIS, entrainment at ROPP is expected to be low.

## **ATTACHMENT TR-6**

Cooling Water Intake Structure(s) Data

**Worksheet 11.0**  
**Cooling Water Intake Information**

**Section 2.b. Cooling Water Intake Structure Data**

- 1. A narrative description of the configuration of each CWIS, annual and daily operation, including any seasonal changes, and where it is located in the water body and in the water column.**

ROPP has a single CWIS which is divided into bays which serve each of the units' CW pumps. Each unit has two circulating-water (CW) pumps. The Cooling Water Intake Structure(s) Data Table describes the components of the CWIS. Each CW pump is served by a single traveling-water screen (screen) with  $\frac{3}{8}$ -inch square steel mesh. Screens are usually washed once per 8-hour shift when the units are in operation. The length of time the screen wash operates varies depending on the differential pressure loss. On occasion the screens may be washed several times during a single day. Screen-wash water from each unit is transported through a sluice, then to a debris sump and basket, and then returned to the reservoir near the CWIS.

Figure 3 shows the 5-year flow history for ROPP. In general, the facility withdraws more cooling water during summer followed by winter and less water during fall and spring. In the 5-year flow history, the facility had not operated at design capacity. As shown on Figure 3, the facility withdraws less than design capacity during most of the time. The annual cooling water utilization capacity over the past 5 years was about 43% of design capacity

Cooling water is withdrawn from the rear of a 700-foot-long excavated intake canal. However, the distance to the main body of the reservoir is approximately 2,500 ft. The shallowest depth of the canal is approximately 25 ft; however, the depth in the vicinity of the CWIS is approximately 32 feet under normal reservoir pool elevation. The CW pumps are vertical-shaft turbines with the impellers near the floor of the CWIS. Therefore, a higher proportion of flow is generally from near the bottom (deeper water).

- 2. Engineering calculations for each CWIS.**

There is only one CWIS at ROPP. CWIS information is listed in the ROPP CWIS Configuration Table in Attachment TR-5 and The Cooling Water Intake Structure(s) Data Table (Worksheet 11.0 2.a). DIF is 357 mgd and is the compilation of all circulating and service water pump capacities (assumed zero head differential). AIF is the average reported flows for the past 3 years (June 2021 – June 2024). Intake flow uses percentage is the proportion of the reported flow for each use to the AIF.

## **ATTACHMENT TR-7**

### Source Water Physical Data

**Worksheet 11.0**  
**Cooling Water Intake Information**  
**Section 3.b. Source Water Physical Data**

- 1. A narrative description of the source water for each CWIS, including areal dimensions, depths, salinity and temperature regimes, and other documentation that supports your determination of the water body type where each cooling water intake structure is located.**

ROPP uses cooling water from Lake Lavon. The facility utilizes a single CWIS located at the rear of a 700-foot-long excavated intake canal (see Figure 4). The distance to the main body of the reservoir is approximately 2,500 ft. The depth at the CWIS is approximately 32 ft under conservation pool elevation. Lake Lavon is a man-made impoundment constructed on the East Fork Trinity River, Texas Commission on Environmental Quality Segment No. 0821. At normal operating reservoir pool elevation of 492.0 ft msl, total surface area of Lake Lavon is 20,559 acres with a storage capacity of approximately 409,360 acre-feet. The reservoir and power plant are located in the Navarro and Taylor geologic groups (Bureau of Economic Geology <http://www.jsg.utexas.edu/news/files/Geologic-map-of-Texas.jpg>).

- 2. A narrative description of the source waterbody's hydrological and geomorphological features.**

Lake Lavon is a fresh water impoundment used for flood control, water supply, and recreation. The reservoir fishery is stocked and managed by the Texas Parks and Wildlife Department. Water quality was monitored for 1 year during the ROPP impingement study (Ray Olinger Impingement Mortality Study, PBS&J, 2007). Temperature ranged from 7°C in February to 31°C in September 2007. Salinity remained below 0.5 parts per thousand during the study.

- 3. Scaled drawings showing the physical configuration of all source water bodies used by the facility, including the source waterbody's hydrological and geomorphological features. Note: The source waterbody's hydrological and geomorphological features may be included on the map submitted for item 1.b.ii of this worksheet.**

See Figure 4.

- 4. A description of the methods used to conduct any physical studies to determine your intake's area of influence within the waterbody and the results of such studies.**

There have been no studies that describe the zone of influence associated with cooling water withdrawal by the facility.





# **ATTACHMENT TR-8**

Operational Status



**Worksheet 11.0**  
**Cooling Water Intake Information**  
**Section 4.a. Operational Status**

1. Describe the operating status of each individual unit, including age of each unit, capacity utilization rate (or equivalent), for the previous five years (a minimum of 60 months), and any seasonal changes in operation.

ROPP Unit 1 was constructed in 1967, Unit 2 in 1971, and Unit 3 in 1975. Each unit remains in service, although operating intermittently and at a very low utilization capacity. Over the past 5 years (October 2018 – June 2024), the capacity utilization rate for the power plant was 2.3% (Table 5).

**Table 5. Ray Olinger Power Plant 5-Year Monthly Capacity Utilization Rate by Unit.**

DATE	UNIT 1	UNIT 2	UNIT 3	DATE	UNIT 1	UNIT 2	UNIT 3
Oct-18	0.0%	0.0%	0.0%	Jan-22	0.0%	1.4%	0.0%
Nov-18	0.0%	0.0%	2.1%	Feb-22	0.0%	3.7%	2.8%
Dec-18	0.0%	0.0%	0.0%	Mar-22	0.0%	2.2%	1.9%
Jan-19	0.0%	0.0%	0.0%	Apr-22	0.0%	0.3%	0.0%
Feb-19	0.0%	0.0%	0.0%	May-22	0.0%	1.7%	9.3%
Mar-19	0.2%	1.5%	0.0%	Jun-22	0.0%	7.6%	0.4%
Apr-19	0.0%	0.0%	0.0%	Jul-22	0.0%	10.9%	8.6%
May-19	0.0%	0.0%	0.0%	Aug-22	0.0%	6.3%	8.7%
Jun-19	0.5%	2.4%	5.3%	Sep-22	0.0%	3.0%	3.9%
Jul-19	1.4%	7.5%	12.2%	Oct-22	0.0%	1.4%	0.0%
Aug-19	7.7%	28.2%	36.9%	Nov-22	0.0%	0.0%	0.0%
Sep-19	2.9%	10.0%	28.4%	Dec-22	0.0%	0.0%	0.0%
Oct-19	0.7%	3.0%	5.9%	Jan-23	0.0%	0.2%	0.0%
Nov-19	0.0%	0.0%	0.7%	Feb-23	0.0%	0.3%	0.0%
Dec-19	0.0%	0.0%	1.8%	Mar-23	0.0%	3.0%	0.2%
Jan-20	0.0%	0.0%	0.0%	Apr-23	0.0%	2.6%	2.7%
Feb-20	0.0%	0.0%	0.0%	May-23	0.0%	3.8%	3.3%
Mar-20	0.0%	0.0%	0.0%	Jun-23	0.0%	7.9%	7.0%
Apr-20	0.0%	1.0%	0.7%	Jul-23	0.0%	6.5%	4.8%
May-20	0.0%	0.2%	0.7%	Aug-23	0.0%	15.3%	29.3%
Jun-20	0.0%	1.0%	0.4%	Sep-23	0.0%	5.2%	12.1%
Jul-20	0.2%	0.6%	2.1%	Oct-23	0.0%	0.0%	6.6%
Aug-20	0.9%	6.1%	7.9%	Nov-23	0.0%	0.0%	5.6%
Sep-20	0.0%	0.3%	0.3%	Dec-23	0.0%	0.4%	0.0%
Oct-20	0.0%	0.0%	0.0%	Jan-24	0.0%	2.1%	3.0%
Nov-20	0.0%	0.0%	0.0%	Feb-24	0.0%	0.0%	0.0%
Dec-20	0.0%	0.0%	0.0%	Mar-24	0.0%	0.5%	0.0%
Jan-21	0.0%	0.0%	0.0%	Apr-24	0.0%	2.4%	0.0%
Feb-21	0.0%	0.0%	22.4%	May-24	0.0%	2.3%	0.0%
Mar-21	0.0%	0.0%	0.0%	Jun-24	0.0%	2.4%	1.4%

Apr-21	0.0%	0.4%	0.0%	
May-21	0.0%	0.0%	0.0%	
Jun-21	0.0%	2.3%	4.1%	
Jul-21	0.0%	6.4%	6.9%	
Aug-21	0.0%	6.4%	7.7%	
Sep-21	0.0%	1.1%	3.1%	
Oct-21	0.0%	0.0%	15.5%	
Nov-21	0.0%	0.3%	3.1%	
Dec-21	0.0%	1.5%	0.0%	

In the most recent 24-month contiguous block (June 2022 – June 2024), none of the units operated in February 2024. The highest periods of utilization capacity were July 2022 and August 2023, at 10.9% and 15.3%, respectively. Over this period, Unit 1 ran the least at 0.0%, and Unit 2 ran the most at 3.4% average utilization capacity. In general, the units rarely operate in the spring and fall.

**2. Describe any extended or unusual outages that significantly affect current data for flow, impingement, entrainment, or other factors.**

There have been no significant facility modifications or extended outages in the past 15 years nor are there any major outages planned in the near future. However, the facility operates at a very low electric utilization capacity; therefore, impingement and entrainment impacts are minimized due to normal plant operations.

**3. Identify any operating unit with a capacity utilization rate of less than 8 percent averaged over a contiguous period of two years (a minimum of 24 months).**

Units 1, 2, and 3 each have capacity utilization rates of less than 8% over a recent, contiguous 24-month period, June 2022 – June 2024 (see Table 6). The average capacity utilization rate for Unit 1 was 0.8%, Unit 2 was 1.9%, and Unit 3 was 1.4%. The total facility average capacity utilization rate during this period was 1.4%.

**Table 6. Ray Olinger Power Plant Electric Capacity Utilization Rate from June 2022 – June 2024.**

Electric Capacity Utilization by Month			
Date	ROP 1 MW	ROP 2 MW	ROP3 MW
Jun-22	0.0%	7.6%	0.4%
Jul-22	0.0%	10.9%	8.6%
Aug-22	0.0%	6.3%	8.7%
Sep-22	0.0%	3.0%	3.9%
Oct-22	0.0%	1.4%	0.0%
Nov-22	0.0%	0.0%	0.0%
Dec-22	0.0%	0.0%	0.0%
Jan-23	0.0%	0.2%	0.0%
Feb-23	0.0%	0.3%	0.0%
Mar-23	0.0%	3.0%	0.2%
Apr-23	0.0%	2.6%	2.7%
May-23	0.0%	3.8%	3.3%

Jun-23	0.0%	7.9%	7.0%
Jul-23	0.0%	6.5%	4.8%
Aug-23	0.0%	15.3%	29.3%
Sep-23	0.0%	5.2%	12.1%
Oct-23	0.0%	0.0%	6.6%
Nov-23	0.0%	0.0%	5.6%
Dec-23	0.0%	0.4%	0.0%
Jan-24	0.0%	2.1%	3.0%
Feb-24	0.0%	0.0%	0.0%
Mar-24	0.0%	0.5%	0.0%
Apr-24	0.0%	2.4%	0.0%
May-24	0.0%	2.3%	0.0%
Jun-24	0.0%	2.4%	1.4%
<b>24-Month Average</b>	<b>0.0%</b>	<b>3.4%</b>	<b>3.9%</b>

**4. Describe any major upgrades completed within the last 15 years, including but not limited to boiler replacement, condenser replacement, turbine replacement, or changes to fuel type.**

There have been no significant facility modifications the past 15 years nor are there any major modifications planned in the near future.

## **ATTACHMENT TR-9**

### **TPWD Fisheries Management Report**

PERFORMANCE REPORT

As Required by

FEDERAL AID IN SPORT FISH RESTORATION ACT

TEXAS

FEDERAL AID PROJECT F-221-M-5

INLAND FISHERIES DIVISION MONITORING AND MANAGEMENT PROGRAM

2014 Fisheries Management Survey Report

**Lavon Reservoir**

Prepared by:

Bruce Hysmith, District Management Supervisor  
and  
John H. Moczygemba, Assistant District Management Supervisor

Inland Fisheries Division  
Denison District  
Pottsboro, Texas



Carter Smith  
Executive Director

Craig Bonds  
Director, Inland Fisheries

July 31, 2015

## TABLE OF CONTENTS

Survey and Management Summary .....	2
Introduction.....	3
Reservoir Description.....	3
Angler Access .....	2
Management History .....	3
Methods.....	4
Results and Discussion.....	4
Fisheries Management Plan .....	6
Literature Cited.....	7
Figures and Tables .....	8-21
Water Level (Figure 1) .....	8
Reservoir Characteristics (Table 1) .....	8
Boat Ramp Characteristics (Table 2).....	8
Harvest Regulations (Table 3) .....	9
Stocking History (Table 4).....	10
Structural Habitat Survey (Table 5).....	12
Aquatic Vegetation Survey (Table 6).....	
Gizzard Shad (Figure 2).....	13
Bluegill (Figure 3).....	14
Blue Catfish (Figure 4) .....	15
Channel Catfish (Figure 5).....	16
White Bass (Figure 6) .....	17
Largemouth Bass (Figure 7; Table 7) .....	19
White Crappie (Figure 8) .....	20
Black Crappie (Figure 9) .....	21
Proposed Sampling Schedule (Table 8) .....	21
Appendix A	
Catch Rates for All Target Species from All Gear Types.....	22
Appendix B	
Map of 2010-2011 Sampling Locations .....	23
Appendix C	
Historical Catch Statistics 1996-2014 .....	24

## SURVEY AND MANAGEMENT SUMMARY

Fish populations in Lavon Reservoir were surveyed in 2014 using electrofishing and trap netting and in 2015 using gill netting. Historical data are presented with the 2014-2015 data for comparison. This report summarizes the results of the surveys and contains a management plan for the reservoir based on those findings.

- **Reservoir description:** Lavon Reservoir is a 21,400-acre impoundment located on the East Fork Trinity River approximately 8 miles east of McKinney. Since July 2011 water level has fluctuated 13 feet above and below conservation elevation (492 feet above mean sea level). However, water level began dropping July 2012 and continued dropping until January 2015. Lavon Reservoir has moderate productivity. Habitat features consisted mainly of riprap along the dam and railroad bridges, dead trees and stumps, and rocky shoreline. Standing dead timber was an important habitat feature.
- **Management history:** Important sport fishes include White Bass, Largemouth Bass, White and Black Crappie, and Blue and Channel Catfish. The management plan from the 2011 survey report included requesting the TPWD Webmaster include a statement about the improving sport fishery, especially Blue and Channel Catfish, and Largemouth Bass. We cooperated with USACOE in posting signage warning lake visitors of the potential of zebra mussel infestation. Advised, educated, and provided signage and invasive species literature to marina owners. Utilizing media outlets and speaking engagements, we provided our constituents and user groups this same information. Monitored existing inter-basin water transfers. Monitored Portland samplers deployed in the reservoir for zebra mussel colonization.
- **Fish community**
  - **Prey species:** Threadfin Shad continued to be present, but showed a decline in abundance. While showing a large decline in numbers, the electrofishing catch of Gizzard Shad was still high and most (95%) were available as prey to most sportfishes. The electrofishing catch of prey-size Bluegill declined in numbers, but was still above the district average.
  - **Catfishes:** Gill net catch of Blue Catfish declined, but 100% of the population was legal size and in good condition. Recruitment was low, but they continue to out-number Channel Catfish in abundance. Gill net catch of Channel Catfish declined. No Flathead Catfish were collected.
  - **White Bass:** Gill net catch of White Bass increased and no Striped Bass were collected.
  - **Largemouth Bass:** The electrofishing catch of Largemouth Bass declined, but recruitment was good and relative weights were fair for legal-size fish. Over one-half of the Largemouth Bass sample population was legally harvestable.
  - **Crappies:** The trap netting catch of White Crappie increased, body condition and recruitment was good, and over one-half of the sample population was legal size and larger. The trap netting catch of Black Crappie was at an all-time high and the fish were in good condition. We predict a bright future for Black Crappie.
- **Management strategies:** Conduct general monitoring with electrofisher, trap nets, and gill nets in 2018-2019. Publicize improvements to sport fishes in the reservoir to anglers. Inform the Lavon Reservoir U.S. Army Corps of Engineers personnel about new exotic species threats to Texas waters, and work with them to display appropriate signage, educate constituents, and understand appropriate enforcement actions. Continue to monitor immigration of invasive species into Lavon Reservoir.

## INTRODUCTION

This document is a summary of fisheries data collected from Lavon Reservoir in 2014-2015. Sampling of fishes was done by electrofishing and trap netting in 2014 and in 2015 by gill netting. The purpose of the document is to provide fisheries information and make management recommendations to protect and improve the sport fishery. While information on other species of fishes was collected, this report deals primarily with major sport fishes and important prey species. Historical data are presented with the 2014-2015 data for comparison.

### *Reservoir Description*

Lavon Reservoir is a 21,400-acre impoundment constructed in 1953 on the East Fork Trinity River. It is located in Collin County approximately 8 miles east of McKinney and is operated and controlled by the U.S. Army Corps of Engineers (USACOE). The original dam impounded 11,080 acres of water. In 1974 the dam was raised 12 feet and increased the surface area of the reservoir to 21,400 acres. Primary project purposes are municipal and industrial water supply, flood control, and recreation. To augment municipal and industrial water, Lavon Reservoir receives inter-basin transfers from Cooper and Tawakoni Reservoirs and the East Fork Raw Water Supply Project near Seagoville, TX. The inter-basin transfer of Texoma Reservoir water via Sister Grove Creek has been converted to a direct pipeline transfer from Texoma Reservoir to the North Texas Municipal Water District water treatment facility at Wylie, TX. Lavon Reservoir also receives outfall from a regional sewage treatment facility. Lavon Reservoir was mesotrophic with a mean TSI chl-a of 39.30 (Texas Commission on Environmental Quality 2011). Habitat at time of sampling consisted of dead trees, rocks and boulders, riprap, but mostly rocky interspersed with bare soil shoreline. There were isolated patches of native submerged and emergent vegetation. Native aquatic plants present were pondweed, water willow, and buttonbush. Water level has been low and unstable since July 2011 (Figure 1). With the exception of July 2011, most of the reservoir was 8 to 12 feet below conservation throughout this study period. Other descriptive characteristics for Lavon Reservoir are in Table 1.

### *Angler Access*

Lavon Reservoir has 16 public boat ramps (Table 2). During the period July 2011 through spring 2015 access via these boat ramps was limited to the period January 2012 to July 2013. Early in this period access was denied because of low water and late in this period access was denied because of high water. Boat ramp characteristics appear in detail in Table 2. Bank fishing access has been compromised due to large expanses of exposed flats and shallow inshore water. Despite this there are still potential sites available at USACOE recreation areas and to a lesser extent from public roads. Shoreline access to Lavon Reservoir is unlimited unless posted because it is U.S. Army Corps of Engineers property; hence, public.

### *Management History*

**Previous management strategies and actions:** Management strategies and actions from the previous survey report (Hysmith and Moczygemba 2011) included:

1. Recommended incorporating improvements in the sport fishery on the TPWD web site.  
**Action:** Sport fish survey data were forwarded to the TPWD webmaster in Austin.
2. Recommended cooperating with reservoir controlling authority and marinas to inform and educate the public about invasive species.  
**Action:** Posted appropriate signage at reservoir access points, informed marina owners regarding invasive species, provided printed material, used media and internet, tracked any and all inter basin transfers, and monitored Portland samplers in the reservoir.

**Harvest regulation history:** Sportfishes in Lavon Reservoir are currently managed with statewide regulations (Table 3).

**Stocking history:** Lavon Reservoir was last stocked in 2007 and 2008 with Striped Bass at 13/acre. The complete stocking history is in Table 4.



**Vegetation/habitat history:** Historically, Lavon Reservoir (Hysmith and Moczygemba 1980) supported diverse aquatic vegetation, and consisted of narrow leaved cattail, black willow, smartweed, water willow, knotgrass, duckweed, and water primrose native pondweed, buttonbush, and water willow. There was no aquatic vegetation to sample in 2014, however, in 2010 aquatic vegetation consisted of pondweed, buttonbush, and water willow (Hysmith and Moczygemba 2011).

**Water Transfer:** Lavon Reservoir is primarily used for municipal water supply, recreation, and to a lesser extent, flood control. Water is pumped into Lavon Reservoir from Cooper Reservoir, Tawakoni Reservoir, and the East Fork Raw Water Supply Project Seagoville, TX. Until 2009, water was pumped from Texoma Reservoir to Sister Grove Creek, a tributary of Lavon Reservoir. Water is pumped out of Lavon Reservoir by North Texas Municipal Water District.

## METHODS

Fishes were collected by electrofishing (2 hours at 24 5-min stations), gill netting (15 net nights at 15 stations), and trap netting (15 net nights at 15 stations). Catch per unit effort (CPUE) for electrofishing was recorded as the number of fish caught per hour (fish/h) of actual electrofishing and, for gill and trap nets, as the number of fish caught per net night (fish/nn). Survey sites were randomly selected and all surveys were conducted according to the Fishery Assessment Procedures (TPWD, Inland Fisheries Division, unpublished manual revised 2014).

A structural habitat survey was conducted in 2014. Vegetation surveys were conducted in 2002, 2006, 2010, and 2014. Aquatic vegetation was not present in 2006 and 2014. Habitat was assessed using a modified digital shapefile method (TPWD, Inland Fisheries Division, unpublished manual revised 2014).

Sampling statistics (CPUE for various length categories) and structural indices [Proportional Size Distribution (PSD)] as defined by Guy et al. (2007) and condition indices [relative weight (Wr)] were calculated for target fishes according to Anderson and Neumann (1996). Index of vulnerability (IOV) was calculated for Gizzard Shad (DiCenzo et al. 1996). Relative standard error (RSE =  $100 \times \text{SE of the estimate/estimate}$ ) was calculated for all CPUE statistics and SE was calculated for structural indices and IOV. Ages for Channel Catfish, Largemouth Bass, and White and Black Crappie were determined using Category 2 protocol according to the Fishery Assessment Procedures (TPWD, Inland Fisheries Division, unpublished manual revised 2014). The manual specifies Largemouth Bass, but we adapted the protocol to include Channel Catfish and White and Black Crappie. Source for water level data was the United States Geological Survey (USGS 2015).

Genetic analysis of Largemouth Bass was conducted according to the Fishery Assessment Procedures (TPWD, Inland Fisheries Division, unpublished manual revised 2014). Micro-satellite DNA analysis was used to determine genetic composition of individual fish from 2005 through 2012 and by electrophoresis for previous years.

## RESULTS AND DISCUSSION

**Habitat:** Littoral zone habitat consisted primarily of rocky shoreline and dead timber with some native aquatic vegetation (Tables 5 and 6).

**Prey species:** Electrofishing CPUE of Gizzard Shad and Bluegill were 405.5/h and 88.5/h, respectively (Figures 2 and 3). Catches of both species were lower than for 2010. While not as good as 2011, the current IOV of 95 indicated an abundance of prey-size Gizzard Shad. Over half the sample population of Bluegill was  $\leq 4$  inches, ideal prey-size. Longear Sunfish were almost as abundant as Bluegill (Appendix A) and because of their small average size, provided excellent prey. The electrofishing CPUE for Threadfin Shad (14.0/h) was a record low (Appendix A).

**Catfishes:** The gill net CPUE of Blue Catfish was 2.5/nn in 2015, well below estimates of relative abundance in 2007 (Figure 4). The multiyear relative abundance has averaged 10.7/nn since 1996 (Appendix C). Relative weight ranged from 80 to 115, increasing with size; a trend repeated from 2011 (Figure 4). The trophy component ( $\geq 30$  inches) of the population remained strong, repeating results of 2011 (Figure 4). All of the Blue Catfish sample population was  $\geq 12$  inches.

The gill net CPUE of Channel Catfish was 3.5/nn in 2015, second highest on record (Figure 5 and Appendix C). Recruitment of sub-stock fish was good and body condition was fair with relative weights ranging from 80 to almost 90. Channel Catfish grew to 12 inches in 5 years ( $N = 11$ ; range = 5 to 6 years). Sixty-three percent of the sample population was  $\geq 12$  inches.

**White Bass:** The gill net CPUE of White Bass was 6.0/nn in 2015 (Figure 6), second highest CPUE for this reservoir (Appendix C). Relative weight of White Bass ranged from 95 to 105. Eighty-eight percent of the sample population was  $\geq 10$  inches.

**Largemouth Bass:** The electrofishing CPUE of Largemouth Bass was 35.0/h in 2015 (Figure 7), well below the all-time high CPUE in 2010 (Figure 7, Appendix C). There was excellent recruitment of sub-stock fish. A high average relative weight of 90 indicated a majority of the Largemouth Bass were in good condition, especially sub-stock fish which showed average relative weight ranging between 100 and 120 (Figure 7). Growth was excellent with fish reaching legal size in 2 years ( $N = 13$ ; range 2 to 3 years). Fifty-four percent of the sample population was  $\geq 14$  inches. Genetic analysis of Largemouth Bass collected by electrofishing indicated Florida Largemouth Bass allele's at 39.0% which is a decrease from 42.0% in 2006 (Table 7).

**Crappies:** The trap net CPUE of White Crappie was 34.8/nn in 2015 (Figure 8), more than double the reservoir average (Appendix C). There was excellent recruitment of sub-stock fish. A high average relative weight of 100 % indicated a majority of the White Crappie were in good condition. Twenty-eight percent of the sample population was  $\geq 10$  inches and they reached legal size in 1 year ( $N = 13$ ; range = 1 to 2 years).

Trap netting CPUE of Black Crappie was 3.4/nn (Figure 9). They were first collected in 2006 when one specimen was caught in a trap net during standard sampling (Hysmith and Moczygemba 2007). Thirteen individuals were collected during routine trap net sampling in 2010. There was excellent recruitment of sub-stock fish. High relative weight ( $>90$ ) indicated a majority of the Black Crappie were in good condition. Thirty-seven percent of the sample population was  $\geq 10$  inches and they reached legal size in 2 years ( $N=13$ ; range = 2 to 3 years).

## Fisheries management plan for Lavon Reservoir, Texas

Prepared – July 2015.

**ISSUE 1:** The sport fishery in Lavon Reservoir, especially blue and Channel Catfish, and Largemouth Bass has continued to improve.

### MANAGEMENT STRATEGY

1. Incorporate these improvements on the TPWD web site.

**ISSUE 2:** Many invasive species threaten aquatic habitats and organisms in Texas and can adversely affect the state ecologically, environmentally, and economically. For example, zebra mussels (*Dreissena polymorpha*) can multiply rapidly and attach themselves to any available hard structure, restricting water flow in pipes, fouling swimming beaches and plugging engine cooling systems. Giant Salvinia (*Salvinia molesta*) and other invasive vegetation species can form dense mats, interfering with recreational activities like fishing, boating, skiing and swimming. The financial costs of controlling and/or eradicating these types of invasive species are significant. Additionally, the potential for invasive species to spread to other river drainages and reservoirs via watercraft and other means is a serious threat to all public waters of the state. Zebra mussels have been found in Sister Grove Creek, a tributary to Lavon Reservoir and water conduit for water transfer from Texoma Reservoir, where zebra mussels have established. Portland samplers have been deployed in Lavon Reservoir and Sister Grove Creek.

### MANAGEMENT STRATEGIES

1. Cooperate with the controlling authority to post appropriate signage at access points around the reservoir.
2. Contact and educate marina owners about invasive species, and provide them with posters, literature, etc... so that they can in turn educate their customers.
3. Educate the public about invasive species through the use of media and the internet.
4. Make a speaking point about invasive species when presenting to constituent and user groups.
5. Keep track of (i.e., map) existing and future inter-basin water transfers to facilitate potential invasive species responses.
6. Monitor Portland samplers deployed in Lavon Reservoir.

### SAMPLING SCHEDULE JUSTIFICATION:

Conduct general monitoring surveys in 2018 – 2019 with a creel survey, electrofishing, trap netting, and gill netting. Access and habitat surveys will also be conducted.

## LITERATURE CITED

- Anderson, R.O. and R.M. Neumann. 1996. Length, weight, and associated structural indices. Pages 447-482 *in* B.R. Murphy and D.W. Willis, editors. Fisheries techniques, 2nd edition. American Fisheries Society, Bethesda, Maryland.
- DiCenzo, V.J., M.J. Maceina, and M.R. Stimpert. 1996. Relations between reservoir trophic state and Gizzard Shad population characteristics in Alabama reservoirs. *North American Journal of Fisheries Management* 16:888-895.
- Guy, C.S., R.M. Neumann, D.W. Willis, and R.O. Anderson. 2007. Proportional Size Distribution (PSD): a further refinement of population size structure index terminology. *Fisheries* 32(7):348
- Hysmith, B.T. and J.H. Moczygemba. 1980. Existing reservoir and stream management recommendations. Lake Lavon, 1979. Texas Parks and Wildlife Department, Federal Aid Report F-30-R-3, Austin.
- Hysmith, B.T. and J.H. Moczygemba. 2011. Statewide freshwater fisheries monitoring and management program survey report for Lake Lavon, 2010. Texas Parks and Wildlife Department, Federal Aid Report F-221-M-1, Austin.
- Texas Commission on Environmental Quality. 2011. Trophic Classification of Texas Reservoirs Quality 2010 Texas Water Inventory and 303(d) List. 18 pp.
- United States Geological Society (USGS). 2015. National water information system: Web interface. Available: <http://waterdata.usgs.gov/tx/nwis> (May 2015).

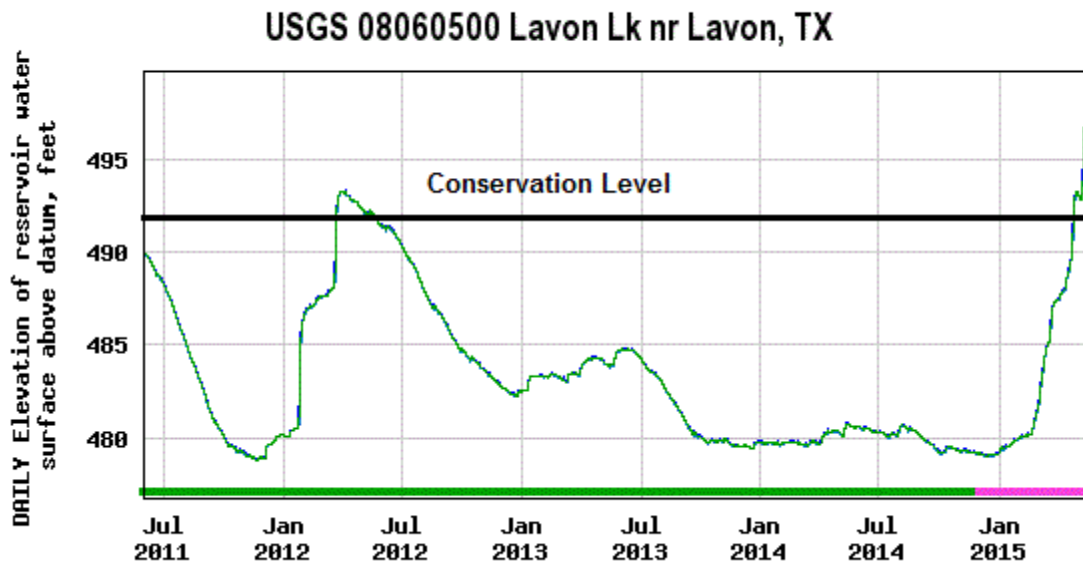


Figure 1. Monthly average water level elevations in feet above mean sea level (MSL) recorded for Lavon Reservoir (U.S. Geological Survey. 2015. USGS real time water data for USGS 08060500 Lavon Lake near Lavon, Texas. <http://waterdata.usgs.gov/nwis>), Texas, June 2011-May 2015.

Table 1. Characteristics of Lavon Reservoir, Texas.

Characteristic	Description
Year constructed	1953
Controlling authority	U.S. Army Corps of Engineers
Counties	Collin
Reservoir type	Mainstream
Shoreline development index	5.9
Conductivity	286 $\mu$ mhos/cm

Table 2. Boat ramp characteristics for Lavon Reservoir, Texas, August, 2014. Reservoir elevation at time of survey was 479.09 feet above mean sea level.

Boat ramp	Latitude Longitude (dd)	Public	Parking capacity (N)	Elevation at end of boat ramp (ft)	Condition
Twin Groves	33.16593 -96.44157	Y	40	490 <sub>a</sub>	Out of water. Extension is not feasible
Caddo Park	33.16247 -96.41896	Y	30	490 <sub>a</sub>	Out of water. Extension is not feasible
Elm Creek	33.14009 -96.42500	Y	30	485 <sub>a</sub>	Out of water. Extension is not feasible
Lakeland Park	33.10315 -96.44589	Y	60	478 <sub>a</sub>	Out of water. Extension is not feasible
Tickey Creek	33.09562 -96.47443	Y	60	478 <sub>a</sub>	Out of water. Extension is not feasible
Pebble Beach	33.08451 -96.45275	Y	45	481 <sub>a</sub>	Out of water. Extension is not feasible
Little Ridge	33.06624 -96.45500	Y	60	478	Fair. Extension is feasible.
Mallard Park	33.04860 -96.42698	Y	30	478	Fair. Extension is feasible.
Lavonia Park	33.04178 -96.44335	Y	60	478	Fair. Extension is feasible.
Clear Lake	33.05900 -96.48810	Y	45	478	Fair. Extension is feasible.
Bratonia Park	33.11063 -96.52019	Y	20	490 <sub>a</sub>	Out of water. Extension is not feasible
Highland Park	33.10782 -96.54063	Y	30	490 <sub>a</sub>	Out of water. Extension is not feasible
Brockdale Park	33.07344 -96.54531	Y	30	484 <sub>a</sub>	Out of water. Extension is not feasible
Collin Park	33.05104 -96.53057	Y	85	478	Fair. Extension is feasible.
East Fork Park	33.03705 -96.51466	Y	105	478	Fair. Extension is feasible.
Avalon Park	33.04276 -96.49807	Y	60	474	Excellent. No access issues.

<sub>a</sub> Elevations were determined using GPS and may be approximate due to GPS error. Varying lake levels and large amounts of siltation on ramps have prevented more accurate onsite measurements from being taken since original survey date.

Table 3. Harvest regulations for Lavon Reservoir, Texas.

Species	Bag limit	Length limit
Catfish: Channel and Blue Catfish, their hybrids and subspecies	25 (in any combination)	12-inch minimum
Catfish, Flathead	5	18-inch minimum
Bass, White	25	10-inch minimum
Bass, Striped	5	18-inch minimum
Bass, Largemouth	5	14-inch minimum
Crappie: White and Black Crappie, their hybrids and subspecies	25 (in any combination)	10-inch minimum

Table 4. Stocking history of Lavon Reservoir, Texas. Life stages are fry (FRY), fingerlings (FGL), advanced fingerlings (AFGL), adults (ADL) and unknown (UNK). Life stages for each species are defined as having a mean length that falls within the given length range. For each year and life stage the species mean total length (Mean TL; in) is given. For years where there were multiple stocking events for a particular species and life stage the mean TL is an average for all stocking events combined.

Species	Year	Number	Life Stage	Mean TL (in)
Blue catfish	1989	214,259	FGL	2.6
	1997	214,106	FGL	2.0
	1998	214,588	FGL	2.2
	Total	642,953		
Channel catfish	1954	20,000	AFGL	7.9
	1971	26,700	AFGL	7.9
	Total	46,700		
Florida Largemouth bass	1988	67,226	FGL	2.0
	1988	361,652	FRY	1.0
	1997	250,800	FGL	1.2
	2004	539,664	FGL	1.5
	2005	535,577	FGL	1.5
	Total	1,754,919		
Largemouth bass	1954	1,027,000	FRY	0.7
	1968	177,100	UNK	UNK
	Total	1,204,100		
Mixed Largemouth Bass	1988	98,860		1.0
	Total	98,860		
Palmetto Bass (Striped X White Bass hybrid)	1976	39,200	FGL	UNK
	Total	39,200		
Striped bass	1989	213,826	FGL	1.4
	1994	428,402	FGL	1.3
	2004	19,241	FGL	1.9
	2005	107,008	FGL	1.6
	2006	216,086	FGL	1.8
	2007	339,114	FGL	1.5
	2008	216,090	FGL	1.6
	Total	1,539,767		
Threadfin shad	1980	8,250	AFGL	2.9
	1984	2,000	AFGL	3.0
	Total	10,250		



Table 4 continued.

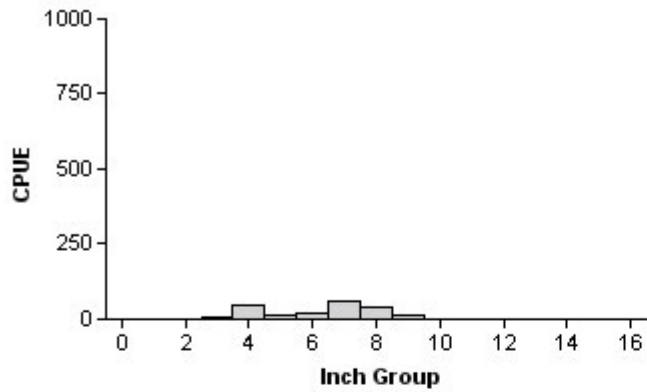
Species	Year	Number	Life Stage	Mean TL (in)
Walleye	1976	86,000	FRY	0.2
	Total	86,000		
White bass	1957	330	ADL	UNK
	Total	330		

Table 5. Survey of structural habitat types, Lavon Reservoir, Texas, 2014. Shoreline habitat type units are in miles and standing timber and piers, boat docks, and marinas in acres.

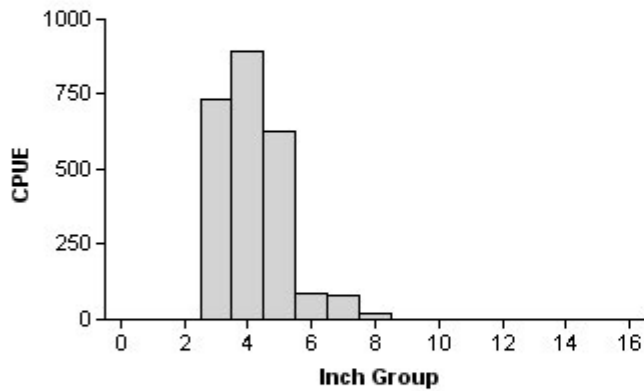
Habitat type	Estimate	% of total
Bulkhead	0.1 miles	0.1
Piers, boat docks, marinas	100 acres	0.5
Natural	41.2 miles	34.0
Rocky	79.7 miles	65.9
Standing timber	10,700 acres	50.0

Table 6. Survey of aquatic vegetation, Lavon Reservoir, Texas, 2002 – 2014. Surface area (acres) is listed with percent of total reservoir surface area in parentheses.


Vegetation	2002	2006	2010	2014
Native submersed		0.0	10 (<0.1)	0.0
Native emergent	44 (0.2)	0.0	44 (0.2)	0.0

**Gizzard Shad****2006**

Effort = 2.0  
 Total CPUE = 208.0 (17; 416)  
 IOV = 74 (5)

**2010**

Effort = 2.0  
 Total CPUE = 2,450.0 (100; 4900)  
 IOV = 99 (0.4)

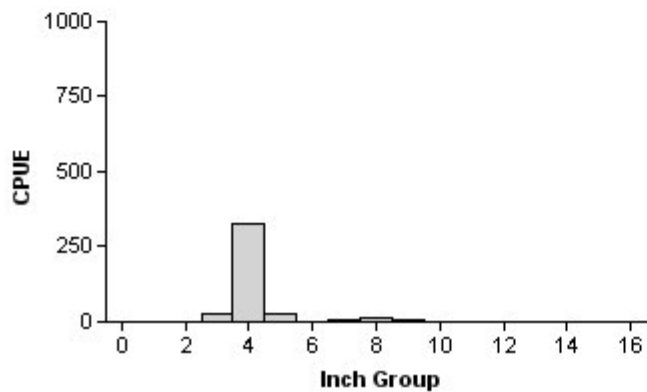**2014**

Effort = 2.0  
 Total CPUE = 405.5 (14; 811)  
 IOV = 95 (1.3)

Figure 2. Number of Gizzard Shad caught per hour (CPUE) and population indices (RSE and N for CPUE and SE for IOV are in parentheses) for fall electrofishing surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014.

## Bluegill



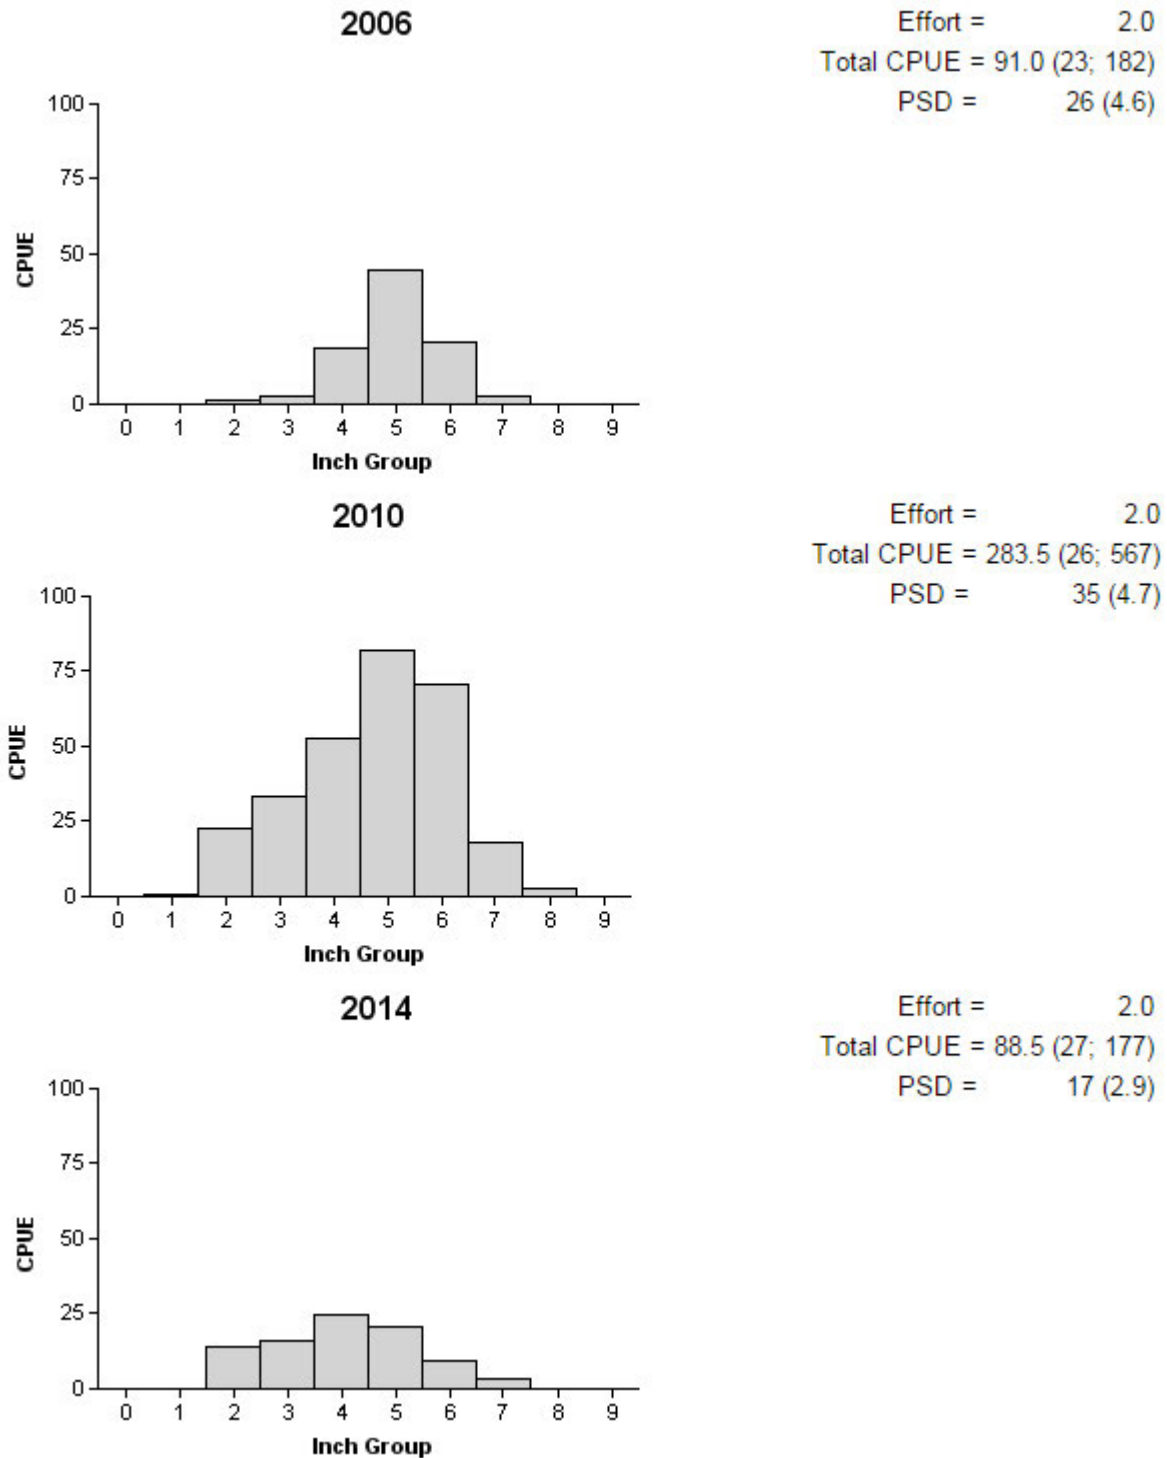


Figure 3. Number of Bluegill caught per hour (CPUE) and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for fall electrofishing surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014.


# Blue Catfish

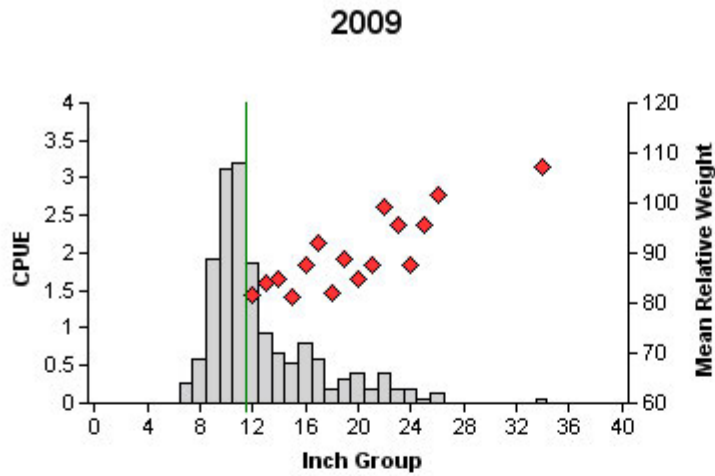

Effort = 15.0  
 Total CPUE = 16.7 (27; 251)  
 Stock CPUE = 7.6 (22; 114)  
 PSD = 22 (3.8)

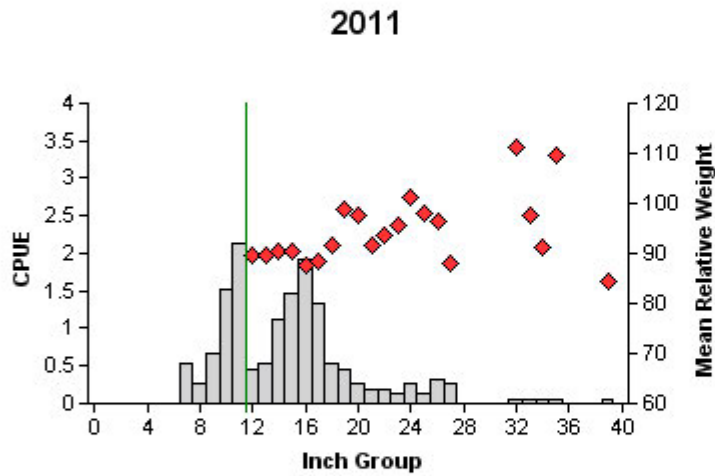

Effort = 15.0  
 Total CPUE = 15.1 (13; 227)  
 Stock CPUE = 10.0 (13; 150)  
 PSD = 21 (3.5)

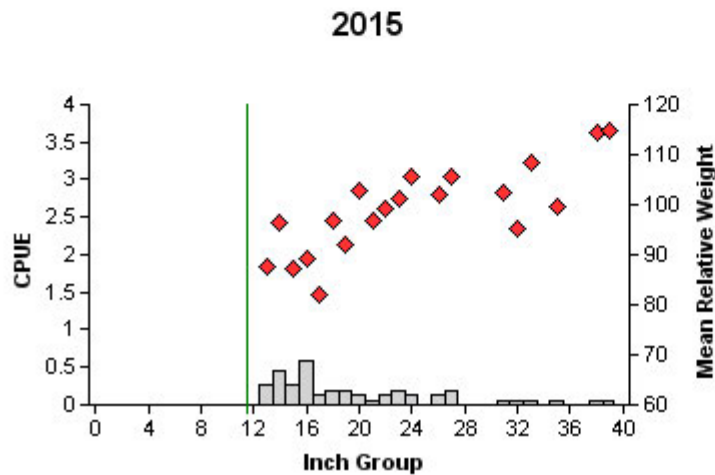

Effort = 15.0  
 Total CPUE = 3.5 (21; 53)  
 Stock CPUE = 3.5 (21; 53)  
 PSD = 40 (5.8)

Figure 4. Number of Blue Catfish caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for spring gill net surveys, Lavon Reservoir, Texas, 2009, 2011, and 2015. Vertical lines represent length limit at time of collection.

## Channel Catfish

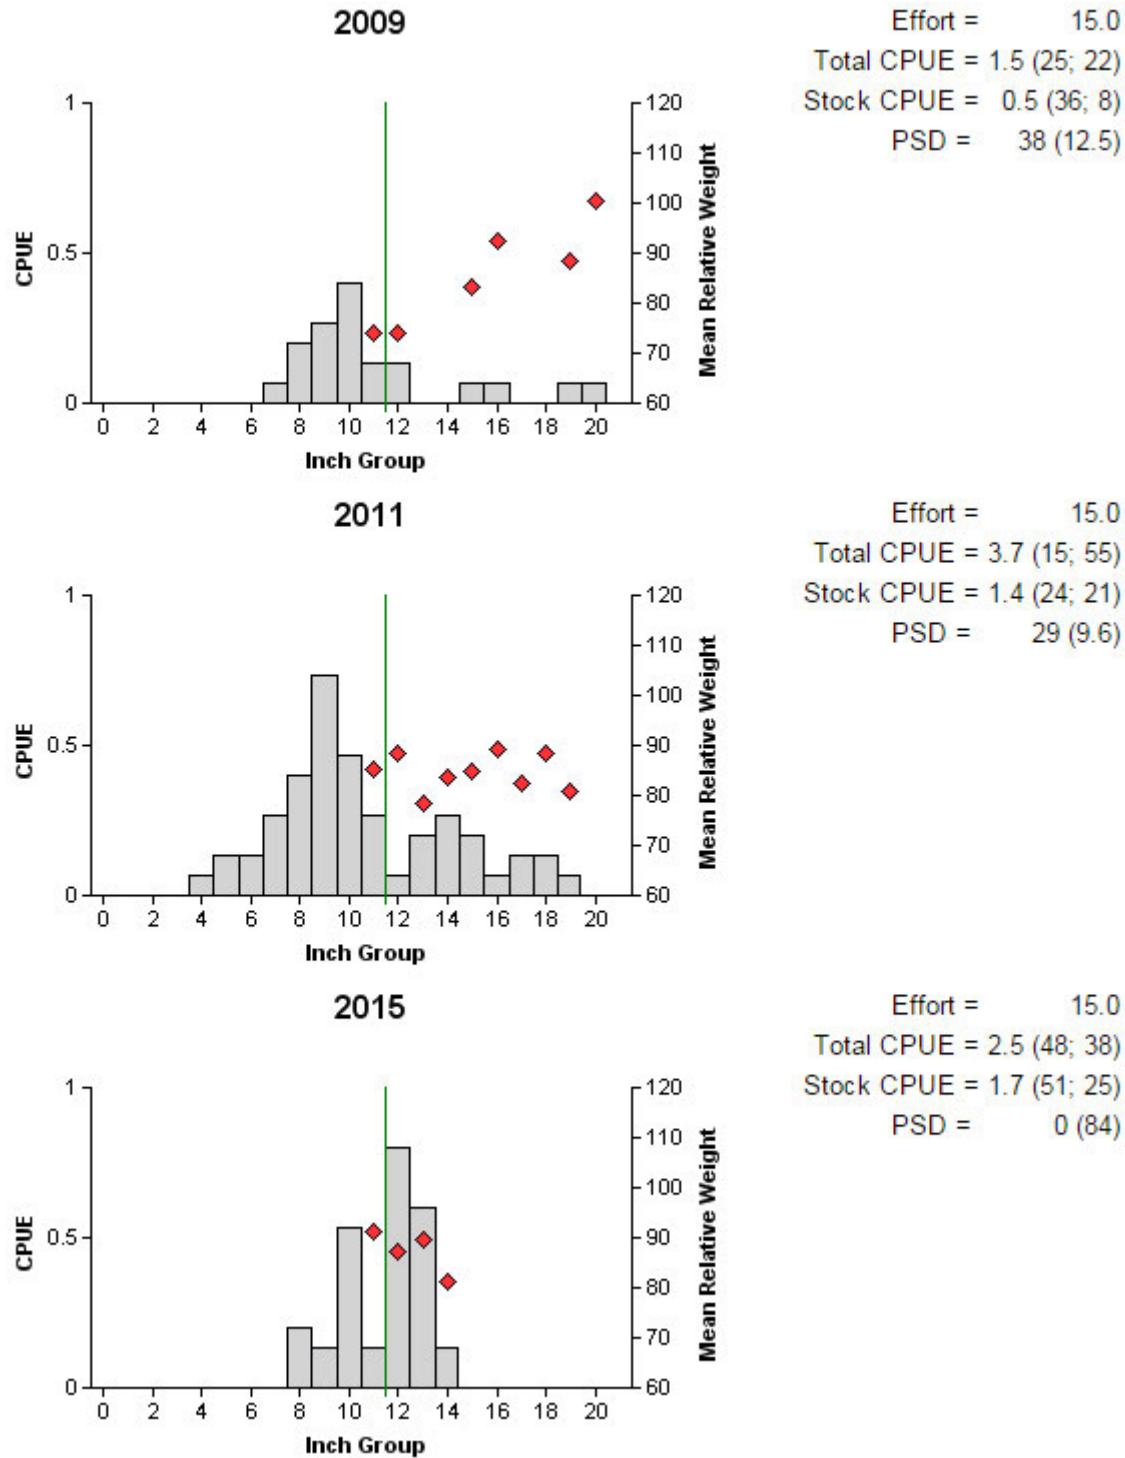


Figure 5. Number of Channel Catfish caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for spring gill net surveys, Lavon Reservoir, Texas, 2009, 2011, and 2015. Vertical lines represent length limit at time of collection.



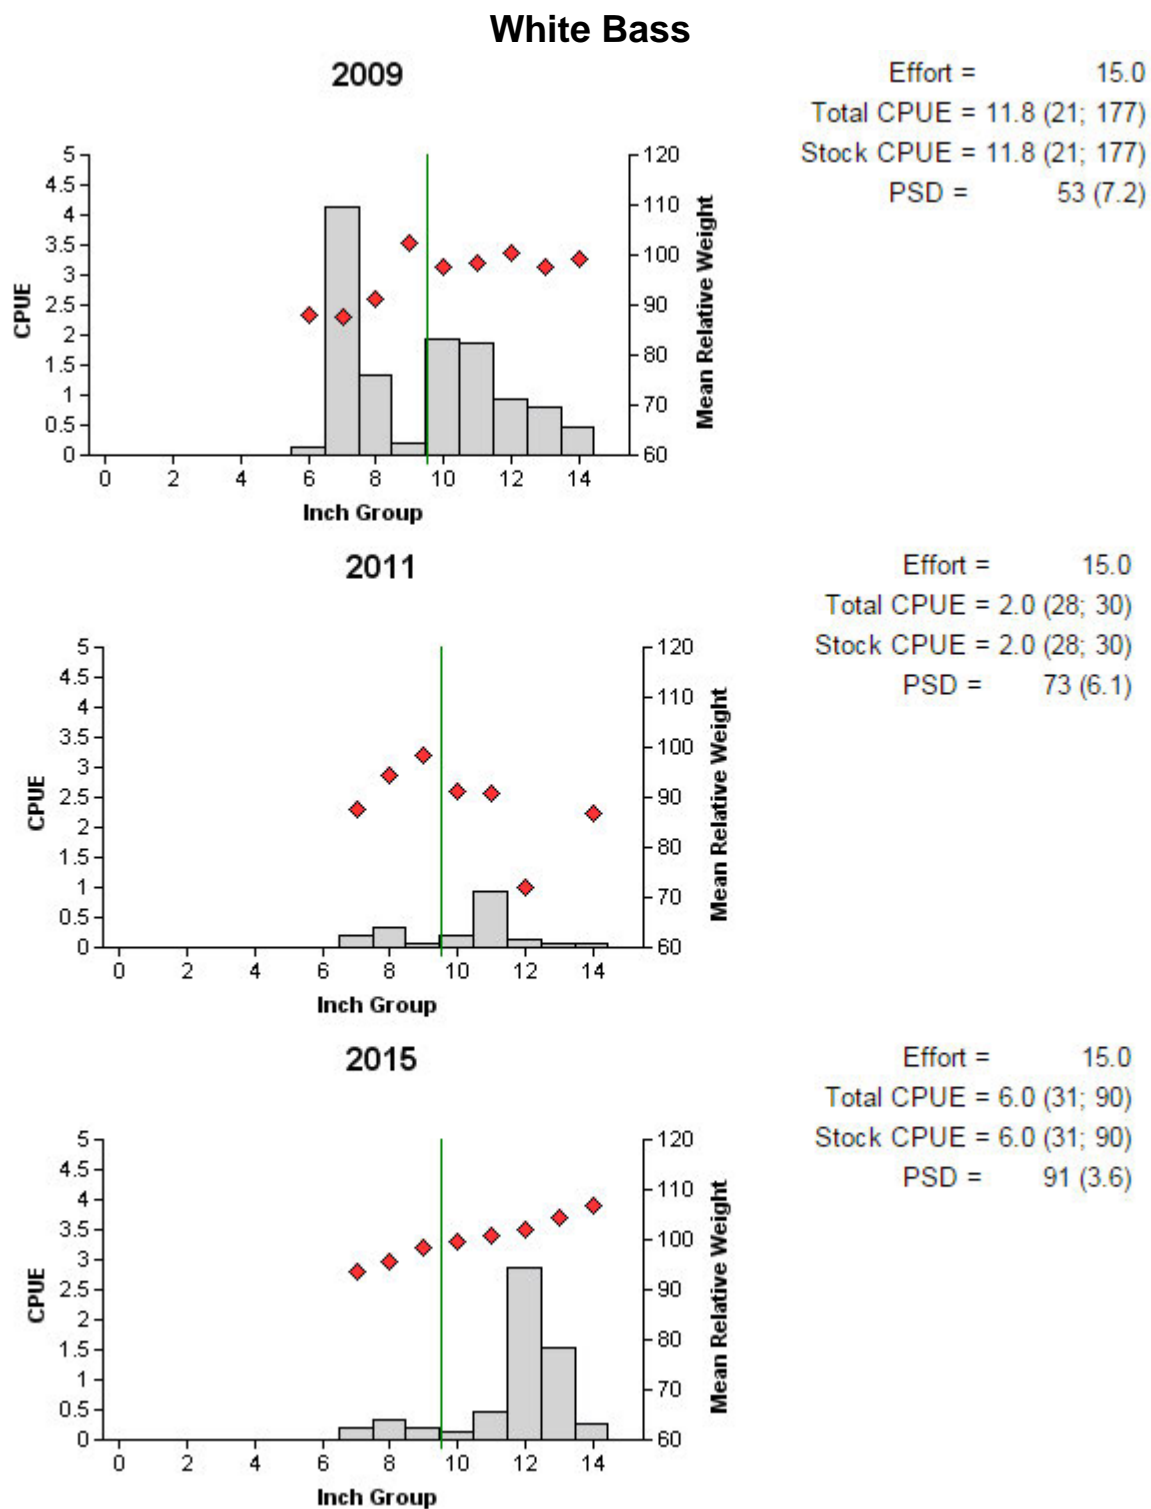


Figure 6. Number of White Bass caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for spring gill net surveys, Lavon Reservoir, Texas, 2009, 2011, and 2015. Vertical lines represent length limit at time of collection.


## Largemouth Bass

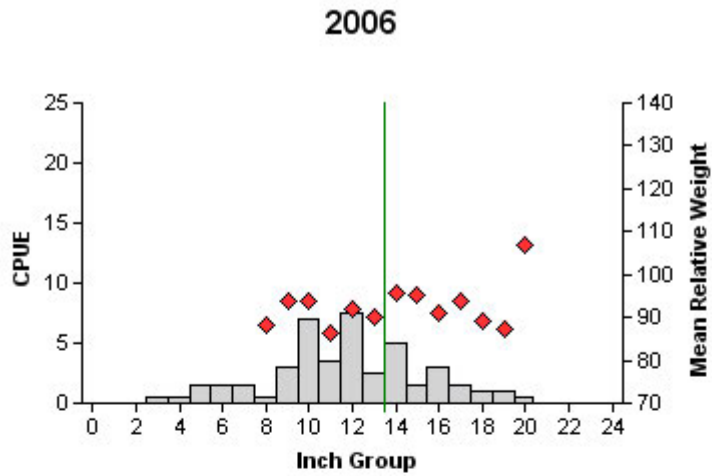

Effort = 2.0  
 Total CPUE = 43.0 (23; 86)  
 Stock CPUE = 37.5 (22; 75)  
 PSD = 63 (7.4)

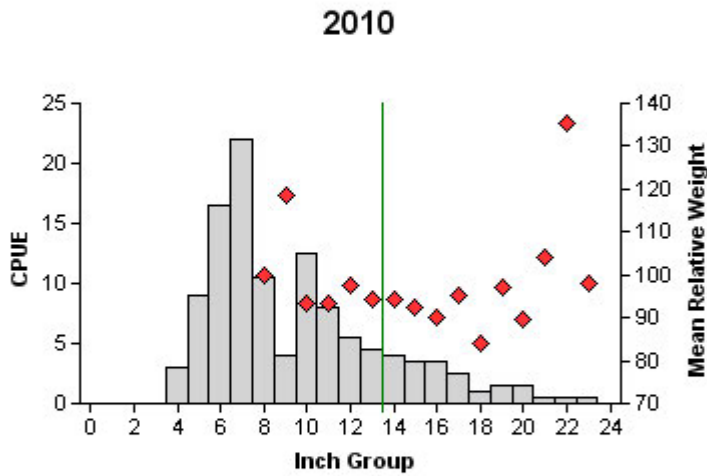

Effort = 2.0  
 Total CPUE = 114.5 (17; 229)  
 Stock CPUE = 64.0 (17; 128)  
 PSD = 45 (5.7)

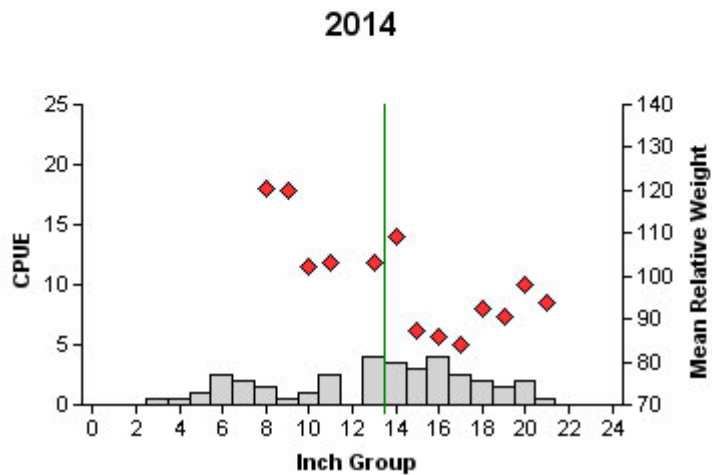

Effort = 2.0  
 Total CPUE = 35.0 (19; 70)  
 Stock CPUE = 28.5 (18; 57)  
 PSD = 81 (6.4)

Figure 7. Number of Largemouth Bass caught per hour (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure) for fall electrofishing surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014. Vertical lines represent length limit at time of collection.



Table 7. Results of genetic analysis of Largemouth Bass collected by fall electrofishing, Lavon Reservoir, Texas, 1990, 1996, 1999, 2002, 2006, and 2014. FLMB = Florida Largemouth Bass, NLMB = Northern Largemouth Bass, Intergrade = hybrid between a FLMB and a NLMB. Genetic composition was determined by electrophoresis prior to 2005 and with micro-satellite DNA analysis since 2005.

Year	Sample size	Number of fish			% FLMB alleles	% FLMB
		FLMB	Intergrade	NLMB		
1990	36	1	6	29	6.9	2.8
1996	40	1	37	2	52.6	2.5
1999	33	1	17	15	23.5	3.0
2002	24	0	7	17	10.4	0.0
2006	30	1	24	5	42.0	3.3
2014	30	2	23	5	39.0	6.7

## White Crappie

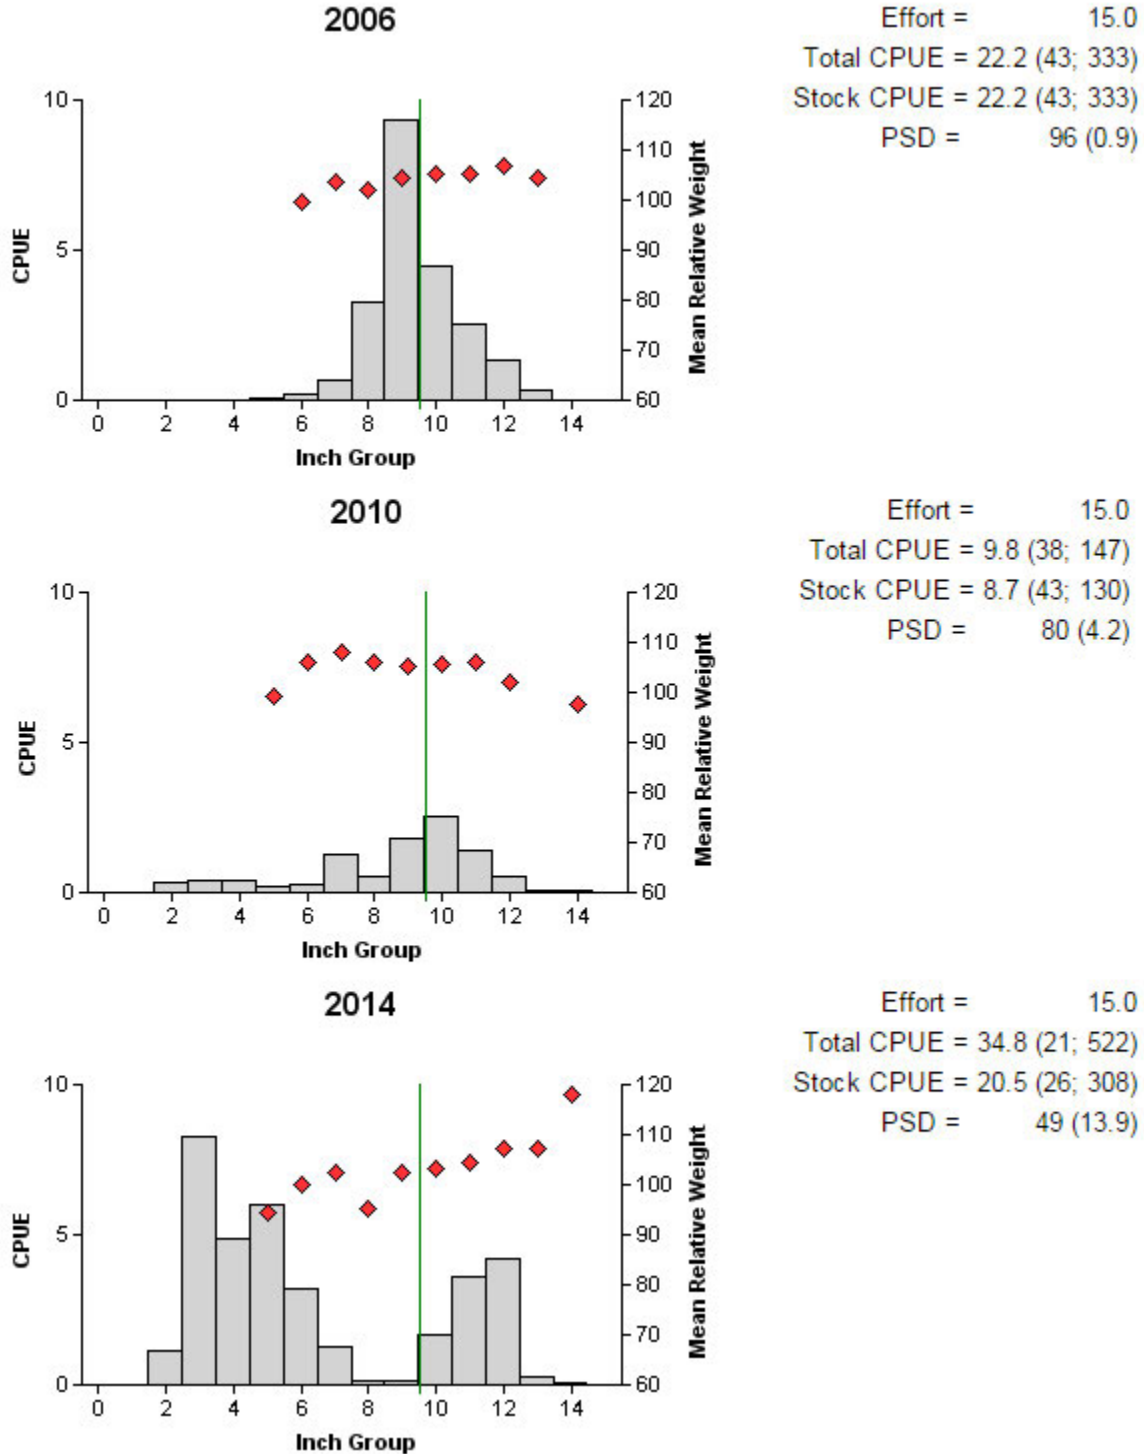


Figure 8. Number of White Crappie caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for fall trap netting surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014. Vertical lines represent length limit at time of collection.

## Black Crappie

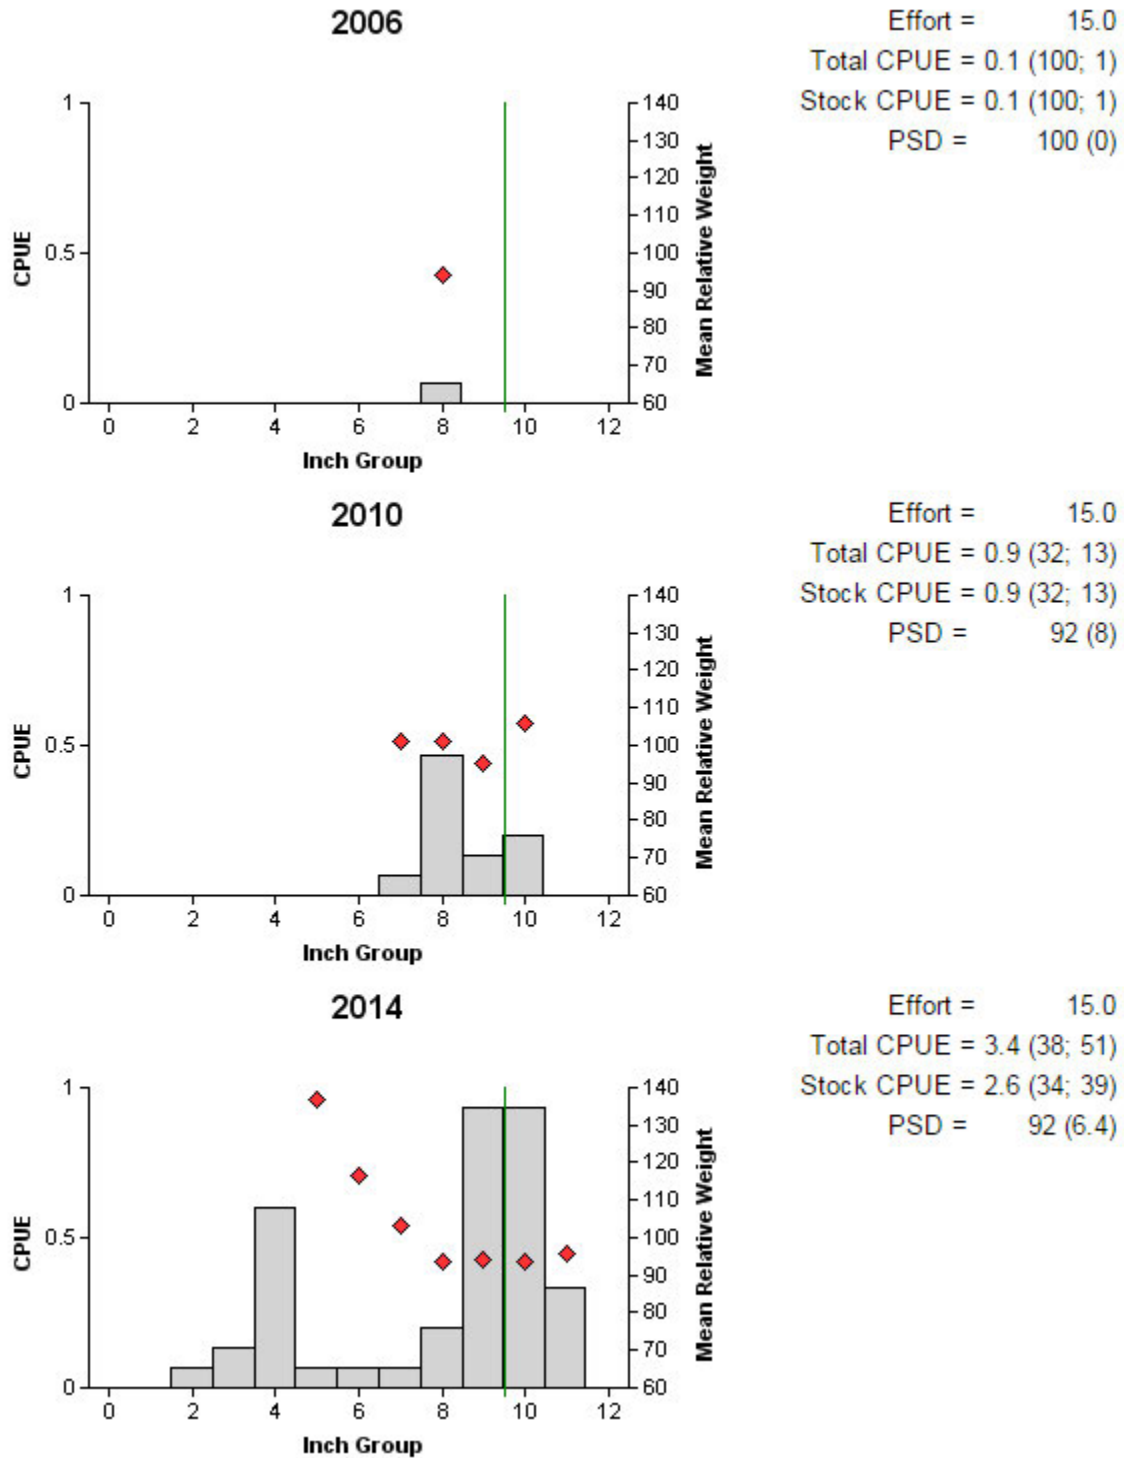


Figure 9. Number of Black Crappie caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for fall trap netting surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014. Vertical lines represent length limit at time of collection.

Table 8. Proposed sampling schedule for Lavon Reservoir, Texas. Survey period is June through May. Gill netting surveys are conducted in the spring, while electrofishing and trap netting surveys are conducted in the fall. Standard survey denoted by S.

Survey year	Electrofish Fall(Spring)	Trap net	Gill net	Habitat		Access	Creel survey	Report
				Structural	Vegetation			
2015-2016								
2016-2017								
2017-2018								
2018-2019	S	S	S		S	S	S	S

**APPENDIX A**

Number (N) and catch rate (CPUE) of all target species collected from all gear types from Lavon Reservoir, Texas, 2014-2015. Sampling effort was 15 net nights for gill netting, 15 net nights for trap netting, and 2 hours for electrofishing.

Species	Gill Netting		Trap Netting		Electrofishing	
	N	CPUE	N	CPUE	N	CPUE
Gizzard Shad					811	405.5
Threadfin Shad					28	14.0
Blue Catfish	53	3.5				
Channel Catfish	38	2.5				
White Bass	90	6.0				
Green Sunfish					8	4.0
Warmouth					9	4.5
Orangespotted Sunfish					32	16.0
Bluegill					177	88.5
Longear Sunfish					171	85.5
Largemouth Bass					70	35.0
White Crappie			522	34.8		
Black Crappie			51	3.4		

## APPENDIX B

### APPENDIX C

Historical catch rates of targeted species by gear type for Lavon Reservoir, Texas, 1996, 1999, 2002, 2006, 2009, 2010, and 2014.

Gear	Species	Year							Avg.
		1996 <sup>a</sup>	1999	2002 <sup>b</sup>	2006 <sup>b</sup>	2009	2010 <sup>b</sup>	2014 <sup>b</sup>	
Gill Netting (fish/net night)	Blue catfish	1.1	8.3	14.8	16.7	15.5	15.1	3.5	<b>10.7</b>
	Channel catfish	1.9	2.5	0.9	1.5	1.3	3.7	2.5	<b>2.0</b>
	Flathead catfish	0.0	0.0	0.0	0.1	0.0	0.1		<b>0.0</b>
	White bass	3.8	3.8	2.5	0.1	11.8	2.0	6.0	<b>4.3</b>
	Striped bass	1.3	1.5	0.1	0.1	0.1	0.2		<b>0.5</b>
Electrofishing (fish/hour)	Gizzard shad	202.5	215.5	209.5	208.0		2450.0	405.5	<b>527.3</b>
	Threadfin shad	120.5	330.0	58.5	832.0		170.5	14.0	<b>217.9</b>
	Green sunfish	1.5	4.0	0.0	0.0		6.5	4.0	<b>2.3</b>
	Warmouth	0.5	3.0	2.5	8.0		14.5	4.5	<b>4.7</b>
	Orangespotted sunfish	0.0	0.0	2.5	0.0		1.0	16.0	<b>2.3</b>
	Bluegill	33.0	40.5	79.0	91.0		283.5	88.5	<b>87.9</b>
	Longear sunfish	4.0	88.0	66.5	65.5		244.5	85.5	<b>79.1</b>
	Redear sunfish	0.0	0.0	0.0	1.0		3.0	0.0	<b>0.6</b>
	Largemouth bass	9.0	66.0	18.5	43.0		114.5	35.0	<b>40.9</b>
Trap Netting (fish/net night)	White Crappie	3.5	17.8	17.5	22.2		9.8	34.8	<b>15.1</b>
	Black Crappie	0.0	0.0	0.0	0.1		0.9	3.4	<b>0.6</b>

<sup>a</sup> Trap netting was conducted in January 1997.

<sup>b</sup> Gill netting was conducted in the spring of the following year.

## **ATTACHMENT TR-10**

### Existing Entrainment Performance Studies



No studies have been conducted at the Ray Olinger Power Plant or Lake Lavon documenting technology efficacy or through-facility entrainment survival. A literature review was conducted, and no studies were found that are comparable to the Ray Olinger Power Plant or Lake Lavon.

# MEMORANDUM



Innovative approaches  
Practical results  
Outstanding service

801 Cherry Street, Suite 2800 + Fort Worth, Texas 76102 + 817-735-7300 + FAX 817-735-7491

[www.freese.com](http://www.freese.com)

**TO:** Applications Review and Processing Team (MC 148)  
**FROM:** Cassie Villarreal, FNI  
**SUBJECT:** Garland Power and Light TPDES Application WQ0001923000  
**DATE:** 8/9/2024  
**PROJECT:** GPL24350

---

The TCEQ Applications Review and Processing Team contacted the permittee about an application submitted via STEERS on August 8, 2024. Although the application in STEERS is listed as a “new permit,” it is a renewal/major amendment for an existing facility (WQ0001923000). TCEQ staff discussed that they would work on making this change internally but suggested we submit a PDF copy to the TCEQ FTP Server with a memo of what was discussed. If needed, we can follow up with hard copies of the application.

Please let me know if you have any questions regarding the application.

Thank you,

Sincerely,

A handwritten signature in blue ink, appearing to read 'C Villarreal'.

Cassandra Villarreal, M.S.  
Freese and Nichols, Inc.  
[cassandra.villarreal@freese.com](mailto:cassandra.villarreal@freese.com)  
817-735-7294

Jon Niermann, *Chairman*  
Bobby Janecka, *Commissioner*  
Catarina R. Gonzales, *Commissioner*  
Kelly Keel, *Executive Director*



## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

*Protecting Texas by Reducing and Preventing Pollution*

August 8, 2024

Dear Applicant:

Re: Confirmation of Submission of the New Industrial Wastewater Individual Permit Application

This is an acknowledgement that you have successfully completed Industrial Wastewater Individual Permit Application.

ER Account Number: ER083325

Application Reference Number: 660831

Authorization Number: WQ0005464000

Site Name: Garland Municipal Power - Ray Olinger Plant

Regulated Entity: RN100219203 - GARLAND MUNICIPAL POWER - RAY OLINGER PLANT

Customer(s): CN600328694 - City of Garland

Please be aware that TCEQ staff may contact your designated contact for any additional information.

If you have any questions, you may contact the Applications Review and Processing Team by email at [WQ-ARPTeam@tceq.texas.gov](mailto:WQ-ARPTeam@tceq.texas.gov) or by telephone at (512) 239-4671.

Sincerely,  
Applications Review and Processing Team  
Water Quality Division



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

# INDUSTRIAL WASTEWATER PERMIT APPLICATION CHECKLIST

**Complete and submit this checklist with the industrial wastewater permit application.**

APPLICANT NAME: City of Garland

PERMIT NUMBER (If new, leave blank): WQ00 0001923000

**Indicate if each of the following items is included in your application.**

	Y	N		Y	N
Administrative Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 8.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Administrative Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Worksheet 9.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>
SPIF	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 10.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Core Data Form	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Public Involvement Plan Form	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.1	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Plain Language Summary	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.2	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Technical Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Worksheet 11.3	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original USGS Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 2.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Affected Landowners Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 3.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Landowner Disk or Labels	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 3.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Flow Diagram	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 3.2	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Site Drawing	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.3	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Original Photographs	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 4.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Design Calculations	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 4.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Solids Management Plan	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 5.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Water Balance	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Worksheet 6.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 7.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			

For TCEQ Use Only

Segment Number \_\_\_\_\_ County \_\_\_\_\_  
Expiration Date \_\_\_\_\_ Region \_\_\_\_\_  
Permit Number \_\_\_\_\_



# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## INDUSTRIAL WASTEWATER PERMIT APPLICATION

### ADMINISTRATIVE REPORT 1.0

This report is required for all applications for TPDES permits and TLAPs, except applications for oil and gas extraction operations subject to 40 CFR Part 435. Contact the Applications Review and Processing Team at 512-239-4671 with any questions about completing this report.

Applications for oil and gas extraction operations subject to 40 CFR Part 435 must use the Oil and Gas Exploration and Production Administrative Report ([TCEQ Form-20893 and 20893-inst<sup>1</sup>](#)).

#### Item 1. Application Information and Fees (Instructions, Page 26)

- a. Complete each field with the requested information, if applicable.

Applicant Name: City of Garland

Permit No.: WQ0001923000

EPA ID No.: TX0001848

Expiration Date: February 5, 2025

- b. Check the box next to the appropriate authorization type.

☒ Industrial Wastewater (wastewater and stormwater)

☐ Industrial Stormwater (stormwater only)

- c. Check the box next to the appropriate facility status.

☒ Active

☐ Inactive

- d. Check the box next to the appropriate permit type.

☒ TPDES Permit

☐ TLAP

☐ TPDES with TLAP component

- e. Check the box next to the appropriate application type.

☐ New

☐ Renewal with changes

☐ Renewal without changes

☒ Major amendment with renewal

☐ Major amendment without renewal

☐ Minor amendment without renewal

☐ Minor modification without renewal

- f. If applying for an amendment or modification, describe the request: N/A

For TCEQ Use Only

Segment Number \_\_\_\_\_ County \_\_\_\_\_

Expiration Date \_\_\_\_\_ Region \_\_\_\_\_

Permit Number \_\_\_\_\_

<sup>1</sup> [https://www.tceq.texas.gov/publications/search\\_forms.html](https://www.tceq.texas.gov/publications/search_forms.html)

g. Application Fee

EPA Classification	New	Major Amend. (with or without renewal)	Renewal (with or without changes)	Minor Amend. / Minor Mod. (without renewal)
Minor facility not subject to EPA categorical effluent guidelines (40 CFR Parts 400-471)	<input type="checkbox"/> \$350	<input type="checkbox"/> \$350	<input type="checkbox"/> \$315	<input type="checkbox"/> \$150
Minor facility subject to EPA categorical effluent guidelines (40 CFR Parts 400-471)	<input type="checkbox"/> \$1,250	<input checked="" type="checkbox"/> \$1,250	<input type="checkbox"/> \$1,215	<input type="checkbox"/> \$150
Major facility	N/A <sup>2</sup>	<input type="checkbox"/> \$2,050	<input type="checkbox"/> \$2,015	<input type="checkbox"/> \$450

h. Payment Information

***Mailed***

Check or money order No.: [Click to enter text.](#)

Check or money order amt.: [Click to enter text.](#)

Named printed on check or money order: [Click to enter text.](#)

***Epay***

Voucher number: [Click to enter text.](#)

Copy of voucher attachment: [Click to enter text.](#)

## Item 2. Applicant Information (Instructions, Pages 26)

a. Customer Number, if applicant is an existing customer: CN600328694

**Note:** Locate the customer number using the [TCEQ's Central Registry Customer Search](#)<sup>3</sup>.

b. Legal name of the entity (applicant) applying for this permit: City of Garland

**Note:** The owner of the facility must apply for the permit. The legal name must be spelled exactly as filed with the TX SOS, Texas Comptroller of Public Accounts, County, or in the legal documents forming the entity.

c. Name and title of the person signing the application. (**Note:** The person must be an executive official that meets signatory requirements in 30 TAC § 305.44.)

Prefix: Mr. Full Name (Last/First Name): Cline, Darrell

Title: General Manager & CEO Credential: N/A

d. Will the applicant have overall financial responsibility for the facility?

<sup>2</sup> All facilities are designated as minors until formally classified as a major by EPA.

<sup>3</sup> <https://www15.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch>

☒ Yes ☐ No

Note: The entity with overall financial responsibility for the facility must apply as a co-applicant, if not the facility owner.

### Item 3. Co-applicant Information (Instructions, Page 27)

☒ Check this box if there is no co-applicant.; otherwise, complete the below questions.

a. Legal name of the entity (co-applicant) applying for this permit: N/A

**Note:** The legal name must be spelled exactly as filed with the TX SOS, Texas Comptroller of Public Accounts, County, or in the legal documents forming the entity.

b. Customer Number (if applicant is an existing customer): CNN/A

**Note:** Locate the customer number using the TCEQ's Central Registry Customer Search.

c. Name and title of the person signing the application. (**Note:** The person must be an executive official that meets signatory requirements in 30 TAC § 305.44.)

Prefix: N/A Full Name (Last/First Name): N/A

Title: N/A Credential: N/A

d. Will the co-applicant have overall financial responsibility for the facility?

☐ Yes ☐ No

Note: The entity with overall financial responsibility for the facility must apply as a co-applicant, if not the facility owner.

### Item 4. Core Data Form (Instructions, Pages 27)

a. Complete one Core Data Form (TCEQ Form 10400) for each customer (applicant and co-applicant(s)) and include as an attachment. If the customer type selected on the Core Data Form is Individual, complete Attachment 1 of the Administrative Report. Attachment: AR-1

### Item 5. Application Contact Information (Instructions, Page 27)

Provide names of two individuals who can be contact for additional information about this application. Indicate if the individual can be contact about administrative or technical information, or both.

a. ☒ Administrative Contact ☒ Technical Contact

Prefix: Mr. Full Name (Last/First Name): Burr, Michael

Title: Environmental Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 County Road 489 City/State/Zip: Nevada, Texas, 75173

Phone No: 972-485-6453 Email: mburr@gpltexas.org

b. ☒ Administrative Contact ☒ Technical Contact

Prefix: Mrs. Full Name (Last/First Name): Leatherwood, Katie

Title: Environmental Scientist Credential: P.G.

Organization Name: Freese and Nichols, Inc

Mailing Address: 801 Cherry Street, Suite 2800 City/State/Zip: Fort Worth, TX 76102

Phone No: 817-735-7503 Email: katie.leatherwood@freese.com

Attachment: N/A

## **Item 6. Permit Contact Information (Instructions, Page 28)**

Provide two names of individuals that can be contacted throughout the permit term.

a. Prefix: Mr. Full Name (Last/First Name): Bernard, David

Title: Production Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

Phone No: 972-205-3831 Email: dbernard@gpltexas.org

b. Prefix: Mr. Full Name (Last/First Name): Burr, Michael

Title: Environmental Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

Phone No: 972-485-6458 Email: mburr@gpltexas.org

Attachment: N/A

## **Item 7. Billing Contact Information (Instructions, Page 28)**

The permittee is responsible for paying the annual fee. The annual fee will be assessed for permits **in effect on September 1 of each year**. The TCEQ will send a bill to the address provided in this section. The permittee is responsible for terminating the permit when it is no longer needed (form TCEQ-20029).

Provide the complete mailing address where the annual fee invoice should be mailed and the name and phone number of the permittee's representative responsible for payment of the invoice.

Prefix: Mr. Full Name (Last/First Name): Bernard, David

Title: Production Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173

Phone No: 972-205-3831 Email: dbernard@gpltexas.org

## **Item 8. DMR/MER Contact Information (Instructions, Page 28)**

Provide the name and mailing address of the person delegated to receive and submit DMRs or MERs. **Note:** DMR data must be submitted through the NetDMR system. An electronic reporting account can be established once the facility has obtained the permit number.

Prefix: Mr. Full Name (Last/First Name): Bernard, David

Title: Production Manager Credential: N/A

Organization Name: Garland Power & Light

Mailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173



**Item 9. Notice Information (Instructions, Pages 28)****a. Individual Publishing the Notices**Prefix: Mr. Full Name (Last/First Name): Bernard, DavidTitle: Production Manager Credential: N/AOrganization Name: Garland Power & LightMailing Address: 13835 Country Road 489 City/State/Zip: Nevada, TX 75173Phone No: 972-205-3831 Email: dbernard@gpltexas.org**b. Method for Receiving Notice of Receipt and Intent to Obtain a Water Quality Permit Package (only for NORI, NAPD will be sent via regular mail)**☒ E-mail: mburr@gpltexas.org; dbernard@gpltexas.org; katie.leatherwood@freese.com;☐ Fax: Click to enter text.☐ Regular Mail (USPS)Mailing Address: Click to enter text.City/State/Zip Code: Click to enter text.**c. Contact in the Notice**Prefix: Mr. Full Name (Last/First Name): Bernard, DavidTitle: Production Manager Credential: N/AOrganization Name: Garland Power & LightPhone No: 972-205-3831 Email: dbernard@gpltexas.org**d. Public Viewing Location Information****Note:** If the facility or outfall is located in more than one county, provide a public viewing place for each county.Public building name: Wylie Municipal Complex Location within the building: Office of City SecretaryPhysical Address of Building: 300 Country Club Road, Building 100City: Wylie County: Collin**e. Bilingual Notice Requirements**

This information is required for new, major amendment, minor amendment or minor modification, and renewal applications.

This section of the application is only used to determine if alternative language notices will be needed. Complete instructions on publishing the alternative language notices will be in your public notice package.

Call the bilingual/ESL coordinator at the nearest elementary and middle schools and obtain the following information to determine if an alternative language notice(s) is required.

1. Is a bilingual education program required by the Texas Education Code at the elementary or middle school nearest to the facility or proposed facility?

☒ Yes ☐ No

If no, publication of an alternative language notice is not required; skip to Item 8 (Regulated Entity and Permitted Site Information.)

2. Are the students who attend either the elementary school or the middle school enrolled in a bilingual education program at that school?

☒ Yes ☐ No

3. Do the students at these schools attend a bilingual education program at another location?

☐ Yes ☒ No

4. Would the school be required to provide a bilingual education program, but the school has waived out of this requirement under 19 TAC §89.1205(g)?

☐ Yes ☐ No ☒ N/A

5. If the answer is yes to question 1, 2, 3, or 4, public notices in an alternative language are required. Which language is required by the bilingual program? Spanish

- f. Plain Language Summary Template – Complete the Plain Language Summary (TCEQ Form 20972) and include as an attachment. Attachment: AR-2
- g. Complete one Public Involvement Plan (PIP) Form (TCEQ Form 20960) for each application for a new permit or major amendment and include as an attachment. Attachment: AR-3

## Item 10. Regulated Entity and Permitted Site Information (Instructions Page 29)

- a. TCEQ issued Regulated Entity Number (RN), if available: RN100219203

**Note:** If your business site is part of a larger business site, a Regulated Entity Number (RN) may already be assigned for the larger site. Use the RN assigned for the larger site. Search the TCEQ's Central Registry to determine the RN or to see if the larger site may already be registered as a Regulated Entity. If the site is found, provide the assigned RN.

- b. Name of project or site (the name known by the community where located): Garland Municipal Power – Ray Olinger Plant

- c. Is the location address of the facility in the existing permit the same?

☒ Yes ☐ No ☐ N/A (new permit)

**Note:** If the facility is located in Bexar, Comal, Hays, Kinney, Medina, Travis, Uvalde, or Williamson County, additional information concerning protection of the Edwards Aquifer may be required.

- d. Owner of treatment facility:

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: City of Garland

Mailing Address: 13835 Country Road 489

City/State/Zip: Nevada, TX 75173

Phone No: 972-205-2650

Email: Click to enter text.

- e. Ownership of facility: ☒ Public ☐ Private ☐ Both ☐ Federal

f. Owner of land where treatment facility is or will be: N/A

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: City of Garland

Mailing Address: 13835 Country Road 489

City/State/Zip: Nevada, TX 75173

Phone No: 972-205-2650

Email: dbernard@gpltexas.org

**Note:** If not the same as the facility owner, attach a long-term lease agreement in effect for at least six years (In some cases, a lease may not suffice - see instructions). Attachment: N/A

g. Owner of effluent TLAP disposal site (if applicable): N/A

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: N/A

Mailing Address: N/A

City/State/Zip: N/A

Phone No: N/A

Email: N/A

**Note:** If not the same as the facility owner, attach a long-term lease agreement in effect for at least six years. Attachment: N/A

h. Owner of sewage sludge disposal site (if applicable):

Prefix: N/A Full Name (Last/First Name): N/A

or Organization Name: N/A

Mailing Address: N/A

City/State/Zip: N/A

Phone No: N/A

Email: N/A

**Note:** If not the same as the facility owner, attach a long-term lease agreement in effect for at least six years. Attachment: N/A

## Item 11. TDPES Discharge/TLAP Disposal Information (Instructions, Page 31)

a. Is the facility located on or does the treated effluent cross Native American Land?

☐ Yes ☒ No

b. Attach an original full size USGS Topographic Map (or an 8.5"×11" reproduced portion for renewal or amendment applications) with all required information. Check the box next to each item below to confirm it has been included on the map.

☒ One-mile radius

☒ Three-miles downstream information

☒ Applicant's property boundaries

☒ Treatment facility boundaries

☒ Labeled point(s) of discharge

☒ Highlighted discharge route(s)

☐ Effluent disposal site boundaries

☒ All wastewater ponds

☐ Sewage sludge disposal site

☐ New and future construction

Attachment: AR-4

c. Is the location of the sewage sludge disposal site in the existing permit accurate?

☐ Yes ☐ No or New Permit N/A

If no, or a new application, provide an accurate location description: N/A

- d. Are the point(s) of discharge in the existing permit correct?

☒ Yes ☐ No or New Permit

If no, or a new application, provide an accurate location description: N/A

- e. Are the discharge route(s) in the existing permit correct?

☒ Yes ☐ No or New Permit

If no, or a new permit, provide an accurate description of the discharge route: N/A

- f. City nearest the outfall(s): Nevada

- g. County in which the outfalls(s) is/are located: Collin

- h. Is or will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch?

☐ Yes ☒ No

If yes, indicate by a check mark if: ☐ Authorization granted ☐ Authorization pending

For new and amendment applications, attach copies of letters that show proof of contact and provide the approval letter upon receipt. Attachment: N/A

For all applications involving an average daily discharge of 5 MGD or more, provide the names of all counties located within 100 statute miles downstream of the point(s) of discharge: N/A

- i. For TLAPs, is the location of the effluent disposal site in the existing permit accurate?

☐ Yes ☐ No or New Permit ☐ N/A

If no, or a new application, provide an accurate location description: N/A

- j. City nearest the disposal site: N/A

- k. County in which the disposal site is located: N/A

- l. For TLAPs, describe how effluent is/will be routed from the treatment facility to the disposal site: N/A

- m. For TLAPs, identify the nearest watercourse to the disposal site to which rainfall runoff might flow if not contained: N/A

## Item 12. Miscellaneous Information (Instructions, Page 33)

- a. Did any person formerly employed by the TCEQ represent your company and get paid for service regarding this application?

☐ Yes ☒ No

If yes, list each person: N/A

- b. Do you owe any fees to the TCEQ?

☐ Yes ☒ No

If yes, provide the following information:

Account no.: N/A

Total amount due: N/A

- c. Do you owe any penalties to the TCEQ?

☐ Yes ☒ No

If yes, provide the following information:

Enforcement order no.: N/A

Amount due: N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## ADMINISTRATIVE REPORT 1.1

The following information is required for new and amendment applications.

### Item 1. Affected Landowner Information (Instructions, Page 35)

- a. Attach a landowner map or drawing, with scale, as applicable. Check the box next to each item to confirm it has been provided.
- ☒ The applicant's property boundaries.
  - ☒ The facility site boundaries within the applicant's property boundaries.
  - ☒ The distance the buffer zone falls into adjacent properties and the property boundaries of the landowners located within the buffer zone.
  - ☒ The property boundaries of all landowners surrounding the applicant's property. (Note: if the application is a major amendment for a lignite mine, the map must include the property boundaries of all landowners adjacent to the new facility (ponds).)
  - ☒ The point(s) of discharge and highlighted discharge route(s) clearly shown for one mile downstream.
  - ☐ The property boundaries of the landowners located on both sides of the discharge route for one full stream mile downstream of the point of discharge.
  - ☒ The property boundaries of the landowners along the watercourse for a one-half mile radius from the point of discharge if the point of discharge is into a lake, bay, estuary, or affected by tides.
  - ☐ The boundaries of the effluent disposal site (e.g., irrigation area or subsurface drainfield site) and all evaporation/holding ponds within the applicant's property.
  - ☐ The property boundaries of all landowners surrounding the applicant's property boundaries where the effluent disposal site is located.
  - ☐ The boundaries of the sludge land application site (for land application of sewage sludge for beneficial use) and the property boundaries of landowners within one-quarter mile of the applicant's property boundaries where the sewage sludge land application site is located.
  - ☐ The property boundaries of landowners within one-half mile in all directions from the applicant's property boundaries where the sewage sludge disposal site (e.g., sludge surface disposal site or sludge monofil) is located.
- Attachment: [AR-5](#)
- b. Check the box next to the format of the landowners list:
- ☐ Readable/Writeable CD
  - ☒ Four sets of labels
- Attachment: [AR-5](#)
- d. Provide the source of the landowners' names and mailing addresses: Collin County CAD
- e. As required by Texas Water Code § 5.115, is any permanent school fund land affected by this application?
- ☐ Yes
  - ☒ No

If yes, provide the location and foreseeable impacts and effects this application has on the land(s): N/A

## **Item 2. Original Photographs (Instructions, Page 37)**

Provide original ground level photographs. Check the box next to each of the following items to indicate it is included.

- ☒ At least one original photograph of the new or expanded treatment unit location.
- ☒ At least two photographs of the existing/proposed point of discharge and as much area downstream (photo 1) and upstream (photo 2) as can be captured. If the discharge is to an open water body (e.g., lake, bay), the point of discharge should be in the right or left edge of each photograph showing the open water and with as much area on each respective side of the discharge as can be captured.
- ☐ At least one photograph of the existing/proposed effluent disposal site.
- ☒ A plot plan or map showing the location and direction of each photograph.

Attachment: **AR-6**

# **INDUSTRIAL WASTEWATER PERMIT APPLICATION**

## **SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)**

This form applies to TPDES permit applications only. Complete and attach the Supplemental Permit information Form (SPIF) (TCEQ Form 20971).

**Attachment:** SPIF-1 (SPIF Form), SPIF-2 (SPIF Topo Map)



# INDUSTRIAL WASTEWATER PERMIT APPLICATION CHECKLIST OF COMMON DEFICIENCIES

Below is a list of common deficiencies found during the administrative review of industrial wastewater permit applications. To ensure the timely processing of this application, please review the items below and indicate each item is complete and in accordance applicable rules at 30 TAC Chapters 21, 281, and 305 by checking the box next to the item. If an item is not required this application, indicate by checking N/A where appropriate. Please do not submit the application until all items below are addressed.

- ☒ Core Data Form (TCEQ Form No. 10400)  
*(Required for all applications types. Must be completed in its entirety and signed.  
Note: Form may be signed by applicant representative.)*
- ☒ Correct and Current Industrial Wastewater Permit Application Forms  
*(TCEQ Form Nos. 10055 and 10411. Version dated 5/10/2019 or later.)*
- ☒ Water Quality Permit Payment Submittal Form (Page 14) **EPAY**  
*(Original payment sent to TCEQ Revenue Section. See instructions for mailing address.)*
- ☒ 7.5 Minute USGS Quadrangle Topographic Map Attached  
*(Full-size map if seeking "New" permit.  
8 ½ x 11 acceptable for Renewals and Amendments.)*
- ☒ N/A ☐ Current/Non-Expired, Executed Lease Agreement or Easement Attached
- ☐ N/A ☒ Landowners Map  
*(See instructions for landowner requirements.)*

## Things to Know:

- All the items shown on the map must be labeled.
- The applicant's complete property boundaries must be delineated which includes boundaries of contiguous property owned by the applicant.
- The applicant cannot be its own adjacent landowner. You must identify the landowners immediately adjacent to their property, regardless of how far they are from the actual facility.
- If the applicant's property is adjacent to a road, creek, or stream, the landowners on the opposite side must be identified. Although the properties are not adjacent to applicant's property boundary, they are considered potentially affected landowners. If the adjacent road is a divided highway as identified on the USGS topographic map, the applicant does not have to identify the landowners on the opposite side of the highway.

- ☐ N/A ☒ Landowners Cross Reference List  
*(See instructions for landowner requirements.)*
- ☐ N/A ☒ Landowners Labels or CD-RW attached  
*(See instructions for landowner requirements.)*
- ☒ Original signature per 30 TAC § 305.44 – Blue Ink Preferred  
*(If signature page is not signed by an elected official or principle executive officer,  
a copy of signature authority/delegation letter must be attached.)*
- ☒ Plain Language Summary



# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## INDUSTRIAL WASTEWATER PERMIT APPLICATION TECHNICAL REPORT 1.0

The following information **is required** for all applications for a TLAP or an individual TPDES discharge permit.

For **additional information** or clarification on the requested information, please refer to the [Instructions for Completing the Industrial Wastewater Permit Application](https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES_industrial_wastewater_steps.html)<sup>1</sup> available on the TCEQ website. Please contact the Industrial Permits Team at 512-239-4671 with any questions about this form.

If more than one outfall is included in the application, provide applicable information for each individual outfall. **If an item does not apply to the facility, enter N/A** to indicate that the item has been considered. Include separate reports or additional sheets as **clearly cross-referenced attachments** and provide the attachment number in the space provided for the item the attachment addresses.

**NOTE:** This application is for an industrial wastewater permit only. Additional authorizations from the TCEQ Waste Permits Division or the TCEQ Air Permits Division may be needed.

### Item 1. Facility/Site Information (Instructions, Page 39)

- a. Describe the general nature of the business and type(s) of industrial and commercial activities. Include all applicable SIC codes (up to 4).

Steam Electric Power Plant (SIC Code 4911 – Electric Services)

- b. Describe all wastewater-generating processes at the facility.

The Ray Olinger Plant burns natural gas to produce steam used to drive turbine generators producing electric power. It also has one combustion gas turbine for power peaking. Exhaust steam is condensed in non-contact heat exchangers using lake water as the cooling media. Boiler blowdown and demineralized wastewater goes to evaporation ponds with zero discharge.

<sup>1</sup>

[https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES\\_industrial\\_wastewater\\_steps.html](https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES_industrial_wastewater_steps.html)

- c. Provide a list of raw materials, major intermediates, and final products handled at the facility.

**Materials List**

Raw Materials	Intermediate Products	Final Products
Natural Gas	Steam	Electricity

**Attachment:** N/A

- d. Attach a facility map (drawn to scale) with the following information:

- Production areas, maintenance areas, materials-handling areas, waste-disposal areas, and water intake structures.
- The location of each unit of the WWTP including the location of wastewater collection sumps, impoundments, outfalls, and sampling points, if significantly different from outfall locations.

**Attachment:** TR-1

- e. Is this a new permit application for an existing facility?

☐ Yes      ☒ No

If **yes**, provide background discussion: N/A

- f. Is/will the treatment facility/disposal site be located above the 100-year frequency flood level.

☒ Yes      ☐ No

List source(s) used to determine 100-year frequency flood plain: FEMA Floodplain Map No. 48085Co430J

If **no**, provide the elevation of the 100-year frequency flood plain and describe what protective measures are used/proposed to prevent flooding (including tail water and rainfall run-on controls) of the treatment facility and disposal area: N/A

**Attachment:** N/A

- g. For **new** or **major amendment** permit applications, will any construction operations result in a discharge of fill material into a water in the state?

☐ Yes    ☒ No    ☐ N/A (renewal only)

- h. If **yes** to Item 1.g, has the applicant applied for a USACE CWA Chapter 404 Dredge and Fill permit?

☐ Yes    ☐ No

If **yes**, provide the permit number: N/A

If **no**, provide an approximate date of application submittal to the USACE: N/A

## Item 2. Treatment System (Instructions, Page 40)

- a. List any physical, chemical, or biological treatment process(es) used/proposed to treat wastewater at this facility. Include a description of each treatment process, starting with initial treatment and finishing with the outfall/point of disposal.

Sodium hyperchlorate is used at the intake to control algae in the circulating water used for condenser cooling. Ammonium bisulfate is used for dichlorination at the outlet of the condenser to limit the total residual chlorine to less than 0.1 mg/L when the water exits the outfall into the lake.

- b. Attach a flow schematic **with a water balance** showing all sources of water and wastewater flow into the facility, wastewater flow into and from each treatment unit, and wastewater flow to each outfall/point of disposal.

Attachment: **TR-2**

## Item 3. Impoundments (Instructions, Page 40)

Does the facility use or plan to use any wastewater impoundments (e.g., lagoons or ponds?)

☒ Yes    ☐ No

If **no**, proceed to Item 4. If **yes**, complete **Item 3.a** for **existing** impoundments and **Items 3.a - 3.e** for **new or proposed** impoundments. **NOTE:** See instructions, Pages 40-42, for additional information on the attachments required by Items 3.a – 3.e.

- a. Complete the table with the following information for each existing, new, or proposed impoundment. Attach additional copies of the Impoundment Information table, if needed.

**Use Designation:** Indicate the use designation for each impoundment as Treatment (T), Disposal (D), Containment (C), or Evaporation (E).

**Associated Outfall Number:** Provide an outfall number if a discharge occurs or will occur.

**Liner Type:** Indicate the liner type as Compacted clay liner (C), In-situ clay liner (I), Synthetic/plastic/rubber liner (S), or Alternate liner (A). **NOTE:** See instructions for further detail on liner specifications. If an alternate liner (A) is selected, include an attachment that provides a description of the alternate liner and any additional technical information necessary for an evaluation.

**Leak Detection System:** If any leak detection systems are in place/planned, enter Y for yes. Otherwise, enter N for no.

**Groundwater Monitoring Wells and Data:** If groundwater monitoring wells are in place/planned, enter Y for yes. Otherwise, enter N for no. Attach any existing groundwater monitoring data.

**Dimensions:** Provide the dimensions, freeboard, surface area, storage capacity of the impoundments, and the maximum depth (not including freeboard). For impoundments with irregular shapes, submit surface area instead of length and width.

**Compliance with 40 CFR Part 257, Subpart D:** If the impoundment is required to be in compliance with 40 CFR Part 257, Subpart D, enter Y for yes. Otherwise, enter N for no.

**Date of Construction:** Enter the date construction of the impoundment commenced (mm/dd/yy).

#### Impoundment Information

Parameter	Pond #1	Pond #2	Pond #3	Pond #4
Use Designation: (T) (D) (C) or (E)	E	E	E	E
Associated Outfall Number				
Liner Type (C) (I) (S) or (A)	C	C	C	S
Alt. Liner Attachment Reference				
Leak Detection System, Y/N				
Groundwater Monitoring Wells, Y/N				
Groundwater Monitoring Data Attachment				
Pond Bottom Located Above The Seasonal High-Water Table, Y/N				
Length (ft)	200	100	384	400
Width (ft)	184	90	274	321
Max Depth From Water Surface (ft), Not Including Freeboard	3	3	3	6
Freeboard (ft)	2	2	2	2
Surface Area (acres)	0.85	0.20	2.42	2.95
Storage Capacity (gallons)	1,376,416	336,623	3,935,352	5,762,992
40 CFR Part 257, Subpart D, Y/N				
Date of Construction				

**Attachment:** N/A

The following information (**Items 3.b – 3.e**) is required only for **new or proposed** impoundments.

- b. For new or proposed impoundments, attach any available information on the following items. If attached, check **yes** in the appropriate box. Otherwise, check **no** or **not yet designed**.

1. Liner data

☐ Yes      ☐ No      ☐ Not yet designed

2. Leak detection system or groundwater monitoring data

☐ Yes      ☐ No      ☐ Not yet designed

3. Groundwater impacts

☐ Yes      ☐ No      ☐ Not yet designed

**NOTE:** Item b.3 is required if the bottom of the pond is not above the seasonal high-water table in the shallowest water-bearing zone.

**Attachment:** N/A

**For TLAP applications: Items 3.c – 3.e are not required, continue to Item 4.**

- c. Attach a USGS map or a color copy of original quality and scale which accurately locates and identifies all known water supply wells and monitor wells within ½-mile of the impoundments.

**Attachment:** N/A

- d. Attach copies of State Water Well Reports (e.g., driller's logs, completion data, etc.), and data on depths to groundwater for all known water supply wells including a description of how the depths to groundwater were obtained.

**Attachment:** N/A

- e. Attach information pertaining to the groundwater, soils, geology, pond liner, etc. used to assess the potential for migration of wastes from the impoundments or the potential for contamination of groundwater or surface water.

**Attachment:** N/A

## Item 4. Outfall/Disposal Method Information (Instructions, Page 42)

Complete the following tables to describe the location and wastewater discharge or disposal operations for each outfall for discharge, and for each point of disposal for TLAP operations.

If there are more outfalls/points of disposal at the facility than the spaces provided, copies of pages 6 and/or numbered accordingly (i.e., page 6a, 6b, etc.) may be used to provide information on the additional outfalls.

**For TLAP applications:** Indicate the disposal method and each individual irrigation area **I**, evaporation pond **E**, or subsurface drainage system **S** by providing the appropriate letter designation for the disposal method followed by a numerical designation for each disposal area in the space provided for **Outfall** number (e.g. **E1** for evaporation pond 1, **I2** for irrigation area No. 2, etc.).

**Outfall Longitude and Latitude**

Outfall No.	Latitude (Decimal Degrees)	Longitude (Decimal Degrees)
001	33.068508	-96.454209

**Outfall Location Description**

Outfall No.	Location Description
001	Lake Lavon
Internal 101	Near water treatment units (to be removed)
Internal 102	Surrounding and near ROP1,2, and 3

**Description of Sampling Point(s) (if different from Outfall location)**

Outfall No.	Description of sampling point
001	Outfall location (33.068508, -96.454209)

**Outfall Flow Information – Permitted and Proposed**

Outfall No.	Permitted Daily Avg Flow (MGD)	Permitted Daily Max Flow (MGD)	Proposed Daily Avg Flow (MGD)	Proposed Daily Max Flow (MGD)	Anticipated Discharge Date (mm/dd/yy)
001	404	404			
Internal 101	Report	Report			

**Outfall Discharge – Method and Measurement**

Outfall No.	Pumped Discharge? Y/N	Gravity Discharge? Y/N	Type of Flow Measurement Device Used
001	Y	N	Meter
Internal 101	Y	N	Est.
Internal 102	N	Y	Est.

**Outfall Discharge – Flow Characteristics**

Outfall No.	Intermittent Discharge? Y/N	Continuous Discharge? Y/N	Seasonal Discharge? Y/N	Discharge Duration (hrs/day)	Discharge Duration (days/mo)	Discharge Duration (mo/yr)
001	N	Y	N	24	31	12
Internal 101	Y	N	N	Variable	Variable	Variable

Outfall No.	Intermittent Discharge? Y/N	Continuous Discharge? Y/N	Seasonal Discharge? Y/N	Discharge Duration (hrs/day)	Discharge Duration (days/mo)	Discharge Duration (mo/yr)
Internal 102	Y	N	N	Variable	Variable	Variable

#### Outfall Wastestream Contributions

##### Outfall No. **001**

Contributing Wastestream	Volume (MGD)	Percent (%) of Total Flow
ROP3 Condenser and Plant Service Water	86.903	59
ROP1 & ROP2 Condensers and Plant Service Water	61.198	41
Internal Outfall 101 - Filter Backwash and RO Reject	0.052	0
Internal Outfall 102 - Stormwater Run-off (gravity, seasonal)	0.014	0
<b>Total</b>	<b>148.167</b>	<b>100</b>

##### Outfall No. **Internal 101 (to be removed)**

Contributing Wastestream	Volume (MGD)	Percent (%) of Total Flow
Prefilter Backwash	0.03	0
RO Reject	0.022	0

##### Outfall No. **Internal 102**

Contributing Wastestream	Volume (MGD)	Percent (%) of Total Flow
Stormwater	0.014	0

Attachment: N/A



## Item 5. Blowdown and Once-Through Cooling Water Discharges (Instructions, Page 43)

a. Indicate if the facility currently or proposes to:

- ☐ Yes ☒ No Use cooling towers that discharge blowdown or other wastestreams
- ☐ Yes ☒ No Use boilers that discharge blowdown or other wastestreams
- ☒ Yes ☐ No Discharge once-through cooling water

**NOTE:** If the facility uses or plans to use cooling towers or once-through cooling water, Item 12 **is required**.

b. If **yes** to any of the above, attach an SDS with the following information for each chemical additive.

- Manufacturers Product Identification Number
- Product use (e.g., biocide, fungicide, corrosion inhibitor, etc.)
- Chemical composition including CASRN for each ingredient
- Classify product as non-persistent, persistent, or bioaccumulative
- Product or active ingredient half-life
- Frequency of product use (e.g., 2 hours/day once every two weeks)
- Product toxicity data specific to fish and aquatic invertebrate organisms
- Concentration of whole product or active ingredient, as appropriate, in wastestream.

In addition to each SDS, attach a summary of the above information for each specific wastestream and the associated chemical additives. Specify which outfalls are affected.

**Attachment:** **TR-3**

c. Cooling Towers and Boilers

If the facility currently or proposes to use cooling towers or boilers that discharge blowdown or other wastestreams to the outfall(s), complete the following table.

**Cooling Towers and Boilers**

Type of Unit	Number of Units	Daily Avg Blowdown (gallons/day)	Daily Max Blowdown (gallons/day)
Cooling Towers			
Boilers	3	34,022	48,916

## Item 6. Stormwater Management (Instructions, Page 44)

Will any existing/proposed outfalls discharge stormwater associated with industrial activities, as defined at 40 CFR § 122.26(b)(14), commingled with any other wastestream?

- ☒ Yes ☐ No

If **yes**, briefly describe the industrial processes and activities that occur outdoors or in a manner which may result in exposure of the activities or materials to stormwater: The ROPP facility has a current MSGP authorization (TXR05AX97). The exposed materials include diesel and gasoline storage, used oil, and sodium hypochlorite associated with the industrial process.

## Item 7. Domestic Sewage, Sewage Sludge, and Septage Management and Disposal (Instructions, Page 44)

**Domestic Sewage** - Waste and wastewater from humans or household operations that is discharged to a wastewater collection system or otherwise enters a treatment works.

- a. Check the box next to the appropriate method of domestic sewage and domestic sewage sludge treatment or disposal. Complete Worksheet 5.0 or Item 7.b if directed to do so.
- ☐ Domestic sewage is routed (i.e., connected to or transported to) to a WWTP permitted to receive domestic sewage for treatment, disposal, or both. Complete Item 7.b.
  - ☒ Domestic sewage disposed of by an on-site septic tank and drainfield system. Complete Item 7.b.
  - ☐ Domestic and industrial treatment sludge ARE commingled prior to use or disposal.
  - ☐ Industrial wastewater and domestic sewage are treated separately, and the respective sludge IS NOT commingled prior to sludge use or disposal. Complete Worksheet 5.0.
  - ☐ Facility is a POTW. Complete Worksheet 5.0.
  - ☐ Domestic sewage is not generated on-site.
  - ☐ Other (e.g., portable toilets), specify and Complete Item 7.b: [Click to enter text.](#)
- b. Provide the name and TCEQ, NPDES, or TPDES Permit No. of the waste-disposal facility which receives the domestic sewage/septage. If hauled by motorized vehicle, provide the name and TCEQ Registration No. of the hauler.

### Domestic Sewage Plant/Hauler Name

Plant/Hauler Name	Permit/Registration No.
AAA Septic Tank Service, Inc	TCEQ 24027
Nortex Septic Service	TCEQ 25282

## Item 8. Improvements or Compliance/Enforcement Requirements (Instructions, Page 45)

- a. Is the permittee currently required to meet any implementation schedule for compliance or enforcement?
- ☐ Yes ☒ No
- b. Has the permittee completed or planned for any improvements or construction projects?
- ☐ Yes ☒ No
- c. If **yes** to either 8.a or 8.b, provide a brief summary of the requirements and a status update: N/A

## Item 9. Toxicity Testing (Instructions, Page 45)

Have any biological tests for acute or chronic toxicity been made on any of the discharges or on a receiving water in relation to the discharge within the last three years?

☐ Yes ☒ No

If **yes**, identify the tests and describe their purposes: N/A

Additionally, attach a copy of all tests performed which **have not** been submitted to the TCEQ or EPA. **Attachment:** N/A

## Item 10. Off-Site/Third Party Wastes (Instructions, Page 45)

- a. Does or will the facility receive wastes from off-site sources for treatment at the facility, disposal on-site via land application, or discharge via a permitted outfall?

☐ Yes ☒ No

If **yes**, provide responses to Items 10.b through 10.d below.

If **no**, proceed to Item 11.

- b. Attach the following information to the application:

- List of wastes received (including volumes, characterization, and capability with on-site wastes).
- Identify the sources of wastes received (including the legal name and addresses of the generators).
- Description of the relationship of waste source(s) with the facility's activities.

**Attachment:** N/A

- c. Is or will wastewater from another TCEQ, NPDES, or TPDES permitted facility commingled with this facility's wastewater after final treatment and prior to discharge via the final outfall/point of disposal?

☐ Yes ☒ No

If **yes**, provide the name, address, and TCEQ, NPDES, or TPDES permit number of the contributing facility and a copy of any agreements or contracts relating to this activity.

**Attachment:** N/A

- d. Is this facility a POTW that accepts/will accept process wastewater from any SIU and has/is required to have an approved pretreatment program under the NPDES/TPDES program?

☐ Yes ☒ No

If **yes**, **Worksheet 6.0** of this application is required.

## Item 11. Radioactive Materials (Instructions, Page 46)

- a. Are/will radioactive materials be mined, used, stored, or processed at this facility?

☐ Yes ☒ No

If **yes**, use the following table to provide the results of one analysis of the effluent for all radioactive materials that may be present. Provide results in pCi/L.

**Radioactive Materials Mined, Used, Stored, or Processed**

Radioactive Material Name	Concentration (pCi/L)
N/A	

- b. Does the applicant or anyone at the facility have any knowledge or reason to believe that radioactive materials may be present in the discharge, including naturally occurring radioactive materials in the source waters or on the facility property?

☐ Yes ☒ No

If **yes**, use the following table to provide the results of one analysis of the effluent for all radioactive materials that may be present. Provide results in pCi/L. Do not include information provided in response to Item 11.a.

**Radioactive Materials Present in the Discharge**

Radioactive Material Name	Concentration (pCi/L)
N/A	

**Item 12. Cooling Water (Instructions, Page 46)**

- a. Does the facility use or propose to use water for cooling purposes?

☒ Yes ☐ No

If **no**, stop here. If **yes**, complete Items 12.b thru 12.f.

- b. Cooling water is/will be obtained from a groundwater source (e.g., on-site well).

☐ Yes ☒ No

If **yes**, stop here. If **no**, continue.

- c. Cooling Water Supplier

1. Provide the name of the owner(s) and operator(s) for the CWIS that supplies or will supply water for cooling purposes to the facility.

**Cooling Water Intake Structure(s) Owner(s) and Operator(s)**

CWIS ID	Unit 1	Unit 2	Unit 3	
<b>Owner</b>	GP&L	GP&L	GP&L	
<b>Operator</b>	GP&L	GP&L	GP&L	

2. Cooling water is/will be obtained from a Public Water Supplier (PWS)

☒ Yes ☐ No

If **no**, continue. If **yes**, provide the PWS Registration No. and stop here: PWS No. 0430044

3. Cooling water is/will be obtained from a reclaimed water source?

☐ Yes ☒ No

If **no**, continue. If **yes**, provide the Reuse Authorization No. and stop here: N/A

4. Cooling water is/will be obtained from an Independent Supplier

☐ Yes ☒ No

If **no**, proceed to Item 12.d. If **yes**, provide the actual intake flow of the Independent Supplier's CWIS that is/will be used to provide water for cooling purposes and proceed: N/A

d. 316(b) General Criteria

1. The CWIS(s) used to provide water for cooling purposes to the facility has or will have a cumulative design intake flow of 2 MGD or greater.

☒ Yes ☐ No

2. At least 25% of the total water withdrawn by the CWIS is/will be used at the facility exclusively for cooling purposes on an annual average basis.

☒ Yes ☐ No

3. The CWIS(s) withdraw(s)/propose(s) to withdraw water for cooling purposes from surface waters that meet the definition of Waters of the United States in *40 CFR § 122.2*.

☒ Yes ☐ No

If **no**, provide an explanation of how the waterbody does not meet the definition of Waters of the United States in *40 CFR § 122.2*: N/A

If **yes** to all three questions in Item 12.d, the facility **meets** the minimum criteria to be subject to the full requirements of Section 316(b) of the CWA. Proceed to **Item 12.f**.

If **no** to any of the questions in Item 12.d, the facility **does not meet** the minimum criteria to be subject to the full requirements of Section 316(b) of the CWA; however, a determination is required based upon BPJ. Proceed to **Item 12.e**.

e. The facility does not meet the minimum requirements to be subject to the fill requirements of Section 316(b) **and uses/proposes to use cooling towers**.

☐ Yes ☐ No

If **yes**, stop here. If **no**, complete Worksheet 11.0, Items 1.a, 1.b.1-3 and 6, 2.b.1, and 3.a to allow for a determination based upon BPJ.

f. Oil and Gas Exploration and Production

1. The facility is subject to requirements at 40 CFR Part 435, Subparts A or D.

☐ Yes ☒ No

If **yes**, continue. If **no**, skip to Item 12.g.

2. The facility is an existing facility as defined at 40 CFR § 125.92(k) or a new unit at an existing facility as defined at 40 CFR § 125.92(u).

☐ Yes ☐ No

If **yes**, complete Worksheet 11.0, Items 1.a, 1.b.1-3 and 6, 2.b.1, and 3.a to allow for a determination based upon BPJ. If **no**, skip to Item 12.g.3.

g. Compliance Phase and Track Selection

1. Phase I – New facility subject to 40 CFR Part 125, Subpart I

☐ Yes ☒ No

If **yes**, check the box next to the compliance track selection, attach the requested information, and complete Worksheet 11.0, Items 2 and 3, and Worksheet 11.2.

☐ Track I – AIF greater than 2 MGD, but less than 10 MGD

- Attach information required by 40 CFR §§ 125.86(b)(2)-(4).

☐ Track I – AIF greater than 10 MGD

- Attach information required by 40 CFR § 125.86(b).

☐ Track II

- Attach information required by 40 CFR § 125.86(c).

**Attachment:** [Click to enter text.](#)

2. Phase II – Existing facility subject to 40 CFR Part 125, Subpart J

☒ Yes ☐ No

If **yes**, complete Worksheets 11.0 through 11.3, as applicable.

3. Phase III – New facility subject to 40 CFR Part 125, Subpart N

☐ Yes ☒ No

If **yes**, check the box next to the compliance track selection and provide the requested information.

☐ Track I – Fixed facility

- Attach information required by 40 CFR § 125.136(b) and complete Worksheet 11.0, Items 2 and 3, and Worksheet 11.2.

☐ Track I – Not a fixed facility

- Attach information required by 40 CFR § 125.136(b) and complete Worksheet 11.0, Item 2 (except CWIS latitude/longitude under Item 2.a).

☐ Track II – Fixed facility

- Attach information required by 40 CFR § 125.136(c) and complete Worksheet 11.0, Items 2 and 3.

**Attachment:** [Click to enter text.](#)

## Item 13. Permit Change Requests (Instructions, Page 48)

This item is only applicable to existing permitted facilities.

- a. Is the facility requesting a **major amendment** of an existing permit?

☒ Yes ☐ No

If **yes**, list each request individually and provide the following information: 1) detailed information regarding the scope of each request and 2) a justification for each request. Attach any supplemental information or additional data to support each request.

GP&L is requesting to remove internal Outfall 101 from the permit to eliminate separate sampling frequency from Outfall 001.

Other Requirement No. 12 (Evaporation Ponds) of the current permit lists that Pond No. 1 and No.3 can accept Meatal Cleaning Waste (MCW). However, the Draft Permit Rationale, Technology-Based Effluent Limitations/Conditions, states, "boiler blowdown, demineralized wastewater, and metal cleaning waste are routed to four evaporation ponds with zero discharge." GP&L would like to inquire about listing all four evaporation ponds to accept MCW.

- b. Is the facility requesting any **minor amendments** to the permit?

☐ Yes ☒ No

If **yes**, list and describe each change individually.

N/A - renewal

- c. Is the facility requesting any **minor modifications** to the permit?

☐ Yes ☒ No

If **yes**, list and describe each change individually.

N/A - renewal

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 1.0: EPA CATEGORICAL EFFLUENT GUIDELINES

This worksheet **is required** for all applications for TPDES permits for discharges of wastewaters subject to EPA categorical effluent limitation guidelines (ELGs).

### Item 1. Categorical Industries (Instructions, Page 53)

Is this facility subject to any 40 CFR categorical ELGs outlined on page 53 of the instructions?

☒ Yes ☐ No

If **no**, this worksheet is not required. If **yes**, provide the appropriate information below.

#### 40 CFR Effluent Guideline

Industry	40 CFR Part
Steam Electric Power Generating	423

### Item 2. Production/Process Data (Instructions, Page 54)

**NOTE:** For all TPDES permit applications requesting individual permit coverage for discharges of oil and gas exploration and production wastewater (discharges into or adjacent to water in the state, falling under the Oil and Gas Extraction Effluent Guidelines – 40 CFR Part 435), see Worksheet 12.0, Item 2 instead.

#### a. Production Data

Provide appropriate data for effluent guidelines with production-based effluent limitations.

##### Production Data

Subcategory	Actual Quantity/Day	Design Quantity/Day	Units
Once-through cooling water	404 Max (varies daily)	404	MGD

#### b. Organic Chemicals, Plastics, and Synthetic Fibers Manufacturing Data (40 CFR Part 414)

Provide each applicable subpart and the percent of total production. Provide data for metal-bearing and cyanide-bearing wastestreams, as required by *40 CFR Part 414, Appendices A and B*.



**Percentage of Total Production**

Subcategory	Percent of Total Production	Appendix A and B - Metals	Appendix A - Cyanide
N/A			

**c. Refineries (40 CFR Part 419)**

Provide the applicable subcategory and a brief justification.

N/A

**Item 3. Process/Non-Process Wastewater Flows (Instructions, Page 54)**

Provide a breakdown of wastewater flow(s) generated by the facility, including both process and non-process wastewater flow(s). Specify which wastewater flows are to be authorized for discharge under this permit and the disposal practices for wastewater flows, excluding domestic, which are not to be authorized for discharge under this permit.

Process: Once-through cooling water and low-volume waste

Non-Process: Stormwater runoff from the site

**Item 4. New Source Determination (Instructions, Page 54)**

Provide a list of all wastewater-generating processes subject to EPA categorical ELGs, identify the appropriate guideline Part and Subpart, and provide the date the process/construction commenced.

**Wastewater Generating Processes Subject to Effluent Guidelines**

Process	EPA Guideline Part	EPA Guideline Subpart	Date Process/Construction Commenced
Once-through cooling water	423	12	1975
Low volume waste	423	12	2011

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 2.0: POLLUTANT ANALYSIS

Worksheet 2.0 is **required** for all applications submitted for a TPDES permit. Worksheet 2.0 is not required for applications for a permit to dispose of all wastewater by land disposal or for discharges solely of stormwater associated with industrial activities.

### Item 1. General Testing Requirements (Instructions, Page 55)

- Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): 7/8/24 – 7/24/24
- ☒ Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- Read the general testing requirements in the instructions for important information about sampling, test methods, and MALs. If a contact laboratory was used, attach a list which includes the name, contact information, and pollutants analyzed for each laboratory/firm.  
**Attachment:** TR-4

### Item 2. Specific Testing Requirements (Instructions, Page 56)

Attach correspondence from TCEQ approving submittal of less than the required number of samples, if applicable. **Attachment:** N/A

#### TABLE 1 and TABLE 2 (Instructions, Page 58)

Completion of Tables 1 and 2 is required for all external outfalls for all TPDES permit applications.

Table 1 for Outfall No.: 001

Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (mg/L) 7/6/24	Sample 2 (mg/L) 7/8/24	Sample 3 (mg/L) 7/16/24	Sample 4 (mg/L) 7/24/24
BOD (5-day)	1.67	1.39	2.53	Lab
CBOD (5-day)	1.75	1.44	2.52	Results
Chemical oxygen demand	25.4	19.0	22.2	Pending
Total organic carbon	11.5	11.2	5.34	
Dissolved oxygen	8.77	10.2	7.77	
Ammonia nitrogen	<0.0280	<0.0280	<0.0280	
Total suspended solids	5.93	6.20	<2.65	
Nitrate nitrogen	<0.0480	<0.0480	<0.0480	
Total organic nitrogen	1.03	0.343	0.478	
Total phosphorus	0.101	0.0443	0.0442	
Oil and grease	0.780	<0.35	<0.35	

<b>Pollutant</b>	<b>Sample 1 (mg/L) 7/6/24</b>	<b>Sample 2 (mg/L) 7/8/24</b>	<b>Sample 3 (mg/L) 7/16/24</b>	<b>Sample 4 (mg/L) 7/24/24</b>
Total residual chlorine	0.033	0.108	0.0420	
Total dissolved solids	184	159	219	
Sulfate	27.1	23.3	27.3	
Chloride	15.4	14.4	16.1	
Fluoride	0.177	0.172	0.243	
Total alkalinity (mg/L as CaCO3)	110	120	110	
Temperature (°F)	86.45	83.9	86.05	84.3
pH (standard units)	8.21	7.83	8.35	

**Table 2 for Outfall No.: 001**

Samples are (check one): ☐ Composite ☒ Grab

<b>Pollutant</b>	<b>Sample 1 (µg/L)</b>	<b>Sample 2 (µg/L)</b>	<b>Sample 3 (µg/L)</b>	<b>Sample 4 (µg/L)</b>	<b>MAL (µg/L)</b>
Aluminum, total	98.4	115	167	Lab	2.5
Antimony, total	<5	<5	<5	Results	5
Arsenic, total	4.8	5.18	5.28	Pending	0.5
Barium, total	39.3	65.9	34.1		3
Beryllium, total	<0.5	<0.5	<0.5		0.5
Cadmium, total	<1	<1	<1		1
Chromium, total	<3	<3	<3		3
Chromium, hexavalent	<3	<3	<3		3
Chromium, trivalent	<3	<3	<3		N/A
Copper, total	6.18	6.09	2.57		2
Cyanide, available	<2	<2	<2		2/10
Lead, total	<0.5	<0.5	<0.5		0.5
Mercury, total	0.078	<0.0005	0.045		0.005/0.0005
Nickel, total	<2	<2	<2		2
Selenium, total	<5	<0.5	<0.5		5
Silver, total	<0.5	<0.5	<0.5		0.5
Thallium, total	<0.5	<0.5	0.894		0.5
Zinc, total	6.02	<5.0	<5.0		5.0

TABLE 3 (Instructions, Page 58)

**Completion** of Table 3 is required for all **external outfalls** which discharge process wastewater.

**Partial completion** of Table 3 is required for all **external outfalls** which discharge non-process wastewater and stormwater associated with industrial activities commingled with other wastestreams (see instructions for additional guidance).

Table 3 for Outfall No.: **001**Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Acrylonitrile	<50	<50	<50	Lab	50
Anthracene	<10	<10	<10	Results	10
Benzene	<10	<10	<10	Pending	10
Benidine	<50	<50	<50		50
Benzo(a)anthracene	<5	<5	<5		5
Benzo(a)pyrene	<5	<5	<5		5
Bis(2-chloroethyl)ether	<10	<10	<10		10
Bis(2-ethylhexyl)phthalate	<10	<10	<10		10
Bromodichloromethane [Dichlorobromomethane]	<10	<10	<10		10
Bromoform	<10	<10	<10		10
Carbon tetrachloride	<2	<2	<2		2
Chlorobenzene	<10	<10	<10		10
Chlorodibromomethane [Dibromochloromethane]	<10	<10	<10		10
Chloroform	<10	<10	<10		10
Chrysene	<5	<5	<5		5
m-Cresol [3-Methylphenol]	<10	<10	<10		10
o-Cresol [2-Methylphenol]	<10	<10	<10		10
p-Cresol [4-Methylphenol]	<10	<10	<10		10
1,2-Dibromoethane	<10	<10	<10		10
m-Dichlorobenzene [1,3-Dichlorobenzene]	<10	<10	<10		10
o-Dichlorobenzene [1,2-Dichlorobenzene]	<10	<10	<10		10
p-Dichlorobenzene [1,4-Dichlorobenzene]	<10	<10	<10		10
3,3'-Dichlorobenzidine	<5	<5	<5		5
1,2-Dichloroethane	<10	<10	<10		10

<b>Pollutant</b>	<b>Sample 1 (µg/L)*</b>	<b>Sample 2 (µg/L)*</b>	<b>Sample 3 (µg/L)*</b>	<b>Sample 4 (µg/L)*</b>	<b>MAL (µg/L)*</b>
1,1-Dichloroethene [1,1-Dichloroethylene]	<10	<10	<10		10
Dichloromethane [Methylene chloride]	<20	<20	<20		20
1,2-Dichloropropane	<10	<10	<10		10
1,3-Dichloropropene [1,3-Dichloropropylene]	<10	<10	<10		10
2,4-Dimethylphenol	<10	<10	<10		10
Di-n-Butyl phthalate	<10	<10	<10		10
Ethylbenzene	<10	<10	<10		10
Fluoride	<500	<500	<500		500
Hexachlorobenzene	<5	<5	<5		5
Hexachlorobutadiene	<10	<10	<10		10
Hexachlorocyclopentadiene	<10	<10	<10		10
Hexachloroethane	<20	<20	<20		20
Methyl ethyl ketone	<50	<50	<50		50
Nitrobenzene	<10	<10	<10		10
N-Nitrosodiethylamine	<20	<20	<20		20
N-Nitroso-di-n-butylamine	<20	<20	<20		20
Nonylphenol	<333	<333	<333		333
Pentachlorobenzene	<20	<20	<20		20
Pentachlorophenol	<5	<5	<5		5
Phenanthrene	<10	<10	<10		10
Polychlorinated biphenyls (PCBs) (**)	<0.2	<0.2	<0.2		0.2
Pyridine	<20	<20	<20		20
1,2,4,5-Tetrachlorobenzene	<20	<20	<20		20
1,1,2,2-Tetrachloroethane	<10	<10	<10		10
Tetrachloroethene [Tetrachloroethylene]	<10	<10	<10		10
Toluene	<10	<10	<10		10
1,1,1-Trichloroethane	<10	<10	<10		10
1,1,2-Trichloroethane	<10	<10	<10		10
Trichloroethene [Trichloroethylene]	<10	<10	<10		10

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
2,4,5-Trichlorophenol	<50	<50	<50		50
TTHM (Total trihalomethanes)	<10	<10	<10		10
Vinyl chloride	<10	<10	<10		10

(\*) Indicate units if different from µg/L.

(\*\*) Total of detects for PCB-1242, PCB-1254, PCB-1221, PCB-1232, PCB-1248, PCB-1260, and PCB-1016. If all non-detects, enter the highest non-detect preceded by a "<".

#### TABLE 4 (Instructions, Pages 58-59)

Partial completion of Table 4 **is required** for each **external outfall** based on the conditions below.

##### a. Tributyltin

Is this facility an industrial/commercial facility which currently or proposes to directly dispose of wastewater from the types of operations listed below or a domestic facility which currently or proposes to receive wastewater from the types of industrial/commercial operations listed below?

☐ Yes ☒ No

If **yes**, check the box next to each of the following criteria which apply and provide the appropriate testing results in Table 4 below (check all that apply).

- ☐ Manufacturers and formulators of tributyltin or related compounds.
- ☐ Painting of ships, boats and marine structures.
- ☐ Ship and boat building and repairing.
- ☐ Ship and boat cleaning, salvage, wrecking and scaling.
- ☐ Operation and maintenance of marine cargo handling facilities and marinas.
- ☐ Facilities engaged in wood preserving.
- ☐ Any other industrial/commercial facility for which tributyltin is known to be present, or for which there is any reason to believe that tributyltin may be present in the effluent.

##### b. Enterococci (discharge to saltwater)

This facility discharges/proposes to discharge directly into saltwater receiving waters **and** Enterococci bacteria are expected to be present in the discharge based on facility processes.

☐ Yes ☒ No

Domestic wastewater is/will be discharged.

☐ Yes ☒ No

If **yes to either** question, provide the appropriate testing results in Table 4 below.

c. **E. coli (discharge to freshwater)**

This facility discharges/proposes to discharge directly into freshwater receiving waters **and** *E. coli* bacteria are expected to be present in the discharge based on facility processes.

☐ Yes ☒ No

Domestic wastewater is/will be discharged.

☐ Yes ☒ No

If **yes to either** question, provide the appropriate testing results in Table 4 below.

Table 4 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1	Sample 2	Sample 3	Sample 4	MAL
Tributyltin (µg/L)					0.010
Enterococci (cfu or MPN/100 mL)					N/A
<i>E. coli</i> (cfu or MPN/100 mL)					N/A

TABLE 5 (Instructions, Page 59)

**Completion** of Table 5 **is required** for all **external outfalls** which discharge process wastewater from a facility which manufactures or formulates pesticides or herbicides or other wastewaters which may contain pesticides or herbicides.

If this facility does not/will not manufacture or formulate pesticides or herbicides and does not/will not discharge other wastewaters that may contain pesticides or herbicides, check N/A.

☒ N/A

Table 5 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Aldrin					0.01
Carbaryl					5
Chlordane					0.2
Chlorpyrifos					0.05
4,4'-DDD					0.1
4,4'-DDE					0.1
4,4'-DDT					0.02
2,4-D					0.7
Danitol [Fenpropathrin]					—
Demeton					0.20
Diazinon					0.5/0.1
Dicofol [Kelthane]					1
Dieldrin					0.02
Diuron					0.090

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Endosulfan I ( <i>alpha</i> )					0.01
Endosulfan II ( <i>beta</i> )					0.02
Endosulfan sulfate					0.1
Endrin					0.02
Guthion [Azinphos methyl]					0.1
Heptachlor					0.01
Heptachlor epoxide					0.01
Hexachlorocyclohexane ( <i>alpha</i> )					0.05
Hexachlorocyclohexane ( <i>beta</i> )					0.05
Hexachlorocyclohexane ( <i>gamma</i> ) [Lindane]					0.05
Hexachlorophene					10
Malathion					0.1
Methoxychlor					2.0
Mirex					0.02
Parathion (ethyl)					0.1
Toxaphene					0.3
2,4,5-TP [Silvex]					0.3

\* Indicate units if different from µg/L.



TABLE 6 (Instructions, Page 59)

Completion of Table 6 is required for all external outfalls.

Table 6 for Outfall No.: **001**

Samples are (check one): ☐ Composite ☒ Grab

Pollutants	Believed Present	Believed Absent	Sample 1 (mg/L)	Sample 2 (mg/L)	Sample 3 (mg/L)	Sample 4 (mg/L)	MAL (µg/L)*
Bromide	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<400	<400	<400		400
Color (PCU)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	20.0	20.0	20.0		—
Nitrate-Nitrite (as N)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<0.048	<0.048	0.21		—
Sulfide (as S)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<0.023	<0.023	<0.023		—
Sulfite (as SO <sub>3</sub> )	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<1.19	<1.19	<1.19		—
Surfactants	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<0.36	<0.36	<0.36		—
Boron, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	0.0707	0.0759	0.0702		20
Cobalt, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	0.00021	0.000199	0.00305		0.3
Iron, total	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.0935	0.119	0.0153		7
Magnesium, total	<input checked="" type="checkbox"/>	<input type="checkbox"/>	3.62	3.78	3.92		20
Manganese, total	<input checked="" type="checkbox"/>	<input type="checkbox"/>	0.0324	0.135	0.0439		0.5
Molybdenum, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	0.000963	0.00103	0.00174		1
Tin, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<5	<5	<5		5
Titanium, total	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<30	<30	<30		30

**TABLE 7 (Instructions, Page 60)**

Check the box next to any of the industrial categories applicable to this facility. If no categories are applicable, check N/A. If GC/MS testing is required, check the box provided to confirm the testing results for the appropriate parameters are provided with the application.

☐ N/A

**Table 7 for Applicable Industrial Categories**

Industrial Category	40 CFR Part	Volatiles Table 8	Acids Table 9	Bases/Neutrals Table 10	Pesticides Table 11
<input type="checkbox"/> Adhesives and Sealants		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Aluminum Forming	467	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Auto and Other Laundries		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Battery Manufacturing	461	<input type="checkbox"/> Yes	No	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Coal Mining	434	No	No	No	No
<input type="checkbox"/> Coil Coating	465	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Copper Forming	468	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Electric and Electronic Components	469	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Electroplating	413	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Explosives Manufacturing	457	No	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Foundries		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Gum and Wood Chemicals - Subparts A,B,C,E	454	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Gum and Wood Chemicals - Subparts D,F	454	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Inorganic Chemicals Manufacturing	415	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Iron and Steel Manufacturing	420	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Leather Tanning and Finishing	425	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Mechanical Products Manufacturing		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Nonferrous Metals Manufacturing	421,471	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Oil and Gas Extraction - Subparts A, D, E, F, G, H	435	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Ore Mining - Subpart B	440	No	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Organic Chemicals Manufacturing	414	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Paint and Ink Formulation	446,447	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Pesticides	455	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Petroleum Refining	419	<input type="checkbox"/> Yes	No	No	No
<input type="checkbox"/> Pharmaceutical Preparations	439	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Photographic Equipment and Supplies	459	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Plastic and Synthetic Materials Manufacturing	414	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Plastic Processing	463	<input type="checkbox"/> Yes	No	No	No
<input type="checkbox"/> Porcelain Enameling	466	No	No	No	No
<input type="checkbox"/> Printing and Publishing		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subpart C	430	<input type="checkbox"/> *	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts F, K	430	<input type="checkbox"/> *	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> *
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts A, B, D, G, H	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> *
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts I, J, L	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subpart E	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *
<input type="checkbox"/> Rubber Processing	428	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Soap and Detergent Manufacturing	417	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input checked="" type="checkbox"/> Steam Electric Power Plants	423	<input checked="" type="checkbox"/> Yes	<input checked="" type="checkbox"/> Yes	No	No
<input type="checkbox"/> Textile Mills (Not Subpart C)	410	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Timber Products Processing	429	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes

\* Test if believed present.

**TABLES 8, 9, 10, and 11 (Instructions, Page 60)**

Completion of Tables 8, 9, 10, and 11 **is required** as specified in Table 7 for all **external outfalls** that contain process wastewater.

Completion of Tables 8, 9, 10, and 11 **may be required** for types of industry not specified in Table 7 for specific parameters that are believed to be present in the wastewater.

**Table 8 for Outfall No.: 001**

Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Acrolein	<50	<50	<50	Lab	50
Acrylonitrile	<50	<50	<50	Results	50
Benzene	<10	<10	<10	Pending	10
Bromoform	<10	<10	<10		10
Carbon tetrachloride	<2	<2	<2		2
Chlorobenzene	<10	<10	<10		10
Chlorodibromomethane	<10	<10	<10		10
Chloroethane	<50	<50	<50		50
2-Chloroethylvinyl ether	<10	<10	<10		10
Chloroform	<10	<10	<10		10
Dichlorobromomethane [Bromodichloromethane]	<10	<10	<10		10
1,1-Dichloroethane	<10	<10	<10		10
1,2-Dichloroethane	<10	<10	<10		10
1,1-Dichloroethylene [1,1-Dichloroethene]	<10	<10	<10		10
1,2-Dichloropropane	<10	<10	<10		10
1,3-Dichloropropylene [1,3-Dichloropropene]	<10	<10	<10		10
Ethylbenzene	<10	<10	<10		10
Methyl bromide [Bromomethane]	<50	<50	<50		50
Methyl chloride [Chloromethane]	<50	<50	<50		50
Methylene chloride [Dichloromethane]	<20	<20	<20		20
1,1,2,2-Tetrachloroethane	<10	<10	<10		10
Tetrachloroethylene [Tetrachloroethene]	<10	<10	<10		10
Toluene	<10	<10	<10		10
1,2-Trans-dichloroethylene [1,2-Trans-dichloroethene]	<10	<10	<10		10

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
1,1,1-Trichloroethane	<10	<10	<10		10
1,1,2-Trichloroethane	<10	<10	<10		10
Trichloroethylene [Trichloroethene]	<10	<10	<10		10
Vinyl chloride	<10	<10	<10		10

\* Indicate units if different from µg/L.

Table 9 for Outfall No.: **001**

Samples are (check one): ☐ Composite ☒ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
2-Chlorophenol	<10	<10	<10	Lab	10
2,4-Dichlorophenol	<10	<10	<10	Results	10
2,4-Dimethylphenol	<10	<10	<10	Pending	10
4,6-Dinitro-o-cresol	<50	<50	<50		50
2,4-Dinitrophenol	<50	<50	<50		50
2-Nitrophenol	<20	<20	<20		20
4-Nitrophenol	<50	<50	<50		50
p-Chloro-m-cresol	<10	<10	<10		10
Pentachlorophenol	<5	<5	<5		5
Phenol	<10	<10	<10		10
2,4,6-Trichlorophenol	<10	<10	<10		10

\* Indicate units if different from µg/L.

Table 10 for Outfall No.: **N/A**

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Acenaphthene					10
Acenaphthylene					10
Anthracene					10
Benzidine					50
Benzo(a)anthracene					5
Benzo(a)pyrene					5
3,4-Benzofluoranthene [Benzo(b)fluoranthene]					10
Benzo(ghi)perylene					20
Benzo(k)fluoranthene					5
Bis(2-chloroethoxy)methane					10

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Bis(2-chloroethyl)ether					10
Bis(2-chloroisopropyl)ether					10
Bis(2-ethylhexyl)phthalate					10
4-Bromophenyl phenyl ether					10
Butylbenzyl phthalate					10
2-Chloronaphthalene					10
4-Chlorophenyl phenyl ether					10
Chrysene					5
Dibenzo(a,h)anthracene					5
1,2-Dichlorobenzene [o-Dichlorobenzene]					10
1,3-Dichlorobenzene [m-Dichlorobenzene]					10
1,4-Dichlorobenzene [p-Dichlorobenzene]					10
3,3'-Dichlorobenzidine					5
Diethyl phthalate					10
Dimethyl phthalate					10
Di-n-butyl phthalate					10
2,4-Dinitrotoluene					10
2,6-Dinitrotoluene					10
Di-n-octyl phthalate					10
1,2-Diphenylhydrazine (as Azobenzene)					20
Fluoranthene					10
Fluorene					10
Hexachlorobenzene					5
Hexachlorobutadiene					10
Hexachlorocyclopentadiene					10
Hexachloroethane					20
Indeno(1,2,3-cd)pyrene					5
Isophorone					10
Naphthalene					10
Nitrobenzene					10
N-Nitrosodimethylamine					50

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
N-Nitrosodi-n-propylamine					20
N-Nitrosodiphenylamine					20
Phenanthrene					10
Pyrene					10
1,2,4-Trichlorobenzene					10

\* Indicate units if different from µg/L.

Table 11 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Aldrin					0.01
alpha-BHC [alpha-Hexachlorocyclohexane]					0.05
beta-BHC [beta-Hexachlorocyclohexane]					0.05
gamma-BHC [gamma-Hexachlorocyclohexane]					0.05
delta-BHC [delta-Hexachlorocyclohexane]					0.05
Chlordane					0.2
4,4'-DDT					0.02
4,4'-DDE					0.1
4,4'-DDD					0.1
Dieldrin					0.02
Endosulfan I (alpha)					0.01
Endosulfan II (beta)					0.02
Endosulfan sulfate					0.1
Endrin					0.02
Endrin aldehyde					0.1
Heptachlor					0.01
Heptachlor epoxide					0.01
PCB 1242					0.2
PCB 1254					0.2
PCB 1221					0.2
PCB 1232					0.2
PCB 1248					0.2

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
PCB 1260					0.2
PCB 1016					0.2
Toxaphene					0.3

\* Indicate units if different from µg/L.

Attachment: N/A

#### TABLE 12 (DIOXINS/FURAN COMPOUNDS)

Complete of Table 12 **is required** for **external outfalls**, as directed below. (Instructions, Pages 59-60)

Indicate which compound(s) are manufactured or used at the facility and provide a brief description of the conditions of its/their presence at the facility (check all that apply).

- ☐ 2,4,5-trichlorophenoxy acetic acid (2,4,5-T) CASRN 93-76-5
- ☐ 2-(2,4,5-trichlorophenoxy) propanoic acid (Silvex, 2,4,5-TP) CASRN 93-72-1
- ☐ 2-(2,4,5-trichlorophenoxy) ethyl 2,2-dichloropropionate (Erbon) CASRN 136-25-4
- ☐ 0,0-dimethyl 0-(2,4,5-trichlorophenyl) phosphorothioate (Ronnell) CASRN 299-84-3
- ☐ 2,4,5-trichlorophenol (TCP) CASRN 95-95-4
- ☐ hexachlorophene (HCP) CASRN 70-30-4
- ☐ None of the above

Description: N/A

Does the applicant or anyone at the facility know or have any reason to believe that 2,3,7,8-tetrachlorodibenzo-p-dioxin (TCDD) or any congeners of TCDD may be present in the effluent proposed for discharge?

- ☐ Yes ☒ No

Description: Click to enter text.

If **yes** to either Items a **or** b, complete Table 12 as instructed.

Table 12 for Outfall No.: Click to enter text. Samples are (check one): ☐ Composite ☐ Grab

Compound	Toxicity Equivalent Factors	Wastewater Concentration (ppq)	Wastewater Toxicity Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Toxicity Equivalents (ppt)	MAL (ppq)
2,3,7,8-TCDD	1					10
1,2,3,7,8-PeCDD	1.0					50
2,3,7,8-HxCDDs	0.1					50
1,2,3,4,6,7,8-HpCDD	0.01					50

Compound	Toxicity Equivalent Factors	Wastewater Concentration (ppq)	Wastewater Toxicity Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Toxicity Equivalents (ppt)	MAL (ppq)
2,3,7,8-TCDF	0.1					10
1,2,3,7,8-PeCDF	0.03					50
2,3,4,7,8-PeCDF	0.3					50
2,3,7,8-HxCDFs	0.1					50
2,3,4,7,8-HpCDFs	0.01					50
OCDD	0.0003					100
OCDF	0.0003					100
PCB 77	0.0001					500
PCB 81	0.0003					500
PCB 126	0.1					500
PCB 169	0.03					500
Total						

**TABLE 13 (HAZARDOUS SUBSTANCES)**

Complete Table 13 **is required** for all **external outfalls** as directed below. (Instructions, Pages 60-61)

Are there any pollutants listed in the instructions (pages 55-62) believed present in the discharge?

☐ Yes ☒ No

Are there pollutants listed in Item 1.c. of Technical Report 1.0 which are believed present in the discharge and have not been analytically quantified elsewhere in this application?

☐ Yes ☒ No

If **yes** to either Items a or b, complete Table 13 as instructed.

Table 13 for Outfall No.: N/A

Samples are (check one): ☐ Composite ☐ Grab

Pollutant	CASRN	Sample 1 (µg/L)	Sample 2 (µg/L)	Sample 3 (µg/L)	Sample 4 (µg/L)	Analytical Method



# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 4.0: RECEIVING WATERS

This worksheet is **required** for all TPDES permit applications.

### Item 1. Domestic Drinking Water Supply (Instructions, Page 80)

- a. There is a surface water intake for domestic drinking water supply located within 5 (five) miles downstream from the point/proposed point of discharge.

☒ Yes ☐ No

If **no**, stop here and proceed to Item 2. If **yes**, provide the following information:

1. The legal name of the owner of the drinking water supply intake: North Texas Municipal Water District
2. The distance and direction from the outfall to the drinking water supply intake: 2.86 miles southwest

- b. Locate and identify the intake on the USGS 7.5-minute topographic map provided for Administrative Report 1.0.

☒ Check this box to confirm the above requested information is provided.

### Item 2. Discharge Into Tidally Influenced Waters (Instructions, Page 80)

If the discharge is to tidally influenced waters, complete this section. Otherwise, proceed to Item 3.

- a. Width of the receiving water at the outfall: N/A feet

- b. Are there oyster reefs in the vicinity of the discharge?

☐ Yes ☐ No

If **yes**, provide the distance and direction from the outfall(s) to the oyster reefs: N/A

- c. Are there sea grasses within the vicinity of the point of discharge?

☐ Yes ☐ No

If **yes**, provide the distance and direction from the outfall(s) to the grasses: N/A

### Item 3. Classified Segment (Instructions, Page 80)

The discharge is/will be directly into (or within 300 feet of) a classified segment.

☒ Yes ☐ No

If **yes**, stop here and do not complete Items 4 and 5 of this worksheet or Worksheet 4.1.

If **no**, complete Items 4 and 5 and Worksheet 4.1 may be required.

## Item 4. Description of Immediate Receiving Waters (Instructions, Page 80)

a. Name of the immediate receiving waters: N/A

b. Check the appropriate description of the immediate receiving waters:

☐ Lake or Pond

- Surface area (acres): [Click to enter text.](#)
- Average depth of the entire water body (feet): [Click to enter text.](#)
- Average depth of water body within a 500-foot radius of the discharge point (feet): [Click to enter text.](#)

☐ Man-Made Channel or Ditch

☐ Stream or Creek

☐ Freshwater Swamp or Marsh

☐ Tidal Stream, Bayou, or Marsh

☐ Open Bay

☐ Other, specify:

If **Man-Made Channel or Ditch** or **Stream or Creek** were selected above, provide responses to Items 4.c – 4.g below:

c. For **existing discharges**, check the description below that best characterizes the area **upstream** of the discharge.

For **new discharges**, check the description below that best characterizes the area **downstream** of the discharge.

- ☐ Intermittent (dry for at least one week during most years)
- ☐ Intermittent with Perennial Pools (enduring pools containing habitat to maintain aquatic life uses)
- ☐ Perennial (normally flowing)

Check the source(s) of the information used to characterize the area upstream (existing discharge) or downstream (new discharge):

- ☐ USGS flow records
- ☐ personal observation
- ☐ historical observation by adjacent landowner(s)
- ☐ other, specify: [Click to enter text.](#)

d. List the names of all perennial streams that join the receiving water within three miles downstream of the discharge point: [Click to enter text.](#)

e. The receiving water characteristics change within three miles downstream of the discharge (e.g., natural or man-made dams, ponds, reservoirs, etc.).

- ☐ Yes      ☐ No

If **yes**, describe how: [Click to enter text.](#)

- f. General observations of the water body during normal dry weather conditions: [Click to enter text.](#)

Date and time of observation: [Click to enter text.](#)

- g. The water body was influenced by stormwater runoff during observations.

☐ Yes ☐ No

If **yes**, describe how: [Click to enter text.](#)

## Item 5. General Characteristics of Water Body (Instructions, Page 81)

- a. Is the receiving water upstream of the existing discharge or proposed discharge site influenced by any of the following (check all that apply):

<input type="checkbox"/> oil field activities	<input checked="" type="checkbox"/> urban runoff
<input type="checkbox"/> agricultural runoff	<input type="checkbox"/> septic tanks
<input checked="" type="checkbox"/> upstream discharges	<input type="checkbox"/> other, specify: <a href="#">Click to enter text.</a>

- b. Uses of water body observed or evidence of such uses (check all that apply):

<input type="checkbox"/> livestock watering	<input type="checkbox"/> industrial water supply
<input type="checkbox"/> non-contact recreation	<input type="checkbox"/> irrigation withdrawal
<input checked="" type="checkbox"/> domestic water supply	<input type="checkbox"/> navigation
<input type="checkbox"/> contact recreation	<input checked="" type="checkbox"/> picnic/park activities
<input checked="" type="checkbox"/> fishing	<input type="checkbox"/> other, specify: <a href="#">Click to enter text.</a>

- c. Description which best describes the aesthetics of the receiving water and the surrounding area (check only one):

☐ **Wilderness:** outstanding natural beauty; usually wooded or un-pastured area: water clarity exceptional

☒ **Natural Area:** trees or native vegetation common; some development evident (from fields, pastures, dwellings); water clarity discolored

☐ **Common Setting:** not offensive, developed but uncluttered; water may be colored or turbid

☐ **Offensive:** stream does not enhance aesthetics; cluttered; highly developed; dumping areas; water discolored

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 6.0: INDUSTRIAL WASTE CONTRIBUTION

The following information is **required** for all applications for publicly-owned treatment works (POTWs).

For an explanation of the terms used in this worksheet, refer to the General Definitions on pages 4-12 and the Definitions Relating to Pretreatment on pages 13-14 of the Instructions.

### Item 1. All POTWs (Instructions, Page 86)

- a. Complete the following table with the number of each type of industrial users (IUs) that discharge to the POTW and the daily average flows from each.

#### Industrial User Information

Type of Industrial User	Number of Industrial Users	Daily Average Flow (gallons per day)
CIU	0 (zero)	0
SIU - Non-categorical	0 (zero)	0
Other IU	0 (zero)	0

- b. In the past three years, has the POTW experienced treatment plant interference?

☐ Yes ☒ No

If **yes**, identify the date(s), duration, nature of interference, and probable cause(s) and possible source(s) of each interference event. Include the names of the IU(s) that may have caused the interference: N/A

- c. In the past three years, has the POTW experienced pass-through?

☐ Yes ☒ No

If **yes**, identify the date(s), duration, pollutants passing through the treatment plant, and probable cause(s) and possible source(s) of each pass-through event. Include the names of the IU(s) that may have caused the pass-through: N/A

- d. Does the POTW have, or is it required to develop, an approved pretreatment program?

☐ Yes ☒ No

If **yes**, answer all questions in Item 2 and skip Item 3.

If **no**, skip Item 2 and answer all questions in Item 3 for each SIU and CIU.

### Item 2. POTWs With Approved Pretreatment Programs or Those Required To Develop A Pretreatment Program (Instructions, Page 86)

- a. Have there been any substantial modifications to the POTW's approved pretreatment program that have not been submitted to the Approval Authority (TCEQ) for approval according to 40 CFR § 403.18?

☐ Yes ☐ No

If **yes**, include an attachment which identifies all substantial modifications that have not been submitted to the TCEQ and the purpose of the modifications.

**Attachment:** N/A

- b. Have there been any non-substantial modifications to the POTW's approved pretreatment program that have not been submitted to the Approval Authority (TCEQ)?

☐ Yes      ☐ No

If **yes**, include an attachment which identifies all non-substantial modifications that have not been submitted to the TCEQ and the purpose of the modification.

**Attachment:** N/A

- c. List all parameters measured above the MAL in the POTW's effluent monitoring during the last three years:

**Effluent Parameters Measured Above the MAL**

Pollutant	Concentration	MAL	Units	Date

**Attachment:** N/A

- d. Has any SIU, CIU, or other IU caused or contributed to any other problems (excluding interference or pass-through) at the POTW in the past three years?

☐ Yes      ☐ No

If **yes**, provide a description of each episode, including date(s), duration, description of problems, and probable pollutants. Include the name(s) of the SIU(s)/CIU(s)/other IU(s) that may have caused or contributed to any of the problems: [Click to enter text.](#)

### Item 3. Significant Industrial User and Categorical Industrial User Information (Instructions, Pages 88-87)

POTWs that **do not** have an approved pretreatment program **are required** to provide the following information for each SIU and CIU:

- a. Mr. or Ms.: N/A First/Last Name: N/A

Organization Name: N/A

SIC Code: N/A

Phone number: N/A

Email address: N/A

Physical Address: N/A

City/State/ZIP Code: N/A

**Attachment:** N/A

- b. Describe the industrial processes or other activities that affect or contribute to the SIU(s) or CIU(s) discharge (e.g., process and non-process wastewater): N/A
- c. Provide a description of the principal products(s) or service(s) performed: N/A
- d. Flow rate information

**Flow Rate Information**

Effluent Type	Discharge Day (gallons per day)	Discharge Frequency (Continuous, batch, or intermittent)
Process Wastewater		
Non-process Wastewater		

e. Pretreatment Standards

1. Is the SIU or CIU subject to technology-based local limits as defined in the application instructions?

☐ Yes ☐ No

2. Is the SIU subject to categorical pretreatment standards?

☐ Yes ☐ No

If **yes**, provide the category and subcategory or subcategories in the SIUs Subject To Categorical Pretreatment Standards table.

**SIUs Subject to Categorical Pretreatment Standards**

Category in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR

- f. Has the SIU or CIU caused or contributed to any problem(s) (e.g., interferences, pass through, odors, corrosion, blockages) at the POTW in the past three years?

☐ Yes ☐ No

If **yes**, provide a description of each episode, including dates, duration, description of problems, and probable pollutants, and include the name(s) of the SIU(s)/CIU(s) that may have caused or contributed to the problem(s): N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 7.0: STORMWATER DISCHARGES ASSOCIATED WITH INDUSTRIAL ACTIVITIES

This worksheet **is required** for all TPDES permit applications requesting individual permit coverage for discharges consisting of **either**: 1) solely of stormwater discharges associated with industrial activities, as defined in *40 CFR § 122.26(b)(14)(i-xi)*, **or** 2) stormwater discharges associated with industrial activities and any of the listed allowable non-stormwater discharges, as defined in the MSGP (TXR05000), Part II, Section A, Item 6.

Discharges of stormwater as defined in *40 CFR § 122.26 (b)(13)* are not required to obtain authorization under a TPDES permit (see exceptions at *40 CFR §§ 122.26(a)(1)* and *(9)*). Authorization for discharge may be required from a local municipal separate storm sewer system.

### Item 1. Applicability (Instructions, Page 89)

Do discharges from any of the existing/proposed outfalls consist either 1) solely of stormwater discharges associated with industrial activities **or** 2) stormwater discharges associated with industrial activities and any of the allowable non-stormwater discharges?

☐ Yes ☒ No

If **no**, stop here. If **yes**, proceed as directed.

### Item 2. Stormwater Coverage (Instructions, Page 89)

List each existing/proposed stormwater outfall at the facility and indicate which type of authorization covers or is proposed to cover discharges.

#### Authorization Coverage

Outfall	Authorization under MSGP	Authorized Under Individual Permit
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>

If **all** existing/proposed outfalls which discharge stormwater associated with industrial activities (and any of the allowable non-stormwater discharges) are **authorized under the MSGP**, **stop** here.

If **seeking authorization** for any outfalls which discharge stormwater associated with industrial activities (and any of the allowable non-stormwater discharges) **under an individual permit**, **proceed**.

**NOTE: The following information is required for each existing/proposed stormwater outfall for which the facility is seeking individual permit authorization under this application**

### **Item 3. Site Map (Instructions, Page 90)**

Attach a site map or maps (drawn to scale) of the entire facility with the following information.

- the location of each stormwater outfall to be covered by the permit
- an outline of the drainage area that is within the facility's boundary and that contributes stormwater to each outfall to be covered by the permit
- connections or discharge points to municipal separate storm sewer systems
- locations of all structures (e.g. buildings, garages, storage tanks)
- structural control devices that are designed to reduce pollution in discharges of stormwater associated with industrial activities
- process wastewater treatment units (including ponds)
- bag house and other air treatment units exposed to stormwater (stormwater runoff, snow melt runoff, and surface runoff and drainage)
- landfills; scrapyards; surface water bodies (including wetlands)
- vehicle and equipment maintenance areas
- physical features of the site that may influence discharges of stormwater associated with industrial activities or contribute a dry weather flow
- locations where spills or leaks of reportable quality (as defined in *30 TAC § 327.4*) have occurred during the three years before this application was submitted to obtain coverage under an individual permit
- processing areas, storage areas, material loading/unloading areas, and other locations where significant materials are exposed to stormwater (stormwater runoff, snow melt runoff, and surface runoff and drainage)

☐ Check the box to confirm all above information was provided on the facility site map(s).

**Attachment:** N/A

### **Item 4. Facility/Site Information (Instructions, Page 90)**

- a. Provide the area of impervious surface and the total area drained by each stormwater outfall requested for authorization by this permit application.

#### **Impervious Surfaces**

<b>Outfall</b>	<b>Area of Impervious Surface (include units)</b>	<b>Total Area Drained (include units)</b>



- b. Provide the following local area rainfall information and the source of the information.  
Wettest month: N/A  
Average rainfall for wettest month (total inches): N/A  
25-year, 24-hour rainfall (inches): N/A  
Source: N/A
- c. Attach an inventory, or list, of materials currently handled at the facility that may be exposed to precipitation. **Attachment:** N/A
- d. Attach narrative descriptions of the industrial processes and activities involving the materials in the above-listed inventory that occur outdoors or in some manner that may result in exposure of the materials to precipitation or runoff (see instructions for guidance). **Attachment:** N/A
- e. Describe any BMPs and controls the facility uses/proposes to prevent or effectively reduce pollution in stormwater discharges from the facility: N/A

## Item 5. Pollutant Analysis (Instructions, Page 91)

- a. Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): N/A
- b. ☐ Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- c. Complete Table 17 as directed on page 92 of the Instructions.

Table 17 for Outfall No.: N/A

Pollutant	Grab Sample* Maximum (mg/L)	Composite Sample** Maximum (mg/L)	Grab Sample* Average (mg/L)	Composite Sample** Average (mg/L)	Number of Storm Events Sampled	MAL (mg/L)
pH (standard units)	(max)	—	(min)	—		—
Total suspended solids						—
Chemical oxygen demand						—
Total organic carbon						—
Oil and grease						—
Arsenic, total						0.0005
Barium, total						0.003
Cadmium, total						0.001
Chromium, total						0.003
Chromium, trivalent						—
Chromium, hexavalent						0.003
Copper, total						0.002

Pollutant	Grab Sample* Maximum (mg/L)	Composite Sample** Maximum (mg/L)	Grab Sample* Average (mg/L)	Composite Sample** Average (mg/L)	Number of Storm Events Sampled	MAL (mg/L)
Lead, total						0.0005
Mercury, total						0.000005
Nickel, total						0.002
Selenium, total						0.005
Silver, total						0.0005
Zinc, total						0.005

\* Taken during first 30 minutes of storm event

\*\* Flow-weighted composite sample

d. Complete Table 18 as directed on pages 92-94 of the Instructions.

Table 18 for Outfall No.: N/A

Pollutant	Grab Sample* Maximum (mg/L)	Composite Sample** Maximum (mg/L)	Grab Sample* Average (mg/L)	Composite Sample** Average (mg/L)	Number of Storm Events Sampled

\* Taken during first 30 minutes of storm event

\*\* Flow-weighted composite sample

**Attachment:** N/A

## Item 6. Storm Event Data (Instructions, Page 93)

Provide the following data for the storm event(s) which resulted in the maximum values for the analytical data submitted:

Date of storm event: N/A

Duration of storm event (minutes): N/A

Total rainfall during storm event (inches): N/A

Number of hours the between beginning of the storm measured and the end of the previous measurable storm event (hours): N/A

Maximum flow rate during rain event (gallons/minute): N/A

Total stormwater flow from rain event (gallons): N/A

Provide a description of the method of flow measurement or estimate:

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.0: COOLING WATER SYSTEM INFORMATION

This worksheet is **required** for all TPDES permit applications that meet the conditions outlined in Technical Report 1.0, Item 12.

### Item 1. Cooling Water System Data (Instructions, Page 104)

a. Complete the following table with information regarding the cooling water system.

**Cooling Water System Data**

Parameter	Volume (include units)
Total DIF	357 MGD
Total AIF	147.13 MGD
Intake Flow Use(s) (%)	
Contact cooling	0.01
Non-contact cooling	99.9
Process Wastewater	0
Other	0

b. Attach the following information:

1. A narrative description of the design and annual operation of the facility's cooling water system and its relationship to the CWIS(s).
2. A scaled map depicting the location of each CWIS, impoundment, intake pipe, and canals, pipes, or waterways used to convey cooling water to, or within, the cooling water system. Provide the latitude and longitude for each CWIS and any intake pipe(s) on the map. Indicate the position of the intake pipe within the water column.
3. A description of water reuse activities, if applicable, reductions in total water withdrawals, if applicable, and the proportion of the source waterbody withdrawn (on a monthly basis).
4. Design and engineering calculations prepared by a qualified professional and data to support the information provided in above item a.
5. Previous year (a minimum of 12 months) of AIF data.
6. A narrative description of existing or proposed impingement and entrainment technologies or operation measures and a summary of their performance, including, but not limited to, reductions in impingement mortality and entrainment due to intake location and reductions in total water withdrawals and usage.

**Attachment:** **TR-5**

## Item 2. Cooling Water Intake Structure(s) Data (Instructions, Page 105)

- a. Complete the following table with information regarding each cooling water intake structure (this includes primary and make-up CWIS(s)).

**Cooling Water Intake Structure(s) Data**

CWIS ID	Primary (Once-through)	Make-up (none)		
DIF (include units)	357 MGD	N/A		
AIF (include units)	148.1722	N/A		
Intake Flow Use(s) (%)				
Contact cooling	0.01	N/A		
Non-contact cooling	99.9	N/A		
Process Wastewater	0	N/A		
Other	0	N/A		
Latitude (decimal degrees)	33.065381	N/A		
Longitude (decimal degrees)	96.453139	N/A		

- b. Attach the following information regarding the CWIS(s):
1. A narrative description of the configuration of each CWIS, annual and daily operation, including any seasonal changes, and where it is located in the water body and in the water column.
  2. Engineering calculations for each CWIS.

Attachment: **TR-6**

## Item 3. Source Water Physical Data (Instructions, Page 105)

- a. Complete the following table with information regarding the CWIS(s) source waterbody (this includes primary and make-up CWIS(s)).

**Source Waterbody Data**

CWIS ID	Primary (Once-through)			
Source Waterbody	Lake Lavon			
Mean Annual Flow	Surface area: 20,559 acres  Storage capacity:			

CWIS ID	Primary (Once-through)			
Source Waterbody	Lake Lavon			
	409,360 acre-feet  Watershed size: 770 square miles			
Source	Texas Water Development Board			

b. Attach the following information regarding the source waterbody.

1. A narrative description of the source water for each CWIS, including areal dimensions, depths, salinity and temperature regimes, and other documentation that supports this determination of the water body type where each cooling water intake structure is located.
2. A narrative description of the source waterbody's hydrological and geomorphological features.
3. Scaled drawings showing the physical configuration of all source water bodies used by the facility, including the source waterbody's hydrological and geomorphological features. **NOTE:** The source waterbody's hydrological and geomorphological features may be included on the map submitted for item 1.b.ii of this worksheet.
4. A description of the methods used to conduct any physical studies to determine the intake's area of influence within the waterbody and the results of such studies.

Attachment: **TR-7**

## Item 4. Operational Status (Instructions, Page 106)

a. Is this application for a power production or steam generation facility?

☒ Yes    ☐ No

If **no**, proceed to Item 4.b. If **yes**, provide the following information as an attachment:

1. Describe the operating status of each individual unit, including age, capacity utilization rate (or equivalent) for the previous five years (a minimum of 60 months), and any seasonal changes in operation.
2. Describe any extended or unusual outages or other factors which significantly affect current data for flow, impingement, entrainment.
3. Identify any operating unit with a capacity utilization rate of less than 8 percent averaged over a contiguous period of two years (a minimum of 24 months).
4. Describe any major upgrades completed within the last 15 years, including but not limited to boiler replacement, condenser replacement, turbine replacement, or changes

of fuel type.

**Attachment:** TR-8

b. Process Units

1. Is this application for a facility which has process units that use cooling water (other than for power production or steam generation)?

☐ Yes      ☒ No

If **no**, proceed to Item 4.c. If **yes**, continue.

2. Does the facility use or intend to use reductions in flow or changes in operations to meet the requirements of *40 CFR § 125.94(c)*?

☐ Yes      ☐ No

If **no**, proceed to Item 4.c. If **yes**, attach descriptions of the following information:

- Individual production processes and product lines
- The operating status, including age of each line and seasonal operation
- Any extended or unusual outages that significantly affect current data for flow, impingement, entrainment, or other factors
- Any major upgrades completed within the last 15 years and plans or schedules for decommissioning or replacement of process units or production processes and product lines.

**Attachment:** N/A

c. Is this an application for a nuclear power production facility?

☐ Yes      ☒ No

If **no**, proceed to Item 4.d. If **yes**, attach a description of completed, approved, or scheduled upgrades and the Nuclear Regulatory Commission relicensing status for each unit at the facility.

**Attachment:** N/A

d. Is this an application for a manufacturing facility?

☐ Yes      ☒ No

If **no**, proceed to Worksheet 11.1. If **yes**, attach descriptions of current and future production schedules and any plans or schedules for any new units planned within the next five years (a minimum of 60 mos)

**Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.1: IMPINGEMENT MORTALITY

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** individual CWIS the facility uses or proposes to use.

CWIS ID: Primary

### Item 1. Impingement Compliance Technology Selection (Instructions, Page 107)

Check the box next to the method of compliance for the Impingement Mortality Standard selected by the facility.

- ☐ Closed-cycle recirculating system (CCRS) [40 CFR § 125.94(c)(1)]
- ☐ 0.5 ft/s Through-Screen Design Velocity [40 CFR § 125.94(c)(2)] – Proceed to Worksheet 11.2
- ☐ 0.5 ft/s Through Screen Actual Velocity [40 CFR § 125.94(c)(3)]
- ☐ Existing offshore velocity cap [40 CFR § 125.94(c)(4)] – Proceed to Worksheet 11.2
- ☐ Modified traveling screens [40 CFR § 125.94(c)(5)]
- ☐ System of technologies [40 CFR § 125.94(c)(6)]
- ☐ Impingement mortality performance standard [40 CFR § 125.94(c)(7)]
- ☒ De minimis rate of impingement [40 CFR § 125.94(c)(11)]
- ☒ Low capacity utilization power-generation facilities [40 CFR § 125.94(c)(12)]

If 0.5 ft/s Through-Screen Design Velocity [40 CFR § 125.94(c)(2)] or existing offshore velocity cap [40 CFR § 125.94(c)(4)] was selected, proceed to Worksheet 11.2. Otherwise, continue to Item 2.

### Item 2. Impingement Compliance Technology Information (Instructions, Page 107)

Complete the following sections based on the selection made for item 1 above.

a. CCRS [40 CFR § 125.94(c)(1)]

- ☐ Check this box to confirm the CWS meets the definition of CCRS located at 40 CFR § 125.91(c) and provide a response to the following questions.

1. Does the facility use or propose to use a CWIS to replenish water losses to the CWS?

- ☐ Yes      ☐ No

If **no**, proceed to item a.2. If **yes**, provide the following information as an attachment and continue.

- CWIS ID
- 12 months of intake flow data for any CWIS used for make-up intake flows to replenish cooling water losses, excluding intakes for losses due to blowdown, drift, or evaporation.



- A narrative description of any physical or operational measures taken to minimize make-up withdraws.

**Attachment:** N/A

**NOTE:** Do not complete a separate Worksheet 11.1 for a make-up CWIS.

2. Does the facility use or propose to use cooling towers?

☐ Yes      ☐ No

If **no**, proceed to Worksheet 11.2. If **yes**, provide the following information and proceed to Worksheet 11.2.

- Average number of cycles of concentration (COCs) prior to blowdown:

**Average COCs Prior to Blowdown**

Cooling Tower ID				
COCs				

- Attach COC monitoring data for each cooling tower from the previous year (a minimum of 12 months): N/A
- Maximum number of COCs each cooling tower can accomplish based on design of the system.

**Calculated COCs Prior to Blowdown**

Cooling Tower ID				
COCs				

- Describe conditions that may limit the number of COCs prior to blowdown, if any, including but not limited to permit conditions: N/A

b. 0.5 ft/s Through Screen Actual Velocity [40 CFR § 125.94(c)(3)]

Provide daily intake flow measurement monitoring data from the previous year (a minimum of 12 months) as an attachment and proceed to Worksheet 11.2.

**Attachment:** N/A

c. Modified traveling screens [40 CFR § 125.94(c)(5)]

Provide the following information as an attachment and proceed to Worksheet 11.2.

1. A description of the modified traveling screens and associated equipment.
2. A site-specific impingement technology performance optimization study that includes a narrative description of the biological data collection methods
3. Biological sampling data from the previous two years (a minimum of 24 months).

**Attachment:** N/A

d. System of technologies [40 CFR § 125.94(c)(6)] or impingement mortality performance standard [40 CFR § 125.94(c)(7)]

Provide the following information as an attachment and proceed to Worksheet 11.2.

1. A description of the system of technologies used or proposed for use by the facility to

achieve compliance with the impingement mortality standard.

2. A site-specific impingement technology performance optimization study that includes a narrative description of the biological data collection methods.
3. Biological sampling data from the previous two years (a minimum of 24 months).

**Attachment:** N/A

- e. De minimis rate of impingement [*40 CFR § 125.94(c)(11)*]

Provide the following information and proceed to Worksheet 11.2.

1. Attach monitoring data from the previous year (a minimum of 12 months) of intake flow measured at a frequency of 1/day on days of operation.

**Attachment:** TR-5 (Table 4)

2. If the rate of impingement caused by the CWIS is extremely low (at an organism or age-one equivalent count), attach supplemental information to Worksheet 11.0, item 1.b.6. to support this determination.

**Attachment:** TR-5 (Item 6)

- f. Low capacity utilization power-generation facilities [*40 CFR § 125.94(c)(12)*]

Attach monthly utilization data from the previous 2 years (a minimum of 24 months) for each operating unit and proceed to Worksheet 11.2.

**Attachment:** TR-8

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.2: SOURCE WATER BIOLOGICAL DATA

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** source waterbody of a CWIS for which a facility has selected an Impingement Mortality Technology Option described at *40 CFR §§ 125.94(c)(1)-(7)*.

Name of source waterbody: Lake Lavon

### Item 1. Species Management (Instructions, Page 109)

- a. The facility has obtained an incidental take permit for its cooling water intake structure(s) from the USFWS or the NMFS.

☐ Yes ☒ No

If yes, attach any information submitted in order to obtain that permit, which may be used to supplement the permit application information requirements of paragraph *40 CFR § 125.95(f)*.

**Attachment:** N/A

- b. Is the facility requesting a waiver from application requirements at *40 CFR § 122.21(r)(4)* in accordance with *40 CFR § 125.95* for any CWIS(s) that withdraw from a man-made reservoir that is stocked and managed by a state or federal natural resources agency or the equivalent?

☒ Yes ☐ No

If **yes**, attach a copy of the most recent managed fisheries report to TPWD, or equivalent.

**Attachment:** TR-9

- c. There are no federally listed threatened or endangered species or critical habitat designations within the source water body.

☒ True ☐ False

### Item 2. Source Water Biological Data (Instructions, Page 109)

New Facilities (Phase I, Track I and II)

- Provide responses to all items in this section and stop.

Existing Facilities (Phase II)

- If the answer to **1.b.** above was **no**, provide responses to all items in this section and proceed to Worksheet 11.3.
- If the answer to **1.b.** was **yes** and **1.c.** was **true**, do not complete any items in this section and proceed to Worksheet 11.3.
- If the answer to **1.b.** was **yes** and **1.c.** was **false**, attach a response for any item in this section that is not contained within the most recent TPWD, or equivalent and proceed to Worksheet 11.3.

**Attachment:** N/A

- a. A list of the data requested at *40 CFR § 122.21(r)(4)(ii)* through (vi) that are not available, and efforts made to identify sources of the data.
- b. Provide a list of species (or relevant taxa) in the vicinity of the CWIS and identify the following information regarding each species listed.
  - all life stages and their relative abundance,
  - identification of all species and life stages that would be most susceptible to impingement and entrainment,
  - forage base,
  - significance to commercial fisheries,
  - significance to recreational fisheries,
  - primary period of reproduction,
  - larval recruitment, and
  - period of peak abundance for relevant taxa.
- c. Data representative of the seasonal and daily activities (e.g., feeding and water column migration) of biological organisms in the vicinity of the CWIS(s).
- d. Identify all threatened, endangered, and other protected species that might be susceptible to impingement and entrainment at the CWIS(s).
- e. Documentation of any public participation or consultation with federal or state agencies undertaken.

The following is required for existing facilities only. Include the following information with the above listed attachment.

- f. Identify any protective measures and stabilization activities that have been implemented and provide a description of how these measures and activities affected the baseline water condition in the vicinity of the intake.
- g. A list of fragile species, as defined at *40 CFR § 125.92(m)*, at the facility. The applicant need only identify those species not already identified as fragile at *40 CFR § 125.92(m)*.

**NOTE:** New units at an existing facility are not required to resubmit this information if the cooling water withdrawals for the operation of the new unit are from an existing intake.

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.3: ENTRAINMENT

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** individual CWIS the facility uses or proposes to use.

CWIS ID: Primary

### Item 1. Applicability (Instructions, Page 111)

Is the AIF of the CWIS identified above greater than, or equal to, 125 MGD?

☒ Yes ☐ No

- If **no** or the facility has selected **CCRS** [40 CFR § 125.94(c)(1)] for the impingement mortality compliance method, complete Item 2 and stop here.
- If **yes** and the facility is **seeking a waiver** from application requirements in accordance with 40 CFR § 125.95 for any CWIS(s) that withdraw from a man-made reservoir that is stocked and managed by a state or federal natural resources agency or the equivalent, complete item 2 and stop.
- If **yes** and the facility is **not seeking a waiver** from application requirements in accordance with 40 CFR § 125.95, complete item 2 and provide any required and completed studies listed in item 3. For any required studies in item 3 that are not complete, provide a detailed explanation for the delay and an anticipated schedule for completion and submittal.

### Item 2. Existing Entrainment Performance Studies (Instructions, Page 111)

Attach any previously conducted studies or studies obtained from other facilities addressing technology efficacy, through-facility entrainment survival, and other entrainment studies.

Attachment: TR-10

### Item 3. Facility Entrainment Performance Studies (Instructions, Page 111)

- Attach an entrainment characterization study, as described at 40 CFR § 122.21(r)(9): N/A
- Attach a comprehensive feasibility study, as described as 40 CFR § 122.21(r)(10): N/A
- Attach a benefits valuation study, as described as 40 CFR § 122.21(r)(11): N/A
- Attach a non-water quality environmental and other impacts study, as described as 40 CFR § 122.21(r)(12): N/A
- Attach a peer review analysis, as described as 40 CFR § 122.21(r)(13): N/A

# **ATTACHMENT AR-1**

Core Data Form



# TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

## SECTION I: General Information

<b>1. Reason for Submission</b> (If other is checked please describe in space provided.)		
<input type="checkbox"/> New Permit, Registration or Authorization (Core Data Form should be submitted with the program application.)		
<input checked="" type="checkbox"/> Renewal (Core Data Form should be submitted with the renewal form)		<input type="checkbox"/> Other
<b>2. Customer Reference Number</b> (if issued)	<a href="#">Follow this link to search for CN or RN numbers in Central Registry**</a>	<b>3. Regulated Entity Reference Number</b> (if issued)
CN 600130140		RN 100219203

## SECTION II: Customer Information

<b>4. General Customer Information</b>		<b>5. Effective Date for Customer Information Updates</b> (mm/dd/yyyy)		7/31/2024	
<input type="checkbox"/> New Customer <input checked="" type="checkbox"/> Update to Customer Information <input type="checkbox"/> Change in Regulated Entity Ownership					
<input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)					
<i>The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).</i>					
<b>6. Customer Legal Name</b> (If an individual, print last name first: eg: Doe, John)				<i>If new Customer, enter previous Customer below:</i>	
City of Garland Power & Light					
<b>7. TX SOS/CPA Filing Number</b>		<b>8. TX State Tax ID</b> (11 digits)		<b>9. Federal Tax ID</b> (9 digits)	<b>10. DUNS Number</b> (if applicable)
<b>11. Type of Customer:</b>		<input type="checkbox"/> Corporation		<input type="checkbox"/> Individual	Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited
Government: <input checked="" type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> Local <input type="checkbox"/> State <input type="checkbox"/> Other		<input type="checkbox"/> Sole Proprietorship		<input type="checkbox"/> Other:	
<b>12. Number of Employees</b>				<b>13. Independently Owned and Operated?</b>	
<input type="checkbox"/> 0-20 <input type="checkbox"/> 21-100 <input type="checkbox"/> 101-250 <input checked="" type="checkbox"/> 251-500 <input type="checkbox"/> 501 and higher				<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
<b>14. Customer Role</b> (Proposed or Actual) – as it relates to the Regulated Entity listed on this form. Please check one of the following					
<input type="checkbox"/> Owner <input type="checkbox"/> Operator <input checked="" type="checkbox"/> Owner & Operator <input type="checkbox"/> Other:					
<input type="checkbox"/> Occupational Licensee <input type="checkbox"/> Responsible Party <input type="checkbox"/> VCP/BSA Applicant					
<b>15. Mailing Address:</b>		13835 County Rd. 489			
City		Nevada		State	TX
ZIP		75173		ZIP + 4	
<b>16. Country Mailing Information</b> (if outside USA)				<b>17. E-Mail Address</b> (if applicable)	
<b>18. Telephone Number</b>		<b>19. Extension or Code</b>		<b>20. Fax Number</b> (if applicable)	

**SECTION III: Regulated Entity Information**

<b>21. General Regulated Entity Information</b> (If 'New Regulated Entity' is selected, a new permit application is also required.)							
<input type="checkbox"/> New Regulated Entity <input type="checkbox"/> Update to Regulated Entity Name <input checked="" type="checkbox"/> Update to Regulated Entity Information							
<i>The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).</i>							
<b>22. Regulated Entity Name</b> (Enter name of the site where the regulated action is taking place.)							
Garland Municipal Power - Ray Olinger Plant							
<b>23. Street Address of the Regulated Entity:</b>  (No PO Boxes)	13835 County Rd. 489						
	City	Nevada	State	TX	ZIP	75173	ZIP + 4
<b>24. County</b>	Collin						

If no Street Address is provided, fields 25-28 are required.

<b>25. Description to Physical Location:</b>							
<b>26. Nearest City</b>				<b>State</b>		<b>Nearest ZIP Code</b>	
Nevada				TX		75173	
<i>Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).</i>							
<b>27. Latitude (N) In Decimal:</b>		33.068056		<b>28. Longitude (W) In Decimal:</b>		-96.452500	
Degrees	Minutes	Seconds		Degrees	Minutes	Seconds	
33	04	05		-96	27	09	
<b>29. Primary SIC Code</b> (4 digits)		<b>30. Secondary SIC Code</b> (4 digits)		<b>31. Primary NAICS Code</b> (5 or 6 digits)		<b>32. Secondary NAICS Code</b> (5 or 6 digits)	
4911							
<b>33. What is the Primary Business of this entity?</b> (Do not repeat the SIC or NAICS description.)							
Electric Power Plant							
<b>34. Mailing Address:</b>	13835 County Rd.						
	City	Nevada	State	TX	ZIP	75173	ZIP + 4
<b>35. E-Mail Address:</b>		MBurr@gpltexas.org					
<b>36. Telephone Number</b>				<b>37. Extension or Code</b>		<b>38. Fax Number</b> (if applicable)	
( 972 ) 205-2650						( ) -	

**39. TCEQ Programs and ID Numbers** Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.



<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input type="checkbox"/> Edwards Aquifer	<input checked="" type="checkbox"/> Emissions Inventory Air	<input checked="" type="checkbox"/> Industrial Hazardous Waste
			CP0026M	TXP490355593
<input type="checkbox"/> Municipal Solid Waste	<input checked="" type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input checked="" type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
	PSDTX935		59661	
<input type="checkbox"/> Sludge	<input checked="" type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
	TXR05AX97			
<input type="checkbox"/> Voluntary Cleanup	<input checked="" type="checkbox"/> Wastewater	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:
	WQ0001923000			

## **SECTION IV: Preparer Information**

<b>40. Name:</b>	Cassandra Villarreal	<b>41. Title:</b>	Environmental Scientist
<b>42. Telephone Number</b>	<b>43. Ext./Code</b>	<b>44. Fax Number</b>	<b>45. E-Mail Address</b>
( 817 ) 735-7294		( 817 ) 735-7492	cassandra.villarreal@freese.com

## **SECTION V: Authorized Signature**

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

<b>Company:</b>	Freese and Nichols, Inc.	<b>Job Title:</b>	Environmental Scientist
<b>Name (In Print):</b>	Katie Leatherwood	<b>Phone:</b>	( 817 ) 735- 7503
<b>Signature:</b>		<b>Date:</b>	

## **ATTACHMENT AR-2**

### Plain Language Summary



## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

### PLAIN LANGUAGE SUMMARY FOR TPDES OR TLAP PERMIT APPLICATIONS

#### Plain Language Summary Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary as required by [Title 30, Texas Administrative Code \(30 TAC\), Chapter 39, Subchapter H](#). Applicants may modify the template as necessary to accurately describe their facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how the applicant will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements.

If you are subject to the alternative language notice requirements in [30 TAC Section 39.426](#), **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package**. For your convenience, a Spanish template has been provided below.

#### ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS **INDUSTRIAL** WASTEWATER/STORMWATER

*The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.*

The City of Garland (CN600328694), operates the Garland Municipal Power - Ray Olinger Power Plant (RN100219203), a natural gas steam electric generating facility. The facility is located at 13835 County Road 489, in Nevada, Collin County, Texas 75173.

This application is for a renewal and amendment to discharge of once-through cooling water from Units 1, 2, and 3 and stormwater at a daily average flow not to exceed 404,000,000 gallons per day via Outfall 001. This amendment is to remove Internal Outfall 101.

Discharges from the facility are expected to contain chlorine. Additional pollutants are included in Worksheet 2.0 of the permit application package. Industrial wastewater is treated by using sodium hyperchlorate at the intake for algae control, and the circulating water is used for condenser cooling. Ammonia bisulfate is used for dechlorination at the condenser outlet to limit the chlorine residual.

## PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

### AGUAS RESIDUALES INDUSTRIALES /AGUAS PLUVIALES

*El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.*

La ciudad de Garland (CN600328694) opera la planta eléctrica Garland Municipal Power - Ray Olinger (RN100219203), una instalación de generación de electricidad a vapor con gas natural. La instalación está ubicada en 13835 County Road 489, en Nevada, Condado de Collin, Texas 75173.

Esta solicitud es para una renovación y enmienda a la descarga de agua de enfriamiento de un solo paso de las Unidades 1, 2 y 3 y aguas pluviales con un flujo promedio diario que no exceda los 404,000,000 galones por día a través del Emisario 001. Esta enmienda es para eliminar el Emisario Interno 101.

Se espera que las descargas de la instalación contengan cloro. Se incluyen contaminantes adicionales en la Hoja de trabajo 2.0 del paquete de solicitud de permiso. Las aguas residuales industriales se tratan utilizando hipoclorato de sodio en la entrada para controlar las algas y el agua en circulación se utiliza para enfriar el condensador. El bisulfato de amoníaco se utiliza para la dicloración en la salida del condensador para limitar el cloro residual.

### INSTRUCTIONS

1. Enter the name of applicant in this section. The applicant name should match the name associated with the customer number.
2. Enter the Customer Number in this section. Each Individual or Organization is issued a unique 11-digit identification number called a CN (e.g. CN123456789).
3. Choose "operates" in this section for existing facility applications or choose "proposes to operate" for new facility applications.
4. Enter the name of the facility in this section. The facility name should match the name associated with the regulated entity number.
5. Enter the Regulated Entity number in this section. Each site location is issued a unique 11-digit identification number called an RN (e.g. RN123456789).
6. Choose the appropriate article (a or an) to complete the sentence.
7. Enter a description of the facility in this section. For example: steam electric generating facility, nitrogenous fertilizer manufacturing facility, etc.
8. Choose "is" for an existing facility or "will be" for a new facility.
9. Enter the location of the facility in this section.
10. Enter the City nearest the facility in this section.

11. Enter the County nearest the facility in this section.
12. Enter the zip code for the facility address in this section.
13. Enter a summary of the application request in this section. For example: renewal to discharge 25,000 gallons per day of treated domestic wastewater, new application to discharge process wastewater and stormwater on an intermittent and flow-variable basis, or major amendment to reduce monitoring frequency for pH, etc. If more than one outfall is included in the application, provide applicable information for each individual outfall.
14. List all pollutants expected in the discharge from this facility in this section. If applicable, refer to the pollutants from any federal numeric effluent limitations that apply to your facility.
15. Enter the discharge types from your facility in this section (e.g., stormwater, process wastewater, once through cooling water, etc.)
16. Choose the appropriate verb tense to complete the sentence.
17. Enter a description of the wastewater treatment used at your facility. Include a description of each process, starting with initial treatment and finishing with the outfall/point of disposal. Use additional lines for individual discharge types if necessary.

Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at [WO-ARPTeam@tceq.texas.gov](mailto:WO-ARPTeam@tceq.texas.gov) or by phone at (512) 239-4671.

**ATTACHMENT AR-3**  
Public Involvement Plan



Texas Commission on Environmental Quality

## Public Involvement Plan Form for Permit and Registration Applications

The Public Involvement Plan is intended to provide applicants and the agency with information about how public outreach will be accomplished for certain types of applications in certain geographical areas of the state. It is intended to apply to new activities; major changes at existing plants, facilities, and processes; and to activities which are likely to have significant interest from the public. This preliminary screening is designed to identify applications that will benefit from an initial assessment of the need for enhanced public outreach.

All applicable sections of this form should be completed and submitted with the permit or registration application. For instructions on how to complete this form, see TCEQ-20960-inst.

### Section 1. Preliminary Screening

- ☐ New Permit or Registration Application  
☒ New Activity – modification, registration, amendment, facility, etc. (see instructions)

**If neither of the above boxes are checked, completion of the form is not required and does not need to be submitted.**

### Section 2. Secondary Screening

- ☒ Requires public notice,  
☐ Considered to have significant public interest, and  
☒ Located within any of the following geographical locations:

- Austin
- Dallas
- Fort Worth
- Houston
- San Antonio
- West Texas
- Texas Panhandle
- Along the Texas/Mexico Border
- Other geographical locations should be decided on a case-by-case basis

**If all the above boxes are not checked, a Public Involvement Plan is not necessary.  
Stop after Section 2 and submit the form.**

- ☒ Public Involvement Plan not applicable to this application. Provide **brief** explanation.

This permit has not had significant public interest in the last permit cycles. Therefore, the remaining sections of the form are not applicable.

### Section 3. Application Information

#### Type of Application (check all that apply):

Air ☐ Initial ☐ Federal ☐ Amendment ☐ Standard Permit ☐ Title V  
Waste ☐ Municipal Solid Waste ☐ Industrial and Hazardous Waste ☐ Scrap Tire  
☐ Radioactive Material Licensing ☐ Underground Injection Control

#### Water Quality

☐ Texas Pollutant Discharge Elimination System (TPDES)  
☐ Texas Land Application Permit (TLAP)  
☐ State Only Concentrated Animal Feeding Operation (CAFO)  
☐ Water Treatment Plant Residuals Disposal Permit  
☐ Class B Biosolids Land Application Permit  
☐ Domestic Septage Land Application Registration

#### Water Rights New Permit

☐ New Appropriation of Water  
☐ New or existing reservoir

#### Amendment to an Existing Water Right

☐ Add a New Appropriation of Water  
☐ Add a New or Existing Reservoir  
☐ Major Amendment that could affect other water rights or the environment

### Section 4. Plain Language Summary

Provide a brief description of planned activities.

N/A



## Section 5. Community and Demographic Information

Community information can be found using EPA's EJ Screen, U.S. Census Bureau information, or generally available demographic tools.

**Information gathered in this section can assist with the determination of whether alternative language notice is necessary. Please provide the following information.**

(City)

(County)

(Census Tract)

Please indicate which of these three is the level used for gathering the following information.

☐

City

☐

County

☐

Census Tract

(a) Percent of people over 25 years of age who at least graduated from high school

(b) Per capita income for population near the specified location

(c) Percent of minority population and percent of population by race within the specified location

(d) Percent of Linguistically Isolated Households by language within the specified location

(e) Languages commonly spoken in area by percentage

(f) Community and/or Stakeholder Groups

(g) Historic public interest or involvement

## Section 6. Planned Public Outreach Activities

(a) Is this application subject to the public participation requirements of Title 30 Texas Administrative Code (30 TAC) Chapter 39?

☐ Yes ☐ No

(b) If yes, do you intend at this time to provide public outreach other than what is required by rule?

☐ Yes ☐ No

If Yes, please describe.

**If you answered "yes" that this application is subject to 30 TAC Chapter 39, answering the remaining questions in Section 6 is not required.**

(c) Will you provide notice of this application in alternative languages?

☐ Yes ☐ No

**Please refer to Section 5. If more than 5% of the population potentially affected by your application is Limited English Proficient, then you are required to provide notice in the alternative language.**

If yes, how will you provide notice in alternative languages?

- ☐ Publish in alternative language newspaper
- ☐ Posted on Commissioner's Integrated Database Website
- ☐ Mailed by TCEQ's Office of the Chief Clerk
- ☐ Other (specify)

(d) Is there an opportunity for some type of public meeting, including after notice?

☐ Yes ☐ No

(e) If a public meeting is held, will a translator be provided if requested?

☐ Yes ☐ No

(f) Hard copies of the application will be available at the following (check all that apply):

- ☐ TCEQ Regional Office ☐ TCEQ Central Office
- ☐ Public Place (specify)

## Section 7. Voluntary Submittal

For applicants voluntarily providing this Public Involvement Plan, who are not subject to formal public participation requirements.


Will you provide notice of this application, including notice in alternative languages?

☐ Yes ☐ No

What types of notice will be provided?

- ☐ Publish in alternative language newspaper
- ☐ Posted on Commissioner's Integrated Database Website
- ☐ Mailed by TCEQ's Office of the Chief Clerk
- ☐ Other (specify)

**ATTACHMENT AR-4**  
USGS Topographic Map

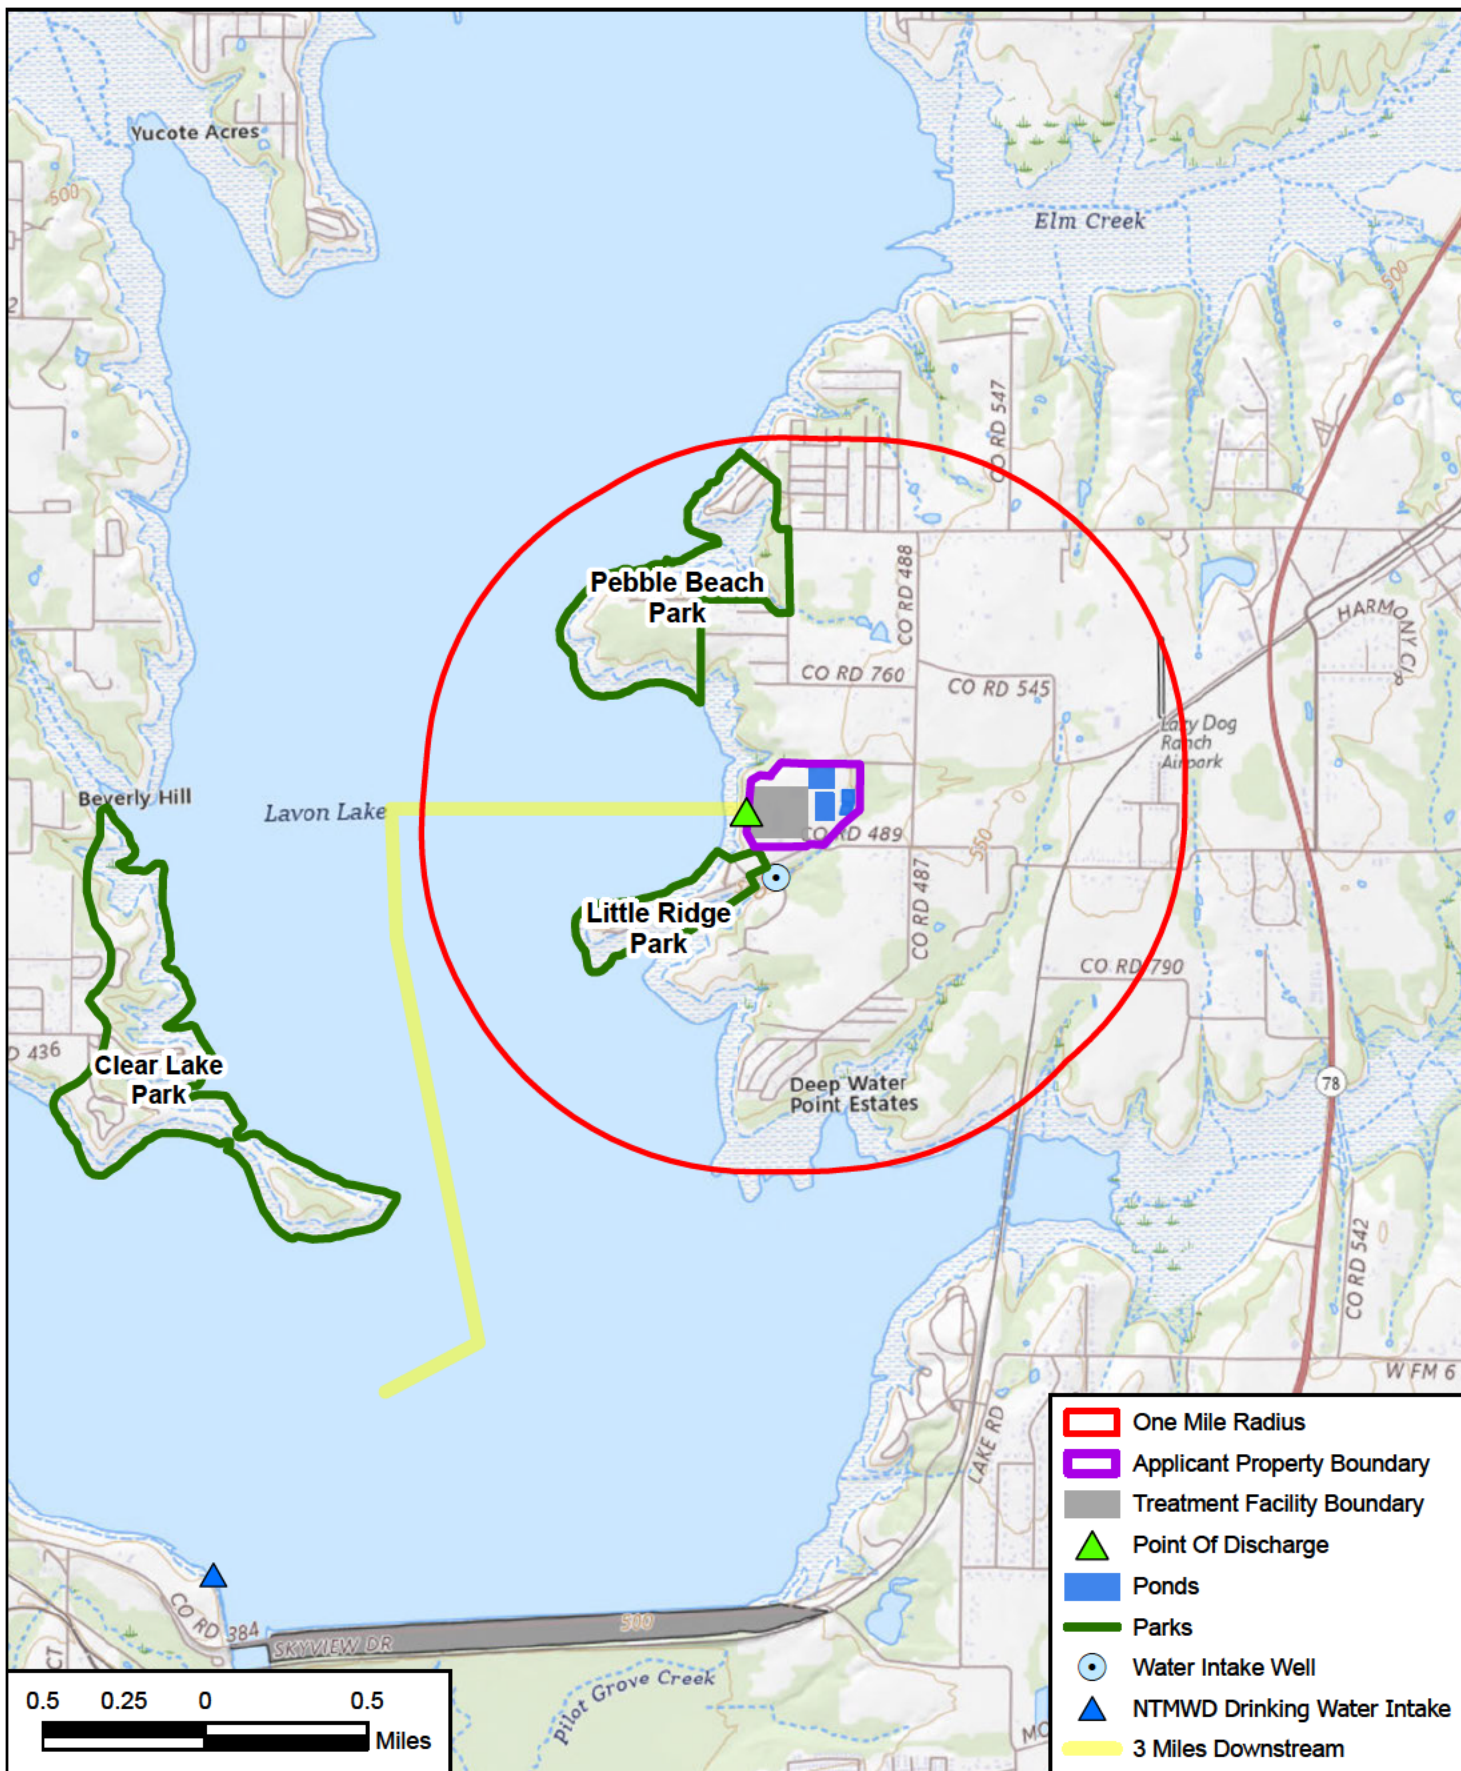


- One Mile Radius
- Applicant Property Boundary
- Treatment Facility Boundary
- ▲ Point Of Discharge
- Ponds
- Parks
- Water Intake Well
- ▲ NTMWD Drinking Water Intake
- 3 Miles Downstream

<p><b>FREASE AND NICHOLS, INC.</b> 801 Cherry Street, Suite 2800 Fort Worth, TX 76102 Phone - (817) 735 - 7300</p>		City of Garland		<div style="font-size: 2em; font-weight: bold;">1</div> <div style="font-weight: bold;">FIGURE</div>
		Ray Olinger TPDES Permit Renewal		
		USGS 7.5 Minute Quadrangle		
		FILE NAME GP&L TPDES Renewal.mxd	DATE 8/1/2024	
		SCALE 1:37,500	DESIGNED CLV	
		DRAFTED 08245		

## **ATTACHMENT AR-5**

Affected Landowners

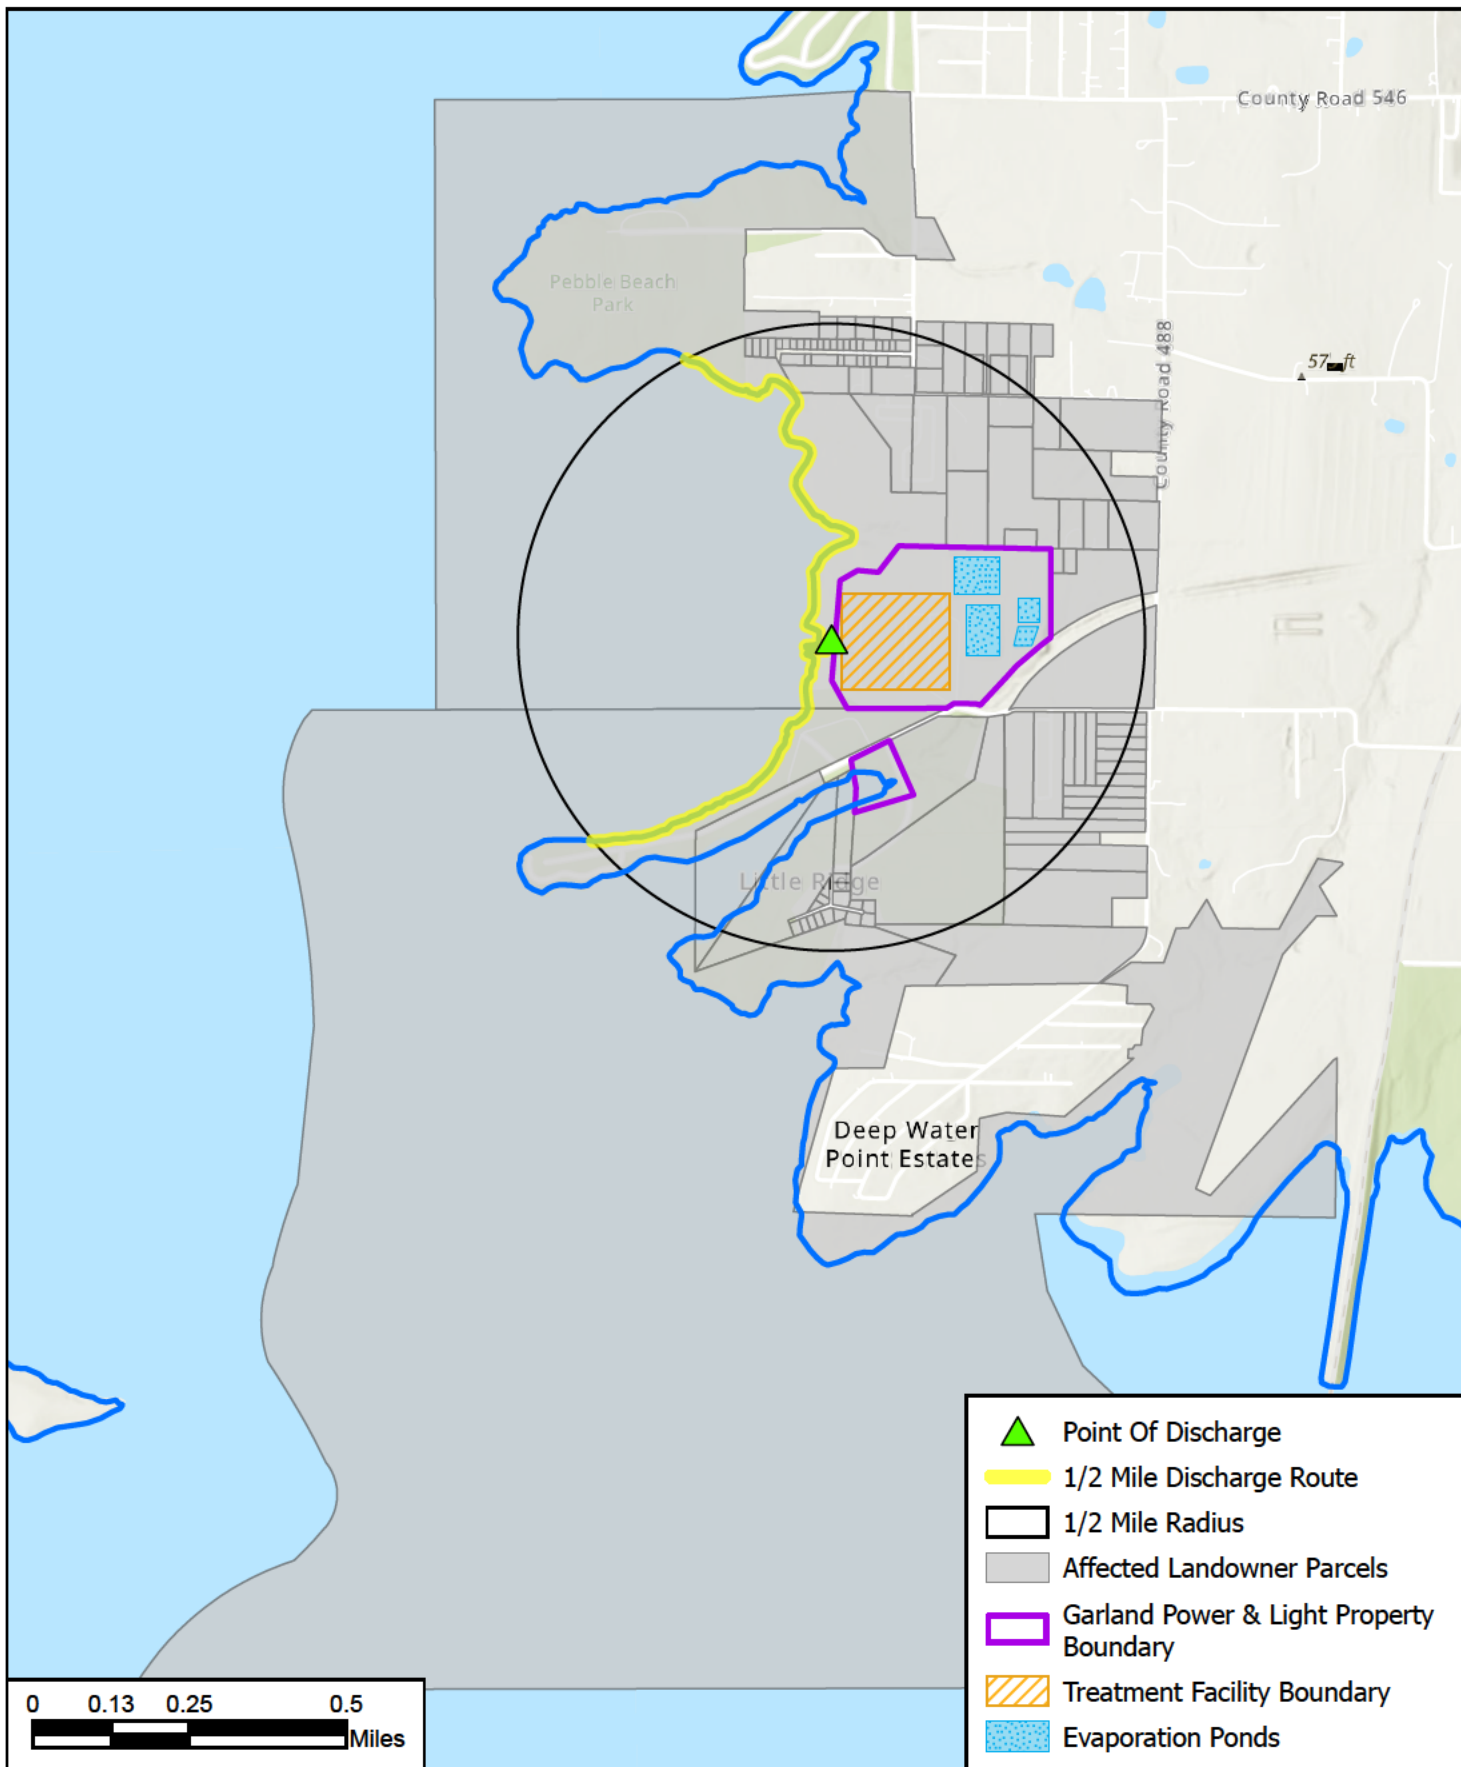

**FRESE AND NICHOLS**  
 FRESE AND NICHOLS, INC  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland


# Ray Olinger Power Plant


## Affected Landowners

PN JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	7/18/2024
SCALE	1:9,399
DESIGNED	CLV
DRAFTED	08245

**3a**  
**FIGURE**



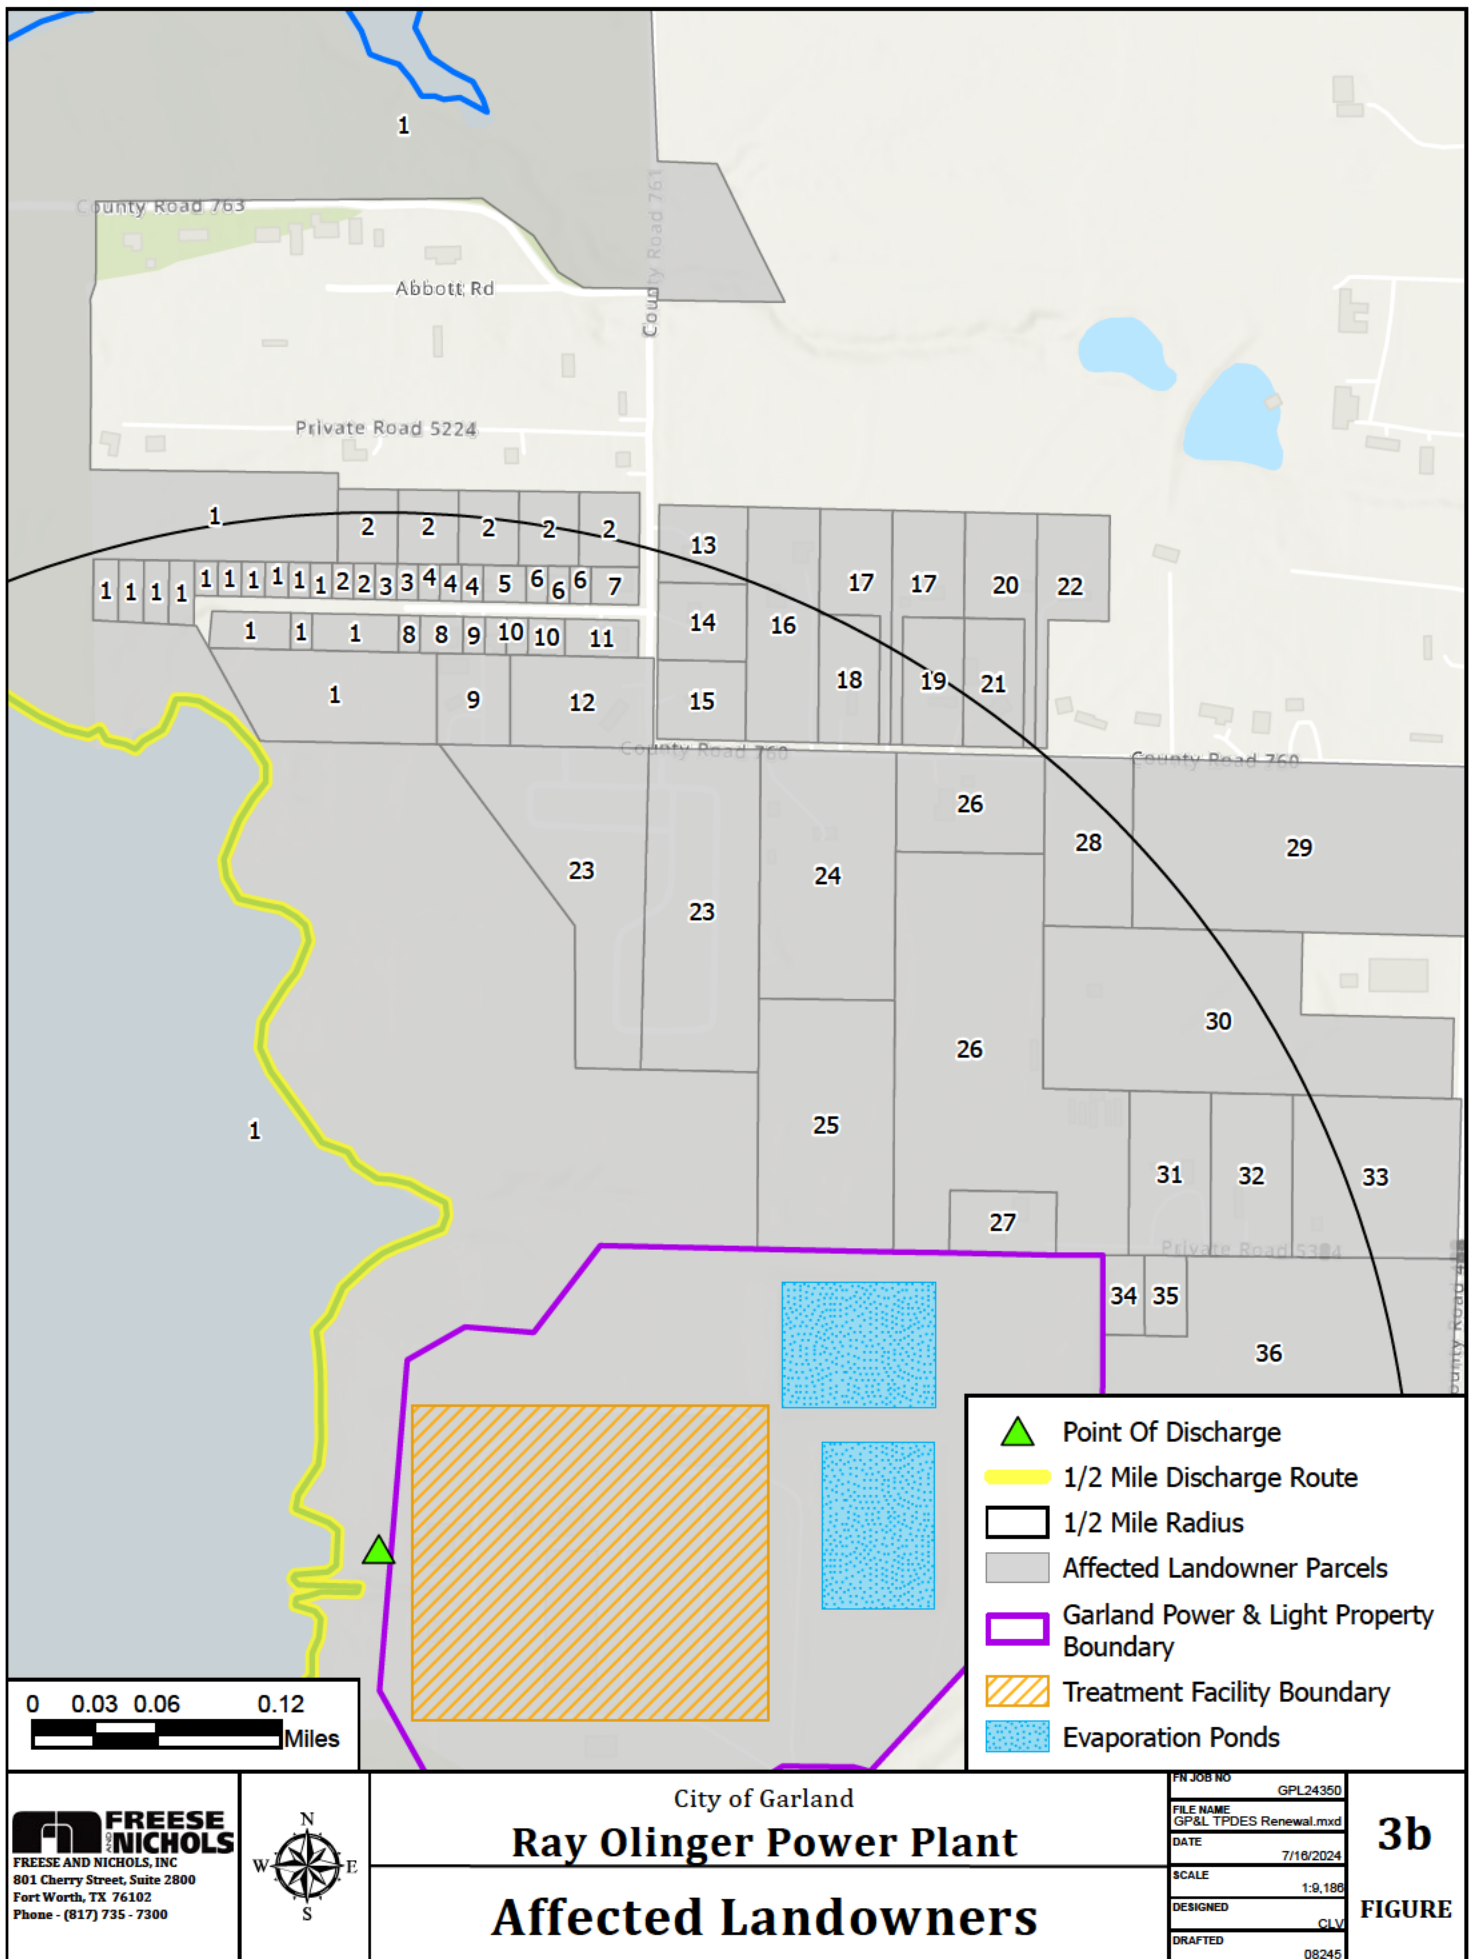

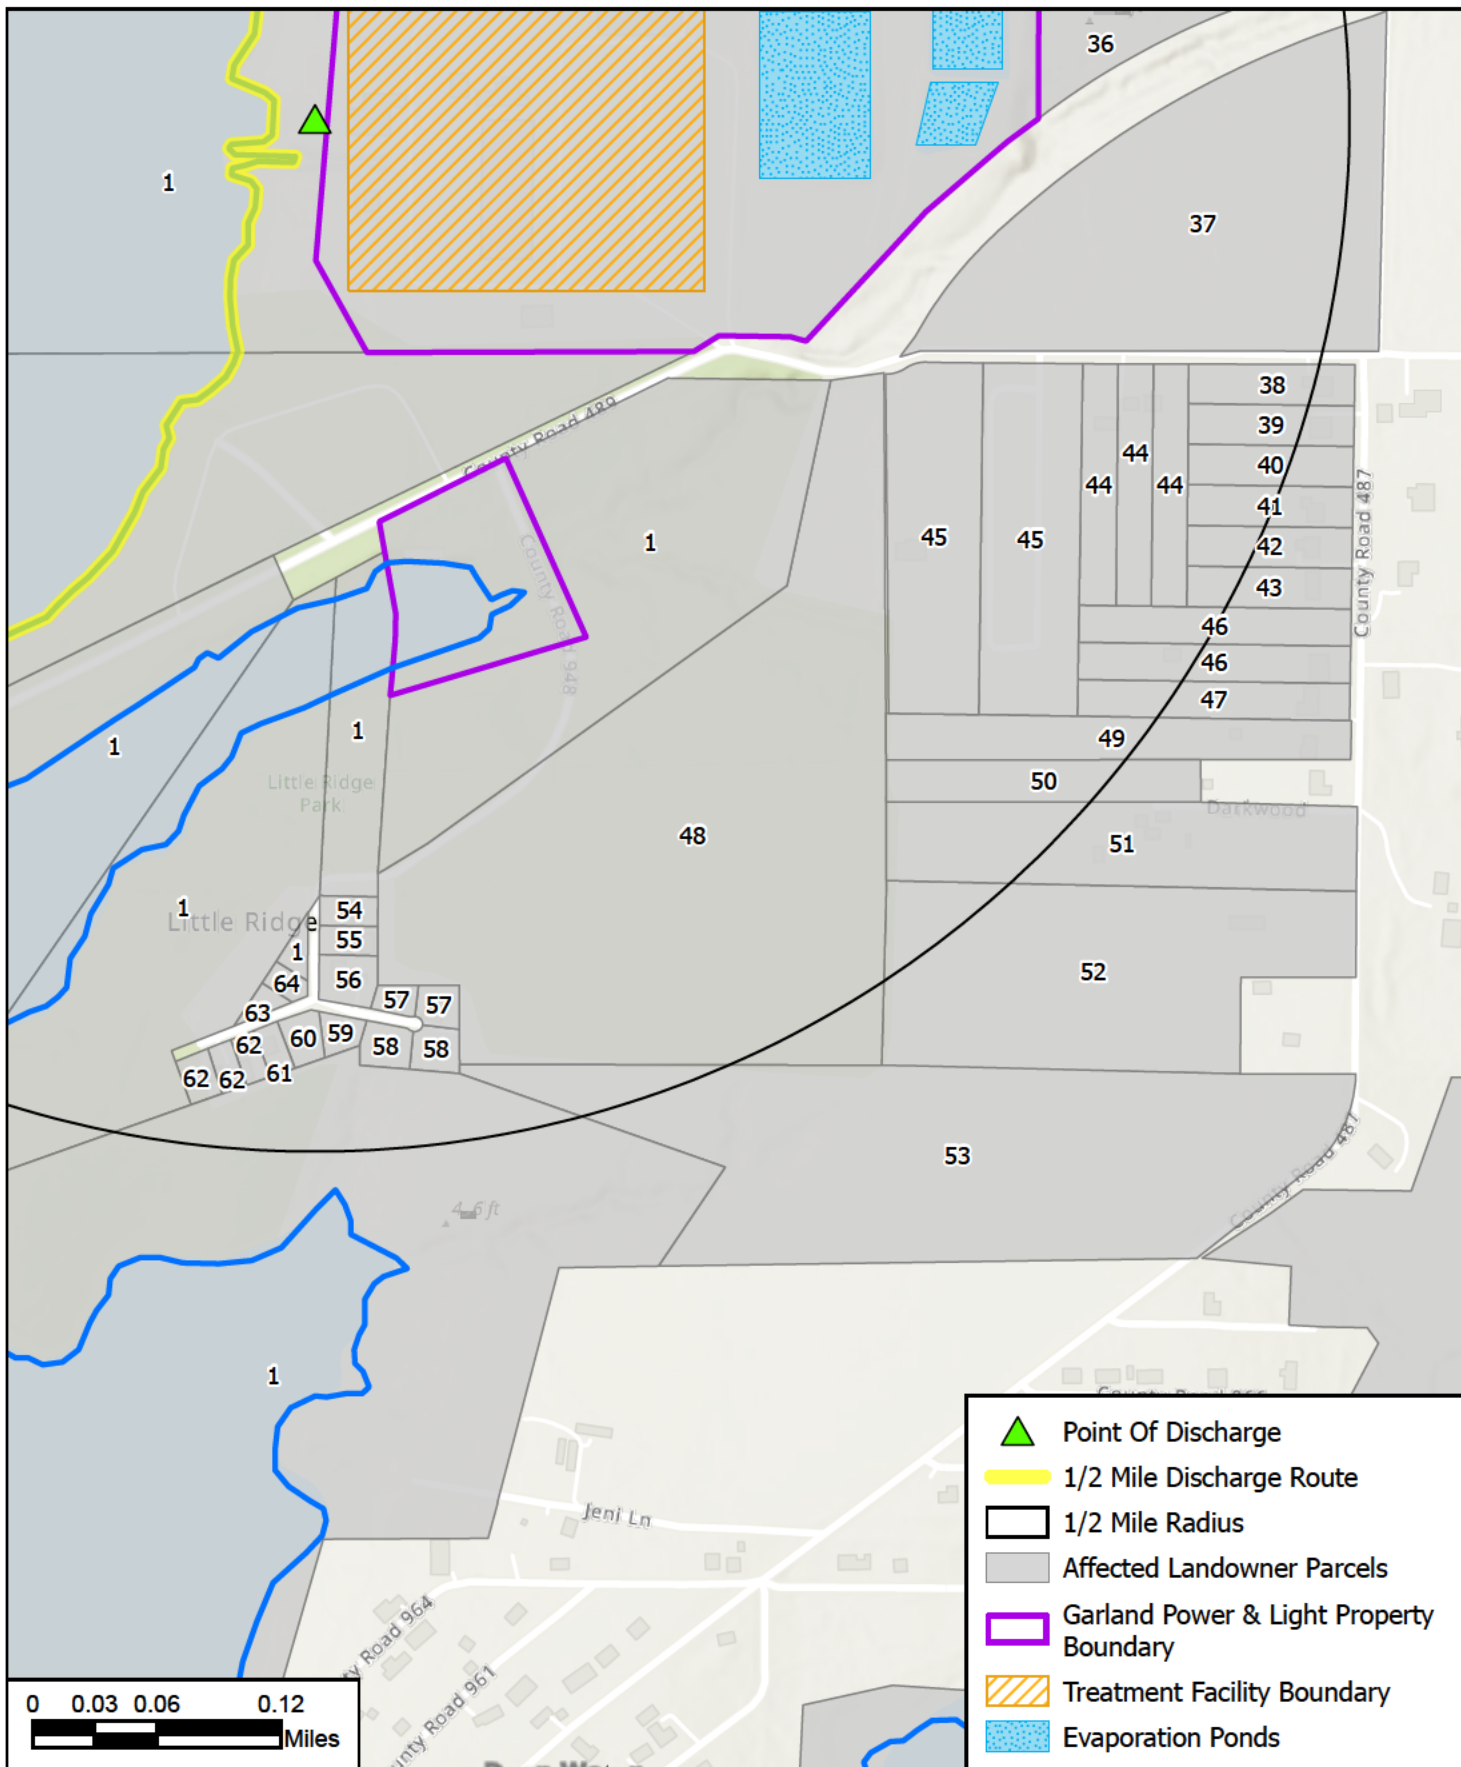

<p><b>FREES &amp; NICHOLS, INC.</b> 801 Cherry Street, Suite 2800 Fort Worth, TX 76102 Phone - (817) 735 - 7300</p>		City of Garland <b>Ray Olinger Power Plant</b> <b>Affected Landowners</b>		PN JOB NO GPL24350	<b>3c</b>  <b>FIGURE</b>
				FILE NAME GP&L TPDES Renewal.mxd	
				DATE 7/18/2024	
				SCALE 1:9,188	
				DESIGNED CLV	
				DRAFTED 08245	



## Affected Landowner Map Cross Referenced List

1	USA	13	Riggall Marvin Vale Jr & Laura 6191 County Road 761 Nevada, TX 75173-6165
2	Mcintire Robin & Shannon 6172 County Road 761 Nevada, TX 75173-6116	14	Dickeson Wayne & Freda Po Box 326 Copeville, TX 75121-0326
3	888 Ma Ltd 3324 Sandy Trail Ln Plano, TX 75023-5656	15	Iriarte Dianne D & Tyre Wade Allen 6285 County Road 761 Nevada, TX 75173-6119
4	Escalona Jose Luis Ontiveros 630 Stoneybrook Dr Wylie, TX 75098-4036	16	Bretado Rayo Elizabeth & Carlos Cruz Ruiz 13731 County Road 760 Nevada, TX 75173-6111
5	Benites Rodolfo Garcia & Herlinda Vasquez 13521 County Road 762 Nevada, TX 75173-6121	17	Rios Humberto & Maria Del Carmen Rios 13771 County Road 760 Nevada, TX 75173-6111
6	Mcguire Buddy Pierce Jr & Lawanna Ann 13539 County Road 762 Nevada, TX 75173-6121	18	Sutton James Robert & Sutton Jane Ann Po Box 5 Weston, TX 75097-0005
7	Riggall Marvin V Jr 13569 County Road 762 Nevada, TX 75173-6121	19	Wilson Marcus G Po Box 233 Copeville, TX 75121-0233
8	Karczmariski Christopher Marc 13510 County Road 762 Nevada, TX 75173-6120	20	Ramirez-Macareno Agustin Jaime & Jazmin Ramirez 13823 County Road 760 Nevada, TX 75173-6113
9	Lavonland LLC 13527 County Road 760 Nevada, TX 75173-6109	21	Pelham Troy V & Barbara 13809 County Road 760 Nevada, TX 75173-6113
10	Dauksavage-DeLoach Sonja & Billy Joe Dauksavage 13540 County Road 762 Nevada, TX 75173-6120	22	Flores Lazaro & Sulema 13849 County Road 760 Nevada, TX 75173-6113
11	Mcintire Legacy Trust 6172 County Road 761 Nevada, TX 75173-6116	23	Fritts Enterprises Inc 1322 Briar Hollow Ln Garland, TX 75043-1614
12	Huang Doris 3936 Dalston Ln Plano, TX 75023-1027	24	Emery Jody J 13700 County Road 760 Nevada, TX 75173-6110

25	Fritts James C DbA Crossed Palms Rv Resort 1322 Briar Hollow Ln Garland, TX 75043-1614	38	Orr Rebecca Kathleen & Michael Alan Parks 14128 County Road 489 Nevada, TX 75173-6038
26	Stone Rose Properties LLC Po Box 92341 Southlake, TX 76092-0135	39	Choctaw American Insurance Inc 10900 Ne 4Th St Ste 2300 Bellevue, WA 98004-5882
27	Proctor A O Po Box 3 Copeville, TX 75121-0003	40	Munroe Patricia 6782 County Road 487 Nevada, TX 75173-6088
28	Arteaga Felix Jose Jr 13888 County Road 760 Nevada, TX 75173-6138	41	Bryant Matthew & Lisa Bryant 6800 County Road 487 Nevada, TX 75173-6026
29	Arteaga Felix Jose & Marbella 6310 County Road 488 Nevada, TX 75173-6355	42	Moody Christopher & Crystal Dawn Moody 6822 County Road 487 Nevada, TX 75173-6026
30	Turner Rocky 6364 County Road 488 Nevada, TX 75173-6355	43	Aquatero John Po Box 336 Lavon, TX 75166-0336
31	Small Michael & Jessica Po Box 226 Copeville, TX 75121-0226	44	Burnett Julianna 3321 Carriage Ct Richardson, TX 75082-3663
32	Boughner Tamara Jean & Bruce Raymond Po Box 212 Copeville, TX 75121-0212	45	Chp Northeast LP 550 S Watters Rd Ste 127 Allen, TX 75013-5225
33	Gonzalez Jose Lira & Lorena Arteaga-Degonzalez 3015 Elm Grove Rd Wylie, TX 75098-6251	46	Taylor Roy Lee & Elizabeth Kern 6860 County Road 487 Nevada, TX 75173-6026
34	White Wayne M Po Box 365 Shamrock, TX 79079-0365	47	Ferrell Douglas 6900 County Road 487 Nevada, TX 75173-6028
35	Eaker Jeanie Po Box 44 Copeville, TX 75121-0044	48	Jewish Family Service of Dallas Inc 5402 Arapaho Rd Ste 102 Dallas, TX 75248-7098
36	Massengale Pat J Elliott 9623 Park Highlands Dr Dallas, TX 75238-2959	49	Unknown
37	Garland City Of 200 N 5Th St Garland, TX 75040-6314	50	Barlett Bruce A & Michelle M 6932 County Road 487 Nevada, TX 75173-6028

- Choudhary Harsh
- 51 6956 County Road 487  
Nevada, TX 75173-6028  
Nix Ronald Dean
- 52 7022 County Road 487  
Nevada, TX 75173-6030  
Wolverton William Dale
- 53 6953 Cotner Rd  
Nevada, TX 75173-6303  
Wallace Kevin & Alesa
- 54 18693 Hilltop Ln  
Nevada, TX 75173-8165  
Nix Marjorie Jean
- 55 7214 County Road 1207  
Nevada, TX 75173-6232  
Ramirez Miguel Lindo & Maricela Zavala
- 56 105 Glen Knoll Dr  
Wylie, TX 75098-5004  
White Donald &  
Janice White
- 57 7294 County Road 1207  
Nevada, TX 75173-6232  
Brown Vicki
- 58 807 S China St  
Brady, TX 76825-5437  
Nix Marjorie Jean - Cle &  
Estate of Robert L Nix
- 59 7214 County Road 1207  
Nevada, TX 75173-6232  
Lessig Kimberly
- 60 7241 County Road 1208  
Nevada, TX 75173-6235  
Lessig Kenneth Allen
- 61 7241 County Road 1208  
Nevada, TX 75173-6235  
Thompson Deborah Elaine
- 62 Po Box 380  
Copeville, TX 75121-0380  
White Shawn Marie
- 63 7252 County Road 1208  
Nevada, TX 75173-6234  
Rademacher Ronald Ray
- 64 7224 County Road 1208  
Nevada, TX 75173-6234

USA (USACE)	Mcintire Robin & Shannon 6172 County Road 761 Nevada, TX 75173-6116	888 Ma Ltd 3324 Sandy Trail Ln Plano, TX 75023-5656
Escalona Jose Luis Ontiveros 630 Stoneybrook Dr Wylie, TX 75098-4036	Benites Rodolfo Garcia & Herlinda Vasquez 13521 County Road 762 Nevada, TX 75173-6121	Mcguire Buddy Pierce Jr & Lawanna Ann 13539 County Road 762 Nevada, TX 75173-6121
Riggall Marvin V Jr 13569 County Road 762 Nevada, TX 75173-6121	Karczmarski Christopher Marc 13510 County Road 762 Nevada, TX 75173-6120	Lavonland LLC 13527 County Road 760 Nevada, TX 75173-6109
Dauksavage-DeLoach Sonja & Billy Joe Dauksavage 13540 County Road 762 Nevada, TX 75173-6120	Mcintire Legacy Trust 6172 County Road 761 Nevada, TX 75173-6116	Huang Doris 3936 Dalston Ln Plano, TX 75023-1027
Riggall Marvin Vale Jr & Laura 6191 County Road 761 Nevada, TX 75173-6165	Dickeson Wayne & Freda Po Box 326 Copeville, TX 75121-0326	Iriarte Dianne D & Tyre Wade Allen 6285 County Road 761 Nevada, TX 75173-6119
Iriarte Dianne D & Tyre Wade Allen 6285 County Road 761 Nevada, TX 75173-6119	Bretado Rayo Elizabeth & Carlos Cruz Ruiz 13731 County Road 760 Nevada, TX 75173-6111	Rios Humberto & Maria Del Carmen Rios 13771 County Road 760 Nevada, TX 75173-6111
Sutton James Robert & Sutton Jane Ann Po Box 5 Weston, TX 75097-0005	Wilson Marcus G Po Box 233 Copeville, TX 75121-0233	Ramirez-Macareno Agustin Jaime & Jazmin Ramirez 13823 County Road 760 Nevada, TX 75173-6113
Pelham Troy V & Barbara 13809 County Road 760 Nevada, TX 75173-6113	Flores Lazaro & Sulema 13849 County Road 760 Nevada, TX 75173-6113	Fritts Enterprises Inc 1322 Briar Hollow Ln Garland, TX 75043-1614
Emery Jody J 13700 County Road 760 Nevada, TX 75173-6110	Fritts James C DbA Crossed Palms Rv Resort 1322 Briar Hollow Ln Garland, TX 75043-1614	Stone Rose Properties LLC Po Box 92341 Southlake, TX 76092-0135
Proctor A O Po Box 3 Copeville, TX 75121-0003	Arteaga Felix Jose Jr 13888 County Road 760 Nevada, TX 75173-6138	Arteaga Felix Jose & Marbella 6310 County Road 488 Nevada, TX 75173-6355

Turner Rocky  
6364 County Road 488  
Nevada, TX 75173-6355

Small Michael & Jessica  
Po Box 226  
Copeville, TX 75121-0226

Boughner Tamara Jean & Bruce  
Raymond  
Po Box 212  
Copeville, TX 75121-0212

Gonzalez Jose Lira &  
Lorena Arteaga-Degonzalez  
3015 Elm Grove Rd  
Wylie, TX 75098-6251

White Wayne M  
Po Box 365  
Shamrock, TX 79079-0365

Eaker Jeanie  
Po Box 44  
Copeville, TX 75121-0044

Massengale Pat J Elliott  
9623 Park Highlands Dr  
Dallas, TX 75238-2959

Garland City Of  
200 N 5Th St  
Garland, TX 75040-6314

Orr Rebecca Kathleen &  
Michael Alan Parks  
14128 County Road 489  
Nevada, TX 75173-6038

Choctaw American Insurance Inc  
10900 Ne 4Th St Ste 2300  
Bellevue, WA 98004-5882

Munroe Patricia  
6782 County Road 487  
Nevada, TX 75173-6088

Bryant Matthew &  
Lisa Bryant  
6800 County Road 487  
Nevada, TX 75173-6026

Moody Christopher &  
Crystal Dawn Moody  
6822 County Road 487  
Nevada, TX 75173-6026

Aquatero John  
Po Box 336  
Lavon, TX 75166-0336

Burnett Julianna  
3321 Carriage Ct  
Richardson, TX 75082-3663

Chp Northeast LP  
550 S Watters Rd Ste 127  
Allen, TX 75013-5225

Taylor Roy Lee & Elizabeth Kern  
6860 County Road 487  
Nevada, TX 75173-6026

Ferrell Douglas  
6900 County Road 487  
Nevada, TX 75173-6028

Jewish Family Service of Dallas Inc  
5402 Arapaho Rd Ste 102  
Dallas, TX 75248-7098

Barlett Bruce A & Michelle M  
6932 County Road 487  
Nevada, TX 75173-6028

Choudhary Harsh  
6956 County Road 487  
Nevada, TX 75173-6028

Nix Ronald Dean  
7022 County Road 487  
Nevada, TX 75173-6030

Wolverton William Dale  
6953 Cotner Rd  
Nevada, TX 75173-6303

Wallace Kevin & Alesa  
18693 Hilltop Ln  
Nevada, TX 75173-8165

Nix Marjorie Jean  
7214 County Road 1207  
Nevada, TX 75173-6232

Ramirez Miguel Lindo & Maricela  
Zavala  
105 Glen Knoll Dr  
Wylie, TX 75098-5004

White Donald &  
Janice White  
7294 County Road 1207  
Nevada, TX 75173-6232

Brown Vicki  
807 S China St  
Brady, TX 76825-5437

Nix Marjorie Jean - Cle &  
Estate of Robert L Nix  
7214 County Road 1207  
Nevada, TX 75173-6232

Ramirez Miguel Lindo & Maricela  
Zavala  
105 Glen Knoll Dr  
Wylie, TX 75098-5004

White Donald &  
Janice White  
7294 County Road 1207  
Nevada, TX 75173-6232

Brown Vicki  
807 S China St  
Brady, TX 76825-5437

Lessig Kimberly  
7241 County Road 1208  
Nevada, TX 75173-6235

Lessig Kenneth Allen  
7241 County Road 1208  
Nevada, TX 75173-6235

Thompson Deborah Elaine  
Po Box 380  
Copeville, TX 75121-0380

White Shawn Marie  
7252 County Road 1208  
Nevada, TX 75173-6234

Rademacher Ronald Ray  
7224 County Road 1208  
Nevada, TX 75173-6234

## **ATTACHMENT AR-6**

Original Photographs



**Photo 1:** Facing South Towards Intake Pumps



**Photo 2:** Facing South Towards Water Intake





**Photo 3:** Facing East Toward Units 1, 2, and 3



**Photo 4:** Outfall 001 (south) facing west towards Lake Lavon.





**Photo 5:** Outfall 001 (south) facing southeast towards the facility.



**Photo 6:** Outfall 001 (north) facing northwest towards Lake Lavon.

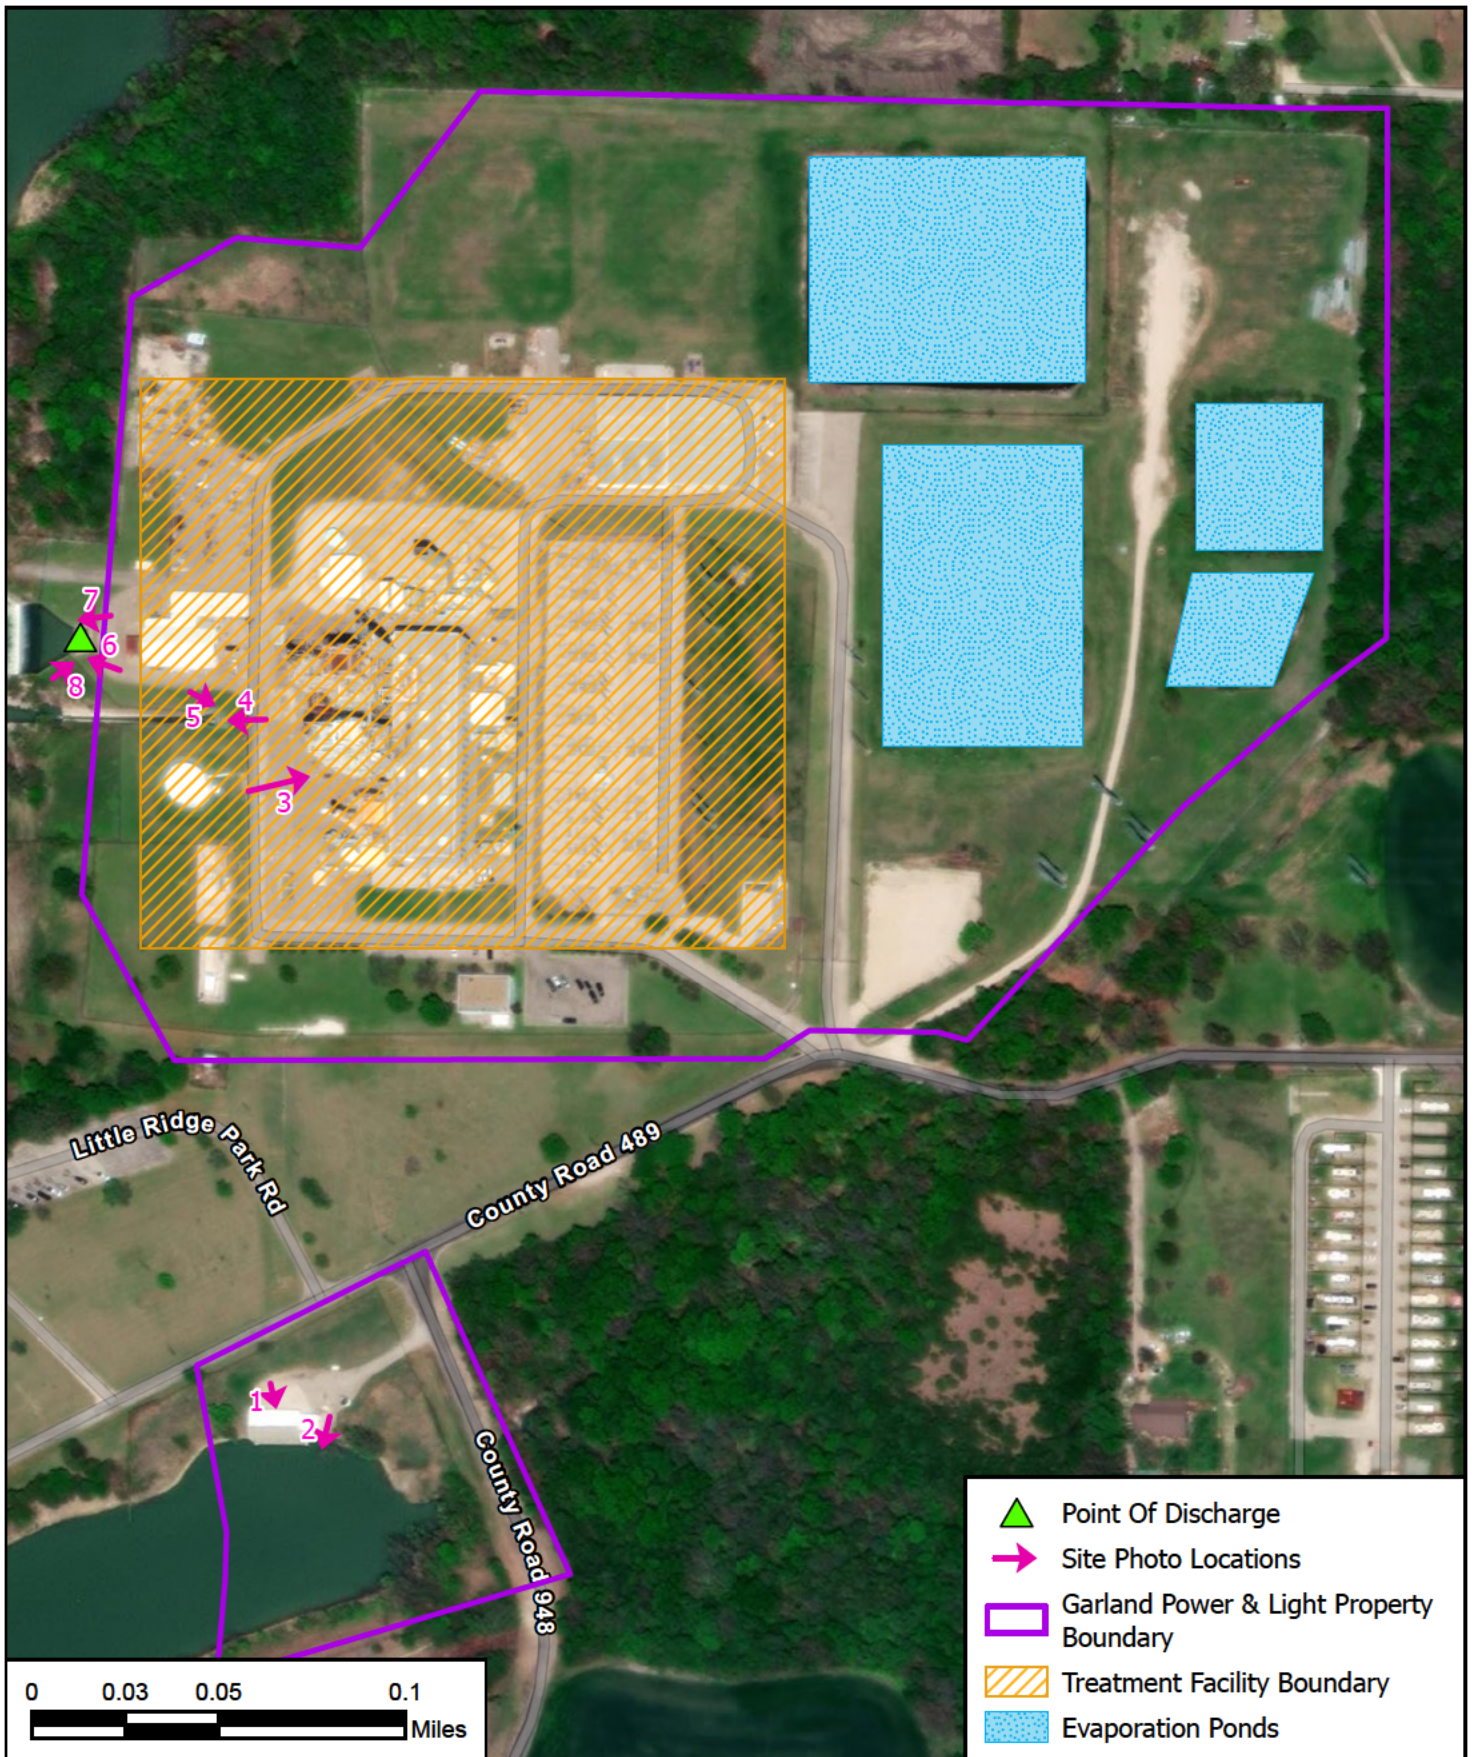


**Photo 7:** Outfall 001 (north) facing southwest towards Lake Lavon.



**Photo 8:** Outfall 001 (north) facing northeast towards facility.





<p><b>FREES AND NICHOLS, INC.</b> 801 Cherry Street, Suite 2800 Fort Worth, TX 76102 Phone - (817) 735 - 7300</p>		City of Garland		<p><b>4</b></p> <p><b>FIGURE</b></p>
		Ray Olinger TPDES Permit Renewal		
		Original Site Photo Locations		
		<p>FW JOB NO. GPL24350</p> <p>FILE NAME GP&amp;L TPDES Renewal.mxd</p> <p>DATE 8/2/2024</p> <p>SCALE</p> <p>DESIGNED CLV</p> <p>DRAFTED</p>	<p>08245</p>	

# **ATTACHMENT SPIF-1**

SPIF Form

# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)

### FOR AGENCIES REVIEWING DOMESTIC OR INDUSTRIAL TPDES WASTEWATER PERMIT APPLICATIONS

#### TCEQ USE ONLY:

Application type: \_\_\_\_Renewal \_\_\_\_Major Amendment \_\_\_\_Minor Amendment \_\_\_\_New

County: \_\_\_\_\_ Segment Number: \_\_\_\_\_

Admin Complete Date: \_\_\_\_\_

Agency Receiving SPIF:

\_\_\_\_ Texas Historical Commission

\_\_\_\_ U.S. Fish and Wildlife

\_\_\_\_ Texas Parks and Wildlife Department

\_\_\_\_ U.S. Army Corps of Engineers

**This form applies to TPDES permit applications only.** (Instructions, Page 53)

Complete this form as a separate document. TCEQ will mail a copy to each agency as required by our agreement with EPA. If any of the items are not completely addressed or further information is needed, we will contact you to provide the information before issuing the permit. Address each item completely.

**Do not refer to your response to any item in the permit application form.** Provide each attachment for this form separately from the Administrative Report of the application. The application will not be declared administratively complete without this SPIF form being completed in its entirety including all attachments. Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at [WQ-ARPTeam@tceq.texas.gov](mailto:WQ-ARPTeam@tceq.texas.gov) or by phone at (512) 239-4671.

The following applies to all applications:

1. Permittee: Ray Olinger Steam Electric Station

Permit No. WQ00 01923000

EPA ID No. TX 0001848

Address of the project (or a location description that includes street/highway, city/vicinity, and county):

13835 County Rd 489, Nevada, TX 75173

Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.

Prefix (Mr., Ms., Miss): Mr.

First and Last Name: David Bernard

Credential (P.E, P.G., Ph.D., etc.): N/A

Title: Production Manager

Mailing Address: 13835 Co Rd 489

City, State, Zip Code: Nevada, TX 75173

Phone No.: 972-205-3831 Ext.: N /A Fax No.: 972-485-6485

E-mail Address: dbernard@gpltexas.org

2. List the county in which the facility is located: Collin
3. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.

N/A

4. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the classified segment number.

From the plant site through a channel to Lake Lavon in Segment No. 0821 of the Trinity River Basin.

5. Please provide a separate 7.5-minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required in addition to the map in the administrative report).

Provide original photographs of any structures 50 years or older on the property.

Does your project involve any of the following? Check all that apply.

- ☐ Proposed access roads, utility lines, construction easements
- ☐ Visual effects that could damage or detract from a historic property's integrity
- ☐ Vibration effects during construction or as a result of project design
- ☐ Additional phases of development that are planned for the future
- ☐ Sealing caves, fractures, sinkholes, other karst features

☐ Disturbance of vegetation or wetlands

1. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features):

N/A

2. Describe existing disturbances, vegetation, and land use:

Land is currently used for steam electric plant directly adjacent to Lake Lavon.

THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

3. List construction dates of all buildings and structures on the property:

1967 - 1975


4. Provide a brief history of the property, and name of the architect/builder, if known.

ROPP Unit 1 was constructed in 1967, Unit 2 in 1971, and Unit 3 in 1975.



## **ATTACHMENT SPIF-2**

SPIF USGS Topographic Map

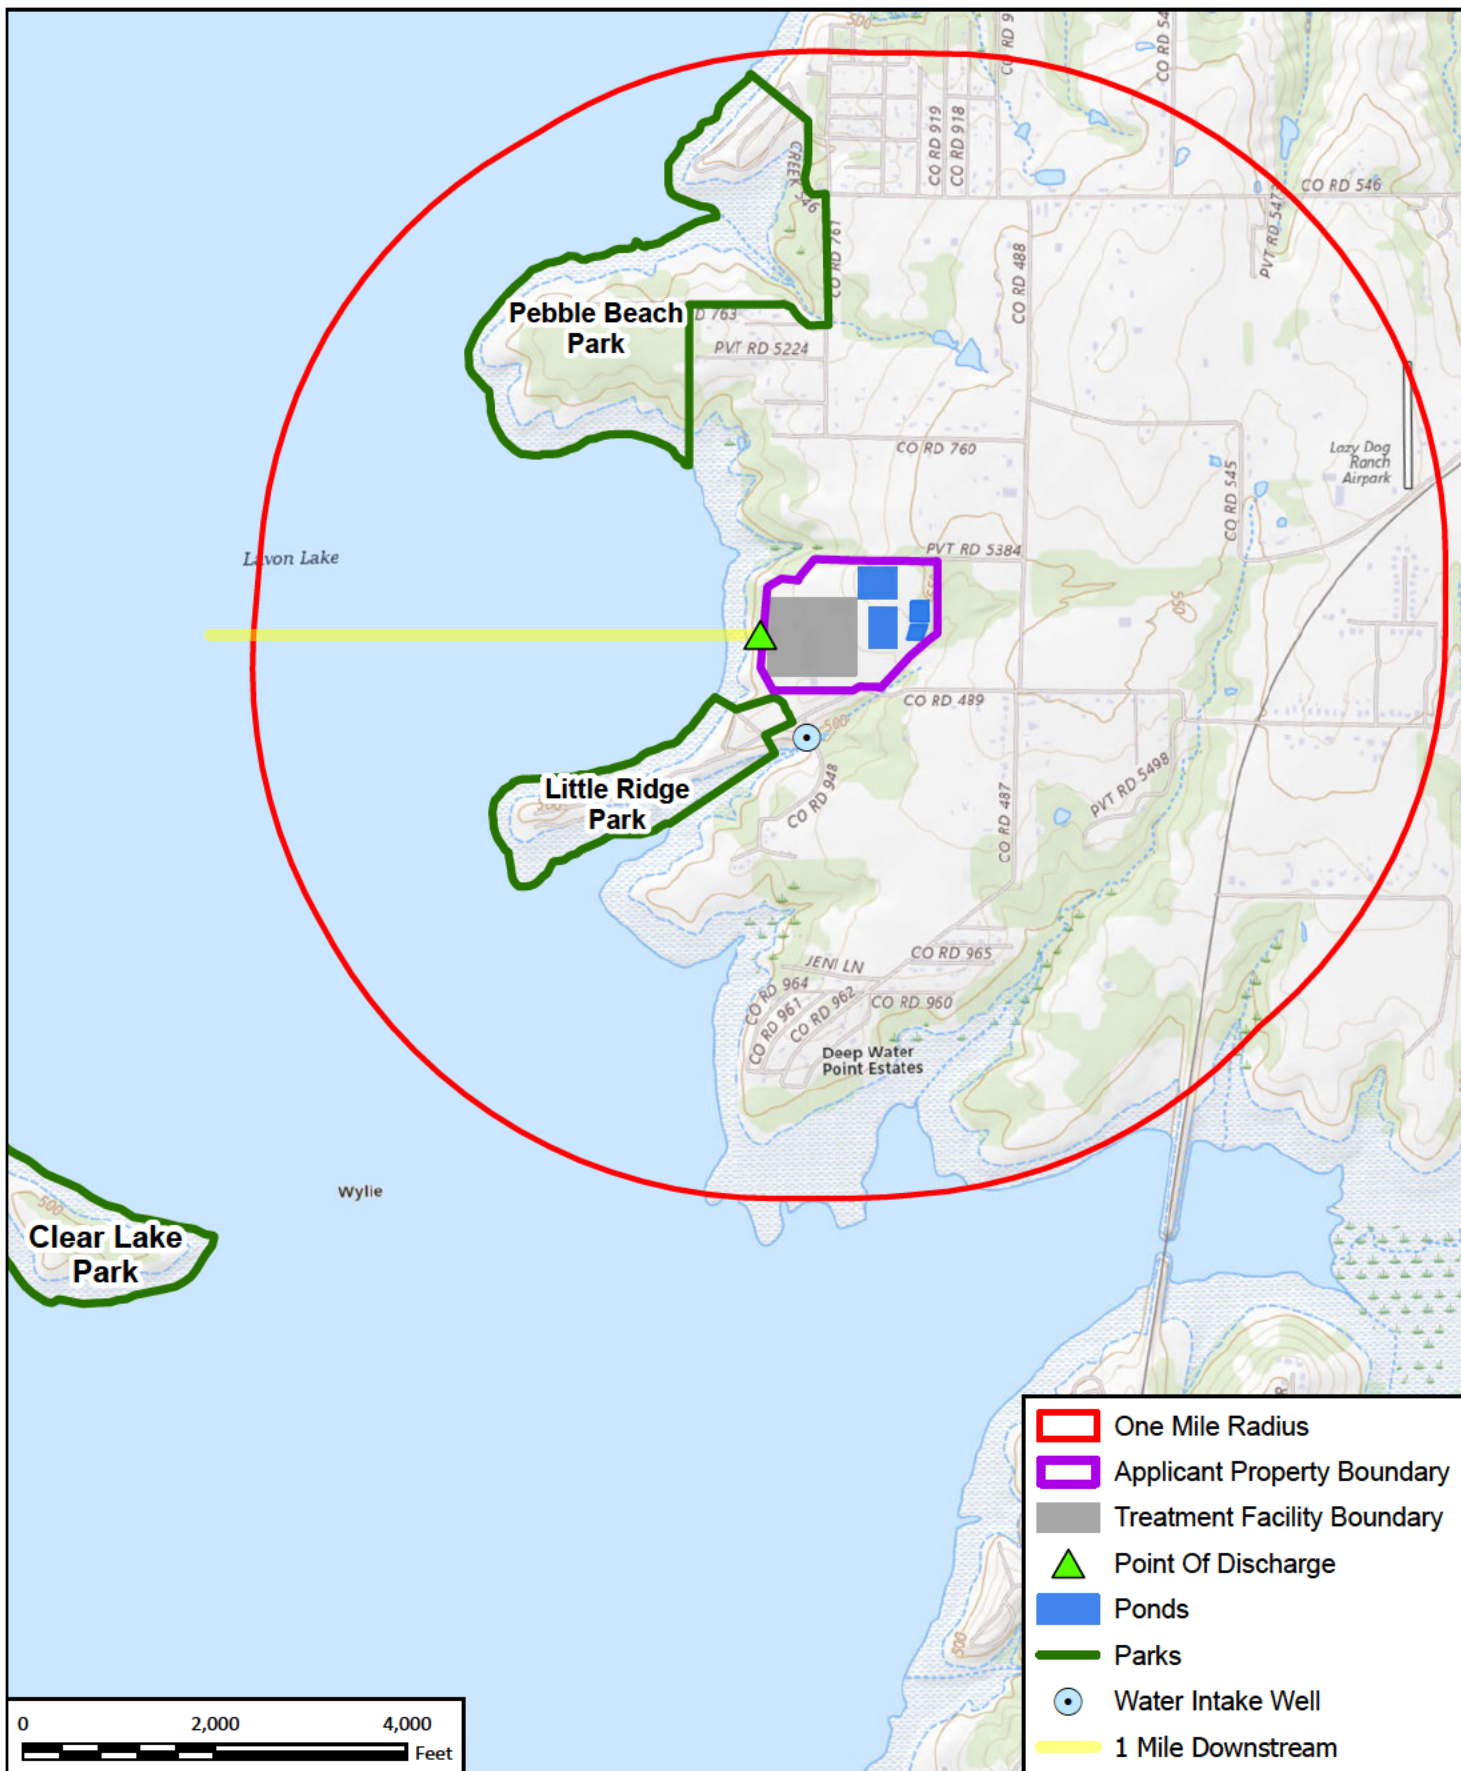

**FRESE AND NICHOLS, INC.**  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland  
**Ray Olinger TPDES Permit Renewal**  
**SPIF USGS Topographic Map**

FW JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	8/1/2024
SCALE	1:24,000
DESIGNED	CLV
DRAFTED	08245

**1**  
**FIGURE**

# **ATTACHMENT TR-1**

## Facility Map



Outfall 001

Outfall 102

Storm Water 4

Storm Water 1

Storm Water 2

Water Intake

Storm Water 3

GROUND OBSCURED  
CONTOURS OMITTED

GROUND OBSCURED  
CONTOURS OMITTED

Legend

CULV


DITCH

INLETS

MANHOLE

# **ATTACHMENT TR-2**

## Flow Schematic

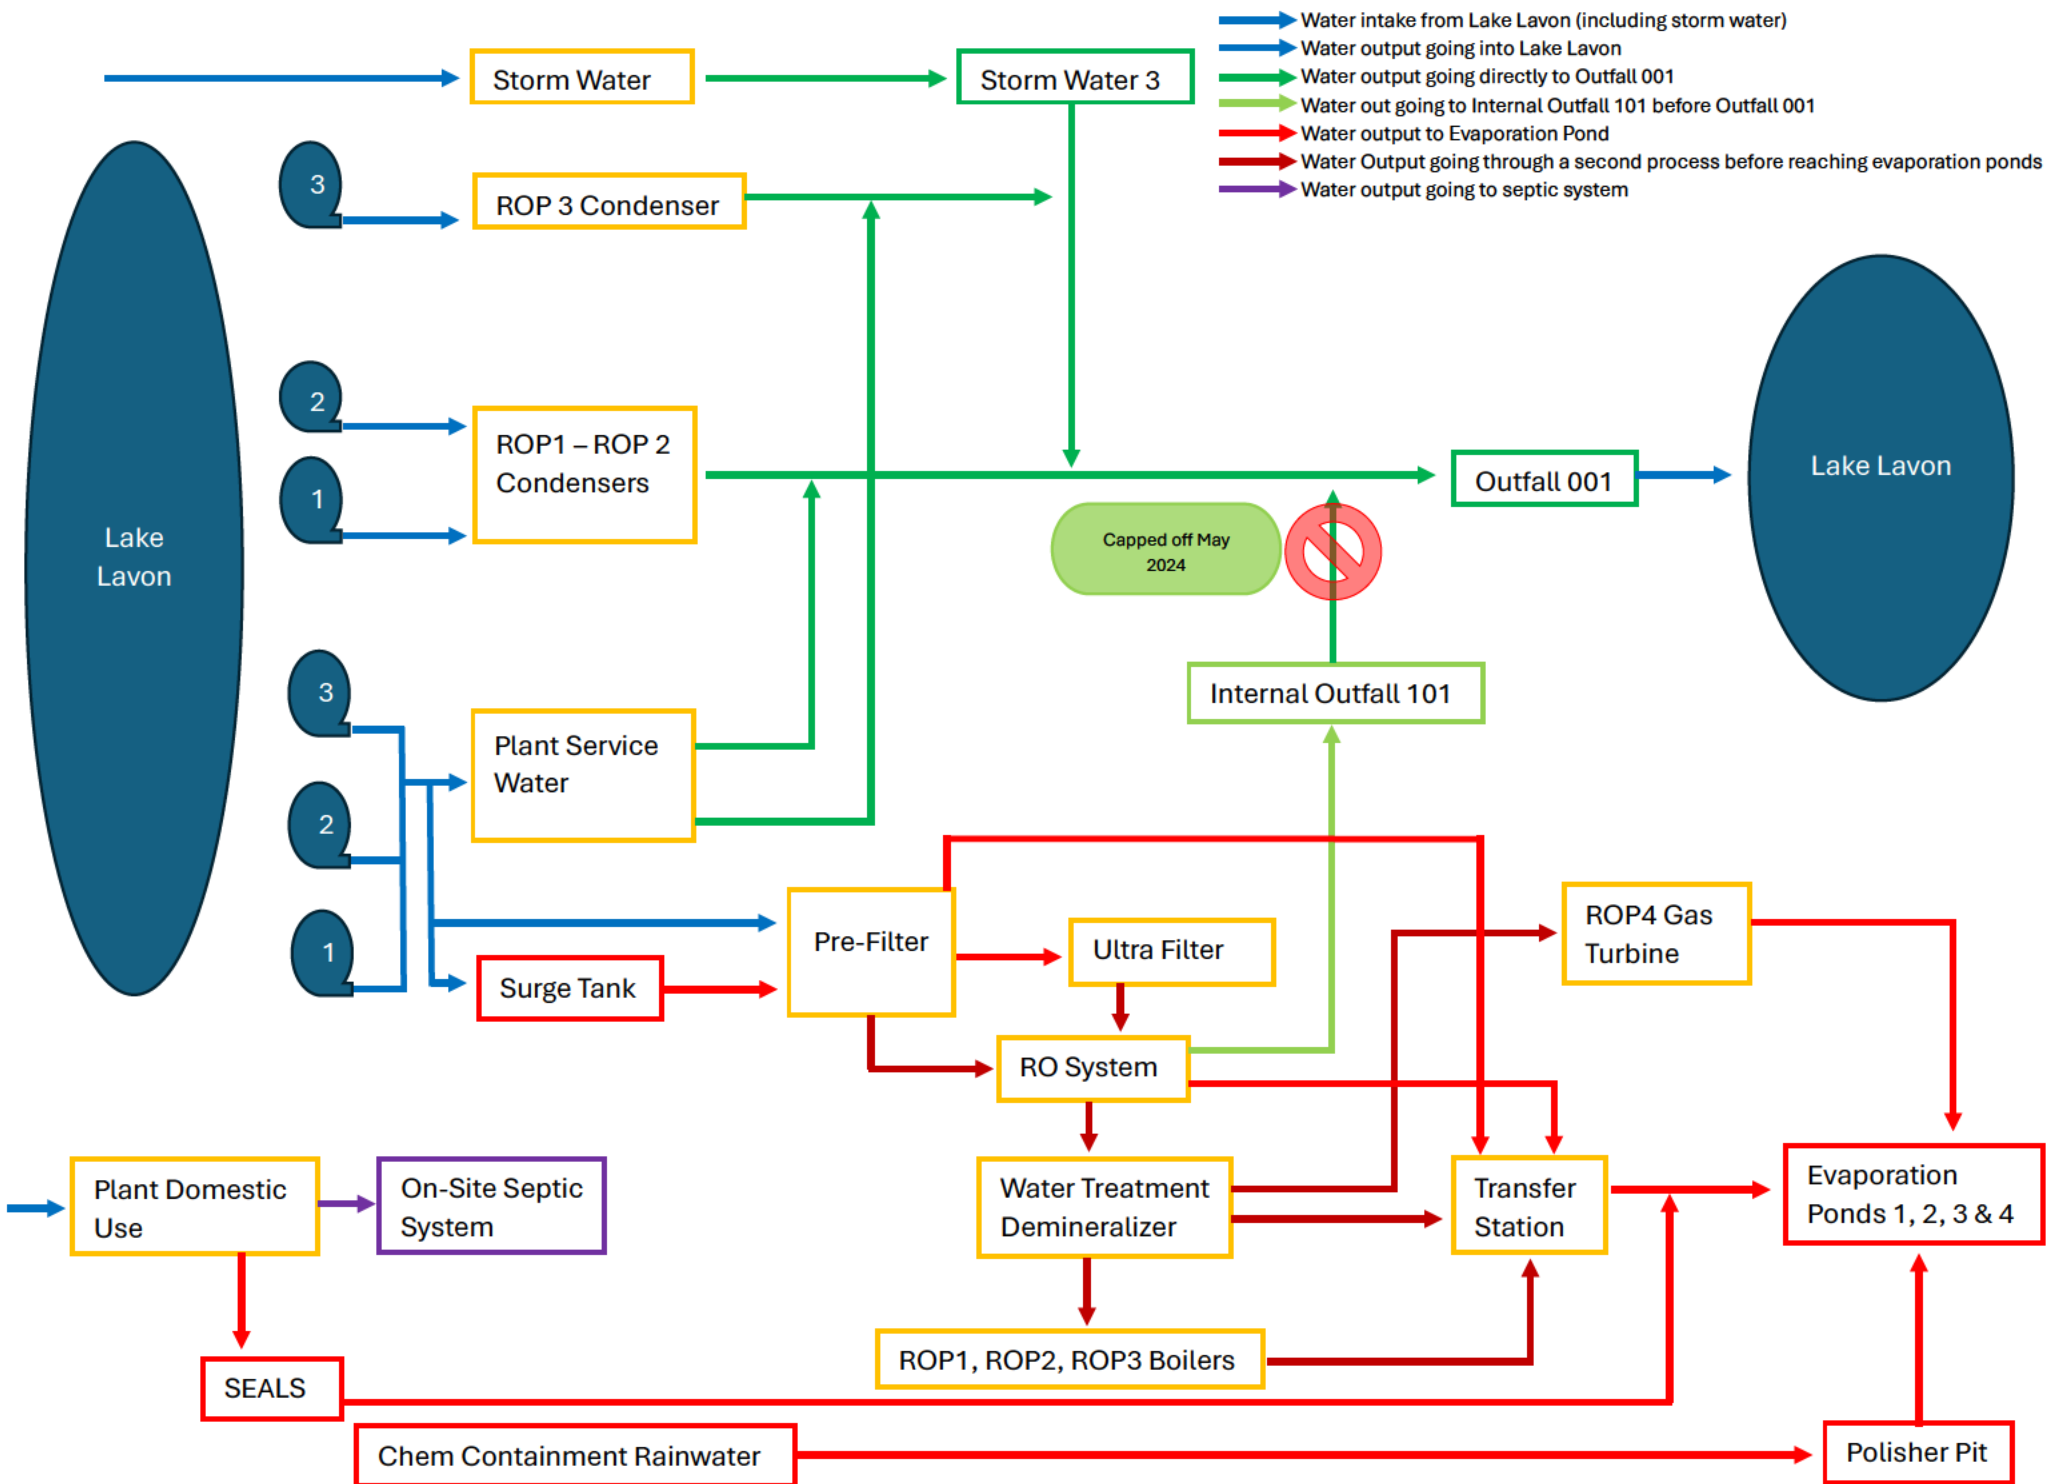

# **ATTACHMENT TR-3**

SDS

## **Technical Report 1.0**

### **Industrial**

#### **Section 5.c. Blowdown and Once-Through Cooling Water Discharges**

Product Identification: Disodium Phosphate Anhydrous

Product Use: pH control and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 7558-79-4

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Twice a week

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Trisodium Phosphate Anhydrous

Product Use: pH control and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 7601-54-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Morpholine <35%

Product Use: pH control and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 110-91-8

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Hydroquinone <10%

Product Use: oxygen scavenger and corrosion inhibitor in boilers, would be found in boiler blowdown

CAS Number: 123-31-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Hydrate Line >95% slaked Line, Calcium Hydroxide

Product Use: Used to elevate pH in makeup water to precipitate calcium, magnesium and other impurities for water purification. Waste would be blown down to waster pit and pumped to evaporation pond.

CAS Number: 1305-78-8

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS



## **Technical Report 1.0**

### **Industrial**

#### **Section 5.c. Blowdown and Once-Through Cooling Water Discharges**

Product Identification: Bleach 10%, sodium hypochlorite

Product Use: bacterial algae control in once through condensers, reduced with ammonium bisulfate when discharged.

CAS Number: 7681-52-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Three times a week

Product Toxicity to Fish or Aquatic Invertebrate Organisms: product may be toxic to aquatic life in immediate area of accidental spill according to MSDS

Product Identification: Ammonium Bisulfite 45-70%

Product Use: Product used to reduce residual and total chlorine in once through condensers

CAS Number: 10192-30-0

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Three times a week

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Use: Product is used to regenerate cation beds of demineralizer for water purification. Waste is drained to waste pit and pumped to evaporation pond.

CAS Number: 7664-93-9

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

Product Identification: Sodium Hydroxide 50%

Product Use: Product used to regenerate anion beds of the demineralizer used in water purification. The waste is drained into the waste pit and pumped to the evaporation pond.

CAS Number: 1310-73-2

Product Classification: No information available on MSDS

Product Half Life: No information available on MSDS

Frequency of Use: Daily

Product Toxicity to Fish or Aquatic Invertebrate Organisms: No information available on MSDS

# **ATTACHMENT TR-4**

## Lab Reports

**Garland Power & Light**

Sample Delivery Group: L1754191

Samples Received: 07/08/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By:



Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1754191-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	17
Wet Chemistry by Method 351.2	18
Wet Chemistry by Method 353.2	19
Wet Chemistry by Method 360.1	20
Wet Chemistry by Method 4500Cl G-2011	21
Wet Chemistry by Method 4500CN-E	22
Wet Chemistry by Method 4500P-E	23
Wet Chemistry by Method 4500-S2 D	24
Wet Chemistry by Method 4500SO3 B-2011	25
Wet Chemistry by Method 5210 B-2016	26
Wet Chemistry by Method 5220D	28
Wet Chemistry by Method 5310C	29
Wet Chemistry by Method 5540C	30
Wet Chemistry by Method SM 4500-H+B	31
Wet Chemistry by Method SM4500NH3H	32
Mercury by Method 245.1	33
Metals (ICP) by Method 200.7	34
Metals (ICPMS) by Method 200.8	35
Volatile Organic Compounds (GC/MS) by Method 624.1	38
Polychlorinated Biphenyls (GC) by Method EPA-608.3	41
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	42
Gl: Glossary of Terms	45
Al: Accreditations & Locations	46
Sc: Sample Chain of Custody	47

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc

# SAMPLE SUMMARY

OUTFALL 001 L1754191-01 WW

Collected by

Collected date/time

Received date/time

07/06/24 23:09

07/08/24 09:51

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2317944	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Calculated Results	WG2323027	1	07/15/24 20:10	07/15/24 20:10	EIG	Allen, TX
Gravimetric Analysis by Method 2540C	WG2320714	1	07/10/24 16:26	07/10/24 17:12	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2320499	1	07/10/24 13:12	07/10/24 16:33	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2319853	1	07/11/24 09:09	07/11/24 15:24	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2320288	1	07/10/24 10:40	07/10/24 10:40	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2319489	1	07/09/24 09:39	07/09/24 09:39	SEN	Allen, TX
Wet Chemistry by Method 300.0	WG2320313	1	07/10/24 21:19	07/10/24 21:19	JDG	Mt. Juliet, TN
Wet Chemistry by Method 3500Cr-B	WG2322157	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Wet Chemistry by Method 351.2	WG2323027	1	07/15/24 11:10	07/15/24 20:10	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2321792	1	07/12/24 12:54	07/12/24 12:54	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2324067	1	07/16/24 14:05	07/16/24 14:05	JBS	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2322664	1	07/14/24 12:14	07/14/24 12:14	CAH	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2321047	1	07/11/24 11:30	07/11/24 16:58	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2323646	1	07/16/24 16:14	07/16/24 16:14	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2319455	1	07/10/24 10:11	07/10/24 10:11	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2319662	1	07/09/24 15:00	07/09/24 15:00	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2323050	1	07/15/24 11:20	07/15/24 11:20	JAR	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2319171	1	07/08/24 15:09	07/13/24 09:39	SEN	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2319172	1	07/08/24 15:30	07/13/24 10:03	SEN	Allen, TX
Wet Chemistry by Method 5220D	WG2319514	1	07/09/24 09:59	07/09/24 12:02	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2320357	2	07/11/24 20:39	07/11/24 20:39	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2319936	1	07/09/24 18:54	07/09/24 19:02	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2321035	1	07/11/24 09:01	07/11/24 09:01	JBS	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2321326	1	07/11/24 16:41	07/11/24 16:41	EIG	Allen, TX
Mercury by Method 245.1	WG2320254	1	07/10/24 09:46	07/10/24 16:05	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2320626	1	07/10/24 16:30	07/11/24 15:39	SKW	Allen, TX
Metals (ICPMS) by Method 200.8	WG2317944	1	07/09/24 13:25	07/10/24 21:56	NA	Allen, TX
Metals (ICPMS) by Method 200.8	WG2317944	1	07/09/24 13:25	07/11/24 17:29	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2319924	1	07/09/24 18:02	07/09/24 18:02	NSR	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2322292	1	07/13/24 19:04	07/14/24 06:14	LJD	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2320434	1	07/10/24 12:55	07/13/24 15:45	XLY	Allen, TX

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager

## Sample Delivery Group (SDG) Narrative

The following analysis were performed from an unpreserved, insufficiently or inadequately preserved sample.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	4500-S2 D, 4500CN-E

The Laboratory is not accredited for specific analytes on the associated Sample/Method. These analytes are flagged in the Sample Results section of the report with an asterisk (\*).

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	300.0

Analysis was filtered in the laboratory.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B

No extra volume received to perform Matrix Spike samples.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754191-01</a>	<a href="#">OUTFALL 001</a>	625.1



Calculated Results

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Trivalent	0.000525	J	0.000510	0.00300	1	07/12/2024 19:03	WG2317944
Organic Nitrogen	1.03		0.0280	0.100	1	07/15/2024 20:10	WG2323027

Gravimetric Analysis by Method 2540C

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Total Dissolved Solids	184		25.0	1	07/10/2024 17:12	WG2320714

Gravimetric Analysis by Method 2540D

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Suspended Solids	5.93		2.65	1	07/10/2024 16:33	WG2320499

Wet Chemistry by Method 1664A

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Oil & Grease (Hexane Extr)	0.780	J	0.350	5.00	1	07/11/2024 15:24	WG2319853

Wet Chemistry by Method 2120B

Analyte	Result units	Qualifier	RDL units	Dilution	Analysis date / time	Batch
Color	20.0	T8	5.00	1	07/10/2024 10:40	WG2320288

Sample Narrative:  
L1754191-01 WG2320288: 7

Wet Chemistry by Method 2320B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Alkalinity	110		20.0	20.0	1	07/09/2024 09:39	WG2319489

Wet Chemistry by Method 300.0

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
*Bromide	0.914	J	0.353	1.00	1	07/10/2024 21:19	WG2320313
Chloride	15.4		0.379	1.00	1	07/10/2024 21:19	WG2320313
Fluoride	0.177		0.0640	0.150	1	07/10/2024 21:19	WG2320313
Nitrate as (N)	U	Q	0.0480	0.100	1	07/10/2024 21:19	WG2320313
Sulfate	27.1		0.594	5.00	1	07/10/2024 21:19	WG2320313

Wet Chemistry by Method 3500Cr-B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Hexavalent	U	T8	0.00200	0.00300	1	07/12/2024 19:03	WG2322157

Wet Chemistry by Method 351.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Kjeldahl Nitrogen, TKN	1.03	J5	0.140	0.250	1	07/15/2024 20:10	WG2323027

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



## OUTFALL 001

Collected date/time: 07/06/24 23:09

## SAMPLE RESULTS - 01

L1754191

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	07/12/2024 12:54	<a href="#">WG2321792</a>

1  
Cp2  
Tc3  
Ss4  
Cn5  
Sr6  
Qc7  
Gl8  
Al9  
Sc

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	8.77	<a href="#">T8</a>	1	1	1	07/16/2024 14:05	<a href="#">WG2324067</a>

## Wet Chemistry by Method 4500CI G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.0330	<a href="#">J T8</a>	0.0260	0.100	1	07/14/2024 12:14	<a href="#">WG2322664</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/11/2024 16:58	<a href="#">WG2321047</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00350	0.0100	1	07/16/2024 16:14	WG2323646

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.101		0.0152	0.0500	1	07/10/2024 10:11	<a href="#">WG2319455</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/09/2024 15:00	<a href="#">WG2319662</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	07/15/2024 11:20	<a href="#">WG2323050</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	1.67		1.00	1	1	07/13/2024 09:39	<a href="#">WG2319171</a>
CBOD	1.75		1.00	1	1	07/13/2024 10:03	<a href="#">WG2319172</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	25.4	<a href="#">J</a>	16.1	35.0	1	07/09/2024 12:02	<a href="#">WG2319514</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------



Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	11.5		0.540	1.40	2	07/11/2024 20:39	<a href="#">WG2320357</a>

1  
Cp

2  
Tc

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">T8</a>	0.360	0.500	1	07/09/2024 19:02	<a href="#">WG2319936</a>

3  
Ss

4  
Cn

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	8.21	<a href="#">T8</a>	1	07/11/2024 09:01	<a href="#">WG2321035</a>

5  
Sr

6  
Qc

Sample Narrative:

L1754191-01 WG2321035: 8.21 at 19.1C

7  
Gl

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	U		0.0280	0.100	1	07/11/2024 16:41	<a href="#">WG2321326</a>

8  
Al

9  
Sc

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	0.0000780	<a href="#">B J</a>	0.0000450	0.000200	1	07/10/2024 16:05	<a href="#">WG2320254</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0707	<a href="#">J</a>	0.0186	0.100	1	07/11/2024 15:39	<a href="#">WG2320626</a>
Tin	U		0.00240	0.0250	1	07/11/2024 15:39	<a href="#">WG2320626</a>
Titanium	U		0.00835	0.100	1	07/11/2024 15:39	<a href="#">WG2320626</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.0984		0.00186	0.00250	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Antimony	U		0.000580	0.00500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Arsenic	0.00448		0.000100	0.000500	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Barium	0.0393		0.000440	0.00300	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Beryllium	0.0000935	<a href="#">J</a>	0.0000600	0.000500	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Cadmium	U		0.000120	0.00100	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Chromium	0.000525	<a href="#">J</a>	0.000510	0.00300	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Cobalt	0.000210	<a href="#">B J</a>	0.0000400	0.000300	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Copper	0.00618		0.000900	0.00200	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Iron	0.0935		0.00432	0.00700	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Lead	U		0.000140	0.000500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Magnesium	3.62		0.0121	0.0200	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Manganese	0.0324		0.000330	0.000500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Molybdenum	0.000963	<a href="#">J</a>	0.000530	0.00100	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Nickel	0.00166	<a href="#">J</a>	0.000640	0.00200	1	07/11/2024 17:29	<a href="#">WG2317944</a>
Selenium	U		0.000740	0.00500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Silver	U		0.0000800	0.000500	1	07/10/2024 21:56	<a href="#">WG2317944</a>
Thallium	0.000363	<a href="#">J</a>	0.000190	0.000500	1	07/11/2024 17:29	<a href="#">WG2317944</a>

## OUTFALL 001

Collected date/time: 07/06/24 23:09

## SAMPLE RESULTS - 01

L1754191

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	0.00602		0.00265	0.00500	1	07/11/2024 17:29	<a href="#">WG2317944</a>

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
2-Butanone (MEK)	U		0.00822	0.0250	1	07/09/2024 18:02	<a href="#">WG2319924</a>
2-Chloroethyl vinyl ether	U	<a href="#">J6</a>	0.00652	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Acrolein	U		0.00544	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Acrylonitrile	U		0.00709	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Benzene	U		0.00207	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Bromoform	U		0.000960	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Bromomethane	U		0.00347	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chlorobenzene	U		0.00276	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chloroethane	U		0.00296	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chloroform	U		0.00212	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Chloromethane	U		0.00361	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Ethylbenzene	U		0.000401	0.00200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Methylene Chloride	U		0.0117	0.0200	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Toluene	U		0.00219	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Trichloroethene	U		0.00262	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
Vinyl chloride	U		0.00466	0.00500	1	07/09/2024 18:02	<a href="#">WG2319924</a>
(S) 1,2-Dichloroethane-d4	93.9			70.0-130		07/09/2024 18:02	<a href="#">WG2319924</a>
(S) 4-Bromofluorobenzene	94.4			70.0-130		07/09/2024 18:02	<a href="#">WG2319924</a>
(S) Toluene-d8	97.8			70.0-130		07/09/2024 18:02	<a href="#">WG2319924</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1221	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1232	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1242	U		0.000270	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1248	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1254	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
PCB 1260	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
Total PCBs	U		0.000173	0.000500	1	07/14/2024 06:14	<a href="#">WG2322292</a>
(S) Decachlorobiphenyl	31.2			10.0-144		07/14/2024 06:14	<a href="#">WG2322292</a>
(S) Tetrachloro-m-xylene	60.3			10.0-135		07/14/2024 06:14	<a href="#">WG2322292</a>

## OUTFALL 001


Collected date/time: 07/06/24 23:09

## SAMPLE RESULTS - 01

L1754191

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2-Chlorophenol	U		0.000307	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2-Methylphenol	U		0.000238	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
2-Nitrophenol	U		0.000247	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	07/13/2024 15:45	<a href="#">WG2320434</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
4-Nitrophenol	U		0.00123	0.0100	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Anthracene	U		0.000168	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Benzidine	U		0.000350	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Chrysene	U		0.000257	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachlorobenzene	U		0.000307	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Hexachloroethane	U		0.000247	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Nitrobenzene	U		0.000314	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Nonylphenol	U		0.000168	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Pentachlorobenzene	U		0.000247	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Pentachlorophenol	U		0.000283	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Phenanthrene	U		0.000200	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Phenol	U		0.000500	0.00200	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Pyridine	U		0.00174	0.00400	1	07/13/2024 15:45	<a href="#">WG2320434</a>
Total Cresols	U		0.00153	0.00800	1	07/13/2024 15:45	<a href="#">WG2320434</a>
(S) 2,4,6-Tribromophenol	49.6			29.0-132		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) 2-Fluorobiphenyl	76.0			26.0-102		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) 2-Fluorophenol	67.0	<a href="#">J1</a>		10.0-66.0		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) Nitrobenzene-d5	75.5			15.0-106		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) p-Terphenyl-d14	84.5			10.0-120		07/13/2024 15:45	<a href="#">WG2320434</a>
(S) Phenol-D6	61.0	<a href="#">J1</a>		10.0-54.0		07/13/2024 15:45	<a href="#">WG2320434</a>



Method Blank (MB)

(MB) R4092654-1 07/10/24 17:12

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Total Dissolved Solids	U		25.0	25.0

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/10/24 17:12 • (DUP) R4092654-3 07/10/24 17:12

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	184	196	1	6.32		10

Laboratory Control Sample (LCS)

(LCS) R4092654-2 07/10/24 17:12

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Total Dissolved Solids	2410	2410	100	85.0-115	

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4092588-1 07/10/24 16:33

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Suspended Solids	U		2.50	2.50

Laboratory Control Sample (LCS)

(LCS) R4092588-2 07/10/24 16:33

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Suspended Solids	879	803	91.4	85.0-115	

1

Cp

2

Tc

3

Ss

4

Cn

5

Sr

6

Qc

7

Gl

8

Al

9

Sc

Method Blank (MB)

(MB) R4093012-1 07/11/24 15:24

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4093012-2 07/11/24 15:24 • (LCSD) R4093012-3 07/11/24 15:24

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	35.1	36.2	87.8	90.5	78.0-114			3.09	18

L1753541-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1753541-02 07/11/24 15:24 • (MS) R4093012-4 07/11/24 15:24

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	36.8	92.0	1	78.0-114	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092474-1 07/10/24 10:40

Analyte	MB Result units	MB Qualifier	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:  
BLANK: 7

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/10/24 10:40 • (DUP) R4092474-2 07/10/24 10:40

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:  
OS: 7  
DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091456-1 07/09/24 09:39

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/09/24 09:39 • (DUP) R4091456-3 07/09/24 09:39

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	110	113	1	2.25		20

Laboratory Control Sample (LCS)

(LCS) R4091456-2 07/09/24 09:39

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	242	96.8	90.0-110	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4093158-1 07/10/24 19:59

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.353	1.00
Chloride	U		0.379	1.00
Fluoride	U		0.0640	0.150
Nitrate as (N)	U		0.0480	0.100
Sulfate	U		0.594	5.00

L1747043-13 Original Sample (OS) • Duplicate (DUP)

(OS) L1747043-13 07/10/24 20:26 • (DUP) R4093158-3 07/10/24 20:39

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	1.84	1.79	1	2.94		15
Chloride	67.4	64.7	1	4.05		15
Fluoride	0.125	0.116	1	7.49	J	15
Nitrate as (N)	2.69	2.58	1	4.08		15
Sulfate	95.6	91.0	1	4.92		15

L1754873-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754873-01 07/11/24 02:15 • (DUP) R4093158-6 07/11/24 02:28

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	0.637	0.595	1	6.79	J	15
Chloride	10.5	10.4	1	1.21		15
Fluoride	0.103	0.142	1	32.4	J P1	15
Nitrate as (N)	U	U	1	0.000		15
Sulfate	142	139	1	1.74		15

Laboratory Control Sample (LCS)

(LCS) R4093158-2 07/10/24 20:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	40.0	40.4	101	90.0-110	
Chloride	40.0	40.3	101	90.0-110	
Fluoride	8.00	8.11	101	90.0-110	
Nitrate as (N)	8.00	7.79	97.4	90.0-110	

Cp

Tc

Ss

Cn

Sr

Qc

Gl

Al

Sc

Laboratory Control Sample (LCS)

(LCS) R4093158-2 07/10/24 20:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Sulfate	40.0	40.9	102	90.0-110	

L1747043-13 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1747043-13 07/10/24 20:26 • (MS) R4093158-4 07/10/24 20:53 • (MSD) R4093158-5 07/10/24 21:06

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Bromide	40.0	1.84	41.2	40.7	98.4	97.2	1	80.0-120			1.19	15
Chloride	40.0	67.4	93.0	91.9	64.0	61.4	1	80.0-120	J6	J6	1.12	15
Fluoride	8.00	0.125	8.34	7.99	103	98.4	1	80.0-120			4.18	15
Nitrate as (N)	8.00	2.69	10.1	9.98	92.6	91.1	1	80.0-120			1.15	15
Sulfate	40.0	95.6	115	112	48.9	42.2	1	80.0-120	J6	J6	2.36	15

L1754873-01 Original Sample (OS) • Matrix Spike (MS)

(OS) L1754873-01 07/11/24 02:15 • (MS) R4093158-7 07/11/24 02:42

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>
Bromide	40.0	0.637	40.6	99.9	1	80.0-120	
Chloride	40.0	10.5	48.9	96.1	1	80.0-120	
Fluoride	8.00	0.103	8.07	99.5	1	80.0-120	
Nitrate as (N)	8.00	U	8.83	110	1	80.0-120	
Sulfate	40.0	142	149	17.3	1	80.0-120	J6

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093286-1 07/12/24 19:03

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

Laboratory Control Sample (LCS)

(LCS) R4093286-2 07/12/24 19:03

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.195	97.7	85.0-115	

L1756127-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756127-01 07/12/24 19:03 • (MS) R4093286-3 07/12/24 19:03 • (MSD) R4093286-4 07/12/24 19:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.204	0.202	102	101	1	10.0-120			0.842	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4094061-1 07/15/24 20:06

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Kjeldahl Nitrogen, TKN	U		0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4094061-2 07/15/24 20:07

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Kjeldahl Nitrogen, TKN	4.00	4.27	107	90.0-110	

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/15/24 20:10 • (MS) R4094061-3 07/15/24 20:44 • (MSD) R4094061-4 07/15/24 20:45

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	4.00	1.03	5.64	6.51	115	137	1	90.0-110	J5	J5	14.3	20

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 20:11 • (MS) R4094061-5 07/15/24 20:46 • (MSD) R4094061-6 07/15/24 20:48

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	4.00	0.343	4.88	4.63	113	107	1	90.0-110	J5		5.26	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093045-1 07/12/24 12:50

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4093045-2 07/12/24 12:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Nitrate-Nitrite	2.50	2.40	96.0	90.0-110	

L1754182-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754182-01 07/12/24 12:51 • (MS) R4093045-3 07/12/24 12:59 • (MSD) R4093045-4 07/12/24 13:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	0.794	3.13	3.11	93.4	92.6	1	90.0-110			0.641	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/16/24 14:05 • (DUP) R4094367-1 07/16/24 14:05

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	<u>DUP Qualifier</u>	DUP RPD Limits %
Dissolved Oxygen	7.77	8.25	1	5.99		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093561-1 07/14/24 11:59

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chlorine,residual	U		0.0260	0.100

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/14/24 12:14 • (DUP) R4093561-3 07/14/24 12:15

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Chlorine,residual	0.0330	0.0340	1	2.99	J	20

Laboratory Control Sample (LCS)

(LCS) R4093561-2 07/14/24 12:13

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chlorine,residual	1.00	0.960	96.0	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092740-1 07/11/24 16:58

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4092740-2 07/11/24 16:58

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Cyanide	0.100	0.0908	90.8	85.0-115	

L1754359-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754359-01 07/11/24 16:58 • (MS) R4092740-3 07/11/24 16:58 • (MSD) R4092740-4 07/11/24 16:58

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	U	0.0928	0.0928	92.8	92.8	1	85.0-115			0.000	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc



Method Blank (MB)

(MB) R4091941-1 07/10/24 10:09

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4091941-2 07/10/24 10:09

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Phosphorus,Total	0.500	0.522	104	80.0-120	

L1753186-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753186-01 07/10/24 10:09 • (MS) R4091941-3 07/10/24 10:11 • (MSD) R4091941-4 07/10/24 10:11

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Phosphorus,Total	0.500	2.51	2.70	2.79	38.4	55.9	5	80.0-120	<u>V</u>	<u>V</u>	3.18	20

L1753974-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753974-01 07/10/24 10:10 • (MS) R4091941-5 07/10/24 10:11 • (MSD) R4091941-6 07/10/24 10:11

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.0327	0.564	0.548	106	103	1	80.0-120			2.93	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4091612-1 07/09/24 15:00

	MB Result	<u>MB Qualifier</u>	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4091612-2 07/09/24 15:00

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	mg/l	mg/l	%	%	
Sulfide	0.800	0.850	106	80.0-120	

L1753522-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753522-01 07/09/24 15:00 • (MS) R4091612-3 07/09/24 15:03 • (MSD) R4091612-4 07/09/24 15:03

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfide	0.800	U	0.772	0.769	96.5	96.1	1	80.0-120			0.453	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093789-1 07/15/24 11:20

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/15/24 11:20 • (DUP) R4093789-3 07/15/24 11:20

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	U	U	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4093789-2 07/15/24 11:20

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 11:20 • (MS) R4093789-4 07/15/24 11:20 • (MSD) R4093789-5 07/15/24 11:20

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	19.0	18.5	95.0	92.5	1	85.0-115			2.67	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093354-1 07/13/24 09:30

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
BOD	U		0.200	0.200

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

L1754142-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754142-01 07/13/24 09:40 • (DUP) R4093354-3 07/13/24 09:44

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	349	332	1	5.11		20

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

Laboratory Control Sample (LCS)

(LCS) R4093354-2 07/13/24 09:36

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
BOD	198	188	95	85-115	

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093367-1 07/13/24 09:54

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
CBOD	U		0.200	0.200

L1754163-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1754163-02 07/13/24 10:21 • (DUP) R4093367-3 07/13/24 10:22

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
CBOD	1.57	1.62	1	3.13		20

Laboratory Control Sample (LCS)

(LCS) R4093367-2 07/13/24 09:59

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
CBOD	198	189	95.3	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091496-1 07/09/24 12:02

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

Laboratory Control Sample (LCS)

(LCS) R4091496-2 07/09/24 12:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
COD	500	509	102	80.0-120	

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/09/24 12:02 • (MS) R4091496-3 07/09/24 12:02 • (MSD) R4091496-4 07/09/24 12:02

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
COD	500	25.4	526	532	100	101	1	80.0-120			1.20	20

Method Blank (MB)

(MB) R4092962-1 07/11/24 16:22

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4092962-2 07/11/24 16:42

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
TOC (Total Organic Carbon)	10.0	10.4	104	90.0-110	

L1754776-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754776-01 07/11/24 17:08 • (MS) R4092962-3 07/11/24 17:54 • (MSD) R4092962-4 07/11/24 18:14

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
TOC (Total Organic Carbon)	100	30.8	127	127	96.3	96.3	10	80.0-120			0.000	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092475-1 07/09/24 19:02

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4092475-2 07/09/24 19:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
MBAS	1.00	1.17	117	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/09/24 19:02 • (MS) R4092475-3 07/09/24 19:02 • (MSD) R4092475-4 07/09/24 19:02

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
MBAS	1.00	U	1.20	1.25	120	125	1	80.0-120		J5	3.87	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc



L1754340-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754340-01 07/11/24 09:01 • (DUP) R4092476-2 07/11/24 09:01

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	su	su		%		%
pH	7.61	7.62	1	0.131		20

Sample Narrative:  
OS: 7.61 at 19.6C  
DUP: 7.62 at 19.3C

Laboratory Control Sample (LCS)

(LCS) R4092476-1 07/11/24 09:01

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	su	su	%	%	
pH	6.00	5.99	99.8	99.0-101	

Sample Narrative:  
LCS: 5.99 at 22C

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092766-1 07/11/24 16:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	0.0285	⬇	0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4092766-2 07/11/24 16:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.28	106	80.0-120	

L1754163-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754163-02 07/11/24 16:39 • (MS) R4092766-3 07/11/24 16:32 • (MSD) R4092766-4 07/11/24 16:34

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.369	5.44	5.43	101	101	1	80.0-120			0.184	20

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/11/24 16:41 • (MS) R4092766-5 07/11/24 16:36 • (MSD) R4092766-6 07/11/24 16:37

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	U	5.12	5.15	102	103	1	80.0-120			0.584	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092198-3 07/10/24 16:35

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Mercury	0.0000450	J	0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4092198-4 07/10/24 16:37

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Mercury	0.00250	0.00227	90.8	85.0-115	

L1753552-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753552-01 07/10/24 16:40 • (MS) R4092198-5 07/10/24 16:42 • (MSD) R4092198-6 07/10/24 16:44

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	0.0000520	0.00170	0.00171	65.9	66.3	1	70.0-130	J6	J6	0.587	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092733-2 07/11/24 13:15

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4092733-1 07/11/24 13:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.962	96.2	85.0-115	
Tin	1.00	0.999	99.9	85.0-115	
Titanium	1.00	0.996	99.6	85.0-115	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092396-1 07/10/24 19:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Antimony	U		0.000580	0.00500
Arsenic	0.000137	U	0.000100	0.000500
Barium	U		0.000440	0.00300
Beryllium	U		0.0000600	0.000500
Cadmium	U		0.000120	0.00100
Chromium	U		0.000510	0.00300
Cobalt	0.0000413	U	0.0000400	0.000300
Iron	0.00498	U	0.00432	0.00700
Lead	U		0.000140	0.000500
Magnesium	U		0.0121	0.0200
Manganese	0.000528		0.000330	0.000500
Molybdenum	U		0.000530	0.00100
Nickel	U		0.000640	0.00200
Selenium	U		0.000740	0.00500
Silver	U		0.0000800	0.000500

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092655-1 07/11/24 14:06

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Aluminum	0.00824		0.00186	0.00250
Copper	U		0.000900	0.00200
Thallium	U		0.000190	0.000500
Zinc	U		0.00265	0.00500

Laboratory Control Sample (LCS)

(LCS) R4092396-2 07/10/24 19:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Antimony	0.100	0.0953	95.3	85.0-115	
Arsenic	0.100	0.0925	92.5	85.0-115	
Barium	0.100	0.0975	97.5	85.0-115	
Beryllium	0.100	0.0906	90.6	85.0-115	
Cadmium	0.100	0.0946	94.6	85.0-115	
Chromium	0.100	0.0950	95.0	85.0-115	
Cobalt	0.100	0.0927	92.7	85.0-115	
Iron	1.00	0.940	94.0	85.0-115	

Laboratory Control Sample (LCS)

(LCS) R4092396-2 07/10/24 19:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Lead	0.100	0.0928	92.8	85.0-115	
Magnesium	1.00	0.959	95.9	85.0-115	
Manganese	0.100	0.0958	95.8	85.0-115	
Molybdenum	0.100	0.0960	96.0	85.0-115	
Nickel	0.100	0.0908	90.8	85.0-115	
Selenium	0.100	0.0938	93.8	85.0-115	
Silver	0.0500	0.0477	95.3	85.0-115	

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

Laboratory Control Sample (LCS)

(LCS) R4092655-2 07/11/24 14:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Aluminum	1.00	0.973	97.3	85.0-115	
Copper	0.100	0.102	102	85.0-115	
Thallium	0.100	0.0921	92.1	85.0-115	
Zinc	0.100	0.0972	97.2	85.0-115	

L1752768-10 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1752768-10 07/10/24 20:10 • (MS) R4092396-3 07/10/24 20:16 • (MSD) R4092396-4 07/10/24 20:22

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Antimony	0.100	0.000718	0.0936	0.0921	92.9	91.3	1	70.0-130			1.66	20
Arsenic	0.100	0.00198	0.0912	0.0924	89.2	90.4	1	70.0-130			1.35	20
Barium	0.100	0.0649	0.156	0.157	90.8	91.7	1	70.0-130			0.574	20
Beryllium	0.100	U	0.0895	0.0896	89.5	89.6	1	70.0-130			0.215	20
Cadmium	0.100	U	0.0859	0.0894	85.9	89.4	1	70.0-130			3.93	20
Chromium	0.100	0.000624	0.0883	0.0890	87.7	88.3	1	70.0-130			0.752	20
Cobalt	0.100	0.000235	0.0864	0.0882	86.1	88.0	1	70.0-130			2.08	20
Iron	1.00	0.0356	0.891	0.912	85.5	87.6	1	70.0-130			2.33	20
Lead	0.100	U	0.0870	0.0869	87.0	86.9	1	70.0-130			0.0364	20
Magnesium	1.00	14.9	15.1	15.7	16.7	73.0	1	70.0-130	V		3.66	20
Manganese	0.100	0.0249	0.110	0.113	84.9	88.6	1	70.0-130			3.30	20
Molybdenum	0.100	0.00356	0.0956	0.0981	92.0	94.6	1	70.0-130			2.62	20
Nickel	0.100	0.00232	0.0862	0.0876	83.9	85.2	1	70.0-130			1.59	20
Selenium	0.100	0.00164	0.0918	0.0942	90.2	92.6	1	70.0-130			2.53	20
Silver	0.0500	U	0.0443	0.0452	88.5	90.4	1	70.0-130			2.12	20

L1753977-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753977-02 07/10/24 21:31 • (MS) R4092396-5 07/10/24 21:38 • (MSD) R4092396-6 07/10/24 21:44

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Antimony	0.100	U	0.103	0.0995	103	99.5	1	70.0-130			3.92	20
Barium	0.100	0.0577	0.162	0.157	104	99.2	1	70.0-130			3.09	20
Cadmium	0.100	U	0.102	0.0985	102	98.5	1	70.0-130			3.77	20
Chromium	0.100	0.00109	0.105	0.102	104	101	1	70.0-130			3.07	20
Lead	0.100	0.000216	0.101	0.0982	101	98.0	1	70.0-130			2.79	20
Manganese	0.100	0.171	0.274	0.268	103	97.6	1	70.0-130			2.02	20
Molybdenum	0.100	0.00727	0.113	0.110	105	103	1	70.0-130			2.31	20
Selenium	0.100	U	0.0945	0.105	94.5	105	1	70.0-130			10.0	20
Silver	0.0500	U	0.0507	0.0494	101	98.8	1	70.0-130			2.50	20

L1752768-10 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1752768-10 07/11/24 14:31 • (MS) R4092655-3 07/11/24 14:37 • (MSD) R4092655-4 07/11/24 14:43

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Aluminum	1.00	0.0394	0.972	0.996	93.3	95.7	1	70.0-130			2.43	20
Copper	0.100	0.00526	0.102	0.104	97.1	98.3	1	70.0-130			1.17	20
Thallium	0.100	U	0.0893	0.0923	89.3	92.3	1	70.0-130			3.28	20
Zinc	0.100	0.0484	0.141	0.142	92.3	93.7	1	70.0-130			1.02	20

L1753977-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753977-02 07/11/24 17:03 • (MS) R4092655-5 07/11/24 17:10 • (MSD) R4092655-6 07/11/24 17:17

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Arsenic	0.100	0.00126	0.0982	0.0969	96.9	95.7	1	70.0-130			1.25	20
Beryllium	0.100	U	0.0979	0.0965	97.9	96.5	1	70.0-130			1.45	20
Cobalt	0.100	0.000213	0.0996	0.0988	99.4	98.6	1	70.0-130			0.823	20
Copper	0.100	U	0.101	0.100	101	100	1	70.0-130			0.503	20
Iron	1.00	0.538	1.51	1.47	97.0	93.5	1	70.0-130			2.37	20
Magnesium	1.00	3.86	4.82	4.73	96.1	86.6	1	70.0-130			1.99	20
Nickel	0.100	0.00152	0.102	0.0996	100	98.1	1	70.0-130			2.11	20
Thallium	0.100	U	0.0888	0.0907	88.8	90.7	1	70.0-130			2.15	20
Zinc	0.100	U	0.0953	0.0957	95.3	95.7	1	70.0-130			0.385	20



Method Blank (MB)

(MB) R4091976-2 07/09/24 17:32

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Butanone (MEK)	U		0.00822	0.0250
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	0.00317	U	0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	93.5			70.0-130
(S) 4-Bromofluorobenzene	99.6			70.0-130
(S) Toluene-d8	97.4			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



Laboratory Control Sample (LCS)

(LCS) R4091976-1 07/09/24 16:24

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0200	0.0201	101	70.0-130	
1,1,2,2-Tetrachloroethane	0.0200	0.0185	92.5	60.0-140	
1,1,2-Trichloroethane	0.0200	0.0190	95.0	70.0-130	
1,1-Dichloroethene	0.0200	0.0195	97.5	50.0-150	
1,1-Dichloroethane	0.0200	0.0203	102	70.0-130	
1,2-Dibromoethane	0.0200	0.0186	93.0	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0203	102	65.0-135	
1,2-Dichloroethane	0.0200	0.0202	101	70.0-130	
1,2-Dichloropropane	0.0200	0.0181	90.5	35.0-165	
1,3-Dichlorobenzene	0.0200	0.0195	97.5	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0192	96.0	65.0-135	
2-Butanone (MEK)	0.100	0.0829	82.9	70.0-130	
2-Chloroethyl vinyl ether	0.100	0.0529	52.9	1.00-225	
Acrolein	0.100	0.105	105	64.0-139	
Acrylonitrile	0.100	0.104	104	67.0-136	
Benzene	0.0200	0.0197	98.5	65.0-135	
Bromodichloromethane	0.0200	0.0203	102	65.0-135	
Bromoform	0.0200	0.0233	117	70.0-130	
Bromomethane	0.0200	0.0329	165	15.0-185	
Carbon tetrachloride	0.0200	0.0216	108	70.0-130	
Chlorobenzene	0.0200	0.0196	98.0	65.0-135	
Chloroethane	0.0200	0.0214	107	40.0-160	
Chloroform	0.0200	0.0207	104	70.0-135	
Chloromethane	0.0200	0.0159	79.5	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0177	88.5	25.0-175	
Dibromochloromethane	0.0200	0.0202	101	70.0-135	
Ethylbenzene	0.0200	0.0197	98.5	60.0-140	
Methylene Chloride	0.0200	0.0221	111	60.0-140	
Tetrachloroethene	0.0200	0.0181	90.5	70.0-130	
Toluene	0.0200	0.0196	98.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0206	103	70.0-130	
Trichloroethene	0.0200	0.0201	101	65.0-135	
Vinyl chloride	0.0200	0.0208	104	5.00-195	
(S) 1,2-Dichloroethane-d4			95.4	70.0-130	
(S) 4-Bromofluorobenzene			91.3	70.0-130	
(S) Toluene-d8			99.6	70.0-130	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/09/24 18:02 • (MS) R4091976-3 07/09/24 18:26 • (MSD) R4091976-4 07/09/24 18:51

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0199	U	0.0200	0.0203	101	102	1	52.0-162			1.49	36
1,1,2,2-Tetrachloroethane	0.0201	U	0.0183	0.0188	91.0	93.5	1	46.0-157			2.70	61
1,1,2-Trichloroethane	0.0199	U	0.0194	0.0193	97.5	97.0	1	52.0-150			0.517	45
1,1-Dichloroethene	0.0200	U	0.0203	0.0203	102	102	1	1.00-234			0.000	32
1,1-Dichloroethane	0.0200	U	0.0214	0.0211	107	105	1	59.0-155			1.41	40
1,2-Dibromoethane	0.0200	U	0.0184	0.0187	92.0	93.5	1	70.0-130			1.62	20
1,2-Dichlorobenzene	0.0200	U	0.0212	0.0213	106	106	1	18.0-190			0.471	57
1,2-Dichloroethane	0.0200	U	0.0208	0.0209	104	105	1	49.0-155			0.480	49
1,2-Dichloropropane	0.0199	U	0.0185	0.0185	93.0	93.0	1	1.00-210			0.000	55
1,3-Dichlorobenzene	0.0199	U	0.0203	0.0205	102	103	1	59.0-156			0.980	43
1,4-Dichlorobenzene	0.0200	U	0.0201	0.0201	101	101	1	18.0-190			0.000	57
2-Butanone (MEK)	0.100	U	0.0762	0.0774	76.2	77.4	1	70.0-130			1.56	20
2-Chloroethyl vinyl ether	0.100	U	U	U	0.000	0.000	1	1.00-305	J6	J6	0.000	71
Acrolein	0.100	U	0.0936	0.0921	93.6	92.1	1	4.00-172			1.62	20
Acrylonitrile	0.100	U	0.0986	0.104	98.6	104	1	22.0-189			5.33	20
Benzene	0.0200	U	0.0204	0.0202	102	101	1	37.0-151			0.985	61
Bromodichloromethane	0.0199	U	0.0203	0.0199	102	100	1	35.0-155			1.99	56
Bromoform	0.0198	U	0.0225	0.0229	114	116	1	70.0-130			1.76	42
Bromomethane	0.0200	U	0.0261	0.0283	131	142	1	15.0-185			8.09	61
Carbon tetrachloride	0.0200	U	0.0224	0.0225	112	113	1	70.0-140			0.445	41
Chlorobenzene	0.0200	U	0.0203	0.0205	102	103	1	37.0-160			0.980	53
Chloroethane	0.0200	U	0.0203	0.0198	102	99.0	1	14.0-230			2.49	78
Chloroform	0.0200	U	0.0212	0.0215	106	108	1	51.0-138			1.41	54
Chloromethane	0.0200	U	0.0133	0.0137	66.5	68.5	1	1.00-273			2.96	20
cis-1,3-Dichloropropene	0.0200	U	0.0179	0.0181	89.5	90.5	1	1.00-227			1.11	58
Dibromochloromethane	0.0198	U	0.0204	0.0202	103	102	1	53.0-149			0.985	50
Ethylbenzene	0.0200	U	0.0211	0.0209	105	105	1	37.0-162			0.952	63
Methylene Chloride	0.0204	U	0.0193	0.0198	94.6	97.1	1	1.00-221	J	J	2.56	28
Tetrachloroethene	0.0200	U	0.0194	0.0193	97.0	96.5	1	64.0-148			0.517	39
Toluene	0.0200	U	0.0208	0.0206	104	103	1	47.0-150			0.966	41
trans-1,2-Dichloroethene	0.0200	U	0.0213	0.0213	106	106	1	54.0-156			0.000	45
Trichloroethene	0.0200	U	0.0215	0.0213	108	106	1	70.0-157			0.935	48
Vinyl chloride	0.0200	U	0.0189	0.0187	94.5	93.5	1	1.00-251			1.06	66
(S) 1,2-Dichloroethane-d4					97.2	97.9		70.0-130				
(S) 4-Bromofluorobenzene					90.3	91.8		70.0-130				
(S) Toluene-d8					101	100		70.0-130				

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093629-1 07/14/24 04:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
PCB 1016	U		0.000270	0.000500
PCB 1221	U		0.000270	0.000500
PCB 1232	U		0.000270	0.000500
PCB 1242	U		0.000270	0.000500
PCB 1248	U		0.000173	0.000500
PCB 1254	U		0.000173	0.000500
PCB 1260	U		0.000173	0.000500
Total PCBs	U		0.000173	0.000500
(S) Decachlorobiphenyl	40.9			10.0-144
(S) Tetrachloro-m-xylene	77.2			10.0-135

Laboratory Control Sample (LCS)

(LCS) R4093629-5 07/14/24 04:50

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00226	90.4	50.0-140	
PCB 1260	0.00250	0.00211	84.4	8.00-140	
(S) Decachlorobiphenyl			69.4	10.0-144	
(S) Tetrachloro-m-xylene			79.7	10.0-135	

L1754575-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754575-01 07/14/24 06:36 • (MS) R4093629-6 07/14/24 07:08 • (MSD) R4093629-7 07/14/24 07:20

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
PCB 1016	0.00250	U	0.00210	0.00204	84.0	81.6	1	50.0-140			2.90	36
PCB 1260	0.00250	U	0.00139	0.00146	55.6	58.4	1	8.00-140			4.91	38
(S) Decachlorobiphenyl					39.5	42.5		10.0-144				
(S) Tetrachloro-m-xylene					69.7	70.6		10.0-135				

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	55.0			29.0-132
(S) 2-Fluorobiphenyl	81.5			26.0-102
(S) 2-Fluorophenol	72.5	J1		10.0-66.0
(S) Nitrobenzene-d5	82.5			15.0-106
(S) p-Terphenyl-d14	95.0			10.0-120

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	69.0	J1		10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.141	70.5	31.0-120	
2,4,6-Trichlorophenol	0.200	0.175	87.5	37.0-144	
2,4-Dichlorophenol	0.200	0.168	84.0	39.0-135	
2,4-Dimethylphenol	0.200	0.171	85.5	32.0-120	
2,4-Dinitrophenol	0.200	0.123	61.5	100-191	
2-Chlorophenol	0.200	0.172	86.0	23.0-134	
2-Methylphenol	0.200	0.179	89.5	26.0-120	
2-Nitrophenol	0.200	0.160	80.0	29.0-182	
3&4-Methyl Phenol	0.200	0.169	84.5	27.0-120	
3,3-Dichlorobenzidine	0.400	0.401	100	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.152	76.0	100-181	
4-Chloro-3-methylphenol	0.200	0.170	85.0	22.0-147	
4-Nitrophenol	0.200	0.121	60.5	100-132	
Anthracene	0.200	0.184	92.0	27.0-133	
Benzidine	0.400	0.125	31.3	100-120	
Benzo(a)anthracene	0.200	0.189	94.5	33.0-143	
Benzo(a)pyrene	0.200	0.200	100	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.163	81.5	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.213	106	8.00-158	
Chrysene	0.200	0.178	89.0	17.0-168	
Di-n-butyl phthalate	0.200	0.196	98.0	100-120	
Hexachloro-1,3-butadiene	0.200	0.128	64.0	24.0-120	
Hexachlorobenzene	0.200	0.150	75.0	100-152	
Hexachlorocyclopentadiene	0.200	0.120	60.0	10.0-120	
Hexachloroethane	0.200	0.142	71.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.174	87.0	39.0-127	
n-Nitrosodiethylamine	0.200	0.182	91.0	10.0-142	
Nitrobenzene	0.200	0.169	84.5	35.0-180	
Nonylphenol	0.200	0.189	94.5	57.0-136	
Pentachlorobenzene	0.200	0.138	69.0	10.0-151	
Pentachlorophenol	0.200	0.163	81.5	14.0-176	
Phenanthrene	0.200	0.173	86.5	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.137	68.5	5.00-120	
Pyridine	0.200	0.0338	16.9	10.0-120	
Total Cresols	0.400	0.348	87.0	36.0-110	
(S) 2,4,6-Tribromophenol			67.5	29.0-132	
(S) 2-Fluorobiphenyl			81.5	26.0-102	
(S) 2-Fluorophenol			75.5	10.0-66.0	J1
(S) Nitrobenzene-d5			81.5	15.0-106	
(S) p-Terphenyl-d14			92.0	10.0-120	
(S) Phenol-d6			73.5	10.0-54.0	J1

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

### Qualifier Description

B	The same analyte is found in the associated blank.
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
P1	RPD value not applicable for sample concentrations less than 5 times the reporting limit.
Q	Sample was prepared and/or analyzed past holding time as defined in the method. Concentrations should be considered minimum values.
T8	Sample(s) received past/too close to holding time expiration.
V	The sample concentration is too high to evaluate accurate spike recoveries.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> GI

<sup>8</sup> AI

<sup>9</sup> Sc



# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey–NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio–VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA–Crypto	TN00003		


## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013

Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.





## CHAIN-OF-CUSTODY Analytical Request Document

Chain-of-Custody is a LEGAL DOCUMENT - Complete all relevant fields

LAB USE ONLY- Affix Workorder/Login Label Here or List Pace Workorder Number or  
MTJL Log-In Number Here

ALL SHADED AREAS are for LAB USE ONLY

Company: <b>GPL</b>		Billing Information:	
Address: <b>13835 CL 489</b>			
Report To:		Email To:	
Copy To:		Site Collection Info/Address:	
Customer Project Name/Number:		State:      County/City:      Time Zone Collected: /      [ ] PT [ ] MT [ ] CT [ ] ET	
Phone:	Site/Facility ID #:	Compliance Monitoring?	
Email:		[ ] Yes      [ ] No	
Collected By (print):	Purchase Order #:	DW PWS ID #:	
	Quote #:	DW Location Code:	
Collected By (signature):	Turnaround Date Required:	Immediately Packed on Ice:	
		[ ] Yes      [ ] No	
Sample Disposal:	Rush:	Field Filtered (if applicable):	
[ ] Dispose as appropriate [ ] Return	[ ] Same Day [ ] Next Day	[ ] Yes      [ ] No	
[ ] Archive: _____	[ ] 2 Day [ ] 3 Day [ ] 4 Day [ ] 5 Day	Analysis: _____	
[ ] Hold: _____	(Expedite Charges Apply)		

Container Preservative Type **										Lab Project Manager:

\*\* Preservative Types: (1) nitric acid, (2) sulfuric acid, (3) hydrochloric acid, (4) sodium hydroxide, (5) zinc acetate, (6) methanol, (7) sodium bisulfate, (8) sodium thiosulfate, (9) hexane, (A) ascorbic acid, (B) ammonium sulfate, (C) ammonium hydroxide, (D) TSP, (U) Unpreserved, (O) Other

## Analyses

Lab Profile/Line:

Lab Sample Receipt Checklist:

Custody Seals Present/Intact	Y	N	NA
Custody Signatures Present	Y	N	NA
Collector Signature Present	Y	N	NA
Bottles Intact	Y	N	NA
Correct Bottles	Y	N	NA
Sufficient Volume	Y	N	NA
Samples Received on Ice	Y	N	NA
VOA - Headspace Acceptable	Y	N	NA
USDA Regulated Soils	Y	N	NA
Samples in Holding Time	Y	N	NA
Residual Chlorine Present	Y	N	NA
Cl Strips:			
Sample pH Acceptable	Y	N	NA
pH Strips:			
Sulfide Present	Y	N	NA
Lead Acetate Strips:			

LAB USE ONLY:

Lab Sample # / Comments:

\* Matrix Codes (Insert in Matrix box below): Drinking Water (DW), Ground Water (GW), Wastewater (WW), Product (P), Soil/Solid (SL), Oil (OL), Wipe (WP), Air (AR), Tissue (TS), Bioassay (B), Vapor (V), Other (OT)

[illegible]

Customer Remarks / Special Conditions / Possible Hazards:	Type of Ice Used:    Wet    Blue    Dry    None	SHORT HOLDS PRESENT (<72 hours):    Y    N    N/A	Lab Sample Temperature Info:
	Packing Material Used:	Lab Tracking #:    2893516	Temp Blank Received:    Y    N    NA Therm ID#: _____
	Radchem sample(s) screened (<500 cpm):    Y    N    NA	Samples received via: FEDEX    UPS    Client    Courier    Pace Courier	Cooler 1 Temp Upon Receipt: _____ oC Cooler 1 Therm Corr. Factor: _____ oC Cooler 1 Corrected Temp: _____ oC

Relinquished by/Company: (Signature)		Date/Time:	Received by/Company: (Signature)		Date/Time:	MTJL LAB USE ONLY		Comments:
Relinquished by/Company: (Signature)		Date/Time:	Received by/Company: (Signature)		Date/Time:	Table #:	Trip Blank Received: Y N NA HCL MeOH TSP Other	
Relinquished by/Company: (Signature)		Date/Time:	Received by/Company: (Signature)		Date/Time:	Acctnum:		
Relinquished by/Company: (Signature)		Date/Time:	Received by/Company: (Signature)		Date/Time:	Template:		
Jel McCain		7/8/24	Bouffie 7/8/24 0951					
Carm Pysen Ramos PACE		7/9/24 1700	FedEx 7/9/24 1700					
FedEx			Jmccain		7-10-24 0900			Non Conformance(s): _____ Page: _____



DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

## Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ AustinClient Name: G PL Project Work order (place label):Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒Received on ice: Wet ☒ Blue ☐ No ice ☐Receiving Lab 1 Thermometer Used: 1218 Cooler Temp °C: 7.9 (Recorded) 10.3 (Correction Factor) 8.2 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AR Date: 7/8

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Sulfide Present Lead Acetate Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas State Sampled: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Non-Conformance(s):	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Login Person: JW Date: 7/8

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

Time estimate: oh

Time spent: oh

## Members



Jeremy Watkins (responsible)



Dorothy Roberts

- ☐ 1. If Chain-of-custody (COC) is not received: contact client and if necessary, fill out a COC and indicate that it was filled out by lab personnel. Note issues on this NCF.
- ☐ 2. If COC is incomplete, check applicable issues below and add details where appropriate:
- ☐ \*Collection date/time missing or incorrect
- ☐ \*Analyses or analytes: missing or Clarification needed
- ☐ \*Samples listed on COC do not match samples recieved (missing, additional,etc.)
- ☐ \*Sample IDs on COC do not match sample Labels
- ☐ \*Required trip blanks were not received
- ☐ \*Required signatures are missing
- ☒ 3. Sample integrity issues: check applicable issues below and add details where appropriate:
- ☒ \*Samples: Past holding time
- ☐ \*Samples: Not Field Filtered
- ☐ \*samples: Insufficient volume received
- ☐ \*Samples: Cooler damaged or compromised
- ☐ \*Samples: contain Chlorine or Sulfide
- ☐ \*Samples: condition needs to be brought to lab personnel's attention (details below)
- ☐ \*Containers: Broken or compromised
- ☐ \*Containers: Incorrect
- ☐ \*Custody Seals: missing or compromised on samples, trip blanks or coolers
- ☐ \*Packing Material: Insufficient/Improper
- ☒ \*Preservation: improper
- ☐ \*Temperature: not within acceptance criteria (typically 0-6C)
- ☐ \*Temperature: Samples arrived frozen
- ☐ \*Vials received with improper headspace
- ☐ \*Other:
- ☐ 4. If Samples not preserved properly and Sample Receiving adjusts pH, add details below:
- ☐ Sample ID: \_\_\_\_\_
- ☐ Preserved by: \_\_\_\_\_
- ☐ Date/Time: \_\_\_\_\_
- ☐ Initial and Final pH: \_\_\_\_\_
- ☐ Amount/type pres added: \_\_\_\_\_
- ☐ Lot # of Pres added: \_\_\_\_\_
- ☐ 5. Client contact: If Client is Contacted for any issue listed above, fill in details below:
- ☒ Client:
- ☒ PM Initials: DPR
- ☒ Contacted per: JMcClain
- ☒ Date/Time: 7/9 1051

## Comments

*Jeremy Watkins*

*9 July 2024 8:48 AM*

1. MBAS, NITRATE, CR6 all out of hold
2. CN and SULFIDE recieved unpreserved.

*Dorothy Roberts*

*10 July 2024 9:34 AM*

Proceed / may not report if replacements can be collected  
also sending replacement bottles to recollect T256352



**Garland Power & Light**

Sample Delivery Group: L1754283

Samples Received: 07/08/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By:



Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1754283-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	17
Wet Chemistry by Method 351.2	18
Wet Chemistry by Method 353.2	19
Wet Chemistry by Method 360.1	20
Wet Chemistry by Method 4500Cl G-2011	21
Wet Chemistry by Method 4500CN-E	22
Wet Chemistry by Method 4500P-E	23
Wet Chemistry by Method 4500-S2 D	24
Wet Chemistry by Method 4500SO3 B-2011	25
Wet Chemistry by Method 5210 B-2016	26
Wet Chemistry by Method 5220D	28
Wet Chemistry by Method 5310C	29
Wet Chemistry by Method 5540C	30
Wet Chemistry by Method SM 4500-H+B	31
Wet Chemistry by Method SM4500NH3H	32
Mercury by Method 245.1	33
Metals (ICP) by Method 200.7	34
Metals (ICPMS) by Method 200.8	35
Volatile Organic Compounds (GC/MS) by Method 624.1	38
Polychlorinated Biphenyls (GC) by Method EPA-608.3	41
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	42
Gl: Glossary of Terms	45
Al: Accreditations & Locations	46
Sc: Sample Chain of Custody	47

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc

# SAMPLE SUMMARY

OUTFALL 001 L1754283-01 WW

Collected by

Collected date/time

Received date/time

07/08/24 12:34

07/08/24 14:30

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2321072	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Calculated Results	WG2323027	1	07/15/24 20:11	07/15/24 20:11	EIG	Allen, TX
Gravimetric Analysis by Method 2540C	WG2321280	1	07/11/24 13:04	07/11/24 15:55	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2322092	1	07/12/24 15:40	07/12/24 17:30	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2320716	1	07/12/24 05:40	07/12/24 07:26	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2320288	1	07/10/24 10:40	07/10/24 10:40	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2320255	1	07/10/24 09:19	07/10/24 09:19	SEN	Allen, TX
Wet Chemistry by Method 300.0	WG2320279	1	07/10/24 23:07	07/10/24 23:07	DLH	Mt. Juliet, TN
Wet Chemistry by Method 3500Cr-B	WG2322157	1	07/12/24 19:03	07/12/24 19:03	KCM	Allen, TX
Wet Chemistry by Method 351.2	WG2323027	1	07/15/24 11:10	07/15/24 20:11	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2321792	1	07/12/24 12:55	07/12/24 12:55	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2324067	1	07/16/24 14:05	07/16/24 14:05	JBS	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2322664	1	07/14/24 12:15	07/14/24 12:15	CAH	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2321047	1	07/11/24 11:30	07/11/24 16:58	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2323646	1	07/16/24 16:14	07/16/24 16:14	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2320999	1	07/11/24 14:26	07/11/24 14:26	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2319662	1	07/09/24 15:00	07/09/24 15:00	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2323050	1	07/15/24 11:20	07/15/24 11:20	JAR	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2319546	1	07/09/24 14:09	07/14/24 13:01	QQT	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2319551	1	07/09/24 15:54	07/14/24 14:30	SEN	Allen, TX
Wet Chemistry by Method 5220D	WG2323013	1	07/15/24 10:31	07/15/24 13:10	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2320357	2	07/11/24 21:00	07/11/24 21:00	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2319936	1	07/09/24 18:54	07/09/24 19:02	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2321035	1	07/11/24 09:01	07/11/24 09:01	JBS	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2321326	1	07/11/24 16:43	07/11/24 16:43	EIG	Allen, TX
Mercury by Method 245.1	WG2320254	1	07/10/24 09:46	07/10/24 16:09	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2320626	1	07/10/24 16:30	07/11/24 15:43	TJG	Allen, TX
Metals (ICPMS) by Method 200.8	WG2321072	1	07/11/24 10:47	07/11/24 21:58	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2319924	1	07/09/24 19:15	07/09/24 19:15	ZST	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2322292	1	07/13/24 19:04	07/14/24 06:24	LJD	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2320434	1	07/10/24 12:55	07/13/24 16:14	XLY	Allen, TX

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager

## Sample Delivery Group (SDG) Narrative

The following analysis were performed from an unpreserved, insufficiently or inadequately preserved sample.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	4500-S2 D, 4500CN-E

The Laboratory is not accredited for specific analytes on the associated Sample/Method. These analytes are flagged in the Sample Results section of the report with an asterisk (\*).

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	300.0

Analysis was filtered in the laboratory.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B

No extra volume received to perform Matrix Spike samples.

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1754283-01</a>	<a href="#">OUTFALL 001</a>	625.1

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc



Calculated Results

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l	mg/l			
Chromium,Trivalent	U		0.000510	0.00300	1	07/12/2024 19:03	<a href="#">WG2321072</a>
Organic Nitrogen	0.343		0.0280	0.100	1	07/15/2024 20:11	<a href="#">WG2323027</a>

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Gravimetric Analysis by Method 2540C

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l				
Total Dissolved Solids	159		25.0		1	07/11/2024 15:55	<a href="#">WG2321280</a>

Gravimetric Analysis by Method 2540D

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l				
Suspended Solids	6.20		2.93		1	07/12/2024 17:30	<a href="#">WG2322092</a>

Wet Chemistry by Method 1664A

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l	mg/l			
Oil & Grease (Hexane Extr)	U		0.350	5.00	1	07/12/2024 07:26	<a href="#">WG2320716</a>

Wet Chemistry by Method 2120B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	units		units				
Color	20.0		5.00		1	07/10/2024 10:40	<a href="#">WG2320288</a>

Sample Narrative:

L1754283-01 WG2320288: 7

Wet Chemistry by Method 2320B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l	mg/l			
Alkalinity	120		20.0	20.0	1	07/10/2024 09:19	<a href="#">WG2320255</a>

Wet Chemistry by Method 300.0

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l	mg/l			
*Bromide	U		0.353	1.00	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Chloride	14.4		0.379	1.00	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Fluoride	0.172		0.0640	0.150	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Nitrate as (N)	U	<a href="#">Q</a>	0.0480	0.100	1	07/10/2024 23:07	<a href="#">WG2320279</a>
Sulfate	23.3		0.594	5.00	1	07/10/2024 23:07	<a href="#">WG2320279</a>

Wet Chemistry by Method 3500Cr-B

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l	mg/l			
Chromium,Hexavalent	U		0.00200	0.00300	1	07/12/2024 19:03	<a href="#">WG2322157</a>

Sample Narrative:

L1754283-01 WG2322157: Sample preserved in lab w/in 24 hrs of collection

Wet Chemistry by Method 351.2

Analyte	Result	Qualifier	MDL	RDL	Dilution	Analysis date / time	Batch
	mg/l		mg/l	mg/l			
Kjeldahl Nitrogen, TKN	0.343	<a href="#">J5</a>	0.140	0.250	1	07/15/2024 20:11	<a href="#">WG2323027</a>

## OUTFALL 001

Collected date/time: 07/08/24 12:34

## SAMPLE RESULTS - 01

L1754283

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	07/12/2024 12:55	<a href="#">WG2321792</a>

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	10.2	<a href="#">T8</a>	1	1	1	07/16/2024 14:05	<a href="#">WG2324067</a>

## Wet Chemistry by Method 4500Cl G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.108	<a href="#">T8</a>	0.0260	0.100	1	07/14/2024 12:15	<a href="#">WG2322664</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/11/2024 16:58	<a href="#">WG2321047</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00350	0.0100	1	07/16/2024 16:14	WG2323646

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.0443	<a href="#">J</a>	0.0152	0.0500	1	07/11/2024 14:26	<a href="#">WG2320999</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/09/2024 15:00	<a href="#">WG2319662</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	07/15/2024 11:20	<a href="#">WG2323050</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	1.39		1.00	1	1	07/14/2024 13:01	<a href="#">WG2319546</a>
CBOD	1.44	<a href="#">B1</a>	1.00	1	1	07/14/2024 14:30	<a href="#">WG2319551</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	19.0	<a href="#">J</a>	16.1	35.0	1	07/15/2024 13:10	<a href="#">WG2323013</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	11.2		0.540	1.40	2	07/11/2024 21:00	<a href="#">WG2320357</a>

1  
Cp

2  
Tc

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">J5</a>	0.360	0.500	1	07/09/2024 19:02	<a href="#">WG2319936</a>

3  
Ss

4  
Cn

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	7.83	<a href="#">T8</a>	1	07/11/2024 09:01	<a href="#">WG2321035</a>

5  
Sr

6  
Qc

Sample Narrative:

L1754283-01 WG2321035: 7.83 at 19.6C

7  
Gl

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	U		0.0280	0.100	1	07/11/2024 16:43	<a href="#">WG2321326</a>

8  
Al

9  
Sc

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	U		0.0000450	0.000200	1	07/10/2024 16:09	<a href="#">WG2320254</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0759	<a href="#">J</a>	0.0186	0.100	1	07/11/2024 15:43	<a href="#">WG2320626</a>
Tin	U		0.00240	0.0250	1	07/11/2024 15:43	<a href="#">WG2320626</a>
Titanium	U		0.00835	0.100	1	07/11/2024 15:43	<a href="#">WG2320626</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.115		0.00186	0.00250	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Antimony	U		0.000580	0.00500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Arsenic	0.00518		0.000100	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Barium	0.0659		0.000440	0.00300	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Beryllium	U		0.0000600	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Cadmium	U		0.000120	0.00100	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Chromium	U		0.000510	0.00300	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Cobalt	0.000199	<a href="#">B J</a>	0.0000400	0.000300	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Copper	0.00609		0.000900	0.00200	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Iron	0.119		0.00432	0.00700	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Lead	U		0.000140	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Magnesium	3.78		0.0121	0.0200	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Manganese	0.135		0.000330	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Molybdenum	0.00103		0.000530	0.00100	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Nickel	0.00161	<a href="#">J</a>	0.000640	0.00200	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Selenium	U		0.000740	0.00500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Silver	U		0.0000800	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>
Thallium	U		0.000190	0.000500	1	07/11/2024 21:58	<a href="#">WG2321072</a>

## OUTFALL 001

Collected date/time: 07/08/24 12:34

## SAMPLE RESULTS - 01

L1754283

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	U		0.00265	0.00500	1	07/11/2024 21:58	<a href="#">WG2321072</a>

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
2-Butanone (MEK)	U		0.00822	0.0250	1	07/09/2024 19:15	<a href="#">WG2319924</a>
2-Chloroethyl vinyl ether	U		0.00652	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Acrolein	U		0.00544	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Acrylonitrile	U		0.00709	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Benzene	U		0.00207	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Bromoform	U		0.000960	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Bromomethane	U		0.00347	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chlorobenzene	U		0.00276	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chloroethane	U		0.00296	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chloroform	U		0.00212	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Chloromethane	U		0.00361	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Ethylbenzene	U		0.000401	0.00200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Methylene Chloride	U		0.0117	0.0200	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Toluene	U		0.00219	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Trichloroethene	U		0.00262	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
Vinyl chloride	U		0.00466	0.00500	1	07/09/2024 19:15	<a href="#">WG2319924</a>
(S) 1,2-Dichloroethane-d4	93.2			70.0-130		07/09/2024 19:15	<a href="#">WG2319924</a>
(S) 4-Bromofluorobenzene	93.1			70.0-130		07/09/2024 19:15	<a href="#">WG2319924</a>
(S) Toluene-d8	100			70.0-130		07/09/2024 19:15	<a href="#">WG2319924</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1221	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1232	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1242	U		0.000270	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1248	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1254	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
PCB 1260	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
Total PCBs	U		0.000173	0.000500	1	07/14/2024 06:24	<a href="#">WG2322292</a>
(S) Decachlorobiphenyl	43.0			10.0-144		07/14/2024 06:24	<a href="#">WG2322292</a>
(S) Tetrachloro-m-xylene	71.7			10.0-135		07/14/2024 06:24	<a href="#">WG2322292</a>

## OUTFALL 001

Collected date/time: 07/08/24 12:34

## SAMPLE RESULTS - 01

L1754283

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2-Chlorophenol	U		0.000307	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2-Methylphenol	U		0.000238	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
2-Nitrophenol	U		0.000247	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	07/13/2024 16:14	<a href="#">WG2320434</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
4-Nitrophenol	U		0.00123	0.0100	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Anthracene	U		0.000168	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Benzidine	U		0.000350	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Chrysene	U		0.000257	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachlorobenzene	U		0.000307	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Hexachloroethane	U		0.000247	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Nitrobenzene	U		0.000314	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Nonylphenol	U		0.000168	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Pentachlorobenzene	U		0.000247	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Pentachlorophenol	U		0.000283	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Phenanthrene	U		0.000200	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Phenol	U		0.000500	0.00200	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Pyridine	U		0.00174	0.00400	1	07/13/2024 16:14	<a href="#">WG2320434</a>
Total Cresols	U		0.00153	0.00800	1	07/13/2024 16:14	<a href="#">WG2320434</a>
(S) 2,4,6-Tribromophenol	48.6			29.0-132		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) 2-Fluorobiphenyl	74.5			26.0-102		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) 2-Fluorophenol	63.5			10.0-66.0		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) Nitrobenzene-d5	73.5			15.0-106		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) p-Terphenyl-d14	84.5			10.0-120		07/13/2024 16:14	<a href="#">WG2320434</a>
(S) Phenol-D6	56.5	<a href="#">J1</a>		10.0-54.0		07/13/2024 16:14	<a href="#">WG2320434</a>

<sup>1</sup> Cp<sup>2</sup> Tc<sup>3</sup> Ss<sup>4</sup> Cn<sup>5</sup> Sr<sup>6</sup> Qc<sup>7</sup> Gl<sup>8</sup> Al<sup>9</sup> Sc

Method Blank (MB)

(MB) R4093133-1 07/11/24 15:55

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Total Dissolved Solids	U		25.0	25.0

L1754251-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754251-01 07/11/24 15:55 • (DUP) R4093133-3 07/11/24 15:55

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	467	416	1	11.6	J3	10

L1754251-03 Original Sample (OS) • Duplicate (DUP)

(OS) L1754251-03 07/11/24 15:55 • (DUP) R4093133-4 07/11/24 15:55

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Total Dissolved Solids	450	475	1	5.41		10

Laboratory Control Sample (LCS)

(LCS) R4093133-2 07/11/24 15:55

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Total Dissolved Solids	2410	2440	101	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4093943-1 07/12/24 17:30

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Suspended Solids	U		2.50	2.50

L1754525-04 Original Sample (OS) • Duplicate (DUP)

(OS) L1754525-04 07/12/24 17:30 • (DUP) R4093943-3 07/12/24 17:30

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	15400	15400	1	0.260		10

L1754525-06 Original Sample (OS) • Duplicate (DUP)

(OS) L1754525-06 07/12/24 17:30 • (DUP) R4093943-4 07/12/24 17:30

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	15700	15700	1	0.000		10

Laboratory Control Sample (LCS)

(LCS) R4093943-2 07/12/24 17:30

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Suspended Solids	879	844	96.0	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093066-1 07/12/24 07:26

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4093066-2 07/12/24 07:26 • (LCSD) R4093066-3 07/12/24 07:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	39.8	37.9	99.5	94.8	78.0-114			4.89	18

L1753717-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1753717-02 07/12/24 07:26 • (MS) R4093066-4 07/12/24 07:26

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	39.6	99.0	1	78.0-114	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4092474-1 07/10/24 10:40

Analyte	MB Result units	MB Qualifier	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:

BLANK: 7

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/10/24 10:40 • (DUP) R4092474-2 07/10/24 10:40

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:

OS: 7

DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091926-1 07/10/24 09:19

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/10/24 09:19 • (DUP) R4091926-3 07/10/24 09:19

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	120	118	1	2.11		20

Laboratory Control Sample (LCS)

(LCS) R4091926-2 07/10/24 09:19

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	240	96.0	90.0-110	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092616-3 07/10/24 19:14

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.353	1.00
Chloride	U		0.379	1.00
Fluoride	U		0.0640	0.150
Nitrate as (N)	U		0.0480	0.100
Sulfate	U		0.594	5.00

L1754251-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754251-01 07/10/24 21:50 • (DUP) R4092616-5 07/10/24 22:03

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	U	U	1	0.000		15
Chloride	112	112	1	0.610		15
Fluoride	0.393	0.408	1	3.67		15
Nitrate as (N)	0.155	0.244	1	44.5	P1	15
Sulfate	22.2	22.2	1	0.105		15

L1754732-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754732-01 07/11/24 01:02 • (DUP) R4092616-8 07/11/24 01:15

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Bromide	U	U	1	0.000		15
Chloride	2.86	2.84	1	0.806		15
Fluoride	0.653	0.643	1	1.58		15
Nitrate as (N)	0.0661	0.0653	1	1.22	J	15
Sulfate	1.27	1.32	1	3.37	J	15

Laboratory Control Sample (LCS)

(LCS) R4092616-4 07/10/24 19:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	40.0	40.0	99.9	90.0-110	
Chloride	40.0	39.3	98.3	90.0-110	
Fluoride	8.00	8.20	102	90.0-110	
Nitrate as (N)	8.00	7.87	98.4	90.0-110	

Cp

Tc

Ss

Cn

Sr

Qc

Gl

Al

Sc

Laboratory Control Sample (LCS)

(LCS) R4092616-4 07/10/24 19:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Sulfate	40.0	39.3	98.1	90.0-110	

L1754251-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754251-01 07/10/24 21:50 • (MS) R4092616-6 07/10/24 22:16 • (MSD) R4092616-7 07/10/24 22:29

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Bromide	40.0	U	40.4	40.9	101	102	1	80.0-120			1.03	15
Chloride	40.0	112	130	130	45.8	46.8	1	80.0-120	J6	J6	0.313	15
Fluoride	8.00	0.393	9.14	8.41	109	100	1	80.0-120			8.31	15
Nitrate as (N)	8.00	0.155	8.04	8.09	98.5	99.2	1	80.0-120			0.661	15
Sulfate	40.0	22.2	57.6	58.7	88.4	91.3	1	80.0-120			2.00	15

L1754732-01 Original Sample (OS) • Matrix Spike (MS)

(OS) L1754732-01 07/11/24 01:02 • (MS) R4092616-9 07/11/24 01:28

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>
Bromide	40.0	U	39.7	99.2	1	80.0-120	
Chloride	40.0	2.86	42.2	98.5	1	80.0-120	
Fluoride	8.00	0.653	8.69	100	1	80.0-120	
Nitrate as (N)	8.00	0.0661	8.00	99.2	1	80.0-120	
Sulfate	40.0	1.27	40.3	97.7	1	80.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093286-1 07/12/24 19:03

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

Laboratory Control Sample (LCS)

(LCS) R4093286-2 07/12/24 19:03

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.195	97.7	85.0-115	

7  
Gl

8  
Al

9  
Sc

L1756127-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756127-01 07/12/24 19:03 • (MS) R4093286-3 07/12/24 19:03 • (MSD) R4093286-4 07/12/24 19:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.204	0.202	102	101	1	10.0-120			0.842	20

Method Blank (MB)

(MB) R4094061-1 07/15/24 20:06

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Kjeldahl Nitrogen, TKN	U		0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4094061-2 07/15/24 20:07

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Kjeldahl Nitrogen, TKN	4.00	4.27	107	90.0-110	

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/15/24 20:10 • (MS) R4094061-3 07/15/24 20:44 • (MSD) R4094061-4 07/15/24 20:45

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	4.00	1.03	5.64	6.51	115	137	1	90.0-110	J5	J5	14.3	20

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 20:11 • (MS) R4094061-5 07/15/24 20:46 • (MSD) R4094061-6 07/15/24 20:48

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	4.00	0.343	4.88	4.63	113	107	1	90.0-110	J5		5.26	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093045-1 07/12/24 12:50

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4093045-2 07/12/24 12:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Nitrate-Nitrite	2.50	2.40	96.0	90.0-110	

L1754182-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754182-01 07/12/24 12:51 • (MS) R4093045-3 07/12/24 12:59 • (MSD) R4093045-4 07/12/24 13:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	0.794	3.13	3.11	93.4	92.6	1	90.0-110			0.641	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/16/24 14:05 • (DUP) R4094367-1 07/16/24 14:05

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	<u>DUP Qualifier</u>	DUP RPD Limits %
Dissolved Oxygen	7.77	8.25	1	5.99		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



Method Blank (MB)

(MB) R4093561-1 07/14/24 11:59

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chlorine,residual	U		0.0260	0.100

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/14/24 12:14 • (DUP) R4093561-3 07/14/24 12:15

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Chlorine,residual	0.0330	0.0340	1	2.99	J	20

Laboratory Control Sample (LCS)

(LCS) R4093561-2 07/14/24 12:13

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chlorine,residual	1.00	0.960	96.0	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092740-1 07/11/24 16:58

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4092740-2 07/11/24 16:58

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Cyanide	0.100	0.0908	90.8	85.0-115	

L1754359-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754359-01 07/11/24 16:58 • (MS) R4092740-3 07/11/24 16:58 • (MSD) R4092740-4 07/11/24 16:58

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	U	0.0928	0.0928	92.8	92.8	1	85.0-115			0.000	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092631-1 07/11/24 14:26

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4092631-2 07/11/24 14:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phosphorus,Total	0.500	0.526	105	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/11/24 14:26 • (MS) R4092631-3 07/11/24 14:27 • (MSD) R4092631-4 07/11/24 14:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.0443	0.569	0.562	105	104	1	80.0-120			1.20	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4091612-1 07/09/24 15:00

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4091612-2 07/09/24 15:00

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Sulfide	0.800	0.850	106	80.0-120	

L1753522-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753522-01 07/09/24 15:00 • (MS) R4091612-3 07/09/24 15:03 • (MSD) R4091612-4 07/09/24 15:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Sulfide	0.800	U	0.772	0.769	96.5	96.1	1	80.0-120			0.453	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4093789-1 07/15/24 11:20

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1754191-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754191-01 07/15/24 11:20 • (DUP) R4093789-3 07/15/24 11:20

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	U	U	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4093789-2 07/15/24 11:20

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 11:20 • (MS) R4093789-4 07/15/24 11:20 • (MSD) R4093789-5 07/15/24 11:20

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	19.0	18.5	95.0	92.5	1	85.0-115			2.67	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093582-1 07/14/24 12:45

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
BOD	U		0.200	0.200

L1754172-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754172-01 07/14/24 12:55 • (DUP) R4093582-3 07/14/24 13:42

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
BOD	3.30	ND	1	200	P1	20

L1754283-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754283-01 07/14/24 13:01 • (DUP) R4093582-4 07/14/24 13:44

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
BOD	1.39	1.45	1	4.23		20

Laboratory Control Sample (LCS)

(LCS) R4093582-2 07/14/24 12:52

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
BOD	198	187	94.6	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093709-1 07/14/24 14:20

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
CBOD	0.220	B1	0.200	0.200

1 Cp

2 Tc

3 Ss

L1754373-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754373-01 07/14/24 14:46 • (DUP) R4093709-3 07/14/24 14:54

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
CBOD	1.04	7.58	1	200	J3	20

4 Cn

5 Sr

6 Qc

Laboratory Control Sample (LCS)

(LCS) R4093709-2 07/14/24 14:26

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
CBOD	198	183	92.5	85-115	

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4093841-1 07/15/24 13:10

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

Laboratory Control Sample (LCS)

(LCS) R4093841-2 07/15/24 13:10

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
COD	500	511	102	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/15/24 13:10 • (MS) R4093841-3 07/15/24 13:10 • (MSD) R4093841-4 07/15/24 13:10

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
COD	500	19.0	517	524	99.7	101	1	80.0-120			1.22	20

L1754768-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754768-01 07/15/24 13:10 • (MS) R4093841-5 07/15/24 13:10 • (MSD) R4093841-6 07/15/24 13:10

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
COD	500	67.6	524	526	91.2	91.7	1	80.0-120			0.402	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4092962-1 07/11/24 16:22

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4092962-2 07/11/24 16:42

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
TOC (Total Organic Carbon)	10.0	10.4	104	90.0-110	

L1754776-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754776-01 07/11/24 17:08 • (MS) R4092962-3 07/11/24 17:54 • (MSD) R4092962-4 07/11/24 18:14

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
TOC (Total Organic Carbon)	100	30.8	127	127	96.3	96.3	10	80.0-120			0.000	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4092475-1 07/09/24 19:02

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4092475-2 07/09/24 19:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
MBAS	1.00	1.17	117	80.0-120	

L1754283-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754283-01 07/09/24 19:02 • (MS) R4092475-3 07/09/24 19:02 • (MSD) R4092475-4 07/09/24 19:02

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
MBAS	1.00	U	1.20	1.25	120	125	1	80.0-120		J5	3.87	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1754340-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1754340-01 07/11/24 09:01 • (DUP) R4092476-2 07/11/24 09:01

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	su	su		%		%
pH	7.61	7.62	1	0.131		20

Sample Narrative:  
OS: 7.61 at 19.6C  
DUP: 7.62 at 19.3C

Laboratory Control Sample (LCS)

(LCS) R4092476-1 07/11/24 09:01

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	su	su	%	%	
pH	6.00	5.99	99.8	99.0-101	

Sample Narrative:  
LCS: 5.99 at 22C

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092766-1 07/11/24 16:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	0.0285	⬇	0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4092766-2 07/11/24 16:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.28	106	80.0-120	

L1754163-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754163-02 07/11/24 16:39 • (MS) R4092766-3 07/11/24 16:32 • (MSD) R4092766-4 07/11/24 16:34

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.369	5.44	5.43	101	101	1	80.0-120			0.184	20

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/11/24 16:41 • (MS) R4092766-5 07/11/24 16:36 • (MSD) R4092766-6 07/11/24 16:37

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	U	5.12	5.15	102	103	1	80.0-120			0.584	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092198-3 07/10/24 16:35

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Mercury	0.0000450	J	0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4092198-4 07/10/24 16:37

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Mercury	0.00250	0.00227	90.8	85.0-115	

L1753552-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1753552-01 07/10/24 16:40 • (MS) R4092198-5 07/10/24 16:42 • (MSD) R4092198-6 07/10/24 16:44

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	0.0000520	0.00170	0.00171	65.9	66.3	1	70.0-130	J6	J6	0.587	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4092733-2 07/11/24 13:15

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4092733-1 07/11/24 13:12

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.962	96.2	85.0-115	
Tin	1.00	0.999	99.9	85.0-115	
Titanium	1.00	0.996	99.6	85.0-115	

L1754731-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754731-01 07/11/24 13:19 • (MS) R4092733-3 07/11/24 13:23 • (MSD) R4092733-4 07/11/24 13:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	0.0190	0.980	0.983	96.1	96.4	1	70.0-130			0.357	20
Tin	1.00	0.00833	1.00	1.01	99.2	99.8	1	70.0-130			0.598	20
Titanium	1.00	0.0438	1.04	1.04	99.3	99.6	1	70.0-130			0.289	20

L1754768-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754768-01 07/11/24 14:11 • (MS) R4092733-5 07/11/24 14:15 • (MSD) R4092733-6 07/11/24 14:19

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	1.72	2.62	2.65	89.9	93.5	1	70.0-130			1.37	20
Tin	1.00	U	0.947	0.958	94.7	95.8	1	70.0-130			1.11	20
Titanium	1.00	U	0.977	0.995	97.7	99.5	1	70.0-130			1.73	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4092690-1 07/11/24 15:02

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Aluminum	0.00743		0.00186	0.00250
Antimony	U		0.000580	0.00500
Arsenic	0.000222	U	0.000100	0.000500
Barium	U		0.000440	0.00300
Beryllium	0.000152	U	0.0000600	0.000500
Cadmium	U		0.000120	0.00100
Chromium	U		0.000510	0.00300
Cobalt	0.000117	U	0.0000400	0.000300
Copper	U		0.000900	0.00200
Iron	0.00776		0.00432	0.00700
Lead	U		0.000140	0.000500
Magnesium	U		0.0121	0.0200
Manganese	U		0.000330	0.000500
Molybdenum	U		0.000530	0.00100
Nickel	U		0.000640	0.00200
Selenium	U		0.000740	0.00500
Silver	0.0000896	U	0.0000800	0.000500
Thallium	0.000232	U	0.000190	0.000500
Zinc	U		0.00265	0.00500

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4092690-2 07/11/24 15:08

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Aluminum	1.00	0.969	96.9	85.0-115	
Antimony	0.100	0.0971	97.1	85.0-115	
Arsenic	0.100	0.0983	98.3	85.0-115	
Barium	0.100	0.0963	96.3	85.0-115	
Beryllium	0.100	0.0990	99.0	85.0-115	
Cadmium	0.100	0.0998	99.8	85.0-115	
Chromium	0.100	0.0995	99.5	85.0-115	
Cobalt	0.100	0.0999	99.9	85.0-115	
Copper	0.100	0.101	101	85.0-115	
Iron	1.00	0.971	97.1	85.0-115	
Lead	0.100	0.0951	95.1	85.0-115	
Magnesium	1.00	1.00	100	85.0-115	
Manganese	0.100	0.0981	98.1	85.0-115	
Molybdenum	0.100	0.100	100	85.0-115	

Laboratory Control Sample (LCS)

(LCS) R4092690-2 07/11/24 15:08

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Nickel	0.100	0.101	101	85.0-115	
Selenium	0.100	0.101	101	85.0-115	
Silver	0.0500	0.0505	101	85.0-115	
Thallium	0.100	0.0900	90.0	85.0-115	
Zinc	0.100	0.0963	96.3	85.0-115	

L1752148-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1752148-01 07/11/24 15:15 • (MS) R4092690-3 07/11/24 15:21 • (MSD) R4092690-4 07/11/24 15:27

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Aluminum	1.00	0.0185	0.981	0.958	96.3	93.9	1	70.0-130			2.39	20
Antimony	0.100	0.000615	0.0978	0.0991	97.2	98.5	1	70.0-130			1.39	20
Arsenic	0.100	0.0149	0.113	0.113	97.7	97.8	1	70.0-130			0.0911	20
Barium	0.100	0.427	0.523	0.529	96.4	102	1	70.0-130			1.08	20
Beryllium	0.100	0.000212	0.0935	0.0912	93.3	91.0	1	70.0-130			2.44	20
Cadmium	0.100	0.000135	0.0926	0.0923	92.5	92.1	1	70.0-130			0.419	20
Chromium	0.100	0.0179	0.114	0.112	96.4	94.1	1	70.0-130			2.02	20
Cobalt	0.100	0.000261	0.0957	0.0961	95.5	95.8	1	70.0-130			0.341	20
Copper	0.100	0.0163	0.110	0.110	93.7	94.2	1	70.0-130			0.435	20
Iron	1.00	0.149	1.08	1.07	92.9	91.9	1	70.0-130			0.897	20
Lead	0.100	0.000194	0.0913	0.0906	91.1	90.4	1	70.0-130			0.834	20
Magnesium	1.00	33.8	35.1	34.4	125	54.6	1	70.0-130		V	2.02	20
Manganese	0.100	0.00562	0.101	0.0990	95.6	93.4	1	70.0-130			2.17	20
Molybdenum	0.100	0.00292	0.103	0.103	99.8	99.8	1	70.0-130			0.0476	20
Nickel	0.100	0.0466	0.140	0.140	93.1	92.9	1	70.0-130			0.152	20
Selenium	0.100	0.0173	0.117	0.115	99.3	98.1	1	70.0-130			0.986	20
Silver	0.0500	0.000107	0.0474	0.0468	94.5	93.4	1	70.0-130			1.17	20
Thallium	0.100	0.000987	0.0860	0.0863	85.0	85.3	1	70.0-130			0.438	20
Zinc	0.100	0.00409	0.0947	0.0940	90.6	89.9	1	70.0-130			0.793	20

L1754390-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754390-06 07/11/24 22:48 • (MS) R4092690-5 07/11/24 22:55 • (MSD) R4092690-6 07/11/24 23:01

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Antimony	0.100	U	0.0992	0.0970	99.2	97.0	1	70.0-130			2.24	20
Arsenic	0.100	0.000533	0.0977	0.0956	97.1	95.0	1	70.0-130			2.16	20
Barium	0.100	0.0429	0.145	0.143	102	99.8	1	70.0-130			1.67	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



L1754390-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754390-06 07/11/24 22:48 • (MS) R4092690-5 07/11/24 22:55 • (MSD) R4092690-6 07/11/24 23:01

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Beryllium	0.100	U	0.0938	0.102	93.8	102	1	70.0-130			8.31	20
Cadmium	0.100	0.000379	0.0952	0.0955	94.8	95.1	1	70.0-130			0.298	20
Chromium	0.100	U	0.0948	0.0957	94.8	95.7	1	70.0-130			0.921	20
Cobalt	0.100	0.00123	0.0992	0.0972	98.0	96.0	1	70.0-130			2.07	20
Copper	0.100	0.290	0.419	0.409	129	119	1	70.0-130			2.41	20
Iron	1.00	0.00434	0.930	0.940	92.6	93.5	1	70.0-130			0.996	20
Lead	0.100	0.00217	0.0951	0.0936	92.9	91.4	1	70.0-130			1.60	20
Magnesium	1.00	3.50	4.78	4.77	128	127	1	70.0-130			0.0436	20
Manganese	0.100	0.256	0.374	0.375	118	119	1	70.0-130			0.191	20
Molybdenum	0.100	0.000975	0.102	0.0997	101	98.8	1	70.0-130			2.54	20
Nickel	0.100	0.304	0.439	0.431	135	127	1	70.0-130	J5		1.79	20
Selenium	0.100	U	0.0991	0.104	99.1	104	1	70.0-130			4.71	20
Silver	0.0500	U	0.0483	0.0485	96.6	97.1	1	70.0-130			0.481	20
Thallium	0.100	U	0.0907	0.0885	90.7	88.5	1	70.0-130			2.46	20
Zinc	0.100	1.14	1.37	1.34	221	199	1	70.0-130	V	V	1.61	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4091976-2 07/09/24 17:32

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Butanone (MEK)	U		0.00822	0.0250
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	0.00317	U	0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	93.5			70.0-130
(S) 4-Bromofluorobenzene	99.6			70.0-130
(S) Toluene-d8	97.4			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4091976-1 07/09/24 16:24

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0200	0.0201	101	70.0-130	
1,1,2,2-Tetrachloroethane	0.0200	0.0185	92.5	60.0-140	
1,1,2-Trichloroethane	0.0200	0.0190	95.0	70.0-130	
1,1-Dichloroethene	0.0200	0.0195	97.5	50.0-150	
1,1-Dichloroethane	0.0200	0.0203	102	70.0-130	
1,2-Dibromoethane	0.0200	0.0186	93.0	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0203	102	65.0-135	
1,2-Dichloroethane	0.0200	0.0202	101	70.0-130	
1,2-Dichloropropane	0.0200	0.0181	90.5	35.0-165	
1,3-Dichlorobenzene	0.0200	0.0195	97.5	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0192	96.0	65.0-135	
2-Butanone (MEK)	0.100	0.0829	82.9	70.0-130	
2-Chloroethyl vinyl ether	0.100	0.0529	52.9	1.00-225	
Acrolein	0.100	0.105	105	64.0-139	
Acrylonitrile	0.100	0.104	104	67.0-136	
Benzene	0.0200	0.0197	98.5	65.0-135	
Bromodichloromethane	0.0200	0.0203	102	65.0-135	
Bromoform	0.0200	0.0233	117	70.0-130	
Bromomethane	0.0200	0.0329	165	15.0-185	
Carbon tetrachloride	0.0200	0.0216	108	70.0-130	
Chlorobenzene	0.0200	0.0196	98.0	65.0-135	
Chloroethane	0.0200	0.0214	107	40.0-160	
Chloroform	0.0200	0.0207	104	70.0-135	
Chloromethane	0.0200	0.0159	79.5	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0177	88.5	25.0-175	
Dibromochloromethane	0.0200	0.0202	101	70.0-135	
Ethylbenzene	0.0200	0.0197	98.5	60.0-140	
Methylene Chloride	0.0200	0.0221	111	60.0-140	
Tetrachloroethene	0.0200	0.0181	90.5	70.0-130	
Toluene	0.0200	0.0196	98.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0206	103	70.0-130	
Trichloroethene	0.0200	0.0201	101	65.0-135	
Vinyl chloride	0.0200	0.0208	104	5.00-195	
(S) 1,2-Dichloroethane-d4			95.4	70.0-130	
(S) 4-Bromofluorobenzene			91.3	70.0-130	
(S) Toluene-d8			99.6	70.0-130	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

L1754191-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754191-01 07/09/24 18:02 • (MS) R4091976-3 07/09/24 18:26 • (MSD) R4091976-4 07/09/24 18:51

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0199	U	0.0200	0.0203	101	102	1	52.0-162			1.49	36
1,1,2,2-Tetrachloroethane	0.0201	U	0.0183	0.0188	91.0	93.5	1	46.0-157			2.70	61
1,1,2-Trichloroethane	0.0199	U	0.0194	0.0193	97.5	97.0	1	52.0-150			0.517	45
1,1-Dichloroethene	0.0200	U	0.0203	0.0203	102	102	1	1.00-234			0.000	32
1,1-Dichloroethane	0.0200	U	0.0214	0.0211	107	105	1	59.0-155			1.41	40
1,2-Dibromoethane	0.0200	U	0.0184	0.0187	92.0	93.5	1	70.0-130			1.62	20
1,2-Dichlorobenzene	0.0200	U	0.0212	0.0213	106	106	1	18.0-190			0.471	57
1,2-Dichloroethane	0.0200	U	0.0208	0.0209	104	105	1	49.0-155			0.480	49
1,2-Dichloropropane	0.0199	U	0.0185	0.0185	93.0	93.0	1	1.00-210			0.000	55
1,3-Dichlorobenzene	0.0199	U	0.0203	0.0205	102	103	1	59.0-156			0.980	43
1,4-Dichlorobenzene	0.0200	U	0.0201	0.0201	101	101	1	18.0-190			0.000	57
2-Butanone (MEK)	0.100	U	0.0762	0.0774	76.2	77.4	1	70.0-130			1.56	20
2-Chloroethyl vinyl ether	0.100	U	U	U	0.000	0.000	1	1.00-305	J6	J6	0.000	71
Acrolein	0.100	U	0.0936	0.0921	93.6	92.1	1	4.00-172			1.62	20
Acrylonitrile	0.100	U	0.0986	0.104	98.6	104	1	22.0-189			5.33	20
Benzene	0.0200	U	0.0204	0.0202	102	101	1	37.0-151			0.985	61
Bromodichloromethane	0.0199	U	0.0203	0.0199	102	100	1	35.0-155			1.99	56
Bromoform	0.0198	U	0.0225	0.0229	114	116	1	70.0-130			1.76	42
Bromomethane	0.0200	U	0.0261	0.0283	131	142	1	15.0-185			8.09	61
Carbon tetrachloride	0.0200	U	0.0224	0.0225	112	113	1	70.0-140			0.445	41
Chlorobenzene	0.0200	U	0.0203	0.0205	102	103	1	37.0-160			0.980	53
Chloroethane	0.0200	U	0.0203	0.0198	102	99.0	1	14.0-230			2.49	78
Chloroform	0.0200	U	0.0212	0.0215	106	108	1	51.0-138			1.41	54
Chloromethane	0.0200	U	0.0133	0.0137	66.5	68.5	1	1.00-273			2.96	20
cis-1,3-Dichloropropene	0.0200	U	0.0179	0.0181	89.5	90.5	1	1.00-227			1.11	58
Dibromochloromethane	0.0198	U	0.0204	0.0202	103	102	1	53.0-149			0.985	50
Ethylbenzene	0.0200	U	0.0211	0.0209	105	105	1	37.0-162			0.952	63
Methylene Chloride	0.0204	U	0.0193	0.0198	94.6	97.1	1	1.00-221	J	J	2.56	28
Tetrachloroethene	0.0200	U	0.0194	0.0193	97.0	96.5	1	64.0-148			0.517	39
Toluene	0.0200	U	0.0208	0.0206	104	103	1	47.0-150			0.966	41
trans-1,2-Dichloroethene	0.0200	U	0.0213	0.0213	106	106	1	54.0-156			0.000	45
Trichloroethene	0.0200	U	0.0215	0.0213	108	106	1	70.0-157			0.935	48
Vinyl chloride	0.0200	U	0.0189	0.0187	94.5	93.5	1	1.00-251			1.06	66
(S) 1,2-Dichloroethane-d4					97.2	97.9		70.0-130				
(S) 4-Bromofluorobenzene					90.3	91.8		70.0-130				
(S) Toluene-d8					101	100		70.0-130				

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4093629-1 07/14/24 04:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
PCB 1016	U		0.000270	0.000500
PCB 1221	U		0.000270	0.000500
PCB 1232	U		0.000270	0.000500
PCB 1242	U		0.000270	0.000500
PCB 1248	U		0.000173	0.000500
PCB 1254	U		0.000173	0.000500
PCB 1260	U		0.000173	0.000500
Total PCBs	U		0.000173	0.000500
(S) Decachlorobiphenyl	40.9			10.0-144
(S) Tetrachloro-m-xylene	77.2			10.0-135

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

Laboratory Control Sample (LCS)

(LCS) R4093629-5 07/14/24 04:50

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00226	90.4	50.0-140	
PCB 1260	0.00250	0.00211	84.4	8.00-140	
(S) Decachlorobiphenyl			69.4	10.0-144	
(S) Tetrachloro-m-xylene			79.7	10.0-135	

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1754575-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754575-01 07/14/24 06:36 • (MS) R4093629-6 07/14/24 07:08 • (MSD) R4093629-7 07/14/24 07:20

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
PCB 1016	0.00250	U	0.00210	0.00204	84.0	81.6	1	50.0-140			2.90	36
PCB 1260	0.00250	U	0.00139	0.00146	55.6	58.4	1	8.00-140			4.91	38
(S) Decachlorobiphenyl					39.5	42.5		10.0-144				
(S) Tetrachloro-m-xylene					69.7	70.6		10.0-135				

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	55.0			29.0-132
(S) 2-Fluorobiphenyl	81.5			26.0-102
(S) 2-Fluorophenol	72.5	J1		10.0-66.0
(S) Nitrobenzene-d5	82.5			15.0-106
(S) p-Terphenyl-d14	95.0			10.0-120

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4093641-1 07/13/24 14:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	69.0	J1		10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.141	70.5	31.0-120	
2,4,6-Trichlorophenol	0.200	0.175	87.5	37.0-144	
2,4-Dichlorophenol	0.200	0.168	84.0	39.0-135	
2,4-Dimethylphenol	0.200	0.171	85.5	32.0-120	
2,4-Dinitrophenol	0.200	0.123	61.5	100-191	
2-Chlorophenol	0.200	0.172	86.0	23.0-134	
2-Methylphenol	0.200	0.179	89.5	26.0-120	
2-Nitrophenol	0.200	0.160	80.0	29.0-182	
3&4-Methyl Phenol	0.200	0.169	84.5	27.0-120	
3,3-Dichlorobenzidine	0.400	0.401	100	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.152	76.0	100-181	
4-Chloro-3-methylphenol	0.200	0.170	85.0	22.0-147	
4-Nitrophenol	0.200	0.121	60.5	100-132	
Anthracene	0.200	0.184	92.0	27.0-133	
Benzidine	0.400	0.125	31.3	100-120	
Benzo(a)anthracene	0.200	0.189	94.5	33.0-143	
Benzo(a)pyrene	0.200	0.200	100	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.163	81.5	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.213	106	8.00-158	
Chrysene	0.200	0.178	89.0	17.0-168	
Di-n-butyl phthalate	0.200	0.196	98.0	100-120	
Hexachloro-1,3-butadiene	0.200	0.128	64.0	24.0-120	
Hexachlorobenzene	0.200	0.150	75.0	100-152	
Hexachlorocyclopentadiene	0.200	0.120	60.0	10.0-120	
Hexachloroethane	0.200	0.142	71.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.174	87.0	39.0-127	
n-Nitrosodiethylamine	0.200	0.182	91.0	10.0-142	
Nitrobenzene	0.200	0.169	84.5	35.0-180	
Nonylphenol	0.200	0.189	94.5	57.0-136	
Pentachlorobenzene	0.200	0.138	69.0	10.0-151	
Pentachlorophenol	0.200	0.163	81.5	14.0-176	
Phenanthrene	0.200	0.173	86.5	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4093641-2 07/13/24 15:15

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.137	68.5	5.00-120	
Pyridine	0.200	0.0338	16.9	10.0-120	
Total Cresols	0.400	0.348	87.0	36.0-110	
(S) 2,4,6-Tribromophenol			67.5	29.0-132	
(S) 2-Fluorobiphenyl			81.5	26.0-102	
(S) 2-Fluorophenol			75.5	10.0-66.0	J1
(S) Nitrobenzene-d5			81.5	15.0-106	
(S) p-Terphenyl-d14			92.0	10.0-120	
(S) Phenol-d6			73.5	10.0-54.0	J1

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
ND	Not detected at the Reporting Limit (or MDL where applicable).
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier	Description
B	The same analyte is found in the associated blank.
B1	The blank depletion was greater than the recommended maximum depletion of 0.2mg/L.
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J3	The associated batch QC was outside the established quality control range for precision.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
P1	RPD value not applicable for sample concentrations less than 5 times the reporting limit.
Q	Sample was prepared and/or analyzed past holding time as defined in the method. Concentrations should be considered minimum values.
T8	Sample(s) received past/too close to holding time expiration.
V	The sample concentration is too high to evaluate accurate spike recoveries.

1	Cp
2	Tc
3	Ss
4	Cn
5	Sr
6	Qc
7	Gi
8	Al
9	Sc

# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey–NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio–VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA–Crypto	TN00003		


## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013

Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.



## CHAIN-OF-CUSTODY Analytical Request Document

Chain-of-Custody is a LEGAL DOCUMENT - Complete all relevant fields

LAB USE ONLY- Affix Workorder/Login Label Here or List Pace Workorder Number or  
MTJL Log-in Number Here

ALL SHADED AREAS are for LAB USE ONLY

Container Preservative Type \*\*

Lab Project Manager:

\*\* Preservative Types: (1) nitric acid, (2) sulfuric acid, (3) hydrochloric acid, (4) sodium hydroxide, (5) zinc acetate, (6) methanol, (7) sodium bisulfate, (8) sodium thiosulfate, (9) hexane, (A) ascorbic acid, (B) ammonium sulfate, (C) ammonium hydroxide, (D) TSP, (U) Unpreserved, (O) Other

## Analyses

Lab Profile/Line:

Lab Sample Receipt Checklist:

Custody Seals Present/Intact	Y	N	NA
Custody Signatures Present	Y	N	NA
Collector Signature Present	Y	N	NA
Bottles Intact	Y	N	NA
Correct Bottles	Y	N	NA
Sufficient Volume	Y	N	NA
Samples Received on Ice	Y	N	NA
VOR - Headspace Acceptable	Y	N	NA
USDA Regulated Soils	Y	N	NA
Samples in Holding Time	Y	N	NA
Residual Chlorine Present	Y	N	NA

Cl Strips: \_\_\_\_\_  
Sample pH Acceptable Y N NA  
pH Strips: \_\_\_\_\_  
Sulfide Present Y N NA  
Lead Acetate Strips: \_\_\_\_\_

LAB USE ONLY:  
Lab Sample # / Comments:

Company: <b>GPR</b>		Billing Information:	
Address: <b>13835 CL 485</b>			
Report To:		Email To:	
Copy To:		Site Collection Info/Address:	
Customer Project Name/Number:		State:      County/City:      Time Zone Collected: /      [ ] PT [ ] MT [ ] CT [ ] ET	
Phone:	Site/Facility ID #:	Compliance Monitoring?	
Email:		[ ] Yes      [ ] No	
Collected By (print):	Purchase Order #:	DW PWS ID #:	
	Quote #:	DW Location Code:	
Collected By (signature):	Turnaround Date Required:	Immediately Packed on Ice:	
		[ ] Yes      [ ] No	
Sample Disposal:	Rush:	Field Filtered (if applicable):	
[ ] Dispose as appropriate [ ] Return	[ ] Same Day [ ] Next Day	[ ] Yes      [ ] No	
[ ] Archive: _____	[ ] 2 Day [ ] 3 Day [ ] 4 Day [ ] 5 Day	Analysis: _____	
[ ] Hold: _____	(Expedite Charges Apply)		

\* Matrix Codes (insert in Matrix box below): Drinking Water (DW), Ground Water (GW), Wastewater (WW), Product (P), Soil/Solid (SL), Oil (OL), Wipe (WP), Air (AR), Tissue (TS), Bioassay (B), Vapor (V), Other (OT)

[illegible]

Customer Remarks / Special Conditions / Possible Hazards:	Type of Ice Used:	Wet	Blue	Dry	None
	Packing Material Used:				
6DA7-12403-15	Radchem sample(s) screened (<500 cpm):	Y	N	NA	

SHORT HOLDS PRESENT (<72 hours):	Y	N	N/A
----------------------------------	---	---	-----

Lab Tracking #:

2893476

Samples received via:	
-----------------------	--

FEDEX	UPS	Client	Courier	Pace Courier
-------	-----	--------	---------	--------------

Date/Time: 11/20/2011 11:20:00 AM

MTJL LAB USE ONLY

Table #:

Acctnum:

Template:

Prelogin:

PM:

Lab Sample Temperature Info:

Temp Blank Received: Y N NA

Therm ID#: \_\_\_\_\_

Cooler 1 Temp Upon Receipt: \_\_\_\_\_ °C

Cooler 1 Therm Corr. Factor: \_\_\_\_\_ °C

Cooler 1 Corrected Temp: \_\_\_\_\_ °C

Comments:

Trip Blank Received: Y N NA

HCL	MeOH	TSP	Other
-----	------	-----	-------

Non Conformance(s):	Page:
---------------------	-------

Relinquished by/Company: (Signature) <i>J. McClure</i>	Date/Time: 1430 7/18/24	Received by/Company: (Signature) <i>Larry Lee</i>
Relinquished by/Company: (Signature) <i>Mike Pysen Ramos</i>	Date/Time: 7/19/24 1300	Received by/Company: (Signature) <i>FedEx</i>
Relinquished by/Company: (Signature)	Date/Time:	Received by/Company: (Signature)

Date/Time: 7-10-24 0900





DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

## Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ AustinClient Name: GPL Project Work order (place label):Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☒ No ☐Received on ice: Wet ☒ Blue ☐ No ice ☐Receiving Lab 1 Thermometer Used: IR-18 Cooler Temp °C: 26.9 (Recorded) 10.3 (Correction Factor) 28.2 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AG Date: 7/9/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
pH Strips: <u>6.402007</u>	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Residual Chlorine Present	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Cl Strips: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Sulfide Present	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Lead Acetate Strips: _____	
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
State Sampled: _____	
Non-Conformance(s):	Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: JW Date: 7/8/24

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

Time estimate: oh

Time spent: oh

## Members



Jeremy Watkins (responsible)



Dorothy Roberts

- ☐ 1. If Chain-of-custody (COC) is not received: contact client and if necessary, fill out a COC and indicate that it was filled out by lab personnel. Note issues on this NCF.
- ☐ 2. If COC is incomplete, check applicable issues below and add details where appropriate:
- ☐ \*Collection date/time missing or incorrect
  - ☐ \*Analyses or analytes: missing or Clarification needed
  - ☐ \*Samples listed on COC do not match samples recieved (missing, additional,etc.)
  - ☐ \*Sample IDs on COC do not match sample Labels
  - ☐ \*Required trip blanks were not received
  - ☐ \*Required signatures are missing
- ☒ 3. Sample integrity issues: check applicable issues below and add details where appropriate:
- ☐ \*Samples: Past holding time
  - ☐ \*Samples: Not Field Filtered
  - ☐ \*samples: Insufficient volume received
  - ☐ \*Samples: Cooler damaged or compromised
  - ☐ \*Samples: contain Chlorine or Sulfide
  - ☐ \*Samples: condition needs to be brought to lab personnel's attention (details below)
  - ☐ \*Containers: Broken or compromised
  - ☐ \*Containers: Incorrect
  - ☐ \*Custody Seals: missing or compromised on samples, trip blanks or coolers
  - ☐ \*Packing Material: Insufficient/Improper
  - ☒ \*Preservation: improper
  - ☐ \*Temperature: not within acceptance criteria (typically 0-6C)
  - ☐ \*Temperature: Samples arrived frozen
  - ☐ \*Vials received with improper headspace
  - ☐ \*Other:
- ☐ 4. If Samples not preserved properly and Sample Receiving adjusts pH, add details below:
- ☐ Sample ID: \_\_\_\_\_
  - ☐ Preserved by: \_\_\_\_\_
  - ☐ Date/Time: \_\_\_\_\_
  - ☐ Initial and Final pH: \_\_\_\_\_
  - ☐ Amount/type pres added: \_\_\_\_\_
  - ☐ Lot # of Pres added: \_\_\_\_\_
- ☐ 5. Client contact: If Client is Contacted for any issue listed above, fill in details below:
- ☒ Client:
  - ☒ PM Initials: DPR
  - ☒ Contacted per: JMcClain
  - ☒ Date/Time: 07/09/24 1050

## Comments

*Jeremy Watkins*

*9 July 2024 10:21 AM*

CN and SULFIDE recieved unpreserved.

*Dorothy Roberts*

*10 July 2024 9:35 AM*

Proceed / may not report if replacements can be collected

also sending replacement bottles T256352

**Garland Power & Light**

Sample Delivery Group: L1756836

Samples Received: 07/16/2024

Project Number:

Description: TPDES

Report To: Jeff McClain  
13835 County Rd 489  
Nevada, TX 75173

Entire Report Reviewed By:



Dorothy P Roberts  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

**Pace Analytical National**12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [mydata.pacelabs.com](https://mydata.pacelabs.com)

# TABLE OF CONTENTS

Cp: Cover Page	1
Tc: Table of Contents	2
Ss: Sample Summary	3
Cn: Case Narrative	4
Sr: Sample Results	5
OUTFALL 001 L1756836-01	5
Qc: Quality Control Summary	10
Gravimetric Analysis by Method 2540C	10
Gravimetric Analysis by Method 2540D	11
Wet Chemistry by Method 1664A	12
Wet Chemistry by Method 2120B	13
Wet Chemistry by Method 2320B	14
Wet Chemistry by Method 300.0	15
Wet Chemistry by Method 3500Cr-B	16
Wet Chemistry by Method 351.2	17
Wet Chemistry by Method 353.2	18
Wet Chemistry by Method 360.1	19
Wet Chemistry by Method 4500Cl G-2011	20
Wet Chemistry by Method 4500CN-E	21
Wet Chemistry by Method 4500P-E	22
Wet Chemistry by Method 4500-S2 D	23
Wet Chemistry by Method 4500SO3 B-2011	24
Wet Chemistry by Method 5210 B-2016	25
Wet Chemistry by Method 5220D	27
Wet Chemistry by Method 5310C	28
Wet Chemistry by Method 5540C	29
Wet Chemistry by Method SM 4500-H+B	30
Wet Chemistry by Method SM4500NH3H	31
Mercury by Method 245.1	32
Metals (ICP) by Method 200.7	33
Metals (ICPMS) by Method 200.8	34
Volatile Organic Compounds (GC/MS) by Method 624.1	36
Polychlorinated Biphenyls (GC) by Method EPA-608.3	39
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	40
Gl: Glossary of Terms	43
Al: Accreditations & Locations	44
Sc: Sample Chain of Custody	45

<sup>1</sup> Cp
<sup>2</sup> Tc
<sup>3</sup> Ss
<sup>4</sup> Cn
<sup>5</sup> Sr
<sup>6</sup> Qc
<sup>7</sup> Gl
<sup>8</sup> Al
<sup>9</sup> Sc



# SAMPLE SUMMARY

OUTFALL 001 L1756836-01 WW

Collected by

Collected date/time

Received date/time

07/16/24 08:18

07/16/24 09:42

Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Calculated Results	WG2327774	1	07/22/24 16:22	07/22/24 16:22	EIG	Allen, TX
Calculated Results	WG2329841	1	07/26/24 14:40	07/26/24 14:40	NA	Allen, TX
Gravimetric Analysis by Method 2540C	WG2325834	1	07/18/24 15:18	07/18/24 17:02	QQT	Allen, TX
Gravimetric Analysis by Method 2540D	WG2328064	1	07/23/24 06:21	07/23/24 07:41	QQT	Allen, TX
Wet Chemistry by Method 1664A	WG2324487	1	07/18/24 13:00	07/19/24 09:53	TK	Allen, TX
Wet Chemistry by Method 2120B	WG2324656	1	07/17/24 13:58	07/17/24 13:58	EIG	Allen, TX
Wet Chemistry by Method 2320B	WG2327704	1	07/22/24 12:47	07/22/24 12:47	JBS	Allen, TX
Wet Chemistry by Method 300.0	WG2323759	1	07/16/24 17:30	07/16/24 17:30	SMC	Allen, TX
Wet Chemistry by Method 300.0	WG2323759	5	07/16/24 22:34	07/16/24 22:34	SMC	Allen, TX
Wet Chemistry by Method 3500Cr-B	WG2324738	1	07/17/24 15:16	07/17/24 15:16	KCM	Allen, TX
Wet Chemistry by Method 351.2	WG2326234	1	07/19/24 10:40	07/19/24 20:41	EIG	Allen, TX
Wet Chemistry by Method 353.2	WG2325801	1	07/18/24 15:59	07/18/24 15:59	EIG	Allen, TX
Wet Chemistry by Method 360.1	WG2324067	1	07/16/24 14:05	07/16/24 14:05	JBS	Allen, TX
Wet Chemistry by Method 4500CI G-2011	WG2325082	1	07/18/24 12:43	07/18/24 12:43	JAR	Mt. Juliet, TN
Wet Chemistry by Method 4500CN-E	WG2325383	1	07/18/24 11:00	07/18/24 18:49	KCM	Allen, TX
Wet Chemistry by Method 4500CN-G	WG2328176	1	07/23/24 15:25	07/23/24 15:25	KCM	Allen, TX
Wet Chemistry by Method 4500P-E	WG2327473	1	07/22/24 16:34	07/22/24 16:34	SMC	Allen, TX
Wet Chemistry by Method 4500-S2 D	WG2324648	1	07/17/24 13:40	07/17/24 13:40	EIG	Allen, TX
Wet Chemistry by Method 4500SO3 B-2011	WG2328484	1	07/23/24 15:00	07/23/24 15:00	CAH	Mt. Juliet, TN
Wet Chemistry by Method 5210 B-2016	WG2323729	1	07/16/24 15:58	07/21/24 11:53	JBS	Allen, TX
Wet Chemistry by Method 5210 B-2016	WG2323730	1	07/16/24 17:37	07/21/24 13:30	JBS	Allen, TX
Wet Chemistry by Method 5220D	WG2324533	1	07/17/24 08:52	07/17/24 11:53	JBS	Allen, TX
Wet Chemistry by Method 5310C	WG2323910	2	07/16/24 20:56	07/16/24 20:56	EIG	Allen, TX
Wet Chemistry by Method 5540C	WG2324658	1	07/17/24 17:24	07/17/24 17:29	EIG	Allen, TX
Wet Chemistry by Method SM 4500-H+B	WG2325390	1	07/18/24 08:46	07/18/24 08:46	SEN	Allen, TX
Wet Chemistry by Method SM4500NH3H	WG2327774	1	07/22/24 16:22	07/22/24 16:22	EIG	Allen, TX
Mercury by Method 245.1	WG2325148	1	07/18/24 12:44	07/18/24 17:47	TDM	Allen, TX
Metals (ICP) by Method 200.7	WG2325465	1	07/18/24 16:25	07/19/24 10:56	SKW	Allen, TX
Metals (ICPMS) by Method 200.8	WG2329841	1	07/25/24 15:11	07/26/24 14:40	NA	Allen, TX
Volatile Organic Compounds (GC/MS) by Method 624.1	WG2324214	1	07/16/24 22:36	07/16/24 22:36	ZST	Allen, TX
Polychlorinated Biphenyls (GC) by Method EPA-608.3	WG2325314	1	07/18/24 20:00	07/19/24 02:59	NWH	Mt. Juliet, TN
Semi Volatile Organic Compounds (GC/MS) by Method 625.1	WG2324634	1	07/17/24 09:31	07/19/24 15:22	XLY	Allen, TX

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Dorothy P Roberts  
Project Manager


## Sample Delivery Group (SDG) Narrative

**Analysis was filtered in the laboratory.**

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1756836-01</a>	<a href="#">OUTFALL 001</a>	3500Cr-B

**No extra volume received to perform Matrix Spike samples.**

<u>Lab Sample ID</u>	<u>Project Sample ID</u>	<u>Method</u>
<a href="#">L1756836-01</a>	<a href="#">OUTFALL 001</a>	625.1



Calculated Results

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Trivalent	U		0.000510	0.00300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Organic Nitrogen	0.478		0.0280	0.100	1	07/22/2024 16:22	<a href="#">WG2327774</a>

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Gravimetric Analysis by Method 2540C

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Total Dissolved Solids	219	<a href="#">J3</a>	25.0	1	07/18/2024 17:02	<a href="#">WG2325834</a>

Gravimetric Analysis by Method 2540D

Analyte	Result mg/l	Qualifier	RDL mg/l	Dilution	Analysis date / time	Batch
Suspended Solids	ND		5.00	1	07/23/2024 07:41	<a href="#">WG2328064</a>

Wet Chemistry by Method 1664A

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Oil & Grease (Hexane Extr)	U		0.350	5.00	1	07/19/2024 09:53	<a href="#">WG2324487</a>

Wet Chemistry by Method 2120B

Analyte	Result units	Qualifier	RDL units	Dilution	Analysis date / time	Batch
Color	20.0		5.00	1	07/17/2024 13:58	<a href="#">WG2324656</a>

Sample Narrative:

L1756836-01 WG2324656: 7

Wet Chemistry by Method 2320B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Alkalinity	110		20.0	20.0	1	07/22/2024 12:47	<a href="#">WG2327704</a>

Wet Chemistry by Method 300.0

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Bromide	0.116	<a href="#">J</a>	0.0668	0.400	1	07/16/2024 17:30	<a href="#">WG2323759</a>
Chloride	16.1	<a href="#">J5</a>	1.62	4.00	5	07/16/2024 22:34	<a href="#">WG2323759</a>
Fluoride	0.243	<a href="#">J</a>	0.0947	0.500	1	07/16/2024 17:30	<a href="#">WG2323759</a>
Nitrate	U		0.379	0.500	1	07/16/2024 17:30	<a href="#">WG2323759</a>
Sulfate	27.3	<a href="#">V</a>	1.06	3.50	5	07/16/2024 22:34	<a href="#">WG2323759</a>

Wet Chemistry by Method 3500Cr-B

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chromium,Hexavalent	U		0.00200	0.00300	1	07/17/2024 15:16	<a href="#">WG2324738</a>

Sample Narrative:

L1756836-01 WG2324738: Sample preserved in lab w/in 24 hrs of collection

Wet Chemistry by Method 351.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Kjeldahl Nitrogen, TKN	0.478		0.140	0.250	1	07/19/2024 20:41	<a href="#">WG2326234</a>

## OUTFALL 001

Collected date/time: 07/16/24 08:18

## SAMPLE RESULTS - 01

L1756836

## Wet Chemistry by Method 353.2

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Nitrate-Nitrite	U		0.0300	0.0500	1	07/18/2024 15:59	<a href="#">WG2325801</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

## Wet Chemistry by Method 360.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Dissolved Oxygen	7.77	<a href="#">T8</a>	1	1	1	07/16/2024 14:05	<a href="#">WG2324067</a>

## Wet Chemistry by Method 4500CI G-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Chlorine,residual	0.0420	<a href="#">J T8</a>	0.0260	0.100	1	07/18/2024 12:43	<a href="#">WG2325082</a>

## Wet Chemistry by Method 4500CN-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide	U		0.00430	0.0100	1	07/18/2024 18:49	<a href="#">WG2325383</a>

## Wet Chemistry by Method 4500CN-G

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Cyanide,amenable	U		0.00350	0.0100	1	07/23/2024 15:25	WG2328176

## Wet Chemistry by Method 4500P-E

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Phosphorus,Total	0.0442	<a href="#">J</a>	0.0152	0.0500	1	07/22/2024 16:34	<a href="#">WG2327473</a>

## Wet Chemistry by Method 4500-S2 D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfide	U		0.0230	0.100	1	07/17/2024 13:40	<a href="#">WG2324648</a>

## Wet Chemistry by Method 4500SO3 B-2011

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Sulfite	U	<a href="#">T8</a>	1.19	3.00	1	07/23/2024 15:00	<a href="#">WG2328484</a>

## Wet Chemistry by Method 5210 B-2016

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
BOD	2.53		1.00	1	1	07/21/2024 11:53	<a href="#">WG2323729</a>
CBOD	2.52		1.00	1	1	07/21/2024 13:30	<a href="#">WG2323730</a>

## Wet Chemistry by Method 5220D

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
COD	22.2	<a href="#">J</a>	16.1	35.0	1	07/17/2024 11:53	<a href="#">WG2324533</a>

## Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
---------	----------------	-----------	-------------	-------------	----------	-------------------------	-------

OUTFALL 001

SAMPLE RESULTS - 01

Collected date/time: 07/16/24 08:18

L1756836

Wet Chemistry by Method 5310C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
TOC (Total Organic Carbon)	5.34		0.540	1.40	2	07/16/2024 20:56	<a href="#">WG2323910</a>

1  
Cp

2  
Tc

Wet Chemistry by Method 5540C

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
MBAS	U	<a href="#">J5</a>	0.360	0.500	1	07/17/2024 17:29	<a href="#">WG2324658</a>

3  
Ss

4  
Cn

Wet Chemistry by Method SM 4500-H+B

Analyte	Result su	Qualifier	Dilution	Analysis date / time	Batch
pH	8.35	<a href="#">T8</a>	1	07/18/2024 08:46	<a href="#">WG2325390</a>

5  
Sr

6  
Qc

Sample Narrative:

L1756836-01 WG2325390: 8.35 at 23.6C

7  
Gl

Wet Chemistry by Method SM4500NH3H

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Ammonia Nitrogen	U		0.0280	0.100	1	07/22/2024 16:22	<a href="#">WG2327774</a>

8  
Al

9  
Sc

Mercury by Method 245.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Mercury	0.0000450	<a href="#">J</a>	0.0000450	0.000200	1	07/18/2024 17:47	<a href="#">WG2325148</a>

Metals (ICP) by Method 200.7

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Boron	0.0702	<a href="#">J</a>	0.0186	0.100	1	07/19/2024 10:56	<a href="#">WG2325465</a>
Tin	U		0.00240	0.0250	1	07/19/2024 10:56	<a href="#">WG2325465</a>
Titanium	U		0.00835	0.100	1	07/19/2024 10:56	<a href="#">WG2325465</a>

Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Aluminum	0.167		0.00186	0.00250	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Antimony	U		0.000580	0.00500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Arsenic	0.00528		0.000100	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Barium	0.0341		0.000440	0.00300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Beryllium	0.0000927	<a href="#">J</a>	0.0000600	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Cadmium	U		0.000120	0.00100	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Chromium	U		0.000510	0.00300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Cobalt	0.00305		0.0000400	0.000300	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Copper	0.00257		0.000900	0.00200	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Iron	0.153		0.00432	0.00700	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Lead	0.000221	<a href="#">J</a>	0.000140	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Magnesium	3.92	<a href="#">J6</a>	0.0121	0.0200	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Manganese	0.0439		0.000330	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Molybdenum	0.00174		0.000530	0.00100	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Nickel	0.00163	<a href="#">J</a>	0.000640	0.00200	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Selenium	U		0.000740	0.00500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Silver	U		0.0000800	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>
Thallium	0.000894	<a href="#">B</a>	0.000190	0.000500	1	07/26/2024 14:40	<a href="#">WG2329841</a>

## OUTFALL 001

Collected date/time: 07/16/24 08:18

## SAMPLE RESULTS - 01

L1756836

## Metals (ICPMS) by Method 200.8

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
Zinc	U		0.00265	0.00500	1	07/26/2024 14:40	<a href="#">WG2329841</a>

## Volatile Organic Compounds (GC/MS) by Method 624.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,1,1-Trichloroethane	U		0.00335	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1,2-Trichloroethane	U		0.00145	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1-Dichloroethene	U		0.00367	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,1-Dichloroethane	U		0.00292	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dibromoethane	U		0.000549	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dichlorobenzene	U		0.00172	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dichloroethane	U		0.00195	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,2-Dichloropropane	U		0.000804	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,3-Dichlorobenzene	U		0.00419	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
1,4-Dichlorobenzene	U		0.00173	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
2-Butanone (MEK)	U	<a href="#">J6</a>	0.00822	0.0250	1	07/16/2024 22:36	<a href="#">WG2324214</a>
2-Chloroethyl vinyl ether	U		0.00652	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Acrolein	U		0.00544	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Acrylonitrile	U		0.00709	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Benzene	U		0.00207	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Bromodichloromethane	U		0.00179	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Bromoform	U		0.000960	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Bromomethane	U		0.00347	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Carbon tetrachloride	U		0.00159	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chlorobenzene	U		0.00276	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chloroethane	U		0.00296	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chloroform	U		0.00212	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Chloromethane	U		0.00361	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
cis-1,3-Dichloropropene	U		0.00492	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Dibromochloromethane	U		0.00327	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Ethylbenzene	U		0.000401	0.00200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Methylene Chloride	U		0.0117	0.0200	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Tetrachloroethene	U		0.00486	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Toluene	U		0.00219	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
trans-1,2-Dichloroethene	U		0.00501	0.0100	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Trichloroethene	U		0.00262	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
Vinyl chloride	U		0.00466	0.00500	1	07/16/2024 22:36	<a href="#">WG2324214</a>
(S) 1,2-Dichloroethane-d4	101			70.0-130		07/16/2024 22:36	<a href="#">WG2324214</a>
(S) 4-Bromofluorobenzene	101			70.0-130		07/16/2024 22:36	<a href="#">WG2324214</a>
(S) Toluene-d8	100			70.0-130		07/16/2024 22:36	<a href="#">WG2324214</a>

## Polychlorinated Biphenyls (GC) by Method EPA-608.3

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
PCB 1016	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1221	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1232	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1242	U		0.000270	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1248	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1254	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
PCB 1260	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
Total PCBs	U		0.000173	0.000500	1	07/19/2024 02:59	<a href="#">WG2325314</a>
(S) Decachlorobiphenyl	15.8			10.0-144		07/19/2024 02:59	<a href="#">WG2325314</a>
(S) Tetrachloro-m-xylene	32.2			10.0-135		07/19/2024 02:59	<a href="#">WG2325314</a>



## OUTFALL 001

## SAMPLE RESULTS - 01

Collected date/time: 07/16/24 08:18

L1756836

## Semi Volatile Organic Compounds (GC/MS) by Method 625.1

Analyte	Result mg/l	Qualifier	MDL mg/l	RDL mg/l	Dilution	Analysis date / time	Batch
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4,6-Trichlorophenol	U		0.000238	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4-Dichlorophenol	U		0.000336	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4-Dimethylphenol	U		0.000613	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2,4-Dinitrophenol	U		0.00154	0.0100	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2-Chlorophenol	U		0.000307	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2-Methylphenol	U		0.000238	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
2-Nitrophenol	U		0.000247	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
3&4-Methyl Phenol	U		0.000238	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
3,3-Dichlorobenzidine	U		0.000788	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100	1	07/19/2024 15:22	<a href="#">WG2324634</a>
4-Chloro-3-methylphenol	U		0.000217	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
4-Nitrophenol	U		0.00123	0.0100	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Anthracene	U		0.000168	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Benzidine	U		0.000350	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Benzo(a)anthracene	U		0.000307	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Benzo(a)pyrene	U		0.000470	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Bis(2-chloroethyl)ether	U		0.000168	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Chrysene	U		0.000257	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Di-n-butyl phthalate	U		0.00160	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachloro-1,3-butadiene	U		0.000217	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachlorobenzene	U		0.000307	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachlorocyclopentadiene	U		0.000299	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Hexachloroethane	U		0.000247	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
n-Nitrosodi-n-butylamine	U		0.00110	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
n-Nitrosodiethylamine	U		0.000696	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Nitrobenzene	U		0.000314	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Nonylphenol	U		0.000168	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Pentachlorobenzene	U		0.000247	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Pentachlorophenol	U		0.000283	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Phenanthrene	U		0.000200	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Phenol	U		0.000500	0.00200	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Pyridine	U		0.00174	0.00400	1	07/19/2024 15:22	<a href="#">WG2324634</a>
Total Cresols	U		0.00153	0.00800	1	07/19/2024 15:22	<a href="#">WG2324634</a>
(S) 2,4,6-Tribromophenol	60.4			29.0-132		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) 2-Fluorobiphenyl	70.3			26.0-102		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) 2-Fluorophenol	64.8			10.0-66.0		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) Nitrobenzene-d5	74.7			15.0-106		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) p-Terphenyl-d14	87.9			10.0-120		07/19/2024 15:22	<a href="#">WG2324634</a>
(S) Phenol-D6	57.1	<a href="#">J1</a>		10.0-54.0		07/19/2024 15:22	<a href="#">WG2324634</a>

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

Method Blank (MB)

(MB) R4096041-1 07/18/24 17:02

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Total Dissolved Solids	U		25.0	25.0

L1756796-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756796-01 07/18/24 17:02 • (DUP) R4096041-3 07/18/24 17:02

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Total Dissolved Solids	411	399	1	2.96		10

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/18/24 17:02 • (DUP) R4096041-4 07/18/24 17:02

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Total Dissolved Solids	219	178	1	20.7	J3	10

Laboratory Control Sample (LCS)

(LCS) R4096041-2 07/18/24 17:02

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Total Dissolved Solids	2410	2500	104	85.0-115	

1

Cp

2

Tc

3

Ss

4

Cn

5

Sr

6

Qc

7

Gl

8

Al

9

Sc



Method Blank (MB)

(MB) R4097307-1 07/23/24 07:41

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Suspended Solids	U		2.50	2.50

L1756933-05 Original Sample (OS) • Duplicate (DUP)

(OS) L1756933-05 07/23/24 07:41 • (DUP) R4097307-3 07/23/24 07:41

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	14300	14200	1	0.840		10

L1756933-06 Original Sample (OS) • Duplicate (DUP)

(OS) L1756933-06 07/23/24 07:41 • (DUP) R4097307-4 07/23/24 07:41

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Suspended Solids	14300	14100	1	1.83		10

Laboratory Control Sample (LCS)

(LCS) R4097307-2 07/23/24 07:41

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Suspended Solids	879	820	93.3	85.0-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096035-1 07/19/24 09:53

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Oil & Grease (Hexane Extr)	U		0.350	5.00

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4096035-2 07/19/24 09:53 • (LCSD) R4096035-3 07/19/24 09:53

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Oil & Grease (Hexane Extr)	40.0	35.3	36.2	88.3	90.5	78.0-114			2.52	18

L1756705-02 Original Sample (OS) • Matrix Spike (MS)

(OS) L1756705-02 07/19/24 09:53 • (MS) R4096035-4 07/19/24 09:53

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MS Rec. %	Dilution	Rec. Limits %	MS Qualifier
Oil & Grease (Hexane Extr)	40.0	U	34.0	85.1	1	78.0-114	

Method Blank (MB)

(MB) R4094918-1 07/17/24 13:58

Analyte	MB Result units	MB Qualifier	MB MDL units	MB RDL units
Color	U		5.00	5.00

Sample Narrative:  
BLANK: 7

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/17/24 13:58 • (DUP) R4094918-2 07/17/24 13:58

Analyte	Original Result units	DUP Result units	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Color	20.0	20.0	1	0.000		20

Sample Narrative:  
OS: 7  
DUP: 7

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096806-1 07/22/24 12:47

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Alkalinity	U		20.0	20.0

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/22/24 12:47 • (DUP) R4096806-3 07/22/24 12:47

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Alkalinity	110	112	1	1.80		20

<sup>7</sup>Gl

<sup>8</sup>Al

Laboratory Control Sample (LCS)

(LCS) R4096806-2 07/22/24 12:47

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Alkalinity	250	240	96.0	90.0-110	

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4094668-1 07/16/24 16:19

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Bromide	U		0.0668	0.400
Chloride	U		0.325	0.800
Fluoride	U		0.0947	0.500
Nitrate	U		0.379	0.500
Sulfate	U		0.211	0.700

Laboratory Control Sample (LCS)

(LCS) R4094668-2 07/16/24 16:37

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Bromide	5.00	5.38	108	90.0-110	
Chloride	5.00	5.19	104	90.0-110	
Fluoride	5.00	5.33	107	90.0-110	
Nitrate	5.00	5.17	103	90.0-110	
Sulfate	5.00	5.37	107	90.0-110	

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/16/24 17:30 • (MS) R4094668-3 07/16/24 21:58 • (MSD) R4094668-4 07/16/24 22:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Bromide	5.00	0.116	5.50	5.53	108	108	1	90.0-110			0.508	20
Fluoride	5.00	0.243	5.66	5.66	108	108	1	90.0-110			0.0689	20
Nitrate	5.00	U	5.24	5.25	105	105	1	90.0-110			0.286	20

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/16/24 22:34 • (MS) R4094668-5 07/16/24 22:52 • (MSD) R4094668-6 07/16/24 23:09

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chloride	5.00	16.1	43.4	43.6	546	550	5	90.0-110	J5	J5	0.393	20
Sulfate	5.00	27.3	55.1	55.2	556	560	5	90.0-110	V	V	0.333	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4094993-1 07/17/24 15:16

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chromium,Hexavalent	U		0.00200	0.00300

Laboratory Control Sample (LCS)

(LCS) R4094993-2 07/17/24 15:16

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Chromium,Hexavalent	0.200	0.200	100	85.0-115	

L1754173-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754173-02 07/17/24 15:16 • (MS) R4094993-3 07/17/24 15:16 • (MSD) R4094993-4 07/17/24 15:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	0.00460	0.208	0.210	102	103	1	10.0-120			0.825	20

Sample Narrative:

OS: Sample preserved in lab w/in 24 hrs of collection

L1754768-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754768-01 07/17/24 15:16 • (MS) R4094993-5 07/17/24 15:16 • (MSD) R4094993-6 07/17/24 15:16

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Chromium,Hexavalent	0.200	U	0.198	0.197	98.8	98.4	1	10.0-120			0.437	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096223-1 07/19/24 20:26

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Kjeldahl Nitrogen, TKN	U		0.140	0.250

Laboratory Control Sample (LCS)

(LCS) R4096223-2 07/19/24 20:29

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Kjeldahl Nitrogen, TKN	4.00	3.78	94.5	90.0-110	

L1754376-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754376-02 07/19/24 20:31 • (MS) R4096223-3 07/19/24 20:59 • (MSD) R4096223-4 07/19/24 21:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	20.0	76.7	104	97.3	137	103	10	90.0-110	E J5		6.66	20

L1754397-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1754397-01 07/19/24 20:33 • (MS) R4096223-5 07/19/24 21:01 • (MSD) R4096223-6 07/19/24 21:03

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Kjeldahl Nitrogen, TKN	20.0	27.6	50.1	47.0	113	97.0	10	90.0-110	J5		6.39	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4095809-1 07/18/24 15:56

Analyte	MB Result mg/l	<u>MB Qualifier</u>	MB MDL mg/l	MB RDL mg/l
Nitrate-Nitrite	U		0.0300	0.0500

Laboratory Control Sample (LCS)

(LCS) R4095809-2 07/18/24 15:57

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Nitrate-Nitrite	2.50	2.41	96.4	90.0-110	

L1755904-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1755904-01 07/18/24 15:57 • (MS) R4095809-3 07/18/24 16:05 • (MSD) R4095809-4 07/18/24 16:06

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Nitrate-Nitrite	2.50	0.934	3.24	3.23	92.2	91.8	1	90.0-110			0.309	20

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc



L1756836-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756836-01 07/16/24 14:05 • (DUP) R4094367-1 07/16/24 14:05

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Dissolved Oxygen	7.77	8.25	1	5.99		10

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4095472-1 07/18/24 12:41

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Chlorine,residual	U		0.0260	0.100

L1756487-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756487-01 07/18/24 12:42 • (DUP) R4095472-4 07/18/24 12:42

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
Chlorine,residual	0.192	0.191	1	0.522		20

Laboratory Control Sample (LCS) • Laboratory Control Sample Duplicate (LCSD)

(LCS) R4095472-2 07/18/24 12:41 • (LCSD) R4095472-3 07/18/24 12:41

Analyte	Spike Amount mg/l	LCS Result mg/l	LCSD Result mg/l	LCS Rec. %	LCSD Rec. %	Rec. Limits %	LCS Qualifier	LCSD Qualifier	RPD %	RPD Limits %
Chlorine,residual	1.00	0.975	0.978	97.5	97.8	85.0-115			0.307	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4095810-1 07/18/24 18:49

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Cyanide	U		0.00430	0.0100

Laboratory Control Sample (LCS)

(LCS) R4095810-2 07/18/24 18:49

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Cyanide	0.100	0.103	103	85.0-115	

L1757293-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757293-02 07/18/24 18:49 • (MS) R4095810-3 07/18/24 18:49 • (MSD) R4095810-4 07/18/24 18:49

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	U	0.0507	0.0507	50.7	50.7	1	85.0-115	J6	J6	0.000	20

L1757408-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757408-06 07/18/24 18:49 • (MS) R4095810-5 07/18/24 18:49 • (MSD) R4095810-6 07/18/24 18:49

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Cyanide	0.100	0.00474	0.0900	0.0940	90.0	94.0	1	85.0-115			4.34	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4096931-1 07/22/24 16:34

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Phosphorus,Total	U		0.0152	0.0500

Laboratory Control Sample (LCS)

(LCS) R4096931-2 07/22/24 16:34

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phosphorus,Total	0.500	0.513	103	80.0-120	

L1757284-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757284-02 07/22/24 16:34 • (MS) R4096931-3 07/22/24 16:35 • (MSD) R4096931-4 07/22/24 16:35

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Phosphorus,Total	0.500	0.164	0.686	0.666	104	100	1	80.0-120			3.01	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4094911-1 07/17/24 13:38

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Sulfide	U		0.0230	0.100

Laboratory Control Sample (LCS)

(LCS) R4094911-2 07/17/24 13:38

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Sulfide	0.800	0.877	110	80.0-120	

L1756950-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756950-02 07/17/24 13:40 • (MS) R4094911-3 07/17/24 13:40 • (MSD) R4094911-4 07/17/24 13:40

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Sulfide	0.800	0.0269	0.591	0.567	70.5	67.5	1	80.0-120	J6	J6	4.07	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4097393-1 07/23/24 15:00

	MB Result	MB Qualifier	MB MDL	MB RDL
Analyte	mg/l		mg/l	mg/l
Sulfite	U		1.19	3.00

L1757021-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1757021-02 07/23/24 15:00 • (DUP) R4097393-3 07/23/24 15:00

	Original Result	DUP Result	Dilution	DUP RPD	DUP Qualifier	DUP RPD Limits
Analyte	mg/l	mg/l		%		%
Sulfite	6.50	6.50	1	0.000		20

Laboratory Control Sample (LCS)

(LCS) R4097393-2 07/23/24 15:00

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	LCS Qualifier
Analyte	mg/l	mg/l	%	%	
Sulfite	20.0	18.0	90.0	85.0-115	

L1757021-03 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1757021-03 07/23/24 15:00 • (MS) R4097393-4 07/23/24 15:00 • (MSD) R4097393-5 07/23/24 15:00

	Spike Amount	Original Result	MS Result	MSD Result	MS Rec.	MSD Rec.	Dilution	Rec. Limits	MS Qualifier	MSD Qualifier	RPD	RPD Limits
Analyte	mg/l	mg/l	mg/l	mg/l	%	%		%			%	%
Sulfite	20.0	U	17.5	18.0	87.5	90.0	1	85.0-115			2.82	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096615-1 07/21/24 11:11

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
BOD	U		0.200	0.200

L1756776-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756776-01 07/21/24 11:42 • (DUP) R4096615-3 07/21/24 11:54

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	7.12	7.08	1	0.563		20

L1756822-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756822-01 07/21/24 11:48 • (DUP) R4096615-4 07/21/24 11:59

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
BOD	ND	ND	1	0		20

Laboratory Control Sample (LCS)

(LCS) R4096615-2 07/21/24 11:17

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
BOD	198	194	98.1	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096616-1 07/21/24 12:45

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
CBOD	U		0.200	0.200

L1756689-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756689-01 07/21/24 12:55 • (DUP) R4096616-3 07/21/24 13:45

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
CBOD	3.79	3.71	1	2.13		20

L1756933-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756933-01 07/21/24 13:39 • (DUP) R4096616-4 07/21/24 13:49

Analyte	Original Result mg/l	DUP Result mg/l	Dilution	DUP RPD %	DUP Qualifier	DUP RPD Limits %
CBOD	ND	ND	1	0		20

Laboratory Control Sample (LCS)

(LCS) R4096616-2 07/21/24 12:51

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
CBOD	198	198	100	85-115	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



Method Blank (MB)

(MB) R4094848-1 07/17/24 11:53

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
COD	U		16.1	35.0

Laboratory Control Sample (LCS)

(LCS) R4094848-2 07/17/24 11:53

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
COD	500	516	103	80.0-120	

L1756038-04 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756038-04 07/17/24 11:53 • (MS) R4094848-3 07/17/24 11:53 • (MSD) R4094848-4 07/17/24 11:53

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
COD	500	28.5	518	531	98.0	100	1	80.0-120			2.39	20

L1756465-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756465-01 07/17/24 11:53 • (MS) R4094848-5 07/17/24 11:53 • (MSD) R4094848-6 07/17/24 11:53

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
COD	500	51.5	531	543	95.9	98.4	1	80.0-120			2.34	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4094841-1 07/16/24 15:35

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
TOC (Total Organic Carbon)	U		0.270	0.700

Laboratory Control Sample (LCS)

(LCS) R4094841-2 07/16/24 15:54

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
TOC (Total Organic Carbon)	10.0	10.2	102	90.0-110	

L1756680-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756680-01 07/16/24 17:14 • (MS) R4094841-3 07/16/24 18:08 • (MSD) R4094841-4 07/16/24 18:36

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
TOC (Total Organic Carbon)	50.0	28.5	79.8	84.1	103	111	5	80.0-120			5.19	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4095086-1 07/17/24 17:29

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
MBAS	U		0.360	0.500

Laboratory Control Sample (LCS)

(LCS) R4095086-2 07/17/24 17:29

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
MBAS	1.00	1.12	112	80.0-120	

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/17/24 17:29 • (MS) R4095086-3 07/17/24 17:29 • (MSD) R4095086-4 07/17/24 17:29

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
MBAS	1.00	U	1.25	1.13	125	113	1	80.0-120	J5		10.4	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

L1756869-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1756869-01 07/18/24 08:46 • (DUP) R4095234-2 07/18/24 08:46

	Original Result	DUP Result	Dilution	DUP RPD	<u>DUP Qualifier</u>	DUP RPD Limits
Analyte	su	su		%		%
pH	8.99	8.99	1	0.000		20

Sample Narrative:  
OS: 8.99 at 21.7C  
DUP: 8.99 at 21.6C

Laboratory Control Sample (LCS)

(LCS) R4095234-1 07/18/24 08:46

	Spike Amount	LCS Result	LCS Rec.	Rec. Limits	<u>LCS Qualifier</u>
Analyte	su	su	%	%	
pH	6.00	5.97	99.5	99.0-101	

Sample Narrative:  
LCS: 5.97 at 21.2C

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4096965-1 07/22/24 15:38

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Ammonia Nitrogen	U		0.0280	0.100

Laboratory Control Sample (LCS)

(LCS) R4096965-2 07/22/24 15:39

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Ammonia Nitrogen	5.00	5.04	101	80.0-120	

L1755609-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1755609-01 07/22/24 15:57 • (MS) R4096965-3 07/22/24 15:50 • (MSD) R4096965-4 07/22/24 15:52

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.0469	4.91	4.90	97.3	97.1	1	80.0-120			0.204	20

L1756014-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756014-01 07/22/24 15:59 • (MS) R4096965-5 07/22/24 15:53 • (MSD) R4096965-6 07/22/24 15:55

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Ammonia Nitrogen	5.00	0.120	4.96	4.98	96.8	97.2	1	80.0-120			0.402	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4095624-5 07/18/24 17:12

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Mercury	U		0.0000450	0.000200

Laboratory Control Sample (LCS)

(LCS) R4095624-2 07/18/24 16:54

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Mercury	0.00250	0.00255	102	85.0-115	

L1756002-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756002-06 07/18/24 16:56 • (MS) R4095624-3 07/18/24 16:58 • (MSD) R4095624-4 07/18/24 17:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	0.000119	0.00246	0.00243	93.6	92.4	1	70.0-130			1.23	20

L1756002-04 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756002-04 07/18/24 17:56 • (MS) R4095624-6 07/18/24 17:58 • (MSD) R4095624-7 07/18/24 18:00

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Mercury	0.00250	0.000237	0.00273	0.00270	99.7	98.5	1	70.0-130			1.10	20

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Method Blank (MB)

(MB) R4095885-1 07/19/24 10:24

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Boron	U		0.0186	0.100
Tin	U		0.00240	0.0250
Titanium	U		0.00835	0.100

Laboratory Control Sample (LCS)

(LCS) R4095885-2 07/19/24 10:28

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Boron	1.00	0.936	93.6	85.0-115	
Tin	1.00	0.994	99.4	85.0-115	
Titanium	1.00	0.979	97.9	85.0-115	

L1756433-03 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756433-03 07/19/24 10:32 • (MS) R4095885-3 07/19/24 10:36 • (MSD) R4095885-4 07/19/24 10:40

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
Boron	1.00	0.283	1.22	1.19	93.6	91.2	1	70.0-130			1.99	20
Tin	1.00	0.00980	0.974	0.964	96.4	95.4	1	70.0-130			1.10	20
Titanium	1.00	U	0.982	0.954	98.2	95.4	1	70.0-130			2.87	20

1

Cp

2

Tc

3

Ss

4

Cn

5

Sr

6

Qc

7

Gl

8

Al

9

Sc

Method Blank (MB)

(MB) R4098986-1 07/26/24 14:22

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
Aluminum	0.00428		0.00186	0.00250
Antimony	U		0.000580	0.00500
Arsenic	0.000112	J	0.000100	0.000500
Barium	U		0.000440	0.00300
Beryllium	U		0.0000600	0.000500
Cadmium	U		0.000120	0.00100
Chromium	U		0.000510	0.00300
Cobalt	U		0.0000400	0.000300
Copper	U		0.000900	0.00200
Iron	0.00462	J	0.00432	0.00700
Lead	U		0.000140	0.000500
Magnesium	U		0.0121	0.0200
Manganese	U		0.000330	0.000500
Molybdenum	U		0.000530	0.00100
Nickel	U		0.000640	0.00200
Selenium	U		0.000740	0.00500
Silver	U		0.0000800	0.000500
Thallium	0.000202	J	0.000190	0.000500
Zinc	U		0.00265	0.00500

1  
Cp

2  
Tc

3  
Ss

4  
Cn

5  
Sr

6  
Qc

7  
Gl

8  
Al

9  
Sc

Laboratory Control Sample (LCS)

(LCS) R4098986-2 07/26/24 14:34

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Aluminum	1.00	1.03	103	85.0-115	
Antimony	0.100	0.0972	97.2	85.0-115	
Arsenic	0.100	0.103	103	85.0-115	
Barium	0.100	0.0943	94.3	85.0-115	
Beryllium	0.100	0.103	103	85.0-115	
Cadmium	0.100	0.106	106	85.0-115	
Chromium	0.100	0.105	105	85.0-115	
Cobalt	0.100	0.104	104	85.0-115	
Copper	0.100	0.105	105	85.0-115	
Iron	1.00	1.07	107	85.0-115	
Lead	0.100	0.104	104	85.0-115	
Magnesium	1.00	1.08	108	85.0-115	
Manganese	0.100	0.104	104	85.0-115	
Molybdenum	0.100	0.109	109	85.0-115	



Laboratory Control Sample (LCS)

(LCS) R4098986-2 07/26/24 14:34

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Nickel	0.100	0.103	103	85.0-115	
Selenium	0.100	0.105	105	85.0-115	
Silver	0.0500	0.0530	106	85.0-115	
Thallium	0.100	0.0980	98.0	85.0-115	
Zinc	0.100	0.103	103	85.0-115	

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/26/24 14:40 • (MS) R4098986-3 07/26/24 14:59 • (MSD) R4098986-4 07/26/24 15:05

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	RPD Limits %
Aluminum	1.00	0.167	1.06	1.03	89.2	86.1	1	70.0-130			2.97	20
Antimony	0.100	U	0.0847	0.0830	84.7	83.0	1	70.0-130			2.08	20
Arsenic	0.100	0.00528	0.0963	0.0954	91.1	90.1	1	70.0-130			1.02	20
Barium	0.100	0.0341	0.112	0.111	78.2	76.5	1	70.0-130			1.50	20
Beryllium	0.100	0.0000927	0.0964	0.0966	96.3	96.5	1	70.0-130			0.186	20
Cadmium	0.100	U	0.0908	0.0898	90.8	89.8	1	70.0-130			1.12	20
Chromium	0.100	U	0.0915	0.0880	91.5	88.0	1	70.0-130			3.91	20
Cobalt	0.100	0.00305	0.0895	0.0877	86.5	84.6	1	70.0-130			2.06	20
Copper	0.100	0.00257	0.0935	0.0913	91.0	88.7	1	70.0-130			2.40	20
Iron	1.00	0.153	1.18	1.06	103	90.8	1	70.0-130			11.0	20
Lead	0.100	0.000221	0.0913	0.0896	91.1	89.4	1	70.0-130			1.90	20
Magnesium	1.00	3.92	4.50	4.29	58.9	37.8	1	70.0-130	J6	J6	4.79	20
Manganese	0.100	0.0439	0.129	0.124	85.0	79.8	1	70.0-130			4.12	20
Molybdenum	0.100	0.00174	0.0961	0.0951	94.4	93.4	1	70.0-130			1.04	20
Nickel	0.100	0.00163	0.0913	0.0889	89.7	87.3	1	70.0-130			2.60	20
Selenium	0.100	U	0.0974	0.0996	97.4	99.6	1	70.0-130			2.26	20
Silver	0.0500	U	0.0465	0.0465	93.0	93.0	1	70.0-130			0.0109	20
Thallium	0.100	0.000894	0.0919	0.0893	91.0	88.4	1	70.0-130			2.83	20
Zinc	0.100	U	0.0937	0.0896	93.7	89.6	1	70.0-130			4.46	20

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4095202-2 07/16/24 20:34

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,1,1-Trichloroethane	U		0.00335	0.00500
1,1,2,2-Tetrachloroethane	U		0.000596	0.00500
1,1,2-Trichloroethane	U		0.00145	0.00500
1,1-Dichloroethene	U		0.00367	0.00500
1,1-Dichloroethane	U		0.00292	0.00500
1,2-Dibromoethane	U		0.000549	0.00200
1,2-Dichlorobenzene	U		0.00172	0.00200
1,2-Dichloroethane	U		0.00195	0.00500
1,2-Dichloropropane	U		0.000804	0.00200
1,3-Dichlorobenzene	U		0.00419	0.00500
1,4-Dichlorobenzene	U		0.00173	0.00200
2-Butanone (MEK)	U		0.00822	0.0250
2-Chloroethyl vinyl ether	U		0.00652	0.0100
Acrolein	U		0.00544	0.0100
Acrylonitrile	U		0.00709	0.0100
Benzene	U		0.00207	0.00500
Bromodichloromethane	U		0.00179	0.00200
Bromoform	U		0.000960	0.0100
Bromomethane	U		0.00347	0.00500
Carbon tetrachloride	U		0.00159	0.00200
Chlorobenzene	U		0.00276	0.0100
Chloroethane	U		0.00296	0.00500
Chloroform	U		0.00212	0.00500
Chloromethane	U		0.00361	0.00500
cis-1,3-Dichloropropene	U		0.00492	0.0100
Dibromochloromethane	U		0.00327	0.00500
Ethylbenzene	U		0.000401	0.00200
Methylene Chloride	U		0.0118	0.0200
Tetrachloroethene	U		0.00486	0.0100
Toluene	U		0.00219	0.00500
trans-1,2-Dichloroethene	U		0.00501	0.0100
Trichloroethene	U		0.00262	0.00500
Vinyl chloride	U		0.00466	0.00500
(S) 1,2-Dichloroethane-d4	101			70.0-130
(S) 4-Bromofluorobenzene	100			70.0-130
(S) Toluene-d8	100			70.0-130

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Laboratory Control Sample (LCS)

(LCS) R4095202-1 07/16/24 18:55

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,1,1-Trichloroethane	0.0200	0.0208	104	70.0-130	
1,1,2,2-Tetrachloroethane	0.0200	0.0185	92.5	60.0-140	
1,1,2-Trichloroethane	0.0200	0.0203	102	70.0-130	
1,1-Dichloroethene	0.0200	0.0202	101	50.0-150	
1,1-Dichloroethane	0.0200	0.0195	97.5	70.0-130	
1,2-Dibromoethane	0.0200	0.0200	100	70.0-130	
1,2-Dichlorobenzene	0.0200	0.0204	102	65.0-135	
1,2-Dichloroethane	0.0200	0.0193	96.5	70.0-130	
1,2-Dichloropropane	0.0200	0.0194	97.0	35.0-165	
1,3-Dichlorobenzene	0.0200	0.0201	101	70.0-130	
1,4-Dichlorobenzene	0.0200	0.0197	98.5	65.0-135	
2-Butanone (MEK)	0.100	0.0999	99.9	70.0-130	
2-Chloroethyl vinyl ether	0.100	0.0974	97.4	1.00-225	
Acrolein	0.100	0.103	103	64.0-139	
Acrylonitrile	0.100	0.0991	99.1	67.0-136	
Benzene	0.0200	0.0199	99.5	65.0-135	
Bromodichloromethane	0.0200	0.0202	101	65.0-135	
Bromoform	0.0200	0.0189	94.5	70.0-130	
Bromomethane	0.0200	0.0235	117	15.0-185	
Carbon tetrachloride	0.0200	0.0197	98.5	70.0-130	
Chlorobenzene	0.0200	0.0199	99.5	65.0-135	
Chloroethane	0.0200	0.0195	97.5	40.0-160	
Chloroform	0.0200	0.0199	99.5	70.0-135	
Chloromethane	0.0200	0.0173	86.5	1.00-205	
cis-1,3-Dichloropropene	0.0200	0.0192	96.0	25.0-175	
Dibromochloromethane	0.0200	0.0196	98.0	70.0-135	
Ethylbenzene	0.0200	0.0200	100	60.0-140	
Methylene Chloride	0.0200	0.0197	98.5	60.0-140	U
Tetrachloroethene	0.0200	0.0197	98.5	70.0-130	
Toluene	0.0200	0.0196	98.0	70.0-130	
trans-1,2-Dichloroethene	0.0200	0.0202	101	70.0-130	
Trichloroethene	0.0200	0.0215	108	65.0-135	
Vinyl chloride	0.0200	0.0197	98.5	5.00-195	
(S) 1,2-Dichloroethane-d4			107	70.0-130	
(S) 4-Bromofluorobenzene			100	70.0-130	
(S) Toluene-d8			101	70.0-130	

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

L1756836-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756836-01 07/16/24 22:36 • (MS) R4095202-3 07/16/24 23:00 • (MSD) R4095202-4 07/16/24 23:25

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
1,1,1-Trichloroethane	0.0200	U	0.0217	0.0194	109	97.0	1	52.0-162			11.2	36
1,1,2,2-Tetrachloroethane	0.0200	U	0.0178	0.0174	89.0	87.0	1	46.0-157			2.27	61
1,1,2-Trichloroethane	0.0200	U	0.0198	0.0189	99.0	94.5	1	52.0-150			4.65	45
1,1-Dichloroethene	0.0200	U	0.0225	0.0206	113	103	1	1.00-234			8.82	32
1,2-Dibromoethane	0.0200	U	0.0187	0.0186	93.5	93.0	1	70.0-130			0.536	20
1,2-Dichlorobenzene	0.0200	U	0.0215	0.0199	108	99.5	1	18.0-190			7.73	57
1,2-Dichloroethane	0.0200	U	0.0200	0.0192	100	96.0	1	49.0-155			4.08	49
1,2-Dichloropropane	0.0200	U	0.0201	0.0183	101	91.5	1	1.00-210			9.37	55
1,3-Dichlorobenzene	0.0200	U	0.0208	0.0192	104	96.0	1	59.0-156			8.00	43
1,4-Dichlorobenzene	0.0200	U	0.0202	0.0198	101	99.0	1	18.0-190			2.00	57
2-Butanone (MEK)	0.100	U	0.0618	0.0625	61.8	62.5	1	70.0-130	J6	J6	1.13	20
2-Chloroethyl vinyl ether	0.100	U	0.0768	0.0713	76.8	71.3	1	1.00-305			7.43	71
Acrolein	0.100	U	0.0515	0.0489	51.5	48.9	1	4.00-172			5.18	20
Acrylonitrile	0.100	U	0.0908	0.0796	90.8	79.6	1	22.0-189			13.1	20
Benzene	0.0200	U	0.0215	0.0196	108	98.0	1	37.0-151			9.25	61
Bromodichloromethane	0.0200	U	0.0203	0.0184	102	92.0	1	35.0-155			9.82	56
Bromoform	0.0200	U	0.0171	0.0169	85.5	84.5	1	70.0-130			1.18	42
Bromomethane	0.0200	U	0.0199	0.0178	99.5	89.0	1	15.0-185			11.1	61
Carbon tetrachloride	0.0200	U	0.0212	0.0188	106	94.0	1	70.0-140			12.0	41
Chlorobenzene	0.0200	U	0.0201	0.0193	101	96.5	1	37.0-160			4.06	53
Chloroethane	0.0200	U	0.0169	0.0159	84.5	79.5	1	14.0-230			6.10	78
Chloroform	0.0200	U	0.0218	0.0199	109	99.5	1	51.0-138			9.11	54
Chloromethane	0.0200	U	0.0144	0.0140	72.0	70.0	1	1.00-273			2.82	20
cis-1,3-Dichloropropene	0.0200	U	0.0180	0.0174	90.0	87.0	1	1.00-227			3.39	58
Dibromochloromethane	0.0200	U	0.0190	0.0176	95.0	88.0	1	53.0-149			7.65	50
Ethylbenzene	0.0200	U	0.0210	0.0198	105	99.0	1	37.0-162			5.88	63
Methylene Chloride	0.0200	U	0.0185	0.0171	92.5	85.5	1	1.00-221	J	J	7.87	28
Tetrachloroethene	0.0200	U	0.0215	0.0201	108	101	1	64.0-148			6.73	39
Toluene	0.0200	U	0.0199	0.0193	99.5	96.5	1	47.0-150			3.06	41
trans-1,2-Dichloroethene	0.0200	U	0.0226	0.0204	113	102	1	54.0-156			10.2	45
Trichloroethene	0.0200	U	0.0229	0.0213	115	106	1	70.0-157			7.24	48
Vinyl chloride	0.0200	U	0.0177	0.0165	88.5	82.5	1	1.00-251			7.02	66
(S) 1,2-Dichloroethane-d4					104	100		70.0-130				
(S) 4-Bromofluorobenzene					100	99.0		70.0-130				
(S) Toluene-d8					100	101		70.0-130				

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Method Blank (MB)

(MB) R4096010-1 07/19/24 02:11

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
PCB 1016	U		0.000270	0.000500
PCB 1221	U		0.000270	0.000500
PCB 1232	U		0.000270	0.000500
PCB 1242	U		0.000270	0.000500
PCB 1248	U		0.000173	0.000500
PCB 1254	U		0.000173	0.000500
PCB 1260	U		0.000173	0.000500
Total PCBs	U		0.000173	0.000500
(S) Decachlorobiphenyl	22.5			10.0-144
(S) Tetrachloro-m-xylene	70.6			10.0-135

Laboratory Control Sample (LCS)

(LCS) R4096010-5 07/19/24 02:30

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
PCB 1016	0.00250	0.00282	113	50.0-140	
PCB 1260	0.00250	0.00247	98.8	8.00-140	
(S) Decachlorobiphenyl			63.5	10.0-144	
(S) Tetrachloro-m-xylene			79.2	10.0-135	

L1756962-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1756962-01 07/19/24 03:09 • (MS) R4096010-6 07/19/24 03:39 • (MSD) R4096010-7 07/19/24 03:48

Analyte	Spike Amount mg/l	Original Result mg/l	MS Result mg/l	MSD Result mg/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	MS Qualifier	MSD Qualifier	RPD %	RPD Limits %
PCB 1016	0.00250	U	0.0152	0.0214	608	856	1	50.0-140	J5 P	J5	33.9	36
PCB 1260	0.00250	U	0.0165	0.0238	660	952	1	8.00-140	J5 P	J5	36.2	38
(S) Decachlorobiphenyl					23.0	28.6		10.0-144				
(S) Tetrachloro-m-xylene					49.2	57.9		10.0-135				

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4096164-1 07/19/24 12:54

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
1,2,4,5-Tetrachlorobenzene	U		0.000200	0.00200
2,4,6-Trichlorophenol	U		0.000238	0.00200
2,4-Dichlorophenol	U		0.000336	0.00400
2,4-Dimethylphenol	U		0.000613	0.00200
2,4-Dinitrophenol	U		0.00154	0.0100
2-Chlorophenol	U		0.000307	0.00200
2-Methylphenol	U		0.000238	0.00200
2-Nitrophenol	U		0.000247	0.00200
3&4-Methyl Phenol	U		0.000238	0.00200
3,3-Dichlorobenzidine	U		0.000788	0.00400
4,6-Dinitro-2-methylphenol	U		0.00202	0.0100
4-Chloro-3-methylphenol	U		0.000217	0.00200
4-Nitrophenol	U		0.00123	0.0100
Anthracene	U		0.000168	0.00200
Benzidine	U		0.000350	0.00400
Benzo(a)anthracene	U		0.000307	0.00200
Benzo(a)pyrene	U		0.000470	0.00200
Bis(2-chloroethyl)ether	U		0.000168	0.00200
Bis(2-Ethylhexyl)phthalate	U		0.00180	0.00200
Chrysene	U		0.000257	0.00200
Di-n-butyl phthalate	U		0.00160	0.00200
Hexachloro-1,3-butadiene	U		0.000217	0.00200
Hexachlorobenzene	U		0.000307	0.00200
Hexachlorocyclopentadiene	U		0.000299	0.00200
Hexachloroethane	U		0.000247	0.00200
n-Nitrosodi-n-butylamine	U		0.00110	0.00200
n-Nitrosodiethylamine	U		0.000696	0.00200
Nitrobenzene	U		0.000314	0.00200
Nonylphenol	U		0.000168	0.00200
Pentachlorobenzene	U		0.000247	0.00200
Pentachlorophenol	U		0.000283	0.00200
Phenanthrene	U		0.000200	0.00200
Phenol	U		0.000500	0.00200
Pyridine	U		0.00174	0.00400
Total Cresols	U		0.00153	0.00800
(S) 2,4,6-Tribromophenol	54.0			29.0-132
(S) 2-Fluorobiphenyl	68.0			26.0-102
(S) 2-Fluorophenol	59.0			10.0-66.0
(S) Nitrobenzene-d5	70.0			15.0-106
(S) p-Terphenyl-d14	80.0			10.0-120

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>Gl

<sup>8</sup>Al

<sup>9</sup>Sc

Method Blank (MB)

(MB) R4096164-1 07/19/24 12:54

Analyte	MB Result mg/l	MB Qualifier	MB MDL mg/l	MB RDL mg/l
(S) Phenol-d6	50.5			10.0-54.0

Laboratory Control Sample (LCS)

(LCS) R4096164-2 07/19/24 13:23

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
1,2,4,5-Tetrachlorobenzene	0.200	0.137	68.5	31.0-120	
2,4,6-Trichlorophenol	0.200	0.173	86.5	37.0-144	
2,4-Dichlorophenol	0.200	0.166	83.0	39.0-135	
2,4-Dimethylphenol	0.200	0.169	84.5	32.0-120	
2,4-Dinitrophenol	0.200	0.121	60.5	100-191	
2-Chlorophenol	0.200	0.168	84.0	23.0-134	
2-Methylphenol	0.200	0.174	87.0	26.0-120	
2-Nitrophenol	0.200	0.158	79.0	29.0-182	
3&4-Methyl Phenol	0.200	0.164	82.0	27.0-120	
3,3-Dichlorobenzidine	0.400	0.397	99.3	100-262	
4,6-Dinitro-2-methylphenol	0.200	0.159	79.5	100-181	
4-Chloro-3-methylphenol	0.200	0.174	87.0	22.0-147	
4-Nitrophenol	0.200	0.121	60.5	100-132	
Anthracene	0.200	0.179	89.5	27.0-133	
Benzidine	0.400	0.175	43.8	100-120	
Benzo(a)anthracene	0.200	0.184	92.0	33.0-143	
Benzo(a)pyrene	0.200	0.198	99.0	17.0-163	
Bis(2-chloroethyl)ether	0.200	0.162	81.0	33.0-185	
Bis(2-Ethylhexyl)phthalate	0.200	0.207	104	8.00-158	
Chrysene	0.200	0.173	86.5	17.0-168	
Di-n-butyl phthalate	0.200	0.196	98.0	100-120	
Hexachloro-1,3-butadiene	0.200	0.130	65.0	24.0-120	
Hexachlorobenzene	0.200	0.145	72.5	100-152	
Hexachlorocyclopentadiene	0.200	0.106	53.0	10.0-120	
Hexachloroethane	0.200	0.138	69.0	40.0-120	
n-Nitrosodi-n-butylamine	0.200	0.172	86.0	39.0-127	
n-Nitrosodiethylamine	0.200	0.167	83.5	10.0-142	
Nitrobenzene	0.200	0.166	83.0	35.0-180	
Nonylphenol	0.200	0.184	92.0	57.0-136	
Pentachlorobenzene	0.200	0.144	72.0	10.0-151	
Pentachlorophenol	0.200	0.158	79.0	14.0-176	
Phenanthrene	0.200	0.166	83.0	54.0-120	

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc

Laboratory Control Sample (LCS)

(LCS) R4096164-2 07/19/24 13:23

Analyte	Spike Amount mg/l	LCS Result mg/l	LCS Rec. %	Rec. Limits %	LCS Qualifier
Phenol	0.200	0.125	62.5	5.00-120	
Pyridine	0.200	0.0435	21.7	10.0-120	
Total Cresols	0.400	0.338	84.5	36.0-110	
(S) 2,4,6-Tribromophenol			71.0	29.0-132	
(S) 2-Fluorobiphenyl			80.5	26.0-102	
(S) 2-Fluorophenol			70.5	10.0-66.0	J1
(S) Nitrobenzene-d5			79.5	15.0-106	
(S) p-Terphenyl-d14			88.5	10.0-120	
(S) Phenol-d6			68.0	10.0-54.0	J1

1Cp

2Tc

3Ss

4Cn

5Sr

6Qc

7Gl

8Al

9Sc



# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report


The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

Results Disclaimer - Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDL	Method Detection Limit.
ND	Not detected at the Reporting Limit (or MDL where applicable).
RDL	Reported Detection Limit.
Rec.	Recovery.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(S)	Surrogate (Surrogate Standard) - Analytes added to every blank, sample, Laboratory Control Sample/Duplicate and Matrix Spike/Duplicate; used to evaluate analytical efficiency by measuring recovery. Surrogates are not expected to be detected in all environmental media.
U	Not detected at the Reporting Limit (or MDL where applicable).
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

Qualifier	Description
B	The same analyte is found in the associated blank.
E	The analyte concentration exceeds the upper limit of the calibration range of the instrument established by the initial calibration (ICAL).
J	The identification of the analyte is acceptable; the reported value is an estimate.
J1	Surrogate recovery limits have been exceeded; values are outside upper control limits.
J3	The associated batch QC was outside the established quality control range for precision.
J5	The sample matrix interfered with the ability to make any accurate determination; spike value is high.
J6	The sample matrix interfered with the ability to make any accurate determination; spike value is low.
P	RPD between the primary and confirmatory analysis exceeded 40%.
T8	Sample(s) received past/too close to holding time expiration.
V	The sample concentration is too high to evaluate accurate spike recoveries.



# ACCREDITATIONS & LOCATIONS

## Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey-NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio-VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1 6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1 4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP, LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		


## Pace Analytical Services, LLC -Dallas 400 W. Bethany Drive Suite 190 Allen, TX 75013

Arkansas	88-0647	Kansas	E10388
Florida	E871118	Texas	T104704232-23-39
Iowa	408	Oklahoma	8727
Louisiana	30686		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.



[illegible]



Company Name/Address:  
**Garland Power & Light**  
  
13835 County Rd 489  
Nevada, TX 75173

Billing Information:  
**Michael Burr**  
13835 County Rd 489  
Nevada, TX 75173

Report to:  
**Jeff McClain**

Project Description:  
**TPDES**

Phone: **972-485-6458**

City/State Collected:

Please Circle:  
PT MT CT ET

Email To: mburr@gpiltexas.org;jmccain@gpiltexas.org;gplenviron@gpiltexas.org

Client Project #

Lab Project #  
**DSGARLWNTX-RENEW  
AL**

Collected by (print):

Site/Facility ID #

P.O. #

Collected by (signature):

**Rush?** (Lab MUST Be Notified)  
\_\_\_\_ Same Day \_\_\_\_ Five Day  
\_\_\_\_ Next Day \_\_\_\_ 5 Day (Rad Only)  
\_\_\_\_ Two Day \_\_\_\_ 10 Day (Rad Only)  
\_\_\_\_ Three Day

Date Results Needed

No. of  
Cntrs

Immediately  
Packed on Ice N \_\_\_\_ Y \_\_\_\_

Sample ID

Comp/Grab

Matrix \*

Depth

Date

Time

**OUTFALL 001**

**6**

**WW**

**7/16/24 0818**

**24**

\* Matrix:  
SS - Soil **AIR** - Air **F** - Filter  
GW - Groundwater **B** - Bioassay  
WW - WasteWater  
DW - Drinking Water  
OT - Other

Remarks:

Samples returned via:  
\_\_\_\_ UPS \_\_\_\_ FedEx \_\_\_\_ Courier

Tracking #

Relinquished by : (Signature)  
**ay**

Date:  
**7/16/24**

Time:  
**0942**

Received by: (Signature)  
**Clarissa PACE**

Trip Blank Received: Yes / No  
HCL / MeoH  
TBR

Relinquished by : (Signature)  
**ay**

Date:  
**7/16/24**

Time:  
**1700**

Received by: (Signature)  
**FedEx**

Temp: °C  
**7/16/24 1700**

Bottles Received:

If preservation required by Login: Date/Time

Relinquished by : (Signature)  
**FedEx**

Date:

Time:

Received for lab by: (Signature)  
**07-17-24 0900**

Date:

Time:

S.S. = 5.0

Condition:  
NCF / OK

Chain of Custody Page 7 of 8

190 Allen, TX 75013  
Submitting a sample via this chain of custody constitutes acknowledgment and acceptance of the Pace Terms and Conditions found at: <https://info.pacelabs.com/hubfs/pas-standard-terms.pdf>

SDG # **L1756836**

Table #

Acctnum: **DSGARLWNTX**

Template: **T256244**

Prelogin: **P1088417**

PM: **3565 - Dorothy P Roberts**

PB:

Shipped Via: **FedEx Priority**

Remarks

Sample # (lab only)  
**01**

Analysis / Container / Preservative

BOD CBOD MBAS TDS 1L-HDPE NoPres

BOD CBOD MBAS TDS 1L-HDPE-NoPres

Metals site spec 250mlHDPE HNO3

PAN CHLORR 250mlHDPE-NoPres

PAN SULFITE 250mlHDPE-NoPres

PAN-SULFITE,CHLORR 250mlHDPE NoPres

WetChem COD NH3 N/N 250mlHDPE-H2SO4

WetChem anions, ALK 125mlHDPE-NoPres

WetChem,color CR6,DO 500mlHDPE-NoPres

1756836



DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

### Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ Austin

Client Name: Garland Power Light Project Work order (place label):

Courier: FedEx ☐ UPS ☐ USPS ☐ Client ☐ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒

Received on ice: Wet ☒ Blue ☐ No ice ☐

Receiving Lab 1 Thermometer Used: 1219 Cooler Temp °C: 3.3 (Recorded) +0.1 (Correction Factor) 34 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AG Date: 7/16/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6.402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: <u>14820</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Sulfide Present Lead Acetate Strips: <u>14822</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
State Sampled: _____	
Non-Conformance(s):	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: OC Date: 7/16

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

[illegible]



[illegible]

[illegible]





DC#\_Title: ENV-FRM-ALLE-0017 v15\_Sample Condition Upon Receipt

Effective Date: 12/18/2023

## Sample Condition Upon Receipt

☐ Dallas ☐ Ft Worth ☐ Corpus Christi ☐ AustinClient Name: Garland Power Plant Project Work order (place label):Courier: FedEX ☐ UPS ☐ USPS ☐ Client ☒ LSO ☐ PACE ☐ Other: \_\_\_\_\_

Tracking #: \_\_\_\_\_

Custody Seal on Cooler/Box: Yes ☐ No ☒Received on ice: Wet ☒ Blue ☐ No ice ☐Receiving Lab 1 Thermometer Used: 1819 Cooler Temp °C: 4.4 (Recorded) 10.1 (Correction Factor) 4.5 (Actual)

Receiving Lab 2 Thermometer Used: \_\_\_\_\_ Cooler Temp °C: \_\_\_\_\_ (Recorded) \_\_\_\_\_ (Correction Factor) \_\_\_\_\_ (Actual)

Chain of Custody relinquished	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sampler name & signature on COC	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Short HT analyses (<72 hrs)	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>

Temperature should be above freezing to 6°C unless collected same day as receipt in which evidence of cooling is acceptable.

Triage Person: AG Date: 7/26/24

Sufficient Volume received	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Correct Container used	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Container Intact	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Sample pH Acceptable pH Strips: <u>6402007</u>	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA <input type="checkbox"/>
Residual Chlorine Present Cl Strips: <u>14880</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Sulfide Present Lead Acetate Strips: <u>148802</u>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Are soil samples (volatiles, TPH) received in 5035A Kits (not applicable to TCLP VOA or PST Program TPH)	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Unpreserved 5035A soil frozen within 48 hrs	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Headspace in VOA (>6mm)	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA <input type="checkbox"/>
Project sampled in USDA Regulated Area outside of Texas State Sampled: _____	Yes <input type="checkbox"/> No <input type="checkbox"/> NA <input checked="" type="checkbox"/>
Non-Conformance(s):	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>

Login Person: pe Date: 7/26

Labeling Person (if different than log-in): \_\_\_\_\_ Date: \_\_\_\_\_

## **ATTACHMENT TR-5**

### Cooling Water System Data

**Worksheet 11.0**  
**Cooling Water Intake Information**  
**Section 1.b. Cooling Water System Data**

**1. Description of the design and annual operation of the facility's cooling water system and its relationship to the CWIS(s)**

A description of ROPP and the cooling-water system of the facility is provided in the facility PIC (GP&L, 2006). ROPP is a 420-megawatt peaking, gas-fired facility consisting of four generating units. The power plant is located on the southeast shore of Lake Lavon in Collin County (Figures 1 and 2). Units 1, 2, and 3 use Lake Lavon water for once-through condenser cooling. Unit 4 is a gas turbine that uses an average of 0.0006 mgd of reservoir water for contact cooling; then it is discharged to evaporation ponds. Units 1, 2, and 3 each have two circulating-water (CW) pumps. The CW pumps for Unit 1 are each rated at 30,000 gallons per minute (gpm). The CW pumps for Unit 2 are each rated at 35,000 gpm. The CW pumps for Unit 3 are each rated at 54,000 gpm. Each CW pump is served by a single traveling-water screen (screen) with  $\frac{3}{8}$ -inch square steel mesh. The facility's maximum design cooling-water withdrawal volume (flow) is 248,000 gpm (357 mgd). One screen wash pump per unit also withdraws small volumes of water from Lake Lavon.

Figure 3 shows the 5-year flow history for ROPP. In general, the facility withdraws more cooling water during summer, followed by winter and less water during fall and spring. In the 5-year flow history, the facility has not operated at design capacity. As shown in Figure 3, the facility withdraws less than the design capacity most of the time. The annual cooling water utilization capacity over the past 5 years was about 43% of the design capacity.


Normal operating reservoir pool elevation (reservoir elevation) is 492.0 feet (ft) mean sea level [msl]). The minimum operating reservoir elevation is 483.3 ft msl. The wetted screen depth at normal reservoir elevation is 32 ft. The CW pumps are either off, with zero flow, or operating at design flow. Screen velocities (velocity) vary among units due to the different CW pump capacities. In addition, velocity varies with varying wetted screen area, resulting in changes in reservoir elevation.

Cooling water is withdrawn from the rear of a 700-foot-long excavated intake canal. However, the distance to the main body of the reservoir is approximately 2,500 ft. The shallowest depth of the canal is approximately 25 ft.


Screens are usually washed once per 8-hour shift when the units are in operation. The length of time the screen wash operates varies depending on the differential pressure loss. On occasion, the screens may be washed several times during a single day. Screen-wash water from each unit is transported through a sluice, then to a debris sump and basket, and then returned to the reservoir near the CWIS. The cooling water system is described below in Table 1.

**Table 1. ROPP CWIS Configuration.**

	<b>Unit 1</b>	<b>Unit 2</b>	<b>Unit 3</b>	<b>Facility</b>
Number of circulating water pumps	2	2	2	
Circulating water pump capacity (mgd) per pump	43.2	50.4	77.8	
Number of service water pumps	1	1	1	
Service water pump capacity (mgd)	4.32	4.32	5.76	
Number of screens	2	2	2	
Screen type	Traveling	Traveling	Traveling	
Screen mesh size (inch)	0.38	0.38	0.38	
Through-screen velocity (fps)	0.84	0.98	1.51	
Design flow (mgd)				357
Percent reservoir volume pumped/day at design				0.2
Megawatt rating (Units 1-3)				420
24-month capacity utilization (June 2022 – June 2024)	0.0%	3.4%	3.9%	3.6%

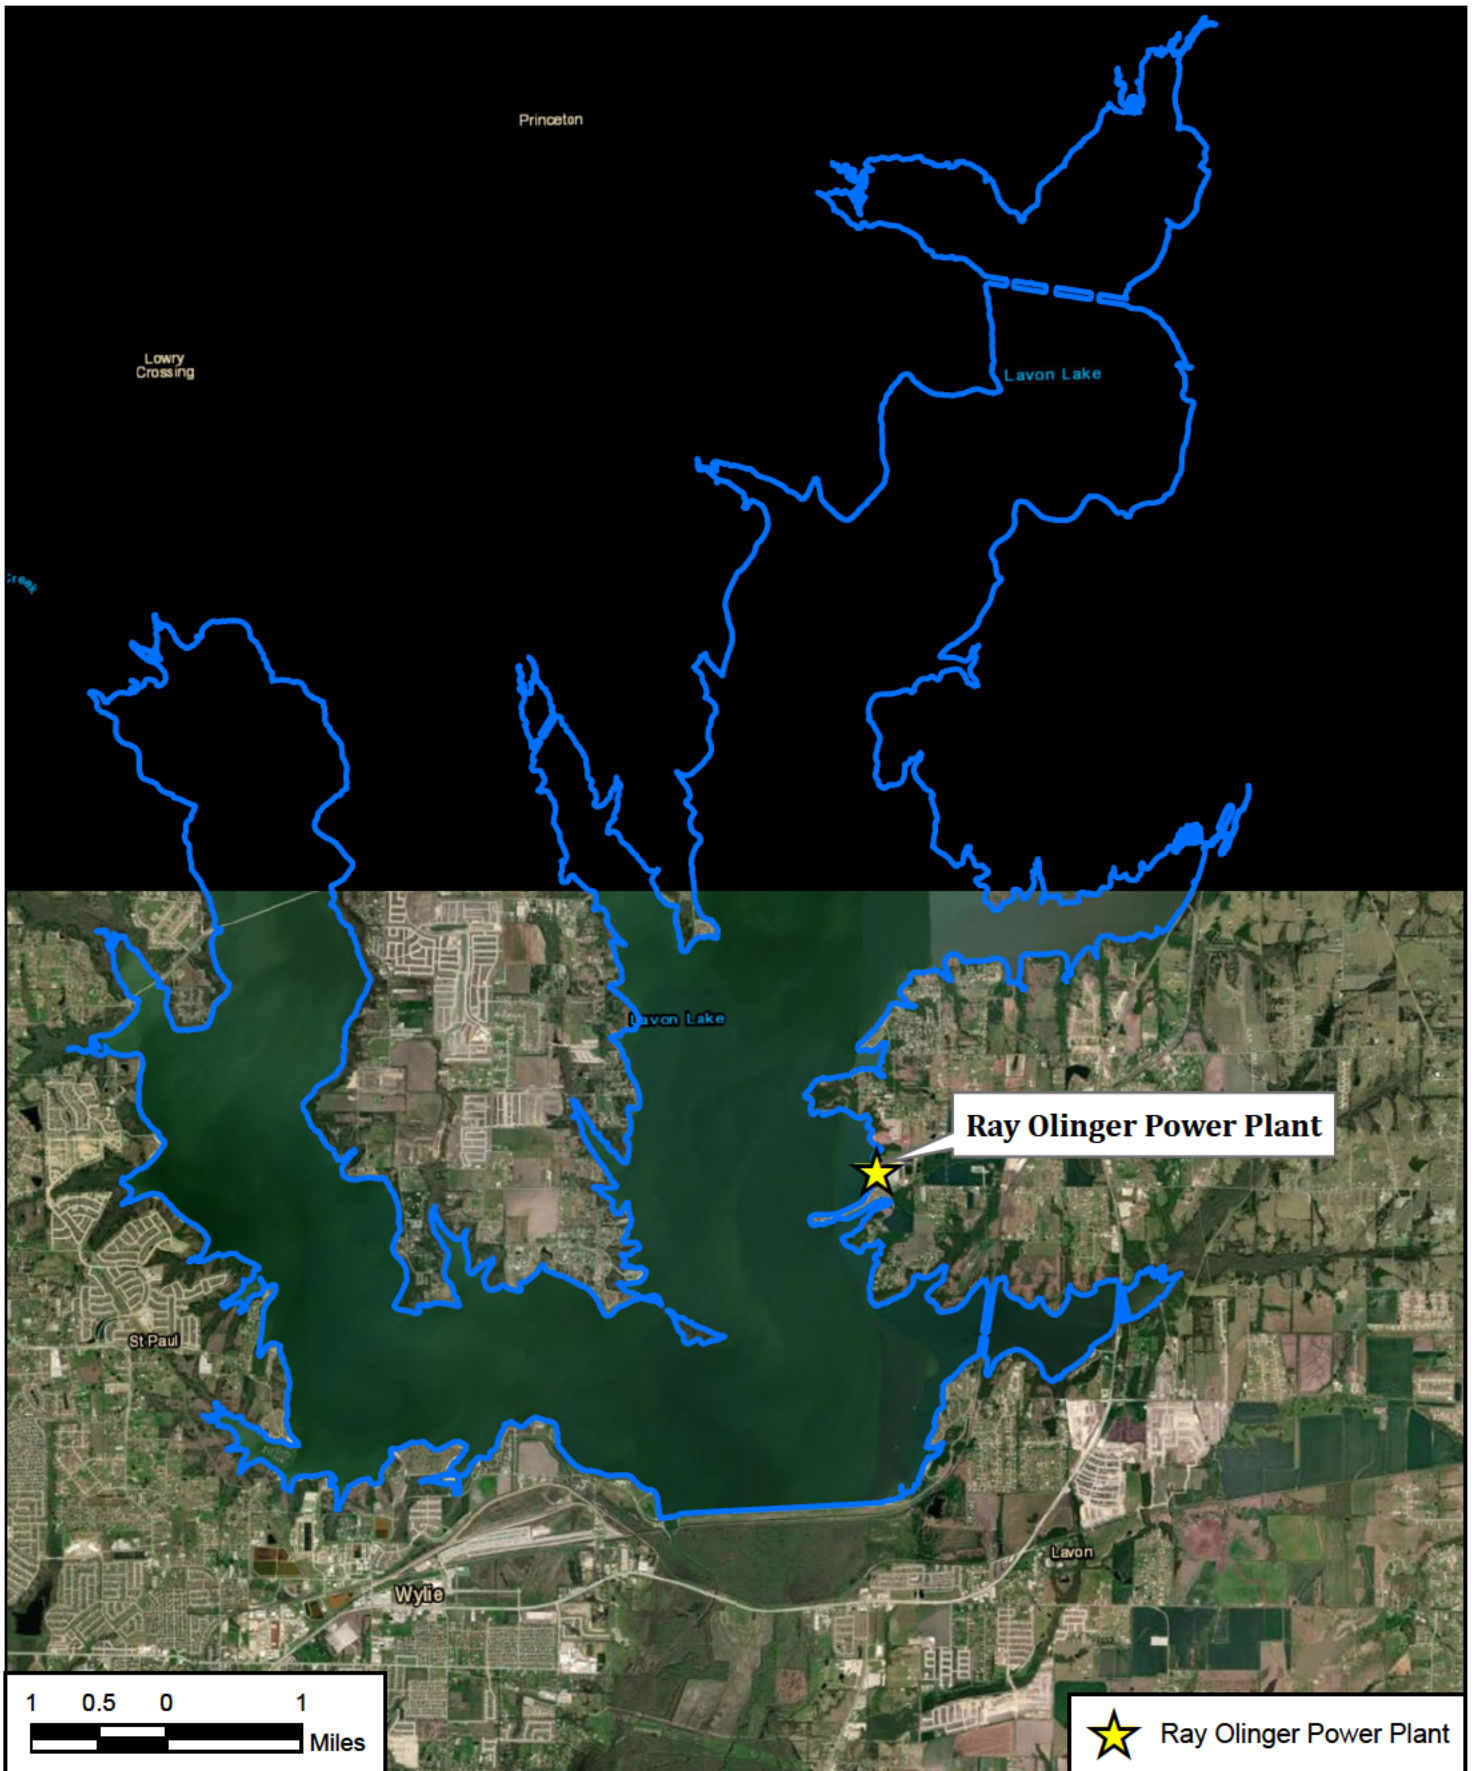

**FREESSE AND NICHOLS**  
 FREESSE AND NICHOLS, INC  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland  
**Ray Olinger Power Plant**  
**Lake Lavon**

FW JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	7/16/2024
SCALE	1:90,000
DESIGNED	CLV
DRAFTED	08245

**5**  
**FIGURE**





**FRESE AND NICHOLS**  
 FREESE AND NICHOLS, INC  
 801 Cherry Street, Suite 2800  
 Fort Worth, TX 76102  
 Phone - (817) 735 - 7300



City of Garland

**Ray Olinger Power Plant**


**Power Plant Facilities**

FW JOB NO	GPL24350
FILE NAME	GP&L TPDES Renewal.mxd
DATE	7/18/2024
SCALE	1:7,372
DESIGNED	CLV
DRAFTED	08245

**5**

**FIGURE**

Figure 3. 5-year Flow History for ROPP

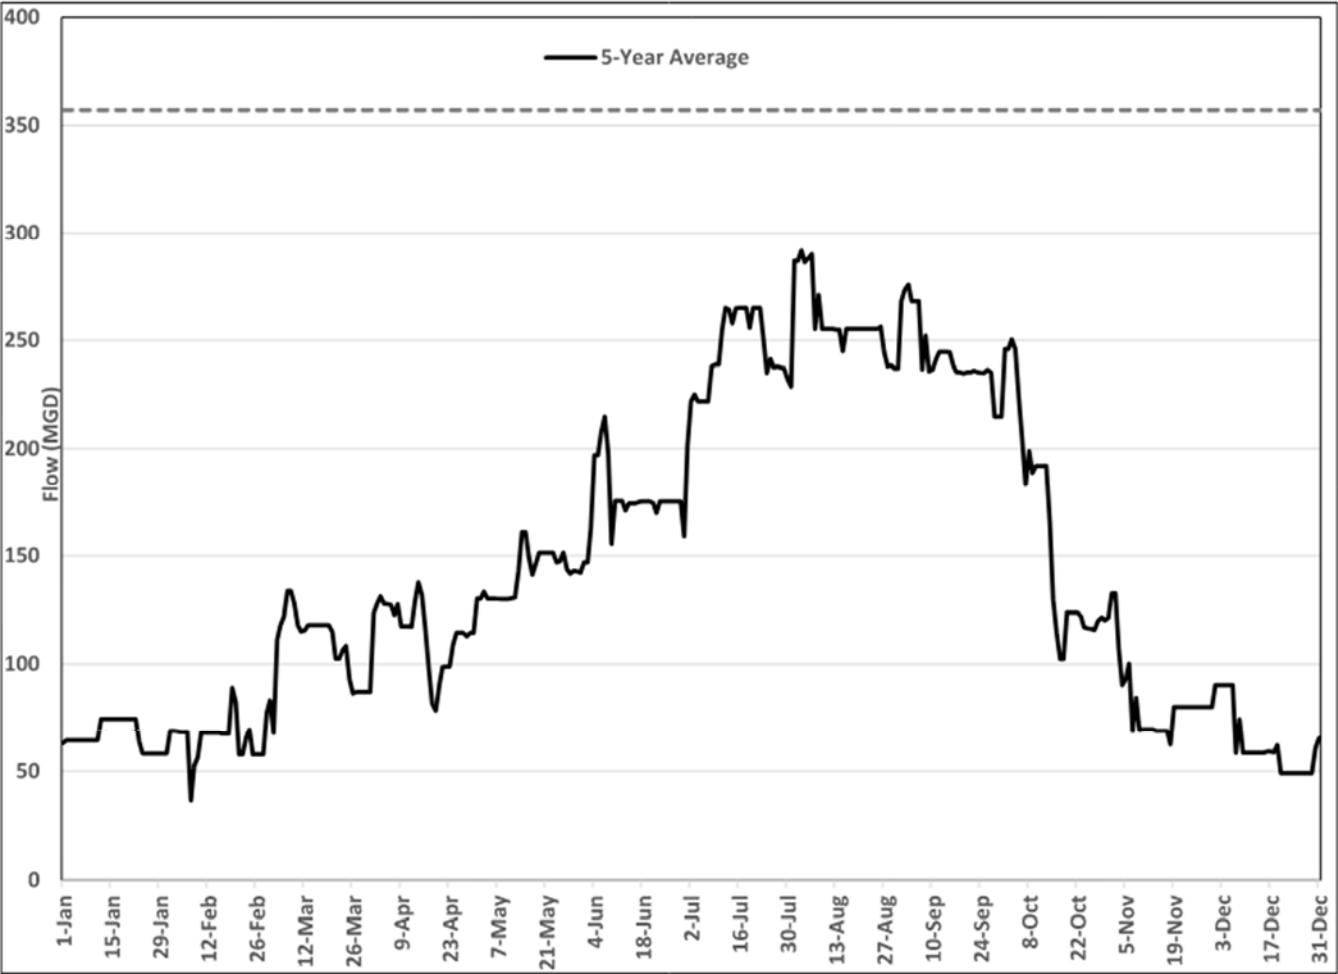

### **Section 1.b. Cooling Water System Data**

- 2. A scaled map depicting the location of each CWIS, impoundment, intake pipe, and canals, pipes, or waterways used to convey cooling water to, or within, the cooling water system. Provide the latitude and longitude for each CWIS and any intake pipe(s) on the map. Indicate the position of the intake pipe within the water column.**

Figures 1 and 2 provide aerial views of the CWIS and associated power plant facilities. The CWIS geographic location is at: 33° 03' 55.37" N, 96° 27' 11.30" W. The CWIS withdraws from the rear of an excavated channel that is approximately 34-feet deep at the CWIS. The floor of the CWIS is at 458.0 ft- msl. Normal pool elevation of Lake Lavon is 492.0 ft- msl. The traveling screens span from the floor of the CWIS to the top deck, allowing vertical integration of the water column. However, the CW pumps are vertical-shaft turbines with the impellers near the floor of the CWIS, and, therefore, a higher proportion of flow is generally from near the bottom.

- 3. A description of water reuse activities, if applicable.**

ROPP utilizes once-through cooling water from Lake Lavon. While cooling water is circulated within the reservoir, there is no reuse, such as reclaimed effluent to offset the use of surface water.

- 4. Design and engineering calculations prepared by a qualified professional and data to support the information provided in above item a.**

DIF is the compilation of all circulating and service water pump capacities (assumed zero head differential). AIF is the average discharge monitoring reported flows for the past 3 years (June 2021 – June 2024). Intake flow use percentage is the proportion of the reported flow for each use to the AIF. The proportion of contact cooling was derived from a 3-year average that is presented in the water balance. There is no process use of water at ROPP.



### Section 1.b. Cooling Water System Data

#### 5. Previous year (a minimum of 12 months) of AIF data.

**Table 4. Ray Olinger Power Plant actual intake flow, January 2023 – December 2023.**

Day	January	February	March	April	May	June	July	August	September	October	November	December
1	6.48	57.6	54.721	213.12	213.12	216	268.56	268.56	268.56	268.56	113.04	7.2
2	7.2	57.6	56.041	213.12	213.12	216	268.56	268.56	268.56	268.56	113.04	7.2
3	7.2	57.6	57.6	222	222	188.64	279.75	279.75	279.75	279.75	49.98	7.5
4	7.2	57.6	137.52	213.12	213.12	213.12	268.56	268.56	268.56	268.56	7.2	7.2
5	7.2	57.6	134.64	213.12	213.12	213.12	268.56	268.56	268.56	264.27	7.2	7.2
6	7.2	57.6	154.8	213.12	213.12	213.12	268.56	268.56	268.56	242.82	7.2	7.2
7	7.2	57.6	213.12	213.12	213.12	213.12	268.56	268.56	268.56	268.56	7.2	7.2
8	7.2	57.6	213.12	213.12	213.12	167.76	268.56	268.56	268.44	268.56	7.29	7.2
9	7.2	57.6	135.36	213.12	213.12	61.14	268.56	268.56	266.52	268.56	8.28	7.2
10	7.2	57.6	57.6	213.48	213.12	110.88	268.56	268.56	268.56	268.56	9.36	7.2
11	7.2	57.6	42.9	213.12	214.32	110.88	268.56	268.56	268.56	268.56	9.36	7.2
12	57.6	57.6	45	213.12	216	110.88	268.56	268.56	268.56	268.56	9.36	7.2
13	57.6	57.6	57.6	213.12	216	110.88	264.24	268.56	268.56	268.56	9.27	7.2
14	57.6	57.6	57.6	213.12	216	110.88	232.92	268.56	268.56	190.8	7.2	7.2
15	57.6	57.6	57.6	213.12	216	110.88	268.56	268.56	268.56	113.04	7.2	7.2
16	57.6	54.721	57.6	213.12	216	110.88	268.56	268.56	268.56	113.04	7.2	7.2
17	57.6	54.721	57.6	213.12	216	110.88	268.56	268.56	268.56	113.04	7.2	7.2
18	57.6	54.721	57.6	213.12	243.3	110.88	268.56	268.56	268.56	113.04	7.2	7.2
19	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	267.48	113.04	7.2	7.2
20	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
21	57.6	54.721	57.6	213.12	266.4	108.96	268.56	268.56	268.56	113.04	7.2	7.2
22	57.6	54.721	57.6	213.12	266.4	97.44	268.56	268.56	268.56	113.04	7.2	7.2
23	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
24	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
25	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
26	57.6	54.721	55.98	213.12	266.4	110.88	268.56	268.56	268.56	113.04	7.2	7.2
27	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	111.6	7.2	7.2
28	57.6	54.721	57.6	213.12	266.4	110.88	268.56	268.56	268.56	107.521	7.2	7.2
29	57.6		57.6	213.12	266.4	110.88	268.56	268.56	268.56	111.12	7.2	7.2
30	57.6		57.6	213.12	266.4	110.88	268.56	268.56	268.56	108.001	7.2	7.2
31	57.6		57.6		266.4		268.56	268.56		110.641		7.2
<b>AVG</b>	<b>39.6929</b>	<b>56.26332</b>	<b>77.26458</b>	<b>213.428</b>	<b>237.3194</b>	<b>133.838</b>	<b>267.6319</b>	<b>268.921</b>	<b>268.825</b>	<b>179.6324</b>	<b>16.006</b>	<b>7.209677</b>

**6. A narrative description of existing or proposed impingement and entrainment technologies or operation measures and a summary of their performance, including, but not limited to, reductions in impingement mortality and entrainment due to intake location and reductions in total water withdrawals and usage.**

There have been no technologies or operational measures recently employed to specifically reduce impingement mortality or entrainment at ROPP. From November 2006 through November 2007, biweekly impingement sampling was conducted at ROPP (Impingement Mortality Characterization Study, Ray Olinger Power Plant conducted by PBS&J, 2007). Over the course of that study, a total of 387 fish impinged, of which 88% were Threadfin (*Dorosoma petenense*) and Gizzard (*D. cepedianum*) shad, followed by Largemouth Bass (*Micropterus salmoides*) [5%], and Golden Shiner (*Notemigonus crysoleucas*) [3%]. The cooling water capacity factor (AIF/DIF x 100) was 43% during the study. Total impingement for the entire year was estimated at approximately 4,800, with the overwhelming majority of fish consisting of fragile (shad) [40 FCR 125.92(m)] or exotic (Golden Shiner) species.

The number of fish not considered fragile or exotic expected to be impinged at ROPP is exceptionally low (up to a few hundred annually) and the facility might qualify for the de minimis alternative (40 CFR 125.94[11]) to meet impingement mortality compliance standard. The low impingement rate results from the CWIS location and design. The U.S. Environmental Protection Agency's 2004 Final Regulations to Establish Requirements for Cooling Water Intake Structures at Phase II Existing Facilities Rule defines a "baseline" CWIS configuration as one that is oriented parallel to the shore and is absent impingement or entrainment control measures (otherwise, worst-case scenario). The CWIS at ROPP is located at the rear of a man-made, excavated canal that is 32-feet deep at normal reservoir pool elevation. The CWIS employs vertical-shaft turbine pumps that withdraw from near the floor of the CWIS (deep water), which is not the most biologically productive zone. In addition, screen velocities are relatively low, ranging from 0.8 (Unit 1) to 1.5 (Unit 3) fps at normal reservoir pool elevation. Therefore, the location and operation of the CWIS aids in reducing impingement mortality. It is also important to note that cooling water capacity is generally low, with a recent 3-year (2016-2018) average of 41%, indicating that current and likely future CWIS operations for ROPP would likely result in low impingement.

Entrainment has not been monitored at ROPP. Peak spawning (and juvenile life stage abundance) in Lake Lavon occurs in the spring and early summer. As indicated in Figure 3, power plant operations are greatly reduced in the spring, during spawning season. In addition, the CWIS is located at the rear of a deep, excavated channel which presumably has little, if any littoral habitat for spawning. As a result of this operational pattern and the location of the CWIS, entrainment at ROPP is expected to be low.

## **ATTACHMENT TR-6**

Cooling Water Intake Structure(s) Data

**Worksheet 11.0**  
**Cooling Water Intake Information**

**Section 2.b. Cooling Water Intake Structure Data**

- 1. A narrative description of the configuration of each CWIS, annual and daily operation, including any seasonal changes, and where it is located in the water body and in the water column.**

ROPP has a single CWIS which is divided into bays which serve each of the units' CW pumps. Each unit has two circulating-water (CW) pumps. The Cooling Water Intake Structure(s) Data Table describes the components of the CWIS. Each CW pump is served by a single traveling-water screen (screen) with  $\frac{3}{8}$ -inch square steel mesh. Screens are usually washed once per 8-hour shift when the units are in operation. The length of time the screen wash operates varies depending on the differential pressure loss. On occasion the screens may be washed several times during a single day. Screen-wash water from each unit is transported through a sluice, then to a debris sump and basket, and then returned to the reservoir near the CWIS.

Figure 3 shows the 5-year flow history for ROPP. In general, the facility withdraws more cooling water during summer followed by winter and less water during fall and spring. In the 5-year flow history, the facility had not operated at design capacity. As shown on Figure 3, the facility withdraws less than design capacity during most of the time. The annual cooling water utilization capacity over the past 5 years was about 43% of design capacity

Cooling water is withdrawn from the rear of a 700-foot-long excavated intake canal. However, the distance to the main body of the reservoir is approximately 2,500 ft. The shallowest depth of the canal is approximately 25 ft; however, the depth in the vicinity of the CWIS is approximately 32 feet under normal reservoir pool elevation. The CW pumps are vertical-shaft turbines with the impellers near the floor of the CWIS. Therefore, a higher proportion of flow is generally from near the bottom (deeper water).

- 2. Engineering calculations for each CWIS.**

There is only one CWIS at ROPP. CWIS information is listed in the ROPP CWIS Configuration Table in Attachment TR-5 and The Cooling Water Intake Structure(s) Data Table (Worksheet 11.0 2.a). DIF is 357 mgd and is the compilation of all circulating and service water pump capacities (assumed zero head differential). AIF is the average reported flows for the past 3 years (June 2021 – June 2024). Intake flow uses percentage is the proportion of the reported flow for each use to the AIF.

## **ATTACHMENT TR-7**

### Source Water Physical Data

**Worksheet 11.0**  
**Cooling Water Intake Information**  
**Section 3.b. Source Water Physical Data**

- 1. A narrative description of the source water for each CWIS, including areal dimensions, depths, salinity and temperature regimes, and other documentation that supports your determination of the water body type where each cooling water intake structure is located.**

ROPP uses cooling water from Lake Lavon. The facility utilizes a single CWIS located at the rear of a 700-foot-long excavated intake canal (see Figure 4). The distance to the main body of the reservoir is approximately 2,500 ft. The depth at the CWIS is approximately 32 ft under conservation pool elevation. Lake Lavon is a man-made impoundment constructed on the East Fork Trinity River, Texas Commission on Environmental Quality Segment No. 0821. At normal operating reservoir pool elevation of 492.0 ft msl, total surface area of Lake Lavon is 20,559 acres with a storage capacity of approximately 409,360 acre-feet. The reservoir and power plant are located in the Navarro and Taylor geologic groups (Bureau of Economic Geology <http://www.jsg.utexas.edu/news/files/Geologic-map-of-Texas.jpg>).

- 2. A narrative description of the source waterbody's hydrological and geomorphological features.**

Lake Lavon is a fresh water impoundment used for flood control, water supply, and recreation. The reservoir fishery is stocked and managed by the Texas Parks and Wildlife Department. Water quality was monitored for 1 year during the ROPP impingement study (Ray Olinger Impingement Mortality Study, PBS&J, 2007). Temperature ranged from 7°C in February to 31°C in September 2007. Salinity remained below 0.5 parts per thousand during the study.


- 3. Scaled drawings showing the physical configuration of all source water bodies used by the facility, including the source waterbody's hydrological and geomorphological features. Note: The source waterbody's hydrological and geomorphological features may be included on the map submitted for item 1.b.ii of this worksheet.**

See Figure 4.

- 4. A description of the methods used to conduct any physical studies to determine your intake's area of influence within the waterbody and the results of such studies.**

There have been no studies that describe the zone of influence associated with cooling water withdrawal by the facility.



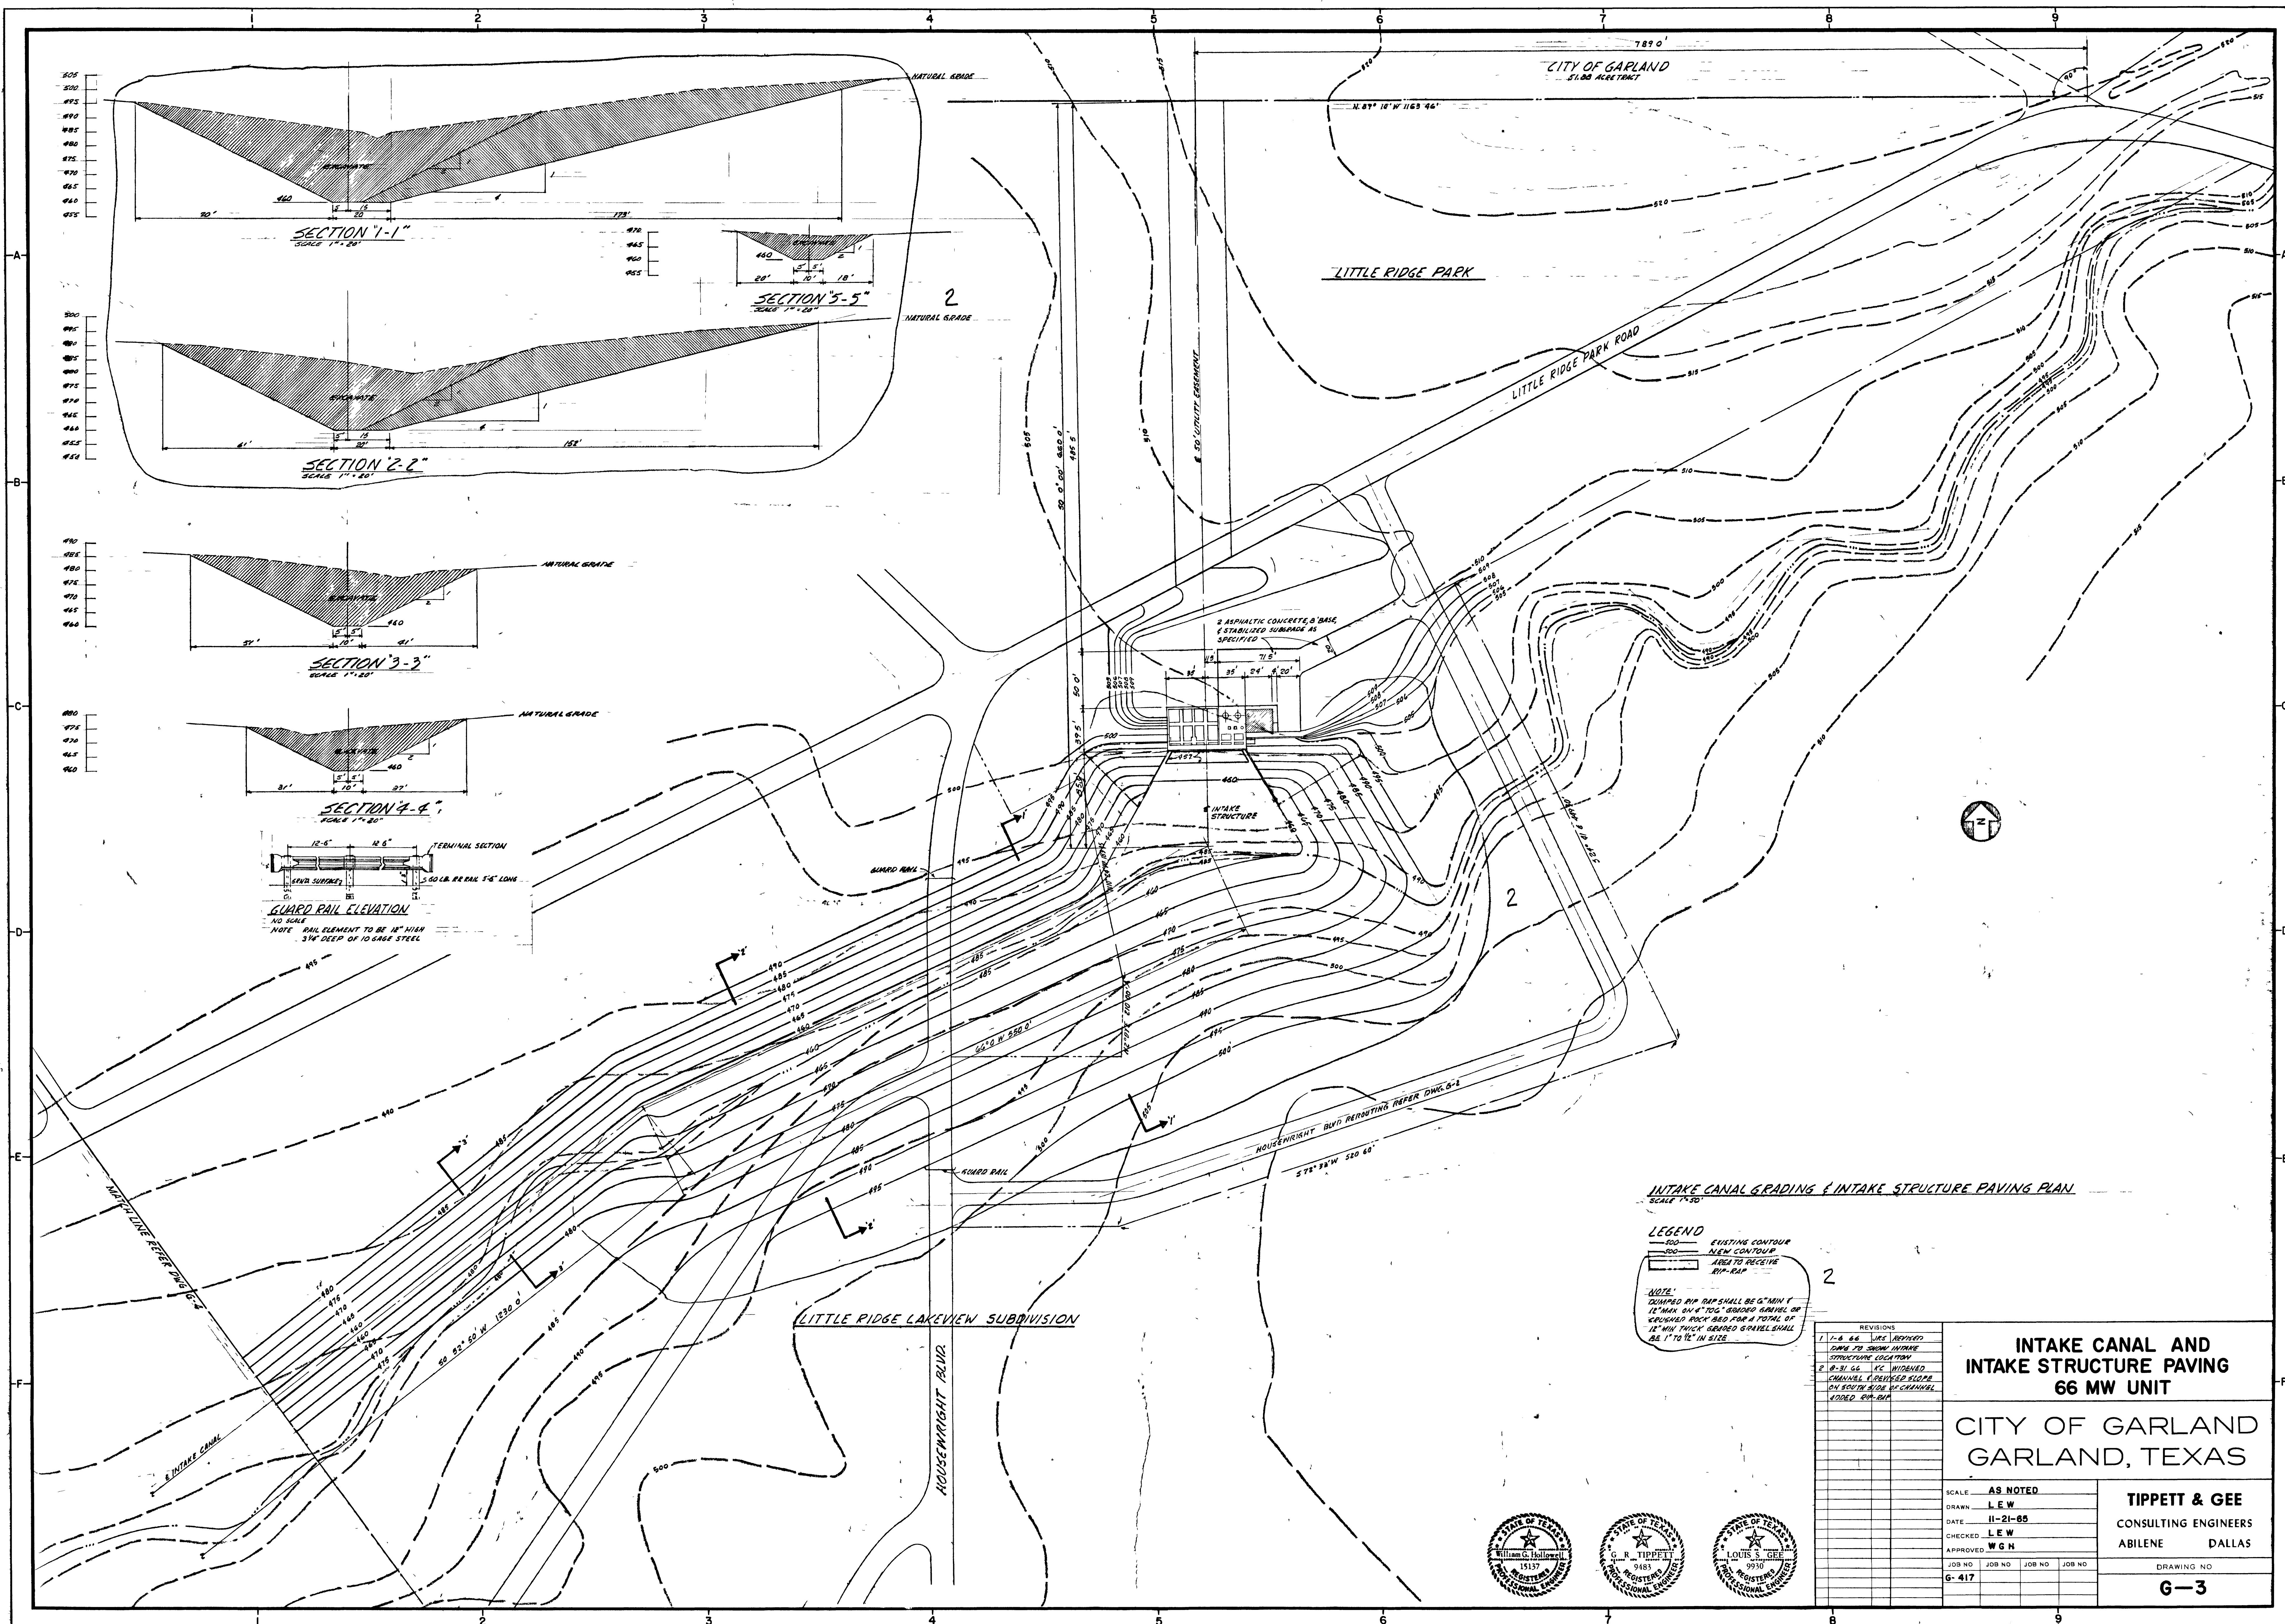

# **ATTACHMENT TR-8**

Operational Status



**Worksheet 11.0**  
**Cooling Water Intake Information**  
**Section 4.a. Operational Status**

1. Describe the operating status of each individual unit, including age of each unit, capacity utilization rate (or equivalent), for the previous five years (a minimum of 60 months), and any seasonal changes in operation.

ROPP Unit 1 was constructed in 1967, Unit 2 in 1971, and Unit 3 in 1975. Each unit remains in service, although operating intermittently and at a very low utilization capacity. Over the past 5 years (October 2018 – June 2024), the capacity utilization rate for the power plant was 2.3% (Table 5).

**Table 5. Ray Olinger Power Plant 5-Year Monthly Capacity Utilization Rate by Unit.**

DATE	UNIT 1	UNIT 2	UNIT 3	DATE	UNIT 1	UNIT 2	UNIT 3
Oct-18	0.0%	0.0%	0.0%	Jan-22	0.0%	1.4%	0.0%
Nov-18	0.0%	0.0%	2.1%	Feb-22	0.0%	3.7%	2.8%
Dec-18	0.0%	0.0%	0.0%	Mar-22	0.0%	2.2%	1.9%
Jan-19	0.0%	0.0%	0.0%	Apr-22	0.0%	0.3%	0.0%
Feb-19	0.0%	0.0%	0.0%	May-22	0.0%	1.7%	9.3%
Mar-19	0.2%	1.5%	0.0%	Jun-22	0.0%	7.6%	0.4%
Apr-19	0.0%	0.0%	0.0%	Jul-22	0.0%	10.9%	8.6%
May-19	0.0%	0.0%	0.0%	Aug-22	0.0%	6.3%	8.7%
Jun-19	0.5%	2.4%	5.3%	Sep-22	0.0%	3.0%	3.9%
Jul-19	1.4%	7.5%	12.2%	Oct-22	0.0%	1.4%	0.0%
Aug-19	7.7%	28.2%	36.9%	Nov-22	0.0%	0.0%	0.0%
Sep-19	2.9%	10.0%	28.4%	Dec-22	0.0%	0.0%	0.0%
Oct-19	0.7%	3.0%	5.9%	Jan-23	0.0%	0.2%	0.0%
Nov-19	0.0%	0.0%	0.7%	Feb-23	0.0%	0.3%	0.0%
Dec-19	0.0%	0.0%	1.8%	Mar-23	0.0%	3.0%	0.2%
Jan-20	0.0%	0.0%	0.0%	Apr-23	0.0%	2.6%	2.7%
Feb-20	0.0%	0.0%	0.0%	May-23	0.0%	3.8%	3.3%
Mar-20	0.0%	0.0%	0.0%	Jun-23	0.0%	7.9%	7.0%
Apr-20	0.0%	1.0%	0.7%	Jul-23	0.0%	6.5%	4.8%
May-20	0.0%	0.2%	0.7%	Aug-23	0.0%	15.3%	29.3%
Jun-20	0.0%	1.0%	0.4%	Sep-23	0.0%	5.2%	12.1%
Jul-20	0.2%	0.6%	2.1%	Oct-23	0.0%	0.0%	6.6%
Aug-20	0.9%	6.1%	7.9%	Nov-23	0.0%	0.0%	5.6%
Sep-20	0.0%	0.3%	0.3%	Dec-23	0.0%	0.4%	0.0%
Oct-20	0.0%	0.0%	0.0%	Jan-24	0.0%	2.1%	3.0%
Nov-20	0.0%	0.0%	0.0%	Feb-24	0.0%	0.0%	0.0%
Dec-20	0.0%	0.0%	0.0%	Mar-24	0.0%	0.5%	0.0%
Jan-21	0.0%	0.0%	0.0%	Apr-24	0.0%	2.4%	0.0%
Feb-21	0.0%	0.0%	22.4%	May-24	0.0%	2.3%	0.0%
Mar-21	0.0%	0.0%	0.0%	Jun-24	0.0%	2.4%	1.4%

Apr-21	0.0%	0.4%	0.0%	
May-21	0.0%	0.0%	0.0%	
Jun-21	0.0%	2.3%	4.1%	
Jul-21	0.0%	6.4%	6.9%	
Aug-21	0.0%	6.4%	7.7%	
Sep-21	0.0%	1.1%	3.1%	
Oct-21	0.0%	0.0%	15.5%	
Nov-21	0.0%	0.3%	3.1%	
Dec-21	0.0%	1.5%	0.0%	

In the most recent 24-month contiguous block (June 2022 – June 2024), none of the units operated in February 2024. The highest periods of utilization capacity were July 2022 and August 2023, at 10.9% and 15.3%, respectively. Over this period, Unit 1 ran the least at 0.0%, and Unit 2 ran the most at 3.4% average utilization capacity. In general, the units rarely operate in the spring and fall.

**2. Describe any extended or unusual outages that significantly affect current data for flow, impingement, entrainment, or other factors.**

There have been no significant facility modifications or extended outages in the past 15 years nor are there any major outages planned in the near future. However, the facility operates at a very low electric utilization capacity; therefore, impingement and entrainment impacts are minimized due to normal plant operations.

**3. Identify any operating unit with a capacity utilization rate of less than 8 percent averaged over a contiguous period of two years (a minimum of 24 months).**

Units 1, 2, and 3 each have capacity utilization rates of less than 8% over a recent, contiguous 24-month period, June 2022 – June 2024 (see Table 6). The average capacity utilization rate for Unit 1 was 0.8%, Unit 2 was 1.9%, and Unit 3 was 1.4%. The total facility average capacity utilization rate during this period was 1.4%.

**Table 6. Ray Olinger Power Plant Electric Capacity Utilization Rate from June 2022 – June 2024.**

Electric Capacity Utilization by Month			
Date	ROP 1 MW	ROP 2 MW	ROP3 MW
Jun-22	0.0%	7.6%	0.4%
Jul-22	0.0%	10.9%	8.6%
Aug-22	0.0%	6.3%	8.7%
Sep-22	0.0%	3.0%	3.9%
Oct-22	0.0%	1.4%	0.0%
Nov-22	0.0%	0.0%	0.0%
Dec-22	0.0%	0.0%	0.0%
Jan-23	0.0%	0.2%	0.0%
Feb-23	0.0%	0.3%	0.0%
Mar-23	0.0%	3.0%	0.2%
Apr-23	0.0%	2.6%	2.7%
May-23	0.0%	3.8%	3.3%

Jun-23	0.0%	7.9%	7.0%
Jul-23	0.0%	6.5%	4.8%
Aug-23	0.0%	15.3%	29.3%
Sep-23	0.0%	5.2%	12.1%
Oct-23	0.0%	0.0%	6.6%
Nov-23	0.0%	0.0%	5.6%
Dec-23	0.0%	0.4%	0.0%
Jan-24	0.0%	2.1%	3.0%
Feb-24	0.0%	0.0%	0.0%
Mar-24	0.0%	0.5%	0.0%
Apr-24	0.0%	2.4%	0.0%
May-24	0.0%	2.3%	0.0%
Jun-24	0.0%	2.4%	1.4%
<b>24-Month Average</b>	<b>0.0%</b>	<b>3.4%</b>	<b>3.9%</b>

**4. Describe any major upgrades completed within the last 15 years, including but not limited to boiler replacement, condenser replacement, turbine replacement, or changes to fuel type.**

There have been no significant facility modifications the past 15 years nor are there any major modifications planned in the near future.

## **ATTACHMENT TR-9**

### **TPWD Fisheries Management Report**

PERFORMANCE REPORT

As Required by

FEDERAL AID IN SPORT FISH RESTORATION ACT

TEXAS

FEDERAL AID PROJECT F-221-M-5

INLAND FISHERIES DIVISION MONITORING AND MANAGEMENT PROGRAM

2014 Fisheries Management Survey Report

**Lavon Reservoir**

Prepared by:

Bruce Hysmith, District Management Supervisor  
and  
John H. Moczygemba, Assistant District Management Supervisor

Inland Fisheries Division  
Denison District  
Pottsboro, Texas



Carter Smith  
Executive Director

Craig Bonds  
Director, Inland Fisheries

July 31, 2015

## TABLE OF CONTENTS

Survey and Management Summary .....	2
Introduction.....	3
Reservoir Description.....	3
Angler Access .....	2
Management History .....	3
Methods.....	4
Results and Discussion.....	4
Fisheries Management Plan .....	6
Literature Cited.....	7
Figures and Tables .....	8-21
Water Level (Figure 1) .....	8
Reservoir Characteristics (Table 1) .....	8
Boat Ramp Characteristics (Table 2).....	8
Harvest Regulations (Table 3) .....	9
Stocking History (Table 4).....	10
Structural Habitat Survey (Table 5).....	12
Aquatic Vegetation Survey (Table 6).....	
Gizzard Shad (Figure 2).....	13
Bluegill (Figure 3).....	14
Blue Catfish (Figure 4) .....	15
Channel Catfish (Figure 5).....	16
White Bass (Figure 6) .....	17
Largemouth Bass (Figure 7; Table 7) .....	19
White Crappie (Figure 8) .....	20
Black Crappie (Figure 9) .....	21
Proposed Sampling Schedule (Table 8) .....	21
Appendix A	
Catch Rates for All Target Species from All Gear Types.....	22
Appendix B	
Map of 2010-2011 Sampling Locations .....	23
Appendix C	
Historical Catch Statistics 1996-2014 .....	24

## SURVEY AND MANAGEMENT SUMMARY

Fish populations in Lavon Reservoir were surveyed in 2014 using electrofishing and trap netting and in 2015 using gill netting. Historical data are presented with the 2014-2015 data for comparison. This report summarizes the results of the surveys and contains a management plan for the reservoir based on those findings.

- **Reservoir description:** Lavon Reservoir is a 21,400-acre impoundment located on the East Fork Trinity River approximately 8 miles east of McKinney. Since July 2011 water level has fluctuated 13 feet above and below conservation elevation (492 feet above mean sea level). However, water level began dropping July 2012 and continued dropping until January 2015. Lavon Reservoir has moderate productivity. Habitat features consisted mainly of riprap along the dam and railroad bridges, dead trees and stumps, and rocky shoreline. Standing dead timber was an important habitat feature.
- **Management history:** Important sport fishes include White Bass, Largemouth Bass, White and Black Crappie, and Blue and Channel Catfish. The management plan from the 2011 survey report included requesting the TPWD Webmaster include a statement about the improving sport fishery, especially Blue and Channel Catfish, and Largemouth Bass. We cooperated with USACOE in posting signage warning lake visitors of the potential of zebra mussel infestation. Advised, educated, and provided signage and invasive species literature to marina owners. Utilizing media outlets and speaking engagements, we provided our constituents and user groups this same information. Monitored existing inter-basin water transfers. Monitored Portland samplers deployed in the reservoir for zebra mussel colonization.
- **Fish community**
  - **Prey species:** Threadfin Shad continued to be present, but showed a decline in abundance. While showing a large decline in numbers, the electrofishing catch of Gizzard Shad was still high and most (95%) were available as prey to most sportfishes. The electrofishing catch of prey-size Bluegill declined in numbers, but was still above the district average.
  - **Catfishes:** Gill net catch of Blue Catfish declined, but 100% of the population was legal size and in good condition. Recruitment was low, but they continue to out-number Channel Catfish in abundance. Gill net catch of Channel Catfish declined. No Flathead Catfish were collected.
  - **White Bass:** Gill net catch of White Bass increased and no Striped Bass were collected.
  - **Largemouth Bass:** The electrofishing catch of Largemouth Bass declined, but recruitment was good and relative weights were fair for legal-size fish. Over one-half of the Largemouth Bass sample population was legally harvestable.
  - **Crappies:** The trap netting catch of White Crappie increased, body condition and recruitment was good, and over one-half of the sample population was legal size and larger. The trap netting catch of Black Crappie was at an all-time high and the fish were in good condition. We predict a bright future for Black Crappie.
- **Management strategies:** Conduct general monitoring with electrofisher, trap nets, and gill nets in 2018-2019. Publicize improvements to sport fishes in the reservoir to anglers. Inform the Lavon Reservoir U.S. Army Corps of Engineers personnel about new exotic species threats to Texas waters, and work with them to display appropriate signage, educate constituents, and understand appropriate enforcement actions. Continue to monitor immigration of invasive species into Lavon Reservoir.

## INTRODUCTION

This document is a summary of fisheries data collected from Lavon Reservoir in 2014-2015. Sampling of fishes was done by electrofishing and trap netting in 2014 and in 2015 by gill netting. The purpose of the document is to provide fisheries information and make management recommendations to protect and improve the sport fishery. While information on other species of fishes was collected, this report deals primarily with major sport fishes and important prey species. Historical data are presented with the 2014-2015 data for comparison.

### *Reservoir Description*

Lavon Reservoir is a 21,400-acre impoundment constructed in 1953 on the East Fork Trinity River. It is located in Collin County approximately 8 miles east of McKinney and is operated and controlled by the U.S. Army Corps of Engineers (USACOE). The original dam impounded 11,080 acres of water. In 1974 the dam was raised 12 feet and increased the surface area of the reservoir to 21,400 acres. Primary project purposes are municipal and industrial water supply, flood control, and recreation. To augment municipal and industrial water, Lavon Reservoir receives inter-basin transfers from Cooper and Tawakoni Reservoirs and the East Fork Raw Water Supply Project near Seagoville, TX. The inter-basin transfer of Texoma Reservoir water via Sister Grove Creek has been converted to a direct pipeline transfer from Texoma Reservoir to the North Texas Municipal Water District water treatment facility at Wylie, TX. Lavon Reservoir also receives outfall from a regional sewage treatment facility. Lavon Reservoir was mesotrophic with a mean TSI chl-a of 39.30 (Texas Commission on Environmental Quality 2011). Habitat at time of sampling consisted of dead trees, rocks and boulders, riprap, but mostly rocky interspersed with bare soil shoreline. There were isolated patches of native submerged and emergent vegetation. Native aquatic plants present were pondweed, water willow, and buttonbush. Water level has been low and unstable since July 2011 (Figure 1). With the exception of July 2011, most of the reservoir was 8 to 12 feet below conservation throughout this study period. Other descriptive characteristics for Lavon Reservoir are in Table 1.

### *Angler Access*

Lavon Reservoir has 16 public boat ramps (Table 2). During the period July 2011 through spring 2015 access via these boat ramps was limited to the period January 2012 to July 2013. Early in this period access was denied because of low water and late in this period access was denied because of high water. Boat ramp characteristics appear in detail in Table 2. Bank fishing access has been compromised due to large expanses of exposed flats and shallow inshore water. Despite this there are still potential sites available at USACOE recreation areas and to a lesser extent from public roads. Shoreline access to Lavon Reservoir is unlimited unless posted because it is U.S. Army Corps of Engineers property; hence, public.

### *Management History*

**Previous management strategies and actions:** Management strategies and actions from the previous survey report (Hysmith and Moczygemba 2011) included:

1. Recommended incorporating improvements in the sport fishery on the TPWD web site.  
**Action:** Sport fish survey data were forwarded to the TPWD webmaster in Austin.
2. Recommended cooperating with reservoir controlling authority and marinas to inform and educate the public about invasive species.  
**Action:** Posted appropriate signage at reservoir access points, informed marina owners regarding invasive species, provided printed material, used media and internet, tracked any and all inter basin transfers, and monitored Portland samplers in the reservoir.

**Harvest regulation history:** Sportfishes in Lavon Reservoir are currently managed with statewide regulations (Table 3).

**Stocking history:** Lavon Reservoir was last stocked in 2007 and 2008 with Striped Bass at 13/acre. The complete stocking history is in Table 4.



**Vegetation/habitat history:** Historically, Lavon Reservoir (Hysmith and Moczygemba 1980) supported diverse aquatic vegetation, and consisted of narrow leaved cattail, black willow, smartweed, water willow, knotgrass, duckweed, and water primrose native pondweed, buttonbush, and water willow. There was no aquatic vegetation to sample in 2014, however, in 2010 aquatic vegetation consisted of pondweed, buttonbush, and water willow (Hysmith and Moczygemba 2011).

**Water Transfer:** Lavon Reservoir is primarily used for municipal water supply, recreation, and to a lesser extent, flood control. Water is pumped into Lavon Reservoir from Cooper Reservoir, Tawakoni Reservoir, and the East Fork Raw Water Supply Project Seagoville, TX. Until 2009, water was pumped from Texoma Reservoir to Sister Grove Creek, a tributary of Lavon Reservoir. Water is pumped out of Lavon Reservoir by North Texas Municipal Water District.

## METHODS

Fishes were collected by electrofishing (2 hours at 24 5-min stations), gill netting (15 net nights at 15 stations), and trap netting (15 net nights at 15 stations). Catch per unit effort (CPUE) for electrofishing was recorded as the number of fish caught per hour (fish/h) of actual electrofishing and, for gill and trap nets, as the number of fish caught per net night (fish/nn). Survey sites were randomly selected and all surveys were conducted according to the Fishery Assessment Procedures (TPWD, Inland Fisheries Division, unpublished manual revised 2014).

A structural habitat survey was conducted in 2014. Vegetation surveys were conducted in 2002, 2006, 2010, and 2014. Aquatic vegetation was not present in 2006 and 2014. Habitat was assessed using a modified digital shapefile method (TPWD, Inland Fisheries Division, unpublished manual revised 2014).

Sampling statistics (CPUE for various length categories) and structural indices [Proportional Size Distribution (PSD)] as defined by Guy et al. (2007) and condition indices [relative weight (Wr)] were calculated for target fishes according to Anderson and Neumann (1996). Index of vulnerability (IOV) was calculated for Gizzard Shad (DiCenzo et al. 1996). Relative standard error (RSE =  $100 \times \text{SE of the estimate/estimate}$ ) was calculated for all CPUE statistics and SE was calculated for structural indices and IOV. Ages for Channel Catfish, Largemouth Bass, and White and Black Crappie were determined using Category 2 protocol according to the Fishery Assessment Procedures (TPWD, Inland Fisheries Division, unpublished manual revised 2014). The manual specifies Largemouth Bass, but we adapted the protocol to include Channel Catfish and White and Black Crappie. Source for water level data was the United States Geological Survey (USGS 2015).

Genetic analysis of Largemouth Bass was conducted according to the Fishery Assessment Procedures (TPWD, Inland Fisheries Division, unpublished manual revised 2014). Micro-satellite DNA analysis was used to determine genetic composition of individual fish from 2005 through 2012 and by electrophoresis for previous years.

## RESULTS AND DISCUSSION

**Habitat:** Littoral zone habitat consisted primarily of rocky shoreline and dead timber with some native aquatic vegetation (Tables 5 and 6).

**Prey species:** Electrofishing CPUE of Gizzard Shad and Bluegill were 405.5/h and 88.5/h, respectively (Figures 2 and 3). Catches of both species were lower than for 2010. While not as good as 2011, the current IOV of 95 indicated an abundance of prey-size Gizzard Shad. Over half the sample population of Bluegill was  $\leq 4$  inches, ideal prey-size. Longear Sunfish were almost as abundant as Bluegill (Appendix A) and because of their small average size, provided excellent prey. The electrofishing CPUE for Threadfin Shad (14.0/h) was a record low (Appendix A).

**Catfishes:** The gill net CPUE of Blue Catfish was 2.5/nn in 2015, well below estimates of relative abundance in 2007 (Figure 4). The multiyear relative abundance has averaged 10.7/nn since 1996 (Appendix C). Relative weight ranged from 80 to 115, increasing with size; a trend repeated from 2011 (Figure 4). The trophy component ( $\geq 30$  inches) of the population remained strong, repeating results of 2011 (Figure 4). All of the Blue Catfish sample population was  $\geq 12$  inches.

The gill net CPUE of Channel Catfish was 3.5/nn in 2015, second highest on record (Figure 5 and Appendix C). Recruitment of sub-stock fish was good and body condition was fair with relative weights ranging from 80 to almost 90. Channel Catfish grew to 12 inches in 5 years ( $N = 11$ ; range = 5 to 6 years). Sixty-three percent of the sample population was  $\geq 12$  inches.

**White Bass:** The gill net CPUE of White Bass was 6.0/nn in 2015 (Figure 6), second highest CPUE for this reservoir (Appendix C). Relative weight of White Bass ranged from 95 to 105. Eighty-eight percent of the sample population was  $\geq 10$  inches.

**Largemouth Bass:** The electrofishing CPUE of Largemouth Bass was 35.0/h in 2015 (Figure 7), well below the all-time high CPUE in 2010 (Figure 7, Appendix C). There was excellent recruitment of sub-stock fish. A high average relative weight of 90 indicated a majority of the Largemouth Bass were in good condition, especially sub-stock fish which showed average relative weight ranging between 100 and 120 (Figure 7). Growth was excellent with fish reaching legal size in 2 years ( $N = 13$ ; range 2 to 3 years). Fifty-four percent of the sample population was  $\geq 14$  inches. Genetic analysis of Largemouth Bass collected by electrofishing indicated Florida Largemouth Bass allele's at 39.0% which is a decrease from 42.0% in 2006 (Table 7).

**Crappies:** The trap net CPUE of White Crappie was 34.8/nn in 2015 (Figure 8), more than double the reservoir average (Appendix C). There was excellent recruitment of sub-stock fish. A high average relative weight of 100 % indicated a majority of the White Crappie were in good condition. Twenty-eight percent of the sample population was  $\geq 10$  inches and they reached legal size in 1 year ( $N = 13$ ; range = 1 to 2 years).

Trap netting CPUE of Black Crappie was 3.4/nn (Figure 9). They were first collected in 2006 when one specimen was caught in a trap net during standard sampling (Hysmith and Moczygemba 2007). Thirteen individuals were collected during routine trap net sampling in 2010. There was excellent recruitment of sub-stock fish. High relative weight ( $>90$ ) indicated a majority of the Black Crappie were in good condition. Thirty-seven percent of the sample population was  $\geq 10$  inches and they reached legal size in 2 years ( $N=13$ ; range = 2 to 3 years).

## Fisheries management plan for Lavon Reservoir, Texas

Prepared – July 2015.

**ISSUE 1:** The sport fishery in Lavon Reservoir, especially blue and Channel Catfish, and Largemouth Bass has continued to improve.

### MANAGEMENT STRATEGY

1. Incorporate these improvements on the TPWD web site.

**ISSUE 2:** Many invasive species threaten aquatic habitats and organisms in Texas and can adversely affect the state ecologically, environmentally, and economically. For example, zebra mussels (*Dreissena polymorpha*) can multiply rapidly and attach themselves to any available hard structure, restricting water flow in pipes, fouling swimming beaches and plugging engine cooling systems. Giant Salvinia (*Salvinia molesta*) and other invasive vegetation species can form dense mats, interfering with recreational activities like fishing, boating, skiing and swimming. The financial costs of controlling and/or eradicating these types of invasive species are significant. Additionally, the potential for invasive species to spread to other river drainages and reservoirs via watercraft and other means is a serious threat to all public waters of the state. Zebra mussels have been found in Sister Grove Creek, a tributary to Lavon Reservoir and water conduit for water transfer from Texoma Reservoir, where zebra mussels have established. Portland samplers have been deployed in Lavon Reservoir and Sister Grove Creek.

### MANAGEMENT STRATEGIES

1. Cooperate with the controlling authority to post appropriate signage at access points around the reservoir.
2. Contact and educate marina owners about invasive species, and provide them with posters, literature, etc... so that they can in turn educate their customers.
3. Educate the public about invasive species through the use of media and the internet.
4. Make a speaking point about invasive species when presenting to constituent and user groups.
5. Keep track of (i.e., map) existing and future inter-basin water transfers to facilitate potential invasive species responses.
6. Monitor Portland samplers deployed in Lavon Reservoir.

### SAMPLING SCHEDULE JUSTIFICATION:

Conduct general monitoring surveys in 2018 – 2019 with a creel survey, electrofishing, trap netting, and gill netting. Access and habitat surveys will also be conducted.

## LITERATURE CITED

- Anderson, R.O. and R.M. Neumann. 1996. Length, weight, and associated structural indices. Pages 447-482 *in* B.R. Murphy and D.W. Willis, editors. Fisheries techniques, 2nd edition. American Fisheries Society, Bethesda, Maryland.
- DiCenzo, V.J., M.J. Maceina, and M.R. Stimpert. 1996. Relations between reservoir trophic state and Gizzard Shad population characteristics in Alabama reservoirs. *North American Journal of Fisheries Management* 16:888-895.
- Guy, C.S., R.M. Neumann, D.W. Willis, and R.O. Anderson. 2007. Proportional Size Distribution (PSD): a further refinement of population size structure index terminology. *Fisheries* 32(7):348
- Hysmith, B.T. and J.H. Moczygemba. 1980. Existing reservoir and stream management recommendations. Lake Lavon, 1979. Texas Parks and Wildlife Department, Federal Aid Report F-30-R-3, Austin.
- Hysmith, B.T. and J.H. Moczygemba. 2011. Statewide freshwater fisheries monitoring and management program survey report for Lake Lavon, 2010. Texas Parks and Wildlife Department, Federal Aid Report F-221-M-1, Austin.
- Texas Commission on Environmental Quality. 2011. Trophic Classification of Texas Reservoirs Quality 2010 Texas Water Inventory and 303(d) List. 18 pp.
- United States Geological Society (USGS). 2015. National water information system: Web interface. Available: <http://waterdata.usgs.gov/tx/nwis> (May 2015).

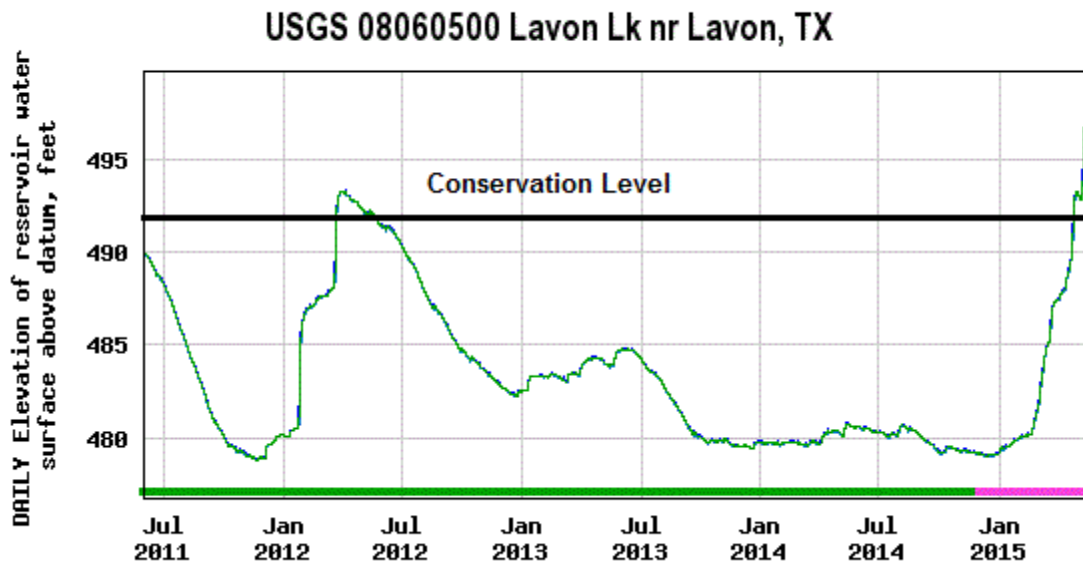


Figure 1. Monthly average water level elevations in feet above mean sea level (MSL) recorded for Lavon Reservoir (U.S. Geological Survey. 2015. USGS real time water data for USGS 08060500 Lavon Lake near Lavon, Texas. <http://waterdata.usgs.gov/nwis>), Texas, June 2011-May 2015.

Table 1. Characteristics of Lavon Reservoir, Texas.

Characteristic	Description
Year constructed	1953
Controlling authority	U.S. Army Corps of Engineers
Counties	Collin
Reservoir type	Mainstream
Shoreline development index	5.9
Conductivity	286 $\mu$ mhos/cm

Table 2. Boat ramp characteristics for Lavon Reservoir, Texas, August, 2014. Reservoir elevation at time of survey was 479.09 feet above mean sea level.

Boat ramp	Latitude Longitude (dd)	Public	Parking capacity (N)	Elevation at end of boat ramp (ft)	Condition
Twin Groves	33.16593 -96.44157	Y	40	490 <sub>a</sub>	Out of water. Extension is not feasible
Caddo Park	33.16247 -96.41896	Y	30	490 <sub>a</sub>	Out of water. Extension is not feasible
Elm Creek	33.14009 -96.42500	Y	30	485 <sub>a</sub>	Out of water. Extension is not feasible
Lakeland Park	33.10315 -96.44589	Y	60	478 <sub>a</sub>	Out of water. Extension is not feasible
Tickey Creek	33.09562 -96.47443	Y	60	478 <sub>a</sub>	Out of water. Extension is not feasible
Pebble Beach	33.08451 -96.45275	Y	45	481 <sub>a</sub>	Out of water. Extension is not feasible
Little Ridge	33.06624 -96.45500	Y	60	478	Fair. Extension is feasible.
Mallard Park	33.04860 -96.42698	Y	30	478	Fair. Extension is feasible.
Lavonia Park	33.04178 -96.44335	Y	60	478	Fair. Extension is feasible.
Clear Lake	33.05900 -96.48810	Y	45	478	Fair. Extension is feasible.
Bratonia Park	33.11063 -96.52019	Y	20	490 <sub>a</sub>	Out of water. Extension is not feasible
Highland Park	33.10782 -96.54063	Y	30	490 <sub>a</sub>	Out of water. Extension is not feasible
Brockdale Park	33.07344 -96.54531	Y	30	484 <sub>a</sub>	Out of water. Extension is not feasible
Collin Park	33.05104 -96.53057	Y	85	478	Fair. Extension is feasible.
East Fork Park	33.03705 -96.51466	Y	105	478	Fair. Extension is feasible.
Avalon Park	33.04276 -96.49807	Y	60	474	Excellent. No access issues.

<sub>a</sub> Elevations were determined using GPS and may be approximate due to GPS error. Varying lake levels and large amounts of siltation on ramps have prevented more accurate onsite measurements from being taken since original survey date.

Table 3. Harvest regulations for Lavon Reservoir, Texas.

Species	Bag limit	Length limit
Catfish: Channel and Blue Catfish, their hybrids and subspecies	25 (in any combination)	12-inch minimum
Catfish, Flathead	5	18-inch minimum
Bass, White	25	10-inch minimum
Bass, Striped	5	18-inch minimum
Bass, Largemouth	5	14-inch minimum
Crappie: White and Black Crappie, their hybrids and subspecies	25 (in any combination)	10-inch minimum

Table 4. Stocking history of Lavon Reservoir, Texas. Life stages are fry (FRY), fingerlings (FGL), advanced fingerlings (AFGL), adults (ADL) and unknown (UNK). Life stages for each species are defined as having a mean length that falls within the given length range. For each year and life stage the species mean total length (Mean TL; in) is given. For years where there were multiple stocking events for a particular species and life stage the mean TL is an average for all stocking events combined.

Species	Year	Number	Life Stage	Mean TL (in)
Blue catfish	1989	214,259	FGL	2.6
	1997	214,106	FGL	2.0
	1998	214,588	FGL	2.2
	Total	642,953		
Channel catfish	1954	20,000	AFGL	7.9
	1971	26,700	AFGL	7.9
	Total	46,700		
Florida Largemouth bass	1988	67,226	FGL	2.0
	1988	361,652	FRY	1.0
	1997	250,800	FGL	1.2
	2004	539,664	FGL	1.5
	2005	535,577	FGL	1.5
	Total	1,754,919		
Largemouth bass	1954	1,027,000	FRY	0.7
	1968	177,100	UNK	UNK
	Total	1,204,100		
Mixed Largemouth Bass	1988	98,860		1.0
	Total	98,860		
Palmetto Bass (Striped X White Bass hybrid)	1976	39,200	FGL	UNK
	Total	39,200		
Striped bass	1989	213,826	FGL	1.4
	1994	428,402	FGL	1.3
	2004	19,241	FGL	1.9
	2005	107,008	FGL	1.6
	2006	216,086	FGL	1.8
	2007	339,114	FGL	1.5
	2008	216,090	FGL	1.6
	Total	1,539,767		
Threadfin shad	1980	8,250	AFGL	2.9
	1984	2,000	AFGL	3.0
	Total	10,250		



Table 4 continued.

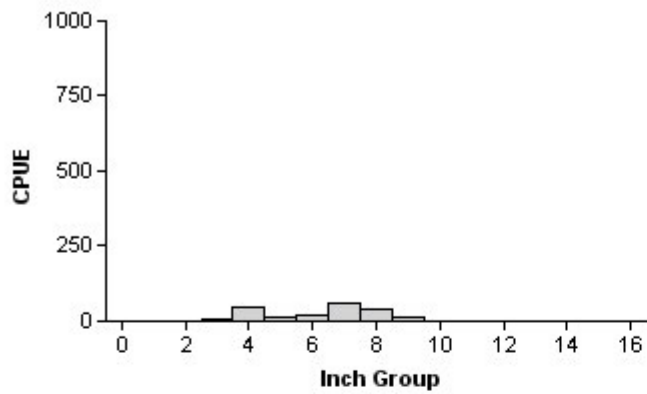
Species	Year	Number	Life Stage	Mean TL (in)
Walleye	1976	86,000	FRY	0.2
	Total	86,000		
White bass	1957	330	ADL	UNK
	Total	330		

Table 5. Survey of structural habitat types, Lavon Reservoir, Texas, 2014. Shoreline habitat type units are in miles and standing timber and piers, boat docks, and marinas in acres.

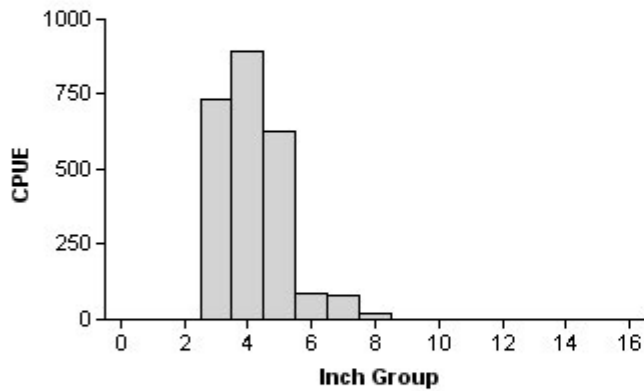
Habitat type	Estimate	% of total
Bulkhead	0.1 miles	0.1
Piers, boat docks, marinas	100 acres	0.5
Natural	41.2 miles	34.0
Rocky	79.7 miles	65.9
Standing timber	10,700 acres	50.0

Table 6. Survey of aquatic vegetation, Lavon Reservoir, Texas, 2002 – 2014. Surface area (acres) is listed with percent of total reservoir surface area in parentheses.


Vegetation	2002	2006	2010	2014
Native submersed		0.0	10 (<0.1)	0.0
Native emergent	44 (0.2)	0.0	44 (0.2)	0.0

**Gizzard Shad****2006**

Effort = 2.0  
 Total CPUE = 208.0 (17; 416)  
 IOV = 74 (5)

**2010**

Effort = 2.0  
 Total CPUE = 2,450.0 (100; 4900)  
 IOV = 99 (0.4)

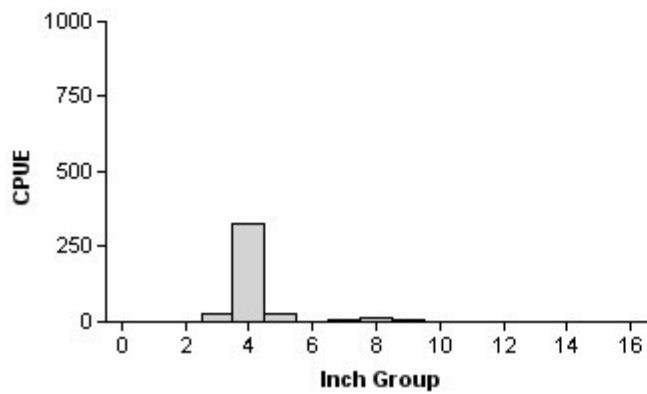**2014**

Effort = 2.0  
 Total CPUE = 405.5 (14; 811)  
 IOV = 95 (1.3)

Figure 2. Number of Gizzard Shad caught per hour (CPUE) and population indices (RSE and N for CPUE and SE for IOV are in parentheses) for fall electrofishing surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014.

## Bluegill



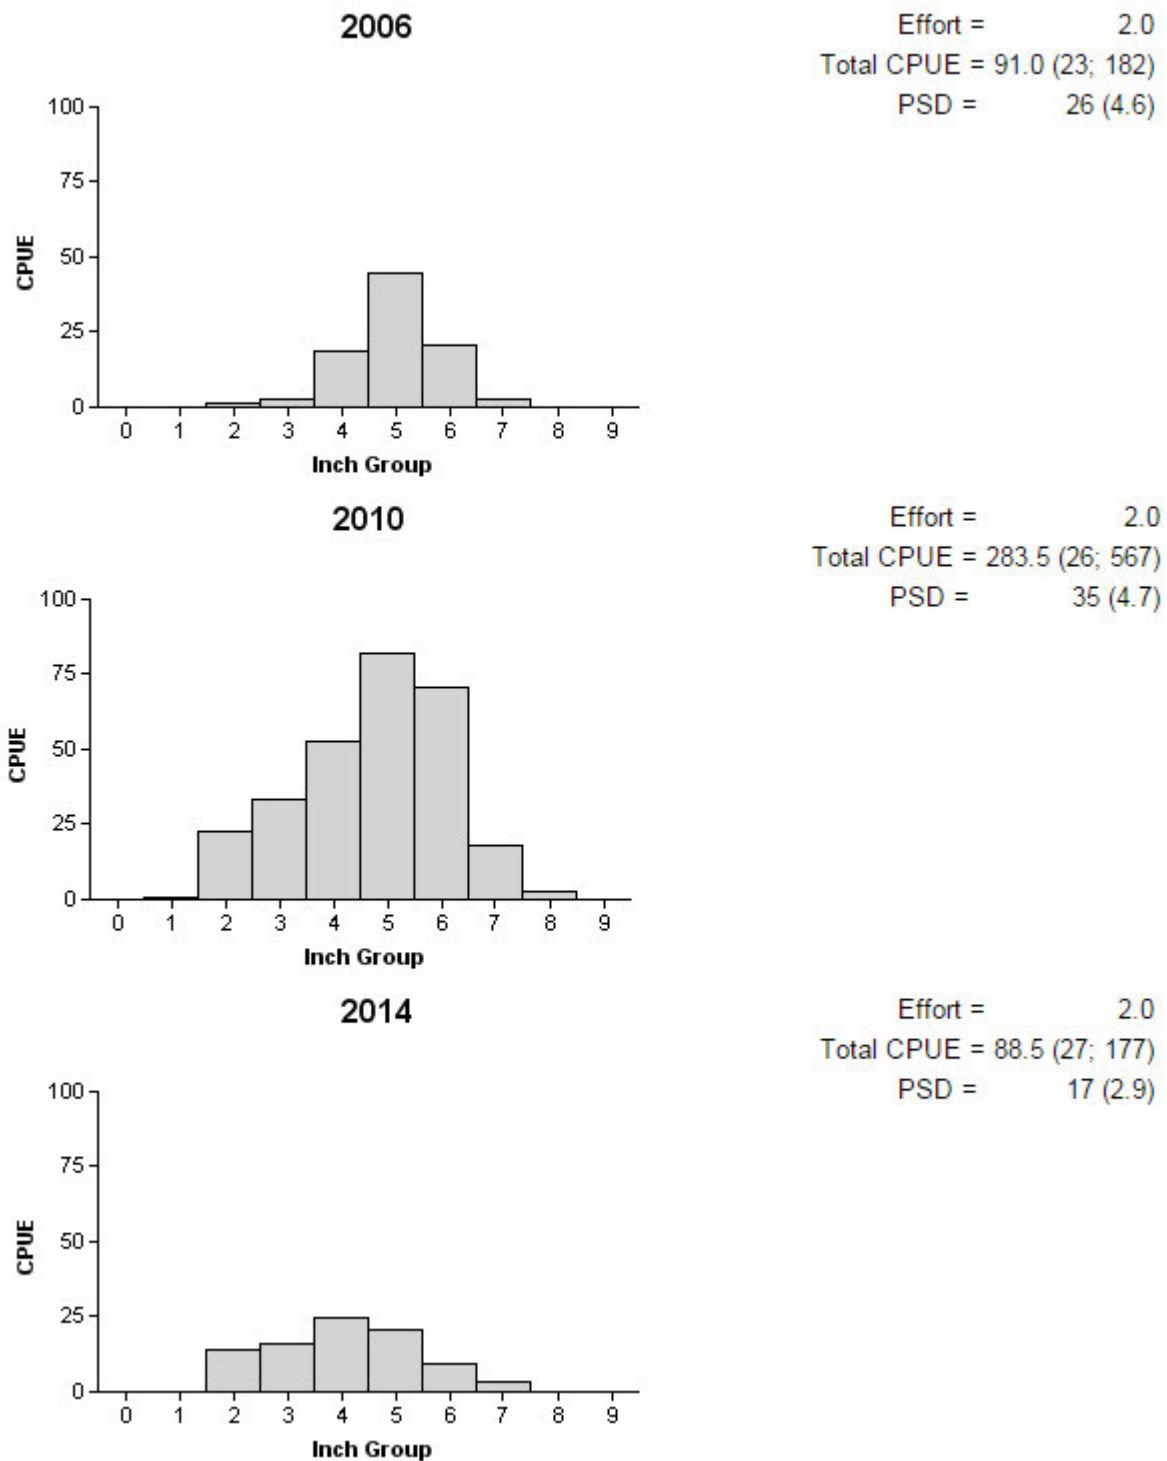


Figure 3. Number of Bluegill caught per hour (CPUE) and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for fall electrofishing surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014.


## Blue Catfish

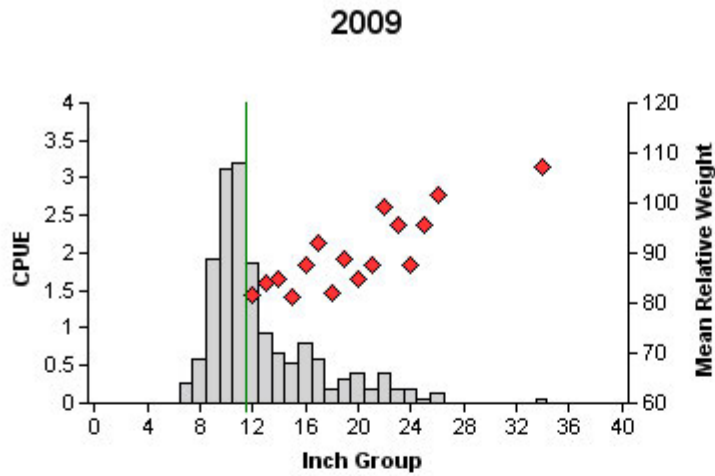

Effort = 15.0  
 Total CPUE = 16.7 (27; 251)  
 Stock CPUE = 7.6 (22; 114)  
 PSD = 22 (3.8)

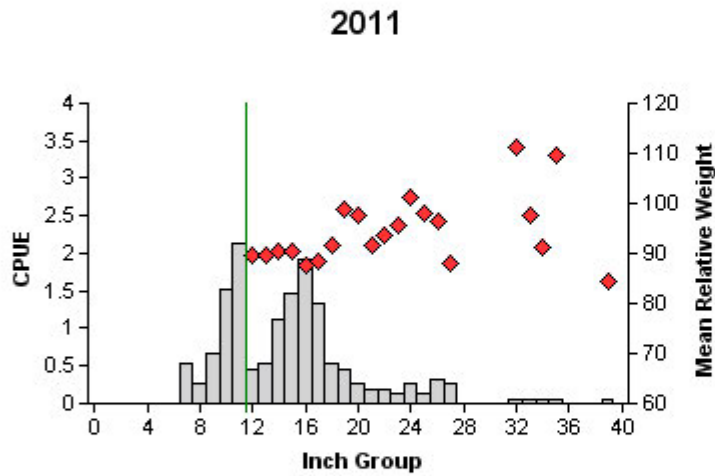

Effort = 15.0  
 Total CPUE = 15.1 (13; 227)  
 Stock CPUE = 10.0 (13; 150)  
 PSD = 21 (3.5)

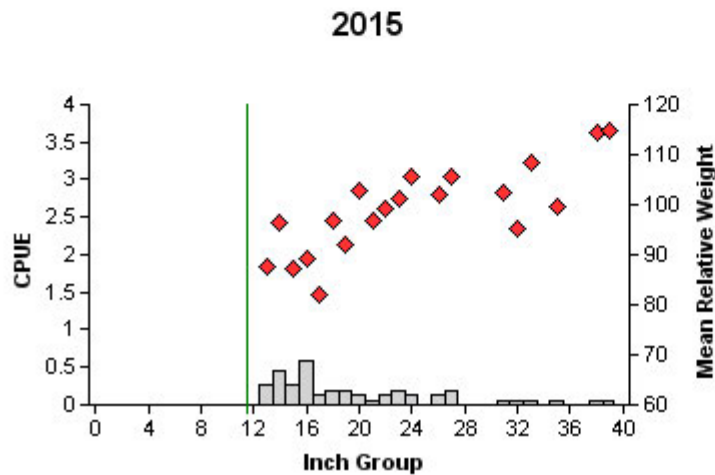

Effort = 15.0  
 Total CPUE = 3.5 (21; 53)  
 Stock CPUE = 3.5 (21; 53)  
 PSD = 40 (5.8)

Figure 4. Number of Blue Catfish caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for spring gill net surveys, Lavon Reservoir, Texas, 2009, 2011, and 2015. Vertical lines represent length limit at time of collection.

## Channel Catfish

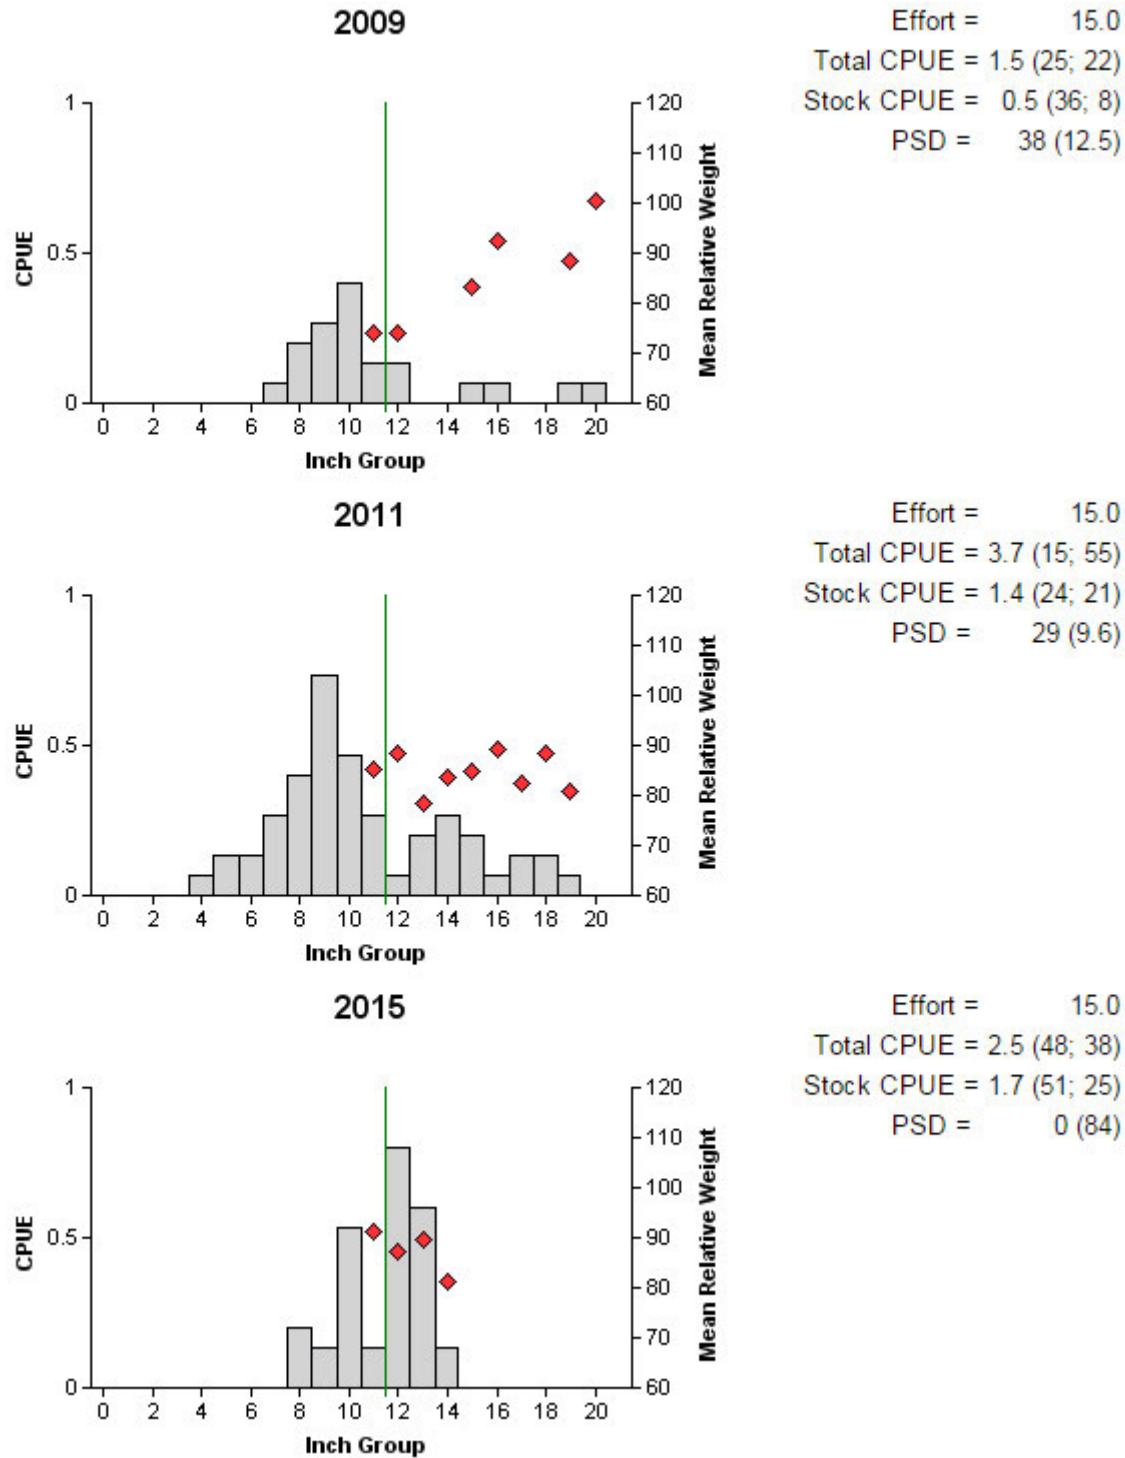


Figure 5. Number of Channel Catfish caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for spring gill net surveys, Lavon Reservoir, Texas, 2009, 2011, and 2015. Vertical lines represent length limit at time of collection.

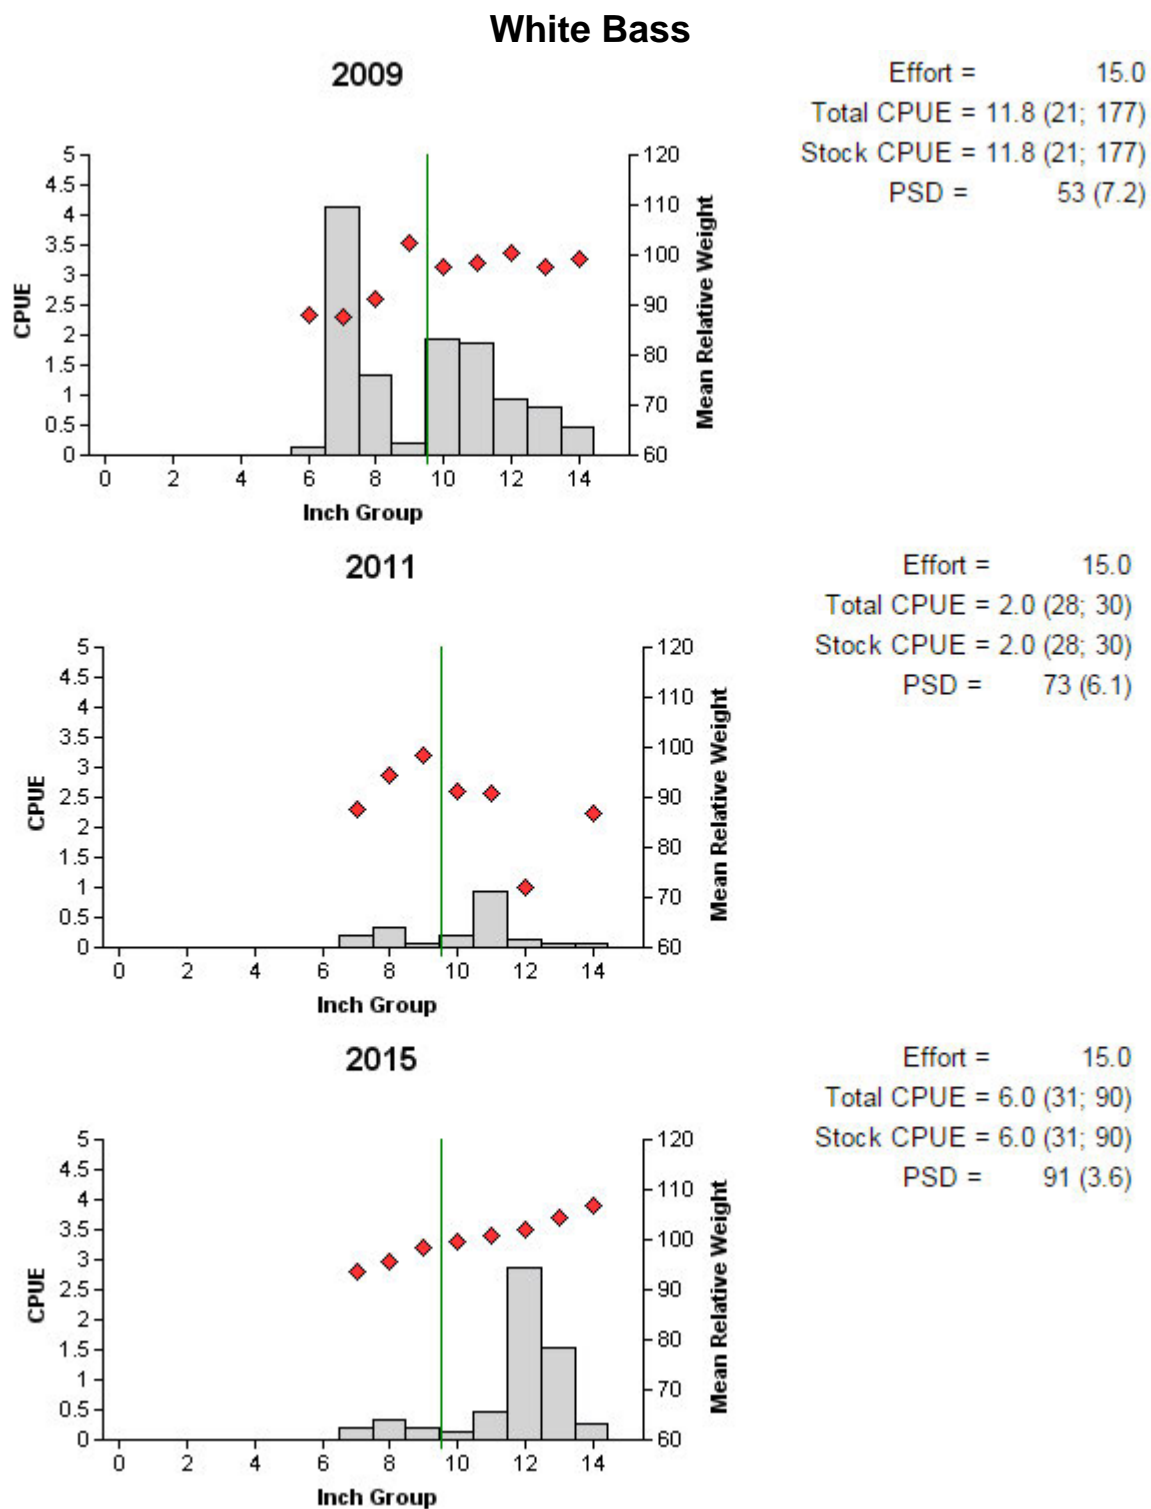


Figure 6. Number of White Bass caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for spring gill net surveys, Lavon Reservoir, Texas, 2009, 2011, and 2015. Vertical lines represent length limit at time of collection.

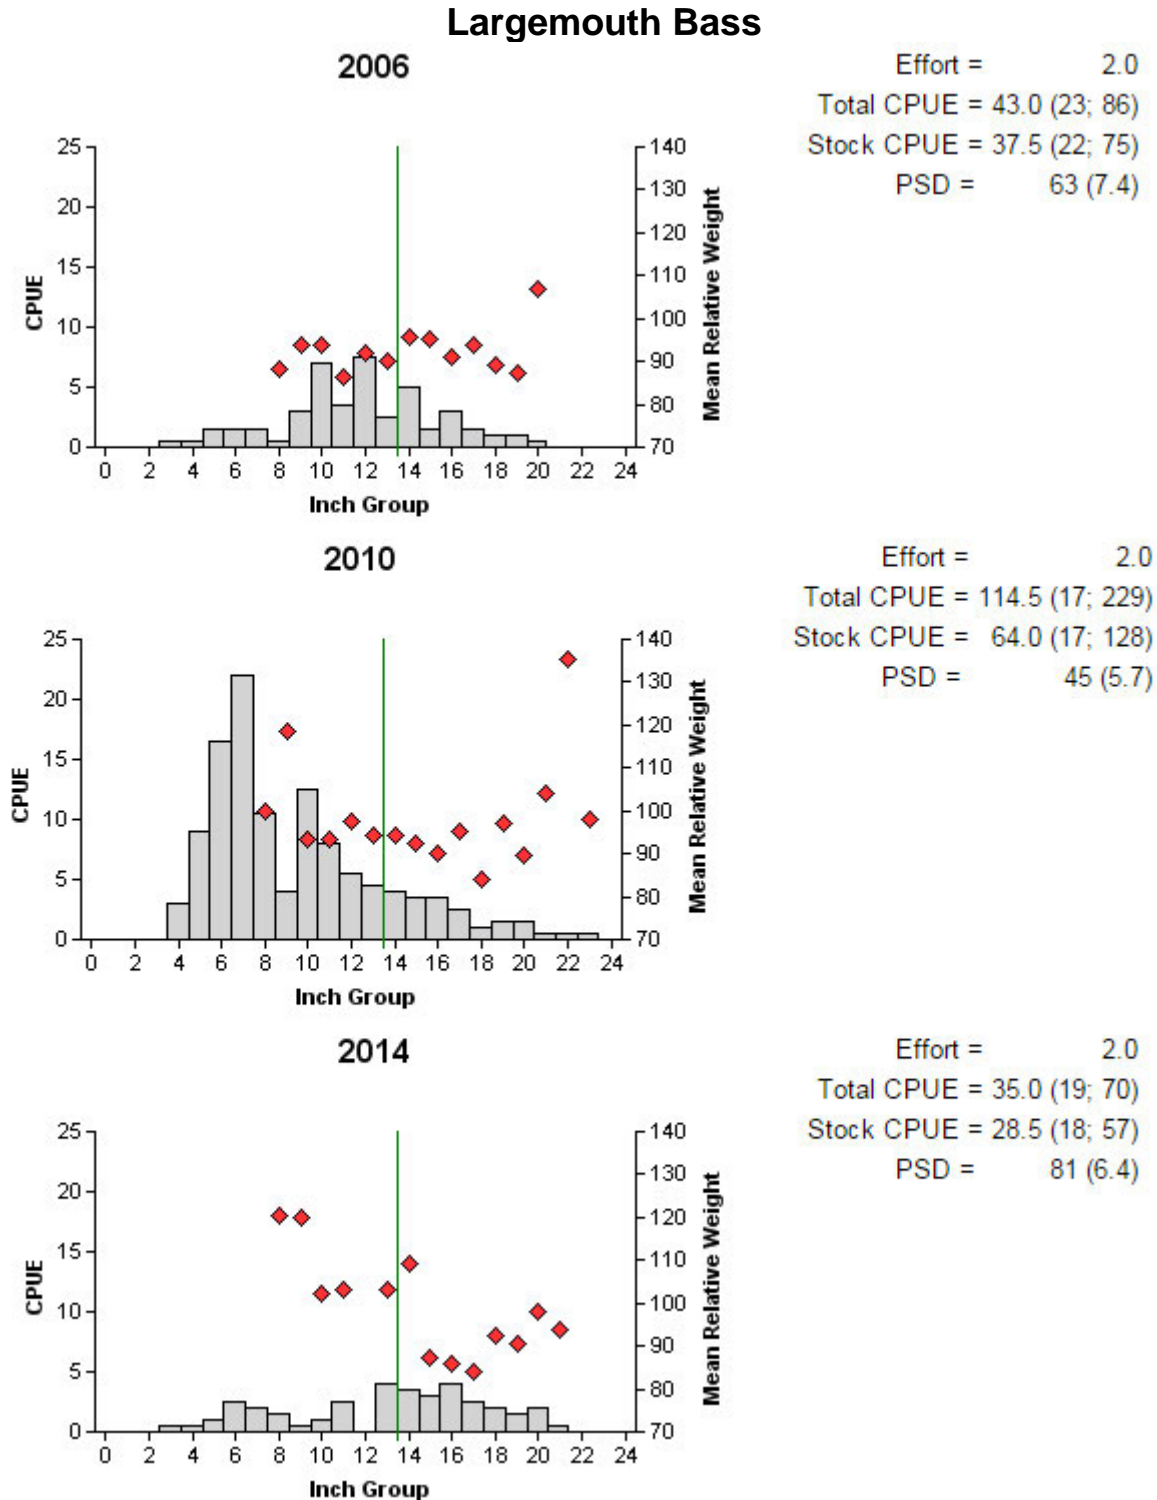


Figure 7. Number of Largemouth Bass caught per hour (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure) for fall electrofishing surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014. Vertical lines represent length limit at time of collection.



Table 7. Results of genetic analysis of Largemouth Bass collected by fall electrofishing, Lavon Reservoir, Texas, 1990, 1996, 1999, 2002, 2006, and 2014. FLMB = Florida Largemouth Bass, NLMB = Northern Largemouth Bass, Intergrade = hybrid between a FLMB and a NLMB. Genetic composition was determined by electrophoresis prior to 2005 and with micro-satellite DNA analysis since 2005.

Year	Sample size	Number of fish			% FLMB alleles	% FLMB
		FLMB	Intergrade	NLMB		
1990	36	1	6	29	6.9	2.8
1996	40	1	37	2	52.6	2.5
1999	33	1	17	15	23.5	3.0
2002	24	0	7	17	10.4	0.0
2006	30	1	24	5	42.0	3.3
2014	30	2	23	5	39.0	6.7

## White Crappie

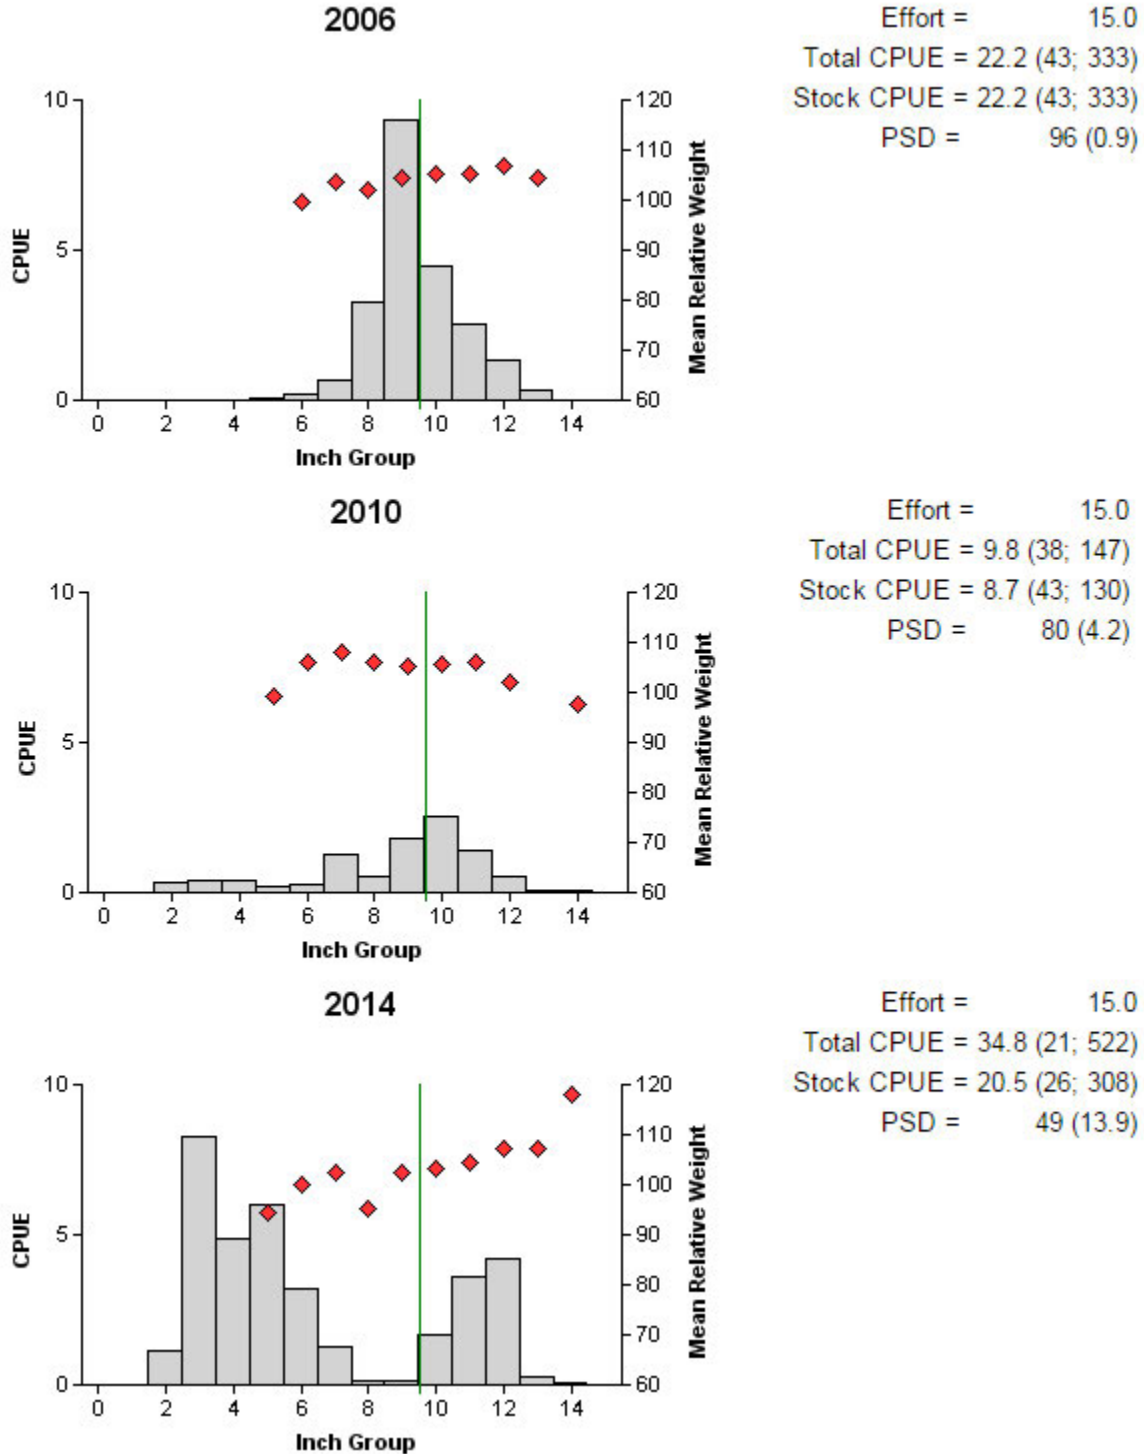


Figure 8. Number of White Crappie caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for fall trap netting surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014. Vertical lines represent length limit at time of collection.

## Black Crappie

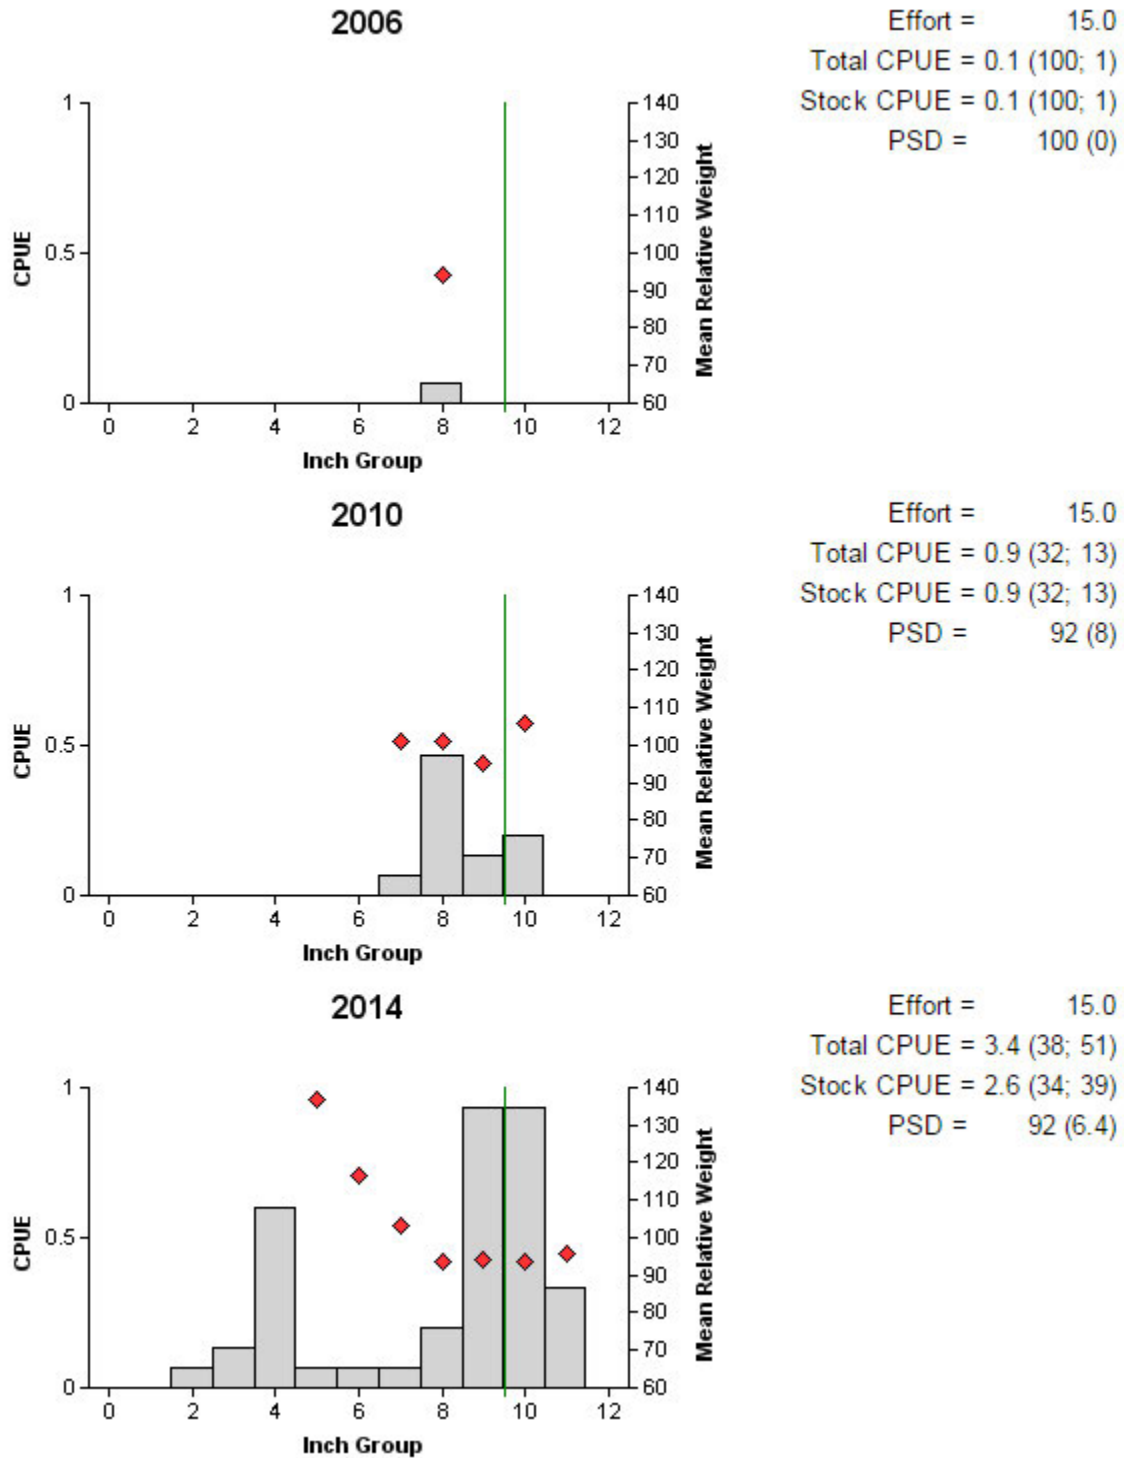


Figure 9. Number of Black Crappie caught per net night (CPUE, bars), mean relative weight (diamonds), and population indices (RSE and N for CPUE and SE for size structure are in parentheses) for fall trap netting surveys, Lavon Reservoir, Texas, 2006, 2010, and 2014. Vertical lines represent length limit at time of collection.

Table 8. Proposed sampling schedule for Lavon Reservoir, Texas. Survey period is June through May. Gill netting surveys are conducted in the spring, while electrofishing and trap netting surveys are conducted in the fall. Standard survey denoted by S.


Survey year	Electrofish Fall(Spring)	Trap net	Gill net	Habitat		Access	Creel survey	Report
				Structural	Vegetation			
2015-2016								
2016-2017								
2017-2018								
2018-2019	S	S	S		S	S	S	S

**APPENDIX A**

Number (N) and catch rate (CPUE) of all target species collected from all gear types from Lavon Reservoir, Texas, 2014-2015. Sampling effort was 15 net nights for gill netting, 15 net nights for trap netting, and 2 hours for electrofishing.

Species	Gill Netting		Trap Netting		Electrofishing	
	N	CPUE	N	CPUE	N	CPUE
Gizzard Shad					811	405.5
Threadfin Shad					28	14.0
Blue Catfish	53	3.5				
Channel Catfish	38	2.5				
White Bass	90	6.0				
Green Sunfish					8	4.0
Warmouth					9	4.5
Orangespotted Sunfish					32	16.0
Bluegill					177	88.5
Longear Sunfish					171	85.5
Largemouth Bass					70	35.0
White Crappie			522	34.8		
Black Crappie			51	3.4		

## APPENDIX B

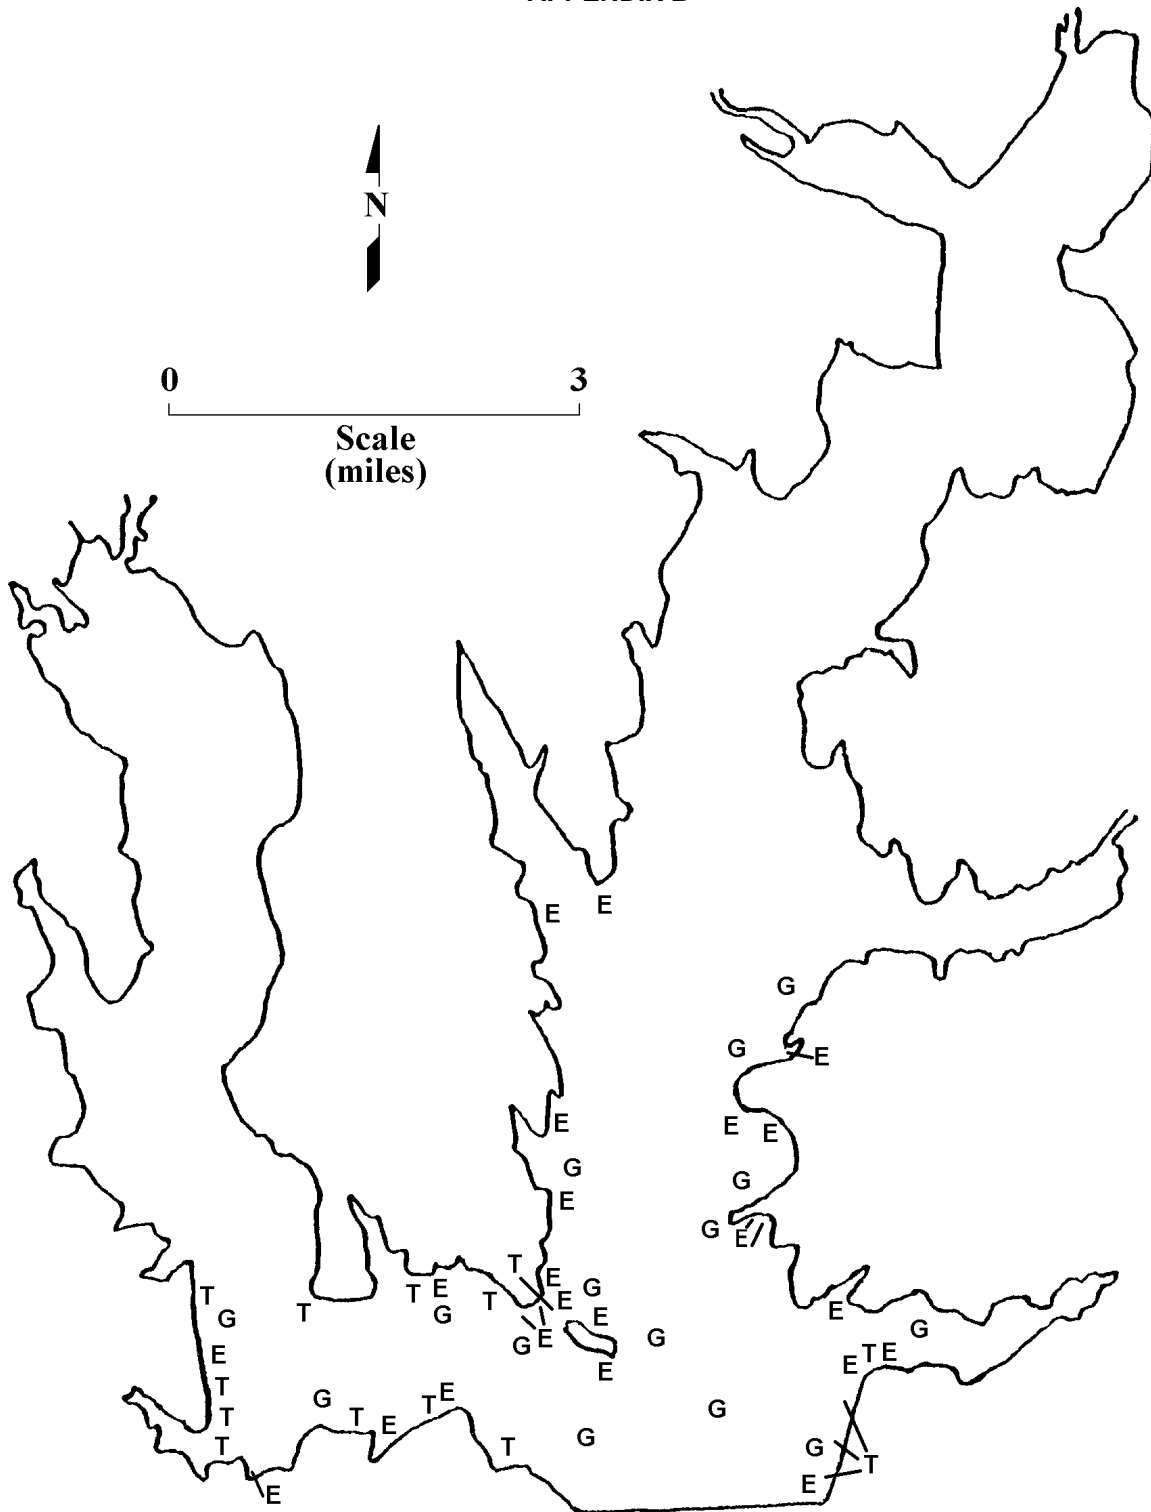

Location of sampling sites, Lavon Reservoir, Texas, 2014-2015. Electrofishing, trap netting, and gill netting stations are indicated by E, T, and G, respectively. Water level was 12.5 feet below conservation for electrofishing, 12.9 feet below during trap netting, and 7.1 feet below during gill netting.

### APPENDIX C

Historical catch rates of targeted species by gear type for Lavon Reservoir, Texas, 1996, 1999, 2002, 2006, 2009, 2010, and 2014.

Gear	Species	Year							Avg.
		1996 <sup>a</sup>	1999	2002 <sup>b</sup>	2006 <sup>b</sup>	2009	2010 <sup>b</sup>	2014 <sup>b</sup>	
Gill Netting (fish/net night)	Blue catfish	1.1	8.3	14.8	16.7	15.5	15.1	3.5	<b>10.7</b>
	Channel catfish	1.9	2.5	0.9	1.5	1.3	3.7	2.5	<b>2.0</b>
	Flathead catfish	0.0	0.0	0.0	0.1	0.0	0.1		<b>0.0</b>
	White bass	3.8	3.8	2.5	0.1	11.8	2.0	6.0	<b>4.3</b>
	Striped bass	1.3	1.5	0.1	0.1	0.1	0.2		<b>0.5</b>
Electrofishing (fish/hour)	Gizzard shad	202.5	215.5	209.5	208.0		2450.0	405.5	<b>527.3</b>
	Threadfin shad	120.5	330.0	58.5	832.0		170.5	14.0	<b>217.9</b>
	Green sunfish	1.5	4.0	0.0	0.0		6.5	4.0	<b>2.3</b>
	Warmouth	0.5	3.0	2.5	8.0		14.5	4.5	<b>4.7</b>
	Orangespotted sunfish	0.0	0.0	2.5	0.0		1.0	16.0	<b>2.3</b>
	Bluegill	33.0	40.5	79.0	91.0		283.5	88.5	<b>87.9</b>
	Longear sunfish	4.0	88.0	66.5	65.5		244.5	85.5	<b>79.1</b>
	Redear sunfish	0.0	0.0	0.0	1.0		3.0	0.0	<b>0.6</b>
	Largemouth bass	9.0	66.0	18.5	43.0		114.5	35.0	<b>40.9</b>
Trap Netting (fish/net night)	White Crappie	3.5	17.8	17.5	22.2		9.8	34.8	<b>15.1</b>
	Black Crappie	0.0	0.0	0.0	0.1		0.9	3.4	<b>0.6</b>

<sup>a</sup> Trap netting was conducted in January 1997.

<sup>b</sup> Gill netting was conducted in the spring of the following year.

# **ATTACHMENT TR-10**

## Existing Entrainment Performance Studies



No studies have been conducted at the Ray Olinger Power Plant or Lake Lavon documenting technology efficacy or through-facility entrainment survival. A literature review was conducted, and no studies were found that are comparable to the Ray Olinger Power Plant or Lake Lavon.