



# Technical Package Cover Page

**This file contains the following documents:**

1. Summary of application (in plain language)
2. First notice (NORI-Notice of Receipt of Application and Intent to Obtain a Permit)
3. Second notice (NAPD-Notice of Preliminary Decision)
4. Application materials
5. Draft permit
6. Technical summary or fact sheet

*The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.*

San Antonio Water System (CN600529069) operates an Ultra Filtration Water Treatment Plant (RN103114724), a potable water treatment facility. The facility is located at 6725 Moreno Street, near the city of San Antonio, Bexar County, Texas 78073.

The water treatment facility is currently not producing wastewater. However, this application is for a renewal to discharge process wastewater on an intermittent and flow-variable basis via Outfall 001. Discharges from the facility are required to contain no more than 45 parts per million of Total Suspended Solids (TSS) and are required to have a potential of hydrogen (pH) between 6.0 and 9.0, measured as standard units.

Raw water is supplied by Medina Lake where it is withdrawn from an intake structure at the Medina River and is fed through a clarification system to remove turbidity, which are particles that cause cloudiness in water. The water is then fed through pre-filtration and ultra-filtration membranes to remove dissolved solids and the finished water is distributed for potable drinking water use while the solids are stored in lagoons.

Process wastewater discharges only occur when the incoming source water is excessive in turbidity. The ultra-filtration membranes system is shut off automatically and the flow is diverted to an equalization chamber and then discharged through Outfall 001, discharging to an unnamed ditch and then into Medio Creek, Segment ID 1912.

# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



## NOTICE OF RECEIPT OF APPLICATION AND INTENT TO OBTAIN WATER QUALITY PERMIT RENEWAL

PERMIT NO. WQ0004437000

**APPLICATION.** San Antonio Water System, 2800 U.S. Highway 281 North, San Antonio, Texas 78212, which owns a potable water treatment system facility, has applied to the Texas Commission on Environmental Quality (TCEQ) to renew Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0004437000 (EPA I.D. No. TX0125083) to authorize the discharge of clarifier water at an intermittent and variable flow rate. The water treatment facility is located at 6725 Moreno Street, near the city of Von Ormy, in Bexar County, Texas 78073. The discharge route is from the plant site to an unnamed ditch; thence to O. R. Mitchell Lake 1; thence to Medio Creek. TCEQ received this application on September 30, 2024. The permit application will be available for viewing and copying at San Antonio Water System Admin Building, tower 1, first floor, 2800 U.S. Highway 281 North, San Antonio, in Bexar County, Texas prior to the date this notice is published in the newspaper. The application, including any updates, and associated notices are available electronically at the following webpage: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For the exact location, refer to the application.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-98.635555,29.320277&level=18>

**ADDITIONAL NOTICE.** TCEQ's Executive Director has determined the application is administratively complete and will conduct a technical review of the application. After technical review of the application is complete, the Executive Director may prepare a draft permit and will issue a preliminary decision on the application. **Notice of the Application and Preliminary Decision will be published and mailed to those who are on the county-wide mailing list and to those who are on the mailing list for this application. That notice will contain the deadline for submitting public comments.**

**PUBLIC COMMENT / PUBLIC MEETING.** You may submit public comments or request a public meeting on this application. The purpose of a public meeting is to provide the opportunity to submit comments or to ask questions about the application. TCEQ will hold a public meeting if the Executive Director determines that there is a significant degree of public interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

**OPPORTUNITY FOR A CONTESTED CASE HEARING.** After the deadline for submitting public comments, the Executive Director will consider all timely comments and prepare a response to all relevant and material, or significant public comments. **Unless the application**

is directly referred for a contested case hearing, the response to comments, and the Executive Director's decision on the application, will be mailed to everyone who submitted public comments and to those persons who are on the mailing list for this application. If comments are received, the mailing will also provide instructions for requesting reconsideration of the Executive Director's decision and for requesting a contested case hearing. A contested case hearing is a legal proceeding similar to a civil trial in state district court.

**TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST:** your name, address, phone number; applicant's name and proposed permit number; the location and distance of your property/activities relative to the proposed facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; a list of all disputed issues of fact that you submit during the comment period and, the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify by name and physical address an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are relevant to the group's purpose.

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

The Commission may only grant a request for a contested case hearing on issues the requestor submitted in their timely comments that were not subsequently withdrawn. **If a hearing is granted, the subject of a hearing will be limited to disputed issues of fact or mixed questions of fact and law relating to relevant and material water quality concerns submitted during the comment period.**

**TCEQ may act on an application to renew a permit for discharge of wastewater without providing an opportunity for a contested case hearing if certain criteria are met.**

**MAILING LIST.** If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be placed on: (1) the permanent mailing list for a specific applicant name and permit number; and/or (2) the mailing list for a specific county. If you wish to be placed on the permanent and/or the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

**INFORMATION AVAILABLE ONLINE.** For details about the status of the application, visit the Commissioners' Integrated Database at [www.tceq.texas.gov/goto/cid](http://www.tceq.texas.gov/goto/cid). Search the database using the permit number for this application, which is provided at the top of this notice.


**AGENCY CONTACTS AND INFORMATION.** All public comments and requests must be submitted either electronically at <https://www14.tceq.texas.gov/epic/eComment/>, or in writing to the Texas Commission on Environmental Quality, Office of the Chief Clerk, MC-105,

P.O. Box 13087, Austin, Texas 78711-3087. Please be aware that any contact information you provide, including your name, phone number, email address and physical address will become part of the agency's public record. For more information about this permit application or the permitting process, please call the TCEQ Public Education Program, Toll Free, at 1-800-687-4040 or visit their website at [www.tceq.texas.gov/goto/pep](http://www.tceq.texas.gov/goto/pep). Si desea información en Español, puede llamar al 1-800-687-4040.

Further information may also be obtained from San Antonio Water System at the address stated above or by calling Ms. Olga Galindo, Executive Admin Assistant, at 210-233-4570.

Issuance Date: October 25, 2024

# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



## NOTICE OF APPLICATION AND PRELIMINARY DECISION FOR TPDES PERMIT FOR INDUSTRIAL WASTEWATER

### RENEWAL

Permit No. WQ0004437000

**APPLICATION AND PRELIMINARY DECISION.** San Antonio Water System, 2800 U. S. Highway 281 North, San Antonio, Texas 78212, which operates the Ultrafiltration Water Treatment Plant, has applied to the Texas Commission on Environmental Quality (TCEQ) for a renewal of Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0004437000, which authorizes the discharge of clarifier water on an intermittent and flow-variable basis via Outfall 001. TCEQ received this application on September 30, 2024.

The facility is located at 6725 Moreno Street, in the City of Von Ormy, Bexar County, Texas 78073. This link to an electronic map of the site or facility's general location is provided as a public courtesy and is not part of the application or notice. For the exact location, refer to the application. <https://gisweb.tceq.texas.gov/LocationMapper/?marker=-98.62936328259191,29.32160560842485&level=18>

The effluent is discharged to an unnamed ditch, thence to O.R. Mitchell Lake 1, thence to Medio Creek in Segment No. 1912 of the San Antonio River. The unclassified receiving water uses are minimal aquatic life for the unnamed ditch and high aquatic life for Mitchell Lake 1. The designated uses for Segment No. 1912 are primary contact recreation and intermediate aquatic life use.

The TCEQ Executive Director has completed the technical review of the application and prepared a draft permit. The draft permit, if approved, would establish the conditions under which the facility must operate. The Executive Director has made a preliminary decision that this permit, if issued, meets all statutory and regulatory requirements. The permit application, Executive Director's preliminary decision, and draft permit are available for viewing and copying at San Antonio Water System Admin Building, tower 1, first floor, 2800 U.S. Highway 281 North, San Antonio, in Bexar County, Texas. The application and associated notices are available electronically at the following webpage:

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>

**PUBLIC COMMENT / PUBLIC MEETING.** You may submit public comments or request a public meeting about this application. The purpose of a public meeting is to provide the opportunity to submit written or oral comment or to ask questions about the application. Generally, the TCEQ will hold a public meeting if the Executive Director determines that there is a significant degree of public interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

**OPPORTUNITY FOR A CONTESTED CASE HEARING.** After the deadline for public comments, the Executive Director will consider the comments and prepare a response to all relevant and material, or significant public comments. **The response to comments, along with the Executive Director's decision on the application, will be mailed to everyone who submitted public comments or who requested to be on a mailing list for this application. If comments are received, the mailing will also provide instructions for requesting a contested case hearing or reconsideration of the Executive Director's decision.** A contested case hearing is a legal proceeding similar to a civil trial in a state district court.

**TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST: your name, address, phone number; applicant's name and proposed permit number; the location and distance of your property/activities relative to the proposed facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; a list of all disputed issues of fact that you submit during the comment period; and the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify by name and physical address an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are relevant to the group's purpose.**

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting. The Commission may only grant a request for a contested case hearing on issues the requestor submitted in their timely comments that were not subsequently withdrawn. **If a hearing is granted, the subject of a hearing will be limited to disputed issues of fact or mixed questions of fact and law relating to relevant and material water quality concerns submitted during the comment period. TCEQ may act on an application to renew a permit for discharge of wastewater without providing an opportunity for a contested case hearing if certain criteria are met.**

**EXECUTIVE DIRECTOR ACTION.** The Executive Director may issue final approval of the application unless a timely contested case hearing request or a timely request for reconsideration is filed. If a timely hearing request or request for reconsideration is filed, the Executive Director will not issue final approval of the permit and will forward the application and requests to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

**MAILING LIST.** If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be added to: (1) the permanent list for a specific applicant name and permit number; and (2) the mailing list for a specific county. If you wish to be placed on the permanent and the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

**All written public comments and public meeting requests must be submitted to the Office of the Chief Clerk, MC 105, TCEQ, P.O. Box 13087, Austin, TX 78711-3087 or electronically at <https://www.tceq.texas.gov/goto/comment> within 30 days from the date of newspaper publication of this notice.**

**INFORMATION AVAILABLE ONLINE.** For details about the status of the application, visit the Commissioners' Integrated Database at <https://www.tceq.texas.gov/goto/cid/>. Search the database using the permit number for this application, which is provided at the top of this notice.

**AGENCY CONTACTS AND INFORMATION.** Public comments and requests must be submitted either electronically at <https://www.tceq.texas.gov/goto/comment>, or in writing to the Texas Commission on Environmental Quality, Office of the Chief Clerk, MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Please be aware that any contact information you provide, including your name, phone number, email address, and physical address will become part of the agency's public record. For more information about this permit application or the permitting process, please call the TCEQ Public Education Program, toll free, at 1-800-687-4040 or visit their website at <https://www.tceq.texas.gov/agency/decisions/participation/permitting-participation>. Si desea información en Español, puede llamar al 1-800-687-4040.

Further information may also be obtained from San Antonio Water System at the address stated above or by calling Ms. Floramie Welch, Environmental Analyst III, at 210-233-3747.

Issued: November 24, 2025

Jon Niermann, *Chairman*  
Bobby Janecka, *Commissioner*  
Catarina R. Gonzales, *Commissioner*  
Kelly Keel, *Executive Director*



## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

*Protecting Texas by Reducing and Preventing Pollution*

September 30, 2024

Re: Confirmation of Submission of the Renewal without changes for Reverse Osmosis Water Treatment Authorization.

Dear Applicant:

This is an acknowledgement that you have successfully completed Renewal without changes for the Reverse Osmosis Water Treatment authorization.

ER Account Number: ER046829  
Application Reference Number: 656086  
Authorization Number: WQ0004437000  
Site Name: Ultrafiltration Wtp  
Regulated Entity: RN103114724 - Ultrafiltration Wtp  
Customer(s): CN600529069 - San Antonio Water System

Please be aware that TCEQ staff may contact your designated contact for any additional information.

If you have any questions, you may contact the Applications Review and Processing Team by email at [WQ-ARPTeam@tceq.texas.gov](mailto:WQ-ARPTeam@tceq.texas.gov) or by telephone at (512) 239-4671.

Sincerely,  
Applications Review and Processing Team  
Water Quality Division

**Texas Commission on Environmental Quality**  
 Update Domestic or Industrial Individual Permit  
 WQ0004437000

### Site Information (Regulated Entity)

What is the name of the site to be authorized?	ULTRAFILTRATION WTP
Does the site have a physical address?	Yes
<b>Physical Address</b>	
Number and Street	6725 MORENO ST
City	VON ORMY
State	TX
ZIP	78073
County	BEXAR
Latitude (N) (##.#####)	29.320277
Longitude (W) (-###.#####)	-98.635555
Primary SIC Code	4941
Secondary SIC Code	
Primary NAICS Code	221310
Secondary NAICS Code	
<b>Regulated Entity Site Information</b>	
What is the Regulated Entity's Number (RN)?	RN103114724
What is the name of the Regulated Entity (RE)?	ULTRAFILTRATION WTP
Does the RE site have a physical address?	No
<b>Physical Address</b>	
Because there is no physical address, describe how to locate this site:	LOCATED AT 6725 MORENO STREET APPROXIMATELY 1.6 MILES NW OF THE INTERSECTION OF INTERSTATE HWY 35 AND LOOP 410 SW OF THE CITY OF SAN ANTONIO BEXAR COUNTY TEXAS
City	VON ORMY
State	TX
ZIP	78073
County	BEXAR
Latitude (N) (##.#####)	29.320833
Longitude (W) (-###.#####)	-98.634166
Facility NAICS Code	
What is the primary business of this entity?	INDUSTRIAL

### San Ant-Customer (Applicant) Information (Owner)

How is this applicant associated with this site?	Owner
What is the applicant's Customer Number (CN)?	CN600529069
Type of Customer	City Government
<b>Full legal name of the applicant:</b>	
Legal Name	San Antonio Water System
Texas SOS Filing Number	
Federal Tax ID	742632530
State Franchise Tax ID	
State Sales Tax ID	
Local Tax ID	
DUNS Number	57582603
Number of Employees	501+
Independently Owned and Operated?	Yes
I certify that the full legal name of the entity applying for this permit has been provided and is legally authorized to do business in Texas.	Yes
<b>Responsible Authority Contact</b>	
Organization Name	San Antonio Water System
Prefix	
First	Jeff
Middle	
Last	Haby
Suffix	
Credentials	PE
Title	Senior Vice President
<b>Responsible Authority Mailing Address</b>	
Enter new address or copy one from list:	
Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	2800 US HIGHWAY 281 N
Routing (such as Mail Code, Dept., or Attn:)	
City	SAN ANTONIO
State	TX
ZIP	78212
Phone (###-###-####)	2102333747
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	Jeff.Haby@saws.org

## Billing Contact

**Responsible contact for receiving billing statements:**

Select the permittee that is responsible for payment of the annual fee.

CN600529069, San Antonio Water System

Organization Name

SAN ANTONIO WATER SYSTEM

Prefix

First

Floramie

Middle

Last

Welch

Suffix

Credentials

Title

Environmental Analyst III

Enter new address or copy one from list:

**Mailing Address**

Address Type

Domestic

Mailing Address (include Suite or Bldg. here, if applicable)

2800 US HIGHWAY 281 N

Routing (such as Mail Code, Dept., or Attn:)

City

SAN ANTONIO

State

TX

ZIP

78212

Phone (###-###-####)

2102333744

Extension

Alternate Phone (###-###-####)

Fax (###-###-####)

E-mail

Floramie.Welch@saws.org

**Application Contact****Person TCEQ should contact for questions about this application:**

Same as another contact?

Billing Contact

Organization Name

SAN ANTONIO WATER SYSTEM

Prefix

First

Floramie

Middle

Last

Welch

Suffix

Credentials

Title

Environmental Analyst III

Enter new address or copy one from list:

**Mailing Address**

Address Type

Domestic

Mailing Address (include Suite or Bldg. here, if applicable)	2800 US HIGHWAY 281 N
Routing (such as Mail Code, Dept., or Attn:)	
City	SAN ANTONIO
State	TX
ZIP	78212
Phone (###-###-####)	2102333744
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	Floramie.Welch@saws.org

## Technical Contact

### Person TCEQ should contact for questions about this application:

Same as another contact?	Application Contact
Organization Name	SAN ANTONIO WATER SYSTEM
Prefix	MS
First	Floramie
Middle	
Last	Welch
Suffix	
Credentials	
Title	Environmental Analyst III

Enter new address or copy one from list:

### Mailing Address

Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	2800 US HIGHWAY 281 N
Routing (such as Mail Code, Dept., or Attn:)	
City	SAN ANTONIO
State	TX
ZIP	78212
Phone (###-###-####)	2102333744
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	Floramie.Welch@SAWS.ORG

## DMR Contact

**Person responsible for submitting Discharge Monitoring Report Forms:**

Same as another contact?	Application Contact
Organization Name	SAN ANTONIO WATER SYSTEM
Prefix	
First	Floramie
Middle	
Last	Welch
Suffix	
Credentials	
Title	Environmental Analyst III
Enter new address or copy one from list:	
<b>Mailing Address:</b>	
Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	2800 US HIGHWAY 281 N
Routing (such as Mail Code, Dept., or Attn:)	
City	SAN ANTONIO
State	TX
ZIP	78212
Phone (###-###-####)	2102333744
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	Floramie.Welch@SAWS.ORG

## Section 1# Permit Contact

### Permit Contact#: 1

**Person TCEQ should contact throughout the permit term.**

1) Same as another contact?	Application Contact
2) Organization Name	SAN ANTONIO WATER SYSTEM
3) Prefix	
4) First	Floramie
5) Middle	
6) Last	Welch
7) Suffix	
8) Credentials	
9) Title	Environmental Analyst III
<b>Mailing Address</b>	
10) Enter new address or copy one from list	
11) Address Type	Domestic
11.1) Mailing Address (include Suite or Bldg. here, if applicable)	2800 US HIGHWAY 281 N

11.2) Routing (such as Mail Code, Dept., or Attn:)	
11.3) City	SAN ANTONIO
11.4) State	TX
11.5) ZIP	78212
12) Phone (###-###-####)	2102333744
13) Extension	
14) Alternate Phone (###-###-####)	
15) Fax (###-###-####)	
16) E-mail	Floramie.Welch@saws.org

## Owner Information

### Owner of Treatment Facility

1) Prefix	
2) First and Last Name	
3) Organization Name	SAN ANTONIO WATER SYSTEM
4) Mailing Address	2800 US HWY 281 NORTH
5) City	SAN ANTONIO
6) State	TX
7) Zip Code	78212
8) Phone (###-###-####)	2107047297
9) Extension	
10) Email	Floramie.Welch@saws.org
11) What is ownership of the treatment facility?	Public

### Owner of Land (where treatment facility is or will be)

12) Prefix	
13) First and Last Name	
14) Organization Name	SAN ANTONIO WATER SYSTEM
15) Mailing Address	2800 US HWY 281 NORTH
16) City	SAN ANTONIO
17) State	TX
18) Zip Code	78212
19) Phone (###-###-####)	2107047297
20) Extension	
21) Email	Floramie.Welch@saws.org
22) Is the landowner the same person as the facility owner or co-applicant?	Yes

## General Information Renewal-Amendment

1) Current authorization expiration date:	02/10/2025
---	------------

2) Current Facility operational status:	Active
3) Is the facility located on or does the treated effluent cross American Indian Land?	No
4) What is the application type that you are seeking?	Renewal without changes
5) Current Authorization type:	Reverse Osmosis Water Treatment
5.1) What is your EPA facility classification?	Minor
5.1.1) Are the discharges at your facility subjected to federal effluent limitation guidelines (ELG) 40 CFR Part 400-471?	No
5.1.1.1) Select the applicable fee for the Minor facility that is not subjected to 40 CFR 400-471:	Renewal - \$315
6) What is the classification for your authorization?	TPDES
6.1) What is the EPA Identification Number?	TX0125083
6.2) Is the wastewater treatment facility location in the existing permit accurate?	Yes
6.3) Are the point(s) of discharge and the discharge route(s) in the existing permit correct?	Yes
6.4) City nearest the outfall(s):	SAN ANTONIO
6.5) County where the outfalls are located:	BEXAR
6.6) Is or will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch?	No
6.7) Is the daily average discharge at your facility of 5 MGD or more?	No
7) Did any person formerly employed by the TCEQ represent your company and get paid for service regarding this application?	No

## Public Notice Information

### Individual Publishing the Notices

1) Prefix	
2) First and Last Name	Lilliana Gonzalez
3) Credential	
4) Title	SR COMMUNICATIONS SPECIALIST
5) Organization Name	SAN ANTONIO WATER SYSTEM
6) Mailing Address	2800 US HIGHWAY 281 N
7) Address Line 2	
8) City	SAN ANTONIO
9) State	TX
10) Zip Code	78212
11) Phone (###-###-####)	2102333247
12) Extension	
13) Fax (###-###-####)	
14) Email	Lilliana.Gonzalez@saws.org

### Contact person to be listed in the Notices

15) Prefix  
 16) First and Last Name OLGA GALINDO  
 17) Credential  
 18) Title EXECUTIVE ADMIN ASSISTANT  
 19) Organization Name SAN ANTONIO WATER SYSTEM  
 20) Phone (###-###-####) 2102334570  
 21) Fax (###-###-####)  
 22) Email OLGA.GALINDO@SAWS.ORG

**Bilingual Notice Requirements**

23) Is a bilingual education program required by the Texas Education Code at the elementary or middle school nearest to the facility or proposed facility? No

**Section 1# Public Viewing Information****County#: 1**

1) County BEXAR  
 2) Public building name SAN ANTONIO WATER SYSTEM  
 ADMIN BLDG  
 3) Location within the building TOWER 1 FIRST FLOOR  
 4) Physical Address of Building 2800 US HWY 281 NORTH  
 5) City SAN ANTONIO  
 6) Contact Name FLORAMIE WELCH  
 7) Phone (###-###-####) 2102333744  
 8) Extension  
 9) Is the location open to the public? Yes

**Plain Language**

## 1) Plain Language

[File Properties]

File Name LANG\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_PLAIN\_LANGUAGE.pdf  
 Hash 9C81D89CA86D24A216FF7B8B028AA0AFF56A4E9B3FEFEEEE4518A91528EB5E8EC  
 MIME-Type application/pdf

**Supplemental Permit Information Form**

## 1) Supplemental Permit Information Form (SPIF)

[File Properties]

File Name SPIF\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_SPIF\_OUTFALL\_MAP.pdf  
 Hash FF8313B7D3A5C33EB9B2F1C1DD7E2304DDE219AD0885745F6268D37CF4189456

MIME-Type application/pdf

## Industrial Attachments

1) Attach an 8.5"x11", reproduced portion of the most current and original USGS Topographic Quadrangle Map(s) that meets the 1:24,000 scale.

### [File Properties]

File Name MAP\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_USGS\_MAPS.pdf  
 Hash 12F438830C70AEA29E8995526BBB72F5614113668E235C3E4A02B4BBB61AB5BF  
 MIME-Type application/pdf

2) I confirm that all required sections of Technical Report 1.0 are complete and will be included in the Technical Attachment. Yes

2.1) I confirm that Worksheet 2.0 (Pollutant Analyses Requirements) is complete and included in the Technical Attachment. Yes

2.2) I confirm that Worksheet 4.0 (Receiving Waters) is complete and included in the Technical Attachment. Yes

2.3) Are you planning to include Worksheet 4.1 (Waterbody Physical Characteristics) in the Technical Attachment? No

2.4) Are you planning to include Worksheet 6.0 (Industrial Waste Contribution) in the Technical Attachment? No

2.5) Are you planning to include Worksheet 7.0 (Stormwater Discharges Associated with Industrial Activities) to the Technical Attachment? No

2.6) Are you planning to include Worksheet 8.0 (Aquaculture) in the Technical Attachment? No

2.7) Are you planning to include Worksheet 9.0 (Class V Injection Well Inventory/Authorization) in the Technical Attachment? No

2.8) Are you planning to include Worksheet 10.0 (Quarries in the John Graves Scenic Riverway) in the Technical Attachment? No

2.9) Are you planning to include Worksheet 11.0 (Cooling Water System Information) in the Technical Attachment? No

2.10) Are you planning to include Worksheet 11.1 (Impingement Mortality) in the Technical Attachment? No

2.11) Are you planning to include Worksheet 11.2 (Source Water Biological Data) in the Technical Attachment? No

2.12) Are you planning to include Worksheet 11.3 (Entrainment) in the Technical Attachment? No

2.13) Technical Attachment

### [File Properties]

File Name TECH\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_TECHNICAL\_REPORT1.0A.pdf  
 Hash EC26462D3B6BBA21186337E3834EA5DBB95E1400AA41C82C14AABBFF9E42CC57  
 MIME-Type application/pdf

## 3) Flow Diagram

[File Properties]

File Name FLDIA\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_FLOW\_DIAGRAM.pdf  
Hash CFCCBBB16464B163C1B0CE0069982E8817D37836C80675F14F69A147827EBE1B  
MIME-Type application/pdf

## 4) Site Drawing

[File Properties]

File Name SITEDR\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_SITE\_MAP.pdf  
Hash AFEFFD2F24CA1A448743E447CB1A6C6E969EEEF44DD3BE4FFCF780303D354451  
MIME-Type application/pdf

## 5) Design Calculations

[File Properties]

File Name DES\_CAL\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_NOT\_APPLICABLE\_SECTIONS\_SIGNED.pdf  
Hash 4FE069A36D8DF307B425E8859656B8C9B2A07CA7B6E382512834BC1321F3BEE4  
MIME-Type application/pdf

## 6) Solids Management Plan

[File Properties]

File Name SMP\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_NOT\_APPLICABLE\_SECTIONS\_SIGNED.pdf  
Hash 4FE069A36D8DF307B425E8859656B8C9B2A07CA7B6E382512834BC1321F3BEE4  
MIME-Type application/pdf

## 7) Water Balance

[File Properties]

File Name WB\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_NOT\_APPLICABLE\_SECTIONS\_SIGNED.pdf  
Hash 4FE069A36D8DF307B425E8859656B8C9B2A07CA7B6E382512834BC1321F3BEE4  
MIME-Type application/pdf

## 8) Other Attachments

[File Properties]

File Name OTHER\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_CORE\_DATA\_FORM\_SIGNED.pdf  
Hash 1F0B5FB49E07C7E2206AD173978CC9413774B18CA3291BD1A177D28146FA8BF3  
MIME-Type application/pdf

[File Properties]

File Name OTHER\_2024\_UF\_PLANT\_TPDES\_APPLICATION\_LABORATORY\_FORM\_SIGNED.pdf  
Hash B89BA324927D0F560AD25C02EE7A110C3AB61A3B447A4C16740DDFE2C239853D  
MIME-Type application/pdf

[File Properties]

File Name	OTHER_2024_0520_UF_PLANT_CLOSURE_PLAN_SIGNED.pdf
Hash	E30F2993FAF55AFEEEC31FEE3B7594A0E133F46C1380935B603AA08F72263C9D0
MIME-Type	application/pdf

## Certification

I certify that I am authorized under 30 Texas Administrative Code 305.44 to sign this document and can provide documentation in proof of such authorization upon request.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

1. I am Jeffrey J Haby, the owner of the STEERS account ER106003.
2. I have the authority to sign this data on behalf of the applicant named above.
3. I have personally examined the foregoing and am familiar with its content and the content of any attachments, and based upon my personal knowledge and/or inquiry of any individual responsible for information contained herein, that this information is true, accurate, and complete.
4. I further certify that I have not violated any term in my TCEQ STEERS participation agreement and that I have no reason to believe that the confidentiality or use of my password has been compromised at any time.
5. I understand that use of my password constitutes an electronic signature legally equivalent to my written signature.
6. I also understand that the attestations of fact contained herein pertain to the implementation, oversight and enforcement of a state and/or federal environmental program and must be true and complete to the best of my knowledge.
7. I am aware that criminal penalties may be imposed for statements or omissions that I know or have reason to believe are untrue or misleading.
8. I am knowingly and intentionally signing Update Domestic or Industrial Individual Permit WQ0004437000.
9. My signature indicates that I am in agreement with the information on this form, and authorize its submittal to the TCEQ.

OWNER Signature: Jeffrey J Haby OWNER

Customer Number:	CN600529069
Legal Name:	San Antonio Water System
Account Number:	ER106003
Signature IP Address:	155.190.8.7
Signature Date:	2024-09-05
Signature Hash:	2E9FE6E897E0EB8864AEF70857885D410DE05A2A22FFEE66DB5E01DFD478A77F
Form Hash Code at time of Signature:	7A1E3E1EF12E542037D80BA1B041E50C50212C5245C57D4CDEDF93DA1F540F39

## Fee Payment

Transaction by:	The application fee payment transaction was made by ER106003/Jeffrey J Haby
Paid by:	The application fee was paid by JEFFREY J

Fee Amount:	HABY \$300.00
Paid Date:	The application fee was paid on 2024-09-05
Transaction/Voucher number:	The transaction number is 582EA000624251 and the voucher number is 720065

## Submission

---

Reference Number:	The application reference number is 656086
Submitted by:	The application was submitted by ER046829/Floramie Welch
Submitted Timestamp:	The application was submitted on 2024-09-30 at 13:34:10 CDT
Submitted From:	The application was submitted from IP address 155.190.8.5
Confirmation Number:	The confirmation number is 567262
Steers Version:	The STEERS version is 6.82
Permit Number:	The permit number is WQ0004437000

## Additional Information

---

Application Creator: This account was created by Floramie Welch



TCEQ Use Only

# TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

## SECTION I: General Information

<b>1. Reason for Submission</b> (If other is checked please describe in space provided.)		
<input type="checkbox"/> New Permit, Registration or Authorization (Core Data Form should be submitted with the program application.)		
<input checked="" type="checkbox"/> Renewal (Core Data Form should be submitted with the renewal form)		<input type="checkbox"/> Other
<b>2. Customer Reference Number</b> (if issued)	<a href="#">Follow this link to search for CN or RN numbers in Central Registry**</a>	<b>3. Regulated Entity Reference Number</b> (if issued)
CN 600529069		RN 103114724

## SECTION II: Customer Information

<b>4. General Customer Information</b>		<b>5. Effective Date for Customer Information Updates</b> (mm/dd/yyyy)	
<input type="checkbox"/> New Customer <input checked="" type="checkbox"/> Update to Customer Information <input type="checkbox"/> Change in Regulated Entity Ownership <input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)			
<i>The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).</i>			
<b>6. Customer Legal Name</b> (If an individual, print last name first: eg: Doe, John)		<i>If new Customer, enter previous Customer below:</i>	
SAN ANTONIO WATER SYSTEM (SAWS)			
<b>7. TX SOS/CPA Filing Number</b>	<b>8. TX State Tax ID</b> (11 digits) 17426325308	<b>9. Federal Tax ID</b> (9 digits) 74-2632530	<b>10. DUNS Number</b> (if applicable) 057582603
<b>11. Type of Customer:</b>	<input type="checkbox"/> Corporation	<input type="checkbox"/> Individual	Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited
Government: <input checked="" type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> Local <input type="checkbox"/> State <input type="checkbox"/> Other	<input type="checkbox"/> Sole Proprietorship		<input type="checkbox"/> Other:
<b>12. Number of Employees</b>		<b>13. Independently Owned and Operated?</b>	
<input type="checkbox"/> 0-20 <input type="checkbox"/> 21-100 <input type="checkbox"/> 101-250 <input type="checkbox"/> 251-500 <input checked="" type="checkbox"/> 501 and higher		<input type="checkbox"/> Yes <input type="checkbox"/> No	
<b>14. Customer Role</b> (Proposed or Actual) – as it relates to the Regulated Entity listed on this form. Please check one of the following			
<input type="checkbox"/> Owner <input type="checkbox"/> Operator <input checked="" type="checkbox"/> Owner & Operator <input type="checkbox"/> Other: <input type="checkbox"/> Occupational Licensee <input type="checkbox"/> Responsible Party <input type="checkbox"/> VCP/BSA Applicant			
<b>15. Mailing Address:</b>	2800 US HIGHWAY 281 NORTH		
	City	SAN ANTONIO	State TX   ZIP 78212   ZIP + 4 3106
<b>16. Country Mailing Information</b> (if outside USA)		<b>17. E-Mail Address</b> (if applicable)	
<b>18. Telephone Number</b>	<b>19. Extension or Code</b>	<b>20. Fax Number</b> (if applicable)	

**SECTION III: Regulated Entity Information****21. General Regulated Entity Information** (If 'New Regulated Entity' is selected, a new permit application is also required.)

New Regulated Entity     Update to Regulated Entity Name     Update to Regulated Entity Information

*The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).*

**22. Regulated Entity Name** (Enter name of the site where the regulated action is taking place.)

ULTRAFILTRATION WATER TREATMENT PLANT

**23. Street Address of the Regulated Entity:**

6725 MORENO STREET

**(No PO Boxes)**

City	VON ARMY	State	TX	ZIP	78073	ZIP + 4	
------	----------	-------	----	-----	-------	---------	--

**24. County**

BEXAR

If no Street Address is provided, fields 25-28 are required.

**25. Description to****Physical Location:****26. Nearest City****State****Nearest ZIP Code**

*Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).*

**27. Latitude (N) In Decimal:****28. Longitude (W) In Decimal:**

Degrees

Minutes

Seconds

Degrees

Minutes

Seconds

**29. Primary SIC Code****30. Secondary SIC Code****31. Primary NAICS Code****32. Secondary NAICS Code**

(4 digits)

(4 digits)

(5 or 6 digits)

(5 or 6 digits)

4941

221310

**33. What is the Primary Business of this entity?** (Do not repeat the SIC or NAICS description.)

POTABLE WATER TREATMENT

**34. Mailing**

2800 US HIGHWAY 281 NORTH

**Address:**

City	SAN ANTONIO	State	TX	ZIP	7821	ZIP + 4	3106
------	-------------	-------	----	-----	------	---------	------

**35. E-Mail Address:****36. Telephone Number****37. Extension or Code****38. Fax Number** (if applicable)

( 210 ) 704-7297

( ) -

**39. TCEQ Programs and ID Numbers** Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.


<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input type="checkbox"/> Edwards Aquifer	<input type="checkbox"/> Emissions Inventory Air	<input type="checkbox"/> Industrial Hazardous Waste
<input type="checkbox"/> Municipal Solid Waste	<input type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
<input type="checkbox"/> Sludge	<input type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
<input type="checkbox"/> Voluntary Cleanup	<input checked="" type="checkbox"/> Wastewater	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:
	WQ0004437-000			

**SECTION IV: Preparer Information**

<b>40. Name:</b>	FLORAMIE WELCH	<b>41. Title:</b>	ENVIRONMENTAL ANALYST III
<b>42. Telephone Number</b>	<b>43. Ext./Code</b>	<b>44. Fax Number</b>	<b>45. E-Mail Address</b>
( 210 ) 233-3744		( ) -	FLORAMIE.WELCH@SAWS.ORG

**SECTION V: Authorized Signature**

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

<b>Company:</b>	SAN ANTONIO WATER SYSTEM (SAWS)	<b>Job Title:</b>	SR. VICE PRESIDENT, PRODUCTION OPERATIONS
<b>Name (In Print):</b>	JEFF HABY, P.E.	<b>Phone:</b>	( 210 ) 233- 3747
<b>Signature:</b>		<b>Date:</b>	6-3-2024


*The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.*

San Antonio Water System (CN600529069) operates an Ultra Filtration Water Treatment Plant (RN103114724), a potable water treatment facility. The facility is located at 6725 Moreno Street, near the city of San Antonio, Bexar County, Texas 78073.


The water treatment facility is currently not producing wastewater. However, this application is for a renewal to discharge process wastewater on an intermittent and flow-variable basis via Outfall 001. Discharges from the facility are required to contain no more than 45 parts per million of Total Suspended Solids (TSS) and are required to have a potential of hydrogen (pH) between 6.0 and 9.0, measured as standard units.

Raw water is supplied by Medina Lake where it is withdrawn from an intake structure at the Medina River and is fed through a clarification system to remove turbidity, which are particles that cause cloudiness in water. The water is then fed through pre-filtration and ultra-filtration membranes to remove dissolved solids and the finished water is distributed for potable drinking water use while the solids are stored in lagoons.

Process wastewater discharges only occur when the incoming source water is excessive in turbidity. The ultra-filtration membranes system is shut off automatically and the flow is diverted to an equalization chamber and then discharged through Outfall 001, discharging to an unnamed ditch and then into Medio Creek, Segment ID 1912.

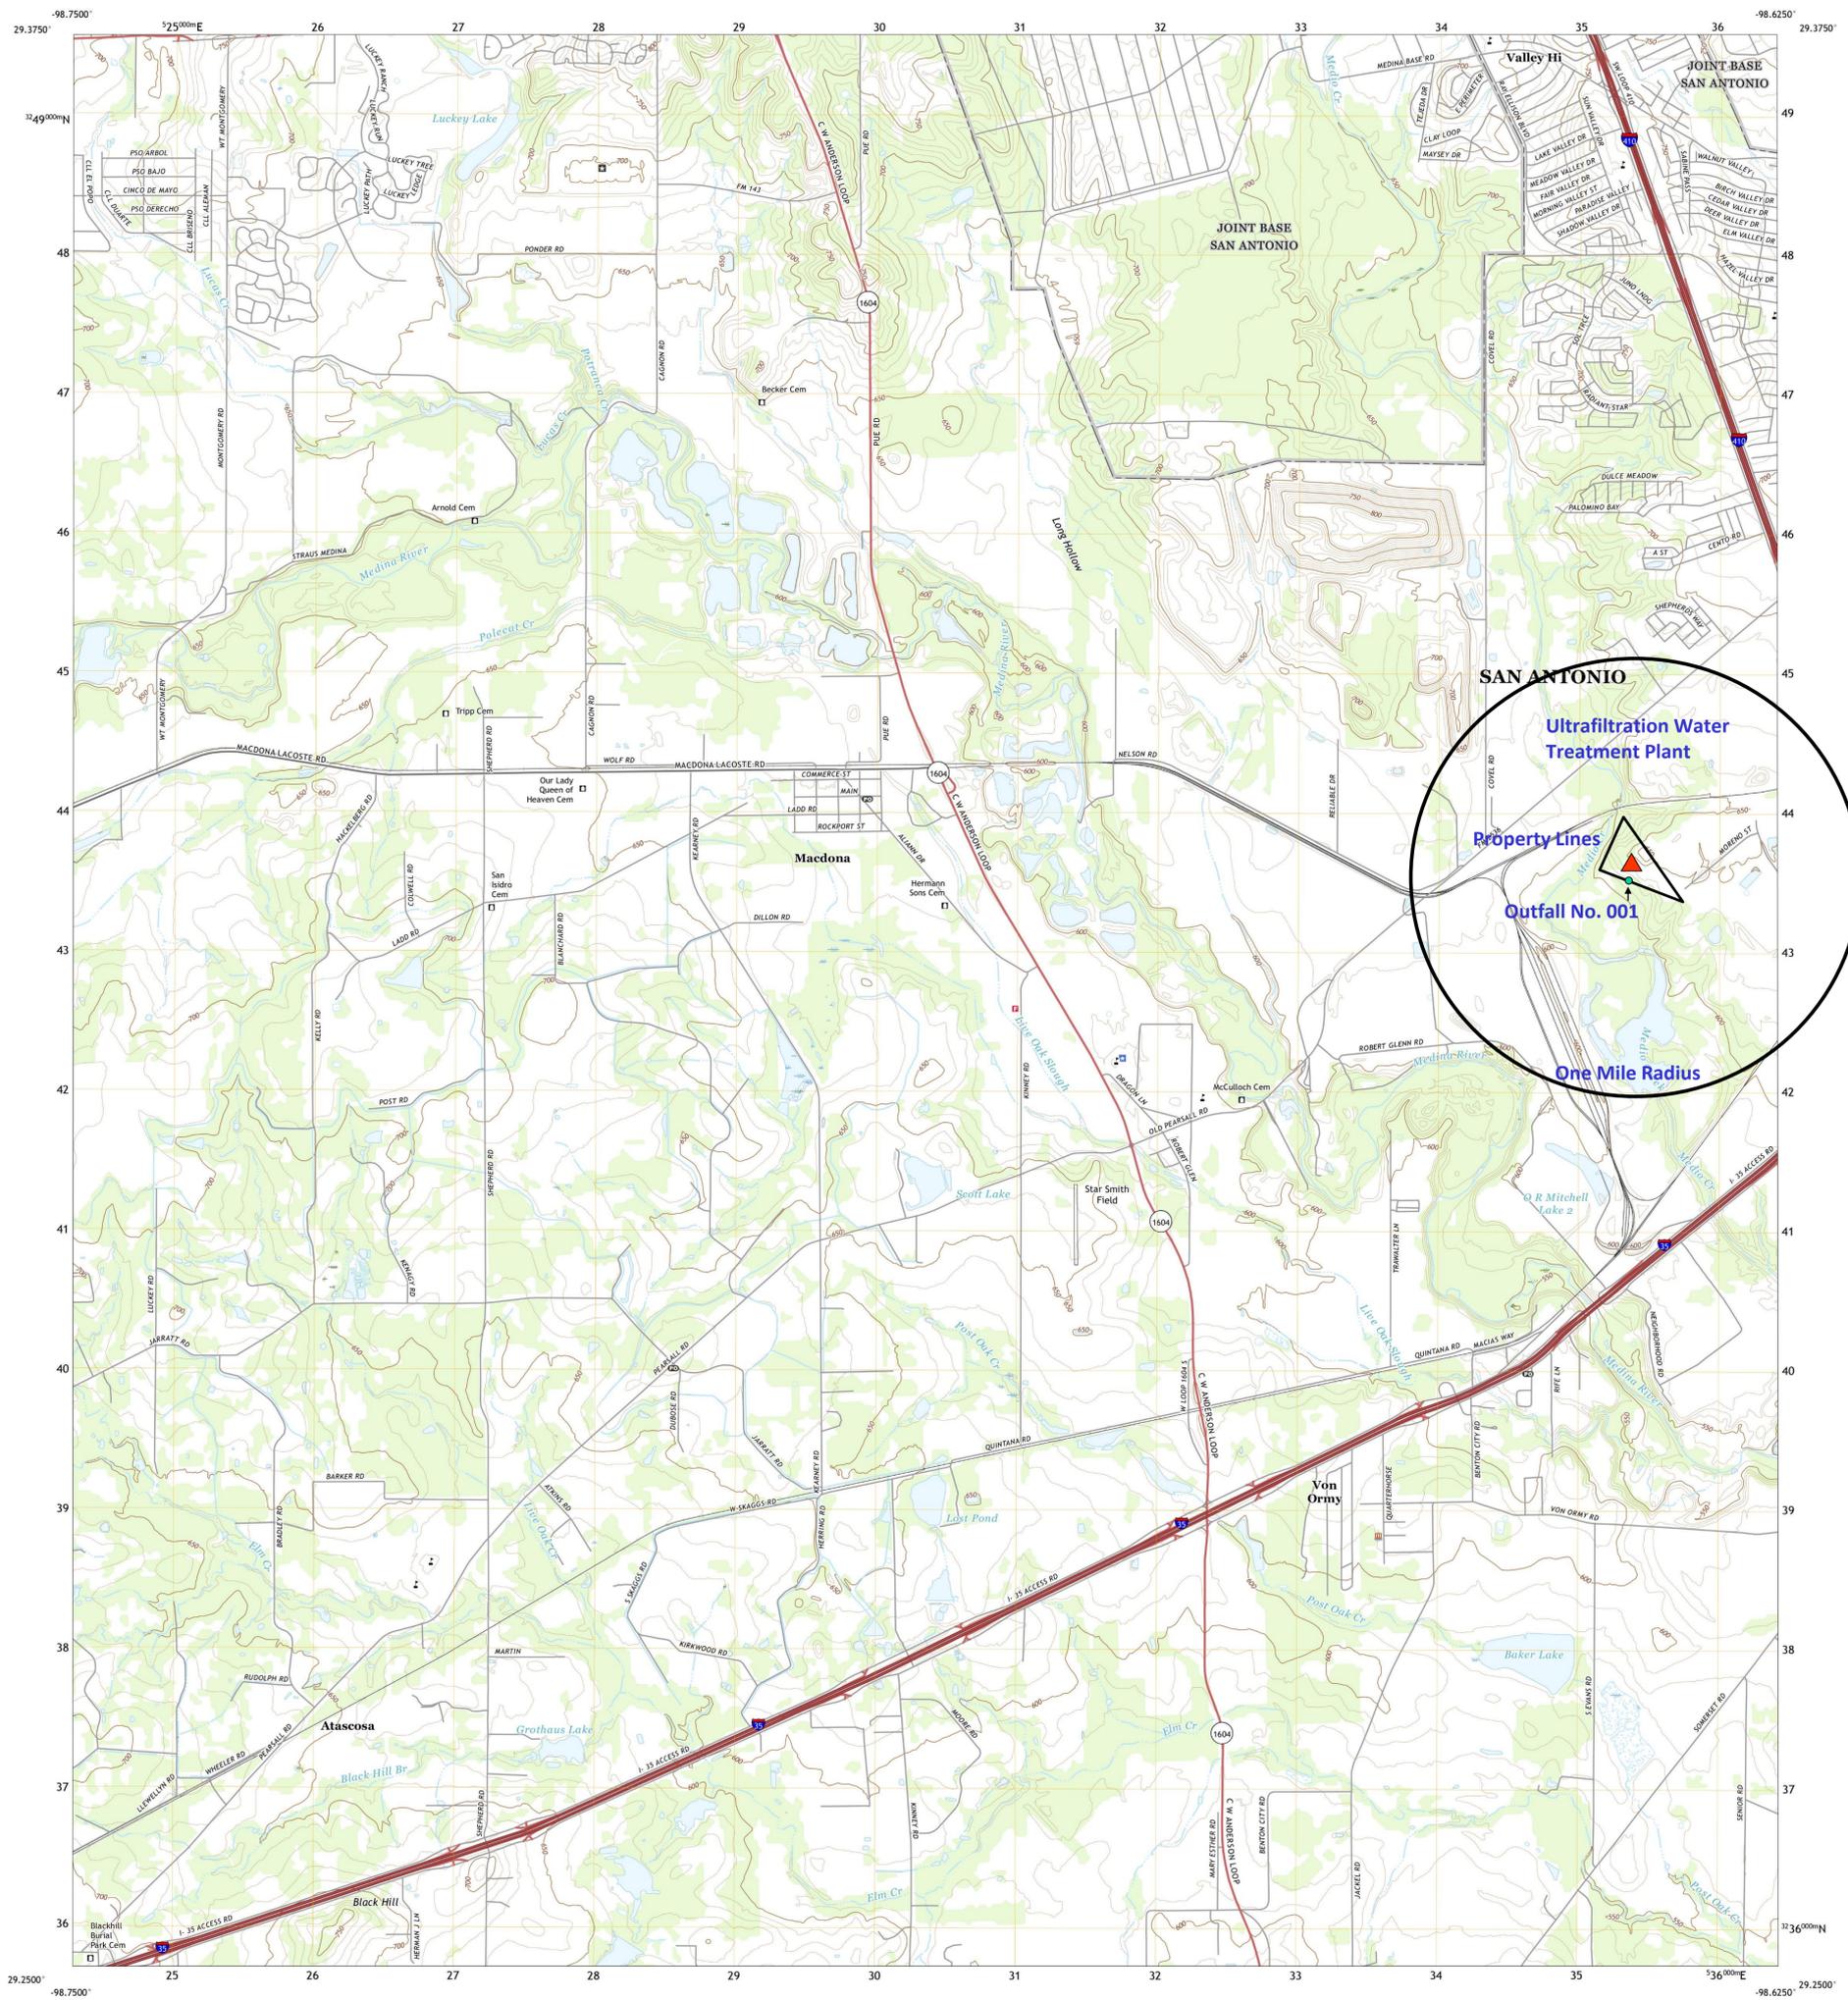

Produced by the United States Geological Survey
North American Datum of 1983 (NAD83)
World Geodetic System of 1984 (WGS84), Projection and 1 000-meter grid/Universal Transverse Mercator, Zone 14K
This map is not a legal document. Boundaries may be generalized for this map scale. Private lands within government reservations may not be shown. Obtain permission before entering private lands.




ROAD CLASSIFICATION table with symbols for Expressway, Secondary Hwy, Ramp, Interstate Route, Local Connector, Local Road, 4WD, US Route, and State Route.

ADJOINING QUADRANGLES table listing adjacent map sheets: 1 La Coste NE, 2 Calieba Hill, 3 San Antonio West, 4 La Coste, 5 Terrell Wells, 6 Lytle, 7 Somerset, 8 Thelma.

MACDONA, TX 2022



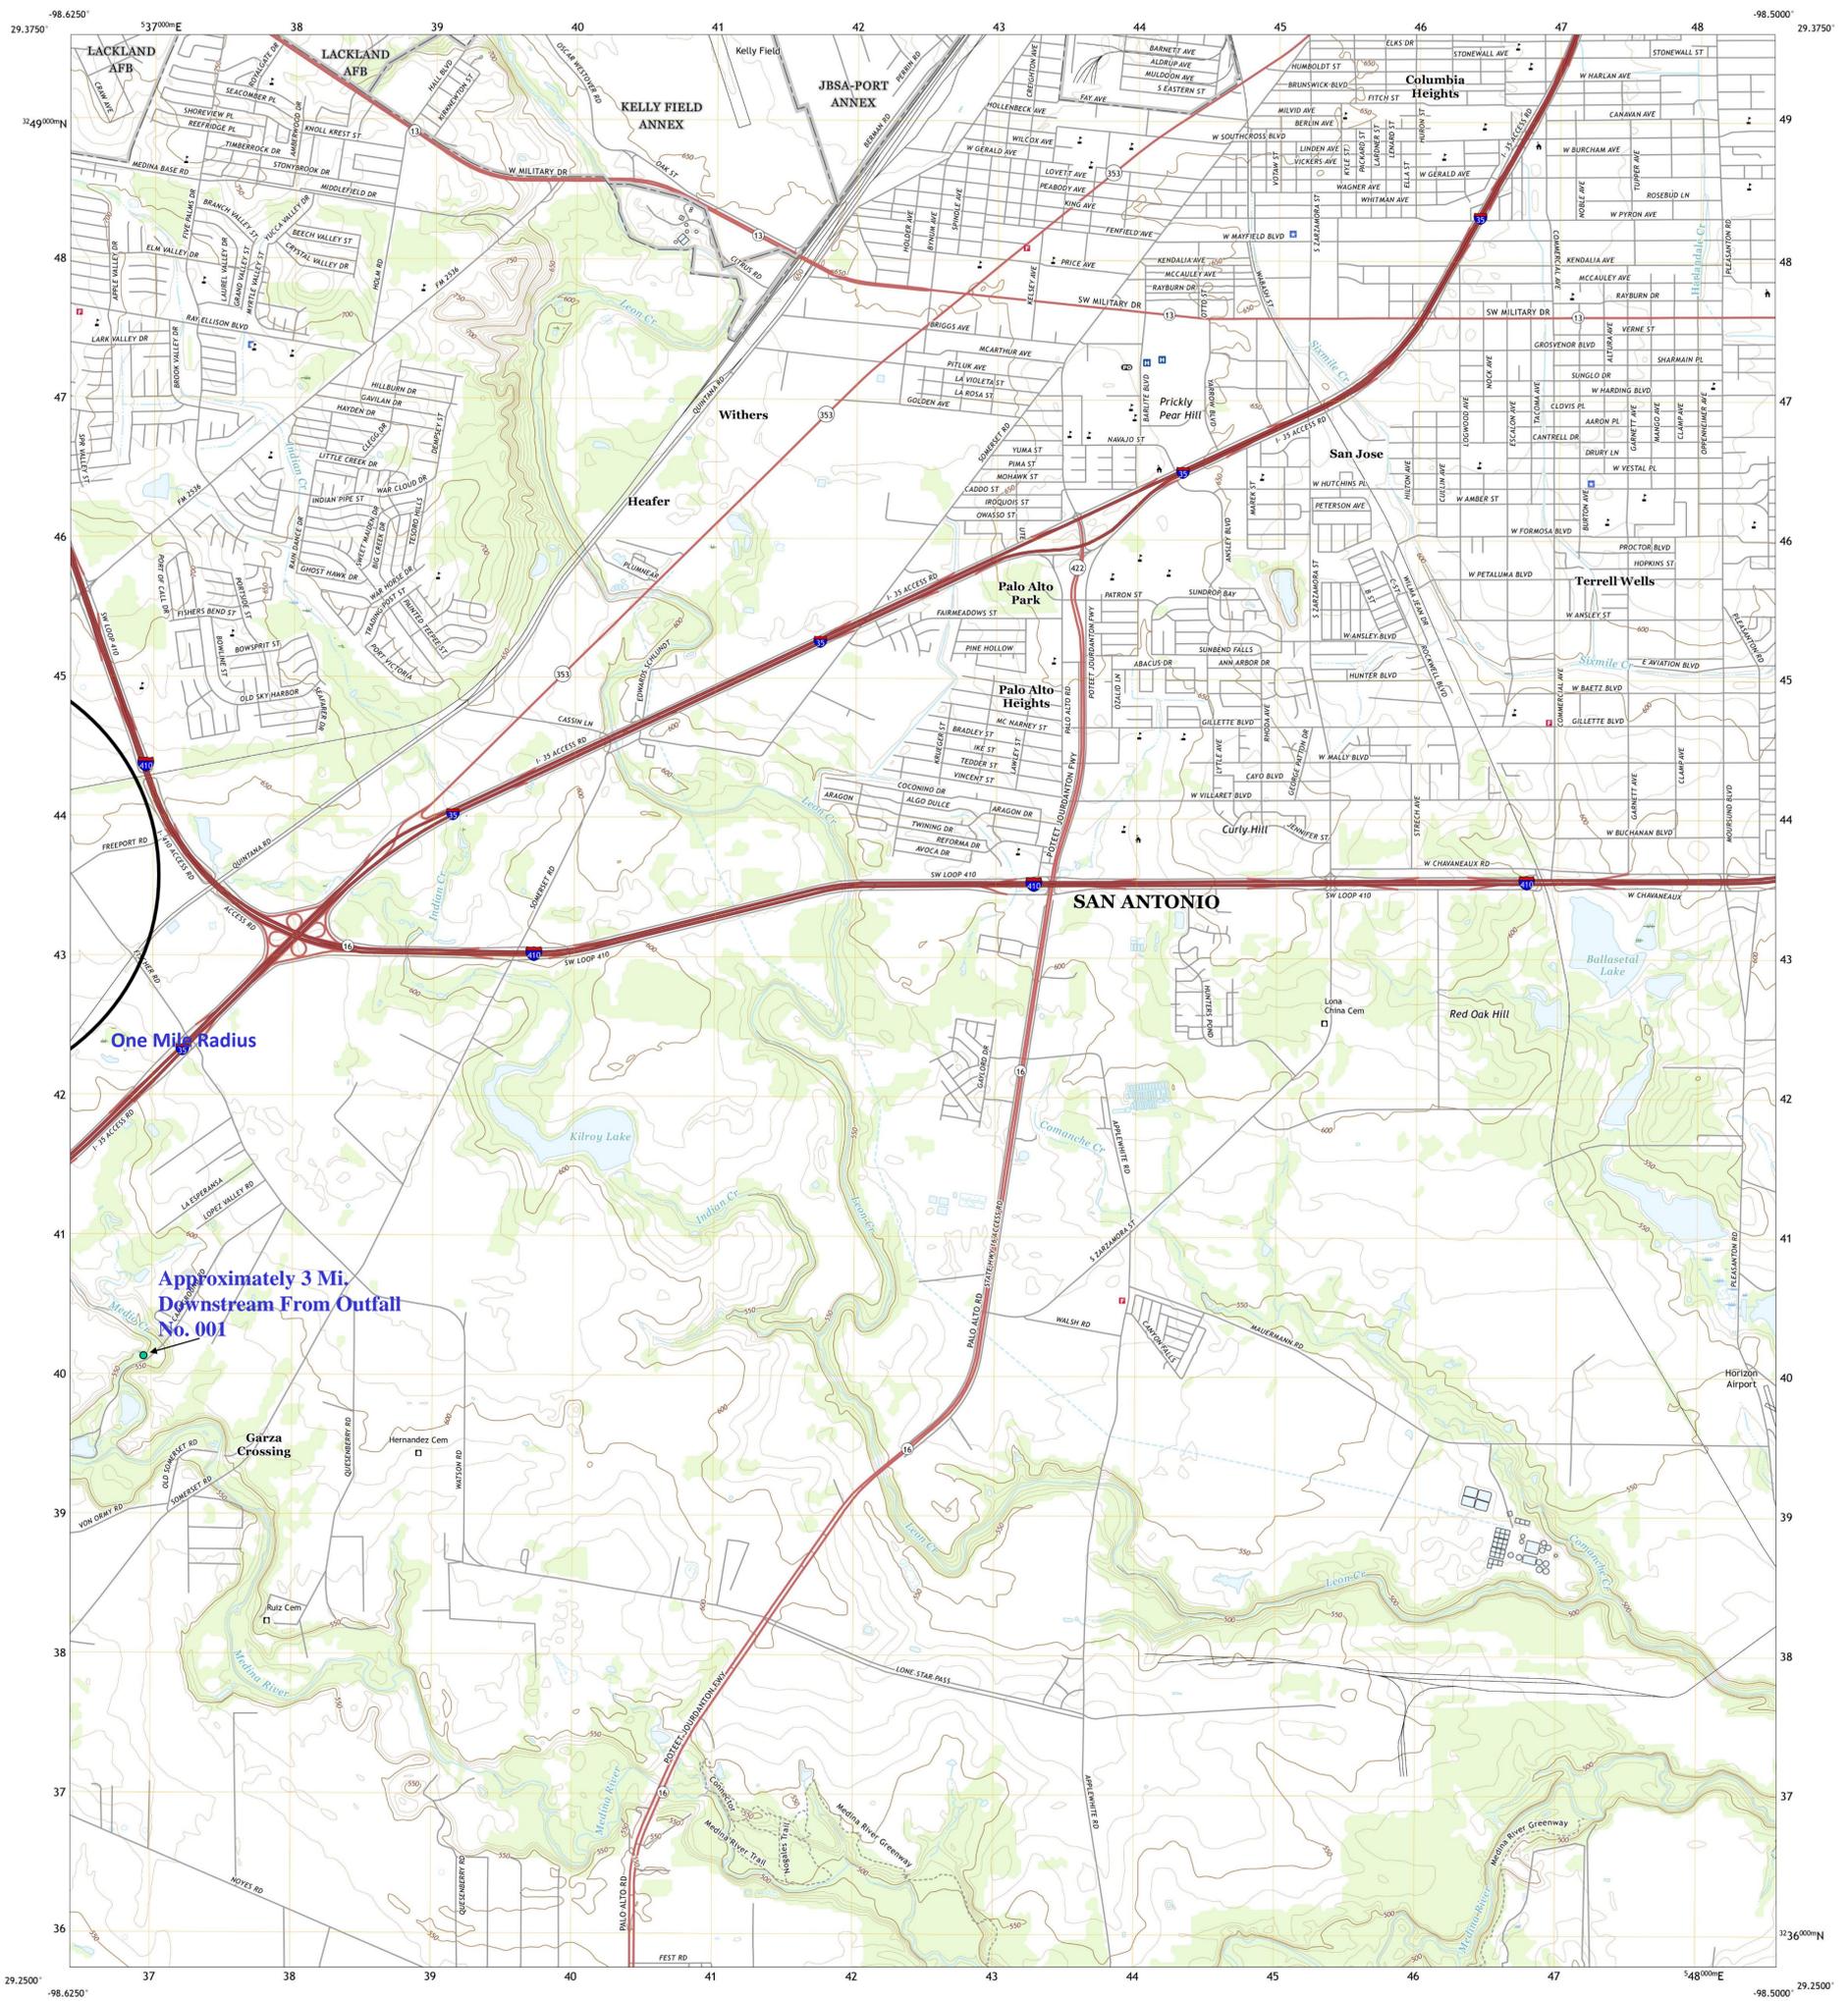

One Mile Radius

Approximately 3 Mi. Downstream From Outfall No. 001

Produced by the United States Geological Survey North American Datum of 1983 (NAD83) World Geodetic System of 1984 (WGS84)...



SCALE 1:24 000

CONTOUR INTERVAL 10 FEET NORTH AMERICAN VERTICAL DATUM OF 1988

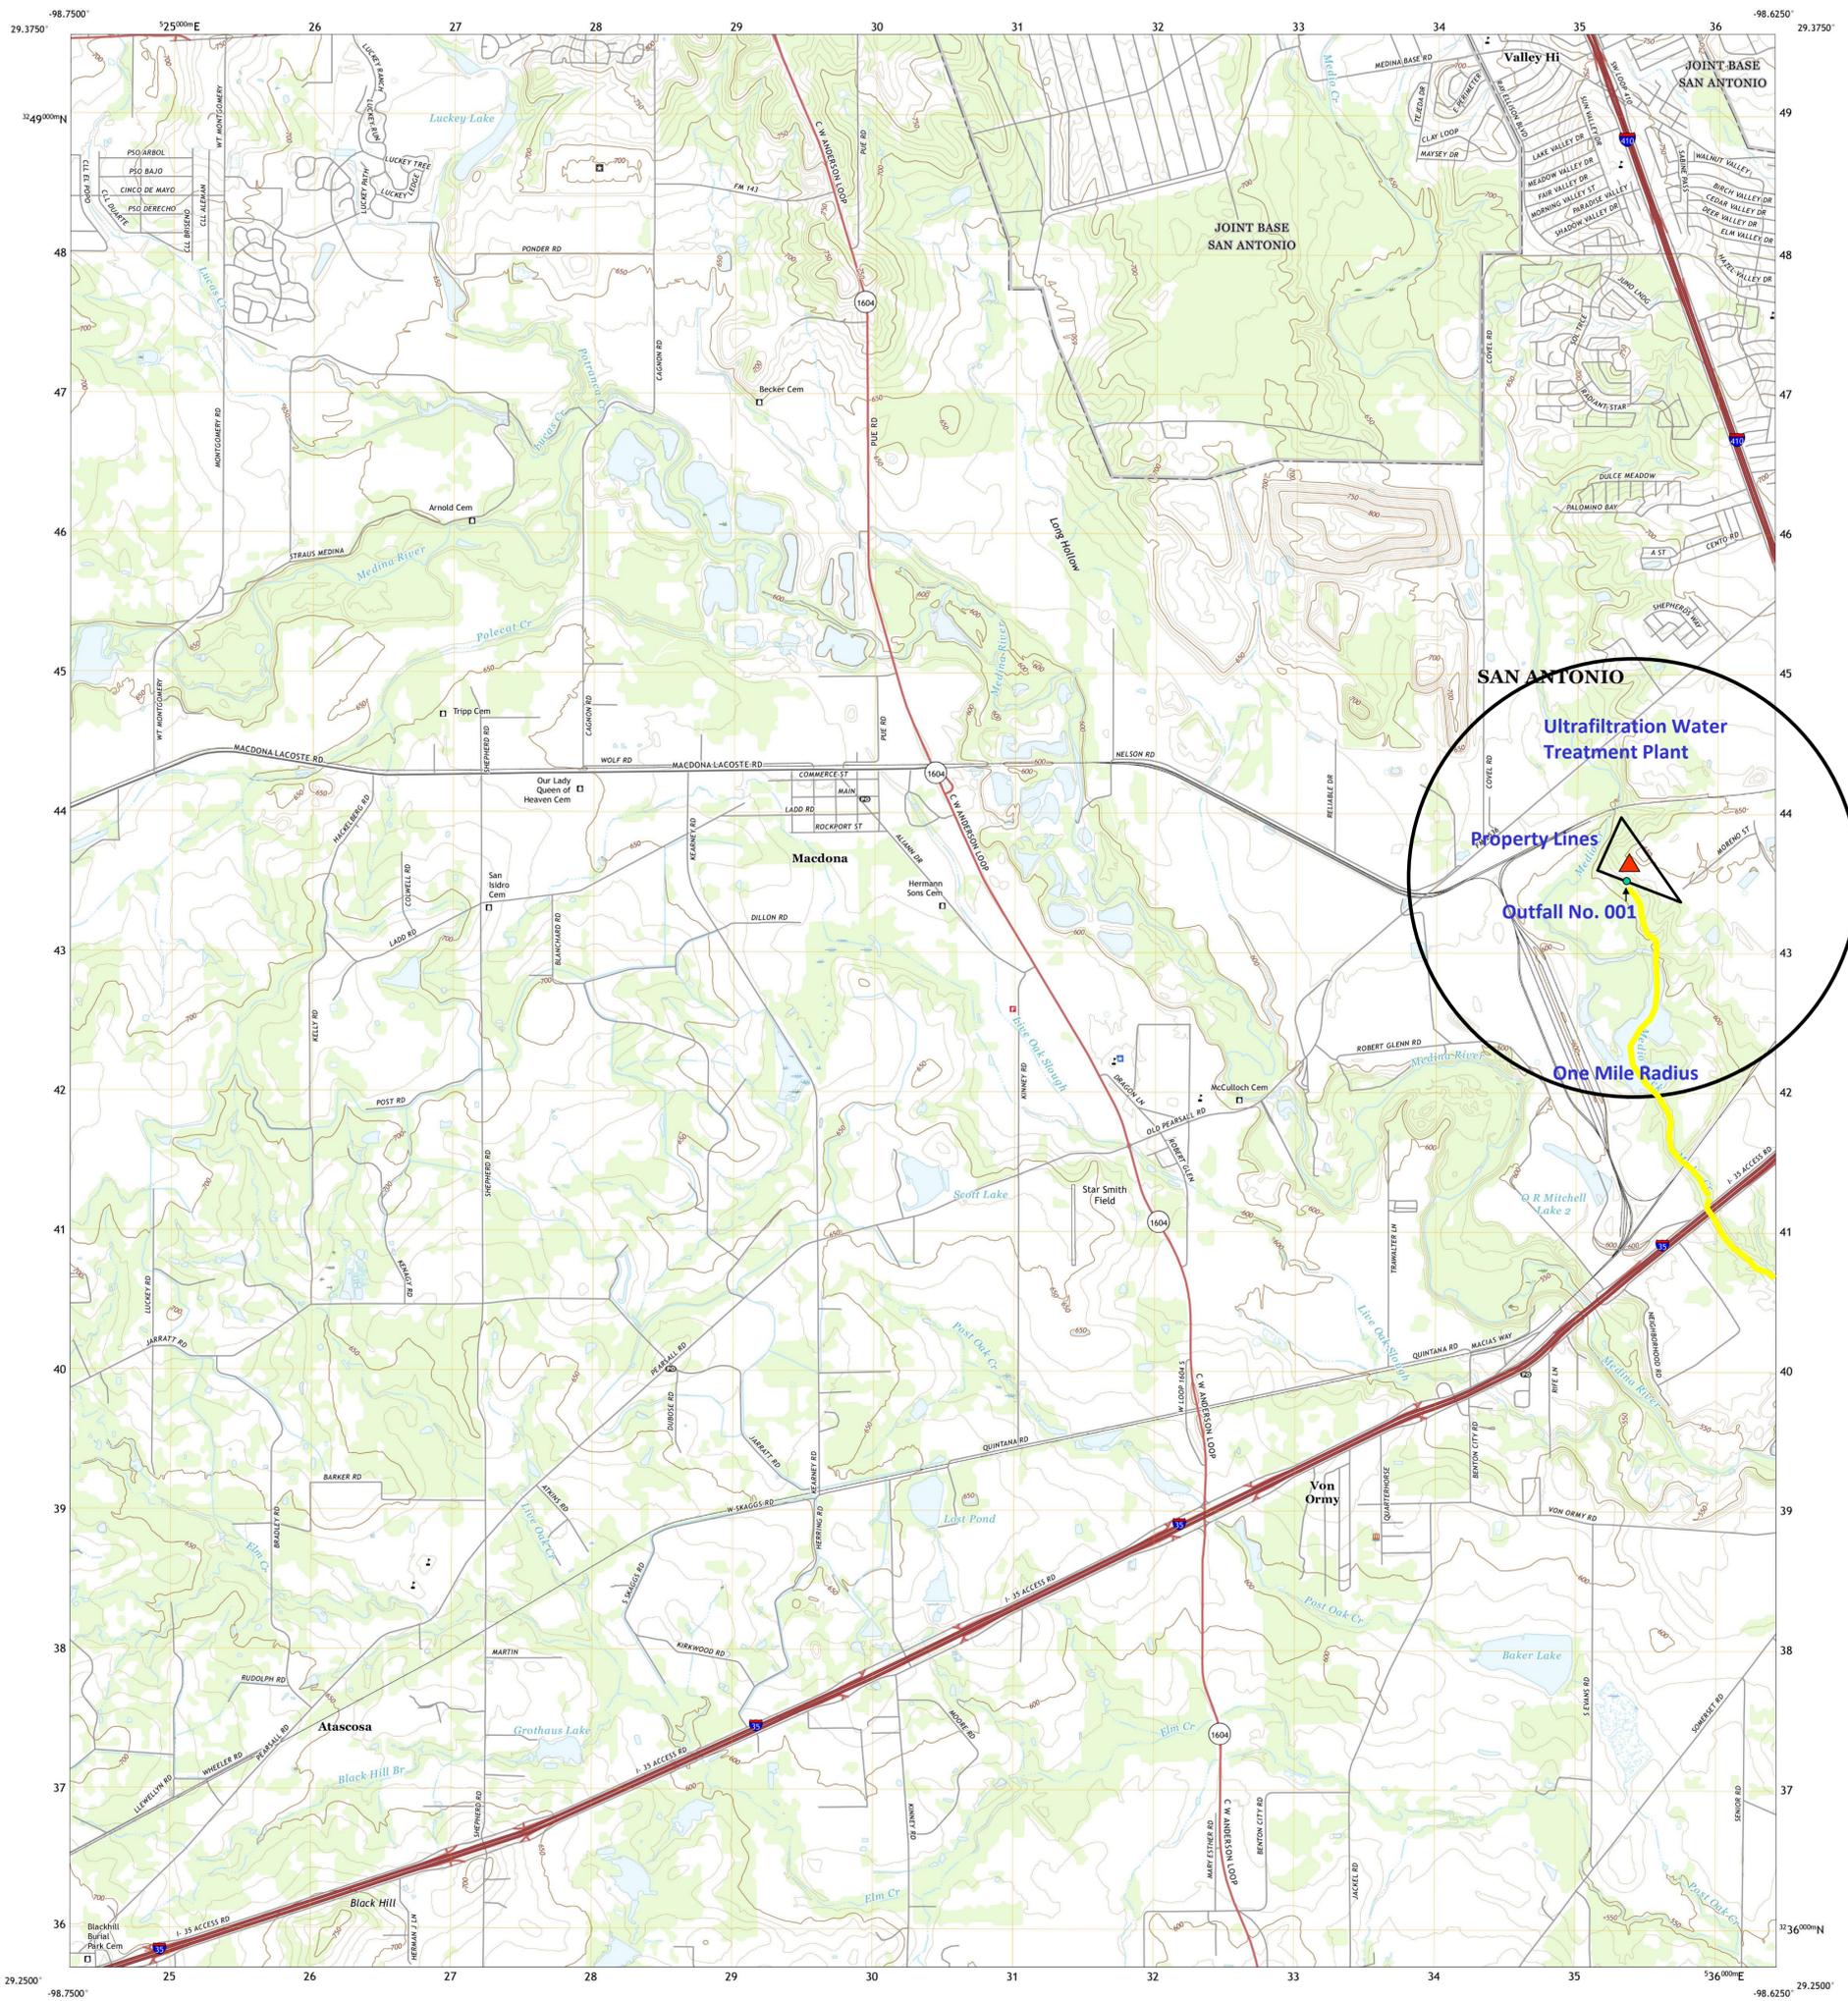


Table with 3 columns and 8 rows showing adjacent quadrangles and their names (e.g., Culebra Hill, San Antonio West).

ROAD CLASSIFICATION table with symbols for Expressway, Secondary Hwy, Ramp, Interstate Route, US Route, Local Connector, Local Road, 4WD, and State Route.

TERRELL WELLS, TX 2019







Produced by the United States Geological Survey

North American Datum of 1983 (NAD83) World Geodetic System of 1984 (WGS84), Projection and 1 000-meter grid (Universal Transverse Mercator, Zone 14K. This map is not a legal document. Boundaries may be generalized for this map scale. Private lands within government reservations may not be shown. Obtain permission before entering private lands.

Imagery: NAIP, September 2016 - November 2016  
Roads: U.S. Census Bureau, 2015 - 2019  
Names: GNS, 1979 - 2022  
Hydrography: National Hydrography Dataset, 2003 - 2018  
Contours: National Elevation Dataset, 2021  
Boundaries: Multiple sources; see metadata file 2019 - 2021  
Wetlands: FWS National Wetlands Inventory Not Available



SCALE 1:24 000



CONTOUR INTERVAL 10 FEET  
NORTH AMERICAN VERTICAL DATUM OF 1988  
This map was produced to conform with the National Geospatial Program US Topo Product Standard.



ADJOINING QUADRANGLES

1	2	3
4	5	6
7	8	


1 La Coste NE  
2 Calieba Hill  
3 San Antonio West  
4 La Coste  
5 Terrell Wells  
6 Lytle  
7 Somerset  
8 Thelma

ROAD CLASSIFICATION

Expressway	Local Connector
Secondary Hwy	Local Road
Ramp	4WD
Interstate Route	US Route
	State Route

MACDONA, TX  
2022



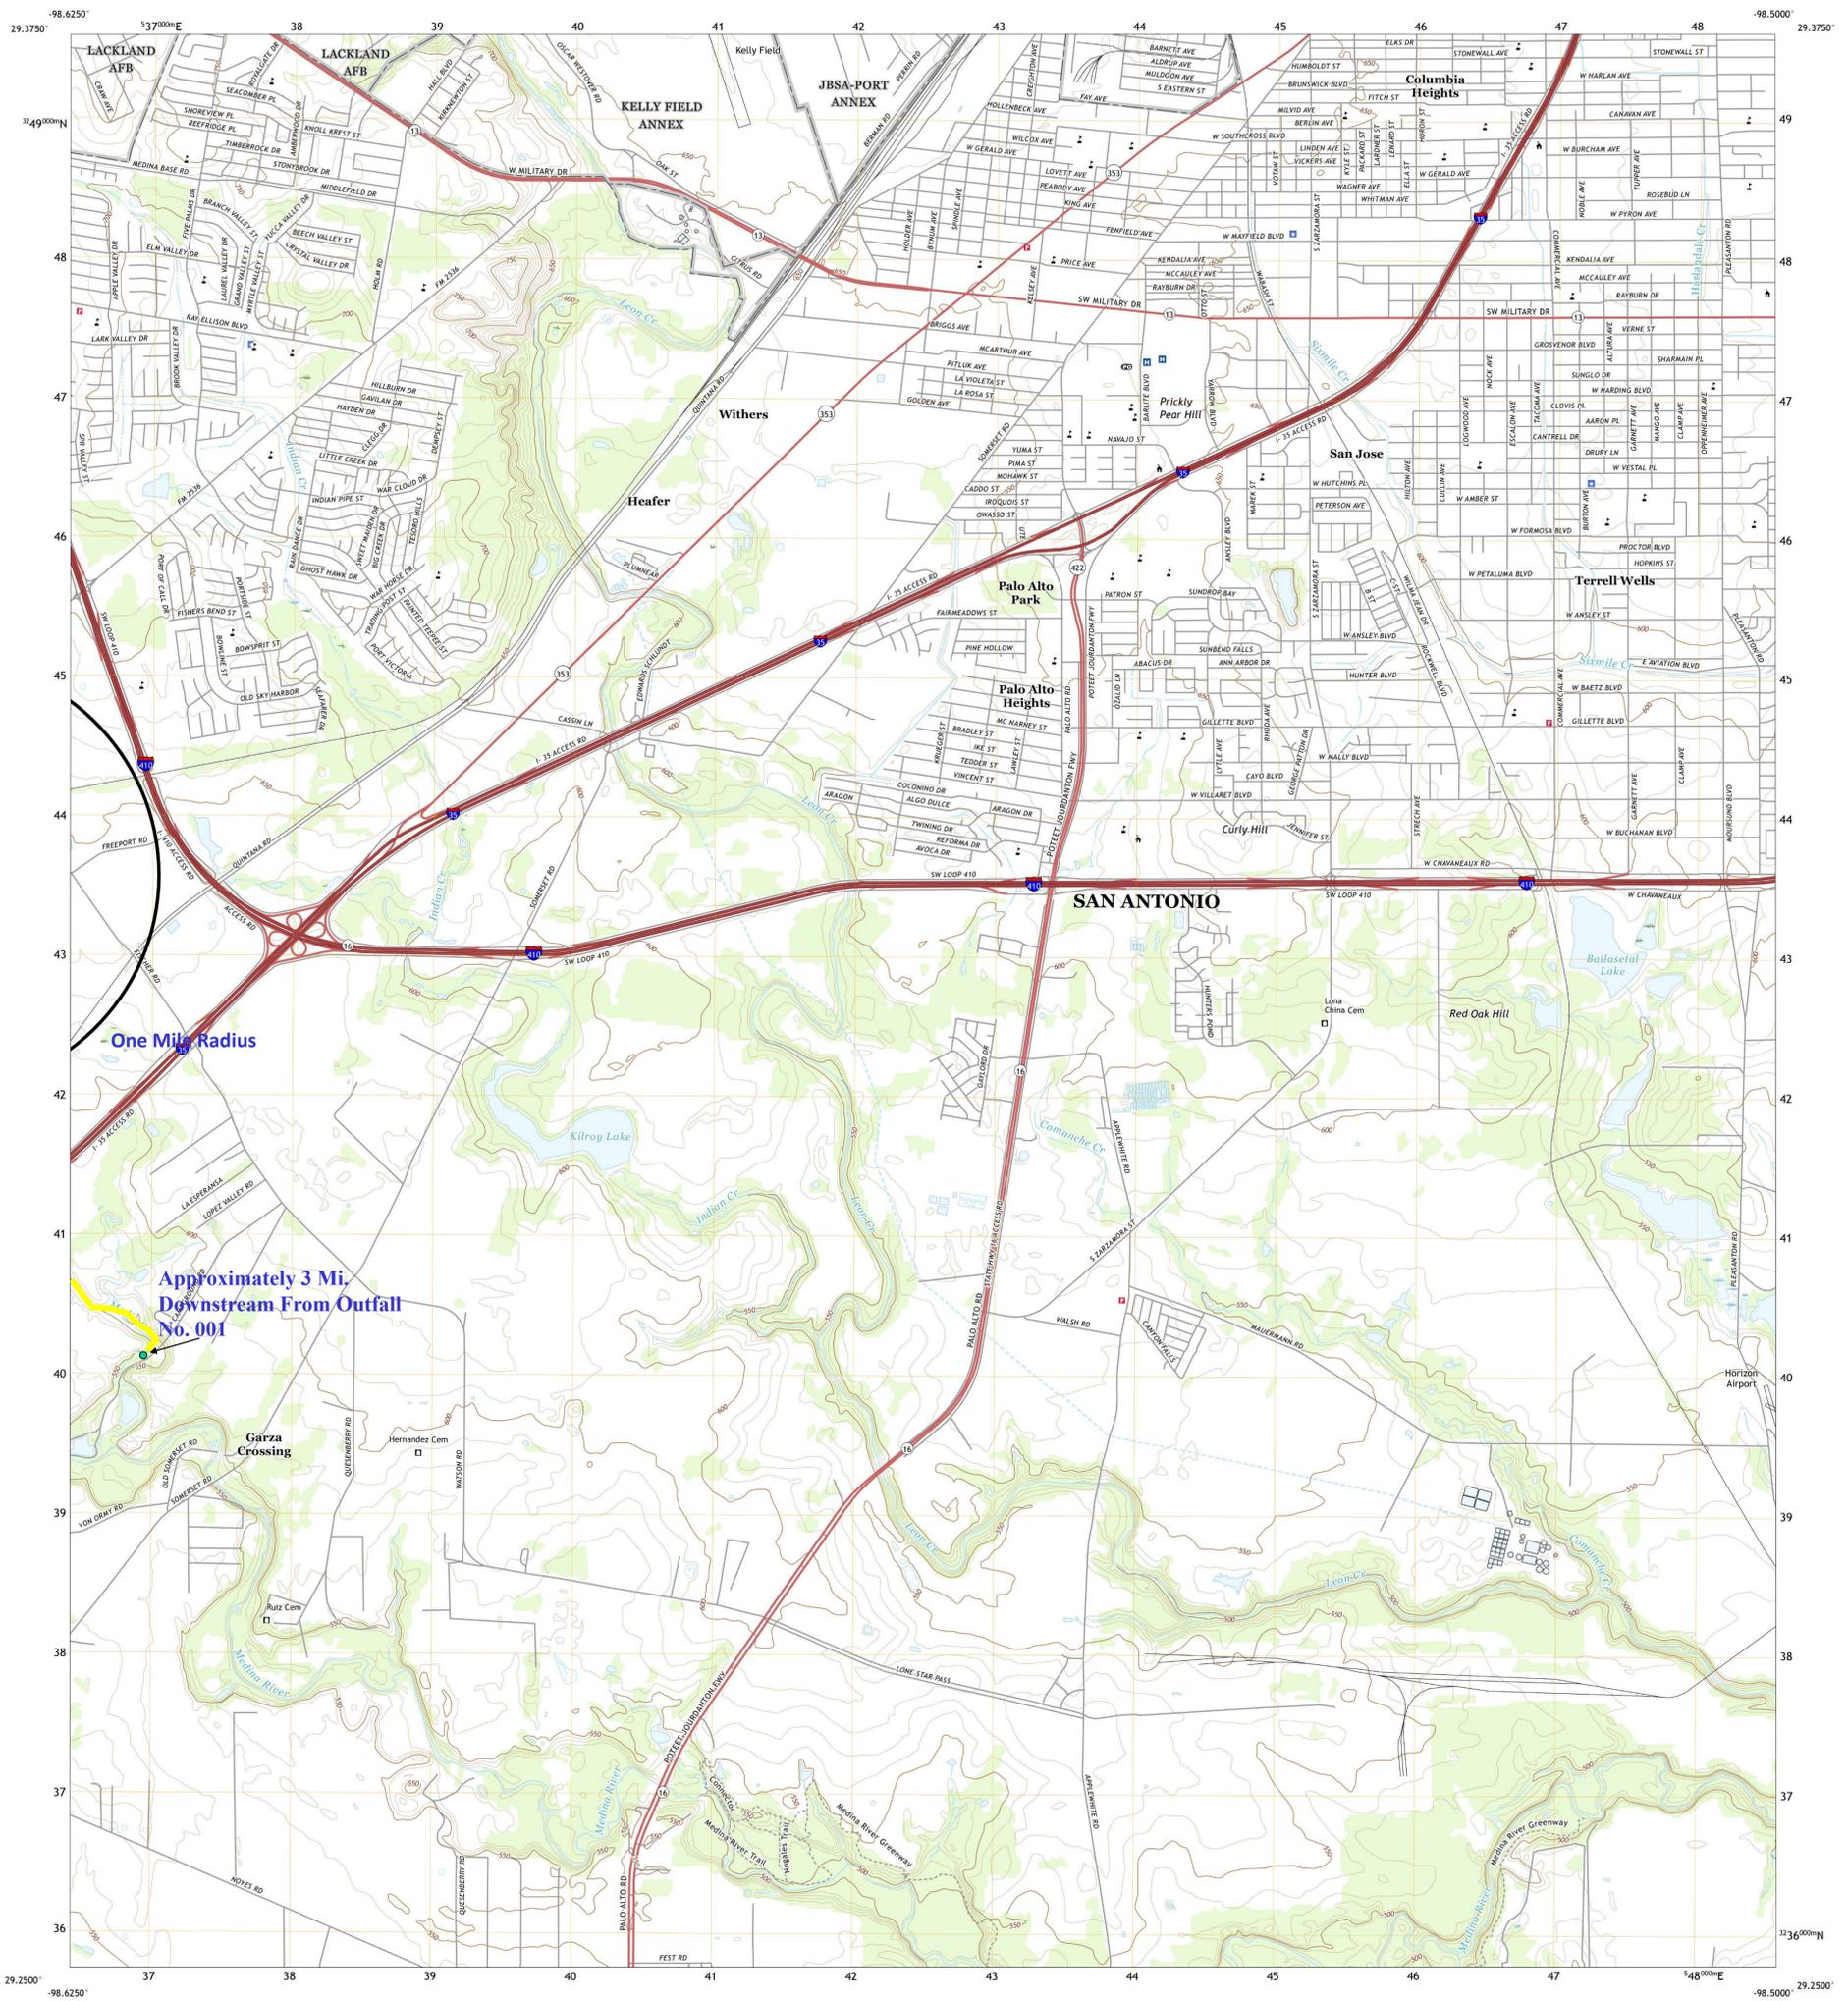

Produced by the United States Geological Survey North American Datum of 1983 (NAD83) World Geodetic System of 1984 (WGS84)...





Table with 3 columns: Quadrangle Number, Name, and Description. Includes entries for Culebra Hill, San Antonio West, San Antonio East, Macdonia, Southern, Somersett, Thelma, and Lesoya.



**TEXAS COMMISSION ON ENVIRONMENTAL QUALITY**  
**SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)**

**FOR AGENCIES REVIEWING DOMESTIC OR INDUSTRIAL  
TPDES WASTEWATER PERMIT APPLICATIONS**

**TCEQ USE ONLY:**

Application type:  Renewal  Major Amendment  Minor Amendment  New

County: \_\_\_\_\_ Segment Number: \_\_\_\_\_

Admin Complete Date: \_\_\_\_\_

Agency Receiving SPIF:

Texas Historical Commission

U.S. Fish and Wildlife

Texas Parks and Wildlife Department

U.S. Army Corps of Engineers

**This form applies to TPDES permit applications only.** (Instructions, Page 53)

Complete this form as a separate document. TCEQ will mail a copy to each agency as required by our agreement with EPA. If any of the items are not completely addressed or further information is needed, we will contact you to provide the information before issuing the permit. Address each item completely.

**Do not refer to your response to any item in the permit application form.** Provide each attachment for this form separately from the Administrative Report of the application. The application will not be declared administratively complete without this SPIF form being completed in its entirety including all attachments. Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at [WQ-ARPTeam@tceq.texas.gov](mailto:WQ-ARPTeam@tceq.texas.gov) or by phone at (512) 239-4671.

The following applies to all applications:

1. Permittee: San Antonio Water System

Permit No. WQ00 04437000

EPA ID No. TX 0125083

Address of the project (or a location description that includes street/highway, city/vicinity, and county):

6725 Moreno Street, approximately 1.6 miles northwest of the intersection of Interstate Highway 35 and Loop 410, southwest of the City of San Antonio, Bexar County, Texas 78073

Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.

Prefix (Mr., Ms., Miss): Ms.

First and Last Name: Floramie Welch

Credential (P.E, P.G., Ph.D., etc.): [REDACTED]

Title: Environmental Analyst III

Mailing Address: 2800 US Hwy 281 North

City, State, Zip Code: San Antonio, TX 78212

Phone No.: 210 233 3744 Ext.: [REDACTED] Fax No.: [REDACTED]

E-mail Address: Floramie.Welch@saws.org

2. List the county in which the facility is located: Bexar
3. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.

N/A

4. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the classified segment number.

To an unnamed ditch; thence to O.R. Mitchell Lake 1; thence to Medio Creek in Segment 1912 of the San Antonio River

5. Please provide a separate 7.5-minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required in addition to the map in the administrative report).

Provide original photographs of any structures 50 years or older on the property.

Does your project involve any of the following? Check all that apply.

- Proposed access roads, utility lines, construction easements
- Visual effects that could damage or detract from a historic property's integrity
- Vibration effects during construction or as a result of project design
- Additional phases of development that are planned for the future
- Sealing caves, fractures, sinkholes, other karst features

Disturbance of vegetation or wetlands

1. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features):

N/A

2. Describe existing disturbances, vegetation, and land use:

N/A


THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

3. List construction dates of all buildings and structures on the property:

N/A

4. Provide a brief history of the property, and name of the architect/builder, if known.

N/A

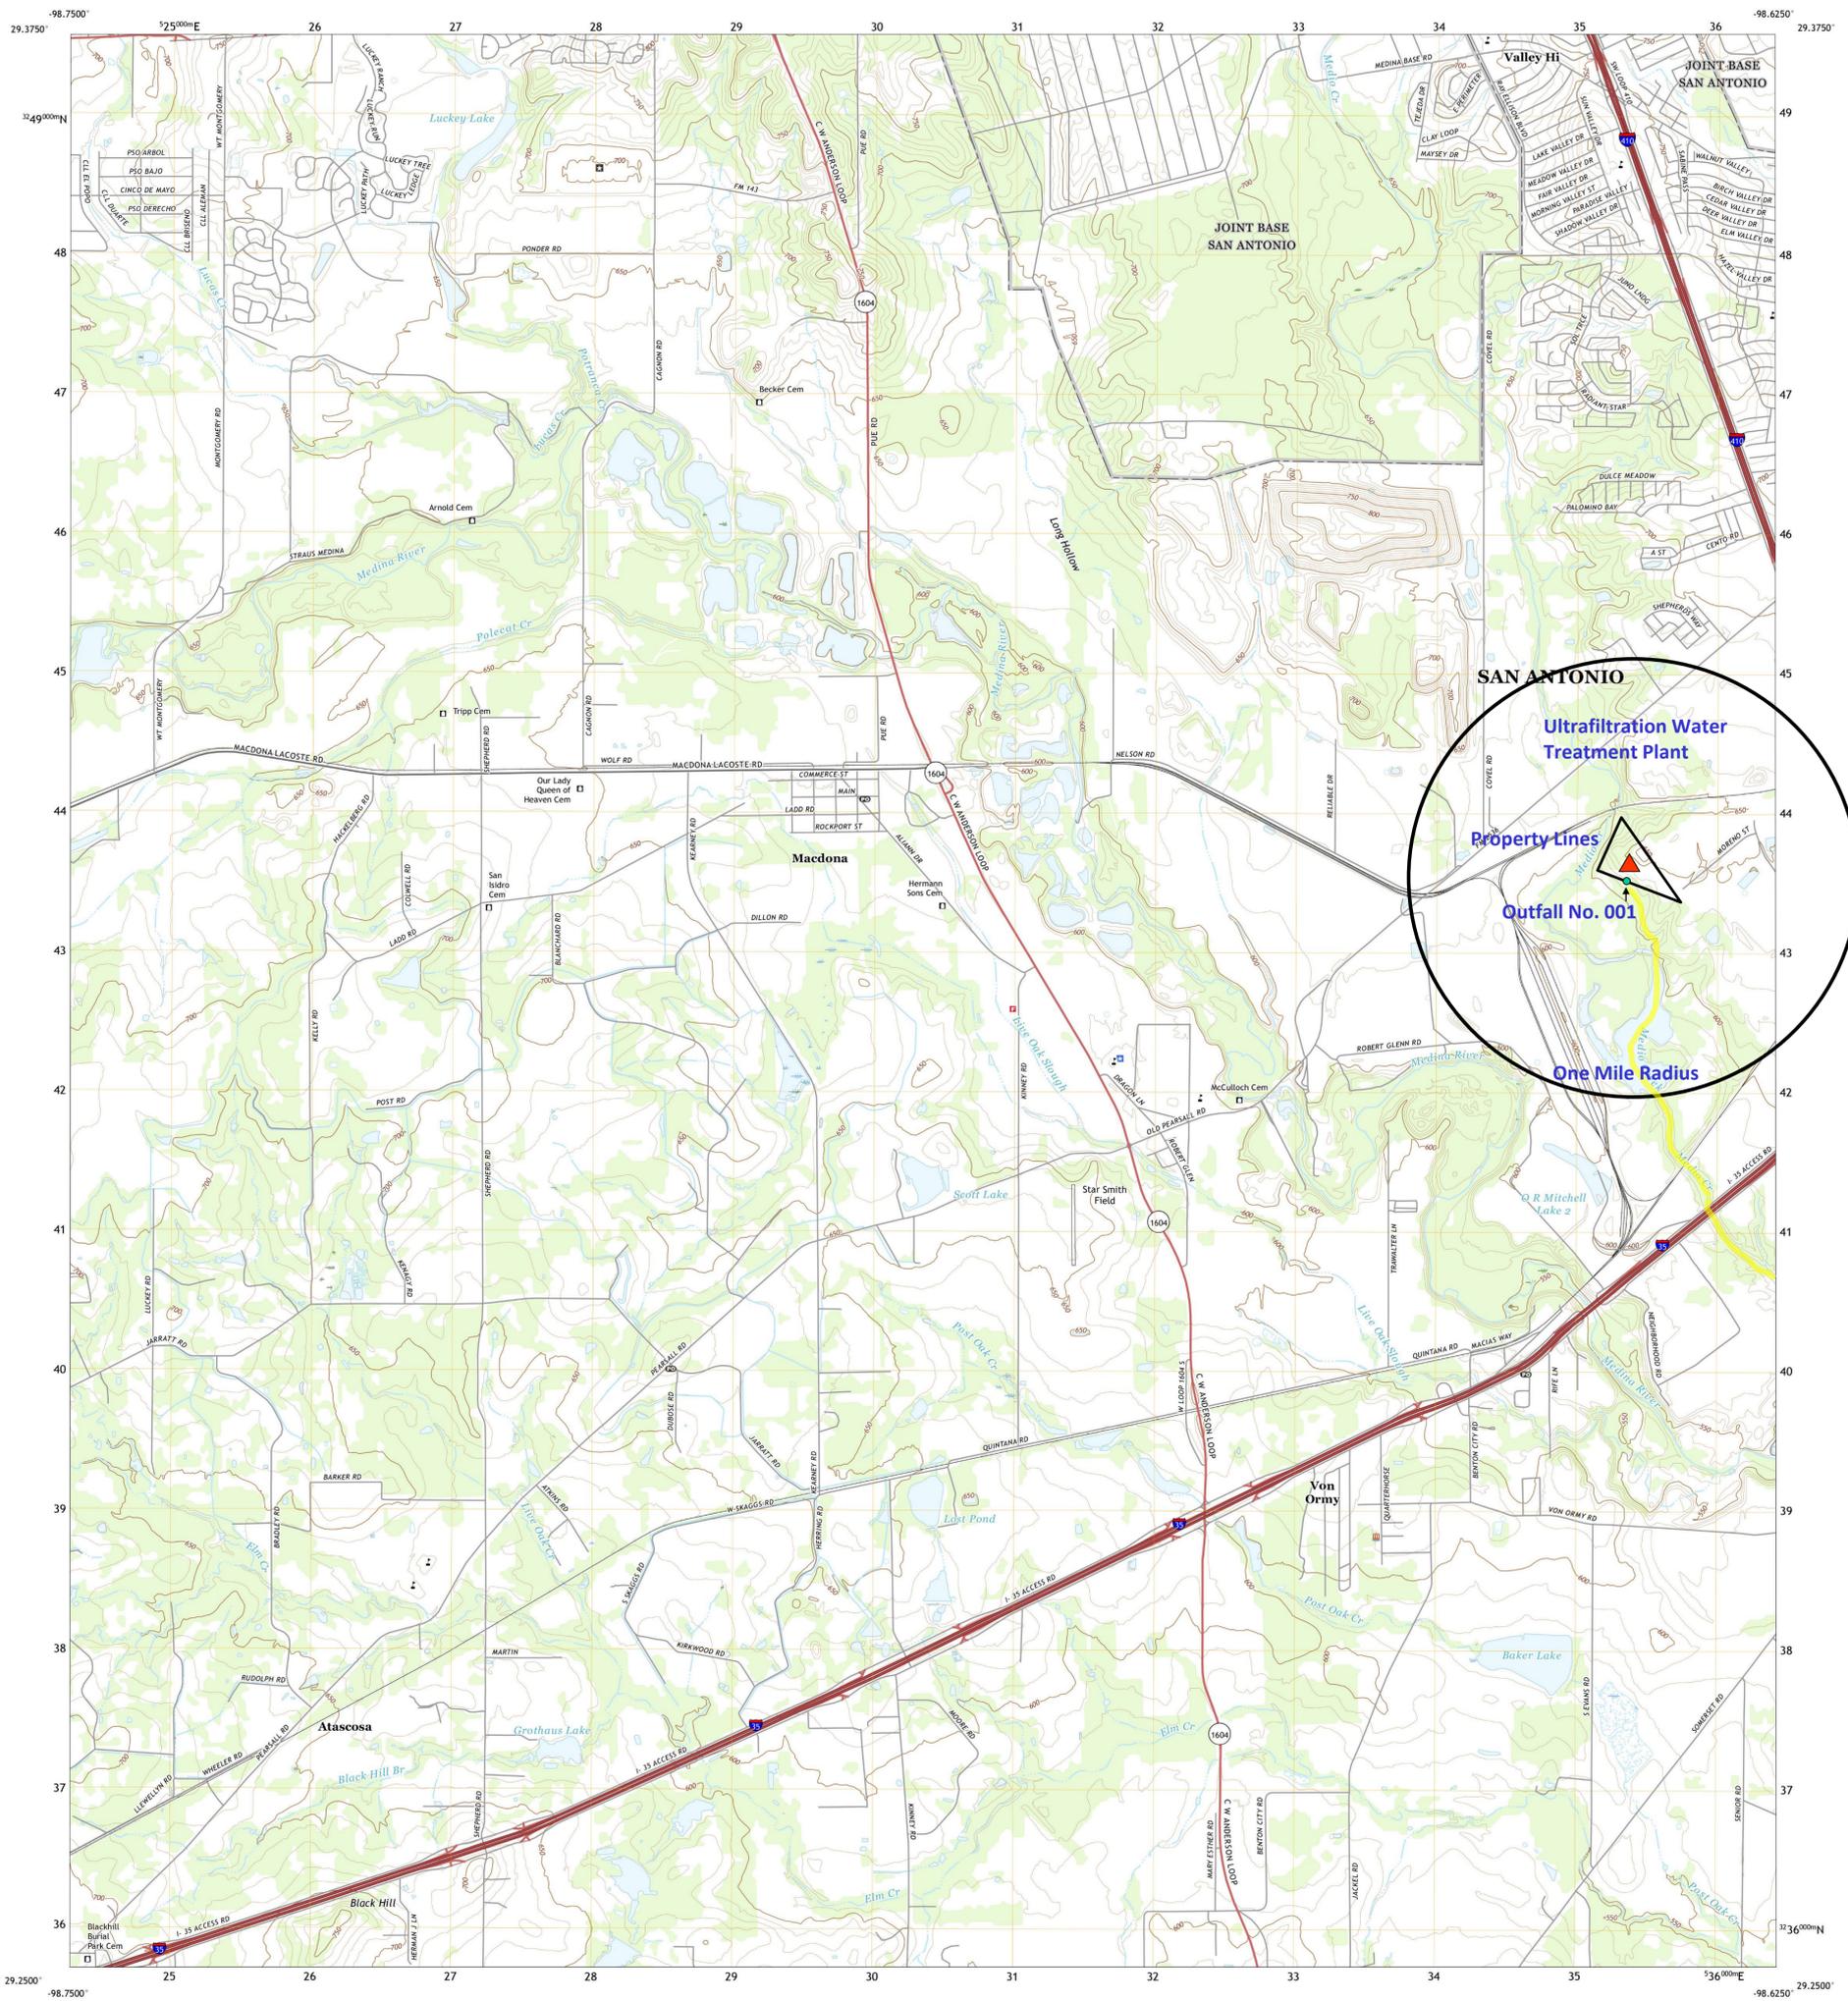

Produced by the United States Geological Survey
North American Datum of 1983 (NAD83)
World Geodetic System of 1984 (WGS84), Projection and 1 000-meter grid/Universal Transverse Mercator, Zone 14K
This map is not a legal document. Boundaries may be generalized for this map scale. Private lands within government reservations may not be shown. Obtain permission before entering private lands.





Table with 3 columns and 8 rows showing adjacent quadrangles and their names: 1 La Coste NE, 2 Calieba Hill, 3 San Antonio West, 4 La Coste, 5 Terrell Wells, 6 Lytle, 7 Somerset, 8 Thelma.

MACDONA, TX 2022



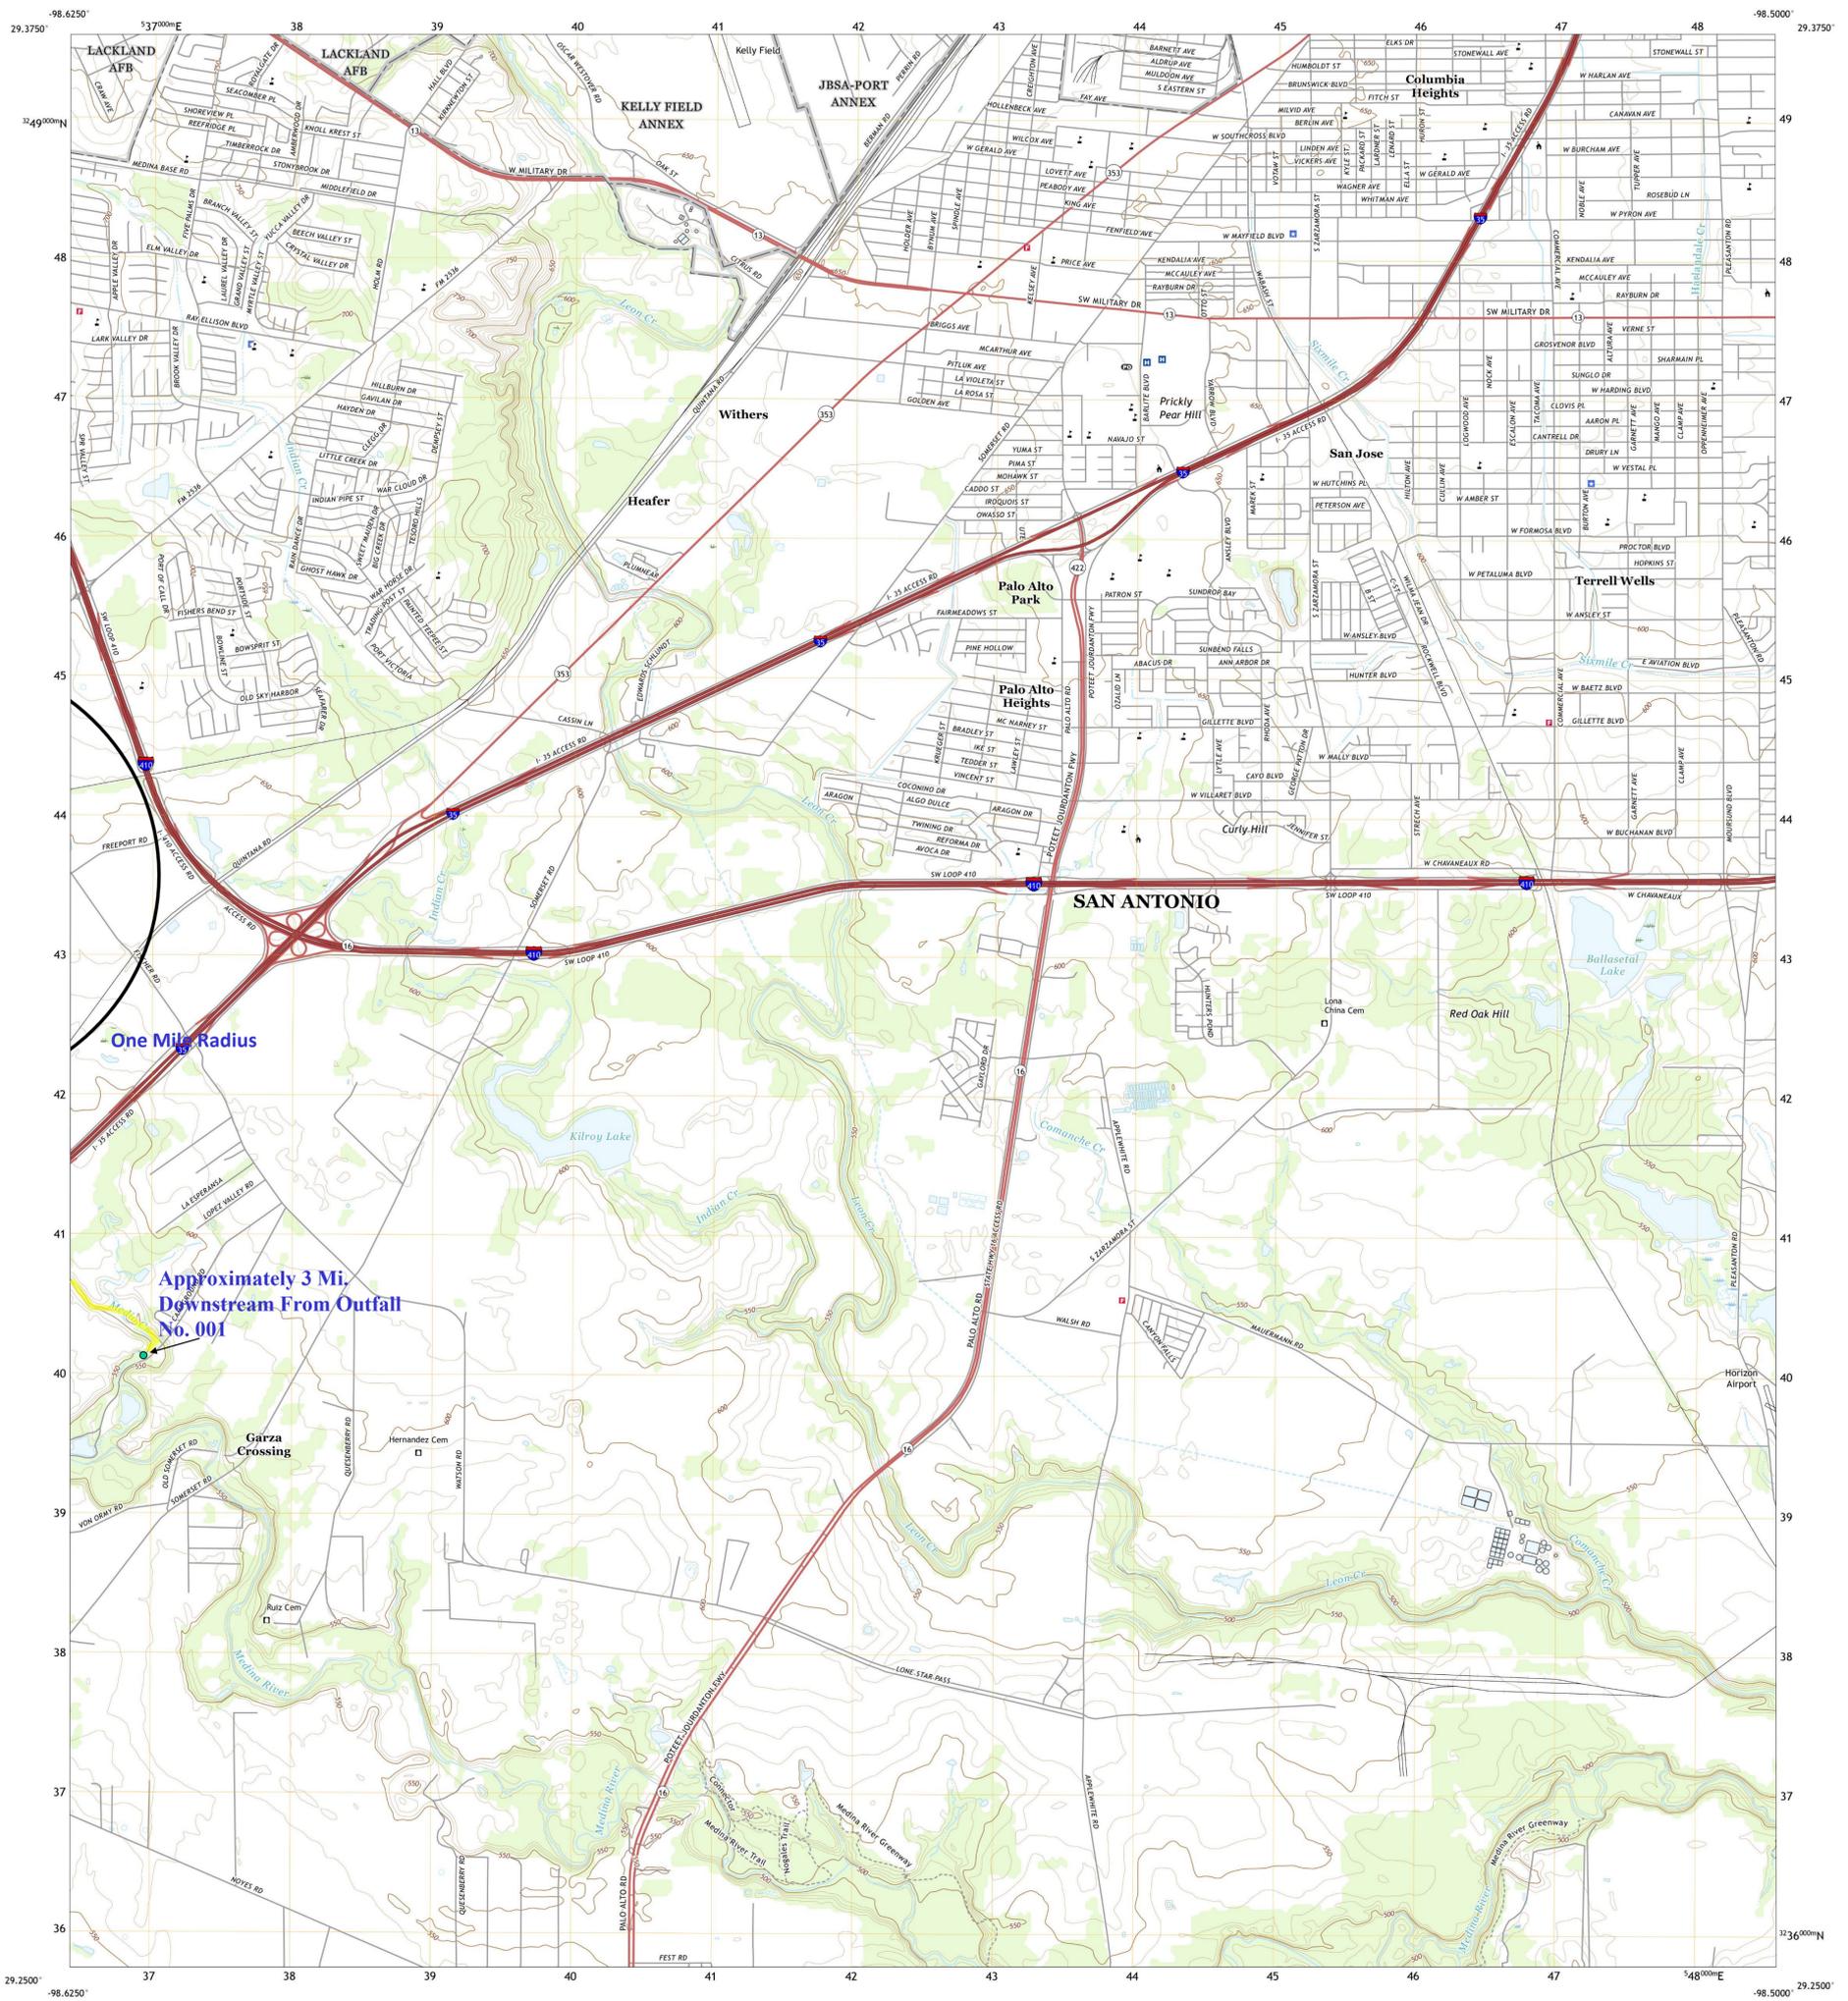

Produced by the United States Geological Survey North American Datum of 1983 (NAD83) World Geodetic System of 1984 (WGS84) Projection and 1 000 meter grid/Universal Transverse Mercator, Zone 14R. This map is not a legal document. Boundaries may be generalized for this map scale. Private lands within government reservations may not be shown. Obtain permission before entering private lands.



SCALE 1:24 000 CONTOUR INTERVAL 10 FEET NORTH AMERICAN VERTICAL DATUM OF 1988 This map was produced to conform with the National Geospatial Program US Topo Product Standard, 2011. A metadata file associated with this product is draft version 0.6.18



ROAD CLASSIFICATION

Expressway	Local Connector
Secondary Hwy	Local Road
Ramp	4WD
Interstate Route	US Route
	State Route

ADJOINING QUADRANGLES

1	2	3
4	5	6
7	8	

1 Culebra Hill  
2 San Antonio West  
3 San Antonio East  
4 Macdonia  
5 Southern  
6 Somerset  
7 Thelma  
8 Lesoya



# Ultrafiltration Water Treatment Plant





# TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

## INDUSTRIAL WASTEWATER PERMIT APPLICATION TECHNICAL REPORT 1.0

The following information **is required** for all applications for a TLAP or an individual TPDES discharge permit.

For **additional information** or clarification on the requested information, please refer to the [Instructions for Completing the Industrial Wastewater Permit Application](#)<sup>1</sup> available on the TCEQ website. Please contact the Industrial Permits Team at 512-239-4671 with any questions about this form.

If more than one outfall is included in the application, provide applicable information for each individual outfall. **If an item does not apply to the facility, enter N/A** to indicate that the item has been considered. Include separate reports or additional sheets as **clearly cross-referenced attachments** and provide the attachment number in the space provided for the item the attachment addresses.

**NOTE:** This application is for an industrial wastewater permit only. Additional authorizations from the TCEQ Waste Permits Division or the TCEQ Air Permits Division may be needed.

### Item 1. Facility/Site Information (Instructions, Page 39)

- a. Describe the general nature of the business and type(s) of industrial and commercial activities. Include all applicable SIC codes (up to 4).

Potable Water Treatment. SIC Code: 4941 NAICS Code: 221310

- b. Describe all wastewater-generating processes at the facility.

Under normal operating conditions, the facility does not produce wastewater. All water in the process is recycled and/or lost to evaporation of the river sediments in storage lagoons. Periodically, the turbidity level of the source water (Medina River) exceeds 500 NTU, and the flow to the ultra-filtration membranes automatically shuts off. The super flocculating clarifier is designed to continue in operation to maintain the "floc". When this condition occurs, discharging wastewater is required.

---

<sup>1</sup>  
[https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES\\_industrial\\_wastewater\\_steps.html](https://www.tceq.texas.gov/permitting/wastewater/industrial/TPDES_industrial_wastewater_steps.html)

c. Provide a list of raw materials, major intermediates, and final products handled at the facility.

**Materials List**

Raw Materials	Intermediate Products	Final Products
Medina River Water		

**Attachment:** N/A

d. Attach a facility map (drawn to scale) with the following information:

- Production areas, maintenance areas, materials-handling areas, waste-disposal areas, and water intake structures.
- The location of each unit of the WWTP including the location of wastewater collection sumps, impoundments, outfalls, and sampling points, if significantly different from outfall locations.

**Attachment:** N/A

e. Is this a new permit application for an existing facility?

- Yes       No

If **yes**, provide background discussion: N/A

f. Is/will the treatment facility/disposal site be located above the 100-year frequency flood level.

- Yes       No

List source(s) used to determine 100-year frequency flood plain: FEMA Maps for Bexar County

If **no**, provide the elevation of the 100-year frequency flood plain and describe what protective measures are used/proposed to prevent flooding (including tail water and rainfall run-on controls) of the treatment facility and disposal area: N/A

**Attachment:** N/A

g. For **new** or **major amendment** permit applications, will any construction operations result in a discharge of fill material into a water in the state?

- Yes       No       N/A (renewal only)

h. If **yes** to Item 1.g, has the applicant applied for a USACE CWA Chapter 404 Dredge and Fill permit?

- Yes       No

If **yes**, provide the permit number: N/A

If **no**, provide an approximate date of application submittal to the USACE: N/A

## Item 2. Treatment System (Instructions, Page 40)

a. List any physical, chemical, or biological treatment process(es) used/proposed to treat wastewater at this facility. Include a description of each treatment process, starting with initial treatment and finishing with the outfall/point of disposal.

Under normal operating conditions, the facility does not produce wastewater. All water in the process is recycled and/or lost to evaporation of the river sediments in storage lagoons. Periodically, the turbidity level of the source water (Medina River) exceeds 500 NTU, and the flow to the ultra-filtration membranes automatically shuts off. The super flocculating clarifier is designed to continue in operation to maintain the “floc”. When this condition occurs, discharging wastewater is required.

b. Attach a flow schematic **with a water balance** showing all sources of water and wastewater flow into the facility, wastewater flow into and from each treatment unit, and wastewater flow to each outfall/point of disposal.

**Attachment:** N/A

## Item 3. Impoundments (Instructions, Page 40)

Does the facility use or plan to use any wastewater impoundments (e.g., lagoons or ponds?)

- Yes     No

If **no**, proceed to Item 4. If **yes**, complete **Item 3.a** for **existing** impoundments and **Items 3.a - 3.e** for **new or proposed** impoundments. **NOTE:** See instructions, Pages 40-42, for additional information on the attachments required by Items 3.a - 3.e.

a. Complete the table with the following information for each existing, new, or proposed impoundment. Attach additional copies of the Impoundment Information table, if needed.

**Use Designation:** Indicate the use designation for each impoundment as Treatment (T), Disposal (D), Containment (C), or Evaporation (E).

**Associated Outfall Number:** Provide an outfall number if a discharge occurs or will occur.

**Liner Type:** Indicate the liner type as Compacted clay liner (C), In-situ clay liner (I), Synthetic/plastic/rubber liner (S), or Alternate liner (A). **NOTE:** See instructions for further detail on liner specifications. If an alternate liner (A) is selected, include an attachment that provides a description of the alternate liner and any additional technical information necessary for an evaluation.

**Leak Detection System:** If any leak detection systems are in place/planned, enter Y for yes. Otherwise, enter N for no.

**Groundwater Monitoring Wells and Data:** If groundwater monitoring wells are in place/planned, enter Y for yes. Otherwise, enter N for no. Attach any existing groundwater monitoring data.

**Dimensions:** Provide the dimensions, freeboard, surface area, storage capacity of the impoundments, and the maximum depth (not including freeboard). For impoundments with irregular shapes, submit surface area instead of length and width.

**Compliance with 40 CFR Part 257, Subpart D:** If the impoundment is required to be in compliance with 40 CFR Part 257, Subpart D, enter Y for yes. Otherwise, enter N for no.

**Date of Construction:** Enter the date construction of the impoundment commenced (mm/dd/yy).

**Impoundment Information**

Parameter	Pond #	Pond #	Pond #	Pond #
Use Designation: (T) (D) (C) or (E)				
Associated Outfall Number				
Liner Type (C) (I) (S) or (A)				
Alt. Liner Attachment Reference				
Leak Detection System, Y/N				
Groundwater Monitoring Wells, Y/N				
Groundwater Monitoring Data Attachment				
Pond Bottom Located Above The Seasonal High-Water Table, Y/N				
Length (ft)				
Width (ft)				
Max Depth From Water Surface (ft), Not Including Freeboard				
Freeboard (ft)				
Surface Area (acres)				
Storage Capacity (gallons)				
40 CFR Part 257, Subpart D, Y/N				
Date of Construction				

**Attachment:** N/A

The following information (**Items 3.b – 3.e**) is required only for **new or proposed** impoundments.

b. For new or proposed impoundments, attach any available information on the following items. If attached, check **yes** in the appropriate box. Otherwise, check **no** or **not yet designed**.

1. Liner data

Yes       No       Not yet designed

2. Leak detection system or groundwater monitoring data

Yes       No       Not yet designed

3. Groundwater impacts

Yes       No       Not yet designed

**NOTE:** Item b.3 is required if the bottom of the pond is not above the seasonal high-water table in the shallowest water-bearing zone.

**Attachment:** N/A

**For TLAP applications:** Items 3.c – 3.e are **not required**, continue to Item 4.

c. Attach a USGS map or a color copy of original quality and scale which accurately locates and identifies all known water supply wells and monitor wells within ½-mile of the impoundments.

**Attachment:** N/A

d. Attach copies of State Water Well Reports (e.g., driller’s logs, completion data, etc.), and data on depths to groundwater for all known water supply wells including a description of how the depths to groundwater were obtained.

**Attachment:** N/A

e. Attach information pertaining to the groundwater, soils, geology, pond liner, etc. used to assess the potential for migration of wastes from the impoundments or the potential for contamination of groundwater or surface water.

**Attachment:** N/A

## Item 4. Outfall/Disposal Method Information (Instructions, Page 42)

Complete the following tables to describe the location and wastewater discharge or disposal operations for each outfall for discharge, and for each point of disposal for TLAP operations.

If there are more outfalls/points of disposal at the facility than the spaces provided, copies of pages 6 and/or numbered accordingly (i.e., page 6a, 6b, etc.) may be used to provide information on the additional outfalls.

**For TLAP applications:** Indicate the disposal method and each individual irrigation area **I**, evaporation pond **E**, or subsurface drainage system **S** by providing the appropriate letter designation for the disposal method followed by a numerical designation for each disposal area in the space provided for **Outfall** number (e.g. **E1** for evaporation pond 1, **I2** for irrigation area No. 2, etc.).

**Outfall Longitude and Latitude**

Outfall No.	Latitude (Decimal Degrees)	Longitude (Decimal Degrees)
001	29.320278	-98.635556

**Outfall Location Description**

Outfall No.	Location Description
001	4-8" pipes along fence line discharging to a ditch

**Description of Sampling Point(s) (if different from Outfall location)**

Outfall No.	Description of sampling point
N/A	

**Outfall Flow Information - Permitted and Proposed**

Outfall No.	Permitted Daily Avg Flow (MGD)	Permitted Daily Max Flow (MGD)	Proposed Daily Avg Flow (MGD)	Proposed Daily Max Flow (MGD)	Anticipated Discharge Date (mm/dd/yy)
N/A					

**Outfall Discharge - Method and Measurement**

Outfall No.	Pumped Discharge? Y/N	Gravity Discharge? Y/N	Type of Flow Measurement Device Used
001	N	Y	N/A

**Outfall Discharge - Flow Characteristics**

Outfall No.	Intermittent Discharge? Y/N	Continuous Discharge? Y/N	Seasonal Discharge? Y/N	Discharge Duration (hrs/day)	Discharge Duration (days/mo)	Discharge Duration (mo/yr)
001	Y	N	N	N/A	N/A	N/A

**Outfall Wastestream Contributions**

**Outfall No. 001**

<b>Contributing Wastestream</b>	<b>Volume (MGD)</b>	<b>Percent (%) of Total Flow</b>
Wastewater from Super Pulsator	Intermittent & Variable	100

**Outfall No. N/A**

<b>Contributing Wastestream</b>	<b>Volume (MGD)</b>	<b>Percent (%) of Total Flow</b>

**Outfall No. N/A**

<b>Contributing Wastestream</b>	<b>Volume (MGD)</b>	<b>Percent (%) of Total Flow</b>

**Attachment: N/A**

## Item 5. Blowdown and Once-Through Cooling Water Discharges (Instructions, Page 43)

a. Indicate if the facility currently or proposes to:

- Yes  No      Use cooling towers that discharge blowdown or other wastestreams
- Yes  No      Use boilers that discharge blowdown or other wastestreams
- Yes  No      Discharge once-through cooling water

**NOTE:** If the facility uses or plans to use cooling towers or once-through cooling water, Item 12 is required.

b. If **yes** to any of the above, attach an SDS with the following information for each chemical additive.

- Manufacturers Product Identification Number
- Product use (e.g., biocide, fungicide, corrosion inhibitor, etc.)
- Chemical composition including CASRN for each ingredient
- Classify product as non-persistent, persistent, or bioaccumulative
- Product or active ingredient half-life
- Frequency of product use (e.g., 2 hours/day once every two weeks)
- Product toxicity data specific to fish and aquatic invertebrate organisms
- Concentration of whole product or active ingredient, as appropriate, in wastestream.

In addition to each SDS, attach a summary of the above information for each specific wastestream and the associated chemical additives. Specify which outfalls are affected.

**Attachment:** N/A

c. Cooling Towers and Boilers

If the facility currently or proposes to use cooling towers or boilers that discharge blowdown or other wastestreams to the outfall(s), complete the following table.

### Cooling Towers and Boilers

Type of Unit	Number of Units	Daily Avg Blowdown (gallons/day)	Daily Max Blowdown (gallons/day)
Cooling Towers			
Boilers			

## Item 6. Stormwater Management (Instructions, Page 44)

Will any existing/proposed outfalls discharge stormwater associated with industrial activities, as defined at 40 CFR § 122.26(b)(14), commingled with any other wastestream?

- Yes  No

If **yes**, briefly describe the industrial processes and activities that occur outdoors or in a manner which may result in exposure of the activities or materials to stormwater: N/A

## Item 7. Domestic Sewage, Sewage Sludge, and Septage Management and Disposal (Instructions, Page 44)

**Domestic Sewage** - Waste and wastewater from humans or household operations that is discharged to a wastewater collection system or otherwise enters a treatment works.

- a. Check the box next to the appropriate method of domestic sewage and domestic sewage sludge treatment or disposal. Complete Worksheet 5.0 or Item 7.b if directed to do so.
- Domestic sewage is routed (i.e., connected to or transported to) to a WWTP permitted to receive domestic sewage for treatment, disposal, or both. Complete Item 7.b.
  - Domestic sewage disposed of by an on-site septic tank and drainfield system. Complete Item 7.b.
  - Domestic and industrial treatment sludge ARE commingled prior to use or disposal.
  - Industrial wastewater and domestic sewage are treated separately, and the respective sludge IS NOT commingled prior to sludge use or disposal. Complete Worksheet 5.0.
  - Facility is a POTW. Complete Worksheet 5.0.
  - Domestic sewage is not generated on-site.
  - Other (e.g., portable toilets), specify and Complete Item 7.b: N/A
- b. Provide the name and TCEQ, NPDES, or TPDES Permit No. of the waste-disposal facility which receives the domestic sewage/septage. If hauled by motorized vehicle, provide the name and TCEQ Registration No. of the hauler.

**Domestic Sewage Plant/Hauler Name**

Plant/Hauler Name	Permit/Registration No.

## Item 8. Improvements or Compliance/Enforcement Requirements (Instructions, Page 45)

- a. Is the permittee currently required to meet any implementation schedule for compliance or enforcement?
- Yes    No
- b. Has the permittee completed or planned for any improvements or construction projects?
- Yes    No
- c. If **yes** to either 8.a or 8.b, provide a brief summary of the requirements and a status update: N/A

## Item 9. Toxicity Testing (Instructions, Page 45)

Have any biological tests for acute or chronic toxicity been made on any of the discharges or on a receiving water in relation to the discharge within the last three years?

Yes  No

If **yes**, identify the tests and describe their purposes: N/A

Additionally, attach a copy of all tests performed which **have not** been submitted to the TCEQ or EPA. **Attachment:** N/A

## Item 10. Off-Site/Third Party Wastes (Instructions, Page 45)

a. Does or will the facility receive wastes from off-site sources for treatment at the facility, disposal on-site via land application, or discharge via a permitted outfall?

Yes  No

If **yes**, provide responses to Items 10.b through 10.d below.

If **no**, proceed to Item 11.

b. Attach the following information to the application:

- List of wastes received (including volumes, characterization, and capability with on-site wastes).
- Identify the sources of wastes received (including the legal name and addresses of the generators).
- Description of the relationship of waste source(s) with the facility's activities.

**Attachment:** N/A

c. Is or will wastewater from another TCEQ, NPDES, or TPDES permitted facility commingled with this facility's wastewater after final treatment and prior to discharge via the final outfall/point of disposal?

Yes  No

If **yes**, provide the name, address, and TCEQ, NPDES, or TPDES permit number of the contributing facility and a copy of any agreements or contracts relating to this activity.

**Attachment:** N/A

d. Is this facility a POTW that accepts/will accept process wastewater from any SIU and has/is required to have an approved pretreatment program under the NPDES/TPDES program?

Yes  No

If **yes**, **Worksheet 6.0** of this application is required.

## Item 11. Radioactive Materials (Instructions, Page 46)

a. Are/will radioactive materials be mined, used, stored, or processed at this facility?

Yes  No

If **yes**, use the following table to provide the results of one analysis of the effluent for all radioactive materials that may be present. Provide results in pCi/L.

**Radioactive Materials Mined, Used, Stored, or Processed**

Radioactive Material Name	Concentration (pCi/L)

b. Does the applicant or anyone at the facility have any knowledge or reason to believe that radioactive materials may be present in the discharge, including naturally occurring radioactive materials in the source waters or on the facility property?

- Yes  No

If **yes**, use the following table to provide the results of one analysis of the effluent for all radioactive materials that may be present. Provide results in pCi/L. Do not include information provided in response to Item 11.a.

**Radioactive Materials Present in the Discharge**

Radioactive Material Name	Concentration (pCi/L)

**Item 12. Cooling Water (Instructions, Page 46)**

a. Does the facility use or propose to use water for cooling purposes?

- Yes  No

If **no**, stop here. If **yes**, complete Items 12.b thru 12.f.

b. Cooling water is/will be obtained from a groundwater source (e.g., on-site well).

- Yes  No

If **yes**, stop here. If **no**, continue.

c. Cooling Water Supplier

1. Provide the name of the owner(s) and operator(s) for the CWIS that supplies or will supply water for cooling purposes to the facility.

**Cooling Water Intake Structure(s) Owner(s) and Operator(s)**

<b>CWIS ID</b>				
<b>Owner</b>				
<b>Operator</b>				

2. Cooling water is/will be obtained from a Public Water Supplier (PWS)

- Yes       No

If **no**, continue. If **yes**, provide the PWS Registration No. and stop here: PWS No. N/A

3. Cooling water is/will be obtained from a reclaimed water source?

- Yes       No

If **no**, continue. If **yes**, provide the Reuse Authorization No. and stop here: N/A

4. Cooling water is/will be obtained from an Independent Supplier

- Yes       No

If **no**, proceed to Item 12.d. If **yes**, provide the actual intake flow of the Independent Supplier's CWIS that is/will be used to provide water for cooling purposes and proceed: N/A

d. 316(b) General Criteria

1. The CWIS(s) used to provide water for cooling purposes to the facility has or will have a cumulative design intake flow of 2 MGD or greater.

- Yes       No

2. At least 25% of the total water withdrawn by the CWIS is/will be used at the facility exclusively for cooling purposes on an annual average basis.

- Yes       No

3. The CWIS(s) withdraw(s)/propose(s) to withdraw water for cooling purposes from surface waters that meet the definition of Waters of the United States in *40 CFR § 122.2*.

- Yes       No

If **no**, provide an explanation of how the waterbody does not meet the definition of Waters of the United States in *40 CFR § 122.2*: N/A

If **yes** to all three questions in Item 12.d, the facility **meets** the minimum criteria to be subject to the full requirements of Section 316(b) of the CWA. Proceed to **Item 12.f**.

If **no** to any of the questions in Item 12.d, the facility **does not meet** the minimum criteria to be subject to the full requirements of Section 316(b) of the CWA; however, a determination is required based upon BPJ. Proceed to **Item 12.e**.

e. The facility does not meet the minimum requirements to be subject to the fill requirements of Section 316(b) **and uses/proposes to use cooling towers**.

- Yes       No

If **yes**, stop here. If **no**, complete Worksheet 11.0, Items 1.a, 1.b.1-3 and 6, 2.b.1, and 3.a to allow for a determination based upon BPJ.

f. Oil and Gas Exploration and Production

1. The facility is subject to requirements at 40 CFR Part 435, Subparts A or D.

- Yes       No

If **yes**, continue. If **no**, skip to Item 12.g.

2. The facility is an existing facility as defined at 40 CFR § 125.92(k) or a new unit at an existing facility as defined at 40 CFR § 125.92(u).

Yes       No

If **yes**, complete Worksheet 11.0, Items 1.a, 1.b.1-3 and 6, 2.b.1, and 3.a to allow for a determination based upon BPJ. If **no**, skip to Item 12.g.3.

g. Compliance Phase and Track Selection

1. Phase I - New facility subject to 40 CFR Part 125, Subpart I

Yes       No

If **yes**, check the box next to the compliance track selection, attach the requested information, and complete Worksheet 11.0, Items 2 and 3, and Worksheet 11.2.

- Track I - AIF greater than 2 MGD, but less than 10 MGD

- Attach information required by 40 CFR §§ 125.86(b)(2)-(4).

- Track I - AIF greater than 10 MGD

- Attach information required by 40 CFR § 125.86(b).

- Track II

- Attach information required by 40 CFR § 125.86(c).

**Attachment:** N/A

2. Phase II - Existing facility subject to 40 CFR Part 125, Subpart J

Yes       No

If **yes**, complete Worksheets 11.0 through 11.3, as applicable.

3. Phase III - New facility subject to 40 CFR Part 125, Subpart N

Yes       No

If **yes**, check the box next to the compliance track selection and provide the requested information.

- Track I - Fixed facility

- Attach information required by 40 CFR § 125.136(b) and complete Worksheet 11.0, Items 2 and 3, and Worksheet 11.2.

- Track I - Not a fixed facility

- Attach information required by 40 CFR § 125.136(b) and complete Worksheet 11.0, Item 2 (except CWIS latitude/longitude under Item 2.a).

- Track II - Fixed facility

- Attach information required by 40 CFR § 125.136(c) and complete Worksheet 11.0, Items 2 and 3.

**Attachment:** N/A

## Item 13. Permit Change Requests (Instructions, Page 48)

This item is only applicable to existing permitted facilities.

a. Is the facility requesting a **major amendment** of an existing permit?

Yes       No

If **yes**, list each request individually and provide the following information: 1) detailed information regarding the scope of each request and 2) a justification for each request. Attach any supplemental information or additional data to support each request.

N/A

b. Is the facility requesting any **minor amendments** to the permit?

Yes       No

If **yes**, list and describe each change individually.

N/A

c. Is the facility requesting any **minor modifications** to the permit?

Yes       No

If **yes**, list and describe each change individually.

N/A

## Item 14. Laboratory Accreditation (Instructions, Page 49)

All laboratory tests performed must meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*, which includes the following general exemptions from National Environmental Laboratory Accreditation Program (NELAP) certification requirements:

- The laboratory is an in-house laboratory and is:
  - periodically inspected by the TCEQ; or
  - located in another state and is accredited or inspected by that state; or
  - performing work for another company with a unit located in the same site; or
  - performing pro bono work for a governmental agency or charitable organization.
- The laboratory is accredited under federal law.
- The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review *30 TAC Chapter 25* for specific requirements.


The following certification statement shall be signed and submitted with every application. See the *Signature Page* section in the Instructions, for a list of designated representatives who may sign the certification.

### CERTIFICATION:

I certify that all laboratory tests submitted with this application meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*.

Printed Name: Jeff Haby, P.E.

Title: Sr. Vice President, Production Operations

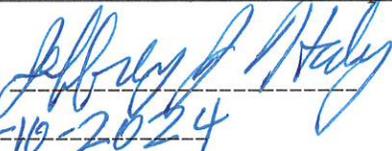Signature: 

Date: 7-10-2024

## Item 14. Laboratory Accreditation (Instructions, Page 49)

All laboratory tests performed must meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*, which includes the following general exemptions from National Environmental Laboratory Accreditation Program (NELAP) certification requirements:

- The laboratory is an in-house laboratory and is:
  - periodically inspected by the TCEQ; or
  - located in another state and is accredited or inspected by that state; or
  - performing work for another company with a unit located in the same site; or
  - performing pro bono work for a governmental agency or charitable organization.
- The laboratory is accredited under federal law.
- The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review *30 TAC Chapter 25* for specific requirements.

The following certification statement shall be signed and submitted with every application. See the *Signature Page* section in the Instructions, for a list of designated representatives who may sign the certification.

### CERTIFICATION:

I certify that all laboratory tests submitted with this application meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*.

Printed Name: Jeff Haby, P.E.

Title: Sr. Vice President, Production Operations

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 1.0: EPA CATEGORICAL EFFLUENT GUIDELINES

This worksheet **is required** for all applications for TPDES permits for discharges of wastewaters subject to EPA categorical effluent limitation guidelines (ELGs).

## Item 1. Categorical Industries (Instructions, Page 53)

Is this facility subject to any 40 CFR categorical ELGs outlined on page 53 of the instructions?

Yes  No

If **no**, this worksheet is not required. If **yes**, provide the appropriate information below.

### 40 CFR Effluent Guideline

Industry	40 CFR Part

## Item 2. Production/Process Data (Instructions, Page 54)

**NOTE:** For all TPDES permit applications requesting individual permit coverage for discharges of oil and gas exploration and production wastewater (discharges into or adjacent to water in the state, falling under the Oil and Gas Extraction Effluent Guidelines – 40 CFR Part 435), see Worksheet 12.0, Item 2 instead.

### a. Production Data

Provide appropriate data for effluent guidelines with production-based effluent limitations.

#### Production Data

Subcategory	Actual Quantity/Day	Design Quantity/Day	Units

**b. Organic Chemicals, Plastics, and Synthetic Fibers Manufacturing Data (40 CFR Part 414)**

Provide each applicable subpart and the percent of total production. Provide data for metal-bearing and cyanide-bearing wastestreams, as required by *40 CFR Part 414, Appendices A and B*.

**Percentage of Total Production**

<b>Subcategory</b>	<b>Percent of Total Production</b>	<b>Appendix A and B - Metals</b>	<b>Appendix A - Cyanide</b>

**c. Refineries (40 CFR Part 419)**

Provide the applicable subcategory and a brief justification.

N/A

**Item 3. Process/Non-Process Wastewater Flows (Instructions, Page 54)**

Provide a breakdown of wastewater flow(s) generated by the facility, including both process and non-process wastewater flow(s). Specify which wastewater flows are to be authorized for discharge under this permit and the disposal practices for wastewater flows, excluding domestic, which are not to be authorized for discharge under this permit.

N/A



# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 2.0: POLLUTANT ANALYSIS

Worksheet 2.0 is **required** for all applications submitted for a TPDES permit. Worksheet 2.0 is not required for applications for a permit to dispose of all wastewater by land disposal or for discharges solely of stormwater associated with industrial activities.

## Item 1. General Testing Requirements (Instructions, Page 55)

- a. Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): N/A; NO DISCHARGE SINCE 2015
- b.  Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- c. Read the general testing requirements in the instructions for important information about sampling, test methods, and MALs. If a contact laboratory was used, attach a list which includes the name, contact information, and pollutants analyzed for each laboratory/firm. **Attachment:** N/A

## Item 2. Specific Testing Requirements (Instructions, Page 56)

Attach correspondence from TCEQ approving submittal of less than the required number of samples, if applicable. **Attachment:** N/A

### TABLE 1 and TABLE 2 (Instructions, Page 58)

Completion of Tables 1 and 2 is required for all external outfalls for all TPDES permit applications.

Table 1 for Outfall No.:

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (mg/L)	Sample 2 (mg/L)	Sample 3 (mg/L)	Sample 4 (mg/L)
BOD (5-day)				
CBOD (5-day)				
Chemical oxygen demand				
Total organic carbon				
Dissolved oxygen				
Ammonia nitrogen				
Total suspended solids				
Nitrate nitrogen				
Total organic nitrogen				
Total phosphorus				
Oil and grease				

Pollutant	Sample 1 (mg/L)	Sample 2 (mg/L)	Sample 3 (mg/L)	Sample 4 (mg/L)
Total residual chlorine				
Total dissolved solids				
Sulfate				
Chloride				
Fluoride				
Total alkalinity (mg/L as CaCO3)				
Temperature (°F)				
pH (standard units)				

Table 2 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)	Sample 2 (µg/L)	Sample 3 (µg/L)	Sample 4 (µg/L)	MAL (µg/L)
Aluminum, total					2.5
Antimony, total					5
Arsenic, total					0.5
Barium, total					3
Beryllium, total					0.5
Cadmium, total					1
Chromium, total					3
Chromium, hexavalent					3
Chromium, trivalent					N/A
Copper, total					2
Cyanide, available					2/10
Lead, total					0.5
Mercury, total					0.005/0.0005
Nickel, total					2
Selenium, total					5
Silver, total					0.5
Thallium, total					0.5
Zinc, total					5.0

**TABLE 3 (Instructions, Page 58)**

**Completion** of Table 3 is required for all **external outfalls** which discharge process wastewater.

**Partial completion** of Table 3 is required for all **external outfalls** which discharge non-process wastewater and stormwater associated with industrial activities commingled with other wastestreams (see instructions for additional guidance).

Table 3 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Acrylonitrile					50
Anthracene					10
Benzene					10
Benzidine					50
Benzo(a)anthracene					5
Benzo(a)pyrene					5
Bis(2-chloroethyl)ether					10
Bis(2-ethylhexyl)phthalate					10
Bromodichloromethane [Dichlorobromomethane]					10
Bromoform					10
Carbon tetrachloride					2
Chlorobenzene					10
Chlorodibromomethane [Dibromochloromethane]					10
Chloroform					10
Chrysene					5
m-Cresol [3-Methylphenol]					10
o-Cresol [2-Methylphenol]					10
p-Cresol [4-Methylphenol]					10
1,2-Dibromoethane					10
m-Dichlorobenzene [1,3-Dichlorobenzene]					10
o-Dichlorobenzene [1,2-Dichlorobenzene]					10
p-Dichlorobenzene [1,4-Dichlorobenzene]					10
3,3'-Dichlorobenzidine					5
1,2-Dichloroethane					10

<b>Pollutant</b>	<b>Sample 1 (µg/L)*</b>	<b>Sample 2 (µg/L)*</b>	<b>Sample 3 (µg/L)*</b>	<b>Sample 4 (µg/L)*</b>	<b>MAL (µg/L)*</b>
1,1-Dichloroethene [1,1-Dichloroethylene]					10
Dichloromethane [Methylene chloride]					20
1,2-Dichloropropane					10
1,3-Dichloropropene [1,3-Dichloropropylene]					10
2,4-Dimethylphenol					10
Di-n-Butyl phthalate					10
Ethylbenzene					10
Fluoride					500
Hexachlorobenzene					5
Hexachlorobutadiene					10
Hexachlorocyclopentadiene					10
Hexachloroethane					20
Methyl ethyl ketone					50
Nitrobenzene					10
N-Nitrosodiethylamine					20
N-Nitroso-di-n-butylamine					20
Nonylphenol					333
Pentachlorobenzene					20
Pentachlorophenol					5
Phenanthrene					10
Polychlorinated biphenyls (PCBs) (**)					0.2
Pyridine					20
1,2,4,5-Tetrachlorobenzene					20
1,1,2,2-Tetrachloroethane					10
Tetrachloroethene [Tetrachloroethylene]					10
Toluene					10
1,1,1-Trichloroethane					10
1,1,2-Trichloroethane					10
Trichloroethene [Trichloroethylene]					10
2,4,5-Trichlorophenol					50

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
TTHM (Total trihalomethanes)					10
Vinyl chloride					10

(\*) Indicate units if different from µg/L.

(\*\*) Total of detects for PCB-1242, PCB-1254, PCB-1221, PCB-1232, PCB-1248, PCB-1260, and PCB-1016. If all non-detects, enter the highest non-detect preceded by a "<".

**TABLE 4 (Instructions, Pages 58-59)**

Partial completion of Table 4 is **required** for each **external outfall** based on the conditions below.

**a. Tributyltin**

Is this facility an industrial/commercial facility which currently or proposes to directly dispose of wastewater from the types of operations listed below or a domestic facility which currently or proposes to receive wastewater from the types of industrial/commercial operations listed below?

- Yes       No

If **yes**, check the box next to each of the following criteria which apply and provide the appropriate testing results in Table 4 below (check all that apply).

- Manufacturers and formulators of tributyltin or related compounds.
- Painting of ships, boats and marine structures.
- Ship and boat building and repairing.
- Ship and boat cleaning, salvage, wrecking and scaling.
- Operation and maintenance of marine cargo handling facilities and marinas.
- Facilities engaged in wood preserving.
- Any other industrial/commercial facility for which tributyltin is known to be present, or for which there is any reason to believe that tributyltin may be present in the effluent.

**b. Enterococci (discharge to saltwater)**

This facility discharges/proposes to discharge directly into saltwater receiving waters **and** Enterococci bacteria are expected to be present in the discharge based on facility processes.

- Yes       No

Domestic wastewater is/will be discharged.

- Yes       No

If **yes to either** question, provide the appropriate testing results in Table 4 below.

**c. E. coli (discharge to freshwater)**

This facility discharges/proposes to discharge directly into freshwater receiving waters **and** *E. coli* bacteria are expected to be present in the discharge based on facility processes.

Yes       No

Domestic wastewater is/will be discharged.

Yes       No

If **yes to either** question, provide the appropriate testing results in Table 4 below.

Table 4 for Outfall No.: N/A

Samples are (check one):  Composite     Grab

Pollutant	Sample 1	Sample 2	Sample 3	Sample 4	MAL
Tributyltin (µg/L)					0.010
Enterococci (cfu or MPN/100 mL)					N/A
<i>E. coli</i> (cfu or MPN/100 mL)					N/A

TABLE 5 (Instructions, Page 59)

**Completion of Table 5 is required** for all **external outfalls** which discharge process wastewater from a facility which manufactures or formulates pesticides or herbicides or other wastewaters which may contain pesticides or herbicides.

If this facility does not/will not manufacture or formulate pesticides or herbicides and does not/will not discharge other wastewaters that may contain pesticides or herbicides, check N/A.

N/A

Table 5 for Outfall No.: N/A

Samples are (check one):  Composite     Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)*
Aldrin					0.01
Carbaryl					5
Chlordane					0.2
Chlorpyrifos					0.05
4,4'-DDD					0.1
4,4'-DDE					0.1
4,4'-DDT					0.02
2,4-D					0.7
Danitol [Fenpropathrin]					—
Demeton					0.20
Diazinon					0.5/0.1
Dicofol [Kelthane]					1
Dieldrin					0.02
Diuron					0.090
Endosulfan I ( <i>alpha</i> )					0.01
Endosulfan II ( <i>beta</i> )					0.02
Endosulfan sulfate					0.1

<b>Pollutant</b>	<b>Sample 1 (µg/L)*</b>	<b>Sample 2 (µg/L)*</b>	<b>Sample 3 (µg/L)*</b>	<b>Sample 4 (µg/L)*</b>	<b>MAL (µg/L)*</b>
Endrin					0.02
Guthion [Azinphos methyl]					0.1
Heptachlor					0.01
Heptachlor epoxide					0.01
Hexachlorocyclohexane ( <i>alpha</i> )					0.05
Hexachlorocyclohexane ( <i>beta</i> )					0.05
Hexachlorocyclohexane ( <i>gamma</i> ) [Lindane]					0.05
Hexachlorophene					10
Malathion					0.1
Methoxychlor					2.0
Mirex					0.02
Parathion (ethyl)					0.1
Toxaphene					0.3
2,4,5-TP [Silvex]					0.3

\* Indicate units if different from µg/L.

**TABLE 6 (Instructions, Page 59)**

Completion of Table 6 is required for all external outfalls.

Table 6 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutants	Believed Present	Believed Absent	Sample 1 (mg/L)	Sample 2 (mg/L)	Sample 3 (mg/L)	Sample 4 (mg/L)	MAL (µg/L)*
Bromide	<input type="checkbox"/>	<input type="checkbox"/>					400
Color (PCU)	<input type="checkbox"/>	<input type="checkbox"/>					—
Nitrate-Nitrite (as N)	<input type="checkbox"/>	<input type="checkbox"/>					—
Sulfide (as S)	<input type="checkbox"/>	<input type="checkbox"/>					—
Sulfite (as SO3)	<input type="checkbox"/>	<input type="checkbox"/>					—
Surfactants	<input type="checkbox"/>	<input type="checkbox"/>					—
Boron, total	<input type="checkbox"/>	<input type="checkbox"/>					20
Cobalt, total	<input type="checkbox"/>	<input type="checkbox"/>					0.3
Iron, total	<input type="checkbox"/>	<input type="checkbox"/>					7
Magnesium, total	<input type="checkbox"/>	<input type="checkbox"/>					20
Manganese, total	<input type="checkbox"/>	<input type="checkbox"/>					0.5
Molybdenum, total	<input type="checkbox"/>	<input type="checkbox"/>					1
Tin, total	<input type="checkbox"/>	<input type="checkbox"/>					5
Titanium, total	<input type="checkbox"/>	<input type="checkbox"/>					30

**TABLE 7 (Instructions, Page 60)**

Check the box next to any of the industrial categories applicable to this facility. If no categories are applicable, check N/A. If GC/MS testing is required, check the box provided to confirm the testing results for the appropriate parameters are provided with the application.

N/A

**Table 7 for Applicable Industrial Categories**

Industrial Category	40 CFR Part	Volatiles Table 8	Acids Table 9	Bases/Neutrals Table 10	Pesticides Table 11
<input type="checkbox"/> Adhesives and Sealants		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Aluminum Forming	467	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Auto and Other Laundries		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Battery Manufacturing	461	<input type="checkbox"/> Yes	No	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Coal Mining	434	No	No	No	No
<input type="checkbox"/> Coil Coating	465	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Copper Forming	468	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Electric and Electronic Components	469	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Electroplating	413	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Explosives Manufacturing	457	No	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Foundries		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Gum and Wood Chemicals - Subparts A,B,C,E	454	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Gum and Wood Chemicals - Subparts D,F	454	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Inorganic Chemicals Manufacturing	415	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Iron and Steel Manufacturing	420	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Leather Tanning and Finishing	425	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Mechanical Products Manufacturing		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Nonferrous Metals Manufacturing	421,471	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Oil and Gas Extraction - Subparts A, D, E, F, G, H	435	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Ore Mining - Subpart B	440	No	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Organic Chemicals Manufacturing	414	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Paint and Ink Formulation	446,447	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Pesticides	455	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Petroleum Refining	419	<input type="checkbox"/> Yes	No	No	No
<input type="checkbox"/> Pharmaceutical Preparations	439	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Photographic Equipment and Supplies	459	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Plastic and Synthetic Materials Manufacturing	414	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Plastic Processing	463	<input type="checkbox"/> Yes	No	No	No
<input type="checkbox"/> Porcelain Enameling	466	No	No	No	No
<input type="checkbox"/> Printing and Publishing		<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subpart C	430	<input type="checkbox"/> *	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts F, K	430	<input type="checkbox"/> *	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> *
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts A, B, D, G, H	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> *
<input type="checkbox"/> Pulp and Paperboard Mills - Subparts I, J, L	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *	<input type="checkbox"/> Yes
<input type="checkbox"/> Pulp and Paperboard Mills - Subpart E	430	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> *

Industrial Category	40 CFR Part	Volatiles Table 8	Acids Table 9	Bases/Neutrals Table 10	Pesticides Table 11
<input type="checkbox"/> Rubber Processing	428	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Soap and Detergent Manufacturing	417	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Steam Electric Power Plants	423	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No	No
<input type="checkbox"/> Textile Mills (Not Subpart C)	410	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	No
<input type="checkbox"/> Timber Products Processing	429	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes	<input type="checkbox"/> Yes

\* Test if believed present.

**TABLES 8, 9, 10, and 11 (Instructions, Page 60)**

Completion of Tables 8, 9, 10, and 11 **is required** as specified in Table 7 for all **external outfalls** that contain process wastewater.

Completion of Tables 8, 9, 10, and 11 **may be required** for types of industry not specified in Table 7 for specific parameters that are believed to be present in the wastewater.

Table 8 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Acrolein					50
Acrylonitrile					50
Benzene					10
Bromoform					10
Carbon tetrachloride					2
Chlorobenzene					10
Chlorodibromomethane					10
Chloroethane					50
2-Chloroethylvinyl ether					10
Chloroform					10
Dichlorobromomethane [Bromodichloromethane]					10
1,1-Dichloroethane					10
1,2-Dichloroethane					10
1,1-Dichloroethylene [1,1-Dichloroethene]					10
1,2-Dichloropropane					10
1,3-Dichloropropylene [1,3-Dichloropropene]					10
Ethylbenzene					10
Methyl bromide [Bromomethane]					50
Methyl chloride [Chloromethane]					50

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Methylene chloride [Dichloromethane]					20
1,1,2,2-Tetrachloroethane					10
Tetrachloroethylene [Tetrachloroethene]					10
Toluene					10
1,2-Trans-dichloroethylene [1,2-Trans-dichloroethene]					10
1,1,1-Trichloroethane					10
1,1,2-Trichloroethane					10
Trichloroethylene [Trichloroethene]					10
Vinyl chloride					10

\* Indicate units if different from µg/L.

Table 9 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
2-Chlorophenol					10
2,4-Dichlorophenol					10
2,4-Dimethylphenol					10
4,6-Dinitro-o-cresol					50
2,4-Dinitrophenol					50
2-Nitrophenol					20
4-Nitrophenol					50
p-Chloro-m-cresol					10
Pentachlorophenol					5
Phenol					10
2,4,6-Trichlorophenol					10

\* Indicate units if different from µg/L.

Table 10 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Acenaphthene					10
Acenaphthylene					10
Anthracene					10
Benzidine					50

<b>Pollutant</b>	<b>Sample 1 (µg/L)*</b>	<b>Sample 2 (µg/L)*</b>	<b>Sample 3 (µg/L)*</b>	<b>Sample 4 (µg/L)*</b>	<b>MAL (µg/L)</b>
Benzo(a)anthracene					5
Benzo(a)pyrene					5
3,4-Benzofluoranthene [Benzo(b)fluoranthene]					10
Benzo(ghi)perylene					20
Benzo(k)fluoranthene					5
Bis(2-chloroethoxy)methane					10
Bis(2-chloroethyl)ether					10
Bis(2-chloroisopropyl)ether					10
Bis(2-ethylhexyl)phthalate					10
4-Bromophenyl phenyl ether					10
Butylbenzyl phthalate					10
2-Chloronaphthalene					10
4-Chlorophenyl phenyl ether					10
Chrysene					5
Dibenzo(a,h)anthracene					5
1,2-Dichlorobenzene [o-Dichlorobenzene]					10
1,3-Dichlorobenzene [m-Dichlorobenzene]					10
1,4-Dichlorobenzene [p-Dichlorobenzene]					10
3,3'-Dichlorobenzidine					5
Diethyl phthalate					10
Dimethyl phthalate					10
Di-n-butyl phthalate					10
2,4-Dinitrotoluene					10
2,6-Dinitrotoluene					10
Di-n-octyl phthalate					10
1,2-Diphenylhydrazine (as Azobenzene)					20
Fluoranthene					10
Fluorene					10
Hexachlorobenzene					5
Hexachlorobutadiene					10

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Hexachlorocyclopentadiene					10
Hexachloroethane					20
Indeno(1,2,3-cd)pyrene					5
Isophorone					10
Naphthalene					10
Nitrobenzene					10
N-Nitrosodimethylamine					50
N-Nitrosodi-n-propylamine					20
N-Nitrosodiphenylamine					20
Phenanthrene					10
Pyrene					10
1,2,4-Trichlorobenzene					10

\* Indicate units if different from µg/L.

Table 11 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Aldrin					0.01
alpha-BHC [alpha-Hexachlorocyclohexane]					0.05
beta-BHC [beta-Hexachlorocyclohexane]					0.05
gamma-BHC [gamma-Hexachlorocyclohexane]					0.05
delta-BHC [delta-Hexachlorocyclohexane]					0.05
Chlordane					0.2
4,4'-DDT					0.02
4,4'-DDE					0.1
4,4'-DDD					0.1
Dieldrin					0.02
Endosulfan I (alpha)					0.01
Endosulfan II (beta)					0.02
Endosulfan sulfate					0.1
Endrin					0.02
Endrin aldehyde					0.1

Pollutant	Sample 1 (µg/L)*	Sample 2 (µg/L)*	Sample 3 (µg/L)*	Sample 4 (µg/L)*	MAL (µg/L)
Heptachlor					0.01
Heptachlor epoxide					0.01
PCB 1242					0.2
PCB 1254					0.2
PCB 1221					0.2
PCB 1232					0.2
PCB 1248					0.2
PCB 1260					0.2
PCB 1016					0.2
Toxaphene					0.3

\* Indicate units if different from µg/L.

**Attachment:** N/A

**TABLE 12 (DIOXINS/FURAN COMPOUNDS)**

Complete of Table 12 **is required** for **external outfalls**, as directed below. (Instructions, Pages 59-60)

Indicate which compound(s) are manufactured or used at the facility and provide a brief description of the conditions of its/their presence at the facility (check all that apply).

- 2,4,5-trichlorophenoxy acetic acid (2,4,5-T) CASRN 93-76-5
- 2-(2,4,5-trichlorophenoxy) propanoic acid (Silvex, 2,4,5-TP) CASRN 93-72-1
- 2-(2,4,5-trichlorophenoxy) ethyl 2,2-dichloropropionate (Erbon) CASRN 136-25-4
- 0,0-dimethyl 0-(2,4,5-trichlorophenyl) phosphorothioate (Ronnell) CASRN 299-84-3
- 2,4,5-trichlorophenol (TCP) CASRN 95-95-4
- hexachlorophene (HCP) CASRN 70-30-4
- None of the above

Description: N/A

Does the applicant or anyone at the facility know or have any reason to believe that 2,3,7,8-tetrachlorodibenzo-p-dioxin (TCDD) or any congeners of TCDD may be present in the effluent proposed for discharge?

- Yes  No

Description: N/A

If **yes** to either Items a **or** b, complete Table 12 as instructed.

Table 12 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Compound	Toxicity Equivalent Factors	Wastewater Concentration (ppq)	Wastewater Toxicity Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Toxicity Equivalents (ppt)	MAL (ppq)
2,3,7,8-TCDD	1					10
1,2,3,7,8-PeCDD	1.0					50
2,3,7,8-HxCDDs	0.1					50
1,2,3,4,6,7,8-HpCDD	0.01					50
2,3,7,8-TCDF	0.1					10
1,2,3,7,8-PeCDF	0.03					50
2,3,4,7,8-PeCDF	0.3					50
2,3,7,8-HxCDFs	0.1					50
2,3,4,7,8-HpCDFs	0.01					50
OCDD	0.0003					100
OCDF	0.0003					100
PCB 77	0.0001					500
PCB 81	0.0003					500
PCB 126	0.1					500
PCB 169	0.03					500
Total						

**TABLE 13 (HAZARDOUS SUBSTANCES)**

Complete Table 13 is required for all external outfalls as directed below. (Instructions, Pages 60-61)

Are there any pollutants listed in the instructions (pages 55-62) believed present in the discharge?

- Yes  No

Are there pollutants listed in Item 1.c. of Technical Report 1.0 which are believed present in the discharge and have not been analytically quantified elsewhere in this application?

- Yes  No

If yes to either Items a or b, complete Table 13 as instructed.

Table 13 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

<b>Pollutant</b>	<b>CASRN</b>	<b>Sample 1 (µg/L)</b>	<b>Sample 2 (µg/L)</b>	<b>Sample 3 (µg/L)</b>	<b>Sample 4 (µg/L)</b>	<b>Analytical Method</b>

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 3.0: LAND APPLICATION OF EFFLUENT

This worksheet **is required** for all applications for a permit to disposal of wastewater by land application (i.e., TLAP)).

## Item 1. Type of Disposal System (Instructions, Page 69)

Check the box next to the type of land disposal requested by this application:

- |  |   |
|--|---|
| <input type="checkbox"/> Irrigation<br><input type="checkbox"/> Evaporation<br><input type="checkbox"/> Evapotranspiration beds<br><input type="checkbox"/> Drip irrigation system | <input type="checkbox"/> Subsurface application<br><input type="checkbox"/> Subsurface soils absorption<br><input type="checkbox"/> Surface application<br><input type="checkbox"/> Other, specify: |
|--|---|

## Item 2. Land Application Area (Instructions, Page 69)

### Land Application Area Information

Effluent Application (gallons/day)	Irrigation Acreage (acres)	Describe land use & indicate type(s) of crop(s)	Public Access? (Y/N)

## Item 3. Annual Cropping Plan (Instructions, Page 69)

Attach the required cropping plan that includes each of the following:

- Cool and warm season plant species
- Breakdown of acreage and percent of total acreage for each crop
- Crop growing season
- Harvesting method/number of harvests
- Minimum/maximum harvest height
- Crop yield goals
- Soils map
- Nitrogen requirements per crop
- Additional fertilizer requirements
- Supplemental watering requirements
- Crop salt tolerances
- Justification for not removing existing vegetation to be irrigated

**Attachment:** N/A

## Item 4. Well and Map Information (Instructions, Page 70)

a. Check each box to confirm the required information is shown and labeled on the attached USGS map:

- The exact boundaries of the land application area
- On-site buildings
- Waste-disposal or treatment facilities
- Effluent storage and tailwater control facilities
- Buffer zones
- All surface waters in the state onsite and within 500 feet of the property boundaries
- All water wells within ½-mile of the disposal site, wastewater ponds, or property boundaries
- All springs and seeps onsite and within 500 feet of the property boundaries

Attachment: N/A

b. List and cross reference all water wells located on or within 500 feet of the disposal site, wastewater ponds, or property boundaries in the following table. Attach additional pages as necessary to include all of the wells.

**Well and Map Information Table**

Well ID	Well Use	Producing? Y/N/U	Open, cased, capped, or plugged?	Proposed Best Management Practice

Attachment: N/A

c. Groundwater monitoring wells or lysimeters are/will be installed around the land application site or wastewater ponds.

- Yes       No

If **yes**, provide the existing/proposed location of the monitoring wells or lysimeters on the site map attached for Item 4.a. Additionally, attach information on the depth of the wells or lysimeters, sampling schedule, and monitoring parameters for TCEQ review, possible modification, and approval.

Attachment: N/A

d. Attach a short groundwater technical report using *30 TAC § 309.20(a)(4)* as guidance.

Attachment:





## Item 7. Pollutant Analysis (Instructions, Page 72)

- a. Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): N/A; NO DISCHARGE SINCE 2015
- b.  Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- c. Complete Tables 15 and 16.

Table 15 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (mg/L)	Sample 2 (mg/L)	Sample 3 (mg/L)	Sample 4 (mg/L)
BOD (5-day)				
CBOD (5-day)				
Chemical oxygen demand				
Total organic carbon				
Dissolved oxygen				
Ammonia nitrogen				
Total suspended solids				
Nitrate nitrogen				
Total organic nitrogen				
Total phosphorus				
Oil and grease				
Total residual chlorine				
Total dissolved solids				
Sulfate				
Chloride				
Fluoride				
Total alkalinity (mg/L as CaCO <sub>3</sub> )				
Temperature (°F)				
pH (standard units)				

Table 16 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (µg/L)	Sample 2 (µg/L)	Sample 3 (µg/L)	Sample 4 (µg/L)	MAL (µg/L)
Aluminum, total					2.5
Antimony, total					5
Arsenic, total					0.5

<b>Pollutant</b>	<b>Sample 1 (µg/L)</b>	<b>Sample 2 (µg/L)</b>	<b>Sample 3 (µg/L)</b>	<b>Sample 4 (µg/L)</b>	<b>MAL (µg/L)</b>
Barium, total					3
Beryllium, total					0.5
Cadmium, total					1
Chromium, total					3
Chromium, hexavalent					3
Chromium, trivalent					N/A
Copper, total					2
Cyanide, available					2/10
Lead, total					0.5
Mercury, total					0.005/0.0005
Nickel, total					2
Selenium, total					5
Silver, total					0.5
Thallium, total					0.5
Zinc, total					5.0

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 3.1: SURFACE LAND APPLICATION AND APPLICATION

This worksheet **is required** for all applications for a permit to disposal of wastewater by surface land application or evaporation.

## Item 1. Edwards Aquifer (Instructions, Page 73)

a. Is the facility subject to *30 TAC Chapter 213*, Edwards Aquifer Rules?

- Yes       No

If **no**, proceed to Item 2. If **yes**, complete Items 1.b and 1.c.

b. Check the box next to the subchapter applicable to the facility.

- 30 TAC Chapter 213, Subchapter A  
 30 TAC Chapter 213, Subchapter B

c. If *30 TAC Chapter 213, Subchapter A* applies, attach **either**: 1) a Geologic Assessment (if conducted in accordance with *30 TAC § 213.5*) **or** 2) a report that contains the following:

- A description of the surface geological units within the proposed land application site and wastewater pond area.
- The location and extent of any sensitive recharge features in the land application site and wastewater pond area
- A list of any proposed BMPs to protect the recharge features.

**Attachment:** N/A

## Item 2. Surface Spray/Irrigation (Instructions, Page 73)

a. Provide the following information on the irrigation operations:

Area under irrigation (acres): N/A

Design application rate (acre-ft/acre/yr): N/A

Design application frequency (hours/day): N/A

Design application frequency (days/week): N/A

Design total nitrogen loading rate (lbs nitrogen/acre/year): N/A

Average slope of the application area (percent): N/A

Maximum slope of the application area (percent): N/A

Irrigation efficiency (percent): N/A

Effluent conductivity (mmhos/cm): N/A

Soil conductivity (mmhos/cm): N/A

Curve number: N/A

Describe the application method and equipment: N/A

- b. Attach a detailed engineering report which includes a water balance, storage volume calculations, and a nitrogen balance. **Attachment:** N/A

### **Item 3. Evaporation Ponds (Instructions, Page 74)**

- a. Daily average effluent flow into ponds: N/A gallons per day
- b. Attach a separate engineering report of evaporation calculations for average long-term and worst-case critical conditions. **Attachment:** N/A

### **Item 4. Evapotranspiration Beds (Instructions, Page 74)**

- a. Provide the following information on the evapotranspiration beds:
- Number of beds: N/A
  - Area of bed(s) (acres): N/A
  - Depth of bed(s) (feet): N/A
  - Void ratio of soil in the beds: N/A
  - Storage volume within the beds (include units): N/A
  - Description of any lining to protect groundwater: N/A
- b. Attach a certification by a licensed Texas professional engineer that the liner meets TCEQ requirements. **Attachment:** N/A
- c. Attach a separate engineering report with water balance, storage volume calculations, and description of the liner. **Attachment:** N/A

### **Item 5. Overland Flow (Instructions, Page 74)**

- a. Provide the following information on the overland flow:
- Area used for application (acres): N/A
  - Slopes for application area (percent): N/A
  - Design application rate (gpm/foot of slope width): N/A
  - Slope length (feet): N/A
  - Design BOD5 loading rate (lbs BOD5/acre/day): N/A
  - Design application frequency (hours/day): N/A
  - Design application frequency (days/week): N/A
- b. Attach a separate engineering report with the method of application and design requirements according to 30 TAC § 217.212. **Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 3.2: SUBSURFACE IRRIGATION (NON-DRIP)

This worksheet **is required** for all applications for a permit to disposal of wastewater by subsurface land application.

- Check the box to confirm the Class V Injection Well Inventory/Authorization Form (Worksheet 9.0) has been submitted to the TCEQ UIC Permits Team as directed.

### Item 1. Edwards Aquifer (Instructions, Page 75)

- a. The subsurface system is/will be located on the Edwards Aquifer Recharge Zone, as mapped by TCEQ?
- Yes       No
- b. The subsurface system is/will be located on the Edwards Aquifer Transition Zone, as mapped by TCEQ?
- Yes       No

If **yes** to Item 1.a **or** 1.b, the subsurface system may be prohibited by *30 TAC § 213.8*. Contact the Water Quality Assessment Section at (512) 239-4671 for a preapplication meeting.

### Item 2. Subsurface Application (Instructions, Page 75)

- a. Check the box next to the type of subsurface land disposal system requested:
- Conventional drainfield, beds, or trenches
- Low pressure dosing
- Other: N/A
- b. Provide the following information on the irrigation operations:
- Application area (acres): N/A
- Area of drainfield (square feet): N/A
- Application rate (gal/square ft/day): N/A
- Depth to groundwater (feet): N/A
- Area of trench (square feet): N/A
- Dosing duration per area (hours): N/A
- Number of beds: N/A
- Dosing amount per area (inches/day): N/A
- Soil infiltration rate (inches/hour): N/A
- Storage volume (gallons): N/A
- Area of bed(s) (square feet): N/A
- Soil classification: N/A
- c. Attach a separate engineering report using *30 TAC § 309.20, Subchapter C, Land Disposal of Sewage Effluent* as guidance, excluding items b(3)(A) and b(3)(B). Include a description of the schedule of dosing basin rotation. **Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 3.3: SUBSURFACE AREA DRIP DISPERSAL SYSTEMS

This worksheet **is required** for all applications for a permit to dispose of wastewater using a subsurface area drip dispersal system (SADDS).

- Check the box to confirm the Class V Injection Well Inventory/Authorization Form (Worksheet 9.0) has been submitted to the TCEQ UIC Permits Team as directed.

## Item 1. Edwards Aquifer (Instructions, Page 76)

- a. The subsurface system is/will be located on the Edwards Aquifer Recharge Zone, as mapped by TCEQ?  
 Yes       No
- b. The subsurface system is/will be located on the Edwards Aquifer Transition Zone, as mapped by TCEQ?  
 Yes       No

If **yes** to Item 1.a **or** 1.b, the subsurface system may be prohibited by *30 TAC § 213.8*. Contact the Water Quality Assessment Section at (512) 239-4671 for a preapplication meeting.

## Item 2. Administrative Information (Instructions, Page 76)

- a. Provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the owner of the treatment facility: N/A
- b. The owner of the land where the WWTF is/will be located is the same as the owner of the WWTF.  
 Yes       No

If **no**, provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the owner of the land where the WWTF is/will be located: N/A

- c. Provide the legal name of the owner of the SADDS: N/A
- d. The owner of the SADDS is the same as the owner of the WWTF or the site where the WWTF is/will be located.  
 Yes       No
- If **no**, identify the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the entity identified in Item 1.c: N/A
- e. Provide the legal name of the owner of the land where the SADDS is located: N/A
- f. The owner of the land where the SADDS is/will be located is the same as owner of the WWTF, the site where the WWTF is located, or the owner of the SADDS.  
 Yes       No

If **no**, provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the entity identified in item 1.e: N/A

### Item 3. SADDs (Instructions, Page 77)

a. Check the box next to the type SADDs requested by this application:

- Subsurface drip/trickle irrigation
- Surface drip irrigation
- Other: N/A

b. Attach a description of the SADDs proposed/used by the facility (see instructions for guidance). **Attachment:** N/A

c. Provide the following information on the SADDs:

Application area (acres): N/A

Soil infiltration rate (inches/hour): N/A

Average slope of the application area: N/A

Maximum slope of the application area: N/A

Storage volume (gallons): N/A

Major soil series: N/A

Depth to groundwater (feet): N/A

Effluent conductivity (mmhos/cm): N/A

d. The facility is/will be located west of the boundary shown in *30 TAC § 222.83* **and** using a vegetative cover of non-native grasses over seeded with cool-season grasses.

- Yes       No

If **yes**, the facility may propose a hydraulic application rate up to, but not to exceed, 0.1 gal/ft<sup>2</sup>/day.

e. The facility is/will be located east of the boundary shown in *30 TAC § 222.83* **or** is the facility proposing any crop other than non-native grasses.

- Yes       No

If **yes**, the facility must use the formula in *30 TAC § 222.83* to calculate the maximum hydraulic application rate.

f. The facility has or plans to submit an alternative method to calculate the hydraulic application rate for approval by the ED.

- Yes       No

If **yes**, provide the following information on the hydraulic application rates:

- Hydraulic application rate (gal/square foot/day): N/A
- Nitrogen application rate (gal/square foot/day): N/A

g. Provide the following dosing information:

Number of doses per day: N/A  
Dosing duration per area (hours): N/A  
Rest period between doses (hours): N/A  
Dosing amount per area (inches/day): N/A  
Number of zones: N/A

h. The system is/will be a surface drip irrigation system using existing native vegetation as a crop?

Yes       No

If **yes**, attach the following information:

- A vegetation survey by a certified arborist describing the percent canopy cover and relative percentage of major overstory and understory plant species.  
**Attachment:** N/A
- Attach a separate engineering report using *30 TAC § 309.20, Subchapter C, Land Disposal of Sewage Effluent* as guidance, excluding items b(3)(A) and b(3)(B). Include a description of the schedule of dosing basin rotation.  
**Attachment:** N/A

#### Item 4. Required Plans (Instructions, Page 78)

a. Attach a Soil Evaluation with all information required in *30 TAC § 222.73*.

**Attachment:** N/A

b. Attach a Site Preparation Plan with all information required in *30 TAC § 222.75*.

**Attachment:** N/A

c. Attach a Recharge Feature Plan with all information required in *30 TAC § 222.79*.

**Attachment:** N/A

d. Provide soil sampling and testing with all information required in *30 TAC § 222.157*.

**Attachment:** N/A

#### Item 5. Flood and Run-On Protection (Instructions, Page 79)

a. Is the existing/proposed SADDs located within the 100-year frequency flood level?

Yes       No

Source: N/A

If **yes**, describe how the site will be protected from inundation: N/A

b. Is the existing/proposed SADDs within a designated floodway?

Yes       No

If **yes**, attach either the FEMA flood map or alternate information used to make this determination. **Attachment:** N/A

## Item 6. Surface Waters in The State (Instructions, Page 79)

- a. Attach a buffer map which shows the appropriate buffers on surface waters in the state, water wells, and springs/seeps. **Attachment:** N/A
- b. The facility has or plans to request a buffer variance from water wells or waters in the state?  
 Yes  No

If **yes**, attach the additional information required in *30 TAC § 222.81(c)*. **Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 4.0: RECEIVING WATERS

This worksheet is **required** for all TPDES permit applications.

## Item 1. Domestic Drinking Water Supply (Instructions, Page 80)

a. There is a surface water intake for domestic drinking water supply located within 5 (five) miles downstream from the point/proposed point of discharge.

Yes     No

If **no**, stop here and proceed to Item 2. If **yes**, provide the following information:

1. The legal name of the owner of the drinking water supply intake: N/A

2. The distance and direction from the outfall to the drinking water supply intake: N/A

b. Locate and identify the intake on the USGS 7.5-minute topographic map provided for Administrative Report 1.0.

Check this box to confirm the above requested information is provided.

## Item 2. Discharge Into Tidally Influenced Waters (Instructions, Page 80)

If the discharge is to tidally influenced waters, complete this section. Otherwise, proceed to Item 3.

a. Width of the receiving water at the outfall: N/A feet

b. Are there oyster reefs in the vicinity of the discharge?

Yes     No

If **yes**, provide the distance and direction from the outfall(s) to the oyster reefs: N/A

c. Are there sea grasses within the vicinity of the point of discharge?

Yes     No

If **yes**, provide the distance and direction from the outfall(s) to the grasses: N/A

## Item 3. Classified Segment (Instructions, Page 80)

The discharge is/will be directly into (or within 300 feet of) a classified segment.

Yes     No

If **yes**, stop here and do not complete Items 4 and 5 of this worksheet or Worksheet 4.1.

If **no**, complete Items 4 and 5 and Worksheet 4.1 may be required.

## Item 4. Description of Immediate Receiving Waters (Instructions, Page 80)

a. Name of the immediate receiving waters: Drainage ditch to O.R. Mitchell Reservoir to Medio Creek

b. Check the appropriate description of the immediate receiving waters:

- Lake or Pond
  - Surface area (acres): N/A
  - Average depth of the entire water body (feet): N/A
  - Average depth of water body within a 500-foot radius of the discharge point (feet): N/A
- Man-Made Channel or Ditch
- Stream or Creek
- Freshwater Swamp or Marsh
- Tidal Stream, Bayou, or Marsh
- Open Bay
- Other, specify:

If **Man-Made Channel or Ditch** or **Stream or Creek** were selected above, provide responses to Items 4.c - 4.g below:

c. For **existing discharges**, check the description below that best characterizes the area **upstream** of the discharge.

For **new discharges**, check the description below that best characterizes the area **downstream** of the discharge.

- Intermittent (dry for at least one week during most years)
- Intermittent with Perennial Pools (enduring pools containing habitat to maintain aquatic life uses)
- Perennial (normally flowing)

Check the source(s) of the information used to characterize the area upstream (existing discharge) or downstream (new discharge):

- USGS flow records
- personal observation
- historical observation by adjacent landowner(s)
- other, specify: N/A

d. List the names of all perennial streams that join the receiving water within three miles downstream of the discharge point: Medio Creek

e. The receiving water characteristics change within three miles downstream of the discharge (e.g., natural or man-made dams, ponds, reservoirs, etc.).

Yes       No

If **yes**, describe how: Man-made reservoir – OR Mitchell Lake

f. General observations of the water body during normal dry weather conditions: Water body appeared dry during normal dry weather conditions

Date and time of observation: June 07, 2024; 1:00 PM

g. The water body was influenced by stormwater runoff during observations.

Yes       No

If **yes**, describe how: N/A

## Item 5. General Characteristics of Water Body (Instructions, Page 81)

a. Is the receiving water upstream of the existing discharge or proposed discharge site influenced by any of the following (check all that apply):

- |   |   |
|---|---|
| <input type="checkbox"/> oil field activities           | <input checked="" type="checkbox"/> urban runoff    |
| <input checked="" type="checkbox"/> agricultural runoff | <input type="checkbox"/> septic tanks               |
| <input type="checkbox"/> upstream discharges            | <input type="checkbox"/> other, specify: <u>N/A</u> |

b. Uses of water body observed or evidence of such uses (check all that apply):

- |  |   |
|--|---|
| <input checked="" type="checkbox"/> livestock watering | <input type="checkbox"/> industrial water supply    |
| <input type="checkbox"/> non-contact recreation        | <input type="checkbox"/> irrigation withdrawal      |
| <input type="checkbox"/> domestic water supply         | <input type="checkbox"/> navigation                 |
| <input type="checkbox"/> contact recreation            | <input type="checkbox"/> picnic/park activities     |
| <input type="checkbox"/> fishing                       | <input type="checkbox"/> other, specify: <u>N/A</u> |

c. Description which best describes the aesthetics of the receiving water and the surrounding area (check only one):

- Wilderness:** outstanding natural beauty; usually wooded or un-pastured area: water clarity exceptional
- Natural Area:** trees or native vegetation common; some development evident (from fields, pastures, dwellings); water clarity discolored
- Common Setting:** not offensive, developed but uncluttered; water may be colored or turbid
- Offensive:** stream does not enhance aesthetics; cluttered; highly developed; dumping areas; water discolored



## Item 2. Summarize Measurements (Instructions, Page 83)

Provide the following information regarding the transect measurements:

Streambed slope of entire reach (from USGS map in ft. /ft.): N/A

Approximate drainage area above the most downstream transect from USGS map or county highway map (square miles): N/A

Length of stream evaluated (ft): N/A

Number of lateral transects made: N/A

Average stream width (ft): N/A

Average stream depth (ft): N/A

Average stream velocity (ft/sec): N/A

Instantaneous stream flow (ft<sup>3</sup>/sec): N/A

Indicate flow measurement method (VERY IMPORTANT - type of meter, floating chip timed over a fixed distance, etc.): N/A

Flow fluctuations (i.e., minor, moderate, or severe): N/A

Size of pools (i.e., large, small, moderate, or none): N/A

Maximum pool depth (ft): N/A

Total number of stream bends: N/A

    Number well defined: N/A

    Number moderately defined: N/A

    Number poorly defined: N/A

Total number of riffles: N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 5.0: SEWAGE SLUDGE MANAGEMENT AND DISPOSAL

The following information **is required** for all TPDES permit applications that meet the conditions as outlined in Technical Report 1.0, Item 7.

## Item 1. Sewage Sludge Solids Management Plan (Instructions, Page 84)

a. Is this a new permit application or an amendment permit application?

- Yes       No

b. Does or will the facility discharge in the Lake Houston watershed?

- Yes       No

If **yes** to either Item 1.a or 1.b, attach a solids management plan. **Attachment:** N/A

## Item 2. Sewage Sludge Management and Disposal (Instructions, Page 84)

a. Check the box next to the sludge disposal method(s) authorized under the facility's existing permit (check all that apply).

- Permitted landfill
- Marketing and distribution by the permittee, attach Form TCEQ-00551
- Registered land application site, attach Form TCEQ-00565
- Processed by the permittee, attach Form TCEQ-00744
- Surface disposal site (sludge monofill), attach Form TCEQ-00744
- Transported to another WWTP
- Beneficial land application, attach Form TCEQ-10451
- Incineration, attach Form TCEQ-00744

Based on the selection(s) made above, complete and attach the required TCEQ forms as directed. Failure to submit the required TCEQ form will result in delays in processing the application

**Attachment:** N/A – The facility does not generate sewage waste onsite

b. Provide the following information for each disposal site:

Disposal site name: N/A

TCEQ Permit/Registration Number: N/A

County where disposal site is located: N/A

c. Method of sewage sludge transportation:

truck     train     pipe     other: N/A

TCEQ Hauler Registration Number: N/A

d. Sludge is transported as a:

liquid     semi-liquid     semi-solid     solid

e. Purpose of land application:     reclamation     soil conditioning     N/A

f. If sewage sludge is transported to another WWTP for treatment, attach a written statement or copy of contractual agreements confirming that the WWTP identified above will accept and be responsible for the sludge from this facility for the life of the permit (at least 5 years).

Attachment: N/A

### Item 3. Authorization for Sewage Sludge Disposal (Instructions, Page 85)

If this is a new or major amendment application which requests authorization of a new sewage sludge disposal method, check the new sewage disposal method(s) requested for authorization (check all that apply):

- Marketing and distribution by the permittee, attach Form TCEQ-00551
- Processed by the permittee, attach Form TCEQ-00744
- Surface disposal site (sludge monofill), attach Form TCEQ-00744
- Beneficial land application, attach Form TCEQ-10451
- Incineration, attach Form TCEQ-00744

Based on the selection(s) made above, complete and attach any required TCEQ forms, as directed. Failure to submit the required TCEQ form will result in delays in processing the application.

Attachment: N/A

**NOTE:** New authorization for beneficial land application, incineration, processing, or disposal in the TPDES permit or TLAP **requires a major amendment to the permit.** New authorization for composting may require a major amendment to the permit. See the instructions to determine if a major amendment is required or if authorization for composting can be added through the renewal process.

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 6.0: INDUSTRIAL WASTE CONTRIBUTION

The following information is required for all applications for publicly-owned treatment works (POTWs).

For an explanation of the terms used in this worksheet, refer to the General Definitions on pages 4-12 and the Definitions Relating to Pretreatment on pages 13-14 of the Instructions.

## Item 1. All POTWs (Instructions, Page 86)

- a. Complete the following table with the number of each type of industrial users (IUs) that discharge to the POTW and the daily average flows from each.

### Industrial User Information

Type of Industrial User	Number of Industrial Users	Daily Average Flow (gallons per day)
CIU		
SIU - Non-categorical		
Other IU		

- b. In the past three years, has the POTW experienced treatment plant interference?

Yes       No

If **yes**, identify the date(s), duration, nature of interference, and probable cause(s) and possible source(s) of each interference event. Include the names of the IU(s) that may have caused the interference: N/A

- c. In the past three years, has the POTW experienced pass-through?

Yes       No

If **yes**, identify the date(s), duration, pollutants passing through the treatment plant, and probable cause(s) and possible source(s) of each pass-through event. Include the names of the IU(s) that may have caused the pass-through: N/A

- d. Does the POTW have, or is it required to develop, an approved pretreatment program?

Yes       No

If **yes**, answer all questions in Item 2 and skip Item 3.

If **no**, skip Item 2 and answer all questions in Item 3 for each SIU and CIU.

## Item 2. POTWs With Approved Pretreatment Programs or Those Required To Develop A Pretreatment Program (Instructions, Page 86)

- a. Have there been any substantial modifications to the POTW's approved pretreatment program that have not been submitted to the Approval Authority (TCEQ) for approval according to 40 CFR § 403.18?

Yes       No

If **yes**, include an attachment which identifies all substantial modifications that have not been submitted to the TCEQ and the purpose of the modifications.

**Attachment:** N/A

- b. Have there been any non-substantial modifications to the POTW’s approved pretreatment program that have not been submitted to the Approval Authority (TCEQ)?

Yes       No

If **yes**, include an attachment which identifies all non-substantial modifications that have not been submitted to the TCEQ and the purpose of the modification.

**Attachment:** N/A

- c. List all parameters measured above the MAL in the POTW’s effluent monitoring during the last three years:

**Effluent Parameters Measured Above the MAL**

Pollutant	Concentration	MAL	Units	Date

**Attachment:** N/A

- d. Has any SIU, CIU, or other IU caused or contributed to any other problems (excluding interference or pass-through) at the POTW in the past three years?

Yes       No

If **yes**, provide a description of each episode, including date(s), duration, description of problems, and probable pollutants. Include the name(s) of the SIU(s)/CIU(s)/other IU(s) that may have caused or contributed to any of the problems: N/A

**Item 3. Significant Industrial User and Categorical Industrial User Information (Instructions, Pages 88-87)**

POTWs that **do not** have an approved pretreatment program **are required** to provide the following information for each SIU and CIU:

- a. Mr. or Ms.: N/A First/Last Name: N/A

Organization Name: N/A

SIC Code: N/A

Phone number: N/A

Email address: N/A

Physical Address: N/A

City/State/ZIP Code: N/A

**Attachment:** N/A

- b. Describe the industrial processes or other activities that affect or contribute to the SIU(s) or CIU(s) discharge (e.g., process and non-process wastewater): N/A
- c. Provide a description of the principal products(s) or service(s) performed: N/A
- d. Flow rate information

**Flow Rate Information**

Effluent Type	Discharge Day (gallons per day)	Discharge Frequency (Continuous, batch, or intermittent)
Process Wastewater		
Non-process Wastewater		

e. Pretreatment Standards

1. Is the SIU or CIU subject to technology-based local limits as defined in the application instructions?  
 Yes       No
  
2. Is the SIU subject to categorical pretreatment standards?  
 Yes       No

If **yes**, provide the category and subcategory or subcategories in the SIUs Subject To Categorical Pretreatment Standards table.

**SIUs Subject to Categorical Pretreatment Standards**

Category in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR	Subcategory in 40 CFR

- f. Has the SIU or CIU caused or contributed to any problem(s) (e.g., interferences, pass through, odors, corrosion, blockages) at the POTW in the past three years?  
 Yes       No

If **yes**, provide a description of each episode, including dates, duration, description of problems, and probable pollutants, and include the name(s) of the SIU(s)/CIU(s) that may have caused or contributed to the problem(s): N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 7.0: STORMWATER DISCHARGES ASSOCIATED WITH INDUSTRIAL ACTIVITIES

This worksheet **is required** for all TPDES permit applications requesting individual permit coverage for discharges consisting of **either**: 1) solely of stormwater discharges associated with industrial activities, as defined in *40 CFR § 122.26(b)(14)(i-xi)*, **or** 2) stormwater discharges associated with industrial activities and any of the listed allowable non-stormwater discharges, as defined in the MSGP (TXR05000), Part II, Section A, Item 6.

Discharges of stormwater as defined in *40 CFR § 122.26 (b)(13)* are not required to obtain authorization under a TPDES permit (see exceptions at *40 CFR §§ 122.26(a)(1)* and *(9)*). Authorization for discharge may be required from a local municipal separate storm sewer system.

## Item 1. Applicability (Instructions, Page 89)

Do discharges from any of the existing/proposed outfalls consist either 1) solely of stormwater discharges associated with industrial activities **or** 2) stormwater discharges associated with industrial activities and any of the allowable non-stormwater discharges?

Yes  No

If **no**, stop here. If **yes**, proceed as directed.

## Item 2. Stormwater Coverage (Instructions, Page 89)

List each existing/proposed stormwater outfall at the facility and indicate which type of authorization covers or is proposed to cover discharges.

### Authorization Coverage

Outfall	Authorization under MSGP	Authorized Under Individual Permit
	<input type="checkbox"/>	<input type="checkbox"/>

If **all** existing/proposed outfalls which discharge stormwater associated with industrial activities (and any of the allowable non-stormwater discharges) are **authorized under the MSGP**, **stop** here.

If **seeking authorization** for any outfalls which discharge stormwater associated with industrial activities (and any of the allowable non-stormwater discharges) **under an individual permit**, **proceed**.

**NOTE: The following information is required for each existing/proposed stormwater outfall for which the facility is seeking individual permit authorization under this application**

**Item 3. Site Map (Instructions, Page 90)**

Attach a site map or maps (drawn to scale) of the entire facility with the following information.

- the location of each stormwater outfall to be covered by the permit
- an outline of the drainage area that is within the facility’s boundary and that contributes stormwater to each outfall to be covered by the permit
- connections or discharge points to municipal separate storm sewer systems
- locations of all structures (e.g. buildings, garages, storage tanks)
- structural control devices that are designed to reduce pollution in discharges of stormwater associated with industrial activities
- process wastewater treatment units (including ponds)
- bag house and other air treatment units exposed to stormwater (stormwater runoff, snow melt runoff, and surface runoff and drainage)
- landfills; scrapyards; surface water bodies (including wetlands)
- vehicle and equipment maintenance areas
- physical features of the site that may influence discharges of stormwater associated with industrial activities or contribute a dry weather flow
- locations where spills or leaks of reportable quality (as defined in 30 TAC § 327.4) have occurred during the three years before this application was submitted to obtain coverage under an individual permit
- processing areas, storage areas, material loading/unloading areas, and other locations where significant materials are exposed to stormwater (stormwater runoff, snow melt runoff, and surface runoff and drainage)

Check the box to confirm all above information was provided on the facility site map(s).

**Attachment:** N/A

**Item 4. Facility/Site Information (Instructions, Page 90)**

a. Provide the area of impervious surface and the total area drained by each stormwater outfall requested for authorization by this permit application.

**Impervious Surfaces**

<b>Outfall</b>	<b>Area of Impervious Surface (include units)</b>	<b>Total Area Drained (include units)</b>

- b. Provide the following local area rainfall information and the source of the information.  
 Wettest month: N/A  
 Average rainfall for wettest month (total inches): N/A  
 25-year, 24-hour rainfall (inches): N/A  
 Source: N/A
- c. Attach an inventory, or list, of materials currently handled at the facility that may be exposed to precipitation. **Attachment:** N/A
- d. Attach narrative descriptions of the industrial processes and activities involving the materials in the above-listed inventory that occur outdoors or in some manner that may result in exposure of the materials to precipitation or runoff (see instructions for guidance). **Attachment:** N/A
- e. Describe any BMPs and controls the facility uses/proposes to prevent or effectively reduce pollution in stormwater discharges from the facility: N/A

## Item 5. Pollutant Analysis (Instructions, Page 91)

- a. Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): N/A
- b.  Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- c. Complete Table 17 as directed on page 92 of the Instructions.

Table 17 for Outfall No.: N/A

Pollutant	Grab Sample* Maximum (mg/L)	Composite Sample** Maximum (mg/L)	Grab Sample* Average (mg/L)	Composite Sample** Average (mg/L)	Number of Storm Events Sampled	MAL (mg/L)
pH (standard units)	(max)	—	(min)	—		—
Total suspended solids						—
Chemical oxygen demand						—
Total organic carbon						—
Oil and grease						—
Arsenic, total						0.0005
Barium, total						0.003
Cadmium, total						0.001
Chromium, total						0.003
Chromium, trivalent						—
Chromium, hexavalent						0.003
Copper, total						0.002



## Item 6. Storm Event Data (Instructions, Page 93)

Provide the following data for the storm event(s) which resulted in the maximum values for the analytical data submitted:

Date of storm event: N/A

Duration of storm event (minutes): N/A

Total rainfall during storm event (inches): N/A

Number of hours the between beginning of the storm measured and the end of the previous measurable storm event (hours): N/A

Maximum flow rate during rain event (gallons/minute): N/A

Total stormwater flow from rain event (gallons): N/A

Provide a description of the method of flow measurement or estimate:

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 8.0: AQUACULTURE

This worksheet **is required** for all TPDES permit applications requesting individual permit coverage for discharges of aquaculture wastewater.

## Item 1. Facility/Site Information (Instructions, Page 94)

- a. Complete the following table with information regarding production ponds, raceways, and fabricated tanks at the facility.

### Production Pond Descriptions

Number of Ponds	Dimensions (include units)	Area of Each Pond (include units)	Number of Ponds x Area of Ponds (include Units)

Total surface area of all ponds: N/A

### Raceway Descriptions

Number of Raceways	Dimensions (include units)

### Fabricated Tank Descriptions

Number of Tanks	Dimensions (include units)

b. Does the facility have a TPWD-approved emergency plan?

- Yes       No

If **yes**, attach a copy of the approved plan.

**Attachment:** N/A

c. Does the facility have an aquatic plant transplant authorization?

- Yes       No

If **yes**, attach a copy of the authorization letter.

**Attachment:** N/A

d. Provide the number of aquaculture facilities located within 25-miles of this facility: N/A

## Item 2. Species Identification (Instructions, Page 95)

Complete the following table regarding each species raised, source, origin, and disease status of the stock. Identify and attach copies of any current relevant authorizations or permits that authorize the species.

### Stock Species Information

Species	Source of Stock	Origin of Stock	Disease Status	Authorizations

**Attachment:** N/A

## Item 3. Stock Management Plan (Instructions, Page 95)

Attach a detailed stock management plan: N/A

## Item 4. Water Treatment and Discharge Description (Instructions, Page 96)

Attach a detailed description of the discharge practices and water treatment process(es): N/A

## Item 5. Solid Waste Management (Instructions, Page 96)

Attach a description of the solid waste-disposal practices: N/A

## Item 6. Site Assessment Report (Instructions, Page 96)

All new and expanding commercial shrimp facilities located/to be located within the coastal zone must attach a detailed site assessment report which identifies sensitive aquatic habitats within the coastal zone: N/A

# WORKSHEET 9.0

## TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

### CLASS V INJECTION WELL INVENTORY/AUTHORIZATION FORM

Submit the completed form to:

TCEQ  
IUC Permits Team  
Radioactive Materials Division  
MC-233  
PO Box 13087  
Austin, Texas 78711-3087  
512-239-6466

For TCEQ Use Only

Reg. No. \_\_\_\_\_

Date Received \_\_\_\_\_

Date Authorized \_\_\_\_\_

## Item 1. General Information (Instructions Page 99)

### 1. TCEQ Program Area

Program Area (PST, VCP, IHW, etc.): N/A

Program ID: N/A

Contact Name: N/A

Phone Number: N/A

### 2. Agent/Consultant Contact Information

Contact Name: N/A

Address: N/A

City, State, and Zip Code: N/A

Phone Number: N/A

### 3. Owner/Operator Contact Information

Owner  Operator

Owner/Operator Name: N/A

Contact Name: N/A

Address: N/A

City, State, and Zip Code: N/A

Phone Number: N/A

### 4. Facility Contact Information

Facility Name: N/A

Address: N/A

City, State, and Zip Code: N/A

Location description (if no address is available): N/A

Facility Contact Person: N/A

Phone Number: N/A

**5. Latitude and Longitude, in degrees-minutes-seconds**

Latitude: N/A

Longitude: N/A

Method of determination (GPS, TOPO, etc.): N/A

Attach topographic quadrangle map as attachment A.

**6. Well Information**

Type of Well Construction, select one:

- Vertical Injection
- Subsurface Fluid Distribution System
- Infiltration Gallery
- Temporary Injection Points
- Other, Specify: N/A

Number of Injection Wells: N/A

**7. Purpose**

Detailed Description regarding purpose of Injection System:

N/A
-----

Attach a Site Map as Attachment B (Attach the Approved Remediation Plan, if appropriate.)

**8. Water Well Driller/Installer**

Water Well Driller/Installer Name: N/A

City, State, and Zip Code: N/A

Phone Number: N/A

License Number: N/A

**Item 2. Proposed Down Hole Design**

Attach a diagram signed and sealed by a licensed engineer as Attachment C.

**Down Hole Design Table**

Name of String	Size	Setting Depth	Sacks Cement/Grout - Slurry Volume - Top of Center	Hole Size	Weight (lbs/ft) PVC/Steel
Casing					
Tubing					
Screen					

### Item 3. Proposed Trench System, Subsurface Fluid Distribution System, or Infiltration Gallery

Attach a diagram signed and sealed by a licensed engineer as Attachment D.

System(s) Dimensions: N/A

System(s) Construction: N/A

### Item 4. Site Hydrogeological and Injection Zone Data

1. Name of Contaminated Aquifer: N/A

2. Receiving Formation Name of Injection Zone: N/A

3. Well/Trench Total Depth: N/A

4. Surface Elevation: N/A

5. Depth to Ground Water: N/A

6. Injection Zone Depth: N/A

7. Injection Zone vertically isolated geologically?  Yes  No

Impervious Strata between Injection Zone and nearest Underground Source of Drinking Water:

Name: N/A

Thickness: N/A

8. Attach a list of contaminants and the levels (ppm) in contaminated aquifer as Attachment E.

9. Attach the Horizontal and Vertical extent of contamination and injection plume as Attachment F.

10. Attach Formation (Injection Zone) Water Chemistry (Background levels) TDS, etc., as Attachment G.

11. Injection Fluid Chemistry in PPM at point of injection. Attach as Attachment H.

12. Lowest Known Depth of Ground Water with < 10,000 PPM TDS: N/A

13. Maximum injection Rate/Volume/Pressure: N/A

14. Water wells within 1/4 mile radius (attach map as Attachment I): N/A

15. Injection wells within 1/4 mile radius (attach map as Attachment J): N/A

16. Monitor wells within 1/4 mile radius (attach drillers logs and map as Attachment K): N/A

17. Sampling frequency: N/A

18. Known hazardous components in injection fluid: N/A

## Item 5. Site History

1. Type of Facility: N/A
2. Contamination Dates: N/A
3. Original Contamination (VOCs, TPH, BTEX, etc.) and Concentrations. Attach as Attachment L.
4. Previous Remediation. Attach results of any previous remediation as Attachment M.

**NOTE:** Authorization Form should be completed in detail and authorization given by the TCEQ before construction, operation, and/or conversion can begin. Attach additional pages as necessary.

## Item 6. CLASS V INJECTION WELL DESIGNATIONS

- 5A07 Heat Pump/AC return (IW used for groundwater to heat or cool buildings)
- 5A19 Industrial Cooling Water Return Flow (IW used to cool industrial process equipment)
- 5B22 Salt Water Intrusion Barrier (IW used to inject fluids to prevent the intrusion of salt water into an aquifer)
- 5D02 Stormwater Drainage (IW designed for the disposal of rain water)
- 5D04 Industrial Stormwater Drainage Wells (IW designed for the disposal of rain water associated with industrial facilities)
- 5F01 Agricultural Drainage (IW that receive agricultural runoff)
- 5R21 Aquifer Recharge (IW used to inject fluids to recharge an aquifer)
- 5S23 Subsidence Control Wells (IW used to control land subsidence caused by groundwater withdrawal)
- 5W09 Untreated Sewage
- 5W10 Large Capacity Cesspools (Cesspools that are designed for 5,000 gpd or greater)
- 5W11 Large Capacity Septic systems (Septic systems designed for 5,000 gpd or greater)
- 5W12 WTPP disposal
- 5W20 Industrial Process Waste-disposal Wells
- 5W31 Septic System (Well Disposal method)
- 5W32 Septic System Drainfield Disposal
- 5X13 Mine Backfill (IW used to control subsidence, dispose of mining byproducts, or fill sections of a mine)
- 5X25 Experimental Wells (Pilot Test) (IW used to test new technologies or tracer dye studies)
- 5X26 Aquifer Remediation (IW used to clean up, treat, or prevent contamination of a USDW)
- 5X27 Other Wells
- 5X28 Motor Vehicle Waste-disposal Wells (IW used to dispose of waste from a motor vehicle site - These are currently banned)
- 5X29 Abandoned Drinking Water Wells (waste disposal)

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 10.0: QUARRIES IN THE JOHN GRAVES SCENIC RIVERWAY

This worksheet **is required** for all applications for individual permits for a municipal solid waste facility or mining facility located within a Water Quality Protection Area in the John Graves Scenic Riverway. **Note: Review 30 TAC §§ 311.71-311.82 thoroughly prior to completing any portion of this worksheet.**

## Item 1. Exclusions (Instructions, Page 100)

- a. Is this a municipal solid waste facility?  
 Yes  No
- b. Has this quarry been in operation since January 1, 1994 without cessation of operation for more than 30 consecutive days and under the same ownership?  
 Yes  No
- c. Is this a coal mine?  
 Yes  No
- d. Is this facility mining clay and/or shale for use in manufacturing structural clay products?  
 Yes  No

If **yes** to **any** above question, **stop here**. The facility is required to maintain documentation, as outlined in *30 TAC § 311.72(c)*, at the facility to demonstrate the exclusion(s).

## Item 2. Location of the Quarry (Instructions, Page 101)

Check the box next to the distance between the quarry and the nearest navigable water body:

- < 200 feet    200 feet - 1,500 feet    1,500 feet - 1 mile    > 1 mile

**NOTE:** The construction or operation of any new quarry or expansion of any existing quarry **is prohibited** within 200 feet of any water body located within a Water Quality Protection Area in the John Graves Scenic Riverway.

## Item 3. Additional Requirements (Instructions, Page 101)

Use the table in the Instructions to determine if additional application requirements apply to the facility based on distance between the quarry and the nearest waterway. Attach as appropriate or enter N/A.

- a. Attach a Restoration Plan: N/A
- b. Amount of Financial Assurance for Restoration: \$ N/A  
Mechanism: N/A
- c. Attach a Technical Demonstration: N/A
- d. Attach a Reclamation Plan: N/A
- e. Amount of Financial Assurance for Reclamation: \$ N/A  
Mechanism: N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 11.0: COOLING WATER SYSTEM INFORMATION

This worksheet is required for all TPDES permit applications that meet the conditions outlined in Technical Report 1.0, Item 12.

## Item 1. Cooling Water System Data (Instructions, Page 104)

a. Complete the following table with information regarding the cooling water system.

**Cooling Water System Data**

Parameter	Volume (include units)
Total DIF	
Total AIF	
Intake Flow Use(s) (%)	
Contact cooling	
Non-contact cooling	
Process Wastewater	
Other	

b. Attach the following information:

1. A narrative description of the design and annual operation of the facility's cooling water system and its relationship to the CWIS(s).
2. A scaled map depicting the location of each CWIS, impoundment, intake pipe, and canals, pipes, or waterways used to convey cooling water to, or within, the cooling water system. Provide the latitude and longitude for each CWIS and any intake pipe(s) on the map. Indicate the position of the intake pipe within the water column.
3. A description of water reuse activities, if applicable, reductions in total water withdrawals, if applicable, and the proportion of the source waterbody withdrawn (on a monthly basis).
4. Design and engineering calculations prepared by a qualified professional and data to support the information provided in above item a.
5. Previous year (a minimum of 12 months) of AIF data.
6. A narrative description of existing or proposed impingement and entrainment technologies or operation measures and a summary of their performance, including, but not limited to, reductions in impingement mortality and entrainment due to intake location and reductions in total water withdrawals and usage.

**Attachment:** N/A

## Item 2. Cooling Water Intake Structure(s) Data (Instructions, Page 105)

- a. Complete the following table with information regarding each cooling water intake structure (this includes primary and make-up CWIS(s)).

### Cooling Water Intake Structure(s) Data

<b>CWIS ID</b>				
DIF (include units)				
AIF (include units)				
Intake Flow Use(s) (%)				
Contact cooling				
Non-contact cooling				
Process Wastewater				
Other				
Latitude (decimal degrees)				
Longitude (decimal degrees)				

- b. Attach the following information regarding the CWIS(s):
1. A narrative description of the configuration of each CWIS, annual and daily operation, including any seasonal changes, and where it is located in the water body and in the water column.
  2. Engineering calculations for each CWIS.

Attachment: N/A

## Item 3. Source Water Physical Data (Instructions, Page 105)

- a. Complete the following table with information regarding the CWIS(s) source waterbody (this includes primary and make-up CWIS(s)).

### Source Waterbody Data

<b>CWIS ID</b>				
Source Waterbody				
Mean Annual Flow				
Source				

- b. Attach the following information regarding the source waterbody.
1. A narrative description of the source water for each CWIS, including areal dimensions, depths, salinity and temperature regimes, and other documentation that supports this determination of the water body type where each cooling water intake structure is located.

2. A narrative description of the source waterbody's hydrological and geomorphological features.
3. Scaled drawings showing the physical configuration of all source water bodies used by the facility, including the source waterbody's hydrological and geomorphological features. **NOTE:** The source waterbody's hydrological and geomorphological features may be included on the map submitted for item 1.b.ii of this worksheet.
4. A description of the methods used to conduct any physical studies to determine the intake's area of influence within the waterbody and the results of such studies.

**Attachment:** N/A

## Item 4. Operational Status (Instructions, Page 106)

a. Is this application for a power production or steam generation facility?

- Yes       No

If **no**, proceed to Item 4.b. If **yes**, provide the following information as an attachment:

1. Describe the operating status of each individual unit, including age, capacity utilization rate (or equivalent) for the previous five years (a minimum of 60 months), and any seasonal changes in operation.
2. Describe any extended or unusual outages or other factors which significantly affect current data for flow, impingement, entrainment.
3. Identify any operating unit with a capacity utilization rate of less than 8 percent averaged over a contiguous period of two years (a minimum of 24 months).
4. Describe any major upgrades completed within the last 15 years, including but not limited to boiler replacement, condenser replacement, turbine replacement, or changes of fuel type.

**Attachment:** N/A

b. Process Units

1. Is this application for a facility which has process units that use cooling water (other than for power production or steam generation)?

- Yes       No

If **no**, proceed to Item 4.c. If **yes**, continue.

2. Does the facility use or intend to use reductions in flow or changes in operations to meet the requirements of *40 CFR § 125.94(c)*?

- Yes       No

If **no**, proceed to Item 4.c. If **yes**, attach descriptions of the following information:

- Individual production processes and product lines
- The operating status, including age of each line and seasonal operation
- Any extended or unusual outages that significantly affect current data for flow, impingement, entrainment, or other factors

- Any major upgrades completed within the last 15 years and plans or schedules for decommissioning or replacement of process units or production processes and product lines.

**Attachment:** N/A

c. Is this an application for a nuclear power production facility?

Yes       No

If **no**, proceed to Item 4.d. If **yes**, attach a description of completed, approved, or scheduled upgrades and the Nuclear Regulatory Commission relicensing status for each unit at the facility.

**Attachment:** N/A

d. Is this an application for a manufacturing facility?

Yes       No

If **no**, proceed to Worksheet 11.1. If **yes**, attach descriptions of current and future production schedules and any plans or schedules for any new units planned within the next five years (a minimum of 60 mos)

**Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 11.1: IMPINGEMENT MORTALITY

This worksheet is **required** for all TPDES permit applications that meet the conditions outlined in **Technical Report 1.0, Item 12**. Complete one copy of this worksheet for each individual CWIS the facility uses or proposes to use.

CWIS ID: N/A

## Item 1. Impingement Compliance Technology Selection (Instructions, Page 107)

Check the box next to the method of compliance for the Impingement Mortality Standard selected by the facility.

- Closed-cycle recirculating system (CCRS) [40 CFR § 125.94(c)(1)]
- 0.5 ft/s Through-Screen Design Velocity [40 CFR § 125.94(c)(2)] - Proceed to Worksheet 11.2
- 0.5 ft/s Through Screen Actual Velocity [40 CFR § 125.94(c)(3)]
- Existing offshore velocity cap [40 CFR § 125.94(c)(4)] - Proceed to Worksheet 11.2
- Modified traveling screens [40 CFR § 125.94(c)(5)]
- System of technologies [40 CFR § 125.94(c)(6)]
- Impingement mortality performance standard [40 CFR § 125.94(c)(7)]
- De minimis rate of impingement [40 CFR § 125.94(c)(11)]
- Low capacity utilization power-generation facilities [40 CFR § 125.94(c)(12)]

If 0.5 ft/s Through-Screen Design Velocity [40 CFR § 125.94(c)(2)] or existing offshore velocity cap [40 CFR § 125.94(c)(4)] was selected, proceed to Worksheet 11.2. Otherwise, continue to Item 2.

## Item 2. Impingement Compliance Technology Information (Instructions, Page 107)

Complete the following sections based on the selection made for item 1 above.

a. CCRS [40 CFR § 125.94(c)(1)]

- Check this box to confirm the CWS meets the definition of CCRS located at 40 CFR § 125.91(c) and provide a response to the following questions.

1. Does the facility use or propose to use a CWIS to replenish water losses to the CWS?

- Yes       No

If **no**, proceed to item a.2. If **yes**, provide the following information as an attachment and continue.

- CWIS ID
- 12 months of intake flow data for any CWIS used for make-up intake flows to replenish cooling water losses, excluding intakes for losses due to blowdown, drift, or evaporation.

- A narrative description of any physical or operational measures taken to minimize make-up withdraws.

**Attachment:** N/A

**NOTE:** Do not complete a separate Worksheet 11.1 for a make-up CWIS.

2. Does the facility use or propose to use cooling towers?

- Yes       No

If **no**, proceed to Worksheet 11.2. If **yes**, provide the following information and proceed to Worksheet 11.2.

- Average number of cycles of concentration (COCs) prior to blowdown:

**Average COCs Prior to Blowdown**

<b>Cooling Tower ID</b>				
COCs				

- Attach COC monitoring data for each cooling tower from the previous year (a minimum of 12 months): N/A
- Maximum number of COCs each cooling tower can accomplish based on design of the system.

**Calculated COCs Prior to Blowdown**

<b>Cooling Tower ID</b>				
COCs				

- Describe conditions that may limit the number of COCs prior to blowdown, if any, including but not limited to permit conditions: N/A

b. 0.5 ft/s Through Screen Actual Velocity [40 CFR § 125.94(c)(3)]

Provide daily intake flow measurement monitoring data from the previous year (a minimum of 12 months) as an attachment and proceed to Worksheet 11.2.

**Attachment:** N/A

c. Modified traveling screens [40 CFR § 125.94(c)(5)]

Provide the following information as an attachment and proceed to Worksheet 11.2.

1. A description of the modified traveling screens and associated equipment.
2. A site-specific impingement technology performance optimization study that includes a narrative description of the biological data collection methods
3. Biological sampling data from the previous two years (a minimum of 24 months).

**Attachment:** N/A

d. System of technologies [40 CFR § 125.94(c)(6)] or impingement mortality performance standard [40 CFR § 125.94(c)(7)]

Provide the following information as an attachment and proceed to Worksheet 11.2.

1. A description of the system of technologies used or proposed for use by the facility to

achieve compliance with the impingement mortality standard.

2. A site-specific impingement technology performance optimization study that includes a narrative description of the biological data collection methods.
3. Biological sampling data from the previous two years (a minimum of 24 months).

**Attachment:** N/A

- e. De minimis rate of impingement [*40 CFR § 125.94(c)(11)*]

Provide the following information and proceed to Worksheet 11.2.

1. Attach monitoring data from the previous year (a minimum of 12 months) of intake flow measured at a frequency of 1/day on days of operation.

**Attachment:** N/A

2. If the rate of impingement caused by the CWIS is extremely low (at an organism or age-one equivalent count), attach supplemental information to Worksheet 11.0, item 1.b.6. to support this determination.

**Attachment:** N/A

- f. Low capacity utilization power-generation facilities [*40 CFR § 125.94(c)(12)*]

Attach monthly utilization data from the previous 2 years (a minimum of 24 months) for each operating unit and proceed to Worksheet 11.2.

**Attachment:** N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION

## WORKSHEET 11.2: SOURCE WATER BIOLOGICAL DATA

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** source waterbody of a CWIS for which a facility has selected an Impingement Mortality Technology Option described at *40 CFR §§ 125.94(c)(1)-(7)*.

Name of source waterbody: N/A

### Item 1. Species Management (Instructions, Page 109)

- a. The facility has obtained an incidental take permit for its cooling water intake structure(s) from the USFWS or the NMFS.

Yes       No

If yes, attach any information submitted in order to obtain that permit, which may be used to supplement the permit application information requirements of paragraph *40 CFR § 125.95(f)*.

**Attachment:** N/A

- b. Is the facility requesting a waiver from application requirements at *40 CFR § 122.21(r)(4)* in accordance with *40 CFR § 125.95* for any CWIS(s) that withdraw from a man-made reservoir that is stocked and managed by a state or federal natural resources agency or the equivalent?

Yes       No

If **yes**, attach a copy of the most recent managed fisheries report to TPWD, or equivalent.

**Attachment:** N/A

- c. There are no federally listed threatened or endangered species or critical habitat designations within the source water body.

True    False

### Item 2. Source Water Biological Data (Instructions, Page 109)

New Facilities (Phase I, Track I and II)

- Provide responses to all items in this section and stop.

Existing Facilities (Phase II)

- If the answer to **1.b.** above was **no**, provide responses to all items in this section and proceed to Worksheet 11.3.
- If the answer to **1.b.** was **yes** and **1.c.** was **true**, do not complete any items in this section and proceed to Worksheet 11.3.
- If the answer to **1.b.** was **yes** and **1.c.** was **false**, attach a response for any item in this section that is not contained within the most recent TPWD, or equivalent and proceed to Worksheet 11.3.

**Attachment:** N/A

- a. A list of the data requested at *40 CFR § 122.21(r)(4)(ii)* through *(vi)* that are not available, and efforts made to identify sources of the data.
- b. Provide a list of species (or relevant taxa) in the vicinity of the CWIS and identify the following information regarding each species listed.
  - all life stages and their relative abundance,
  - identification of all species and life stages that would be most susceptible to impingement and entrainment,
  - forage base,
  - significance to commercial fisheries,
  - significance to recreational fisheries,
  - primary period of reproduction,
  - larval recruitment, and
  - period of peak abundance for relevant taxa.
- c. Data representative of the seasonal and daily activities (e.g., feeding and water column migration) of biological organisms in the vicinity of the CWIS(s).
- d. Identify all threatened, endangered, and other protected species that might be susceptible to impingement and entrainment at the CWIS(s).
- e. Documentation of any public participation or consultation with federal or state agencies undertaken.

The following is required for existing facilities only. Include the following information with the above listed attachment.

- f. Identify any protective measures and stabilization activities that have been implemented and provide a description of how these measures and activities affected the baseline water condition in the vicinity of the intake.
- g. A list of fragile species, as defined at *40 CFR § 125.92(m)*, at the facility. The applicant need only identify those species not already identified as fragile at *40 CFR § 125.92(m)*.

**NOTE:** New units at an existing facility are not required to resubmit this information if the cooling water withdrawals for the operation of the new unit are from an existing intake.

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 11.3: ENTRAINMENT

This worksheet is **required** for all TPDES permit applications that **meet the conditions outlined in Technical Report 1.0, Item 12**. Complete one copy of this worksheet for **each** individual CWIS the facility uses or proposes to use.

CWIS ID: N/A

## Item 1. Applicability (Instructions, Page 111)

Is the AIF of the CWIS identified above greater than, or equal to, 125 MGD?

Yes  No

- If **no** or the facility has selected **CCRS** [40 CFR § 125.94(c)(1)] for the impingement mortality compliance method, complete Item 2 and stop here.
- If **yes** and the facility is **seeking a waiver** from application requirements in accordance with 40 CFR § 125.95 for any CWIS(s) that withdraw from a man-made reservoir that is stocked and managed by a state or federal natural resources agency or the equivalent, complete item 2 and stop.
- If **yes** and the facility is **not seeking a waiver** from application requirements in accordance with 40 CFR § 125.95, complete item 2 and provide any required and completed studies listed in item 3. For any required studies in item 3 that are not complete, provide a detailed explanation for the delay and an anticipated schedule for completion and submittal.

## Item 2. Existing Entrainment Performance Studies (Instructions, Page 111)

Attach any previously conducted studies or studies obtained from other facilities addressing technology efficacy, through-facility entrainment survival, and other entrainment studies.

Attachment: N/A

## Item 3. Facility Entrainment Performance Studies (Instructions, Page 111)

- a. Attach an entrainment characterization study, as described at 40 CFR § 122.21(r)(9): N/A
- b. Attach a comprehensive feasibility study, as described as 40 CFR § 122.21(r)(10): N/A
- c. Attach a benefits valuation study, as described as 40 CFR § 122.21(r)(11): N/A
- d. Attach a non-water quality environmental and other impacts study, as described as 40 CFR § 122.21(r)(12): N/A
- e. Attach a peer review analysis, as described as 40 CFR § 122.21(r)(13): N/A

# INDUSTRIAL WASTEWATER PERMIT APPLICATION WORKSHEET 12.0: OIL AND GAS EXPLORATION, DEVELOPMENT, AND PRODUCTION WASTEWATER DISCHARGES

This worksheet **is required** for all TPDES permit applications that are subject to Effluent Limitation Guidelines in 40 CFR Part 435.

## Item 1. Operational Information (Instructions, Page 112)

- a. Is the wastewater from an oil and gas exploration, development, or production facility located west of the 98th meridian?

Yes     No

If yes, continue to the next question. If no, skip to Item 2 relating to Production/Process Data.

- b. Provide justification for how the wastewater is/will be used for agriculture or wildlife propagation.

N/A

## Item 2. Production/Process Data (Instructions, Page 112)

- a. Provide the applicable 40 CFR Part 435 Subpart(s).

N/A

- b. Describe if the permit being sought is for discharges from exploration, development, production, or for a combination of more than one of those activities.

N/A





### Item 3. Pollutant Analysis (Instructions, Page 113)

Tables 1, 2, 6, and 7 located in Worksheet 2.0 are required. In addition, Table 19 below is required and must be completed for each outfall and submitted with this application. The remaining tables in Worksheet 2.0, are required as applicable.

- a. Provide the date range of all sampling events conducted to obtain the analytical data submitted with this application (e.g., 05/01/2018-05/30/2018): No Discharge from the last 5 years
- b.  Check the box to confirm all samples were collected no more than 12 months prior to the date of application submittal.
- c. Read the general testing requirements in the instructions for important information about sampling, test methods, and MALs. If a contact laboratory was used, attach a list which includes the name, contact information, and pollutants analyzed for each laboratory/firm. **Attachment** N/A; NO DISCHARGE SINCE 2015
- d. Attach correspondence from TCEQ approving submittal of less than the required number of samples, if applicable. **Attachment:** N/A

Table 19 for Outfall No.: N/A

Samples are (check one):  Composite  Grab

Pollutant	Sample 1 (mg/L)*	Sample 2 (mg/L)*	Sample 3 (mg/L)*	Sample 4 (mg/L)*
Calcium				
Potassium				
Sodium				

\*Indicate units if different from mg/L.




TPDES Permit No. WQ0004437-000

# Ultrafiltration Water Treatment Plant

## Process Schematic

### Normal Operations

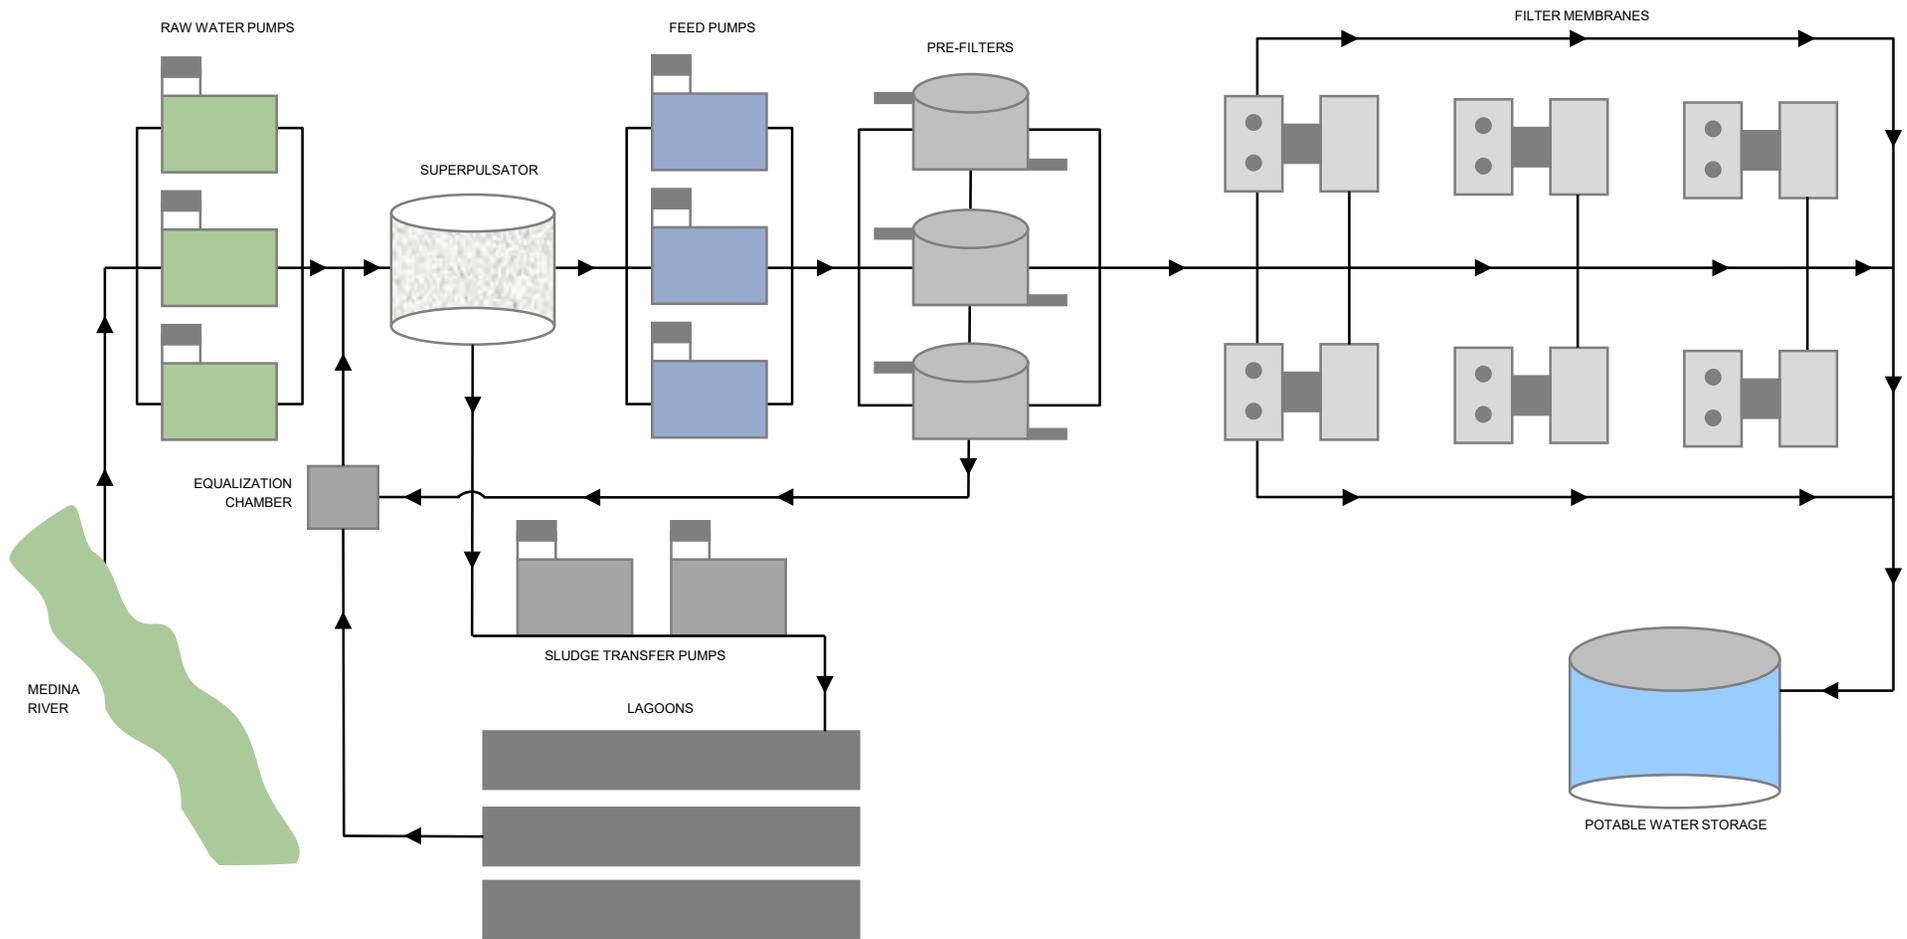




TPDES Permit No. WQ0004437-000

# Ultrafiltration Water Treatment Plant

## Process Schematic

Excessively Turbid Source Water

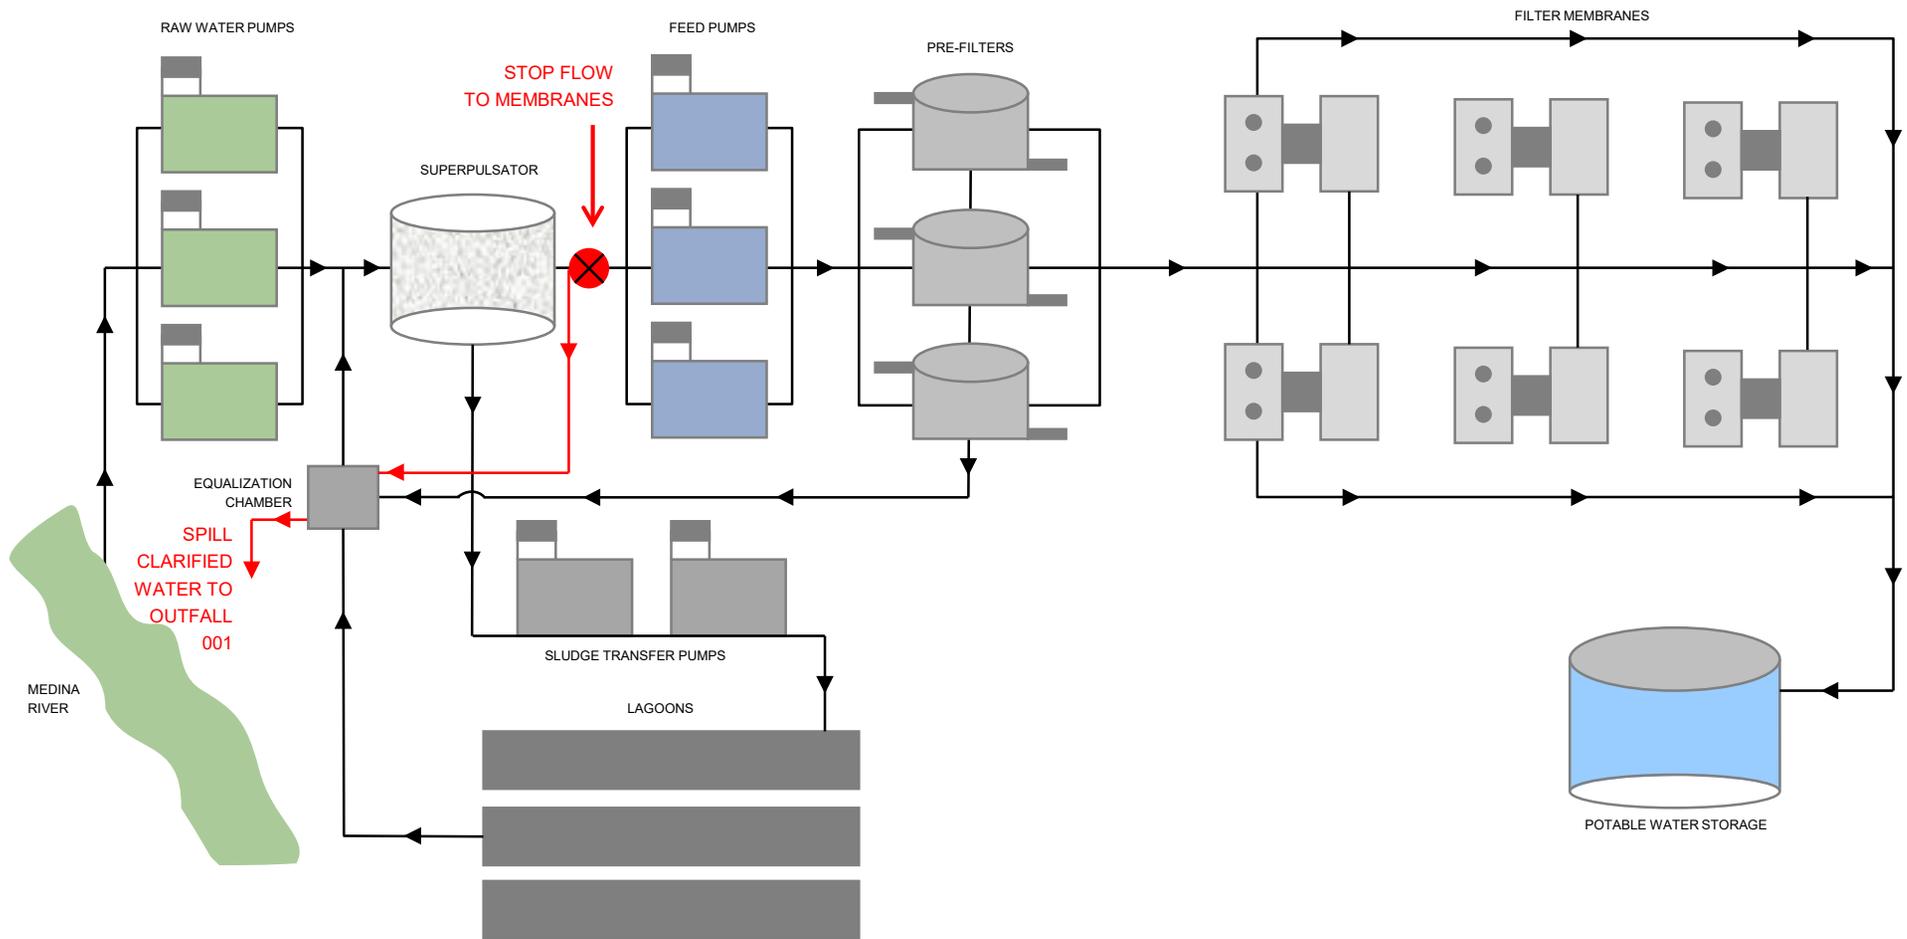



May 20, 2024

TCEQ Remediation Division – MC 127  
Corrective Action, VCP-CA Section  
P.O. Box 13087  
12100 Park 35 Circle, Building D  
Austin, TX 78711-3087

**RE:** Sludge Lagoons Closure Report and Closure Request  
Release Determination Activities and Reporting  
San Antonio Water System Ultrafiltration Water Treatment Plant  
6725 Agua Pura Street, Von Ormy, Texas.  
RN103114724; CN600529069; WQ0004437000

Dear Sir/Madam,

In October 2023, Mr. Felix Gonzales, TCEQ Environmental Investigator, San Antonio Region Office inspected the facility and at the time of the inspection, a "closure" plan for the three inactive sludge lagoons currently authorized by WQ0004437000. Although the permit is still active, there has been no treatment process(es) have occurred at the facility, and a "NO DISCHARGE" report is submitted monthly. The San Antonio Water System engaged Weston Solutions, Inc. (WESTON®) to perform a site assessment and closure-related activities for the inactive sludge lagoons (**ATTACHMENT A**).

Therefore, SAWS respectfully requests that a closure letter be issued for the inactive sludge lagoons. Thank you for your consideration and should you need additional information, please do not hesitate to contact Floramie Welch, Environmental Analyst III, at 210-233-3744.

Sincerely,



Scott R. Halty  
Director, Resource Protection & Compliance

Attachment: SLUDGE LAGOON CLOSURE REPORT

cc: Javier Anguiano, TCEQ, Region 13  
Felix Gonzales, TCEQ, Region 13  
Jack Higginbotham, TCEQ, Region 13  
Rogelio Placencia, SAWS, Sr. Director, Production Operations  
Rob Escobar, SAWS, Manager, Production Operations  
Vicente Garza, P.E., SAWS Manager, Engineering Operations Support  
Lee Bausinger, P.E., SAWS Manager, Engineering Operations Support  
Gregg Eckhardt, SAWS, Sr. Resource Analyst, Production Operations  
Floramie Welch, SAWS, Environmental Analyst III, Resource Protection & Compliance

Texas Commission on Environmental Quality  
**Remediation Division Correspondence Identification Form**

**SITE & PROGRAM AREA IDENTIFICATION**

SITE LOCATION		REMEDIATION DIVISION PROGRAM AND FACILITY IDENTIFICATION	
Site Name: <b>Ultrafiltration Water Plant</b>		Is This Site Being Managed Under A State Lead Contract? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	
Address 1: <b>6725 Agua Pura Street</b>		Program Area:	IHW CORRECTIVE ACTION ▼
Address 2:		Mail Code:	<b>MC-127</b>
City: <b>Von Army</b>	State: <b>Texas</b>	Is This A New Site To This Program Area? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Zip Code: <b>78073</b>	County: <b>Bexar</b> ▼		<b>WQ0004437000</b>
TCEQ Region: <b>Region 13 - San Antonio</b>		--Leave This Field Blank--	--Leave This Field Blank--

**DOCUMENT(S) IDENTIFICATION**

PHASE OF REMEDIATION	DOCUMENT NAME
1. ▼	▼
2. ▼	▼
3. ▼	▼
4. ▼	▼
5. ▼	▼

**CONTACT INFORMATION**

**RESPONSIBLE PARTY/APPLICANT/CUSTOMER**

Name: <b>Vicente J. Garza, P.E.</b>	Phone Number: <b>210-233-3596</b>	Fax Number:
Company: <b>San Antonio Water System</b>	City: <b>San Antonio</b>	State: <b>TX</b>
Address 1: <b>2800 US Hwy 281 North</b>	Email Address: <b>arlopez@texas-ec.org</b>	Zip Code: <b>78212</b>
Address 2:		

**ENVIRONMENTAL CONSULTANT/REPORT PREPARER/AGENT**

Name: <b>Nancy L. Koch, P.E.</b>	Phone Number: <b>512-651-7104</b>	Fax Number:
Company: <b>Weston Solutions, Inc.</b>	City: <b>Austin</b>	State: <b>TX</b>
Address 1: <b>5301 Southwest Parkway, Suite 450</b>	Email Address: <b>Nancy.koch@westonsolutions.com</b>	Zip Code: <b>78735</b>
Address 2:		

**TCEQ INTERNAL USE ONLY**

Document No.	TCEQ Database Term	Document No.	TCEQ Database Term
1.		4.	
2.		5.	
3.			



Weston Solutions, Inc.  
5301 Southwest Parkway, Suite 450  
Austin, TX, 78735  
512-651-7100  
WestonSolutions.com



30 April 2024

TCEQ Remediation Division – MC 127  
Corrective Action, VCP-CA Section  
P.O. Box 13087  
12100 Park 35 Circle, Building D  
Austin, TX 78711-3087

Also via: [corract@tceq.texas.gov](mailto:corract@tceq.texas.gov)

**RE: Sludge Lagoons Closure Report and Closure Request  
Ultrafiltration Water Plant, 6725 Agua Pura Street, Von Ormy, Texas.  
WQ0004437000  
RN103114724/CN600529069**

To Whom it May Concern:

On behalf of San Antonio Water System (SAWS), Weston Solutions, Inc. (WESTON®) submits the enclosed original and electronic copy (via [corract@tceq.texas.gov](mailto:corract@tceq.texas.gov)) of the Sludge Lagoons Closure Report and Closure Request. This Closure Report and Request addresses three inactive sludge lagoons currently authorized by WQ0004437000.

We appreciate your consideration of this request. Should you have any questions, please call me at (512) 651-7104.

Sincerely,

**Weston Solutions, Inc.**

Nancy L. Koch, P.E.  
Senior Project Engineer

cc: Jack Higginbotham, TCEQ, Waste Section Manager, San Antonio Region 13 Office (via email – [jack.higginbotham@tceq.texas.gov](mailto:jack.higginbotham@tceq.texas.gov))

Vicente J. Garza., Engineering Manager, Operations Support, SAWS (via email)

**SLUDGE LAGOON CLOSURE REPORT AND CLOSURE REQUEST  
TPDES PERMIT WQ0004437000**

**ULTRAFILTRATION WATER TREATMENT PLANT  
6725 AGUA PURA STREET  
VON ARMY, TEXAS 78073  
TCEQ REGION 13 – SAN ANTONIO**



Prepared for:  
**San Antonio Water System**  
Vincente J Garza, P.E., PMP,  
Engineering Manager  
2800 U.S. Hwy 281 North  
San Antonio, Texas 78212

Prepared by:  
**WESTON SOLUTIONS, INC.**  
70 NE Interstate 410 Loop, #200  
San Antonio, Texas 78216  
210-308-4300

May 2024

W.O. No. 10412.036.001.0003



---

## TABLE OF CONTENTS

---

Section	Page
1. EXECUTIVE SUMMARY AND INTRODUCTION.....	1
2. BACKGROUND INFORMATION.....	1
3. CLOSURE INFORMATION .....	2
3.1 RELEASE DETERMINATION.....	2
4. CONCLUSION AND REQUEST FOR CLOSURE.....	5
5. REFERENCES.....	5

---

## LIST OF FIGURES

---

Figure 1	Site Location Map
Figure 2	Site Layout Map

---

## LIST OF TABLES

---

Table 1	Soil Volatile Organic Compounds Summary
Table 2	Soil Semi-Volatile Organic Compounds Summary
Table 3	Soil Total Metals Summary
Table 4	Soil Metals Synthetic Precipitation and Leachate Procedure Summary
Table 5	Groundwater Arsenic Summary

---

## ATTACHMENTS

---

Attachment 1	Field Notes
Attachment 2	Laboratory Analytical Data Packages
Attachment 3	Boring Log

---

## LIST OF ACRONYMS

---

bgs	below grade surface
COCs	Chemicals of Concern
GW	groundwater
PID	photoionization detector
ppm	parts per million
RALs	Residential Assessment Levels
SAWS	San Antonio Water System
SDL	sample detection level
SPLP	Synthetic Precipitate Leachate Procedure
SVOCs	Semi-volatile Organic Compounds
TCEQ	Texas Commission on Environmental Quality
TPDES	Texas Pollution Discharge Elimination System
TRRP	Texas Risk Reduction Program
TSSBC	Texas-Specific Soil Background Concentration
U.S. EPA	United States Environmental Protection Agency
VOC	Volatile Organic Compounds
WESTON <sup>®</sup>	Weston Solutions, Inc.

## 1. EXECUTIVE SUMMARY AND INTRODUCTION

Weston Solutions, Inc. (WESTON®) is submitting this Closure Report on behalf of San Antonio Water System (SAWS) for the three sludge lagoons at the Ultrafiltration Water Treatment Plant located at 6725 Agua Pura Street in the City of Von Ormy, Texas (Site). A Site Location Map showing the general location and topography is included as **Figure 1**, and a Site Layout Map depicting the Site boundary and features is included as **Figure 2**.

The SAWS Ultrafiltration Water Treatment Plant is regulated under Texas Pollutant Discharge Elimination System (TPDES) Permit WQ0004437000 (the Permit; TCEQ 2020), which includes three inactive sludge lagoons that managed industrial solid waste from the water treatment plant from the late 1990s to approximately 2016. The three sludge lagoons are required to be closed in accordance with the provisions of the Texas Commission on Environmental Quality (TCEQ) Texas Risk Reduction Program (TRRP) based on their management of solid waste. This Closure Report was prepared to satisfy requirements listed in *TCEQ Regulatory Guidance - Closure of Waste-Management Units Subject to TRRP*. (TCEQ 2011)

An investigation of soils within the lagoons and groundwater beneath the lagoons was conducted. The results indicate there has not been a release of any chemicals of concern (COCs) and that the residential assessment levels (RALs) under the TRRP have been met. No further action is necessary for the three sludge lagoons to be eligible for closure.

## 2. BACKGROUND INFORMATION

The Ultrafiltration Water Treatment Plant was constructed in the late 1990s by United Water. Bexar Met Water District took over facility operations in the mid-2000s. SAWS took control of the facility in 2012. The Ultrafiltration Water Treatment Plant filtered and processed raw groundwater to potable drinking water levels for distribution to the local population. Three sludge lagoons were constructed to hold wastewater from the treatment plant prior to discharging. According to the original 1998 construction plans, the three sludge lagoons totaled approximately 2.8 acres and were approximately 9 feet deep. The sludge lagoons were constructed with a 12-inch-thick native compacted clay bottom, and 12-inch-thick “soil cement” on the sloped sides (Montgomery Watson, 1998). The wastewater

from the treatment plant transferred to the three sludge lagoons included settled solids from the raw water clarifier, residual solids from prefilter, and membrane backwash.

SAWS ceased operations at the facility in approximately 2016 and the plant and the three lagoons have been out of service for 8 years. The discharge location on the southwest side of the lagoons is identified as Outfall 001 in the Permit. Discharged water would sheet flow to the west and into an unnamed branch, and then flow south into O.R. Mitchell Lake 1 (TCEQ, 2020). The facility, surface impoundment/lagoons, and outfall location are depicted on **Figure 2**.

### **3. RELEASE INVESTIGATION/CLOSURE INFORMATION**

The sludge lagoons are proposed to be closed through Closure Option A – Closure without physical controls. As described below, soil and groundwater samples collected as part of the release determination activities did not indicate a release had occurred.

#### **3.1 RELEASE DETERMINATION**

Release determination activities were conducted to identify possible releases of COCs from the three lagoons. The lagoons had been inactive since approximately 2016 and were dry and grass-covered during the sampling. Field notes from the release determination activities are included as **Attachment 1**.

##### **Soil Assessment**

On February 20, 2024, six surface soil samples (SS-1 through SS-6) and one field duplicate (SS-DUP – duplicate of SS-6) were collected from six locations within the lagoons and analyzed for a broad spectrum of COCs. In addition, a background soil sample (SS-background) was collected approximately 250 feet southwest of the three lagoons for background metals concentrations. Soils on the surface of the lagoon floors generally consisted of brown to tan coarse sand/sandy clay with some gravel (1/4-inch diameter). A very thin layer of soil/material was visible on the material comprising the lagoon liner, suggesting that any accumulated waste in the lagoons had been previously removed. All soil samples were screened with a photoionization detector (PID), and screening results ranged from 0.0 parts per million (ppm) to 0.5 ppm. Soil sample locations are displayed on **Figure 2**.

Soil samples were collected into laboratory-provided glass jars, which were sealed in a waterproof plastic bag. The samples were then placed on ice in laboratory-provided coolers and shipped by FedEx under chain-of-custody procedure to DHL Analytical in Round Rock, Texas, for the below analysis.

- Volatile organic compounds (VOCs) by U.S. EPA Method 8260
- Semi-volatile organic compounds (SVOCs) by U.S. EPA Method 8270
- Total metals by U. S. EPA Method 6020/7471

Laboratory analytical results were compared to the Tier 1 Residential Assessment Levels (RALs) for soil-to-groundwater ingestion ( $^{GW}Soil_{Ing}$ ) and direct contact with soil ( $^{Total}Soil_{Comb}$ ) exposure pathways for a 30-acre source area. In addition, the Texas-Specific Soil Background Concentrations (TSSBCs) were used in place of the  $^{GW}Soil_{Ing}$  RAL for arsenic, barium, beryllium, lead, and mercury as the background levels are higher than their respective RALs. **Table 1** summarizes VOC analytical data for the soil samples, **Table 2** summarizes the SVOC analytical data for the soil samples, and **Table 3** summarizes the total metals analytical data for the soil samples. Laboratory analytical data packages are included in **Attachment 2**. The results and finds of the soil laboratory analytical data are summarized below:

- None of the soil samples collected had VOCs reported above the sample detection level (SDL).
- None of the soil samples collected had SVOCs reported above the SDL, with the exception of some low-level detections of benzo(a)pyrene, benzo(b)fluoranthene, benzo(g,h,i)perylene, fluoranthene, and indeno(1,2,3-cd)pyrene in soil samples SS-4 and SS-6 (and duplicate). None of the reported SVOC concentrations exceeded the lowest of either the  $^{GW}Soil_{Ing}$  or the  $^{Total}Soil_{Comb}$  RALs.
- None of the soil samples collected had metals concentrations reported above their applicable RALs, with the exception of arsenic reported in soil samples SS-1 (19.2 milligrams per kilogram [mg/kg]), SS-2 (7.22 mg/kg), and SS-5 (11.3 mg/kg); these values also exceeded arsenic's TSSBC of 5.9 mg/kg.

Due to the TSSBC and RAL exceedance of arsenic at three sample locations, soil sample SS-1 was selected for synthetic precipitate leachate procedure (SPLP), and the leachate was analyzed for arsenic, barium, and lead by U.S. EPA Method 6020. **Table 4** summarizes the SPLP analytical data,

and laboratory analytical packages are included in **Attachment 2**. The analysis of the leachate from soil sample SS-1 reported arsenic and lead above the groundwater ingestion ( $^{GW}GW_{Ing}$ ) RAL, and beryllium below the  $^{GW}GW_{Ing}$  RAL. As the arsenic SPLP result exceeded the  $^{GW}GW_{Ing}$  RAL, a groundwater assessment was conducted to determine whether there had been a release through the clay liner to the underlying groundwater.

### **Groundwater Assessment**

On April 9, 2024, WESTON and its drilling subcontractor, Pacific West, advanced a soil boring in the center of the three lagoons. The soil boring was advanced to a depth of 30 feet below ground surface (bgs) via direct push drilling method with a tracked Geoprobe 7822DT drill rig. The soil boring cores were continuously logged by a WESTON geologist for soil properties and no soil samples were collected. After reaching the depth of 30 feet bgs, the bore hole was converted to temporary monitoring well TW-1. Temporary monitoring well TW-1 was constructed with 15 feet of 1-inch-diameter, 0.01-inch slotted screen from bottom of bore hole to 15 feet bgs, followed by a 1-inch-diameter riser to the surface. General lithology encountered during drilling included a silty/clayey sand and limestone gravel from the surface to approximately 14 feet bgs, followed by a lean clay layer from 14 feet bgs to 19 feet bgs. Below the lean clay layer was alluvium gravel from 19 feet bgs to 20 feet bgs. A high plasticity clay underlays the alluvium gravel layer from 20 feet bgs to the terminus depth of the boring at 30 feet bgs. A boring log displaying lithology and well construction details is included in **Attachment 3**.

After installation, temporary monitoring well TW-1 was allowed to equilibrate for approximately 4 hours. Temporary monitoring well TW-1 was developed with a peristaltic pump by purging three well volumes from the temporary well, and then sampled by low-flow sampling procedures. Due to elevated turbidity of the groundwater when sampling, the sample aliquot was filtered with a 10-micron filter in the field. The groundwater sample was collected into the laboratory-provided container that contained preservatives, which was then sealed in a waterproof plastic bag. The bag with the sample was placed on ice in the laboratory-provided cooler and shipped by FedEx under chain-of-custody procedure to DHL Analytical in Round Rock, Texas, for arsenic analysis by U.S. EPA Method 6020.

Arsenic was not reported above its SDL in the groundwater sample collected from the temporary monitoring well TW-1 and the SDL was less than the  $^{GW}GW_{Ing}$  RAL, demonstrating there has been

no release of arsenic from the lagoons. The arsenic results from TW-1 are summarized in **Table 5** and laboratory analytical packages are included in **Attachment 2**.

#### **4. CONCLUSION AND REQUEST FOR CLOSURE**

Based on the documentation provided herein, no evidence of a release of COCs attributable to waste management within the sludge lagoons was identified. Therefore, we respectfully request that the TCEQ administratively close these three inactive lagoons and issue a “no further action” letter.

#### **5. REFERENCES**

Montgomery Watson, 1998. *Internation Business Park Water Production Facility – Phase I; Drawings for Package 3 – Plant Process Facilities*. June 1998.


Texas Commission on Environmental Quality (TCEQ), 2011. *Closure of Waste-Management Units Subject to TRRP – RG-366/TRRP-2A*. July 2011.

TCEQ, 2020. *Texas Pollution Discharge Elimination System Permit No. WQ0004437000, Ultrafiltration Water Treatment Plant, 6725 Moreno Street, Von Ormy, Bexar County, Texas*. February 10, 2020

---


## FIGURES

---

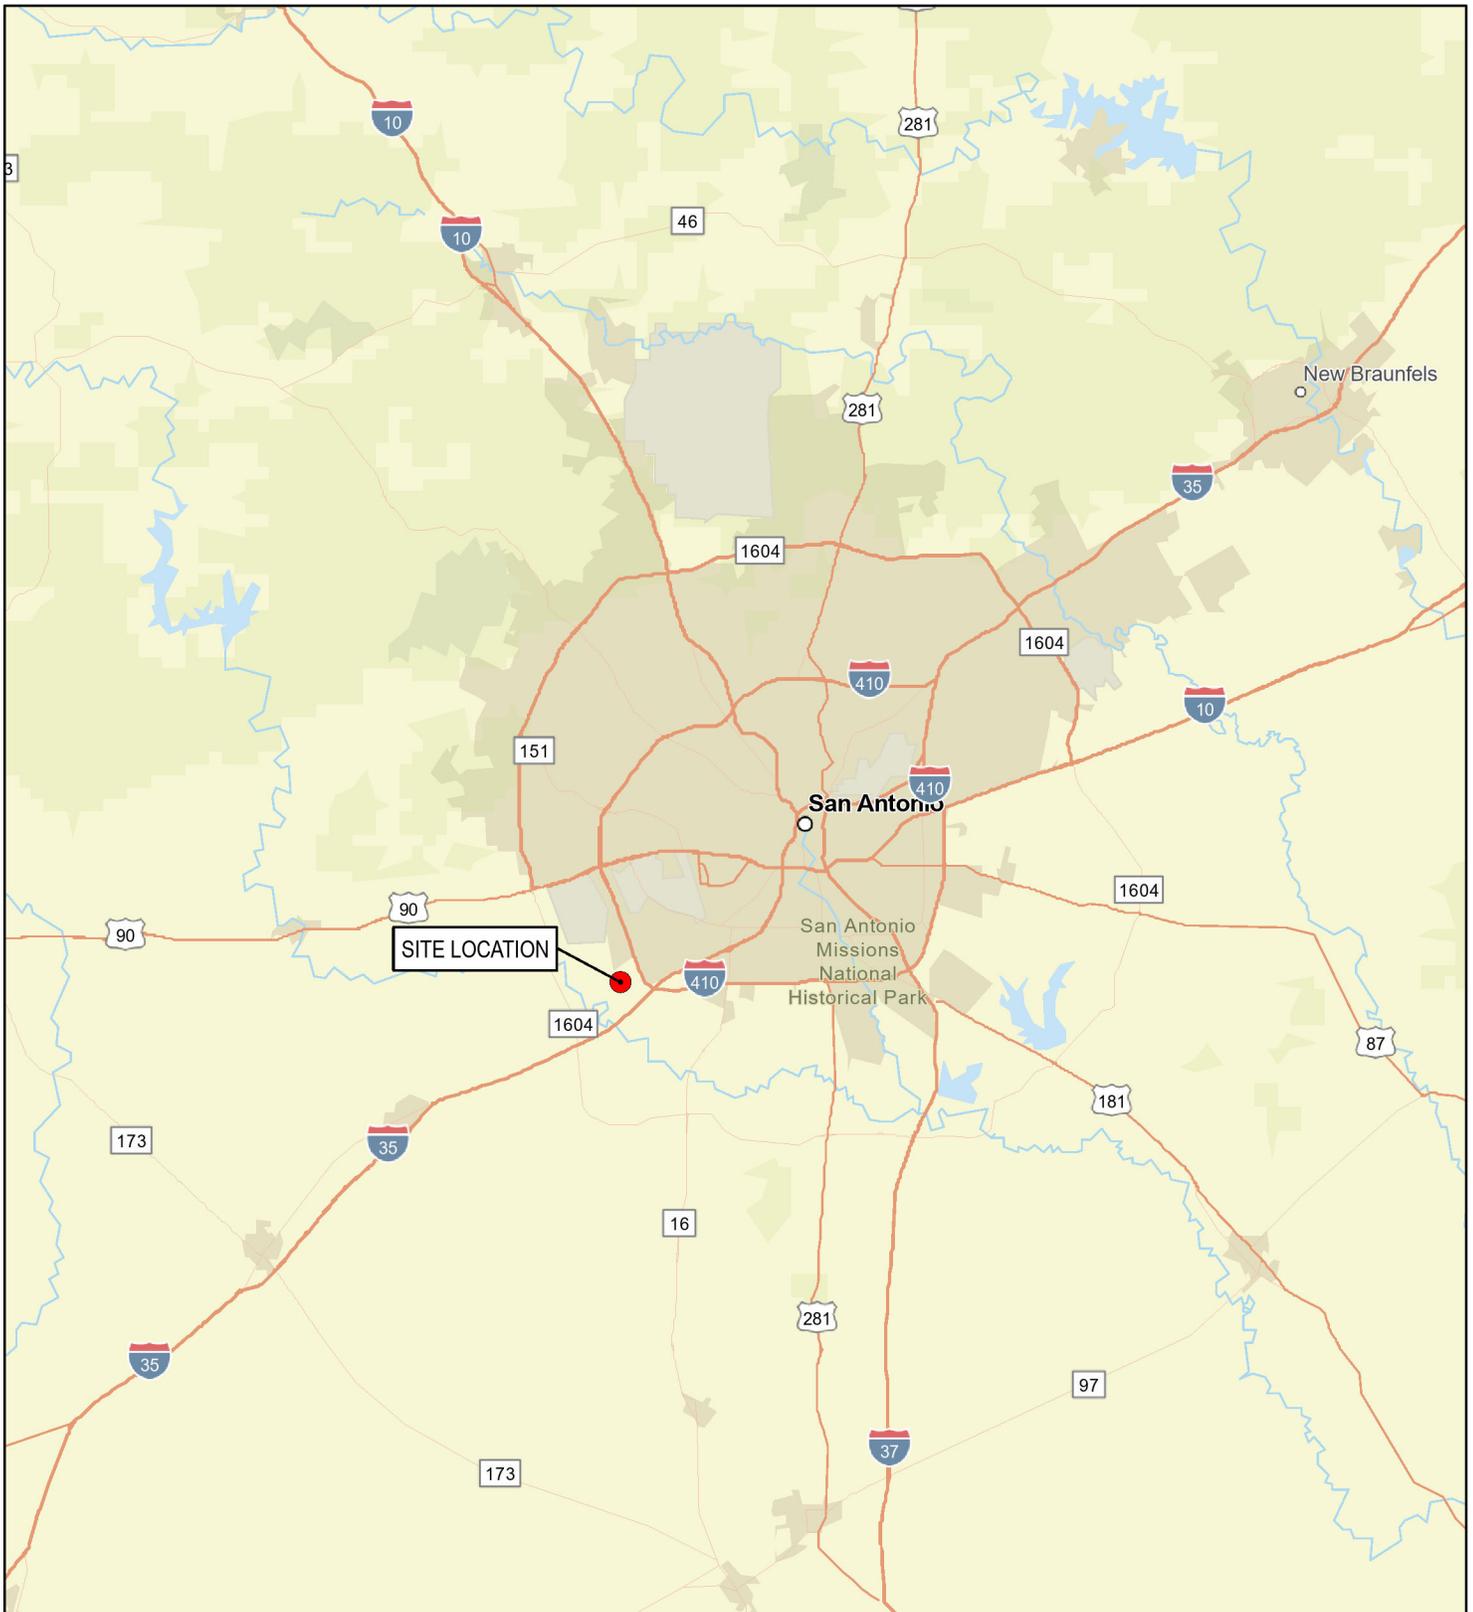

**LEGEND**

- SITE LOCATION



SCALE IN MILES



**FIGURE 1**  
**SITE LOCATION MAP**  
 SAN ANTONIO WATER SERVICE  
 6725 AGUA PURA STREET  
 SAN ANTONIA, BEXAR COUNTY, TEXAS


DATE APRIL 2024	PROJECT NO 10412.036.001.0003	SCALE AS SHOWN
--------------------	----------------------------------	-------------------

SOURCE: WORLD STREET MAPS; ESRI



**LEGEND**

- SITE BOUNDARY
- SAMPLE LOCATION
- ⊕ TEMPORARY MONITORING WELL

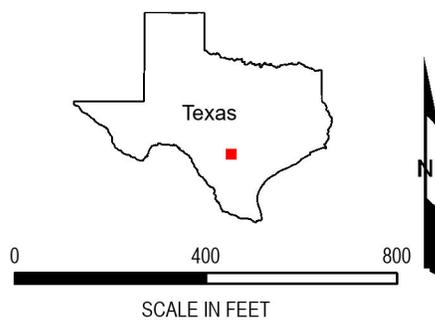

**FIGURE 2**  
**SITE LAYOUT MAP**  
 SAN ANTONIO WATER SERVICE  
 6725 AGUA PURA STREET  
 SAN ANTONIA, BEXAR COUNTY, TEXAS

DATE APRIL 2024	PROJECT NO 10412.036.001.0003	SCALE AS SHOWN
--------------------	----------------------------------	-------------------

SOURCE: WORLD IMAGERY;ESRI

---

## TABLES

---

**Table 1**  
**Soil Volatile Organic Compounds Summary**  
**San Antonio Water System**  
**6725 Agua Pura Street**  
**Von Ormy, Texas**

Analyte	CAS.NO	Units	Residential Soil May 2023 GWSoilng 30 Acre	Residential Soil May 2023 TotSoilComb 30 Acre	Station	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-6
					SNM	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-6
					Sample ID	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-DUP
					Depth (ft)	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5
					Date	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024
Type	N	N	N	N	N	N	DUP					
<b>VOCS</b>												
1,1,1,2-Tetrachloroethane	630-20-6	mg/kg	0.71	39	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,1,1-Trichloroethane	71-55-6	mg/kg	0.81	32000	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,1,2,2-Tetrachloroethane	79-34-5	mg/kg	0.012	30	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,1,2-Trichloro-1,2,2-trifluoroethane	76-13-1	mg/kg	40000	39000	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
1,1,2-Trichloroethane	79-00-5	mg/kg	0.01	10	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,1-Dichloroethane	75-34-3	mg/kg	9.2	8800	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,1-Dichloroethane	75-35-4	mg/kg	0.025	1600	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,1-Dichloropropene	563-58-6	mg/kg	0.067	26	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2,3-Trichlorobenzene	87-61-6	mg/kg	13	87	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2,3-Trichloropropane	96-18-4	mg/kg	0.00027	0.2	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2,4-Trichlorobenzene	120-82-1	mg/kg	2.4	70	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2,4-Trimethylbenzene	95-63-6	mg/kg	16	1200	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2-Dibromo-3-chloropropane	96-12-8	mg/kg	0.00087	0.08	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2-Dibromoethane	106-93-4	mg/kg	0.0001	2.1	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2-Dichlorobenzene	95-50-1	mg/kg	8.9	390	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2-Dichloroethane	107-06-2	mg/kg	0.0069	30	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,2-Dichloropropane	78-87-5	mg/kg	0.011	31	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,3,5-Trimethylbenzene	108-67-8	mg/kg	18	1100	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,3-Dichlorobenzene	541-73-1	mg/kg	3.4	62	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,3-Dichloropropane	142-28-9	mg/kg	0.032	26	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1,4-Dichlorobenzene	106-46-7	mg/kg	1.1	250	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
1-Chlorohexane	544-10-5	mg/kg	20	2300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
2,2-Dichloropropane	594-20-7	mg/kg	0.06	31	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
2-Chlorotoluene	95-49-8	mg/kg	4.5	1100	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
2-Hexanone	591-78-6	mg/kg	1.6	380	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
4-Chlorotoluene	106-43-4	mg/kg	5.4	1600	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
4-Methyl-2-pentanone	108-10-1	mg/kg	2.5	5400	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Acetone	67-64-1	mg/kg	21	59000	--	0.0207 U	0.0152 U	0.0137 U	0.0164 U	0.0193 U	0.0212 U	0.0255 U
Benzene	71-43-2	mg/kg	0.013	69	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Bromobenzene	108-86-1	mg/kg	1.2	280	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Bromochloromethane	74-97-5	mg/kg	1.5	3300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Bromodichloromethane	75-27-4	mg/kg	0.18	98	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Bromoform	75-25-2	mg/kg	0.22	280	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Bromomethane	74-83-9	mg/kg	0.065	24	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Carbon disulfide	75-15-0	mg/kg	6.8	3300	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Carbon tetrachloride	56-23-5	mg/kg	0.031	23	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Chlorobenzene	108-90-7	mg/kg	0.55	320	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Chloroethane	75-00-3	mg/kg	15	23000	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Chloroform	67-66-3	mg/kg	0.17	8	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Chloromethane	74-87-3	mg/kg	0.2	84	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
cis-1,2-Dichloroethane	156-59-2	mg/kg	0.12	120	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
cis-1,3-Dichloropropene	10061-01-5	mg/kg	0.0033	7.8	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Cyclohexane	110-82-7	mg/kg	2900	42000	--	0.00689 NU	0.00508 NU	0.00456 NU	0.00546 NU	0.00644 NU	0.00706 NU	0.00849 NU
Dibromochloromethane	124-48-1	mg/kg	0.18	72	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Dibromomethane	74-95-3	mg/kg	0.56	42	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Dichlorodifluoromethane	75-71-8	mg/kg	120	750	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Ethylbenzene	100-41-4	mg/kg	3.8	5300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Hexachlorobutadiene	87-68-3	mg/kg	1.6	12	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Isopropylbenzene	98-82-8	mg/kg	170	3000	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
m,p-Xylene	1330-20-7	MP	mg/kg		--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Methyl Acetate	79-20-9	mg/kg	24	82000	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Methyl Ethyl Ketone	78-93-3	mg/kg	15	33000	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Methyl tert-butyl ether (MTBE)	1634-04-4	mg/kg	0.31	590	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Methylecyclohexane	108-87-2	mg/kg	7800	22000	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Methylene chloride	75-09-2	mg/kg	0.0065	1500	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Naphthalene	91-20-3	mg/kg	16	120	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
n-Butylbenzene	104-51-8	mg/kg	76	3300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
n-Propylbenzene	103-65-1	mg/kg	22	1600	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
o-Xylene	95-47-6	mg/kg	35	29000	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
p-Isopropyltoluene	99-87-6	mg/kg	120	8200	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
sec-Butylbenzene	135-98-8	mg/kg	42	3300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Styrene	100-42-5	mg/kg	1.6	4300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
tert-Butylbenzene	98-06-6	mg/kg	50	3300	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Tetrachloroethene	127-18-4	mg/kg	0.025	420	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Toluene	108-88-3	mg/kg	4.1	5400	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
trans-1,2-Dichloroethane	156-60-5	mg/kg	0.25	370	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
trans-1,3-Dichloropropene	10061-02-6	mg/kg	0.018	26	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Trichloroethene	79-01-6	mg/kg	0.017	11	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Trichlorofluoromethane	75-69-4	mg/kg	64	25000	--	0.00689 U	0.00508 U	0.00456 U	0.00546 U	0.00644 U	0.00706 U	0.00849 U
Vinyl Chloride	75-01-4	mg/kg	0.011	3.4	--	0.00138 U	0.00102 U	0.000913 U	0.00109 U	0.00129 U	0.00141 U	0.0017 U
Xylenes (Total)	1330-20-7	mg/kg	61	3700	--	0.00138 U	0					

**Table 2**  
**Soil Semi-Volatile Organic Compounds Summary**  
**San Antonio Water System**  
**6725 Agua Pura Street**  
**Von Ormy, Texas**

Analyte	CAS.NO	Units	Residential Soil May 2023 GWSoilng 30 Acre	Residential Soil May 2023 TotSoilComb 30 Acre	Station	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-6
					SNM	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-6
					Sample ID	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-DUP
					Depth (ft)	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5
					Date	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024
Type	N	N	N	N	N	N	DUP					
<b>SVOCs</b>												
1-chloro-4-phenoxybenzene	7005-72-3	mg/kg	0.016	0.15	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2,4,5-Trichlorophenol	95-95-4	mg/kg	17	6700	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2,4,6-Trichlorophenol	88-06-2	mg/kg	0.087	67	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2,4-Dichlorophenol	120-83-2	mg/kg	0.18	200	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2,4-Dimethylphenol	105-67-9	mg/kg	1.6	1300	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2,4-Dinitrophenol	51-28-5	mg/kg	0.047	130	--	0.0658 U	0.0579 U	0.0568 U	0.0574 U	0.064 U	0.0599 U	0.0631 U
2,4-Dinitrotoluene	121-14-2	mg/kg	0.0027	6.9	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2,6-Dinitrotoluene	606-20-2	mg/kg	0.0024	6.9	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2-Chloronaphthalene	91-58-7	mg/kg	330	5000	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2-Chlorophenol	95-57-8	mg/kg	0.82	410	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2-Methylnaphthalene	91-57-6	mg/kg	8.5	250	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2-Methylphenol	95-48-7	mg/kg	3.6	3300	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2-Nitroaniline	88-74-4	mg/kg	0.011	11	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
2-Nitrophenol	88-75-5	mg/kg	0.067	130	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
3,3-Dichlorobenzidine	91-94-1	mg/kg	0.031	10	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
3-Nitroaniline	99-09-2	mg/kg	0.013	12	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
4,6-Dinitro-2-methylphenol	534-52-1	mg/kg	0.0023	6.7	--	0.0395 U	0.0347 U	0.0341 U	0.0344 U	0.0384 U	0.036 U	0.0378 U
4-Bromophenyl phenyl ether	101-55-3	mg/kg	0.18	0.27	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
4-Chloro-3-methylphenol	59-50-7	mg/kg	2.3	330	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
4-Chloroaniline	106-47-8	mg/kg	0.01	23	--	0.0395 U	0.0347 U	0.0341 U	0.0344 U	0.0384 U	0.036 U	0.0378 U
4-Methylphenol	106-44-5	mg/kg	0.32	330	--	0.0263 U	0.0232 U	0.0227 U	0.023 U	0.0256 U	0.024 U	0.0252 U
4-Nitroaniline	100-01-6	mg/kg	0.054	190	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
4-Nitrophenol	100-02-7	mg/kg	0.05	130	--	0.0658 U	0.0579 U	0.0568 U	0.0574 U	0.064 U	0.0599 U	0.0631 U
Acenaphthene	83-32-9	mg/kg	120	3000	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Acenaphthylene	208-96-8	mg/kg	200	3800	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Acetophenone	98-86-2	mg/kg	4.1	6700	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Anthracene	120-12-7	mg/kg	3400	18000	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Atrazine	1912-24-9	mg/kg	0.012	21	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Benzaldehyde	100-52-7	mg/kg	5.3	8200	--	0.0132 NU	0.0116 NU	0.0114 NU	0.0115 NU	0.0128 NU	0.012 NU	0.0126 NU
Benzo(a)anthracene	56-55-3	mg/kg	65	41	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Benzo(a)pyrene	50-32-8	mg/kg	3.8	4.1	--	0.0132 U	0.0116 U	0.0114 U	<b>0.0191 J</b>	0.0128 U	<b>0.012 J</b>	0.0126 U
Benzo(b)fluoranthene	205-99-2	mg/kg	220	41	--	0.0132 U	0.0116 U	0.0114 U	<b>0.0298 J</b>	0.0128 U	<b>0.016 J</b>	<b>0.016 J</b>
Benzo(g,h,i)perylene	191-24-2	mg/kg	23000	1800	--	0.0132 U	0.0116 U	0.0114 U	<b>0.0176 J</b>	0.0128 U	0.012 U	0.0126 U
Benzo(k)fluoranthene	207-08-9	mg/kg	2200	420	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Benzoic acid	65-85-0	mg/kg	95	27000	--	0.0658 U	0.0579 U	0.0568 U	0.0574 U	0.064 U	0.0599 U	0.0631 U
Benzyl alcohol	100-51-6	mg/kg	2.9	6700	--	0.0395 U	0.0347 U	0.0341 U	0.0344 U	0.0384 U	0.036 U	0.0378 U
Biphenyl, 1,1-	92-52-4	mg/kg	1300	12000	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
bis(2-Chloroethoxy)methane	111-91-1	mg/kg	0.0059	2.5	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
bis(2-Chloroethyl)ether	111-44-4	mg/kg	0.0011	1.4	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
bis(2-Chloroisopropyl)ether	108-60-1	mg/kg	0.095	41	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
bis(2-Ethylhexyl)phthalate	117-81-7	mg/kg	82	43	--	0.0842 U	0.0741 U	0.0727 U	0.0734 U	0.0819 U	0.0767 U	0.0807 U
Butyl Benzyl Phthalate	85-68-7	mg/kg	130	1600	--	0.0526 U	0.0463 U	0.0454 U	0.0459 U	0.0512 U	0.0479 U	0.0504 U
Caprolactam	105-60-2	mg/kg	23	33000	--	0.0395 U	0.0347 U	0.0341 U	0.0344 U	0.0384 U	0.036 U	0.0378 U
Carbazole	86-74-8	mg/kg	2.3	230	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Chrysene	218-01-9	mg/kg	5600	4100	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Dibenzo(a,h)anthracene	53-70-3	mg/kg	7.6	4	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Dibenzofuran	132-64-9	mg/kg	17	270	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Diethyl phthalate	84-66-2	mg/kg	78	53000	--	0.0526 U	0.0463 U	0.0454 U	0.0459 U	0.0512 U	0.0479 U	0.0504 U
Dimethyl phthalate	131-11-3	mg/kg	31	53000	--	0.0526 U	0.0463 U	0.0454 U	0.0459 U	0.0512 U	0.0479 U	0.0504 U
Di-N-Butyl phthalate	84-74-2	mg/kg	1700	6200	--	0.0526 U	0.0463 U	0.0454 U	0.0459 U	0.0512 U	0.0479 U	0.0504 U
Di-N-Octyl phthalate	117-84-0	mg/kg	410000	640	--	0.0526 U	0.0463 U	0.0454 U	0.0459 U	0.0512 U	0.0479 U	0.0504 U
Fluoranthene	206-44-0	mg/kg	960	2300	--	0.0132 U	0.0116 U	0.0114 U	<b>0.0252 J</b>	0.0128 U	<b>0.0128 J</b>	<b>0.0126 J</b>
Fluorene	86-73-7	mg/kg	150	2300	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Hexachlorobenzene	118-74-1	mg/kg	0.56	1	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Hexachlorobutadiene	87-68-3	mg/kg	1.6	12	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Hexachlorocyclopentadiene	77-47-4	mg/kg	9.6	7.2	--	0.0395 U	0.0347 U	0.0341 U	0.0344 U	0.0384 U	0.036 U	0.0378 U
Hexachloroethane	67-72-1	mg/kg	0.64	46	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Indeno(1,2,3-cd)pyrene	193-39-5	mg/kg	630	42	--	0.0132 U	0.0116 U	0.0114 U	<b>0.0145 J</b>	0.0128 U	0.012 U	0.0126 U
Isophorone	78-59-1	mg/kg	1.5	4900	--	0.0395 U	0.0347 U	0.0341 U	0.0344 U	0.0384 U	0.036 U	0.0378 U
Naphthalene	91-20-3	mg/kg	16	120	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Nitrobenzene	98-95-3	mg/kg	0.18	34	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
N-Nitroso-di-N-propylamine	621-64-7	mg/kg	0.0018	0.4	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
N-Nitrosodiphenylamine	86-30-6	mg/kg	1.4	570	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Pentachlorophenol	87-86-5	mg/kg	0.0092	0.73	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Phenanthrene	85-01-8	mg/kg	210	1700	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Phenol	108-95-2	mg/kg	9.6	950	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Pvrene	129-00-0	mg/kg	560	1700	--	0.0132 U	0.0116 U	0.0114 U	0.0115 U	0.0128 U	0.012 U	0.0126 U
Pyridine	110-86-1	mg/kg	0.035	82	--	0.0658 U	0.0579 U	0.0568 U	0.0574 U	0.064 U	0.0599 U	0.0631 U

Notes:

<sup>1</sup>TRRP Residential PCLs dated May 2023

All results reported in milligrams per liter (mg/kg).

**Bolded** - Analyte reported at or above the sample detection limit (SDL)

NA - Not Analyzed

J - Analyte was estimated between the SDL and reporting limit (RL)

U - Analyte not reported at or above the SDL

N - Normal

DUP - Duplicate

**Table 3**  
**Soil Total Metals Summary**  
**San Antonio Water System**  
**6725 Agua Pura Street**  
**Von Ormy, Texas**

Analyte	CAS.NO	Units	Residential Soil May 2023 GWSoilIng 30 Acre	Residential Soil May 2023 TotSoilComb 30 Acre	Texas-Specific Soil Background Concentrations	SS-Background	Station	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-6
							SNM	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-6
							Sample ID	SS-1	SS-2	SS-3	SS-4	SS-5	SS-6	SS-DUP
							Depth (ft)	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5	0.0 - 0.5
							Date	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024	02/20/2024
							Type	N	N	N	N	N	N	DUP
<b>Metals, Total</b>														
Aluminum	7429-90-5	mg/kg	86,000	64,000	30,000	18,800	--	25,700	20,600	18,200	10,000	24,800	18,100	18,400
Antimony	7440-36-0	mg/kg	2.7	15	1	0.575	--	0.622 U	0.559 U	0.529 U	0.545 U	0.604 U	0.604 U	0.598 U
Arsenic	7440-38-2	mg/kg	2.5	24	5.9	7.16	--	19.2	7.22	5.45	5.19	11.3	4.25	4.97
Barium	7440-39-3	mg/kg	220	8100	300	165	--	210	87	127	61.2	162	144	147
Beryllium	7440-41-7	mg/kg	0.92	38	1.5	0.682	--	0.945	0.734	0.653	0.454	0.828	0.684	0.694
Cadmium	7440-43-9	mg/kg	0.75	51	NS	0.176	--	0.251 J	0.198 J	0.155 J	0.109 U	0.218 J	0.19 J	0.191 J
Chromium	7440-47-3	mg/kg	1,200	27,000	30	21.2	--	31	22.4	21.9	12	26.3	21.9	21.7
Cobalt	7440-48-4	mg/kg	110	680	7	4.97	--	12.2	5.28	4.91	3.26	8.49	4.76	5.12
Copper	7440-50-8	mg/kg	520	1,300	15	6.36	--	13.7	7.22	7.06	5.2	9.72	9.02	9.26
Lead	7439-92-1	mg/kg	1.5	500	15	8.76	--	13.1	9.11	8.6	6.37	10.7	9.97	10.1
Manganese	7439-96-5	mg/kg	580	3,900	300	190	--	429	163	147	92.9	282	136	158
Mercury	7439-97-6	mg/kg	0.0039	2.1	0.04	0.0199	--	0.0197 U	0.0169 U	0.0229 J	0.0174 U	0.0202 U	0.0222 J	0.0267 J
Nickel	7440-02-0	mg/kg	79	840	10	9.93	--	19.5	9.77	10.5	7.21	15.5	10.4	11.1
Selenium	7782-49-2	mg/kg	1.1	310	0.3	0.409	--	1.03	0.418 J	0.338 J	0.949	0.676	0.587 J	0.553 J
Silver	7440-22-4	mg/kg	0.24	97	NS	0.115	--	0.124 U	0.112 U	0.106 U	0.109 U	0.121 U	0.121 U	0.12 U
Thallium	7440-28-0	mg/kg	0.87	5.3	NS	0.575	--	0.622 U	0.559 U	0.529 U	0.545 U	0.604 U	0.604 U	0.598 U
Vanadium	7440-62-2	mg/kg	440	75	50	53.4	--	396	52.4	56.7	50	164	53.5	55
Zinc	7440-66-6	mg/kg	1,200	9,900	30	34.3	--	57.5	37.4	38.8	29.7	48.7	48.4	48.7

Notes:

<sup>1</sup>TRRP Residential PCLs dated May 2023

All results reported in milligrams per liter (mg/kg).

**Bolded** - Analyte reported at or above the sample detection limit (SDL)

Applicable PCL (Lesser of GW Soil Ing or TotSoilComb unless Texas Background is higher)

Exceeds Applicable PCL

NA - Not Analyzed

NS - No Specified

J - Analyte was estimated between the SDL and reporting limit (RL)

U - Analyte not reported at or above the SDL

N - Normal

DUP - Duplicate

**Table 4**  
**Soil Metal SPLP Summary**  
**San Antonio Water System**  
**6725 Agua Pura Street**  
**Von Ormy, Texas**

Analyte	CAS.NO	Units	Residential GW May 2023 GWGWing	Commercial GW May 2023 GWGWing	Station	SS-1
					SNM	SS-1
					Sample ID	SS-1
					Date	02/20/2024
					Type	N
<b>SPLP</b>						
Arsenic	7440-38-2	mg/l	0.01	0.01	--	<b>0.0252</b>
Beryllium	7440-41-7	mg/l	0.004	0.004	--	<b>0.00167</b>
Lead	7439-92-1	mg/l	0.015	0.015	--	<b>0.0174</b>

Notes:

<sup>1</sup>TRRP Residential PCLs dated May 2023

All results reported in milligrams per liter (mg/kg).

**Bolded** - Analyte reported at or above the sample detection limit (SDL)

**Shaded value exceeds** Residential GW May 2023 GWGWing or Commercial GW May 2023 GWGWing

SPLP = Synthetic Precipitation Leaching Procedure

NA - Not Analyzed

J - Analyte was estimated between the SDL and reporting limit (RL)

U - Analyte not reported at or above the SDL

N - Normal

DUP - Duplicate

**Table 5**  
**Groundwater Arsenic Summary**  
**San Antonio Water System**  
**6725 Agua Pura Street**  
**Von Ormy, Texas**

Analyte	CAS.NO	Units	Residential GW May 2023 GWGWIng	Commercial GW May 2023 GWGWIng	Station	TW-1
					SNM	TW-1
					Sample ID	TW-1
					Date	4/9/2024
					Type	N
<b>SPLP</b>						
Arsenic	7440-38-2	mg/l	0.01	0.01	--	0.002 U

Notes:

<sup>1</sup>TRRP Residential PCLs dated May 2023

All results reported in milligrams per liter (mg/l).

**Bolded** - Analyte reported at or above the sample detection limit (SDL)

**Shaded value exceeds** Residential GW May 2023 GWGWIng or Commercial GW May 2023 GWGWIng

U - Analyte not reported at or above the SDL

N - Normal

---

**ATTACHMENT 1 – FIELD NOTES**

---

10412.036.001.0002

2 SAWS Lagoon and Decant Sampling 2/20/24

0859 - Cole Castleberry arrived on-site and met with Orlando Mirreter (SAWS).

0910 - Tailgate Safety: Heat, sunburn, biologicals, and PID VOC safety levels. PID = MultiRAE Lite  
Weather: 49°F, SSW @ 3mph, Sunny

0920 - Equipment prepped and began sampling

Sample ID	Location Desc.	Time	Coordinates
SS-1	South Lagoon	0926	N29° 19.312', W098° 38.058'
SS-2	Middle Lagoon	0950	N29° 19.315', W098° 38.087'
SS-3	North Lagoon	1018	N29° 19.336', W098° 38.098'
SS-4	<del>South</del> Lagoon Sump toe	1045	N29° 19.294', W098° 38.091'
SS-5	Middle Lagoon Sump toe	1059	N29° 19.311', W098° 38.104'
SS-6	North Lagoon Sump toe	1113	N29° 19.323', W098° 38.116'
SS-DUP	North Lagoon Sump toe	1113	N29° 19.323', W098° 38.116'
SS-background	~250ft West of Lagoons	1135	N29° 19.291', W098° 38.152'

There were no ambient VOC detections during the sampling. Sample bag VOC readings were:

Sample ID	VOC(ppm)	—	Sample ID	VOC(ppm)
SS-1	0.0	—	SS-6	0.4
SS-2	0.0	—	SS-DUP	0.2
SS-3	0.4	—	SS-background	0.0
SS-4	0.0	—		
SS-5	0.5	—		

10412.036.001.0002


SAWS Lagoon and Decant Sampling 2/20/24

1240 - Finished labeling samples. Returned excess soil to sampling locations.


1248 - Labeled and placed IDW bucket behind main site building (N29°19'15", W98°38'03")

1252 - Departed site to ship samples

1500 - Samples shipped via Fed Ex

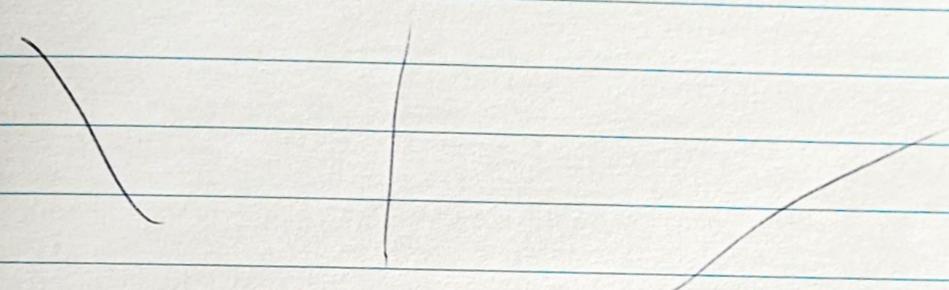

Cole Castle

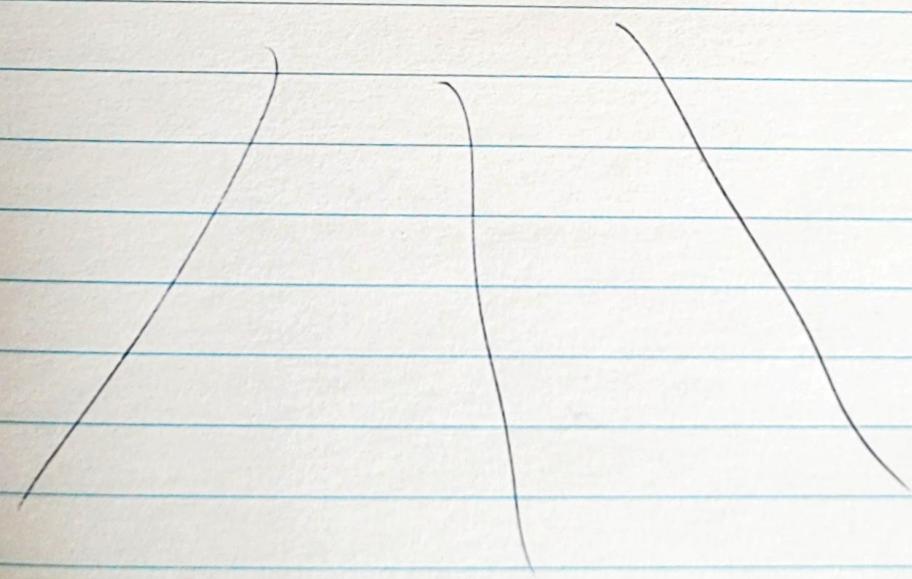

Location 6725 AGUA PURA ST. Date 4/9/24 57

Project / Client SAWS - IMPOUNDMENT ASSESSMENT  
LAGOONS

- 1020: Arrive on-site. Meet w/ Michael  
SAWS Rep.  
- Go over HAST. Weather: 90° H 69% Driedle  
- Do site walk around.
- 1040: Drillers on site. Show them where to  
bring geo probe rig.  
- Go over HAST  
- Go over scope of drilling.
- 1100: Pacific West lines up on drilling  
location.
- 1121: Begin drilling.
- 1157: Drillers encounter clay. Unable  
to push. Consider flight auger.  
Talk to A. Sobet. Says to try  
for +2'-3' more.
- 1217: Drillers attempt push.
- 1240: Drillers reach TD by push @  
30' bgs. Drilling finished.  
- Michael off-site to grab lunch.  
- Clean up / move rig. Run casing.  
~ 15' screened  
- Michael goes on-site
- 1430: Begin purge. 3 well volumes, Pacific  
West off-site. Peri-pumped.
- 1447: Sample TW-1 taken, Weston / ~~SAWS~~ off-site.



SITE: SAWS IMPOUND LAGOONS

WELL ID: TW-1

**Groundwater Sampling Field Data Sheet**

Project Number: 10412 036.001

Task Number: 10002

Date: 4/9/24

Casing Diameter 1"	Screened Interval (ft from GS) ~15-30	Flow Rate 175-225 ml/min
Total Depth of Well from TOC (ft) ~30.5	Purge Equipment Pesi	Sample Equipment -
Static Water from TOC (ft) 15.03   15.40 after purge	Depth of Sample Intake (ft) ~22.5	Analytical Equipment VSI PD DSS
Product Level from TOC (ft) - 3x well ✓	Time Purge Started 1430	Well location Sketch Lagoon 
Length of Water Column (ft) 14.97	Micro Purge Data: CPM = Duration (sec): = Recharge = Discharge =	
1 Well Volume (gal) 0.16	Peristaltic Pump Setting Med.	

Time	Gallon	Temperature (C) (+/- 0.1)	Specific Cond. (us/cm) (+/- 3%)	DO mg/L (+/- 0.3)	pH (+/- 0.1)	Redox (ORP) (+/- 10mv)	Water Level (ft btoc)	Turbidity (NTU)
1433		24.6	977	2.74	7.60	93.7	15.44	265.0
1436		24.3	970	2.14	7.16	87.6	15.57	112.3
1439		24.2	967	1.77	7.07	86.7	15.98	99.2
1442		24.1	961	2.01	7.08	89.9	16.77	118.4
1445		24.1	940	2.17	7.12	78.9	17.53	382.5
<del>WALK OFF</del>								* Field Filtered for Sample to use filter

Sample ID: <u>TW-1</u>	Sample Date: <u>4/9/24</u>	Sample Time: <u>1447</u>
------------------------	----------------------------	--------------------------

Comments: ORP <sup>wk</sup> N(EI)

Level of PPE: <u>D</u>	Analytical Parameters: <u>Total Arsenic (6000)</u>
------------------------	---

Disposition of Purged Water: <u>Back in Epochole</u>	Sampler's Signature/Date: <u>W. Kennedy 4/9/24</u>
---	---

---

**ATTACHMENT 2 – LABORATORY ANALYTICAL DATA**

---



February 28, 2024

Armin Sabet  
Weston Solutions, Inc.  
2600 Dallas Parkway, Suite 280  
Frisco, Texas 75034  
TEL: (310) 980-6300

FAX:

Order No.: 2402269

RE: SAWS Impoundment Assessment Lagoons and Decant Sam

Dear Armin Sabet:

DHL Analytical, Inc. received 10 sample(s) on 2/21/2024 for the analyses presented in the following report.

There were no problems with the analyses and all data met requirements of NELAP except where noted in the Case Narrative. All non-NELAP methods will be identified accordingly in the case narrative and all estimated uncertainties of test results are within method or EPA specifications.

If you have any questions regarding these tests results, please feel free to call. Thank you for using DHL Analytical.

Sincerely,

A handwritten signature in red ink, appearing to read 'John DuPont'.

John DuPont  
General Manager

This report was performed under the accreditation of the State of Texas Laboratory Certification Number: T104704211-23-29



# Table of Contents

<b>Miscellaneous Documents .....</b>	<b>3</b>
<b>CaseNarrative 2402269 .....</b>	<b>11</b>
<b>WorkOrderSampleSummary 2402269 .....</b>	<b>13</b>
<b>PrepDatesReport 2402269 .....</b>	<b>14</b>
<b>AnalyticalDatesReport 2402269 .....</b>	<b>16</b>
<b>Analytical Report 2402269 .....</b>	<b>18</b>
<b>AnalyticalQCSummaryReport 2402269 .....</b>	<b>58</b>
<b>MQLSummaryReport 2402269 .....</b>	<b>98</b>





ORIGIN ID:SVZA (940) 395-8775  
COLE CASTLEBERRY  
WESTON SOLUTIONS/OU1025  
70 NE LOOP 410  
SUITE 200  
SAN ANTONIO, TX 78216  
UNITED STATES US


SHIP DATE: 20FEB24  
ACTWGT: 41.45 LB  
CAD: 6992618/SSF02500  
DIMS: 26x13x14 IN  
BILL THIRD PARTY

Part # 156203840884

TO **WORK ORDER# 10412.036.001.0002**  
**DHL ANALYTICAL**  
**2300 DOUBLE CREEK DR**  
**ROUND ROCK TX 78664**

RT 512  
FZ

(512) 388-8222 REF: INU1 DEPT: PD:

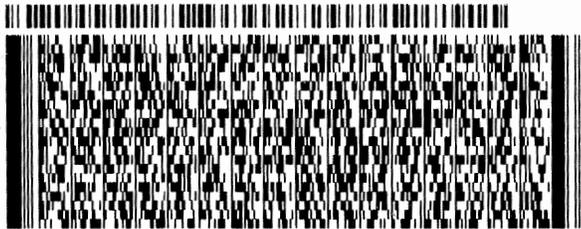

FedEx Express



AN1001100201421


1 of 2

WED - 21 FEB 10:30A  
PRIORITY OVERNIGHT

TRK# 2712 0885 7223  
0201  
## MASTER ##

**44 BSMA**


78664  
TX-US AUS

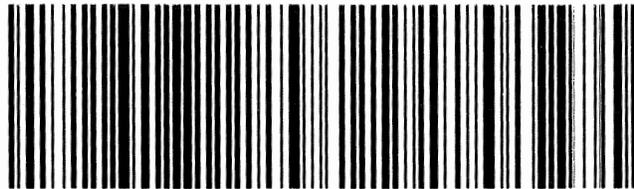

**CUSTODY SEAL**

DATE 2/20/24

SIGNATURE Cole Castleberry



**DHL**  
ANALYTICAL

ORIGIN ID:SVZA (940) 395-8775  
COLE CASTLEBERRY  
WESTON SOLUTIONS/OU1025  
70-NE LOOP 410  
SUITE 200  
SAN ANTONIO, TX 78216  
UNITED STATES US

SHIP DATE: 20FEB24  
ACTWGT: 40.30 LB  
CAD: 6992618/SSF02500  
DIMS: 25x14x14 IN  
BILL THIRD PARTY


Part # 1562924631R1R1R2R3R4R5R6R7R8R9R10R11R12R13R14R15R16R17R18R19R20R21R22R23R24R25R26R27R28R29R30R31R32R33R34R35R36R37R38R39R40R41R42R43R44R45R46R47R48R49R50R51R52R53R54R55R56R57R58R59R60R61R62R63R64R65R66R67R68R69R70R71R72R73R74R75R76R77R78R79R80R81R82R83R84R85R86R87R88R89R90R91R92R93R94R95R96R97R98R99R100R101R102R103R104R105R106R107R108R109R110R111R112R113R114R115R116R117R118R119R120R121R122R123R124R125R126R127R128R129R130R131R132R133R134R135R136R137R138R139R140R141R142R143R144R145R146R147R148R149R150R151R152R153R154R155R156R157R158R159R160R161R162R163R164R165R166R167R168R169R170R171R172R173R174R175R176R177R178R179R180R181R182R183R184R185R186R187R188R189R190R191R192R193R194R195R196R197R198R199R200R201R202R203R204R205R206R207R208R209R210R211R212R213R214R215R216R217R218R219R220R221R222R223R224R225R226R227R228R229R230R231R232R233R234R235R236R237R238R239R240R241R242R243R244R245R246R247R248R249R250R251R252R253R254R255R256R257R258R259R260R261R262R263R264R265R266R267R268R269R270R271R272R273R274R275R276R277R278R279R280R281R282R283R284R285R286R287R288R289R290R291R292R293R294R295R296R297R298R299R300R301R302R303R304R305R306R307R308R309R310R311R312R313R314R315R316R317R318R319R320R321R322R323R324R325R326R327R328R329R330R331R332R333R334R335R336R337R338R339R340R341R342R343R344R345R346R347R348R349R350R351R352R353R354R355R356R357R358R359R360R361R362R363R364R365R366R367R368R369R370R371R372R373R374R375R376R377R378R379R380R381R382R383R384R385R386R387R388R389R390R391R392R393R394R395R396R397R398R399R400R401R402R403R404R405R406R407R408R409R410R411R412R413R414R415R416R417R418R419R420R421R422R423R424R425R426R427R428R429R430R431R432R433R434R435R436R437R438R439R440R441R442R443R444R445R446R447R448R449R450R451R452R453R454R455R456R457R458R459R460R461R462R463R464R465R466R467R468R469R470R471R472R473R474R475R476R477R478R479R480R481R482R483R484R485R486R487R488R489R490R491R492R493R494R495R496R497R498R499R500R501R502R503R504R505R506R507R508R509R510R511R512R513R514R515R516R517R518R519R520R521R522R523R524R525R526R527R528R529R530R531R532R533R534R535R536R537R538R539R540R541R542R543R544R545R546R547R548R549R550R551R552R553R554R555R556R557R558R559R560R561R562R563R564R565R566R567R568R569R570R571R572R573R574R575R576R577R578R579R580R581R582R583R584R585R586R587R588R589R590R591R592R593R594R595R596R597R598R599R600R601R602R603R604R605R606R607R608R609R610R611R612R613R614R615R616R617R618R619R620R621R622R623R624R625R626R627R628R629R630R631R632R633R634R635R636R637R638R639R640R641R642R643R644R645R646R647R648R649R650R651R652R653R654R655R656R657R658R659R660R661R662R663R664R665R666R667R668R669R670R671R672R673R674R675R676R677R678R679R680R681R682R683R684R685R686R687R688R689R690R691R692R693R694R695R696R697R698R699R700R701R702R703R704R705R706R707R708R709R710R711R712R713R714R715R716R717R718R719R720R721R722R723R724R725R726R727R728R729R730R731R732R733R734R735R736R737R738R739R740R741R742R743R744R745R746R747R748R749R750R751R752R753R754R755R756R757R758R759R760R761R762R763R764R765R766R767R768R769R770R771R772R773R774R775R776R777R778R779R780R781R782R783R784R785R786R787R788R789R790R791R792R793R794R795R796R797R798R799R800R801R802R803R804R805R806R807R808R809R810R811R812R813R814R815R816R817R818R819R820R821R822R823R824R825R826R827R828R829R830R831R832R833R834R835R836R837R838R839R840R841R842R843R844R845R846R847R848R849R850R851R852R853R854R855R856R857R858R859R860R861R862R863R864R865R866R867R868R869R870R871R872R873R874R875R876R877R878R879R880R881R882R883R884R885R886R887R888R889R890R891R892R893R894R895R896R897R898R899R900R901R902R903R904R905R906R907R908R909R910R911R912R913R914R915R916R917R918R919R920R921R922R923R924R925R926R927R928R929R930R931R932R933R934R935R936R937R938R939R940R941R942R943R944R945R946R947R948R949R950R951R952R953R954R955R956R957R958R959R960R961R962R963R964R965R966R967R968R969R970R971R972R973R974R975R976R977R978R979R980R981R982R983R984R985R986R987R988R989R990R991R992R993R994R995R996R997R998R999R1000

TO **WORK ORDER# 10412.036.001.0002**  
**DHL ANALYTICAL**  
**2300 DOUBLE CREEK DR**  
  
**ROUND ROCK TX 78664**

(512) 388-8222  
INV:  
PO:

REF:

DEPT:

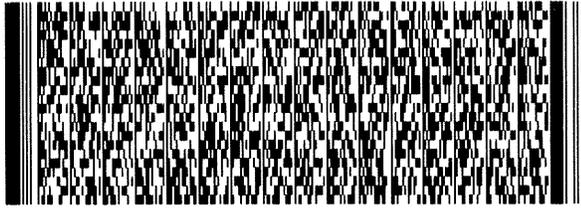

**FedEx**  
Express



AT1001L10P201R27


2 of 2  
MPS# 2712 0885 7234  
0263  
Mstr# 2712 0885 7223

0201

**WED - 21 FEB 10:30A**  
**PRIORITY OVERNIGHT**

**44 BSMA**

**78664**  
**TX-US AUS**

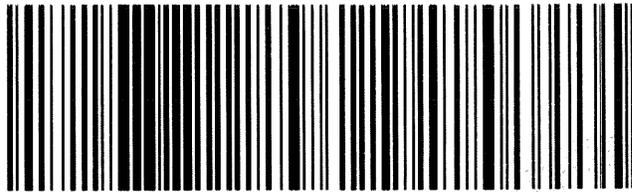


**CUSTODY SEAL**

DATE

2/20/24

SIGNATURE

*Cal Castleberry*



**DHL**  
ANALYTICAL

Sample Receipt Checklist

Client Name: Weston Solutions, Inc.

Date Received: 2/21/2024

Work Order Number: 2402269

Received by: KAO

Checklist completed by: [Signature] 2/21/2024
Signature Date

Reviewed by: [Initials] 2/21/2024
Initials Date

Carrier name: FedEx 1day

- Shipping container/cooler in good condition? Yes [checked] No [ ] Not Present [ ]
Custody seals intact on shipping container/cooler? Yes [checked] No [ ] Not Present [ ]
Custody seals intact on sample bottles? Yes [ ] No [ ] Not Present [checked]
Chain of custody present? Yes [checked] No [ ]
Chain of custody signed when relinquished and received? Yes [checked] No [ ]
Chain of custody agrees with sample labels? Yes [checked] No [ ]
Samples in proper container/bottle? Yes [checked] No [ ]
Sample containers intact? Yes [checked] No [ ]
Sufficient sample volume for indicated test? Yes [checked] No [ ]
All samples received within holding time? Yes [checked] No [ ]
Water - VOA vials have zero headspace? Yes [checked] No [ ] No VOA vials submitted [ ] NA [ ]
Water - pH<2 acceptable upon receipt? Yes [ ] No [ ] NA [checked] LOT #
Adjusted? \_\_\_\_\_ Checked by \_\_\_\_\_
Water - pH>9 (S) or pH>10 (CN) acceptable upon receipt? Yes [ ] No [ ] NA [checked] LOT #
Adjusted? \_\_\_\_\_ Checked by \_\_\_\_\_
Container/Temp Blank temperature in compliance? Yes [checked] No [ ]

Table with 3 columns: Cooler #, 1, 2. Rows: Temp °C (0.7, 1.6), Seal Intact (Y, Y)

Any No response must be detailed in the comments section below.

Client contacted: \_\_\_\_\_ Date contacted: \_\_\_\_\_ Person contacted: \_\_\_\_\_

Contacted by: \_\_\_\_\_ Regarding: \_\_\_\_\_

Comments: \_\_\_\_\_

Corrective Action: \_\_\_\_\_

<b>Laboratory Name: DHL Analytical, Inc.</b>							
<b>Laboratory Review Checklist: Reportable Data</b>							
<b>Project Name:</b> SAWS Impoundment Assess Lagoons/Decant Samp				<b>LRC Date:</b> 2/28/2024			
<b>Reviewer Name:</b> Angie O'Donnell				<b>Laboratory Work Order:</b> 2402269			
<b>Prep Batch Number(s):</b> See Prep Dates Report				<b>Run Batch:</b> See Analytical Dates Report			
# <sup>1</sup>	A <sup>2</sup>	Description	Yes	No	NA <sup>3</sup>	NR <sup>4</sup>	ER# <sup>5</sup>
		<b>Chain-of-Custody (C-O-C)</b>					
R1	OI	1) Did samples meet the laboratory's standard conditions of sample acceptability upon receipt?	X				R1-01
		2) Were all departures from standard conditions described in an exception report?			X		
R2	OI	<b>Sample and Quality Control (QC) Identification</b>					
		1) Are all field sample ID numbers cross-referenced to the laboratory ID numbers?	X				
		2) Are all laboratory ID numbers cross-referenced to the corresponding QC data?	X				
R3	OI	<b>Test Reports</b>					
		1) Were all samples prepared and analyzed within holding times?	X				
		2) Other than those results < MQL, were all other raw values bracketed by calibration standards?	X				
		3) Were calculations checked by a peer or supervisor?	X				
		4) Were all analyte identifications checked by a peer or supervisor?	X				
		5) Were sample detection limits reported for all analytes not detected?	X				
		6) Were all results for soil and sediment samples reported on a dry weight basis?	X				
		7) Were % moisture (or solids) reported for all soil and sediment samples?	X				
		8) Were bulk soils/solids samples for volatile analysis extracted with methanol per EPA Method 5035?	X				
		9) If required for the project, TICs reported?			X		
R4	O	<b>Surrogate Recovery Data</b>					
		1) Were surrogates added prior to extraction?	X				
		2) Were surrogate percent recoveries in all samples within the laboratory QC limits?	X				
R5	OI	<b>Test Reports/Summary Forms for Blank Samples</b>					
		1) Were appropriate type(s) of blanks analyzed?	X				
		2) Were blanks analyzed at the appropriate frequency?	X				
		3) Where method blanks taken through the entire analytical process, including preparation and, if applicable, cleanup procedures?	X				
		4) Were blank concentrations < MDL?	X				
		5) For analyte(s) detected in a blank sample, was the concentration, unadjusted for sample specific factors, in all associated field samples, <b>greater</b> than 10 times the concentration in the blank sample?			X		
R6	OI	<b>Laboratory Control Samples (LCS):</b>					
		1) Were all COCs included in the LCS?	X				
		2) Was each LCS taken through the entire analytical procedure, including prep and cleanup steps?	X				
		3) Were LCSs analyzed at the required frequency?	X				
		4) Were LCS (and LCSD, if applicable) %Rs within the laboratory QC limits?		X			R6-04
		5) Does the detectability data document the laboratory's capability to detect the COCs at the MDL used to calculate the SDLs?	X				
		6) Was the LCSD RPD within QC limits (if applicable)?	X				
R7	OI	<b>Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Data</b>					
		1) Were the project/method specified analytes included in the MS and MSD?	X				
		2) Were MS/MSD analyzed at the appropriate frequency?	X				
		3) Were MS (and MSD, if applicable) %Rs within the laboratory QC limits?		X			R7-03
		4) Were MS/MSD RPDs within laboratory QC limits?	X				
R8	OI	<b>Analytical Duplicate Data</b>					
		1) Were appropriate analytical duplicates analyzed for each matrix?			X		
		2) Were analytical duplicates analyzed at the appropriate frequency?			X		
		3) Were RPDs or relative standard deviations within the laboratory QC limits?			X		
R9	OI	<b>Method Quantitation Limits (MQLs):</b>					
		1) Are the MQLs for each method analyte included in the laboratory data package?	X				
		2) Do the MQLs correspond to the concentration of the lowest non-zero calibration standard?	X				
		3) Are unadjusted MQLs and DCSs included in the laboratory data package?	X				
R10	OI	<b>Other Problems/Anomalies</b>					
		1) Are all known problems/anomalies/special conditions noted in this LRC and ER?	X				R10-01
		2) Was applicable and available technology used to lower the SDL to minimize the matrix interference affects on the sample results?	X				
		3) Is the laboratory NELAC-accredited under the Texas Laboratory Accreditation Program for the analytes, matrices and methods associated with this laboratory data package?	X				

<b>Laboratory Name: DHL Analytical, Inc.</b>							
<b>Laboratory Review Checklist (continued): Supporting Data</b>							
<b>Project Name:</b> SAWS Impoundment Assess Lagoons/Decant Samp			<b>LRC Date:</b> 2/28/2024				
<b>Reviewer Name:</b> Angie O'Donnell			<b>Laboratory Work Order:</b> 2402269				
<b>Prep Batch Number(s):</b> See Prep Dates Report			<b>Run Batch:</b> See Analytical Dates Report				
# <sup>1</sup>	A <sup>2</sup>	Description	Yes	No	NA <sup>3</sup>	NR <sup>4</sup>	ER# <sup>5</sup>
S1	OI	<b>Initial Calibration (ICAL)</b>					
		1) Were response factors and/or relative response factors for each analyte within QC limits?	X				
		2) Were percent RSDs or correlation coefficient criteria met?	X				
		3) Was the number of standards recommended in the method used for all analytes?	X				
		4) Were all points generated between the lowest and highest standard used to calculate the curve?	X				
		5) Are ICAL data available for all instruments used?	X				
		6) Has the initial calibration curve been verified using an appropriate second source standard?	X				
S2	OI	<b>Initial and Continuing calibration Verification (ICCV and CCV) and Continuing Calibration blank (CCB):</b>					
		1) Was the CCV analyzed at the method-required frequency?	X				
		2) Were percent differences for each analyte within the method-required QC limits?		X			S2-02
		3) Was the ICAL curve verified for each analyte?	X				
		4) Was the absolute value of the analyte concentration in the inorganic CCB < MDL?	X				
S3	O	<b>Mass Spectral Tuning:</b>					
		1) Was the appropriate compound for the method used for tuning?	X				
		2) Were ion abundance data within the method-required QC limits?	X				
S4	O	<b>Internal Standards (IS):</b>					
		1) Were IS area counts and retention times within the method-required QC limits?	X				
S5	OI	<b>Raw Data (NELAC Section 5.5.10)</b>					
		1) Were the raw data (for example, chromatograms, spectral data) reviewed by an analyst?	X				
		2) Were data associated with manual integrations flagged on the raw data?	X				
S6	O	<b>Dual Column Confirmation</b>					
		1) Did dual column confirmation results meet the method-required QC?			X		
S7	O	<b>Tentatively Identified Compounds (TICs):</b>					
		1) If TICs were requested, were the mass spectra and TIC data subject to appropriate checks?			X		
S8	I	<b>Interference Check Sample (ICS) Results:</b>					
		1) Were percent recoveries within method QC limits?	X				
S9	I	<b>Serial Dilutions, Post Digestion Spikes, and Method of Standard Additions</b>					
		1) Were percent differences, recoveries, and the linearity within the QC limits specified in the method?	X				
S10	OI	<b>Method Detection Limit (MDL) Studies</b>					
		1) Was a MDL study performed for each reported analyte?	X				
		2) Is the MDL either adjusted or supported by the analysis of DCSs?	X				
S11	OI	<b>Proficiency Test Reports:</b>					
		1) Was the lab's performance acceptable on the applicable proficiency tests or evaluation studies?	X				
S12	OI	<b>Standards Documentation</b>					
		1) Are all standards used in the analyses NIST-traceable or obtained from other appropriate sources?	X				
S13	OI	<b>Compound/Analyte Identification Procedures</b>					
		1) Are the procedures for compound/analyte identification documented?	X				
S14	OI	<b>Demonstration of Analyst Competency (DOC)</b>					
		1) Was DOC conducted consistent with NELAC Chapter 5 – Appendix C?	X				
		2) Is documentation of the analyst's competency up-to-date and on file?	X				
S15	OI	<b>Verification/Validation Documentation for Methods (NELAC Chapter 5)</b>					
		1) Are all the methods used to generate the data documented, verified, and validated, where applicable?	X				
S16	OI	<b>Laboratory Standard Operating Procedures (SOPs):</b>					
		1) Are laboratory SOPs current and on file for each method performed?	X				

- 1 Items identified by the letter "R" should be included in the laboratory data package submitted to the TCEQ in the TRRP-required report(s). Items identified by the letter "S" should be retained and made available upon request for the appropriate retention period.
- 2 O = organic analyses; I = inorganic analyses (and general chemistry, when applicable).
- 3 NA = Not applicable.
- 4 NR = Not Reviewed.
- 5 ER# = Exception Report identification number (an Exception Report should be completed for an item if "NR" or "No" is checked).

# Laboratory Data Package Signature Page – RG-366/TRRP-13

This data package consists of:

This signature page, the laboratory review checklist, and the following reportable data:

- R1 Field chain-of-custody documentation;
- R2 Sample identification cross-reference;
- R3 Test reports (analytical data sheets) for each environmental sample that includes:
  - a) Items consistent with NELAC Chapter 5,
  - b) dilution factors,
  - c) preparation methods,
  - d) cleanup methods, and
  - e) if required for the project, tentatively identified compounds (TICs).
- R4 Surrogate recovery data including:
  - a) Calculated recovery (%R), and
  - b) The laboratory's surrogate QC limits.
- R5 Test reports/summary forms for blank samples;
- R6 Test reports/summary forms for laboratory control samples (LCSs) including:
  - a) LCS spiking amounts,
  - b) Calculated %R for each analyte, and
  - c) The laboratory's LCS QC limits.
- R7 Test reports for project matrix spike/matrix spike duplicates (MS/MSDs) including:
  - a) Samples associated with the MS/MSD clearly identified,
  - b) MS/MSD spiking amounts,
  - c) Concentration of each MS/MSD analyte measured in the parent and spiked samples,
  - d) Calculated %Rs and relative percent differences (RPDs), and
  - e) The laboratory's MS/MSD QC limits
- R8 Laboratory analytical duplicate (if applicable) recovery and precision:
  - a) The amount of analyte measured in the duplicate,
  - b) The calculated RPD, and
  - c) The laboratory's QC limits for analytical duplicates.
- R9 List of method quantitation limits (MQLs) and detectability check sample results for each analyte for each method and matrix;
- R10 Other problems or anomalies.

The Exception Report for each “No” or “Not Reviewed (NR)” item in the Laboratory Review Checklist and for each analyte, matrix, and method for which the laboratory is not accredited under the Texas Laboratory Accreditation Program.

**Release Statement:** I am responsible for the release of this laboratory data package. This laboratory is accredited under the Texas Laboratory Accreditation Program for all the methods, analytes, and matrices reported in this data package except as noted in the Exception Reports. The data have been reviewed and are technically compliant with the requirements of the methods used, except where noted by the laboratory in the Exception Reports. By my signature below, I affirm to the best of my knowledge that all problems/anomalies observed by the laboratory have been identified in the Laboratory Review Checklist, and no information or data affecting the quality of the data has been knowingly withheld.

This laboratory was last inspected by TCEQ on May 30 – June 2, 2023. Any findings affecting the data in this laboratory data package are noted in the Exception Reports herein. The official signing the cover page of the report in which these data are used is responsible for releasing this data package and is by signature affirming the above release statement is true.

Name: John DuPont  
Official Title: General Manager

  
Signature

02/28/24  
Date

Name: Dr. Derhsing Luu  
Official Title: Technical Director

---

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Lab Order:** 2402269

---

**CASE NARRATIVE**

Samples were analyzed using the methods outlined in the following references:

Method SW8260D - Volatile Organics Analysis (the compound Cyclohexane is not NELAP Certified)

Method SW8270E - Semivolatile Organics Analysis (the compound Benzaldehyde is not NELAP Certified)

Method SW6020B- Metals Analysis

Method SW7471B - Mercury Analysis

Method D2216 - Percent Moisture Analysis

**Exception Report R1-01**

Samples were received and login performed on 2/21/2024. A total of 10 samples were received and analyzed. The samples arrived in good condition and were properly packaged.

**Exception Report R6-04**

For Volatile Organics Analysis, for aqueous Batch 114106, the recoveries of three compounds for the Laboratory Control Spike (LCS-114106) were above the method control limits. These are flagged accordingly in the QC Summary Report. These compounds were within method control limits in the associated ICV. No further corrective action was taken.

For Semivolatile Organics Analysis, for soil Batch 114177, the recovery of Atrazine for the Laboratory Control Spike (LCS-114177) was above the method control limits. This is flagged accordingly in the QC Summary Report. This compound was within method control limits in the associated ICV. No further corrective action was taken.

**Exception Report R7-03**

For Metals Analysis, for soil Batch 114139, the recoveries of three analytes for the Matrix Spike and Matrix Spike Duplicate (2402269-04 MS/MSD) were outside of the method control limits. These are flagged accordingly in the QC Summary Report. These analytes were within method control limits in the associated LCS. No further corrective action was taken.

For Semivolatile Organics Analysis, for soil Batch 114177, the recoveries of three compounds for the Matrix Spike and Matrix Spike Duplicate (2402269-01 MS/MSD) were outside of the method control limits. These are flagged accordingly in the QC Summary Report. These compounds analytes were within method control limits in the associated LCS or were nondetect in the associated samples. No further corrective action was taken.

---

---

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Lab Order:** 2402269

---

**CASE NARRATIVE**

Exception Report R10-01

Per project specification, MS/MSD/Duplicates are from this workorder or project samples only.

Exception Report S2-02

For Volatiles Analysis, for aqueous samples performed on 2/21/2024, the recovery of Carbon disulfide for the Initial Calibration Verification (ICV-240221) was slightly below the method control limits specified in SW8260D (70-130% recovery). This is flagged accordingly in the QC Summary Report. The number of target analytes outside of the method control limits for the ICV are less than 20% of the total number of compounds being reported; this is allowed in SW8260D specifications. This compound was within method control limits in the associated LCS. No further corrective action was taken.

---

---

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Lab Order:** 2402269

**Work Order Sample Summary**

---

<b>Lab Smp ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Recved</b>
2402269-01	SS-1		02/20/24 09:26 AM	02/21/2024
2402269-02	SS-2		02/20/24 09:50 AM	02/21/2024
2402269-03	SS-3		02/20/24 10:18 AM	02/21/2024
2402269-04	SS-4		02/20/24 10:45 AM	02/21/2024
2402269-05	Trip Blank-1		02/20/24	02/21/2024
2402269-06	SS-5		02/20/24 10:59 AM	02/21/2024
2402269-07	SS-6		02/20/24 11:13 AM	02/21/2024
2402269-08	SS-DUP		02/20/24 11:13 AM	02/21/2024
2402269-09	SS-Background		02/20/24 11:35 AM	02/21/2024
2402269-10	Trip Blank-2		02/20/24	02/21/2024

**Lab Order:** 2402269  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**PREP DATES REPORT**

Sample ID	Client Sample ID	Collection Date	Matrix	Test Number	Test Name	Prep Date	Batch ID
2402269-01A	SS-1	02/20/24 09:26 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-01B	SS-1	02/20/24 09:26 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-1	02/20/24 09:26 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177
	SS-1	02/20/24 09:26 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-1	02/20/24 09:26 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-01D	SS-1	02/20/24 09:26 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-02A	SS-2	02/20/24 09:50 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-02B	SS-2	02/20/24 09:50 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-2	02/20/24 09:50 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177
	SS-2	02/20/24 09:50 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-2	02/20/24 09:50 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-02D	SS-2	02/20/24 09:50 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-03A	SS-3	02/20/24 10:18 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-03B	SS-3	02/20/24 10:18 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-3	02/20/24 10:18 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177
	SS-3	02/20/24 10:18 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-3	02/20/24 10:18 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-03D	SS-3	02/20/24 10:18 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-04A	SS-4	02/20/24 10:45 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-04B	SS-4	02/20/24 10:45 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-4	02/20/24 10:45 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177
	SS-4	02/20/24 10:45 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-4	02/20/24 10:45 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-04D	SS-4	02/20/24 10:45 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-05A	Trip Blank-1	02/20/24	Trip Blank	SW5030C	Purge and Trap Water GC/MS	02/21/24 08:52 AM	114106
2402269-06A	SS-5	02/20/24 10:59 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-06B	SS-5	02/20/24 10:59 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-5	02/20/24 10:59 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177

**Lab Order:** 2402269  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**PREP DATES REPORT**

Sample ID	Client Sample ID	Collection Date	Matrix	Test Number	Test Name	Prep Date	Batch ID
2402269-06B	SS-5	02/20/24 10:59 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-5	02/20/24 10:59 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-06D	SS-5	02/20/24 10:59 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-07A	SS-6	02/20/24 11:13 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-07B	SS-6	02/20/24 11:13 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-6	02/20/24 11:13 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177
	SS-6	02/20/24 11:13 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-6	02/20/24 11:13 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-07D	SS-6	02/20/24 11:13 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-08A	SS-DUP	02/20/24 11:13 AM	Soil	SW5035A	Purge and Trap 5035	02/21/24 10:36 AM	114118
2402269-08B	SS-DUP	02/20/24 11:13 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-DUP	02/20/24 11:13 AM	Soil	SW3550C	Soil Prep Sonication: BNA	02/26/24 09:04 AM	114177
	SS-DUP	02/20/24 11:13 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-DUP	02/20/24 11:13 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-08D	SS-DUP	02/20/24 11:13 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-09A	SS-Background	02/20/24 11:35 AM	Soil	SW7471B	Mercury Soil Prep, Total	02/22/24 08:07 AM	114134
	SS-Background	02/20/24 11:35 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
	SS-Background	02/20/24 11:35 AM	Soil	SW3050B	Soil Prep Total Metals: ICP-MS	02/22/24 09:35 AM	114139
2402269-09C	SS-Background	02/20/24 11:35 AM	Soil	D2216	Moisture Preparation	02/21/24 01:44 PM	114122
2402269-10A	Trip Blank-2	02/20/24	Trip Blank	SW5030C	Purge and Trap Water GC/MS	02/21/24 08:52 AM	114106

**Lab Order:** 2402269  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**ANALYTICAL DATES REPORT**

Sample ID	Client Sample ID	Matrix	Test Number	Test Name	Batch ID	Dilution	Analysis Date	Run ID
2402269-01A	SS-1	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/21/24 09:23 PM	GCMS2_240221B
2402269-01B	SS-1	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 10:38 AM	CETAC2_HG_240223 A
	SS-1	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 05:33 PM	GCMS4_240226A
	SS-1	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:43 AM	ICP-MS5_240223A
	SS-1	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	250	02/23/24 11:26 AM	ICP-MS5_240223A
2402269-01D	SS-1	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-02A	SS-2	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/21/24 09:51 PM	GCMS2_240221B
2402269-02B	SS-2	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 10:40 AM	CETAC2_HG_240223 A
	SS-2	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 05:59 PM	GCMS4_240226A
	SS-2	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:46 AM	ICP-MS5_240223A
	SS-2	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	250	02/23/24 11:29 AM	ICP-MS5_240223A
2402269-02D	SS-2	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-03A	SS-3	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/21/24 10:19 PM	GCMS2_240221B
2402269-03B	SS-3	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 10:51 AM	CETAC2_HG_240223 A
	SS-3	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 06:24 PM	GCMS4_240226A
	SS-3	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:48 AM	ICP-MS5_240223A
	SS-3	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	100	02/23/24 11:31 AM	ICP-MS5_240223A
2402269-03D	SS-3	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-04A	SS-4	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/21/24 10:47 PM	GCMS2_240221B
2402269-04B	SS-4	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 10:54 AM	CETAC2_HG_240223 A
	SS-4	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 06:49 PM	GCMS4_240226A
	SS-4	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:38 AM	ICP-MS5_240223A
	SS-4	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	100	02/23/24 11:21 AM	ICP-MS5_240223A
2402269-04D	SS-4	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-05A	Trip Blank-1	Trip Blank	SW8260D	8260 Water Volatiles by GC/MS	114106	1	02/21/24 11:31 AM	GCMS7_240221A
2402269-06A	SS-5	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/21/24 11:15 PM	GCMS2_240221B

**Lab Order:** 2402269  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**ANALYTICAL DATES REPORT**

Sample ID	Client Sample ID	Matrix	Test Number	Test Name	Batch ID	Dilution	Analysis Date	Run ID
2402269-06B	SS-5	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 10:56 AM	CETAC2_HG_240223_A
	SS-5	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 07:14 PM	GCMS4_240226A
	SS-5	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:51 AM	ICP-MS5_240223A
	SS-5	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	250	02/23/24 11:34 AM	ICP-MS5_240223A
2402269-06D	SS-5	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-07A	SS-6	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/21/24 11:43 PM	GCMS2_240221B
2402269-07B	SS-6	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 10:58 AM	CETAC2_HG_240223_A
	SS-6	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 07:39 PM	GCMS4_240226A
	SS-6	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	100	02/23/24 11:36 AM	ICP-MS5_240223A
	SS-6	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:53 AM	ICP-MS5_240223A
2402269-07D	SS-6	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-08A	SS-DUP	Soil	SW8260D	Volatiles by 8260/5035 GC/MS	114118	1	02/22/24 12:11 AM	GCMS2_240221B
2402269-08B	SS-DUP	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 11:05 AM	CETAC2_HG_240223_A
	SS-DUP	Soil	SW8270E	Semivolatiles by GC/MS	114177	1	02/26/24 08:04 PM	GCMS4_240226A
	SS-DUP	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:56 AM	ICP-MS5_240223A
	SS-DUP	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	100	02/23/24 11:39 AM	ICP-MS5_240223A
2402269-08D	SS-DUP	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-09A	SS-Background	Soil	SW7471B	Mercury Total: Soil/Solid	114134	1	02/23/24 11:07 AM	CETAC2_HG_240223_A
	SS-Background	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	5	02/23/24 10:58 AM	ICP-MS5_240223A
	SS-Background	Soil	SW6020B	Trace Metals: ICP-MS - Solid	114139	250	02/23/24 11:41 AM	ICP-MS5_240223A
2402269-09C	SS-Background	Soil	D2216	Percent Moisture	114122	1	02/22/24 10:00 AM	PMOIST_240221A
2402269-10A	Trip Blank-2	Trip Blank	SW8260D	8260 Water Volatiles by GC/MS	114106	1	02/21/24 11:56 AM	GCMS7_240221A

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-1  
**Lab ID:** 2402269-01  
**Collection Date:** 02/20/24 09:26 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	25700	777	2330		mg/Kg-dry	250	02/23/24 11:26 AM
Antimony	<0.622	0.622	1.24		mg/Kg-dry	5	02/23/24 10:43 AM
Arsenic	19.2	0.622	1.24		mg/Kg-dry	5	02/23/24 10:43 AM
Barium	210	0.622	2.49		mg/Kg-dry	5	02/23/24 10:43 AM
Beryllium	0.945	0.124	0.373		mg/Kg-dry	5	02/23/24 10:43 AM
Cadmium	0.251	0.124	0.373	J	mg/Kg-dry	5	02/23/24 10:43 AM
Calcium	155000	777	2330		mg/Kg-dry	250	02/23/24 11:26 AM
Chromium	31.0	0.622	2.49		mg/Kg-dry	5	02/23/24 10:43 AM
Cobalt	12.2	0.622	2.49		mg/Kg-dry	5	02/23/24 10:43 AM
Copper	13.7	0.622	2.49		mg/Kg-dry	5	02/23/24 10:43 AM
Iron	126000	777	2330		mg/Kg-dry	250	02/23/24 11:26 AM
Lead	13.1	0.124	0.373		mg/Kg-dry	5	02/23/24 10:43 AM
Magnesium	6130	15.5	46.6		mg/Kg-dry	5	02/23/24 10:43 AM
Manganese	429	0.622	2.49		mg/Kg-dry	5	02/23/24 10:43 AM
Nickel	19.5	0.622	2.49		mg/Kg-dry	5	02/23/24 10:43 AM
Potassium	5310	15.5	46.6		mg/Kg-dry	5	02/23/24 10:43 AM
Selenium	1.03	0.186	0.622		mg/Kg-dry	5	02/23/24 10:43 AM
Silver	<0.124	0.124	0.249		mg/Kg-dry	5	02/23/24 10:43 AM
Sodium	90.5	15.5	46.6		mg/Kg-dry	5	02/23/24 10:43 AM
Thallium	<0.622	0.622	1.24		mg/Kg-dry	5	02/23/24 10:43 AM
Vanadium	396	1.24	3.11		mg/Kg-dry	5	02/23/24 10:43 AM
Zinc	57.5	1.24	3.11		mg/Kg-dry	5	02/23/24 10:43 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	<0.0197	0.0197	0.0494		mg/Kg-dry	1	02/23/24 10:38 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2,4,6-Trichlorophenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2,4-Dichlorophenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2,4-Dimethylphenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2,4-Dinitrophenol	<0.0658	0.0658	0.174		mg/Kg-dry	1	02/26/24 05:33 PM
2,4-Dinitrotoluene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2,6-Dinitrotoluene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2-Chloronaphthalene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2-Chlorophenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2-Methylnaphthalene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2-Methylphenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2-Nitroaniline	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
2-Nitrophenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-1  
**Lab ID:** 2402269-01  
**Collection Date:** 02/20/24 09:26 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
3-Nitroaniline	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
4,6-Dinitro-2-methylphenol	<0.0395	0.0395	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
4-Bromophenyl phenyl ether	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
4-Chloro-3-methylphenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
4-Chloroaniline	<0.0395	0.0395	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
4-Chlorophenyl phenyl ether	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
4-Methylphenol	<0.0263	0.0263	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
4-Nitroaniline	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
4-Nitrophenol	<0.0658	0.0658	0.174		mg/Kg-dry	1	02/26/24 05:33 PM
Acenaphthene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Acenaphthylene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Acetophenone	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Anthracene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Atrazine	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Benzaldehyde	<0.0132	0.0132	0.0350	N	mg/Kg-dry	1	02/26/24 05:33 PM
Benzo[a]anthracene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Benzo[a]pyrene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Benzo[b]fluoranthene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Benzo[g,h,i]perylene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Benzo[k]fluoranthene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Benzoic acid	<0.0658	0.0658	0.174		mg/Kg-dry	1	02/26/24 05:33 PM
Benzyl alcohol	<0.0395	0.0395	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Biphenyl	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Bis(2-chloroethoxy)methane	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Bis(2-chloroethyl)ether	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Bis(2-chloroisopropyl)ether	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Bis(2-ethylhexyl)phthalate	<0.0842	0.0842	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Butyl benzyl phthalate	<0.0526	0.0526	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Caprolactam	<0.0395	0.0395	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Carbazole	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Chrysene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Dibenz[a,h]anthracene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Dibenzofuran	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Diethyl phthalate	<0.0526	0.0526	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Dimethyl phthalate	<0.0526	0.0526	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Di-n-butyl phthalate	<0.0526	0.0526	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Di-n-octyl phthalate	<0.0526	0.0526	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Fluoranthene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-1  
**Lab ID:** 2402269-01  
**Collection Date:** 02/20/24 09:26 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Hexachlorobenzene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Hexachlorobutadiene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Hexachlorocyclopentadiene	<0.0395	0.0395	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Hexachloroethane	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Indeno[1,2,3-cd]pyrene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Isophorone	<0.0395	0.0395	0.0869		mg/Kg-dry	1	02/26/24 05:33 PM
Naphthalene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Nitrobenzene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
N-Nitrosodi-n-propylamine	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
N-Nitrosodiphenylamine	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Pentachlorophenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Phenanthrene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Phenol	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Pyrene	<0.0132	0.0132	0.0350		mg/Kg-dry	1	02/26/24 05:33 PM
Pyridine	<0.0658	0.0658	0.174		mg/Kg-dry	1	02/26/24 05:33 PM
Surr: 2,4,6-Tribromophenol	79.0	0	45-126		%REC	1	02/26/24 05:33 PM
Surr: 2-Fluorobiphenyl	84.0	0	60-125		%REC	1	02/26/24 05:33 PM
Surr: 2-Fluorophenol	81.0	0	37-125		%REC	1	02/26/24 05:33 PM
Surr: 4-Terphenyl-d14	90.0	0	45-125		%REC	1	02/26/24 05:33 PM
Surr: Nitrobenzene-d5	77.0	0	45-125		%REC	1	02/26/24 05:33 PM
Surr: Phenol-d5	78.0	0	40-125		%REC	1	02/26/24 05:33 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,1,1-Trichloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,1,2,2-Tetrachloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,1,2-Trichloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,1,2-Trichlorotrifluoroethane	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
1,1-Dichloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,1-Dichloroethene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,1-Dichloropropene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2,3-Trichlorobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2,3-Trichloropropane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2,4-Trichlorobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2,4-Trimethylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2-Dibromo-3-chloropropane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2-Dibromoethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2-Dichlorobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-1  
**Lab ID:** 2402269-01  
**Collection Date:** 02/20/24 09:26 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,2-Dichloropropane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,3,5-Trimethylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,3-Dichlorobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,3-Dichloropropane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1,4-Dichlorobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
1-Chlorohexane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
2,2-Dichloropropane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
2-Butanone	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
2-Chlorotoluene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
2-Hexanone	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
4-Chlorotoluene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
4-Methyl-2-pentanone	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
Acetone	<0.0207	0.0207	0.0689		mg/Kg-dry	1	02/21/24 09:23 PM
Benzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Bromobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Bromochloromethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Bromodichloromethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Bromoform	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Bromomethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Carbon disulfide	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
Carbon tetrachloride	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Chlorobenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Chloroethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Chloroform	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Chloromethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
cis-1,2-Dichloroethene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
cis-1,3-Dichloropropene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Cyclohexane	<0.00689	0.00689	0.0207	N	mg/Kg-dry	1	02/21/24 09:23 PM
Dibromochloromethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Dibromomethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Dichlorodifluoromethane	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Ethylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Hexachlorobutadiene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Isopropylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
m,p-Xylene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Methyl Acetate	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
Methyl tert-butyl ether	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Methylcyclohexane	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-1  
**Lab ID:** 2402269-01  
**Collection Date:** 02/20/24 09:26 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00689	0.00689	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Naphthalene	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
n-Butylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
n-Propylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
o-Xylene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
p-Isopropyltoluene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
sec-Butylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Styrene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
tert-Butylbenzene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Tetrachloroethene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Toluene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
trans-1,2-Dichloroethene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
trans-1,3-Dichloropropene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Trichloroethene	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Trichlorofluoromethane	<0.00689	0.00689	0.0207		mg/Kg-dry	1	02/21/24 09:23 PM
Vinyl chloride	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Xylenes, Total	<0.00138	0.00138	0.00689		mg/Kg-dry	1	02/21/24 09:23 PM
Surr: 1,2-Dichloroethane-d4	107	0	52-149		%REC	1	02/21/24 09:23 PM
Surr: 4-Bromofluorobenzene	105	0	84-118		%REC	1	02/21/24 09:23 PM
Surr: Dibromofluoromethane	95.1	0	65-135		%REC	1	02/21/24 09:23 PM
Surr: Toluene-d8	97.2	0	84-116		%REC	1	02/21/24 09:23 PM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	24.1	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-2  
**Lab ID:** 2402269-02  
**Collection Date:** 02/20/24 09:50 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	20600	699	2100		mg/Kg-dry	250	02/23/24 11:29 AM
Antimony	<0.559	0.559	1.12		mg/Kg-dry	5	02/23/24 10:46 AM
Arsenic	7.22	0.559	1.12		mg/Kg-dry	5	02/23/24 10:46 AM
Barium	87.0	0.559	2.24		mg/Kg-dry	5	02/23/24 10:46 AM
Beryllium	0.734	0.112	0.335		mg/Kg-dry	5	02/23/24 10:46 AM
Cadmium	0.198	0.112	0.335	J	mg/Kg-dry	5	02/23/24 10:46 AM
Calcium	158000	699	2100		mg/Kg-dry	250	02/23/24 11:29 AM
Chromium	22.4	0.559	2.24		mg/Kg-dry	5	02/23/24 10:46 AM
Cobalt	5.28	0.559	2.24		mg/Kg-dry	5	02/23/24 10:46 AM
Copper	7.22	0.559	2.24		mg/Kg-dry	5	02/23/24 10:46 AM
Iron	17400	699	2100		mg/Kg-dry	250	02/23/24 11:29 AM
Lead	9.11	0.112	0.335		mg/Kg-dry	5	02/23/24 10:46 AM
Magnesium	3990	14.0	41.9		mg/Kg-dry	5	02/23/24 10:46 AM
Manganese	163	0.559	2.24		mg/Kg-dry	5	02/23/24 10:46 AM
Nickel	9.77	0.559	2.24		mg/Kg-dry	5	02/23/24 10:46 AM
Potassium	3660	14.0	41.9		mg/Kg-dry	5	02/23/24 10:46 AM
Selenium	0.418	0.168	0.559	J	mg/Kg-dry	5	02/23/24 10:46 AM
Silver	<0.112	0.112	0.224		mg/Kg-dry	5	02/23/24 10:46 AM
Sodium	69.7	14.0	41.9		mg/Kg-dry	5	02/23/24 10:46 AM
Thallium	<0.559	0.559	1.12		mg/Kg-dry	5	02/23/24 10:46 AM
Vanadium	52.4	1.12	2.79		mg/Kg-dry	5	02/23/24 10:46 AM
Zinc	37.4	1.12	2.79		mg/Kg-dry	5	02/23/24 10:46 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	<0.0169	0.0169	0.0423		mg/Kg-dry	1	02/23/24 10:40 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2,4,6-Trichlorophenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2,4-Dichlorophenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2,4-Dimethylphenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2,4-Dinitrophenol	<0.0579	0.0579	0.153		mg/Kg-dry	1	02/26/24 05:59 PM
2,4-Dinitrotoluene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2,6-Dinitrotoluene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2-Chloronaphthalene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2-Chlorophenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2-Methylnaphthalene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2-Methylphenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2-Nitroaniline	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
2-Nitrophenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-2  
**Lab ID:** 2402269-02  
**Collection Date:** 02/20/24 09:50 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
3-Nitroaniline	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
4,6-Dinitro-2-methylphenol	<0.0347	0.0347	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
4-Bromophenyl phenyl ether	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
4-Chloro-3-methylphenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
4-Chloroaniline	<0.0347	0.0347	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
4-Chlorophenyl phenyl ether	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
4-Methylphenol	<0.0232	0.0232	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
4-Nitroaniline	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
4-Nitrophenol	<0.0579	0.0579	0.153		mg/Kg-dry	1	02/26/24 05:59 PM
Acenaphthene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Acenaphthylene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Acetophenone	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Anthracene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Atrazine	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Benzaldehyde	<0.0116	0.0116	0.0308	N	mg/Kg-dry	1	02/26/24 05:59 PM
Benzo[a]anthracene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Benzo[a]pyrene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Benzo[b]fluoranthene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Benzo[g,h,i]perylene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Benzo[k]fluoranthene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Benzoic acid	<0.0579	0.0579	0.153		mg/Kg-dry	1	02/26/24 05:59 PM
Benzyl alcohol	<0.0347	0.0347	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Biphenyl	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Bis(2-chloroethoxy)methane	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Bis(2-chloroethyl)ether	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Bis(2-chloroisopropyl)ether	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Bis(2-ethylhexyl)phthalate	<0.0741	0.0741	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Butyl benzyl phthalate	<0.0463	0.0463	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Caprolactam	<0.0347	0.0347	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Carbazole	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Chrysene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Dibenz[a,h]anthracene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Dibenzofuran	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Diethyl phthalate	<0.0463	0.0463	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Dimethyl phthalate	<0.0463	0.0463	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Di-n-butyl phthalate	<0.0463	0.0463	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Di-n-octyl phthalate	<0.0463	0.0463	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Fluoranthene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-2  
**Lab ID:** 2402269-02  
**Collection Date:** 02/20/24 09:50 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Hexachlorobenzene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Hexachlorobutadiene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Hexachlorocyclopentadiene	<0.0347	0.0347	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Hexachloroethane	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Indeno[1,2,3-cd]pyrene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Isophorone	<0.0347	0.0347	0.0764		mg/Kg-dry	1	02/26/24 05:59 PM
Naphthalene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Nitrobenzene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
N-Nitrosodi-n-propylamine	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
N-Nitrosodiphenylamine	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Pentachlorophenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Phenanthrene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Phenol	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Pyrene	<0.0116	0.0116	0.0308		mg/Kg-dry	1	02/26/24 05:59 PM
Pyridine	<0.0579	0.0579	0.153		mg/Kg-dry	1	02/26/24 05:59 PM
Surr: 2,4,6-Tribromophenol	82.0	0	45-126		%REC	1	02/26/24 05:59 PM
Surr: 2-Fluorobiphenyl	84.0	0	60-125		%REC	1	02/26/24 05:59 PM
Surr: 2-Fluorophenol	80.0	0	37-125		%REC	1	02/26/24 05:59 PM
Surr: 4-Terphenyl-d14	91.0	0	45-125		%REC	1	02/26/24 05:59 PM
Surr: Nitrobenzene-d5	76.0	0	45-125		%REC	1	02/26/24 05:59 PM
Surr: Phenol-d5	78.0	0	40-125		%REC	1	02/26/24 05:59 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,1,1-Trichloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,1,2,2-Tetrachloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,1,2-Trichloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,1,2-Trichlorotrifluoroethane	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
1,1-Dichloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,1-Dichloroethene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,1-Dichloropropene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2,3-Trichlorobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2,3-Trichloropropane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2,4-Trichlorobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2,4-Trimethylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2-Dibromo-3-chloropropane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2-Dibromoethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2-Dichlorobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-2  
**Lab ID:** 2402269-02  
**Collection Date:** 02/20/24 09:50 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,2-Dichloropropane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,3,5-Trimethylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,3-Dichlorobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,3-Dichloropropane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1,4-Dichlorobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
1-Chlorohexane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
2,2-Dichloropropane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
2-Butanone	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
2-Chlorotoluene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
2-Hexanone	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
4-Chlorotoluene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
4-Methyl-2-pentanone	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
Acetone	<0.0152	0.0152	0.0508		mg/Kg-dry	1	02/21/24 09:51 PM
Benzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Bromobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Bromochloromethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Bromodichloromethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Bromoform	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Bromomethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Carbon disulfide	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
Carbon tetrachloride	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Chlorobenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Chloroethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Chloroform	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Chloromethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
cis-1,2-Dichloroethene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
cis-1,3-Dichloropropene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Cyclohexane	<0.00508	0.00508	0.0152	N	mg/Kg-dry	1	02/21/24 09:51 PM
Dibromochloromethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Dibromomethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Dichlorodifluoromethane	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Ethylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Hexachlorobutadiene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Isopropylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
m,p-Xylene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Methyl Acetate	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
Methyl tert-butyl ether	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Methylcyclohexane	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-2  
**Lab ID:** 2402269-02  
**Collection Date:** 02/20/24 09:50 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00508	0.00508	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Naphthalene	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
n-Butylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
n-Propylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
o-Xylene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
p-Isopropyltoluene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
sec-Butylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Styrene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
tert-Butylbenzene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Tetrachloroethene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Toluene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
trans-1,2-Dichloroethene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
trans-1,3-Dichloropropene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Trichloroethene	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Trichlorofluoromethane	<0.00508	0.00508	0.0152		mg/Kg-dry	1	02/21/24 09:51 PM
Vinyl chloride	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Xylenes, Total	<0.00102	0.00102	0.00508		mg/Kg-dry	1	02/21/24 09:51 PM
Surr: 1,2-Dichloroethane-d4	108	0	52-149		%REC	1	02/21/24 09:51 PM
Surr: 4-Bromofluorobenzene	106	0	84-118		%REC	1	02/21/24 09:51 PM
Surr: Dibromofluoromethane	104	0	65-135		%REC	1	02/21/24 09:51 PM
Surr: Toluene-d8	93.0	0	84-116		%REC	1	02/21/24 09:51 PM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	14.8	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-3  
**Lab ID:** 2402269-03  
**Collection Date:** 02/20/24 10:18 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	18200	264	793		mg/Kg-dry	100	02/23/24 11:31 AM
Antimony	<0.529	0.529	1.06		mg/Kg-dry	5	02/23/24 10:48 AM
Arsenic	5.45	0.529	1.06		mg/Kg-dry	5	02/23/24 10:48 AM
Barium	127	0.529	2.12		mg/Kg-dry	5	02/23/24 10:48 AM
Beryllium	0.653	0.106	0.317		mg/Kg-dry	5	02/23/24 10:48 AM
Cadmium	0.155	0.106	0.317	J	mg/Kg-dry	5	02/23/24 10:48 AM
Calcium	119000	264	793		mg/Kg-dry	100	02/23/24 11:31 AM
Chromium	21.9	0.529	2.12		mg/Kg-dry	5	02/23/24 10:48 AM
Cobalt	4.91	0.529	2.12		mg/Kg-dry	5	02/23/24 10:48 AM
Copper	7.06	0.529	2.12		mg/Kg-dry	5	02/23/24 10:48 AM
Iron	18100	264	793		mg/Kg-dry	100	02/23/24 11:31 AM
Lead	8.60	0.106	0.317		mg/Kg-dry	5	02/23/24 10:48 AM
Magnesium	3420	13.2	39.7		mg/Kg-dry	5	02/23/24 10:48 AM
Manganese	147	0.529	2.12		mg/Kg-dry	5	02/23/24 10:48 AM
Nickel	10.5	0.529	2.12		mg/Kg-dry	5	02/23/24 10:48 AM
Potassium	3610	13.2	39.7		mg/Kg-dry	5	02/23/24 10:48 AM
Selenium	0.338	0.159	0.529	J	mg/Kg-dry	5	02/23/24 10:48 AM
Silver	<0.106	0.106	0.212		mg/Kg-dry	5	02/23/24 10:48 AM
Sodium	53.8	13.2	39.7		mg/Kg-dry	5	02/23/24 10:48 AM
Thallium	<0.529	0.529	1.06		mg/Kg-dry	5	02/23/24 10:48 AM
Vanadium	56.7	1.06	2.64		mg/Kg-dry	5	02/23/24 10:48 AM
Zinc	38.8	1.06	2.64		mg/Kg-dry	5	02/23/24 10:48 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	0.0229	0.0178	0.0445	J	mg/Kg-dry	1	02/23/24 10:51 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2,4,6-Trichlorophenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2,4-Dichlorophenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2,4-Dimethylphenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2,4-Dinitrophenol	<0.0568	0.0568	0.150		mg/Kg-dry	1	02/26/24 06:24 PM
2,4-Dinitrotoluene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2,6-Dinitrotoluene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2-Chloronaphthalene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2-Chlorophenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2-Methylnaphthalene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2-Methylphenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2-Nitroaniline	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
2-Nitrophenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-3  
**Lab ID:** 2402269-03  
**Collection Date:** 02/20/24 10:18 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
3-Nitroaniline	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
4,6-Dinitro-2-methylphenol	<0.0341	0.0341	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
4-Bromophenyl phenyl ether	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
4-Chloro-3-methylphenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
4-Chloroaniline	<0.0341	0.0341	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
4-Chlorophenyl phenyl ether	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
4-Methylphenol	<0.0227	0.0227	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
4-Nitroaniline	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
4-Nitrophenol	<0.0568	0.0568	0.150		mg/Kg-dry	1	02/26/24 06:24 PM
Acenaphthene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Acenaphthylene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Acetophenone	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Anthracene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Atrazine	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Benzaldehyde	<0.0114	0.0114	0.0302	N	mg/Kg-dry	1	02/26/24 06:24 PM
Benzo[a]anthracene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Benzo[a]pyrene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Benzo[b]fluoranthene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Benzo[g,h,i]perylene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Benzo[k]fluoranthene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Benzoic acid	<0.0568	0.0568	0.150		mg/Kg-dry	1	02/26/24 06:24 PM
Benzyl alcohol	<0.0341	0.0341	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Biphenyl	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Bis(2-chloroethoxy)methane	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Bis(2-chloroethyl)ether	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Bis(2-chloroisopropyl)ether	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Bis(2-ethylhexyl)phthalate	<0.0727	0.0727	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Butyl benzyl phthalate	<0.0454	0.0454	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Caprolactam	<0.0341	0.0341	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Carbazole	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Chrysene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Dibenz[a,h]anthracene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Dibenzofuran	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Diethyl phthalate	<0.0454	0.0454	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Dimethyl phthalate	<0.0454	0.0454	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Di-n-butyl phthalate	<0.0454	0.0454	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Di-n-octyl phthalate	<0.0454	0.0454	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Fluoranthene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-3  
**Lab ID:** 2402269-03  
**Collection Date:** 02/20/24 10:18 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Hexachlorobenzene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Hexachlorobutadiene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Hexachlorocyclopentadiene	<0.0341	0.0341	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Hexachloroethane	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Indeno[1,2,3-cd]pyrene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Isophorone	<0.0341	0.0341	0.0750		mg/Kg-dry	1	02/26/24 06:24 PM
Naphthalene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Nitrobenzene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
N-Nitrosodi-n-propylamine	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
N-Nitrosodiphenylamine	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Pentachlorophenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Phenanthrene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Phenol	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Pyrene	<0.0114	0.0114	0.0302		mg/Kg-dry	1	02/26/24 06:24 PM
Pyridine	<0.0568	0.0568	0.150		mg/Kg-dry	1	02/26/24 06:24 PM
Surr: 2,4,6-Tribromophenol	80.0	0	45-126		%REC	1	02/26/24 06:24 PM
Surr: 2-Fluorobiphenyl	84.0	0	60-125		%REC	1	02/26/24 06:24 PM
Surr: 2-Fluorophenol	82.0	0	37-125		%REC	1	02/26/24 06:24 PM
Surr: 4-Terphenyl-d14	90.0	0	45-125		%REC	1	02/26/24 06:24 PM
Surr: Nitrobenzene-d5	77.0	0	45-125		%REC	1	02/26/24 06:24 PM
Surr: Phenol-d5	77.0	0	40-125		%REC	1	02/26/24 06:24 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,1,1-Trichloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,1,2,2-Tetrachloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,1,2-Trichloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,1,2-Trichlorotrifluoroethane	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
1,1-Dichloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,1-Dichloroethene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,1-Dichloropropene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2,3-Trichlorobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2,3-Trichloropropane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2,4-Trichlorobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2,4-Trimethylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2-Dibromo-3-chloropropane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2-Dibromoethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2-Dichlorobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-3  
**Lab ID:** 2402269-03  
**Collection Date:** 02/20/24 10:18 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,2-Dichloropropane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,3,5-Trimethylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,3-Dichlorobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,3-Dichloropropane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1,4-Dichlorobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
1-Chlorohexane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
2,2-Dichloropropane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
2-Butanone	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
2-Chlorotoluene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
2-Hexanone	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
4-Chlorotoluene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
4-Methyl-2-pentanone	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
Acetone	<0.0137	0.0137	0.0456		mg/Kg-dry	1	02/21/24 10:19 PM
Benzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Bromobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Bromochloromethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Bromodichloromethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Bromoform	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Bromomethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Carbon disulfide	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
Carbon tetrachloride	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Chlorobenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Chloroethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Chloroform	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Chloromethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
cis-1,2-Dichloroethene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
cis-1,3-Dichloropropene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Cyclohexane	<0.00456	0.00456	0.0137	N	mg/Kg-dry	1	02/21/24 10:19 PM
Dibromochloromethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Dibromomethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Dichlorodifluoromethane	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Ethylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Hexachlorobutadiene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Isopropylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
m,p-Xylene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Methyl Acetate	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
Methyl tert-butyl ether	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Methylcyclohexane	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-3  
**Lab ID:** 2402269-03  
**Collection Date:** 02/20/24 10:18 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00456	0.00456	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Naphthalene	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
n-Butylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
n-Propylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
o-Xylene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
p-Isopropyltoluene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
sec-Butylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Styrene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
tert-Butylbenzene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Tetrachloroethene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Toluene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
trans-1,2-Dichloroethene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
trans-1,3-Dichloropropene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Trichloroethene	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Trichlorofluoromethane	<0.00456	0.00456	0.0137		mg/Kg-dry	1	02/21/24 10:19 PM
Vinyl chloride	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Xylenes, Total	<0.000913	0.000913	0.00456		mg/Kg-dry	1	02/21/24 10:19 PM
Surr: 1,2-Dichloroethane-d4	106	0	52-149		%REC	1	02/21/24 10:19 PM
Surr: 4-Bromofluorobenzene	106	0	84-118		%REC	1	02/21/24 10:19 PM
Surr: Dibromofluoromethane	100	0	65-135		%REC	1	02/21/24 10:19 PM
Surr: Toluene-d8	96.3	0	84-116		%REC	1	02/21/24 10:19 PM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	14.8	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-4  
**Lab ID:** 2402269-04  
**Collection Date:** 02/20/24 10:45 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	10000	273	818		mg/Kg-dry	100	02/23/24 11:21 AM
Antimony	<0.545	0.545	1.09		mg/Kg-dry	5	02/23/24 10:38 AM
Arsenic	5.19	0.545	1.09		mg/Kg-dry	5	02/23/24 10:38 AM
Barium	61.2	0.545	2.18		mg/Kg-dry	5	02/23/24 10:38 AM
Beryllium	0.454	0.109	0.327		mg/Kg-dry	5	02/23/24 10:38 AM
Cadmium	<0.109	0.109	0.327		mg/Kg-dry	5	02/23/24 10:38 AM
Calcium	46100	273	818		mg/Kg-dry	100	02/23/24 11:21 AM
Chromium	12.0	0.545	2.18		mg/Kg-dry	5	02/23/24 10:38 AM
Cobalt	3.26	0.545	2.18		mg/Kg-dry	5	02/23/24 10:38 AM
Copper	5.20	0.545	2.18		mg/Kg-dry	5	02/23/24 10:38 AM
Iron	26000	273	818		mg/Kg-dry	100	02/23/24 11:21 AM
Lead	6.37	0.109	0.327		mg/Kg-dry	5	02/23/24 10:38 AM
Magnesium	1800	13.6	40.9		mg/Kg-dry	5	02/23/24 10:38 AM
Manganese	92.9	0.545	2.18		mg/Kg-dry	5	02/23/24 10:38 AM
Nickel	7.21	0.545	2.18		mg/Kg-dry	5	02/23/24 10:38 AM
Potassium	1920	13.6	40.9		mg/Kg-dry	5	02/23/24 10:38 AM
Selenium	0.949	0.164	0.545		mg/Kg-dry	5	02/23/24 10:38 AM
Silver	<0.109	0.109	0.218		mg/Kg-dry	5	02/23/24 10:38 AM
Sodium	34.6	13.6	40.9	J	mg/Kg-dry	5	02/23/24 10:38 AM
Thallium	<0.545	0.545	1.09		mg/Kg-dry	5	02/23/24 10:38 AM
Vanadium	50.0	1.09	2.73		mg/Kg-dry	5	02/23/24 10:38 AM
Zinc	29.7	1.09	2.73		mg/Kg-dry	5	02/23/24 10:38 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	<0.0174	0.0174	0.0436		mg/Kg-dry	1	02/23/24 10:54 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2,4,6-Trichlorophenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2,4-Dichlorophenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2,4-Dimethylphenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2,4-Dinitrophenol	<0.0574	0.0574	0.151		mg/Kg-dry	1	02/26/24 06:49 PM
2,4-Dinitrotoluene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2,6-Dinitrotoluene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2-Chloronaphthalene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2-Chlorophenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2-Methylnaphthalene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2-Methylphenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2-Nitroaniline	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
2-Nitrophenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-4  
 Lab ID: 2402269-04  
 Collection Date: 02/20/24 10:45 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
3-Nitroaniline	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
4,6-Dinitro-2-methylphenol	<0.0344	0.0344	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
4-Bromophenyl phenyl ether	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
4-Chloro-3-methylphenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
4-Chloroaniline	<0.0344	0.0344	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
4-Chlorophenyl phenyl ether	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
4-Methylphenol	<0.0230	0.0230	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
4-Nitroaniline	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
4-Nitrophenol	<0.0574	0.0574	0.151		mg/Kg-dry	1	02/26/24 06:49 PM
Acenaphthene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Acenaphthylene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Acetophenone	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Anthracene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Atrazine	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Benzaldehyde	<0.0115	0.0115	0.0305	N	mg/Kg-dry	1	02/26/24 06:49 PM
Benzo[a]anthracene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Benzo[a]pyrene	0.0191	0.0115	0.0305	J	mg/Kg-dry	1	02/26/24 06:49 PM
Benzo[b]fluoranthene	0.0298	0.0115	0.0305	J	mg/Kg-dry	1	02/26/24 06:49 PM
Benzo[g,h,i]perylene	0.0176	0.0115	0.0305	J	mg/Kg-dry	1	02/26/24 06:49 PM
Benzo[k]fluoranthene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Benzoic acid	<0.0574	0.0574	0.151		mg/Kg-dry	1	02/26/24 06:49 PM
Benzyl alcohol	<0.0344	0.0344	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Biphenyl	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Bis(2-chloroethoxy)methane	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Bis(2-chloroethyl)ether	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Bis(2-chloroisopropyl)ether	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Bis(2-ethylhexyl)phthalate	<0.0734	0.0734	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Butyl benzyl phthalate	<0.0459	0.0459	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Caprolactam	<0.0344	0.0344	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Carbazole	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Chrysene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Dibenz[a,h]anthracene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Dibenzofuran	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Diethyl phthalate	<0.0459	0.0459	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Dimethyl phthalate	<0.0459	0.0459	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Di-n-butyl phthalate	<0.0459	0.0459	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Di-n-octyl phthalate	<0.0459	0.0459	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Fluoranthene	0.0252	0.0115	0.0305	J	mg/Kg-dry	1	02/26/24 06:49 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-4  
 Lab ID: 2402269-04  
 Collection Date: 02/20/24 10:45 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Hexachlorobenzene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Hexachlorobutadiene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Hexachlorocyclopentadiene	<0.0344	0.0344	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Hexachloroethane	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Indeno[1,2,3-cd]pyrene	0.0145	0.0115	0.0305	J	mg/Kg-dry	1	02/26/24 06:49 PM
Isophorone	<0.0344	0.0344	0.0757		mg/Kg-dry	1	02/26/24 06:49 PM
Naphthalene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Nitrobenzene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
N-Nitrosodi-n-propylamine	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
N-Nitrosodiphenylamine	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Pentachlorophenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Phenanthrene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Phenol	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Pyrene	<0.0115	0.0115	0.0305		mg/Kg-dry	1	02/26/24 06:49 PM
Pyridine	<0.0574	0.0574	0.151		mg/Kg-dry	1	02/26/24 06:49 PM
Surr: 2,4,6-Tribromophenol	85.0	0	45-126		%REC	1	02/26/24 06:49 PM
Surr: 2-Fluorobiphenyl	89.0	0	60-125		%REC	1	02/26/24 06:49 PM
Surr: 2-Fluorophenol	85.0	0	37-125		%REC	1	02/26/24 06:49 PM
Surr: 4-Terphenyl-d14	92.0	0	45-125		%REC	1	02/26/24 06:49 PM
Surr: Nitrobenzene-d5	78.0	0	45-125		%REC	1	02/26/24 06:49 PM
Surr: Phenol-d5	81.0	0	40-125		%REC	1	02/26/24 06:49 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,1,1-Trichloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,1,2,2-Tetrachloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,1,2-Trichloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,1,2-Trichlorotrifluoroethane	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
1,1-Dichloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,1-Dichloroethene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,1-Dichloropropene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2,3-Trichlorobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2,3-Trichloropropane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2,4-Trichlorobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2,4-Trimethylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2-Dibromo-3-chloropropane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2-Dibromoethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2-Dichlorobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-4  
 Lab ID: 2402269-04  
 Collection Date: 02/20/24 10:45 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,2-Dichloropropane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,3,5-Trimethylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,3-Dichlorobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,3-Dichloropropane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1,4-Dichlorobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
1-Chlorohexane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
2,2-Dichloropropane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
2-Butanone	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
2-Chlorotoluene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
2-Hexanone	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
4-Chlorotoluene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
4-Methyl-2-pentanone	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
Acetone	<0.0164	0.0164	0.0546		mg/Kg-dry	1	02/21/24 10:47 PM
Benzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Bromobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Bromochloromethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Bromodichloromethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Bromoform	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Bromomethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Carbon disulfide	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
Carbon tetrachloride	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Chlorobenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Chloroethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Chloroform	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Chloromethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
cis-1,2-Dichloroethene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
cis-1,3-Dichloropropene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Cyclohexane	<0.00546	0.00546	0.0164	N	mg/Kg-dry	1	02/21/24 10:47 PM
Dibromochloromethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Dibromomethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Dichlorodifluoromethane	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Ethylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Hexachlorobutadiene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Isopropylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
m,p-Xylene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Methyl Acetate	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
Methyl tert-butyl ether	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Methylcyclohexane	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-4  
**Lab ID:** 2402269-04  
**Collection Date:** 02/20/24 10:45 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00546	0.00546	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Naphthalene	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
n-Butylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
n-Propylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
o-Xylene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
p-Isopropyltoluene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
sec-Butylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Styrene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
tert-Butylbenzene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Tetrachloroethene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Toluene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
trans-1,2-Dichloroethene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
trans-1,3-Dichloropropene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Trichloroethene	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Trichlorofluoromethane	<0.00546	0.00546	0.0164		mg/Kg-dry	1	02/21/24 10:47 PM
Vinyl chloride	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Xylenes, Total	<0.00109	0.00109	0.00546		mg/Kg-dry	1	02/21/24 10:47 PM
Surr: 1,2-Dichloroethane-d4	110	0	52-149		%REC	1	02/21/24 10:47 PM
Surr: 4-Bromofluorobenzene	106	0	84-118		%REC	1	02/21/24 10:47 PM
Surr: Dibromofluoromethane	104	0	65-135		%REC	1	02/21/24 10:47 PM
Surr: Toluene-d8	94.9	0	84-116		%REC	1	02/21/24 10:47 PM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	15.1	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** Trip Blank-1  
**Lab ID:** 2402269-05  
**Collection Date:** 02/20/24  
**Matrix:** TRIP BLANK

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>8260 WATER VOLATILES BY GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JVR</b>		
1,1,1,2-Tetrachloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,1,1-Trichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,1,2,2-Tetrachloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,1,2-Trichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,1,2-Trichlorotrifluoroethane	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
1,1-Dichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,1-Dichloroethene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,1-Dichloropropene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,2,3-Trichlorobenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:31 AM
1,2,3-Trichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,2,4-Trichlorobenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:31 AM
1,2,4-Trimethylbenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:31 AM
1,2-Dibromo-3-chloropropane	<0.00300	0.00300	0.0100		mg/L	1	02/21/24 11:31 AM
1,2-Dibromoethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,2-Dichlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,2-Dichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,2-Dichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,3,5-Trimethylbenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:31 AM
1,3-Dichlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,3-Dichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1,4-Dichlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
1-Chlorohexane	<0.00100	0.00100	0.00500		mg/L	1	02/21/24 11:31 AM
2,2-Dichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
2-Butanone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
2-Chlorotoluene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
2-Hexanone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
4-Chlorotoluene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
4-Methyl-2-pentanone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
Acetone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
Benzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Bromobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Bromochloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Bromodichloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Bromoform	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Bromomethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Carbon disulfide	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
Carbon tetrachloride	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Chlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Chloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: Trip Blank-1  
 Lab ID: 2402269-05  
 Collection Date: 02/20/24  
 Matrix: TRIP BLANK

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>8260 WATER VOLATILES BY GC/MS</b>		<b>SW8260D</b>					Analyst: JVR
Chloroform	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Chloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
cis-1,2-Dichloroethene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
cis-1,3-Dichloropropene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Cyclohexane	<0.00500	0.00500	0.0150	N	mg/L	1	02/21/24 11:31 AM
Dibromochloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Dibromomethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Dichlorodifluoromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Ethylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Hexachlorobutadiene	<0.00100	0.00100	0.00300		mg/L	1	02/21/24 11:31 AM
Isopropylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
m,p-Xylene	<0.000600	0.000600	0.00200		mg/L	1	02/21/24 11:31 AM
Methyl Acetate	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
Methyl tert-butyl ether	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Methylcyclohexane	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
Methylene chloride	<0.00250	0.00250	0.00250		mg/L	1	02/21/24 11:31 AM
Naphthalene	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:31 AM
n-Butylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
n-Propylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
o-Xylene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
p-Isopropyltoluene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
sec-Butylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Styrene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
tert-Butylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Tetrachloroethene	<0.000600	0.000600	0.00200		mg/L	1	02/21/24 11:31 AM
Toluene	<0.000600	0.000600	0.00200		mg/L	1	02/21/24 11:31 AM
trans-1,2-Dichloroethene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
trans-1,3-Dichloropropene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Trichloroethene	<0.000600	0.000600	0.00100		mg/L	1	02/21/24 11:31 AM
Trichlorofluoromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Vinyl chloride	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Xylenes, Total	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:31 AM
Surr: 1,2-Dichloroethane-d4	90.7	0	72-119		%REC	1	02/21/24 11:31 AM
Surr: 4-Bromofluorobenzene	96.7	0	76-119		%REC	1	02/21/24 11:31 AM
Surr: Dibromofluoromethane	94.0	0	85-115		%REC	1	02/21/24 11:31 AM
Surr: Toluene-d8	96.5	0	81-120		%REC	1	02/21/24 11:31 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-5  
 Lab ID: 2402269-06  
 Collection Date: 02/20/24 10:59 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	24800	755	2270		mg/Kg-dry	250	02/23/24 11:34 AM
Antimony	<0.604	0.604	1.21		mg/Kg-dry	5	02/23/24 10:51 AM
Arsenic	11.3	0.604	1.21		mg/Kg-dry	5	02/23/24 10:51 AM
Barium	162	0.604	2.42		mg/Kg-dry	5	02/23/24 10:51 AM
Beryllium	0.828	0.121	0.363		mg/Kg-dry	5	02/23/24 10:51 AM
Cadmium	0.218	0.121	0.363	J	mg/Kg-dry	5	02/23/24 10:51 AM
Calcium	169000	755	2270		mg/Kg-dry	250	02/23/24 11:34 AM
Chromium	26.3	0.604	2.42		mg/Kg-dry	5	02/23/24 10:51 AM
Cobalt	8.49	0.604	2.42		mg/Kg-dry	5	02/23/24 10:51 AM
Copper	9.72	0.604	2.42		mg/Kg-dry	5	02/23/24 10:51 AM
Iron	60400	755	2270		mg/Kg-dry	250	02/23/24 11:34 AM
Lead	10.7	0.121	0.363		mg/Kg-dry	5	02/23/24 10:51 AM
Magnesium	5550	15.1	45.3		mg/Kg-dry	5	02/23/24 10:51 AM
Manganese	282	0.604	2.42		mg/Kg-dry	5	02/23/24 10:51 AM
Nickel	15.5	0.604	2.42		mg/Kg-dry	5	02/23/24 10:51 AM
Potassium	4970	15.1	45.3		mg/Kg-dry	5	02/23/24 10:51 AM
Selenium	0.676	0.181	0.604		mg/Kg-dry	5	02/23/24 10:51 AM
Silver	<0.121	0.121	0.242		mg/Kg-dry	5	02/23/24 10:51 AM
Sodium	80.6	15.1	45.3		mg/Kg-dry	5	02/23/24 10:51 AM
Thallium	<0.604	0.604	1.21		mg/Kg-dry	5	02/23/24 10:51 AM
Vanadium	164	1.21	3.02		mg/Kg-dry	5	02/23/24 10:51 AM
Zinc	48.7	1.21	3.02		mg/Kg-dry	5	02/23/24 10:51 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	<0.0202	0.0202	0.0505		mg/Kg-dry	1	02/23/24 10:56 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2,4,6-Trichlorophenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2,4-Dichlorophenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2,4-Dimethylphenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2,4-Dinitrophenol	<0.0640	0.0640	0.169		mg/Kg-dry	1	02/26/24 07:14 PM
2,4-Dinitrotoluene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2,6-Dinitrotoluene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2-Chloronaphthalene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2-Chlorophenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2-Methylnaphthalene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2-Methylphenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2-Nitroaniline	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
2-Nitrophenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-5  
**Lab ID:** 2402269-06  
**Collection Date:** 02/20/24 10:59 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
3-Nitroaniline	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
4,6-Dinitro-2-methylphenol	<0.0384	0.0384	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
4-Bromophenyl phenyl ether	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
4-Chloro-3-methylphenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
4-Chloroaniline	<0.0384	0.0384	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
4-Chlorophenyl phenyl ether	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
4-Methylphenol	<0.0256	0.0256	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
4-Nitroaniline	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
4-Nitrophenol	<0.0640	0.0640	0.169		mg/Kg-dry	1	02/26/24 07:14 PM
Acenaphthene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Acenaphthylene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Acetophenone	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Anthracene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Atrazine	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Benzaldehyde	<0.0128	0.0128	0.0340	N	mg/Kg-dry	1	02/26/24 07:14 PM
Benzo[a]anthracene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Benzo[a]pyrene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Benzo[b]fluoranthene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Benzo[g,h,i]perylene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Benzo[k]fluoranthene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Benzoic acid	<0.0640	0.0640	0.169		mg/Kg-dry	1	02/26/24 07:14 PM
Benzyl alcohol	<0.0384	0.0384	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Biphenyl	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Bis(2-chloroethoxy)methane	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Bis(2-chloroethyl)ether	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Bis(2-chloroisopropyl)ether	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Bis(2-ethylhexyl)phthalate	<0.0819	0.0819	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Butyl benzyl phthalate	<0.0512	0.0512	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Caprolactam	<0.0384	0.0384	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Carbazole	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Chrysene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Dibenz[a,h]anthracene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Dibenzofuran	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Diethyl phthalate	<0.0512	0.0512	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Dimethyl phthalate	<0.0512	0.0512	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Di-n-butyl phthalate	<0.0512	0.0512	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Di-n-octyl phthalate	<0.0512	0.0512	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Fluoranthene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-5  
**Lab ID:** 2402269-06  
**Collection Date:** 02/20/24 10:59 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Hexachlorobenzene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Hexachlorobutadiene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Hexachlorocyclopentadiene	<0.0384	0.0384	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Hexachloroethane	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Indeno[1,2,3-cd]pyrene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Isophorone	<0.0384	0.0384	0.0845		mg/Kg-dry	1	02/26/24 07:14 PM
Naphthalene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Nitrobenzene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
N-Nitrosodi-n-propylamine	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
N-Nitrosodiphenylamine	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Pentachlorophenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Phenanthrene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Phenol	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Pyrene	<0.0128	0.0128	0.0340		mg/Kg-dry	1	02/26/24 07:14 PM
Pyridine	<0.0640	0.0640	0.169		mg/Kg-dry	1	02/26/24 07:14 PM
Surr: 2,4,6-Tribromophenol	86.0	0	45-126		%REC	1	02/26/24 07:14 PM
Surr: 2-Fluorobiphenyl	91.0	0	60-125		%REC	1	02/26/24 07:14 PM
Surr: 2-Fluorophenol	89.0	0	37-125		%REC	1	02/26/24 07:14 PM
Surr: 4-Terphenyl-d14	94.0	0	45-125		%REC	1	02/26/24 07:14 PM
Surr: Nitrobenzene-d5	81.0	0	45-125		%REC	1	02/26/24 07:14 PM
Surr: Phenol-d5	86.0	0	40-125		%REC	1	02/26/24 07:14 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,1,1-Trichloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,1,2,2-Tetrachloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,1,2-Trichloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,1,2-Trichlorotrifluoroethane	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
1,1-Dichloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,1-Dichloroethene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,1-Dichloropropene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2,3-Trichlorobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2,3-Trichloropropane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2,4-Trichlorobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2,4-Trimethylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2-Dibromo-3-chloropropane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2-Dibromoethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2-Dichlorobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-5  
**Lab ID:** 2402269-06  
**Collection Date:** 02/20/24 10:59 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,2-Dichloropropane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,3,5-Trimethylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,3-Dichlorobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,3-Dichloropropane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1,4-Dichlorobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
1-Chlorohexane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
2,2-Dichloropropane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
2-Butanone	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
2-Chlorotoluene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
2-Hexanone	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
4-Chlorotoluene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
4-Methyl-2-pentanone	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
Acetone	<0.0193	0.0193	0.0644		mg/Kg-dry	1	02/21/24 11:15 PM
Benzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Bromobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Bromochloromethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Bromodichloromethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Bromoform	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Bromomethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Carbon disulfide	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
Carbon tetrachloride	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Chlorobenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Chloroethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Chloroform	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Chloromethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
cis-1,2-Dichloroethene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
cis-1,3-Dichloropropene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Cyclohexane	<0.00644	0.00644	0.0193	N	mg/Kg-dry	1	02/21/24 11:15 PM
Dibromochloromethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Dibromomethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Dichlorodifluoromethane	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Ethylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Hexachlorobutadiene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Isopropylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
m,p-Xylene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Methyl Acetate	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
Methyl tert-butyl ether	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Methylcyclohexane	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-5  
**Lab ID:** 2402269-06  
**Collection Date:** 02/20/24 10:59 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00644	0.00644	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Naphthalene	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
n-Butylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
n-Propylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
o-Xylene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
p-Isopropyltoluene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
sec-Butylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Styrene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
tert-Butylbenzene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Tetrachloroethene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Toluene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
trans-1,2-Dichloroethene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
trans-1,3-Dichloropropene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Trichloroethene	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Trichlorofluoromethane	<0.00644	0.00644	0.0193		mg/Kg-dry	1	02/21/24 11:15 PM
Vinyl chloride	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Xylenes, Total	<0.00129	0.00129	0.00644		mg/Kg-dry	1	02/21/24 11:15 PM
Surr: 1,2-Dichloroethane-d4	111	0	52-149		%REC	1	02/21/24 11:15 PM
Surr: 4-Bromofluorobenzene	108	0	84-118		%REC	1	02/21/24 11:15 PM
Surr: Dibromofluoromethane	100	0	65-135		%REC	1	02/21/24 11:15 PM
Surr: Toluene-d8	97.8	0	84-116		%REC	1	02/21/24 11:15 PM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	25.5	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-6  
 Lab ID: 2402269-07  
 Collection Date: 02/20/24 11:13 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	18100	302	906		mg/Kg-dry	100	02/23/24 11:36 AM
Antimony	<0.604	0.604	1.21		mg/Kg-dry	5	02/23/24 10:53 AM
Arsenic	4.25	0.604	1.21		mg/Kg-dry	5	02/23/24 10:53 AM
Barium	144	0.604	2.42		mg/Kg-dry	5	02/23/24 10:53 AM
Beryllium	0.684	0.121	0.363		mg/Kg-dry	5	02/23/24 10:53 AM
Cadmium	0.190	0.121	0.363	J	mg/Kg-dry	5	02/23/24 10:53 AM
Calcium	136000	302	906		mg/Kg-dry	100	02/23/24 11:36 AM
Chromium	21.9	0.604	2.42		mg/Kg-dry	5	02/23/24 10:53 AM
Cobalt	4.76	0.604	2.42		mg/Kg-dry	5	02/23/24 10:53 AM
Copper	9.02	0.604	2.42		mg/Kg-dry	5	02/23/24 10:53 AM
Iron	17900	302	906		mg/Kg-dry	100	02/23/24 11:36 AM
Lead	9.97	0.121	0.363		mg/Kg-dry	5	02/23/24 10:53 AM
Magnesium	3490	15.1	45.3		mg/Kg-dry	5	02/23/24 10:53 AM
Manganese	136	0.604	2.42		mg/Kg-dry	5	02/23/24 10:53 AM
Nickel	10.4	0.604	2.42		mg/Kg-dry	5	02/23/24 10:53 AM
Potassium	3880	15.1	45.3		mg/Kg-dry	5	02/23/24 10:53 AM
Selenium	0.587	0.181	0.604	J	mg/Kg-dry	5	02/23/24 10:53 AM
Silver	<0.121	0.121	0.242		mg/Kg-dry	5	02/23/24 10:53 AM
Sodium	59.3	15.1	45.3		mg/Kg-dry	5	02/23/24 10:53 AM
Thallium	<0.604	0.604	1.21		mg/Kg-dry	5	02/23/24 10:53 AM
Vanadium	53.5	1.21	3.02		mg/Kg-dry	5	02/23/24 10:53 AM
Zinc	48.4	1.21	3.02		mg/Kg-dry	5	02/23/24 10:53 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	0.0222	0.0195	0.0488	J	mg/Kg-dry	1	02/23/24 10:58 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2,4,6-Trichlorophenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2,4-Dichlorophenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2,4-Dimethylphenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2,4-Dinitrophenol	<0.0599	0.0599	0.158		mg/Kg-dry	1	02/26/24 07:39 PM
2,4-Dinitrotoluene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2,6-Dinitrotoluene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2-Chloronaphthalene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2-Chlorophenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2-Methylnaphthalene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2-Methylphenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2-Nitroaniline	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
2-Nitrophenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-6  
**Lab ID:** 2402269-07  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
3-Nitroaniline	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
4,6-Dinitro-2-methylphenol	<0.0360	0.0360	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
4-Bromophenyl phenyl ether	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
4-Chloro-3-methylphenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
4-Chloroaniline	<0.0360	0.0360	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
4-Chlorophenyl phenyl ether	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
4-Methylphenol	<0.0240	0.0240	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
4-Nitroaniline	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
4-Nitrophenol	<0.0599	0.0599	0.158		mg/Kg-dry	1	02/26/24 07:39 PM
Acenaphthene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Acenaphthylene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Acetophenone	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Anthracene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Atrazine	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Benzaldehyde	<0.0120	0.0120	0.0319	N	mg/Kg-dry	1	02/26/24 07:39 PM
Benzo[a]anthracene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Benzo[a]pyrene	0.0120	0.0120	0.0319	J	mg/Kg-dry	1	02/26/24 07:39 PM
Benzo[b]fluoranthene	0.0160	0.0120	0.0319	J	mg/Kg-dry	1	02/26/24 07:39 PM
Benzo[g,h,i]perylene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Benzo[k]fluoranthene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Benzoic acid	<0.0599	0.0599	0.158		mg/Kg-dry	1	02/26/24 07:39 PM
Benzyl alcohol	<0.0360	0.0360	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Biphenyl	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Bis(2-chloroethoxy)methane	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Bis(2-chloroethyl)ether	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Bis(2-chloroisopropyl)ether	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Bis(2-ethylhexyl)phthalate	<0.0767	0.0767	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Butyl benzyl phthalate	<0.0479	0.0479	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Caprolactam	<0.0360	0.0360	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Carbazole	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Chrysene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Dibenz[a,h]anthracene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Dibenzofuran	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Diethyl phthalate	<0.0479	0.0479	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Dimethyl phthalate	<0.0479	0.0479	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Di-n-butyl phthalate	<0.0479	0.0479	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Di-n-octyl phthalate	<0.0479	0.0479	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Fluoranthene	0.0128	0.0120	0.0319	J	mg/Kg-dry	1	02/26/24 07:39 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-6  
**Lab ID:** 2402269-07  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Hexachlorobenzene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Hexachlorobutadiene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Hexachlorocyclopentadiene	<0.0360	0.0360	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Hexachloroethane	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Indeno[1,2,3-cd]pyrene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Isophorone	<0.0360	0.0360	0.0791		mg/Kg-dry	1	02/26/24 07:39 PM
Naphthalene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Nitrobenzene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
N-Nitrosodi-n-propylamine	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
N-Nitrosodiphenylamine	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Pentachlorophenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Phenanthrene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Phenol	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Pyrene	<0.0120	0.0120	0.0319		mg/Kg-dry	1	02/26/24 07:39 PM
Pyridine	<0.0599	0.0599	0.158		mg/Kg-dry	1	02/26/24 07:39 PM
Surr: 2,4,6-Tribromophenol	84.0	0	45-126		%REC	1	02/26/24 07:39 PM
Surr: 2-Fluorobiphenyl	85.0	0	60-125		%REC	1	02/26/24 07:39 PM
Surr: 2-Fluorophenol	80.0	0	37-125		%REC	1	02/26/24 07:39 PM
Surr: 4-Terphenyl-d14	91.0	0	45-125		%REC	1	02/26/24 07:39 PM
Surr: Nitrobenzene-d5	76.0	0	45-125		%REC	1	02/26/24 07:39 PM
Surr: Phenol-d5	75.0	0	40-125		%REC	1	02/26/24 07:39 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,1,1-Trichloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,1,2,2-Tetrachloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,1,2-Trichloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,1,2-Trichlorotrifluoroethane	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
1,1-Dichloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,1-Dichloroethene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,1-Dichloropropene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2,3-Trichlorobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2,3-Trichloropropane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2,4-Trichlorobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2,4-Trimethylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2-Dibromo-3-chloropropane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2-Dibromoethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2-Dichlorobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-6  
**Lab ID:** 2402269-07  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,2-Dichloropropane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,3,5-Trimethylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,3-Dichlorobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,3-Dichloropropane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1,4-Dichlorobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
1-Chlorohexane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
2,2-Dichloropropane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
2-Butanone	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
2-Chlorotoluene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
2-Hexanone	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
4-Chlorotoluene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
4-Methyl-2-pentanone	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
Acetone	<0.0212	0.0212	0.0706		mg/Kg-dry	1	02/21/24 11:43 PM
Benzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Bromobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Bromochloromethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Bromodichloromethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Bromoform	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Bromomethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Carbon disulfide	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
Carbon tetrachloride	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Chlorobenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Chloroethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Chloroform	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Chloromethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
cis-1,2-Dichloroethene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
cis-1,3-Dichloropropene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Cyclohexane	<0.00706	0.00706	0.0212	N	mg/Kg-dry	1	02/21/24 11:43 PM
Dibromochloromethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Dibromomethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Dichlorodifluoromethane	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Ethylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Hexachlorobutadiene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Isopropylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
m,p-Xylene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Methyl Acetate	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
Methyl tert-butyl ether	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Methylcyclohexane	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-6  
**Lab ID:** 2402269-07  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00706	0.00706	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Naphthalene	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
n-Butylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
n-Propylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
o-Xylene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
p-Isopropyltoluene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
sec-Butylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Styrene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
tert-Butylbenzene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Tetrachloroethene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Toluene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
trans-1,2-Dichloroethene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
trans-1,3-Dichloropropene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Trichloroethene	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Trichlorofluoromethane	<0.00706	0.00706	0.0212		mg/Kg-dry	1	02/21/24 11:43 PM
Vinyl chloride	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Xylenes, Total	<0.00141	0.00141	0.00706		mg/Kg-dry	1	02/21/24 11:43 PM
Surr: 1,2-Dichloroethane-d4	109	0	52-149		%REC	1	02/21/24 11:43 PM
Surr: 4-Bromofluorobenzene	107	0	84-118		%REC	1	02/21/24 11:43 PM
Surr: Dibromofluoromethane	105	0	65-135		%REC	1	02/21/24 11:43 PM
Surr: Toluene-d8	97.7	0	84-116		%REC	1	02/21/24 11:43 PM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	20.4	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-DUP  
 Lab ID: 2402269-08  
 Collection Date: 02/20/24 11:13 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	18400	299	897		mg/Kg-dry	100	02/23/24 11:39 AM
Antimony	<0.598	0.598	1.20		mg/Kg-dry	5	02/23/24 10:56 AM
Arsenic	4.97	0.598	1.20		mg/Kg-dry	5	02/23/24 10:56 AM
Barium	147	0.598	2.39		mg/Kg-dry	5	02/23/24 10:56 AM
Beryllium	0.694	0.120	0.359		mg/Kg-dry	5	02/23/24 10:56 AM
Cadmium	0.191	0.120	0.359	J	mg/Kg-dry	5	02/23/24 10:56 AM
Calcium	137000	299	897		mg/Kg-dry	100	02/23/24 11:39 AM
Chromium	21.7	0.598	2.39		mg/Kg-dry	5	02/23/24 10:56 AM
Cobalt	5.12	0.598	2.39		mg/Kg-dry	5	02/23/24 10:56 AM
Copper	9.26	0.598	2.39		mg/Kg-dry	5	02/23/24 10:56 AM
Iron	19300	299	897		mg/Kg-dry	100	02/23/24 11:39 AM
Lead	10.1	0.120	0.359		mg/Kg-dry	5	02/23/24 10:56 AM
Magnesium	3470	15.0	44.9		mg/Kg-dry	5	02/23/24 10:56 AM
Manganese	158	0.598	2.39		mg/Kg-dry	5	02/23/24 10:56 AM
Nickel	11.1	0.598	2.39		mg/Kg-dry	5	02/23/24 10:56 AM
Potassium	3880	15.0	44.9		mg/Kg-dry	5	02/23/24 10:56 AM
Selenium	0.553	0.179	0.598	J	mg/Kg-dry	5	02/23/24 10:56 AM
Silver	<0.120	0.120	0.239		mg/Kg-dry	5	02/23/24 10:56 AM
Sodium	58.2	15.0	44.9		mg/Kg-dry	5	02/23/24 10:56 AM
Thallium	<0.598	0.598	1.20		mg/Kg-dry	5	02/23/24 10:56 AM
Vanadium	55.0	1.20	2.99		mg/Kg-dry	5	02/23/24 10:56 AM
Zinc	48.7	1.20	2.99		mg/Kg-dry	5	02/23/24 10:56 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	0.0267	0.0203	0.0509	J	mg/Kg-dry	1	02/23/24 11:05 AM
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
2,4,5-Trichlorophenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2,4,6-Trichlorophenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2,4-Dichlorophenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2,4-Dimethylphenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2,4-Dinitrophenol	<0.0631	0.0631	0.166		mg/Kg-dry	1	02/26/24 08:04 PM
2,4-Dinitrotoluene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2,6-Dinitrotoluene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2-Chloronaphthalene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2-Chlorophenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2-Methylnaphthalene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2-Methylphenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2-Nitroaniline	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
2-Nitrophenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.  
 Project: SAWS Impoundment Assessment Lagoons and  
 Project No: 10412.036.001.0002  
 Lab Order: 2402269

Client Sample ID: SS-DUP  
 Lab ID: 2402269-08  
 Collection Date: 02/20/24 11:13 AM  
 Matrix: SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
3,3'-Dichlorobenzidine	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
3-Nitroaniline	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
4,6-Dinitro-2-methylphenol	<0.0378	0.0378	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
4-Bromophenyl phenyl ether	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
4-Chloro-3-methylphenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
4-Chloroaniline	<0.0378	0.0378	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
4-Chlorophenyl phenyl ether	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
4-Methylphenol	<0.0252	0.0252	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
4-Nitroaniline	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
4-Nitrophenol	<0.0631	0.0631	0.166		mg/Kg-dry	1	02/26/24 08:04 PM
Acenaphthene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Acenaphthylene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Acetophenone	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Anthracene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Atrazine	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Benzaldehyde	<0.0126	0.0126	0.0335	N	mg/Kg-dry	1	02/26/24 08:04 PM
Benzo[a]anthracene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Benzo[a]pyrene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Benzo[b]fluoranthene	0.0160	0.0126	0.0335	J	mg/Kg-dry	1	02/26/24 08:04 PM
Benzo[g,h,i]perylene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Benzo[k]fluoranthene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Benzoic acid	<0.0631	0.0631	0.166		mg/Kg-dry	1	02/26/24 08:04 PM
Benzyl alcohol	<0.0378	0.0378	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Biphenyl	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Bis(2-chloroethoxy)methane	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Bis(2-chloroethyl)ether	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Bis(2-chloroisopropyl)ether	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Bis(2-ethylhexyl)phthalate	<0.0807	0.0807	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Butyl benzyl phthalate	<0.0504	0.0504	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Caprolactam	<0.0378	0.0378	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Carbazole	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Chrysene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Dibenz[a,h]anthracene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Dibenzofuran	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Diethyl phthalate	<0.0504	0.0504	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Dimethyl phthalate	<0.0504	0.0504	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Di-n-butyl phthalate	<0.0504	0.0504	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Di-n-octyl phthalate	<0.0504	0.0504	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Fluoranthene	0.0126	0.0126	0.0335	J	mg/Kg-dry	1	02/26/24 08:04 PM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-DUP  
**Lab ID:** 2402269-08  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SEMIVOLATILES BY GC/MS</b>		<b>SW8270E</b>			Analyst: <b>DEW</b>		
Fluorene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Hexachlorobenzene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Hexachlorobutadiene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Hexachlorocyclopentadiene	<0.0378	0.0378	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Hexachloroethane	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Indeno[1,2,3-cd]pyrene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Isophorone	<0.0378	0.0378	0.0832		mg/Kg-dry	1	02/26/24 08:04 PM
Naphthalene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Nitrobenzene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
N-Nitrosodi-n-propylamine	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
N-Nitrosodiphenylamine	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Pentachlorophenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Phenanthrene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Phenol	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Pyrene	<0.0126	0.0126	0.0335		mg/Kg-dry	1	02/26/24 08:04 PM
Pyridine	<0.0631	0.0631	0.166		mg/Kg-dry	1	02/26/24 08:04 PM
Surr: 2,4,6-Tribromophenol	84.0	0	45-126		%REC	1	02/26/24 08:04 PM
Surr: 2-Fluorobiphenyl	89.0	0	60-125		%REC	1	02/26/24 08:04 PM
Surr: 2-Fluorophenol	86.0	0	37-125		%REC	1	02/26/24 08:04 PM
Surr: 4-Terphenyl-d14	91.0	0	45-125		%REC	1	02/26/24 08:04 PM
Surr: Nitrobenzene-d5	80.0	0	45-125		%REC	1	02/26/24 08:04 PM
Surr: Phenol-d5	82.0	0	40-125		%REC	1	02/26/24 08:04 PM
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,1,1,2-Tetrachloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,1,1-Trichloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,1,2,2-Tetrachloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,1,2-Trichloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,1,2-Trichlorotrifluoroethane	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
1,1-Dichloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,1-Dichloroethene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,1-Dichloropropene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2,3-Trichlorobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2,3-Trichloropropane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2,4-Trichlorobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2,4-Trimethylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2-Dibromo-3-chloropropane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2-Dibromoethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2-Dichlorobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-DUP  
**Lab ID:** 2402269-08  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
1,2-Dichloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,2-Dichloropropane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,3,5-Trimethylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,3-Dichlorobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,3-Dichloropropane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1,4-Dichlorobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
1-Chlorohexane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
2,2-Dichloropropane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
2-Butanone	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
2-Chlorotoluene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
2-Hexanone	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
4-Chlorotoluene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
4-Methyl-2-pentanone	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
Acetone	<0.0255	0.0255	0.0849		mg/Kg-dry	1	02/22/24 12:11 AM
Benzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Bromobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Bromochloromethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Bromodichloromethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Bromoform	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Bromomethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Carbon disulfide	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
Carbon tetrachloride	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Chlorobenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Chloroethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Chloroform	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Chloromethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
cis-1,2-Dichloroethene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
cis-1,3-Dichloropropene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Cyclohexane	<0.00849	0.00849	0.0255	N	mg/Kg-dry	1	02/22/24 12:11 AM
Dibromochloromethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Dibromomethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Dichlorodifluoromethane	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Ethylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Hexachlorobutadiene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Isopropylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
m,p-Xylene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Methyl Acetate	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
Methyl tert-butyl ether	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Methylcyclohexane	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-DUP  
**Lab ID:** 2402269-08  
**Collection Date:** 02/20/24 11:13 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>VOLATILES BY 8260/5035 GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JL</b>		
Methylene chloride	<0.00849	0.00849	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Naphthalene	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
n-Butylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
n-Propylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
o-Xylene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
p-Isopropyltoluene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
sec-Butylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Styrene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
tert-Butylbenzene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Tetrachloroethene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Toluene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
trans-1,2-Dichloroethene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
trans-1,3-Dichloropropene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Trichloroethene	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Trichlorofluoromethane	<0.00849	0.00849	0.0255		mg/Kg-dry	1	02/22/24 12:11 AM
Vinyl chloride	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Xylenes, Total	<0.00170	0.00170	0.00849		mg/Kg-dry	1	02/22/24 12:11 AM
Surr: 1,2-Dichloroethane-d4	110	0	52-149		%REC	1	02/22/24 12:11 AM
Surr: 4-Bromofluorobenzene	111	0	84-118		%REC	1	02/22/24 12:11 AM
Surr: Dibromofluoromethane	105	0	65-135		%REC	1	02/22/24 12:11 AM
Surr: Toluene-d8	99.3	0	84-116		%REC	1	02/22/24 12:11 AM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	21.9	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**DHL Analytical, Inc.**

**Date:** 28-Feb-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** SS-Background  
**Lab ID:** 2402269-09  
**Collection Date:** 02/20/24 11:35 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TRACE METALS: ICP-MS - SOLID</b>		<b>SW6020B</b>			Analyst: <b>SP</b>		
Aluminum	18800	718	2160		mg/Kg-dry	250	02/23/24 11:41 AM
Antimony	<0.575	0.575	1.15		mg/Kg-dry	5	02/23/24 10:58 AM
Arsenic	7.16	0.575	1.15		mg/Kg-dry	5	02/23/24 10:58 AM
Barium	165	0.575	2.30		mg/Kg-dry	5	02/23/24 10:58 AM
Beryllium	0.682	0.115	0.345		mg/Kg-dry	5	02/23/24 10:58 AM
Cadmium	0.176	0.115	0.345	J	mg/Kg-dry	5	02/23/24 10:58 AM
Calcium	151000	718	2160		mg/Kg-dry	250	02/23/24 11:41 AM
Chromium	21.2	0.575	2.30		mg/Kg-dry	5	02/23/24 10:58 AM
Cobalt	4.97	0.575	2.30		mg/Kg-dry	5	02/23/24 10:58 AM
Copper	6.36	0.575	2.30		mg/Kg-dry	5	02/23/24 10:58 AM
Iron	16300	718	2160		mg/Kg-dry	250	02/23/24 11:41 AM
Lead	8.76	0.115	0.345		mg/Kg-dry	5	02/23/24 10:58 AM
Magnesium	3530	14.4	43.1		mg/Kg-dry	5	02/23/24 10:58 AM
Manganese	190	0.575	2.30		mg/Kg-dry	5	02/23/24 10:58 AM
Nickel	9.93	0.575	2.30		mg/Kg-dry	5	02/23/24 10:58 AM
Potassium	3760	14.4	43.1		mg/Kg-dry	5	02/23/24 10:58 AM
Selenium	0.409	0.172	0.575	J	mg/Kg-dry	5	02/23/24 10:58 AM
Silver	<0.115	0.115	0.230		mg/Kg-dry	5	02/23/24 10:58 AM
Sodium	72.5	14.4	43.1		mg/Kg-dry	5	02/23/24 10:58 AM
Thallium	<0.575	0.575	1.15		mg/Kg-dry	5	02/23/24 10:58 AM
Vanadium	53.4	1.15	2.87		mg/Kg-dry	5	02/23/24 10:58 AM
Zinc	34.3	1.15	2.87		mg/Kg-dry	5	02/23/24 10:58 AM
<b>MERCURY TOTAL: SOIL/SOLID</b>		<b>SW7471B</b>			Analyst: <b>CMC</b>		
Mercury	<0.0199	0.0199	0.0497		mg/Kg-dry	1	02/23/24 11:07 AM
<b>PERCENT MOISTURE</b>		<b>D2216</b>			Analyst: <b>SMA</b>		
Percent Moisture	22.3	0	0		WT%	1	02/22/24 10:00 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** Trip Blank-2  
**Lab ID:** 2402269-10  
**Collection Date:** 02/20/24  
**Matrix:** TRIP BLANK

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>8260 WATER VOLATILES BY GC/MS</b>		<b>SW8260D</b>			Analyst: <b>JVR</b>		
1,1,1,2-Tetrachloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,1,1-Trichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,1,2,2-Tetrachloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,1,2-Trichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,1,2-Trichlorotrifluoroethane	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
1,1-Dichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,1-Dichloroethene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,1-Dichloropropene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,2,3-Trichlorobenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:56 AM
1,2,3-Trichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,2,4-Trichlorobenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:56 AM
1,2,4-Trimethylbenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:56 AM
1,2-Dibromo-3-chloropropane	<0.00300	0.00300	0.0100		mg/L	1	02/21/24 11:56 AM
1,2-Dibromoethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,2-Dichlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,2-Dichloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,2-Dichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,3,5-Trimethylbenzene	<0.00150	0.00150	0.00500		mg/L	1	02/21/24 11:56 AM
1,3-Dichlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,3-Dichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1,4-Dichlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
1-Chlorohexane	<0.00100	0.00100	0.00500		mg/L	1	02/21/24 11:56 AM
2,2-Dichloropropane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
2-Butanone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
2-Chlorotoluene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
2-Hexanone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
4-Chlorotoluene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
4-Methyl-2-pentanone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
Acetone	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
Benzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Bromobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Bromochloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Bromodichloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Bromoform	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Bromomethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Carbon disulfide	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
Carbon tetrachloride	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Chlorobenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Chloroethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402269

**Client Sample ID:** Trip Blank-2  
**Lab ID:** 2402269-10  
**Collection Date:** 02/20/24  
**Matrix:** TRIP BLANK

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>8260 WATER VOLATILES BY GC/MS</b>		<b>SW8260D</b>					Analyst: <b>JVR</b>
Chloroform	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Chloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
cis-1,2-Dichloroethene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
cis-1,3-Dichloropropene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Cyclohexane	<0.00500	0.00500	0.0150	N	mg/L	1	02/21/24 11:56 AM
Dibromochloromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Dibromomethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Dichlorodifluoromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Ethylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Hexachlorobutadiene	<0.00100	0.00100	0.00300		mg/L	1	02/21/24 11:56 AM
Isopropylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
m,p-Xylene	<0.000600	0.000600	0.00200		mg/L	1	02/21/24 11:56 AM
Methyl Acetate	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
Methyl tert-butyl ether	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Methylcyclohexane	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
Methylene chloride	<0.00250	0.00250	0.00250		mg/L	1	02/21/24 11:56 AM
Naphthalene	<0.00500	0.00500	0.0150		mg/L	1	02/21/24 11:56 AM
n-Butylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
n-Propylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
o-Xylene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
p-Isopropyltoluene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
sec-Butylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Styrene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
tert-Butylbenzene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Tetrachloroethene	<0.000600	0.000600	0.00200		mg/L	1	02/21/24 11:56 AM
Toluene	<0.000600	0.000600	0.00200		mg/L	1	02/21/24 11:56 AM
trans-1,2-Dichloroethene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
trans-1,3-Dichloropropene	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Trichloroethene	<0.000600	0.000600	0.00100		mg/L	1	02/21/24 11:56 AM
Trichlorofluoromethane	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Vinyl chloride	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Xylenes, Total	<0.000300	0.000300	0.00100		mg/L	1	02/21/24 11:56 AM
Surr: 1,2-Dichloroethane-d4	90.6	0	72-119		%REC	1	02/21/24 11:56 AM
Surr: 4-Bromofluorobenzene	98.6	0	76-119		%REC	1	02/21/24 11:56 AM
Surr: Dibromofluoromethane	95.1	0	85-115		%REC	1	02/21/24 11:56 AM
Surr: Toluene-d8	97.5	0	81-120		%REC	1	02/21/24 11:56 AM

**Qualifiers:** ND - Not Detected at the SDL  
 J - Analyte detected between SDL and RL  
 B - Analyte detected in the associated Method Blank  
 DF- Dilution Factor  
 N - Parameter not NELAP certified  
 See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
 C - Sample Result or QC discussed in Case Narrative  
 RL - Reporting Limit (MQL adjusted for moisture and sample size)  
 SDL - Sample Detection Limit  
 E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.

**ANALYTICAL QC SUMMARY REPORT**

**Work Order:** 2402269

**Project:** SAWS Impoundment Assessment Lagoons and

**RunID:** CETAC2\_HG\_240216A

Sample ID: <b>DCS-114006</b>	Batch ID: <b>114006</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>DCS</b>	Run ID: <b>CETAC2_HG_240216A</b>	Analysis Date: <b>2/16/2024 10:00:18 AM</b>	Prep Date: <b>2/15/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	0.0372	0.0400	0.04000	0	93.0	80	124	0	0	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: CETAC2\_HG\_240223A

The QC data in batch 114134 applies to the following samples: 2402269-01B, 2402269-02B, 2402269-03B, 2402269-04B, 2402269-06B, 2402269-07B, 2402269-08B, 2402269-09A

Sample ID: <b>MB-114134</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>MBLK</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:22:17 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	<0.0160	0.0400								

Sample ID: <b>LCS-114134</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>LCS</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:24:33 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	0.193	0.0400	0.2000	0	96.5	85	115			

Sample ID: <b>LCSD-114134</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>LCSD</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:26:50 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	0.195	0.0400	0.2000	0	97.5	85	115	1.03	25	

Sample ID: <b>2402269-02BMS</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>MS</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:42:41 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	0.200	0.0432	0.2159	0	92.5	80	120			

Sample ID: <b>2402269-02BMSD</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>MSD</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:44:57 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	0.194	0.0415	0.2076	0	93.5	80	120	2.86	25	

Sample ID: <b>2402269-02BSD</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>SD</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:47:13 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	<0.0845	0.211	0	0				0	10	

Sample ID: <b>2402269-02BPDS</b>	Batch ID: <b>114134</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>PDS</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:49:29 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Mercury	0.265	0.0423	0.2642	0	100	85	115			

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: CETAC2\_HG\_240223A

Sample ID: <b>ICV-240223</b>	Batch ID: <b>R131580</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>ICV</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 10:17:44 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

Mercury	0.00402	0.0400	0.004000	0	101	90	110			
---------	---------	--------	----------	---	-----	----	-----	--	--	--

Sample ID: <b>CCV1-240223</b>	Batch ID: <b>R131580</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>CCV</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 11:00:51 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

Mercury	0.00190	0.0400	0.002000	0	95.0	90	110			
---------	---------	--------	----------	---	------	----	-----	--	--	--

Sample ID: <b>CCV2-240223</b>	Batch ID: <b>R131580</b>	TestNo: <b>SW7471B</b>	Units: <b>mg/Kg</b>							
SampType: <b>CCV</b>	Run ID: <b>CETAC2_HG_240223A</b>	Analysis Date: <b>2/23/2024 11:09:59 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

Mercury	0.00194	0.0400	0.002000	0	97.0	90	110			
---------	---------	--------	----------	---	------	----	-----	--	--	--

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_231208A

Sample ID: <b>DCS1-113162</b>	Batch ID: <b>113162</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS</b>	Run ID: <b>ICP-MS5_231208A</b>	Analysis Date: <b>12/8/2023 11:21:00 AM</b>	Prep Date: <b>12/7/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	45.1	37.5	37.50	0	120	70	130	0	0	
Beryllium	0.287	0.300	0.2500	0	115	70	130	0	0	
Cadmium	0.272	0.300	0.2500	0	109	70	130	0	0	
Calcium	47.5	37.5	37.50	0	127	70	130	0	0	
Iron	45.7	37.5	37.50	0	122	70	130	0	0	
Lead	0.276	0.300	0.2500	0	110	70	130	0	0	
Magnesium	38.7	37.5	37.50	0	103	70	130	0	0	
Potassium	37.2	37.5	37.50	0	99.1	70	130	0	0	
Selenium	0.245	0.500	0.2500	0	98.1	70	130	0	0	
Silver	0.242	0.200	0.2500	0	96.6	70	130	0	0	
Sodium	33.4	37.5	37.50	0	89.0	70	130	0	0	

Sample ID: <b>DCS2-113162</b>	Batch ID: <b>113162</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS2</b>	Run ID: <b>ICP-MS5_231208A</b>	Analysis Date: <b>12/8/2023 11:25:00 AM</b>	Prep Date: <b>12/7/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Antimony	1.23	1.00	1.250	0	98.5	70	130	0	0	
Arsenic	1.32	1.00	1.250	0	105	70	130	0	0	
Barium	1.28	2.00	1.250	0	102	70	130	0	0	
Chromium	1.35	2.00	1.250	0	108	70	130	0	0	
Cobalt	1.33	2.00	1.250	0	107	70	130	0	0	
Copper	1.36	2.00	1.250	0	109	70	130	0	0	
Manganese	1.32	2.00	1.250	0	105	70	130	0	0	
Nickel	1.22	2.00	1.250	0	98.0	70	130	0	0	
Thallium	1.24	1.00	1.250	0	99.4	70	130	0	0	

Sample ID: <b>DCS3-113162</b>	Batch ID: <b>113162</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS3</b>	Run ID: <b>ICP-MS5_231208A</b>	Analysis Date: <b>12/8/2023 11:28:00 AM</b>	Prep Date: <b>12/7/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Vanadium	2.50	2.50	2.500	0	99.8	70	130	0	0	
Zinc	2.81	2.50	2.500	0	112	70	130	0	0	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

The QC data in batch 114139 applies to the following samples: 2402269-01B, 2402269-02B, 2402269-03B, 2402269-04B, 2402269-06B, 2402269-07B, 2402269-08B, 2402269-09A

Sample ID: <b>MB-114139</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:28:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	<12.5	37.5								
Antimony	<0.500	1.00								
Arsenic	<0.500	1.00								
Barium	<0.500	2.00								
Beryllium	<0.100	0.300								
Cadmium	<0.100	0.300								
Calcium	<12.5	37.5								
Chromium	<0.500	2.00								
Cobalt	<0.500	2.00								
Copper	<0.500	2.00								
Iron	<12.5	37.5								
Lead	<0.100	0.300								
Magnesium	<12.5	37.5								
Manganese	<0.500	2.00								
Nickel	<0.500	2.00								
Potassium	<12.5	37.5								
Selenium	<0.150	0.500								
Silver	<0.100	0.200								
Sodium	<12.5	37.5								
Thallium	<0.500	1.00								
Vanadium	<1.00	2.50								
Zinc	<1.00	2.50								

Sample ID: <b>LCS-114139</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>LCS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:30:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	251	37.5	250.0	0	100	80	120			
Antimony	50.1	1.00	50.00	0	100	80	120			
Arsenic	49.1	1.00	50.00	0	98.2	80	120			
Barium	48.7	2.00	50.00	0	97.5	80	120			
Beryllium	47.5	0.300	50.00	0	95.1	80	120			
Cadmium	48.2	0.300	50.00	0	96.4	80	120			
Calcium	1240	37.5	1250	0	98.9	80	120			
Chromium	49.1	2.00	50.00	0	98.2	80	120			
Cobalt	50.1	2.00	50.00	0	100	80	120			
Copper	49.8	2.00	50.00	0	99.7	80	120			
Iron	260	37.5	250.0	0	104	80	120			
Lead	48.1	0.300	50.00	0	96.3	80	120			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

Sample ID: <b>LCS-114139</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>LCS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:30:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Magnesium	1240	37.5	1250	0	99.0	80	120			
Manganese	49.1	2.00	50.00	0	98.3	80	120			
Nickel	49.4	2.00	50.00	0	98.7	80	120			
Potassium	1270	37.5	1250	0	102	80	120			
Selenium	45.8	0.500	50.00	0	91.6	80	120			
Silver	49.8	0.200	50.00	0	99.6	80	120			
Sodium	1250	37.5	1250	0	100	80	120			
Thallium	49.3	1.00	50.00	0	98.6	80	120			
Vanadium	48.8	2.50	50.00	0	97.7	80	120			
Zinc	48.7	2.50	50.00	0	97.3	80	120			

Sample ID: <b>LCSD-114139</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg</b>
SampType: <b>LCSD</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:33:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	249	37.5	250.0	0	99.5	80	120	0.795	25	
Antimony	50.5	1.00	50.00	0	101	80	120	0.774	25	
Arsenic	49.2	1.00	50.00	0	98.4	80	120	0.256	25	
Barium	48.9	2.00	50.00	0	97.8	80	120	0.370	25	
Beryllium	47.6	0.300	50.00	0	95.2	80	120	0.163	25	
Cadmium	48.2	0.300	50.00	0	96.4	80	120	0.018	25	
Calcium	1230	37.5	1250	0	98.0	80	120	0.865	25	
Chromium	48.7	2.00	50.00	0	97.4	80	120	0.795	25	
Cobalt	50.0	2.00	50.00	0	99.9	80	120	0.217	25	
Copper	50.0	2.00	50.00	0	100	80	120	0.397	25	
Iron	259	37.5	250.0	0	104	80	120	0.102	25	
Lead	48.5	0.300	50.00	0	97.0	80	120	0.757	25	
Magnesium	1240	37.5	1250	0	98.9	80	120	0.078	25	
Manganese	49.4	2.00	50.00	0	98.8	80	120	0.522	25	
Nickel	49.6	2.00	50.00	0	99.1	80	120	0.389	25	
Potassium	1270	37.5	1250	0	102	80	120	0.305	25	
Selenium	46.0	0.500	50.00	0	91.9	80	120	0.362	25	
Silver	50.3	0.200	50.00	0	101	80	120	0.981	25	
Sodium	1250	37.5	1250	0	99.8	80	120	0.304	25	
Thallium	49.6	1.00	50.00	0	99.2	80	120	0.630	25	
Vanadium	48.5	2.50	50.00	0	97.1	80	120	0.601	25	
Zinc	49.0	2.50	50.00	0	98.1	80	120	0.776	25	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

Sample ID: <b>2402269-04B SD</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>SD</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:40:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Antimony	<2.73	5.45	0	0				0	20	
Arsenic	5.25	5.45	0	5.191				1.18	20	
Barium	58.1	10.9	0	61.21				5.28	20	
Beryllium	<0.545	1.64	0	0.4535				0	20	
Cadmium	<0.545	1.64	0	0				0	20	
Chromium	11.4	10.9	0	11.96				4.97	20	
Cobalt	3.25	10.9	0	3.264				0.343	20	
Copper	5.18	10.9	0	5.205				0.562	20	
Lead	6.01	1.64	0	6.368				5.84	20	
Magnesium	1730	204	0	1804				4.15	20	
Manganese	88.9	10.9	0	92.92				4.38	20	
Nickel	6.98	10.9	0	7.213				3.30	20	
Potassium	1830	204	0	1923				4.86	20	
Selenium	0.991	2.73	0	0.9490				4.30	20	
Silver	<0.545	1.09	0	0				0	20	
Sodium	<68.1	204	0	34.60				0	20	
Thallium	<2.73	5.45	0	0				0	20	
Vanadium	47.7	13.6	0	50.00				4.76	20	
Zinc	28.5	13.6	0	29.67				3.97	20	

Sample ID: <b>2402269-04B PDS</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>PDS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:06:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Antimony	56.9	1.09	54.51	0	104	75	125			
Arsenic	59.3	1.09	54.51	5.191	99.3	75	125			
Barium	116	2.18	54.51	61.21	100	75	125			
Beryllium	54.4	0.327	54.51	0.4535	99.0	75	125			
Cadmium	54.6	0.327	54.51	0	100	75	125			
Chromium	66.9	2.18	54.51	11.96	101	75	125			
Cobalt	58.2	2.18	54.51	3.264	101	75	125			
Copper	60.2	2.18	54.51	5.205	101	75	125			
Lead	60.3	0.327	54.51	6.368	98.9	75	125			
Magnesium	3230	40.9	1363	1804	105	75	125			
Manganese	146	2.18	54.51	92.92	96.5	75	125			
Nickel	62.6	2.18	54.51	7.213	102	75	125			
Potassium	3360	40.9	1363	1923	105	75	125			
Selenium	50.8	0.545	54.51	0.9490	91.4	75	125			
Silver	55.5	0.218	54.51	0	102	75	125			
Sodium	1490	40.9	1363	34.60	107	75	125			
Thallium	57.2	1.09	54.51	0	105	75	125			

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

Sample ID: <b>2402269-04B PDS</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>PDS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:06:00 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Vanadium	105	2.73	54.51	50.00	100	75	125			
Zinc	83.0	2.73	54.51	29.67	97.8	75	125			

Sample ID: <b>2402269-04B MS</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>MS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:09:00 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Antimony	47.7	1.11	55.54	0	85.9	75	125			
Arsenic	58.8	1.11	55.54	5.191	96.5	75	125			
Barium	116	2.22	55.54	61.21	99.1	75	125			
Beryllium	53.1	0.333	55.54	0.4535	94.9	75	125			
Cadmium	53.1	0.333	55.54	0	95.6	75	125			
Chromium	65.9	2.22	55.54	11.96	97.1	75	125			
Cobalt	57.9	2.22	55.54	3.264	98.4	75	125			
Copper	59.9	2.22	55.54	5.205	98.5	75	125			
Lead	59.3	0.333	55.54	6.368	95.3	75	125			
Magnesium	3170	41.7	1388	1804	98.1	75	125			
Manganese	145	2.22	55.54	92.92	94.0	75	125			
Nickel	60.9	2.22	55.54	7.213	96.7	75	125			
Potassium	3330	41.7	1388	1923	102	75	125			
Selenium	49.6	0.555	55.54	0.9490	87.6	75	125			
Silver	55.0	0.222	55.54	0	99.0	75	125			
Sodium	1400	41.7	1388	34.60	98.2	75	125			
Thallium	55.4	1.11	55.54	0	99.7	75	125			
Vanadium	104	2.78	55.54	50.00	96.5	75	125			
Zinc	82.8	2.78	55.54	29.67	95.7	75	125			

Sample ID: <b>2402269-04B MSD</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>							
SampType: <b>MSD</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:11:00 AM</b>	Prep Date: <b>2/22/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Antimony	48.3	1.10	55.02	0	87.9	75	125	1.27	25	
Arsenic	57.7	1.10	55.02	5.191	95.5	75	125	1.78	25	
Barium	114	2.20	55.02	61.21	95.9	75	125	1.96	25	
Beryllium	52.6	0.330	55.02	0.4535	94.7	75	125	1.09	25	
Cadmium	53.0	0.330	55.02	0	96.4	75	125	0.152	25	
Chromium	65.6	2.20	55.02	11.96	97.5	75	125	0.408	25	
Cobalt	57.5	2.20	55.02	3.264	98.6	75	125	0.679	25	
Copper	59.4	2.20	55.02	5.205	98.6	75	125	0.733	25	
Lead	58.8	0.330	55.02	6.368	95.3	75	125	0.803	25	
Magnesium	3120	41.3	1376	1804	95.3	75	125	1.64	25	

**Qualifiers:** B Analyte detected in the associated Method Blank DF Dilution Factor  
 J Analyte detected between MDL and RL MDL Method Detection Limit  
 ND Not Detected at the Method Detection Limit R RPD outside accepted control limits  
 RL Reporting Limit S Spike Recovery outside control limits  
 J Analyte detected between SDL and RL N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

Sample ID: <b>2402269-04B MSD</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MSD</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:11:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Manganese	142	2.20	55.02	92.92	90.1	75	125	1.82	25	
Nickel	60.2	2.20	55.02	7.213	96.3	75	125	1.21	25	
Potassium	3280	41.3	1376	1923	98.7	75	125	1.61	25	
Selenium	48.7	0.550	55.02	0.9490	86.8	75	125	1.82	25	
Silver	54.9	0.220	55.02	0	99.9	75	125	0.093	25	
Sodium	1390	41.3	1376	34.60	98.9	75	125	0.290	25	
Thallium	55.1	1.10	55.02	0	100	75	125	0.521	25	
Vanadium	103	2.75	55.02	50.00	95.6	75	125	0.945	25	
Zinc	81.2	2.75	55.02	29.67	93.7	75	125	1.92	25	

Sample ID: <b>2402269-04B SD</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>SD</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:23:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	9660	4090	0	10020				3.61	20	
Calcium	47500	4090	0	46080				2.96	20	
Iron	25900	4090	0	25980				0.209	20	

Sample ID: <b>2402269-04B PDS</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>PDS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:44:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	36000	818	27260	10020	95.3	75	125			
Calcium	73700	818	27260	46080	101	75	125			
Iron	52100	818	27260	25980	95.7	75	125			

Sample ID: <b>2402269-04B MS</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MS</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:47:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	12300	833	277.7	10020	826	75	125			S
Calcium	49600	833	1388	46080	250	75	125			S
Iron	27300	833	277.7	25980	479	75	125			S

Sample ID: <b>2402269-04B MSD</b>	Batch ID: <b>114139</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MSD</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:49:00 AM</b>	Prep Date: <b>2/22/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	11800	825	275.1	10020	634	75	125	4.57	25	S
Calcium	48500	825	1376	46080	174	75	125	2.19	25	S
Iron	25700	825	275.1	25980	-108	75	125	6.14	25	S

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

Sample ID: <b>ICV-240223</b>	Batch ID: <b>R131582</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>ICV</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:10:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	2.38	0.0300	2.50	0	95.1	90	110			
Antimony	0.102	0.00250	0.100	0	102	90	110			
Arsenic	0.101	0.00500	0.100	0	101	90	110			
Barium	0.100	0.0100	0.100	0	100	90	110			
Beryllium	0.0974	0.00100	0.100	0	97.4	90	110			
Cadmium	0.101	0.00100	0.100	0	101	90	110			
Calcium	2.49	0.300	2.50	0	99.5	90	110			
Chromium	0.103	0.00500	0.100	0	103	90	110			
Cobalt	0.105	0.00500	0.100	0	105	90	110			
Copper	0.106	0.0100	0.100	0	106	90	110			
Iron	2.46	0.100	2.50	0	98.4	90	110			
Lead	0.0977	0.00100	0.100	0	97.7	90	110			
Magnesium	2.40	0.300	2.50	0	96.2	90	110			
Manganese	0.100	0.0100	0.100	0	100	90	110			
Nickel	0.107	0.0100	0.100	0	107	90	110			
Potassium	2.42	0.300	2.50	0	96.9	90	110			
Selenium	0.104	0.00500	0.100	0	104	90	110			
Silver	0.102	0.00200	0.100	0	102	90	110			
Sodium	2.45	0.300	2.50	0	97.8	90	110			
Thallium	0.0967	0.00150	0.100	0	96.7	90	110			
Vanadium	0.101	0.00100	0.100	0	101	90	110			
Zinc	0.105	0.00500	0.100	0	105	90	110			

Sample ID: <b>LCVL-240223</b>	Batch ID: <b>R131582</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>LCVL</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:16:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	0.0989	0.0300	0.100	0	98.8	80	120			
Antimony	0.00213	0.00250	0.00200	0	107	80	120			
Arsenic	0.00524	0.00500	0.00500	0	105	80	120			
Barium	0.00535	0.0100	0.00500	0	107	80	120			
Beryllium	0.00104	0.00100	0.00100	0	104	80	120			
Cadmium	0.00102	0.00100	0.00100	0	102	80	120			
Calcium	0.112	0.300	0.100	0	112	80	120			
Chromium	0.00517	0.00500	0.00500	0	103	80	120			
Cobalt	0.00522	0.00500	0.00500	0	104	80	120			
Copper	0.00527	0.0100	0.00500	0	105	80	120			
Iron	0.104	0.100	0.100	0	104	80	120			
Lead	0.00103	0.00100	0.00100	0	103	80	120			
Magnesium	0.105	0.300	0.100	0	105	80	120			
Manganese	0.00510	0.0100	0.00500	0	102	80	120			

**Qualifiers:** B Analyte detected in the associated Method Blank DF Dilution Factor  
 J Analyte detected between MDL and RL MDL Method Detection Limit  
 ND Not Detected at the Method Detection Limit R RPD outside accepted control limits  
 RL Reporting Limit S Spike Recovery outside control limits  
 J Analyte detected between SDL and RL N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240223A

Sample ID: <b>LCVL-240223</b>	Batch ID: <b>R131582</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>LCVL</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 10:16:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Nickel	0.00513	0.0100	0.00500	0	103	80	120			
Potassium	0.106	0.300	0.100	0	106	80	120			
Selenium	0.00552	0.00500	0.00500	0	110	80	120			
Silver	0.00206	0.00200	0.00200	0	103	80	120			
Sodium	0.106	0.300	0.100	0	106	80	120			
Thallium	0.00100	0.00150	0.00100	0	100	80	120			
Vanadium	0.00106	0.00100	0.00100	0	106	80	120			
Zinc	0.00531	0.00500	0.00500	0	106	80	120			

Sample ID: <b>CCV1-240223</b>	Batch ID: <b>R131582</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>CCV</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:15:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	4.89	0.0300	5.00	0	97.9	90	110			
Antimony	0.200	0.00250	0.200	0	100	90	110			
Arsenic	0.201	0.00500	0.200	0	100	90	110			
Barium	0.196	0.0100	0.200	0	98.2	90	110			
Beryllium	0.188	0.00100	0.200	0	93.8	90	110			
Cadmium	0.194	0.00100	0.200	0	97.2	90	110			
Calcium	4.93	0.300	5.00	0	98.6	90	110			
Chromium	0.197	0.00500	0.200	0	98.7	90	110			
Cobalt	0.203	0.00500	0.200	0	101	90	110			
Copper	0.204	0.0100	0.200	0	102	90	110			
Iron	5.09	0.100	5.00	0	102	90	110			
Lead	0.192	0.00100	0.200	0	96.2	90	110			
Magnesium	4.94	0.300	5.00	0	98.9	90	110			
Manganese	0.197	0.0100	0.200	0	98.7	90	110			
Nickel	0.200	0.0100	0.200	0	100	90	110			
Potassium	5.00	0.300	5.00	0	100	90	110			
Selenium	0.201	0.00500	0.200	0	101	90	110			
Silver	0.198	0.00200	0.200	0	99.1	90	110			
Sodium	4.99	0.300	5.00	0	99.7	90	110			
Thallium	0.202	0.00150	0.200	0	101	90	110			
Vanadium	0.196	0.00100	0.200	0	98.0	90	110			
Zinc	0.201	0.00500	0.200	0	100	90	110			

Sample ID: <b>CCV2-240223</b>	Batch ID: <b>R131582</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>CCV</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:52:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Aluminum	4.90	0.0300	5.00	0	98.1	90	110			

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

**CLIENT:** Weston Solutions, Inc.

**Work Order:** 2402269

**Project:** SAWS Impoundment Assessment Lagoons and

## ANALYTICAL QC SUMMARY REPORT

**RunID:** ICP-MS5\_240223A

Sample ID: <b>CCV2-240223</b>	Batch ID: <b>R131582</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>CCV</b>	Run ID: <b>ICP-MS5_240223A</b>	Analysis Date: <b>2/23/2024 11:52:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Calcium	4.95	0.300	5.00	0	99.0	90	110			
Iron	5.07	0.100	5.00	0	101	90	110			

**Qualifiers:** B Analyte detected in the associated Method Blank  
J Analyte detected between MDL and RL  
ND Not Detected at the Method Detection Limit  
RL Reporting Limit  
J Analyte detected between SDL and RL

DF Dilution Factor  
MDL Method Detection Limit  
R RPD outside accepted control limits  
S Spike Recovery outside control limits  
N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_231226B

Sample ID: <b>DCS1-113405</b>	Batch ID: <b>113405</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS</b>	Run ID: <b>GCMS4_231226B</b>	Analysis Date: <b>12/26/2023 4:43:00 PM</b>	Prep Date: <b>12/26/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,5-Trichlorophenol	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
2,4,6-Trichlorophenol	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
2,4-Dichlorophenol	0.0173	0.0266	0.02000	0	86.7	10	400	0	0	
2,4-Dimethylphenol	0.0207	0.0266	0.02000	0	103	10	400	0	0	
2,4-Dinitrotoluene	0.0307	0.0266	0.02000	0	153	10	400	0	0	
2,6-Dinitrotoluene	0.0147	0.0266	0.02000	0	73.3	10	400	0	0	
2-Chloronaphthalene	0.0187	0.0266	0.02000	0	93.3	10	400	0	0	
2-Chlorophenol	0.0187	0.0266	0.02000	0	93.3	10	400	0	0	
2-Methylnaphthalene	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
2-Methylphenol	0.0187	0.0266	0.02000	0	93.3	10	400	0	0	
2-Nitroaniline	0.0373	0.0266	0.02000	0	187	10	400	0	0	
2-Nitrophenol	0.0320	0.0266	0.02000	0	160	10	400	0	0	
3,3'-Dichlorobenzidine	0.0307	0.0266	0.02000	0	153	10	400	0	0	
3-Nitroaniline	0.0373	0.0266	0.02000	0	187	10	400	0	0	
4-Bromophenyl phenyl ether	0.0160	0.0266	0.02000	0	80.0	10	400	0	0	
4-Chloro-3-methylphenol	0.0180	0.0266	0.02000	0	90.0	10	400	0	0	
4-Chlorophenyl phenyl ether	0.0193	0.0266	0.02000	0	96.7	10	400	0	0	
4-Methylphenol	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
4-Nitroaniline	0.0367	0.0266	0.02000	0	183	10	400	0	0	
Acenaphthene	0.0180	0.0266	0.02000	0	90.0	10	400	0	0	
Acenaphthylene	0.0147	0.0266	0.02000	0	73.3	10	400	0	0	
Acetophenone	0.0133	0.0266	0.02000	0	66.7	10	400	0	0	
Anthracene	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
Atrazine	0.0193	0.0266	0.02000	0	96.7	10	400	0	0	
Benzaldehyde	0.0153	0.0266	0.02000	0	76.7	10	400	0	0	N
Benzo[a]anthracene	0.0100	0.0266	0.02000	0	50.0	10	400	0	0	
Benzo[a]pyrene	0.0213	0.0266	0.02000	0	107	10	400	0	0	
Benzo[b]fluoranthene	0.0213	0.0266	0.02000	0	107	10	400	0	0	
Benzo[g,h,i]perylene	0.0207	0.0266	0.02000	0	103	10	400	0	0	
Benzo[k]fluoranthene	0.0187	0.0266	0.02000	0	93.3	10	400	0	0	
Biphenyl	0.0187	0.0266	0.02000	0	93.3	10	400	0	0	
Bis(2-chloroethoxy)methane	0.0193	0.0266	0.02000	0	96.7	10	400	0	0	
Bis(2-chloroethyl)ether	0.0207	0.0266	0.02000	0	103	10	400	0	0	
Bis(2-chloroisopropyl)ether	0.0247	0.0266	0.02000	0	123	10	400	0	0	
Carbazole	0.0200	0.0266	0.02000	0	100	10	400	0	0	
Dibenz[a,h]anthracene	0.0207	0.0266	0.02000	0	103	10	400	0	0	
Dibenzofuran	0.0193	0.0266	0.02000	0	96.7	10	400	0	0	
Fluoranthene	0.0193	0.0266	0.02000	0	96.7	10	400	0	0	
Fluorene	0.0180	0.0266	0.02000	0	90.0	10	400	0	0	
Hexachlorobenzene	0.0153	0.0266	0.02000	0	76.7	10	400	0	0	
Hexachlorobutadiene	0.0180	0.0266	0.02000	0	90.0	10	400	0	0	

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 J Analyte detected between MDL and RL  
 ND Not Detected at the Method Detection Limit  
 RL Reporting Limit  
 J Analyte detected between SDL and RL

DF Dilution Factor  
 MDL Method Detection Limit  
 R RPD outside accepted control limits  
 S Spike Recovery outside control limits  
 N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_231226B

Sample ID: <b>DCS1-113405</b>	Batch ID: <b>113405</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS</b>	Run ID: <b>GCMS4_231226B</b>	Analysis Date: <b>12/26/2023 4:43:00 PM</b>	Prep Date: <b>12/26/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Hexachloroethane	0.0207	0.0266	0.02000	0	103	10	400	0	0	
Indeno[1,2,3-cd]pyrene	0.0207	0.0266	0.02000	0	103	10	400	0	0	
Naphthalene	0.0187	0.0266	0.02000	0	93.3	10	400	0	0	
Nitrobenzene	0.0213	0.0266	0.02000	0	107	10	400	0	0	
N-Nitrosodi-n-propylamine	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
N-Nitrosodiphenylamine	0.0167	0.0266	0.02000	0	83.3	10	400	0	0	
Pentachlorophenol	0.0393	0.0266	0.02000	0	197	10	400	0	0	
Phenanthrene	0.00733	0.0266	0.02000	0	36.7	10	400	0	0	
Phenol	0.0233	0.0266	0.02000	0	117	10	400	0	0	
Pyrene	0.0107	0.0266	0.02000	0	53.3	10	400	0	0	

Sample ID: <b>DCS2-113405</b>	Batch ID: <b>113405</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS2</b>	Run ID: <b>GCMS4_231226B</b>	Analysis Date: <b>12/26/2023 5:08:00 PM</b>	Prep Date: <b>12/26/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4-Dinitrophenol	0.0807	0.132	0.04000	0	202	10	400	0	0	
4,6-Dinitro-2-methylphenol	0.114	0.0660	0.04000	0	285	10	400	0	0	
4-Chloroaniline	0.0167	0.0660	0.04000	0	41.7	10	400	0	0	
4-Nitrophenol	0.0620	0.132	0.04000	0	155	10	400	0	0	
Benzoic acid	0.0833	0.132	0.04000	0	208	10	400	0	0	
Benzyl alcohol	0.0300	0.0660	0.04000	0	75.0	10	400	0	0	
Bis(2-ethylhexyl)phthalate	0.0720	0.0660	0.04000	0	180	10	400	0	0	
Butyl benzyl phthalate	0.0353	0.0660	0.04000	0	88.3	10	400	0	0	
Chrysene	0.0207	0.0266	0.04000	0	51.7	10	400	0	0	
Diethyl phthalate	0.0420	0.0660	0.04000	0	105	10	400	0	0	
Dimethyl phthalate	0.0347	0.0660	0.04000	0	86.7	10	400	0	0	
Di-n-butyl phthalate	0.0420	0.0660	0.04000	0	105	10	400	0	0	
Di-n-octyl phthalate	0.0547	0.0660	0.04000	0	137	10	400	0	0	
Hexachlorocyclopentadiene	0.0513	0.0660	0.04000	0	128	10	400	0	0	
Isophorone	0.0333	0.0660	0.04000	0	83.3	10	400	0	0	
Pyridine	0.0280	0.132	0.04000	0	70.0	10	400	0	0	

Sample ID: <b>DCS3-113405</b>	Batch ID: <b>113405</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS3</b>	Run ID: <b>GCMS4_231226B</b>	Analysis Date: <b>12/26/2023 5:33:00 PM</b>	Prep Date: <b>12/26/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Caprolactam	0.0960	0.0660	0.1000	0	96.0	10	400	0	0	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

The QC data in batch 114177 applies to the following samples: 2402269-01B, 2402269-02B, 2402269-03B, 2402269-04B, 2402269-06B, 2402269-07B, 2402269-08B

Sample ID: <b>LCS-114177</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>LCS</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 3:03:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,5-Trichlorophenol	1.65	0.0266	1.340	0	123	49	125			
2,4,6-Trichlorophenol	1.65	0.0266	1.340	0	123	43	125			
2,4-Dichlorophenol	1.50	0.0266	1.340	0	112	45	125			
2,4-Dimethylphenol	1.41	0.0266	1.340	0	105	32	125			
2,4-Dinitrophenol	1.62	0.132	1.340	0	121	25	132			
2,4-Dinitrotoluene	1.43	0.0266	1.340	0	107	48	125			
2,6-Dinitrotoluene	1.52	0.0266	1.340	0	114	48	125			
2-Chloronaphthalene	1.37	0.0266	1.340	0	102	45	125			
2-Chlorophenol	1.39	0.0266	1.340	0	104	44	125			
2-Methylnaphthalene	1.22	0.0266	1.340	0	91.3	47	125			
2-Methylphenol	1.35	0.0266	1.340	0	101	40	125			
2-Nitroaniline	1.39	0.0266	1.340	0	104	44	125			
2-Nitrophenol	1.41	0.0266	1.340	0	105	42	125			
3,3'-Dichlorobenzidine	1.52	0.0266	1.340	0	114	25	128			
3-Nitroaniline	1.31	0.0266	1.340	0	98.0	27	125			
4,6-Dinitro-2-methylphenol	1.63	0.0660	1.340	0	121	29	137			
4-Bromophenyl phenyl ether	1.29	0.0266	1.340	0	96.6	46	125			
4-Chloro-3-methylphenol	1.40	0.0266	1.340	0	105	46	125			
4-Chloroaniline	0.825	0.0660	1.340	0	61.6	34	125			
4-Chlorophenyl phenyl ether	1.29	0.0266	1.340	0	96.0	47	125			
4-Methylphenol	1.32	0.0266	1.340	0	98.6	41	125			
4-Nitroaniline	1.47	0.0266	1.340	0	110	34	125			
4-Nitrophenol	1.47	0.132	1.340	0	110	25	138			
Acenaphthene	1.25	0.0266	1.340	0	93.3	46	125			
Acenaphthylene	1.14	0.0266	1.340	0	85.4	44	125			
Acetophenone	1.11	0.0266	1.340	0	82.8	40	125			
Anthracene	1.24	0.0266	1.340	0	92.6	53	125			
Atrazine	1.90	0.0266	1.340	0	142	40	125			S
Benzaldehyde	1.22	0.0266	1.340	0	90.9	40	125			N
Benzo[a]anthracene	1.40	0.0266	1.340	0	104	52	125			
Benzo[a]pyrene	1.50	0.0266	1.340	0	112	50	125			
Benzo[b]fluoranthene	1.49	0.0266	1.340	0	111	45	125			
Benzo[g,h,i]perylene	1.53	0.0266	1.340	0	114	38	126			
Benzo[k]fluoranthene	1.36	0.0266	1.340	0	101	45	125			
Benzoic acid	1.39	0.132	1.340	0	103	25	125			
Benzyl alcohol	1.23	0.0660	1.340	0	92.1	25	125			
Biphenyl	1.56	0.0266	1.340	0	116	40	125			
Bis(2-chloroethoxy)methane	1.21	0.0266	1.340	0	90.1	43	125			
Bis(2-chloroethyl)ether	1.19	0.0266	1.340	0	88.6	38	125			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>LCS-114177</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>LCS</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 3:03:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Bis(2-chloroisopropyl)ether	1.24	0.0266	1.340	0	92.5	25	125			
Bis(2-ethylhexyl)phthalate	1.59	0.0660	1.340	0	119	47	127			
Butyl benzyl phthalate	1.52	0.0660	1.340	0	114	49	125			
Caprolactam	1.38	0.0660	1.340	0	103	40	125			
Carbazole	1.48	0.0266	1.340	0	110	40	125			
Chrysene	1.39	0.0266	1.340	0	103	53	125			
Dibenz[a,h]anthracene	1.62	0.0266	1.340	0	121	41	125			
Dibenzofuran	1.28	0.0266	1.340	0	95.8	51	125			
Diethyl phthalate	1.37	0.0660	1.340	0	102	50	125			
Dimethyl phthalate	1.33	0.0660	1.340	0	99.5	49	125			
Di-n-butyl phthalate	1.41	0.0660	1.340	0	105	56	125			
Di-n-octyl phthalate	1.62	0.0660	1.340	0	121	41	132			
Fluoranthene	1.29	0.0266	1.340	0	96.3	54	125			
Fluorene	1.28	0.0266	1.340	0	95.2	49	125			
Hexachlorobenzene	1.19	0.0266	1.340	0	89.2	47	125			
Hexachlorobutadiene	1.30	0.0266	1.340	0	96.8	40	125			
Hexachlorocyclopentadiene	1.64	0.0660	1.340	0	122	31	135			
Hexachloroethane	1.17	0.0266	1.340	0	87.0	34	125			
Indeno[1,2,3-cd]pyrene	1.58	0.0266	1.340	0	118	38	125			
Isophorone	1.24	0.0660	1.340	0	92.2	43	125			
Naphthalene	1.22	0.0266	1.340	0	91.1	40	125			
Nitrobenzene	1.29	0.0266	1.340	0	96.5	41	125			
N-Nitrosodi-n-propylamine	1.09	0.0266	1.340	0	81.1	40	125			
N-Nitrosodiphenylamine	1.34	0.0266	1.340	0	99.9	49	125			
Pentachlorophenol	1.54	0.0266	1.340	0	115	25	125			
Phenanthrene	1.37	0.0266	1.340	0	102	50	125			
Phenol	1.40	0.0266	1.340	0	105	39	125			
Pyrene	1.44	0.0266	1.340	0	108	46	125			
Pyridine	0.792	0.132	1.340	0	59.1	20	125			
Surr: 2,4,6-Tribromophenol	0.633		0.6670		95.0	45	126			
Surr: 2-Fluorobiphenyl	0.627		0.6670		94.0	60	125			
Surr: 2-Fluorophenol	0.613		0.6670		92.0	37	125			
Surr: 4-Terphenyl-d14	0.647		0.6670		97.0	45	125			
Surr: Nitrobenzene-d5	0.593		0.6670		89.0	45	125			
Surr: Phenol-d5	0.587		0.6670		88.0	40	125			

Sample ID: <b>MB-114177</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 4:18:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,5-Trichlorophenol	<0.0100	0.0266								

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2402269  
**Project:** SAWS Impoundment Assessment Lagoons and

## ANALYTICAL QC SUMMARY REPORT

**RunID:** GCMS4\_240226A

Sample ID: <b>MB-114177</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 4:18:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,6-Trichlorophenol	<0.0100	0.0266								
2,4-Dichlorophenol	<0.0100	0.0266								
2,4-Dimethylphenol	<0.0100	0.0266								
2,4-Dinitrophenol	<0.0500	0.132								
2,4-Dinitrotoluene	<0.0100	0.0266								
2,6-Dinitrotoluene	<0.0100	0.0266								
2-Chloronaphthalene	<0.0100	0.0266								
2-Chlorophenol	<0.0100	0.0266								
2-Methylnaphthalene	<0.0100	0.0266								
2-Methylphenol	<0.0100	0.0266								
2-Nitroaniline	<0.0100	0.0266								
2-Nitrophenol	<0.0100	0.0266								
3,3'-Dichlorobenzidine	<0.0100	0.0266								
3-Nitroaniline	<0.0100	0.0266								
4,6-Dinitro-2-methylphenol	<0.0300	0.0660								
4-Bromophenyl phenyl ether	<0.0100	0.0266								
4-Chloro-3-methylphenol	<0.0100	0.0266								
4-Chloroaniline	<0.0300	0.0660								
4-Chlorophenyl phenyl ether	<0.0100	0.0266								
4-Methylphenol	<0.0200	0.0266								
4-Nitroaniline	<0.0100	0.0266								
4-Nitrophenol	<0.0500	0.132								
Acenaphthene	<0.0100	0.0266								
Acenaphthylene	<0.0100	0.0266								
Acetophenone	<0.0100	0.0266								
Anthracene	<0.0100	0.0266								
Atrazine	<0.0100	0.0266								
Benzaldehyde	<0.0100	0.0266								N
Benzo[a]anthracene	<0.0100	0.0266								
Benzo[a]pyrene	<0.0100	0.0266								
Benzo[b]fluoranthene	<0.0100	0.0266								
Benzo[g,h,i]perylene	<0.0100	0.0266								
Benzo[k]fluoranthene	<0.0100	0.0266								
Benzoic acid	<0.0500	0.132								
Benzyl alcohol	<0.0300	0.0660								
Biphenyl	<0.0100	0.0266								
Bis(2-chloroethoxy)methane	<0.0100	0.0266								
Bis(2-chloroethyl)ether	<0.0100	0.0266								
Bis(2-chloroisopropyl)ether	<0.0100	0.0266								
Bis(2-ethylhexyl)phthalate	<0.0640	0.0660								
Butyl benzyl phthalate	<0.0400	0.0660								

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 J Analyte detected between MDL and RL  
 ND Not Detected at the Method Detection Limit  
 RL Reporting Limit  
 J Analyte detected between SDL and RL

DF Dilution Factor  
 MDL Method Detection Limit  
 R RPD outside accepted control limits  
 S Spike Recovery outside control limits  
 N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>MB-114177</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 4:18:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Caprolactam	<0.0300	0.0660								
Carbazole	<0.0100	0.0266								
Chrysene	<0.0100	0.0266								
Dibenz[a,h]anthracene	<0.0100	0.0266								
Dibenzofuran	<0.0100	0.0266								
Diethyl phthalate	<0.0400	0.0660								
Dimethyl phthalate	<0.0400	0.0660								
Di-n-butyl phthalate	<0.0400	0.0660								
Di-n-octyl phthalate	<0.0400	0.0660								
Fluoranthene	<0.0100	0.0266								
Fluorene	<0.0100	0.0266								
Hexachlorobenzene	<0.0100	0.0266								
Hexachlorobutadiene	<0.0100	0.0266								
Hexachlorocyclopentadiene	<0.0300	0.0660								
Hexachloroethane	<0.0100	0.0266								
Indeno[1,2,3-cd]pyrene	<0.0100	0.0266								
Isophorone	<0.0300	0.0660								
Naphthalene	<0.0100	0.0266								
Nitrobenzene	<0.0100	0.0266								
N-Nitrosodi-n-propylamine	<0.0100	0.0266								
N-Nitrosodiphenylamine	<0.0100	0.0266								
Pentachlorophenol	<0.0100	0.0266								
Phenanthrene	<0.0100	0.0266								
Phenol	<0.0100	0.0266								
Pyrene	<0.0100	0.0266								
Pyridine	<0.0500	0.132								
Surr: 2,4,6-Tribromophenol	0.573		0.6670		86.0	45	126			
Surr: 2-Fluorobiphenyl	0.607		0.6670		91.0	60	125			
Surr: 2-Fluorophenol	0.593		0.6670		89.0	37	125			
Surr: 4-Terphenyl-d14	0.633		0.6670		95.0	45	125			
Surr: Nitrobenzene-d5	0.567		0.6670		85.0	45	125			
Surr: Phenol-d5	0.573		0.6670		86.0	40	125			

Sample ID: <b>2402269-01BMS</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MS</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 8:30:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,5-Trichlorophenol	1.89	0.0331	1.668	0	114	49	125			
2,4,6-Trichlorophenol	1.92	0.0331	1.668	0	115	43	125			
2,4-Dichlorophenol	1.72	0.0331	1.668	0	103	45	125			
2,4-Dimethylphenol	1.71	0.0331	1.668	0	102	32	125			

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>2402269-01BMS</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MS</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 8:30:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4-Dinitrophenol	0.351	0.164	1.668	0	21.0	25	132			S
2,4-Dinitrotoluene	1.62	0.0331	1.668	0	97.4	48	125			
2,6-Dinitrotoluene	1.78	0.0331	1.668	0	107	48	125			
2-Chloronaphthalene	1.65	0.0331	1.668	0	99.2	45	125			
2-Chlorophenol	1.72	0.0331	1.668	0	103	44	125			
2-Methylnaphthalene	1.37	0.0331	1.668	0	82.2	47	125			
2-Methylphenol	1.70	0.0331	1.668	0	102	40	125			
2-Nitroaniline	1.63	0.0331	1.668	0	97.6	44	125			
2-Nitrophenol	1.62	0.0331	1.668	0	97.3	42	125			
3,3'-Dichlorobenzidine	1.76	0.0331	1.668	0	106	25	128			
3-Nitroaniline	1.57	0.0331	1.668	0	94.1	27	125			
4,6-Dinitro-2-methylphenol	0.700	0.0821	1.668	0	42.0	29	137			
4-Bromophenyl phenyl ether	1.52	0.0331	1.668	0	90.8	46	125			
4-Chloro-3-methylphenol	1.51	0.0331	1.668	0	90.8	46	125			
4-Chloroaniline	0.968	0.0821	1.668	0	58.0	34	125			
4-Chlorophenyl phenyl ether	1.52	0.0331	1.668	0	91.2	47	125			
4-Methylphenol	1.68	0.0331	1.668	0	101	41	125			
4-Nitroaniline	1.64	0.0331	1.668	0	98.6	34	125			
4-Nitrophenol	2.00	0.164	1.668	0	120	25	138			
Acenaphthene	1.48	0.0331	1.668	0	88.5	46	125			
Acenaphthylene	1.36	0.0331	1.668	0	81.8	44	125			
Acetophenone	1.42	0.0331	1.668	0	85.2	40	125			
Anthracene	1.49	0.0331	1.668	0	89.3	53	125			
Atrazine	2.31	0.0331	1.668	0	139	40	125			S
Benzaldehyde	1.49	0.0331	1.668	0	89.1	40	125			N
Benzo[a]anthracene	1.68	0.0331	1.668	0	101	52	125			
Benzo[a]pyrene	1.83	0.0331	1.668	0	110	50	125			
Benzo[b]fluoranthene	1.77	0.0331	1.668	0	106	45	125			
Benzo[g,h,i]perylene	1.82	0.0331	1.668	0	109	38	126			
Benzo[k]fluoranthene	1.70	0.0331	1.668	0	102	45	125			
Benzoic acid	0.290	0.164	1.668	0	17.4	25	125			S
Benzyl alcohol	1.49	0.0821	1.668	0	89.5	25	125			
Biphenyl	1.95	0.0331	1.668	0	117	40	125			
Bis(2-chloroethoxy)methane	1.44	0.0331	1.668	0	86.4	43	125			
Bis(2-chloroethyl)ether	1.42	0.0331	1.668	0	85.0	38	125			
Bis(2-chloroisopropyl)ether	1.55	0.0331	1.668	0	92.9	25	125			
Bis(2-ethylhexyl)phthalate	1.96	0.0821	1.668	0	117	47	127			
Butyl benzyl phthalate	1.88	0.0821	1.668	0	113	49	125			
Caprolactam	1.22	0.0821	1.668	0	72.9	40	125			
Carbazole	1.81	0.0331	1.668	0	108	40	125			
Chrysene	1.65	0.0331	1.668	0	98.7	53	125			

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	DF	Dilution Factor
	J	Analyte detected between MDL and RL	MDL	Method Detection Limit
	ND	Not Detected at the Method Detection Limit	R	RPD outside accepted control limits
	RL	Reporting Limit	S	Spike Recovery outside control limits
	J	Analyte detected between SDL and RL	N	Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>2402269-01BMS</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MS</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 8:30:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Dibenz[a,h]anthracene	1.95	0.0331	1.668	0	117	41	125			
Dibenzofuran	1.51	0.0331	1.668	0	90.8	51	125			
Diethyl phthalate	1.60	0.0821	1.668	0	95.9	50	125			
Dimethyl phthalate	1.57	0.0821	1.668	0	94.3	49	125			
Di-n-butyl phthalate	1.67	0.0821	1.668	0	100	56	125			
Di-n-octyl phthalate	2.03	0.0821	1.668	0	122	41	132			
Fluoranthene	1.57	0.0331	1.668	0	94.1	54	125			
Fluorene	1.50	0.0331	1.668	0	89.9	49	125			
Hexachlorobenzene	1.44	0.0331	1.668	0	86.1	47	125			
Hexachlorobutadiene	1.50	0.0331	1.668	0	89.8	40	125			
Hexachlorocyclopentadiene	1.91	0.0821	1.668	0	115	31	135			
Hexachloroethane	1.36	0.0331	1.668	0	81.7	34	125			
Indeno[1,2,3-cd]pyrene	1.92	0.0331	1.668	0	115	38	125			
Isophorone	1.44	0.0821	1.668	0	86.5	43	125			
Naphthalene	1.42	0.0331	1.668	0	85.3	40	125			
Nitrobenzene	1.49	0.0331	1.668	0	89.6	41	125			
N-Nitrosodi-n-propylamine	1.37	0.0331	1.668	0	82.4	40	125			
N-Nitrosodiphenylamine	1.61	0.0331	1.668	0	96.7	49	125			
Pentachlorophenol	1.15	0.0331	1.668	0	68.9	25	125			
Phenanthrene	1.63	0.0331	1.668	0	97.5	50	125			
Phenol	1.73	0.0331	1.668	0	103	39	125			
Pyrene	1.75	0.0331	1.668	0	105	46	125			
Pyridine	0.864	0.164	1.668	0	51.8	20	125			
Surr: 2,4,6-Tribromophenol	0.722		0.8302		87.0	45	126			
Surr: 2-Fluorobiphenyl	0.772		0.8302		93.0	60	125			
Surr: 2-Fluorophenol	0.747		0.8302		90.0	37	125			
Surr: 4-Terphenyl-d14	0.780		0.8302		94.0	45	125			
Surr: Nitrobenzene-d5	0.697		0.8302		84.0	45	125			
Surr: Phenol-d5	0.722		0.8302		87.0	40	125			

Sample ID: <b>2402269-01BMSD</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MSD</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 8:56:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,5-Trichlorophenol	1.96	0.0343	1.728	0	113	49	125	3.31	30	
2,4,6-Trichlorophenol	1.96	0.0343	1.728	0	113	43	125	1.96	30	
2,4-Dichlorophenol	1.73	0.0343	1.728	0	100	45	125	0.544	30	
2,4-Dimethylphenol	1.70	0.0343	1.728	0	98.5	32	125	0.387	30	
2,4-Dinitrophenol	0.305	0.170	1.728	0	17.7	25	132	14.0	30	S
2,4-Dinitrotoluene	1.70	0.0343	1.728	0	98.6	48	125	4.74	30	
2,6-Dinitrotoluene	1.86	0.0343	1.728	0	108	48	125	4.27	30	

**Qualifiers:** B Analyte detected in the associated Method Blank DF Dilution Factor  
 J Analyte detected between MDL and RL MDL Method Detection Limit  
 ND Not Detected at the Method Detection Limit R RPD outside accepted control limits  
 RL Reporting Limit S Spike Recovery outside control limits  
 J Analyte detected between SDL and RL N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>2402269-01BMSD</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MSD</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 8:56:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2-Chloronaphthalene	1.68	0.0343	1.728	0	97.5	45	125	1.86	30	
2-Chlorophenol	1.70	0.0343	1.728	0	98.7	44	125	0.721	30	
2-Methylnaphthalene	1.40	0.0343	1.728	0	80.9	47	125	1.94	30	
2-Methylphenol	1.64	0.0343	1.728	0	94.9	40	125	3.90	30	
2-Nitroaniline	1.69	0.0343	1.728	0	97.9	44	125	3.83	30	
2-Nitrophenol	1.67	0.0343	1.728	0	96.6	42	125	2.86	30	
3,3'-Dichlorobenzidine	1.87	0.0343	1.728	0	108	25	128	5.80	30	
3-Nitroaniline	1.64	0.0343	1.728	0	94.8	27	125	4.21	30	
4,6-Dinitro-2-methylphenol	0.644	0.0851	1.728	0	37.3	29	137	8.41	30	
4-Bromophenyl phenyl ether	1.59	0.0343	1.728	0	92.0	46	125	4.83	30	
4-Chloro-3-methylphenol	1.55	0.0343	1.728	0	89.6	46	125	2.15	30	
4-Chloroaniline	1.01	0.0851	1.728	0	58.7	34	125	4.72	30	
4-Chlorophenyl phenyl ether	1.56	0.0343	1.728	0	90.2	47	125	2.43	30	
4-Methylphenol	1.60	0.0343	1.728	0	92.8	41	125	4.45	30	
4-Nitroaniline	1.74	0.0343	1.728	0	101	34	125	5.87	30	
4-Nitrophenol	1.80	0.170	1.728	0	104	25	138	10.7	30	
Acenaphthene	1.52	0.0343	1.728	0	88.1	46	125	3.07	30	
Acenaphthylene	1.40	0.0343	1.728	0	80.7	44	125	2.18	30	
Acetophenone	1.38	0.0343	1.728	0	79.8	40	125	3.05	30	
Anthracene	1.54	0.0343	1.728	0	89.0	53	125	3.13	30	
Atrazine	2.33	0.0343	1.728	0	135	40	125	0.798	30	S
Benzaldehyde	1.46	0.0343	1.728	0	84.7	40	125	1.57	30	N
Benzo[a]anthracene	1.76	0.0343	1.728	0	102	52	125	4.41	30	
Benzo[a]pyrene	1.87	0.0343	1.728	0	108	50	125	2.38	30	
Benzo[b]fluoranthene	1.96	0.0343	1.728	0	114	45	125	10.2	30	
Benzo[g,h,i]perylene	1.88	0.0343	1.728	0	109	38	126	3.34	30	
Benzo[k]fluoranthene	1.64	0.0343	1.728	0	94.7	45	125	3.92	30	
Benzoic acid	0.293	0.170	1.728	0	17.0	25	125	1.21	30	S
Benzyl alcohol	1.50	0.0851	1.728	0	86.7	25	125	0.361	30	
Biphenyl	1.94	0.0343	1.728	0	112	40	125	0.818	30	
Bis(2-chloroethoxy)methane	1.52	0.0343	1.728	0	87.7	43	125	5.01	30	
Bis(2-chloroethyl)ether	1.44	0.0343	1.728	0	83.3	38	125	1.52	30	
Bis(2-chloroisopropyl)ether	1.55	0.0343	1.728	0	89.9	25	125	0.205	30	
Bis(2-ethylhexyl)phthalate	2.01	0.0851	1.728	0	117	47	127	2.76	30	
Butyl benzyl phthalate	1.93	0.0851	1.728	0	112	49	125	2.90	30	
Caprolactam	1.26	0.0851	1.728	0	72.7	40	125	3.32	30	
Carbazole	1.84	0.0343	1.728	0	106	40	125	1.67	30	
Chrysene	1.70	0.0343	1.728	0	98.1	53	125	2.97	30	
Dibenz[a,h]anthracene	1.98	0.0343	1.728	0	115	41	125	1.55	30	
Dibenzofuran	1.59	0.0343	1.728	0	92.0	51	125	4.83	30	
Diethyl phthalate	1.68	0.0851	1.728	0	97.1	50	125	4.76	30	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>2402269-01BMSD</b>	Batch ID: <b>114177</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg-dry</b>
SampType: <b>MSD</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 8:56:00 PM</b>	Prep Date: <b>2/26/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Dimethyl phthalate	1.65	0.0851	1.728	0	95.6	49	125	4.89	30	
Di-n-butyl phthalate	1.74	0.0851	1.728	0	101	56	125	4.12	30	
Di-n-octyl phthalate	2.09	0.0851	1.728	0	121	41	132	2.83	30	
Fluoranthene	1.62	0.0343	1.728	0	93.7	54	125	3.05	30	
Fluorene	1.57	0.0343	1.728	0	90.7	49	125	4.46	30	
Hexachlorobenzene	1.46	0.0343	1.728	0	84.6	47	125	1.78	30	
Hexachlorobutadiene	1.54	0.0343	1.728	0	88.9	40	125	2.58	30	
Hexachlorocyclopentadiene	1.90	0.0851	1.728	0	110	31	135	0.416	30	
Hexachloroethane	1.37	0.0343	1.728	0	79.5	34	125	0.809	30	
Indeno[1,2,3-cd]pyrene	1.98	0.0343	1.728	0	114	38	125	2.87	30	
Isophorone	1.50	0.0851	1.728	0	86.7	43	125	3.81	30	
Naphthalene	1.46	0.0343	1.728	0	84.6	40	125	2.71	30	
Nitrobenzene	1.57	0.0343	1.728	0	90.9	41	125	5.01	30	
N-Nitrosodi-n-propylamine	1.35	0.0343	1.728	0	78.4	40	125	1.49	30	
N-Nitrosodiphenylamine	1.67	0.0343	1.728	0	96.5	49	125	3.32	30	
Pentachlorophenol	1.13	0.0343	1.728	0	65.2	25	125	1.89	30	
Phenanthrene	1.66	0.0343	1.728	0	96.1	50	125	2.14	30	
Phenol	1.70	0.0343	1.728	0	98.6	39	125	1.25	30	
Pyrene	1.79	0.0343	1.728	0	104	46	125	2.43	30	
Pyridine	0.884	0.170	1.728	0	51.2	20	125	2.37	30	
Surr: 2,4,6-Tribromophenol	0.722		0.8600		84.0	45	126	0	0	
Surr: 2-Fluorobiphenyl	0.756		0.8600		88.0	60	125	0	0	
Surr: 2-Fluorophenol	0.748		0.8600		87.0	37	125	0	0	
Surr: 4-Terphenyl-d14	0.791		0.8600		92.0	45	125	0	0	
Surr: Nitrobenzene-d5	0.705		0.8600		82.0	45	125	0	0	
Surr: Phenol-d5	0.713		0.8600		83.0	40	125	0	0	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>ICV-240226</b>	Batch ID: <b>R131629</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>ICV</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 2:38:00 PM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
2,4,5-Trichlorophenol	2.63	0.0266	2.500	0	105	70	130			
2,4,6-Trichlorophenol	2.70	0.0266	2.500	0	108	70	130			
2,4-Dichlorophenol	2.40	0.0266	2.500	0	95.9	70	130			
2,4-Dimethylphenol	2.28	0.0266	2.500	0	91.2	70	130			
2,4-Dinitrophenol	2.58	0.132	2.500	0	103	70	130			
2,4-Dinitrotoluene	2.50	0.0266	2.500	0	99.9	70	130			
2,6-Dinitrotoluene	2.79	0.0266	2.500	0	112	70	130			
2-Chloronaphthalene	2.59	0.0266	2.500	0	104	70	130			
2-Chlorophenol	2.48	0.0266	2.500	0	99.2	70	130			
2-Methylnaphthalene	2.19	0.0266	2.500	0	87.7	70	130			
2-Methylphenol	2.30	0.0266	2.500	0	91.9	70	130			
2-Nitroaniline	2.49	0.0266	2.500	0	99.5	70	130			
2-Nitrophenol	2.60	0.0266	2.500	0	104	70	130			
3,3'-Dichlorobenzidine	3.00	0.0266	2.500	0	120	70	130			
3-Nitroaniline	2.60	0.0266	2.500	0	104	70	130			
4,6-Dinitro-2-methylphenol	2.51	0.0660	2.500	0	101	70	130			
4-Bromophenyl phenyl ether	2.32	0.0266	2.500	0	92.6	70	130			
4-Chloro-3-methylphenol	2.04	0.0266	2.500	0	81.7	70	130			
4-Chloroaniline	2.28	0.0660	2.500	0	91.1	70	130			
4-Chlorophenyl phenyl ether	2.31	0.0266	2.500	0	92.4	70	130			
4-Methylphenol	2.26	0.0266	2.500	0	90.6	70	130			
4-Nitroaniline	2.56	0.0266	2.500	0	102	70	130			
4-Nitrophenol	2.52	0.132	2.500	0	101	70	130			
Acenaphthene	2.36	0.0266	2.500	0	94.4	70	130			
Acenaphthylene	2.52	0.0266	2.500	0	101	70	130			
Acetophenone	2.18	0.0266	2.500	0	87.4	70	130			
Anthracene	2.25	0.0266	2.500	0	90.1	70	130			
Atrazine	3.17	0.0266	2.500	0	127	70	130			
Benzaldehyde	2.23	0.0266	2.500	0	89.3	70	130			N
Benzo[a]anthracene	2.53	0.0266	2.500	0	101	70	130			
Benzo[a]pyrene	2.81	0.0266	2.500	0	112	70	130			
Benzo[b]fluoranthene	2.75	0.0266	2.500	0	110	70	130			
Benzo[g,h,i]perylene	2.63	0.0266	2.500	0	105	70	130			
Benzo[k]fluoranthene	2.35	0.0266	2.500	0	94.1	70	130			
Benzoic acid	2.26	0.132	2.500	0	90.3	70	130			
Benzyl alcohol	2.34	0.0660	2.500	0	93.5	70	130			
Biphenyl	2.87	0.0266	2.500	0	115	70	130			
Bis(2-chloroethoxy)methane	2.36	0.0266	2.500	0	94.4	70	130			
Bis(2-chloroethyl)ether	2.40	0.0266	2.500	0	96.0	70	130			
Bis(2-chloroisopropyl)ether	2.57	0.0266	2.500	0	103	70	130			
Bis(2-ethylhexyl)phthalate	2.72	0.0660	2.500	0	109	70	130			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS4\_240226A

Sample ID: <b>ICV-240226</b>	Batch ID: <b>R131629</b>	TestNo: <b>SW8270E</b>	Units: <b>mg/Kg</b>
SampType: <b>ICV</b>	Run ID: <b>GCMS4_240226A</b>	Analysis Date: <b>2/26/2024 2:38:00 PM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Butyl benzyl phthalate	2.65	0.0660	2.500	0	106	70	130			
Caprolactam	2.18	0.0660	2.500	0	87.4	70	130			
Carbazole	2.53	0.0266	2.500	0	101	70	130			
Chrysene	2.44	0.0266	2.500	0	97.5	70	130			
Dibenz[a,h]anthracene	2.86	0.0266	2.500	0	115	70	130			
Dibenzofuran	2.31	0.0266	2.500	0	92.4	70	130			
Diethyl phthalate	2.34	0.0660	2.500	0	93.6	70	130			
Dimethyl phthalate	2.37	0.0660	2.500	0	94.9	70	130			
Di-n-butyl phthalate	2.50	0.0660	2.500	0	100	70	130			
Di-n-octyl phthalate	2.72	0.0660	2.500	0	109	70	130			
Fluoranthene	2.30	0.0266	2.500	0	91.9	70	130			
Fluorene	2.29	0.0266	2.500	0	91.5	70	130			
Hexachlorobenzene	2.19	0.0266	2.500	0	87.8	70	130			
Hexachlorobutadiene	2.70	0.0266	2.500	0	108	70	130			
Hexachlorocyclopentadiene	2.85	0.0660	2.500	0	114	70	130			
Hexachloroethane	2.45	0.0266	2.500	0	98.1	70	130			
Indeno[1,2,3-cd]pyrene	2.83	0.0266	2.500	0	113	70	130			
Isophorone	2.46	0.0660	2.500	0	98.5	70	130			
Naphthalene	2.41	0.0266	2.500	0	96.2	70	130			
Nitrobenzene	2.58	0.0266	2.500	0	103	70	130			
N-Nitrosodi-n-propylamine	2.24	0.0266	2.500	0	89.4	70	130			
N-Nitrosodiphenylamine	2.40	0.0266	2.500	0	96.0	70	130			
Pentachlorophenol	2.41	0.0266	2.500	0	96.4	70	130			
Phenanthrene	2.45	0.0266	2.500	0	98.0	70	130			
Phenol	2.54	0.0266	2.500	0	102	70	130			
Pyrene	2.58	0.0266	2.500	0	103	70	130			
Pyridine	2.26	0.132	2.500	0	90.2	70	130			
Surr: 2,4,6-Tribromophenol	2.45		2.500		98.0	70	130			
Surr: 2-Fluorobiphenyl	2.64		2.500		106	70	130			
Surr: 2-Fluorophenol	2.46		2.500		98.4	70	130			
Surr: 4-Terphenyl-d14	2.58		2.500		103	70	130			
Surr: Nitrobenzene-d5	2.64		2.500		106	70	130			
Surr: Phenol-d5	2.37		2.500		94.8	70	130			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240108A

Sample ID: <b>DCS-113523</b>	Batch ID: <b>113523</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS</b>	Run ID: <b>GCMS2_240108A</b>	Analysis Date: <b>1/8/2024 5:45:00 PM</b>	Prep Date: <b>1/8/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	0.00254	0.00500	0.00232	0	109	10	400	0	0	
1,1,1-Trichloroethane	0.00252	0.00500	0.00232	0	109	10	400	0	0	
1,1,2,2-Tetrachloroethane	0.00269	0.00500	0.00232	0	116	10	400	0	0	
1,1,2-Trichloroethane	0.00250	0.00500	0.00232	0	108	10	400	0	0	
1,1,2-Trichlorotrifluoroethane	0.00344	0.0150	0.00232	0	148	10	400	0	0	
1,1-Dichloroethane	0.00259	0.00500	0.00232	0	112	10	400	0	0	
1,1-Dichloroethene	0.00242	0.00500	0.00232	0	104	10	400	0	0	
1,1-Dichloropropene	0.00260	0.00500	0.00232	0	112	10	400	0	0	
1,2,3-Trichlorobenzene	0.00590	0.00500	0.00232	0	254	10	400	0	0	
1,2,3-Trichloropropane	0.00282	0.00500	0.00232	0	122	10	400	0	0	
1,2,4-Trichlorobenzene	0.00481	0.00500	0.00232	0	207	10	400	0	0	
1,2,4-Trimethylbenzene	0.00319	0.00500	0.00232	0	138	10	400	0	0	
1,2-Dibromo-3-chloropropane	0.00341	0.00500	0.00232	0	147	10	400	0	0	
1,2-Dibromoethane	0.00241	0.00500	0.00232	0	104	10	400	0	0	
1,2-Dichlorobenzene	0.00326	0.00500	0.00232	0	141	10	400	0	0	
1,2-Dichloroethane	0.00250	0.00500	0.00232	0	108	10	400	0	0	
1,2-Dichloropropane	0.00256	0.00500	0.00232	0	110	10	400	0	0	
1,3,5-Trimethylbenzene	0.00310	0.00500	0.00232	0	134	10	400	0	0	
1,3-Dichlorobenzene	0.00301	0.00500	0.00232	0	130	10	400	0	0	
1,3-Dichloropropane	0.00253	0.00500	0.00232	0	109	10	400	0	0	
1,4-Dichlorobenzene	0.00324	0.00500	0.00232	0	140	10	400	0	0	
1-Chlorohexane	0.00399	0.00500	0.00232	0	172	10	400	0	0	
2,2-Dichloropropane	0.00253	0.00500	0.00232	0	109	10	400	0	0	
2-Butanone	0.0126	0.0150	0.0116	0	109	10	400	0	0	
2-Chlorotoluene	0.00288	0.00500	0.00232	0	124	10	400	0	0	
2-Hexanone	0.0131	0.0150	0.0116	0	113	10	400	0	0	
4-Chlorotoluene	0.00277	0.00500	0.00232	0	119	10	400	0	0	
4-Methyl-2-pentanone	0.0129	0.0150	0.0116	0	111	10	400	0	0	
Acetone	0.0134	0.0500	0.0116	0	116	10	400	0	0	
Benzene	0.00267	0.00500	0.00232	0	115	10	400	0	0	
Bromobenzene	0.00267	0.00500	0.00232	0	115	10	400	0	0	
Bromochloromethane	0.00235	0.00500	0.00232	0	101	10	400	0	0	
Bromodichloromethane	0.00245	0.00500	0.00232	0	106	10	400	0	0	
Bromoform	0.00244	0.00500	0.00232	0	105	10	400	0	0	
Bromomethane	0.00387	0.00500	0.00232	0	167	10	400	0	0	
Carbon disulfide	0.00253	0.0150	0.00232	0	109	10	400	0	0	
Carbon tetrachloride	0.00250	0.00500	0.00232	0	108	10	400	0	0	
Chlorobenzene	0.00271	0.00500	0.00232	0	117	10	400	0	0	
Chloroethane	0.00267	0.00500	0.00232	0	115	10	400	0	0	
Chloroform	0.00254	0.00500	0.00232	0	109	10	400	0	0	
Chloromethane	0.00331	0.00500	0.00232	0	143	10	400	0	0	

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 J Analyte detected between MDL and RL  
 ND Not Detected at the Method Detection Limit  
 RL Reporting Limit  
 J Analyte detected between SDL and RL

DF Dilution Factor  
 MDL Method Detection Limit  
 R RPD outside accepted control limits  
 S Spike Recovery outside control limits  
 N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240108A

Sample ID: <b>DCS-113523</b>	Batch ID: <b>113523</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>DCS</b>	Run ID: <b>GCMS2_240108A</b>	Analysis Date: <b>1/8/2024 5:45:00 PM</b>	Prep Date: <b>1/8/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
cis-1,2-Dichloroethene	0.00267	0.00500	0.00232	0	115	10	400	0	0	
cis-1,3-Dichloropropene	0.00253	0.00500	0.00232	0	109	10	400	0	0	
Cyclohexane	0.00344	0.0150	0.00232	0	148	10	400	0	0	N
Dibromochloromethane	0.00237	0.00500	0.00232	0	102	10	400	0	0	
Dibromomethane	0.00252	0.00500	0.00232	0	109	10	400	0	0	
Dichlorodifluoromethane	0.00254	0.00500	0.00232	0	109	10	400	0	0	
Ethylbenzene	0.00270	0.00500	0.00232	0	116	10	400	0	0	
Hexachlorobutadiene	0.00681	0.00500	0.00232	0	294	10	400	0	0	
Isopropylbenzene	0.00288	0.00500	0.00232	0	124	10	400	0	0	
m,p-Xylene	0.00551	0.00500	0.00464	0	119	10	400	0	0	
Methyl Acetate	0.00293	0.0150	0.00232	0	126	10	400	0	0	
Methyl tert-butyl ether	0.00273	0.00500	0.00232	0	118	10	400	0	0	
Methylcyclohexane	0.00336	0.0150	0.00232	0	145	10	400	0	0	
Methylene chloride	0.00271	0.00500	0.00232	0	117	10	400	0	0	
Naphthalene	0.00466	0.0150	0.00232	0	201	10	400	0	0	
n-Butylbenzene	0.00345	0.00500	0.00232	0	149	10	400	0	0	
n-Propylbenzene	0.00301	0.00500	0.00232	0	130	10	400	0	0	
o-Xylene	0.00268	0.00500	0.00232	0	116	10	400	0	0	
p-Isopropyltoluene	0.00335	0.00500	0.00232	0	144	10	400	0	0	
sec-Butylbenzene	0.00346	0.00500	0.00232	0	149	10	400	0	0	
Styrene	0.00275	0.00500	0.00232	0	119	10	400	0	0	
tert-Butylbenzene	0.00311	0.00500	0.00232	0	134	10	400	0	0	
Tetrachloroethene	0.00277	0.00500	0.00232	0	119	10	400	0	0	
Toluene	0.00252	0.00500	0.00232	0	109	10	400	0	0	
trans-1,2-Dichloroethene	0.00256	0.00500	0.00232	0	110	10	400	0	0	
trans-1,3-Dichloropropene	0.00252	0.00500	0.00232	0	109	10	400	0	0	
Trichloroethene	0.00254	0.00500	0.00232	0	109	10	400	0	0	
Trichlorofluoromethane	0.00242	0.0150	0.00232	0	104	10	400	0	0	
Vinyl chloride	0.00248	0.00500	0.00232	0	107	10	400	0	0	
Xylenes, Total	0.00819	0.00500	0.00696	0	118	10	400	0	0	

**Qualifiers:** B Analyte detected in the associated Method Blank  
 J Analyte detected between MDL and RL  
 ND Not Detected at the Method Detection Limit  
 RL Reporting Limit  
 J Analyte detected between SDL and RL

DF Dilution Factor  
 MDL Method Detection Limit  
 R RPD outside accepted control limits  
 S Spike Recovery outside control limits  
 N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240221B

The QC data in batch 114118 applies to the following samples: 2402269-01A, 2402269-02A, 2402269-03A, 2402269-04A, 2402269-06A, 2402269-07A, 2402269-08A

Sample ID: <b>LCS-114118</b>	Batch ID: <b>114118</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>LCS</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 3:45:00 PM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	0.0227	0.00500	0.0232	0	97.9	74	125			
1,1,1-Trichloroethane	0.0227	0.00500	0.0232	0	97.8	68	130			
1,1,2,2-Tetrachloroethane	0.0254	0.00500	0.0232	0	110	59	140			
1,1,2-Trichloroethane	0.0228	0.00500	0.0232	0	98.2	62	127			
1,1,2-Trichlorotrifluoroethane	0.0217	0.0150	0.0232	0	93.5	57	135			
1,1-Dichloroethane	0.0236	0.00500	0.0232	0	102	73	125			
1,1-Dichloroethene	0.0228	0.00500	0.0232	0	98.2	65	136			
1,1-Dichloropropene	0.0230	0.00500	0.0232	0	99.2	70	135			
1,2,3-Trichlorobenzene	0.0268	0.00500	0.0232	0	116	62	133			
1,2,3-Trichloropropane	0.0258	0.00500	0.0232	0	111	63	130			
1,2,4-Trichlorobenzene	0.0254	0.00500	0.0232	0	110	65	131			
1,2,4-Trimethylbenzene	0.0255	0.00500	0.0232	0	110	65	135			
1,2-Dibromo-3-chloropropane	0.0211	0.00500	0.0232	0	90.9	49	135			
1,2-Dibromoethane	0.0240	0.00500	0.0232	0	103	70	124			
1,2-Dichlorobenzene	0.0256	0.00500	0.0232	0	110	74	120			
1,2-Dichloroethane	0.0236	0.00500	0.0232	0	102	72	137			
1,2-Dichloropropane	0.0236	0.00500	0.0232	0	102	71	120			
1,3,5-Trimethylbenzene	0.0254	0.00500	0.0232	0	110	65	133			
1,3-Dichlorobenzene	0.0248	0.00500	0.0232	0	107	72	124			
1,3-Dichloropropane	0.0247	0.00500	0.0232	0	106	76	123			
1,4-Dichlorobenzene	0.0252	0.00500	0.0232	0	109	72	125			
1-Chlorohexane	0.0236	0.00500	0.0232	0	102	60	135			
2,2-Dichloropropane	0.0227	0.00500	0.0232	0	97.9	67	134			
2-Butanone	0.251	0.0150	0.232	0	108	60	135			
2-Chlorotoluene	0.0250	0.00500	0.0232	0	108	69	128			
2-Hexanone	0.257	0.0150	0.232	0	111	50	150			
4-Chlorotoluene	0.0257	0.00500	0.0232	0	111	73	126			
4-Methyl-2-pentanone	0.266	0.0150	0.232	0	115	60	135			
Acetone	0.247	0.0500	0.232	0	107	40	141			
Benzene	0.0232	0.00500	0.0232	0	99.8	73	126			
Bromobenzene	0.0248	0.00500	0.0232	0	107	66	121			
Bromochloromethane	0.0231	0.00500	0.0232	0	99.6	71	127			
Bromodichloromethane	0.0224	0.00500	0.0232	0	96.7	72	128			
Bromoform	0.0210	0.00500	0.0232	0	90.4	66	137			
Bromomethane	0.0256	0.00500	0.0232	0	110	45	141			
Carbon disulfide	0.0217	0.0150	0.0232	0	93.6	50	150			
Carbon tetrachloride	0.0215	0.00500	0.0232	0	92.7	67	133			
Chlorobenzene	0.0239	0.00500	0.0232	0	103	75	123			
Chloroethane	0.0240	0.00500	0.0232	0	103	41	141			

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	DF	Dilution Factor
	J	Analyte detected between MDL and RL	MDL	Method Detection Limit
	ND	Not Detected at the Method Detection Limit	R	RPD outside accepted control limits
	RL	Reporting Limit	S	Spike Recovery outside control limits
	J	Analyte detected between SDL and RL	N	Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240221B

Sample ID: <b>LCS-114118</b>	Batch ID: <b>114118</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>LCS</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 3:45:00 PM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Chloroform	0.0225	0.00500	0.0232	0	97.2	72	124			
Chloromethane	0.0213	0.00500	0.0232	0	91.6	51	129			
cis-1,2-Dichloroethene	0.0227	0.00500	0.0232	0	97.9	67	125			
cis-1,3-Dichloropropene	0.0224	0.00500	0.0232	0	96.7	72	126			
Cyclohexane	0.0224	0.0150	0.0232	0	96.4	40	158			N
Dibromochloromethane	0.0222	0.00500	0.0232	0	95.8	66	130			
Dibromomethane	0.0226	0.00500	0.0232	0	97.6	73	128			
Dichlorodifluoromethane	0.0178	0.00500	0.0232	0	76.7	34	136			
Ethylbenzene	0.0235	0.00500	0.0232	0	101	74	127			
Hexachlorobutadiene	0.0245	0.00500	0.0232	0	105	53	142			
Isopropylbenzene	0.0237	0.00500	0.0232	0	102	77	129			
m,p-Xylene	0.0486	0.00500	0.0464	0	105	79	126			
Methyl Acetate	0.0250	0.0150	0.0232	0	108	50	150			
Methyl tert-butyl ether	0.0228	0.00500	0.0232	0	98.2	50	135			
Methylcyclohexane	0.0224	0.0150	0.0232	0	96.4	50	150			
Methylene chloride	0.0228	0.00500	0.0232	0	98.2	63	137			
Naphthalene	0.0242	0.0150	0.0232	0	104	51	135			
n-Butylbenzene	0.0264	0.00500	0.0232	0	114	65	138			
n-Propylbenzene	0.0257	0.00500	0.0232	0	111	63	135			
o-Xylene	0.0237	0.00500	0.0232	0	102	77	125			
p-Isopropyltoluene	0.0245	0.00500	0.0232	0	105	75	133			
sec-Butylbenzene	0.0258	0.00500	0.0232	0	111	63	132			
Styrene	0.0237	0.00500	0.0232	0	102	74	128			
tert-Butylbenzene	0.0256	0.00500	0.0232	0	110	65	132			
Tetrachloroethene	0.0226	0.00500	0.0232	0	97.4	67	139			
Toluene	0.0230	0.00500	0.0232	0	99.3	71	127			
trans-1,2-Dichloroethene	0.0223	0.00500	0.0232	0	96.3	66	134			
trans-1,3-Dichloropropene	0.0217	0.00500	0.0232	0	93.6	65	127			
Trichloroethene	0.0223	0.00500	0.0232	0	95.9	77	124			
Trichlorofluoromethane	0.0236	0.0150	0.0232	0	102	49	139			
Vinyl chloride	0.0232	0.00500	0.0232	0	99.8	58	126			
Xylenes, Total	0.0723	0.00500	0.0696	0	104	75	125			
Surr: 1,2-Dichloroethane-d4	49.1		50.00		98.1	52	149			
Surr: 4-Bromofluorobenzene	53.0		50.00		106	84	118			
Surr: Dibromofluoromethane	49.0		50.00		97.9	65	135			
Surr: Toluene-d8	49.6		50.00		99.3	84	116			

Sample ID: <b>MB-114118</b>	Batch ID: <b>114118</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 6:06:00 PM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
---------	--------	----	-----------	---------	------	----------	-----------	------	----------	------

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240221B

Sample ID: <b>MB-114118</b>	Batch ID: <b>114118</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 6:06:00 PM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	<0.00100	0.00500								
1,1,1-Trichloroethane	<0.00100	0.00500								
1,1,2,2-Tetrachloroethane	<0.00100	0.00500								
1,1,2-Trichloroethane	<0.00100	0.00500								
1,1,2-Trichlorotrifluoroethane	<0.00500	0.0150								
1,1-Dichloroethane	<0.00100	0.00500								
1,1-Dichloroethene	<0.00100	0.00500								
1,1-Dichloropropene	<0.00100	0.00500								
1,2,3-Trichlorobenzene	<0.00100	0.00500								
1,2,3-Trichloropropane	<0.00100	0.00500								
1,2,4-Trichlorobenzene	<0.00100	0.00500								
1,2,4-Trimethylbenzene	<0.00100	0.00500								
1,2-Dibromo-3-chloropropane	<0.00100	0.00500								
1,2-Dibromoethane	<0.00100	0.00500								
1,2-Dichlorobenzene	<0.00100	0.00500								
1,2-Dichloroethane	<0.00100	0.00500								
1,2-Dichloropropane	<0.00100	0.00500								
1,3,5-Trimethylbenzene	<0.00100	0.00500								
1,3-Dichlorobenzene	<0.00100	0.00500								
1,3-Dichloropropane	<0.00100	0.00500								
1,4-Dichlorobenzene	<0.00100	0.00500								
1-Chlorohexane	<0.00100	0.00500								
2,2-Dichloropropane	<0.00100	0.00500								
2-Butanone	<0.00500	0.0150								
2-Chlorotoluene	<0.00100	0.00500								
2-Hexanone	<0.00500	0.0150								
4-Chlorotoluene	<0.00100	0.00500								
4-Methyl-2-pentanone	<0.00500	0.0150								
Acetone	<0.0150	0.0500								
Benzene	<0.00100	0.00500								
Bromobenzene	<0.00100	0.00500								
Bromochloromethane	<0.00100	0.00500								
Bromodichloromethane	<0.00100	0.00500								
Bromoform	<0.00100	0.00500								
Bromomethane	<0.00100	0.00500								
Carbon disulfide	<0.00500	0.0150								
Carbon tetrachloride	<0.00100	0.00500								
Chlorobenzene	<0.00100	0.00500								
Chloroethane	<0.00100	0.00500								
Chloroform	<0.00100	0.00500								
Chloromethane	<0.00100	0.00500								

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240221B

Sample ID: <b>MB-114118</b>	Batch ID: <b>114118</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 6:06:00 PM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
cis-1,2-Dichloroethene	<0.00100	0.00500								
cis-1,3-Dichloropropene	<0.00100	0.00500								
Cyclohexane	<0.00500	0.01500								N
Dibromochloromethane	<0.00100	0.00500								
Dibromomethane	<0.00100	0.00500								
Dichlorodifluoromethane	<0.00100	0.00500								
Ethylbenzene	<0.00100	0.00500								
Hexachlorobutadiene	<0.00100	0.00500								
Isopropylbenzene	<0.00100	0.00500								
m,p-Xylene	<0.00100	0.00500								
Methyl Acetate	<0.00500	0.01500								
Methyl tert-butyl ether	<0.00100	0.00500								
Methylcyclohexane	<0.00500	0.01500								
Methylene chloride	<0.00500	0.00500								
Naphthalene	<0.00500	0.01500								
n-Butylbenzene	<0.00100	0.00500								
n-Propylbenzene	<0.00100	0.00500								
o-Xylene	<0.00100	0.00500								
p-Isopropyltoluene	<0.00100	0.00500								
sec-Butylbenzene	<0.00100	0.00500								
Styrene	<0.00100	0.00500								
tert-Butylbenzene	<0.00100	0.00500								
Tetrachloroethene	<0.00100	0.00500								
Toluene	<0.00100	0.00500								
trans-1,2-Dichloroethene	<0.00100	0.00500								
trans-1,3-Dichloropropene	<0.00100	0.00500								
Trichloroethene	<0.00100	0.00500								
Trichlorofluoromethane	<0.00500	0.01500								
Vinyl chloride	<0.00100	0.00500								
Xylenes, Total	<0.00100	0.00500								
Surr: 1,2-Dichloroethane-d4	50.3		50.00		101	52	149			
Surr: 4-Bromofluorobenzene	54.1		50.00		108	84	118			
Surr: Dibromofluoromethane	48.9		50.00		97.7	65	135			
Surr: Toluene-d8	47.9		50.00		95.8	84	116			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240221B

Sample ID: <b>ICV-240221</b>	Batch ID: <b>R131527</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>ICV</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 3:17:00 PM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	0.0441	0.00500	0.0464	0	95.1	70	130			
1,1,1-Trichloroethane	0.0442	0.00500	0.0464	0	95.3	70	130			
1,1,2,2-Tetrachloroethane	0.0491	0.00500	0.0464	0	106	70	130			
1,1,2-Trichloroethane	0.0459	0.00500	0.0464	0	98.8	70	130			
1,1,2-Trichlorotrifluoroethane	0.0430	0.0150	0.0464	0	92.6	70	130			
1,1-Dichloroethane	0.0464	0.00500	0.0464	0	100	70	130			
1,1-Dichloroethene	0.0449	0.00500	0.0464	0	96.7	70	130			
1,1-Dichloropropene	0.0442	0.00500	0.0464	0	95.3	70	130			
1,2,3-Trichlorobenzene	0.0486	0.00500	0.0464	0	105	70	130			
1,2,3-Trichloropropane	0.0500	0.00500	0.0464	0	108	70	130			
1,2,4-Trichlorobenzene	0.0489	0.00500	0.0464	0	105	70	130			
1,2,4-Trimethylbenzene	0.0491	0.00500	0.0464	0	106	70	130			
1,2-Dibromo-3-chloropropane	0.0438	0.00500	0.0464	0	94.5	70	130			
1,2-Dibromoethane	0.0487	0.00500	0.0464	0	105	70	130			
1,2-Dichlorobenzene	0.0491	0.00500	0.0464	0	106	70	130			
1,2-Dichloroethane	0.0455	0.00500	0.0464	0	98.0	70	130			
1,2-Dichloropropane	0.0474	0.00500	0.0464	0	102	70	130			
1,3,5-Trimethylbenzene	0.0480	0.00500	0.0464	0	103	70	130			
1,3-Dichlorobenzene	0.0483	0.00500	0.0464	0	104	70	130			
1,3-Dichloropropane	0.0485	0.00500	0.0464	0	105	70	130			
1,4-Dichlorobenzene	0.0473	0.00500	0.0464	0	102	70	130			
1-Chlorohexane	0.0440	0.00500	0.0464	0	94.7	70	130			
2,2-Dichloropropane	0.0436	0.00500	0.0464	0	93.9	70	130			
2-Butanone	0.507	0.0150	0.464	0	109	70	130			
2-Chlorotoluene	0.0482	0.00500	0.0464	0	104	70	130			
2-Hexanone	0.522	0.0150	0.464	0	113	70	130			
4-Chlorotoluene	0.0501	0.00500	0.0464	0	108	70	130			
4-Methyl-2-pentanone	0.521	0.0150	0.464	0	112	70	130			
Acetone	0.484	0.0500	0.464	0	104	70	130			
Benzene	0.0454	0.00500	0.0464	0	97.8	70	130			
Bromobenzene	0.0475	0.00500	0.0464	0	102	70	130			
Bromochloromethane	0.0451	0.00500	0.0464	0	97.2	70	130			
Bromodichloromethane	0.0448	0.00500	0.0464	0	96.5	70	130			
Bromoform	0.0434	0.00500	0.0464	0	93.6	70	130			
Bromomethane	0.0500	0.00500	0.0464	0	108	70	130			
Carbon disulfide	0.0432	0.0150	0.0464	0	93.1	70	130			
Carbon tetrachloride	0.0413	0.00500	0.0464	0	89.1	70	130			
Chlorobenzene	0.0460	0.00500	0.0464	0	99.1	70	130			
Chloroethane	0.0479	0.00500	0.0464	0	103	70	130			
Chloroform	0.0454	0.00500	0.0464	0	97.8	70	130			
Chloromethane	0.0410	0.00500	0.0464	0	88.4	70	130			

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	DF	Dilution Factor
	J	Analyte detected between MDL and RL	MDL	Method Detection Limit
	ND	Not Detected at the Method Detection Limit	R	RPD outside accepted control limits
	RL	Reporting Limit	S	Spike Recovery outside control limits
	J	Analyte detected between SDL and RL	N	Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS2\_240221B

Sample ID: <b>ICV-240221</b>	Batch ID: <b>R131527</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/Kg</b>
SampType: <b>ICV</b>	Run ID: <b>GCMS2_240221B</b>	Analysis Date: <b>2/21/2024 3:17:00 PM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
cis-1,2-Dichloroethene	0.0450	0.00500	0.0464	0	96.9	70	130			
cis-1,3-Dichloropropene	0.0466	0.00500	0.0464	0	100	70	130			
Cyclohexane	0.0445	0.0150	0.0464	0	95.8	70	130			N
Dibromochloromethane	0.0447	0.00500	0.0464	0	96.4	70	130			
Dibromomethane	0.0468	0.00500	0.0464	0	101	70	130			
Dichlorodifluoromethane	0.0357	0.00500	0.0464	0	77.0	70	130			
Ethylbenzene	0.0440	0.00500	0.0464	0	94.7	70	130			
Hexachlorobutadiene	0.0442	0.00500	0.0464	0	95.4	70	130			
Isopropylbenzene	0.0472	0.00500	0.0464	0	102	70	130			
m,p-Xylene	0.0931	0.00500	0.0928	0	100	70	130			
Methyl Acetate	0.0500	0.0150	0.0464	0	108	70	130			
Methyl tert-butyl ether	0.0460	0.00500	0.0464	0	99.1	70	130			
Methylcyclohexane	0.0428	0.0150	0.0464	0	92.2	70	130			
Methylene chloride	0.0442	0.00500	0.0464	0	95.2	70	130			
Naphthalene	0.0440	0.0150	0.0464	0	94.8	70	130			
n-Butylbenzene	0.0489	0.00500	0.0464	0	105	70	130			
n-Propylbenzene	0.0496	0.00500	0.0464	0	107	70	130			
o-Xylene	0.0472	0.00500	0.0464	0	102	70	130			
p-Isopropyltoluene	0.0492	0.00500	0.0464	0	106	70	130			
sec-Butylbenzene	0.0488	0.00500	0.0464	0	105	70	130			
Styrene	0.0473	0.00500	0.0464	0	102	70	130			
tert-Butylbenzene	0.0482	0.00500	0.0464	0	104	70	130			
Tetrachloroethene	0.0432	0.00500	0.0464	0	93.0	70	130			
Toluene	0.0470	0.00500	0.0464	0	101	70	130			
trans-1,2-Dichloroethene	0.0442	0.00500	0.0464	0	95.3	70	130			
trans-1,3-Dichloropropene	0.0448	0.00500	0.0464	0	96.5	70	130			
Trichloroethene	0.0431	0.00500	0.0464	0	92.9	70	130			
Trichlorofluoromethane	0.0469	0.0150	0.0464	0	101	70	130			
Vinyl chloride	0.0476	0.00500	0.0464	0	103	70	130			
Xylenes, Total	0.140	0.00500	0.139	0	101	70	130			
Surr: 1,2-Dichloroethane-d4	48.9		50.00		97.9	52	149			
Surr: 4-Bromofluorobenzene	52.4		50.00		105	84	118			
Surr: Dibromofluoromethane	49.8		50.00		99.6	65	135			
Surr: Toluene-d8	48.1		50.00		96.1	84	116			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_231227A

Sample ID: <b>DCS2-113423</b>	Batch ID: <b>113423</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>DCS2</b>	Run ID: <b>GCMS7_231227A</b>	Analysis Date: <b>12/27/2023 2:41:00 PM</b>	Prep Date: <b>12/27/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,2,3-Trichlorobenzene	0.00269	0.00500	0.00186	0	145	10	400	0	0	
1,2,4-Trichlorobenzene	0.00221	0.00500	0.00186	0	119	10	400	0	0	
1,2,4-Trimethylbenzene	0.00194	0.00500	0.00186	0	104	10	400	0	0	
1,2-Dibromo-3-chloropropane	0.000930	0.0100	0.00186	0	50.0	10	400	0	0	
1,3,5-Trimethylbenzene	0.00194	0.00500	0.00186	0	104	10	400	0	0	
1-Chlorohexane	0.00255	0.00500	0.00186	0	137	10	400	0	0	
Hexachlorobutadiene	0.00236	0.00300	0.00186	0	127	10	400	0	0	
Methylene chloride	0.00233	0.00250	0.00186	0	125	10	400	0	0	
Naphthalene	0.00206	0.0150	0.00186	0	111	10	400	0	0	

Sample ID: <b>DCS-113423</b>	Batch ID: <b>113423</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>DCS</b>	Run ID: <b>GCMS7_231227A</b>	Analysis Date: <b>12/27/2023 3:06:00 PM</b>	Prep Date: <b>12/27/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	0.000440	0.00100	0.000464	0	94.8	10	400	0	0	
1,1,1-Trichloroethane	0.000550	0.00100	0.000464	0	119	10	400	0	0	
1,1,2,2-Tetrachloroethane	0.000500	0.00100	0.000464	0	108	10	400	0	0	
1,1,2-Trichloroethane	0.000580	0.00100	0.000464	0	125	10	400	0	0	
1,1,2-Trichlorotrifluoroethane	0.0112	0.0150	0.00928	0	120	10	400	0	0	
1,1-Dichloroethane	0.000530	0.00100	0.000464	0	114	10	400	0	0	
1,1-Dichloroethene	0.000610	0.00100	0.000464	0	131	10	400	0	0	
1,1-Dichloropropene	0.000530	0.00100	0.000464	0	114	10	400	0	0	
1,2,3-Trichloropropane	0.000260	0.00100	0.000464	0	56.0	10	400	0	0	
1,2-Dibromoethane	0.000480	0.00100	0.000464	0	103	10	400	0	0	
1,2-Dichlorobenzene	0.000500	0.00100	0.000464	0	108	10	400	0	0	
1,2-Dichloroethane	0.000670	0.00100	0.000464	0	144	10	400	0	0	
1,2-Dichloropropane	0.000560	0.00100	0.000464	0	121	10	400	0	0	
1,3-Dichlorobenzene	0.000490	0.00100	0.000464	0	106	10	400	0	0	
1,3-Dichloropropane	0.000470	0.00100	0.000464	0	101	10	400	0	0	
1,4-Dichlorobenzene	0.000590	0.00100	0.000464	0	127	10	400	0	0	
2,2-Dichloropropane	0.000570	0.00100	0.000464	0	123	10	400	0	0	
2-Butanone	0.00893	0.0150	0.00928	0	96.2	10	400	0	0	
2-Chlorotoluene	0.000430	0.00100	0.000464	0	92.7	10	400	0	0	
2-Hexanone	0.00704	0.0150	0.00928	0	75.9	10	400	0	0	
4-Chlorotoluene	0.000450	0.00100	0.000464	0	97.0	10	400	0	0	
4-Methyl-2-pentanone	0.00699	0.0150	0.00928	0	75.3	10	400	0	0	
Acetone	0.00994	0.0150	0.00928	0	107	10	400	0	0	
Benzene	0.000560	0.00100	0.000464	0	121	10	400	0	0	
Bromobenzene	0.000500	0.00100	0.000464	0	108	10	400	0	0	
Bromochloromethane	0.000570	0.00100	0.000464	0	123	10	400	0	0	
Bromodichloromethane	0.000520	0.00100	0.000464	0	112	10	400	0	0	

**Qualifiers:** B Analyte detected in the associated Method Blank DF Dilution Factor  
 J Analyte detected between MDL and RL MDL Method Detection Limit  
 ND Not Detected at the Method Detection Limit R RPD outside accepted control limits  
 RL Reporting Limit S Spike Recovery outside control limits  
 J Analyte detected between SDL and RL N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_231227A

Sample ID: <b>DCS-113423</b>	Batch ID: <b>113423</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>DCS</b>	Run ID: <b>GCMS7_231227A</b>	Analysis Date: <b>12/27/2023 3:06:00 PM</b>	Prep Date: <b>12/27/2023</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Bromoform	0.000420	0.00100	0.000464	0	90.5	10	400	0	0	
Bromomethane	0.00153	0.00100	0.000464	0	330	10	400	0	0	
Carbon disulfide	0.0100	0.0150	0.00928	0	108	10	400	0	0	
Carbon tetrachloride	0.000510	0.00100	0.000464	0	110	10	400	0	0	
Chlorobenzene	0.000510	0.00100	0.000464	0	110	10	400	0	0	
Chloroethane	0.000480	0.00100	0.000464	0	103	10	400	0	0	
Chloroform	0.000470	0.00100	0.000464	0	101	10	400	0	0	
Chloromethane	0.000490	0.00100	0.000464	0	106	10	400	0	0	
cis-1,2-Dichloroethene	0.000590	0.00100	0.000464	0	127	10	400	0	0	
cis-1,3-Dichloropropene	0.000480	0.00100	0.000464	0	103	10	400	0	0	
Cyclohexane	0.00995	0.0150	0.00928	0	107	10	400	0	0	N
Dibromochloromethane	0.000410	0.00100	0.000464	0	88.4	10	400	0	0	
Dibromomethane	0.000620	0.00100	0.000464	0	134	10	400	0	0	
Dichlorodifluoromethane	0.000490	0.00100	0.000464	0	106	10	400	0	0	
Ethylbenzene	0.000470	0.00100	0.000464	0	101	10	400	0	0	
Isopropylbenzene	0.000440	0.00100	0.000464	0	94.8	10	400	0	0	
m,p-Xylene	0.000840	0.00200	0.000928	0	90.5	10	400	0	0	
Methyl Acetate	0.00778	0.0150	0.00928	0	83.8	10	400	0	0	
Methyl tert-butyl ether	0.000680	0.00100	0.000464	0	147	10	400	0	0	
Methylcyclohexane	0.00987	0.0150	0.00928	0	106	10	400	0	0	
n-Butylbenzene	0.000200	0.00100	0.000464	0	43.1	10	400	0	0	
n-Propylbenzene	0.000460	0.00100	0.000464	0	99.1	10	400	0	0	
o-Xylene	0.000450	0.00100	0.000464	0	97.0	10	400	0	0	
p-Isopropyltoluene	0.000460	0.00100	0.000464	0	99.1	10	400	0	0	
sec-Butylbenzene	0.000510	0.00100	0.000464	0	110	10	400	0	0	
Styrene	0.000380	0.00100	0.000464	0	81.9	10	400	0	0	
tert-Butylbenzene	0.000500	0.00100	0.000464	0	108	10	400	0	0	
Tetrachloroethene	0.000450	0.00200	0.000464	0	97.0	10	400	0	0	
Toluene	0.000560	0.00200	0.000464	0	121	10	400	0	0	
trans-1,2-Dichloroethene	0.000540	0.00100	0.000464	0	116	10	400	0	0	
trans-1,3-Dichloropropene	0.000490	0.00100	0.000464	0	106	10	400	0	0	
Trichloroethene	0.000540	0.00100	0.000464	0	116	10	400	0	0	
Trichlorofluoromethane	0.000510	0.00100	0.000464	0	110	10	400	0	0	
Vinyl chloride	0.000550	0.00100	0.000464	0	119	10	400	0	0	
Xylenes, Total	0.00129	0.00100	0.00139	0	92.7	10	400	0	0	

**Qualifiers:** B Analyte detected in the associated Method Blank  
 J Analyte detected between MDL and RL  
 ND Not Detected at the Method Detection Limit  
 RL Reporting Limit  
 J Analyte detected between SDL and RL

DF Dilution Factor  
 MDL Method Detection Limit  
 R RPD outside accepted control limits  
 S Spike Recovery outside control limits  
 N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_240221A

The QC data in batch 114106 applies to the following samples: 2402269-05A, 2402269-10A

Sample ID: <b>LCS-114106</b>	Batch ID: <b>114106</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>LCS</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 10:06:00 AM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	0.0268	0.00100	0.0232	0	115	81	129			
1,1,1-Trichloroethane	0.0237	0.00100	0.0232	0	102	67	132			
1,1,2,2-Tetrachloroethane	0.0257	0.00100	0.0232	0	111	63	128			
1,1,2-Trichloroethane	0.0241	0.00100	0.0232	0	104	75	125			
1,1,2-Trichlorotrifluoroethane	0.0167	0.0150	0.0232	0	72.1	67	125			
1,1-Dichloroethane	0.0215	0.00100	0.0232	0	92.8	69	133			
1,1-Dichloroethene	0.0204	0.00100	0.0232	0	88.0	68	130			
1,1-Dichloropropene	0.0216	0.00100	0.0232	0	93.1	73	132			
1,2,3-Trichlorobenzene	0.0341	0.00500	0.0232	0	147	67	137			S
1,2,3-Trichloropropane	0.0268	0.00100	0.0232	0	116	73	124			
1,2,4-Trichlorobenzene	0.0318	0.00500	0.0232	0	137	66	134			S
1,2,4-Trimethylbenzene	0.0258	0.00500	0.0232	0	111	74	132			
1,2-Dibromo-3-chloropropane	0.0257	0.0100	0.0232	0	111	50	132			
1,2-Dibromoethane	0.0264	0.00100	0.0232	0	114	80	121			
1,2-Dichlorobenzene	0.0274	0.00100	0.0232	0	118	75	122			
1,2-Dichloroethane	0.0231	0.00100	0.0232	0	99.7	69	132			
1,2-Dichloropropane	0.0217	0.00100	0.0232	0	93.5	75	125			
1,3,5-Trimethylbenzene	0.0257	0.00500	0.0232	0	111	74	131			
1,3-Dichlorobenzene	0.0271	0.00100	0.0232	0	117	75	124			
1,3-Dichloropropane	0.0251	0.00100	0.0232	0	108	73	126			
1,4-Dichlorobenzene	0.0267	0.00100	0.0232	0	115	74	123			
1-Chlorohexane	0.0206	0.00500	0.0232	0	88.7	70	125			
2,2-Dichloropropane	0.0236	0.00100	0.0232	0	102	69	137			
2-Butanone	0.115	0.0150	0.116	0	99.2	49	136			
2-Chlorotoluene	0.0249	0.00100	0.0232	0	107	73	126			
2-Hexanone	0.119	0.0150	0.116	0	102	50	150			
4-Chlorotoluene	0.0249	0.00100	0.0232	0	107	74	128			
4-Methyl-2-pentanone	0.124	0.0150	0.116	0	107	60	134			
Acetone	0.104	0.0150	0.116	0	89.8	40	135			
Benzene	0.0221	0.00100	0.0232	0	95.1	81	122			
Bromobenzene	0.0270	0.00100	0.0232	0	116	76	124			
Bromochloromethane	0.0246	0.00100	0.0232	0	106	65	129			
Bromodichloromethane	0.0235	0.00100	0.0232	0	101	76	121			
Bromoform	0.0282	0.00100	0.0232	0	122	69	128			
Bromomethane	0.0222	0.00100	0.0232	0	95.8	53	141			
Carbon disulfide	0.0218	0.0150	0.0232	0	93.8	50	150			
Carbon tetrachloride	0.0244	0.00100	0.0232	0	105	66	138			
Chlorobenzene	0.0260	0.00100	0.0232	0	112	81	122			
Chloroethane	0.0230	0.00100	0.0232	0	99.2	58	133			
Chloroform	0.0230	0.00100	0.0232	0	99.2	69	128			

<b>Qualifiers:</b>	B	Analyte detected in the associated Method Blank	DF	Dilution Factor
	J	Analyte detected between MDL and RL	MDL	Method Detection Limit
	ND	Not Detected at the Method Detection Limit	R	RPD outside accepted control limits
	RL	Reporting Limit	S	Spike Recovery outside control limits
	J	Analyte detected between SDL and RL	N	Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_240221A

Sample ID: <b>LCS-114106</b>	Batch ID: <b>114106</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>LCS</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 10:06:00 AM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Chloromethane	0.0215	0.00100	0.0232	0	92.6	56	131			
cis-1,2-Dichloroethene	0.0227	0.00100	0.0232	0	97.8	72	126			
cis-1,3-Dichloropropene	0.0228	0.00100	0.0232	0	98.2	69	131			
Cyclohexane	0.0178	0.0150	0.0232	0	76.8	40	161			N
Dibromochloromethane	0.0271	0.00100	0.0232	0	117	66	133			
Dibromomethane	0.0237	0.00100	0.0232	0	102	76	125			
Dichlorodifluoromethane	0.0253	0.00100	0.0232	0	109	53	153			
Ethylbenzene	0.0260	0.00100	0.0232	0	112	80	120			
Hexachlorobutadiene	0.0316	0.00300	0.0232	0	136	67	131			S
Isopropylbenzene	0.0265	0.00100	0.0232	0	114	75	127			
m,p-Xylene	0.0527	0.00200	0.0464	0	113	80	120			
Methyl Acetate	0.0210	0.0150	0.0232	0	90.4	50	150			
Methyl tert-butyl ether	0.0221	0.00100	0.0232	0	95.2	68	123			
Methylcyclohexane	0.0182	0.0150	0.0232	0	78.3	70	130			
Methylene chloride	0.0209	0.00250	0.0232	0	90.0	63	137			
Naphthalene	0.0296	0.0150	0.0232	0	128	54	138			
n-Butylbenzene	0.0266	0.00100	0.0232	0	115	69	137			
n-Propylbenzene	0.0254	0.00100	0.0232	0	109	72	129			
o-Xylene	0.0259	0.00100	0.0232	0	112	80	120			
p-Isopropyltoluene	0.0268	0.00100	0.0232	0	115	73	130			
sec-Butylbenzene	0.0257	0.00100	0.0232	0	111	72	127			
Styrene	0.0264	0.00100	0.0232	0	114	65	134			
tert-Butylbenzene	0.0264	0.00100	0.0232	0	114	70	129			
Tetrachloroethene	0.0270	0.00200	0.0232	0	116	66	128			
Toluene	0.0229	0.00200	0.0232	0	98.6	80	120			
trans-1,2-Dichloroethene	0.0219	0.00100	0.0232	0	94.5	63	137			
trans-1,3-Dichloropropene	0.0240	0.00100	0.0232	0	104	59	135			
Trichloroethene	0.0241	0.00100	0.0232	0	104	70	127			
Trichlorofluoromethane	0.0258	0.00100	0.0232	0	111	57	129			
Vinyl chloride	0.0227	0.00100	0.0232	0	97.8	50	134			
Xylenes, Total	0.0786	0.00100	0.0696	0	113	80	120			
Surr: 1,2-Dichloroethane-d4	183		200.0		91.4	72	119			
Surr: 4-Bromofluorobenzene	190		200.0		94.9	76	119			
Surr: Dibromofluoromethane	191		200.0		95.4	85	115			
Surr: Toluene-d8	197		200.0		98.7	81	120			

Sample ID: <b>MB-114106</b>	Batch ID: <b>114106</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 11:07:00 AM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	<0.000300	0.00100								

- Qualifiers:**
- B Analyte detected in the associated Method Blank
  - J Analyte detected between MDL and RL
  - ND Not Detected at the Method Detection Limit
  - RL Reporting Limit
  - J Analyte detected between SDL and RL
  - DF Dilution Factor
  - MDL Method Detection Limit
  - R RPD outside accepted control limits
  - S Spike Recovery outside control limits
  - N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_240221A

Sample ID: <b>MB-114106</b>	Batch ID: <b>114106</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 11:07:00 AM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1-Trichloroethane	<0.000300	0.00100								
1,1,2,2-Tetrachloroethane	<0.000300	0.00100								
1,1,2-Trichloroethane	<0.000300	0.00100								
1,1,2-Trichlorotrifluoroethane	<0.00500	0.0150								
1,1-Dichloroethane	<0.000300	0.00100								
1,1-Dichloroethene	<0.000300	0.00100								
1,1-Dichloropropene	<0.000300	0.00100								
1,2,3-Trichlorobenzene	<0.00150	0.00500								
1,2,3-Trichloropropane	<0.000300	0.00100								
1,2,4-Trichlorobenzene	<0.00150	0.00500								
1,2,4-Trimethylbenzene	<0.00150	0.00500								
1,2-Dibromo-3-chloropropane	<0.00300	0.0100								
1,2-Dibromoethane	<0.000300	0.00100								
1,2-Dichlorobenzene	<0.000300	0.00100								
1,2-Dichloroethane	<0.000300	0.00100								
1,2-Dichloropropane	<0.000300	0.00100								
1,3,5-Trimethylbenzene	<0.00150	0.00500								
1,3-Dichlorobenzene	<0.000300	0.00100								
1,3-Dichloropropane	<0.000300	0.00100								
1,4-Dichlorobenzene	<0.000300	0.00100								
1-Chlorohexane	<0.00100	0.00500								
2,2-Dichloropropane	<0.000300	0.00100								
2-Butanone	<0.00500	0.0150								
2-Chlorotoluene	<0.000300	0.00100								
2-Hexanone	<0.00500	0.0150								
4-Chlorotoluene	<0.000300	0.00100								
4-Methyl-2-pentanone	<0.00500	0.0150								
Acetone	<0.00500	0.0150								
Benzene	<0.000300	0.00100								
Bromobenzene	<0.000300	0.00100								
Bromochloromethane	<0.000300	0.00100								
Bromodichloromethane	<0.000300	0.00100								
Bromoform	<0.000300	0.00100								
Bromomethane	<0.000300	0.00100								
Carbon disulfide	<0.00500	0.0150								
Carbon tetrachloride	<0.000300	0.00100								
Chlorobenzene	<0.000300	0.00100								
Chloroethane	<0.000300	0.00100								
Chloroform	<0.000300	0.00100								
Chloromethane	<0.000300	0.00100								
cis-1,2-Dichloroethene	<0.000300	0.00100								

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_240221A

Sample ID: <b>MB-114106</b>	Batch ID: <b>114106</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>MBLK</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 11:07:00 AM</b>	Prep Date: <b>2/21/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
cis-1,3-Dichloropropene	<0.000300	0.00100								
Cyclohexane	<0.00500	0.0150								N
Dibromochloromethane	<0.000300	0.00100								
Dibromomethane	<0.000300	0.00100								
Dichlorodifluoromethane	<0.000300	0.00100								
Ethylbenzene	<0.000300	0.00100								
Hexachlorobutadiene	<0.00100	0.00300								
Isopropylbenzene	<0.000300	0.00100								
m,p-Xylene	<0.000600	0.00200								
Methyl Acetate	<0.00500	0.0150								
Methyl tert-butyl ether	<0.000300	0.00100								
Methylcyclohexane	<0.00500	0.0150								
Methylene chloride	<0.00250	0.00250								
Naphthalene	<0.00500	0.0150								
n-Butylbenzene	<0.000300	0.00100								
n-Propylbenzene	<0.000300	0.00100								
o-Xylene	<0.000300	0.00100								
p-Isopropyltoluene	<0.000300	0.00100								
sec-Butylbenzene	<0.000300	0.00100								
Styrene	<0.000300	0.00100								
tert-Butylbenzene	<0.000300	0.00100								
Tetrachloroethene	<0.000600	0.00200								
Toluene	<0.000600	0.00200								
trans-1,2-Dichloroethene	<0.000300	0.00100								
trans-1,3-Dichloropropene	<0.000300	0.00100								
Trichloroethene	<0.000600	0.00100								
Trichlorofluoromethane	<0.000300	0.00100								
Vinyl chloride	<0.000300	0.00100								
Xylenes, Total	<0.000300	0.00100								
Surr: 1,2-Dichloroethane-d4	184		200.0		91.9	72	119			
Surr: 4-Bromofluorobenzene	192		200.0		95.8	76	119			
Surr: Dibromofluoromethane	188		200.0		94.1	85	115			
Surr: Toluene-d8	198		200.0		98.9	81	120			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_240221A

Sample ID: <b>ICV-240221</b>	Batch ID: <b>R131522</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>ICV</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 9:42:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
1,1,1,2-Tetrachloroethane	0.0470	0.00100	0.0464	0	101	70	130			
1,1,1-Trichloroethane	0.0424	0.00100	0.0464	0	91.4	70	130			
1,1,2,2-Tetrachloroethane	0.0443	0.00100	0.0464	0	95.5	70	130			
1,1,2-Trichloroethane	0.0423	0.00100	0.0464	0	91.3	70	130			
1,1,2-Trichlorotrifluoroethane	0.0378	0.0150	0.0464	0	81.4	70	130			
1,1-Dichloroethane	0.0387	0.00100	0.0464	0	83.4	70	130			
1,1-Dichloroethene	0.0378	0.00100	0.0464	0	81.4	70	130			
1,1-Dichloropropene	0.0404	0.00100	0.0464	0	87.1	70	130			
1,2,3-Trichlorobenzene	0.0562	0.00500	0.0464	0	121	70	130			
1,2,3-Trichloropropane	0.0463	0.00100	0.0464	0	99.8	70	130			
1,2,4-Trichlorobenzene	0.0564	0.00500	0.0464	0	121	70	130			
1,2,4-Trimethylbenzene	0.0466	0.00500	0.0464	0	100	70	130			
1,2-Dibromo-3-chloropropane	0.0436	0.0100	0.0464	0	93.9	70	130			
1,2-Dibromoethane	0.0461	0.00100	0.0464	0	99.3	70	130			
1,2-Dichlorobenzene	0.0482	0.00100	0.0464	0	104	70	130			
1,2-Dichloroethane	0.0411	0.00100	0.0464	0	88.6	70	130			
1,2-Dichloropropane	0.0392	0.00100	0.0464	0	84.4	70	130			
1,3,5-Trimethylbenzene	0.0465	0.00500	0.0464	0	100	70	130			
1,3-Dichlorobenzene	0.0488	0.00100	0.0464	0	105	70	130			
1,3-Dichloropropane	0.0434	0.00100	0.0464	0	93.5	70	130			
1,4-Dichlorobenzene	0.0471	0.00100	0.0464	0	101	70	130			
1-Chlorohexane	0.0370	0.00500	0.0464	0	79.7	70	130			
2,2-Dichloropropane	0.0425	0.00100	0.0464	0	91.6	70	130			
2-Butanone	0.216	0.0150	0.232	0	93.3	70	130			
2-Chlorotoluene	0.0450	0.00100	0.0464	0	97.1	70	130			
2-Hexanone	0.217	0.0150	0.232	0	93.6	70	130			
4-Chlorotoluene	0.0449	0.00100	0.0464	0	96.9	70	130			
4-Methyl-2-pentanone	0.227	0.0150	0.232	0	97.9	70	130			
Acetone	0.194	0.0150	0.232	0	83.7	70	130			
Benzene	0.0399	0.00100	0.0464	0	86.0	70	130			
Bromobenzene	0.0478	0.00100	0.0464	0	103	70	130			
Bromochloromethane	0.0429	0.00100	0.0464	0	92.5	70	130			
Bromodichloromethane	0.0426	0.00100	0.0464	0	91.7	70	130			
Bromoform	0.0495	0.00100	0.0464	0	107	70	130			
Bromomethane	0.0401	0.00100	0.0464	0	86.3	70	130			
Carbon disulfide	0.0301	0.0150	0.0464	0	64.9	70	130			S
Carbon tetrachloride	0.0441	0.00100	0.0464	0	95.0	70	130			
Chlorobenzene	0.0461	0.00100	0.0464	0	99.3	70	130			
Chloroethane	0.0412	0.00100	0.0464	0	88.7	70	130			
Chloroform	0.0413	0.00100	0.0464	0	89.1	70	130			
Chloromethane	0.0397	0.00100	0.0464	0	85.6	70	130			

**Qualifiers:**  
 B Analyte detected in the associated Method Blank  
 J Analyte detected between MDL and RL  
 ND Not Detected at the Method Detection Limit  
 RL Reporting Limit  
 J Analyte detected between SDL and RL

DF Dilution Factor  
 MDL Method Detection Limit  
 R RPD outside accepted control limits  
 S Spike Recovery outside control limits  
 N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402269

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: GCMS7\_240221A

Sample ID: <b>ICV-240221</b>	Batch ID: <b>R131522</b>	TestNo: <b>SW8260D</b>	Units: <b>mg/L</b>
SampType: <b>ICV</b>	Run ID: <b>GCMS7_240221A</b>	Analysis Date: <b>2/21/2024 9:42:00 AM</b>	Prep Date:

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
cis-1,2-Dichloroethene	0.0411	0.00100	0.0464	0	88.5	70	130			
cis-1,3-Dichloropropene	0.0413	0.00100	0.0464	0	88.9	70	130			
Cyclohexane	0.0378	0.0150	0.0464	0	81.5	70	130			N
Dibromochloromethane	0.0476	0.00100	0.0464	0	103	70	130			
Dibromomethane	0.0416	0.00100	0.0464	0	89.7	70	130			
Dichlorodifluoromethane	0.0466	0.00100	0.0464	0	100	70	130			
Ethylbenzene	0.0465	0.00100	0.0464	0	100	70	130			
Hexachlorobutadiene	0.0578	0.00300	0.0464	0	125	70	130			
Isopropylbenzene	0.0467	0.00100	0.0464	0	101	70	130			
m,p-Xylene	0.0941	0.00200	0.0928	0	101	70	130			
Methyl Acetate	0.0421	0.0150	0.0464	0	90.7	70	130			
Methyl tert-butyl ether	0.0384	0.00100	0.0464	0	82.8	70	130			
Methylcyclohexane	0.0376	0.0150	0.0464	0	80.9	70	130			
Methylene chloride	0.0374	0.00250	0.0464	0	80.5	70	130			
Naphthalene	0.0491	0.0150	0.0464	0	106	70	130			
n-Butylbenzene	0.0494	0.00100	0.0464	0	107	70	130			
n-Propylbenzene	0.0458	0.00100	0.0464	0	98.7	70	130			
o-Xylene	0.0462	0.00100	0.0464	0	99.6	70	130			
p-Isopropyltoluene	0.0484	0.00100	0.0464	0	104	70	130			
sec-Butylbenzene	0.0469	0.00100	0.0464	0	101	70	130			
Styrene	0.0470	0.00100	0.0464	0	101	70	130			
tert-Butylbenzene	0.0468	0.00100	0.0464	0	101	70	130			
Tetrachloroethene	0.0486	0.00200	0.0464	0	105	70	130			
Toluene	0.0415	0.00200	0.0464	0	89.5	70	130			
trans-1,2-Dichloroethene	0.0402	0.00100	0.0464	0	86.7	70	130			
trans-1,3-Dichloropropene	0.0424	0.00100	0.0464	0	91.3	70	130			
Trichloroethene	0.0435	0.00100	0.0464	0	93.8	70	130			
Trichlorofluoromethane	0.0477	0.00100	0.0464	0	103	70	130			
Vinyl chloride	0.0418	0.00100	0.0464	0	90.0	70	130			
Xylenes, Total	0.140	0.00100	0.139	0	101	70	130			
Surr: 1,2-Dichloroethane-d4	182		200.0		91.1	72	119			
Surr: 4-Bromofluorobenzene	191		200.0		95.3	76	119			
Surr: Dibromofluoromethane	190		200.0		94.8	85	115			
Surr: Toluene-d8	195		200.0		97.4	81	120			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2402269  
**Project:** SAWS Impoundment Assessment Lagoons and

**MQL SUMMARY REPORT**

TestNo: SW6020B	MDL	ML
Analyte	mg/Kg	mg/Kg
Aluminum	12.5	37.5
Antimony	0.500	1.00
Arsenic	0.500	1.00
Barium	0.500	2.00
Beryllium	0.100	0.300
Cadmium	0.100	0.300
Calcium	12.5	37.5
Chromium	0.500	2.00
Cobalt	0.500	2.00
Copper	0.500	2.00
Iron	12.5	37.5
Lead	0.100	0.300
Magnesium	12.5	37.5
Manganese	0.500	2.00
Nickel	0.500	2.00
Potassium	12.5	37.5
Selenium	0.150	0.500
Silver	0.100	0.200
Sodium	12.5	37.5
Thallium	0.500	1.00
Vanadium	1.00	2.50
Zinc	1.00	2.50

TestNo: SW8260D	MDL	ML
Analyte	mg/L	mg/L
1,1,1,2-Tetrachloroethane	0.000300	0.00100
1,1,1-Trichloroethane	0.000300	0.00100
1,1,2,2-Tetrachloroethane	0.000300	0.00100
1,1,2-Trichloroethane	0.000300	0.00100
1,1,2-Trichlorotrifluoroethane	0.00500	0.0150
1,1-Dichloroethane	0.000300	0.00100
1,1-Dichloroethene	0.000300	0.00100
1,1-Dichloropropene	0.000300	0.00100
1,2,3-Trichlorobenzene	0.00150	0.00500
1,2,3-Trichloropropane	0.000300	0.00100
1,2,4-Trichlorobenzene	0.00150	0.00500
1,2,4-Trimethylbenzene	0.00150	0.00500
1,2-Dibromo-3-chloropropane	0.00300	0.0100
1,2-Dibromoethane	0.000300	0.00100
1,2-Dichlorobenzene	0.000300	0.00100
1,2-Dichloroethane	0.000300	0.00100
1,2-Dichloropropane	0.000300	0.00100
1,3,5-Trimethylbenzene	0.00150	0.00500
1,3-Dichlorobenzene	0.000300	0.00100
1,3-Dichloropropane	0.000300	0.00100
1,4-Dichlorobenzene	0.000300	0.00100
1-Chlorohexane	0.00100	0.00500
2,2-Dichloropropane	0.000300	0.00100
2-Butanone	0.00500	0.0150
2-Chlorotoluene	0.000300	0.00100
2-Hexanone	0.00500	0.0150
4-Chlorotoluene	0.000300	0.00100
4-Methyl-2-pentanone	0.00500	0.0150
Acetone	0.00500	0.0150
Benzene	0.000300	0.00100
Bromobenzene	0.000300	0.00100
Bromochloromethane	0.000300	0.00100
Bromodichloromethane	0.000300	0.00100
Bromoform	0.000300	0.00100
Bromomethane	0.000300	0.00100
Carbon disulfide	0.00500	0.0150
Carbon tetrachloride	0.000300	0.00100
Chlorobenzene	0.000300	0.00100
Chloroethane	0.000300	0.00100
Chloroform	0.000300	0.00100
Chloromethane	0.000300	0.00100
cis-1,2-Dichloroethene	0.000300	0.00100
cis-1,3-Dichloropropene	0.000300	0.00100
Cyclohexane	0.00500	0.0150

**Qualifiers:** MQL -Method Quantitation Limit as defined by TRRP  
 MDL -Method Detection Limit as defined by TRRP

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2402269  
**Project:** SAWS Impoundment Assessment Lagoons and

## MQL SUMMARY REPORT

Analyte	0.000300	0.00100	TestNo: SW8260D	MDL	MQL
Analyte			Analyte	mg/Kg	mg/Kg
Dibromochloromethane	0.000300	0.00100	1,1,1,2-Tetrachloroethane	0.00100	0.00500
Dibromomethane	0.000300	0.00100	1,1,1-Trichloroethane	0.00100	0.00500
Dichlorodifluoromethane	0.000300	0.00100	1,1,2,2-Tetrachloroethane	0.00100	0.00500
Ethylbenzene	0.000300	0.00100	1,1,2-Trichloroethane	0.00100	0.00500
Hexachlorobutadiene	0.00100	0.00300	1,1,2-Trichlorotrifluoroethane	0.00500	0.0150
Isopropylbenzene	0.000300	0.00100	1,1-Dichloroethane	0.00100	0.00500
m,p-Xylene	0.000600	0.00200	1,1-Dichloroethene	0.00100	0.00500
Methyl Acetate	0.00500	0.0150	1,1-Dichloropropene	0.00100	0.00500
Methyl tert-butyl ether	0.000300	0.00100	1,2,3-Trichlorobenzene	0.00100	0.00500
Methylcyclohexane	0.00500	0.0150	1,2,3-Trichloropropane	0.00100	0.00500
Methylene chloride	0.00250	0.00250	1,2,4-Trichlorobenzene	0.00100	0.00500
Naphthalene	0.00500	0.0150	1,2,4-Trimethylbenzene	0.00100	0.00500
n-Butylbenzene	0.000300	0.00100	1,2-Dibromo-3-chloropropane	0.00100	0.00500
n-Propylbenzene	0.000300	0.00100	1,2-Dibromoethane	0.00100	0.00500
o-Xylene	0.000300	0.00100	1,2-Dichlorobenzene	0.00100	0.00500
p-Isopropyltoluene	0.000300	0.00100	1,2-Dichloroethane	0.00100	0.00500
sec-Butylbenzene	0.000300	0.00100	1,2-Dichloropropane	0.00100	0.00500
Styrene	0.000300	0.00100	1,3,5-Trimethylbenzene	0.00100	0.00500
tert-Butylbenzene	0.000300	0.00100	1,3-Dichlorobenzene	0.00100	0.00500
Tetrachloroethene	0.000600	0.00200	1,3-Dichloropropane	0.00100	0.00500
Toluene	0.000600	0.00200	1,4-Dichlorobenzene	0.00100	0.00500
trans-1,2-Dichloroethene	0.000300	0.00100	1-Chlorohexane	0.00100	0.00500
trans-1,3-Dichloropropene	0.000300	0.00100	2,2-Dichloropropane	0.00100	0.00500
Trichloroethene	0.000600	0.00100	2-Butanone	0.00500	0.0150
Trichlorofluoromethane	0.000300	0.00100	2-Chlorotoluene	0.00100	0.00500
Vinyl chloride	0.000300	0.00100	2-Hexanone	0.00500	0.0150
Total Xylenes	0.000300	0.00100	4-Chlorotoluene	0.00100	0.00500
			4-Methyl-2-pentanone	0.00500	0.0150
			Acetone	0.0150	0.0500
			Benzene	0.00100	0.00500
			Bromobenzene	0.00100	0.00500
			Bromochloromethane	0.00100	0.00500
			Bromodichloromethane	0.00100	0.00500
			Bromoform	0.00100	0.00500
			Bromomethane	0.00100	0.00500
			Carbon disulfide	0.00500	0.0150
			Carbon tetrachloride	0.00100	0.00500
			Chlorobenzene	0.00100	0.00500
			Chloroethane	0.00100	0.00500
			Chloroform	0.00100	0.00500
			Chloromethane	0.00100	0.00500
			cis-1,2-Dichloroethene	0.00100	0.00500
			cis-1,3-Dichloropropene	0.00100	0.00500
			Cyclohexane	0.00500	0.0150
			Dibromochloromethane	0.00100	0.00500
			Dibromomethane	0.00100	0.00500

**Qualifiers:** MQL -Method Quantitation Limit as defined by TRRP  
MDL -Method Detection Limit as defined by TRRP

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2402269  
**Project:** SAWS Impoundment Assessment Lagoons and

## MQL SUMMARY REPORT

			<b>TestNo: SW8270E</b>	<b>MDL</b>	<b>MLL</b>
			<b>Analyte</b>	<b>mg/Kg</b>	<b>mg/Kg</b>
Dichlorodifluoromethane	0.00100	0.00500			
Ethylbenzene	0.00100	0.00500			
Hexachlorobutadiene	0.00100	0.00500			
Isopropylbenzene	0.00100	0.00500			
m,p-Xylene	0.00100	0.00500			
Methyl Acetate	0.00500	0.0150			
Methyl tert-butyl ether	0.00100	0.00500			
Methylcyclohexane	0.00500	0.0150			
Methylene chloride	0.00500	0.00500			
Naphthalene	0.00500	0.0150			
n-Butylbenzene	0.00100	0.00500			
n-Propylbenzene	0.00100	0.00500			
o-Xylene	0.00100	0.00500			
p-Isopropyltoluene	0.00100	0.00500			
sec-Butylbenzene	0.00100	0.00500			
Styrene	0.00100	0.00500			
tert-Butylbenzene	0.00100	0.00500			
Tetrachloroethene	0.00100	0.00500			
Toluene	0.00100	0.00500			
trans-1,2-Dichloroethene	0.00100	0.00500			
trans-1,3-Dichloropropene	0.00100	0.00500			
Trichloroethene	0.00100	0.00500			
Trichlorofluoromethane	0.00500	0.0150			
Vinyl chloride	0.00100	0.00500			
Xylenes, Total	0.00100	0.00500			
			2,4,5-Trichlorophenol	0.0100	0.0266
			2,4,6-Trichlorophenol	0.0100	0.0266
			2,4-Dichlorophenol	0.0100	0.0266
			2,4-Dimethylphenol	0.0100	0.0266
			2,4-Dinitrophenol	0.0500	0.132
			2,4-Dinitrotoluene	0.0100	0.0266
			2,6-Dinitrotoluene	0.0100	0.0266
			2-Chloronaphthalene	0.0100	0.0266
			2-Chlorophenol	0.0100	0.0266
			2-Methylnaphthalene	0.0100	0.0266
			2-Methylphenol	0.0100	0.0266
			2-Nitroaniline	0.0100	0.0266
			2-Nitrophenol	0.0100	0.0266
			3,3'-Dichlorobenzidine	0.0100	0.0266
			3-Nitroaniline	0.0100	0.0266
			4,6-Dinitro-2-methylphenol	0.0300	0.0660
			4-Bromophenyl phenyl ether	0.0100	0.0266
			4-Chloro-3-methylphenol	0.0100	0.0266
			4-Chloroaniline	0.0300	0.0660
			4-Chlorophenyl phenyl ether	0.0100	0.0266
			4-Methylphenol	0.0200	0.0266
			4-Nitroaniline	0.0100	0.0266
			4-Nitrophenol	0.0500	0.132
			Acenaphthene	0.0100	0.0266
			Acenaphthylene	0.0100	0.0266
			Acetophenone	0.0100	0.0266
			Anthracene	0.0100	0.0266
			Atrazine	0.0100	0.0266
			Benzaldehyde	0.0100	0.0266
			Benzo[a]anthracene	0.0100	0.0266
			Benzo[a]pyrene	0.0100	0.0266
			Benzo[b]fluoranthene	0.0100	0.0266
			Benzo[g,h,i]perylene	0.0100	0.0266
			Benzo[k]fluoranthene	0.0100	0.0266
			Benzoic acid	0.0500	0.132
			Benzyl alcohol	0.0300	0.0660
			Biphenyl	0.0100	0.0266
			Bis(2-chloroethoxy)methane	0.0100	0.0266
			Bis(2-chloroethyl)ether	0.0100	0.0266
			Bis(2-chloroisopropyl)ether	0.0100	0.0266
			Bis(2-ethylhexyl)phthalate	0.0640	0.0660
			Butyl benzyl phthalate	0.0400	0.0660
			Caprolactam	0.0300	0.0660
			Carbazole	0.0100	0.0266
			Chrysene	0.0100	0.0266
			Dibenz[a,h]anthracene	0.0100	0.0266

**Qualifiers:** MQL -Method Quantitation Limit as defined by TRRP  
MDL -Method Detection Limit as defined by TRRP

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2402269  
**Project:** SAWS Impoundment Assessment Lagoons and

## MQL SUMMARY REPORT

Dibenzofuran	0.0100	0.0266
Diethyl phthalate	0.0400	0.0660
Dimethyl phthalate	0.0400	0.0660
Di-n-butyl phthalate	0.0400	0.0660
Di-n-octyl phthalate	0.0400	0.0660
Fluoranthene	0.0100	0.0266
Fluorene	0.0100	0.0266
Hexachlorobenzene	0.0100	0.0266
Hexachlorobutadiene	0.0100	0.0266
Hexachlorocyclopentadiene	0.0300	0.0660
Hexachloroethane	0.0100	0.0266
Indeno[1,2,3-cd]pyrene	0.0100	0.0266
Isophorone	0.0300	0.0660
Naphthalene	0.0100	0.0266
Nitrobenzene	0.0100	0.0266
N-Nitrosodi-n-propylamine	0.0100	0.0266
N-Nitrosodiphenylamine	0.0100	0.0266
Pentachlorophenol	0.0100	0.0266
Phenanthrene	0.0100	0.0266
Phenol	0.0100	0.0266
Pyrene	0.0100	0.0266
Pyridine	0.0500	0.132

<b>TestNo:</b> SW7471B	<b>MDL</b>	<b>MQL</b>
<b>Analyte</b>	<b>mg/Kg</b>	<b>mg/Kg</b>
Mercury	0.0160	0.0400

**Qualifiers:** MQL -Method Quantitation Limit as defined by TRRP  
 MDL -Method Detection Limit as defined by TRRP



March 08, 2024

Armin Sabet  
Weston Solutions, Inc.  
2600 Dallas Parkway, Suite 280  
Frisco, Texas 75034  
TEL: (310) 980-6300

FAX:

Order No.: 2402409

RE: SAWS Impoundment Assessment Lagoons and Decant Sam

Dear Armin Sabet:

DHL Analytical, Inc. received 1 sample(s) on 2/29/2024 for the analyses presented in the following report.

There were no problems with the analyses and all data met requirements of NELAP except where noted in the Case Narrative. All non-NELAP methods will be identified accordingly in the case narrative and all estimated uncertainties of test results are within method or EPA specifications.

If you have any questions regarding these tests results, please feel free to call. Thank you for using DHL Analytical.

Sincerely,

A handwritten signature in red ink, appearing to read 'John DuPont'.

John DuPont  
General Manager

This report was performed under the accreditation of the State of Texas Laboratory Certification  
Number: T104704211-23-29



# Table of Contents

<b>Miscellaneous Documents</b> .....	<b>3</b>
<b>CaseNarrative 2402409</b> .....	<b>8</b>
<b>WorkOrderSampleSummary 2402409</b> .....	<b>9</b>
<b>PrepDatesReport 2402409</b> .....	<b>10</b>
<b>TCLP Dates Report 2402409</b> .....	<b>11</b>
<b>AnalyticalDatesReport 2402409</b> .....	<b>12</b>
<b>Analytical Report 2402409</b> .....	<b>13</b>
<b>AnalyticalQCSummaryReport 2402409</b> .....	<b>14</b>
<b>MQLSummaryReport 2402409</b> .....	<b>18</b>



Sample Receipt Checklist

Client Name: Weston Solutions, Inc.

Date Received: 2/29/2024

Work Order Number: 2402409

Received by: KAO

Checklist completed by: [Signature] 3/1/2024
Signature Date

Reviewed by: [Initials] 3/1/2024
Initials Date

Carrier name: FedEx 1day

- Shipping container/cooler in good condition? Yes [checked] No [ ] Not Present [ ]
Custody seals intact on shipping container/cooler? Yes [checked] No [ ] Not Present [ ]
Custody seals intact on sample bottles? Yes [ ] No [ ] Not Present [checked]
Chain of custody present? Yes [checked] No [ ]
Chain of custody signed when relinquished and received? Yes [checked] No [ ]
Chain of custody agrees with sample labels? Yes [checked] No [ ]
Samples in proper container/bottle? Yes [checked] No [ ]
Sample containers intact? Yes [checked] No [ ]
Sufficient sample volume for indicated test? Yes [checked] No [ ]
All samples received within holding time? Yes [checked] No [ ]
Water - VOA vials have zero headspace? Yes [ ] No [ ] No VOA vials submitted [checked] NA [ ]
Water - pH<2 acceptable upon receipt? Yes [ ] No [ ] NA [checked] LOT #
Adjusted? \_\_\_\_\_ Checked by \_\_\_\_\_
Water - pH>9 (S) or pH>10 (CN) acceptable upon receipt? Yes [ ] No [ ] NA [checked] LOT #
Adjusted? \_\_\_\_\_ Checked by \_\_\_\_\_
Container/Temp Blank temperature in compliance? Yes [checked] No [ ]

Cooler # 1
Temp °C 0.7
Seal Intact Y

Any No response must be detailed in the comments section below.

Client contacted: \_\_\_\_\_ Date contacted: \_\_\_\_\_ Person contacted: \_\_\_\_\_

Contacted by: \_\_\_\_\_ Regarding: \_\_\_\_\_

Comments: \_\_\_\_\_

Corrective Action: \_\_\_\_\_

<b>Laboratory Name: DHL Analytical, Inc.</b>							
<b>Laboratory Review Checklist: Reportable Data</b>							
<b>Project Name:</b> SAWS Impoundment Assess Lagoons & Decant Samp				<b>LRC Date:</b> 3/8/2024			
<b>Reviewer Name:</b> Angie O'Donnell				<b>Laboratory Work Order:</b> 2402409			
<b>Prep Batch Number(s):</b> See Prep Dates Report				<b>Run Batch:</b> See Analytical Dates Report			
# <sup>1</sup>	A <sup>2</sup>	Description	Yes	No	NA <sup>3</sup>	NR <sup>4</sup>	ER# <sup>5</sup>
		<b>Chain-of-Custody (C-O-C)</b>					
R1	OI	1) Did samples meet the laboratory's standard conditions of sample acceptability upon receipt?	X				R1-01
		2) Were all departures from standard conditions described in an exception report?	X				
R2	OI	<b>Sample and Quality Control (QC) Identification</b>					
		1) Are all field sample ID numbers cross-referenced to the laboratory ID numbers?	X				
		2) Are all laboratory ID numbers cross-referenced to the corresponding QC data?	X				
R3	OI	<b>Test Reports</b>					
		1) Were all samples prepared and analyzed within holding times?	X				
		2) Other than those results < MQL, were all other raw values bracketed by calibration standards?	X				
		3) Were calculations checked by a peer or supervisor?	X				
		4) Were all analyte identifications checked by a peer or supervisor?	X				
		5) Were sample detection limits reported for all analytes not detected?	X				
		6) Were all results for soil and sediment samples reported on a dry weight basis?			X		
		7) Were % moisture (or solids) reported for all soil and sediment samples?			X		
		8) Were bulk soils/solids samples for volatile analysis extracted with methanol per EPA Method 5035?			X		
		9) If required for the project, TICs reported?			X		
R4	O	<b>Surrogate Recovery Data</b>					
		1) Were surrogates added prior to extraction?			X		
		2) Were surrogate percent recoveries in all samples within the laboratory QC limits?			X		
R5	OI	<b>Test Reports/Summary Forms for Blank Samples</b>					
		1) Were appropriate type(s) of blanks analyzed?	X				
		2) Were blanks analyzed at the appropriate frequency?	X				
		3) Where method blanks taken through the entire analytical process, including preparation and, if applicable, cleanup procedures?	X				
		4) Were blank concentrations < MDL?	X				
		5) For analyte(s) detected in a blank sample, was the concentration, unadjusted for sample specific factors, in all associated field samples, <b>greater</b> than 10 times the concentration in the blank sample?			X		
R6	OI	<b>Laboratory Control Samples (LCS):</b>					
		1) Were all COCs included in the LCS?	X				
		2) Was each LCS taken through the entire analytical procedure, including prep and cleanup steps?	X				
		3) Were LCSs analyzed at the required frequency?	X				
		4) Were LCS (and LCSD, if applicable) %Rs within the laboratory QC limits?	X				
		5) Does the detectability data document the laboratory's capability to detect the COCs at the MDL used to calculate the SDLs?	X				
		6) Was the LCSD RPD within QC limits (if applicable)?	X				
R7	OI	<b>Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Data</b>					
		1) Were the project/method specified analytes included in the MS and MSD?	X				
		2) Were MS/MSD analyzed at the appropriate frequency?	X				
		3) Were MS (and MSD, if applicable) %Rs within the laboratory QC limits?	X				
		4) Were MS/MSD RPDs within laboratory QC limits?	X				
R8	OI	<b>Analytical Duplicate Data</b>					
		1) Were appropriate analytical duplicates analyzed for each matrix?			X		
		2) Were analytical duplicates analyzed at the appropriate frequency?			X		
		3) Were RPDs or relative standard deviations within the laboratory QC limits?			X		
R9	OI	<b>Method Quantitation Limits (MQLs):</b>					
		1) Are the MQLs for each method analyte included in the laboratory data package?	X				
		2) Do the MQLs correspond to the concentration of the lowest non-zero calibration standard?	X				
		3) Are unadjusted MQLs and DCSs included in the laboratory data package?	X				
R10	OI	<b>Other Problems/Anomalies</b>					
		1) Are all known problems/anomalies/special conditions noted in this LRC and ER?	X				R10-01
		2) Was applicable and available technology used to lower the SDL to minimize the matrix interference affects on the sample results?	X				
		3) Is the laboratory NELAC-accredited under the Texas Laboratory Accreditation Program for the analytes, matrices and methods associated with this laboratory data package?	X				

<b>Laboratory Name: DHL Analytical, Inc.</b>							
<b>Laboratory Review Checklist (continued): Supporting Data</b>							
<b>Project Name:</b> SAWS Impoundment Assess Lagoons & Decant Samp				<b>LRC Date:</b> 3/8/2024			
<b>Reviewer Name:</b> Angie O'Donnell				<b>Laboratory Work Order:</b> 2402409			
<b>Prep Batch Number(s):</b> See Prep Dates Report				<b>Run Batch:</b> See Analytical Dates Report			
# <sup>1</sup>	A <sup>2</sup>	Description	Yes	No	NA <sup>3</sup>	NR <sup>4</sup>	ER# <sup>5</sup>
S1	OI	<b>Initial Calibration (ICAL)</b>					
		1) Were response factors and/or relative response factors for each analyte within QC limits?	X				
		2) Were percent RSDs or correlation coefficient criteria met?	X				
		3) Was the number of standards recommended in the method used for all analytes?	X				
		4) Were all points generated between the lowest and highest standard used to calculate the curve?	X				
		5) Are ICAL data available for all instruments used?	X				
		6) Has the initial calibration curve been verified using an appropriate second source standard?	X				
S2	OI	<b>Initial and Continuing calibration Verification (ICCV and CCV) and Continuing Calibration blank (CCB):</b>					
		1) Was the CCV analyzed at the method-required frequency?	X				
		2) Were percent differences for each analyte within the method-required QC limits?	X				
		3) Was the ICAL curve verified for each analyte?	X				
		4) Was the absolute value of the analyte concentration in the inorganic CCB < MDL?	X				
S3	O	<b>Mass Spectral Tuning:</b>					
		1) Was the appropriate compound for the method used for tuning?	X				
		2) Were ion abundance data within the method-required QC limits?	X				
S4	O	<b>Internal Standards (IS):</b>					
		1) Were IS area counts and retention times within the method-required QC limits?	X				
S5	OI	<b>Raw Data (NELAC Section 5.5.10)</b>					
		1) Were the raw data (for example, chromatograms, spectral data) reviewed by an analyst?	X				
		2) Were data associated with manual integrations flagged on the raw data?	X				
S6	O	<b>Dual Column Confirmation</b>					
		1) Did dual column confirmation results meet the method-required QC?			X		
S7	O	<b>Tentatively Identified Compounds (TICs):</b>					
		1) If TICs were requested, were the mass spectra and TIC data subject to appropriate checks?			X		
S8	I	<b>Interference Check Sample (ICS) Results:</b>					
		1) Were percent recoveries within method QC limits?	X				
S9	I	<b>Serial Dilutions, Post Digestion Spikes, and Method of Standard Additions</b>					
		1) Were percent differences, recoveries, and the linearity within the QC limits specified in the method?	X				
S10	OI	<b>Method Detection Limit (MDL) Studies</b>					
		1) Was a MDL study performed for each reported analyte?	X				
		2) Is the MDL either adjusted or supported by the analysis of DCSs?	X				
S11	OI	<b>Proficiency Test Reports:</b>					
		1) Was the lab's performance acceptable on the applicable proficiency tests or evaluation studies?	X				
S12	OI	<b>Standards Documentation</b>					
		1) Are all standards used in the analyses NIST-traceable or obtained from other appropriate sources?	X				
S13	OI	<b>Compound/Analyte Identification Procedures</b>					
		1) Are the procedures for compound/analyte identification documented?	X				
S14	OI	<b>Demonstration of Analyst Competency (DOC)</b>					
		1) Was DOC conducted consistent with NELAC Chapter 5 – Appendix C?	X				
		2) Is documentation of the analyst's competency up-to-date and on file?	X				
S15	OI	<b>Verification/Validation Documentation for Methods (NELAC Chapter 5)</b>					
		1) Are all the methods used to generate the data documented, verified, and validated, where applicable?	X				
S16	OI	<b>Laboratory Standard Operating Procedures (SOPs):</b>					
		1) Are laboratory SOPs current and on file for each method performed?	X				

1 Items identified by the letter "R" should be included in the laboratory data package submitted to the TCEQ in the TRRP-required report(s). Items identified by the letter "S" should be retained and made available upon request for the appropriate retention period.

2 O = organic analyses; I = inorganic analyses (and general chemistry, when applicable).

3 NA = Not applicable.

4 NR = Not Reviewed.

5 ER# = Exception Report identification number (an Exception Report should be completed for an item if "NR" or "No" is checked).

# Laboratory Data Package Signature Page – RG-366/TRRP-13

This data package consists of:

This signature page, the laboratory review checklist, and the following reportable data:

- R1 Field chain-of-custody documentation;
- R2 Sample identification cross-reference;
- R3 Test reports (analytical data sheets) for each environmental sample that includes:
  - a) Items consistent with NELAC Chapter 5,
  - b) dilution factors,
  - c) preparation methods,
  - d) cleanup methods, and
  - e) if required for the project, tentatively identified compounds (TICs).
- R4 Surrogate recovery data including:
  - a) Calculated recovery (%R), and
  - b) The laboratory's surrogate QC limits.
- R5 Test reports/summary forms for blank samples;
- R6 Test reports/summary forms for laboratory control samples (LCSs) including:
  - a) LCS spiking amounts,
  - b) Calculated %R for each analyte, and
  - c) The laboratory's LCS QC limits.
- R7 Test reports for project matrix spike/matrix spike duplicates (MS/MSDs) including:
  - a) Samples associated with the MS/MSD clearly identified,
  - b) MS/MSD spiking amounts,
  - c) Concentration of each MS/MSD analyte measured in the parent and spiked samples,
  - d) Calculated %Rs and relative percent differences (RPDs), and
  - e) The laboratory's MS/MSD QC limits
- R8 Laboratory analytical duplicate (if applicable) recovery and precision:
  - a) The amount of analyte measured in the duplicate,
  - b) The calculated RPD, and
  - c) The laboratory's QC limits for analytical duplicates.
- R9 List of method quantitation limits (MQLs) and detectability check sample results for each analyte for each method and matrix;
- R10 Other problems or anomalies.

The Exception Report for each “No” or “Not Reviewed (NR)” item in the Laboratory Review Checklist and for each analyte, matrix, and method for which the laboratory is not accredited under the Texas Laboratory Accreditation Program.

**Release Statement:** I am responsible for the release of this laboratory data package. This laboratory is accredited under the Texas Laboratory Accreditation Program for all the methods, analytes, and matrices reported in this data package except as noted in the Exception Reports. The data have been reviewed and are technically compliant with the requirements of the methods used, except where noted by the laboratory in the Exception Reports. By my signature below, I affirm to the best of my knowledge that all problems/anomalies observed by the laboratory have been identified in the Laboratory Review Checklist, and no information or data affecting the quality of the data has been knowingly withheld.

This laboratory was last inspected by TCEQ on May 30 – June 2, 2023. Any findings affecting the data in this laboratory data package are noted in the Exception Reports herein. The official signing the cover page of the report in which these data are used is responsible for releasing this data package and is by signature affirming the above release statement is true.

Name: John DuPont  
Official Title: General Manager

  
Signature

03/08/24  
Date

Name: Dr. Derhsing Luu  
Official Title: Technical Director

---

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Lab Order:** 2402409

**CASE NARRATIVE**

---

Samples were analyzed using the methods outlined in the following references:

Method SW1312/6020B- SPLP Metals Analysis

Exception Report R1-01

Sample was added and login performed on 2/29/2024. Analysis was added to one sample of DHL WO# 2402409, and analyzed. The sample arrived in good condition and was properly packaged.

Exception Report R10-01

Per project specification, MS/MSD/Duplicates are from this workorder or project samples only.

---

---

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Lab Order:** 2402409

**Work Order Sample Summary**

---

<b>Lab Smp ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Recved</b>
2402409-01	SS-1		02/20/24 09:26 AM	03/01/2024

**Lab Order:** 2402409  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**PREP DATES REPORT**

Sample ID	Client Sample ID	Collection Date	Matrix	Test Number	Test Name	Prep Date	Batch ID
2402409-01A	SS-1	02/20/24 09:26 AM	Soil	SW3010A	Liquid Prep Total Metals: ICP-MS	03/07/24 08:10 AM	114365

**Lab Order:** 2402409  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**TCLP/SPLP PREP DATES REPORT**

Sample ID	Client Sample ID	Collection Date	Matrix	Test Number	Test Name	Prep Date	Batch ID
2402409-01A	SS-1	2/20/2024 9:26:00 AM	Soil	SW1312	SPLP Bottle Extr. (Metals)	3/6/2024 2:38:57 PM	114359

**Lab Order:** 2402409  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**ANALYTICAL DATES REPORT**

Sample ID	Client Sample ID	Matrix	Test Number	Test Name	Batch ID	Dilution	Analysis Date	Run ID
2402409-01A	SS-1	Soil	SW1312/6020B	SPLP Metals	114365	1	03/07/24 03:12 PM	ICP-MS5_240307B

**DHL Analytical, Inc.**

**Date:** 08-Mar-24

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons and  
**Project No:** 10412.036.001.0002  
**Lab Order:** 2402409

**Client Sample ID:** SS-1  
**Lab ID:** 2402409-01  
**Collection Date:** 02/20/24 09:26 AM  
**Matrix:** SOIL

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>SPLP METALS</b>							Analyst: <b>SP</b>
Arsenic	0.0252	0.00200	0.00500		mg/L	1	03/07/24 03:12 PM
Beryllium	0.00167	0.000300	0.00100		mg/L	1	03/07/24 03:12 PM
Lead	0.0174	0.000300	0.00100		mg/L	1	03/07/24 03:12 PM

**Qualifiers:** ND - Not Detected at the SDL  
J - Analyte detected between SDL and RL  
B - Analyte detected in the associated Method Blank  
DF- Dilution Factor  
N - Parameter not NELAP certified  
See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
C - Sample Result or QC discussed in Case Narrative  
RL - Reporting Limit (MQL adjusted for moisture and sample size)  
SDL - Sample Detection Limit  
E - TPH pattern not Gas or Diesel Range Pattern

CLIENT: Weston Solutions, Inc.

**ANALYTICAL QC SUMMARY REPORT**

Work Order: 2402409

Project: SAWS Impoundment Assessment Lagoons and

RunID: ICP-MS5\_240304A

Sample ID: <b>DCS1-114267</b>	Batch ID: <b>114267</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>DCS</b>	Run ID: <b>ICP-MS5_240304A</b>	Analysis Date: <b>3/4/2024 10:02:00 AM</b>	Prep Date: <b>3/1/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Beryllium	0.000524	0.00100	0.000500	0	105	70	130	0	0	
Lead	0.000504	0.00100	0.000500	0	101	70	130	0	0	

Sample ID: <b>DCS3-114267</b>	Batch ID: <b>114267</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>
SampType: <b>DCS3</b>	Run ID: <b>ICP-MS5_240304A</b>	Analysis Date: <b>3/4/2024 10:08:00 AM</b>	Prep Date: <b>3/1/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.00497	0.00500	0.00500	0	99.4	70	130	0	0	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402409

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240307B

The QC data in batch 114365 applies to the following samples: 2402409-01A

Sample ID: <b>MB-114365</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>MBLK</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 2:59:00 PM</b>	Prep Date: <b>3/7/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	<0.00200	0.00500								
Beryllium	<0.000300	0.00100								
Lead	<0.000300	0.00100								

Sample ID: <b>MB-114359-SPLP</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>MBLK</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:01:00 PM</b>	Prep Date: <b>3/7/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	<0.00200	0.00500								
Beryllium	<0.000300	0.00100								
Lead	<0.000300	0.00100								

Sample ID: <b>LCS-114365</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>LCS</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:04:00 PM</b>	Prep Date: <b>3/7/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.201	0.00500	0.200	0	101	80	120			
Beryllium	0.197	0.00100	0.200	0	98.6	80	120			
Lead	0.194	0.00100	0.200	0	97.2	80	120			

Sample ID: <b>LCSD-114365</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>LCSD</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:07:00 PM</b>	Prep Date: <b>3/7/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.206	0.00500	0.200	0	103	80	120	2.20	15	
Beryllium	0.203	0.00100	0.200	0	101	80	120	2.89	15	
Lead	0.199	0.00100	0.200	0	99.5	80	120	2.34	15	

Sample ID: <b>2402409-01A SD</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>SD</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:15:00 PM</b>	Prep Date: <b>3/7/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.0269	0.0250	0	0.0252				6.58	20	
Beryllium	0.00183	0.00500	0	0.00167				8.90	20	
Lead	0.0174	0.00500	0	0.0174				0.230	20	

Sample ID: <b>2402409-01A PDS</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>PDS</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:17:00 PM</b>	Prep Date: <b>3/7/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402409

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240307B

Sample ID: <b>2402409-01A PDS</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>
SampType: <b>PDS</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:17:00 PM</b>	Prep Date: <b>3/7/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.215	0.00500	0.200	0.0252	95.1	75	125			
Beryllium	0.204	0.00100	0.200	0.00167	101	75	125			
Lead	0.220	0.00100	0.200	0.0174	101	75	125			

Sample ID: <b>2402409-01A MS</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>
SampType: <b>MS</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:20:00 PM</b>	Prep Date: <b>3/7/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.221	0.00500	0.200	0.0252	97.8	75	125			
Beryllium	0.201	0.00100	0.200	0.00167	99.9	75	125			
Lead	0.225	0.00100	0.200	0.0174	104	75	125			

Sample ID: <b>2402409-01A MSD</b>	Batch ID: <b>114365</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>
SampType: <b>MSD</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:22:00 PM</b>	Prep Date: <b>3/7/2024</b>

Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.224	0.00500	0.200	0.0252	99.4	75	125	1.50	15	
Beryllium	0.204	0.00100	0.200	0.00167	101	75	125	1.28	15	
Lead	0.225	0.00100	0.200	0.0174	104	75	125	0.138	15	

**Qualifiers:** B Analyte detected in the associated Method Blank  
J Analyte detected between MDL and RL  
ND Not Detected at the Method Detection Limit  
RL Reporting Limit  
J Analyte detected between SDL and RL

DF Dilution Factor  
MDL Method Detection Limit  
R RPD outside accepted control limits  
S Spike Recovery outside control limits  
N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2402409

Project: SAWS Impoundment Assessment Lagoons and

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240307B

Sample ID: <b>ICV-240307</b>	Batch ID: <b>R131849</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>ICV</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 10:03:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.103	0.00500	0.100	0	103	90	110			
Beryllium	0.103	0.00100	0.100	0	103	90	110			
Lead	0.101	0.00100	0.100	0	101	90	110			

Sample ID: <b>LCVL-240307</b>	Batch ID: <b>R131849</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>LCVL</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 10:09:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.00513	0.00500	0.00500	0	103	80	120			
Beryllium	0.00105	0.00100	0.00100	0	105	80	120			
Lead	0.00102	0.00100	0.00100	0	102	80	120			

Sample ID: <b>CCV2-240307</b>	Batch ID: <b>R131849</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>CCV</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 11:21:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.203	0.00500	0.200	0	102	90	110			
Beryllium	0.204	0.00100	0.200	0	102	90	110			
Lead	0.198	0.00100	0.200	0	99.1	90	110			

Sample ID: <b>CCV3-240307</b>	Batch ID: <b>R131849</b>	TestNo: <b>SW1312/6020B</b>	Units: <b>mg/L</b>							
SampType: <b>CCV</b>	Run ID: <b>ICP-MS5_240307B</b>	Analysis Date: <b>3/7/2024 3:25:00 PM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.202	0.00500	0.200	0	101	90	110			
Beryllium	0.197	0.00100	0.200	0	98.6	90	110			
Lead	0.199	0.00100	0.200	0	99.3	90	110			

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2402409  
**Project:** SAWS Impoundment Assessment Lagoons and

**SQL SUMMARY REPORT**

---

<b>TestNo:</b> SW1312/6020B	<b>MDL</b>	<b>SQL</b>
<b>Analyte</b>	<b>mg/L</b>	<b>mg/L</b>
Arsenic	0.00200	0.00500
Beryllium	0.000300	0.00100
Lead	0.000300	0.00100

---

**Qualifiers:** SQL -Method Quantitation Limit as defined by TRRP  
MDL -Method Detection Limit as defined by TRRP



April 15, 2024

Armin Sabet  
Weston Solutions, Inc.  
2600 Dallas Parkway, Suite 280  
Frisco, Texas 75034  
TEL: (310) 980-6300

FAX:

Order No.: 2404088

RE: SAWS Impoundment Assessment Lagoons 6725 Agua Pura

Dear Armin Sabet:

DHL Analytical, Inc. received 1 sample(s) on 4/10/2024 for the analyses presented in the following report.

There were no problems with the analyses and all data met requirements of NELAP except where noted in the Case Narrative. All non-NELAP methods will be identified accordingly in the case narrative and all estimated uncertainties of test results are within method or EPA specifications.

If you have any questions regarding these tests results, please feel free to call. Thank you for using DHL Analytical.

Sincerely,

A handwritten signature in red ink, appearing to read 'John DuPont'.

John DuPont  
General Manager

This report was performed under the accreditation of the State of Texas Laboratory Certification  
Number: T104704211-23-29



# Table of Contents

<b>Miscellaneous Documents</b> .....	<b>3</b>
<b>CaseNarrative 2404088</b> .....	<b>9</b>
<b>WorkOrderSampleSummary 2404088</b> .....	<b>10</b>
<b>PrepDatesReport 2404088</b> .....	<b>11</b>
<b>AnalyticalDatesReport 2404088</b> .....	<b>12</b>
<b>Analytical Report 2404088</b> .....	<b>13</b>
<b>AnalyticalQCSummaryReport 2404088</b> .....	<b>14</b>
<b>MQLSummaryReport 2404088</b> .....	<b>17</b>



DO NOT USE USING THIS TAG

ORIGIN ID:SATA (310) 980-6300  
WESTON SOLUTIONS/OU1025  
2929 BRIARPARK DR STE 175  
HOUSTON, TX 77042  
UNITED STATES US

SHIP DATE: 09APR24  
ACTWGT: 9.70 LB  
CAD: 6994916/SSFE2500  
DIMS: 11x7x10 IN  
BILL THIRD PARTY

Part # 156297-438 RHD02 Exp 12/24

TO


DHL ANALYTICAL  
2300 DOUBLE CREEK DR

ROUND ROCK TX 78664

(612) 388-0222  
THU:  
PO:

REF:

DEPT:

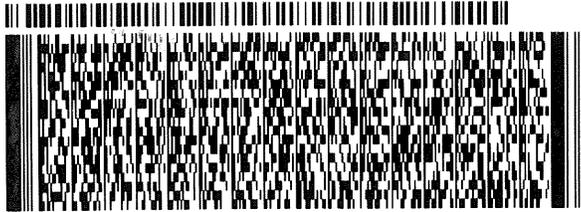

FedEx  
Express




1001100110240121

TRK# 2732 1573 7289  
0201

WED - 10 APR 10:30A  
PRIORITY OVERNIGHT

44 BSMA

AHS  
78664  
TX-US AUS

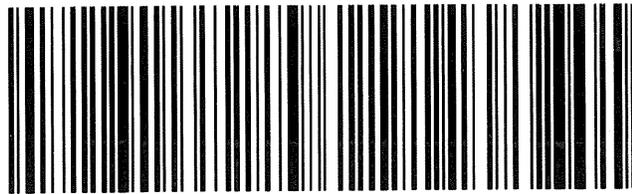


CUSTOMY SEAL

DATE

SIGNATURE

DHL ANALYTICAL



Handwritten signature

Handwritten date: 4/9/24

Sample Receipt Checklist

Client Name: Weston Solutions, Inc.

Date Received: 4/10/2024

Work Order Number: 2404088

Received by: KAO

Checklist completed by: [Signature] 4/10/2024
Signature Date

Reviewed by: [Initials] 4/10/2024
Initials Date

Carrier name: FedEx 1day

- Shipping container/cooler in good condition? Yes [checked] No [ ] Not Present [ ]
Custody seals intact on shipping container/cooler? Yes [checked] No [ ] Not Present [ ]
Custody seals intact on sample bottles? Yes [ ] No [ ] Not Present [checked]
Chain of custody present? Yes [checked] No [ ]
Chain of custody signed when relinquished and received? Yes [checked] No [ ]
Chain of custody agrees with sample labels? Yes [checked] No [ ]
Samples in proper container/bottle? Yes [checked] No [ ]
Sample containers intact? Yes [checked] No [ ]
Sufficient sample volume for indicated test? Yes [checked] No [ ]
All samples received within holding time? Yes [checked] No [ ]
Water - VOA vials have zero headspace? Yes [ ] No [ ] No VOA vials submitted [checked] NA [ ]
Water - pH<2 acceptable upon receipt? Yes [checked] No [ ] NA [ ] LOT # 13171
Adjusted? no Checked by EL
Water - ph>9 (S) or ph>10 (CN) acceptable upon receipt? Yes [ ] No [ ] NA [checked] LOT #
Adjusted? Checked by
Container/Temp Blank temperature in compliance? Yes [checked] No [ ]

Cooler # 1
Temp °C 1.2
Seal Intact Y

Any No response must be detailed in the comments section below.

Client contacted: Date contacted: Person contacted:

Contacted by: Regarding:

Comments:

Corrective Action:

<b>Laboratory Name: DHL Analytical, Inc.</b>							
<b>Laboratory Review Checklist: Reportable Data</b>							
<b>Project Name:</b> SAWS Impoundment Assess. Lagoon 6725 AguaPura				<b>LRC Date:</b> 4/15/2024			
<b>Reviewer Name:</b> Angie O'Donnell				<b>Laboratory Work Order:</b> 2404088			
<b>Prep Batch Number(s):</b> See Prep Dates Report				<b>Run Batch:</b> See Analytical Dates Report			
# <sup>1</sup>	A <sup>2</sup>	Description	Yes	No	NA <sup>3</sup>	NR <sup>4</sup>	ER# <sup>5</sup>
		<b>Chain-of-Custody (C-O-C)</b>					
R1	OI	1) Did samples meet the laboratory's standard conditions of sample acceptability upon receipt?	X				R1-01
		2) Were all departures from standard conditions described in an exception report?			X		
R2	OI	<b>Sample and Quality Control (QC) Identification</b>					
		1) Are all field sample ID numbers cross-referenced to the laboratory ID numbers?	X				
		2) Are all laboratory ID numbers cross-referenced to the corresponding QC data?	X				
R3	OI	<b>Test Reports</b>					
		1) Were all samples prepared and analyzed within holding times?	X				
		2) Other than those results < MQL, were all other raw values bracketed by calibration standards?	X				
		3) Were calculations checked by a peer or supervisor?	X				
		4) Were all analyte identifications checked by a peer or supervisor?	X				
		5) Were sample detection limits reported for all analytes not detected?	X				
		6) Were all results for soil and sediment samples reported on a dry weight basis?			X		
		7) Were % moisture (or solids) reported for all soil and sediment samples?			X		
		8) Were bulk soils/solids samples for volatile analysis extracted with methanol per EPA Method 5035?			X		
		9) If required for the project, TICs reported?			X		
R4	O	<b>Surrogate Recovery Data</b>					
		1) Were surrogates added prior to extraction?			X		
		2) Were surrogate percent recoveries in all samples within the laboratory QC limits?			X		
R5	OI	<b>Test Reports/Summary Forms for Blank Samples</b>					
		1) Were appropriate type(s) of blanks analyzed?	X				
		2) Were blanks analyzed at the appropriate frequency?	X				
		3) Were method blanks taken through the entire analytical process, including preparation and, if applicable, cleanup procedures?	X				
		4) Were blank concentrations < MDL?	X				
		5) For analyte(s) detected in a blank sample, was the concentration, unadjusted for sample specific factors, in all associated field samples, <b>greater</b> than 10 times the concentration in the blank sample?			X		
R6	OI	<b>Laboratory Control Samples (LCS):</b>					
		1) Were all COCs included in the LCS?	X				
		2) Was each LCS taken through the entire analytical procedure, including prep and cleanup steps?	X				
		3) Were LCSs analyzed at the required frequency?	X				
		4) Were LCS (and LCSD, if applicable) %Rs within the laboratory QC limits?	X				
		5) Does the detectability data document the laboratory's capability to detect the COCs at the MDL used to calculate the SDLs?	X				
		6) Was the LCSD RPD within QC limits (if applicable)?	X				
R7	OI	<b>Matrix Spike (MS) and Matrix Spike Duplicate (MSD) Data</b>					
		1) Were the project/method specified analytes included in the MS and MSD?			X		
		2) Were MS/MSD analyzed at the appropriate frequency?			X		
		3) Were MS (and MSD, if applicable) %Rs within the laboratory QC limits?			X		
		4) Were MS/MSD RPDs within laboratory QC limits?			X		
R8	OI	<b>Analytical Duplicate Data</b>					
		1) Were appropriate analytical duplicates analyzed for each matrix?			X		
		2) Were analytical duplicates analyzed at the appropriate frequency?			X		
		3) Were RPDs or relative standard deviations within the laboratory QC limits?			X		
R9	OI	<b>Method Quantitation Limits (MQLs):</b>					
		1) Are the MQLs for each method analyte included in the laboratory data package?	X				
		2) Do the MQLs correspond to the concentration of the lowest non-zero calibration standard?	X				
		3) Are unadjusted MQLs and DCSs included in the laboratory data package?	X				
R10	OI	<b>Other Problems/Anomalies</b>					
		1) Are all known problems/anomalies/special conditions noted in this LRC and ER?	X				R10-01
		2) Was applicable and available technology used to lower the SDL to minimize the matrix interference affects on the sample results?	X				
		3) Is the laboratory NELAC-accredited under the Texas Laboratory Accreditation Program for the analytes, matrices and methods associated with this laboratory data package?	X				

<b>Laboratory Name: DHL Analytical, Inc.</b>							
<b>Laboratory Review Checklist (continued): Supporting Data</b>							
<b>Project Name:</b> SAWS Impoundment Assess. Lagoon 6725 AguaPura				<b>LRC Date:</b> 4/15/2024			
<b>Reviewer Name:</b> Angie O'Donnell				<b>Laboratory Work Order:</b> 2404088			
<b>Prep Batch Number(s):</b> See Prep Dates Report				<b>Run Batch:</b> See Analytical Dates Report			
# <sup>1</sup>	A <sup>2</sup>	Description	Yes	No	NA <sup>3</sup>	NR <sup>4</sup>	ER# <sup>5</sup>
S1	OI	<b>Initial Calibration (ICAL)</b>					
		1) Were response factors and/or relative response factors for each analyte within QC limits?	X				
		2) Were percent RSDs or correlation coefficient criteria met?	X				
		3) Was the number of standards recommended in the method used for all analytes?	X				
		4) Were all points generated between the lowest and highest standard used to calculate the curve?	X				
		5) Are ICAL data available for all instruments used?	X				
		6) Has the initial calibration curve been verified using an appropriate second source standard?	X				
S2	OI	<b>Initial and Continuing calibration Verification (ICCV and CCV) and Continuing Calibration blank (CCB):</b>					
		1) Was the CCV analyzed at the method-required frequency?	X				
		2) Were percent differences for each analyte within the method-required QC limits?	X				
		3) Was the ICAL curve verified for each analyte?	X				
		4) Was the absolute value of the analyte concentration in the inorganic CCB < MDL?	X				
S3	O	<b>Mass Spectral Tuning:</b>					
		1) Was the appropriate compound for the method used for tuning?	X				
		2) Were ion abundance data within the method-required QC limits?	X				
S4	O	<b>Internal Standards (IS):</b>					
		1) Were IS area counts and retention times within the method-required QC limits?	X				
S5	OI	<b>Raw Data (NELAC Section 5.5.10)</b>					
		1) Were the raw data (for example, chromatograms, spectral data) reviewed by an analyst?	X				
		2) Were data associated with manual integrations flagged on the raw data?	X				
S6	O	<b>Dual Column Confirmation</b>					
		1) Did dual column confirmation results meet the method-required QC?			X		
S7	O	<b>Tentatively Identified Compounds (TICs):</b>					
		1) If TICs were requested, were the mass spectra and TIC data subject to appropriate checks?			X		
S8	I	<b>Interference Check Sample (ICS) Results:</b>					
		1) Were percent recoveries within method QC limits?	X				
S9	I	<b>Serial Dilutions, Post Digestion Spikes, and Method of Standard Additions</b>					
		1) Were percent differences, recoveries, and the linearity within the QC limits specified in the method?			X		
S10	OI	<b>Method Detection Limit (MDL) Studies</b>					
		1) Was a MDL study performed for each reported analyte?	X				
		2) Is the MDL either adjusted or supported by the analysis of DCSs?	X				
S11	OI	<b>Proficiency Test Reports:</b>					
		1) Was the lab's performance acceptable on the applicable proficiency tests or evaluation studies?	X				
S12	OI	<b>Standards Documentation</b>					
		1) Are all standards used in the analyses NIST-traceable or obtained from other appropriate sources?	X				
S13	OI	<b>Compound/Analyte Identification Procedures</b>					
		1) Are the procedures for compound/analyte identification documented?	X				
S14	OI	<b>Demonstration of Analyst Competency (DOC)</b>					
		1) Was DOC conducted consistent with NELAC Chapter 5 – Appendix C?	X				
		2) Is documentation of the analyst's competency up-to-date and on file?	X				
S15	OI	<b>Verification/Validation Documentation for Methods (NELAC Chapter 5)</b>					
		1) Are all the methods used to generate the data documented, verified, and validated, where applicable?	X				
S16	OI	<b>Laboratory Standard Operating Procedures (SOPs):</b>					
		1) Are laboratory SOPs current and on file for each method performed?	X				

1 Items identified by the letter "R" should be included in the laboratory data package submitted to the TCEQ in the TRRP-required report(s). Items identified by the letter "S" should be retained and made available upon request for the appropriate retention period.

2 O = organic analyses; I = inorganic analyses (and general chemistry, when applicable).

3 NA = Not applicable.

4 NR = Not Reviewed.

5 ER# = Exception Report identification number (an Exception Report should be completed for an item if "NR" or "No" is checked).

# Laboratory Data Package Signature Page – RG-366/TRRP-13

This data package consists of:

This signature page, the laboratory review checklist, and the following reportable data:

- R1 Field chain-of-custody documentation;
- R2 Sample identification cross-reference;
- R3 Test reports (analytical data sheets) for each environmental sample that includes:
  - a) Items consistent with NELAC Chapter 5,
  - b) dilution factors,
  - c) preparation methods,
  - d) cleanup methods, and
  - e) if required for the project, tentatively identified compounds (TICs).
- R4 Surrogate recovery data including:
  - a) Calculated recovery (%R), and
  - b) The laboratory's surrogate QC limits.
- R5 Test reports/summary forms for blank samples;
- R6 Test reports/summary forms for laboratory control samples (LCSs) including:
  - a) LCS spiking amounts,
  - b) Calculated %R for each analyte, and
  - c) The laboratory's LCS QC limits.
- R7 Test reports for project matrix spike/matrix spike duplicates (MS/MSDs) including:
  - a) Samples associated with the MS/MSD clearly identified,
  - b) MS/MSD spiking amounts,
  - c) Concentration of each MS/MSD analyte measured in the parent and spiked samples,
  - d) Calculated %Rs and relative percent differences (RPDs), and
  - e) The laboratory's MS/MSD QC limits
- R8 Laboratory analytical duplicate (if applicable) recovery and precision:
  - a) The amount of analyte measured in the duplicate,
  - b) The calculated RPD, and
  - c) The laboratory's QC limits for analytical duplicates.
- R9 List of method quantitation limits (MQLs) and detectability check sample results for each analyte for each method and matrix;
- R10 Other problems or anomalies.

The Exception Report for each “No” or “Not Reviewed (NR)” item in the Laboratory Review Checklist and for each analyte, matrix, and method for which the laboratory is not accredited under the Texas Laboratory Accreditation Program.

**Release Statement:** I am responsible for the release of this laboratory data package. This laboratory is accredited under the Texas Laboratory Accreditation Program for all the methods, analytes, and matrices reported in this data package except as noted in the Exception Reports. The data have been reviewed and are technically compliant with the requirements of the methods used, except where noted by the laboratory in the Exception Reports. By my signature below, I affirm to the best of my knowledge that all problems/anomalies observed by the laboratory have been identified in the Laboratory Review Checklist, and no information or data affecting the quality of the data has been knowingly withheld.

This laboratory was last inspected by TCEQ on May 30 – June 2, 2023. Any findings affecting the data in this laboratory data package are noted in the Exception Reports herein. The official signing the cover page of the report in which these data are used is responsible for releasing this data package and is by signature affirming the above release statement is true.

Name: John DuPont  
Official Title: General Manager

  
Signature

04/15/24  
Date

Name: Dr. Derhsing Luu  
Official Title: Technical Director

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons 672  
**Lab Order:** 2404088

**CASE NARRATIVE**

---

Samples were analyzed using the methods outlined in the following references:

Method SW6020B- Metals Analysis

Exception Report R1-01

Samples were received and login performed on 4/10/2024. A total of 1 sample was received and analyzed. The sample arrived in good condition and was properly packaged.

Exception Report R10-01

Per project specification, MS/MSD/Duplicates are from this workorder or project samples only.

---

---

**CLIENT:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment Lagoons 6725  
**Lab Order:** 2404088

**Work Order Sample Summary**

---

<b>Lab Smp ID</b>	<b>Client Sample ID</b>	<b>Tag Number</b>	<b>Date Collected</b>	<b>Date Recved</b>
2404088-01	TW-1		04/09/24 02:47 PM	04/10/2024

**Lab Order:** 2404088  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**PREP DATES REPORT**

Sample ID	Client Sample ID	Collection Date	Matrix	Test Number	Test Name	Prep Date	Batch ID
2404088-01A	TW-1	04/09/24 02:47 PM	Aqueous	SW3005A	Aq Prep Metals : ICP-MS	04/11/24 07:24 AM	114911

**Lab Order:** 2404088  
**Client:** Weston Solutions, Inc.  
**Project:** SAWS Impoundment Assessment

**ANALYTICAL DATES REPORT**

Sample ID	Client Sample ID	Matrix	Test Number	Test Name	Batch ID	Dilution	Analysis Date	Run ID
2404088-01A	TW-1	Aqueous	SW6020B	Total Metals: ICP-MS - Water	114911	1	04/12/24 10:59 AM	ICP-MS5_240412A

**DHL Analytical, Inc.**

**Date:** 15-Apr-24

**CLIENT:** Weston Solutions, Inc.

**Client Sample ID:** TW-1

**Project:** SAWS Impoundment Assessment Lagoons 6725

**Lab ID:** 2404088-01

**Project No:** 10412.036.001.0002

**Collection Date:** 04/09/24 02:47 PM

**Lab Order:** 2404088

**Matrix:** AQUEOUS

Analyses	Result	SDL	RL	Qual	Units	DF	Date Analyzed
<b>TOTAL METALS: ICP-MS - WATER</b>							Analyst: <b>SP</b>
Arsenic	<0.00200	0.00200	0.00500		mg/L	1	04/12/24 10:59 AM

**Qualifiers:** ND - Not Detected at the SDL  
J - Analyte detected between SDL and RL  
B - Analyte detected in the associated Method Blank  
DF- Dilution Factor  
N - Parameter not NELAP certified  
See Final Page of Report for MQLs and MDLs

S - Spike Recovery outside control limits  
C - Sample Result or QC discussed in Case Narrative  
RL - Reporting Limit (MQL adjusted for moisture and sample size)  
SDL - Sample Detection Limit  
E - TPH pattern not Gas or Diesel Range Pattern

**CLIENT:** Weston Solutions, Inc.

**ANALYTICAL QC SUMMARY REPORT**

**Work Order:** 2404088

**Project:** SAWS Impoundment Assessment Lagoons 6725

**RunID:** ICP-MS5\_240304A

Sample ID: <b>DCS3-114267</b>	Batch ID: <b>114267</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>DCS3</b>	Run ID: <b>ICP-MS5_240304A</b>	Analysis Date: <b>3/4/2024 10:08:00 AM</b>	Prep Date: <b>3/1/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.00497	0.00500	0.00500	0	99.4	70	130	0	0	

**Qualifiers:**

B	Analyte detected in the associated Method Blank	DF	Dilution Factor
J	Analyte detected between MDL and RL	MDL	Method Detection Limit
ND	Not Detected at the Method Detection Limit	R	RPD outside accepted control limits
RL	Reporting Limit	S	Spike Recovery outside control limits
J	Analyte detected between SDL and RL	N	Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2404088

Project: SAWS Impoundment Assessment Lagoons 6725

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240412A

The QC data in batch 114911 applies to the following samples: 2404088-01A

Sample ID: <b>MB-114911</b>	Batch ID: <b>114911</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>MBLK</b>	Run ID: <b>ICP-MS5_240412A</b>	Analysis Date: <b>4/12/2024 10:41:00 AM</b>	Prep Date: <b>4/11/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	<0.00200	0.00500								

Sample ID: <b>LCS-114911</b>	Batch ID: <b>114911</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>LCS</b>	Run ID: <b>ICP-MS5_240412A</b>	Analysis Date: <b>4/12/2024 10:44:00 AM</b>	Prep Date: <b>4/11/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.199	0.00500	0.200	0	99.3	80	120			

Sample ID: <b>LCSD-114911</b>	Batch ID: <b>114911</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>LCSD</b>	Run ID: <b>ICP-MS5_240412A</b>	Analysis Date: <b>4/12/2024 10:49:00 AM</b>	Prep Date: <b>4/11/2024</b>							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual
Arsenic	0.196	0.00500	0.200	0	98.2	80	120	1.02	15	

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

CLIENT: Weston Solutions, Inc.

Work Order: 2404088

Project: SAWS Impoundment Assessment Lagoons 6725

# ANALYTICAL QC SUMMARY REPORT

RunID: ICP-MS5\_240412A

Sample ID: <b>ICV-240412</b>	Batch ID: <b>R132490</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>ICV</b>	Run ID: <b>ICP-MS5_240412A</b>	Analysis Date: <b>4/12/2024 10:27:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

Arsenic 0.0981 0.00500 0.100 0 98.1 90 110

Sample ID: <b>LCVL-240412</b>	Batch ID: <b>R132490</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>LCVL</b>	Run ID: <b>ICP-MS5_240412A</b>	Analysis Date: <b>4/12/2024 10:32:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

Arsenic 0.00512 0.00500 0.00500 0 102 80 120

Sample ID: <b>CCV1-240412</b>	Batch ID: <b>R132490</b>	TestNo: <b>SW6020B</b>	Units: <b>mg/L</b>							
SampType: <b>CCV</b>	Run ID: <b>ICP-MS5_240412A</b>	Analysis Date: <b>4/12/2024 11:30:00 AM</b>	Prep Date:							
Analyte	Result	RL	SPK value	Ref Val	%REC	LowLimit	HighLimit	%RPD	RPDLimit	Qual

Arsenic 0.198 0.00500 0.200 0 99.0 90 110

**Qualifiers:**

- B Analyte detected in the associated Method Blank
- J Analyte detected between MDL and RL
- ND Not Detected at the Method Detection Limit
- RL Reporting Limit
- J Analyte detected between SDL and RL

- DF Dilution Factor
- MDL Method Detection Limit
- R RPD outside accepted control limits
- S Spike Recovery outside control limits
- N Parameter not NELAP certified

**CLIENT:** Weston Solutions, Inc.  
**Work Order:** 2404088  
**Project:** SAWS Impoundment Assessment Lagoons 6725

**SQL SUMMARY REPORT**

---

<b>TestNo:</b> SW6020B	<b>MDL</b>	<b>SQL</b>
<b>Analyte</b>	<b>mg/L</b>	<b>mg/L</b>
Arsenic	0.00200	0.00500

---

**Qualifiers:** SQL -Method Quantitation Limit as defined by TRRP  
MDL -Method Detection Limit as defined by TRRP

---


**ATTACHMENT 3 – BORING LOG**

---



**CLIENT** San Antonio Water System  
**PROJECT NUMBER** 10412.036.001.0002  
**DATE STARTED** 4/4/24 **COMPLETED** 4/4/24  
**DRILLING CONTRACTOR** Pacific West  
**DRILLING METHOD** Direct Push  
**DRILLER** Eric Castillo **LOGGED BY** Will Kennedy  
**NOTES**

**PROJECT NAME** SAWS IMPOUNDMENT ASSESSMENT LAGOONS  
**PROJECT LOCATION** 6725 Agua Pura Street, Von Ormy, Texas 78073  
**GROUND ELEVATION** NA **HOLE SIZE** 2"  
**GROUND WATER LEVELS:**  
 ▽ **INITIAL WATER LEVEL** 26.16 BGS  
 ▼ **STATIC WATER LEVEL** 15.03 BGS

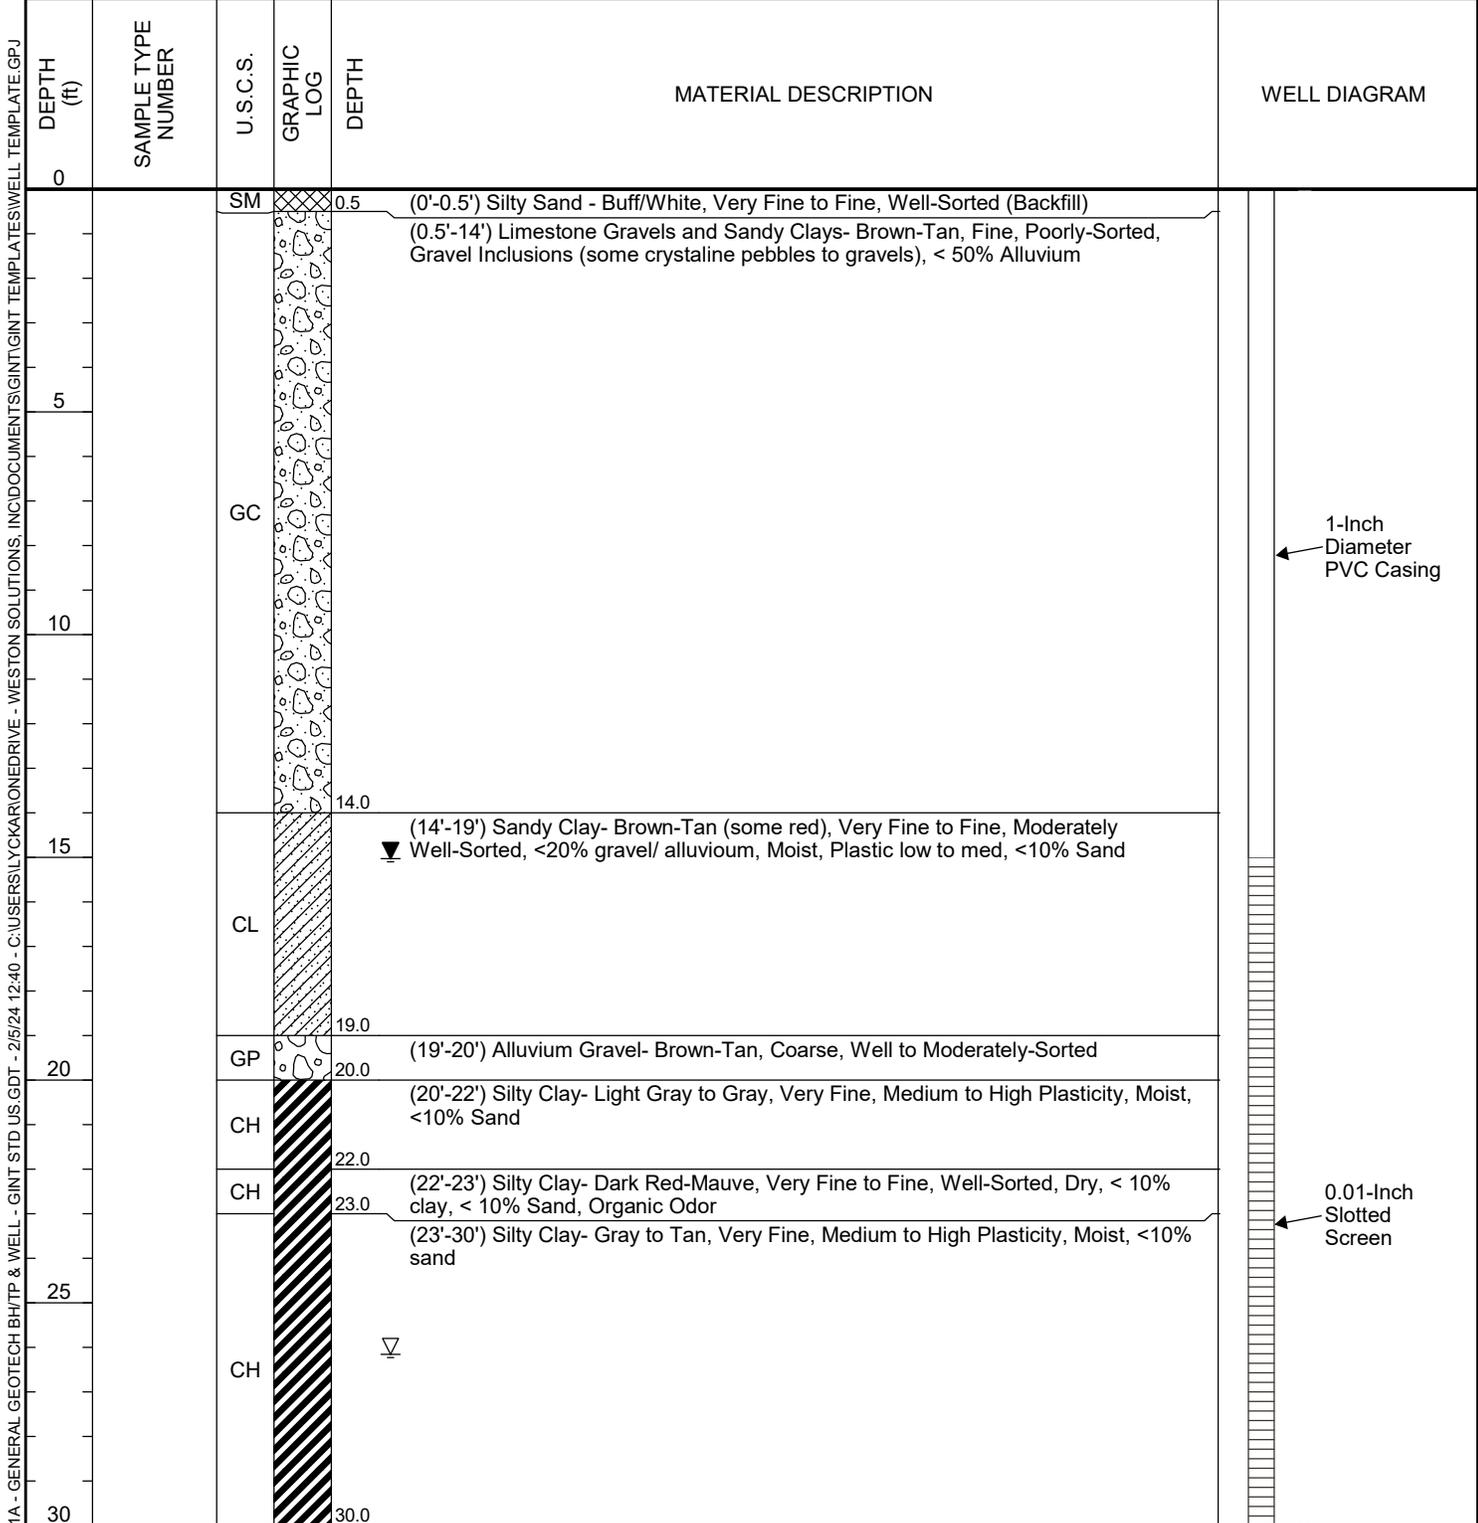

This log should not be used separately from the original report.



August 5, 2024

Texas Commission on Environmental Quality  
Applications Review and Process Team,  
Building F, Room 2101  
12100 Park 35 Circle  
Austin, TX 78753

Re: Industrial Permit Discharge Renewal for:  
San Antonio Water System (SAWS) Ultrafiltration Water Treatment Plant  
Permit No. WQ0004437000; EPA ID No. TX0125083

Dear Sir/Madam:

I hope this message finds you well. I am writing to address the specific requirements outlined in the Water Quality Individual Permits (EPR\_WQIP) application through the Texas Environmental Electronic Reporting System (STEERS). The permit application requires submittals of the following documents.

- Design Calculations,
- Solids Management Plan, and
- Water Balance

After a thorough review of these requirements, we have determined that they do not apply to this permit application because the plant hasn't had a discharge since 2015. Should you have any questions or need additional information, you may reach Floramie Welch, Environmental Analyst III, at (210) 233-3744.

Sincerely,

A handwritten signature in blue ink, appearing to read "Jeff Haby", is written over a light blue circular stamp.

Jeff Haby, P.E.  
Sr. Vice President, Production Operations



August 5, 2024

Texas Commission on Environmental Quality  
Applications Review and Process Team,  
Building F, Room 2101  
12100 Park 35 Circle  
Austin, TX 78753

Re: Industrial Permit Discharge Renewal for:  
San Antonio Water System (SAWS) Ultrafiltration Water Treatment Plant  
Permit No. WQ0004437000; EPA ID No. TX0125083

Dear Sir/Madam:

I hope this message finds you well. I am writing to address the specific requirements outlined in the Water Quality Individual Permits (EPR\_WQIP) application through the Texas Environmental Electronic Reporting System (STEERS). The permit application requires submittals of the following documents.

- Design Calculations,
- Solids Management Plan, and
- Water Balance

After a thorough review of these requirements, we have determined that they do not apply to this permit application because the plant hasn't had a discharge since 2015. Should you have any questions or need additional information, you may reach Floramie Welch, Environmental Analyst III, at (210) 233-3744.

Sincerely,

A handwritten signature in blue ink, appearing to read "Jeff Haby", is written over a faint, larger version of the same signature.

Jeff Haby, P.E.  
Sr. Vice President, Production Operations



August 5, 2024

Texas Commission on Environmental Quality  
Applications Review and Process Team,  
Building F, Room 2101  
12100 Park 35 Circle  
Austin, TX 78753

Re: Industrial Permit Discharge Renewal for:  
San Antonio Water System (SAWS) Ultrafiltration Water Treatment Plant  
Permit No. WQ0004437000; EPA ID No. TX0125083

Dear Sir/Madam:

I hope this message finds you well. I am writing to address the specific requirements outlined in the Water Quality Individual Permits (EPR\_WQIP) application through the Texas Environmental Electronic Reporting System (STEERS). The permit application requires submittals of the following documents.

- Design Calculations,
- Solids Management Plan, and
- Water Balance

After a thorough review of these requirements, we have determined that they do not apply to this permit application because the plant hasn't had a discharge since 2015. Should you have any questions or need additional information, you may reach Floramie Welch, Environmental Analyst III, at (210) 233-3744.

Sincerely,

A handwritten signature in blue ink, appearing to read "Jeff Haby", is written over a faint, larger version of the same signature.

Jeff Haby, P.E.  
Sr. Vice President, Production Operations

## Item 14. Laboratory Accreditation (Instructions, Page 49)

All laboratory tests performed must meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*, which includes the following general exemptions from National Environmental Laboratory Accreditation Program (NELAP) certification requirements:

- The laboratory is an in-house laboratory and is:
  - periodically inspected by the TCEQ; or
  - located in another state and is accredited or inspected by that state; or
  - performing work for another company with a unit located in the same site; or
  - performing pro bono work for a governmental agency or charitable organization.
- The laboratory is accredited under federal law.
- The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review *30 TAC Chapter 25* for specific requirements.


The following certification statement shall be signed and submitted with every application. See the *Signature Page* section in the Instructions, for a list of designated representatives who may sign the certification.

### CERTIFICATION:

I certify that all laboratory tests submitted with this application meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*.

Printed Name: Jeff Haby, P.E.

Title: Sr. Vice President, Production Operations

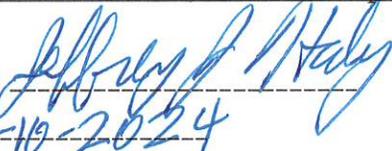Signature: 

Date: 7-10-2024

## Candice Calhoun

---

**From:** Floramie Welch <Floramie.Welch@saws.org>  
**Sent:** Tuesday, October 15, 2024 9:46 AM  
**To:** Candice Calhoun  
**Subject:** RE: Application to Renew Permit No. WQ0004437000 - San Antonio Water System - Notice of Deficiency  
**Attachments:** 2024\_UF\_PLANT\_TPDES\_APPLICATION\_NODI.pdf  
**Follow Up Flag:** Follow up  
**Flag Status:** Flagged

Ms. Calhoun,  
We've reviewed the NODI information carefully and everything is correct.

Sincerely,  
Floramie Welch

---

**From:** Candice Calhoun <Candice.Calhoun@tceq.texas.gov>  
**Sent:** Monday, October 14, 2024 8:32 AM  
**To:** Floramie Welch <Floramie.Welch@saws.org>  
**Subject:** RE: Application to Renew Permit No. WQ0004437000 - San Antonio Water System - Notice of Deficiency

### External Sender

Do not click links or attachments unless you trust the sender and know the content is safe.

Report Suspicious

Good morning, Ms. Welch,

My apologies for the late response, I was out last week.

Yes ma'am, the only thing that is needed is for you to review the portion of the NORI, that is listed in the NOD, and indicate if it contains any errors or omissions.

Regards,



### Candice Courville

Texas Commission on Environmental  
Quality  
Water Quality Division  
512-239-4312  
[candice.calhoun@tceq.texas.gov](mailto:candice.calhoun@tceq.texas.gov)

How is our customer service? Fill out our online customer satisfaction survey at  
[www.tceq.texas.gov/customersurvey](http://www.tceq.texas.gov/customersurvey)



TEXAS COMMISSION ON ENVIRONMENTAL  
QUALITY

P.O. Box 13087  
Austin, Texas 78711-3087

PERMIT TO DISCHARGE WASTES  
under provisions of  
Section 402 of the Clean Water Act  
and Chapter 26 of the Texas Water Code

TPDES PERMIT NO.  
WQ0004437000  
*[For TCEQ office use only -  
EPA I.D. No. TX0125083]*

This renewal replaces TPDES Permit  
No. WQ0004437000, issued on  
February 10, 2020.

San Antonio Water System

whose mailing address is

2800 U.S. Highway 281 North  
San Antonio, TX, 78212

is authorized to treat and discharge wastes from the Ultrafiltration Water Treatment Plant, a potable water treatment plant facility. (SIC 4941)

located at 6725 Moreno Street, in the City of Von Ormy, Bexar County, Texas 78073

To an unnamed ditch, thence to O.R. Mitchell Lake 1 thence to Medio Creek in Segment No. 1912 of the San Antonio River Basin

only according to effluent limitations, monitoring requirements, and other conditions set forth in this permit, as well as the rules of the Texas Commission on Environmental Quality (TCEQ), the laws of the State of Texas, and other orders of the TCEQ. The issuance of this permit does not grant to the permittee the right to use private or public property for conveyance of wastewater along the discharge route described in this permit. This includes, but is not limited to, property belonging to any individual, partnership, corporation, or other entity. Neither does this permit authorize any invasion of personal rights nor any violation of federal, state, or local laws or regulations. It is the responsibility of the permittee to acquire property rights as may be necessary to use the discharge route.

This permit shall expire at midnight, five years from the date of permit issuance.

ISSUED DATE:

---

For the Commission

EFFLUENT LIMITATIONS AND MONITORING REQUIREMENTS

Outfall Number 001

1. During the period beginning upon the date of permit issuance and lasting through the date of permit expiration, the permittee is authorized to discharge clarifier water<sup>1</sup> subject to the following effluent limitations:

Volume: Intermittent and variable flow.

Effluent Characteristics	Discharge Limitations			Minimum Self-Monitoring Requirements	
	Daily Average mg/L	Daily Maximum mg/L	Single Grab mg/L	Report Daily Average and Daily Maximum Measurement Frequency	Sample Type
Flow	Report, MGD	Report, MGD	N/A	1/day <sup>2</sup>	Estimate
Total Suspended Solids	N/A	45	45	1/day <sup>2</sup>	Grab

2. The pH must not be less than 6.0 standard units nor greater than 9.0 standard units and must be monitored 1/day<sup>2</sup> by grab sample.
3. There must be no discharge of floating solids or visible foam in other than trace amounts and no discharge of visible oil.
4. Effluent monitoring samples must be taken at the following location: At Outfall 001, where clarifier water is discharged and prior to entering the drainage ditch.

<sup>1</sup> See Other Requirement No. 3.

<sup>2</sup> When discharging.

**DEFINITIONS AND STANDARD PERMIT CONDITIONS**

As required by Title 30 Texas Administrative Code (TAC) Chapter 305, certain regulations appear as standard conditions in waste discharge permits. 30 TAC §§305.121 - 305.129 (relating to Permit Characteristics and Conditions) as promulgated under the Texas Water Code (TWC) §§5.103 and 5.105, and the Texas Health and Safety Code (THSC) §§361.017 and 361.024(a), establish the characteristics and standards for waste discharge permits, including sewage sludge, and those sections of 40 Code of Federal Regulations (CFR) Part 122 adopted by reference by the Commission. The following text includes these conditions and incorporates them into this permit. All definitions in Texas Water Code §26.001 and 30 TAC Chapter 305 shall apply to this permit and are incorporated by reference. Some specific definitions of words or phrases used in this permit are as follows:

**1. Flow Measurements**

- a. Annual average flow - the arithmetic average of all daily flow determinations taken within the preceding 12 consecutive calendar months. The annual average flow determination shall consist of daily flow volume determinations made by a totalizing meter, charted on a chart recorder, and limited to major domestic wastewater discharge facilities with a one million gallons per day or greater permitted flow.
- b. Daily average flow - the arithmetic average of all determinations of the daily flow within a period of one calendar month. The daily average flow determination shall consist of determinations made on at least four separate days. If instantaneous measurements are used to determine the daily flow, the determination shall be the arithmetic average of all instantaneous measurements taken during that month. Daily average flow determination for intermittent discharges shall consist of a minimum of three flow determinations on days of discharge.
- c. Daily maximum flow - the highest total flow for any 24-hour period in a calendar month.
- d. Instantaneous flow - the measured flow during the minimum time required to interpret the flow measuring device.
- e. 2-hour peak flow (domestic wastewater treatment plants) - the maximum flow sustained for a two-hour period during the period of daily discharge. The average of multiple measurements of instantaneous maximum flow within a two-hour period may be used to calculate the 2-hour peak flow.
- f. Maximum 2-hour peak flow (domestic wastewater treatment plants) - the highest 2-hour peak flow for any 24-hour period in a calendar month.

**2. Concentration Measurements**

- a. Daily average concentration - the arithmetic average of all effluent samples, composite or grab as required by this permit, within a period of one calendar month, consisting of at least four separate representative measurements.
  - i. For domestic wastewater treatment plants - When four samples are not available in a calendar month, the arithmetic average (weighted by flow) of all values in the previous four consecutive month period consisting of at least four measurements shall be utilized as the daily average concentration.
  - ii. For all other wastewater treatment plants - When four samples are not available in a calendar month, the arithmetic average (weighted by flow) of all values taken during the month shall be utilized as the daily average concentration.
- b. 7-day average concentration - the arithmetic average of all effluent samples, composite or grab as required by this permit, within a period of one calendar week, Sunday through Saturday.
- c. Daily maximum concentration - the maximum concentration measured on a single day, by the sample type specified in the permit, within a period of one calendar month.
- d. Daily discharge - the discharge of a pollutant measured during a calendar day or any 24-hour period that reasonably represents the calendar day for purposes of sampling. For pollutants with limitations expressed in terms of mass, the "daily discharge" is calculated as the total

mass of the pollutant discharged over the sampling day. For pollutants with limitations expressed in other units of measurement, the “daily discharge” is calculated as the average measurement of the pollutant over the sampling day.

The “daily discharge” determination of concentration made using a composite sample shall be the concentration of the composite sample. When grab samples are used, the “daily discharge” determination of concentration shall be the arithmetic average (weighted by flow value) of all samples collected during that day.

- e. Bacteria concentration (Fecal coliform, *E. coli*, or Enterococci) – the number of colonies of bacteria per 100 milliliters effluent. The daily average bacteria concentration is a geometric mean of the values for the effluent samples collected in a calendar month. The geometric mean shall be determined by calculating the *n*th root of the product of all measurements made in a calendar month, where *n* equals the number of measurements made; or computed as the antilogarithm of the arithmetic mean of the logarithms of all measurements made in a calendar month. For any measurement of bacteria equaling zero, a substitute value of one shall be made for input into either computation method. If specified, the 7-day average for bacteria is the geometric mean of the values for all effluent samples collected during a calendar week.
- f. Daily average loading (lbs/day) - the arithmetic average of all daily discharge loading calculations during a period of one calendar month. These calculations must be made for each day of the month that a parameter is analyzed. The daily discharge, in terms of mass (lbs/day), is calculated as (Flow, MGD × Concentration, mg/L × 8.34).
- g. Daily maximum loading (lbs/day) - the highest daily discharge, in terms of mass (lbs/day), within a period of one calendar month.

### 3. Sample Type

- a. Composite sample - For domestic wastewater, a composite sample is a sample made up of a minimum of three effluent portions collected in a continuous 24-hour period or during the period of daily discharge if less than 24 hours, and combined in volumes proportional to flow, and collected at the intervals required by 30 TAC §319.9(a). For industrial wastewater, a composite sample is a sample made up of a minimum of three effluent portions collected in a continuous 24-hour period or during the period of daily discharge if less than 24 hours, and combined in volumes proportional to flow, and collected at the intervals required by 30 TAC §319.9(c).
  - b. Grab sample - an individual sample collected in less than 15 minutes.
4. Treatment Facility (facility) - wastewater facilities used in the conveyance, storage, treatment, recycling, reclamation or disposal of domestic sewage, industrial wastes, agricultural wastes, recreational wastes, or other wastes including sludge handling or disposal facilities under the jurisdiction of the Commission.
  5. The term “sewage sludge” is defined as solid, semi-solid, or liquid residue generated during the treatment of domestic sewage in 30 TAC Chapter 312. This includes the solids that have not been classified as hazardous waste separated from wastewater by unit processes.
  6. Bypass - the intentional diversion of a waste stream from any portion of a treatment facility.

## MONITORING AND REPORTING REQUIREMENTS

### 1. Self-Reporting

Monitoring results shall be provided at the intervals specified in the permit. Unless otherwise specified in this permit or otherwise ordered by the Commission, the permittee shall conduct effluent sampling and reporting in accordance with 30 TAC §§319.4 - 319.12. Unless otherwise specified, effluent monitoring data shall be submitted each month, to the Enforcement Division (MC 224), by the 20th day of the following month for each discharge that is described by this permit whether or not a discharge is made for that month. Monitoring results must be submitted online using the NetDMR reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. Monitoring results must be signed and certified as required by Monitoring and Reporting Requirements No. 10.

As provided by state law, the permittee is subject to administrative, civil and criminal penalties, as applicable, for negligently or knowingly violating the Clean Water Act; TWC Chapters 26, 27, and 28; and THSC Chapter 361, including but not limited to knowingly making any false statement, representation, or certification on any report, record, or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or noncompliance, or falsifying, tampering with or knowingly rendering inaccurate any monitoring device or method required by this permit or violating any other requirement imposed by state or federal regulations.

## 2. Test Procedures

- a. Unless otherwise specified in this permit, test procedures for the analysis of pollutants shall comply with procedures specified in 30 TAC §§319.11 - 319.12. Measurements, tests, and calculations shall be accurately accomplished in a representative manner.
- b. All laboratory tests submitted to demonstrate compliance with this permit must meet the requirements of 30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification.

## 3. Records of Results

- a. Monitoring samples and measurements shall be taken at times and in a manner so as to be representative of the monitored activity.
- b. Except for records of monitoring information required by this permit related to the permittee's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 CFR Part 503), monitoring and reporting records, including strip charts and records of calibration and maintenance, copies of all records required by this permit, records of all data used to complete the application for this permit, and the certification required by 40 CFR §264.73(b)(9) shall be retained at the facility site, or shall be readily available for review by a TCEQ representative for a period of three years from the date of the record or sample, measurement, report, application or certification. This period shall be extended at the request of the Executive Director.
- c. Records of monitoring activities shall include the following:
  - i. date, time, and place of sample or measurement;
  - ii. identity of individual who collected the sample or made the measurement;
  - iii. date and time of analysis;
  - iv. identity of the individual and laboratory who performed the analysis;
  - v. the technique or method of analysis; and
  - vi. the results of the analysis or measurement and quality assurance/quality control records.

The period during which records are required to be kept shall be automatically extended to the date of the final disposition of any administrative or judicial enforcement action that may be instituted against the permittee.

## 4. Additional Monitoring by Permittee

If the permittee monitors any pollutant at the location(s) designated herein more frequently than required by this permit using approved analytical methods as specified above, all results of such monitoring shall be included in the calculation and reporting of the values submitted on the approved self-report form. Increased frequency of sampling shall be indicated on the self-report form.

## 5. Calibration of Instruments

All automatic flow measuring or recording devices and all totalizing meters for measuring flows shall be accurately calibrated by a trained person at plant start-up and as often thereafter as necessary to ensure accuracy, but not less often than annually unless authorized by the Executive Director for a longer period. Such person shall verify in writing that the device is operating properly and giving accurate results. Copies of the verification shall be retained at the facility site or shall be readily available for review by a TCEQ representative for a period of three years.

## 6. Compliance Schedule Reports

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of the permit shall be submitted no later than 14 days following each schedule date to the regional office and the Enforcement Division (MC 224).

## 7. Noncompliance Notification

- a. In accordance with 30 TAC §305.125(9) any noncompliance that may endanger human health or safety, or the environment shall be reported by the permittee to the TCEQ. Report of such information shall be provided orally or by facsimile transmission (FAX) to the regional office within 24 hours of becoming aware of the noncompliance. A written submission of such information shall also be provided by the permittee to the regional office and the Enforcement Division (MC 224) within five working days of becoming aware of the noncompliance. For Publicly Owned Treatment Works (POTWs), effective September 1, 2020, the permittee must submit the written report for unauthorized discharges and unanticipated bypasses that exceed any effluent limit in the permit using the online electronic reporting system available through the TCEQ website unless the permittee requests and obtains an electronic reporting waiver. The written submission shall contain a description of the noncompliance and its cause; the potential danger to human health or safety, or the environment; the period of noncompliance, including exact dates and times; if the noncompliance has not been corrected, the time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance, and to mitigate its adverse effects.
- b. The following violations shall be reported under Monitoring and Reporting Requirement 7.a.:
  - i. unauthorized discharges as defined in Permit Condition 2(g).
  - ii. any unanticipated bypass that exceeds any effluent limitation in the permit.
  - iii. violation of a permitted maximum daily discharge limitation for pollutants listed specifically in the Other Requirements section of an Industrial TPDES permit.
- c. In addition to the above, any effluent violation that deviates from the permitted effluent limitation by more than 40% shall be reported by the permittee in writing to the regional office and the Enforcement Division (MC 224) within 5 working days of becoming aware of the noncompliance.
- d. Any noncompliance other than that specified in this section, or any required information not submitted or submitted incorrectly, shall be reported to the Enforcement Division (MC 224) as promptly as possible. For effluent limitation violations, noncompliances shall be reported on the approved self-report form.

8. In accordance with the procedures described in 30 TAC §§35.301 - 35.303 (relating to Water Quality Emergency and Temporary Orders) if the permittee knows in advance of the need for a bypass, it shall submit prior notice by applying for such authorization.

## 9. Changes in Discharges of Toxic Substances

All existing manufacturing, commercial, mining, and silvicultural permittees shall notify the regional office, orally or by facsimile transmission within 24 hours, and both the regional office and the Enforcement Division (MC 224) in writing within five (5) working days, after becoming aware of or having reason to believe:

- a. That any activity has occurred or will occur that would result in the discharge, on a routine or frequent basis, of any toxic pollutant listed at 40 CFR Part 122, Appendix D, Tables II and III (excluding Total Phenols) that is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":
  - i. one hundred micrograms per liter (100 µg/L);
  - ii. two hundred micrograms per liter (200 µg/L) for acrolein and acrylonitrile; five hundred micrograms per liter (500 µg/L) for 2,4-dinitrophenol and for 2-methyl-4,6-dinitrophenol; and one milligram per liter (1 mg/L) for antimony;
  - iii. five (5) times the maximum concentration value reported for that pollutant in the permit application; or
  - iv. the level established by the TCEQ.

- b. That any activity has occurred or will occur that would result in any discharge, on a nonroutine or infrequent basis, of a toxic pollutant that is not limited in the permit, if that discharge will exceed the highest of the following "notification levels":
  - i. five hundred micrograms per liter (500 µg/L);
  - ii. one milligram per liter (1 mg/L) for antimony;
  - iii. ten (10) times the maximum concentration value reported for that pollutant in the permit application; or
  - iv. the level established by the TCEQ.

#### 10. Signatories to Reports

All reports and other information requested by the Executive Director shall be signed by the person and in the manner required by 30 TAC §305.128 (relating to Signatories to Reports).

#### 11. All POTWs must provide adequate notice to the Executive Director of the following:

- a. any new introduction of pollutants into the POTW from an indirect discharger that would be subject to CWA §301 or §306 if it were directly discharging those pollutants;
- b. any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of issuance of the permit; and
- c. for the purpose of this paragraph, adequate notice shall include information on:
  - i. the quality and quantity of effluent introduced into the POTW; and
  - ii. any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW.

### PERMIT CONDITIONS

#### 1. General

- a. When the permittee becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in an application or in any report to the Executive Director, it shall promptly submit such facts or information.
- b. This permit is granted on the basis of the information supplied and representations made by the permittee during action on an application, and relying upon the accuracy and completeness of that information and those representations. After notice and opportunity for a hearing, this permit may be modified, suspended, or revoked, in whole or in part, in accordance with 30 TAC Chapter 305, Subchapter D, during its term for good cause including, but not limited to, the following:
  - i. violation of any terms or conditions of this permit;
  - ii. obtaining this permit by misrepresentation or failure to disclose fully all relevant facts; or
  - iii. a change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge.
- c. The permittee shall furnish to the Executive Director, upon request and within a reasonable time, any information to determine whether cause exists for amending, revoking, suspending, or terminating the permit. The permittee shall also furnish to the Executive Director, upon request, copies of records required to be kept by the permit.

#### 2. Compliance

- a. Acceptance of the permit by the person to whom it is issued constitutes acknowledgment and agreement that such person will comply with all the terms and conditions embodied in the permit, and the rules and other orders of the Commission.
- b. The permittee has a duty to comply with all conditions of the permit. Failure to comply with any permit condition constitutes a violation of the permit and the Texas Water Code or the Texas Health and Safety Code, and is grounds for enforcement action, for permit amendment,

revocation, or suspension, or for denial of a permit renewal application or an application for a permit for another facility.

- c. It shall not be a defense for a permittee in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of the permit.
- d. The permittee shall take all reasonable steps to minimize or prevent any discharge or sludge use or disposal or other permit violation that has a reasonable likelihood of adversely affecting human health or the environment.
- e. Authorization from the Commission is required before beginning any change in the permitted facility or activity that may result in noncompliance with any permit requirements.
- f. A permit may be amended, suspended and reissued, or revoked for cause in accordance with 30 TAC §§305.62 and 305.66 and TWC §7.302. The filing of a request by the permittee for a permit amendment, suspension and reissuance, or termination, or a notification of planned changes or anticipated noncompliance, does not stay any permit condition.
- g. There shall be no unauthorized discharge of wastewater or any other waste. For the purpose of this permit, an unauthorized discharge is considered to be any discharge of wastewater into or adjacent to water in the state at any location not permitted as an outfall or otherwise defined in the Other Requirements section of this permit.
- h. In accordance with 30 TAC §305.535(a), the permittee may allow any bypass to occur from a TPDES permitted facility that does not cause permitted effluent limitations to be exceeded or an unauthorized discharge to occur, but only if the bypass is also for essential maintenance to assure efficient operation.
- i. The permittee is subject to administrative, civil, and criminal penalties, as applicable, under Texas Water Code §§7.051 - 7.075 (relating to Administrative Penalties), 7.101 - 7.111 (relating to Civil Penalties), and 7.141 - 7.202 (relating to Criminal Offenses and Penalties) for violations including, but not limited to, negligently or knowingly violating the federal CWA §§301, 302, 306, 307, 308, 318, or 405, or any condition or limitation implementing any sections in a permit issued under the CWA §402, or any requirement imposed in a pretreatment program approved under the CWA §§402(a)(3) or 402(b)(8).

### 3. Inspections and Entry

- a. Inspection and entry shall be allowed as prescribed in the TWC Chapters 26, 27, and 28, and THSC Chapter 361.
- b. The members of the Commission and employees and agents of the Commission are entitled to enter any public or private property at any reasonable time for the purpose of inspecting and investigating conditions relating to the quality of water in the state or the compliance with any rule, regulation, permit, or other order of the Commission. Members, employees, or agents of the Commission and Commission contractors are entitled to enter public or private property at any reasonable time to investigate or monitor or, if the responsible party is not responsive or there is an immediate danger to public health or the environment, to remove or remediate a condition related to the quality of water in the state. Members, employees, Commission contractors, or agents acting under this authority who enter private property shall observe the establishment's rules and regulations concerning safety, internal security, and fire protection, and if the property has management in residence, shall notify management or the person then in charge of his presence and shall exhibit proper credentials. If any member, employee, Commission contractor, or agent is refused the right to enter in or on public or private property under this authority, the Executive Director may invoke the remedies authorized in TWC §7.002. The statement above, that Commission entry shall occur in accordance with an establishment's rules and regulations concerning safety, internal security, and fire protection, is not grounds for denial or restriction of entry to any part of the facility, but merely describes the Commission's duty to observe appropriate rules and regulations during an inspection.

#### 4. Permit Amendment or Renewal

- a. The permittee shall give notice to the Executive Director as soon as possible of any planned physical alterations or additions to the permitted facility if such alterations or additions would require a permit amendment or result in a violation of permit requirements. Notice shall also be required under this paragraph when:
  - i. the alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in accordance with 30 TAC §305.534 (relating to New Sources and New Dischargers); or
  - ii. the alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are subject neither to effluent limitations in the permit, nor to notification requirements in Monitoring and Reporting Requirements No. 9; or
  - iii. the alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan.
- b. Prior to any facility modifications, additions, or expansions that will increase the plant capacity beyond the permitted flow, the permittee must apply for and obtain proper authorization from the Commission before commencing construction.
- c. The permittee must apply for an amendment or renewal at least 180 days prior to expiration of the existing permit in order to continue a permitted activity after the expiration date of the permit. If an application is submitted prior to the expiration date of the permit, the existing permit shall remain in effect until the application is approved, denied, or returned. If the application is returned or denied, authorization to continue such activity shall terminate upon the effective date of the action. If an application is not submitted prior to the expiration date of the permit, the permit shall expire and authorization to continue such activity shall terminate.
- d. Prior to accepting or generating wastes that are not described in the permit application or that would result in a significant change in the quantity or quality of the existing discharge, the permittee must report the proposed changes to the Commission. The permittee must apply for a permit amendment reflecting any necessary changes in permit conditions, including effluent limitations for pollutants not identified and limited by this permit.
- e. In accordance with the TWC §26.029(b), after a public hearing, notice of which shall be given to the permittee, the Commission may require the permittee, from time to time, for good cause, in accordance with applicable laws, to conform to new or additional conditions.
- f. If any toxic effluent standard or prohibition (including any schedule of compliance specified in such effluent standard or prohibition) is promulgated under CWA §307(a) for a toxic pollutant that is present in the discharge and that standard or prohibition is more stringent than any limitation on the pollutant in this permit, this permit shall be modified or revoked and reissued to conform to the toxic effluent standard or prohibition. The permittee shall comply with effluent standards or prohibitions established under CWA §307(a) for toxic pollutants within the time provided in the regulations that established those standards or prohibitions, even if the permit has not yet been modified to incorporate the requirement.

#### 5. Permit Transfer

- a. Prior to any transfer of this permit, Commission approval must be obtained. The Commission shall be notified in writing of any change in control or ownership of facilities authorized by this permit. Such notification should be sent to the Applications Review and Processing Team (MC 148) of the Water Quality Division.
- b. A permit may be transferred only according to the provisions of 30 TAC §305.64 (relating to Transfer of Permits) and 30 TAC §50.133 (relating to Executive Director Action on Application or WQMP update).

#### 6. Relationship to Hazardous Waste Activities

This permit does not authorize any activity of hazardous waste storage, processing, or disposal that requires a permit or other authorization pursuant to the Texas Health and Safety Code.

#### 7. Relationship to Water Rights

Disposal of treated effluent by any means other than discharge directly to water in the state must be specifically authorized in this permit and may require a permit pursuant to Texas Water Code Chapter 11.

#### 8. Property Rights

A permit does not convey any property rights of any sort, or any exclusive privilege.

#### 9. Permit Enforceability

The conditions of this permit are severable, and if any provision of this permit, or the application of any provision of this permit to any circumstances, is held invalid, the application of such provision to other circumstances, and the remainder of this permit, shall not be affected thereby.

#### 10. Relationship to Permit Application

The application pursuant to which the permit has been issued is incorporated herein; provided, however, that in the event of a conflict between the provisions of this permit and the application, the provisions of the permit shall control.

#### 11. Notice of Bankruptcy.

- a. Each permittee shall notify the Executive Director, in writing, immediately following the filing of a voluntary or involuntary petition for bankruptcy under any chapter of Title 11 (Bankruptcy) of the United States Code (11 USC) by or against:
  - i. the permittee;
  - ii. an entity (as that term is defined in 11 USC, §101(15)) controlling the permittee or listing the permit or permittee as property of the estate; or
  - iii. an affiliate (as that term is defined in 11 USC, §101(2)) of the permittee.
- b. This notification must indicate:
  - i. the name of the permittee;
  - ii. the permit number(s);
  - iii. the bankruptcy court in which the petition for bankruptcy was filed; and
  - iv. the date of filing of the petition.

### **OPERATIONAL REQUIREMENTS**

1. The permittee shall at all times ensure that the facility and all of its systems of collection, treatment, and disposal are properly operated and maintained. This includes, but is not limited to, the regular, periodic examination of wastewater solids within the treatment plant by the operator in order to maintain an appropriate quantity and quality of solids inventory as described in the various operator training manuals and according to accepted industry standards for process control. Process control, maintenance, and operations records shall be retained at the facility site, or shall be readily available for review by a TCEQ representative, for a period of three years.
2. Upon request by the Executive Director, the permittee shall take appropriate samples and provide proper analysis in order to demonstrate compliance with Commission rules. Unless otherwise specified in this permit or otherwise ordered by the Commission, the permittee shall comply with all applicable provisions of 30 TAC Chapter 312 concerning sewage sludge use and disposal and 30 TAC §§319.21 - 319.29 concerning the discharge of certain hazardous metals.

3. Domestic wastewater treatment facilities shall comply with the following provisions:
  - a. The permittee shall notify the Domestic Permits Team, Domestic Wastewater Section (MC 148) of the Water Quality Division, in writing, of any facility expansion at least 90 days prior to conducting such activity.
  - b. The permittee shall submit a closure plan for review and approval to the Domestic Permits Team, Domestic Wastewater Section (MC 148) of the Water Quality Division, for any closure activity at least 90 days prior to conducting such activity. Closure is the act of permanently taking a waste management unit or treatment facility out of service and includes the permanent removal from service of any pit, tank, pond, lagoon, surface impoundment or other treatment unit regulated by this permit.
4. The permittee is responsible for installing prior to plant start-up, and subsequently maintaining, adequate safeguards to prevent the discharge of untreated or inadequately treated wastes during electrical power failures by means of alternate power sources, standby generators, or retention of inadequately treated wastewater.
5. Unless otherwise specified, the permittee shall provide a readily accessible sampling point and, where applicable, an effluent flow measuring device or other acceptable means by which effluent flow may be determined.
6. The permittee shall remit an annual water quality fee to the Commission as required by 30 TAC Chapter 21. Failure to pay the fee may result in revocation of this permit under TWC §7.302(b)(6).
7. Documentation

For all written notifications to the Commission required of the permittee by this permit, the permittee shall keep and make available a copy of each such notification under the same conditions as self-monitoring data are required to be kept and made available. Except for information required for TPDES permit applications, effluent data, including effluent data in permits, draft permits and permit applications, and other information specified as not confidential in 30 TAC §1.5(d), any information submitted pursuant to this permit may be claimed as confidential by the submitter. Any such claim must be asserted in the manner prescribed in the application form or by stamping the words "confidential business information" on each page containing such information. If no claim is made at the time of submission, information may be made available to the public without further notice. If the Commission or Executive Director agrees with the designation of confidentiality, the TCEQ will not provide the information for public inspection unless required by the Texas Attorney General or a court pursuant to an open records request. If the Executive Director does not agree with the designation of confidentiality, the person submitting the information will be notified.

8. Facilities that generate domestic wastewater shall comply with the following provisions; domestic wastewater treatment facilities at permitted industrial sites are excluded.
  - a. Whenever flow measurements for any domestic sewage treatment facility reach 75% of the permitted daily average or annual average flow for three consecutive months, the permittee must initiate engineering and financial planning for expansion or upgrading of the domestic wastewater treatment or collection facilities. Whenever the flow reaches 90% of the permitted daily average or annual average flow for three consecutive months, the permittee shall obtain necessary authorization from the Commission to commence construction of the necessary additional treatment or collection facilities. In the case of a domestic wastewater treatment facility that reaches 75% of the permitted daily average or annual average flow for three consecutive months, and the planned population to be served or the quantity of waste produced is not expected to exceed the design limitations of the treatment facility, the permittee shall submit an engineering report supporting this claim to the Executive Director of the Commission.

If in the judgment of the Executive Director the population to be served will not cause permit noncompliance, then the requirement of this section may be waived. To be effective, any waiver must be in writing and signed by the Director of the Enforcement Division (MC 219) of the Commission, and such waiver of these requirements will be reviewed upon expiration of the existing permit; however, any such waiver shall not be interpreted as condoning or excusing any violation of any permit parameter.

- b. The plans and specifications for domestic sewage collection and treatment works associated with any domestic permit must be approved by the Commission, and failure to secure approval before commencing construction of such works or making a discharge is a violation of this permit and each day is an additional violation until approval has been secured.
  - c. Permits for domestic wastewater treatment plants are granted subject to the policy of the Commission to encourage the development of area-wide waste collection, treatment, and disposal systems. The Commission reserves the right to amend any domestic wastewater permit in accordance with applicable procedural requirements to require the system covered by this permit to be integrated into an area-wide system, should such be developed; to require the delivery of the wastes authorized to be collected in, treated by or discharged from said system, to such area-wide system; or to amend this permit in any other particular to effectuate the Commission's policy. Such amendments may be made when the changes required are advisable for water quality control purposes and are feasible on the basis of waste treatment technology, engineering, financial, and related considerations existing at the time the changes are required, exclusive of the loss of investment in or revenues from any then existing or proposed waste collection, treatment or disposal system.
9. Domestic wastewater treatment plants shall be operated and maintained by sewage plant operators holding a valid certificate of competency at the required level as defined in 30 TAC Chapter 30.
  10. For Publicly Owned Treatment Works (POTWs), the 30-day average (or monthly average) percent removal for BOD and TSS shall not be less than 85%, unless otherwise authorized by this permit.
  11. Facilities that generate industrial solid waste as defined in 30 TAC §335.1 shall comply with these provisions:
    - a. Any solid waste, as defined in 30 TAC §335.1 (including but not limited to such wastes as garbage, refuse, sludge from a waste treatment, water supply treatment plant or air pollution control facility, discarded materials, discarded materials to be recycled, whether the waste is solid, liquid, or semisolid), generated by the permittee during the management and treatment of wastewater, must be managed in accordance with all applicable provisions of 30 TAC Chapter 335, relating to Industrial Solid Waste Management.
    - b. Industrial wastewater that is being collected, accumulated, stored, or processed before discharge through any final discharge outfall, specified by this permit, is considered to be industrial solid waste until the wastewater passes through the actual point source discharge and must be managed in accordance with all applicable provisions of 30 TAC Chapter 335.
    - c. The permittee shall provide written notification, pursuant to the requirements of 30 TAC §335.8(b)(1), to the Corrective Action Section (MC 127) of the Remediation Division informing the Commission of any closure activity involving an Industrial Solid Waste Management Unit, at least 90 days prior to conducting such an activity.
    - d. Construction of any industrial solid waste management unit requires the prior written notification of the proposed activity to the Registration and Reporting Section (MC 129) of the Permitting and Remediation Support Division. No person shall dispose of industrial solid waste, including sludge or other solids from wastewater treatment processes, prior to fulfilling the deed recordation requirements of 30 TAC §335.5.
    - e. The term "industrial solid waste management unit" means a landfill, surface impoundment, waste-pile, industrial furnace, incinerator, cement kiln, injection well, container, drum, salt dome waste containment cavern, or any other structure vessel, appurtenance, or other improvement on land used to manage industrial solid waste.
    - f. The permittee shall keep management records for all sludge (or other waste) removed from any wastewater treatment process. These records shall fulfill all applicable requirements of 30 TAC Chapter 335 and must include the following, as it pertains to wastewater treatment and discharge:
      - i. volume of waste and date(s) generated from treatment process;
      - ii. volume of waste disposed of on-site or shipped off-site;
      - iii. date(s) of disposal;

- iv. identity of hauler or transporter;
- v. location of disposal site; and
- vi. method of final disposal.

The above records shall be maintained on a monthly basis. The records shall be retained at the facility site, or shall be readily available for review by authorized representatives of the TCEQ for at least five years.

12. For industrial facilities to which the requirements of 30 TAC Chapter 335 do not apply, sludge and solid wastes, including tank cleaning and contaminated solids for disposal, shall be disposed of in accordance with THSC Code Chapter 361.

TCEQ Revision 05/2021

**OTHER REQUIREMENTS**

1. Violations of daily maximum limitations for the following pollutants shall be reported orally or by facsimile to TCEQ Region 13 within 24 hours from the time the permittee becomes aware of the violation, followed by a written report within five working days to TCEQ Region 13 and Compliance Monitoring Team (MC 224): None
2. Upon the first discharge of wastewater via Outfall 001 after permit issuance, the permittee must sample the discharge and have it analyzed as directed below for those parameters listed in Tables 1 and 2, of Attachment 1 of this permit. Sampling and analytical testing at Outfall 001 must be conducted for a minimum of two (2) separate sampling events which are a minimum of one (1) week apart. Results of the analytical testing must be submitted within 90 days of sampling the second discharge. Based on a technical review of the submitted analytical results, an amendment may be initiated by TCEQ staff to include additional effluent limitations, monitoring requirements, or both.

Tables 1 & 2: Wastewater must be sampled and analyzed for those parameters listed in Tables 1 and 2 for a minimum of two sampling events. Report an average and maximum value.

Table 3: For all pollutants listed in Table 3, the permittee shall indicate whether each pollutant is believed to be present or absent in the discharge. Sampling and analysis must be conducted for each pollutant believed present for a minimum of one sampling event.

The permittee shall report the flow at Outfall 001 in million gallons per day (MGD) in the attachment. The permittee shall indicate on each table whether the samples are composite (C) or grab (G) by checking the appropriate box.

3. The term "clarifier water" shall mean the discharge from the water treatment plant clarifier unit. Water is discharged from the clarifier when source water to the clarifier exceeds the established turbidity level.
4. This permit does not authorize the discharge of domestic wastewater. All domestic wastewater must be disposed of in an approved manner such as routing to an approved on-site septic tank and drainfield system or to an authorized third party for treatment and disposal.
5. There is no mixing zone established for this discharge to an intermittent stream. Acute toxic criteria apply at the point of discharge.

**Attachment A**

**Table 1 – Conventionals and Non-conventionals**

<b>Outfall No.:</b>	<input type="checkbox"/> C <input type="checkbox"/> G	<b>Effluent Concentration (mg/L)</b>				
<b>Pollutant</b>		<b>Samp.</b>	<b>Samp.</b>	<b>Samp.</b>	<b>Samp.</b>	<b>Average</b>
Flow (MGD)						
BOD (5-day)						
CBOD (5-day)						
Chemical Oxygen Demand						
Total Organic Carbon						
Dissolved Oxygen						
Ammonia Nitrogen						
Total Suspended Solids						
Nitrate Nitrogen						
Total Organic Nitrogen						
Total Phosphorus						
Oil and Grease						
Total Residual Chlorine						
Total Dissolved Solids						
Sulfate						
Chloride						
Fluoride						
Total Alkalinity (mg/L as CaCO <sub>3</sub> )						
Temperature (°F)						
pH (Standard Units; min/max)						

## Attachment A

Table 2 – Metals

Pollutant	Effluent Concentration (µg/L) <sup>1</sup>					MAL <sup>2</sup> (µg/L)
	Samp.	Samp.	Samp.	Samp.	Average	
Aluminum, Total						2.5
Antimony, Total						5
Arsenic, Total						0.5
Barium, Total						3
Beryllium, Total						0.5
Cadmium, Total						1
Chromium, Total						3
Chromium, Hexavalent						3
Chromium, Trivalent						N/A
Copper, Total						2
Cyanide, Free						10
Lead, Total						0.5
Mercury, Total						0.005
Nickel, Total						2
Selenium, Total						5
Silver, Total						0.5
Thallium, Total						0.5
Zinc, Total						5.0

Table 3

Outfall No.	<input type="checkbox"/> C <input type="checkbox"/> G	Believed Present	Believed Absent	Average Conc. (mg/L)	Maximum Conc. (mg/L)	No. of Samples	MAL (mg/L)
Bromide							0.400
Color (PCU)							—
Nitrate-Nitrite (as N)							—
Sulfide (as S)							—
Sulfite (as SO <sub>3</sub> )							—
Surfactants							—
Boron, total							0.020
Cobalt, total							0.0003
Iron, total							0.007
Magnesium, total							0.020
Manganese, total							0.0005
Molybdenum, total							0.001
Tin, total							0.005
Titanium, total							0.030

<sup>1</sup> Indicate units if different than µg/L.

<sup>2</sup> Minimum Analytical Level

STATEMENT OF BASIS/TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION

**DESCRIPTION OF APPLICATION**

Applicant: San Antonio Water System; Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0004437000 (EPA I.D. No. TX0125083)

Regulated activity: Industrial wastewater permit

Type of application: Renewal

Request: Renewal without changes

Authority: Federal Clean Water Act (CWA) §402; Texas Water Code (TWC) §26.027; 30 Texas Administrative Code (TAC) Chapter 305, Subchapters C-F, and Chapters 307 and 319; commission policies; and Environmental Protection Agency (EPA) guidelines

**EXECUTIVE DIRECTOR RECOMMENDATION**

The Executive Director has made a preliminary decision that this permit, if issued, meets all statutory and regulatory requirements. The draft permit will expire at midnight, five years from the date of permit issuance according to the requirements of 30 TAC §305.127(1)(C)(i).

**REASON FOR PROJECT PROPOSED**

The applicant applied to the Texas Commission on Environmental Quality (TCEQ) for a renewal of its existing permit.

**PROJECT DESCRIPTION AND LOCATION**

The applicant currently operates the Ultrafiltration Water Treatment Plant, a potable water treatment plant facility.

The wastewater system consists of raw water, drawn from the Medina River, receiving treatment as a potable water supply for the City of San Antonio and, under normal operating conditions, there is no discharge of wastewater from the facility. Discharge from this facility only occurs when the turbidity level of the raw water exceeds the maximum allowable level for treatment and the water from the treatment unit is discharged, via Outfall 001, to allow the proper operation of the membrane filters within the treatment unit and to allow enough flow to maintain proper levels within the water treatment unit.

Domestic wastewater produced at the facility is routed to the San Antonio Water System Medio Creek Water Recycling Center TPDES Permit No. WQ0010137040 for treatment and disposal.

The facility is located at 6725 Moreno Street, in the City of Von Ormy, in Bexar County, Texas

**Routes and Designated Uses**

The effluent is discharged to an unnamed ditch, thence to O. R. Mitchell Lake 1, thence to Medio Creek, in Segment No. 1912 of the San Antonio River Basin. The unclassified receiving water uses are minimal aquatic life for the unnamed ditch and high aquatic life for Mitchell Lake 1. The designated uses for Segment No. 1912 are primary contact recreation and intermediate aquatic life use. The

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

effluent limits in the draft permit will maintain and protect the existing instream uses. All determinations are preliminary and subject to additional review and revisions.

**Endangered Species Review**

The discharge from this permit is not expected to have an effect on any federal endangered or threatened aquatic or aquatic-dependent species or proposed species or their critical habitat. This determination is based on the United States Fish and Wildlife Service's (USFWS) biological opinion on the State of Texas authorization of the TPDES (September 14, 1998; October 21, 1998 update). To make this determination for TPDES permits, TCEQ and the EPA only considered aquatic or aquatic-dependent species occurring in watersheds of critical concern or high priority as listed in Appendix A of the USFWS's biological opinion. The determination is subject to reevaluation due to subsequent updates or amendments to the biological opinion. The permit does not require EPA review with respect to the presence of endangered or threatened species.

**Impaired Water Bodies**

Segment No. 1912 is currently listed in the State's inventory of impaired and threatened waters (the **2024** Clean Water Act Section 303(d) list). This listing is for elevated bacteria levels in water from the confluence with the Medina River in Bexar County to a point 1.0 km (0.6 mi) upstream of IH 35 at San Antonio in Bexar County (AU 1912\_01).

The proposed issuance of the draft permit is not anticipated to cause any additional adverse impact to the receiving waters with respect to the listed impairments. There are no sources for bacteria associated with the discharge from this facility. Additionally, this is a renewal without changes so it will not increase any pollutant loading in the segment.

**Completed Total Maximum Daily Loads (TMDLs)**

There are no completed TMDLs for Segment No. 1912.

**Dissolved Oxygen**

Due to the low levels of oxygen-demanding constituents expected from this type of waste stream, no significant dissolved oxygen depletion is anticipated in the receiving waters as a result of this discharge.

**SUMMARY OF EFFLUENT DATA**

Self-reporting data is not available because the facility did not discharge during the reporting period.

**DRAFT PERMIT CONDITIONS**

The draft permit authorizes the discharge of clarifier water at an intermittent and variable-flow basis via Outfall 001

Effluent limitations are established in the draft permit as follows:

Outfall	Pollutant	Daily Average mg/L	Daily Maximum mg/L
001	Flow	Report, MGD	Report, MGD
	TSS	N/A	45
	pH	6.0 SU (minimum)	9.0 SU

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

OUTFALL LOCATIONS

Outfall	Latitude	Longitude
001	29.320012 N	98.634408 W

**Technology-Based Effluent Limitations**

Regulations in Title 40 of the Code of Federal Regulations (40 CFR) require that technology-based limitations be placed in wastewater discharge permits based on effluent limitations guidelines, where applicable, or on best professional judgment (BPJ) in the absence of guidelines. The discharge of clarifier water via Outfall 001 is not subject to the technology-based limitations located in Title 40 CFR. Monitoring and reporting requirements for flow at Outfall is continued from the existing permit and are required by 40 CFR §122.44(i)(1)(ii). Effluent limitations for TSS and pH are continued from the existing permit based on EPA anti-backsliding regulations [40 CFR §122.44(l)] and were originally based on BPJ.

**Water Quality-Based Effluent Limitations**

Calculations of water quality-based effluent limitations for the protection of aquatic life are presented in Appendix A. Aquatic life criteria established in Table 1 and human health criteria established in Table 2 of 30 TAC Chapter 307 are incorporated into the calculations, as are recommendations in the Water Quality Assessment Team's memorandum dated February 7, 2025. TCEQ practice for determining significant potential is to compare the reported analytical data from the facility against percentages of the calculated daily average water quality-based effluent limitation. Permit limitations are required when analytical data reported in the application exceeds 85 percent of the calculated daily average water quality-based effluent limitation. Monitoring and reporting is required when analytical data reported in the application exceeds 70 percent of the calculated daily average water quality-based effluent limitation.

No analytical data was submitted in the application; therefore, Other Requirements No. 2 has been continued in the draft permit, which requires the permittee to conduct sampling upon the first discharge after permit issuance and submit the analytical data to the TCEQ, Industrial Wastewater Permits Team (MC-148). Based on a technical review of the submitted analytical results, an amendment may be initiated by TCEQ staff to include additional effluent limitations, monitoring requirements, or both.

**Total Dissolved Solids (TDS), Chloride, and Sulfate Screening**

Screening for TDS, chloride, and sulfate will be conducted when the permittee submits the analytical data required in Other Requirements No. 2 of the draft permit to the TCEQ, Industrial Wastewater Permits Team (MC-148). Screening procedures are conducted and effluent limitations for TDS, chloride, and/or sulfate are calculated using the methodology in the *Procedures to Implement the Texas Surface Water Quality Standards*, June 2010, and criteria in the Texas Surface Water Quality Standards (30 TAC Chapter 307). Based on a technical review of the screening results, an amendment may be initiated by TCEQ staff to include additional effluent limitations, monitoring requirements, or both.

**pH Screening**

The existing permit includes pH limits of 6.0 – 9.0 SU at Outfall 001, which discharge into an unclassified water body. Consistent with the procedures for pH screening that were submitted to EPA with a letter dated May 28, 2014, and approved by EPA in a letter dated June 2, 2014, requiring a discharge to an unclassified water body to meet pH limits of 6.0 – 9.0 standard units reasonably ensures instream compliance with *Texas Surface Water Quality Standards* pH criteria. These limits have been carried forward in the draft permit.

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

**Whole Effluent Toxicity Testing (Biomonitoring)**

Biomonitoring requirements not included in the draft permit.

The existing permit did not establish biomonitoring requirements and discharges authorized by this permit do not meet the threshold established in the *Procedures to Implement the Texas Surface Water Quality Standards* (RG-194) to impose biomonitoring requirements.

**SUMMARY OF CHANGES FROM APPLICATION**

1. The retest requirement (Other Requirement No. 2) has been revised to include an additional table of parameters.

**SUMMARY OF CHANGES FROM EXISTING PERMIT**

The following additional changes have been made to the draft permit.

1. Pages 3-13 were updated (May 2021 version).

**BASIS FOR DRAFT PERMIT**

The following items were considered in developing the draft permit:

1. Application received on September 30, 2024.
2. Existing permits: TPDES Permit No. WQ0004437000 issued on February 10, 2020.
3. TCEQ Rules.
4. *Texas Surface Water Quality Standards* – 30 TAC §§307.1-307.10, effective March 1, 2018, as approved by EPA Region 6.
5. *Texas Surface Water Quality Standards* – 30 TAC §§307.1-307.10, effective March 6, 2014, as approved by EPA Region 6, for portions of the 2018 standards not approved by EPA Region 6.
6. *Texas Surface Water Quality Standards* – 30 TAC §§307.1-307.10, effective July 22, 2010, as approved by EPA Region 6, for portions of the 2014 standards not approved by EPA Region 6.
7. *Texas Surface Water Quality Standards* – 30 TAC §§307.1-307.10, effective August 17, 2000, and Appendix E, effective February 27, 2002, for portions of the 2010 standards not approved by EPA Region 6.
8. *Procedures to Implement the Texas Surface Water Quality Standards* (IPs), Texas Commission on Environmental Quality, June 2010, as approved by EPA Region 6.
9. *Procedures to Implement the Texas Surface Water Quality Standards*, Texas Commission on Environmental Quality, January 2003, for portions of the 2010 IPs not approved by EPA Region 6.
10. Memos from the Standards Implementation Team and Water Quality Assessment Team of the Water Quality Assessment Section of the TCEQ.
11. *Guidance Document for Establishing Monitoring Frequencies for Domestic and Industrial Wastewater Discharge Permits*, TCEQ Document No. 98-001.000-OWR-WQ, May 1998.
12. EPA Effluent Guidelines: N/A.
13. Consistency with the Coastal Management Plan: N/A
14. Letter dated May 28, 2014, from L'Oreal W. Stepney, P.E., Deputy Director, Office of Water, TCEQ, to Bill Honker, Director, Water Quality Protection Division, EPA (TCEQ proposed development strategy for pH evaluation procedures).
15. Letter dated June 2, 2014, from William K. Honker, P.E., Director, Water Quality Protection Division, EPA, to L'Oreal W. Stepney, P.E., Deputy Director, Office of Water, TCEQ (Approval of TCEQ proposed development strategy for pH evaluation procedures).

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

**PROCEDURES FOR FINAL DECISION**

When an application is declared administratively complete, the chief clerk sends a letter to the applicant advising the applicant to publish the Notice of Receipt of Application and Intent to Obtain Permit in the newspaper. In addition, the Chief Clerk instructs the applicant to place a copy of the application in a public place for reviewing and copying in the county where the facility is or will be located. This application will be in a public place throughout the comment period. The Chief Clerk also mails this notice to any interested persons and, if required, to landowners identified in the permit application. This notice informs the public about the application and provides that an interested person may file comments on the application or request a contested case hearing or a public meeting.

Once a draft permit is completed, it is sent to the Chief Clerk, along with the Executive Director's preliminary decision contained in the technical summary or fact sheet. At that time, the Notice of Application and Preliminary Decision will be mailed to the same people and published in the same newspaper as the prior notice. This notice sets a deadline for making public comments. The applicant must place a copy of the Executive Director's preliminary decision and draft permit in the public place with the application.

Any interested person may request a public meeting on the application until the deadline for filing public comments. A public meeting is intended for the taking of public comment and is not a contested case hearing.

After the public comment deadline, the Executive Director prepares a response to all significant public comments on the application or the draft permit raised during the public comment period. The Chief Clerk then mails the Executive Director's response to comments and final decision to people who have filed comments, requested a contested case hearing, or requested to be on the mailing list. This notice provides that if a person is not satisfied with the Executive Director's response and decision, they can request a contested case hearing or file a request to reconsider the Executive Director's decision within 30 days after the notice is mailed.

The Executive Director will issue the permit unless a written hearing request or request for reconsideration is filed within 30 days after the Executive Director's response to comments and final decision is mailed. If a hearing request or request for reconsideration is filed, the Executive Director will not issue the permit and will forward the application and request to the TCEQ commissioners for their consideration at a scheduled commission meeting. If a contested case hearing is held, it will be a legal proceeding similar to a civil trial in state district court.

If the Executive Director calls a public meeting or the commission grants a contested case hearing as described above, the commission will give notice of the date, time, and place of the meeting or hearing. If a hearing request or request for reconsideration is made, the commission will consider all public comments in making its decision and shall either adopt the Executive Director's response to public comments or prepare its own response.

For additional information about this application, contact John Hoher at (512) 239-5210.

John Hoher  
John Hoher

September 26, 2025  
Date

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

**Appendix A**  
**Calculated Water Quality-Based Effluent Limits**

**TEXTTOX MENU #8 - INTERMITTENT STREAM WITHIN 3 MILES OF A LAKE/RESERVOIR**

The water quality-based effluent limitations developed below are calculated using:

Table 1, 2014 Texas Surface Water Quality Standards (30 TAC 307) for Freshwater Aquatic Life

Table 2, 2018 Texas Surface Water Quality Standards for Human Health

"Procedures to Implement the Texas Surface Water Quality Standards," TCEQ, June 2010

**PERMIT INFORMATION**

Permittee Name:	San Antonio Water System
TPDES Permit No:	WQ0004437000
Outfall No:	001
Prepared by:	John Hocher
Date:	September 26, 2025

**DISCHARGE INFORMATION**

<i>Intermittent Receiving Waterbody:</i>	Unnamed Ditch
TSS (mg/L) (Intermittent):	13
pH (Standard Units) (Intermittent):	7.9
Hardness (mg/L as CaCO <sub>3</sub> ) (Intermittent):	248
Chloride (mg/L) (Intermittent):	84
Effluent Flow for Aquatic Life (MGD)	<10
% Effluent for Acute Aquatic Life (Intermittent):	100
<i>Lake/Reservoir within 3 miles:</i>	O.R. Mitchell Lake 1
Segment No.:	1912
TSS (mg/L) (Lake/Reservoir):	13
pH (Standard Units) (Lake/Reservoir):	7.9
Hardness (mg/L as CaCO <sub>3</sub> ) (Lake/Reservoir):	248
Chloride (mg/L) (Lake/Reservoir):	84
% Effluent for Chronic Aquatic Life (Lake/Reservoir):	22
% Effluent for Acute Aquatic Life (Lake/Reservoir):	89
Effluent Flow for Human Health (MGD):	<10
% Effluent for Human Health (Lake/Reservoir):	11
Human Health Criterion (select: PWS, FISH, or INC)	FISH

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

**CALCULATE DISSOLVED FRACTION (AND ENTER WATER EFFECT RATIO IF APPLICABLE):**

<i>Stream/River Metal</i>	<i>Intercept (b)</i>	<i>Slope (m)</i>	<i>Partition Coefficient (Kp)</i>	<i>Dissolved Fraction (Cd/Ct)</i>	<i>Source</i>	<i>Water Effect Ratio (WER)</i>	<i>Source</i>
Aluminum	N/A	N/A	N/A	1	Assumed	1	Assumed
Arsenic	5.68	-0.73	73590.432	0.5110709	0	1	Assumed
Cadmium	6.6	-1.13	219403.73	0.2595887	0	1	Assumed
Chromium (total)	6.52	-0.93	304812.44	0.2015088	0	1	Assumed
Chromium (trivalent)	6.52	-0.93	304812.44	0.2015088	0	1	Assumed
Chromium (hexavalent)	N/A	N/A	N/A	1	Assumed	1	Assumed
Copper	6.02	-0.74	156921.31	0.3289499	0	1	Assumed
Lead	6.45	-0.8	362114	0.1752086	0	1	Assumed
Mercury	N/A	N/A	N/A	1	Assumed	1	Assumed
Nickel	5.69	-0.57	113514.75	0.4039275	0	1	Assumed
Selenium	N/A	N/A	N/A	1	Assumed	1	Assumed
Silver	6.38	-1.03	170859.19	0.3104463	0	1	Assumed
Zinc	6.1	-0.7	209044.94	0.2689919	0	1	Assumed

<i>Lake/Reservoir Metal</i>	<i>Intercept (b)</i>	<i>Slope (m)</i>	<i>Partition Coefficient (Kp)</i>	<i>Dissolved Fraction (Cd/Ct)</i>	<i>Source</i>	<i>Water Effect Ratio (WER)</i>	<i>Source</i>
Aluminum	N/A	N/A	N/A	1	Assumed	1	Assumed
Arsenic	5.68	-0.73	73590.432	0.5110709	0	1	Assumed
Cadmium	6.55	-0.92	335098.22	0.1866968	0	1	Assumed
Chromium (total)	6.34	-0.27	1094549.2	0.0656636	0	1	Assumed
Chromium (trivalent)	6.34	-0.27	1094549.2	0.0656636	0	1	Assumed
Chromium (hexavalent)	N/A	N/A	N/A	1	Assumed	1	Assumed
Copper	6.45	-0.9	280188.94	0.2154032	0	1	Assumed
Lead	6.31	-0.53	524336.42	0.1279366	0	1	Assumed
Mercury	N/A	N/A	N/A	1	Assumed	1	Assumed
Nickel	6.34	-0.76	311460.55	0.1980595	0	1	Assumed
Selenium	N/A	N/A	N/A	1	Assumed	1	Assumed
Silver	6.38	-1.03	170859.19	0.3104463	0	1	Assumed
Zinc	6.52	-0.68	578786.67	0.1173127	0	1	Assumed

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

AQUATIC LIFE

CALCULATE DAILY AVERAGE AND DAILY MAXIMUM EFFLUENT LIMITATIONS:

Parameter	FW			WLAa (int. stream) (µg/L)	WLAa (lake) (µg/L)	WLAc (lake) (µg/L)	LTAa			Daily Avg. (µg/L)	Daily Max. (µg/L)
	Acute Criterion (int. stream) (µg/L)	FW Acute Criterion (lake) (µg/L)	FW Chronic Criterion (lake) (µg/L)				(int. stream) (µg/L)	(lake) (µg/L)	(lake) (µg/L)		
Aldrin	3.0	3.0	N/A	3.00	3.37	N/A	1.72	1.08	N/A	1.58	3.35
Aluminum	991	991	N/A	991	1113	N/A	568	356	N/A	523	1108
Arsenic	340	340	150	665	747	1334	381	239	814	351	743
Cadmium	20.74	20.74	0.462	79.9	125	11.2	45.8	39.9	6.86	10.0	21.3
Carbaryl	2.0	2.0	N/A	2.00	2.25	N/A	1.15	0.719	N/A	1.05	2.23
Chlordane	2.4	2.4	0.004	2.40	2.70	0.0182	1.38	0.863	0.0111	0.0163	0.0344
Chlorpyrifos	0.083	0.083	0.041	0.0830	0.0933	0.186	0.0476	0.0298	0.114	0.0438	0.0928
Chromium (trivalent)	1199	1199	155.9	5949	20513	10795	3409	6564	6585	5011	10601
Chromium (hexavalent)	15.7	15.7	10.6	15.7	17.6	48.2	9.00	5.64	29.4	8.29	17.5
Copper	33.42	33.42	20.58	102	174	434	58.2	55.8	265	82.0	173
Cyanide (free)	45.8	45.8	10.7	45.8	51.5	48.6	26.2	16.5	29.7	24.2	51.2
4,4'-DDT	1.1	1.1	0.001	1.10	1.24	0.00455	0.630	0.396	0.00277	0.00407	0.00862
Demeton	N/A	N/A	0.1	N/A	N/A	0.455	N/A	N/A	0.277	0.407	0.862
Diazinon	0.17	0.17	0.17	0.170	0.191	0.773	0.0974	0.0611	0.471	0.0898	0.190
Dicofol [Kelthane]	59.3	59.3	19.8	59.3	66.6	90.0	34.0	21.3	54.9	31.3	66.3
Dieldrin	0.24	0.24	0.002	0.240	0.270	0.00909	0.138	0.0863	0.00555	0.00815	0.0172
Diuron	210	210	70	210	236	318	120	75.5	194	110	234
Endosulfan I (alpha)	0.22	0.22	0.056	0.220	0.247	0.255	0.126	0.0791	0.155	0.116	0.246
Endosulfan II (beta)	0.22	0.22	0.056	0.220	0.247	0.255	0.126	0.0791	0.155	0.116	0.246
Endosulfan sulfate	0.22	0.22	0.056	0.220	0.247	0.255	0.126	0.0791	0.155	0.116	0.246
Endrin	0.086	0.086	0.002	0.0860	0.0966	0.00909	0.0493	0.0309	0.00555	0.00815	0.0172
Guthion [Azinphos Methyl]	N/A	N/A	0.01	N/A	N/A	0.0455	N/A	N/A	0.0277	0.0407	0.0862
Heptachlor	0.52	0.52	0.004	0.520	0.584	0.0182	0.298	0.187	0.0111	0.0163	0.0344
Hexachlorocyclohexane (gamma) [Lindane]	1.126	1.126	0.08	1.13	1.27	0.364	0.645	0.405	0.222	0.326	0.689
Lead	170.9	170.9	6.66	975	1501	237	559	480	144	212	448
Malathion	N/A	N/A	0.01	N/A	N/A	0.0455	N/A	N/A	0.0277	0.0407	0.0862
Mercury	2.4	2.4	1.3	2.40	2.70	5.91	1.38	0.863	3.60	1.26	2.68
Methoxychlor	N/A	N/A	0.03	N/A	N/A	0.136	N/A	N/A	0.0832	0.122	0.258
Mirex	N/A	N/A	0.001	N/A	N/A	0.00455	N/A	N/A	0.00277	0.00407	0.00862
Nickel	1010	1010	112.1	2500	5728	2574	1432	1833	1570	2105	4454
Nonylphenol	28	28	6.6	28.0	31.5	30.0	16.0	10.1	18.3	14.7	31.3
Parathion (ethyl)	0.065	0.065	0.013	0.0650	0.0730	0.0591	0.0372	0.0234	0.0360	0.0343	0.0726
Pentachlorophenol	21.6	21.6	16.54	21.6	24.2	75.2	12.3	7.75	45.8	11.3	24.1
Phenanthrene	30	30	30	30.0	33.7	136	17.2	10.8	83.2	15.8	33.5
Polychlorinated Biphenyls [PCBs]	2.0	2.0	0.014	2.00	2.25	0.0636	1.15	0.719	0.0388	0.0570	0.120
Selenium	20	20	5	20.0	22.5	22.7	11.5	7.19	13.9	10.5	22.3
Silver	0.8	0.8	N/A	18.2	16.2	N/A	10.4	5.18	N/A	7.61	16.1
Toxaphene	0.78	0.78	0.0002	0.780	0.876	0.000909	0.447	0.280	0.000555	0.000815	0.00172
Tributyltin [TBT]	0.13	0.13	0.024	0.130	0.146	0.109	0.0745	0.0467	0.0665	0.0687	0.145
2,4,5 Trichlorophenol	136	136	64	136	153	291	77.9	48.9	177	71.8	152
Zinc	253.0	253.0	255.0	940	2423	9882	539	775	6028	792	1675

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

**HUMAN HEALTH**

**CALCULATE DAILY AVERAGE AND DAILY MAXIMUM EFFLUENT LIMITATIONS**

<i>Parameter</i>	<i>Water and Fish Criterion (µg/L)</i>	<i>Fish Only Criterion (µg/L)</i>	<i>Incidental Fish Criterion (µg/L)</i>	<i>WLAh (µg/L)</i>	<i>LTAh (µg/L)</i>	<i>Daily Avg. (µg/L)</i>	<i>Daily Max. (µg/L)</i>
Acrylonitrile	1.0	115	1150	1045	972	1429	3023
Aldrin	1.146E-05	1.147E-05	1.147E-04	0.000104	0.0000970	0.000142	0.000301
Anthracene	1109	1317	13170	11973	11135	16367	34628
Antimony	6	1071	10710	9736	9055	13310	28160
Arsenic	10	N/A	N/A	N/A	N/A	N/A	N/A
Barium	2000	N/A	N/A	N/A	N/A	N/A	N/A
Benzene	5	581	5810	5282	4912	7220	15276
Benzidine	0.0015	0.107	1.07	0.973	0.905	1.32	2.81
Benzo(a)anthracene	0.024	0.025	0.25	0.227	0.211	0.310	0.657
Benzo(a)pyrene	0.0025	0.0025	0.025	0.0227	0.0211	0.0310	0.0657
Bis(chloromethyl)ether	0.0024	0.2745	2.745	2.50	2.32	3.41	7.21
Bis(2-chloroethyl)ether	0.60	42.83	428.3	389	362	532	1126
Bis(2-ethylhexyl) phthalate [Di(2-ethylhexyl) phthalate]	6	7.55	75.5	68.6	63.8	93.8	198
Bromodichloromethane [Dichlorobromomethane]	10.2	275	2750	2500	2325	3417	7230
Bromoform [Tribromomethane]	66.9	1060	10600	9636	8962	13173	27871
Cadmium	5	N/A	N/A	N/A	N/A	N/A	N/A
Carbon Tetrachloride	4.5	46	460	418	389	571	1209
Chlordane	0.0025	0.0025	0.025	0.0227	0.0211	0.0310	0.0657
Chlorobenzene	100	2737	27370	24882	23140	34015	71965
Chlorodibromomethane [Dibromochloromethane]	7.5	183	1830	1664	1547	2274	4811
Chloroform [Trichloromethane]	70	7697	76970	69973	65075	95659	202382
Chromium (hexavalent)	62	502	5020	4564	4244	6238	13199
Chrysene	2.45	2.52	25.2	22.9	21.3	31.3	66.2
Cresols [Methylphenols]	1041	9301	93010	84555	78636	115594	244557
Cyanide (free)	200	N/A	N/A	N/A	N/A	N/A	N/A
4,4'-DDD	0.002	0.002	0.02	0.0182	0.0169	0.0248	0.0525
4,4'-DDE	0.00013	0.00013	0.0013	0.00118	0.00110	0.00161	0.00341
4,4'-DDT	0.0004	0.0004	0.004	0.00364	0.00338	0.00497	0.0105
2,4'-D	70	N/A	N/A	N/A	N/A	N/A	N/A
Danitol [Fenpropathrin]	262	473	4730	4300	3999	5878	12436
1,2-Dibromoethane [Ethylene Dibromide]	0.17	4.24	42.4	38.5	35.8	52.6	111
<i>m</i> -Dichlorobenzene [1,3-Dichlorobenzene]	322	595	5950	5409	5030	7394	15644
<i>o</i> -Dichlorobenzene [1,2-Dichlorobenzene]	600	3299	32990	29991	27892	41000	86742
<i>p</i> -Dichlorobenzene [1,4-Dichlorobenzene]	75	N/A	N/A	N/A	N/A	N/A	N/A
3,3'-Dichlorobenzidine	0.79	2.24	22.4	20.4	18.9	27.8	58.8
1,2-Dichloroethane	5	364	3640	3309	3077	4523	9570
1,1-Dichloroethylene [1,1-Dichloroethene]	7	55114	551140	501036	465964	684966	1449147
Dichloromethane [Methylene Chloride]	5	13333	133330	121209	112724	165704	350573
1,2-Dichloropropane	5	259	2590	2355	2190	3218	6810
1,3-Dichloropropene [1,3-Dichloropropylene]	2.8	119	1190	1082	1006	1478	3128
Dicofol [Kelthane]	0.30	0.30	3	2.73	2.54	3.72	7.88
Dieldrin	2.0E-05	2.0E-05	2.0E-04	0.000182	0.000169	0.000248	0.000525
2,4-Dimethylphenol	444	8436	84360	76691	71323	104844	221813
Di- <i>n</i> -Butyl Phthalate	88.9	92.4	924	840	781	1148	2429
Dioxins/Furans [TCDD Equivalents]	7.80E-08	7.97E-08	7.97E-07	7.25E-07	6.74E-07	9.90E-07	0.0000021
Endrin	0.02	0.02	0.2	0.182	0.169	0.248	0.525
Epichlorohydrin	53.5	2013	20130	18300	17019	25017	52929

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

<i>Parameter</i>	<i>Water and Fish Criterion (µg/L)</i>	<i>Fish Only Criterion (µg/L)</i>	<i>Incidental Fish Criterion (µg/L)</i>	<i>WLAh (µg/L)</i>	<i>LTAh (µg/L)</i>	<i>Daily Avg. (µg/L)</i>	<i>Daily Max. (µg/L)</i>
Ethylbenzene	700	1867	18670	16973	15785	23203	49090
Ethylene Glycol	46744	1.68E+07	1.68E+08	152727273	142036364	208793454	441733090
Fluoride	4000	N/A	N/A	N/A	N/A	N/A	N/A
Heptachlor	8.0E-05	0.0001	0.001	0.000909	0.000845	0.00124	0.00262
Heptachlor Epoxide	0.00029	0.00029	0.0029	0.00264	0.00245	0.00360	0.00762
Hexachlorobenzene	0.00068	0.00068	0.0068	0.00618	0.00575	0.00845	0.0178
Hexachlorobutadiene	0.21	0.22	2.2	2.00	1.86	2.73	5.78
Hexachlorocyclohexane ( <i>alpha</i> )	0.0078	0.0084	0.084	0.0764	0.0710	0.104	0.220
Hexachlorocyclohexane ( <i>beta</i> )	0.15	0.26	2.6	2.36	2.20	3.23	6.83
Hexachlorocyclohexane ( <i>gamma</i> ) [Lindane]	0.2	0.341	3.41	3.10	2.88	4.23	8.96
Hexachlorocyclopentadiene	10.7	11.6	116	105	98.1	144	305
Hexachloroethane	1.84	2.33	23.3	21.2	19.7	28.9	61.2
Hexachlorophene	2.05	2.90	29	26.4	24.5	36.0	76.2
4,4'-Isopropylidenediphenol [Bisphenol A]	1092	15982	159820	145291	135121	198627	420224
Lead	1.15	3.83	38.3	272	253	372	787
Mercury	0.0122	0.0122	0.122	0.111	0.103	0.151	0.320
Methoxychlor	2.92	3.0	30	27.3	25.4	37.2	78.8
Methyl Ethyl Ketone	13865	9.92E+05	9.92E+06	9018182	8386909	12328756	26083287
Methyl <i>tert</i> -butyl ether [MTBE]	15	10482	104820	95291	88621	130272	275609
Nickel	332	1140	11400	52326	48663	71534	151342
Nitrate-Nitrogen (as Total Nitrogen)	10000	N/A	N/A	N/A	N/A	N/A	N/A
Nitrobenzene	45.7	1873	18730	17027	15835	23277	49247
N-Nitrosodiethylamine	0.0037	2.1	21	19.1	17.8	26.0	55.2
N-Nitroso-di- <i>n</i> -Butylamine	0.119	4.2	42	38.2	35.5	52.1	110
Pentachlorobenzene	0.348	0.355	3.55	3.23	3.00	4.41	9.33
Pentachlorophenol	0.22	0.29	2.9	2.64	2.45	3.60	7.62
Polychlorinated Biphenyls [PCBs]	6.4E-04	6.4E-04	6.40E-03	0.00582	0.00541	0.00795	0.0168
Pyridine	23	947	9470	8609	8006	11769	24900
Selenium	50	N/A	N/A	N/A	N/A	N/A	N/A
1,2,4,5-Tetrachlorobenzene	0.23	0.24	2.4	2.18	2.03	2.98	6.31
1,1,2,2-Tetrachloroethane	1.64	26.35	263.5	240	223	327	692
Tetrachloroethylene [Tetrachloroethylene]	5	280	2800	2545	2367	3479	7362
Thallium	0.12	0.23	2.3	2.09	1.94	2.85	6.04
Toluene	1000	N/A	N/A	N/A	N/A	N/A	N/A
Toxaphene	0.011	0.011	0.11	0.1000	0.0930	0.136	0.289
2,4,5-TP [Silvex]	50	369	3690	3355	3120	4585	9702
1,1,1-Trichloroethane	200	784354	7843540	7130491	6631357	9748094	20623518
1,1,2-Trichloroethane	5	166	1660	1509	1403	2063	4364
Trichloroethylene [Trichloroethene]	5	71.9	719	654	608	893	1890
2,4,5-Trichlorophenol	1039	1867	18670	16973	15785	23203	49090
TTHM [Sum of Total Trihalomethanes]	80	N/A	N/A	N/A	N/A	N/A	N/A
Vinyl Chloride	0.23	16.5	165	150	140	205	433

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

CALCULATE 70% AND 85% OF DAILY AVERAGE EFFLUENT LIMITATIONS:

<b>Aquatic Life</b>	<b>70% of Daily Avg.</b>	<b>85% of Daily Avg.</b>
<b>Parameter</b>	<b>(µg/L)</b>	<b>(µg/L)</b>
Aldrin	1.10	1.34
Aluminum	366	445
Arsenic	246	298
Cadmium	7.06	8.57
Carbaryl	0.739	0.898
Chlordane	0.0114	0.0138
Chlorpyrifos	0.0307	0.0372
Chromium (trivalent)	3507	4259
Chromium (hexavalent)	5.80	7.05
Copper	57.4	69.7
Cyanide (free)	16.9	20.5
4,4'-DDT	0.00285	0.00346
Demeton	0.285	0.346
Diazinon	0.0628	0.0763
Dicofol [Kelthane]	21.9	26.6
Dieldrin	0.00570	0.00692
Diuron	77.6	94.3
Endosulfan I ( <i>alpha</i> )	0.0813	0.0988
Endosulfan II ( <i>beta</i> )	0.0813	0.0988
Endosulfan sulfate	0.0813	0.0988
Endrin	0.00570	0.00692
Guthion [Azinphos Methyl]	0.0285	0.0346
Heptachlor	0.0114	0.0138
Hexachlorocyclohexane ( <i>gamma</i> ) [Lindane]	0.228	0.277
Lead	148	180
Malathion	0.0285	0.0346
Mercury	0.887	1.07
Methoxychlor	0.0855	0.103
Mirex	0.00285	0.00346
Nickel	1473	1789
Nonylphenol	10.3	12.5
Parathion (ethyl)	0.0240	0.0292
Pentachlorophenol	7.97	9.68
Phenanthrene	11.0	13.4
Polychlorinated Biphenyls [PCBs]	0.0399	0.0485
Selenium	7.39	8.98
Silver	5.32	6.46
Toxaphene	0.000570	0.000692
Tributyltin [TBT]	0.0480	0.0584
2,4,5 Trichlorophenol	50.3	61.0
Zinc	554	673

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

<b>Human Health Parameter</b>	<b>70% of Daily Avg. (µg/L)</b>	<b>85% of Daily Avg. (µg/L)</b>
Acrylonitrile	1000	1214
Aldrin	0.0000997	0.000121
Anthracene	11457	13912
Antimony	9317	11313
Arsenic	N/A	N/A
Barium	N/A	N/A
Benzene	5054	6137
Benzidine	0.930	1.13
Benzo(a)anthracene	0.217	0.264
Benzo(a)pyrene	0.0217	0.0264
Bis(chloromethyl)ether	2.38	2.89
Bis(2-chloroethyl)ether	372	452
Bis(2-ethylhexyl) phthalate [Di(2-ethylhexyl) phthalate]	65.6	79.7
Bromodichloromethane [Dichlorobromomethane]	2392	2905
Bromoform [Tribromomethane]	9221	11197
Cadmium	N/A	N/A
Carbon Tetrachloride	400	485
Chlordane	0.0217	0.0264
Chlorobenzene	23811	28913
Chlorodibromomethane [Dibromochloromethane]	1592	1933
Chloroform [Trichloromethane]	66961	81310
Chromium (hexavalent)	4367	5303
Chrysene	21.9	26.6
Cresols [Methylphenols]	80916	98255
Cyanide (free)	N/A	N/A
4,4'-DDD	0.0173	0.0211
4,4'-DDE	0.00113	0.00137
4,4'-DDT	0.00347	0.00422
2,4'-D	N/A	N/A
Danitol [Fenpropathrin]	4114	4996
1,2-Dibromoethane [Ethylene Dibromide]	36.8	44.7
<i>m</i> -Dichlorobenzene [1,3-Dichlorobenzene]	5176	6285
<i>o</i> -Dichlorobenzene [1,2-Dichlorobenzene]	28700	34850
<i>p</i> -Dichlorobenzene [1,4-Dichlorobenzene]	N/A	N/A
3,3'-Dichlorobenzidine	19.4	23.6
1,2-Dichloroethane	3166	3845
1,1-Dichloroethylene [1,1-Dichloroethene]	479476	582221
Dichloromethane [Methylene Chloride]	115993	140849
1,2-Dichloropropane	2253	2736
1,3-Dichloropropene [1,3-Dichloropropylene]	1035	1257
Dicofol [Kelthane]	2.60	3.16
Dieldrin	0.000173	0.000211
2,4-Dimethylphenol	73390	89117
Di- <i>n</i> -Butyl Phthalate	803	976
Dioxins/Furans [TCDD Equivalents]	6.93E-07	8.41E-07
Endrin	0.173	0.211
Epichlorohydrin	17512	21265
Ethylbenzene	16242	19722

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

Human Health Parameter	70% of Daily Avg. (µg/L)	85% of Daily Avg. (µg/L)
Ethylene Glycol	146155418	177474436
Fluoride	N/A	N/A
Heptachlor	0.000869	0.00105
Heptachlor Epoxide	0.00252	0.00306
Hexachlorobenzene	0.00591	0.00718
Hexachlorobutadiene	1.91	2.32
Hexachlorocyclohexane ( <i>alpha</i> )	0.0730	0.0887
Hexachlorocyclohexane ( <i>beta</i> )	2.26	2.74
Hexachlorocyclohexane ( <i>gamma</i> ) [Lindane]	2.96	3.60
Hexachlorocyclopentadiene	100	122
Hexachloroethane	20.2	24.6
Hexachlorophene	25.2	30.6
4,4'-Isopropylidenediphenol [Bisphenol A]	139039	168833
Lead	260	316
Mercury	0.106	0.128
Methoxychlor	26.0	31.6
Methyl Ethyl Ketone	8630129	10479442
Methyl <i>tert</i> -butyl ether [MTBE]	91190	110731
Nickel	50074	60804
Nitrate-Nitrogen (as Total Nitrogen)	N/A	N/A
Nitrobenzene	16294	19786
N-Nitrosodiethylamine	18.2	22.1
N-Nitroso-di- <i>n</i> -Butylamine	36.5	44.3
Pentachlorobenzene	3.08	3.75
Pentachlorophenol	2.52	3.06
Polychlorinated Biphenyls [PCBs]	0.00556	0.00676
Pyridine	8238	10004
Selenium	N/A	N/A
1,2,4,5-Tetrachlorobenzene	2.08	2.53
1,1,1,2-Tetrachloroethane	229	278
Tetrachloroethylene [Tetrachloroethylene]	2435	2957
Thallium	2.00	2.42
Toluene	N/A	N/A
Toxaphene	0.0956	0.116
2,4,5-TP [Silvex]	3210	3898
1,1,1-Trichloroethane	6823665	8285880
1,1,2-Trichloroethane	1444	1753
Trichloroethylene [Trichloroethene]	625	759
2,4,5-Trichlorophenol	16242	19722
TTHM [Sum of Total Trihalomethanes]	N/A	N/A
Vinyl Chloride	143	174

STATEMENT OF BASIS / TECHNICAL SUMMARY AND  
EXECUTIVE DIRECTOR'S PRELIMINARY DECISION  
TPDES Permit No. WQ0004437000

**Appendix D**  
**Comparison of Effluent Limits**

The following table is a summary of technology-based effluent limitations calculated/assessed in the draft permit (Technology-Based), calculated/assessed water quality-based effluent limitations (Water Quality-Based), and effluent limitations in the existing permit (Existing Permit). Effluent limitations appearing in bold are the most stringent of the three and are included in the draft permit.

Outfall	Pollutant	Technology-Based		Water Quality-Based		Existing Permit	
		Daily Avg	Daily Max	Daily Avg	Daily Max	Daily Avg	Daily Max
		mg/L	mg/L	mg/L	mg/L	mg/L	mg/L
001	Flow, MGD	Report, MGD	Report, MGD	-	-	Report, MGD	Report, MGD
	TSS	N/A	45	-	-	N/A	45
	pH	6.0 SU (minimum)	9.0 SU	6.0 SU (minimum)	9.0 SU	6.0 SU (minimum)	9.0 SU