



Administrative Package Cover Page

This file contains the following documents:

1. Summary of application (in plain language)
 - English
 - Alternative Language (Spanish)
 2. First Notice (NORI-Notice of Receipt of Application and Intent to Obtain a Permit)
 - English
 - Alternative Language (Spanish)
 3. Application materials
-



Portada de Paquete Administrativo

Este archivo contiene los siguientes documentos:

1. Resumen en lenguaje sencillo (PLS, por sus siglas en inglés) de la actividad propuesta
 - Inglés
 - Idioma alternativo (español)
2. Primer aviso (NORI, por sus siglas en inglés)
 - Inglés
 - Idioma alternativo (español)
3. Solicitud original



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SUMMARY OF APPLICATION IN PLAIN LANGUAGE FOR TPDES OR TLAP PERMIT APPLICATIONS

Summary of Application (in plain language) Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary of your facility and application as required by Title 30, Texas Administrative Code (30 TAC), Chapter 39, Subchapter H. You may modify the template as necessary to accurately describe your facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how you will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements. After filling in the information for your facility delete these instructions.

If you are subject to the alternative language notice requirements in 30 TAC Section 39.426, **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package.** For your convenience, a Spanish template has been provided below.

ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS DOMESTIC WASTEWATER/STORMWATER

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.

The City of Freeport (CN600641799) operates the City of Freeport Wastewater Treatment Plant (RN102184025), a domestic wastewater treatment facility. The facility is located at 931 E. Floodgate Rd., in Freeport, Brazoria County, Texas 77541. The City of Freeport is requesting a renewal of the wastewater permit to discharge 2.25 MGD treated domestic wastewater to the Brazos River. When needed, there is also an option to discharge to the 38.2 acre impounded wetlands adjacent to the plant site with no discharge from the wetlands.

Discharges from the facility are expected to contain total suspended solids and BOD. Domestic wastewater is treated by chlorine gas.

PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

AGUAS RESIDUALES DOMESTICAS /AGUAS PLUVIALES

El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.

La ciudad de Freeport (CN600641799) opera la Planta de Tratamiento de Aguas Residuales de la Ciudad de Freeport (RN102184025), una instalación de tratamiento de aguas residuales domésticas. La instalación está ubicada en 931 E. Floodgate Rd., en Freeport, Condado de Brazoria, Texas 77541. La ciudad de Freeport solicita la renovación del permiso de aguas residuales para descargar 2.25 MGD de aguas residuales domésticas tratadas al río Brazos. De ser necesario, también existe la opción de descargarlas en los humedales embalsados de 38.2 acres adyacentes a la planta, sin que se produzcan descargas desde estos.

Se espera que las descargas de la instalación contengan sólidos suspendidos totales y DBO. Las aguas residuales domésticas se tratan con cloro gaseoso.

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



NOTICE OF RECEIPT OF APPLICATION AND INTENT TO OBTAIN WATER QUALITY PERMIT RENEWAL

PERMIT NO. WQ0010882001

APPLICATION. City of Freeport, 1201 North Avenue H, Freeport, Texas 77541, has applied to the Texas Commission on Environmental Quality (TCEQ) to renew Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0010882001 (EPA I.D. No. TX0033332) to authorize the discharge of treated wastewater at a volume not to exceed an annual average flow of 2,250,000 gallons per day. The domestic wastewater treatment facility is located at 931 East Floodgate Road, near the city of Freeport, in Brazoria County, Texas 77541. The discharge route is from the plant site via Outfall 001 directly to Brazos River Tidal and via Outfall 002 to a 38.2-acre impounded wetlands adjacent to the plant site with no discharge from the wetlands. TCEQ received this application on April 1, 2025. The permit application will be available for viewing and copying at Freeport City Hall, Front Entrance, 1201 North Avenue H, Freeport, in Brazoria County, Texas prior to the date this notice is published in the newspaper. The application, including any updates, and associated notices are available electronically at the following webpage:

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For the exact location, refer to the application.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-95.377222,28.944444&level=18>

ALTERNATIVE LANGUAGE NOTICE. Alternative language notice in Spanish is available at:

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

El aviso de idioma alternativo en español está disponible en

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

ADDITIONAL NOTICE. TCEQ's Executive Director has determined the application is administratively complete and will conduct a technical review of the application. After technical review of the application is complete, the Executive Director may prepare a draft permit and will issue a preliminary decision on the application. **Notice of the Application and Preliminary Decision will be published and mailed to those who are on the county-wide mailing list and to those who are on the mailing list for this application. That notice will contain the deadline for submitting public comments.**

PUBLIC COMMENT / PUBLIC MEETING. You may submit public comments or request a public meeting on this application. The purpose of a public meeting is to provide the opportunity to submit comments or to ask questions about the application. TCEQ will hold a

public meeting if the Executive Director determines that there is a significant degree of public interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

OPPORTUNITY FOR A CONTESTED CASE HEARING. After the deadline for submitting public comments, the Executive Director will consider all timely comments and prepare a response to all relevant and material, or significant public comments. **Unless the application is directly referred for a contested case hearing, the response to comments, and the Executive Director's decision on the application, will be mailed to everyone who submitted public comments and to those persons who are on the mailing list for this application. If comments are received, the mailing will also provide instructions for requesting reconsideration of the Executive Director's decision and for requesting a contested case hearing.** A contested case hearing is a legal proceeding similar to a civil trial in state district court.

TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST: your name, address, phone number; applicant's name and proposed permit number; the location and distance of your property/activities relative to the proposed facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; a list of all disputed issues of fact that you submit during the comment period and, the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify by name and physical address an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are relevant to the group's purpose.

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

The Commission may only grant a request for a contested case hearing on issues the requestor submitted in their timely comments that were not subsequently withdrawn. **If a hearing is granted, the subject of a hearing will be limited to disputed issues of fact or mixed questions of fact and law relating to relevant and material water quality concerns submitted during the comment period.**

TCEQ may act on an application to renew a permit for discharge of wastewater without providing an opportunity for a contested case hearing if certain criteria are met.

MAILING LIST. If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be placed on: (1) the permanent mailing list for a specific applicant name and permit number; and/or (2) the mailing list for a specific county. If you wish to be placed on the permanent and/or the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

INFORMATION AVAILABLE ONLINE. For details about the status of the application, visit the Commissioners' Integrated Database at www.tceq.texas.gov/goto/cid. Search the database using the permit number for this application, which is provided at the top of this notice.

AGENCY CONTACTS AND INFORMATION. All public comments and requests must be submitted either electronically at <https://www14.tceq.texas.gov/epic/eComment/>, or in writing to the Texas Commission on Environmental Quality, Office of the Chief Clerk, MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Please be aware that any contact information you provide, including your name, phone number, email address and physical address will become part of the agency's public record. For more information about this permit application or the permitting process, please call the TCEQ Public Education Program, Toll Free, at 1-800-687-4040 or visit their website at www.tceq.texas.gov/goto/pep. Si desea información en Español, puede llamar al 1-800-687-4040.

Further information may also be obtained from City of Freeport at the address stated above or by calling Mr. Lance Petty, City Manager, at 979-233-3526.

Issuance Date: June 16, 2025

Comisión de Calidad Ambiental del Estado de Texas



AVISO DE RECIBO DE LA SOLICITUD Y EL INTENTO DE OBTENER PERMISO PARA LA CALIDAD DEL AGUA RENOVACION

PERMISO NO. WQ0010882001

SOLICITUD. City of Freeport, 1201 North Avenue H, Freeport, Texas 77541, ha solicitado a la Comisión de Calidad Ambiental del Estado de Texas (TCEQ) para renovar el Permiso No. WQ0010882001 (EPA I.D. No. TX 0033332) del Sistema de Eliminación de Descargas de Contaminantes de Texas (TPDES) para autorizar la descarga de aguas residuales tratadas en un volumen que no sobrepasa un flujo promedio anual de 2,250,000 galones por día. La planta está ubicada en 931 East Floodgate Road, cerca de la ciudad de Freeport, en el Condado de Brazoria, Texas 77541. La ruta de descarga es desde el sitio de la planta a través del emisario 001 directamente al río Brazos Tidal y a través del emisario 002 a un humedal embalsado de 38,2 acres adyacente al sitio de la planta sin descarga desde los humedales. La TCEQ recibió esta solicitud el 1 de abril de 2025. La solicitud para el permiso estará disponible para leerla y copiarla en Freeport City Hall, Front Entrance, 1201 North Avenue H, Freeport, Texas antes de la fecha de publicación de este aviso en el periódico. La solicitud (cualquier actualización y aviso inclusive) está disponible electrónicamente en la siguiente página web: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

Este enlace a un mapa electrónico de la ubicación general del sitio o de la instalación es proporcionado como una cortesía y no es parte de la solicitud o del aviso. Para la ubicación exacta, consulte la solicitud.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-95.377222,28.944444&level=18>

AVISO DE IDIOMA ALTERNATIVO. El aviso de idioma alternativo en español está disponible en <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

AVISO ADICIONAL. El Director Ejecutivo de la TCEQ ha determinado que la solicitud es administrativamente completa y conducirá una revisión técnica de la solicitud. Despues de completar la revisión técnica, el Director Ejecutivo puede preparar un borrador del permiso y emitirá una Decisión Preliminar sobre la solicitud. **El aviso de la solicitud y la decisión preliminar serán publicados y enviado a los que están en la lista de correo de las personas a lo largo del condado que desean recibir los avisos y los que están en la lista de correo que desean recibir avisos de esta solicitud. El aviso dará la fecha límite para someter comentarios públicos.**

COMENTARIO PUBLICO / REUNION PUBLICA. Usted puede presentar comentarios públicos

o pedir una reunión pública sobre esta solicitud. El propósito de una reunión pública es dar la oportunidad de presentar comentarios o hacer preguntas acerca de la solicitud. La TCEQ realiza una reunión pública si el Director Ejecutivo determina que hay un grado de interés público suficiente en la solicitud o si un legislador local lo pide. Una reunión pública no es una audiencia administrativa de lo contencioso.

OPORTUNIDAD DE UNA AUDIENCIA ADMINISTRATIVA DE LO CONTENCIOSO. Después del plazo para presentar comentarios públicos, el Director Ejecutivo considerará todos los comentarios apropiados y preparará una respuesta a todo los comentarios públicos esenciales, pertinentes, o significativos. **A menos que la solicitud haya sido referida directamente a una audiencia administrativa de lo contencioso, la respuesta a los comentarios y la decisión del Director Ejecutivo sobre la solicitud serán enviados por correo a todos los que presentaron un comentario público y a las personas que están en la lista para recibir avisos sobre esta solicitud. Si se reciben comentarios, el aviso también proveerá instrucciones para pedir una reconsideración de la decisión del Director Ejecutivo y para pedir una audiencia administrativa de lo contencioso.** Una audiencia administrativa de lo contencioso es un procedimiento legal similar a un procedimiento legal civil en un tribunal de distrito del estado.

PARA SOLICITAR UNA AUDIENCIA DE CASO IMPUGNADO, USTED DEBE INCLUIR EN SU SOLICITUD LOS SIGUIENTES DATOS: su nombre, dirección, y número de teléfono; el nombre del solicitante y número del permiso; la ubicación y distancia de su propiedad/actividad con respecto a la instalación; una descripción específica de la forma cómo usted sería afectado adversamente por el sitio de una manera no común al público en general; una lista de todas las cuestiones de hecho en disputa que usted presente durante el período de comentarios; y la declaración "[Yo/nosotros] solicito/solicitamos una audiencia de caso impugnado". Si presenta la petición para una audiencia de caso impugnado de parte de un grupo o asociación, debe identificar una persona que representa al grupo para recibir correspondencia en el futuro; identificar el nombre y la dirección de un miembro del grupo que sería afectado adversamente por la planta o la actividad propuesta; proveer la información indicada anteriormente con respecto a la ubicación del miembro afectado y su distancia de la planta o actividad propuesta; explicar cómo y porqué el miembro sería afectado; y explicar cómo los intereses que el grupo desea proteger son pertinentes al propósito del grupo.

Después del cierre de todos los períodos de comentarios y de petición que aplican, el Director Ejecutivo enviará la solicitud y cualquier petición para reconsideración o para una audiencia de caso impugnado a los Comisionados de la TCEQ para su consideración durante una reunión programada de la Comisión.

La Comisión sólo puede conceder una solicitud de una audiencia de caso impugnado sobre los temas que el solicitante haya presentado en sus comentarios oportunos que no fueron retirados posteriormente. **Si se concede una audiencia, el tema de la audiencia estará limitado a cuestiones de hecho en disputa o cuestiones mixtas de hecho y de derecho relacionadas a intereses pertinentes y materiales de calidad del agua que se hayan presentado durante el período de comentarios. Si ciertos criterios se cumplen, la TCEQ puede actuar sobre una solicitud para renovar un permiso sin proveer una oportunidad de una audiencia administrativa de lo contencioso.**

LISTA DE CORREO. Si somete comentarios públicos, un pedido para una audiencia administrativa de lo contencioso o una reconsideración de la decisión del Director Ejecutivo, la Oficina del Secretario Principal enviará por correo los avisos públicos en relación con la solicitud. Además, puede pedir que la TCEQ ponga su nombre en una o más de las listas correos siguientes (1) la lista de correo permanente para recibir los avisos del solicitante indicado por nombre y número del permiso específico y/o (2) la lista de correo de todas las solicitudes en un condado específico. Si desea que se agrega su nombre en una de las listas designe cual lista(s) y envíe por correo su pedido a la Oficina del Secretario Principal de la TCEQ.

INFORMACIÓN DISPONIBLE EN LÍNEA. Para detalles sobre el estado de la solicitud, favor de visitar la Base de Datos Integrada de los Comisionados en www.tceq.texas.gov/goto/cid. Para buscar en la base de datos, utilizar el número de permiso para esta solicitud que aparece en la parte superior de este aviso.

CONTACTOS E INFORMACIÓN A LA AGENCIA. Todos los comentarios públicos y solicitudes deben ser presentadas electrónicamente vía <http://www14.tceq.texas.gov/epic/eComment/> o por escrito dirigidos a la Comisión de Texas de Calidad Ambiental, Oficial de la Secretaría (Office of Chief Clerk), MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Tenga en cuenta que cualquier información personal que usted proporcione, incluyendo su nombre, número de teléfono, dirección de correo electrónico y dirección física pasarán a formar parte del registro público de la Agencia. Para obtener más información acerca de esta solicitud de permiso o el proceso de permisos, llame al programa de educación pública de la TCEQ, gratis, al 1-800-687-4040. Si desea información en Español, puede llamar al 1-800-687-4040.

También se puede obtener información adicional del City of Freeport a la dirección indicada arriba o llamando a Mr. Lance Petty, City Manager, al 979-233-3526.

Fecha de emisión: el 16 de junio de 2025



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

DOMESTIC WASTEWATER PERMIT APPLICATION CHECKLIST

Complete and submit this checklist with the application.

APPLICANT NAME: City of Freeport

PERMIT NUMBER (If new, leave blank): WQ00o010882001

Indicate if each of the following items is included in your application.

	Y	N		Y	N
Administrative Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original USGS Map	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Administrative Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Affected Landowners Map	<input type="checkbox"/>	<input checked="" type="checkbox"/>
SPIF	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Landowner Disk or Labels	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Core Data Form	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Buffer Zone Map	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Summary of Application (PLS)	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Flow Diagram	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Public Involvement Plan Form	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Site Drawing	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Technical Report 1.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Original Photographs	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Technical Report 1.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>	Design Calculations	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 2.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Solids Management Plan	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 2.1	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Water Balance	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Worksheet 3.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 3.1	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 3.2	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 3.3	<input type="checkbox"/>	<input checked="" type="checkbox"/>			
Worksheet 4.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 5.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 6.0	<input checked="" type="checkbox"/>	<input type="checkbox"/>			
Worksheet 7.0	<input type="checkbox"/>	<input checked="" type="checkbox"/>			

For TCEQ Use Only

Segment Number _____

County _____

Expiration Date _____

Region _____

Permit Number _____



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

DOMESTIC WASTEWATER PERMIT APPLICATION ADMINISTRATIVE REPORT 1.0

For any questions about this form, please contact the Applications Review and Processing Team at 512-239-4671.

Section 1. Application Fees (Instructions Page 26)

Indicate the amount submitted for the application fee (check only one).

Flow	New/Major Amendment	Renewal
<0.05 MGD	\$350.00 <input type="checkbox"/>	\$315.00 <input type="checkbox"/>
≥0.05 but <0.10 MGD	\$550.00 <input type="checkbox"/>	\$515.00 <input type="checkbox"/>
≥0.10 but <0.25 MGD	\$850.00 <input type="checkbox"/>	\$815.00 <input type="checkbox"/>
≥0.25 but <0.50 MGD	\$1,250.00 <input type="checkbox"/>	\$1,215.00 <input type="checkbox"/>
≥0.50 but <1.0 MGD	\$1,650.00 <input type="checkbox"/>	\$1,615.00 <input type="checkbox"/>
≥1.0 MGD	\$2,050.00 <input type="checkbox"/>	\$2,015.00 <input checked="" type="checkbox"/>

Minor Amendment (for any flow) \$150.00

Payment Information:

Mailed Check/Money Order Number: [Click to enter text](#).

Check/Money Order Amount: [Click to enter text](#).

Name Printed on Check: [Click to enter text](#).

EPAY Voucher Number: 759114

Copy of Payment Voucher enclosed? Yes

Section 2. Type of Application (Instructions Page 26)

a. Check the box next to the appropriate authorization type.

- Publicly Owned Domestic Wastewater
- Privately-Owned Domestic Wastewater
- Conventional Water Treatment

b. Check the box next to the appropriate facility status.

- Active
- Inactive

- c. Check the box next to the appropriate permit type.
- TPDES Permit
- TLAP
- TPDES Permit with TLAP component
- Subsurface Area Drip Dispersal System (SADDS)
- d. Check the box next to the appropriate application type
- New
- Major Amendment with Renewal Minor Amendment with Renewal
- Major Amendment without Renewal Minor Amendment without Renewal
- Renewal without changes Minor Modification of permit
- e. For amendments or modifications, describe the proposed changes: Click to enter text.
- f. **For existing permits:**
- Permit Number: WQ00 0010882001
- EPA I.D. (TPDES only): TX 0033332
- Expiration Date: 05/08/2025

Section 3. Facility Owner (Applicant) and Co-Applicant Information (Instructions Page 26)

A. The owner of the facility must apply for the permit.

What is the Legal Name of the entity (applicant) applying for this permit?

City of Freeport

(The legal name must be spelled exactly as filed with the Texas Secretary of State, County, or in the legal documents forming the entity.)

If the applicant is currently a customer with the TCEQ, what is the Customer Number (CN)? You may search for your CN on the TCEQ website at [http://www15.tceq.texas.gov/crpublish/](http://www15.tceq.texas.gov/crpublish)

CN: 600641799

What is the name and title of the person signing the application? The person must be an executive official meeting signatory requirements in 30 TAC § 305.44.

Prefix: Mr.

Last Name, First Name: Cain, Jerry

Title: Mayor

Credential: Click to enter text.

B. Co-applicant information. Complete this section only if another person or entity is required to apply as a co-permittee.

What is the Legal Name of the co-applicant applying for this permit?

Click to enter text.

(The legal name must be spelled exactly as filed with the TX SOS, with the County, or in the legal documents forming the entity.)

If the co-applicant is currently a customer with the TCEQ, what is the Customer Number (CN)? You may search for your CN on the TCEQ website at: <http://www15.tceq.texas.gov/crpublish>

CN: Click to enter text.

What is the name and title of the person signing the application? The person must be an executive official meeting signatory requirements in 30 TAC § 305.44.

Prefix: Click to enter text.

Last Name, First Name: Click to enter text.

Title: Click to enter text.

Credential: Click to enter text.

Provide a brief description of the need for a co-permittee: Click to enter text.

C. Core Data Form

Complete the Core Data Form for each customer and include as an attachment. If the customer type selected on the Core Data Form is **Individual**, complete **Attachment 1** of Administrative Report 1.0. Click to enter text.

Section 4. Application Contact Information (Instructions Page 27)

This is the person(s) TCEQ will contact if additional information is needed about this application. Provide a contact for administrative questions and technical questions.

A. Prefix: Mr.

Last Name, First Name: Meeks, Jerry Jr.

Title: Lead Operator

Credential: Click to enter text.

Organization Name: Veolia

Mailing Address: PO Box 3201

City, State, Zip Code: Freeport, TX. 77542

Phone No.: 979-233-4281

E-mail Address: Jerry.Meeks2@veolia.com

Check one or both: Administrative Contact Technical Contact

B. Prefix: Click to enter text.

Last Name, First Name: Click to enter text.

Title: Click to enter text.

Credential: Click to enter text.

Organization Name: Click to enter text.

Mailing Address: Click to enter text.

City, State, Zip Code: Click to enter text.

Phone No.: Click to enter text.

E-mail Address: Click to enter text.

Check one or both: Administrative Contact Technical Contact

Section 5. Permit Contact Information (Instructions Page 27)

Provide the names and contact information for two individuals that can be contacted throughout the permit term.

A. Prefix: Mr.

Last Name, First Name: Petty, Lance

Title: City Manager

Credential: Click to enter text.

Organization Name: City of Freeport

Mailing Address: 1201 N. Ave. H

City, State, Zip Code: Freeport, TX. 77541

Phone No.: 979-233-3526

E-mail Address: LPetty@Freeport.tx.us

B. Prefix: Mr. Last Name, First Name: Meeks, Jerry Jr.
Title: Lead Operator Credential: Click to enter text.
Organization Name: Veolia
Mailing Address: PO Box 3201 City, State, Zip Code: Freeport, TX. 77542
Phone No.: 979-233-4281 E-mail Address: Jerry.Meeks2@veolia.com

Section 6. Billing Contact Information (Instructions Page 27)

The permittee is responsible for paying the annual fee. The annual fee will be assessed to permits ***in effect on September 1 of each year***. The TCEQ will send a bill to the address provided in this section. The permittee is responsible for terminating the permit when it is no longer needed (using form TCEQ-20029).

Prefix: Mr. Last Name, First Name: Petty, Lance
Title: City Manager Credential: Click to enter text.
Organization Name: City of Freeport
Mailing Address: 1201 N. Ave. H City, State, Zip Code: Freeport, TX. 77541
Phone No.: 979-233-3526 E-mail Address: LPetty@Freeport.tx.us

Section 7. DMR/MER Contact Information (Instructions Page 27)

Provide the name and complete mailing address of the person delegated to receive and submit Discharge Monitoring Reports (DMR) (EPA 3320-1) or maintain Monthly Effluent Reports (MER).

Prefix: Mr. Last Name, First Name: Petty, Lance
Title: City Manager Credential: Click to enter text.
Organization Name: City of Freeport
Mailing Address: 1201 N. Ave. H City, State, Zip Code: Freeport, TX. 77541
Phone No.: 979-233-3526 E-mail Address: LPetty@Freeport.tx.us

Section 8. Public Notice Information (Instructions Page 27)

A. Individual Publishing the Notices

Prefix: Mr. Last Name, First Name: Petty, Lance
Title: City Manager Credential: Click to enter text.
Organization Name: City of Freeport
Mailing Address: 1201 N. Ave. H City, State, Zip Code: Freeport, TX. 77541
Phone No.: 979-233-3526 E-mail Address: LPetty@Freeport.tx.us

B. Method for Receiving Notice of Receipt and Intent to Obtain a Water Quality Permit Package

Indicate by a check mark the preferred method for receiving the first notice and instructions:

- E-mail Address
 Fax
 Regular Mail

C. Contact permit to be listed in the Notices

Prefix: Mr. Last Name, First Name: Petty, Lance

Title: City Manager Credential: Click to enter text.

Organization Name: City of Freeport

Mailing Address: 1201 N. Ave. F City, State, Zip Code: Freeport, TX. 77541

Phone No.: 979-233-3526 E-mail Address: LPetty@Freeport.tx.us

D. Public Viewing Information

If the facility or outfall is located in more than one county, a public viewing place for each county must be provided.

Public building name: City Hall

Location within the building: Front Enterance

Physical Address of Building: 1201 N. Ave. H

City: Freeport County: Brazoria

Contact (Last Name, First Name): Petty, Lance

Phone No.: 979-233-3526 Ext.: Click to enter text.

E. Bilingual Notice Requirements

This information **is required** for new, major amendment, minor amendment or minor modification, and renewal applications.

This section of the application is only used to determine if alternative language notices will be needed. Complete instructions on publishing the alternative language notices will be in your public notice package.

Please call the bilingual/ESL coordinator at the nearest elementary and middle schools and obtain the following information to determine whether an alternative language notices are required.

1. Is a bilingual education program required by the Texas Education Code at the elementary or middle school nearest to the facility or proposed facility?

- Yes No

If **no**, publication of an alternative language notice is not required; **skip to** Section 9 below.

2. Are the students who attend either the elementary school or the middle school enrolled in a bilingual education program at that school?

- Yes No

3. Do the students at these schools attend a bilingual education program at another location?
- Yes No
4. Would the school be required to provide a bilingual education program but the school has waived out of this requirement under 19 TAC §89.1205(g)?
- Yes No
5. If the answer is **yes** to **question 1, 2, 3, or 4**, public notices in an alternative language are required. Which language is required by the bilingual program? Spanish

F. Summary of Application in Plain Language Template

Complete the F. Summary of Application in Plain Language Template (TCEQ Form 20972), also known as the plain language summary or PLS, and include as an attachment.

Attachment: Attachment 1

G. Public Involvement Plan Form

Complete the Public Involvement Plan Form (TCEQ Form 20960) for each application for a **new permit or major amendment to a permit** and include as an attachment.

Attachment: Click to enter text.

Section 9. Regulated Entity and Permitted Site Information (Instructions Page 29)

- A. If the site is currently regulated by TCEQ, provide the Regulated Entity Number (RN) issued to this site. RN 102184025

Search the TCEQ's Central Registry at <http://www15.tceq.texas.gov/crpub/> to determine if the site is currently regulated by TCEQ.

- B. Name of project or site (the name known by the community where located):

Freeport Central Wastewater Treatment Facility

- C. Owner of treatment facility: City of Freeport

Ownership of Facility: Public Private Both Federal

- D. Owner of land where treatment facility is or will be:

Prefix: Click to enter text. Last Name, First Name: Click to enter text.

Title: Click to enter text. Credential: Click to enter text.

Organization Name: City of Freeport

Mailing Address: 1201 N. Ave. H City, State, Zip Code: Freeport, TX. 77541

Phone No.: 979-233-3526 E-mail Address: LPetty@Freeport.tx.us

If the landowner is not the same person as the facility owner or co-applicant, attach a lease agreement or deed recorded easement. See instructions.

Attachment: Click to enter text.

E. Owner of effluent disposal site:

Prefix: Click to enter text.

Last Name, First Name: Click to enter text.

Title: Click to enter text.

Credential: Click to enter text.

Organization Name: City of Freeport

Mailing Address: 1201 N. Ave. H

City, State, Zip Code: Freeport, TX. 77541

Phone No.: 979-233-3526

E-mail Address: LPetty@Freeport.tx.us

If the landowner is not the same person as the facility owner or co-applicant, attach a lease agreement or deed recorded easement. See instructions.

Attachment: Click to enter text.

F. Owner sewage sludge disposal site (if authorization is requested for sludge disposal on property owned or controlled by the applicant)::

Prefix: Click to enter text.

Last Name, First Name: Click to enter text.

Title: Click to enter text.

Credential: Click to enter text.

Organization Name: Click to enter text.

Mailing Address: Click to enter text.

City, State, Zip Code: Click to enter text.

Phone No.: Click to enter text.

E-mail Address: Click to enter text.

If the landowner is not the same person as the facility owner or co-applicant, attach a lease agreement or deed recorded easement. See instructions.

Attachment: Click to enter text.

Section 10. TPDES Discharge Information (Instructions Page 31)

A. Is the wastewater treatment facility location in the existing permit accurate?

Yes No

If no, or a new permit application, please give an accurate description:

Click to enter text.

B. Are the point(s) of discharge and the discharge route(s) in the existing permit correct?

Yes No

If no, or a new or amendment permit application, provide an accurate description of the point of discharge and the discharge route to the nearest classified segment as defined in 30 TAC Chapter 307:

Click to enter text.

City nearest the outfall(s): City of Freeport

County in which the outfalls(s) is/are located: Brazoria

C. Is or will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch?

Yes No

If yes, indicate by a check mark if:

- Authorization granted Authorization pending

For new and amendment applications, provide copies of letters that show proof of contact and the approval letter upon receipt.

Attachment: Click to enter text.

- D. For all applications involving an average daily discharge of 5 MGD or more, provide the names of all counties located within 100 statute miles downstream of the point(s) of discharge: Click to enter text.

Section 11. TLAP Disposal Information (Instructions Page 32)

- A. For TLAPs, is the location of the effluent disposal site in the existing permit accurate?

- Yes No

If no, or a new or amendment permit application, provide an accurate description of the disposal site location:

Click to enter text.

- B. City nearest the disposal site: Freeport

- C. County in which the disposal site is located: Brazoria

- D. For TLAPs, describe the routing of effluent from the treatment facility to the disposal site:

Outfall 002 is discharged from the plant effluent following final treatment through an isolation valve, through a flow meter via a 12" pipe to the impounded wetlands where it is discharged through an Alfalfa Valve on a splash pad.

- E. For TLAPs, please identify the nearest watercourse to the disposal site to which rainfall runoff might flow if not contained: Brazos River Tidal in Segment No. 1201 of the Brazos River Basin.

Section 12. Miscellaneous Information (Instructions Page 32)

- A. Is the facility located on or does the treated effluent cross American Indian Land?

- Yes No

- B. If the existing permit contains an onsite sludge disposal authorization, is the location of the sewage sludge disposal site in the existing permit accurate?

- Yes No Not Applicable

If No, or if a new onsite sludge disposal authorization is being requested in this permit application, provide an accurate location description of the sewage sludge disposal site.

Click to enter text.

C. Did any person formerly employed by the TCEQ represent your company and get paid for service regarding this application?

Yes No

If yes, list each person formerly employed by the TCEQ who represented your company and was paid for service regarding the application: [Click to enter text](#).

D. Do you owe any fees to the TCEQ?

Yes No

If **yes**, provide the following information:

Account number: [Click to enter text](#).

Amount past due: [Click to enter text](#).

E. Do you owe any penalties to the TCEQ?

Yes No

If **yes**, please provide the following information:

Enforcement order number: [Click to enter text](#).

Amount past due: [Click to enter text](#).

Section 13. Attachments (Instructions Page 33)

Indicate which attachments are included with the Administrative Report. Check all that apply:

- Lease agreement or deed recorded easement, if the land where the treatment facility is located or the effluent disposal site are not owned by the applicant or co-applicant.
- Original full-size USGS Topographic Map with the following information:
- Applicant's property boundary
 - Treatment facility boundary
 - Labeled point of discharge for each discharge point (TPDES only)
 - Highlighted discharge route for each discharge point (TPDES only)
 - Onsite sewage sludge disposal site (if applicable)
 - Effluent disposal site boundaries (TLAP only)
 - New and future construction (if applicable)
 - 1 mile radius information
 - 3 miles downstream information (TPDES only)
 - All ponds.
- Attachment 1 for Individuals as co-applicants
- Other Attachments. Please specify: Plain Language Summary for Section 8-F

Section 14. Signature Page (Instructions Page 34)

If co-applicants are necessary, each entity must submit an original, separate signature page.

Permit Number: WQ0010882001

Applicant: City of Freeport

Certification:

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code § 305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signatory name (typed or printed): Jerry Cain

Signatory title: Mayor

Signature: Jerry Cain Date: 3/27/25
(Use blue ink)


Subscribed and Sworn to before me by the said Jerry Cain
on this 27th day of March, 2025.
My commission expires on the 29th day of JUNE, 2027.

Clarisa Molina
Notary Public



[SEAL]

Brazoria
County, Texas



DOMESTIC WASTEWATER PERMIT APPLICATION

ADMINISTRATIVE REPORT 1.0

The following information is required for new and amendment applications.

Section 1. Affected Landowner Information (Instructions Page 36)

- A. Indicate by a check mark that the landowners map or drawing, with scale, includes the following information, as applicable:
- The applicant's property boundaries
 - The facility site boundaries within the applicant's property boundaries
 - The distance the buffer zone falls into adjacent properties and the property boundaries of the landowners located within the buffer zone
 - The property boundaries of all landowners surrounding the applicant's property (Note: if the application is a major amendment for a lignite mine, the map must include the property boundaries of all landowners adjacent to the new facility (ponds).)
 - The point(s) of discharge and highlighted discharge route(s) clearly shown for one mile downstream
 - The property boundaries of the landowners located on both sides of the discharge route for one full stream mile downstream of the point of discharge
 - The property boundaries of the landowners along the watercourse for a one-half mile radius from the point of discharge if the point of discharge is into a lake, bay, estuary, or affected by tides
 - The boundaries of the effluent disposal site (for example, irrigation area or subsurface drainfield site) and all evaporation/holding ponds within the applicant's property
 - The property boundaries of all landowners surrounding the effluent disposal site
 - The boundaries of the sludge land application site (for land application of sewage sludge for beneficial use) and the property boundaries of landowners surrounding the applicant's property boundaries where the sewage sludge land application site is located
 - The property boundaries of landowners within one-half mile in all directions from the applicant's property boundaries where the sewage sludge disposal site (for example, sludge surface disposal site or sludge monofill) is located
- B. Indicate by a check mark that a separate list with the landowners' names and mailing addresses cross-referenced to the landowner's map has been provided.
- C. Indicate by a check mark that the landowners list has also been provided as mailing labels in electronic format (Avery 5160).
- D. Provide the source of the landowners' names and mailing addresses: Click to enter text.
- E. As required by *Texas Water Code § 5.115*, is any permanent school fund land affected by this application?
- Yes No

If yes, provide the location and foreseeable impacts and effects this application has on the land(s):

Click to enter text.

Section 2. Original Photographs (Instructions Page 38)

Provide original ground level photographs. Indicate with checkmarks that the following information is provided.

- At least one original photograph of the new or expanded treatment unit location
- At least two photographs of the existing/proposed point of discharge and as much area downstream (photo 1) and upstream (photo 2) as can be captured. If the discharge is to an open water body (e.g., lake, bay), the point of discharge should be in the right or left edge of each photograph showing the open water and with as much area on each respective side of the discharge as can be captured.
- At least one photograph of the existing/proposed effluent disposal site
- A plot plan or map showing the location and direction of each photograph

Section 3. Buffer Zone Map (Instructions Page 38)

A. Buffer zone map. Provide a buffer zone map on 8.5 x 11-inch paper with all of the following information. The applicant's property line and the buffer zone line may be distinguished by using dashes or symbols and appropriate labels.

- The applicant's property boundary;
- The required buffer zone; and
- Each treatment unit; and
- The distance from each treatment unit to the property boundaries.

B. Buffer zone compliance method. Indicate how the buffer zone requirements will be met. Check all that apply.

- Ownership
- Restrictive easement
- Nuisance odor control
- Variance

C. Unsuitable site characteristics. Does the facility comply with the requirements regarding unsuitable site characteristic found in 30 TAC § 309.13(a) through (d)?

- Yes
- No

DOMESTIC WASTEWATER PERMIT APPLICATION

SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)

This form applies to TPDES permit applications only. Complete and attach the Supplemental Permit information Form (SPIF) (TCEQ Form 20971).

Attachment: Attachment 3

ATTACHMENT 1

INDIVIDUAL INFORMATION

Section 1. Individual Information (Instructions Page 41)

Complete this attachment if the facility applicant or co-applicant is an individual. Make additional copies of this attachment if both are individuals.

Prefix (Mr., Ms., Miss): [Click to enter text](#).

Full legal name (Last Name, First Name, Middle Initial): [Click to enter text](#).

Driver's License or State Identification Number: [Click to enter text](#).

Date of Birth: [Click to enter text](#).

Mailing Address: [Click to enter text](#).

City, State, and Zip Code: [Click to enter text](#).

Phone Number: [Click to enter text](#). Fax Number: [Click to enter text](#).

E-mail Address: [Click to enter text](#).

CN: [Click to enter text](#).

For Commission Use Only:

Customer Number:

Regulated Entity Number:

Permit Number:

DOMESTIC WASTEWATER PERMIT APPLICATION

CHECKLIST OF COMMON DEFICIENCIES

Below is a list of common deficiencies found during the administrative review of domestic wastewater permit applications. To ensure the timely processing of this application, please review the items below and indicate by checking Yes that each item is complete and in accordance applicable rules at 30 TAC Chapters 21, 281, and 305. If an item is not required this application, indicate by checking N/A where appropriate. Please do not submit the application until the items below have been addressed.

Core Data Form (TCEQ Form No. 10400) Yes

(Required for all application types. Must be completed in its entirety and signed.)

Note: Form may be signed by applicant representative.)

Correct and Current Industrial Wastewater Permit Application Forms Yes
(TCEQ Form Nos. 10053 and 10054. Version dated 6/25/2018 or later.)

Water Quality Permit Payment Submittal Form (Page 19) Yes
(Original payment sent to TCEQ Revenue Section. See instructions for mailing address.)

7.5 Minute USGS Quadrangle Topographic Map Attached Yes
*(Full-size map if seeking "New" permit.
8 ½ x 11 acceptable for Renewals and Amendments)*

Current/Non-Expired, Executed Lease Agreement or Easement N/A Yes

Landowners Map N/A Yes
(See instructions for landowner requirements)

Things to Know:

- All the items shown on the map must be labeled.
- The applicant's complete property boundaries must be delineated which includes boundaries of contiguous property owned by the applicant.
- The applicant cannot be its own adjacent landowner. You must identify the landowners immediately adjacent to their property, regardless of how far they are from the actual facility.
- If the applicant's property is adjacent to a road, creek, or stream, the landowners on the opposite side must be identified. Although the properties are not adjacent to applicant's property boundary, they are considered potentially affected landowners. If the adjacent road is a divided highway as identified on the USGS topographic map, the applicant does not have to identify the landowners on the opposite side of the highway.

Landowners Labels and Cross Reference List N/A Yes
(See instructions for landowner requirements)

Electronic Application Submittal Yes
(See application submittal requirements on page 23 of the instructions.)

Original signature per 30 TAC § 305.44 - Blue Ink Preferred Yes
(If signature page is not signed by an elected official or principle executive officer, a copy of signature authority/delegation letter must be attached)

Summary of Application (in Plain Language) Yes



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

DOMESTIC WASTEWATER PERMIT APPLICATION

TECHNICAL REPORT 1.0

For any questions about this form, please contact the Domestic Wastewater Permitting Team at 512-239-4671.

The following information is required for all renewal, new, and amendment applications.

Section 1. Permitted or Proposed Flows (Instructions Page 42)

A. Existing/Interim I Phase

Design Flow (MGD): 2.25

2-Hr Peak Flow (MGD): 0.66

Estimated construction start date: Existing

Estimated waste disposal start date: Existing

B. Interim II Phase

Design Flow (MGD): Click to enter text.

2-Hr Peak Flow (MGD): Click to enter text.

Estimated construction start date: Click to enter text.

Estimated waste disposal start date: Click to enter text.

C. Final Phase

Design Flow (MGD): 2.25

2-Hr Peak Flow (MGD): 0.66

Estimated construction start date: Existing

Estimated waste disposal start date: Existing

D. Current Operating Phase

Provide the startup date of the facility: Existing

Section 2. Treatment Process (Instructions Page 42)

A. Current Operating Phase

Provide a detailed description of the treatment process. **Include the type of treatment plant, mode of operation, and all treatment units.** Start with the plant's head works and

finish with the point of discharge. Include all sludge processing and drying units. If more than one phase exists or is proposed, a description of *each phase* must be provided.

See Attachment #6.

B. Treatment Units

In Table 1.0(1), provide the treatment unit type, the number of units, and dimensions (length, width, depth) of each treatment unit, accounting for *all phases of operation*.

Table 1.0(1) - Treatment Units

Treatment Unit Type	Number of Units	Dimensions (L x W x D)
Activated Sludge Aeration Tank	2	103'x23'x15'
Activated Sludge Clarifier	1	80'x5' (circular tank)
Chlorine Contact Chamber	2	23'x23'x10'
Trickling Filter	1	110'x5.1' (circular)
Primary Clarifier	1	50'x10' (circular)
Secondary Clarifier	1	55'x10' (circular)

C. Process Flow Diagram

Provide flow diagrams for the existing facilities and **each** proposed phase of construction.

Attachment: Attachment #4

Section 3. Site Information and Drawing (Instructions Page 43)

Provide the TPDES discharge outfall latitude and longitude. Enter N/A if not applicable.

- Latitude: 28 degrees 55 minutes 40 seconds N
- Longitude: 95 degrees 22 minutes 47 seconds W

Provide the TLAP disposal site latitude and longitude. Enter N/A if not applicable.

- Latitude: 23 degrees 56 minutes 35 seconds N
- Longitude: 95 degrees 22 minutes 37 seconds W

Provide a site drawing for the facility that shows the following:

- The boundaries of the treatment facility;
- The boundaries of the area served by the treatment facility;
- If land disposal of effluent, the boundaries of the disposal site and all storage/holding ponds; and
- If sludge disposal is authorized in the permit, the boundaries of the land application or disposal site.

Attachment: Attachment #8

Provide the name and a description of the area served by the treatment facility.

The City of Freeport.

Collection System Information for wastewater TPDES permits only: Provide information for each **uniquely owned** collection system, existing and new, served by this facility, including satellite collection systems. **Please see the instructions for a detailed explanation and examples.**

Collection System Information

Collection System Name	Owner Name	Owner Type	Population Served
City of Freeport	City of Freeport	Publicly Owned	10,550
		Choose an item.	
		Choose an item.	
		Choose an item.	

Section 4. Unbuilt Phases (Instructions Page 44)

Is the application for a renewal of a permit that contains an unbuilt phase or phases?

- Yes No

If yes, does the existing permit contain a phase that has not been constructed **within five years** of being authorized by the TCEQ?

- Yes No

If yes, provide a detailed discussion regarding the continued need for the unbuilt phase. **Failure to provide sufficient justification may result in the Executive Director recommending denial of the unbuilt phase or phases.**

Click to enter text.

Section 5. Closure Plans (Instructions Page 44)

Have any treatment units been taken out of service permanently, or will any units be taken out of service in the next five years?

- Yes No

If yes, was a closure plan submitted to the TCEQ?

- Yes No

If yes, provide a brief description of the closure and the date of plan approval.

Click to enter text.

Section 6. Permit Specific Requirements (Instructions Page 44)

For applicants with an existing permit, check the Other Requirements or Special Provisions of the permit.

A. Summary transmittal

Have plans and specifications been approved for the existing facilities and each proposed phase?

- Yes No

If yes, provide the date(s) of approval for each phase: [Click to enter text.](#)

Provide information, including dates, on any actions taken to meet a *requirement or provision* pertaining to the submission of a summary transmittal letter. **Provide a copy of an approval letter from the TCEQ, if applicable.**

N/A

B. Buffer zones

Have the buffer zone requirements been met?

- Yes No

Provide information below, including dates, on any actions taken to meet the conditions of the buffer zone. If available, provide any new documentation relevant to maintaining the buffer zones.

N/A.

C. Other actions required by the current permit

Does the *Other Requirements* or *Special Provisions* section in the existing permit require submission of any other information or other required actions? Examples include Notification of Completion, progress reports, soil monitoring data, etc.

Yes No

If yes, provide information below on the status of any actions taken to meet the conditions of an *Other Requirement* or *Special Provision*.

Click to enter text.

D. Grit and grease treatment

1. Acceptance of grit and grease waste

Does the facility have a grit and/or grease processing facility onsite that treats and decants or accepts transported loads of grit and grease waste that are discharged directly to the wastewater treatment plant prior to any treatment?

Yes No

If No, stop here and continue with Subsection E. Stormwater Management.

2. Grit and grease processing

Describe below how the grit and grease waste is treated at the facility. In your description, include how and where the grit and grease is introduced to the treatment works and how it is separated or processed. Provide a flow diagram showing how grit and grease is processed at the facility.

Click to enter text.

3. Grit disposal

Does the facility have a Municipal Solid Waste (MSW) registration or permit for grit disposal?

Yes No

If No, contact the TCEQ Municipal Solid Waste team at 512-239-2335. Note: A registration or permit is required for grit disposal. Grit shall not be combined with treatment plant sludge. See the instruction booklet for additional information on grit disposal requirements and restrictions.

Describe the method of grit disposal.

Click to enter text.

4. Grease and decanted liquid disposal

Note: A registration or permit is required for grease disposal. Grease shall not be combined with treatment plant sludge. For more information, contact the TCEQ Municipal Solid Waste team at 512-239-2335.

Describe how the decant and grease are treated and disposed of after grit separation.

Click to enter text.

E. Stormwater management

1. Applicability

Does the facility have a design flow of 1.0 MGD or greater in any phase?

Yes No

Does the facility have an approved pretreatment program, under 40 CFR Part 403?

Yes No

If no to both of the above, then skip to Subsection F, Other Wastes Received.

2. MSGP coverage

Is the stormwater runoff from the WWTP and dedicated lands for sewage disposal currently permitted under the TPDES Multi-Sector General Permit (MSGP), TXR050000?

Yes No

If yes, please provide MSGP Authorization Number and skip to Subsection F, Other Wastes Received:

TXR05 [Click to enter text](#), or TXRNE [Click to enter text](#).

If no, do you intend to seek coverage under TXR050000?

Yes No

3. Conditional exclusion

Alternatively, do you intend to apply for a conditional exclusion from permitting based TXR050000 (Multi Sector General Permit) Part II B.2 or TXR050000 (Multi Sector General Permit) Part V, Sector T 3(b)?

Yes No

If yes, please explain below then proceed to Subsection F, Other Wastes Received:

Click to enter text.

4. Existing coverage in individual permit

Is your stormwater discharge currently permitted through this individual TPDES or TLAP permit?

Yes No

If yes, provide a description of stormwater runoff management practices at the site that are authorized in the wastewater permit then skip to Subsection F, Other Wastes Received.

Click to enter text.

5. Zero stormwater discharge

Do you intend to have no discharge of stormwater via use of evaporation or other means?

Yes No

If yes, explain below then skip to Subsection F. Other Wastes Received.

Click to enter text.

Note: If there is a potential to discharge any stormwater to surface water in the state as the result of any storm event, then permit coverage is required under the MSGP or an individual discharge permit. This requirement applies to all areas of facilities with treatment plants or systems that treat, store, recycle, or reclaim domestic sewage, wastewater or sewage sludge (including dedicated lands for sewage sludge disposal located within the onsite property boundaries) that meet the applicability criteria of above. You have the option of obtaining coverage under the MSGP for direct discharges, (recommended), or obtaining coverage under this individual permit.

6. Request for coverage in individual permit

Are you requesting coverage of stormwater discharges associated with your treatment plant under this individual permit?

Yes No

If yes, provide a description of stormwater runoff management practices at the site for which you are requesting authorization in this individual wastewater permit and describe whether you intend to comingle this discharge with your treated effluent or discharge it via a separate dedicated stormwater outfall. Please also indicate if you

intend to divert stormwater to the treatment plant headworks and indirectly discharge it to water in the state.

Click to enter text.

Note: Direct stormwater discharges to waters in the state authorized through this individual permit will require the development and implementation of a stormwater pollution prevention plan (SWPPP) and will be subject to additional monitoring and reporting requirements. Indirect discharges of stormwater via headworks recycling will require compliance with all individual permit requirements including 2-hour peak flow limitations. All stormwater discharge authorization requests will require additional information during the technical review of your application.

F. Discharges to the Lake Houston Watershed

Does the facility discharge in the Lake Houston watershed?

Yes No

If yes, attach a Sewage Sludge Solids Management Plan. See Example 5 in the instructions.
Click to enter text.

G. Other wastes received including sludge from other WWTPs and septic waste

1. Acceptance of sludge from other WWTPs

Does or will the facility accept sludge from other treatment plants at the facility site?

Yes No

If yes, attach sewage sludge solids management plan. See Example 5 of instructions.

In addition, provide the date the plant started or is anticipated to start accepting sludge, an estimate of monthly sludge acceptance (gallons or millions of gallons), an estimate of the BOD₅ concentration of the sludge, and the design BOD₅ concentration of the influent from the collection system. Also note if this information has or has not changed since the last permit action.

Click to enter text.

Note: Permits that accept sludge from other wastewater treatment plants may be required to have influent flow and organic loading monitoring.

2. Acceptance of septic waste

Is the facility accepting or will it accept septic waste?

Yes No

If yes, does the facility have a Type V processing unit?

Yes No

If yes, does the unit have a Municipal Solid Waste permit?

Yes No

If yes to any of the above, provide the date the plant started or is anticipated to start accepting septic waste, an estimate of monthly septic waste acceptance (gallons or millions of gallons), an estimate of the BOD₅ concentration of the septic waste, and the design BOD₅ concentration of the influent from the collection system. Also note if this information has or has not changed since the last permit action.

Click to enter text.

Note: Permits that accept sludge from other wastewater treatment plants may be required to have influent flow and organic loading monitoring.

3. Acceptance of other wastes (not including septic, grease, grit, or RCRA, CERCLA or as discharged by IUs listed in Worksheet 6)

Is or will the facility accept wastes that are not domestic in nature excluding the categories listed above?

Yes No

If yes, provide the date that the plant started accepting the waste, an estimate how much waste is accepted on a monthly basis (gallons or millions of gallons), a description of the entities generating the waste, and any distinguishing chemical or other physical characteristic of the waste. Also note if this information has or has not changed since the last permit action.

Click to enter text.

Section 7. Pollutant Analysis of Treated Effluent (Instructions Page 49)

Is the facility in operation?

Yes No

If no, this section is not applicable. Proceed to Section 8.

If yes, provide effluent analysis data for the listed pollutants. **Wastewater treatment facilities** complete Table 1.0(2). **Water treatment facilities** discharging filter backwash water, complete Table 1.0(3). Provide copies of the laboratory results sheets. **These tables are not applicable for a minor amendment without renewal.** See the instructions for guidance.

Note: The sample date must be within 1 year of application submission.

Table 1.0(2) – Pollutant Analysis for Wastewater Treatment Facilities

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
CBOD ₅ , mg/l	3.59	3.59	1	C	06/27/24 08:10
Total Suspended Solids, mg/l	6.95	6.95	1	C	06/27/24 08:10
Ammonia Nitrogen, mg/l	12.4	12.4	1	C	06/27/24 08:10
Nitrate Nitrogen, mg/l	<0.1	<0.1	1	C	06/27/24 08:10
Total Kjeldahl Nitrogen, mg/l	23.7	23.7	1	C	06/27/24 08:10
Sulfate, mg/l	75.2	75.2	1	C	06/27/24 08:10
Chloride, mg/l	246	246	1	C	06/27/24 08:10
Total Phosphorus, mg/l	5.10	5.10	1	C	06/27/24 08:10
pH, standard units	7.34	7.34	1	G	06/27/24 08:10
Dissolved Oxygen*, mg/l	6.08	6.08	1	G	06/27/24 08:10
Chlorine Residual, mg/l	2.14	2.14	1	G	06/27/24 08:10
<i>E.coli</i> (CFU/100ml) freshwater					
Enterococci (CFU/100ml) saltwater	29	40	52	G	2024
Total Dissolved Solids, mg/l	604	604	1	C	06/27/24 08:10
Electrical Conductivity, μmhos/cm, †	1340	1340	1	C	06/27/24 08:10
Oil & Grease, mg/l	<5.00	<5.00	1	C	06/27/24 08:10
Alkalinity (CaCO ₃)*, mg/l	157	157	1	C	06/27/24 08:10

*TPDES permits only

†TLAP permits only

Table 1.0(3) – Pollutant Analysis for Water Treatment Facilities

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
Total Suspended Solids, mg/l	6.95	6.95	1	C	06/27/24 08:10

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
Total Dissolved Solids, mg/l	604	604	1	C	06/27/24 08:10
pH, standard units	7.34	7.34	1	G	06/27/24 08:10
Fluoride, mg/l	<0.250	<0.250	1	C	06/27/24 08:10
Aluminum, mg/l	0.026	0.026	1	C	06/27/24 08:10
Alkalinity (CaCO ₃), mg/l	157	157	1	C	06/27/24 08:10

Section 8. Facility Operator (Instructions Page 49)

Facility Operator Name: Jerry Meeks, Jr

Facility Operator's License Classification and Level: Wastewater Class B

Facility Operator's License Number: WW0060350

Section 9. Sludge and Biosolids Management and Disposal (Instructions Page 50)

A. WWTP's Sewage Sludge or Biosolids Management Facility Type

Check all that apply. See instructions for guidance

- Design flow>= 1 MGD
- Serves >= 10,000 people
- Class I Sludge Management Facility (per 40 CFR § 503.9)
- Biosolids generator
- Biosolids end user - land application (onsite)
- Biosolids end user - surface disposal (onsite)
- Biosolids end user - incinerator (onsite)

B. WWTP's Sewage Sludge or Biosolids Treatment Process

Check all that apply. See instructions for guidance.

- Aerobic Digestion
- Air Drying (or sludge drying beds)
- Lower Temperature Composting
- Lime Stabilization
- Higher Temperature Composting
- Heat Drying
- Thermophilic Aerobic Digestion

- Beta Ray Irradiation
- Gamma Ray Irradiation
- Pasteurization
- Preliminary Operation (e.g. grinding, de-gritting, blending)
- Thickening (e.g. gravity thickening, centrifugation, filter press, vacuum filter)
- Sludge Lagoon
- Temporary Storage (< 2 years)
- Long Term Storage (>= 2 years)
- Methane or Biogas Recovery
- Other Treatment Process: [Click to enter text.](#)

C. Sewage Sludge or Biosolids Management

Provide information on the *intended* sewage sludge or biosolids management practice. Do not enter every management practice that you want authorized in the permit, as the permit will authorize all sewage sludge or biosolids management practices listed in the instructions. Rather indicate the management practice the facility plans to use.

Biosolids Management

Management Practice	Handler or Preparer Type	Bulk or Bag Container	Amount (dry metric tons)	Pathogen Reduction Options	Vector Attraction Reduction Option
Disposal in Landfill	Off-site Third-Party Handler or Preparer	Bulk	127.32	N/A: Disposal in Landfill	N/A: Disposal in Landfill
Choose an item.	Choose an item.	Choose an item.		Choose an item.	Choose an item.
Choose an item.	Choose an item.	Choose an item.		Choose an item.	Choose an item.

If "Other" is selected for Management Practice, please explain (e.g. monofill or transport to another WWTP): [Click to enter text.](#)

D. Disposal site

Disposal site name: [GFL Fort Bend LF](#)

TCEQ permit or registration number: [TCEQ Permit #2270 Registration #96322](#)

County where disposal site is located: [Fort Bend](#)

E. Transportation method

Method of transportation (truck, train, pipe, other): [Truck](#)

Name of the hauler: [GFL](#)

Hauler registration number: [23833](#)

Sludge is transported as a:

Liquid semi-liquid semi-solid solid

Section 10. Permit Authorization for Sewage Sludge Disposal (Instructions Page 52)

A. Beneficial use authorization

Does the existing permit include authorization for land application of biosolids for beneficial use?

Yes No

If yes, are you requesting to continue this authorization to land apply biosolids for beneficial use?

Yes No

If yes, is the completed **Application for Permit for Beneficial Land Use of Sewage Sludge (TCEQ Form No. 10451)** attached to this permit application (see the instructions for details)?

Yes No

B. Sludge processing authorization

Does the existing permit include authorization for any of the following sludge processing, storage or disposal options?

Sludge Composting Yes No

Marketing and Distribution of Biosolids Yes No

Sludge Surface Disposal or Sludge Monofill Yes No

Temporary storage in sludge lagoons Yes No

If yes to any of the above sludge options and the applicant is requesting to continue this authorization, is the completed **Domestic Wastewater Permit Application: Sewage Sludge Technical Report (TCEQ Form No. 10056)** attached to this permit application?

Yes No

Section 11. Sewage Sludge Lagoons (Instructions Page 53)

Does this facility include sewage sludge lagoons?

Yes No

If yes, complete the remainder of this section. If no, proceed to Section 12.

A. Location information

The following maps are required to be submitted as part of the application. For each map, provide the Attachment Number.

- Original General Highway (County) Map:

Attachment: [Click to enter text.](#)

- USDA Natural Resources Conservation Service Soil Map:

Attachment: [Click to enter text.](#)

- Federal Emergency Management Map:

Attachment: [Click to enter text.](#)

- Site map:

Attachment: [Click to enter text.](#)

Discuss in a description if any of the following exist within the lagoon area. Check all that apply.

- Overlap a designated 100-year frequency flood plain
- Soils with flooding classification
- Overlap an unstable area
- Wetlands
- Located less than 60 meters from a fault
- None of the above

Attachment: [Click to enter text.](#)

If a portion of the lagoon(s) is located within the 100-year frequency flood plain, provide the protective measures to be utilized including type and size of protective structures:

[Click to enter text.](#)

B. Temporary storage information

Provide the results for the pollutant screening of sludge lagoons. These results are in addition to pollutant results in *Section 7 of Technical Report 1.0*.

Nitrate Nitrogen, mg/kg: [Click to enter text.](#)

Total Kjeldahl Nitrogen, mg/kg: [Click to enter text.](#)

Total Nitrogen (=nitrate nitrogen + TKN), mg/kg: [Click to enter text.](#)

Phosphorus, mg/kg: [Click to enter text.](#)

Potassium, mg/kg: [Click to enter text.](#)

pH, standard units: [Click to enter text.](#)

Ammonia Nitrogen mg/kg: [Click to enter text.](#)

Arsenic: [Click to enter text.](#)

Cadmium: [Click to enter text.](#)

Chromium: [Click to enter text.](#)

Copper: [Click to enter text.](#)

Lead: [Click to enter text.](#)

Mercury: [Click to enter text.](#)

Molybdenum: [Click to enter text.](#)

Nickel: [Click to enter text.](#)

Selenium: [Click to enter text.](#)

Zinc: [Click to enter text.](#)

Total PCBs: [Click to enter text.](#)

Provide the following information:

Volume and frequency of sludge to the lagoon(s): [Click to enter text.](#)

Total dry tons stored in the lagoons(s) per 365-day period: [Click to enter text.](#)

Total dry tons stored in the lagoons(s) over the life of the unit: [Click to enter text.](#)

C. Liner information

Does the active/proposed sludge lagoon(s) have a liner with a maximum hydraulic conductivity of 1×10^{-7} cm/sec?

Yes No

If yes, describe the liner below. Please note that a liner is required.

[Click to enter text.](#)

D. Site development plan

Provide a detailed description of the methods used to deposit sludge in the lagoon(s):

[Click to enter text.](#)

Attach the following documents to the application.

- Plan view and cross-section of the sludge lagoon(s)

Attachment: [Click to enter text.](#)

- Copy of the closure plan

Attachment: [Click to enter text.](#)

- Copy of deed recordation for the site

Attachment: [Click to enter text.](#)

- Size of the sludge lagoon(s) in surface acres and capacity in cubic feet and gallons

Attachment: [Click to enter text.](#)

- Description of the method of controlling infiltration of groundwater and surface water from entering the site

Attachment: [Click to enter text.](#)

- Procedures to prevent the occurrence of nuisance conditions

Attachment: [Click to enter text.](#)

E. Groundwater monitoring

Is groundwater monitoring currently conducted at this site, or are any wells available for groundwater monitoring, or are groundwater monitoring data otherwise available for the sludge lagoon(s)?

- Yes No

If groundwater monitoring data are available, provide a copy. Provide a profile of soil types encountered down to the groundwater table and the depth to the shallowest groundwater as a separate attachment.

Attachment: [Click to enter text.](#)

Section 12. Authorizations/Compliance/Enforcement (Instructions Page 54)

A. Additional authorizations

Does the permittee have additional authorizations for this facility, such as reuse authorization, sludge permit, etc?

- Yes No

If yes, provide the TCEQ authorization number and description of the authorization:

Click to enter text.

B. Permittee enforcement status

Is the permittee currently under enforcement for this facility?

- Yes No

Is the permittee required to meet an implementation schedule for compliance or enforcement?

- Yes No

If yes to either question, provide a brief summary of the enforcement, the implementation schedule, and the current status:

Click to enter text.

Section 13. RCRA/CERCLA Wastes (Instructions Page 55)

A. RCRA hazardous wastes

Has the facility received in the past three years, does it currently receive, or will it receive RCRA hazardous waste?

Yes No

B. Remediation activity wastewater

Has the facility received in the past three years, does it currently receive, or will it receive CERCLA wastewater, RCRA remediation/corrective action wastewater or other remediation activity wastewater?

Yes No

C. Details about wastes received

If yes to either Subsection A or B above, provide detailed information concerning these wastes with the application.

Attachment: [Click to enter text.](#)

Section 14. Laboratory Accreditation (Instructions Page 55)

All laboratory tests performed must meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*, which includes the following general exemptions from National Environmental Laboratory Accreditation Program (NELAP) certification requirements:

- The laboratory is an in-house laboratory and is:
 - periodically inspected by the TCEQ; or
 - located in another state and is accredited or inspected by that state; or
 - performing work for another company with a unit located in the same site; or
 - performing pro bono work for a governmental agency or charitable organization.
- The laboratory is accredited under federal law.
- The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review 30 TAC Chapter 25 for specific requirements.

The following certification statement shall be signed and submitted with every application. See the Signature Page section in the Instructions, for a list of designated representatives who may sign the certification.

CERTIFICATION:

I certify that all laboratory tests submitted with this application meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*.

Printed Name: Jerry Meeks, Jr.

Title: Lead Operator

Signature: 

Date: 3/7/05

DOMESTIC WASTEWATER PERMIT APPLICATION

TECHNICAL REPORT 1.1

The following information is required for new and amendment major applications.

Section 1. Justification for Permit (Instructions Page 56)

A. Justification of permit need

Provide a detailed discussion regarding the need for any phase(s) not currently permitted. Failure to provide sufficient justification may result in the Executive Director recommending denial of the proposed phase(s) or permit.

Click to enter text.

B. Regionalization of facilities

For additional guidance, please review [TCEQ's Regionalization Policy for Wastewater Treatment](#)¹.

Provide the following information concerning the potential for regionalization of domestic wastewater treatment facilities:

1. Municipally incorporated areas

If the applicant is a city, then Item 1 is not applicable. Proceed to Item 2 Utility CCN areas.

Is any portion of the proposed service area located in an incorporated city?

Yes No Not Applicable

If yes, within the city limits of: [Click to enter text](#).

If yes, attach correspondence from the city.

Attachment: [Click to enter text](#).

If consent to provide service is available from the city, attach a justification for the proposed facility and a cost analysis of expenditures that includes the cost of connecting to the city versus the cost of the proposed facility or expansion attached.

Attachment: [Click to enter text](#).

2. Utility CCN areas

Is any portion of the proposed service area located inside another utility's CCN area?

Yes No

¹ <https://www.tceq.texas.gov/permitting/wastewater/tceq-regionalization-for-wastewater>

If yes, attach a justification for the proposed facility and a cost analysis of expenditures that includes the cost of connecting to the CCN facilities versus the cost of the proposed facility or expansion.

Attachment: [Click to enter text.](#)

3. *Nearby WWTPs or collection systems*

Are there any domestic permitted wastewater treatment facilities or collection systems located within a three-mile radius of the proposed facility?

Yes No

If yes, attach a list of these facilities and collection systems that includes each permittee's name and permit number, and an area map showing the location of these facilities and collection systems.

Attachment: [Click to enter text.](#)

If yes, attach proof of mailing a request for service to each facility and collection system, the letters requesting service, and correspondence from each facility and collection system.

Attachment: [Click to enter text.](#)

If the facility or collection system agrees to provide service, attach a justification for the proposed facility and a cost analysis of expenditures that includes the cost of connecting to the facility or collection system versus the cost of the proposed facility or expansion.

Attachment: [Click to enter text.](#)

Section 2. Proposed Organic Loading (Instructions Page 58)

Is this facility in operation?

Yes No

If no, proceed to Item B, Proposed Organic Loading.

If yes, provide organic loading information in Item A, Current Organic Loading

A. Current organic loading

Facility Design Flow (flow being requested in application): [Click to enter text.](#)

Average Influent Organic Strength or BOD₅ Concentration in mg/l: [Click to enter text.](#)

Average Influent Loading (lbs/day = total average flow X average BOD₅ conc. X 8.34): [Click to enter text.](#)

Provide the source of the average organic strength or BOD₅ concentration.

[Click to enter text.](#)

B. Proposed organic loading

This table must be completed if this application is for a facility that is not in operation or if this application is to request an increased flow that will impact organic loading.

Table 1.1(1) – Design Organic Loading

Source	Total Average Flow (MGD)	Influent BOD ₅ Concentration (mg/l)
Municipality		
Subdivision		
Trailer park - transient		
Mobile home park		
School with cafeteria and showers		
School with cafeteria, no showers		
Recreational park, overnight use		
Recreational park, day use		
Office building or factory		
Motel		
Restaurant		
Hospital		
Nursing home		
Other		
TOTAL FLOW from all sources		
AVERAGE BOD ₅ from all sources		

Section 3. Proposed Effluent Quality and Disinfection (Instructions Page 58)

A. Existing/Interim I Phase Design Effluent Quality

Biochemical Oxygen Demand (5-day), mg/l: [Click to enter text](#).

Total Suspended Solids, mg/l: [Click to enter text](#).

Ammonia Nitrogen, mg/l: [Click to enter text](#).

Total Phosphorus, mg/l: [Click to enter text](#).

Dissolved Oxygen, mg/l: [Click to enter text](#).

Other: [Click to enter text](#).

B. Interim II Phase Design Effluent Quality

Biochemical Oxygen Demand (5-day), mg/l: [Click to enter text](#).

Total Suspended Solids, mg/l: [Click to enter text](#).

Ammonia Nitrogen, mg/l: [Click to enter text](#).

Total Phosphorus, mg/l: [Click to enter text](#).

Dissolved Oxygen, mg/l: [Click to enter text](#).

Other: [Click to enter text](#).

C. Final Phase Design Effluent Quality

Biochemical Oxygen Demand (5-day), mg/l: [Click to enter text](#).

Total Suspended Solids, mg/l: [Click to enter text](#).

Ammonia Nitrogen, mg/l: [Click to enter text](#).

Total Phosphorus, mg/l: [Click to enter text](#).

Dissolved Oxygen, mg/l: [Click to enter text](#).

Other: [Click to enter text](#).

D. Disinfection Method

Identify the proposed method of disinfection.

- Chlorine: [Click to enter text](#), mg/l after [Click to enter text](#). minutes detention time at peak flow

Dechlorination process: [Click to enter text](#).

- Ultraviolet Light: [Click to enter text](#). seconds contact time at peak flow
- Other: [Click to enter text](#).

Section 4. Design Calculations (Instructions Page 58)

Attach design calculations and plant features for each proposed phase. Example 4 of the instructions includes sample design calculations and plant features.

Attachment: [Click to enter text](#).

Section 5. Facility Site (Instructions Page 59)

A. 100-year floodplain

Will the proposed facilities be located above the 100-year frequency flood level?

- Yes
- No

If no, describe measures used to protect the facility during a flood event. Include a site map showing the location of the treatment plant within the 100-year frequency flood level. If applicable, provide the size and types of protective structures.

[Click to enter text](#).

Provide the source(s) used to determine 100-year frequency flood plain.

Click to enter text.

For a new or expansion of a facility, will a wetland or part of a wetland be filled?

- Yes No

If yes, has the applicant applied for a US Corps of Engineers 404 Dredge and Fill Permit?

- Yes No

If yes, provide the permit number: [Click to enter text.](#)

If no, provide the approximate date you anticipate submitting your application to the Corps: [Click to enter text.](#)

B. Wind rose

Attach a wind rose: [Click to enter text.](#)

Section 6. Permit Authorization for Sewage Sludge Disposal (Instructions Page 59)

A. Beneficial use authorization

Are you requesting to include authorization to land apply sewage sludge for beneficial use on property located adjacent to the wastewater treatment facility under the wastewater permit?

- Yes No

If yes, attach the completed **Application for Permit for Beneficial Land Use of Sewage Sludge (TCEQ Form No. 10451)**: [Click to enter text.](#)

B. Sludge processing authorization

Identify the sludge processing, storage or disposal options that will be conducted at the wastewater treatment facility:

- Sludge Composting
- Marketing and Distribution of sludge
- Sludge Surface Disposal or Sludge Monofill

If any of the above, sludge options are selected, attach the completed **Domestic Wastewater Permit Application: Sewage Sludge Technical Report (TCEQ Form No. 10056)**: [Click to enter text.](#)

Section 7. Sewage Sludge Solids Management Plan (Instructions Page 60)

Attach a solids management plan to the application.

Attachment: [Click to enter text.](#)

The sewage sludge solids management plan must contain the following information:

- Treatment units and processes dimensions and capacities

- Solids generated at 100, 75, 50, and 25 percent of design flow
- Mixed liquor suspended solids operating range at design and projected actual flow
- Quantity of solids to be removed and a schedule for solids removal
- Identification and ownership of the ultimate sludge disposal site
- For facultative lagoons, design life calculations, monitoring well locations and depths, and the ultimate disposal method for the sludge from the facultative lagoon

An example of a sewage sludge solids management plan has been included as Example 5 of the instructions.

DOMESTIC WASTEWATER PERMIT APPLICATION WORKSHEET 2.0: RECEIVING WATERS

The following information is required for all TPDES permit applications.

Section 1. Domestic Drinking Water Supply (Instructions Page 63)

Is there a surface water intake for domestic drinking water supply located within 5 miles downstream from the point or proposed point of discharge?

Yes No

If no, proceed to Section 2. If yes, provide the following:

Owner of the drinking water supply: [Click to enter text](#).

Distance and direction to the intake: [Click to enter text](#).

Attach a USGS map that identifies the location of the intake.

Attachment: [Click to enter text](#).

Section 2. Discharge into Tidally Affected Waters (Instructions Page 63)

Does the facility discharge into tidally affected waters?

Yes No

If no, proceed to Section 3. If yes, complete the remainder of this section. If no, proceed to Section 3.

A. Receiving water outfall

Width of the receiving water at the outfall, in feet: 300 feet

B. Oyster waters

Are there oyster waters in the vicinity of the discharge?

Yes No

If yes, provide the distance and direction from outfall(s).

[Click to enter text](#)

C. Sea grasses

Are there any sea grasses within the vicinity of the point of discharge?

Yes No

If yes, provide the distance and direction from the outfall(s).

[Click to enter text](#)

Section 3. Classified Segments (Instructions Page 63)

Is the discharge directly into (or within 300 feet of) a classified segment?

- Yes No

If yes, this Worksheet is complete.

If no, complete Sections 4 and 5 of this Worksheet.

Section 4. Description of Immediate Receiving Waters (Instructions Page 63)

Name of the immediate receiving waters: [Click to enter text](#).

A. Receiving water type

Identify the appropriate description of the receiving waters.

- Stream
- Freshwater Swamp or Marsh
- Lake or Pond

Surface area, in acres: [Click to enter text](#).

Average depth of the entire water body, in feet: [Click to enter text](#).

Average depth of water body within a 500-foot radius of discharge point, in feet: [Click to enter text](#).

- Man-made Channel or Ditch
- Open Bay
- Tidal Stream, Bayou, or Marsh
- Other, specify: [Click to enter text](#).

B. Flow characteristics

If a stream, man-made channel or ditch was checked above, provide the following. For existing discharges, check one of the following that best characterizes the area *upstream* of the discharge. For new discharges, characterize the area *downstream* of the discharge (check one).

- Intermittent - dry for at least one week during most years
- Intermittent with Perennial Pools - enduring pools with sufficient habitat to maintain significant aquatic life uses
- Perennial - normally flowing

Check the method used to characterize the area upstream (or downstream for new dischargers).

- USGS flow records
- Historical observation by adjacent landowners
- Personal observation
- Other, specify: [Click to enter text](#).

C. Downstream perennial confluences

List the names of all perennial streams that join the receiving water within three miles downstream of the discharge point.

Click to enter text.

D. Downstream characteristics

Do the receiving water characteristics change within three miles downstream of the discharge (e.g., natural or man-made dams, ponds, reservoirs, etc.)?

- Yes No

If yes, discuss how.

Click to enter text.

E. Normal dry weather characteristics

Provide general observations of the water body during normal dry weather conditions.

Click to enter text.

Date and time of observation: [Click to enter text](#).

Was the water body influenced by stormwater runoff during observations?

- Yes No

Section 5. General Characteristics of the Waterbody (Instructions Page 65)

A. Upstream influences

Is the immediate receiving water upstream of the discharge or proposed discharge site influenced by any of the following? Check all that apply.

- | | |
|---|---|
| <input type="checkbox"/> Oil field activities | <input type="checkbox"/> Urban runoff |
| <input type="checkbox"/> Upstream discharges | <input type="checkbox"/> Agricultural runoff |
| <input type="checkbox"/> Septic tanks | <input type="checkbox"/> Other(s), specify: Click to enter text . |

B. Waterbody uses

Observed or evidences of the following uses. Check all that apply.

- Livestock watering
- Irrigation withdrawal
- Fishing
- Domestic water supply
- Park activities
- Contact recreation
- Non-contact recreation
- Navigation
- Industrial water supply
- Other(s), specify: [Click to enter text](#).

C. Waterbody aesthetics

Check one of the following that best describes the aesthetics of the receiving water and the surrounding area.

- Wilderness: outstanding natural beauty; usually wooded or unpastured area; water clarity exceptional
- Natural Area: trees and/or native vegetation; some development evident (from fields, pastures, dwellings); water clarity discolored
- Common Setting: not offensive; developed but uncluttered; water may be colored or turbid
- Offensive: stream does not enhance aesthetics; cluttered; highly developed; dumping areas; water discolored

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 2.1: STREAM PHYSICAL CHARACTERISTICS

Required for new applications, major facilities, and applications adding an outfall.

Worksheet 2.1 is not required for discharges to intermittent streams or discharges directly to (or within 300 feet of) a classified segment.

Section 1. General Information (Instructions Page 65)

Date of study: [Click to enter text](#). Time of study: [Click to enter text](#).

Stream name: [Click to enter text](#).

Location: [Click to enter text](#).

Type of stream upstream of existing discharge or downstream of proposed discharge (check one).

- Perennial Intermittent with perennial pools

Section 2. Data Collection (Instructions Page 65)

Number of stream bends that are well defined: [Click to enter text](#).

Number of stream bends that are moderately defined: [Click to enter text](#).

Number of stream bends that are poorly defined: [Click to enter text](#).

Number of riffles: [Click to enter text](#).

Evidence of flow fluctuations (check one):

- Minor moderate severe

Indicate the observed stream uses and if there is evidence of flow fluctuations or channel obstruction/modification.

[Click to enter text](#).

Stream transects

In the table below, provide the following information for each transect downstream of the existing or proposed discharges. Use a separate row for each transect.

Table 2.1(1) - Stream Transect Records

Stream type at transect	Transect location	Water surface width (ft)	Stream depths (ft)
Select riffle, run, glide, or pool. See Instructions, Definitions section.			at 4 to 10 points along each transect from the channel bed to the water surface. Separate the measurements with commas.
Choose an item.			

Section 3. Summarize Measurements (Instructions Page 65)

Streambed slope of entire reach, from USGS map in feet/feet: [Click to enter text.](#)

Approximate drainage area above the most downstream transect (from USGS map or county highway map, in square miles): [Click to enter text](#).

Length of stream evaluated, in feet: Click to enter text.

Number of lateral transects made: [Click to enter text.](#)

Average stream width, in feet: Click to enter text.

Average stream depth, in feet: Click to enter text.

Average stream velocity, in feet/second: Click to edit

Instantaneous stream flow, in cubic feet/second: Click to enter

Indicate flow measurement method (type of meter, floating chip timer, etc.)

Size of pools (large, small, moderate, none): Click to enter text

Maximum pool depth, in feet: [Click to enter text](#)

1 2 3 4 5 6 7 8

DOMESTIC WASTEWATER PERMIT APPLICATION WORKSHEET 3.0: LAND DISPOSAL OF EFFLUENT

The following is required for renewal, new, and amendment permit applications.

Section 1. Type of Disposal System (Instructions Page 67)

Identify the method of land disposal:

- Surface application
- Irrigation
- Drip irrigation system
- Evaporation
- Other (describe in detail): [Click to enter text.](#)
- Subsurface application
- Subsurface soils absorption
- Subsurface area drip dispersal system
- Evapotranspiration beds

NOTE: All applicants without authorization or proposing new/amended subsurface disposal MUST complete and submit Worksheet 7.0.

For existing authorizations, provide Registration Number: [Click to enter text.](#)

Section 2. Land Application Site(s) (Instructions Page 67)

In table 3.0(1), provide the requested information for the land application sites. Include the agricultural or cover crop type (wheat, cotton, alfalfa, bermuda grass, native grasses, etc.), land use (golf course, hayland, pastureland, park, row crop, etc.), irrigation area, amount of effluent applied, and whether or not the public has access to the area. Specify the amount of land area and the amount of effluent that will be allotted to each agricultural or cover crop, if more than one crop will be used.

Table 3.0(1) – Land Application Site Crops

Crop Type & Land Use	Irrigation Area (acres)	Effluent Application (GPD)	Public Access? Y/N
Impounded Wetlands	0	0	Y

Section 3. Storage and Evaporation Lagoons/Ponds (Instructions Page 67)

Table 3.0(2) – Storage and Evaporation Ponds

Pond Number	Surface Area (acres)	Storage Volume (acre-feet)	Dimensions	Liner Type
Impounded Wetlands	38.2	38.2	Approx. 1400x1600x1	Clay

Attach a copy of a liner certification that was prepared, signed, and sealed by a Texas licensed professional engineer for each pond.

Attachment: [Click to enter text.](#)

Section 4. Flood and Runoff Protection (Instructions Page 67)

Is the land application site within the 100-year frequency flood level?

Yes No

If yes, describe how the site will be protected from inundation.

[Click to enter text.](#)

Provide the source used to determine the 100-year frequency flood level:

National Flood Insurance Rate Map (FIRM)

Provide a description of tailwater controls and rainfall run-on controls used for the land application site.

Click to enter text.

Section 5. Annual Cropping Plan (Instructions Page 67)

Attach an Annual Cropping Plan which includes a discussion of each of the following items. If not applicable, provide a detailed explanation indicating why. **Attachment:** Attachment #9

- Soils map with crops
- Cool and warm season plant species
- Crop yield goals
- Crop growing season
- Crop nutrient requirements
- Additional fertilizer requirements
- Minimum/maximum harvest height (for grass crops)
- Supplemental watering requirements
- Crop salt tolerances
- Harvesting method/number of harvests
- Justification for not removing existing vegetation to be irrigated

Section 6. Well and Map Information (Instructions Page 68)

Attach a USGS map with the following information shown and labeled. If not applicable, provide a detailed explanation indicating why. **Attachment:** Attachment #5

- The boundaries of the land application site(s)
- Waste disposal or treatment facility site(s)
- On-site buildings
- Buffer zones
- Effluent storage and tailwater control facilities
- All water wells within 1-mile radius of the disposal site or property boundaries
- All springs and seeps onsite and within 500 feet of the property boundaries
- All surface waters in the state onsite and within 500 feet of the property boundaries
- All faults and sinkholes onsite and within 500 feet of the property

List and cross reference all water wells located within a half-mile radius of the disposal site or property boundaries shown on the USGS map in the following table. Attach additional pages as necessary to include all of the wells.

Table 3.0(3) – Water Well Data

Well ID	Well Use	Producing? Y/N	Open, cased, capped, or plugged?	Proposed Best Management Practice
8105605	Unused	N	Cased	

Well ID	Well Use	Producing? Y/N	Open, cased, capped, or plugged?	Proposed Best Management Practice
8106402	N/A	N	Plugged	
83194	N/A	N	Plugged	
179308	N/A	N	Plugged	
4320	Industrial	N	Plugged	
227759	Monitor	N	Cased	
227760	Monitor	N	Cased	
227761	Monitor	N	Cased	
227762	Monitor	N	Cased	
8106406	Public Supply	Y	Cased	
8105606	Observation	N	No Data	
8105602	Observation	N	Cased	
8105607	Observation	N	No Data	
66819	No Data	No Data	No Data	
4321	Industrial	N	Plugged	
8105604	Plugged	N	Plugged	

If water quality data or well log information is available please include the information in an attachment listed by Well ID.

Attachment: [Attachment #10](#)

Section 7. Groundwater Quality (Instructions Page 68)

Attach a Groundwater Quality Technical Report which assesses the impact of the wastewater disposal system on groundwater. This report shall include an evaluation of the water wells (including the information in the well table provided in Item 6. above), the wastewater application rate, and pond liners. Indicate by a check mark that this report is provided.

Attachment: [Click to enter text.](#)

Are groundwater monitoring wells available onsite? Yes No

Do you plan to install ground water monitoring wells or lysimeters around the land application site? Yes No

If yes, provide the proposed location of the monitoring wells or lysimeters on a site map.

Attachment: [Click to enter text.](#)

Attachment: [Click to enter text.](#)

Section 8. Soil Map and Soil Analyses (Instructions Page 69)

A. Soil map

Attach a USDA Soil Survey map that shows the area to be used for effluent disposal.

Attachment: [Attachment #11](#)

B. Soil analyses

Attach the laboratory results sheets from the soil analyses. **Note:** for renewal applications, the current annual soil analyses required by the permit are acceptable as long as the test date is less than one year prior to the submission of the application.

Attachment: [Land application of the effluent is only when needed in the Wetlands. We have not discharged to the Wetlands since the ability has been available.](#)

List all USDA designated soil series on the proposed land application site. Attach additional pages as necessary.

Table 3.0(4) – Soil Data

Soil Series	Depth from Surface	Permeability	Available Water Capacity	Curve Number

Section 9. Effluent Monitoring Data (Instructions Page 70)

Is the facility in operation?

Yes No

If no, this section is not applicable and the worksheet is complete.

If yes, provide the effluent monitoring data for the parameters regulated in the existing permit. If a parameter is not regulated in the existing permit, enter N/A.

Table 3.0(5) – Effluent Monitoring Data

Date	30 Day Avg Flow MGD	BOD5 mg/l	TSS mg/l	pH	Chlorine Residual mg/l	Acres irrigated

Provide a discussion of all persistent excursions above the permitted limits and any corrective actions taken.

Land application of the effluent is only when needed in the Wetlands. We have not discharged to the Wetlands since the ability as been available.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 3.1: SURFACE LAND DISPOSAL OF EFFLUENT

The following is required for new and major amendment permit applications. Renewal and minor amendment permit applications may be asked for this worksheet on a case by case basis.

Section 1. Surface Disposal (Instructions Page 71)

Complete the item that applies for the method of disposal being used.

A. Irrigation

Area under irrigation, in acres: [Click to enter text](#).

Design application frequency:

hours/day [Click to enter text](#). And days/week [Click to enter text](#).

Land grade (slope):

average percent (%): [Click to enter text](#).

maximum percent (%): [Click to enter text](#).

Design application rate in acre-feet/acre/year: [Click to enter text](#).

Design total nitrogen loading rate, in lbs N/acre/year: [Click to enter text](#).

Soil conductivity (mmhos/cm): [Click to enter text](#).

Method of application: [Click to enter text](#).

Attach a separate engineering report with the water balance and storage volume calculations, method of application, irrigation efficiency, and nitrogen balance.

Attachment: [Click to enter text](#).

B. Evaporation ponds

Daily average effluent flow into ponds, in gallons per day: [Click to enter text](#).

Attach a separate engineering report with the water balance and storage volume calculations.

Attachment: [Click to enter text](#).

C. Evapotranspiration beds

Number of beds: [Click to enter text](#).

Area of bed(s), in acres: [Click to enter text](#).

Depth of bed(s), in feet: [Click to enter text](#).

Void ratio of soil in the beds: [Click to enter text](#).

Storage volume within the beds, in acre-feet: [Click to enter text](#).

Attach a separate engineering report with the water balance and storage volume calculations, and a description of the lining.

Attachment: [Click to enter text](#).

D. Overland flow

Area used for application, in acres: [Click to enter text.](#)

Slopes for application area, percent (%): [Click to enter text.](#)

Design application rate, in gpm/foot of slope width: [Click to enter text.](#)

Slope length, in feet: [Click to enter text.](#)

Design BOD₅ loading rate, in lbs BOD₅/acre/day: [Click to enter text.](#)

Design application frequency:

hours/day: [Click to enter text.](#) And days/week: [Click to enter text.](#)

Attach a separate engineering report with the method of application and design requirements according to *30 TAC Chapter 217*.

Attachment: [Click to enter text.](#)

Section 2. Edwards Aquifer (Instructions Page 72)

Is the facility subject to *30 TAC Chapter 213*, Edwards Aquifer Rules?

Yes No

If yes, is the facility located on the Edwards Aquifer Recharge Zone?

Yes No

If yes, attach a geological report addressing potential recharge features.

Attachment: [Click to enter text.](#)

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 3.2: SURFACE LAND DISPOSAL OF EFFLUENT

The following is required for new and major amendment permit applications. Renewal and minor amendments applicants may be asked for the worksheet on a case by case basis.

NOTE: All applicants proposing new/amended subsurface disposal MUST complete and submit Worksheet 7.0. This worksheet applies to any subsurface disposal system that **does not meet** the definition of a subsurface area drip dispersal system as defined in *30 TAC Chapter 222, Subsurface Area Drip Dispersal System*.

Section 1. Subsurface Application (Instructions Page 73)

Identify the type of system:

- Conventional Gravity Drainfield, Beds, or Trenches (new systems must be less than 5,000 GPD)
- Low Pressure Dosing
- Other, specify: [Click to enter text](#).

Application area, in acres: [Click to enter text](#).

Area of drainfield, in square feet: [Click to enter text](#).

Application rate, in gal/square foot/day: [Click to enter text](#).

Depth to groundwater, in feet: [Click to enter text](#).

Area of trench, in square feet: [Click to enter text](#).

Dosing duration per area, in hours: [Click to enter text](#).

Number of beds: [Click to enter text](#).

Dosing amount per area, in inches/day: [Click to enter text](#).

Infiltration rate, in inches/hour: [Click to enter text](#).

Storage volume, in gallons: [Click to enter text](#).

Area of bed(s), in square feet: [Click to enter text](#).

Soil Classification: [Click to enter text](#).

Attach a separate engineering report with the information required in *30 TAC § 309.20*, excluding the requirements of § 309.20 b(3)(A) and (B) design analysis which may be asked for on a case by case basis. Include a description of the schedule of dosing basin rotation.

Attachment: [Click to enter text](#).

Section 2. Edwards Aquifer (Instructions Page 73)

Is the subsurface system over the Edwards Aquifer Recharge Zone as mapped by TCEQ?

- Yes
- No

Is the subsurface system over the Edwards Aquifer Transition Zone as mapped by TCEQ?

- Yes
- No

If yes to either question, the subsurface system may be prohibited by *30 TAC § 213.8*. Please call the Municipal Permits Team, at 512-239-4671, to schedule a pre-application meeting.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 3.3: SUBSURFACE AREA DRIP DISPERSAL (SADDS) LAND DISPOSAL OF EFFLUENT

The following is required for new and major amendment subsurface area drip dispersal system permit applications. Renewal and minor amendments applicants may be asked for the worksheet on a case by case basis.

NOTE: All applicants proposing new/amended subsurface disposal MUST complete and submit Worksheet 7.0. This worksheet applies to any subsurface disposal system that meets the definition of a subsurface area drip dispersal system as defined in *30 TAC Chapter 222, Subsurface Area Drip Dispersal System*.

Section 1. Administrative Information (Instructions Page 74)

- A. Provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the owner of the treatment facility:
- B. Click to enter text. Is the owner of the land where the treatment facility is located the same as the owner of the treatment facility?

Yes No

If no, provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the owner of the land where the treatment facility is located.

Click to enter text.

- C. Owner of the subsurface area drip dispersal system: Click to enter text.
- D. Is the owner of the subsurface area drip dispersal system the same as the owner of the wastewater treatment facility or the site where the wastewater treatment facility is located?

Yes No

If no, identify the names of all corporations or other business entities managed, owned, or otherwise closely related to the entity identified in Item 1.C.

Click to enter text.

- E. Owner of the land where the subsurface area drip dispersal system is located: Click to enter text.
- F. Is the owner of the land where the subsurface area drip dispersal system is located the same as owner of the wastewater treatment facility, the site where the wastewater treatment facility is located, or the owner of the subsurface area drip dispersal system?

Yes No

If no, identify the name of all corporations or other business entities managed, owned, or otherwise closely related to the entity identified in item 1.E.

Click to enter text.

Section 2. Subsurface Area Drip Dispersal System (Instructions Page 74)

A. Type of system

- Subsurface Drip Irrigation
- Surface Drip Irrigation
- Other, specify: [Click to enter text.](#)

B. Irrigation operations

Application area, in acres: [Click to enter text.](#)

Infiltration Rate, in inches/hour: [Click to enter text.](#)

Average slope of the application area, percent (%): [Click to enter text.](#)

Maximum slope of the application area, percent (%): [Click to enter text.](#)

Storage volume, in gallons: [Click to enter text.](#)

Major soil series: [Click to enter text.](#)

Depth to groundwater, in feet: [Click to enter text.](#)

C. Application rate

Is the facility located **west** of the boundary shown in *30 TAC § 222.83* **and** also using a vegetative cover of non-native grasses over seeded with cool season grasses during the winter months (October-March)?

- Yes
- No

If **yes**, then the facility may propose a hydraulic application rate not to exceed 0.1 gal/square foot/day.

Is the facility located **east** of the boundary shown in *30 TAC § 222.83* **or** in any part of the state when the vegetative cover is any crop other than non-native grasses?

- Yes
- No

If **yes**, the facility must use the formula in *30 TAC §222.83* to calculate the maximum hydraulic application rate.

Do you plan to submit an alternative method to calculate the hydraulic application rate for approval by the executive director?

- Yes
- No

Hydraulic application rate, in gal/square foot/day: [Click to enter text.](#)

Nitrogen application rate, in lbs/gal/day: [Click to enter text.](#)

D. Dosing information

Number of doses per day: [Click to enter text.](#)

Dosing duration per area, in hours: [Click to enter text.](#)

Rest period between doses, in hours: [Click to enter text.](#)

Dosing amount per area, in inches/day: [Click to enter text.](#)

Number of zones: [Click to enter text](#).

Does the proposed subsurface drip irrigation system use tree vegetative cover as a crop?

- Yes No

If yes, provide a vegetation survey by a certified arborist. Please call the Water Quality Assessment Team at (512) 239-4671 to schedule a pre-application meeting.

Attachment: [Click to enter text](#).

Section 3. Required Plans (Instructions Page 74)

A. Recharge feature plan

Attach a Recharge Feature Plan with all information required in 30 TAC §222.79.

Attachment: [Click to enter text](#).

B. Soil evaluation

Attach a Soil Evaluation with all information required in 30 TAC §222.73.

Attachment: [Click to enter text](#).

C. Site preparation plan

Attach a Site Preparation Plan with all information required in 30 TAC §222.75.

Attachment: [Click to enter text](#).

D. Soil sampling/testing

Attach soil sampling and testing that includes all information required in 30 TAC §222.157.

Attachment: [Click to enter text](#).

Section 4. Floodway Designation (Instructions Page 75)

A. Site location

Is the existing/proposed land application site within a designated floodway?

- Yes No

B. Flood map

Attach either the FEMA flood map or alternate information used to determine the floodway.

Attachment: [Click to enter text](#).

Section 5. Surface Waters in the State (Instructions Page 75)

A. Buffer Map

Attach a map showing appropriate buffers on surface waters in the state, water wells, and springs/seeps.

Attachment: [Click to enter text](#).

B. Buffer variance request

Do you plan to request a buffer variance from water wells or waters in the state?

- Yes No

If yes, then attach the additional information required in *30 TAC § 222.81(c)*.

Attachment: [Click to enter text.](#)

Section 6. Edwards Aquifer (Instructions Page 75)

A. Is the SADDS located over the Edwards Aquifer Recharge Zone as mapped by TCEQ?

- Yes No

B. Is the SADDS located over the Edwards Aquifer Transition Zone as mapped by TCEQ?

- Yes No

If yes to either question, then the SADDS may be prohibited by *30 TAC §213.8*. Please call the Municipal Permits Team at 512-239-4671 to schedule a pre-application meeting.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 4.0: POLLUTANT ANALYSIS REQUIREMENTS

The following **is required** for facilities with a permitted or proposed flow of **1.0 MGD or greater**, facilities with an approved **pretreatment** program, or facilities classified as a **major facility**. See instructions for further details.

This worksheet is not required minor amendments without renewal.

Section 1. Toxic Pollutants (Instructions Page 76)

For pollutants identified in Table 4.0(1), indicate the type of sample.

Grab Composite

Date and time sample(s) collected: 06/27/2024 08:10

Table 4.0(1) – Toxics Analysis

Pollutant	AVG Effluent Conc. ($\mu\text{g/l}$)	MAX Effluent Conc. ($\mu\text{g/l}$)	Number of Samples	MAL ($\mu\text{g/l}$)
Acrylonitrile	<9.2	<9.2	1	50
Aldrin	<0.04	<0.04	1	0.01
Aluminum	26.0	26.0	1	2.5
Anthracene	<5.00	<5.00	1	10
Antimony	<5.00	<5.00	1	5
Arsenic	2.97	2.97	1	0.5
Barium	41.6	41.6	1	3
Benzene	<1	<1	1	10
Benzidine	<50.0	<50.0	1	50
Benzo(a)anthracene	<5.00	<5.00	1	5
Benzo(a)pyrene	<5.00	<5.00	1	5
Bis(2-chloroethyl)ether	<10.0	<10.0	1	10
Bis(2-ethylhexyl)phthalate	<10.0	<10.0	1	10
Bromodichloromethane	4.14	4.14	1	10
Bromoform	<1	<1	1	10
Cadmium	<1.00	<1.00	1	1
Carbon Tetrachloride	<1	<1	1	2
Carbaryl	<2.56	<2.56	1	5
Chlordane*	<10.0	<10.0	1	0.2
Chlorobenzene	<1	<1	1	10

Pollutant	AVG Effluent Conc. ($\mu\text{g/l}$)	MAX Effluent Conc. ($\mu\text{g/l}$)	Number of Samples	MAL ($\mu\text{g/l}$)
Chlorodibromomethane	1.7	1.7	1	10
Chloroform	10.8	10.8	1	10
Chlorpyrifos	<0.0500	<0.0500	1	0.05
Chromium (Total)	<3.00	<3.00	1	3
Chromium (Tri) (*1)	<3.00	<3.00	1	N/A
Chromium (Hex)	4.44	4.44	1	3
Copper	<2.00	<2.00	1	2
Chrysene	<5.00	<5.00	1	5
p-Chloro-m-Cresol	<10	<10	1	10
4,6-Dinitro-o-Cresol	<50	<50	1	50
p-Cresol				10
Cyanide (*2)	<10.0	<10.0	1	10
4,4'-DDD	<0.002	<0.002	1	0.1
4,4'-DDE	<0.009	<0.009	1	0.1
4,4'-DDT	<0.004	<0.004	1	0.02
2,4-D	<0.700	<0.700	1	0.7
Demeton (O and S)	<0.200	<0.200	1	0.20
Diazinon	<0.500	<0.500	1	0.5/0.1
1,2-Dibromoethane	<1	<1	1	10
m-Dichlorobenzene	<1	<1	1	10
o-Dichlorobenzene	<1	<1	1	10
p-Dichlorobenzene	<1	<1	1	10
3,3'-Dichlorobenzidine	<5.00	<5.00	1	5
1,2-Dichloroethane	<1	<1	1	10
1,1-Dichloroethylene	<1	<1	1	10
Dichloromethane	<1	<1	1	20
1,2-Dichloropropane	<1	<1	1	10
1,3-Dichloropropene	<1	<1	1	10
Dicofol	<0.050	<0.050	1	1
Dieldrin	<0.005	<0.005	1	0.02
2,4-Dimethylphenol	<10.0	<10.0	1	10
Di-n-Butyl Phthalate	<10.0	<10.0	1	10
Diuron	<0.0461	<0.0461	1	0.09

Pollutant	AVG Effluent Conc. ($\mu\text{g/l}$)	MAX Effluent Conc. ($\mu\text{g/l}$)	Number of Samples	MAL ($\mu\text{g/l}$)
Endosulfan I (alpha)	<0.007	<0.007	1	0.01
Endosulfan II (beta)	<0.004	<0.004	1	0.02
Endosulfan Sulfate	<0.005	<0.005	1	0.1
Endrin	<0.004	<0.004	1	0.02
Epichlorohydrin				---
Ethylbenzene	3.12	3.12	1	10
Ethylene Glycol				---
Fluoride	<250	<250	1	500
Guthion	<0.100	<0.100	1	0.1
Heptachlor	<0.004	<0.004	1	0.01
Heptachlor Epoxide	<0.004	<0.004	1	0.01
Hexachlorobenzene	<5.00	<5.00	1	5
Hexachlorobutadiene	<10.0	<10.0	1	10
Hexachlorocyclohexane (alpha)	<0.003	<0.003	1	0.05
Hexachlorocyclohexane (beta)	<0.004	<0.004	1	0.05
gamma-Hexachlorocyclohexane (Lindane)	<0.004	<0.004	1	0.05
Hexachlorocyclopentadiene	<10.0	<10.0	1	10
Hexachloroethane	<20.0	<20.0	1	20
Hexachlorophene	<10.0	<10.0	1	10
4,4'-Isopropylidenediphenol				1
Lead	<0.5	<0.5	1	0.5
Malathion	<0.100	<0.100	1	0.1
Mercury	<0.00500	<0.00500	1	0.005
Methoxychlor	<0.003	<0.003	1	2
Methyl Ethyl Ketone				50
Methyl tert-butyl ether				---
Mirex	<0.010	<0.010	1	0.02
Nickel	2.83	2.83	1	2
Nitrate-Nitrogen	<100	<100	1	100
Nitrobenzene	<10.0	<10.0	1	10
N-Nitrosodiethylamine	<20.0	<20.0	1	20
N-Nitroso-di-n-Butylamine	<20.0	<20.0	1	20

Pollutant	AVG Effluent Conc. ($\mu\text{g/l}$)	MAX Effluent Conc. ($\mu\text{g/l}$)	Number of Samples	MAL ($\mu\text{g/l}$)
Nonylphenol	<333	<333	1	333
Parathion (ethyl)	<0.100	<0.100	1	0.1
Pentachlorobenzene	<20.0	<20.0	1	20
Pentachlorophenol	<5.00	<5.00	1	5
Phenanthrene	<10.0	<10.0	1	10
Polychlorinated Biphenyls (PCB's) (*3)	<0.03	<0.03	1	0.2
Pyridine	<20.0	<20.0	1	20
Selenium	<5.00	<5.00	1	5
Silver	<0.5	<0.5	1	0.5
1,2,4,5-Tetrachlorobenzene	<10.0	<10.0	1	20
1,1,2,2-Tetrachloroethane	<1	<1	1	10
Tetrachloroethylene	<1	<1	1	10
Thallium	<1.25	<1.25	1	0.5
Toluene	1.15	1.15	1	10
Toxaphene	<0.100	<0.100	1	0.3
2,4,5-TP (Silvex)	<0.300	<0.300	1	0.3
Tributyltin (see instructions for explanation)	.	.	.	0.01
1,1,1-Trichloroethane	<1.0	<1.0	1	10
1,1,2-Trichloroethane	<1.00	<1.00	1	10
Trichloroethylene	<1	<1	1	10
2,4,5-Trichlorophenol	<10.0	<10.0	1	50
TTHM (Total Trihalomethanes)	16.64	16.64	1	10
Vinyl Chloride	<1	<1	1	10
Zinc	<5.00	<5.00	1	5

(*1) Determined by subtracting hexavalent Cr from total Cr.

(*2) Cyanide, amenable to chlorination or weak-acid dissociable.

(*3) The sum of seven PCB congeners 1242, 1254, 1221, 1232, 1248, 1260, and 1016.

Section 2. Priority Pollutants

For pollutants identified in Tables 4.0(2)A-E, indicate type of sample.

Grab Composite

Date and time sample(s) collected: 06/27/2024 08:10

Table 4.0(2)A – Metals, Cyanide, and Phenols

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Antimony	<5.00	<5.00	1	5
Arsenic	2.97	2.97	1	0.5
Beryllium	<0.500	<0.500	1	0.5
Cadmium	<1.00	<1.00	1	1
Chromium (Total)	<3.00	<3.00	1	3
Chromium (Hex)	4.44	4.44	1	3
Chromium (Tri) (*1)	<3	<3	1	N/A
Copper	<2.00	<2.00	1	2
Lead	<0.500	<0.500	1	0.5
Mercury	<0.005	<0.005	1	0.005
Nickel	2.83	2.83	1	2
Selenium	<5.00	<5.00	1	5
Silver	<0.500	<0.500	1	0.5
Thallium	<1.25	<1.25	1	0.5
Zinc	<5.00	<5.00	1	5
Cyanide (*2)	<10.0	<10.0	1	10
Phenols, Total	<10.0	<10.0	1	10

(*1) Determined by subtracting hexavalent Cr from total Cr.

(*2) Cyanide, amenable to chlorination or weak-acid dissociable

Table 4.0(2)B – Volatile Compounds

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Acrolein	<6.0	<6.0	1	50
Acrylonitrile	<9.2	<9.2	1	50
Benzene	<1	<1	1	10
Bromoform	<1	<1	1	10
Carbon Tetrachloride	<1	<1	1	2
Chlorobenzene	<1	<1	1	10
Chlorodibromomethane	1.7	1.7	1	10
Chloroethane	<1	<1	1	50
2-Chloroethylvinyl Ether	<6	<6	1	10
Chloroform	10.8	10.8	1	10
Dichlorobromomethane [Bromodichloromethane]	4.14	4.14	1	10
1,1-Dichloroethane	<1	<1	1	10
1,2-Dichloroethane	<1	<1	1	10
1,1-Dichloroethylene	<1	<1	1	10
1,2-Dichloropropane	<1	<1	1	10
1,3-Dichloropropylene [1,3-Dichloropropene]	<1	<1	1	10
1,2-Trans-Dichloroethylene	<1	<1	1	10
Ethylbenzene	3.12	3.12	1	10
Methyl Bromide				50
Methyl Chloride				50
Methylene Chloride	<1	<1	1	20
1,1,2,2-Tetrachloroethane	<1	<1	1	10
Tetrachloroethylene	<1	<1	1	10
Toluene	1.15	1.15	1	10
1,1,1-Trichloroethane	<1	<1	1	10
1,1,2-Trichloroethane	<1	<1	1	10
Trichloroethylene	<1	<1	1	10
Vinyl Chloride	<1	<1	1	10

Table 4.0(2)C – Acid Compounds

Pollutant	AVG Effluent Conc. ($\mu\text{g/l}$)	MAX Effluent Conc. ($\mu\text{g/l}$)	Number of Samples	MAL ($\mu\text{g/l}$)
2-Chlorophenol	<10	<10	1	10
2,4-Dichlorophenol	<10	<10	1	10
2,4-Dimethylphenol	<10	<10	1	10
4,6-Dinitro-o-Cresol				50
2,4-Dinitrophenol	<50	<50	1	50
2-Nitrophenol	<20	<20	1	20
4-Nitrophenol	<50	<50	1	50
P-Chloro-m-Cresol				10
Pentalchlorophenol	<5	<5	1	5
Phenol	<10	<10	1	10
2,4,6-Trichlorophenol	<10	<10	1	10

Table 4.0(2)D – Base/Neutral Compounds

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Acenaphthene	<10	<10	1	10
Acenaphthylene	<10	<10	1	10
Anthracene	<10	<10	1	10
Benzidine	<50	<50	1	50
Benzo(a)Anthracene	<5.0	<5.0	1	5
Benzo(a)Pyrene	<5.0	<5.0	1	5
3,4-Benzofluoranthene	<5.0	<5.0	1	10
Benzo(ghi)Perylene	<20	<20	1	20
Benzo(k)Fluoranthene	<5.00	<5.00	1	5
Bis(2-Chloroethoxy)Methane	<10	<10	1	10
Bis(2-Chloroethyl)Ether	<10	<10	1	10
Bis(2-Chloroisopropyl)Ether				10
Bis(2-Ethylhexyl)Phthalate	<10	<10	1	10
4-Bromophenyl Phenyl Ether	<10	<10	1	10
Butyl benzyl Phthalate	<10	<10	1	10
2-Chloronaphthalene	<10	<10	1	10
4-Chlorophenyl phenyl ether	<10	<10	1	10
Chrysene	<5.0	<5.0	1	5
Dibenzo(a,h)Anthracene	<5.0	<5.0	1	5
1,2-(o)Dichlorobenzene	<1.0	<1.0	1	10
1,3-(m)Dichlorobenzene	<1.0	<1.0	1	10
1,4-(p)Dichlorobenzene	<1.0	<1.0	1	10
3,3-Dichlorobenzidine	<5.0	<5.0	1	5
Diethyl Phthalate	<10	<10	1	10
Dimethyl Phthalate	<10	<10	1	10
Di-n-Butyl Phthalate	<10	<10	1	10
2,4-Dinitrotoluene	<10	<10	1	10
2,6-Dinitrotoluene	<10	<10	1	10
Di-n-Octyl Phthalate	<10	<10	1	10
1,2-Diphenylhydrazine (as Azo-benzene)	<20	<20	1	20
Fluoranthene	<10	<10	1	10

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Fluorene	<10	<10	1	10
Hexachlorobenzene	<5	<5	1	5
Hexachlorobutadiene	<10	<10	1	10
Hexachlorocyclo-pentadiene				10
Hexachloroethane	<20	<20	1	20
Indeno(1,2,3-cd)pyrene	<5	<5	1	5
Isophorone	<10	<10	1	10
Naphthalene	<10	<10	1	10
Nitrobenzene	<10	<10	1	10
N-Nitrosodimethylamine	<20	<20	1	50
N-Nitrosodi-n-Propylamine	<20	<20	1	20
N-Nitrosodiphenylamine	<20	<20	1	20
Phenanthrene	<10	<10	1	10
Pyrene	<10	<10	1	10
1,2,4-Trichlorobenzene	<10	<10	1	10

Table 4.0(2)E - Pesticides

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Aldrin	<0.004	<0.004	1	0.01
alpha-BHC (Hexachlorocyclohexane)	<0.003	<0.003	1	0.05
beta-BHC (Hexachlorocyclohexane)	<0.004	<0.004	1	0.05
gamma-BHC (Hexachlorocyclohexane)	<0.004	<0.004	1	0.05
delta-BHC (Hexachlorocyclohexane)	<0.006	<0.006	1	0.05
Chlordane	<0.10	<0.10	1	0.2
4,4-DDT	<0.004	<0.004	1	0.02
4,4-DDE	<0.009	<0.009	1	0.1
4,4,-DDD	<0.002	<0.002	1	0.1
Dieldrin	<0.002	<0.002	1	0.02
Endosulfan I (alpha)	<0.007	<0.007	1	0.01
Endosulfan II (beta)	<0.004	<0.004	1	0.02
Endosulfan Sulfate	<0.005	<0.005	1	0.1
Endrin	<0.004	<0.004	1	0.02
Endrin Aldehyde	<0.003	<0.003	1	0.1
Heptachlor	<0.004	<0.004	1	0.01
Heptachlor Epoxide	<0.004	<0.004	1	0.01
PCB-1242	<0.03	<0.03	1	0.2
PCB-1254	<0.03	<0.03	1	0.2
PCB-1221	<0.03	<0.03	1	0.2
PCB-1232	<0.03	<0.03	1	0.2
PCB-1248	<0.03	<0.03	1	0.2
PCB-1260	<0.03	<0.03	1	0.2
PCB-1016	<0.03	<0.03	1	0.2
Toxaphene	<0.10	<0.10	1	0.3

* For PCBS, if all are non-detects, enter the highest non-detect preceded by a "<".

Section 3. Dioxin/Furan Compounds

A. Indicate which of the following compounds from may be present in the influent from a contributing industrial user or significant industrial user. Check all that apply.

- 2,4,5-trichlorophenoxy acetic acid
Common Name 2,4,5-T, CASRN 93-76-5
- 2-(2,4,5-trichlorophenoxy) propanoic acid
Common Name Silvex or 2,4,5-TP, CASRN 93-72-1
- 2-(2,4,5-trichlorophenoxy) ethyl 2,2-dichloropropionate
Common Name Erbon, CASRN 136-25-4
- 0,0-dimethyl 0-(2,4,5-trichlorophenyl) phosphorothioate
Common Name Ronnel, CASRN 299-84-3
- 2,4,5-trichlorophenol
Common Name TCP, CASRN 95-95-4
- hexachlorophene
Common Name HCP, CASRN 70-30-4

For each compound identified, provide a brief description of the conditions of its/their presence at the facility.

N/A

B. Do you know or have any reason to believe that 2,3,7,8 Tetrachlorodibenzo-P-Dioxin (TCDD) or any congeners of TCDD may be present in your effluent?

- Yes No

If yes, provide a brief description of the conditions for its presence.

Click to enter text.

C. If any of the compounds in Subsection A or B are present, complete Table 4.0(2)F.

For pollutants identified in Table 4.0(2)F, indicate the type of sample.

Grab Composite

Date and time sample(s) collected: [Click to enter text.](#)

Table 4.0(2)F – Dioxin/Furan Compounds

Compound	Toxic Equivalency Factors	Wastewater Concentration (ppq)	Wastewater Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Equivalents (ppt)	MAL (ppq)
2,3,7,8 TCDD	1					10
1,2,3,7,8 PeCDD	0.5					50
2,3,7,8 HxCDDs	0.1					50
1,2,3,4,6,7,8 HpCDD	0.01					50
2,3,7,8 TCDF	0.1					10
1,2,3,7,8 PeCDF	0.05					50
2,3,4,7,8 PeCDF	0.5					50
2,3,7,8 HxCDFs	0.1					50
2,3,4,7,8 HpCDFs	0.01					50
OCDD	0.0003					100
OCDF	0.0003					100
PCB 77	0.0001					0.5
PCB 81	0.0003					0.5
PCB 126	0.1					0.5
PCB 169	0.03					0.5
Total						

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 5.0: TOXICITY TESTING REQUIREMENTS

The following **is required** for facilities with a current operating design flow of **1.0 MGD or greater**, with an EPA-approved **pretreatment** program (or those required to have one under 40 CFR Part 403), or are required to perform Whole Effluent Toxicity testing. See Page 86 of the instructions for further details.

This worksheet is not required minor amendments without renewal.

Section 1. Required Tests

Indicate the number of 7-day chronic or 48-hour acute Whole Effluent Toxicity (WET) tests performed in the four and one-half years prior to submission of the application.

7-day Chronic: 11

48-hour Acute: 8

Section 2. Toxicity Reduction Evaluations (TREs)

Has this facility completed a TRE in the past four and a half years? Or is the facility currently performing a TRE?

Yes No

If yes, describe the progress to date, if applicable, in identifying and confirming the toxicant.

Click to enter text.

Section 3. Summary of WET Tests

If the required biomonitoring test information has not been previously submitted via both the Discharge Monitoring Reports (DMRs) and the Table 1 (as found in the permit), provide a summary of the testing results for all valid and invalid tests performed over the past four and one-half years. Make additional copies of this table as needed.

Table 5.0(1) Summary of WET Tests

Test Date	Test Species	NOEC Survival	NOEC Sub-lethal
02/25/20	Mysidopsis Bahia	11%	11%
02/25/20	Menidia Beryllina	11%	11%
08/17/20	Mysidopsis Bahia	11%	11%
08/17/20	Menidia Beryllina	11%	11%
11/02/20	Mysidopsis Bahia	11%	11%
11/02/20	Menidia Beryllina	11%	11%
01/18/21	Mysidopsis Bahia	11%	11%
01/18/21	Menidia Beryllina	11%	11%
05/10/21	Mysidopsis Bahia	11%	11%
05/10/21	Menidia Beryllina	11%	11%
09/13/21	Mysidopsis Bahia	11%	11%
11/29/21	Mysidopsis Bahia	11%	11%
11/29/21	Menidia Beryllina	11%	11%
04/18/22	Mysidopsis Bahia	11%	11%
04/18/22	Menidia Beryllina	11%	11%
11/07/22	Mysidopsis Bahia	11%	11%
03/20/23	Mysidopsis Bahia	11%	11%
03/20/23	Menidia Beryllina	11%	11%
10/09/23	Mysidopsis Bahia	11%	11%
04/08/24	Mysidopsis Bahia	11%	11%
04/08/24	Menidia Beryllina	11%	11%

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 6.0: INDUSTRIAL WASTE CONTRIBUTION

The following is required for all publicly owned treatment works.

Section 1. All POTWs (Instructions Page 87)

A. Industrial users (IUs)

Provide the number of each of the following types of industrial users (IUs) that discharge to your POTW and the daily flows from each user. See the Instructions for definitions of Categorical IUs, Significant IUs - non-categorical, and Other IUs.

If there are no users, enter 0 (zero).

Categorical IUs:

Number of IUs: 1

Average Daily Flows, in MGD: 0.003

Significant IUs - non-categorical:

Number of IUs: 1

Average Daily Flows, in MGD: 0.04

Other IUs:

Number of IUs: [Click to enter text.](#)

Average Daily Flows, in MGD: [Click to enter text.](#)

B. Treatment plant interference

In the past three years, has your POTW experienced treatment plant interference (see instructions)?

Yes No

If yes, identify the dates, duration, description of interference, and probable cause(s) and possible source(s) of each interference event. Include the names of the IUs that may have caused the interference.

[Click to enter text.](#)

C. Treatment plant pass through

In the past three years, has your POTW experienced pass through (see instructions)?

- Yes No

If yes, identify the dates, duration, a description of the pollutants passing through the treatment plant, and probable cause(s) and possible source(s) of each pass through event. Include the names of the IUs that may have caused pass through.

Click to enter text.

D. Pretreatment program

Does your POTW have an approved pretreatment program?

- Yes No

If yes, complete Section 2 only of this Worksheet.

Is your POTW required to develop an approved pretreatment program?

- Yes No

If yes, complete Section 2.c. and 2.d. only, and skip Section 3.

If no to either question above, skip Section 2 and complete Section 3 for each significant industrial user and categorical industrial user.

Section 2. POTWs with Approved Programs or Those Required to Develop a Program (Instructions Page 87)

A. Substantial modifications

Have there been any **substantial modifications** to the approved pretreatment program that have not been submitted to the TCEQ for approval according to 40 CFR §403.18?

- Yes No

If yes, identify the modifications that have not been submitted to TCEQ, including the purpose of the modification.

Click to enter text.

B. Non-substantial modifications

Have there been any **non-substantial modifications** to the approved pretreatment program that have not been submitted to TCEQ for review and acceptance?

Yes No

If yes, identify all non-substantial modifications that have not been submitted to TCEQ, including the purpose of the modification.

Click to enter text.

C. Effluent parameters above the MAL

In Table 6.0(1), list all parameters measured above the MAL in the POTW's effluent monitoring during the last three years. Submit an attachment if necessary.

Table 6.0(1) – Parameters Above the MAL

Pollutant	Concentration	MAL	Units	Date
None				

D. Industrial user interruptions

Has any SIU, CIU, or other IU caused or contributed to any problems (excluding interferences or pass throughs) at your POTW in the past three years?

Yes No

If yes, identify the industry, describe each episode, including dates, duration, description of the problems, and probable pollutants.

Click to enter text.

Section 3. Significant Industrial User (SIU) Information and Categorical Industrial User (CIU) (Instructions Page 88)

A. General information

Company Name: [Click to enter text.](#)

SIC Code: [Click to enter text.](#)

Contact name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Telephone number: [Click to enter text.](#)

Email address: [Click to enter text.](#)

B. Process information

Describe the industrial processes or other activities that affect or contribute to the SIU(s) or CIU(s) discharge (i.e., process and non-process wastewater).

[Click to enter text.](#)

C. Product and service information

Provide a description of the principal product(s) or services performed.

[Click to enter text.](#)

D. Flow rate information

See the Instructions for definitions of “process” and “non-process wastewater.”

Process Wastewater:

Discharge, in gallons/day: [Click to enter text.](#)

Discharge Type: Continuous Batch Intermittent

Non-Process Wastewater:

Discharge, in gallons/day: [Click to enter text.](#)

Discharge Type: Continuous Batch Intermittent

E. Pretreatment standards

Is the SIU or CIU subject to technically based local limits as defined in the instructions?

- Yes No

Is the SIU or CIU subject to categorical pretreatment standards found in *40 CFR Parts 405-471*?

- Yes No

If **subject to categorical pretreatment standards**, indicate the applicable category and subcategory for each categorical process.

Category: Subcategories: [Click to enter text](#).

Click or tap here to enter text. [Click to enter text](#).

Category: [Click to enter text](#).

Subcategories: [Click to enter text](#).

Category: [Click to enter text](#).

Subcategories: [Click to enter text](#).

Category: [Click to enter text](#).

Subcategories: [Click to enter text](#).

Category: [Click to enter text](#).

Subcategories: [Click to enter text](#).

F. Industrial user interruptions

Has the SIU or CIU caused or contributed to any problems (e.g., interferences, pass through, odors, corrosion, blockages) at your POTW in the past three years?

- Yes No

If yes, identify the SIU, describe each episode, including dates, duration, description of problems, and probable pollutants.

[Click to enter text](#).

WORKSHEET 7.0

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

CLASS V INJECTION WELL INVENTORY/AUTHORIZATION FORM

Submit the completed form to:

TCEQ
IUC Permits Team
Radioactive Materials Division
MC-233
PO Box 13087
Austin, Texas 78711-3087
512-239-6466

For TCEQ Use Only
Reg. No._____
Date Received_____
Date Authorized_____

Section 1. General Information (Instructions Page 90)

1. TCEQ Program Area

Program Area (PST, VCP, IHW, etc.): [Click to enter text.](#)

Program ID: [Click to enter text.](#)

Contact Name: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

2. Agent/Consultant Contact Information

Contact Name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

3. Owner/Operator Contact Information

Owner Operator

Owner/Operator Name: [Click to enter text.](#)

Contact Name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

4. Facility Contact Information

Facility Name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Location description (if no address is available): [Click to enter text.](#)

Facility Contact Person: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

5. Latitude and Longitude, in degrees-minutes-seconds

Latitude: [Click to enter text.](#)

Longitude: [Click to enter text.](#)

Method of determination (GPS, TOPO, etc.): [Click to enter text.](#)

Attach topographic quadrangle map as attachment A.

6. Well Information

Type of Well Construction, select one:

- Vertical Injection
- Subsurface Fluid Distribution System
- Infiltration Gallery
- Temporary Injection Points
- Other, Specify: [Click to enter text.](#)

Number of Injection Wells: [Click to enter text.](#)

7. Purpose

Detailed Description regarding purpose of Injection System:

[Click to enter text.](#)

Attach a Site Map as Attachment B (Attach the Approved Remediation Plan, if appropriate.)

8. Water Well Driller/Installer

Water Well Driller/Installer Name: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

License Number: [Click to enter text.](#)

Section 2. Proposed Down Hole Design

Attach a diagram signed and sealed by a licensed engineer as Attachment C.

Table 7.0(1) – Down Hole Design Table

Name of String	Size	Setting Depth	Sacks Cement/Grout - Slurry Volume - Top of Cement	Hole Size	Weight (lbs/ft) PVC/Steel
Casing					
Tubing					
Screen					

Section 3. Proposed Trench System, Subsurface Fluid Distribution System, or Infiltration Gallery

Attach a diagram signed and sealed by a licensed engineer as Attachment D.

System(s) Dimensions: [Click to enter text](#).

System(s) Construction: [Click to enter text](#).

Section 4. Site Hydrogeological and Injection Zone Data

1. Name of Contaminated Aquifer: [Click to enter text](#).
2. Receiving Formation Name of Injection Zone: [Click to enter text](#).
3. Well/Trench Total Depth: [Click to enter text](#).
4. Surface Elevation: [Click to enter text](#).
5. Depth to Ground Water: [Click to enter text](#).
6. Injection Zone Depth: [Click to enter text](#).
7. Injection Zone vertically isolated geologically? Yes No

Impervious Strata between Injection Zone and nearest Underground Source of Drinking Water:

Name: [Click to enter text](#).

Thickness: [Click to enter text](#).

8. Provide a list of contaminants and the levels (ppm) in contaminated aquifer
Attach as Attachment E.
9. Horizontal and Vertical extent of contamination and injection plume
Attach as Attachment F.
10. Formation (Injection Zone) Water Chemistry (Background levels) TDS, etc.
Attach as Attachment G.
11. Injection Fluid Chemistry in PPM at point of injection
Attach as Attachment H.
12. Lowest Known Depth of Ground Water with < 10,000 PPM TDS: [Click to enter text](#).
13. Maximum injection Rate/Volume/Pressure: [Click to enter text](#).
14. Water wells within 1/4 mile radius (attach map as Attachment I): [Click to enter text](#).
15. Injection wells within 1/4 mile radius (attach map as Attachment J): [Click to enter text](#).
16. Monitor wells within 1/4 mile radius (attach drillers logs and map as Attachment K): [Click to enter text](#).
17. Sampling frequency: [Click to enter text](#).
18. Known hazardous components in injection fluid: [Click to enter text](#).

Section 5. Site History

1. Type of Facility: [Click to enter text.](#)
2. Contamination Dates: [Click to enter text.](#)
3. Original Contamination (VOCs, TPH, BTEX, etc.) and Concentrations (attach as Attachment L): [Click to enter text.](#)
4. Previous Remediation (attach results of any previous remediation as attachment M): [Click to enter text.](#)

NOTE: Authorization Form should be completed in detail and authorization given by the TCEQ before construction, operation, and/or conversion can begin. Attach additional pages as necessary.

Class V Injection Well Designations

- 5A07 Heat Pump/AC return (IW used for groundwater to heat and/or cool buildings)
- 5A19 Industrial Cooling Water Return Flow (IW used to cool industrial process equipment)
- 5B22 Salt Water Intrusion Barrier (IW used to inject fluids to prevent the intrusion of salt water into an aquifer)
- 5D02 Storm Water Drainage (IW designed for the disposal of rain water)
- 5D04 Industrial Stormwater Drainage Wells (IW designed for the disposal of rain water associated with industrial facilities)
- 5F01 Agricultural Drainage (IW that receive agricultural runoff)
- 5R21 Aquifer Recharge (IW used to inject fluids to recharge an aquifer)
- 5S23 Subsidence Control Wells (IW used to control land subsidence caused by ground water withdrawal)
- 5W09 Untreated Sewage
- 5W10 Large Capacity Cesspools (Cesspools that are designed for 5,000 gpd or greater)
- 5W11 Large Capacity Septic systems (Septic systems designed for 5,000 gpd or greater)
- 5W12 WTTP disposal
- 5W20 Industrial Process Waste Disposal Wells
- 5W31 Septic System (Well Disposal method)
- 5W32 Septic System Drainfield Disposal
- 5X13 Mine Backfill (IW used to control subsidence, dispose of mining byproducts, and/or fill sections of a mine)
- 5X25 Experimental Wells (Pilot Test) (IW used to test new technologies or tracer dye studies)
- 5X26 Aquifer Remediation (IW used to clean up, treat, or prevent contamination of a USDW)
- 5X27 Other Wells
- 5X28 Motor Vehicle Waste Disposal Wells (IW used to dispose of waste from a motor vehicle site - These are currently banned)
- 5X29 Abandoned Drinking Water Wells (waste disposal)

Attachment 1

Payment

Voucher

Your transaction is complete. Thank you for using TCEQ ePay.

Note: It may take up to 3 working days for this electronic payment to be processed and be reflected in the TCEQ ePay system. Print this receipt and the vouchers for your records. An email receipt has also been sent.

Transaction Information

Trace Number: 582EA000660856

Date: 03/25/2025 01:29 PM

Payment Method: CC - Authorization 0000086142

ePay Actor: JERRY MEEKS JR

Actor Email: jerry.meeks2@veolia.com

IP: 165.225.216.166

TCEQ Amount: \$2,015.00

Texas.gov Price: \$2,060.59*

* This service is provided by Texas.gov, the official website of Texas. The price of this service includes funds that support the ongoing operations and enhancements of Texas.gov, which is provided by a third party in partnership with the State.

Payment Contact Information

Name: JERRY MEEKS JR

Company: VEOLIA

Address: PO BOX 3201, FREEPORT, TX 77542

Phone: 979-233-4281

Cart Items

Click on the voucher number to see the voucher details.

Voucher	Fee Description	AR Number	Amount
759114	WW PERMIT - FACILITY WITH FLOW >= 1.0 MGD - RENEWAL		\$2,000.00
759115	30 TAC 305.53B WQ RENEWAL NOTIFICATION FEE		\$15.00
TCEQ Amount:			\$2,015.00

[ePay Again](#) [Exit ePay](#)

Note: It may take up to 3 working days for this electronic payment to be processed and be reflected in the TCEQ ePay system. Print this receipt for your records.

Attachment 2

Core Data Form



TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

SECTION I: General Information

1. Reason for Submission (<i>If other is checked please describe in space provided.</i>)		
<input type="checkbox"/> New Permit, Registration or Authorization (<i>Core Data Form should be submitted with the program application.</i>)		
<input checked="" type="checkbox"/> Renewal (<i>Core Data Form should be submitted with the renewal form</i>)		
2. Customer Reference Number (<i>if issued</i>) CN 600641799		Follow this link to search for CN or RN numbers in Central Registry**
3. Regulated Entity Reference Number (<i>if issued</i>) RN 102184025		

SECTION II: Customer Information

4. General Customer Information		5. Effective Date for Customer Information Updates (mm/dd/yyyy)	2/21/2025					
<input type="checkbox"/> New Customer <input checked="" type="checkbox"/> Update to Customer Information <input type="checkbox"/> Change in Regulated Entity Ownership <input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)								
<i>The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).</i>								
6. Customer Legal Name (<i>If an individual, print last name first: eg: Doe, John</i>)			<i>If new Customer, enter previous Customer below:</i>					
City of Freeport								
7. TX SOS/CPA Filing Number		8. TX State Tax ID (11 digits)	9. Federal Tax ID (9 digits)					
11. Type of Customer:		<input type="checkbox"/> Corporation <input type="checkbox"/> Individual	Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited					
Government: <input checked="" type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> Local <input type="checkbox"/> State <input type="checkbox"/> Other		<input type="checkbox"/> Sole Proprietorship	<input type="checkbox"/> Other:					
12. Number of Employees			13. Independently Owned and Operated?					
<input type="checkbox"/> 0-20 <input checked="" type="checkbox"/> 21-100 <input type="checkbox"/> 101-250 <input type="checkbox"/> 251-500 <input type="checkbox"/> 501 and higher			<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No					
14. Customer Role (Proposed or Actual) – as it relates to the Regulated Entity listed on this form. Please check one of the following								
<input checked="" type="checkbox"/> Owner <input type="checkbox"/> Operator <input type="checkbox"/> Owner & Operator <input type="checkbox"/> Occupational Licensee <input type="checkbox"/> Responsible Party <input type="checkbox"/> VCP/BSA Applicant			<input type="checkbox"/> Other:					
15. Mailing Address:	1201 N. Ave. H							
	City	Freeport	State	TX	ZIP	77541	ZIP + 4	
16. Country Mailing Information (<i>if outside USA</i>)			17. E-Mail Address (<i>if applicable</i>)					
			LPetty@Freeport.TX.US					
18. Telephone Number		19. Extension or Code			20. Fax Number (<i>if applicable</i>)			

SECTION III: Regulated Entity Information

21. General Regulated Entity Information (*If "New Regulated Entity" is selected, a new permit application is also required.*)

New Regulated Entity Update to Regulated Entity Name Update to Regulated Entity Information

The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).

22. Regulated Entity Name (*Enter name of the site where the regulated action is taking place.*)

Central WWTP

23. Street Address of the Regulated Entity: <u>(No PO Boxes)</u>	931 E. Floodgate Rd						
	City	Freeport	State	TX	ZIP	77541	ZIP + 4
24. County	Brazoria						

If no Street Address is provided, fields 25-28 are required.

25. Description to Physical Location:							
--	--	--	--	--	--	--	--

26. Nearest City	State	Nearest ZIP Code

Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).

27. Latitude (N) In Decimal:				28. Longitude (W) In Decimal:			
Degrees	Minutes	Seconds		Degrees	Minutes	Seconds	

29. Primary SIC Code (4 digits)	30. Secondary SIC Code (4 digits)	31. Primary NAICS Code (5 or 6 digits)	32. Secondary NAICS Code (5 or 6 digits)
4952		221320	

33. What is the Primary Business of this entity? (*Do not repeat the SIC or NAICS description.*)

Domestic wastewater facility.

34. Mailing Address:	1201 N. Ave. H						
	City	Freeport	State	TX	ZIP	77541	ZIP + 4

35. E-Mail Address:	Jerry.Meeks2@Veolia.com						
----------------------------	-------------------------	--	--	--	--	--	--

36. Telephone Number	37. Extension or Code	38. Fax Number (if applicable)
(979) 233-4281		(979) 233-5833

39. TCEQ Programs and ID Numbers Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.

<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input type="checkbox"/> Edwards Aquifer	<input type="checkbox"/> Emissions Inventory Air	<input type="checkbox"/> Industrial Hazardous Waste
<input type="checkbox"/> Municipal Solid Waste	<input type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
<input type="checkbox"/> Sludge	<input type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
<input type="checkbox"/> Voluntary Cleanup	<input checked="" type="checkbox"/> Wastewater	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:
	WQ0010882001			

SECTION IV: Preparer Information

40. Name:	Jerry Meeks, Jr.		41. Title:	Lead Operator
42. Telephone Number	43. Ext./Code	44. Fax Number	45. E-Mail Address	
(979) 233-4281		(979) 233-5833	Jerry.Meeks2@Veolia.com	

SECTION V: Authorized Signature

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

Company:	Veolia	Job Title:	Lead Operator	
Name (In Print):	Jerry Meeks, Jr.		Phone:	(979) 233-4281
Signature:			Date:	2/21/2025

Attachment 3

SPIF

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)

FOR AGENCIES REVIEWING DOMESTIC OR INDUSTRIAL
TPDES WASTEWATER PERMIT APPLICATIONS

TCEQ USE ONLY:

Application type: Renewal Major Amendment Minor Amendment New

County: _____ Segment Number: _____

Admin Complete Date: _____

Agency Receiving SPIF:

Texas Historical Commission U.S. Fish and Wildlife

Texas Parks and Wildlife Department U.S. Army Corps of Engineers

This form applies to TPDES permit applications only. (Instructions, Page 53)

Complete this form as a separate document. TCEQ will mail a copy to each agency as required by our agreement with EPA. If any of the items are not completely addressed or further information is needed, we will contact you to provide the information before issuing the permit. Address each item completely.

Do not refer to your response to any item in the permit application form. Provide each attachment for this form separately from the Administrative Report of the application. The application will not be declared administratively complete without this SPIF form being completed in its entirety including all attachments. Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at WQ-ARPTeam@tceq.texas.gov or by phone at (512) 239-4671.

The following applies to all applications:

1. Permittee: City of Freeport

Permit No. WQ00 10882001

EPA ID No. TX 0033332

Address of the project (or a location description that includes street/highway, city/vicinity, and county):

931 E. Floodgate Rd. Freeport, TX. 77541

Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.

Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Lance Petty

Credential (P.E, P.G., Ph.D., etc.): 

Title: City Manager

Mailing Address: 1201 N. Ave. H

City, State, Zip Code: Freeport, TX. 77541

Phone No.: 979-233-3526 Ext.:  Fax No.: 979-373-0113


E-mail Address: LPetty@Freeport.tx.us

2. List the county in which the facility is located: Brazoria
3. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.



4. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the classified segment number.

Effluent is discharged into the Brazos River (segment number 1201).



5. Please provide a separate 7.5-minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required in addition to the map in the administrative report).

Provide original photographs of any structures 50 years or older on the property.


Does your project involve any of the following? Check all that apply.

- Proposed access roads, utility lines, construction easements
- Visual effects that could damage or detract from a historic property's integrity
- Vibration effects during construction or as a result of project design
- Additional phases of development that are planned for the future
- Sealing caves, fractures, sinkholes, other karst features

- Disturbance of vegetation or wetlands
1. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features):
Site already in operation.

2. Describe existing disturbances, vegetation, and land use:
N/A

THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

3. List construction dates of all buildings and structures on the property:


4. Provide a brief history of the property, and name of the architect/builder, if known.


Attachment 4

Plain Language Summary



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SUMMARY OF APPLICATION IN PLAIN LANGUAGE FOR TPDES OR TLAP PERMIT APPLICATIONS

Summary of Application (in plain language) Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary of your facility and application as required by Title 30, Texas Administrative Code (30 TAC), Chapter 39, Subchapter H. You may modify the template as necessary to accurately describe your facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how you will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements. After filling in the information for your facility delete these instructions.

If you are subject to the alternative language notice requirements in 30 TAC Section 39.426, **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package.** For your convenience, a Spanish template has been provided below.

ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS DOMESTIC WASTEWATER/STORMWATER

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.

The City of Freeport (CN600641799) operates the City of Freeport Wastewater Treatment Plant (RN102184025), a domestic wastewater treatment facility. The facility is located at 931 E. Floodgate Rd., in Freeport, Brazoria County, Texas 77541. The City of Freeport is requesting a renewal of the wastewater permit to discharge treated domestic wastewater to the Brazos River. When needed, there is also an option to discharge to the impounded wetlands.

Discharges from the facility are expected to contain total suspended solids and BOD. Domestic wastewater is treated by chlorine gas.

PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

AGUAS RESIDUALES DOMESTICAS /AGUAS PLUVIALES

El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.

La ciudad de Freeport (CN600641799) opera la Planta de Tratamiento de Aguas Residuales de la Ciudad de Freeport (RN102184025), una instalación de tratamiento de aguas residuales domésticas. La instalación está ubicada en 931 E. Floodgate Rd., en Freeport, Condado de Brazoria, Texas 77541. La ciudad de Freeport está solicitando una renovación del permiso de aguas residuales para descargar aguas residuales domésticas tratadas en el río Brazos. Cuando sea necesario, también existe la opción de descargar en los humedales incautados.

Se espera que las descargas de la instalación contengan sólidos suspendidos totales y DBO. Las aguas residuales domésticas se tratan con cloro gaseoso.

Attachment 5

USGS Map

Attachment 6

Treatment

Process Flow

The plant headworks has a Heli-sieve for removal of screenings, plastics and some grit ahead of the secondary treatment process. Downstream of the screen, a flow distribution box allows the flow to be split to either the package activated sludge plant or to the trickling filter plant. The distribution box contains two rectangular weirs of unequal length set at the same elevation. Weir lengths have been fabricated such that approximately 70 percent of the influent flow is routed to the activated sludge plant and 30 percent is routed to the trickling filter plant. Screenings from the Heli-sieve is collected, conveyed and dewatered in a screw conveyor, then dumped in a dumpster for removal.

Approximately 70 percent of all flows are directed to the activated sludge plant. The plant is configured with two aeration cells and two chlorination contact chambers in the outer annulus (126 feet diameter), surrounding an inner clarifier (80 feet diameter). The plant operates as a conventional activated sludge plant with a capacity of 3.2 MGD. Sludge settled in the clarifier is returned to the aeration zones by air lift pumping. Waste sludge flows by gravity to the digester. Returned activated sludge and waste activated sludge flow are metered using magnetic flow meters.

Aeration and mixing of the aeration basin is achieved by a fine bubble diffused air system. Three positive displacement blowers are mounted at grade level next to the influent screening structure. These blowers provide all of the air for aeration and air lift pumps for the return activated sludge (RAS).


Flow from the package plant's clarifier section enter into the inlet well of the chlorine contact tank by gravity, and the trickling filter plant effluent is pumped to the chlorine chamber. Chlorine gas is injected at the inlet well with a submersible vacuum induction feeder mixer. Two symmetrical contact chambers provide a minimum contact time of 20 minutes at the peak two-hour flows of 8 MGD.

From the effluent well of the chlorine contact tank, the effluent flows by gravity via a 20 inch pipe to the effluent chamber where the flow is measured with the existing ultrasonic level transmitter and V-notch weir. A permanent sampling point for chlorine residual is located in the manhole just before the dechlorination point in front of the effluent chamber.

Attachment 7

Flow Diagram

City of Freeport Process Flow Diagram

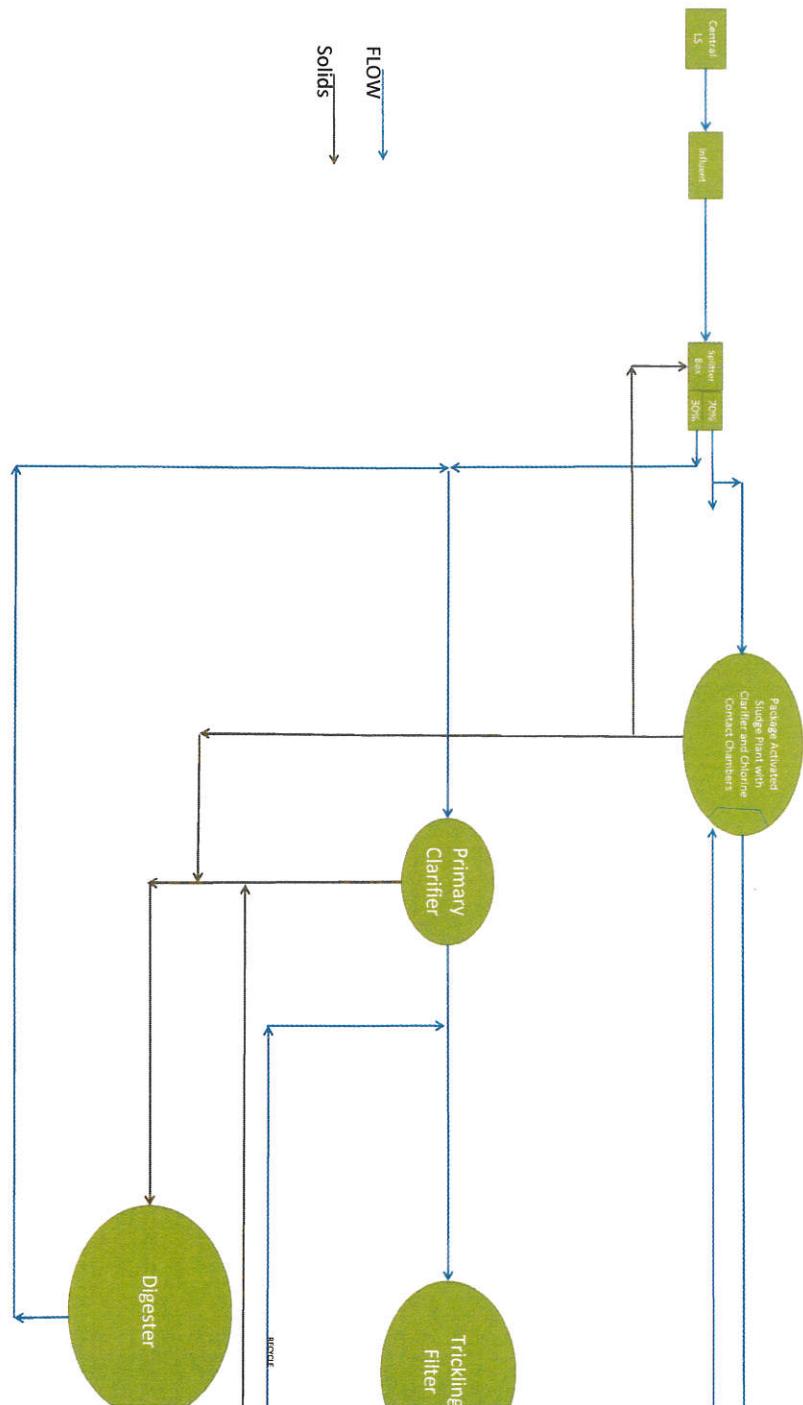

Attachment 8

Site Drawings

Service Area of Freeport WWTP

Google Earth

Image © 2025 Airbus

Data SIO, NOAA, U.S. Navy, NGA, GECO.



Impounded Wetlands

Google Earth



80

-DECHLORINATOR TANK

FENCE

PVC Pipeline
cks Required
s. See Sheet
- For Details.

LEVEE 1 - UNIT 1
STA. 0+00


WATER TROUGH
ALFALFA VALVE

LEVEE 2 - UNIT 1
STA. 0+00


Brazos River Harbor Navigation District

-OUGH #2

BURMS

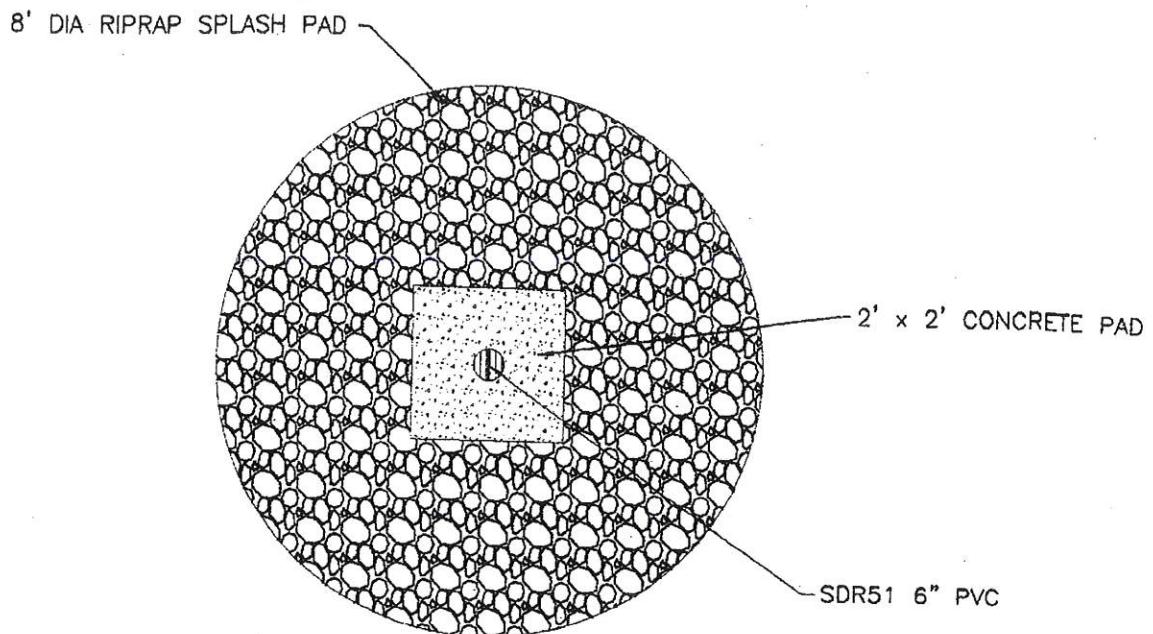

SPLASH PAD DETAIL FOR ALFALFA VALVE
NOT TO SCALE
TOP VIEW

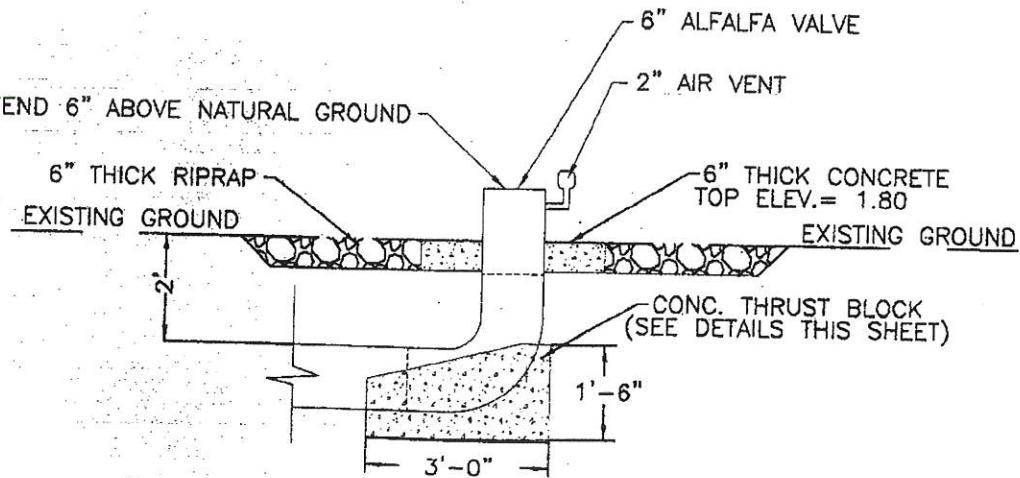

SPLASH PAD DETAIL FOR ALFALFA VALVE
FRONT VIEW
NTS

**VAL
COI

EXISTING GROUND

EXISTING GROUND(ELEV.=6.5)

Attachment 9

Annual

Cropping Plan

Cropping Plan for City of Freeport Discharge 002 to Impounded Wetlands

Soil Map

Please refer to the attached soil map for the soil in the impounded wetlands of the City of Freeport.

Crops and Acreage

Various wild vegetation could be irrigated with the discharge from the City of Freeport's WWTP.

Growing Seasons

There is not a growing season for the vegetation within the wetlands.

Nutrient Requirements

The wetlands are only irrigated with the effluent from the WWTP as needed. There has never been a need to discharge to the wetlands.

Supplemental Watering Requirements

If the need to supplement due to drought or other reasons, then the WWTP has the ability. There has never been a need to supplement since there has been the ability too.

Crop Harvesting

There is no crop harvesting in the wetlands.

Attachment 10

Well Data

GWDB Reports and Downloads		Well Basic Details		Scanned Documents
State Well Number	8106402	Well Type	Withdrawal of Water	
County	Brazoria	Well Use	Plugged or Destroyed	
River Basin	San Jacinto-Brazos	Water Level Observation	Miscellaneous Measurements	
Groundwater Management Area	14	Water Quality Available	Yes	
Regional Water Planning Area	H - Region H	Pump	None	
Groundwater Conservation District	Brazoria County GCD	Pump Depth (feet below land surface)		
Latitude (decimal degrees)	28.947222	Power Type		
Latitude (degrees minutes seconds)	28° 56' 50" N	Annular Seal Method		
Longitude (decimal degrees)	-95.371389	Surface Completion		
Longitude (degrees minutes seconds)	095° 22' 17" W	Owner	City of Freeport Well #9	
Coordinate Source	Global Positioning System - GPS	Driller	Layne Texas	
Aquifer Code	112CHCTU - Chicot Aquifer, Upper	Other Data Available		
Aquifer	Gulf Coast	Well Report Tracking Number		
Aquifer Pick Method		Plugging Report Tracking Number		
Land Surface Elevation (feet above sea level)	5	U.S. Geological Survey Site Number		
Land Surface Elevation Method	Digital Elevation Model -DEM	Texas Commission on Environmental Quality Source Id	G0200005D	
Well Depth (feet below land surface)	249	Groundwater Conservation District Well Number		
Well Depth Source	Another Government Agency	Owner Well Number	9	
Drilling Start Date		Other Well Number		
Drilling End Date	3/0/1953	Previous State Well Number		
Drilling Method		Reporting Agency	Texas Water Development Board	
Borehole Completion		Created Date	3/26/1992	
		Last Update Date	12/15/2009	

Remarks Owners well #9. TCEQ ID #0200005D. Plugged PS well.

Casing - No Data

Well Tests - No Data

Lithology - No Data

Annular Seal Range - No Data

Borehole - No Data


Plugged Back - No Data

Filter Pack - No Data

Packers - No Data

Water Level Measurements

Measurement Year (with decimal months)

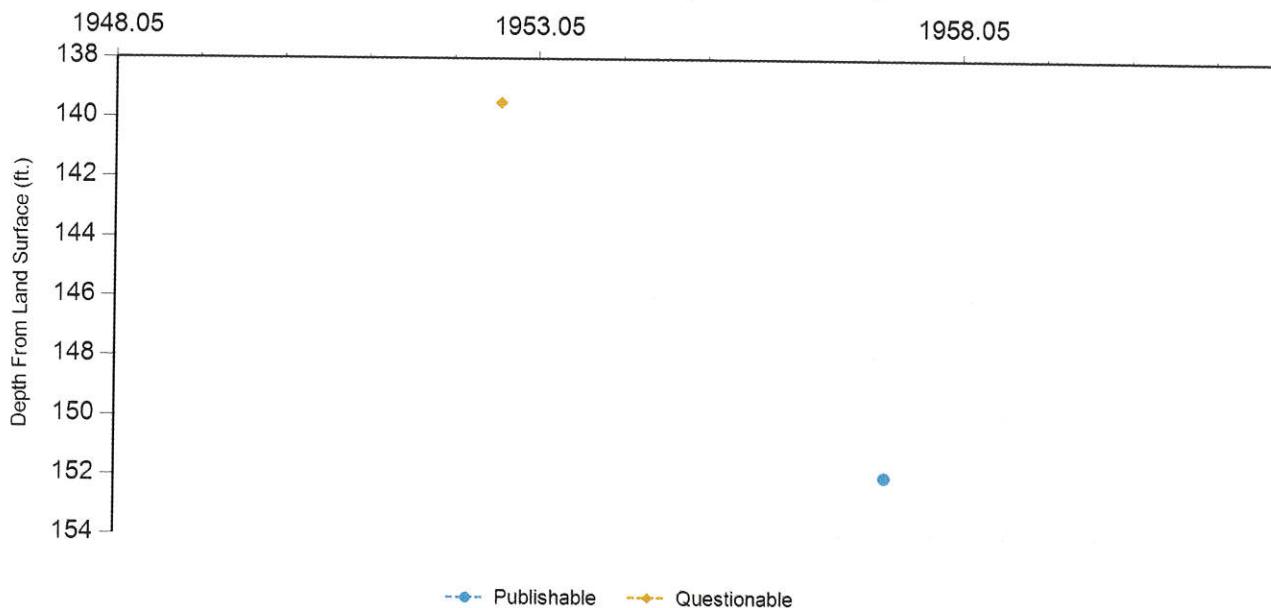

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
Q	8/11/1952		139.5		-134.5	1	Texas Water Development Board	Steel Tape	17	
P	1/0/1957		152	12.50	-147	1	Texas Water Development Board	Steel Tape		

Code Descriptions

Status Code	Status Description	Remark ID	Remark Description
P	Publishable	17	Measurement before well completion
Q	Questionable		

Water Quality Analysis

Sample Date: 3/24/1959 Sample Time: 0000 Sample Number: 1 Collection Entity:

Sampled Aquifer: Chicot Aquifer, Upper

Analyzed Lab:

Reliability: From a report; unknown sample collection & preservation

Collection Remarks: No Data

Parameter Code	Parameter Description	Flag	Value*	Units	Plus/Minus
00415	ALKALINITY, PHENOLPHTHALEIN (MG/L)		0	mg/L	
00410	ALKALINITY, TOTAL (MG/L AS CACO ₃)		468.03	mg/L as CACO 3	
00440	BICARBONATE ION, CALCULATED (MG/L AS HCO ₃)		571.16	mg/L	
00910	CALCIUM (MG/L)		23	mg/L	
00445	CARBONATE ION, CALCULATED (MG/L AS CO ₃)		0	mg/L	
00940	CHLORIDE, TOTAL (MG/L AS CL)		168	mg/L	
00900	HARDNESS, TOTAL, CALCULATED (MG/L AS CACO ₃)		119	mg/L as CACO 3	
01045	IRON, TOTAL (UG/L AS FE)		400	ug/L	
00920	MAGNESIUM (MG/L)		15	mg/L	
00400	PH (STANDARD UNITS), FIELD		7.7	SU	
71860	RESIDUAL SODIUM CARBONATE, CALCULATED		6.98		
00955	SILICA, DISSOLVED (MG/L AS SI ₀₂)		16	mg/L as SI ₀₂	
00931	SODIUM ADSORPTION RATIO, CALCULATED (SAR)		12.04		
00932	SODIUM, CALCULATED, PERCENT		84	PCT	
00929	SODIUM, TOTAL (MG/L AS NA)	calculated	302	mg/L	
00945	SULFATE, TOTAL (MG/L AS SO ₄)		2	mg/L as SO ₄	
70301	TOTAL DISSOLVED SOLIDS , SUM OF CONSTITUENTS (MG/L)		806	mg/L	

* Value may not display all significant digits for parameter in results, check Scanned Documents for laboratory paperwork..


GWDB DISCLAIMER: Except where noted, all of the information provided in the Texas Water Development Board (TWDB) Groundwater Database (<https://www.twdb.texas.gov/groundwater/data/gwdb rpt.asp>) is believed to be accurate and reliable; however, the TWDB assumes no responsibility for any errors appearing in rules or otherwise. Further, TWDB assumes no responsibility for the use of the information provided. PLEASE NOTE that users of these data are responsible for checking the accuracy, completeness, currency and/or suitability of all information themselves. TWDB makes no guarantees or warranties as to the accuracy, completeness, currency, or suitability of the information provided via the Groundwater Database (GWDB). TWDB specifically disclaims any and all liability for any claims or damages that may result from providing GWDB data or the information it contains. For additional information or answers to questions concerning the TWDB GWDB, contact the Groundwater Data Team at GroundwaterData@twdb.texas.gov.

Well No. BH 81-06-402

Latitude-longitude

HYDROGEOLOGIC CARD

SAME AS ON MASTER CARD	Physiographic Province:	03	Section:
<input checked="" type="checkbox"/> Drainage Basin:	512B	Subbasin:	
(D) depression, stream channel, dunes, flat, hilltop, sink, swamp, well site: (E) (F) (H) (I) (K) (L) offshore, pediment, hillside, terrace, undulating, valley flat			
MAJOR AQUIFER:	QIG	CU	
Lithology:	Origin:	Aquifer	Thickness:
Length of well open to:	30 ft	Depth to top of:	209 ft
MINOR AQUIFER:	44 45	46 47	
Lithology:	Origin:	Aquifer	Thickness:
Length of well open to:	ft	Depth to top of:	ft
Intervals Screened:	209 - 239		
Depth to consolidated rock:	ft	Source of data:	68
Depth to basement:	ft	Source of data:	69
Surficial material:	65 66 67 68 69 70 71	Infiltration characteristics:	72
Coefficient Trans:	spd/ft	Coefficient Storage:	76 77
Coefficient Perme:	gpd/ft ² ; Spec cap:	ppm/ft; Number of geologic cards:	78



Well No.

BH 81-06-402

State: **Texas** **4** **9**
Local Well No. **B-14** **S1-06.402** LocationCounty: **BRAZORIA** **B-14** Well No. **1**Latitude: **29° 57' N**
11Longitude: **95° 21' W**
18Seq. No. **1** Date **13-24-59**
25Sampling Depth **26** **19** Type **30**Owner: **None**

Sampled after pumping

Date drilled: **24-9'** **NW**
GPM Pct. of coll.Depth: **24-9'** **NW**

Prod. intervals

KEY PUNCHED

Collector

Water level

K x 10⁶ **R KCl** R sample **31** **33**mg/l **15.71** me/l **62**

B A mg/mg

36 32

mg/mg

mg/mg

mg/mg

Dissolved solids: **7.71** Temperature °C **39** **41**mg/l **17.17** me/l **66** **67**Al **10.41** Fe **4.9** Mn **4.6**

50 52 53 54 55 57

mg/l Ca + Mg **63** mg/l Alk **64**me/l NCH **70** NCH **73**mg/l NCH **74** mg/l NCH **77**SO₄ **Blk** Std Sampleml **1.2** **72**Cu **1.68** Pb **4.3** Zn **4.6**

50 52 53 54 55 57

mg/l Ca + Mg **63** mg/l Alk **64**me/l NCH **70** NCH **73**mg/l NCH **74** mg/l NCH **77**Al **0.0250 mg** **.00625 mg** **.0125 mg** **.025 mg**Sample **ml** **mg/l**mg/l **1.68** **72**mg/l **1.68** **72**mg/l **1.68** **72**mg/l **1.68** **72**mg/l **1.68** **72**Fe **A** **0.025 mg** **.01 mg** **.01 mg** **.01 mg**Sample Diss. **mg/l**mg/l **1.68** **72**mg/l **1.68** **72**mg/l **1.68** **72**mg/l **1.68** **72**mg/l **1.68** **72**F **19** **6** Card No. **80** **9**Source **ml**A sample **2.00 mg/l**A sample **2.00 mg/l**Color **78** **79** **1**Card No. **80**Color **78** **79** **1**NO₃ **A** **sample** **ml std** **ml** **mg/l**A sample **2.00 mg/l**A sample **2.00 mg/l**Color **78** **79** **1**Card No. **80**Color **78** **79** **1**Color **78** **79** **1**NO₂ **A** **0.01 mg** **.02 mg** **.05 mg**Sample **ml**mg/l **2.9** **32**mg/l **2.9** **32**mg/l **2.9** **32**mg/l **2.9** **32**mg/l **2.9** **32**Ca **12.9** **49**mg/l **12.9** **49**mg/l **12.9** **49**mg/l **12.9** **49**mg/l **12.9** **49**mg/l **12.9** **49**mg/l **12.9** **49**Mg **1.5** **53**mg/l **1.5** **53**mg/l **1.5** **53**mg/l **1.5** **53**mg/l **1.5** **53**mg/l **1.5** **53**mg/l **1.5** **53**Na **12.69** **58**mg/l **12.69** **58**mg/l **12.69** **58**mg/l **12.69** **58**mg/l **12.69** **58**mg/l **12.69** **58**mg/l **12.69** **58**K **1.69** **58**mg/l **1.69** **58**mg/l **1.69** **58**mg/l **1.69** **58**mg/l **1.69** **58**mg/l **1.69** **58**mg/l **1.69** **58**Total cations **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**Total anions **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**mg/l **12.69**

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31

32

33

34

35

36

37

38

39

40

41

42

43

44

45

46

47

48

49

50

51

52

53

54

55

56

57

58

59

60

61

62

63

64

65

66

67

68

69

70

71

72

73

74

75

76

77

78

79

80

81

82

83

84

85

86

87

88

89

90

91

92

93

94

95

96

97

98

99

100

101

102

103

104

105

106

107

108

109

110

111

112

113

114

115

116

117

118

119

120

121

122

123

124

125

126

127

128

129

130

131

132

133

134

135

136

137

138

139

140

141

142

143

144

145

146

147

148

149

150

151

152

153

154

155

156

157

158

159

160

161

162

163

164

165

166

167

168

169

170

171

172

173

174

175

176

177

178

179

180

STATE OF TEXAS PLUGGING REPORT for Tracking #83194

Owner:	Nat. Conv. Stroe Inc. #2597	Owner Well #:	MW-2
Address:	P.O. Box 696000 San Antonio, TX 78269	Grid #:	81-06-4
Well Location:	1922 West 4th Street Freeport, TX 77541	Latitude:	28° 57' 21" N
Well County:	Brazoria	Longitude:	095° 22' 25" W
Elevation:			No Data
Well Type:			Monitor

Drilling Information

Company: **No Data** Date Drilled: **No Data**
 Driller: **No Data** License Number: **No Data**

	<i>Diameter (in.)</i>	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>
Borehole:	4		25

Plugging Information

Date Plugged: **8/22/2012** Plugger: **William A. Clayton**
 Plug Method: **Pour in 3/8 bentonite chips when standing water in well is less than 100 feet depth, cement top 2 feet**

Casing Left in Well: Plug(s) Placed in Well:

<i>Dia (in.)</i>	<i>Top (ft.)</i>	<i>Bottom (ft.)</i>	<i>Top (ft.)</i>	<i>Bottom (ft.)</i>	<i>Description (number of sacks & material)</i>
4	0	25	0	3	0.40 Cement
			3	25	2.75 Bentonite

Certification Data: The driller certified that the driller plugged this well (or the well was plugged under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the reports(s) being returned for completion and resubmittal.

Company Information: **Vortex Drilling, Inc.**
4412 Bluemel Road
San Antonio, TX 78240

Driller Name: **William A. Clayton** License Number: **53420**

Comments: **Amended 9/17/12 Ref.# 10689**

Report Amended on by Request #10689

STATE OF TEXAS PLUGGING REPORT for Tracking #179308

Owner:	Phillips 66 Company	Owner Well #:	Freeport Termio
Address:	P.O. Box 866 Sweeny, TX 77480	Grid #:	81-05-6
Well Location:	523 Levee Rd. Freeport, TX 77541	Latitude:	28° 56' 47" N
Well County:	Brazoria	Longitude:	095° 22' 42" W
		Elevation:	No Data

Well Type: **Industrial**

Drilling Information

Company:	Goolsby WW	Date Drilled:	9/13/2011
Driller:	George R Goolsby	License Number:	1765

Well Report Tracking #267044

	<i>Diameter (in.)</i>	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>
Borehole:	7	0	265

Plugging Information

Date Plugged: **7/26/2018** Plugger:
Plug Method: **Tremmie pipe cement from bottom to top**
Variance Number: **049-18**

Casing Left in Well: Plug(s) Placed in Well:

<i>Dia (in.)</i>	<i>Top (ft.)</i>	<i>Bottom (ft.)</i>	<i>Top (ft.)</i>	<i>Bottom (ft.)</i>	<i>Description (number of sacks & material)</i>
4	2	265	0	120	Cement 5 Bags/Sacks

Certification Data: The driller certified that the driller plugged this well (or the well was plugged under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the report(s) being returned for completion and resubmittal.

Company Information: **Goolsby Water Well Service LLC**
20823 N. Hwy. 36
Brazoria, TX 77422

Driller Name: **RYAN GOOLSBY** License Number: **5002**

Comments: **VARIANCE NO. 049-18 PUMP STUCK IN CASING AT 120'**

STATE OF TEXAS WELL REPORT for Tracking #4320

Owner:	Royal Oil Company	Owner Well #:	No Data
Address:	500 N. Shoreline Suite 807 Corpus Christi, TX 78471	Grid #:	81-05-6
Well Location:	Bryan Mound Navigation District Freeport, TX 77541	Latitude:	28° 56' 35" N
Well County:	Brazoria	Longitude:	095° 23' 08" W
		Elevation:	No Data

This well has been plugged

Plugging Report Tracking #4865

Type of Work: New Well	Proposed Use: Industrial
------------------------	--------------------------

Drilling Start Date: **10/29/2001** Drilling End Date: **10/29/2001**

	Diameter (in.)	Top Depth (ft.)	Bottom Depth (ft.)
Borehole:	7	0	205

Drilling Method: **Mud (Hydraulic) Rotary**

Borehole Completion: **Straight Wall**

	Top Depth (ft.)	Bottom Depth (ft.)	Description (number of sacks & material)
Annular Seal Data:	0	10	5

Seal Method: **Poured**

Distance to Property Line (ft.): **No Data**

Sealed By: **Driller**

Distance to Septic Field or other
concentrated contamination (ft.): **n/a**

Distance to Septic Tank (ft.): **No Data**

Method of Verification: **no sewer present**

Surface Completion: **Alternative Procedure Used**

Water Level:	25 ft. below land surface on 2001-10-29	Measurement Method: Unknown
--------------	--	------------------------------------

Packers: **pvc wash valve 200**

Type of Pump: **Submersible** Pump Depth (ft.): **105**

Well Tests: **Jetted** Yield: **120 GPM**

	<i>Strata Depth (ft.)</i>	<i>Water Type</i>
Water Quality:	No Data	No Data
	Chemical Analysis Made: No	
	Did the driller knowingly penetrate any strata which contained injurious constituents?: No	

Certification Data: The driller certified that the driller drilled this well (or the well was drilled under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the report(s) being returned for completion and resubmittal.

Company Information: **Ronnie Goolsby Water Well**
103 Burnett
Brazoria, TX 77422

Driller Name: **G.R. Goolsby** License Number: **1765**

Comments: **No Data**

Lithology: DESCRIPTION & COLOR OF FORMATION MATERIAL		Casing: BLANK PIPE & WELL SCREEN DATA			
From (ft)	To (ft)	Description	Dia. (in.)	New/Used	Type
0-50	top soil and clay red and black		4	new	pvc well casing +2-190 sch 40
50-170	clay brown		4	new	pvc slot screen .006 190-200 sch 40
170-203	sand red		4	new	pvc tail pipe 200-205 sch 40
203-205	clay brown				
205	total depth				

IMPORTANT NOTICE FOR PERSONS HAVING WELLS DRILLED CONCERNING CONFIDENTIALITY

TEX. OCC. CODE Title 12, Chapter 1901.251, authorizes the owner (owner or the person for whom the well was drilled) to keep information in Well Reports confidential. The Department shall hold the contents of the well log confidential and not a matter of public record if it receives, by certified mail, a written request to do so from the owner.

Please include the report's Tracking Number on your written request.

Texas Department of Licensing and Regulation
P.O. Box 12157
Austin, TX 78711
(512) 334-5540

STATE OF TEXAS WELL REPORT for Tracking #227759

Owner:	Bank of Texas, Special Asset Group	Owner Well #:	MW-1		
Address:	8255 Walnut Hill Lane Dallas, TX 75231	Grid #:	81-05-6		
Well Location:	930 East Floodgate Road, Freeport, TX 77541	Latitude:	28° 56' 40" N		
Well County:	Brazoria	Longitude:	095° 22' 46" W		
Elevation:		No Data			
Type of Work:	New Well				
	Proposed Use: Monitor				

Drilling Start Date: **7/20/2010** Drilling End Date: **7/20/2010**

	<i>Diameter (in.)</i>	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>
Borehole:	8.75	0	35

Drilling Method: **Hollow Stem Auger**

Borehole Completion: **Filter Packed**

Filter Pack Intervals:	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>	<i>Filter Material</i>	<i>Size</i>
	18	35	Gravel	20/40

Annular Seal Data:	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>	<i>Description (number of sacks & material)</i>
	0	16	4, Portland
	16	18	1, Bentonite
	18	35	10, Sand

Seal Method: **Grout**

Distance to Property Line (ft.): **No Data**

Sealed By: **Advanced Drilling Systems, Inc.**

Distance to Septic Field or other concentrated contamination (ft.): **No Data**

Distance to Septic Tank (ft.): **No Data**

Method of Verification: **No Data**

Surface Completion: **Alternative Procedure Used**

Water Level: **No Data**

Packers: **No Data**

Type of Pump: **No Data**

Well Tests: **No Test Data Specified**

	<i>Strata Depth (ft.)</i>	<i>Water Type</i>
Water Quality:	No Data	No Data
		Chemical Analysis Made: No
	Did the driller knowingly penetrate any strata which contained injurious constituents?: No	

Certification Data: The driller certified that the driller drilled this well (or the well was drilled under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the report(s) being returned for completion and resubmittal.

Company Information: **Advanced Drilling Systems**

**904 W. Tiwell
Houston, TX 77091**

Driller Name: **M. Moya** License Number: **4990**

Comments: **No Data**

Lithology: DESCRIPTION & COLOR OF FORMATION MATERIAL	Casing: BLANK PIPE & WELL SCREEN DATA
<i>From (ft)</i> <i>To (ft)</i> <i>Description</i>	<i>Dia. (in.)</i> <i>New/Used</i> <i>Type</i> <i>Setting From/To (ft.)</i>
0-2: Miscellaneous gravel and shell mixture	2 New PVC Casing 0-20 sch-40
2-5: Yellowish red to dark reddish brown at 4-5, firm, dry, silty clay with miscellaneous gravel	2 New PVC Slotted 20-35 0.01
5-10: Reddish brown, soft, damp, silty clay with traces of chert gravel	
10-15: Reddish brown to dark reddish gray at 14, soft, moist to wet, silty clay	
15-22: Gray very soft, wet, crumbly silty clay, calcareous nodules	
22-24: Gary and reddish yellow mottled silty clay, with iron and manganese satains, calcareous nodules	
24-25: brown, wet, clayey sand	
25-35: Yellowish red to strong brown at 30, stiff to soft, wet to saturated, silty fine sand to 30	

IMPORTANT NOTICE FOR PERSONS HAVING WELLS DRILLED CONCERNING CONFIDENTIALITY

TEX. OCC. CODE Title 12, Chapter 1901.251, authorizes the owner (owner or the person for whom the well was drilled) to keep information in Well Reports confidential. The Department shall hold the contents of the well log confidential and not a matter of public record if it receives, by certified mail, a written request to do so from the owner.

Please include the report's Tracking Number on your written request.

Texas Department of Licensing and Regulation
P.O. Box 12157
Austin, TX 78711
(512) 334-5540

STATE OF TEXAS WELL REPORT for Tracking #227760

Owner:	Bank of Texas, Special Asset Group	Owner Well #:	MW-2
Address:	8255 Walnut Hill Lane Dallas, TX 75231	Grid #:	81-05-6
Well Location:	930 East Floodgate Road, Freeport, TX 77541	Latitude:	28° 56' 39" N
Well County:	Brazoria	Longitude:	095° 22' 46" W
		Elevation:	No Data

Type of Work: New Well	Proposed Use: Monitor
-------------------------------	------------------------------

Drilling Start Date: **7/20/2010** Drilling End Date: **7/20/2010**

	<i>Diameter (in.)</i>	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>
Borehole:	8.75	0	35

Drilling Method: **Hollow Stem Auger**

Borehole Completion: **Filter Packed**

Filter Pack Intervals:	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>	<i>Filter Material</i>	<i>Size</i>
	18	35	Gravel	20/40
Annular Seal Data:	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>	<i>Description (number of sacks & material)</i>	
	0	16	4, Portland	
	16	18	1, Bentonite	
	18	35	10, Sand	

Seal Method: **Grout**

Distance to Property Line (ft.): **No Data**

Sealed By: **Advanced Drilling Systems, Inc.**

Distance to Septic Field or other concentrated contamination (ft.): **No Data**

Distance to Septic Tank (ft.): **No Data**

Method of Verification: **No Data**

Surface Completion: **Alternative Procedure Used**

Water Level: **No Data**

Packers: **No Data**

Type of Pump: **No Data**

Well Tests: **No Test Data Specified**

	<i>Strata Depth (ft.)</i>	<i>Water Type</i>
Water Quality:	No Data	No Data
		Chemical Analysis Made: No
	Did the driller knowingly penetrate any strata which contained injurious constituents?: No	

Certification Data:	The driller certified that the driller drilled this well (or the well was drilled under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the report(s) being returned for completion and resubmittal.	
Company Information:	Advanced Drilling Systems 904 W. Tiwell Houston, TX 77091	
Driller Name:	M. Moya	License Number: 4990
Comments:	No Data	

Lithology: DESCRIPTION & COLOR OF FORMATION MATERIAL		Casing: BLANK PIPE & WELL SCREEN DATA			
From (ft)	To (ft)	Description	Dia. (in.)	New/Used	Type
0-2:	Miscellaneous gravel and shell, silty clay fill, dry		2	New	PVC Casing 0-20 sch-40
2-7:	Reddish brown to dark reddish gray at 5 stiff to soft, dry to damp, silty clay 7-15: Reddish brown, soft, damp, silty clay with iron & manganese staining		2	New	PVC Slotted 20-35 0.01
15-20:	Gray mottled with yellow crumbly , moist to wet silty clay, calcareous nodules				
20-25:	Strong brown mottled with pale green stiff, moist, silty clay, calcareous nodules and manganese staining				
25-35:	Strong brown, soft, saturated, silty fine to silty sand, calcareous veins at 30				

IMPORTANT NOTICE FOR PERSONS HAVING WELLS DRILLED CONCERNING CONFIDENTIALITY

TEX. OCC. CODE Title 12, Chapter 1901.251, authorizes the owner (owner or the person for whom the well was drilled) to keep information in Well Reports confidential. The Department shall hold the contents of the well log confidential and not a matter of public record if it receives, by certified mail, a written request to do so from the owner.

Please include the report's Tracking Number on your written request.

Texas Department of Licensing and Regulation
P.O. Box 12157
Austin, TX 78711
(512) 334-5540

STATE OF TEXAS WELL REPORT for Tracking #227761

Owner:	Bank of Texas, Special Assets Group	Owner Well #:	MW-3
Address:	8255 Walnut Hill Lane Dallas, TX 75231	Grid #:	81-05-6
Well Location:	930 East Floodgate Road, Freeport, TX 77541	Latitude:	28° 56' 39" N
Well County:	Brazoria	Longitude:	095° 22' 44" W
Elevation:		No Data	
Type of Work:	New Well		Proposed Use: Monitor

Drilling Start Date: **7/20/2010** Drilling End Date: **7/20/2010**

	<i>Diameter (in.)</i>	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>	
Borehole:	8.75	0	35	
Drilling Method:	Hollow Stem Auger			
Borehole Completion:	Filter Packed			
Filter Pack Intervals:	<i>Top Depth (ft.)</i> 18	<i>Bottom Depth (ft.)</i> 35	<i>Filter Material</i> Gravel	<i>Size</i> 20/40
Annular Seal Data:	<i>Top Depth (ft.)</i> 0	<i>Bottom Depth (ft.)</i> 16	<i>Description (number of sacks & material)</i>	
	16	18	4, Portland	
	18	35	1, Bentonite	
			10, Sand	

Seal Method: **Grout**

Distance to Property Line (ft.): **No Data**

Sealed By: **Advanced Drilling Systems, Inc.**

Distance to Septic Field or other concentrated contamination (ft.): **No Data**

Distance to Septic Tank (ft.): **No Data**

Method of Verification: **No Data**

Surface Completion: **Alternative Procedure Used**

Water Level: **No Data**

Packers: **No Data**

Type of Pump: **No Data**

Well Tests: **No Test Data Specified**

	<i>Strata Depth (ft.)</i>	<i>Water Type</i>
Water Quality:	No Data	No Data
		Chemical Analysis Made: No
	Did the driller knowingly penetrate any strata which contained injurious constituents?:	No

Certification Data:	The driller certified that the driller drilled this well (or the well was drilled under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the report(s) being returned for completion and resubmittal.	
Company Information:	Advanced Drilling Systems 904 W. Tiwell Houston, TX 77091	
Driller Name:	M. Moya	License Number: 4990
Comments:	No Data	

Lithology: DESCRIPTION & COLOR OF FORMATION MATERIAL	Casing: BLANK PIPE & WELL SCREEN DATA					
<i>From (ft)</i>	<i>To (ft)</i>	<i>Description</i>	<i>Dia. (in.)</i>	<i>New/Used</i>	<i>Type</i>	<i>Setting From/To (ft.)</i>
0-2:	Sandy gravel and shell fragment fill, dry		2	New	PVC Casing	0-20 sch-40
2-5:	Dark reddish brown stiff , dry, silty clay 7-10: Black to brown, stiff, damp, silty clay		2	New	PVC Slotted	20-35 0.01
10-15:	Dark brown, stiff, damp, silty clay					
15-25:	Dark gray mottled with brown yellow soft, wet silty clay					
- 22-25	Becoms a sandy silty clay					
25-27:	Greenish gray mottled with yellowish brown, soft, wet, silty clay with calcareous noddle					
27-30:	Strong brown, soft, saturated, silty fine sand, wet at 28 bgs.					
30-35:	Storng brown mottled with light greenish gray saturated, silty sand with 0.5 hard dry silty clay					

IMPORTANT NOTICE FOR PERSONS HAVING WELLS DRILLED CONCERNING CONFIDENTIALITY

TEX. OCC. CODE Title 12, Chapter 1901.251, authorizes the owner (owner or the person for whom the well was drilled) to keep information in Well Reports confidential. The Department shall hold the contents of the well log confidential and not a matter of public record if it receives, by certified mail, a written request to do so from the owner.

Please include the report's Tracking Number on your written request.

Texas Department of Licensing and Regulation
P.O. Box 12157
Austin, TX 78711
(512) 334-5540

STATE OF TEXAS WELL REPORT for Tracking #227762

Owner:	Bank of Texas, Special Assets Group	Owner Well #:	MW-4
Address:	8255 Walnut Hill Lane Dallas, TX 75231	Grid #:	81-05-6
Well Location:	930 East Floodgate Road, Freeport, TX 77541	Latitude:	28° 56' 38" N
Well County:	Brazoria	Longitude:	095° 22' 45" W
Elevation:		No Data	
Type of Work:	New Well		Proposed Use: Monitor

Drilling Start Date: **7/20/2010** Drilling End Date: **7/20/2010**

	<i>Diameter (in.)</i>	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>
Borehole:	8.75	0	35

Drilling Method: **Hollow Stem Auger**

Borehole Completion: **Filter Packed**

Filter Pack Intervals:	<i>Top Depth (ft.)</i>	<i>Bottom Depth (ft.)</i>	<i>Filter Material</i>	<i>Size</i>
	18	35	Gravel	20/40
Annular Seal Data:			<i>Description (number of sacks & material)</i>	
	0	16	4, Portland	
	16	18	1, Bentonite	
	18	35	10, Sand	

Seal Method: **Grout**

Distance to Property Line (ft.): **No Data**

Sealed By: **Advanced Drilling Systems, Inc.**

Distance to Septic Field or other concentrated contamination (ft.): **No Data**

Distance to Septic Tank (ft.): **No Data**

Method of Verification: **No Data**

Surface Completion: **Alternative Procedure Used**

Water Level: **No Data**

Packers: **No Data**

Type of Pump: **No Data**

Well Tests: **No Test Data Specified**

Water Quality:	<i>Strata Depth (ft.)</i>	<i>Water Type</i>
	No Data	No Data
		Chemical Analysis Made: No
	Did the driller knowingly penetrate any strata which contained injurious constituents?:	No

Certification Data: The driller certified that the driller drilled this well (or the well was drilled under the driller's direct supervision) and that each and all of the statements herein are true and correct. The driller understood that failure to complete the required items will result in the report(s) being returned for completion and resubmittal.

Company Information: **Advanced Drilling Systems**
904 W. Tiwell
Houston, TX 77091

Driller Name: **M. Moya** License Number: **4990**

Comments: **No Data**

Lithology: DESCRIPTION & COLOR OF FORMATION MATERIAL		Casing: BLANK PIPE & WELL SCREEN DATA				
From (ft)	To (ft)	Description	Dia. (in.)	New/Used	Type	Setting From/To (ft.)
0-2:	Sandy gravel and shell fragment fill, dry		2	New	PVC Casing	0-20 sch-40
2-5:	Dark reddish gray, soft crumbly , dry, silty clay	5-	2	New	PVC Slotted	20-35 0.01
7:	Greenish brown to very dark gray at 6, soft crumbly, damp, silty clay					
7-16:	Brown, soft, damp to moist, silty clay calcareous nodules					
16-22:	Light gray mottled with reddish yellow at 17, soft, crumbly, moist silty to slightly sandy at 20					
22-27:	Gray mottled with reddish yellow hard to soft, damp to wet, sandy silty clay to sand at 25, calcareous nodule					
27-30:	Yellowish red, soft, saturated sand to silty sand at 30 bgs, calcareous nodules					
30-34.5:	Light greenish gray and yellowish red soft saturated, silty sand, calcareous nodules					
34.5-35:	Yellowish red, soft, saturated, sandy silt					

IMPORTANT NOTICE FOR PERSONS HAVING WELLS DRILLED CONCERNING CONFIDENTIALITY

TEX. OCC. CODE Title 12, Chapter 1901.251, authorizes the owner (owner or the person for whom the well was drilled) to keep information in Well Reports confidential. The Department shall hold the contents of the well log confidential and not a matter of public record if it receives, by certified mail, a written request to do so from the owner.

Please include the report's Tracking Number on your written request.

Texas Department of Licensing and Regulation
P.O. Box 12157
Austin, TX 78711
(512) 334-5540

GWDB Reports and Downloads

Well Basic Details

Scanned Documents

State Well Number	8106406	Well Type	Withdrawal of Water
County	Brazoria	Well Use	Public Supply
River Basin	Brazos	Water Level Observation	USGS Current Site Visit
Groundwater Management Area	14	Water Quality Available	No
Regional Water Planning Area	H - Region H	Pump	Turbine
Groundwater Conservation District	Brazoria County GCD	Pump Depth (feet below land surface)	
Latitude (decimal degrees)	28.948889	Power Type	Electric Motor
Latitude (degrees minutes seconds)	28° 56' 56" N	Annular Seal Method	
Longitude (decimal degrees)	-95.364445	Surface Completion	
Longitude (degrees minutes seconds)	095° 21' 52" W	Owner	City of Freeport Well #6
Coordinate Source	Global Positioning System - GPS	Driller	Layne Texas Co.
Aquifer Code	112CHCTU - Chicot Aquifer, Upper	Other Data Available	Drillers Log
Aquifer	Gulf Coast	Well Report Tracking Number	
Aquifer Pick Method		Plugging Report Tracking Number	
Land Surface Elevation (feet above sea level)	5	U.S. Geological Survey Site Number	285654095215101
Land Surface Elevation Method	Interpolated From Topo Map	Texas Commission on Environmental Quality Source Id	G0200005A
Well Depth (feet below land surface)	249	Groundwater Conservation District Well Number	
Well Depth Source	Another Government Agency	Owner Well Number	6
Drilling Start Date		Other Well Number	
Drilling End Date	0/0/1941	Previous State Well Number	
Drilling Method	Mud (Hydraulic) Rotary	Reporting Agency	Texas Water Development Board
Borehole Completion	Screened	Created Date	3/26/1992
		Last Update Date	12/15/2009

Remarks Owners well #6. TCEQ ID #0200005A. Reported yield 420 GPM in 1941.

Casing

Diameter (in.)	Casing Type	Casing Material	Schedule	Gauge	Top Depth (ft.)	Bottom Depth (ft.)
14	Blank	Steel			214	234

Well Tests - No Data

Lithology - No Data

Annular Seal Range - No Data

Borehole - No Data


Plugged Back - No Data

Filter Pack - No Data

Packers - No Data

Water Level Measurements

Measurement Year (with decimal months)

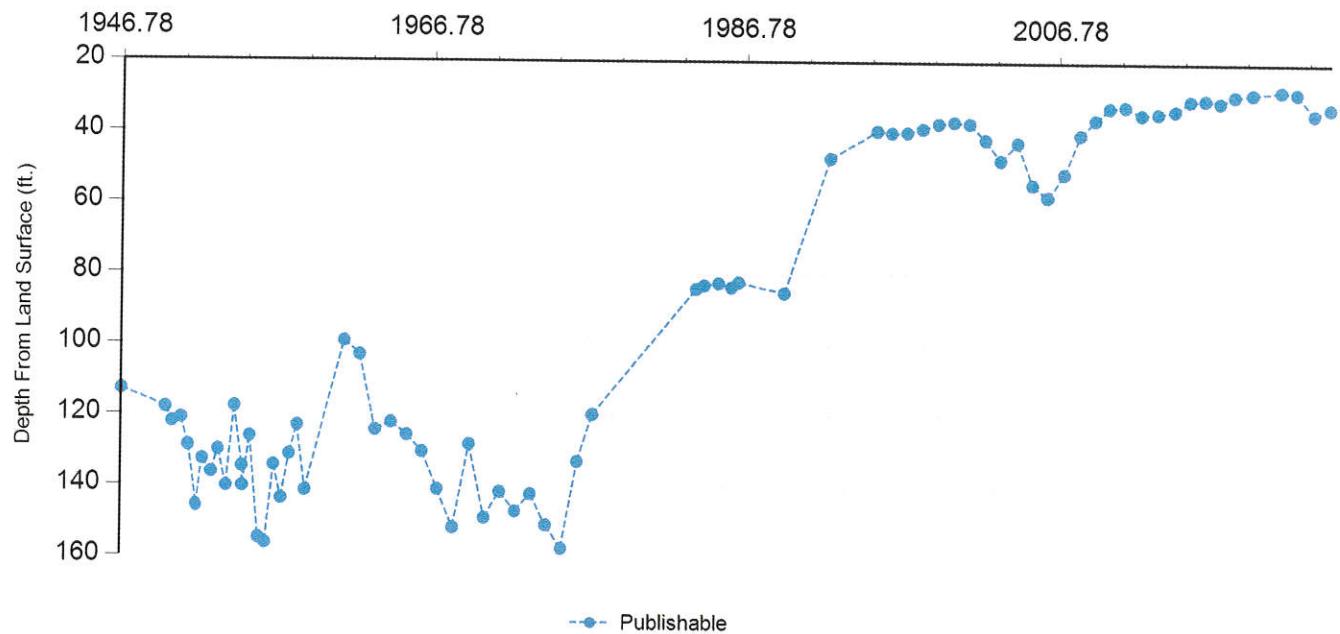

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	10/26/1946		112.9		-107.9	1	U.S. Geological Survey	Steel Tape		
P	8/22/1949		118.01	5.11	-113.01	1	U.S. Geological Survey	Steel Tape		
P	1/18/1950		122.1	4.09	-117.1	1	U.S. Geological Survey	Steel Tape		
P	8/22/1950		121.03	(1.07)	-116.03	1	U.S. Geological Survey	Steel Tape		
P	1/25/1951		128.73	7.70	-123.73	1	U.S. Geological Survey	Steel Tape		
P	8/10/1951		145.5	16.77	-140.5	1	U.S. Geological Survey	Steel Tape		
P	8/21/1951		146	0.50	-141	1	U.S. Geological Survey	Steel Tape		
P	1/8/1952		132.65	(13.35)	-127.65	1	U.S. Geological Survey	Steel Tape		
P	8/11/1952		136.27	3.62	-131.27	1	U.S. Geological Survey	Steel Tape		
P	1/12/1953		129.95	(6.32)	-124.95	1	U.S. Geological Survey	Steel Tape		
P	7/27/1953		140.14	10.19	-135.14	1	U.S. Geological Survey	Steel Tape		
P	1/27/1954		117.66	(22.48)	-112.66	1	U.S. Geological Survey	Steel Tape		
P	7/28/1954		134.6	16.94	-129.6	1	U.S. Geological Survey	Steel Tape		
P	8/9/1954		140.15	5.55	-135.15	1	U.S. Geological Survey	Steel Tape		
P	1/26/1955		126.09	(14.06)	-121.09	1	U.S. Geological Survey	Steel Tape		
P	8/23/1955		154.78	28.69	-149.78	1	U.S. Geological Survey	Steel Tape		
P	1/26/1956		156.18	1.40	-151.18	1	U.S. Geological Survey	Steel Tape		
P	8/8/1956		134.19	(21.99)	-129.19	1	U.S. Geological Survey	Steel Tape		
P	1/29/1957		143.6	9.41	-138.6	1	U.S. Geological Survey	Steel Tape		
P	8/6/1957		131.12	(12.48)	-126.12	1	U.S. Geological Survey	Steel Tape		
P	2/4/1958		122.92	(8.20)	-117.92	1	U.S. Geological Survey	Steel Tape		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-06-406

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	8/12/1958		141.33	18.41	-136.33	1	U.S. Geological Survey	Steel Tape		
P	1/27/1961		99.08	(42.25)	-94.08	1	U.S. Geological Survey	Steel Tape		
P	1/25/1962		102.98	3.90	-97.98	1	U.S. Geological Survey	Steel Tape		
P	1/23/1963		124.2	21.22	-119.2	1	U.S. Geological Survey	Steel Tape		
P	1/28/1964		122.04	(2.16)	-117.04	1	U.S. Geological Survey	Steel Tape		
P	1/26/1965		125.59	3.55	-120.59	1	U.S. Geological Survey	Steel Tape		
P	1/25/1966		130.3	4.71	-125.3	1	U.S. Geological Survey	Steel Tape		
P	1/23/1967		140.9	10.60	-135.9	1	U.S. Geological Survey	Steel Tape		
P	1/23/1968		151.8	10.90	-146.8	1	U.S. Geological Survey	Steel Tape		
P	1/31/1969		128.2	(23.60)	-123.2	1	U.S. Geological Survey	Steel Tape		
P	1/27/1970		149.01	20.81	-144.01	1	U.S. Geological Survey	Steel Tape		
P	1/20/1971		141.58	(7.43)	-136.58	1	U.S. Geological Survey	Steel Tape		
P	1/25/1972		147.1	5.52	-142.1	1	U.S. Geological Survey	Steel Tape		
P	1/17/1973		142.15	(4.95)	-137.15	1	U.S. Geological Survey	Steel Tape		
P	1/17/1974		150.97	8.82	-145.97	1	U.S. Geological Survey	Steel Tape		
P	1/21/1975		157.46	6.49	-152.46	1	U.S. Geological Survey	Steel Tape		
P	1/19/1976		132.95	(24.51)	-127.95	1	U.S. Geological Survey	Steel Tape		
P	1/10/1977		119.69	(13.26)	-114.69	1	U.S. Geological Survey	Steel Tape		
P	8/11/1983		84.14	(35.55)	-79.14	1	U.S. Geological Survey	Unknown		
P	2/14/1984		83.16	(0.98)	-78.16	1	U.S. Geological Survey	Unknown		
P	1/15/1985		82.52	(0.64)	-77.52	1	U.S. Geological Survey	Steel Tape		
P	11/19/1985		83.7	1.18	-78.7	1	U.S. Geological Survey	Steel Tape		
P	4/29/1986		82.25	(1.45)	-77.25	1	U.S. Geological Survey	Steel Tape		
P	3/30/1989		85.22	2.97	-80.22	1	U.S. Geological Survey	Steel Tape		
P	2/12/1992		47.25	(37.97)	-42.25	1	U.S. Geological Survey	Steel Tape		
P	2/2/1995		39.5	(7.75)	-34.5	1	U.S. Geological Survey	Steel Tape		
P	1/10/1996		40.01	0.51	-35.01	1	U.S. Geological Survey	Steel Tape		
P	1/8/1997		39.86	(0.15)	-34.86	1	U.S. Geological Survey	Steel Tape		
P	1/6/1998		38.81	(1.05)	-33.81	1	U.S. Geological Survey	Steel Tape		
P	1/13/1999		37.36	(1.45)	-32.36	1	U.S. Geological Survey	Steel Tape		
P	1/12/2000		36.87	(0.49)	-31.87	1	U.S. Geological Survey	Steel Tape		
P	1/10/2001		37.28	0.41	-32.28	1	U.S. Geological Survey	Steel Tape		
P	1/16/2002		41.88	4.60	-36.88	1	U.S. Geological Survey	Steel Tape		
P	1/10/2003		47.64	5.76	-42.64	1	U.S. Geological Survey	Steel Tape		
P	2/10/2004		42.67	(4.97)	-37.67	1	U.S. Geological Survey	Steel Tape		
P	1/25/2005		54.46	11.79	-49.46	1	U.S. Geological Survey	Steel Tape		
P	1/10/2006		57.87	3.41	-52.87	1	U.S. Geological Survey	Electric Line		
P	1/30/2007		51.35	(6.52)	-46.35	1	U.S. Geological Survey	Steel Tape		
P	1/31/2008		40.39	(10.96)	-35.39	1	U.S. Geological Survey	Steel Tape		
P	1/14/2009		36.15	(4.24)	-31.15	1	U.S. Geological Survey	Steel Tape		
P	12/14/2009		32.7	(3.45)	-27.7	1	U.S. Geological Survey	Steel Tape		
P	12/16/2010		32.37	(0.33)	-27.37	1	U.S. Geological Survey	Steel Tape		

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	1/4/2012		34.58	2.21	-29.58	1	U.S. Geological Survey	Steel Tape		
P	1/18/2013		34.25	(0.33)	-29.25	1	U.S. Geological Survey	Steel Tape		
P	2/18/2014		33.39	(0.86)	-28.39	1	U.S. Geological Survey	Steel Tape		
P	2/5/2015		30.57	(2.82)	-25.57	1	U.S. Geological Survey	Steel Tape		
P	1/21/2016	1159	30.3	(0.27)	-25.3	1	U.S. Geological Survey	Steel Tape		
P	1/4/2017	0850	31	0.70	-26	1	U.S. Geological Survey	Steel Tape		
P	12/18/2017	1345	29.17	(1.83)	-24.17	1	U.S. Geological Survey	Steel Tape		
P	2/6/2019	1110	28.5	(0.67)	-23.5	1	U.S. Geological Survey	Steel Tape		
P	12/7/2020		27.71	(0.79)	-22.71	1	U.S. Geological Survey	Steel Tape		
P	12/8/2021		28.29	0.58	-23.29	1	U.S. Geological Survey	Steel Tape		
P	1/25/2023		34.21	5.92	-29.21	1	U.S. Geological Survey	Steel Tape		
P	2/7/2024		32.5	(1.71)	-27.5	1	U.S. Geological Survey	Steel Tape		

Code Descriptions

Status Code	Status Description
P	Publishable

Water Quality Analysis - No Data Available

GWDB DISCLAIMER: Except where noted, all of the information provided in the Texas Water Development Board (TWDB) Groundwater Database (<https://www.twdb.texas.gov/groundwater/data/gwdb rpt.asp>) is believed to be accurate and reliable; however, the TWDB assumes no responsibility for any errors appearing in rules or otherwise. Further, TWDB assumes no responsibility for the use of the information provided. PLEASE NOTE that users of these data are responsible for checking the accuracy, completeness, currency and/or suitability of all information themselves. TWDB makes no guarantees or warranties as to the accuracy, completeness, currency, or suitability of the information provided via the Groundwater Database (GWDB). TWDB specifically disclaims any and all liability for any claims or damages that may result from providing GWDB data or the information it contains. For additional information or answers to questions concerning the TWDB GWDB, contact the Groundwater Data Team at GroundwaterData@twdb.texas.gov.

Well No. BH 81 - 06 - 406

Latitude-longitude 28° 56' 54" N 095° 21' 51" W

HYDROGEOLOGIC CARD

SAVE AS OR MASTER CARD	Physiographic Province:	0:3	Section:
<input checked="" type="checkbox"/> F	Drainage Basin:	52:8	Subbasin:
Type of depression, stream channel, dunes, flat, hilltop, sink, swamp, well sites (D) (E) (F) (H) (K) (L) (O) (P) (Q) (T) (U) (V) offshore, pediment, hillside, terrace, undulating, valley flat			
WATER AQUIFER:	System	Series	Q:G
Lithology:	SAND	S:	Origin: Aquifer, formation, group C:U
Length of well open to: 20 ft Depth to top of: 214 ft Aquifer Thickness: 214 ft			
HIMR AQUIFER:	System	Series	Aquifer, formation, group
Lithology:		1	Origin: Aquifer Thickness: ft
Length of well open to: ft Depth to top of: ft Aquifer Thickness: ft			
Intervals screened:	214 - 234		
Depth to consolidated rock:	ft	60	Source of data: 64
Depth to basement:	ft	65	Source of data: 69
Surficial material:	ft	70	Infiltration characteristics: 72
Coefficient trans:	ft/d/ft	71	Coefficient storage: 73
Coefficient form:	ft/d/ft ² ; Dens. spgr.	72	gm/ft; Number of geologic cards: 73

Well No. BH 81-06-406

GWDB Reports and Downloads		Well Basic Details		Scanned Documents
State Well Number	8105606	Well Type	Observation	
County	Brazoria	Well Use	Unused	
River Basin	Brazos	Water Level Observation	None	
Groundwater Management Area	14	Water Quality Available	No	
Regional Water Planning Area	H - Region H	Pump	None	
Groundwater Conservation District	Brazoria County GCD	Pump Depth (feet below land surface)		
Latitude (decimal degrees)	28.950278	Power Type		
Latitude (degrees minutes seconds)	28° 57' 01" N	Annular Seal Method		
Longitude (decimal degrees)	-95.378055	Surface Completion		
Longitude (degrees minutes seconds)	095° 22' 41" W	Owner	Dow Chemical Co. obs #4	
Coordinate Source	+/- 1 Second	Driller	Layne Texas	
Aquifer Code	112CHCTU - Chicot Aquifer, Upper	Other Data Available	Electric Log	
Aquifer	Gulf Coast	Well Report Tracking Number		
Aquifer Pick Method		Plugging Report Tracking Number		
Land Surface Elevation (feet above sea level)	15	U.S. Geological Survey Site Number		
Land Surface Elevation Method	Interpolated From Topo Map	Texas Commission on Environmental Quality Source Id		
Well Depth (feet below land surface)	301	Groundwater Conservation District Well Number		
Well Depth Source	Owner	Owner Well Number		
Drilling Start Date		Other Well Number		
Drilling End Date	11/24/1953	Previous State Well Number		
Drilling Method	Mud (Hydraulic) Rotary	Reporting Agency	U.S. Geological Survey	
Borehole Completion		Created Date	12/10/1997	
		Last Update Date	12/10/1997	

Remarks well #4. Not completed.

Casing - No Data

Well Tests - No Data

Lithology - No Data

Annular Seal Range - No Data

Borehole - No Data

Plugged Back - No Data

Filter Pack - No Data

Packers - No Data

Water Level Measurements

No Data Available

Water Quality Analysis - No Data Available

GWDB DISCLAIMER: Except where noted, all of the information provided in the Texas Water Development Board (TWDB) Groundwater Database (<https://www.twdb.texas.gov/groundwater/data/gwdb rpt.asp>) is believed to be accurate and reliable; however, the TWDB assumes no responsibility for any errors appearing in rules or otherwise. Further, TWDB assumes no responsibility for the use of the information provided. PLEASE NOTE that users of these data are responsible for checking the accuracy, completeness, currency and/or suitability of all information themselves. TWDB makes no guarantees or warranties as to the accuracy, completeness, currency, or suitability of the information provided via the Groundwater Database (GWDB). TWDB specifically disclaims any and all liability for any claims or damages that may result from providing GWDB data or the information it contains. For additional information or answers to questions concerning the TWDB GWDB, contact the Groundwater Data Team at GroundwaterData@twdb.texas.gov.

Latitude-longitude



N

S

E

W

HYDROGEOLOGIC CARD

SAME AS ON MASTER CARD

Physiographic
Province:

O:7

Section:

Prainans
Basin:

S:3:P

Subbasin:

(D) (C) (B) (W) (H) (K) (L)
 Type of depression, stream channel, dunes, flat hilltop, sink, swamp.
 Well site: (E) (F) (G) (X) (U) (V)
 offshore, pediment, hillside, terrace, undulating, valley flat

17 i

MAJOR

AQUIFER:

O:G

C:U

system

series

30

30

aquifer, formation, group

30

31

Lithology:

Origin:

Aquifer

Thickness:

ft

32

33

34

MINOR

AQUIFER:

O:G

system

series

44

45

aquifer, formation, group

46

47

Lithology:

Origin:

Aquifer

Thickness:

ft

32

33

34

Intervals

Screened:

- 0 - WELL ABANDONED

Depth to

consolidated rock:

ft

40

41

42

43

Source of data:

64

ft

Depth to

basement:

ft

44

45

46

47

Source of data:

65

ft

Surficial

material:

ft

48

49

50

51

Infiltration

71

characteristics:

Coefficient

Trans:

gpd/ft

72

73

Coefficient

74

Storage:

Coefficient

Pore:

spd/ft²; Spec cap:

gpm/ft; Number of geologic cards:

75

DRILLERS LOG

0-6 6 SURFACE SOIL
 6-20 14 RED CLAY
 20-40 20 BLUE CLAY
 40-50 10 SAND
 50-144 94 SOFT BLUE CLAY
 144-156 12 SAND
 156-185 29 BLUE CLAY
 185-197 12 SAND & CLAY streaks
 197-255 58 CLAY
 255-271 16 SAND
 271-301 30 CLAY

GWDB Reports and Downloads

Well Basic Details

Scanned Documents

State Well Number	8105602	Well Type	Observation
County	Brazoria	Well Use	Unused
River Basin	Brazos	Water Level Observation	Miscellaneous Measurements
Groundwater Management Area	14	Water Quality Available	Yes
Regional Water Planning Area	H - Region H	Pump	None
Groundwater Conservation District	Brazoria County GCD	Pump Depth (feet below land surface)	
Latitude (decimal degrees)	28.942778	Power Type	
Latitude (degrees minutes seconds)	28° 56' 34" N	Annular Seal Method	
Longitude (decimal degrees)	-95.378889	Surface Completion	
Longitude (degrees minutes seconds)	095° 22' 44" W	Owner	Dow Chemical Co. Obs. Well 13 obs
Coordinate Source	+/- 1 Second	Driller	Layne Texas Co.
Aquifer Code	112CHCTU - Chicot Aquifer, Upper	Other Data Available	Aquifer Test; Drillers Log
Aquifer	Gulf Coast	Well Report Tracking Number	
Aquifer Pick Method		Plugging Report Tracking Number	
Land Surface Elevation (feet above sea level)	14	U.S. Geological Survey Site Number	
Land Surface Elevation Method	Interpolated From Topo Map	Texas Commission on Environmental Quality Source Id	
Well Depth (feet below land surface)	246	Groundwater Conservation District Well Number	
Well Depth Source	Driller's Log	Owner Well Number	OBS 13
Drilling Start Date		Other Well Number	
Drilling End Date	12/21/1953	Previous State Well Number	
Drilling Method	Mud (Hydraulic) Rotary	Reporting Agency	U.S. Geological Survey
Borehole Completion	Screened	Created Date	7/26/1967
		Last Update Date	8/23/2010

Remarks Owner's observation well. Aquifer test results in TWDB R-163. No test data in TWDB files Water level obtained by driller on 12/18/53 was -119.5'. Not entered in GWDB since it predates well completion.

Casing

Diameter (in.)	Casing Type	Casing Material	Schedule	Gauge	Top Depth (ft.)	Bottom Depth (ft.)
2	Blank	Steel			0	226
2	Screen	Steel			226	236
2	Blank	Steel			236	246

Well Tests - No Data

Lithology - No Data

Annular Seal Range - No Data

Borehole - No Data


Plugged Back - No Data

Filter Pack - No Data

Packers - No Data

Water Level Measurements

Measurement Year (with decimal months)

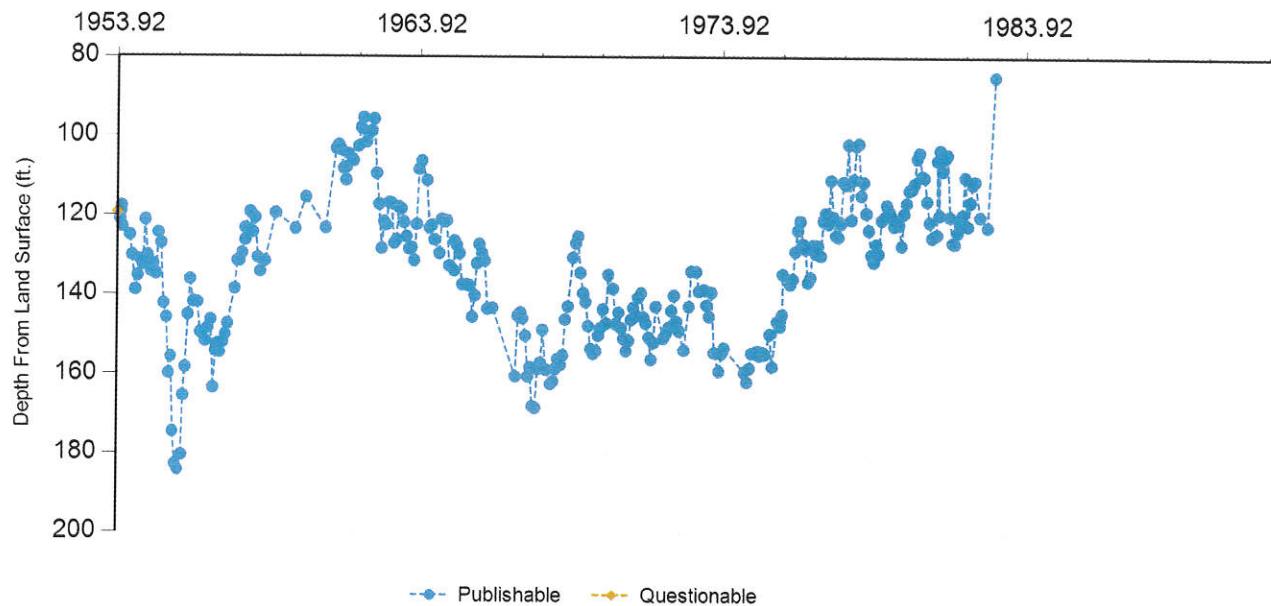

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
Q	12/8/1953		119.5		-105.5	1	Registered Water Well Driller	Electric Line	17	
P	1/4/1954		121	1.50	-107	1	Registered Water Well Driller	Electric Line		
P	1/18/1954		118.9	(2.10)	-104.9	1	U.S. Geological Survey	Steel Tape		
P	1/25/1954		117.7	(1.20)	-103.7	1	U.S. Geological Survey	Steel Tape		
P	2/3/1954		122.9	5.20	-108.9	1	Registered Water Well Driller	Electric Line		
P	5/4/1954		125.01	2.11	-111.01	1	Registered Water Well Driller	Electric Line		
P	5/31/1954		130.1	5.09	-116.1	1	Registered Water Well Driller	Electric Line		
P	7/9/1954		138.8	8.70	-124.8	1	Registered Water Well Driller	Electric Line		
P	8/9/1954		135.24	(3.56)	-121.24	1	Registered Water Well Driller	Electric Line		
P	9/10/1954		131.2	(4.04)	-117.2	1	Registered Water Well Driller	Electric Line		
P	10/8/1954		132.4	1.20	-118.4	1	Registered Water Well Driller	Electric Line		
P	11/8/1954		121.2	(11.20)	-107.2	1	Registered Water Well Driller	Electric Line		
P	12/3/1954		130.1	8.90	-116.1	1	Registered Water Well Driller	Electric Line		
P	1/13/1955		134.2	4.10	-120.2	1	Registered Water Well Driller	Electric Line		
P	2/4/1955		132.3	(1.90)	-118.3	1	Registered Water Well Driller	Electric Line		
P	3/8/1955		134.8	2.50	-120.8	1	Registered Water Well Driller	Electric Line		
P	4/7/1955		124.4	(10.40)	-110.4	1	Registered Water Well Driller	Electric Line		
P	5/10/1955		127.1	2.70	-113.1	1	Registered Water Well Driller	Electric Line		
P	6/8/1955		142.2	15.10	-128.2	1	Registered Water Well Driller	Electric Line		
P	7/13/1955		145.8	3.60	-131.8	1	Registered Water Well Driller	Electric Line		
P	8/11/1955		159.9	14.10	-145.9	1	Registered Water Well Driller	Electric Line		

**Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602**

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	9/9/1955		155.7	(4.20)	-141.7	1	Registered Water Well Driller	Electric Line		
P	10/4/1955		174.6	18.90	-160.6	1	Registered Water Well Driller	Electric Line		
P	11/4/1955		182.8	8.20	-168.8	1	Registered Water Well Driller	Electric Line		
P	12/8/1955		184.2	1.40	-170.2	1	Registered Water Well Driller	Electric Line		
P	1/18/1956		180.5	(3.70)	-166.5	1	Registered Water Well Driller	Electric Line		
P	2/7/1956		165.5	(15.00)	-151.5	1	Registered Water Well Driller	Electric Line		
P	3/2/1956		158.3	(7.20)	-144.3	1	Registered Water Well Driller	Electric Line		
P	4/4/1956		145.1	(13.20)	-131.1	1	Registered Water Well Driller	Electric Line		
P	5/1/1956		136.1	(9.00)	-122.1	1	Registered Water Well Driller	Electric Line		
P	6/6/1956		141.8	5.70	-127.8	1	Registered Water Well Driller	Electric Line		
P	7/30/1956		141.9	0.10	-127.9	1	Registered Water Well Driller	Electric Line		
P	9/5/1956		149.5	7.60	-135.5	1	Registered Water Well Driller	Electric Line		
P	11/6/1956		151.7	2.20	-137.7	1	Registered Water Well Driller	Electric Line		
P	12/5/1956		148.4	(3.30)	-134.4	1	Registered Water Well Driller	Electric Line		
P	1/4/1957		146.3	(2.10)	-132.3	1	Registered Water Well Driller	Electric Line		
P	2/4/1957		163.5	17.20	-149.5	1	Registered Water Well Driller	Electric Line		
P	3/4/1957		154.2	(9.30)	-140.2	1	Registered Water Well Driller	Electric Line		
P	4/3/1957		152.3	(1.90)	-138.3	1	Registered Water Well Driller	Electric Line		
P	4/26/1957		154.5	2.20	-140.5	1	Registered Water Well Driller	Electric Line		
P	6/4/1957		152	(2.50)	-138	1	Registered Water Well Driller	Electric Line		
P	7/2/1957		150	(2.00)	-136	1	Registered Water Well Driller	Electric Line		
P	8/1/1957		147.3	(2.70)	-133.3	1	Registered Water Well Driller	Electric Line		
P	9/0/1957		138.4	(8.90)	-124.4	1	Registered Water Well Driller	Electric Line		
P	10/0/1957		131.4	(7.00)	-117.4	1	Registered Water Well Driller	Electric Line		
P	11/0/1957		131.4	0.00	-117.4	1	Registered Water Well Driller	Electric Line		
P	12/0/1957		129.5	(1.90)	-115.5	1	Registered Water Well Driller	Electric Line		
P	1/0/1958		123.2	(6.30)	-109.2	1	Registered Water Well Driller	Electric Line		
P	2/28/1958		126.2	3.00	-112.2	1	Registered Water Well Driller	Electric Line		
P	3/0/1958		119.1	(7.10)	-105.1	1	Registered Water Well Driller	Electric Line		
P	4/0/1958		124.2	5.10	-110.2	1	Registered Water Well Driller	Electric Line		
P	5/0/1958		120.6	(3.60)	-106.6	1	Registered Water Well Driller	Electric Line		
P	6/0/1958		130.6	10.00	-116.6	1	Registered Water Well Driller	Electric Line		
P	7/0/1958		134.1	3.50	-120.1	1	Registered Water Well Driller	Electric Line		
P	9/0/1958		131.4	(2.70)	-117.4	1	Registered Water Well Driller	Electric Line		
P	1/0/1959		119.4	(12.00)	-105.4	1	Registered Water Well Driller	Electric Line		
P	9/0/1959		123.4	4.00	-109.4	1	Registered Water Well Driller	Electric Line		
P	1/0/1960		115.5	(7.90)	-101.5	1	Registered Water Well Driller	Electric Line		
P	9/0/1960		123.2	7.70	-109.2	1	Registered Water Well Driller	Electric Line		
P	1/0/1961		103.3	(19.90)	-89.3	1	Registered Water Well Driller	Electric Line		
P	2/0/1961		102.3	(1.00)	-88.3	1	Registered Water Well Driller	Electric Line		
P	3/0/1961		103.6	1.30	-89.6	1	Registered Water Well Driller	Electric Line		
P	4/0/1961		108.2	4.60	-94.2	1	Registered Water Well Driller	Electric Line		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	5/0/1961		111.2	3.00	-97.2	1	Registered Water Well Driller	Electric Line		
P	6/30/1961		108	(3.20)	-94	1	Registered Water Well Driller	Electric Line		
P	7/27/1961		104.6	(3.40)	-90.6	1	Registered Water Well Driller	Electric Line		
P	8/0/1961		106.3	1.70	-92.3	1	Registered Water Well Driller	Electric Line		
P	10/0/1961		102.7	(3.60)	-88.7	1	Registered Water Well Driller	Electric Line		
P	11/0/1961		98	(4.70)	-84	1	Registered Water Well Driller	Electric Line		
P	12/0/1961		95.5	(2.50)	-81.5	1	Registered Water Well Driller	Electric Line		
P	1/0/1962		101.6	6.10	-87.6	1	Registered Water Well Driller	Electric Line		
P	2/0/1962		99.4	(2.20)	-85.4	1	Registered Water Well Driller	Electric Line		
P	3/0/1962		98.8	(0.60)	-84.8	1	Registered Water Well Driller	Electric Line		
P	4/0/1962		95.8	(3.00)	-81.8	1	Registered Water Well Driller	Electric Line		
P	5/0/1962		109.5	13.70	-95.5	1	Registered Water Well Driller	Electric Line		
P	6/0/1962		117.2	7.70	-103.2	1	Registered Water Well Driller	Electric Line		
P	7/0/1962		128.3	11.10	-114.3	1	Registered Water Well Driller	Electric Line		
P	8/29/1962		125.6	(2.70)	-111.6	1	Registered Water Well Driller	Electric Line		
P	9/27/1962		121.6	(4.00)	-107.6	1	Registered Water Well Driller	Electric Line		
P	10/25/1962		122.4	0.80	-108.4	1	Registered Water Well Driller	Electric Line		
P	11/27/1962		116.8	(5.60)	-102.8	1	Registered Water Well Driller	Electric Line		
P	12/31/1962		116.9	0.10	-102.9	1	Registered Water Well Driller	Electric Line		
P	1/28/1963		127	10.10	-113	1	Registered Water Well Driller	Electric Line		
P	2/26/1963		126.1	(0.90)	-112.1	1	Registered Water Well Driller	Electric Line		
P	3/25/1963		117.9	(8.20)	-103.9	1	Registered Water Well Driller	Electric Line		
P	4/25/1963		118.3	0.40	-104.3	1	Registered Water Well Driller	Electric Line		
P	5/26/1963		121.7	3.40	-107.7	1	Registered Water Well Driller	Electric Line		
P	6/27/1963		125.3	3.60	-111.3	1	Registered Water Well Driller	Electric Line		
P	7/29/1963		128.4	3.10	-114.4	1	Registered Water Well Driller	Electric Line		
P	8/29/1963		128	(0.40)	-114	1	Registered Water Well Driller	Electric Line		
P	9/30/1963		131.3	3.30	-117.3	1	Registered Water Well Driller	Electric Line		
P	10/30/1963		122.2	(9.10)	-108.2	1	Registered Water Well Driller	Electric Line		
P	11/27/1963		108.4	(13.80)	-94.4	1	Registered Water Well Driller	Electric Line		
P	12/31/1963		106.3	(2.10)	-92.3	1	Registered Water Well Driller	Electric Line		
P	1/0/1964		111.2	4.90	-97.2	1	Registered Water Well Driller	Electric Line		
P	2/0/1964		123.1	11.90	-109.1	1	Registered Water Well Driller	Electric Line		
P	3/0/1964		122.4	(0.70)	-108.4	1	Registered Water Well Driller	Electric Line		
P	4/0/1964		126.1	3.70	-112.1	1	Registered Water Well Driller	Electric Line		
P	6/0/1964		129.5	3.40	-115.5	1	Registered Water Well Driller	Electric Line		
P	7/0/1964		120.9	(8.60)	-106.9	1	Registered Water Well Driller	Electric Line		
P	8/0/1964		121.5	0.60	-107.5	1	Registered Water Well Driller	Electric Line		
P	9/0/1964		121.3	(0.20)	-107.3	1	Registered Water Well Driller	Electric Line		
P	10/0/1964		132.6	11.30	-118.6	1	Registered Water Well Driller	Electric Line		
P	12/0/1964		133.8	1.20	-119.8	1	Registered Water Well Driller	Electric Line		
P	1/29/1965		126.3	(7.50)	-112.3	1	Registered Water Well Driller	Electric Line		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	2/26/1965		127.4	1.10	-113.4	1	Registered Water Well Driller	Electric Line		
P	3/29/1965		129.5	2.10	-115.5	1	Registered Water Well Driller	Electric Line		
P	4/29/1965		137.3	7.80	-123.3	1	Registered Water Well Driller	Electric Line		
P	6/29/1965		137.4	0.10	-123.4	1	Registered Water Well Driller	Electric Line		
P	7/29/1965		137.6	0.20	-123.6	1	Registered Water Well Driller	Electric Line		
P	8/31/1965		145.5	7.90	-131.5	1	Registered Water Well Driller	Electric Line		
P	9/30/1965		140.1	(5.40)	-126.1	1	Registered Water Well Driller	Electric Line		
P	10/25/1965		132	(8.10)	-118	1	Registered Water Well Driller	Electric Line		
P	11/26/1965		127.2	(4.80)	-113.2	1	Registered Water Well Driller	Electric Line		
P	12/29/1965		129.5	2.30	-115.5	1	Registered Water Well Driller	Electric Line		
P	1/26/1966		131.3	1.80	-117.3	1	Registered Water Well Driller	Electric Line		
P	2/28/1966		143.4	12.10	-129.4	1	Registered Water Well Driller	Electric Line		
P	4/28/1966		143.2	(0.20)	-129.2	1	Registered Water Well Driller	Electric Line		
P	1/29/1967		160.5	17.30	-146.5	1	Registered Water Well Driller	Electric Line		
P	2/28/1967		145.2	(15.30)	-131.2	1	Private Firm or Industry	Electric Line		
P	3/30/1967		144.3	(0.90)	-130.3	1	Private Firm or Industry	Electric Line		
P	4/27/1967		145.8	1.50	-131.8	1	Private Firm or Industry	Electric Line		
P	5/31/1967		150.2	4.40	-136.2	1	Private Firm or Industry	Electric Line		
P	6/29/1967		160.5	10.30	-146.5	1	Private Firm or Industry	Electric Line		
P	7/24/1967		158.1	(2.40)	-144.1	1	Private Firm or Industry	Electric Line		
P	8/24/1967		168	9.90	-154	1	Private Firm or Industry	Electric Line		
P	9/28/1967		168.4	0.40	-154.4	1	Private Firm or Industry	Electric Line		
P	10/31/1967		158.5	(9.90)	-144.5	1	Private Firm or Industry	Electric Line		
P	11/30/1967		157.1	(1.40)	-143.1	1	Private Firm or Industry	Electric Line		
P	12/28/1967		148.7	(8.40)	-134.7	1	Private Firm or Industry	Electric Line		
P	1/30/1968		158.7	10.00	-144.7	1	Private Firm or Industry	Electric Line		
P	3/28/1968		162.4	3.70	-148.4	1	Private Firm or Industry	Electric Line		
P	4/29/1968		161.7	(0.70)	-147.7	1	Private Firm or Industry	Electric Line		
P	5/28/1968		158.5	(3.20)	-144.5	1	Private Firm or Industry	Electric Line		
P	6/26/1968		156	(2.50)	-142	1	Private Firm or Industry	Electric Line		
P	7/30/1968		157.5	1.50	-143.5	1	Private Firm or Industry	Electric Line		
P	8/27/1968		155.1	(2.40)	-141.1	1	Private Firm or Industry	Electric Line		
P	9/25/1968		146.1	(9.00)	-132.1	1	Private Firm or Industry	Electric Line		
P	10/28/1968		142.8	(3.30)	-128.8	1	Private Firm or Industry	Electric Line		
P	12/31/1968		130.5	(12.30)	-116.5	1	Private Firm or Industry	Electric Line		
P	1/30/1969		126.9	(3.60)	-112.9	1	Private Firm or Industry	Electric Line		
P	2/27/1969		125.2	(1.70)	-111.2	1	Private Firm or Industry	Electric Line		
P	3/26/1969		134.3	9.10	-120.3	1	Private Firm or Industry	Electric Line		
P	4/28/1969		139.4	5.10	-125.4	1	Private Firm or Industry	Electric Line		
P	5/28/1969		141.6	2.20	-127.6	1	Private Firm or Industry	Electric Line		
P	6/27/1969		147.7	6.10	-133.7	1	Private Firm or Industry	Electric Line		
P	7/28/1969		153.5	5.80	-139.5	1	Private Firm or Industry	Electric Line		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	8/28/1969		154.7	1.20	-140.7	1	Private Firm or Industry	Electric Line		
P	9/30/1969		154	(0.70)	-140	1	Private Firm or Industry	Electric Line		
P	10/30/1969		150.1	(3.90)	-136.1	1	Private Firm or Industry	Electric Line		
P	11/25/1969		148.2	(1.90)	-134.2	1	Private Firm or Industry	Electric Line		
P	12/26/1969		143.5	(4.70)	-129.5	1	Private Firm or Industry	Electric Line		
P	1/28/1970		147.1	3.60	-133.1	1	Private Firm or Industry	Electric Line		
P	2/25/1970		134.8	(12.30)	-120.8	1	Private Firm or Industry	Electric Line		
P	4/24/1970		138.3	3.50	-124.3	1	Private Firm or Industry	Electric Line		
P	5/28/1970		147.2	8.90	-133.2	1	Private Firm or Industry	Electric Line		
P	6/30/1970		144.3	(2.90)	-130.3	1	Private Firm or Industry	Electric Line		
P	7/31/1970		148.2	3.90	-134.2	1	Private Firm or Industry	Electric Line		
P	8/27/1970		150.9	2.70	-136.9	1	Private Firm or Industry	Electric Line		
P	9/29/1970		154	3.10	-140	1	Private Firm or Industry	Electric Line		
P	10/30/1970		151.4	(2.60)	-137.4	1	Private Firm or Industry	Electric Line		
P	12/2/1970		146.1	(5.30)	-132.1	1	Private Firm or Industry	Electric Line		
P	12/29/1970		143.1	(3.00)	-129.1	1	Private Firm or Industry	Electric Line		
P	1/29/1971		145.1	2.00	-131.1	1	Private Firm or Industry	Electric Line		
P	2/24/1971		140.5	(4.60)	-126.5	1	Private Firm or Industry	Electric Line		
P	3/29/1971		139.4	(1.10)	-125.4	1	Private Firm or Industry	Electric Line		
P	4/28/1971		145.5	6.10	-131.5	1	Private Firm or Industry	Electric Line		
P	5/25/1971		147	1.50	-133	1	Private Firm or Industry	Electric Line		
P	6/30/1971		150.6	3.60	-136.6	1	Private Firm or Industry	Electric Line		
P	7/30/1971		156.2	5.60	-142.2	1	Private Firm or Industry	Electric Line		
P	8/30/1971		151.9	(4.30)	-137.9	1	Private Firm or Industry	Electric Line		
P	9/27/1971		142.8	(9.10)	-128.8	1	Private Firm or Industry	Electric Line		
P	11/0/1971		150.8	8.00	-136.8	1	Private Firm or Industry	Electric Line		
P	12/0/1971		149.6	(1.20)	-135.6	1	Private Firm or Industry	Electric Line		
P	1/0/1972		148	(1.60)	-134	1	Private Firm or Industry	Electric Line		
P	2/0/1972		143.8	(4.20)	-129.8	1	Private Firm or Industry	Electric Line		
P	3/0/1972		140	(3.80)	-126	1	Private Firm or Industry	Electric Line		
P	4/0/1972		146.5	6.50	-132.5	1	Private Firm or Industry	Electric Line		
P	5/0/1972		148.9	2.40	-134.9	1	Private Firm or Industry	Electric Line		
P	7/0/1972		153.8	4.90	-139.8	1	Private Firm or Industry	Electric Line		
P	9/0/1972		142.8	(11.00)	-128.8	1	Private Firm or Industry	Electric Line		
P	10/0/1972		133.9	(8.90)	-119.9	1	Private Firm or Industry	Electric Line		
P	12/0/1972		134	0.10	-120	1	Private Firm or Industry	Electric Line		
P	1/0/1973		138.9	4.90	-124.9	1	Private Firm or Industry	Electric Line		
P	3/0/1973		138.5	(0.40)	-124.5	1	Private Firm or Industry	Electric Line		
P	4/0/1973		142.4	3.90	-128.4	1	Private Firm or Industry	Electric Line		
P	5/0/1973		145.3	2.90	-131.3	1	Private Firm or Industry	Electric Line		
P	6/0/1973		139.2	(6.10)	-125.2	1	Private Firm or Industry	Electric Line		
P	7/0/1973		154.4	15.20	-140.4	1	Private Firm or Industry	Electric Line		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	9/0/1973		159.1	4.70	-145.1	1	Private Firm or Industry	Electric Line		
P	10/0/1973		154.7	(4.40)	-140.7	1	Private Firm or Industry	Electric Line		
P	11/0/1973		153.2	(1.50)	-139.2	1	Private Firm or Industry	Electric Line		
P	8/27/1974		159.3	6.10	-145.3	1	Private Firm or Industry	Electric Line		
P	9/30/1974		161.8	2.50	-147.8	1	Private Firm or Industry	Electric Line		
P	10/31/1974		158.3	(3.50)	-144.3	1	Private Firm or Industry	Electric Line		
P	11/26/1974		154.5	(3.80)	-140.5	1	Private Firm or Industry	Electric Line		
P	12/0/1974		154	(0.50)	-140	1	Private Firm or Industry	Electric Line		
P	1/0/1975		155.1	1.10	-141.1	1	Registered Water Well Driller	Electric Line		
P	2/0/1975		154.2	(0.90)	-140.2	1	Registered Water Well Driller	Electric Line		
P	3/0/1975		154.8	0.60	-140.8	1	Registered Water Well Driller	Electric Line		
P	5/0/1975		149.7	(5.10)	-135.7	1	Registered Water Well Driller	Electric Line		
P	6/0/1975		157.9	8.20	-143.9	1	Registered Water Well Driller	Electric Line		
P	8/0/1975		146.5	(11.40)	-132.5	1	Registered Water Well Driller	Electric Line		
P	9/0/1975		147.8	1.30	-133.8	1	Registered Water Well Driller	Electric Line		
P	10/0/1975		144.8	(3.00)	-130.8	1	Registered Water Well Driller	Electric Line		
P	11/2/1975		146.4	1.60	-132.4	1	Registered Water Well Driller	Electric Line		
P	12/4/1975		134.6	(11.80)	-120.6	1	Registered Water Well Driller	Electric Line		
P	1/0/1976		137.1	2.50	-123.1	1	Registered Water Well Driller	Electric Line		
P	2/0/1976		135.8	(1.30)	-121.8	1	Registered Water Well Driller	Electric Line		
P	3/0/1976		128.9	(6.90)	-114.9	1	Registered Water Well Driller	Electric Line		
P	4/0/1976		123.5	(5.40)	-109.5	1	Registered Water Well Driller	Electric Line		
P	5/0/1976		121.3	(2.20)	-107.3	1	Registered Water Well Driller	Electric Line		
P	6/0/1976		127	5.70	-113	1	Registered Water Well Driller	Electric Line		
P	7/0/1976		128.2	1.20	-114.2	1	Registered Water Well Driller	Electric Line		
P	8/0/1976		136.6	8.40	-122.6	1	Registered Water Well Driller	Electric Line		
P	9/0/1976		135.4	(1.20)	-121.4	1	Registered Water Well Driller	Electric Line		
P	10/0/1976		127.3	(8.10)	-113.3	1	Registered Water Well Driller	Electric Line		
P	11/0/1976		129.3	2.00	-115.3	1	Registered Water Well Driller	Electric Line		
P	12/0/1976		127.4	(1.90)	-113.4	1	U.S. Geological Survey	Steel Tape		
P	1/0/1977		129.9	2.50	-115.9	1	U.S. Geological Survey	Steel Tape		
P	2/0/1977		121.2	(8.70)	-107.2	1	U.S. Geological Survey	Steel Tape		
P	3/0/1977		119.2	(2.00)	-105.2	1	U.S. Geological Survey	Steel Tape		
P	4/0/1977		121.8	2.60	-107.8	1	U.S. Geological Survey	Steel Tape		
P	5/0/1977		111	(10.80)	-97	1	U.S. Geological Survey	Steel Tape		
P	6/0/1977		120.2	9.20	-106.2	1	U.S. Geological Survey	Steel Tape		
P	7/0/1977		124.8	4.60	-110.8	1	U.S. Geological Survey	Steel Tape		
P	8/0/1977		125.2	0.40	-111.2	1	U.S. Geological Survey	Steel Tape		
P	9/0/1977		121.8	(3.40)	-107.8	1	U.S. Geological Survey	Steel Tape		
P	10/0/1977		111.4	(10.40)	-97.4	1	U.S. Geological Survey	Steel Tape		
P	11/0/1977		112.1	0.70	-98.1	1	U.S. Geological Survey	Steel Tape		
P	12/0/1977		102	(10.10)	-88	1	U.S. Geological Survey	Steel Tape		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	1/0/1978		120.9	18.90	-106.9	1	U.S. Geological Survey	Steel Tape		
P	2/0/1978		110.8	(10.10)	-96.8	1	U.S. Geological Survey	Steel Tape		
P	3/0/1978		102.3	(8.50)	-88.3	1	U.S. Geological Survey	Steel Tape		
P	4/0/1978		101.8	(0.50)	-87.8	1	U.S. Geological Survey	Steel Tape		
P	5/0/1978		114.8	13.00	-100.8	1	U.S. Geological Survey	Steel Tape		
P	6/0/1978		111.5	(3.30)	-97.5	1	U.S. Geological Survey	Steel Tape		
P	7/0/1978		119.2	7.70	-105.2	1	Registered Water Well Driller	Electric Line		
P	8/0/1978		123.5	4.30	-109.5	1	Registered Water Well Driller	Electric Line		
P	9/0/1978		129.7	6.20	-115.7	1	Registered Water Well Driller	Electric Line		
P	10/0/1978		131.5	1.80	-117.5	1	Registered Water Well Driller	Electric Line		
P	11/0/1978		127	(4.50)	-113	1	Registered Water Well Driller	Electric Line		
P	12/0/1978		129.4	2.40	-115.4	1	U.S. Geological Survey	Steel Tape		
P	1/0/1979		121	(8.40)	-107	1	Registered Water Well Driller	Electric Line		
P	2/0/1979		120.3	(0.70)	-106.3	1	Registered Water Well Driller	Electric Line		
P	3/0/1979		117.2	(3.10)	-103.2	1	Registered Water Well Driller	Electric Line		
P	4/0/1979		118.8	1.60	-104.8	1	Registered Water Well Driller	Electric Line		
P	5/0/1979		120.1	1.30	-106.1	1	Registered Water Well Driller	Electric Line		
P	6/0/1979		122.5	2.40	-108.5	1	Registered Water Well Driller	Electric Line		
P	7/0/1979		121.7	(0.80)	-107.7	1	Registered Water Well Driller	Electric Line		
P	8/0/1979		122	0.30	-108	1	Registered Water Well Driller	Electric Line		
P	9/0/1979		127.4	5.40	-113.4	1	Registered Water Well Driller	Electric Line		
P	10/0/1979		119.3	(8.10)	-105.3	1	Registered Water Well Driller	Electric Line		
P	11/0/1979		116.7	(2.60)	-102.7	1	Registered Water Well Driller	Electric Line		
P	12/0/1979		113.5	(3.20)	-99.5	1	Registered Water Well Driller	Electric Line		
P	1/0/1980		113.2	(0.30)	-99.2	1	Registered Water Well Driller	Electric Line		
P	2/0/1980		111.8	(1.40)	-97.8	1	Registered Water Well Driller	Electric Line		
P	3/0/1980		105.5	(6.30)	-91.5	1	Registered Water Well Driller	Electric Line		
P	4/0/1980		104.1	(1.40)	-90.1	1	Registered Water Well Driller	Electric Line		
P	5/0/1980		110	5.90	-96	1	Registered Water Well Driller	Electric Line		
P	6/0/1980		110.3	0.30	-96.3	1	Registered Water Well Driller	Electric Line		
P	7/0/1980		116.2	5.90	-102.2	1	Registered Water Well Driller	Electric Line		
P	8/0/1980		121.5	5.30	-107.5	1	Registered Water Well Driller	Electric Line		
P	9/0/1980		125.4	3.90	-111.4	1	Registered Water Well Driller	Electric Line		
P	10/0/1980		125	(0.40)	-111	1	Registered Water Well Driller	Electric Line		
P	11/0/1980		124.6	(0.40)	-110.6	1	Registered Water Well Driller	Electric Line		
P	12/0/1980		119.7	(4.90)	-105.7	1	Registered Water Well Driller	Electric Line		
P	1/1/1981		106	(13.70)	-92	1	U.S. Geological Survey	Unknown		
P	2/1/1981		103.5	(2.50)	-89.5	1	U.S. Geological Survey	Unknown		
P	3/1/1981		108.7	5.20	-94.7	1	U.S. Geological Survey	Unknown		
P	4/1/1981		105.5	(3.20)	-91.5	1	U.S. Geological Survey	Unknown		
P	5/1/1981		104.6	(0.90)	-90.6	1	U.S. Geological Survey	Unknown		
P	6/1/1981		120.1	15.50	-106.1	1	U.S. Geological Survey	Unknown		

Texas Water Development Board (TWDB)
Groundwater Database (GWDB)
Well Information Report for State Well Number
81-05-602

Status Code	Date	Time	Water Level (ft. below land surface)	Change value in () indicates rise in level	Water Elevation (ft. above sea level)	Meas #	Measuring Agency	Method	Remark ID	Comments
P	7/1/1981		126.7	6.60	-112.7	1	U.S. Geological Survey	Unknown		
P	8/1/1981		126.9	0.20	-112.9	1	U.S. Geological Survey	Unknown		
P	9/1/1981		124.1	(2.80)	-110.1	1	U.S. Geological Survey	Unknown		
P	10/1/1981		121.9	(2.20)	-107.9	1	U.S. Geological Survey	Unknown		
P	11/1/1981		119.7	(2.20)	-105.7	1	U.S. Geological Survey	Unknown		
P	12/1/1981		110.2	(9.50)	-96.2	1	U.S. Geological Survey	Unknown		
P	1/1/1982		122.5	12.30	-108.5	1	U.S. Geological Survey	Unknown		
P	2/1/1982		116.5	(6.00)	-102.5	1	U.S. Geological Survey	Unknown		
P	3/1/1982		112	(4.50)	-98	1	U.S. Geological Survey	Unknown		
P	4/1/1982		111.3	(0.70)	-97.3	1	U.S. Geological Survey	Unknown		
P	6/1/1982		120.2	8.90	-106.2	1	U.S. Geological Survey	Unknown		
P	9/1/1982		122.8	2.60	-108.8	1	U.S. Geological Survey	Unknown		
P	12/1/1982		85.1	(37.70)	-71.1	1	U.S. Geological Survey	Unknown		
X	0/0/1992					1	U.S. Geological Survey		35	

Code Descriptions

Status Code	Status Description	Remark ID	Remark Description
P	Publishable	17	Measurement before well completion
Q	Questionable	35	Well removed from Water Level Program (no reason stated - outside source)
X	No Measurement		

Water Quality Analysis

Sample Date: 12/0/1953 Sample Time: 0000 Sample Number: 1 Collection Entity: Groundwater Conservation District (general)

Sampled Aquifer: Chicot Aquifer, Upper

Analyzed Lab: Misc. Industrial Lab

Reliability: Reliability unknown or not available

Collection Remarks: No Data

Parameter Code	Parameter Description	Flag	Value*	Units	Plus/Minus
00415	ALKALINITY, PHENOLPHTHALEIN (MG/L)		35.83	mg/L	
00410	ALKALINITY, TOTAL (MG/L AS CACO ₃)		486.3	mg/L as CACO 3	
00440	BICARBONATE ION, CALCULATED (MG/L AS HCO ₃)		506	mg/L	
00910	CALCIUM (MG/L)		26	mg/L	
00445	CARBONATE ION, CALCULATED (MG/L AS CO ₃)		43	mg/L	
00940	CHLORIDE, TOTAL (MG/L AS CL)		285	mg/L	
00900	HARDNESS, TOTAL, CALCULATED (MG/L AS CACO ₃)		155	mg/L as CACO 3	
01045	IRON, TOTAL (UG/L AS FE)	<	50	ug/L	
00920	MAGNESIUM (MG/L)		22	mg/L	
00400	PH (STANDARD UNITS), FIELD		8.1	SU	
71860	RESIDUAL SODIUM CARBONATE, CALCULATED		6.62		
00955	SILICA, DISSOLVED (MG/L AS SIO ₂)		16	mg/L as SIO ₂	
00931	SODIUM ADSORPTION RATIO, CALCULATED (SAR)		11.76		
00932	SODIUM, CALCULATED, PERCENT		82	PCT	
00929	SODIUM, TOTAL (MG/L AS NA)	calculated	337	mg/L	
00945	SULFATE, TOTAL (MG/L AS SO ₄)		1	mg/L as SO ₄	
70301	TOTAL DISSOLVED SOLIDS , SUM OF CONSTITUENTS (MG/L)		978	mg/L	

* Value may not display all significant digits for parameter in results, check Scanned Documents for laboratory paperwork..

GWDB DISCLAIMER: Except where noted, all of the information provided in the Texas Water Development Board (TWDB) Groundwater Database (<https://www.twdb.texas.gov/groundwater/data/gwdrpt.asp>) is believed to be accurate and reliable; however, the TWDB assumes no responsibility for any errors appearing in rules or otherwise. Further, TWDB assumes no responsibility for the use of the information provided. PLEASE NOTE that users of these data are responsible for checking the accuracy, completeness, currency and/or suitability of all information themselves. TWDB makes no guarantees or warranties as to the accuracy, completeness, currency, or suitability of the information provided via the Groundwater Database (GWDB). TWDB specifically disclaims any and all liability for any claims or damages that may result from providing GWDB data or the information it contains. For additional information or answers to questions concerning the TWDB GWDB, contact the Groundwater Data Team at GroundwaterData@twdb.texas.gov.

U. S. DEPT. OF THE INTERIOR

WELL SCHEDULE

GEOLOGICAL SURVEY

WATER RESOURCES DIVISION

MASTER CARD

Record by W. SANDEEN Source of data DOW RECORDS Date 7-26-67 Map FREEPORT, 1963

State TEXAS County 419 County (or town) BROWNSVILLE Sequential number BH
 Latitude 21 35' 6" N Longitude 95 15' 2" W Sequential number 1
 Lat-long accuracy 1 deg 7 min 8 sec N 12 degrees 13 min 18 sec W
 Local well number BH 81 05601 Other number B & M
 Local use Owner or name: DOW CHEMICAL COMPANY
 Owner or name: DOW CHEMICAL COMPANY Address: FREEPORT, TEXAS

(C) (F) (M) (N) (P) (S) (W) Ownership: County, Fed Govt, City, Corp or Co., Private, State Agency, Water Dist N
 (A) (B) (C) (D) (E) (F) (H) (I) (M) (N) (P) (R) Use of Air cond, Bottling, Comm, Devater, Power, Fire, Dom, Irr, Ind, P & S, Rec, water: (S) (T) (U) (V) (W) (X) (Y) (Z) Stock, Instru, Unused, Repressure, Recharge, Diesel-P & S, Diesel-other, Other U
 Use of (A) (B) (C) (D) (E) (F) (G) (H) (I) (M) (N) (O) (P) (R) (S) (T) (U) (V) (X) (Y) (Z) well: Anode, Drain, Seismic, Heat Res, Obs, Oil-gas, Recharge, Test, Unused, Withdraw, Waste, Destroyed O

DATA AVAILABLE: Well date Freq. W/L meas.: RPT, 1963 C Field aquifer char. 73
 Hyd. lab. data: 73
 Qual. water data: type: P
 Freq. sampling: RPT DEC 1953 Pumpage inventory: yes period: 74
 Aperture cards: 75
 Log data: D/E 76 77

WELL-DESCRIPTION CARD

SAME AS ON MASTER CARD Depth well: 246 ft 246 Meas. 73 Dept. 74 6
 Depth cased: 226 ft 1226 Casing type: STEEL Diam. 2 in 29 30
 Finish: porous gravel w. gravel w. horiz. open perf. screen, pt., shored, open hole, (B) concrete, (perf.), (screen), gallery, end, S
 Method: (A) (B) (C) (D) (E) (F) (G) (H) (I) (M) (N) (O) (P) (R) other
 Drilled: air bored, cable, dug hyd. jetted, air reverse trenching, driven, drive rot. percussion, rotary, wash, other H
 Date: 12-21-53 Drilled: 9/5/3 Pump intake setting: N on E ft 36 34

Driller: LAYNE TEXAS Name: address: Deep 75 Shallow 76
 Lift: (A) (B) (C) (J) (L) (M) (N) (P) (R) (S) (T) (U) (V) (W) (B) (S)
 (type): air, bucket, cent, jet, multiple, multiple, none, piston, rot, submers, turb, other IV
 Power: net LP Trans. or
 (type): diesel, elec, gas, gasoline, hand, gas, wind; H.P. NONE meter no.
 Descrip. MP 3.0 ft above LSD Alt. MP

Alt. LSD: 141 14 Accuracy: 5' TOP 47 3
 Water Level: 160.5 ft above LSD 161 Accuracy: TAPE BY DOW. 52 A
 Date: 1-29-67 Yield: 50 60 Method determined 51
 meas: 1-6-7 1-6-7 50 60
 Drawdown: ft Accuracy: Pumping period hrs 52 60
 QUALITY OF WATER DATA: Iron 50 50 Chloride 50 50 Hard. 52 50
 Sp. Conduct. x 10⁶ 50 Temp. 50 50 Date sampled 52 50
 Tests, color, etc.

Latitude-longitude N
d d d S S S S**HYDROGEOLOGIC CARD**

SAME AS ON MASTER CARD	Physiographic Province:	Section:
<input type="checkbox"/>	Drainage Basin:	Subbasin:
19	20 21	22
23	24 25	26
(D) depression, stream channel, dunes	(E) flat, hilltop, sink, swamp,	(H) (K) (L)
well site: (G) offshore, pediment, hillside, terrace, undulating, valley flat	(P) (S) (T) (U) (V)	27
MAJOR AQUIFER: System Series Aquifer, formation, group		
Lithology:	Length of well open to:	Origin: Depth to top off: Thickness: ft
33 34	16 ft	30 34 226 ft 22 23
MINOR AQUIFER: System Series Aquifer, formation, group		
Lithology:	Length of well open to:	Origin: Depth to top off: Thickness: ft
31 32	ft	33 34 35 36 37 ft 38 39
Intervals Screened:	226 - 236;	
Depth to consolidated rock:	ft	40 41 42 Source of data: 44
Depth to basement:	ft	43 44 45 Source of data: 46
Surficial material:	years	Infiltration characteristics: 47
Coefficient Trans:	ft ⁻¹	Coefficient Storage: 48 49
Coefficient Perme:	ft ⁻²	mm/ft; Number of geologic cards: 50

DRILLERS LOG

0-2 2 SURFACE
 2-21 19 RED & GRAY CLAY
 21-36 15 GRAY CLAY
 36-50 14 BROWN SAND
 50-122 72 BLUE CLAY
 122-130 8 BROWN CLAY
 130-143 13 SAND
 143-220 77 SAND, SHELL AND CLAY
 220-238 18 SAND
 238-257 19 BROWN CLAY

43	44	45	46
47	48	49	50
51	52	53	54
55	56	57	58
59	60	61	62

TEXAS WATER DEVELOPMENT BOARD

REPORT 163

GROUND-WATER RESOURCES OF
BRAZORIA COUNTY, TEXAS

By

William M. Sandeen and John B. Wesselman
United States Geological Survey

This report was prepared by the U.S. Geological Survey
under cooperative agreement with the
Texas Water Development Board

February 1973

Reprinted by the Texas Department of Water Resources

December 1982

81-05-602

Table 7.--Records of Wells and Springs in Brazoria County and Adjacent Areas--Continued

WELL NO.	OWNER	DRILLER	DATE COMPLETED	DEPTH OF WELL (FT.)	DIAMETER (IN.)	GAGING DEPTH (FT.)	WATER-BEARING UNITS	ALTITUDE ABOVE (4) OR BELOW LAND SURFACE (FT.)	WATER LEVEL ABOVE (4) OR BELOW LAND SURFACE (FT.)	DATE OF MEASUREMENT	METHOD OF LIFT	REMARKS		
Brazoria County														
BH-R-102-307	Dow Chemical Co.	Layne Texas Co.	1942	225	16, 8	225	CU	7	13, 57, 4	Feb., July	T, E	Ind	Screen from 201 to 223 ft. 1/	
308	do.	do.	1943	233	--	233	CU	8	59	June	1943	N	Screen from 207 to 236 ft. Reported pumping level 71 ft. at 145 gpm June 6, 1943. Well destroyed. 1/	
309	do.	do.	1943	230	--	230	CU	8	48	do.	N	N	Screen from 174 to 186 and 227 ft. Pumping level 59 ft. at 150 gpm June 1943. 1/	
J12	Dow Chemical Co.	do.	1942	249	16	249	CU	9	27	Jan.	1942	T, E	Ind	Screen from 213 to 248 ft. Reported yield 455 gpm Jan. 1942. 1/
314	Dow Chemical Co.	do.	1942	237	--	237	CU	9	--	--	N	N	Screen from 179 to 195 ft.	
315	Dow Chemical Co.	do.	1950	1,146	20	CL	8	27.8	July 11, 1967	T, E	Ind	Test hole drilled to 1,150 ft. Screen from 977 to 1,127 ft. 1/		
316	Dow Chemical Co.	do.	1943	236	10	236	CU	9	48	May	1943	T, E	Ind	Screen from 203 to 233 ft. Reported pumping level 53 ft at 145 gpm, May 1946. 1/
317	Dow Chemical Co.	do.	1942	1,065	12	924	CL	9	+ 4, 254 26.6	July 2, 1942 Oct. 3, 1967 Oct. 4, 1967	N	N	Screen from 928 to 1,061 ft. Test hole drilled to 1,238 ft. Reported pumping level 30 ft. at 800 gpm, July 1942. 1/	
318	Dow Chemical Co.	do.	1942	1,065	12	924	CL	9	25.3	Oct.	3, 1967	N	Screen from 924 to 1,056 ft. Reported pumping level 30 ft. at 800 gpm, July 1942. 1/	
319	Dow Chemical Co.	do.	1966	234	10	234	CU	8	58.6	July 11, 1967	T	Ind	Screen from 207 to 234 ft.	
601	Dow Chemical Co.	do.	1950	248	16	248	CU	15	140.5	Dec.	30, 1966	N	Screen from 208 to 232 ft. Reported pumping level 176 ft. at 465 gpm, June 1967.	
#	602 Dow Chemical Co. Obs. Well 13	do.	1953	246	2	246	CU	16	119.5 160.5	Dec. 18, 1953 Jan. 29, 1967	N	N	Screen from 226 to 236 ft. Observation well. Test hole to 257 ft. 1/3	
603	Dow Chemical Co.	do.	1940	252	12	213	CU	15	22	May	1940	N	Screen from 226 to 246 ft. Test hole drilled to 256 ft. 1/	
604	Dow Chemical Co.	do.	1940	253	13	253	CU	15	28	June	1940	N	Well destroyed. Reported pumping level 62 ft at 425 gpm, June 1940. 1/	

See footnotes at end of table.

Table 8.—Drillers' Logs of Wells in Brazoria County—Continued

	THICKNESS (FEET)	DEPTH (FEET)		THICKNESS (FEET)	DEPTH (FEET)
Well BH-81-05-318					
Owner: Dow Chemical Co. Driller: Layne-Texas Co.			Muck	23	25
Surface material	6	6	Clay	9	34
Clay, sandy clay, sand breaks	97	103	Sand, fine-grained	10	44
Sand, clay breaks	20	123	Clay and streaks of sand	47	91
Clay, some sandy sandy breaks	81	204	Clay, blue	11	102
Sand, good water	31	235	Sand, fine-grained	12	114
Clay	30	265	Clay, red	7	121
Sand, fine-grained and shale breaks	24	289	Sand, fine-grained brown	26	147
Shale and some sandy breaks	236	525	Clay	74	221
Sand	16	541	Sand, coarse-grained and gravel	27	248
Shale	25	566	Clay, tough	6	254
Sand, shale	40	606	Well BH-81-05-604		
Shale, some sandy breaks	184	790	Owner: Dow Chemical Co. Well 7 Driller: Layne-Texas Co.		
Sand and shale	60	850			
Shale	33	883	Fill and muck	12	12
Sand	4	887	Clay	11	23
Shale, tough	110	997	Clay and streaks of sand	27	50
Shale and sandy shale	14	1,011	Sand, fine-grained	5	55
Sand (good, top part fine-grained)	49	1,060	Clay, soft	19	74
Shale	5	1,065	Sand, fine-grained blue	12	86
			Clay	23	109
Well BH-81-05-602					
Owner: Dow Chemical Co. Obs. Well 13 Driller: Layne-Texas Co.			Clay and sand	46	155
Surface	2	2	Sand, white	20	175
Clay, red and gray	19	21	Clay	40	215
Clay, gray	15	36	Sand, coarse-grained and gravel	32	247
Sand, brown	14	50	Clay	6	253
Clay, blue	72	122	Well BH-81-05-605		
Clay, brown	8	130	Owner: Dow Chemical Co. Well 14 Driller: Layne-Texas Co.		
Sand	13	143	Clay, surface material	15	15
Sand, shell and clay	77	220	Clay	25	40
Sand	18	238	Sand, red	18	58
Clay, brown	19	257	Clay	21	79
			Clay, sandy	20	99
Well BH-81-05-603					
Owner: Dow Chemical Co. Well 6 Driller: Layne-Texas Co.			Sand	10	109
Surface soil	2	2	Clay	9	118
			Sand, red	5	123

Table 9.—Water Levels in Wells in Brazoria County—Continued

	DATE	WATER LEVEL (FT)		DATE	WATER LEVEL (FT)		DATE	WATER LEVEL (FT)
Well BH-81-04-701—Continued								
Aug.	6, 1957	12.50	Sept.	10, 1954	131.2	Nov.	1957	131.4
Feb.	4, 1958	17.0	Oct.	8, 1954	132.4	Dec.	1957	129.5
Well BH-81-04-702								
Owner: J. L. Ducroz			Dec.	3, 1954	130.1	Feb.	28, 1958	126.2
May	18, 1937	+ 3.78	Jan.	13, 1955	134.2	Mar.	1958	119.1
Jan.	6, 1949	19.74	Feb.	4, 1955	132.3	Apr.	1958	124.2
Jan.	19, 1950	21.56	Mar.	8, 1955	134.8	May	1958	120.6
Aug.	23, 1950	23.34	Apr.	7, 1955	124.4	June	1958	130.6
Jan.	26, 1951	23.45	May	10, 1955	127.1	July	1958	134.1
Aug.	21, 1951	24.09	June	8, 1955	142.2	Sept.	1958	131.4
Jan.	9, 1952	21.48	July	13, 1955	145.8	Jan.	1959	119.4
Aug.	12, 1952	21.78	Aug.	11, 1955	159.9	Sept.	1959	123.4
Jan.	13, 1953	21.46	Sept.	9, 1955	155.7	Jan.	1960	115.5
July	28, 1953	22.10	Oct.	4, 1955	174.6	Sept.	1960	123.2
Jan.	26, 1956	31.12	Nov.	4, 1955	182.8	Jan.	1961	103.3
Well BH-81-04-803								
Owner: T. J. Poole			Dec.	8, 1955	184.2	Feb.	1961	102.3
Jan.	6, 1949	3.22	Jan.	18, 1956	180.5	Mar.	1961	103.6
Aug.	23, 1949	9.05	Feb.	7, 1956	165.5	Apr.	1961	108.2
Jan.	19, 1950	2.28	Mar.	2, 1956	158.3	May	1961	111.2
Aug.	23, 1950	1.59	Apr.	4, 1956	145.1	June	30, 1961	108.0
Jan.	26, 1951	3.36	May	1, 1956	136.1	July	27, 1961	104.6
Aug.	21, 1951	4.30	June	6, 1956	141.8	Aug.	1961	106.3
Jan.	9, 1952	4.09	July	30, 1956	141.9	Oct.	1961	102.7
July	28, 1953	5.34	Sept.	5, 1956	149.5	Nov.	1961	98.0
Well BH-81-05-602								
Owner: Dow Chemical Co. Obs. Well 13			Dec.	5, 1956	151.7	Dec.	1961	95.5
Dec.	18, 1953	119.50	Jan.	4, 1957	148.4	Jan.	1962	101.6
Jan.	4, 1954	121.0	Feb.	4, 1957	146.3	Feb.	1962	99.4
Jan.	18, 1954	118.9	Mar.	4, 1957	163.5	Mar.	1962	98.8
Jan.	25, 1954	117.7	Apr.	3, 1957	154.2	Apr.	1962	95.8
Feb.	3, 1954	122.9	Apr.	26, 1957	152.3	May	1962	109.5
May	4, 1954	125.01	June	4, 1957	154.5	June	1962	117.2
May	31, 1954	130.1	July	2, 1957	152.0	July	1962	128.3
July	9, 1954	138.8	Aug.	1, 1957	150.0	Aug.	29, 1962	125.6
Aug.	9, 1954	135.24	Sept.	1957	147.3	Sept.	27, 1962	121.6
			Oct.	1957	138.4	Oct.	25, 1962	122.4
					131.4	Nov.	27, 1962	116.8

GWDB Reports and Downloads

Well Basic Details

Scanned Documents

State Well Number	8105607	Well Type	Observation
County	Brazoria	Well Use	Unused
River Basin	Brazos	Water Level Observation	None
Groundwater Management Area	14	Water Quality Available	No
Regional Water Planning Area	H - Region H	Pump	None
Groundwater Conservation District	Brazoria County GCD	Pump Depth (feet below land surface)	
Latitude (decimal degrees)	28.932778	Power Type	
Latitude (degrees minutes seconds)	28° 55' 58" N	Annular Seal Method	
Longitude (decimal degrees)	-95.381111	Surface Completion	
Longitude (degrees minutes seconds)	095° 22' 52" W	Owner	Dow Chemical Co. obs #5
Coordinate Source	+/- 5 Seconds	Driller	Layne Texas Co.
Aquifer Code	112CHCTU - Chicot Aquifer, Upper	Other Data Available	Electric Log
Aquifer	Gulf Coast	Well Report Tracking Number	
Aquifer Pick Method		Plugging Report Tracking Number	
Land Surface Elevation (feet above sea level)	15	U.S. Geological Survey Site Number	
Land Surface Elevation Method	Interpolated From Topo Map	Texas Commission on Environmental Quality Source Id	
Well Depth (feet below land surface)	281	Groundwater Conservation District Well Number	
Well Depth Source	Owner	Owner Well Number	
Drilling Start Date		Other Well Number	
Drilling End Date	11/25/1953	Previous State Well Number	
Drilling Method	Mud (Hydraulic) Rotary	Reporting Agency	U.S. Geological Survey
Borehole Completion		Created Date	12/10/1997
		Last Update Date	12/10/1997

Remarks well #5. Not completed.

Casing - No Data

Well Tests - No Data

Lithology - No Data

Annular Seal Range - No Data

Borehole - No Data

Plugged Back - No Data

Filter Pack - No Data

Packers - No Data

Water Level Measurements

No Data Available

Water Quality Analysis - No Data Available

GWDB DISCLAIMER: Except where noted, all of the information provided in the Texas Water Development Board (TWDB) Groundwater Database (<https://www.twdb.texas.gov/groundwater/data/gwdb rpt.asp>) is believed to be accurate and reliable; however, the TWDB assumes no responsibility for any errors appearing in rules or otherwise. Further, TWDB assumes no responsibility for the use of the information provided. PLEASE NOTE that users of these data are responsible for checking the accuracy, completeness, currency and/or suitability of all information themselves. TWDB makes no guarantees or warranties as to the accuracy, completeness, currency, or suitability of the information provided via the Groundwater Database (GWDB). TWDB specifically disclaims any and all liability for any claims or damages that may result from providing GWDB data or the information it contains. For additional information or answers to questions concerning the TWDB GWDB, contact the Groundwater Data Team at GroundwaterData@twdb.texas.gov.

Latitude-longitude

d N S E W

HYDROGEOLOGIC CARD

SAME AS ON MASTER CARD

Physiographic
Province:

6:3

Section:

Drainage
Basin:

17 18

Subbasin:

26

(D) (C) (E) (F) (R) (U) (L)
 Topo of depression, stream channel, dunes, flat, hilltop, sink, swamp,
 well site: (G) (P) (S) (T) (U) (V)

offshore, pediment, hillside, terrace, undulating, valley flat

27 F

MAJOR

AQUIFER:

Q G

C H

Lithology:

series

28 29

aquifer, formation, group

30 31

32

AQUIFER

Thickness:

ft

MINOR

AQUIFER:

system

series

44 45

aquifer, formation, group

46 47

Lithology:

series

48 49

aquifer, formation, group

48 49

Length of

well open to:

50 51

Depth to

52

ft

33 34

35 36

top of:

37 38

41 42

Intervals

Screened:

- 0 - WELL ABANDONED NA

Depth to

consolidated rock:

53 54

ft

55 56

64 65

Source of data:

Depth to

basement:

57 58

ft

59 60

66 67

Source of data:

Surficial

material:

61 62

Infiltration

characteristics:

68 69

Coefficient

trans:

63 64

Coefficient

70 71

76 77

Storage:

Coefficient

Perm:

65 66

2

73 74

78 79

spd/ft; Spec cap:

67 68

spd/ft; Number of geologic cards:

75 76

79

DALS LOG

0-10 10 FILL
 10-39 29 YELLOW & GRAY CLAY
 39-50 11 RED CLAY
 50-156 106 BLUE CLAY
 156-163 7 SAND & SHELL
 163-274 111 BLUE CLAY
 274-281 7 CLAY

No well data for well #66819

Attachment 11

Soil Map



United States
Department of
Agriculture



Natural
Resources
Conservation
Service

A product of the National Cooperative Soil Survey, a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local participants

Custom Soil Resource Report for Brazoria County, Texas



Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface.....	2
How Soil Surveys Are Made.....	5
Soil Map.....	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Brazoria County, Texas.....	13
43—Surfside clay, 0 to 1 percent slopes, occasionally flooded.....	13
References.....	15

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and


Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report
Soil Map

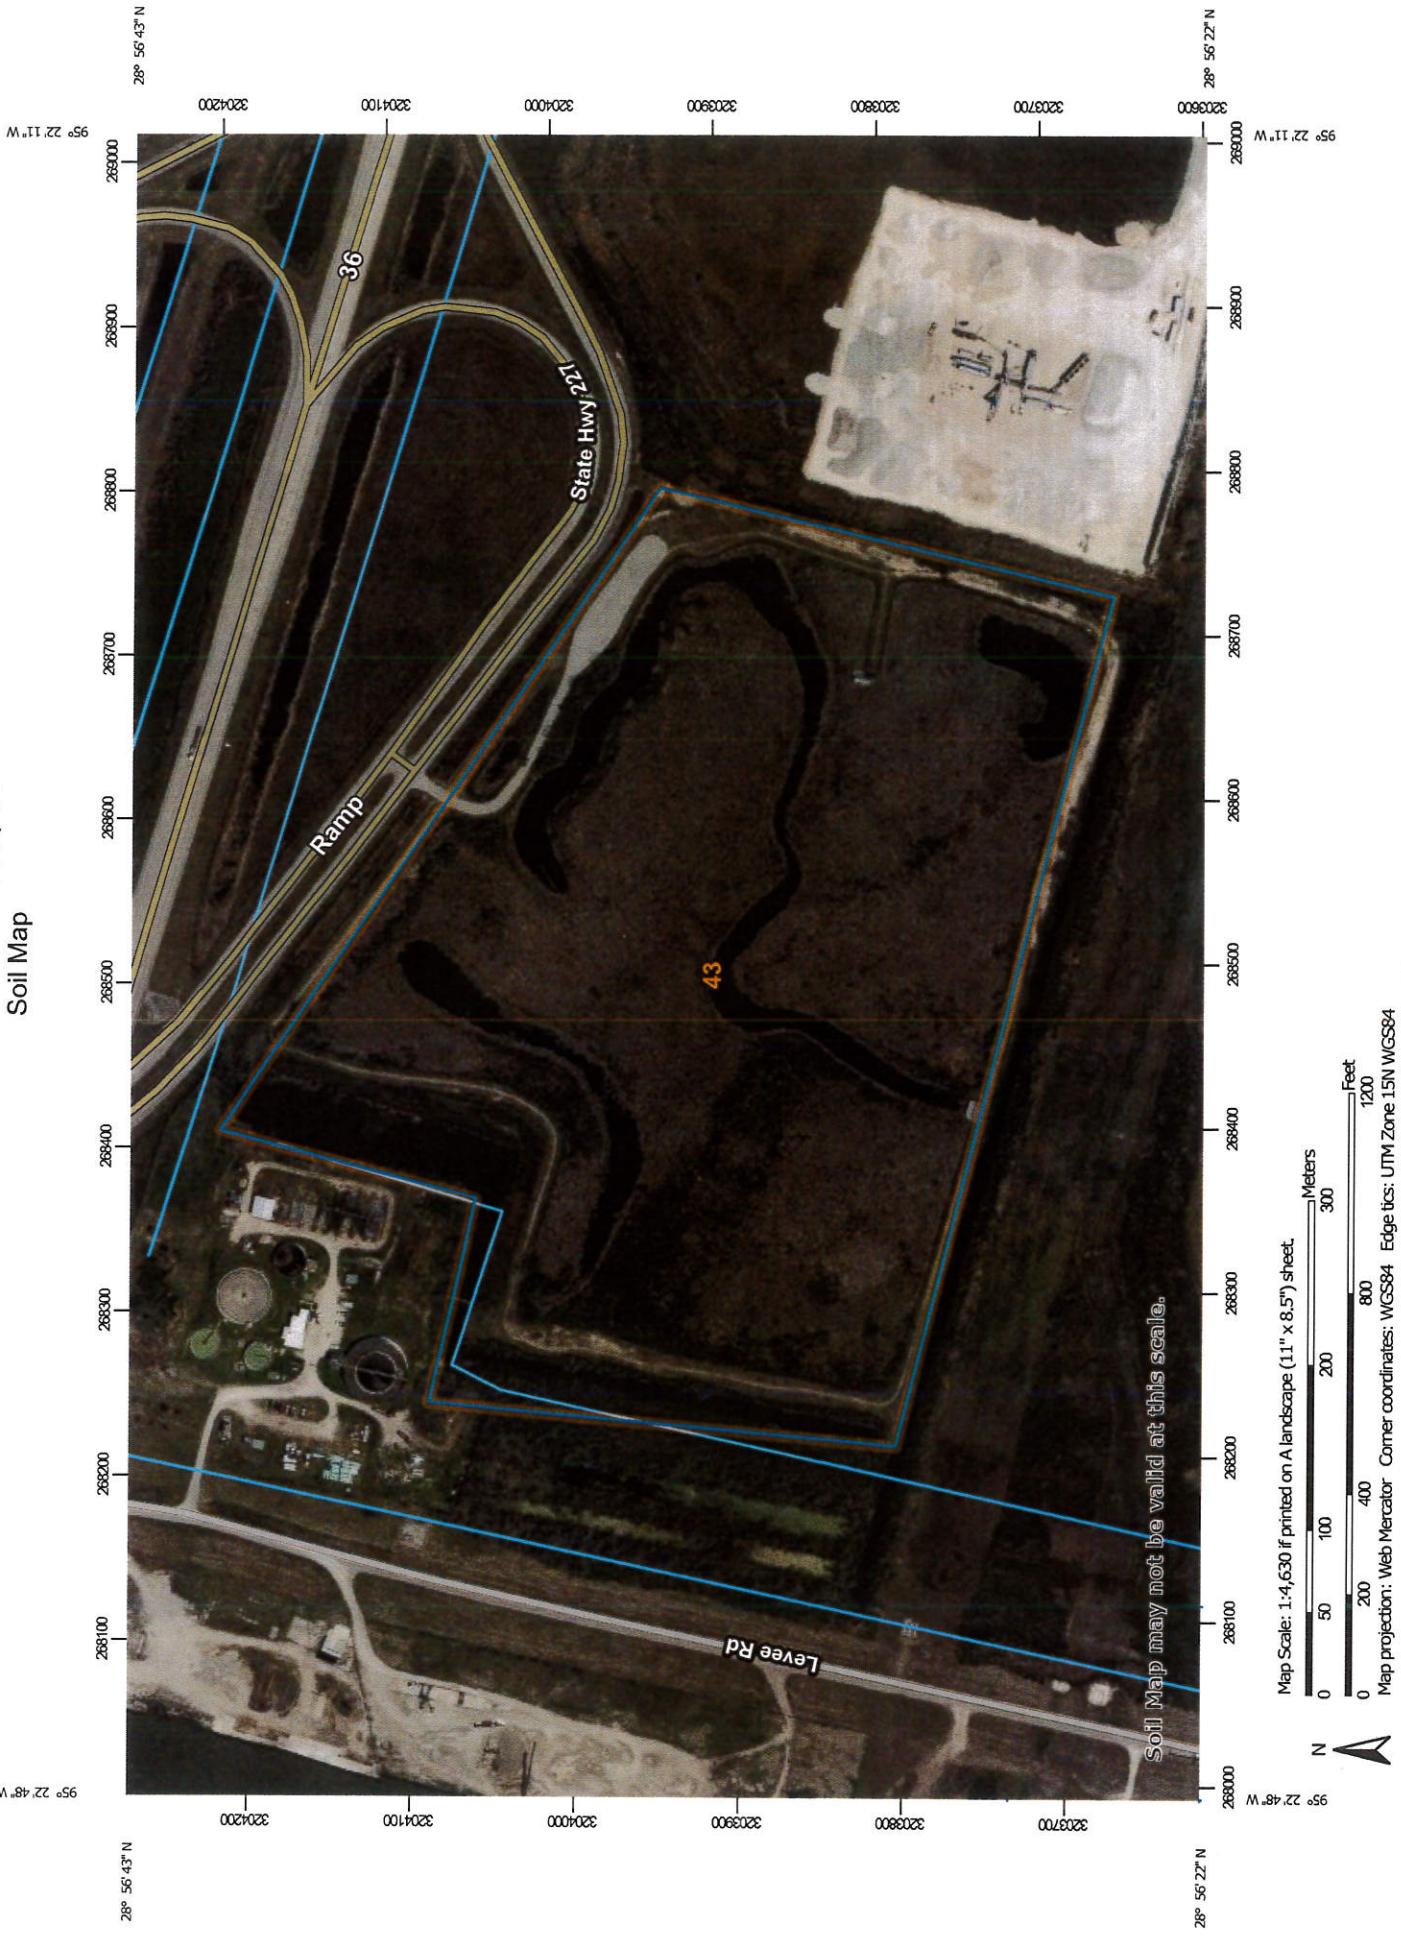

MAP LEGEND

Area of Interest (AOI)		Spoil Area
Soils		Stony Spot
		Very Stony Spot
		Wet Spot
		Other
Special Point Features		Special Line Features
Blowout		Water Features
Borrow Pit		Streams and Canals
Clay Spot		Transportation
Closed Depression		Rails
Gravel Pit		Interstate Highways
Gravelly Spot		US Routes
Landfill		Major Roads
Lava Flow		Local Roads
Marsh or swamp		Background
Mine or Quarry		Aerial Photography
Miscellaneous Water		
Perennial Water		
Rock Outcrop		
Saline Spot		
Sandy Spot		
Severely Eroded Spot		
Sinkhole		
Slide or Slip		
Sodic Spot		

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:20,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Brazoria County, Texas
Survey Area Data: Version 22, Aug 30, 2024

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Mar 20, 2022—Mar 25, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
43	Surfside clay, 0 to 1 percent slopes, occasionally flooded	48.2	100.0%
Totals for Area of Interest		48.2	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Custom Soil Resource Report

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Brazoria County, Texas

43—Surfside clay, 0 to 1 percent slopes, occasionally flooded

Map Unit Setting

National map unit symbol: 2vv3t
Elevation: 0 to 10 feet
Mean annual precipitation: 40 to 60 inches
Mean annual air temperature: 69 to 72 degrees F
Frost-free period: 275 to 300 days
Farmland classification: Not prime farmland

Map Unit Composition

Surfside and similar soils: 90 percent
Minor components: 10 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Surfside

Setting

Landform: Flood plains
Landform position (three-dimensional): Dip
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Calcareous holocene age saline clayey alluvium derived from igneous, metamorphic and sedimentary rock

Typical profile

Ag1 - 0 to 14 inches: clay
Ag2 - 14 to 32 inches: clay
Bg - 32 to 80 inches: clay

Properties and qualities

Slope: 0 to 1 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Very poorly drained
Runoff class: High
Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.06 in/hr)
Depth to water table: About 0 inches
Frequency of flooding: Occasional
Frequency of ponding: None
Calcium carbonate, maximum content: 10 percent
Maximum salinity: Strongly saline (16.0 to 32.0 mmhos/cm)
Sodium adsorption ratio, maximum: 40.0
Available water supply, 0 to 60 inches: Low (about 4.2 inches)

Interpretive groups

Land capability classification (irrigated): 6s
Land capability classification (nonirrigated): 6s
Hydrologic Soil Group: D
Ecological site: R150BY551TX - Salty Prairie
Hydric soil rating: Yes

Minor Components

Velasco

Percent of map unit: 5 percent
Landform: Flood plains
Landform position (three-dimensional): Dip
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R150BY550TX - Northern Salt Marsh
Hydric soil rating: Yes

Veston

Percent of map unit: 4 percent
Landform: Barrier flats
Landform position (three-dimensional): Talf
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R150BY550TX - Northern Salt Marsh
Hydric soil rating: Yes

Ijam

Percent of map unit: 1 percent
Landform: Flats
Landform position (three-dimensional): Rise
Down-slope shape: Linear
Across-slope shape: Convex
Ecological site: R151XY673TX - INTERMEDIATE Firm MARSH
Hydric soil rating: Yes

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

Attachment 12

Lab Reports



130 S. Trade Center Parkway, Conroe TX 77385

Tel: (936) 321-6060

Email: lab@nwdl.com

www. NWDLs.com

September 23, 2024

Laboratory Report

Jerry Meeks Jr.

Veolia Water

931 E Floodgate Rd

Freeport, TX 77541

Report ID: 20240923104719JKW

The following test results meet all NELAP requirements for analytes for which certification is available. Any deviations from our quality system will be noted in the case narrative. All analyses performed by North Water District Laboratory Services, Inc. unless noted.

For questions regarding this report, contact Monica Martin at 936-321-6060.

Sincerely,

A handwritten signature in black ink, appearing to read "Justin W".

Justin Wood For Aundra Noe

Project Manager



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwdfs.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results

Client Sample ID: Outfall 001 Sample Matrix: Waste Water
Lab Sample ID: 24F3396-01 Date Collected: 06/27/2024 8:10
Veolia Water - Permit Renewal Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

General Chemistry

SM 4500-CN ⁻ G	Amenable Cyanide	A	<10.0U	ug/L	1	5.00	10.0	BHG0858	07/08/2024 14:48	TBB
SM 4500-CN ⁻ C	Total Cyanide	A	<10.0U	ug/L	1	5.00	10.0	BHG0858	07/08/2024 14:48	TBB
EPA 1664A	n-Hexane Extractable Material (O&G)	A	<5.00U	mg/L	1	5.00	5.00	BHG0933	07/09/2024 09:17	IDC

Field

Hach 10360	DO Field	N	6.08	mg/L	1	1.00	1.00	BHG0142	06/27/2024 08:10	AEN
Calc	Flow Field	N	0.790	MGD	1	0.00	0.00	BHG0142	06/27/2024 08:10	AEN
SM 4500-H+ B	pH	A	7.34	pH Units @ 25 °C	1	1.00	1.00	BHG0142	06/27/2024 08:10	AEN

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler Sample Matrix: Waste Water
Lab Sample ID: 24F3396-02 Date Collected: 06/27/2024 8:10
Veolia Water - Permit Renewal Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	RLR	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Semivolatile Organic Compounds by GCMS

ASTM D7065	Surrogate: n-NP-surr		54.0% S	60-140					06/29/2024 04:46	
EPA 625.1	1,2,4,5-Tetrachlorobenzene	A	<10.0U	ug/L	1	0.0760	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	1,2,4-Trichlorobenzene	A	<10.0U	ug/L	1	0.0943	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	1,2-Diphenylhydrazine	A	<20.0U	ug/L	1	0.250	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,2'-Oxybis(1-chloropropane), bis(2-Chloro-1-methyl	A	<10.0U	ug/L	1	0.129	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,4,5-Trichlorophenol	A	<10.0U	ug/L	1	0.210	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,4,6-Trichlorophenol	A	<10.0U	ug/L	1	0.385	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,4-Dichlorophenol	A	<10.0U	ug/L	1	0.256	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,4-Dimethylphenol	A	<10.0U	ug/L	1	0.294	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,4-Dinitrophenol	A	<50.0U	ug/L	1	2.85	50.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,4-Dinitrotoluene (2,4-DNT)	A	<10.0U	ug/L	1	0.0530	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2,6-Dinitrotoluene (2,6-DNT)	A	<10.0U	ug/L	1	0.584	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2-Chloronaphthalene	A	<10.0U	ug/L	1	0.123	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2-Chlorophenol	A	<10.0U	ug/L	1	0.147	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2-Methyl-4,6-dinitrophenol (4,6-Dinitro-2-methylph	A	<50.0U	ug/L	1	0.511	50.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	2-Nitrophenol	A	<20.0U	ug/L	1	0.218	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	3,4-Methylphenol	A	<10.0U	ug/L	1	0.462	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	4-Bromophenyl phenyl ether (BDE-3)	A	<10.0U	ug/L	1	0.0682	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	4-Chloro-3-methylphenol	A	<10.0U	ug/L	1	0.218	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	4-Chlorophenyl phenylether	A	<10.0U	ug/L	1	0.207	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	4-Nitrophenol	A	<50.0U	ug/L	1	2.40	50.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Acenaphthene	A	<10.0U	ug/L	1	0.0776	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Acenaphthylene	A	<10.0U	ug/L	1	0.0594	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Anthracene	A	<10.0U	ug/L	1	0.0532	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Benzo(a)anthracene	A	<5.00U	ug/L	1	0.0738	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Benzo(a)pyrene	A	<5.00U	ug/L	1	0.143	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	benzo(b&k)fluoranthene	A	<5.00U	ug/L	1	0.118	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Benzo(g,h,i)perylene	A	<20.0U	ug/L	1	0.112	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	bis(2-Chloroethoxy)methane	A	<10.0U	ug/L	1	0.112	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	bis(2-Chloroethyl) ether	A	<10.0U	ug/L	1	0.184	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Bis(2-ethylhexyl)phthalate	A	<10.0U	ug/L	1	0.500	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Butyl benzyl phthalate	A	<10.0U	ug/L	1	0.123	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Chrysene	A	<5.00U	ug/L	1	0.0573	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Dibenzo(a,h)anthracene	A	<5.00U	ug/L	1	0.152	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Diethyl phthalate	A	<10.0U	ug/L	1	0.150	10.0	BHG0031	07/03/2024 01:26	KRB

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
 931 E Floodgate Rd
 Freeport, TX 77541

Reported:
 09/23/2024 10:47

Sample Results
 (Continued)

Client Sample ID: Outfall 001 Sampler (Continued) Sample Matrix: Waste Water
 Lab Sample ID: 24F3396-02 Date Collected: 06/27/2024 8:10
 Veolia Water - Permit Renewal Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	RL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	----	-------	----------	---------

Semivolatile Organic Compounds by GCMS (Continued)

EPA 625.1	Dimethyl phthalate	A	<10.0U	ug/L	1	0.0869	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Di-n-butyl phthalate	A	<10.0U	ug/L	1	0.505	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Di-n-octyl phthalate	A	<10.0U	ug/L	1	0.163	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Fluoranthene	A	<10.0U	ug/L	1	0.0676	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Fluorene	A	<10.0U	ug/L	1	0.0589	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Hexachlorobenzene	A	<5.00U	ug/L	1	0.0629	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Hexachlorobutadiene	A	<10.0U	ug/L	1	0.0697	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Hexachloroethane	A	<20.0U	ug/L	1	0.0644	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Hexachlorophene	A	<10.0U	ug/L	1	0.343	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Indeno(1,2,3-cd) pyrene	A	<5.00U	ug/L	1	0.126	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Isophorone	A	<10.0U	ug/L	1	0.0853	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Naphthalene	A	<10.0U	ug/L	1	0.0742	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Nitrobenzene	A	<10.0U	ug/L	1	0.118	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	n-Nitrosodiethylamine	A	<20.0U	ug/L	1	0.162	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	n-Nitroso-di-n-butylamine	A	<20.0U	ug/L	1	1.87	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	n-Nitrosodi-n-propylamine	A	<20.0U	ug/L	1	0.445	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	n-Nitrosodiphenylamine	A	<20.0U	ug/L	1	0.0609	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Pentachlorobenzene	A	<20.0U	ug/L	1	0.0514	20.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Pentachlorophenol	A	<5.00U	ug/L	1	0.437	5.00	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Phenanthrene	A	<10.0U	ug/L	1	0.0816	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Phenol, Total	A	<10.0U	ug/L	1	0.470	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Pyrene	A	<10.0U	ug/L	1	0.0848	10.0	BHG0031	07/03/2024 01:26	KRB
EPA 625.1	Pyridine	A	<20.0U	ug/L	1	4.40	20.0	BHG0031	07/03/2024 01:26	KRB
<i>EPA 625.1</i>	<i>Surrogate: 2,4,6-Tribromophenol-surr</i>		<i>106%</i>		<i>33.6-139</i>				<i>07/03/2024 01:26</i>	
<i>EPA 625.1</i>	<i>Surrogate: 2-Fluorobiphenyl-surr</i>		<i>93.4%</i>		<i>32.2-138</i>				<i>07/03/2024 01:26</i>	
<i>EPA 625.1</i>	<i>Surrogate: 2-Fluorophenol-surr</i>		<i>117%</i>		<i>32.7-137</i>				<i>07/03/2024 01:26</i>	
<i>EPA 625.1</i>	<i>Surrogate: Nitrobenzene-d5-surr</i>		<i>109%</i>		<i>31.2-136</i>				<i>07/03/2024 01:26</i>	
<i>EPA 625.1</i>	<i>Surrogate: Phenol-d5-surr</i>		<i>92.9%</i>		<i>28.9-155</i>				<i>07/03/2024 01:26</i>	
<i>EPA 625.1</i>	<i>Surrogate: p-Terphenyl-d14-surr</i>		<i>89.8%</i>		<i>37.6-117</i>				<i>07/03/2024 01:26</i>	

Organics by GC

SM 6640 B	2,4-D	A	<0.700U	ug/L	2	0.234	0.700	BHG0419	07/18/2024 10:04	cdg
SM 6640 B	Silvex (2,4,5-TP)	A	<0.300U	ug/L	2	0.236	0.300	BHG0419	07/18/2024 10:04	cdg
EPA 1657	Azinphos-methyl (Guthion)	A	<0.100U	ug/L	1	0.0332	0.100	BHG0406	07/17/2024 05:53	cdg
EPA 1657	Chlorpyrifos	A	<0.0500U	ug/L	1	0.0256	0.0500	BHG0406	07/17/2024 05:53	cdg
EPA 1657	Dermeton	A	<0.200U	ug/L	1	0.0129	0.200	BHG0406	07/17/2024 05:53	cdg
EPA 1657	Diazinon	A	<0.500U	ug/L	1	0.0321	0.500	BHG0406	07/17/2024 05:53	cdg
EPA 1657	Malathion	A	<0.100U	ug/L	1	0.0133	0.100	BHG0406	07/17/2024 05:53	cdg

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler (Continued)
Lab Sample ID: 24F3396-02
Veolia Water - Permit Renewal [none]

Sample Matrix: Waste Water
Date Collected: 06/27/2024 8:10
Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	RLR	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Organics by GC (Continued)

EPA 1657	Parathion, ethyl	A	<0.100U	ug/L	1	0.0206	0.100	BHG0406	07/17/2024 05:53	cdg
----------	------------------	---	---------	------	---	--------	-------	---------	------------------	-----

Metals, Total

EPA 200.8	Aluminum	A	26.0	ug/L	1	0.167	5.00	BHF3940	07/02/2024 09:22	JKC
EPA 200.8	Antimony	A	<5.00U	ug/L	1	0.0589	5.00	BHF3940	07/02/2024 12:56	JKC
EPA 200.8	Arsenic	A	2.97	ug/L	1	0.0468	0.500	BHF3940	07/02/2024 11:39	JKC
EPA 200.8	Barium	A	41.6	ug/L	1	0.0200	6.00	BHF3940	07/02/2024 12:56	JKC
EPA 200.8	Beryllium	A	<0.500U	ug/L	1	0.0137	0.500	BHF3940	07/09/2024 11:02	JKC
EPA 200.8	Cadmium	A	<1.00U	ug/L	1	0.00798	1.00	BHF3940	07/09/2024 11:02	JKC
EPA 200.8	Chromium	A	<3.00U	ug/L	1	0.0839	3.00	BHF3940	07/02/2024 12:56	JKC
EPA 200.8	Copper	A	<2.00U	ug/L	1	0.182	2.00	BHF3940	07/02/2024 09:22	JKC
Calc	Chromium (III)		<0.00300	mg/L	1	8.39E-5	0.00300	[CALC]	07/02/2024 12:56	JKC
EPA 200.8	Lead	A	<0.500U	ug/L	1	0.0120	0.500	BHF3940	07/09/2024 11:02	JKC
EPA 200.8	Nickel	A	2.83	ug/L	1	0.0398	2.00	BHF3940	07/02/2024 09:22	JKC
EPA 200.8	Selenium	A	<5.00U	ug/L	1	0.354	5.00	BHF3940	07/02/2024 09:22	JKC
EPA 200.8	Silver	A	<0.500U	ug/L	1	0.00467	0.500	BHF3940	07/09/2024 11:02	JKC
EPA 200.8	Thallium	A	<1.25U	ug/L	1	0.0617	1.25	BHF3940	07/02/2024 12:56	JKC
EPA 200.8	Zinc	A	<5.00U	ug/L	1	0.207	5.00	BHF3940	07/02/2024 09:22	JKC

General Chemistry

SM 2320 B	Alkalinity as CaCO ₃	A	157	mg/L	1	10.0	10.0	BHF3955	06/28/2024 16:15	FPN
SM 5210 B	Carbonaceous BOD (CBOD)	A	3.59	mg/L	13514	2.03	2.03	BHF3919	07/02/2024 12:35	BAK
EPA 300.0	Chloride	A	246	mg/L	5	0.172	5.00	BHF4087	06/28/2024 23:28	AGZ
SM 2510 B	Conductivity	A	1340	umhos/cm	1	2.00	2.00	BHF3955	06/28/2024 16:15	FPN
				@ 25 °C						
EPA 300.0	Fluoride	A	<0.250U	mg/L	1	0.0105	0.250	BHF4087	06/28/2024 23:08	AGZ
EPA 350.1	Ammonia as N	A	12.4	mg/L	50	0.700	2.00	BHG0085	07/02/2024 13:52	AMM
EPA 300.0	Nitrate as N	A	<100U	ug/L	1	14.2	100	BHF4087	06/28/2024 23:08	AGZ
EPA 300.0	Nitrite as N	A	<50.0U	ug/L	1	5.10	50.0	BHF4087	06/28/2024 23:08	AGZ
EPA 300.0	Sulfate	A	75.2	mg/L	5	0.170	5.00	BHF4087	06/28/2024 23:28	AGZ
SM 2540 C	Residue-filterable (TDS)	A	604	mg/L	1	10.0	10.0	BHF3943	07/01/2024 10:36	BP
SM 4500-NH3 C	Total Kjeldahl Nitrogen - (TKN)	A	23.7	mg/L	1	0.100	1.00	BHG0077	07/02/2024 09:15	GIW
EPA 365.1	Total Phosphorus	A	5.10	mg/L	1	0.117	0.200	BHG0180	07/10/2024 16:32	GJG
SM 2540 D	Residue-nonfilterable (TSS)	A	6.95	mg/L	1	1.00	1.00	BHF3952	07/01/2024 12:48	BP

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwdfs.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler

Sample Matrix: Waste Water

Lab Sample ID: 24F3396-02RE1

Date Collected: 06/27/2024 8:10

Veolia Water - Permit Renewal

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Semivolatile Organic Compounds by GCMS

ASTM D7065	Nonylphenol (Rerun)	N	<333U	ug/L	5	5.93	333	BHF4081	07/02/2024 05:42	CDG
<hr/>										

ASTM D7065 Surrogate: n-NP-surr (Rerun) 90.5% 60-140 07/02/2024 05:42

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385

Tel: (936) 321-6060

Email: lab@nwqls.com

www. NWDLs.com

TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:

09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler

Sample Matrix: Waste Water

Lab Sample ID: 24F3396-02RE2

Date Collected: 06/27/2024 8:10

Veolia Water - Permit Renewal

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Semivolatile Organic Compounds by GCMS

EPA 625.1	Surrogate: 2-Fluorobiphenyl-surr (Rerun)	55.7%	32.2-138						07/12/2024 03:42
EPA 625.1	Surrogate: Nitrobenzene-d5-surr (Rerun)	88.3%	31.2-136						07/12/2024 03:42
EPA 625.1	Surrogate: p-Terphenyl-d14-surr (Rerun)	56.3%	37.6-117						07/12/2024 03:42

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwcls.com
www. NWCLS.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler
Lab Sample ID: 24F3396-02RE3
Veolia Water - Permit Renewal [none]

Sample Matrix: Waste Water
Date Collected: 06/27/2024 8:10
Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Semivolatile Organic Compounds by GCMS

EPA 625.1	3,3'-Dichlorobenzidine (Rerun)	A	<5.00U	ug/L	1	3.87	5.00	BHG0031	07/12/2024 23:35	KRB
EPA 625.1	Benzidine (Rerun)	A	<50.0U	ug/L	1	11.8	50.0	BHG0031	07/12/2024 23:35	KRB
EPA 625.1	Surrogate: 2-Fluorobiphenyl-surr (Rerun)		49.9%	32.2-138					07/12/2024 23:35	
EPA 625.1	Surrogate: Nitrobenzene-d5-surr (Rerun)		61.4%	31.2-136					07/12/2024 23:35	
EPA 625.1	Surrogate: p-Terphenyl-d14-surr (Rerun)		52.0%	37.6-117					07/12/2024 23:35	

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwqls.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler

Sample Matrix: Waste Water

Lab Sample ID: 24F3396-02RE4

Date Collected: 06/27/2024 8:10

Veolia Water - Permit Renewal

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Semivolatile Organic Compounds by GCMS

EPA 625.1	Surrogate: 2-Fluorobiphenyl-surr (Rerun)	70.0%	32.2-138						07/16/2024 05:24
EPA 625.1	Surrogate: Nitrobenzene-d5-surr (Rerun)	86.9%	31.2-136						07/16/2024 05:24
EPA 625.1	Surrogate: p-Terphenyl-d14-surr (Rerun)	69.1%	37.6-117						07/16/2024 05:24

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwdl.com
www. NWDLs.com
TCEQ TX-C24-00185

Reported:

09/23/2024 10:47

Sample Results

(Continued)

Client Sample ID: Outfall 001 Sampler

Sample Matrix: Waste Water

Lab Sample ID: 24F3396-02RE5

Date Collected: 06/27/2024 8:10

Veolia Water - Permit Renewal

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Semivolatile Organic Compounds by GCMS

EPA 625.1	Hexachlorocyclopentadiene (Rerun)	A	<10.0U	ug/L	3	0.750	10.0	BHG0031	07/30/2024 08:17	KRB
EPA 625.1	n-Nitrosodimethylamine (Rerun)	A	<50.0U	ug/L	3	3.71	50.0	BHG0031	07/30/2024 08:17	KRB
EPA 625.1	Surrogate: 2,4,6-Tribromophenol-surr (Rerun)	68.2%	33.6-139						07/30/2024 08:17	
EPA 625.1	Surrogate: 2-Fluorobiphenyl-surr (Rerun)	77.0%	32.2-138						07/30/2024 08:17	
EPA 625.1	Surrogate: 2-Fluorophenol-surr (Rerun)	91.7%	32.7-137						07/30/2024 08:17	
EPA 625.1	Surrogate: Nitrobenzene-d5-surr (Rerun)	93.5%	31.2-136						07/30/2024 08:17	
EPA 625.1	Surrogate: Phenol-d5-surr (Rerun)	71.9%	28.9-155						07/30/2024 08:17	
EPA 625.1	Surrogate: p-Terphenyl-d14-surr (Rerun)	64.0%	37.6-117						07/30/2024 08:17	

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwqls.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: 18 Mohm DI Sample Matrix: Waste Water
Lab Sample ID: 24G1575-01 Date Collected: 08/15/2024 8:10
Veolia - Outfall 001 3 Part Grab Composite 1 RC Collected by: Jerry Meeks Jr.
[none]

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Metals, Total

EPA 1631E	Mercury	A	<0.00500U	ug/L	1	0.00250	0.00500	BHH3453	08/27/2024 15:00	TBB
-----------	---------	---	-----------	------	---	---------	---------	---------	------------------	-----

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwpls.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 3 Part Grab

Sample Matrix: Waste Water

Lab Sample ID: 24G1575-02

Date Collected: 08/15/2024 7:30

Veolia - Outfall 001 3 Part Grab Composite 1 RC

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Metals, Total

EPA 1631E	Mercury	A	<0.00500U	ug/L	1	0.00250	0.00500	BHH3453	08/27/2024 15:10	TBB
-----------	---------	---	-----------	------	---	---------	---------	---------	------------------	-----

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwqls.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: 18 Mohm DI Sample Matrix: Waste Water
Lab Sample ID: 24G1576-01 Date Collected: 08/15/2024 0:00
Veolia - Outfall 001 3 Part Grab Composite 2 RC Collected by: Jerry Meeks Jr.
[none]

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Metals, Total

EPA 1631E	Mercury	A	<0.00500U	ug/L	1	0.00250	0.00500	BHH3453	08/27/2024 15:15	TBB
-----------	---------	---	-----------	------	---	---------	---------	---------	------------------	-----

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwcls.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 3 Part Grab

Sample Matrix: Waste Water

Lab Sample ID: 24G1576-02

Date Collected: 08/15/2024 7:30

Veolia - Outfall 001 3 Part Grab Composite 2 RC

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Metals, Total

EPA 1631E Mercury A <0.00500U ug/L 1 0.00250 0.00500 BHH3453 08/27/2024 15:19 TBB

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwcls.com
www. NWCLS.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results

(Continued)

Client Sample ID: Outfall 001 Sampler

Sample Matrix: Waste Water

Lab Sample ID: 24G2868-01

Date Collected: 08/15/2024 8:10

Veolia Water - Permit Renewal Recollect II

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Metals, Dissolved

SM 3500-Cr B Chromium (VI) A 4.44 ug/L 1 1.50 3.00 BH2911 08/22/2024 10:09 JVG

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwpls.com
www.NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Results
(Continued)

Client Sample ID: Outfall 001 Sampler

Sample Matrix: Waste Water

Lab Sample ID: 24H4177-01

Date Collected: 08/29/2024 8:20

Veolia Water - Permit Renewal Recollect II

[none]

Collected by: Jerry Meeks Jr.

Method	Analyte	*	Result Q	Units	DF	SDL	LRL	Batch	Analyzed	Analyst
--------	---------	---	----------	-------	----	-----	-----	-------	----------	---------

Metals, Dissolved

SM 3500-Cr B Chromium (VI) A 31.9 ug/L 1 1.50 3.00 BHH3712 09/03/2024 10:33 JVG

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control

Semivolatile Organic Compounds by GCMS

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHF4081 - SW-3511										
MB NP (BHF4081-BLK1)										
Nonylphenol Prepared & Analyzed: 6/28/2024										
Nonylphenol	<333	U	333	ug/L						
Surrogate: n-NP-surr			6.21	ug/L	7.96		78.1	60-140		
BS NP (BHF4081-BS1)										
Nonylphenol Prepared & Analyzed: 6/28/2024										
Nonylphenol	38.3	U	333	ug/L	39.8		96.2	56-112		
Surrogate: n-NP-surr			6.88	ug/L	7.95		86.6	60-140		
BSD NP (BHF4081-BSD1)										
Nonylphenol Prepared: 6/28/2024 Analyzed: 6/29/2024										
Nonylphenol	37.3	U	333	ug/L	39.8		93.7	56-112	2.51	22
Surrogate: n-NP-surr			6.15	ug/L	7.97		77.2	60-140		
24F2138-01 MS (BHF4081-MS1)										
Source: 24F2138-01 Prepared: 6/28/2024 Analyzed: 6/29/2024										
Nonylphenol	<333	CQ, J1, U	333	ug/L	40.0	<333		56-112		
Surrogate: n-NP-surr			4.87	ug/L	7.99		61.0	60-140		
Matrix Spike (BHF4081-MS2)										
Source: 24F2138-01RE1 Prepared: 6/28/2024 Analyzed: 7/2/2024										
Nonylphenol	20.4	J1, U	333	ug/L	40.0	<333	51.2	56-112		
Surrogate: n-NP-surr			8.01	ug/L	7.99		100	60-140		
24F2138-01 MSD (BHF4081-MSD1)										
Source: 24F2138-01 Prepared: 6/28/2024 Analyzed: 6/29/2024										
Nonylphenol	<333	CQ, J1, U	333	ug/L	39.5	<333		56-112		22
Surrogate: n-NP-surr			5.75	ug/L	7.91		72.8	60-140		
Matrix Spike Dup (BHF4081-MSD2)										
Source: 24F2138-01RE1 Prepared: 6/28/2024 Analyzed: 7/2/2024										
Nonylphenol	19.9	J1, U	333	ug/L	39.5	<333	50.4	56-112	2.68	22
Surrogate: n-NP-surr			7.73	ug/L	7.91		97.7	60-140		

* A = Accredited, N = Not Accredited or Accreditation not available

Veolia Water
 931 E Floodgate Rd
 Freeport, TX 77541

Reported:
 09/23/2024 10:47

Quality Control
 (Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE

Blank (BHG0031-BLK1)

Prepared: 7/1/2024 Analyzed: 7/2/2024

2-Methylphenol	<1.10	U	1.10	ug/L						
1,2,4,5-Tetrachlorobenzene	<0.300	U	0.300	ug/L						
1,2,4-Trichlorobenzene	<0.300	U	0.300	ug/L						
1,2-Diphenylhydrazine	<0.750	U	0.750	ug/L						
2,2'-Oxybis(1-chloropropane), bis(2-Chloro-1-methyl	<0.400	U	0.400	ug/L						
2,4,5-Trichlorophenol	<0.700	U	0.700	ug/L						
2,4,6-Trichlorophenol	<1.20	U	1.20	ug/L						
2,4-Dichlorophenol	<0.800	U	0.800	ug/L						
2,4-Dimethylphenol	<0.900	U	0.900	ug/L						
2,4-Dinitrophenol	<8.60	U	8.60	ug/L						
2,4-Dinitrotoluene (2,4-DNT)	<0.200	U	0.200	ug/L						
2,6-Dinitrotoluene (2,6-DNT)	<1.80	U	1.80	ug/L						
2-Chloronaphthalene	<0.400	U	0.400	ug/L						
2-Chlorophenol	<0.500	U	0.500	ug/L						
2-Methyl-4,6-dinitrophenol	<1.60	U	1.60	ug/L						
(4,6-Dinitro-2-methylph										
2-Nitrophenol	<0.700	U	0.700	ug/L						
3,4-Methylphenol	<1.40	U	1.40	ug/L						
4-Bromophenyl phenyl ether (BDE-3)	<0.300	U	0.300	ug/L						
4-Chloro-3-methylphenol	<0.700	U	0.700	ug/L						
4-Chlorophenyl phenylether	<0.700	U	0.700	ug/L						
4-Nitrophenol	<7.20	U	7.20	ug/L						
Acenaphthene	<0.300	U	0.300	ug/L						
Acenaphthylene	<0.200	U	0.200	ug/L						
Anthracene	<0.200	U	0.200	ug/L						
Benzo(a)anthracene	<0.300	U	0.300	ug/L						
Benzo(a)pyrene	<0.500	U	0.500	ug/L						
benzo(b&k)fluoranthene	<0.400	U	0.400	ug/L						
Benzo(g,h,i)perylene	<0.400	U	0.400	ug/L						
bis(2-Chloroethoxy)methane	<0.400	U	0.400	ug/L						
bis(2-Chloroethyl) ether	<0.600	U	0.600	ug/L						
Bis(2-ethylhexyl)phthalate	<1.50	U	1.50	ug/L						
Butyl benzyl phthalate	<0.400	U	0.400	ug/L						
Chrysene	<0.200	U	0.200	ug/L						
Dibenzo(a,h)anthracene	<0.500	U	0.500	ug/L						
Diethyl phthalate	<0.500	U	0.500	ug/L						
Dimethyl phthalate	<0.300	U	0.300	ug/L						
Di-n-butyl phthalate	<1.60	U	1.60	ug/L						
Di-n-octyl phthalate	<0.500	U	0.500	ug/L						
Fluoranthene	<0.300	U	0.300	ug/L						
Fluorene	<0.200	U	0.200	ug/L						
Hexachlorobenzene	<0.200	U	0.200	ug/L						
Hexachlorobutadiene	<0.300	U	0.300	ug/L						
Hexachlorocyclopentadiene	<0.750	U	0.750	ug/L						
Hexachloroethane	<0.200	U	0.200	ug/L						
Hexachlorophene	<1.10	U	1.10	ug/L						
Indeno(1,2,3-cd) pyrene	<0.400	U	0.400	ug/L						

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE (Continued)

Blank (BHG0031-BLK1)

Prepared: 7/1/2024 Analyzed: 7/2/2024

Isophorone	<0.300	U	0.300	ug/L						
Naphthalene	<0.300	U	0.300	ug/L						
Nitrobenzene	<0.400	U	0.400	ug/L						
n-Nitrosodiethylamine	<0.500	U	0.500	ug/L						
n-Nitrosodimethylamine	<3.80	U	3.80	ug/L						
n-Nitroso-di-n-butylamine	<5.70	U	5.70	ug/L						
n-Nitrosodi-n-propylamine	<1.40	U	1.40	ug/L						
n-Nitrosodiphenylamine	<0.200	U	0.200	ug/L						
Pentachlorobenzene	<0.200	U	0.200	ug/L						
Pentachlorophenol	<1.40	U	1.40	ug/L						
Phanthrene	<0.300	U	0.300	ug/L						
Phenol, Total	<1.50	U	1.50	ug/L						
Pyrene	<0.300	U	0.300	ug/L						
Pyridine	<13.3	U	13.3	ug/L						
Surrogate: 2,4,6-Tribromophenol-surr			4.18	ug/L	4.00		105	33.6-139		
Surrogate: 2-Fluorobiphenyl-surr			2.07	ug/L	2.00		104	32.2-138		
Surrogate: 2-Fluorophenol-surr			4.75	ug/L	4.00		119	32.7-137		
Surrogate: Nitrobenzene-d5-surr			2.48	ug/L	2.00		124	31.2-136		
Surrogate: Phenol-d5-surr			4.18	ug/L	4.00		105	28.9-155		
Surrogate: p-Terphenyl-d14-surr		S	4.16	ug/L	2.00		208	37.6-117		

Blank (BHG0031-BLK2)

Prepared: 7/1/2024 Analyzed: 7/5/2024

3,3'-Dichlorobenzidine	<5.00	U	5.00	ug/L						
Benzidine	<50.0	U	50.0	ug/L						
Surrogate: 2-Fluorobiphenyl-surr			0.983	ug/L	2.00		49.2	32.2-138		
Surrogate: Nitrobenzene-d5-surr			1.11	ug/L	2.00		55.3	31.2-136		
Surrogate: p-Terphenyl-d14-surr			1.18	ug/L	2.00		59.0	37.6-117		

* A = Accredited, N = Not Accredited or Accreditation not available

Veolia Water
 931 E Floodgate Rd
 Freeport, TX 77541

Reported:
 09/23/2024 10:47

Quality Control
 (Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE (Continued)

Blank (BHG0031-BLK3)

Prepared: 7/1/2024 Analyzed: 7/12/2024					
Surrogate: 2-Fluorobiphenyl-surr			1.22	ug/L	2.00
Surrogate: Nitrobenzene-d5-surr			1.73	ug/L	2.00
Surrogate: p-Terphenyl-d14-surr	S		2.78	ug/L	2.00

Blank (BHG0031-BLK4)

Prepared: 7/1/2024 Analyzed: 7/12/2024					
3,3'-Dichlorobenzidine	<5.00	U	5.00	ug/L	
Benzidine	<50.0	U	50.0	ug/L	
Surrogate: 2-Fluorobiphenyl-surr			1.05	ug/L	2.00
Surrogate: Nitrobenzene-d5-surr			1.17	ug/L	2.00
Surrogate: p-Terphenyl-d14-surr	S		2.40	ug/L	2.00

Blank (BHG0031-BLK5)

Prepared: 7/1/2024 Analyzed: 7/16/2024					
Surrogate: 2-Fluorobiphenyl-surr			1.38	ug/L	2.00
Surrogate: Nitrobenzene-d5-surr			1.58	ug/L	2.00
Surrogate: p-Terphenyl-d14-surr	S		3.29	ug/L	2.00

LCS (BHG0031-BS1)

Prepared: 7/1/2024 Analyzed: 7/5/2024					
3,3'-Dichlorobenzidine	39.5		4.00	ug/L	50.0
Benzidine	<16.0	U	16.0	ug/L	50.0
Surrogate: 2-Fluorobiphenyl-surr			1.30	ug/L	2.00
Surrogate: Nitrobenzene-d5-surr			1.53	ug/L	2.00
Surrogate: p-Terphenyl-d14-surr	S		1.13	ug/L	2.00

LCS (BHG0031-BS2)

Prepared: 7/1/2024 Analyzed: 7/2/2024					
2-Methylphenol	4.08		1.10	ug/L	4.00
1,2,4,5-Tetrachlorobenzene	1.75		0.300	ug/L	2.00
1,2,4-Trichlorobenzene	1.70		0.300	ug/L	2.00
1,2-Diphenylhydrazine	1.87		0.750	ug/L	2.00
2,2'-Oxybis(1-chloropropane), bis(2-Chloro-1-methyl	2.00		0.400	ug/L	2.00
2,4,5-Trichlorophenol	4.10		0.700	ug/L	4.00
2,4,6-Trichlorophenol	4.10		1.20	ug/L	4.00
2,4-Dichlorophenol	4.30		0.800	ug/L	4.00
2,4-Dimethylphenol	4.41		0.900	ug/L	4.00
2,4-Dinitrophenol	10.6		8.60	ug/L	10.0
2,4-Dinitrotoluene (2,4-DNT)	2.20		0.200	ug/L	2.00
2,6-Dinitrotoluene (2,6-DNT)	2.90		1.80	ug/L	2.00
2-Chloronaphthalene	1.93		0.400	ug/L	2.00
2-Chlorophenol	2.85		0.500	ug/L	4.00
2-Methyl-4,6-dinitrophenol	4.27		1.60	ug/L	4.00
(4,6-Dinitro-2-methylph					
2-Nitrophenol	4.03		0.700	ug/L	4.00
3,4-Methylphenol	6.98		1.40	ug/L	8.00
4-Bromophenyl phenyl ether (BDE-3)	1.81		0.300	ug/L	2.00
4-Chloro-3-methylphenol	4.48		0.700	ug/L	4.00
4-Chlorophenyl phenylether	1.96		0.700	ug/L	2.00
4-Nitrophenol	12.1		7.20	ug/L	10.0

* A = Accredited, N = Not Accredited or Accreditation not available

Veolia Water
 931 E Floodgate Rd
 Freeport, TX 77541

Reported:

09/23/2024 10:47

Quality Control
 (Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE (Continued)
LCS (BHG0031-BS2)

Prepared: 7/1/2024 Analyzed: 7/2/2024

Acenaphthene	2.01		0.300	ug/L	2.00		101	47-145		
Acenaphthylene	1.81		0.200	ug/L	2.00		90.4	33-145		
Anthracene	1.89		0.200	ug/L	2.00		94.6	27-133		
Benzo(a)anthracene	2.21		0.300	ug/L	2.00		110	33-143		
Benzo(a)pyrene	2.00		0.500	ug/L	2.00		100	17-163		
benzo(b&k)fluoranthene	4.21		0.400	ug/L	4.00		105	60-140		
Benzo(g,h,i)perylene	1.73		0.400	ug/L	2.00		86.6	0-219		
bis(2-Chloroethoxy)methane	2.23		0.400	ug/L	2.00		112	33-184		
bis(2-Chloroethyl) ether	2.20		0.600	ug/L	2.00		110	12-158		
Bis(2-ethylhexyl)phthalate	2.83		1.50	ug/L	2.00		141	8-158		
Butyl benzyl phthalate	2.06		0.400	ug/L	2.00		103	0-152		
Chrysene	2.09		0.200	ug/L	2.00		105	17-168		
Dibenzo(a,h)anthracene	2.03		0.500	ug/L	2.00		101	0-227		
Diethyl phthalate	2.58 J1		0.500	ug/L	2.00		129	0-120		
Dimethyl phthalate	2.40		0.300	ug/L	2.00		120	0-120		
Di-n-butyl phthalate	1.81		1.60	ug/L	2.00		90.5	1-120		
Di-n-octyl phthalate	2.20		0.500	ug/L	2.00		110	4-146		
Fluoranthene	2.11		0.300	ug/L	2.00		105	26-137		
Fluorene	2.09		0.200	ug/L	2.00		104	59-121		
Hexachlorobenzene	1.68		0.200	ug/L	2.00		83.9	0-152		
Hexachlorobutadiene	1.42		0.300	ug/L	2.00		71.1	24-120		
Hexachlorocyclopentadiene	1.40		0.750	ug/L	2.00		70.1	60-140		
Hexachloroethane	1.61		0.200	ug/L	2.00		80.4	40-120		
Hexachlorophene	4.07		1.10	ug/L	4.00		102	60-140		
Indeno(1,2,3-cd) pyrene	1.94		0.400	ug/L	2.00		97.2	0-171		
Isophorone	2.01		0.300	ug/L	2.00		101	21-196		
Naphthalene	1.99		0.300	ug/L	2.00		99.3	21-133		
Nitrobenzene	2.19		0.400	ug/L	2.00		109	35-180		
n-Nitrosodiethylamine	1.74		0.500	ug/L	2.00		87.2	60-140		
n-Nitrosodimethylamine	3.05 U		3.80	ug/L	10.0		30.5	4.18-37.2		
n-Nitroso-di-n-butylamine	<5.70 U		5.70	ug/L	2.00			60-140		
n-Nitrosodi-n-propylamine	2.23		1.40	ug/L	2.00		112	0-230		
n-Nitrosodiphenylamine	0.740 J1		0.200	ug/L	2.00		37.0	60-140		
Pentachlorobenzene	1.67		0.200	ug/L	2.00		83.3	60-140		
Pentachlorophenol	4.19		1.40	ug/L	4.00		105	14-176		
Phenanthrene	1.91		0.300	ug/L	2.00		95.4	54-120		
Phenol, Total	4.11		1.50	ug/L	4.00		103	5-120		
Pyrene	1.85		0.300	ug/L	2.00		92.7	52-120		
Pyridine	<13.3 U		13.3	ug/L	10.0			0-137		
<i>Surrogate: 2,4,6-Tribromophenol-surr</i>			4.32	ug/L	4.00		108	33.6-139		
<i>Surrogate: 2-Fluorobiphenyl-surr</i>			1.77	ug/L	2.00		88.7	32.2-138		
<i>Surrogate: 2-Fluorophenol-surr</i>			4.33	ug/L	4.00		108	32.7-137		
<i>Surrogate: Nitrobenzene-d5-surr</i>			2.00	ug/L	2.00		99.8	31.2-136		
<i>Surrogate: Phenol-d5-surr</i>			4.22	ug/L	4.00		106	28.9-155		
<i>Surrogate: p-Terphenyl-d14-surr</i>			1.95	ug/L	2.00		97.5	37.6-117		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHG0031 - EPA 625 LLE (Continued)										
LCS (BHG0031-BS3)										
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/12/2024										
3,3'-Dichlorobenzidine	25.9		4.00	ug/L	50.0		51.8	0-262		
Benzidine	<16.0	U	16.0	ug/L	50.0			0-131		
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/12/2024										
LCS (BHG0031-BS4)										
3,3'-Dichlorobenzidine	25.9		4.00	ug/L	50.0		51.8	0-262		
Benzidine	<16.0	U	16.0	ug/L	50.0			0-131		
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/16/2024										
LCS (BHG0031-BS5)										
Surrogate: 2-Fluorobiphenyl-surr			1.14	ug/L	2.00		57.0	32.2-138		
Surrogate: Nitrobenzene-d5-surr			1.26	ug/L	2.00		62.9	31.2-136		
Surrogate: p-Terphenyl-d14-surr			1.48	ug/L	2.00		73.9	37.6-117		
LCS Dup (BHG0031-BSD1)										
3,3'-Dichlorobenzidine	33.4		5.00	ug/L	50.0		66.8	0-262	16.6	108
Benzidine	<50.0	U	50.0	ug/L	50.0			0-131	200	40
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/5/2024										
LCS Dup (BHG0031-BSD2)										
2-Methylphenol	3.98		1.10	ug/L	4.00		99.6	60-140	2.28	40
1,2,4,5-Tetrachlorobenzene	1.74		0.300	ug/L	2.00		87.1	60-140	0.262	40
1,2,4-Trichlorobenzene	1.41		0.300	ug/L	2.00		70.4	44-142	18.9	50
1,2-Diphenylhydrazine	1.85		0.750	ug/L	2.00		92.5	60-140	0.878	40
2,2'-Oxybis(1-chloropropane), bis(2-Chloro-1-methyl	1.81		0.400	ug/L	2.00		90.4	60-140	10.2	40
2,4,5-Trichlorophenol	4.19		0.700	ug/L	4.00		105	60-140	2.08	40
2,4,6-Trichlorophenol	4.17		1.20	ug/L	4.00		104	37-144	1.90	58
2,4-Dichlorophenol	4.06		0.800	ug/L	4.00		102	39-135	5.57	50
2,4-Dimethylphenol	4.34		0.900	ug/L	4.00		108	32-120	1.75	58
2,4-Dinitrophenol	10.9		8.60	ug/L	10.0		109	0-191	3.01	132
2,4-Dinitrotoluene (2,4-DNT)	2.25		0.200	ug/L	2.00		112	39-139	2.07	42
2,6-Dinitrotoluene (2,6-DNT)	2.53		1.80	ug/L	2.00		127	50-158	13.5	48
2-Chloronaphthalene	1.76		0.400	ug/L	2.00		88.1	60-120	9.28	24
2-Chlorophenol	2.11		0.500	ug/L	4.00		52.8	23-134	29.8	61
2-Methyl-4,6-dinitrophenol	4.30		1.60	ug/L	4.00		108	0-181	0.773	203
(4,6-Dinitro-2-methylph										
2-Nitrophenol	3.93		0.700	ug/L	4.00		98.2	29-182	2.64	55
3,4-Methylphenol	7.27		1.40	ug/L	8.00		90.8	60-140	4.02	40
4-Bromophenyl phenyl ether (BDE-3)	1.60		0.300	ug/L	2.00		80.1	53-127	12.4	43
4-Chloro-3-methylphenol	4.09		0.700	ug/L	4.00		102	22-147	9.07	73
4-Chlorophenyl phenylether	1.88		0.700	ug/L	2.00		94.0	25-158	3.97	61
4-Nitrophenol	11.8		7.20	ug/L	10.0		118	0-132	2.07	131

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHG0031 - EPA 625 LLE (Continued)										
LCS Dup (BHG0031-BSD2)										
						Prepared: 7/1/2024 Analyzed: 7/2/2024				
Acenaphthene	1.87		0.300	ug/L	2.00	93.4	47-145	7.54	48	
Acenaphthylene	1.77		0.200	ug/L	2.00	88.3	33-145	2.44	74	
Anthracene	1.82		0.200	ug/L	2.00	91.1	27-133	3.75	66	
Benzo(a)anthracene	2.07		0.300	ug/L	2.00	104	33-143	6.38	53	
Benzo(a)pyrene	2.04		0.500	ug/L	2.00	102	17-163	1.71	72	
benzo(b&k)fluoranthene	3.99		0.400	ug/L	4.00	99.9	60-140	5.23	40	
Benzo(g,h,i)perylene	1.78		0.400	ug/L	2.00	89.0	0-219	2.81	97	
bis(2-Chloroethoxy)methane	2.20		0.400	ug/L	2.00	110	33-184	1.48	54	
bis(2-Chloroethyl) ether	2.48		0.600	ug/L	2.00	124	12-158	12.2	108	
Bis(2-ethylhexyl)phthalate	2.79		1.50	ug/L	2.00	140	8-158	1.33	82	
Butyl benzyl phthalate	1.93		0.400	ug/L	2.00	96.4	0-152	6.82	60	
Chrysene	2.11		0.200	ug/L	2.00	105	17-168	0.610	87	
Dibenzo(a,h)anthracene	2.05		0.500	ug/L	2.00	102	0-227	0.805	126	
Diethyl phthalate	2.47 J1		0.500	ug/L	2.00	124	0-120	4.42	100	
Dimethyl phthalate	2.22		0.300	ug/L	2.00	111	0-120	7.98	183	
Di-n-butyl phthalate	1.79		1.60	ug/L	2.00	89.5	1-120	1.05	47	
Di-n-octyl phthalate	2.06		0.500	ug/L	2.00	103	4-146	6.55	69	
Fluoranthene	2.12		0.300	ug/L	2.00	106	26-137	0.414	66	
Fluorene	2.00		0.200	ug/L	2.00	100	59-121	4.27	38	
Hexachlorobenzene	1.48		0.200	ug/L	2.00	73.8	0-152	12.9	55	
Hexachlorobutadiene	1.34		0.300	ug/L	2.00	66.9	24-120	6.05	62	
Hexachlorocyclopentadiene	1.40		0.750	ug/L	2.00	69.9	60-140	0.302	40	
Hexachloroethane	1.19		0.200	ug/L	2.00	59.5	40-120	29.8	52	
Hexachlorophene	4.14		1.10	ug/L	4.00	103	60-140	1.56	40	
Indeno(1,2,3-cd) pyrene	1.90		0.400	ug/L	2.00	95.0	0-171	2.29	99	
Isophorone	1.95		0.300	ug/L	2.00	97.7	21-196	2.88	93	
Naphthalene	1.74		0.300	ug/L	2.00	86.9	21-133	13.3	65	
Nitrobenzene	2.03		0.400	ug/L	2.00	101	35-180	7.58	62	
n-Nitrosodiethylamine	1.78		0.500	ug/L	2.00	89.0	60-140	2.01	40	
n-Nitrosodimethylamine	2.87 U		3.80	ug/L	10.0	28.7	4.18-37.2	6.17	40	
n-Nitroso-di-n-butylamine	<5.70 U		5.70	ug/L	2.00		60-140	200	40	
n-Nitrosodi-n-propylamine	2.12		1.40	ug/L	2.00	106	0-230	5.35	87	
n-Nitrosodiphenylamine	0.669 J1		0.200	ug/L	2.00	33.4	60-140	10.1	40	
Pentachlorobenzene	1.61		0.200	ug/L	2.00	80.7	60-140	3.23	40	
Pentachlorophenol	4.15		1.40	ug/L	4.00	104	14-176	0.949	86	
Phenanthrene	1.89		0.300	ug/L	2.00	94.5	54-120	0.980	39	
Phenol, Total	4.53		1.50	ug/L	4.00	113	5-120	9.80	64	
Pyrene	1.83		0.300	ug/L	2.00	91.3	52-120	1.52	49	
Pyridine	<13.3 U		13.3	ug/L	10.0		0-137		40	
Surrogate: 2,4,6-Tribromophenol-surr			4.30	ug/L	4.00		107	33.6-139		
Surrogate: 2-Fluorobiphenyl-surr			1.73	ug/L	2.00		86.5	32.2-138		
Surrogate: 2-Fluorophenol-surr			4.27	ug/L	4.00		107	32.7-137		
Surrogate: Nitrobenzene-d5-surr			1.81	ug/L	2.00		90.3	31.2-136		
Surrogate: Phenol-d5-surr			3.96	ug/L	4.00		98.9	28.9-155		
Surrogate: p-Terphenyl-d14-surr			2.06	ug/L	2.00		103	37.6-117		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHG0031 - EPA 625 LLE (Continued)										
LCS Dup (BHG0031-BSD3)										
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/12/2024										
3,3'-Dichlorobenzidine	23.7		5.00	ug/L	50.0		47.5	0-262	8.65	108
Benzidine	<50.0	U	50.0	ug/L	50.0			0-131	200	40
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/12/2024										
LCS Dup (BHG0031-BSD4)										
3,3'-Dichlorobenzidine	23.7		5.00	ug/L	50.0		47.5	0-262	8.65	108
Benzidine	<50.0	U	50.0	ug/L	50.0			0-131	200	40
Surrogate: 2-Fluorobiphenyl-surr										
Surrogate: Nitrobenzene-d5-surr										
Surrogate: p-Terphenyl-d14-surr										
Prepared: 7/1/2024 Analyzed: 7/16/2024										
LCS Dup (BHG0031-BSD5)										
Surrogate: 2-Fluorobiphenyl-surr			1.07	ug/L	2.00		53.3	32.2-138		
Surrogate: Nitrobenzene-d5-surr			1.24	ug/L	2.00		62.1	31.2-136		
Surrogate: p-Terphenyl-d14-surr			1.31	ug/L	2.00		65.7	37.6-117		
Matrix Spike (BHG0031-MS1)										
Source: 24F3396-02										
Prepared: 7/1/2024 Analyzed: 7/3/2024										
2-Methylphenol	4.14		1.10	ug/L	4.00	<1.10	103	60-140		
1,2,4,5-Tetrachlorobenzene	1.94		0.300	ug/L	2.00	<0.300	97.0	60-140		
1,2,4-Trichlorobenzene	1.64		0.300	ug/L	2.00	<0.300	82.1	44-142		
1,2-Diphenylhydrazine	1.36		0.750	ug/L	2.00	<0.750	68.0	60-140		
2,2'-Oxybis(1-chloropropane), bis(2-Chloro-1-methyl	2.07		0.400	ug/L	2.00	<0.400	103	60-140		
2,4,5-Trichlorophenol	4.12		0.700	ug/L	4.00	<0.700	103	60-140		
2,4,6-Trichlorophenol	4.67		1.20	ug/L	4.00	0.499	104	37-144		
2,4-Dichlorophenol	4.71		0.800	ug/L	4.00	<0.800	118	39-135		
2,4-Dimethylphenol	4.66		0.900	ug/L	4.00	<0.900	116	32-120		
2,4-Dinitrophenol	13.4		8.60	ug/L	10.0	<8.60	134	0-191		
2,4-Dinitrotoluene (2,4-DNT)	2.67		0.200	ug/L	2.00	<0.200	133	39-139		
2,6-Dinitrotoluene (2,6-DNT)	3.16		1.80	ug/L	2.00	0.847	115	50-158		
2-Chloronaphthalene	1.70		0.400	ug/L	2.00	<0.400	84.8	60-120		
2-Chlorophenol	2.06		0.500	ug/L	4.00	<0.500	51.4	23-134		
2-Methyl-4,6-dinitrophenol	5.19		1.60	ug/L	4.00	<1.60	130	0-181		
(4,6-Dinitro-2-methylph										
2-Nitrophenol	4.78		0.700	ug/L	4.00	<0.700	120	29-182		
3,4-Methylphenol	7.93		1.40	ug/L	8.00	1.42	81.4	60-140		
4-Bromophenyl phenyl ether (BDE-3)	2.24		0.300	ug/L	2.00	<0.300	112	53-127		
4-Chloro-3-methylphenol	4.81		0.700	ug/L	4.00	<0.700	120	22-147		
4-Chlorophenyl phenylether	1.92		0.700	ug/L	2.00	<0.700	95.9	25-158		
4-Nitrophenol	12.4		7.20	ug/L	10.0	<7.20	124	0-132		
Acenaphthene	1.78		0.300	ug/L	2.00	<0.300	88.8	47-145		
Acenaphthylene	1.78		0.200	ug/L	2.00	<0.200	88.9	33-145		
Anthracene	1.98		0.200	ug/L	2.00	<0.200	98.9	27-133		
Benzo(a)anthracene	1.88		0.300	ug/L	2.00	<0.300	94.0	33-143		
Benzo(a)pyrene	1.81		0.500	ug/L	2.00	<0.500	90.7	17-163		
benzo(b&k)fluoranthene	3.59		0.400	ug/L	4.00	<0.400	89.7	60-140		
Benzo(g,h,i)perylene	1.73		0.400	ug/L	2.00	<0.400	86.3	0-219		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE (Continued)

Matrix Spike (BHG0031-MS1)	Source: 24F3396-02			Prepared: 7/1/2024 Analyzed: 7/3/2024				
bis(2-Chloroethoxy)methane	2.39		0.400	ug/L	2.00	<0.400	120	33-184
bis(2-Chloroethyl) ether	2.78		0.600	ug/L	2.00	<0.600	139	12-158
Bis(2-ethylhexyl) phthalate	3.24		1.50	ug/L	2.00	0.944	115	8-158
Butyl benzyl phthalate	1.76		0.400	ug/L	2.00	0.128	81.8	0-152
Chrysene	1.94		0.200	ug/L	2.00	<0.200	97.0	17-168
Dibenz(a,h)anthracene	2.01		0.500	ug/L	2.00	<0.500	101	0-227
Diethyl phthalate	2.36		0.500	ug/L	2.00	0.358	100	0-120
Dimethyl phthalate	2.37		0.300	ug/L	2.00	<0.300	119	0-120
Di-n-butyl phthalate	1.18 U		1.60	ug/L	2.00	<1.60	59.0	1-120
Di-n-octyl phthalate	1.67		0.500	ug/L	2.00	<0.500	83.5	4-146
Fluoranthene	1.87		0.300	ug/L	2.00	<0.300	93.3	26-137
Fluorene	1.97		0.200	ug/L	2.00	<0.200	98.5	59-121
Hexachlorobenzene	1.82		0.200	ug/L	2.00	<0.200	91.2	0-152
Hexachlorobutadiene	1.48		0.300	ug/L	2.00	<0.300	74.1	24-120
Hexachlorocyclopentadiene	4.12 J1, L		0.750	ug/L	2.00	<0.750	206	60-140
Hexachloroethane	1.53		0.200	ug/L	2.00	<0.200	76.3	40-120
Hexachlorophene	5.11		1.10	ug/L	4.00	<1.10	128	60-140
Indeno(1,2,3-cd) pyrene	1.82		0.400	ug/L	2.00	<0.400	90.8	0-171
Isophorone	2.57		0.300	ug/L	2.00	0.375	109	21-196
Naphthalene	2.16		0.300	ug/L	2.00	<0.300	108	21-133
Nitrobenzene	2.90		0.400	ug/L	2.00	<0.400	145	35-180
n-Nitrosodiethylamine	1.79		0.500	ug/L	2.00	<0.500	89.7	60-140
n-Nitrosodimethylamine	27.7 L		3.80	ug/L	10.0	26.1	16.6	4.18-91
n-Nitroso-di-n-butylamine	<5.70 U		5.70	ug/L	2.00	<5.70		60-140
n-Nitrosodi-n-propylamine	2.29		1.40	ug/L	2.00	<1.40	114	0-230
n-Nitrosodiphenylamine	<0.200 J1, U		0.200	ug/L	2.00	<0.200		60-140
Pentachlorobenzene	1.65		0.200	ug/L	2.00	<0.200	82.4	60-140
Pentachlorophenol	5.07		1.40	ug/L	4.00	<1.40	127	14-176
Phenanthrene	1.98		0.300	ug/L	2.00	0.0820	94.9	54-120
Phenol, Total	6.57 J1		1.50	ug/L	4.00	1.47	128	5-120
Pyrene	1.60		0.300	ug/L	2.00	<0.300	80.2	52-120
Pyridine	<13.3 J1, U		13.3	ug/L	10.0	<13.3		60-140
Surrogate: 2,4,6-Tribromophenol-surr			4.33	ug/L	4.00		108	33.6-139
Surrogate: 2-Fluorobiphenyl-surr			1.87	ug/L	2.00		93.3	32.2-138
Surrogate: 2-Fluorophenol-surr			4.69	ug/L	4.00		117	32.7-137
Surrogate: Nitrobenzene-d5-surr			2.67	ug/L	2.00		134	31.2-136
Surrogate: Phenol-d5-surr			4.43	ug/L	4.00		111	28.9-155
Surrogate: p-Terphenyl-d14-surr			1.93	ug/L	2.00		96.3	37.6-117

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE (Continued)

Matrix Spike (BHG0031-MS2)	Source: 24F3396-02RE2	Prepared: 7/1/2024 Analyzed: 7/12/2024				
Surrogate: 2-Fluorobiphenyl-surr	1.10	ug/L	2.00		54.9	32.2-138
Surrogate: Nitrobenzene-d5-surr	1.61	ug/L	2.00		80.3	31.2-136
Surrogate: p-Terphenyl-d14-surr	1.12	ug/L	2.00		56.1	37.6-117

Matrix Spike (BHG0031-MS3)	Source: 24F3396-02RE4	Prepared: 7/1/2024 Analyzed: 7/16/2024				
Surrogate: 2-Fluorobiphenyl-surr	0.866	ug/L	2.00		43.3	32.2-138
Surrogate: Nitrobenzene-d5-surr	1.12	ug/L	2.00		56.2	31.2-136
Surrogate: p-Terphenyl-d14-surr	0.873	ug/L	2.00		43.6	37.6-117

Matrix Spike (BHG0031-MS4)	Source: 24F3396-02RE5	Prepared: 7/1/2024 Analyzed: 7/30/2024					
3,4-Methylphenol	6.20 U	10.0	ug/L	8.00	<10.0	77.5	60-140
Hexachlorocyclopentadiene	3.84 J1, U	10.0	ug/L	2.00	2.91	46.5	60-140
n-Nitrosodimethylamine	18.6 J1, U	50.0	ug/L	10.0	25.5	NR	4.18-91
Surrogate: 2,4,6-Tribromophenol-surr		2.75	ug/L	4.00		68.8	33.6-139
Surrogate: 2-Fluorobiphenyl-surr		1.45	ug/L	2.00		72.4	32.2-138
Surrogate: 2-Fluorophenol-surr		2.91	ug/L	4.00		72.7	32.7-137
Surrogate: Nitrobenzene-d5-surr		1.44	ug/L	2.00		71.9	31.2-136
Surrogate: Phenol-d5-surr		2.86	ug/L	4.00		71.6	28.9-155
Surrogate: p-Terphenyl-d14-surr		1.22	ug/L	2.00		60.9	37.6-117

Matrix Spike Dup (BHG0031-MSD1)	Source: 24F3396-02	Prepared: 7/1/2024 Analyzed: 7/3/2024					
2-Methylphenol	3.98	1.10	ug/L	4.00	<1.10	99.4	60-140
1,2,4,5-Tetrachlorobenzene	1.97	0.300	ug/L	2.00	<0.300	98.4	60-140
1,2,4-Trichlorobenzene	1.55	0.300	ug/L	2.00	<0.300	77.5	44-142
1,2-Diphenylhydrazine	1.40	0.750	ug/L	2.00	<0.750	70.1	60-140
2,2'-Oxybis(1-chloropropane), bis(2-Chloro-1-methyl	2.02	0.400	ug/L	2.00	<0.400	101	60-140
2,4,5-Trichlorophenol	4.36	0.700	ug/L	4.00	<0.700	109	60-140
2,4,6-Trichlorophenol	5.30	1.20	ug/L	4.00	0.499	120	37-144
2,4-Dichlorophenol	4.82	0.800	ug/L	4.00	<0.800	120	39-135
2,4-Dimethylphenol	4.70	0.900	ug/L	4.00	<0.900	117	32-120
2,4-Dinitrophenol	13.9	8.60	ug/L	10.0	<8.60	139	0-191
2,4-Dinitrotoluene (2,4-DNT)	2.62	0.200	ug/L	2.00	<0.200	131	39-139
2,6-Dinitrotoluene (2,6-DNT)	3.60	1.80	ug/L	2.00	0.847	138	50-158
2-Chloronaphthalene	1.79	0.400	ug/L	2.00	<0.400	89.3	60-120
2-Chlorophenol	2.01	0.500	ug/L	4.00	<0.500	50.3	23-134
2-Methyl-4,6-dinitrophenol	5.35	1.60	ug/L	4.00	<1.60	134	0-181
(4,6-Dinitro-2-methylph							
2-Nitrophenol	4.76	0.700	ug/L	4.00	<0.700	119	29-182
3,4-Methylphenol	8.41 L	1.40	ug/L	8.00	1.42	87.4	60-140
4-Bromophenyl phenyl ether (BDE-3)	2.26	0.300	ug/L	2.00	<0.300	113	53-127
4-Chloro-3-methylphenol	4.93	0.700	ug/L	4.00	<0.700	123	22-147
4-Chlorophenyl phenylether	2.08	0.700	ug/L	2.00	<0.700	104	25-158
4-Nitrophenol	12.4	7.20	ug/L	10.0	<7.20	124	0-132
Acenaphthene	1.94	0.300	ug/L	2.00	<0.300	97.2	47-145
Acenaphthylene	1.87	0.200	ug/L	2.00	<0.200	93.6	33-145
Anthracene	2.10	0.200	ug/L	2.00	<0.200	105	27-133

* A = Accredited, N = Not Accredited or Accreditation not available

Veolia Water
 931 E Floodgate Rd
 Freeport, TX 77541

Reported:

09/23/2024 10:47

Quality Control
 (Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0031 - EPA 625 LLE (Continued)

Matrix Spike Dup (BHG0031-MSD1)	Source: 24F3396-02			Prepared: 7/1/2024 Analyzed: 7/3/2024						
Benzo(a)anthracene	1.94		0.300	ug/L	2.00	<0.300	97.2	33-143	3.40	53
Benzo(a)pyrene	1.90		0.500	ug/L	2.00	<0.500	95.1	17-163	4.72	72
benzo(b&k)fluoranthene	3.84		0.400	ug/L	4.00	<0.400	96.0	60-140	6.70	40
Benzo(g,h,i)perylene	1.78		0.400	ug/L	2.00	<0.400	88.9	0-219	3.00	97
bis(2-Chloroethoxy)methane	2.54		0.400	ug/L	2.00	<0.400	127	33-184	5.90	54
bis(2-Chloroethyl) ether	2.60		0.600	ug/L	2.00	<0.600	130	12-158	6.77	108
Bis(2-ethylhexyl)phthalate	2.52		1.50	ug/L	2.00	0.944	78.8	8-158	25.0	82
Butyl benzyl phthalate	1.85		0.400	ug/L	2.00	0.128	85.9	0-152	4.63	60
Chrysene	2.06		0.200	ug/L	2.00	<0.200	103	17-168	6.07	87
Dibenzo(a,h)anthracene	2.14		0.500	ug/L	2.00	<0.500	107	0-227	6.18	126
Diethyl phthalate	2.27		0.500	ug/L	2.00	0.358	95.5	0-120	3.92	100
Dimethyl phthalate	2.34		0.300	ug/L	2.00	<0.300	117	0-120	1.40	183
Di-n-butyl phthalate	1.18 U		1.60	ug/L	2.00	<1.60	58.8	1-120	0.278	47
Di-n-octyl phthalate	1.76		0.500	ug/L	2.00	<0.500	88.0	4-146	5.26	69
Fluoranthene	2.10		0.300	ug/L	2.00	<0.300	105	26-137	11.8	66
Fluorene	2.11		0.200	ug/L	2.00	<0.200	105	59-121	6.71	38
Hexachlorobenzene	1.97		0.200	ug/L	2.00	<0.200	98.3	0-152	7.47	55
Hexachlorobutadiene	1.44		0.300	ug/L	2.00	<0.300	72.1	24-120	2.80	62
Hexachlorocyclopentadiene	4.84 J1, L		0.750	ug/L	2.00	<0.750	242	60-140	16.0	40
Hexachloroethane	1.50		0.200	ug/L	2.00	<0.200	74.9	40-120	1.89	52
Hexachlorophene	4.67		1.10	ug/L	4.00	<1.10	117	60-140	9.07	40
Indeno(1,2,3-cd) pyrene	1.92		0.400	ug/L	2.00	<0.400	96.2	0-171	5.70	99
Isophorone	2.56		0.300	ug/L	2.00	0.375	109	21-196	0.0798	93
Naphthalene	2.14		0.300	ug/L	2.00	<0.300	107	21-133	1.26	65
Nitrobenzene	3.01		0.400	ug/L	2.00	<0.400	151	35-180	3.74	62
n-Nitrosodiethylamine	1.86		0.500	ug/L	2.00	<0.500	92.8	60-140	3.32	40
n-Nitrosodimethylamine	31.9 L		3.80	ug/L	10.0	26.1	58.4	4-18-91	14.0	40
n-Nitroso-di-n-butylamine	1.94 U		5.70	ug/L	2.00	<5.70	96.9	60-140	200	40
n-Nitrosodi-n-propylamine	2.29		1.40	ug/L	2.00	<1.40	115	0-230	0.210	87
n-Nitrosodiphenylamine	<0.200 J1, U		0.200	ug/L	2.00	<0.200		60-140		40
Pentachlorobenzene	1.80		0.200	ug/L	2.00	<0.200	90.0	60-140	8.83	40
Pentachlorophenol	5.33		1.40	ug/L	4.00	<1.40	133	14-176	4.97	86
Phenanthere	2.13		0.300	ug/L	2.00	0.0820	102	54-120	7.24	39
Phenol, Total	5.87		1.50	ug/L	4.00	1.47	110	5-120	11.2	64
Pyrene	1.72		0.300	ug/L	2.00	<0.300	86.2	52-120	7.25	49
Pyridine	<13.3 J1, U		13.3	ug/L	10.0	<13.3		60-140		40
<i>Surrogate: 2,4,6-Tribromophenol-surr</i>			4.57	ug/L	4.00		114	33.6-139		
<i>Surrogate: 2-Fluorobiphenyl-surr</i>			1.88	ug/L	2.00		93.8	32.2-138		
<i>Surrogate: 2-Fluorophenol-surr</i>			4.68	ug/L	4.00		117	32.7-137		
<i>Surrogate: Nitrobenzene-d5-surr</i>			2.11	ug/L	2.00		105	31.2-136		
<i>Surrogate: Phenol-d5-surr</i>			4.71	ug/L	4.00		118	28.9-155		
<i>Surrogate: p-Terphenyl-d14-surr</i>			2.06	ug/L	2.00		103	37.6-117		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Semivolatile Organic Compounds by GCMS (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHG0031 - EPA 625 LLE (Continued)										
Matrix Spike Dup (BHG0031-MSD2)										
Source: 24F3396-02RE2 Prepared: 7/1/2024 Analyzed: 7/12/2024										
Surrogate: 2-Fluorobiphenyl-surr			1.13	ug/L	2.00	56.7	32.2-138			
Surrogate: Nitrobenzene-d5-surr			1.64	ug/L	2.00	81.9	31.2-136			
Surrogate: p-Terphenyl-d14-surr			1.17	ug/L	2.00	58.6	37.6-117			
Matrix Spike Dup (BHG0031-MSD3)										
Source: 24F3396-02RE4 Prepared: 7/1/2024 Analyzed: 7/16/2024										
Surrogate: 2-Fluorobiphenyl-surr			0.964	ug/L	2.00	48.2	32.2-138			
Surrogate: Nitrobenzene-d5-surr			1.18	ug/L	2.00	58.9	31.2-136			
Surrogate: p-Terphenyl-d14-surr			1.21	ug/L	2.00	60.4	37.6-117			
Matrix Spike Dup (BHG0031-MSD4)										
Source: 24F3396-02RE5 Prepared: 7/1/2024 Analyzed: 7/30/2024										
3,4-Methylphenol	6.65	U	10.0	ug/L	8.00	<10.0	83.2	60-140	7.05	40
Hexachlorocyclopentadiene	5.28	U	10.0	ug/L	2.00	2.91	119	60-140	31.6	40
n-Nitrosodimethylamine	32.5	J1, U	50.0	ug/L	10.0	25.5	69.1	4.18-91	54.2	40
Surrogate: 2,4,6-Tribromophenol-surr			3.01	ug/L	4.00		75.3	33.6-139		
Surrogate: 2-Fluorobiphenyl-surr			1.47	ug/L	2.00		73.6	32.2-138		
Surrogate: 2-Fluorophenol-surr			3.48	ug/L	4.00		87.0	32.7-137		
Surrogate: Nitrobenzene-d5-surr			1.76	ug/L	2.00		87.9	31.2-136		
Surrogate: Phenol-d5-surr			3.12	ug/L	4.00		78.0	28.9-155		
Surrogate: p-Terphenyl-d14-surr			1.19	ug/L	2.00		59.4	37.6-117		



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Organics by GC

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0406 - EPA 1657 SPE

Blank (BHG0406-BLK1)

			Prepared: 7/3/2024 Analyzed: 7/17/2024						
Azinphos-methyl (Guthion)	<0.101	U	0.101	ug/L					
Chlorpyrifos	<0.0503	U	0.0503	ug/L					
Demeton	<0.201	U	0.201	ug/L					
Diazinon	<0.503	U	0.503	ug/L					
Malathion	<0.101	U	0.101	ug/L					
Parathion, ethyl	<0.101	U	0.101	ug/L					
<i>Surrogate: Tributyl Phosphate-surr</i>	<i>S</i>		<i>0.0226</i>	<i>ug/L</i>	<i>0.101</i>		<i>22.5</i>	<i>40-120</i>	
<i>Surrogate: Triphenyl Phosphate-surr</i>	<i>S</i>		<i>0.0112</i>	<i>ug/L</i>	<i>0.101</i>		<i>11.2</i>	<i>40-120</i>	

LCS (BHG0406-BS1)

			Prepared: 7/3/2024 Analyzed: 7/17/2024				
Azinphos-methyl (Guthion)	0.0649	J1, U	0.100	ug/L	0.250	25.9	37-150
Chlorpyrifos	0.188		0.0501	ug/L	0.250	74.9	48-150
Demeton	0.141	U	0.200	ug/L	0.250	56.2	16-150
Diazinon	0.238	U	0.501	ug/L	0.250	95.1	50-150
Malathion	0.206		0.100	ug/L	0.250	82.1	50-150
Parathion, ethyl	0.317		0.100	ug/L	0.250	126	50-150
<i>Surrogate: Tributyl Phosphate-surr</i>	<i>S</i>		<i>0.163</i>	<i>ug/L</i>	<i>0.100</i>	<i>162</i>	<i>40-120</i>
<i>Surrogate: Triphenyl Phosphate-surr</i>			<i>0.0537</i>	<i>ug/L</i>	<i>0.100</i>	<i>53.6</i>	<i>40-120</i>

LCS Dup (BHG0406-BSD1)

			Prepared: 7/3/2024 Analyzed: 7/17/2024				
Azinphos-methyl (Guthion)	0.0676	J1, U	0.100	ug/L	0.249	27.1	37-150
Chlorpyrifos	0.164		0.0500	ug/L	0.249	65.7	48-150
Demeton	0.102	U	0.200	ug/L	0.249	40.8	16-150
Diazinon	0.214	U	0.500	ug/L	0.249	85.7	50-150
Malathion	0.190		0.100	ug/L	0.249	76.0	50-150
Parathion, ethyl	0.236		0.100	ug/L	0.249	94.4	50-150
<i>Surrogate: Tributyl Phosphate-surr</i>			<i>0.117</i>	<i>ug/L</i>	<i>0.0998</i>	<i>117</i>	<i>40-120</i>
<i>Surrogate: Triphenyl Phosphate-surr</i>			<i>0.0444</i>	<i>ug/L</i>	<i>0.0998</i>	<i>44.5</i>	<i>40-120</i>

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Organics by GC (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0406 - EPA 1657 SPE (Continued)

Matrix Spike (BHG0406-MS1)

Source: 24F3396-02

Prepared: 7/3/2024 Analyzed: 7/17/2024

Azinphos-methyl (Guthion)	<0.100	J1, U	0.100	ug/L	0.250	<0.100		25-150		
Chlorpyrifos	0.0297	J1, U	0.0500	ug/L	0.250	<0.0500	11.9	25-150		
Demeton	<0.200	J1, U	0.200	ug/L	0.250	<0.200		25-150		
Diazinon	<0.500	J1, U	0.500	ug/L	0.250	<0.500		25-150		
Malathion	<0.100	J1, U	0.100	ug/L	0.250	<0.100		25-150		
Parathion, ethyl	0.0225	J1, U	0.100	ug/L	0.250	<0.100	9.03	25-150		
<i>Surrogate: Tributyl Phosphate-surr</i>			0.120	ug/L	0.0998		120	40-120		
<i>Surrogate: Triphenyl Phosphate-surr</i>		S	0.0103	ug/L	0.0998		10.3	40-120		

Matrix Spike Dup (BHG0406-MSD1)

Source: 24F3396-02

Prepared: 7/3/2024 Analyzed: 7/17/2024

Azinphos-methyl (Guthion)	<0.100	J1, U	0.100	ug/L	0.250	<0.100		25-150		40
Chlorpyrifos	0.0546	J1	0.0500	ug/L	0.250	<0.0500	21.8	25-150	58.9	40
Demeton	<0.200	J1, U	0.200	ug/L	0.250	<0.200		25-150		40
Diazinon	0.0692	J1, U	0.500	ug/L	0.250	<0.500	27.7	25-150	200	40
Malathion	0.0479	J1, U	0.100	ug/L	0.250	<0.100	19.1	25-150	200	40
Parathion, ethyl	0.0826	J1, U	0.100	ug/L	0.250	<0.100	33.0	25-150	114	40
<i>Surrogate: Tributyl Phosphate-surr</i>		S	0.260	ug/L	0.100		259	40-120		
<i>Surrogate: Triphenyl Phosphate-surr</i>		S	0.0263	ug/L	0.100		26.3	40-120		

Batch: BHG0419 - SM 6640 B

MB HERB (BHG0419-BLK1)

Prepared: 7/3/2024 Analyzed: 7/18/2024

2,4-D	<0.700	U	0.700	ug/L						
Silvex (2,4,5-TP)	<0.300	U	0.300	ug/L						
<i>Surrogate: DCAA-surr</i>		S	15.7	ug/L	24.9		63.1	70-130		

BS HERB (BHG0419-BS1)

Prepared: 7/3/2024 Analyzed: 7/18/2024

2,4-D	4.92		0.700	ug/L	5.14		95.6	70-130		
Silvex (2,4,5-TP)	4.98		0.300	ug/L	4.99		99.7	70-130		
<i>Surrogate: DCAA-surr</i>			21.6	ug/L	25.0		86.5	70-130		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Organics by GC (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHG0419 - SM 6640 B (Continued)										
BSD HERB (BHG0419-BSD1)										
2,4-D	4.74		0.700	ug/L	5.11		92.6	70-130	3.67	30
Silvex (2,4,5-TP)	4.83		0.300	ug/L	4.97		97.2	70-130	3.09	30
Surrogate: DCAA-surr			20.6	ug/L	24.8		83.1	70-130		
24G1325-01 MS (BHG0419-MS1)										
Source: 24G1325-01										
2,4-D	5.33		0.700	ug/L	5.10	<0.700	105	70-130		
Silvex (2,4,5-TP)	5.35		0.300	ug/L	4.95	<0.300	108	70-130		
Surrogate: DCAA-surr			24.8	ug/L	24.8		100	70-130		
24G1325-01 MSD (BHG0419-MSD1)										
Source: 24G1325-01										
2,4-D	5.09		0.700	ug/L	5.09	<0.700	100	70-130	4.69	30
Silvex (2,4,5-TP)	5.08		0.300	ug/L	4.94	<0.300	103	70-130	5.00	30
Surrogate: DCAA-surr			28.8	ug/L	24.7		117	70-130		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Metals, Total

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHF3940 - EPA 200.8										
Blank (BHF3940-BLK1)										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Aluminum	<5.00	U	5.00	ug/L						
Copper	<2.00	U	2.00	ug/L						
Nickel	<2.00	U	2.00	ug/L						
Selenium	<5.00	U	5.00	ug/L						
Zinc	<5.00	U	5.00	ug/L						
Blank (BHF3940-BLK2)										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Arsenic	<0.500	U	0.500	ug/L						
Blank (BHF3940-BLK3)										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Antimony	<5.00	U	5.00	ug/L						
Barium	<6.00	U	6.00	ug/L						
Chromium	<3.00	U	3.00	ug/L						
Thallium	<1.25	U	1.25	ug/L						
Blank (BHF3940-BLK4)										
Prepared: 6/28/2024 Analyzed: 7/9/2024										
Beryllium	<0.500	U	0.500	ug/L						
Cadmium	<1.00	U	1.00	ug/L						
Lead	<0.500	U	0.500	ug/L						
Silver	<0.500	U	0.500	ug/L						
LCS (BHF3940-BS1)										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Aluminum	269		5.00	ug/L	250		108	85-115		
Copper	113		2.00	ug/L	100		113	85-115		
Nickel	112		2.00	ug/L	100		112	85-115		
Selenium	188		5.00	ug/L	200		93.8	85-115		
Zinc	220		5.00	ug/L	200		110	85-115		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Metals, Total (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHF3940 - EPA 200.8 (Continued)										
LCS (BHF3940-BS2)										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Arsenic	52.2		0.500	ug/L	50.0		104	85-115		
LCS (BHF3940-BS3)										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Antimony	111		1.00	ug/L	100		111	85-115		
Barium	306		6.00	ug/L	300		102	85-115		
Chromium	291		3.00	ug/L	300		97.0	85-115		
Thallium	50.9		1.25	ug/L	50.0		102	85-115		
LCS (BHF3940-BS4)										
Prepared: 6/28/2024 Analyzed: 7/9/2024										
Beryllium	21.4		0.200	ug/L	20.0		107	85-115		
Cadmium	109		1.00	ug/L	100		109	85-115		
Lead	52.2		0.500	ug/L	50.0		104	85-115		
Silver	50.8		0.500	ug/L	50.0		102	85-115		
Duplicate (BHF3940-DUP1)										
Source: 24F4915-02										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Aluminum	9.14		5.00	ug/L		8.91		2.55	20	
Copper	3.23 J1		2.00	ug/L		6.21		63.2	20	
Nickel	3.35		2.00	ug/L		3.35		0.119	20	
Selenium	0.648 U		5.00	ug/L		0.623		3.93	20	
Zinc	33.8		5.00	ug/L		37.0		9.15	20	
Duplicate (BHF3940-DUP2)										
Source: 24F4915-02										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Arsenic	5.72		0.500	ug/L		5.98		4.53	20	
Duplicate (BHF3940-DUP3)										
Source: 24F4915-02										
Prepared: 6/28/2024 Analyzed: 7/2/2024										
Antimony	0.829 U		1.00	ug/L		0.850		2.50	20	
Barium	87.3		6.00	ug/L		84.4		3.35	20	
Chromium	1.47 U		3.00	ug/L		1.32		10.8	20	
Thallium	<1.25 U		1.25	ug/L		<1.25			20	

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Metals, Total (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHF3940 - EPA 200.8 (Continued)										
Duplicate (BHF3940-DUP4)										
Source: 24F4915-02 Prepared: 6/28/2024 Analyzed: 7/9/2024										
Beryllium	<0.200	U	0.200	ug/L		<0.200				20
Cadmium	0.594	U	1.00	ug/L		0.572			3.77	20
Lead	0.0490	U	0.500	ug/L		0.0520			5.94	20
Silver	<0.500	U	0.500	ug/L		<0.500				20
Matrix Spike (BHF3940-MS1)										
Source: 24F4915-02 Prepared: 6/28/2024 Analyzed: 7/2/2024										
Aluminum	232		5.00	ug/L	250	8.91	89.2	75-125		
Copper	93.5		2.00	ug/L	100	6.21	87.3	75-125		
Nickel	92.0		2.00	ug/L	100	3.35	88.6	75-125		
Selenium	168		5.00	ug/L	200	0.623	83.6	75-125		
Zinc	212		5.00	ug/L	200	37.0	87.4	75-125		
Matrix Spike (BHF3940-MS2)										
Source: 24F4915-02 Prepared: 6/28/2024 Analyzed: 7/2/2024										
Arsenic	53.0		0.500	ug/L	50.0	5.98	94.0	75-125		
Matrix Spike (BHF3940-MS3)										
Source: 24F4915-02 Prepared: 6/28/2024 Analyzed: 7/2/2024										
Antimony	92.2		1.00	ug/L	100	0.850	91.3	75-125		
Barium	373		6.00	ug/L	300	84.4	96.1	75-125		
Chromium	268		3.00	ug/L	300	1.32	88.8	75-125		
Thallium	46.1		1.25	ug/L	50.0	<1.25	92.2	75-125		
Matrix Spike (BHF3940-MS4)										
Source: 24F4915-02 Prepared: 6/28/2024 Analyzed: 7/9/2024										
Beryllium	21.4		0.200	ug/L	20.0	<0.200	107	75-125		
Cadmium	99.3		1.00	ug/L	100	0.572	98.8	75-125		
Lead	52.0		0.500	ug/L	50.0	0.0520	104	75-125		
Silver	49.1		0.500	ug/L	50.0	<0.500	98.3	75-125		

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Metals, Total (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHH3453 - EPA 1631										
Blank (BHH3453-BLK1)										
Mercury	<0.00500	U	0.00500	ug/L						
Prepared: 8/26/2024 Analyzed: 8/27/2024										
Blank (BHH3453-BLK2)										
Mercury	<0.00500	U	0.00500	ug/L						
Prepared: 8/26/2024 Analyzed: 8/27/2024										
Blank (BHH3453-BLK3)										
Mercury	<0.00500	U	0.00500	ug/L						
Prepared: 8/26/2024 Analyzed: 8/27/2024										
Matrix Spike (BHH3453-MS1)										
Mercury	0.0325	J1	0.00526	ug/L	0.0526	<0.00526	61.7	71-125		
Source: 24G1576-02 Prepared: 8/26/2024 Analyzed: 8/27/2024										
Matrix Spike (BHH3453-MS2)										
Mercury	0.0262	J1	0.00526	ug/L	0.0526	<0.00526	49.7	71-125		
Source: 24H0748-01 Prepared: 8/26/2024 Analyzed: 8/27/2024										
Matrix Spike Dup (BHH3453-MSD1)										
Mercury	0.0298	J1	0.00526	ug/L	0.0526	<0.00526	56.7	71-125	8.49	24
Source: 24G1576-02 Prepared: 8/26/2024 Analyzed: 8/27/2024										
Matrix Spike Dup (BHH3453-MSD2)										
Mercury	0.0239	J1	0.00526	ug/L	0.0526	<0.00526	45.4	71-125	8.96	24
Source: 24H0748-01 Prepared: 8/26/2024 Analyzed: 8/27/2024										

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

Metals, Dissolved

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHH2911 - Cr VI										
Matrix Spike (BHH2911-MS1)										
Chromium (VI)	255		3.00	ug/L	250	7.58	99.1	70-130		
Matrix Spike Dup (BHH2911-MSD1)										
Chromium (VI)	255		3.00	ug/L	250	7.58	99.2	70-130	0.0626	20
Batch: BHH3712 - Cr VI										
Matrix Spike (BHH3712-MS1)										
Chromium (VI)	249		3.00	ug/L	250	14.5	94.0	70-130		
Matrix Spike Dup (BHH3712-MSD1)										
Chromium (VI)	250		3.00	ug/L	250	14.5	94.4	70-130	0.384	20

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

General Chemistry

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHF3919 - CBOD-5210

LCS (BHF3919-BS1)	Prepared: 6/27/2024 Analyzed: 7/2/2024					
Carbonaceous BOD (CBOD)	200		mg/L	198	101	85-115
Duplicate (BHF3919-DUP1)	Source: 24F4924-04 Prepared: 6/27/2024 Analyzed: 7/2/2024					
Carbonaceous BOD (CBOD)	<2.40	U	mg/L	2.40	<2.40	40
Duplicate (BHF3919-DUP2)	Source: 24F0050-04 Prepared: 6/27/2024 Analyzed: 7/2/2024					
Carbonaceous BOD (CBOD)	86.7		mg/L	50.0	73.6	16.3
						20

Batch: BHF3943 - TDS

Blank (BHF3943-BLK1)	Prepared: 6/28/2024 Analyzed: 7/1/2024					
Residue-filterable (TDS)	<10.0	U	mg/L	10.0		
LCS (BHF3943-BS1)	Prepared: 6/28/2024 Analyzed: 7/1/2024					
Residue-filterable (TDS)	146		mg/L	10.0	150	97.3
Duplicate (BHF3943-DUP1)	Source: 24F0112-02 Prepared: 6/28/2024 Analyzed: 7/1/2024					
Residue-filterable (TDS)	718		mg/L	10.0	734	2.20
						10

Batch: BHF3952 - TSS

Blank (BHF3952-BLK1)	Prepared: 6/28/2024 Analyzed: 7/1/2024					
Residue-nonfilterable (TSS)	<1.00	U	mg/L	1.00		
LCS (BHF3952-BS1)	Prepared: 6/28/2024 Analyzed: 7/1/2024					
Residue-nonfilterable (TSS)	99.0		mg/L	1.00	100	99.0
						85-115

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

General Chemistry (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHF3952 - TSS (Continued)

Duplicate (BHF3952-DUP1) Residue-nonfilterable (TSS)	1.05	J1	1.00	mg/L		Prepared: 6/28/2024 Analyzed: 7/1/2024 <1.00			200	10
Duplicate (BHF3952-DUP2) Residue-nonfilterable (TSS)	2.53		1.00	mg/L		Prepared: 6/28/2024 Analyzed: 7/1/2024 2.32			8.70	10

Batch: BHF3955 - Alkalinity

Blank (BHF3955-BLK1) Conductivity	<2.00	U	2.00	umhos/cm @ 25 °C		Prepared & Analyzed: 6/28/2024				
LCS (BHF3955-BS1) Conductivity	1430			umhos/cm @ 25 °C		Prepared & Analyzed: 6/28/2024	1410	101	90-110	
QCS (BHF3955-BS2) Conductivity	511			umhos/cm @ 25 °C		Prepared & Analyzed: 6/28/2024	500	102	90-110	
LCS (BHF3955-BS3) Conductivity	54000		2.00	umhos/cm @ 25 °C		Prepared & Analyzed: 6/28/2024			90-110	
LCS (BHF3955-BS4) Conductivity	229		2.00	umhos/cm @ 25 °C		Prepared & Analyzed: 6/28/2024			90-110	
Alkalinity as CaCO ₃	106			mg/L	100		106	90-110		
Duplicate (BHF3955-DUP1) Alkalinity as CaCO ₃	60.6		10.0	mg/L		Prepared & Analyzed: 6/28/2024	62.7		3.45	15
Conductivity	844		2.00	umhos/cm @ 25 °C			850		0.708	15

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

General Chemistry (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHF3955 - Alkalinity (Continued)										
Duplicate (BHF3955-DUP2)										
Source: 24F4424-01										
Alkalinity as CaCO ₃										
186										
Conductivity										
533										
2.00 umhos/cm @ 25 °C										
Prepared & Analyzed: 6/28/2024										
0.841										
15										
Batch: BHF4087 - EPA 300.0										
Duplicate (BHF4087-DUP1)										
Source: 24F5069-01										
Prepared & Analyzed: 6/28/2024										
Sulfate										
44.4										
Nitrite as N										
921										
Chloride										
288										
Fluoride										
0.330										
Nitrate as N										
113										
100 ug/L										
4.52										
Duplicate (BHF4087-DUP2)										
Source: 24E6647-10RE1										
Prepared & Analyzed: 6/28/2024										
Nitrate as N										
102										
Sulfate										
63.3										
Chloride										
66.5										
Fluoride										
0.221 U										
<50.0 U										
50.0 ug/L										
<50.0										
MRL Check (BHF4087-MRL1)										
Prepared & Analyzed: 6/28/2024										
Nitrite as N										
48.0 U										
50.0 ug/L										
50.0										
Nitrate as N										
1.17										
1.00 mg/L										
63.3										
Nitrate as N										
0.283										
0.250 mg/L										
0.250										
Chloride										
114										
100 ug/L										
114										
1.06										
1.00 mg/L										
106										
50-150										
Matrix Spike (BHF4087-MS1)										
Source: 24F5069-01										
Prepared & Analyzed: 6/28/2024										
Nitrate as N										
2280										
111 ug/L										
2220										
108										
97.9										
80-120										
Fluoride										
5.54										
0.278 mg/L										
5.56										
0.325										
93.8										
80-120										
Nitrite as N										
2010										
55.6 ug/L										
1110										
916										
98.5										
80-120										
Sulfate										
69.7										
1.11 mg/L										
22.2										
44.4										
114										
292										
NR										
80-120										

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

General Chemistry (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
Batch: BHF4087 - EPA 300.0 (Continued)										
Matrix Spike (BHF4087-MS2)			Source: 24E6647-10RE1			Prepared & Analyzed: 6/28/2024				
Sulfate	77.3	J1		11.1	mg/L	22.2	63.3	62.9	80-120	
Nitrate as N	2390			111	ug/L	2220	95.0	103	80-120	
Nitrite as N	1180			55.6	ug/L	1110	<55.6	106	80-120	
Fluoride	5.45			0.278	mg/L	5.56	0.224	94.0	80-120	
Chloride	81.7	J1		11.1	mg/L	11.1	66.1	140	80-120	

Batch: BHG0077 - TKN T

Blank (BHG0077-BLK1)					Prepared: 7/1/2024	Analyzed: 7/2/2024				
Total Kjeldahl Nitrogen - (TKN)	<1.00	U		1.00	mg/L					
LCS (BHG0077-BS1)										
Total Kjeldahl Nitrogen - (TKN)	1.90			1.00	mg/L	1.97	96.5	85-115		
Duplicate (BHG0077-DUP1)			Source: 24F2695-01			Prepared: 7/1/2024	Analyzed: 7/2/2024			
Total Kjeldahl Nitrogen - (TKN)	56.9	J1		1.00	mg/L	42.2			29.6	20
Matrix Spike (BHG0077-MS1)			Source: 24F2695-01			Prepared: 7/1/2024	Analyzed: 7/2/2024			
Total Kjeldahl Nitrogen - (TKN)	58.9	J1		1.00	mg/L	4.00	42.2	417	85-115	

Batch: BHG0085 - NH3-N SEAL-350.1

Matrix Spike (BHG0085-MS1)			Source: 24F5176-02			Prepared & Analyzed: 7/2/2024				
Ammonia as N	0.214			0.0400	mg/L	0.200	0.0200	97.0	90-110	
Matrix Spike (BHG0085-MS2)										
Ammonia as N	0.278		Source: 24F5105-01			Prepared & Analyzed: 7/2/2024				
				0.0400	mg/L	0.200	0.0860	96.0	90-110	

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

General Chemistry (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0085 - NH3-N SEAL-350.1 (Continued)

Matrix Spike Dup (BHG0085-MSD1)	Source: 24F5176-02	Prepared & Analyzed: 7/2/2024								
Ammonia as N	0.214		0.0400	mg/L	0.200	0.0200	97.0	90-110	0.00	20
Matrix Spike Dup (BHG0085-MSD2)	Source: 24F5105-01	Prepared & Analyzed: 7/2/2024								
Ammonia as N	0.283		0.0400	mg/L	0.200	0.0860	98.5	90-110	1.78	20

Batch: BHG0180 - Phosphorus EPA 365.1

LCS (BHG0180-BS1)		Prepared: 7/9/2024 Analyzed: 7/10/2024								
Total Phosphorus	0.240		0.0100	mg/L	0.250		96.0	90-110		
Matrix Spike (BHG0180-MS1)	Source: 24F2427-01	Prepared: 7/9/2024 Analyzed: 7/10/2024								
Total Phosphorus	4.81		0.200	mg/L	5.00	<0.200	96.2	80-120		
Matrix Spike (BHG0180-MS2)	Source: 24F4931-01	Prepared: 7/9/2024 Analyzed: 7/10/2024								
Total Phosphorus	10.1		0.200	mg/L	5.00	5.08	101	80-120		
Matrix Spike Dup (BHG0180-MSD1)	Source: 24F2427-01	Prepared: 7/9/2024 Analyzed: 7/10/2024								
Total Phosphorus	4.70		0.200	mg/L	5.00	<0.200	94.0	80-120	2.27	20
Matrix Spike Dup (BHG0180-MSD2)	Source: 24F4931-01	Prepared: 7/9/2024 Analyzed: 7/10/2024								
Total Phosphorus	9.80		0.200	mg/L	5.00	5.08	94.3	80-120	3.47	20

Batch: BHG0858 - CN-4500

Blank (BHG0858-BLK1)		Prepared & Analyzed: 7/8/2024								
Total Cyanide	<10.0 U		10.0	ug/L						

* A = Accredited, N = Not Accredited or Accreditation not available



Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Quality Control
(Continued)

General Chemistry (Continued)

Analyte	Result	Qual	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit
---------	--------	------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------

Batch: BHG0858 - CN-4500 (Continued)

LCS (BHG0858-BS1)										
Total Cyanide	201		10.0	ug/L	200	100	90-110			
QCS (BHG0858-BS2)										
Total Cyanide	200		10.0	ug/L	200	99.8	90-110			
MRL Check (BHG0858-MRL1)										
Total Cyanide	12.1		10.0	ug/L	10.0	121	50-150			
Matrix Spike (BHG0858-MS1)										
Total Cyanide	210		10.2	ug/L	204	8.74	98.8	80-120		
Matrix Spike Dup (BHG0858-MSD1)										
Total Cyanide	206		10.2	ug/L	204	8.74	96.9	80-120	1.86	20

Batch: BHG0933 - EPA 1664

Blank (BHG0933-BLK1)										
n-Hexane Extractable Material (O&G)	<5.00	U	5.00	mg/L	Prepared & Analyzed: 7/9/2024					
LCS (BHG0933-BS1)										
n-Hexane Extractable Material (O&G)	39.6		5.00	mg/L	40.0	99.0	77.5-114.5			
LCS Dup (BHG0933-BSD1)										
n-Hexane Extractable Material (O&G)	37.7		5.00	mg/L	40.0	94.3	77.5-114.5	4.89	20	
Matrix Spike (BHG0933-MS1)										
n-Hexane Extractable Material (O&G)	42.7	J1	5.00	mg/L	160	7.80	21.8	77.5-114.5		

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwcls.com
www. NWCLS.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Sample Condition Checklist

Work Order: 24F3394

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

Work Order: 24F3395

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

Work Order: 24F3396

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwcls.com
www. NWCLS.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Work Order: 24G1575

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

Work Order: 24G1576

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

Work Order: 24G2868

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

* A = Accredited, N = Not Accredited or Accreditation not available



130 S. Trade Center Parkway, Conroe TX 77385
Tel: (936) 321-6060
Email: lab@nwdl.com
www. NWDLs.com
TCEQ TX-C24-00185

Veolia Water
931 E Floodgate Rd
Freeport, TX 77541

Reported:
09/23/2024 10:47

Work Order: 24H4177

Check Points

No	Custody Seals
Yes	Containers Intact
Yes	COC/Labels Agree
Yes	Received On Ice
Yes	Appropriate Containers
Yes	Appropriate Sample Volume
Yes	Coolers Intact
Yes	Samples Accepted

* A = Accredited, N = Not Accredited or Accreditation not available

Veolia Water
 931 E Floodgate Rd
 Freeport, TX 77541

Reported:
 09/23/2024 10:47

Term and Qualifier Definitions

Item	Definition
CQ	needs a higher dilution due to interferences
J1	Estimated value - The reported value is outside the established quality control criteria for accuracy and/or precision.
L	Off scale high - The concentration of the analyte exceeds the linear range.
S	The surrogate recovery was outside the established laboratory recovery limit.
U	Non-detected compound.
RPD	Relative Percent Difference
%REC	Percent Recovery
Source	Sample that was matrix spiked or duplicated
*	A = Accredited, N = Not Accredited or Accreditation not available
DF	Dilution Factor - the factor applied to the reported data due to sample preparation, dilution, or moisture content
MDL	Method Detection Limit - The minimum concentration of a substance (or analyte) that can be measured and reported with 99% confidence that the analyte concentration is greater than zero. Based on standard deviation of replicate spiked samples taken through all steps of the analytical procedure following 40 CFR Part 136 Appendix B.
SDL	Sample Detection Limit - The minimum concentration of a substance (analyte) that can be measured and reported with 99% confidence that the analyte concentration is greater than zero. The SDL is an adjusted limit thus sample specific and accounts for preparation weights and volumes, dilutions, and moisture content of soil/sediments. If there are no sample specific parameters, the MDL = SDL.
MRL	Method Reporting Limit - Analyte concentration that corresponds to the lowest level lab reports with confidence in accuracy of quantitation and without qualification (i.e. J-flagged). The MRL is at or above the lowest calibration standard.
LRL	Laboratory Reporting Limit - Analyte concentration that corresponds to the lowest level lab reports with confidence in accuracy of quantitation and without qualification (i.e. J-flagged). The LRL is an adjusted limit thus sample specific and accounts for preparation weights and volumes, dilutions, and moisture content of soil/sediments. If there are no sample specific parameters, the MRL = LRL.

* A = Accredited, N = Not Accredited or Accreditation not available

TCEQ TX-C24-00185

24F3394



Lab PM : Aundra Noe

Veolia Water

Jerry Meeks Jr.

931 E Floodgate Rd

Ft. Worth, TX 76141

Phone: (979) 233-4281

Project Name : Veolia Water - Outfall 001 3 Part Grab Composite 1

**Project Comments: DAY OF GRAB 1 - TAKE GLASS RECEPTACLE & PLACE IN SAMPLER
COORDINATE GRAB 1 & GRAB 2 COLLECTION TIMES WITH OTHER FIELD TECH IF NEEDED**

Schedule Comments

Page 47 of 80

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation	Field Results
24F3394-01	18 Mohn DI	6/19/2024 14:00:00	6/19/2024 14:00:00	AQ Grab	A Glass 4oz Boston Round	LL Hg-1631	BrCl
24F3394-02	Outfall 001 3 Part Grab	6/19/2024 14:00:00	6/19/2024 14:00:00	AQ Grab	A Glass VOA 40mL HCl pH<2 B Glass VOA 40mL HCl pH<2 C Glass VOA 40mL HCl pH<2 D Glass VOA 40mL E Glass VOA 40mL F Glass VOA 40mL G Glass 4oz Boston Round	LL Hg-1631 Composite VOA	BrCl 4°C

Field Remarks:	
Sampler (Signature)	Relinquished By: (Signature)
Print Name	Relinquished By: (Signature)
Terri Meeks Jr	Relinquished To Lab By: (Signature)
Affiliation	Date/Time
Terri Meeks Jr	6/19/2024 14:00:00
Custody Seal: Yes / No	Appropriate Volume: Yes / No
Container Intact: Yes / No	Received on Ice: Yes / No
Appropriate Containers: Yes / No	Samples Accepted: Yes / No
	Temperature: _____ °C
	Thermometer ID: _____

TCEQ TX-C24-00185

24F-3395

Schedule Comment

Page 48 of 80

Lab PM : Aundra Noe	Project Name : Vœlia Water - Outfall 001 3 Part Grab Composite 2	
Veolia Water Jerry Meeks Jr. 931 E Floodgate Rd Freeport, TX 77541 Phone: (979) 233-4281		

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation	Field Results
24F3395-01	18 Mohn Dr	6/27/2024- 6:26:44	6/27/2024- 6:26:44	AQ Grab	A Glass 4oz Boston Round	LL Hg-1631	BrCl
24F3395-02	Outfall 001 3 Part Grab	6/27/2024- 6:26:44	6/27/2024- 6:26:44	AQ Grab	B Glass VOA 40mL HCl pH<2 B Glass VOA 40mL HCl pH<2 C Glass VOA 40mL HCl pH<2 D Glass VOA 40mL E Glass VOA 40mL F Glass VOA 40mL G Glass 4oz Boston Round	Composite VOA	4°C

Field Remarks:	
Sampler (Signature)	Relinquished By (Signature)
Jerry Meeks Jr.	Jerry Meeks Jr.
Affiliation	Relinquished To Lab By (Signature)
Vœlia	Jerry Meeks Jr.
Custody Seal: Yes / No	Received By (Signature)
Container Intact: Yes / No	Date/Time Received By (Signature)
Appropriate Containers: Yes / No	Received for Laboratory By (Signature)
Coolers Intact: Yes / No	Date/Time Received for Laboratory By (Signature)
	Received on Ice: Yes / No
	Temperature: _____
	Samples Accepted: Yes / No
	Thermometer ID: _____
COC Labels Agree: Yes / No	Appropriate Volume: Yes / No



North Water District Laboratory Services
130 S. Trade Center Pkwy, Conroe Tx 77385
(936) 321-6060 - lab@nwmls.com

TCEQ TX-C24-00185

24F3396



Schedule Comment

Page 49 of 80

Lab PM : Aundra Noe	Project Name : Veolia Water - Permit Renewal
Veolia Water Jerry Meeks Jr. 931 E Floodgate Rd Freeport, TX 77541 Phone: (979) 233-4281	Project Comments: DO reading must be recorded before 9am If CL2 not between 1.0 - 4.0 Call Office Unless Dachlor plant <1 Mark out Duplicated Outfall samples on the regular chain

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation	Field Results	
24F3396-01	Outfall 001	6/29/2024	6/29/2024	AQ Grab	A HDPE 250mL NaOH B HDPE S250mL Na2S2O3 C Glass Wide 1L w/ Teflon-lined Lid D HDPE S250mL Na2S2O3	ENT-ASTMD6503 TC EC-9223 O&G-1664 CN AMEN-4500 CN T-4500	DO Field Flow MGD Field pH Field <10°C <10°C HCl 4°C NaOH 4°C NaOH 4°C	6.05 5.79 7.34 2.14



וְיַעֲשֵׂה וְיִתְהַלֵּךְ

Nordi Water District Laboratory Services
130 S. Trade Center Pkwy, Conroe Tx 77385
(936) 331-6050



North Water District Laboratory Services

130 S. Trade Center Pkwy, Conroe TX 77385
(936) 321-8080 - lab@nwmls.com

TCEQ TX-C24-00185

24F3396



Lab PM : Aundra Noe

Project Name : Veolia Water - Permit Renewal

Veolia Water
Jerry Meeks Jr.
931 E Floodgate Rd
Freeport, TX 77541
Phone: (979) 233-4281

Schedule Commence

Page 51 of 80

Project Comments: DO reading must be recorded before Sam If
C1.2 not between 1.0 ~ 4.0 Call Office
Unless Dechlor plant <1'
Mark out Duplicated Outfall samples on the regular chain

24F3396-03	Outfall 001 3 Part Grab	6/20/2024 6/21/24 AQC	AQ Grab	A Glass VOA 40mL HCl B Glass VOA 40mL HCl C Glass VOA 40mL HCl D Glass VOA 40mL E Glass VOA 40mL F Glass VOA 40mL G Glass 4oz Boston Round	LL Hg-1631 Composite VOA	B/C 4°C
24F3396-04	Outfall 001 3 Part Grab	6/20/2024 6/21/24 AQC	AQ Grab 3-Part Cor	VOA-624	4°C	
24F3396-05	18 Mohn DI	6/20/2024 6/21/24 AQC	AQ Grab	LL Hg-1631	B/C	

Field Remarks:					
Sampler (Signature)	Relinquished By: (Signature)	Lab Preservation: H2SO4 (Circle and Write ID Below)	HNO3	NaOH	Other: _____
Print Name	Relinquished By: (Signature)	Date/Time	Received By: (Signature)	<i>J. Meeks Jr.</i>	Date/Time
Affiliation	Relinquished To Lab By: (Signature)	Date/Time	Received By: (Signature)	<i>J. Meeks Jr.</i>	Date/Time
Custody Seal: Yes / No	Appropriate Volume: Yes / No	Received on Ice: Yes / No	Temperature: _____ °C		
Container Intact: Yes / No	Appropriate Containers: Yes / No	Samples Accepted: Yes / No	Thermometer ID: _____		
PM Kits					



CHAIN OF CUSTODY RECORD

North Water District Laboratory Services
130 S. Trade Center Pkwy, Conroe Tx 77385
(936) 321-6060 - lab@nwds.com

TCEQ TX-C24-00185

Page 1 of 1

24G1575

Veolia Water Jerry Meeks Jr. 931 E Floodgate Rd Freeport, TX 77541 Phone: (979) 233-4281	Project Name : Veolia - Outfall 001 3 Part Grab Composite 1 RC Project Comments:
--	---

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation	Field Results
24G1575-01	18 Mohm Di	8/15/14 0730	AQ Grab	A Glass 4oz Boston Round	LL Hg-1631	BrCl	
24G1575-02	Outfall 001 3 Part Grab	8/14/14 0630	AQ Grab	A Glass 4oz Boston Round	LL Hg-1631	BrCl	

Field Remarks:	
Sampler (Signature)	Relinquished By: (Signature)
Print Name	<i>Jerry Meeks Jr.</i>
Affiliation	<i>Veolia</i>
Preservation: H2SO4	
Date/Time <i>8/15/14 11:10</i>	
Received By: (Signature) <i>John B.</i>	
Date/Time <i>8/15/14 11:20</i>	
Received By: (Signature) <i>John B.</i>	
Date/Time <i>8/15/14 11:20</i>	
Received for Laboratory By: (Signature) <i>John B.</i>	
Date/Time <i>8/15/14 16:00</i>	
COC Labels Agree: Yes / No	
Appropriate Containers: Yes / No	
Coolers Intact: Yes / No	
Appropriate Volume: Yes / No	
Received on Ice: Yes / No	
Samples Accepted: Yes / No	
Temperature: _____ °C	
Thermometer ID: _____	

wko_NWDLS_COC_noDate_LS version 4.02/22/2021

Delete Archive Report Reply Reply all Forward Zoom R

Re: Missing Field Results 24G1574



Justin Wood



Reply

Reply all

Forward



...

To: Susan Keel; Aundra Noe; Rebecca Rabon
 Cc: Angela Martinez

Fri 8/16/2024 11:42 AM



Meeks Jr., Jerry <jerry.meeks2@veolia.com>
 To: Justin Wood

Fri 8/16/2024 11:40 AM

Some content in this message has been blocked because the sender isn't in your Safe senders list.

Trust sender

Show blocked content

CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

The residual was 3.27 mg/L Do I need to put it on the chains and email it to you?

Jerry Meeks, Jr.
 Freeport Project
 Municipal & Commercial Business
 VEOLIA NORTH AMERICA

The total chlorine for both chains should be 3.27 per Jerry.

Thank you,



NWDLS
 North Water District
 Laboratory Services, Inc.

Justin Wood

Project Manager

130 South Trade Center Parkway (Conroe, TX 77385



936.213.6878



281.881.9347

justin.wood@nwdls.comwww.nwdls.com

Find us on



This message and any attachments are intended only for the individual(s) to whom it is addressed. This email is confidential and may be privileged information. If you are neither the intended recipient nor the agent responsible for delivering the message to the intended recipient, you are hereby notified that any dissemination of this communication, disclosure, copying, distribution and use are prohibited and may be unlawful. If you feel you have received this communication in error, please notify us immediately by returning this email to the sender and deleting it out of your email.

From: Justin Wood <justin.wood@nwdls.com>

Sent: Friday, August 16, 2024 11:32 AM

To: Susan Keel <susan.keel@nwdls.com>; Aundra Noe <aundra.noe@nwdls.com>; Rebecca Rabon <rebecca.rabon@nwdls.com>

Cc: Angela Martinez <angela.martinez@nwdls.com>

Subject: Re: Missing Field Results 24G1574

Thank you! I will reach out to Jerry now.



24G1575



24G1577

1/1

Delete Archive Report Reply Reply all Forward Zoom R

Re: Missing Field Results 24G1574



Justin Wood

Project Manager

130 South Trade Center Parkway (Conroe, TX 77385

936.213.6878

Find us on

281.881.9347

justin.wood@nwdls.com

www.nwdls.com



This message and any attachments are intended only for the individual(s) to whom it is addressed. This email is confidential and may be privileged information. If you are neither the intended recipient nor the agent responsible for delivering the message to the intended recipient, you are hereby notified that any dissemination of this communication, disclosure, copying, distribution and use are prohibited and may be unlawful. If you feel you have received this communication in error, please notify us immediately by returning this email to the sender and deleting it out of your email.

From: Susan Keel <susan.keel@nwdls.com>

Sent: Friday, August 16, 2024 11:21 AM

To: Justin Wood <justin.wood@nwdls.com>; Aundra Noe <aundra.noe@nwdls.com>; Rebecca Rabon <rebecca.rabon@nwdls.com>

Cc: Angela Martinez <angela.martinez@nwdls.com>

Subject: Re: Missing Field Results 24G1574

Yes, sorry, here's the other scan!

From: Justin Wood <justin.wood@nwdls.com>

Sent: Friday, August 16, 2024 10:58 AM

To: Susan Keel <susan.keel@nwdls.com>; Aundra Noe <aundra.noe@nwdls.com>; Rebecca Rabon <rebecca.rabon@nwdls.com>

Cc: Angela Martinez <angela.martinez@nwdls.com>

Subject: Re: Missing Field Results 24G1574

Can you also send a scan of 24G1577 so that when I email the customer they can see both chains?

Thank you,



Justin Wood

Project Manager

130 South Trade Center Parkway (Conroe, TX 77385

936.213.6878

Find us on

281.881.9347

justin.wood@nwdls.com

www.nwdls.com

24G1575



24G1577





CHAIN OF CUSTODY RECORD

North Water District Laboratory Services
 130 S. Trade Center Pkwy, Conroe Tx 77385
 (936) 321-6060 - lab@nwdis.com
 TCEQ TX-C24-00185

24G1576

Page 1 of 1

Veolia Water Jerry Meeks Jr. 931 E Floodgate Rd Freeport, TX 77541 Phone: (979) 233-4281	Project Name : Veolia - Outfall 001 3 Part Grab Composite 2 RC Project Comments:	Schedule Comments:
--	---	--------------------

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation	Field Results
24G1576-01	18 Mohm DI	8/15/24 07:30	8/15/24 07:30	AQ Grab	A Glass 4oz Boston Round	LL Hg-1631	BrCl
24G1576-02	Outfall 001 3 Part Grab	8/15/24 07:30	8/15/24 07:30	AQ Grab	A Glass 4oz Boston Round	LL Hg-1631	BrCl

Field Remarks:				
Sampler (Signature)	Reinquished By: (Signature)			
Print Name	Received By: (Signature)			
Jerry Meeks	8/15/24 11:20			
Affiliation	Received By: (Signature)			
Veolia	8/15/24 11:20			
Custody Seal : Yes / No	COC Labels Agree: Yes / No	Appropriate Volume: Yes / No	Received on Ice: Yes / No	Temperature: _____
Container Intact : Yes / No	Appropriate Containers: Yes / No	Coolers Intact Yes / No	Samples Accepted: Yes / No	Thermometer ID: _____ °C

wko_NWDLs_COC_noDate_LS version 4: 02/22/2021



CHAIN OF CUSTODY RECORD

North Water District Laboratory Services
 130 S. Trade Center Pkwy, Conroe Tx 77385
 (936) 321-6060 - lab@nwqls.com
 TCEQ TX-C24-00185

Page 1 of 1

24G2868

Veolia Water
 Jerry Meeks Jr.
 931 E Floodgate Rd
 Freeport, TX 77541
 Phone: (979) 233-4281

Project Name : Veolia Water - Permit Renewal Recollect II

Project Comments:

Schedule Comments:

Veolia Water Jerry Meeks Jr. 931 E Floodgate Rd Freeport, TX 77541 Phone: (979) 233-4281	Project Name : Veolia Water - Permit Renewal Recollect II Project Comments:

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation		Field Results	
						Method	Comments	Method	Comments
24G2868-01	Outfall 001 Sampler	8/14/2019 06:30	8/15/2019 06:10	AQ 24HR Comp	A HDPE 250 Cr6+Buf after filtration	Cr VI-D 3500		Cr6+Buf 4°C	

Field Remarks:	
Sampler (Signature)	Relinquished By: (Signature)
Print Name	8/15/2019 11:00
Affiliation	Received By: (Signature)
Custody Seal : Yes / No	Received By: (Signature)
Container Intact : Yes / No	Received By: (Signature)
COC Labels Agree: Yes / No	Appropriate Volume: Yes / No
Appropriate Containers: Yes / No	Coolers Intact: Yes / No
Container Intact : Yes / No	Received on Ice: Yes / No
	Temperature: °C
	Samples Accepted: Yes / No
	Thermometer ID: _____

wko_NWDLs_COC_noDate_LS version 4: 02/22/2021



CHAIN OF CUSTODY RECORD

North Water District Laboratory Services
 130 S. Trade Center Pkwy, Conroe Tx 77385
 (936) 321-6060 - lab@nwcls.com
 TCEQ TX-C24-00185



Page 1 of 1

24H4177

Veolia Water Jerry Meeks Jr. 931 E Floodgate Rd Freeport, TX 77541 Phone: (979) 233-4281		Project Name : Veolia Water - Permit Renewal Recollect II Project Comments:			
--	--	--	--	--	--

Sample ID	Collection Point	Date/Time Begin	Date/Time Sampled	Sample Type	Container	Analysis/Preservation	Field Results
24H4177-01	Outfall 001 Sampler	8/29/24 14:35	8/29/24 14:35	AQ 24HR Comp	A HDPE 250 Cr6+Buf after filtration	Cr VI-D 3500 Cr6+Buf 4°C	

Field Remarks:		Preservation: H2SO4	HNO3	NaOH	Other: _____
Sampler (Signature)	Relinquished By: (Signature)	Date/Time 8/29/24	Received By: (Signature) J. Meeks Jr.	Date/Time 8/29/24 14:40	Date/Time 8/29/24 14:40
Print Name Jerry Meeks Jr.	Relinquished By: (Signature)	Date/Time	Received By: (Signature)	Date/Time	Date/Time 8/29/24 14:40
Affiliation Veolia	Relinquished To Lab By: (Signature)	Date/Time 8/29/24 15:20	Received for Laboratory By: (Signature)	Date/Time JLW 8/29/24	Date/Time 15:20
Custody Seal : Yes / No	COC Labels Agree: Yes / No	Appropriate Volume: Yes / No	Received on Ice: Yes / No	Temperature: _____ °C	
Container Intact : Yes / No	Appropriate Containers: Yes / No	Coolers Intact: Yes / No	Samples Accepted: Yes / No	Thermometer ID: _____	wko_NWDLs_COC_noDate_LS version 4: 02/22/2021



SUBCONTRACT ORDER

Sending Laboratory:


North Water District Laboratory Services, Inc.
130 South Trade Center Parkway
Conroe, TX 77385
Phone: 936-321-6060
Fax: 936-321-6061

Project Manager: Aundra Noe

Subcontracted Laboratory:

SPL
2600 Dudley Rd
Kilgore, TX 75662
Phone: (903) 984-0551
Fax:

Work Order: 24F3396

Analysis	Due	Expires	Comments
Sample ID: 24F3396-02 Waste Water Sampled: 06/27/2024 14:00			
Sub_CBURP-632	07/11/2024	07/04/2024 14:00	
Analyte(s):			
Carbaryl			
Containers Supplied:			
	07.01.24	UPS	07.01.24
Released By	Date	Received By	Date

Laboratory Analysis Report

Total Number of Pages: 15

Job ID : 24070217



10100 East Freeway, Suite 100, Houston, TX 77029 tel: 713-453-6060, fax: 713-453-6091, http://www.ablabs.com

Client Project Name :
24F3396

Report To : Client Name: NWDLS
Attn: Aundra Noe
Client Address: 130 S Trade Center Pkwy
City, State, Zip: Conroe, Texas, 77385

P.O.#.: 24F3396
Sample Collected By:
Date Collected: 06/27/24

A&B Labs has analyzed the following samples...

Client Sample ID	Matrix	A&B Sample ID
24F3396-02	Waste Water	24070217.01
24F3396-04	Waste Water	24070217.02

A handwritten signature in black ink that reads "ashute".

Released By: Amanda Shute

Title: Project Manager

Date: 7/10/2024



This Laboratory is NELAP (T104704213-23-31) accredited. Effective: 04/01/2024; Expires: 03/31/2025

Scope: Non-Potable Water, Drinking Water, Air, Solid, Biological Tissue, Hazardous Waste

I am the laboratory manager, or his/her designee, and I am responsible for the release of this data package. This laboratory data package has been reviewed and is complete and technically compliant with the requirements of the methods used, except where noted in the attached exception reports. I affirm, to the best of my knowledge that all problems/anomalies observed by this laboratory (and if applicable, any and all laboratories subcontracted through this laboratory) that might affect the quality of the data, have been identified in the Laboratory Review Checklist, and that no information or data have been knowingly withheld that would affect the quality of the data.

This report cannot be reproduced, except in full, without prior written permission of A&B Labs. Results shown relate only to the items tested. Results apply to the sample as received. Samples are assumed to be in acceptable condition unless otherwise noted. Blank correction is not made unless otherwise noted. Air concentrations reported are based on field sampling information provided by client. Soil samples are reported on a wet weight basis unless otherwise noted. Uncertainty estimates are available on request.

ab-q210-0321

Date Received : 07/02/2024 11:10

LABORATORY TERM AND QUALIFIER DEFINITION REPORT



Job ID : 24070217

Date: 7/10/2024

General Term Definition

Back-Wt	Back Weight	MQL	Unadjusted Minimum Quantitation Limit
BRL	Below Reporting Limit	Post-Wt	Post Weight
cfu	colony-forming units	ppm	parts per million
Conc.	Concentration	Pre-Wt	Previous Weight
D.F.	Dilution Factor	Q	Qualifier
Front-Wt	Front Weight	RegLimit	Regulatory Limit
J	Estimation. Below calibration range but above MDL	RLU	Relative Light Unit
LCS	Laboratory Check Standard	RPD	Relative Percent Difference
LCSD	Laboratory Check Standard Duplicate	RptLimit	Reporting Limit
LOD	Limit of detection adjusted for %M + DF	SDL	Sample Detection Limit
LOQ	Limit of Quantitation adjusted for %M + DF	surr	Surrogate
MS	Matrix Spike	T	Time
MSD	Matrix Spike Duplicate	TNTC	Too numerous to count
MW	Molecular Weight	UQL	Unadjusted Upper Quantitation Limit

Qualifier Definition

J	Estimation. Below calibration range but above MDL.
M2	Matrix Spike and/or Matrix Spike Duplicate recovery is below laboratory control limits due to matrix interference.
S6	Surrogate recovery is outside control limits due to matrix effects.
U	Undetected at SDL (Sample Detection Limit).



LABORATORY TEST RESULTS

Job ID : 24070217

Date 7/10/2024

Client Name:	NWDLS	Attn: Aundra Noe
Project Name:	24F3396	

Client Sample ID: 24F3396-02
 Date Collected: 06/27/24
 Time Collected: 14:00
 Other Information:

Job Sample ID: 24070217.01
 Sample Matrix Waste Water
 % Moisture

Test Method	Parameter/Test Description	Result	Units	DF	SDL	SQL	Reg Limit	Q	Date Time	Analyst
EPA 608.3	Polychlorinated Biphenyls									
	Aroclor 1016	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Aroclor 1221	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Aroclor 1232	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Aroclor 1242	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Aroclor 1248	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Aroclor 1254	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Aroclor 1260	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Total PCBs	<0.03	ug/L	1.00	0.03	0.0500		U	07/03/24 17:11	MQ
	Decachlorobiphenyl(surr)	7.00	%	1.00		35-129		S6	07/03/24 17:11	MQ
	Tetrachloro-m-xylene(surr)	42	%	1.00		27-127			07/03/24 17:11	MQ
EPA 608.3	Organochlorine Pesticides									
	Alpha-chlordane	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Dicofol ²	<0.050	ug/L	1.00	0.050	0.050		U	07/09/24 20:02	MQ
	Gamma-chlordane	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	4,4-DDD	<0.002	ug/L	1.00	0.002	0.010		U	07/09/24 20:02	MQ
	4,4-DDE	<0.009	ug/L	1.00	0.009	0.010		U	07/09/24 20:02	MQ
	4,4-DDT	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	a-BHC	<0.003	ug/L	1.00	0.003	0.010		U	07/09/24 20:02	MQ
	Aldrin	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	b-BHC	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Chlordane	<0.100	ug/L	1.00	0.100	0.100		U	07/09/24 20:02	MQ
	d-BHC	<0.006	ug/L	1.00	0.006	0.010		U	07/09/24 20:02	MQ
	Dieldrin	<0.005	ug/L	1.00	0.005	0.010		U	07/09/24 20:02	MQ
	Endosulfan I	<0.007	ug/L	1.00	0.007	0.010		U	07/09/24 20:02	MQ
	Endosulfan II	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Endosulfan sulfate	<0.005	ug/L	1.00	0.005	0.010		U	07/09/24 20:02	MQ
	Endrin	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Endrin aldehyde	<0.003	ug/L	1.00	0.003	0.010		U	07/09/24 20:02	MQ
	g-BHC	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Heptachlor	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Heptachlor epoxide	<0.004	ug/L	1.00	0.004	0.010		U	07/09/24 20:02	MQ
	Methoxychlor	<0.003	ug/L	1.00	0.003	0.010		U	07/09/24 20:02	MQ
	Mirex ²	<0.010	ug/L	1.00	0.010	0.010		U	07/09/24 20:02	MQ
	Toxaphene	<0.100	ug/L	1.00	0.100	0.100		U	07/09/24 20:02	MQ
	Decachlorobiphenyl(surr)	27.8	%	1.00		34-120		S6	07/09/24 20:02	MQ

ab-q212-0321



LABORATORY TEST RESULTS

Job ID : 24070217

Date 7/10/2024

Client Name:	NWDLS	Attn: Aundra Noe
Project Name:	24F3396	

Client Sample ID: 24F3396-02
Date Collected: 06/27/24
Time Collected: 14:00
Other Information:

Job Sample ID: 24070217.01
Sample Matrix Waste Water
% Moisture

Test Method	Parameter/Test Description	Result	Units	DF	SDL	SQL	Reg Limit	Q	Date Time	Analyst
EPA 608.3	Organochlorine Pesticides Tetrachloro-m-xylene(surr)	85.5	%	1.00		24-127			07/09/24 20:02	MQ

ab-q212-0321



LABORATORY TEST RESULTS

Job ID : 24070217

Date 7/10/2024

Client Name:	NWDLS	Attn: Aundra Noe
Project Name:	24F3396	

Client Sample ID: 24F3396-04 Job Sample ID: 24070217.02
Date Collected: 06/27/24 Sample Matrix Waste Water
Time Collected: 14:00 % Moisture
Other Information:

Test Method	Parameter/Test Description	Result	Units	DF	SDL	SQL	Reg Limit	Q	Date Time	Analyst
EPA 624.1	Volatile Organic Compounds									
	1,1,1-Trichloroethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,1,2,2-Tetrachloroethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,1,2-Trichloroethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,1-Dichloroethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,1-Dichloroethylene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,2-Dibromoethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,2-Dichlorobenzene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,2-Dichloroethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,2-Dichloropropane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,3-Dichlorobenzene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	1,4-Dichlorobenzene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	2-chloroethylvinyl Ether	<0.00600	mg/L	1.00	0.00600	0.01000		U	07/05/24 14:50	PN
	Acetonitrile ²	<0.00920	mg/L	1.00	0.00920	0.0200		U	07/05/24 14:50	PN
	Acrolein	<0.00600	mg/L	1.00	0.00600	0.0100		U	07/05/24 14:50	PN
	Benzene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Bromodichloromethane	0.00414	mg/L	1.00	0.00100	0.00500	J	07/05/24 14:50	PN	
	Bromoform	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Bromomethane	<0.00200	mg/L	1.00	0.00200	0.00500		U	07/05/24 14:50	PN
	Carbon tetrachloride	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Chlorobenzene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Chloroethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Chloroform	0.0108	mg/L	1.00	0.00100	0.00500			07/05/24 14:50	PN
	Chloromethane	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	cis-1,3-Dichloropropene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Dibromochloromethane	0.00170	mg/L	1.00	0.00100	0.00500	J	07/05/24 14:50	PN	
	Ethylbenzene	0.00312	mg/L	1.00	0.00100	0.00500	J	07/05/24 14:50	PN	
	MEK	0.00480	mg/L	1.00	0.00100	0.00500	J	07/05/24 14:50	PN	
	Methylene chloride	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Tetrachloroethylene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Toluene	0.00115	mg/L	1.00	0.00100	0.00500	J	07/05/24 14:50	PN	
	trans-1,2-Dichloroethylene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	trans-1,3-Dichloropropene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	Trichloroethylene	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN
	TTHMs	0.01664	mg/L	1.00	0.001	0.0200	J	07/05/24 14:50	PN	
	Vinyl Chloride	<0.00100	mg/L	1.00	0.00100	0.00500		U	07/05/24 14:50	PN

ab-q212-0321



LABORATORY TEST RESULTS

Job ID : 24070217

Date 7/10/2024

Client Name:	NWDLS	Attn:	Aundra Noe
Project Name:	24F3396		

Client Sample ID:	24F3396-04	Job Sample ID:	24070217.02
Date Collected:	06/27/24	Sample Matrix	Waste Water
Time Collected:	14:00	% Moisture	
Other Information:			

Test Method	Parameter/Test Description	Result	Units	DF	SDL	SQL	Reg Limit	Q	Date Time	Analyst
EPA 624.1	Volatile Organic Compounds									
	1,2-Dichloroethane-d4(surr)	96	%	1.00		70-130			07/05/24 14:50	PN
	Dibromofluoromethane(surr)	107	%	1.00		70-130			07/05/24 14:50	PN
	p-Bromofluorobenzene(surr)	95.8	%	1.00		70-130			07/05/24 14:50	PN
	Toluene-d8(surr)	96.3	%	1.00		70-130			07/05/24 14:50	PN

ab-q212-0321

^=Parameter not available for accreditation.

QUALITY CONTROL CERTIFICATE



Job ID : 24070217

Date : 7/10/2024

Analysis : Polychlorinated Biphenyls

Method : EPA 608.3

Reporting Units : ug/L

QC Batch ID : Qb240703136 Created Date : 07/03/24

Created By : AMarapadaga

Samples in This QC Batch : 24070217.01

Extraction :	PB24070333	Prep Method : EPA 608.3	Prep Date : 07/03/24 10:00	Prep By : JCoku
--------------	------------	-------------------------	----------------------------	-----------------

QC Type: Method Blank

Parameter	CAS #	Result	Units	D.F.	MQL	MDL	Qual
Aroclor 1016	12674-11-2	< MDL	ug/L	1.00	0.05	0.025	
Aroclor 1221	11104-28-2	< MDL	ug/L	1.00	0.05	0.026	
Aroclor 1232	11141-16-5	< MDL	ug/L	1.00	0.05	0.026	
Aroclor 1242	53469-21-9	< MDL	ug/L	1.00	0.05	0.026	
Aroclor 1248	12672-29-6	< MDL	ug/L	1.00	0.05	0.026	
Aroclor 1254	11097-69-1	< MDL	ug/L	1.00	0.05	0.026	
Aroclor 1260	11096-82-5	< MDL	ug/L	1.00	0.05	0.026	
Total PCBs		< MDL	ug/L	1.00	0.05	0.026	
Decachlorobiphenyl(surr)	2051-24-3	94	%	1.00			
Tetrachloro-m-xylene(surr)	877-09-8	80	%	1.00			

QC Type: LCS and LCSD

Parameter	LCS Spk Added	LCS Result	LCS % Rec	LCSD Spk Added	LCSD Result	LCSD % Rec	RPD	RPD CtrlLimit	%Recovery CtrlLimit	Qual
Aroclor 1016	2	1.71	85.4	2	1.62	81	5.3	30	53.7-124	
Aroclor 1260	2	1.74	86.8	2	1.66	83	4.5	30	51.7-130	
Total PCBs	4	3.44	86.1	4	3.28	82	4.9	30	51.7-130	

ab-q213-0321

Refer to the Definition page for terms.

QUALITY CONTROL CERTIFICATE



Job ID : 24070217

Date : 7/10/2024

Analysis : Volatile Organic Compounds

Method : EPA 624.1

Reporting Units : mg/L

QC Batch ID : Qb24070581 Created Date : 07/05/24

Created By : PNaidu

Samples in This QC Batch : 24070217.02

Sample Preparation : PB24070560 Prep Method : EPA 624.1

Prep Date : 07/05/24 10:00 Prep By : KVignesh

QC Type: Method Blank

Parameter	CAS #	Result	Units	D.F.	MQL	MDL	Qual
1,1,1-Trichloroethane	71-55-6	< MDL	mg/L	1.00	0.005	0.001	
1,1,2,2-Tetrachloroethane	79-34-5	< MDL	mg/L	1.00	0.005	0.001	
1,1,2-Trichloroethane	79-00-5	< MDL	mg/L	1.00	0.005	0.001	
1,1-Dichloroethane	75-34-3	< MDL	mg/L	1.00	0.005	0.001	
1,1-Dichloroethylene	75-35-4	< MDL	mg/L	1.00	0.005	0.001	
1,2-Dibromoethane	106-93-4	< MDL	mg/L	1.00	0.005	0.001	
1,2-Dichlorobenzene	95-50-1	< MDL	mg/L	1.00	0.005	0.001	
1,2-Dichloroethane	107-06-2	< MDL	mg/L	1.00	0.005	0.001	
1,2-Dichloropropane	78-87-5	< MDL	mg/L	1.00	0.005	0.001	
1,3-Dichlorobenzene	541-73-1	< MDL	mg/L	1.00	0.005	0.001	
1,4-Dichlorobenzene	106-46-7	< MDL	mg/L	1.00	0.005	0.001	
2-chloroethylvinyl Ether	110-75-8	< MDL	mg/L	1.00	0.01	0.006	
Acetonitrile	75-05-8	< MDL	mg/L	1.00	0.02	0.00923	
Acrolein	107-02-8	< MDL	mg/L	1.00	0.01	0.006	
Benzene	71-43-2	< MDL	mg/L	1.00	0.005	0.001	
Bromodichloromethane	75-27-4	< MDL	mg/L	1.00	0.005	0.001	
Bromoform	75-25-2	< MDL	mg/L	1.00	0.005	0.001	
Bromomethane	74-83-9	< MDL	mg/L	1.00	0.005	0.002	
Carbon tetrachloride	56-23-5	< MDL	mg/L	1.00	0.005	0.001	
Chlorobenzene	108-90-7	< MDL	mg/L	1.00	0.005	0.001	
Chloroethane	75-00-3	< MDL	mg/L	1.00	0.005	0.001	
Chloroform	67-66-3	< MDL	mg/L	1.00	0.005	0.001	
Chloromethane	74-87-3	< MDL	mg/L	1.00	0.005	0.001	
cis-1,3-Dichloropropene	10061-01-5	< MDL	mg/L	1.00	0.005	0.001	
Dibromochloromethane	124-48-1	< MDL	mg/L	1.00	0.005	0.001	
Ethylbenzene	100-41-4	< MDL	mg/L	1.00	0.005	0.001	
MEK	78-93-3	< MDL	mg/L	1.00	0.005	0.001	
Methylene chloride	75-09-2	< MDL	mg/L	1.00	0.005	0.001	
Tetrachloroethylene	127-18-4	< MDL	mg/L	1.00	0.005	0.001	
Toluene	108-88-3	< MDL	mg/L	1.00	0.005	0.001	
trans-1,2-Dichloroethylene	156-60-5	< MDL	mg/L	1.00	0.005	0.001	
trans-1,3-Dichloropropene	10061-02-6	< MDL	mg/L	1.00	0.005	0.001	
Trichloroethylene	79-01-6	< MDL	mg/L	1.00	0.005	0.001	
TTHMs		< MDL	mg/L	1.00	0.02	0.002	
Vinyl Chloride	75-01-4	< MDL	mg/L	1.00	0.005	0.001	
Dibromofluoromethane(surr)	1868-53-7	104	%	1.00			
1,2-Dichloroethane-d4(surr)	17060-07-0	103	%	1.00			
Toluene-d8(surr)	2037-26-5	97.4	%	1.00			

ab-q213-0321

Refer to the Definition page for terms.

QUALITY CONTROL CERTIFICATE



Job ID : 24070217

Date : 7/10/2024

Analysis : Volatile Organic Compounds

Method : EPA 624.1

Reporting Units : mg/L

QC Batch ID : Qb24070581 Created Date : 07/05/24

Created By : PNaidu

Samples in This QC Batch : 24070217.02

QC Type: Method Blank

Parameter	CAS #	Result	Units	D.F.	MQL	MDL	Qual
p-Bromofluorobenzene(surr)	460-00-4	97.5	%	1.00			

QC Type: LCS and LCSD

Parameter	LCS Spk Added	LCS Result	LCS % Rec	LCSD Spk Added	LCSD Result	LCSD % Rec	RPD	RPD CtrlLimit	%Recovery CtrlLimit	Qual
1,1-Dichloroethylene	0.04	0.0393	98.3	0.04	0.0393	98.3	0.1	30	82.6-123	
Acetonitrile	0.16	0.152	95.1	0.16	0.149	93.4	2.1	30	60-140	
Benzene	0.04	0.0381	95.2	0.04	0.0388	97	1.9	30	89.9-118	
Chlorobenzene	0.04	0.0392	98.1	0.04	0.0392	98	0.1	30	91.5-114	
Toluene	0.04	0.0380	95	0.04	0.0388	97.1	2.1	30	89.6-118	
Trichloroethylene	0.04	0.0393	98.2	0.04	0.0401	100	2.1	30	84.2-115	
1,1,1-Trichloroethane	0.04	0.0396	98.9	0.04	0.0398	99.5	0.6	30	83.2-127	
1,1,2,2-Tetrachloroethane	0.04	0.0387	96.9	0.04	0.0377	94.3	2.7	30	83.1-121	
1,1,2-Trichloroethane	0.04	0.0370	92.5	0.04	0.0374	93.5	1.1	30	82.1-122	
1,1-Dichloroethane	0.04	0.0388	97	0.04	0.0381	95.4	1.8	30	84.8-123	
1,2-Dibromoethane	0.04	0.0371	92.8	0.04	0.0360	90.1	3.1	30	87.1-119	
1,2-Dichlorobenzene	0.04	0.0395	98.8	0.04	0.0405	101	2.4	30	91.1-115	
1,2-Dichloroethane	0.04	0.0380	95	0.04	0.0366	91.5	3.7	30	82.8-123	
1,2-Dichloropropane	0.04	0.0389	97.3	0.04	0.0396	99.1	1.8	30	87.9-122	
1,3-Dichlorobenzene	0.04	0.0409	102	0.04	0.0421	105	2.9	30	91.7-114	
1,4-Dichlorobenzene	0.04	0.0412	103	0.04	0.0418	105	1.5	30	91.4-115	
MEK	0.04	0.0342	85.4	0.04	0.0327	81.7	4.4	30	59.2-133	
Acrolein	0.08	0.0847	106	0.08	0.0861	108	1.6	30	67.4-118	
Bromodichloromethane	0.04	0.0396	99.1	0.04	0.0392	98	1.1	30	86.3-122	
Bromoform	0.04	0.0396	99	0.04	0.0383	95.8	3.3	30	81.6-120	
Bromomethane	0.04	0.0340	85	0.04	0.0339	84.7	0.3	30	58.1-150	
Carbon tetrachloride	0.04	0.0411	103	0.04	0.0403	101	1.9	30	85.6-130	
Chloroethane	0.04	0.0349	87.2	0.04	0.0367	91.6	5.1	30	77.5-130	
Chloroform	0.04	0.0384	96.1	0.04	0.0389	97.2	1.2	30	85.4-121	
Chloromethane	0.04	0.0370	92.5	0.04	0.0365	91.3	1.4	30	71.4-131	
cis-1,3-Dichloropropene	0.04	0.0423	106	0.04	0.0425	106	0.5	30	89.6-118	
Dibromochloromethane	0.04	0.0391	97.7	0.04	0.0381	95.3	2.6	30	83.8-118	
Ethylbenzene	0.04	0.0397	99.2	0.04	0.0404	101	1.8	30	91.1-115	
Methylene chloride	0.04	0.0372	92.9	0.04	0.0370	92.6	0.5	28	60-140	
Tetrachloroethylene	0.04	0.0334	83.4	0.04	0.0352	88.1	5.3	30	70-130	
trans-1,2-Dichloroethylene	0.04	0.0390	97.4	0.04	0.0389	97.2	0.1	30	85.3-123	
trans-1,3-Dichloropropene	0.04	0.0408	102	0.04	0.0411	103	0.7	30	84.7-119	
Vinyl Chloride	0.04	0.0359	89.7	0.04	0.0352	88	1.9	30	78.5-121	
2-chloroethylvinyl Ether	0.08	0.0729	91.1	0.08	0.0745	93.1	2.2	30	32.6-169	
TTHMs	0.16	0.156766	98	0.16	0.154488	96.6	1.5	30	60-140	

ab-q213-0321

Refer to the Definition page for terms.

QUALITY CONTROL CERTIFICATE



Job ID : 24070217

Date : 7/10/2024

Analysis : Volatile Organic Compounds

Method : EPA 624.1

Reporting Units : mg/L

QC Batch ID : Qb24070581 Created Date : 07/05/24

Created By : PNaidu

Samples in This QC Batch : 24070217.02

QC Type: MS and MSD

QC Sample ID: 24070217.02

Parameter	Sample Result	MS Spk Added	MS Result	MS % Rec	MSD Spk Added	MSD Result	MSD % Rec	RPD	RPD CtrlLimit	%Rec CtrlLimit	Qual
1,1-Dichloroethylene	BRL	0.04	0.0367	91.8						74.5-129	
2-chloroethylvinyl Ether	BRL	0.08	0.0919	115						10-239	
Acetonitrile	BRL	0.16	0.147	91.9						60-140	
Benzene	BRL	0.04	0.0389	97.1						88.4-143	
Chlorobenzene	BRL	0.04	0.0390	97.4						88-112	
Toluene	0.00115	0.04	0.0391	97.7						47-150	
Trichloroethylene	BRL	0.04	0.0392	98						78.8-117	
1,1,1-Trichloroethane	BRL	0.04	0.0391	97.8						74.1-132	
1,1,2,2-Tetrachloroethane	BRL	0.04	0.0422	106						92.5-151	
1,1,2-Trichloroethane	BRL	0.04	0.0401	100						83.1-143	
1,1-Dichloroethane	BRL	0.04	0.0366	91.5						74.6-127	
1,2-Dibromoethane	BRL	0.04	0.0400	100						90-133	
1,2-Dichlorobenzene	BRL	0.04	0.0394	98.4						88.7-115	
1,2-Dichloroethane	BRL	0.04	0.0383	95.8						59-155	
1,2-Dichloropropane	BRL	0.04	0.0392	97.9						84.1-128	
1,3-Dichlorobenzene	BRL	0.04	0.0403	101						84.5-114	
1,4-Dichlorobenzene	BRL	0.04	0.0405	101						83.6-115	
MEK	BRL	0.04	0.0448	112						26.5-198	
Acrolein	BRL	0.08	0.0645	80.6						40-160	
Bromodichloromethane	BRL	0.04	0.0439	110						79.2-143	
Bromoform	BRL	0.04	0.0422	106						67.2-167	
Bromomethane	BRL	0.04	0.0221	55.2						10-242	
Carbon tetrachloride	BRL	0.04	0.0399	99.8						78.7-137	
Chloroethane	BRL	0.04	0.0312	78						68.3-134	
Chloroform	0.0108	0.04	0.0487	94.7						69.2-138	
Chloromethane	BRL	0.04	0.0338	84.6						10-273	
cis-1,3-Dichloropropene	BRL	0.04	0.0435	109						76.9-129	
Dibromochloromethane	BRL	0.04	0.0415	104						65.1-149	
Ethylbenzene	BRL	0.04	0.0414	104						64.3-133	
Methylene chloride	BRL	0.04	0.0343	85.7						25.1-195	
Tetrachloroethylene	BRL	0.04	0.0359	89.6						64-138	
trans-1,2-Dichloroethylene	BRL	0.04	0.0375	93.7						79.6-126	
trans-1,3-Dichloropropene	BRL	0.04	0.0439	110						76.2-134	
Vinyl Chloride	BRL	0.04	0.0327	81.9						54.7-139	
TTHMs	0.0167	0.16	0.176322	99.8						60-140	

ab-q213-0321

Refer to the Definition page for terms.

QUALITY CONTROL CERTIFICATE



Job ID : 24070217

Date : 7/10/2024

Analysis : Organochlorine Pesticides

Method : EPA 608.3

Reporting Units : ug/L

QC Batch ID : Qb24071065 Created Date : 07/09/24

Created By : mqiao

Samples in This QC Batch : 24070217.01

Extraction : PB24070335 Prep Method : EPA 608.3

Prep Date : 07/03/24 10:00 Prep By : JCoku

QC Type: Method Blank

Parameter	CAS #	Result	Units	D.F.	MQL	MDL	Qual
Alpha-chlordane	5103-71-9	< MDL	ug/L	1.00	0.01	0.004	
Dicofol	115-32-2	< MDL	ug/L	1.00	0.05	0.05	
Gamma-chlordane	5103-74-2	< MDL	ug/L	1.00	0.01	0.004	
4,4-DDD	72-54-8	< MDL	ug/L	1.00	0.01	0.002	
4,4-DDE	72-55-9	< MDL	ug/L	1.00	0.01	0.009	
4,4-DDT	50-29-3	< MDL	ug/L	1.00	0.01	0.004	
a-BHC	319-84-6	< MDL	ug/L	1.00	0.01	0.003	
Aldrin	309-00-2	< MDL	ug/L	1.00	0.01	0.004	
b-BHC	319-85-7	< MDL	ug/L	1.00	0.01	0.004	
Chlordane	57-74-9	< MDL	ug/L	1.00	0.1	0.1	
d-BHC	319-86-8	< MDL	ug/L	1.00	0.01	0.006	
Dieldrin	60-57-1	< MDL	ug/L	1.00	0.01	0.005	
Endosulfan I	959-98-8	< MDL	ug/L	1.00	0.01	0.007	
Endosulfan II	33213-65-9	< MDL	ug/L	1.00	0.01	0.004	
Endosulfan sulfate	1031-07-8	< MDL	ug/L	1.00	0.01	0.005	
Endrin	72-20-8	< MDL	ug/L	1.00	0.01	0.004	
Endrin aldehyde	7421-93-4	< MDL	ug/L	1.00	0.01	0.003	
g-BHC	58-89-9	< MDL	ug/L	1.00	0.01	0.004	
Heptachlor	76-44-8	< MDL	ug/L	1.00	0.01	0.004	
Heptachlor epoxide	1024-57-3	< MDL	ug/L	1.00	0.01	0.004	
Methoxychlor	72-43-5	< MDL	ug/L	1.00	0.01	0.003	
Mirex	2385-85-5	< MDL	ug/L	1.00	0.01	0.01	
Toxaphene	8001-35-2	< MDL	ug/L	1.00	0.1	0.1	
Tetrachloro-m-xylene(surr)	877-09-8	75.3	%	1.00			
Decachlorobiphenyl(surr)	2051-24-3	102	%	1.00			

QC Type: LCS and LCSD

Parameter	LCS Spk Added	LCS Result	LCS % Rec	LCSD Spk Added	LCSD Result	LCSD % Rec	RPD	RPD CtrlLimit	%Recovery CtrlLimit	Qual
Alpha-chlordane	0.2	0.204	102	0.2	0.198	99.3	3.2	23	42-132	
Gamma-chlordane	0.2	0.200	100	0.2	0.197	98.5	1.8	21	45-133	
4,4-DDD	0.2	0.224	112	0.2	0.226	113	0.9	24	40.8-141	
4,4-DDE	0.2	0.220	110	0.2	0.208	104	5.6	21	30-136	
4,4-DDT	0.2	0.244	122	0.2	0.224	112	8.5	30	34.3-134	
a-BHC	0.2	0.176	88	0.2	0.179	89.5	1.7	25	37-125	
Aldrin	0.2	0.182	90.8	0.2	0.182	90.8	0.3	23	42-127	
b-BHC	0.2	0.198	98.8	0.2	0.205	103	3.7	24	38.5-132	

ab-q213-0321

Refer to the Definition page for terms.

QUALITY CONTROL CERTIFICATE



Job ID : 24070217

Date : 7/10/2024

Analysis : Organochlorine Pesticides

Method : EPA 608.3

Reporting Units : ug/L

QC Batch ID : Qb24071065 Created Date : 07/09/24

Created By : mqiao

Samples in This QC Batch : 24070217.01

QC Type: LCS and LCSD

Parameter	LCS Spk Added	LCS Result	LCS % Rec	LCSD Spk Added	LCSD Result	LCSD % Rec	RPD	RPD CtrlLimit	%Recovery CtrlLimit	Qual
d-BHC	0.2	0.220	110	0.2	0.212	106	3.9	20	30-139	
Dieldrin	0.2	0.218	109	0.2	0.214	107	2.1	21	40.7-133	
Endosulfan I	0.2	0.154	76.8	0.2	0.150	74.8	2.3	24	45-124	
Endosulfan II	0.2	0.176	88.3	0.2	0.168	84	4.9	21	20-114	
Endosulfan sulfate	0.2	0.218	109	0.2	0.236	118	7.7	20	45-131	
Endrin	0.2	0.210	105	0.2	0.202	101	4.1	24	35.1-136	
Endrin aldehyde	0.2	0.212	106	0.2	0.200	99.8	6.1	33	33.9-130	
g-BHC	0.2	0.187	93.5	0.2	0.188	94	0.5	25	39-132	
Heptachlor	0.2	0.204	102	0.2	0.206	103	0.7	20	34.6-134	
Heptachlor epoxide	0.2	0.192	96.3	0.2	0.194	96.8	0.8	24	39.2-132	
Methoxychlor	0.2	0.254	127	0.2	0.240	120	5.9	24	37.7-143	

QC Type: MS and MSD

QC Sample ID: 24070217.01

Parameter	Sample Result	MS Spk Added	MS Result	MS % Rec	MSD Spk Added	MSD Result	MSD % Rec	RPD	RPD CtrlLimit	%Rec CtrlLimit	Qual
Alpha-chlordane	BRL	0.2	0.0920	46						45-140	
Gamma-chlordane	BRL	0.2	0.118	59.3						45-150	
4,4-DDD	BRL	0.2	0.115	57.5						31-141	
4,4-DDE	BRL	0.2	0.0630	31.5						30-145	
4,4-DDT	BRL	0.2	0.0740	37						25-160	
a-BHC	BRL	0.2	0.158	79.3						37-140	
Aldrin	BRL	0.2	0.0645	32.3						42-140	M2
b-BHC	BRL	0.2	0.184	92						17-147	
d-BHC	BRL	0.2	0.184	91.8						19-140	
Dieldrin	BRL	0.2	0.114	57						36-146	
Endosulfan I	BRL	0.2	0.0985	49.3						45-153	
Endosulfan II	BRL	0.2	0.128	63.8						10-190	
Endosulfan sulfate	BRL	0.2	0.220	110						26-144	
Endrin	BRL	0.2	0.126	62.8						30-147	
Endrin aldehyde	BRL	0.2	0.138	69						60-140	
g-BHC	BRL	0.2	0.181	90.5						32-140	
Heptachlor	BRL	0.2	0.0780	39						34-140	
Heptachlor epoxide	BRL	0.2	0.182	91.3						37-142	
Methoxychlor	BRL	0.2	0.188	94						60-140	

ab-q213-0321

Refer to the Definition page for terms.



Job ID:24070217

07/02/2024

NWDLs

AMS

SUBCONTRACT
ORDER

Sending Laboratory:

North Water District Laboratory Services, Inc.
130 South Trade Center Parkway
Conroe, TX 77385
Phone: 936-321-6060
Fax: 936-321-6061

Project Manager: Aundra Noe

Subcontracted Laboratory:

A & B Labs
10100 East Freeway, Suite 100
Houston, TX 77029
Phone: (713) 453-6060
Fax: (713) 453-6091

Work Order: 24F3396

Analysis	Due	Expires	Comments
Sample ID: 24F3396-02	Waste Water Sampled: 06/27/2024 14:00		
OCP-608	07/11/2024	07/04/2024 14:00	
Analyte(s):			
4,4'-DDD	4,4'-DDE	4,4'-DDT	
Aldrin	alpha-BHC (alpha-Hexachlorocyclohexane)	beta-BHC (beta-Hexachlorocyclohexane)	
Chlordane (Total)	cis-Chlordane (alpha-Chlordane)	delta-BHC	
Dicofol	Dieldrin	Endosulfan I	
Endosulfan II	Endosulfan sulfate	Endrin	
Endrin aldehyde	gamma-BHC (Lindane, gamma-Hexachlorocyclohexane)	gamma-Chlordane	
Heptachlor	Heptachlor epoxide	Methoxychlor	
Mirex	Toxaphene (Chlorinated Camphene)		01AD
PCB-608	07/11/2024 06/22/2025 14:00		
Analyte(s):			
Aroclor-1016 (PCB-1016)	Aroclor-1221 (PCB-1221)	Aroclor-1232 (PCB-1232)	
Aroclor-1242 (PCB-1242)	Aroclor-1248 (PCB-1248)	Aroclor-1254 (PCB-1254)	
Aroclor-1260 (PCB-1260)	PCBs, Total		
Containers Supplied:			
Sample ID: 24F3396-04	Waste Water Sampled: 06/27/2024 14:00		
VOA-624	07/11/2024	07/11/2024 14:00	
Analyte(s):			
1,1,1-Trichloroethane	1,1,2,2-Tetrachloroethane	1,1,2-Trichloroethane	
1,1-Dichloroethane	1,1-Dichloroethylene	1,2-Dibromoethane (EDB, Ethylene dibromide)	
1,2-Dichlorobenzene (o-Dichlorobenzene)	1,2-Dichloroethane (Ethylene dichloride)	1,2-Dichloroethane-d4-surr	
1,2-Dichloropropane	1,3-Dichlorobenzene (m-Dichlorobenzene)	1,4-Dichlorobenzene (p-Dichlorobenzene)	
2-Butanone (Methyl ethyl ketone, MEK)	2-Chloroethyl vinyl ether	4-Bromofluorobenzene-surr	
Acrolein (Propenal)	Acrylonitrile	Benzene	
Bromodichloromethane	Bromoform	Carbon tetrachloride	
Chlorobenzene	Chlorodibromomethane	Chloroethane (Ethyl chloride)	
Chloroform	cis-1,3-Dichloropropene	Dibromofluoromethane-surr	
Ethylbenzene	Methyl bromide (Bromomethane)	Methyl chloride (Chloromethane)	
Methylene chloride (Dichloromethane)	Tetrachloroethylene (Perchloroethylene)	Toluene	
Toluene-d8-surr	Total Trihalomethanes (TTHMs)	trans-1,2-Dichloroethylene	
trans-1,3-Dichloropropylene	Trichloroethylene (Trichloroethylene)	Vinyl chloride (Chloroethylene)	02AF
Containers Supplied:			



**SUBCONTRACT
ORDER**
(Continued)


Released By _____ Date 7/2/24 Received By A.Smith Date 7/2/24

11:10 11:10

4.0°C
1R7
ANS



Sample Condition Checklist

A&B JobID : 24070217	Date Received : 07/02/2024	Time Received : 11:10AM		
Client Name : NWDLS				
Temperature : 4.0°C	Sample pH : NA			
Thermometer ID : IR7	pH Paper ID : NA			
Perservative :	Lot# :			
	Check Points	Yes	No	N/A
1.	Cooler Seal present and signed.		X	
2.	Sample(s) in a cooler.		X	
3.	If yes, ice in cooler.		X	
4.	Sample(s) received with chain-of-custody.		X	
5.	C-O-C signed and dated.		X	
6.	Sample(s) received with signed sample custody seal.			X
7.	Sample containers arrived intact. (If No comment)		X	
8.	Matrix: Water <input checked="" type="checkbox"/> Soil <input type="checkbox"/> Liquid <input type="checkbox"/> Sludge <input type="checkbox"/> Solid <input type="checkbox"/> Cassette <input type="checkbox"/> Tube <input type="checkbox"/> Bulk <input type="checkbox"/> Badge <input type="checkbox"/> Food <input type="checkbox"/> Other <input type="checkbox"/>			
9.	Samples were received in appropriate container(s)		X	
10.	Sample(s) were received with Proper preservative		X	
11.	All samples were tagged or labeled.		X	
12.	Sample ID labels match C-O-C ID's.		X	
13.	Bottle count on C-O-C matches bottles found.		X	
14.	Sample volume is sufficient for analyses requested.		X	
15.	Samples were received with in the hold time.		X	
16.	VOA vials completely filled.		X	
17.	Sample accepted.		X	
18.	Has client been contacted about sub-out			X

Comments : Include actions taken to resolve discrepancies/problem:

Received 3 VOA's unpreserved (02AC) and 3 VOA's preserved with HCL (02DF). ~ANS 07/02/24

Brought by : Client

Received by : ASmith

Check in by/date : ASmith / 07/02/2024

ab-s005-1123

Phone : 713-453-6060

www.ablabs.com

NWDS-G

Project
1109022

North Water District Laboratory
Deena McDaniel
130 S Trade Center Parkway
Suite:100
Conroe, TX 77385

Printed 07/16/2024
7:39

TABLE OF CONTENTS

This report consists of this Table of Contents and the following pages:

<u>Report Name</u>	<u>Description</u>	<u>Pages</u>
1109022_r02_01_ProjectSamples	SPL Kilgore Project P:1109022 C:NWDS Project Sample Cross Reference t:304	1
1109022_r03_03_ProjectResults	SPL Kilgore Project P:1109022 C:NWDS Project Results t:304 PO: #26201	2
1109022_r10_05_ProjectQC	SPL Kilgore Project P:1109022 C:NWDS Project Quality Control Groups	1
1109022_r99_09_CoC_1_of_1	SPL Kilgore CoC NWDS 1109022_1_of_1	2
Total Pages:		6

Email: Kilgore.ProjectManagement@spllabs.com



Report Page 1 of 7

SAMPLE CROSS REFERENCE

Project
1109022

North Water District Laboratory
Deena McDaniel
130 S Trade Center Parkway
Suite:100
Conroe, TX 77385

Printed 7/16/2024 Page 1 of 1

Sample	Sample ID	Taken	Time	Received
2312677	24F3396-02	06/27/2024	14:00:00	07/02/2024

Bottle 01 Client Supplied Amber Glass

Bottle 02 Client Supplied Amber Glass

Bottle 03 Prepared Bottle: 632L'632S 2 mL Autosampler Vial (Batch 1127139) Volume: 1.00000 mL <== Derived from 01 (976 ml)

Method	Bottle	PrepSet	Preparation	QcGroup	Analytical
EPA 632	03	1127139	07/03/2024	1128314	07/11/2024

Email: Kilgore.ProjectManagement@spillabs.com

Report Page 2 of 7

NWDS-G

North Water District Laboratory
 Deena McDaniel
 130 S Trade Center Parkway
 Suite:100
 Conroe, TX 77385

Page 1 of 2

Project

1109022

Printed: 07/16/2024

RESULTS

Sample Results

2312677 24F3396-02

Received: 07/02/2024

Non-Potable Water

Collected by: Client

North Water District

PO:

#26201

Taken: 06/27/2024

13:00:00

EPA 632

	Prepared:	1127139	07/03/2024	13:00:00	Analyzed	1128314	07/11/2024	20:59:00	BRU
--	-----------	---------	------------	----------	----------	---------	------------	----------	-----

Parameter

	Results	Units	RL	Flags	CAS	Bottle
--	---------	-------	----	-------	-----	--------

NELAC
z
Carbaryl (Sevin)
Diuron

Carbaryl (Sevin)	<2.56	ug/L	2.56		63-25-2	03
Diuron	<0.0461	ug/L	0.0461		330-54-1	03

Sample Preparation

2312677 24F3396-02

Received: 07/02/2024

#26201

06/27/2024

	Prepared:	07/02/2024	15:48:31	Calculated	07/02/2024	15:48:31	CAL
--	-----------	------------	----------	------------	------------	----------	-----

Environmental Fee (per Project)

Verified

	Prepared:	07/16/2024	07:38:00	Analyzed	07/16/2024	07:38:00	WJP
--	-----------	------------	----------	----------	------------	----------	-----

Level IV Data Review

Completed

EPA 632

	Prepared:	1127139	07/03/2024	13:00:00	Analyzed	1127139	07/03/2024	13:00:00	CRS
--	-----------	---------	------------	----------	----------	---------	------------	----------	-----

Liquid-Liquid Extr. W/Hex Ex

1/976 ml

01

EPA 632

Prepared: 1127139	07/03/2024	13:00:00	Analyzed: 1128314	07/11/2024	20:59:00	BRU
-------------------	------------	----------	-------------------	------------	----------	-----

NELAC Carbaryl/Diuron

Entered

03



Report Page 3 of 7

2600 Dudley Rd. Kilgore, Texas 75662
24 Waterway Avenue, Suite 375 The Woodlands, TX 77380
Office: 903-984-0551 * Fax: 903-984-5914



1
2

NWDS-G

North Water District Laboratory
Deena McDaniel
130 S Trade Center Parkway
Suite:100
Conroe, TX 77385

Qualifiers:

Page 2 of 2
Project
1109022

Printed: 07/16/2024

We report results on an As Received (or Wet) basis unless marked Dry Weight.

Unless otherwise noted, testing was performed at SPL, Inc.- Kilgore laboratory which holds International, Federal, and state accreditations. Please see our Websites for details.

(N)ELAC - Covered in our NELAC scope of accreditation
z-- Not covered by our NELAC scope of accreditation

These analytical results relate to the sample tested. This report may NOT be reproduced EXCEPT in FULL without written approval of SPL Kilgore. Unless otherwise specified, these test results meet the requirements of NELAC.
RL is the Reporting Limit (sample specific quantitation limit) and is at or above the Method Detection Limit (MDL). CAS is Chemical Abstract Service number. RL is our Reporting Limit, or Minimum Quantitation Level. The RL takes into account the Instrument Detection Limit (IDL), Method Detection Limit (MDL), and Practical Quantitation Limit (PQL), and any dilutions and/or concentrations performed during sample preparation (EQL). Our analytical result must be above this RL before we report a value in the 'Results' column of our report (without a 'J' flag). Otherwise, we report ND (Not Detected above RL), because the result is "<" (less than) the number in the RL column. MAL is Minimum Analytical Level and is typically from regulatory agencies. Unless we report a result in the result column, or interferences prevent it, we work to have our RL at or below the MAL.

Bill Peery, MS, VP Technical Services



Report Page 4 of 7

QUALITY CONTROL



NWDS-G

North Water District Laboratory
 Deena McDaniel
 130 S Trade Center Parkway
 Suite:100
 Conroe, TX 77385

Page 1 of 1

Project

1109022

Printed 07/16/2024

Analytical Set 1128314

EPA 632

Blank

<u>Parameter</u>	<u>PrepSet</u>	<u>Reading</u>	<u>MDL</u>	<u>MQL</u>	<u>Units</u>	<u>File</u>
Carbaryl (Sevin)	1127139	ND	66.1	2500	ug/L	126545799
Diuron	1127139	550	44.4	45.0	ug/L	126545799

CCV

<u>Parameter</u>	<u>Reading</u>	<u>Known</u>	<u>Units</u>	<u>Recover%</u>	<u>Limits%</u>	<u>File</u>
Carbaryl (Sevin)	1050	1000	ug/L	105	70.0 - 130	126545798
Carbaryl (Sevin)	1060	1000	ug/L	106	70.0 - 130	126545802
Carbaryl (Sevin)	1000	1000	ug/L	100	70.0 - 130	126545804
Diuron	997	1000	ug/L	99.7	70.0 - 130	126545798
Diuron	980	1000	ug/L	98.0	70.0 - 130	126545802
Diuron	909	1000	ug/L	90.9	70.0 - 130	126545804

LCS Dup

<u>Parameter</u>	<u>PrepSet</u>	<u>LCS</u>	<u>LCSD</u>	<u>Known</u>	<u>Limits%</u>	<u>LCS%</u>	<u>LCSD%</u>	<u>Units</u>	<u>RPD</u>	<u>Limit%</u>
Carbaryl (Sevin)	1127139	880	772	1000	17.1 - 131	88.0	77.2	ug/L	13.1	30.0
Diuron	1127139	16.0	13.0	1000	0.100 - 138	1.60	1.30	ug/L	20.7	30.0

* Out RPD is Relative Percent Difference: $\text{abs}(r_1-r_2) / \text{mean}(r_1,r_2) * 100\%$

Recover% is Recovery Percent: result / known * 100%

Blank - Method Blank - reagent water or other blank matrices that contains all reagents except standard(s) and is processed simultaneously with and under the same conditions as samples; carried through preparation and analytical procedures exactly like a sample; monitors); CCV - Continuing Calibration Verification

(same standard

used to prepare the curve, typically a mid-range concentration; verifies the continued validity of the calibration curve); LCS Dup - Laboratory Control Sample Duplicate (replicate LCS, analyzed when there is insufficient sample for duplicate or MSD; quantifies accuracy and precision.)

Email: Kilgore.ProjectManagement@spllabs.com



Report Page 5 of 7



SUBCONTRACT ORDER

Sending Laboratory:

North Water District Laboratory Services, Inc.
130 South Trade Center Parkway
Conroe, TX 77385
Phone: 936-321-6060
Fax: 936-321-6061

Project Manager: Aundra Noe

Subcontracted Laboratory:

SPL
2600 Dudley Rd
Kilgore, TX 75662
Phone: (903) 984-0551
Fax:

Work Order: 24F3396

Analysis	Due	Expires	Comments	2319679
----------	-----	---------	----------	---------

Sample ID: 24F3396-02 Waste Water Sampled: 06/27/2024 14:00

Sub_CBURP-632 07/11/2024 07/04/2024 14:00

Analyte(s):

Carbaryl Diuron

Containers Supplied:

CHM/A
Released By

07.01.24
Date

UPS
Received By

07.01.24
Date

UPS

7/2/24
Date

MCA
Received By

7/2/24
Date

1035

1035

1
2
3
4

2 of 2

1109022 CoC Print Group 001 of 001




7/2/24 1520 mmv
Date Time Tech
Temp: 71.11.6 C

Therm#: 6205 Corr Fact: 0.5 C

Report Page 7 of 7

Page 80 of 80

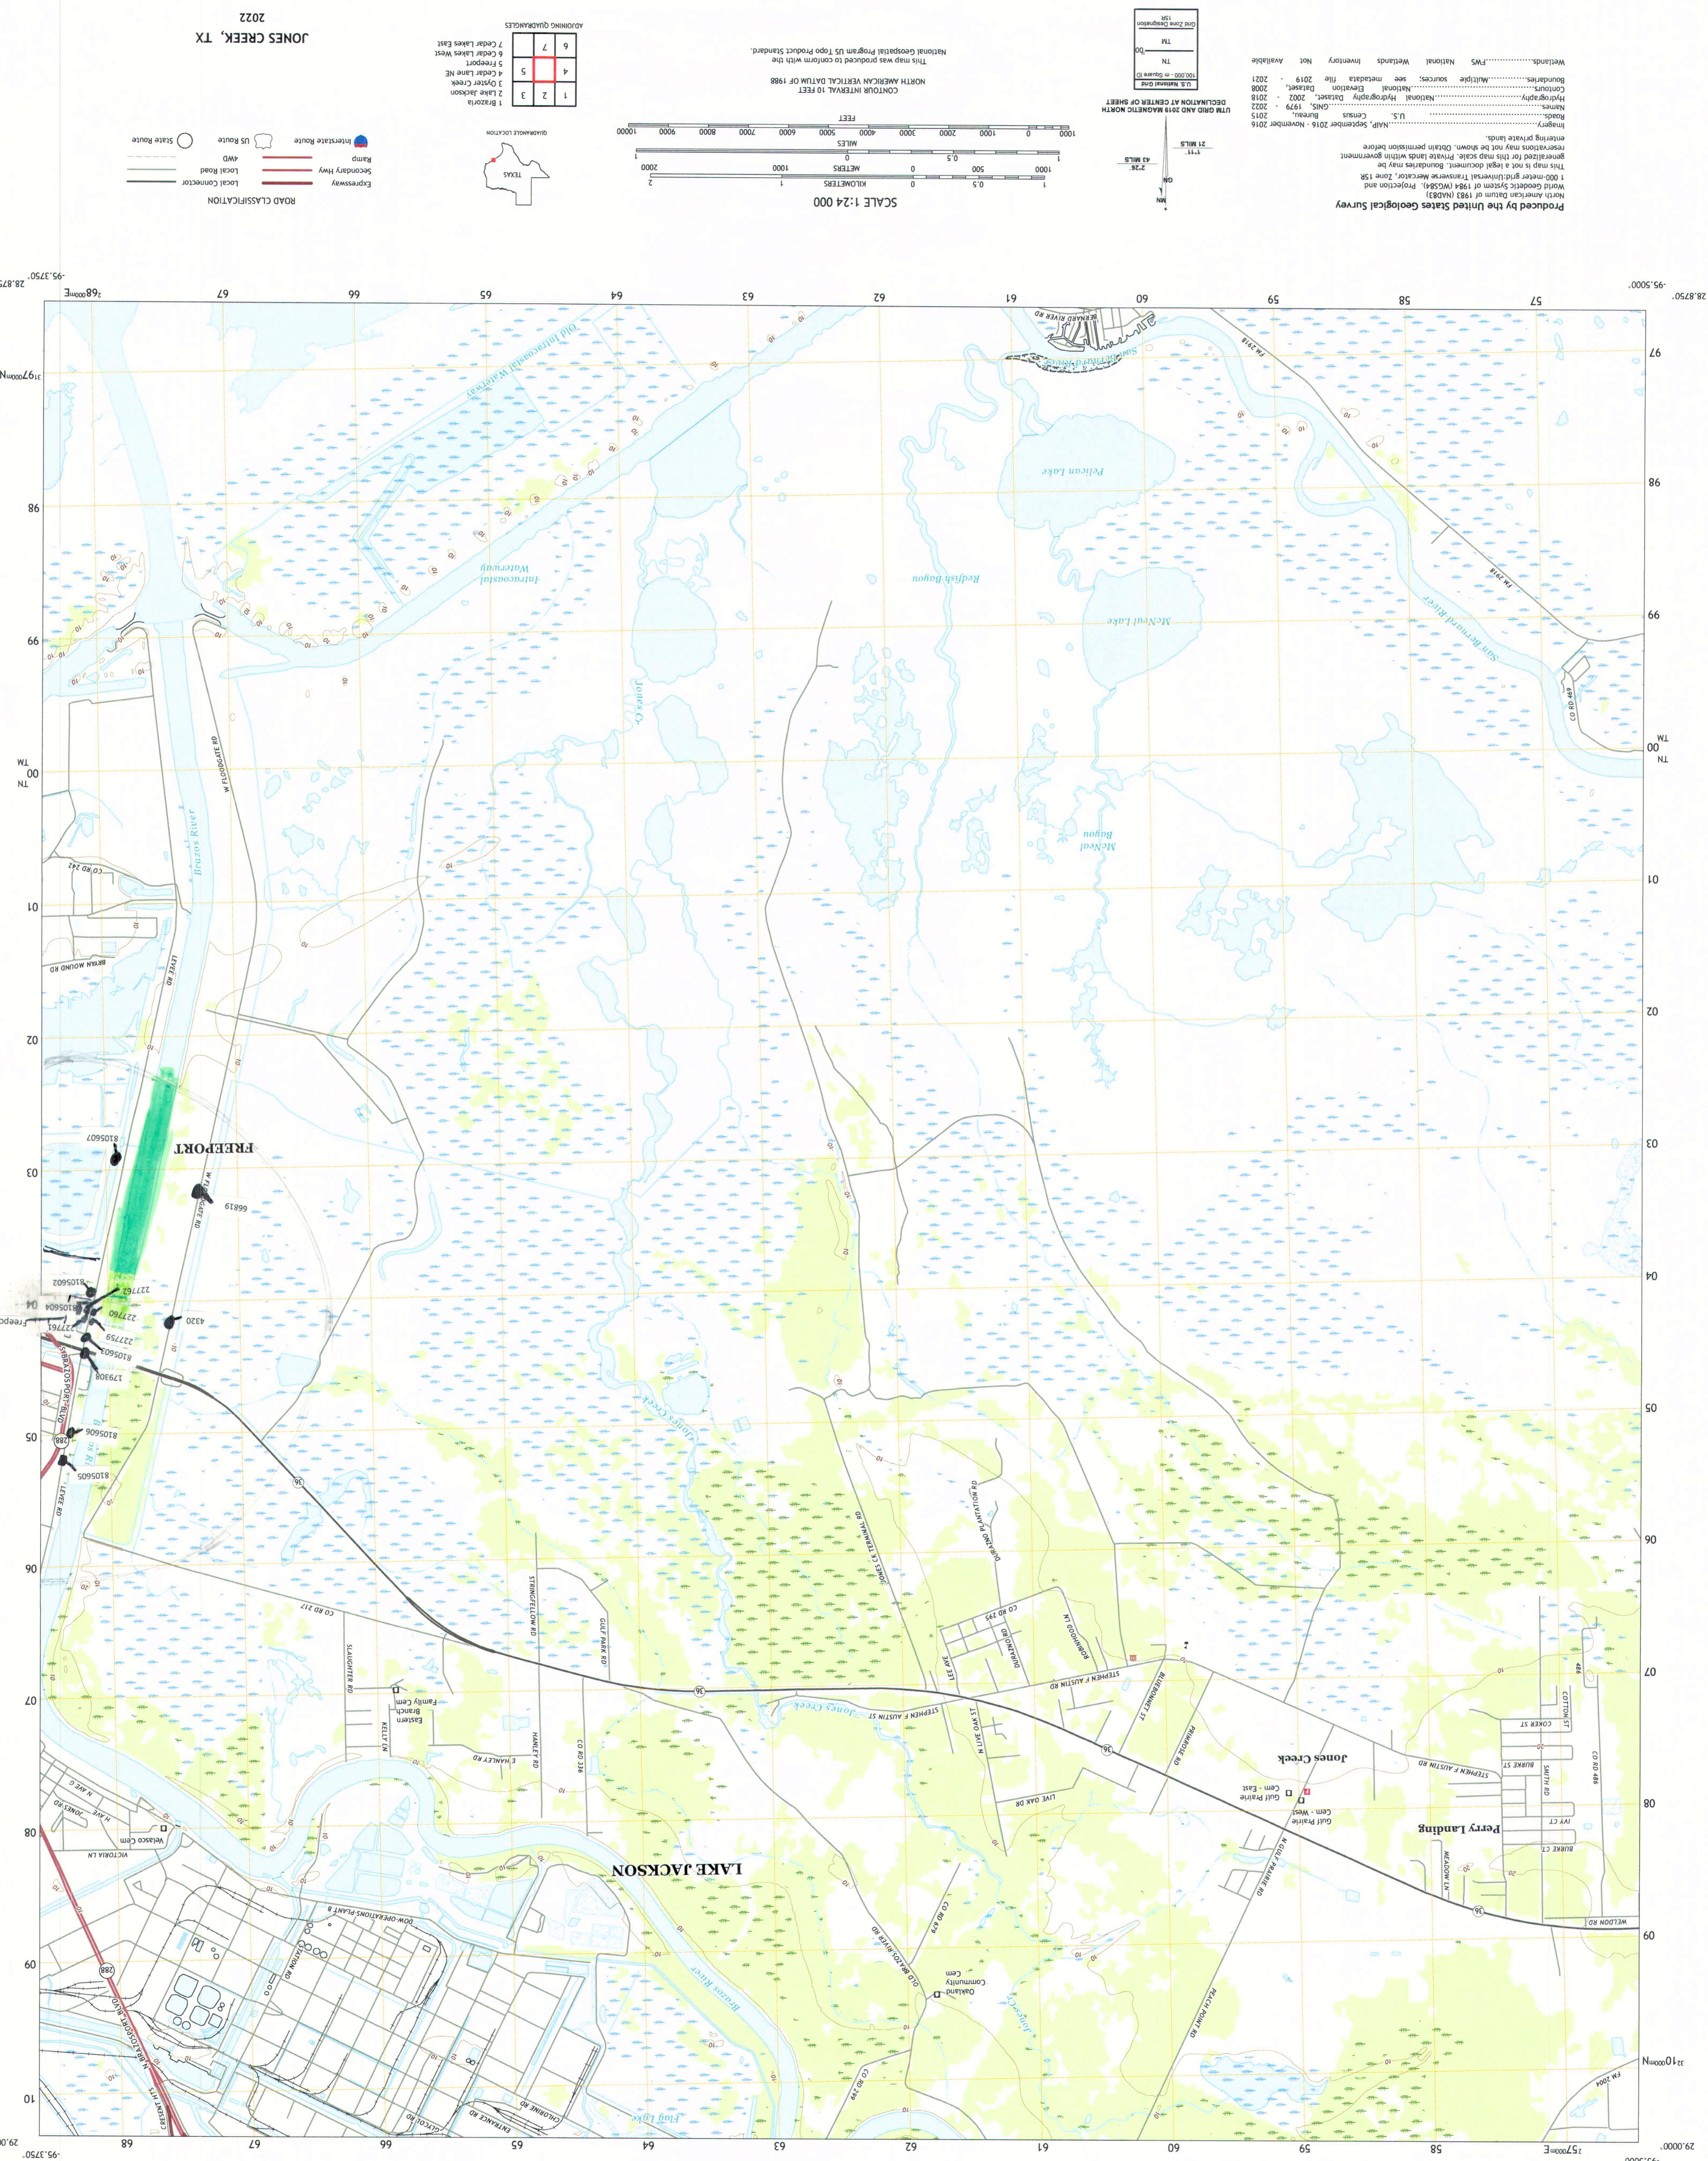

FREEPORt, TX 2022

VI

REPORT TO

ROAD CLASSIFICATION


- Expressway
- Local Connector
- Secondary Hwy
- Ramp
- Local Road
- 4WD
- Interstate Route
- US Route
- State Route

QUADRANGLE LOCATION

1 Lake Jackson	2 Oyster Creek	3 Christmas Point	4 Jones Creek	5 Cedar Lakes East	6 Christmas Point DE S
2	3	5			

TEXAS

Category	Description	Notes	Available
Wetlands	U.S. National Wetlands Inventory	N/A	Not Available
Roads	U.S. Census Bureau, 2015	2015	
Names	GNIS, 1999 - 2022	2022	
Hydrography	National Hydrography Dataset, 2008	2008	
Countours	National Elevation Dataset, 2008	2008	
Boundaries	Multiple sources; see metadata file	2019	-
Image	NAL, September 2016 - November 2016	2016	
DEM GRID AND 2019 MAGNETIC NORTH DECLINATION AT CENTER OF SHE			
100,000 - m Square ID U.S. National Grid			
Grid Zone Designation 15R			

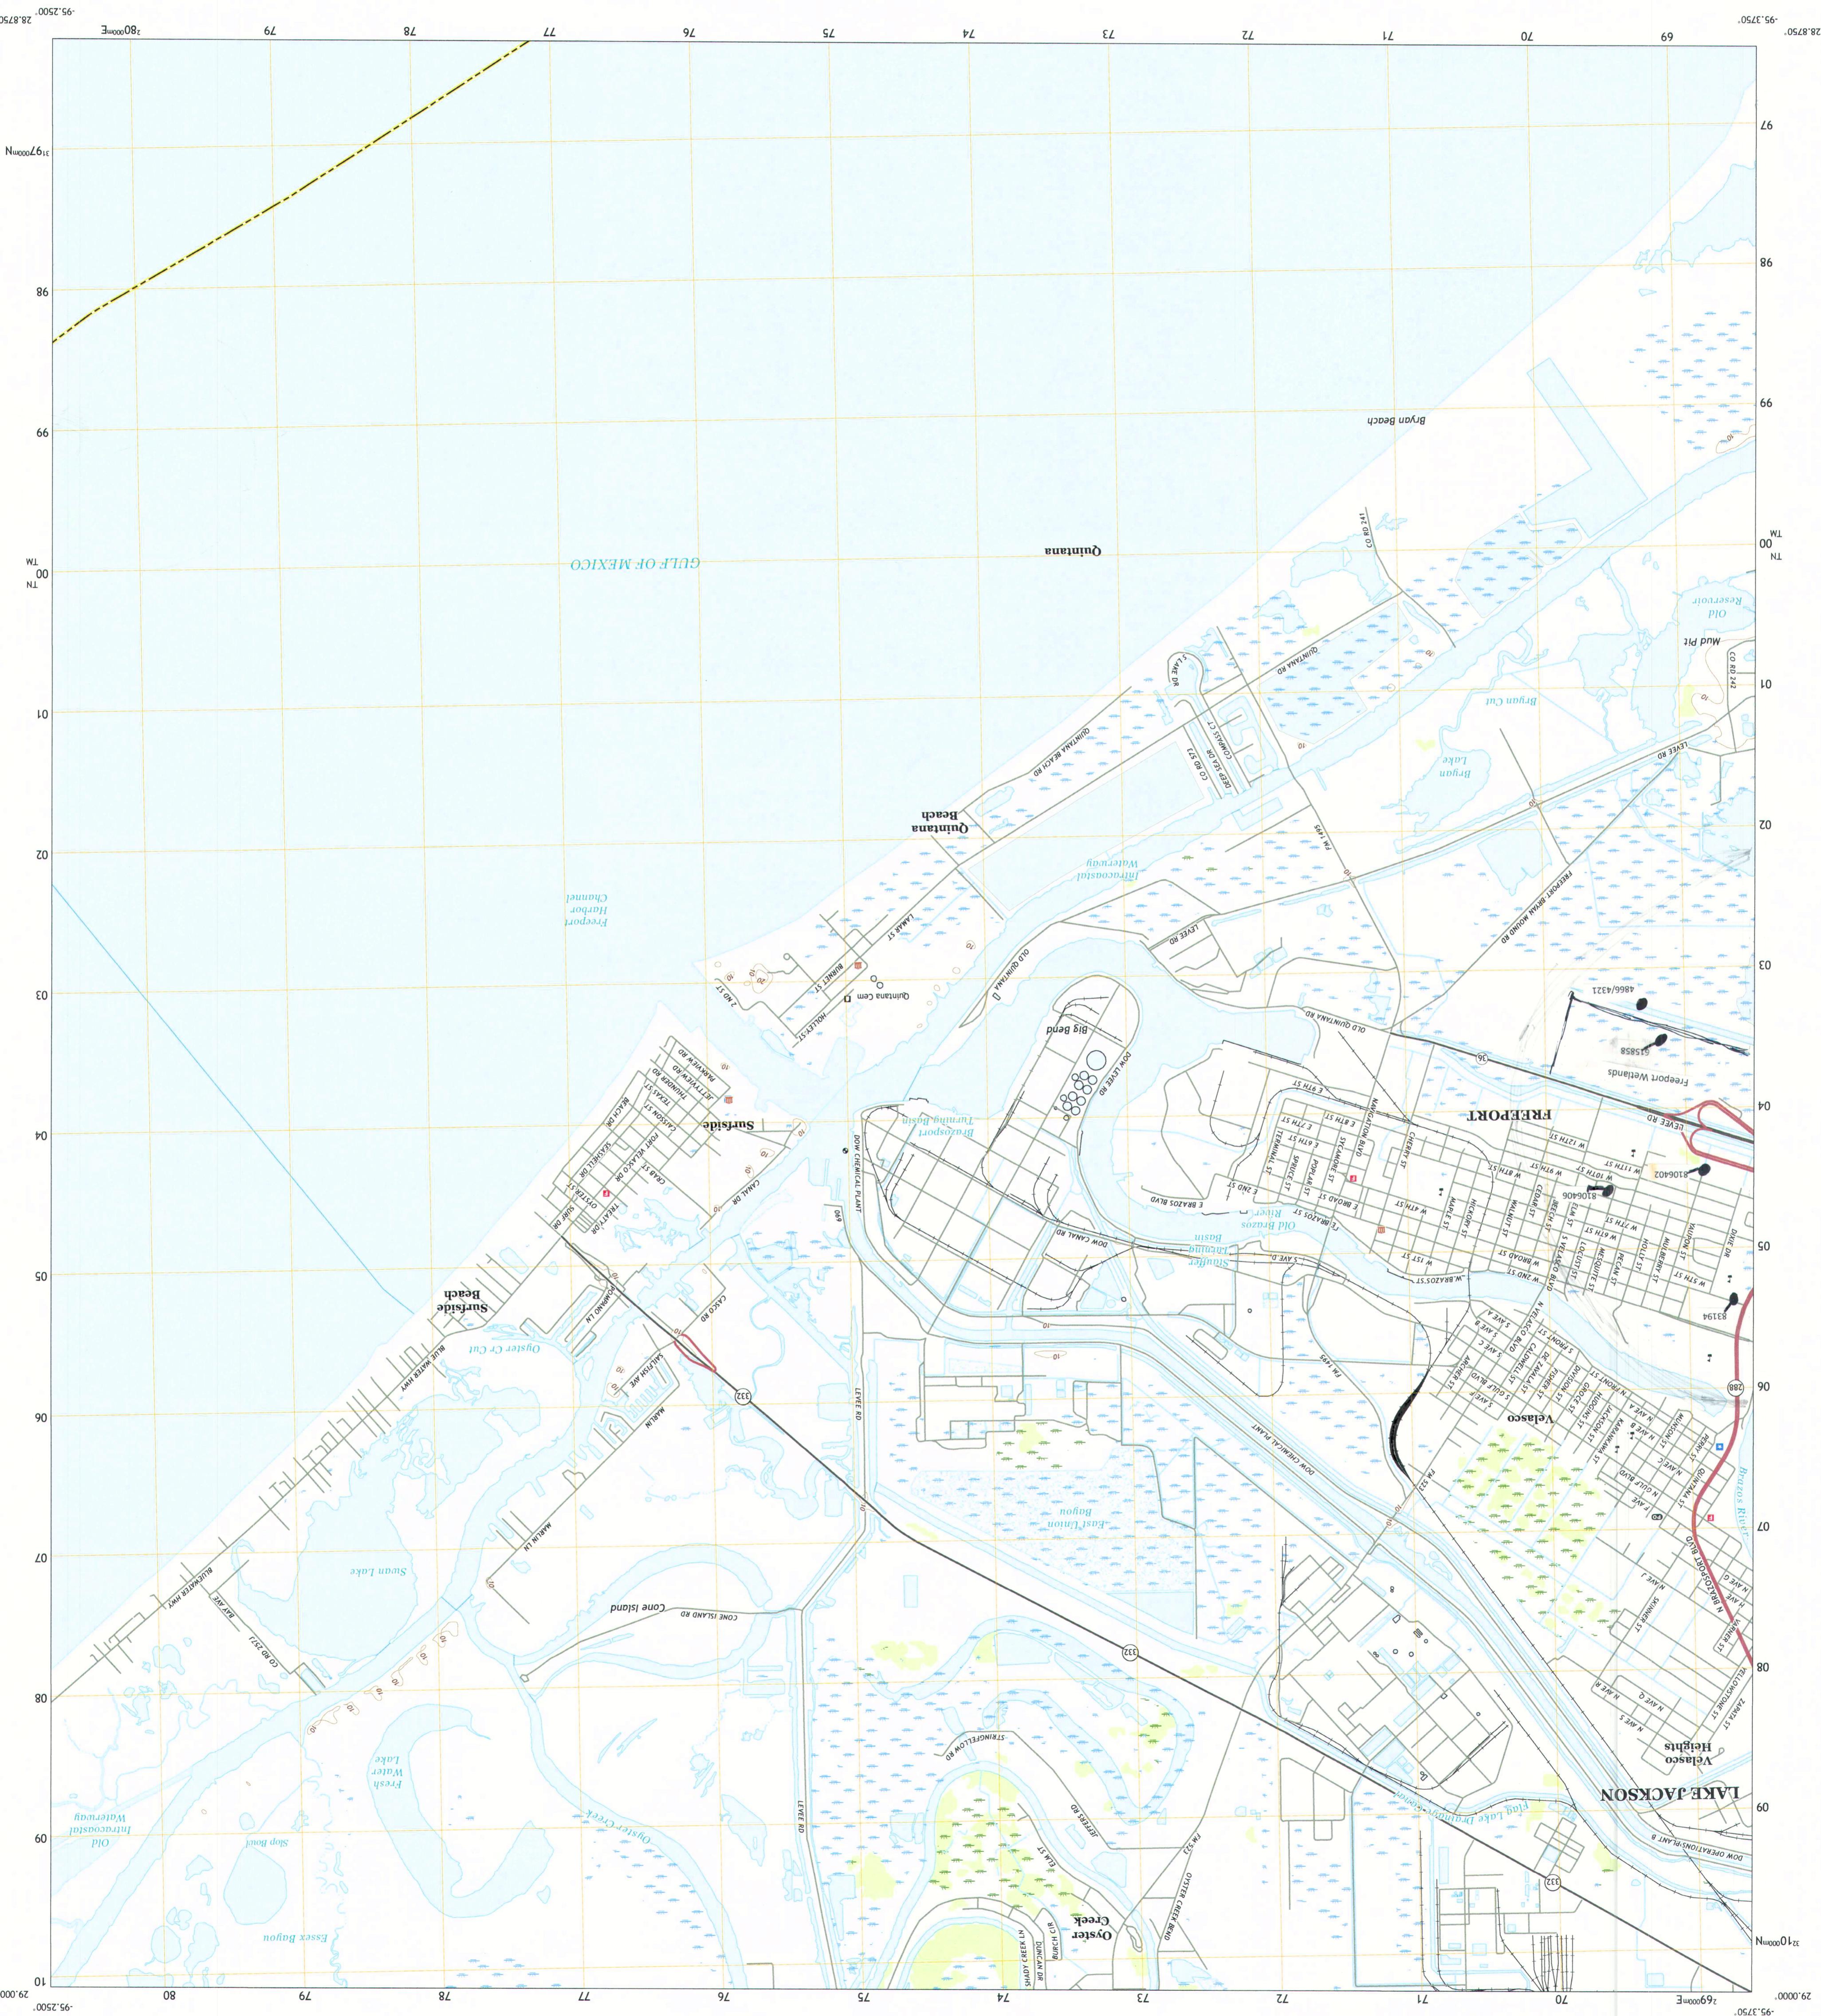

Rainee Trevino


From: Meeks Jr., Jerry <jerry.meeks2@veolia.com>
Sent: Tuesday, April 8, 2025 2:18 PM
To: Rainee Trevino
Cc: James Carter
Subject: Re: Application to Renew Permit No. WQ0010882001-Notice of Deficiency Letter
Attachments: Core Data Form 2025.pdf; Plain Language Summary.docx; Municipal Discharge Renewal Spanish NORI.docx

Categories: Incomplete Response, NOD Response Review

Please see attached the additional information requested. As for the USGS Maps, I will get with USGS to get a better map to label. I will get those to you as soon as possible.

Jerry Meeks, Jr.
Lead Operator - Freeport Project
Municipal Water Contract Operations
VEOLIA NORTH AMERICA

Phone: +1 979 233 4281
veolianorthamerica.com



On Tue, Apr 8, 2025 at 10:06 AM Rainee Trevino <Rainee.Trevino@tceq.texas.gov> wrote:

Dear Mr. Meeks,

The attached Notice of Deficiency letter sent on April 8, 2025, requests additional information needed to declare the application administratively complete. Please send the complete response to my attention by April 22, 2025.

Regards,

Rainee Trevino

Water Quality Division | ARP Team

Texas Commission on Environmental Quality

512-239-4324





TCEQ Core Data Form

For detailed instructions on completing this form, please read the Core Data Form Instructions or call 512-239-5175.

SECTION I: General Information

1. Reason for Submission (<i>If other is checked please describe in space provided.</i>)		
<input type="checkbox"/> New Permit, Registration or Authorization (<i>Core Data Form should be submitted with the program application.</i>)		
<input checked="" type="checkbox"/> Renewal (<i>Core Data Form should be submitted with the renewal form</i>) <input type="checkbox"/> Other		
2. Customer Reference Number (<i>if issued</i>) CN 600641799		Follow this link to search for CN or RN numbers in Central Registry**
3. Regulated Entity Reference Number (<i>if issued</i>) RN 102184025		

SECTION II: Customer Information

4. General Customer Information	5. Effective Date for Customer Information Updates (mm/dd/yyyy)	2/21/2025						
<input type="checkbox"/> New Customer <input type="checkbox"/> Change in Legal Name (Verifiable with the Texas Secretary of State or Texas Comptroller of Public Accounts)	<input checked="" type="checkbox"/> Update to Customer Information <input type="checkbox"/> Change in Regulated Entity Ownership							
<i>The Customer Name submitted here may be updated automatically based on what is current and active with the Texas Secretary of State (SOS) or Texas Comptroller of Public Accounts (CPA).</i>								
6. Customer Legal Name (<i>If an individual, print last name first: eg: Doe, John)</i>		<i>If new Customer, enter previous Customer below:</i>						
City of Freeport								
7. TX SOS/CPA Filing Number	8. TX State Tax ID (11 digits)	9. Federal Tax ID (9 digits)	10. DUNS Number (<i>if applicable</i>)					
11. Type of Customer:	<input type="checkbox"/> Corporation Government: <input checked="" type="checkbox"/> City <input type="checkbox"/> County <input type="checkbox"/> Federal <input type="checkbox"/> Local <input type="checkbox"/> State <input type="checkbox"/> Other	<input type="checkbox"/> Individual <input type="checkbox"/> Sole Proprietorship	Partnership: <input type="checkbox"/> General <input type="checkbox"/> Limited <input type="checkbox"/> Other:					
12. Number of Employees <input type="checkbox"/> 0-20 <input checked="" type="checkbox"/> 21-100 <input type="checkbox"/> 101-250 <input type="checkbox"/> 251-500 <input type="checkbox"/> 501 and higher		13. Independently Owned and Operated? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No						
14. Customer Role (<i>Proposed or Actual – as it relates to the Regulated Entity listed on this form. Please check one of the following</i>)								
<input checked="" type="checkbox"/> Owner <input type="checkbox"/> Operator <input type="checkbox"/> Owner & Operator <input type="checkbox"/> Occupational Licensee <input type="checkbox"/> Responsible Party <input type="checkbox"/> VCP/BSA Applicant <input type="checkbox"/> Other:								
15. Mailing Address:	1201 N. Ave. H							
	City	Freeport	State	TX	ZIP	77541	ZIP + 4	
16. Country Mailing Information (<i>if outside USA</i>)				17. E-Mail Address (<i>if applicable</i>)				
				LPetty@Freeport.TX.US				
18. Telephone Number			19. Extension or Code			20. Fax Number (<i>if applicable</i>)		

SECTION III: Regulated Entity Information

21. General Regulated Entity Information (If "New Regulated Entity" is selected, a new permit application is also required.)

New Regulated Entity Update to Regulated Entity Name Update to Regulated Entity Information

The Regulated Entity Name submitted may be updated, in order to meet TCEQ Core Data Standards (removal of organizational endings such as Inc, LP, or LLC).

22. Regulated Entity Name (Enter name of the site where the regulated action is taking place.)

Freeport Central Wastewater Treatment Facility

**23. Street Address of the Regulated Entity:
(No PO Boxes)**

931 E. Floodgate Rd

City	Freeport	State	TX	ZIP	77541	ZIP + 4	
------	----------	-------	----	-----	-------	---------	--

24. County

Brazoria

If no Street Address is provided, fields 25-28 are required.

25. Description to Physical Location:

26. Nearest City

State

Nearest ZIP Code

Latitude/Longitude are required and may be added/updated to meet TCEQ Core Data Standards. (Geocoding of the Physical Address may be used to supply coordinates where none have been provided or to gain accuracy).

27. Latitude (N) In Decimal:

28. Longitude (W) In Decimal:

Degrees

Minutes

Seconds

Degrees

Minutes

Seconds

29. Primary SIC Code

30. Secondary SIC Code

31. Primary NAICS Code

32. Secondary NAICS Code

(4 digits)

(4 digits)

(5 or 6 digits)

(5 or 6 digits)

4952

221320

33. What is the Primary Business of this entity? (Do not repeat the SIC or NAICS description.)

Domestic wastewater facility.

34. Mailing

Address:

1201 N. Ave. H

City	Freeport	State	TX	ZIP	77541	ZIP + 4	
------	----------	-------	----	-----	-------	---------	--

35. E-Mail Address:

Jerry.Meeks2@Veolia.com

36. Telephone Number

37. Extension or Code

38. Fax Number (if applicable)

(979) 233-4281

(979) 233-5833

39. TCEQ Programs and ID Numbers Check all Programs and write in the permits/registration numbers that will be affected by the updates submitted on this form. See the Core Data Form instructions for additional guidance.

<input type="checkbox"/> Dam Safety	<input type="checkbox"/> Districts	<input type="checkbox"/> Edwards Aquifer	<input type="checkbox"/> Emissions Inventory Air	<input type="checkbox"/> Industrial Hazardous Waste
<input type="checkbox"/> Municipal Solid Waste	<input type="checkbox"/> New Source Review Air	<input type="checkbox"/> OSSF	<input type="checkbox"/> Petroleum Storage Tank	<input type="checkbox"/> PWS
<input type="checkbox"/> Sludge	<input type="checkbox"/> Storm Water	<input type="checkbox"/> Title V Air	<input type="checkbox"/> Tires	<input type="checkbox"/> Used Oil
<input type="checkbox"/> Voluntary Cleanup	<input checked="" type="checkbox"/> Wastewater	<input type="checkbox"/> Wastewater Agriculture	<input type="checkbox"/> Water Rights	<input type="checkbox"/> Other:
	WQ0010882001			

SECTION IV: Preparer Information

40. Name:	Jerry Meeks, Jr.		41. Title:	Lead Operator
42. Telephone Number	43. Ext./Code	44. Fax Number	45. E-Mail Address	
(979) 233-4281		(979) 233-5833	Jerry.Meeks2@Veolia.com	

SECTION V: Authorized Signature

46. By my signature below, I certify, to the best of my knowledge, that the information provided in this form is true and complete, and that I have signature authority to submit this form on behalf of the entity specified in Section II, Field 6 and/or as required for the updates to the ID numbers identified in field 39.

Company:	Veolia	Job Title:	Lead Operator	
Name (In Print):	Jerry Meeks, Jr.		Phone:	(979) 233- 4281
Signature:			Date:	2/21/2025

Comisión de Calidad Ambiental del Estado de Texas



AVISO DE RECIBO DE LA SOLICITUD Y EL INTENTO DE OBTENER PERMISO PARA LA CALIDAD DEL AGUA RENOVACION

PERMISO NO. WQ00

SOLICITUD. *City of Freeport, 1201 North Avenue H, Freeport, Texas 77541*, ha solicitado a la Comisión de Calidad Ambiental del Estado de Texas (TCEQ) para renovar el Permiso No. WQ0010882001 (EPA I.D. No. TX 0033332) del Sistema de Eliminación de Descargas de Contaminantes de Texas (TPDES) para autorizar la descarga de aguas residuales tratadas en un volumen que no sobrepasa un flujo promedio diario de 2,250,000 galones por día. La planta está ubicada City of Freeport en el Condado de *Brazoria*, Texas *77541*. La ruta de descarga es del sitio de la planta a A través del emisario 001, directamente a la red de mareas del río Brazos y a través del emisario 002 a un humedal embalsado de 38,2 acres adyacente al sitio de la planta sin descarga desde los humedales. La TCEQ recibió esta solicitud el April 1, 2025. La solicitud para el permiso estará disponible para leerla y copiarla en Freeport City Hall, Front Entrance, 1201 North Avenue H, Freeport, Texas antes de la fecha de publicación de este aviso en el periódico. La solicitud (cualquier actualización y aviso inclusive) está disponible electrónicamente en la siguiente página web:

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

Este enlace a un mapa electrónico de la ubicación general del sitio o de la instalación es proporcionado como una cortesía y no es parte de la solicitud o del aviso. Para la ubicación exacta, consulte la solicitud.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-95.377222,28.944444&level=18>

AVISO DE IDIOMA ALTERNATIVO. El aviso de idioma alternativo en español está disponible en <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

AVISO ADICIONAL. El Director Ejecutivo de la TCEQ ha determinado que la solicitud es administrativamente completa y conducirá una revisión técnica de la solicitud. Después de completar la revisión técnica, el Director Ejecutivo puede preparar un borrador del permiso y emitirá una Decisión Preliminar sobre la solicitud. **El aviso de la solicitud y la decisión preliminar serán publicados y enviado a los que están en la lista de correo de las personas a lo largo del condado que desean recibir los avisos y los que están en la lista de correo que desean recibir avisos de esta solicitud. El aviso dará la fecha límite para someter comentarios públicos.**

COMENTARIO PUBLICO / REUNION PUBLICA. Usted puede presentar comentarios públicos o pedir una reunión pública sobre esta solicitud. El propósito de una reunión pública es dar la oportunidad de presentar comentarios o hacer preguntas acerca de la solicitud. La TCEQ realiza una reunión pública si el Director Ejecutivo determina que hay un grado de interés público suficiente en la solicitud o si un legislador local lo pide. Una reunión pública no es una audiencia administrativa de lo contencioso.

OPORTUNIDAD DE UNA AUDIENCIA ADMINISTRATIVA DE LO CONTENCIOSO. Después del plazo para presentar comentarios públicos, el Director Ejecutivo considerará todos los comentarios apropiados y preparará una respuesta a todo los comentarios públicos esenciales, pertinentes, o significativos. A menos que la solicitud haya sido referida directamente a una audiencia administrativa de lo contencioso, la respuesta a los comentarios y la decisión del Director Ejecutivo sobre la solicitud serán enviados por correo a todos los que presentaron un comentario público y a las personas que están en la lista para recibir avisos sobre esta solicitud. Si se reciben comentarios, el aviso también proveerá instrucciones para pedir una reconsideración de la decisión del Director Ejecutivo y para pedir una audiencia administrativa de lo contencioso. Una audiencia administrativa de lo contencioso es un procedimiento legal similar a un procedimiento legal civil en un tribunal de distrito del estado.

PARA SOLICITAR UNA AUDIENCIA DE CASO IMPUGNADO, USTED DEBE INCLUIR EN SU SOLICITUD LOS SIGUIENTES DATOS: su nombre, dirección, y número de teléfono; el nombre del solicitante y número del permiso; la ubicación y distancia de su propiedad/actividad con respecto a la instalación; una descripción específica de la forma cómo usted sería afectado adversamente por el sitio de una manera no común al público en general; una lista de todas las cuestiones de hecho en disputa que usted presente durante el período de comentarios; y la declaración "[Yo/nosotros] solicito/solicitamos una audiencia de caso impugnado". Si presenta la petición para una audiencia de caso impugnado de parte de un grupo o asociación, debe identificar una persona que representa al grupo para recibir correspondencia en el futuro; identificar el nombre y la dirección de un miembro del grupo que sería afectado adversamente por la planta o la actividad propuesta; proveer la información indicada anteriormente con respecto a la ubicación del miembro afectado y su distancia de la planta o actividad propuesta; explicar cómo y porqué el miembro sería afectado; y explicar cómo los intereses que el grupo desea proteger son pertinentes al propósito del grupo.

Después del cierre de todos los períodos de comentarios y de petición que aplican, el Director Ejecutivo enviará la solicitud y cualquier petición para reconsideración o para una audiencia de caso impugnado a los Comisionados de la TCEQ para su consideración durante una reunión programada de la Comisión.

La Comisión sólo puede conceder una solicitud de una audiencia de caso impugnado sobre los temas que el solicitante haya presentado en sus comentarios oportunos que no fueron retirados posteriormente. Si se concede una audiencia, el tema de la audiencia estará limitado a cuestiones de hecho en disputa o cuestiones mixtas de hecho y de derecho relacionadas a intereses pertinentes y materiales de calidad del agua que se hayan presentado durante el período de comentarios. Si ciertos criterios se cumplen, la TCEQ puede actuar sobre una solicitud para renovar un permiso sin proveer una oportunidad de una audiencia administrativa de lo contencioso.

LISTA DE CORREO. Si somete comentarios públicos, un pedido para una audiencia administrativa de lo contencioso o una reconsideración de la decisión del Director Ejecutivo, la Oficina del Secretario Principal enviará por correo los avisos públicos en relación con la solicitud. Además, puede pedir que la TCEQ ponga su nombre en una o más de las listas correos siguientes (1) la lista de correo permanente para recibir los avisos del solicitante indicado por nombre y número del permiso específico y/o (2) la lista de correo de todas las solicitudes en un condado específico. Si desea que se agrega su nombre en una de las listas designe cual lista(s) y envíe por correo su pedido a la Oficina del Secretario Principal de la TCEQ.

INFORMACIÓN DISPONIBLE EN LÍNEA. Para detalles sobre el estado de la solicitud, favor de visitar la Base de Datos Integrada de los Comisionados en www.tceq.texas.gov/goto/cid. Para buscar en la base de datos, utilizar el número de permiso para esta solicitud que aparece en la parte superior de este aviso.

CONTACTOS E INFORMACIÓN A LA AGENCIA. **Todos los comentarios públicos y solicitudes deben ser presentadas electrónicamente vía <http://www14.tceq.texas.gov/epic/eComment> o por escrito dirigidos a la Comisión de Texas de Calidad Ambiental, Oficial de la Secretaría (Office of Chief Clerk), MC-105, P.O. Box 13087, Austin, Texas 78711-3087.** Tenga en cuenta que cualquier información personal que usted proporcione, incluyendo su nombre, número de teléfono, dirección de correo electrónico y dirección física pasarán a formar parte del registro público de la Agencia. Para obtener más información acerca de esta solicitud de permiso o el proceso de permisos, llame al programa de educación pública de la TCEQ, gratis, al 1-800-687-4040. Si desea información en Español, puede llamar al 1-800-687-4040.

También se puede obtener información adicional del City of Freeport a la dirección indicada arriba o llamando a Mr. Lance Petty, City Manager, al 979-233-3526.

Fecha de emisión: *[Date notice issued]*



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SUMMARY OF APPLICATION IN PLAIN LANGUAGE FOR TPDES OR TLAP PERMIT APPLICATIONS

Summary of Application (in plain language) Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary of your facility and application as required by Title 30, Texas Administrative Code (30 TAC), Chapter 39, Subchapter H. You may modify the template as necessary to accurately describe your facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how you will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements. After filling in the information for your facility delete these instructions.

If you are subject to the alternative language notice requirements in 30 TAC Section 39.426, **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package.** For your convenience, a Spanish template has been provided below.

ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS DOMESTIC WASTEWATER/STORMWATER

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.

The City of Freeport (CN600641799) operates the City of Freeport Wastewater Treatment Plant (RN102184025), a domestic wastewater treatment facility. The facility is located at 931 E. Floodgate Rd., in Freeport, Brazoria County, Texas 77541. The City of Freeport is requesting a renewal of the wastewater permit to discharge 2.25 MGD treated domestic wastewater to the Brazos River. When needed, there is also an option to discharge to the 38.2 acre impounded wetlands adjacent to the plant site with no discharge from the wetlands.

Discharges from the facility are expected to contain total suspended solids and BOD. Domestic wastewater is treated by chlorine gas.

PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

AGUAS RESIDUALES DOMESTICAS /AGUAS PLUVIALES

El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva federal de la solicitud de permiso.

La ciudad de Freeport (CN600641799) opera la Planta de Tratamiento de Aguas Residuales de la Ciudad de Freeport (RN102184025), una instalación de tratamiento de aguas residuales domésticas. La instalación está ubicada en 931 E. Floodgate Rd., en Freeport, Condado de Brazoria, Texas 77541. La ciudad de Freeport solicita la renovación del permiso de aguas residuales para descargar 2.25 MGD de aguas residuales domésticas tratadas al río Brazos. De ser necesario, también existe la opción de descargarlas en los humedales embalsados de 38.2 acres adyacentes a la planta, sin que se produzcan descargas desde estos.

Se espera que las descargas de la instalación contengan sólidos suspendidos totales y DBO. Las aguas residuales domésticas se tratan con cloro gaseoso.

INSTRUCTIONS

1. Enter the name of applicant in this section. The applicant name should match the name associated with the customer number.
2. Enter the Customer Number in this section. Each Individual or Organization is issued a unique 11-digit identification number called a CN (e.g. CN123456789).
3. Choose “operates” in this section for existing facility applications or choose “proposes to operate” for new facility applications.
4. Enter the name of the facility in this section. The facility name should match the name associated with the regulated entity number.
5. Enter the Regulated Entity number in this section. Each site location is issued a unique 11-digit identification number called an RN (e.g. RN123456789).
6. Choose the appropriate article (a or an) to complete the sentence.
7. Enter a description of the facility in this section. For example: steam electric generating facility, nitrogenous fertilizer manufacturing facility, etc.
8. Choose “is” for an existing facility or “will be” for a new facility.
9. Enter the location of the facility in this section.
10. Enter the City nearest the facility in this section.
11. Enter the County nearest the facility in this section.
12. Enter the zip code for the facility address in this section.
13. Enter a summary of the application request in this section. For example: renewal to discharge 25,000 gallons per day of treated domestic wastewater, new application to discharge process wastewater and stormwater on an intermittent and flow-variable basis, or major amendment to reduce monitoring frequency for pH, etc. If more than one outfall is included in the application, provide applicable information for each individual outfall.
14. List all pollutants expected in the discharge from this facility in this section. If applicable, refer to the pollutants from any federal numeric effluent limitations that apply to your facility.
15. Enter the discharge types from your facility in this section (e.g., stormwater, process wastewater, once through cooling water, etc.)
16. Choose the appropriate verb tense to complete the sentence.
17. Enter a description of the wastewater treatment used at your facility. Include a description of each process, starting with initial treatment and finishing with the outfall/point of disposal. Use additional lines for individual discharge types if necessary.

Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at WQ-ARPTeam@tceq.texas.gov or by phone at (512) 239-4671.

Example 1: Industrial Wastewater TPDES Application (ENGLISH)

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.

ABC Corporation (CN6000000000) operates the Starr Power Station (RN1000000000), a two-unit gas-fired electric generating facility. Unit 1 has a generating capacity of 393 megawatts (MWs) and Unit 2 has a generating capacity of 528 MWs. The facility is located at 1356 Starr Street, near the City of Austin, Travis County, Texas 78753.

This application is for a renewal to discharge 870,000,000 gallons per day of once through cooling water, auxiliary cooling water, and also authorizes the following waste streams monitored inside the facility (internal outfalls) before it is mixed with the other wastewaters authorized for discharge via main Outfall 001, referred to as "previously monitored effluents" (low-volume wastewater, metal-cleaning waste, and stormwater (from diked oil storage area yards and storm drains)) via Outfall 001. Low-volume waste sources, metal-cleaning waste, and stormwater drains on a continuous and flow-variable basis via internal Outfall 101.

The discharge of once through cooling water via Outfall 001 and low-volume waste and metal-cleaning waste via Outfall 101 from this facility is subject to federal effluent limitation guidelines at 40 CFR Part 423. The pollutants expected from these discharges based on 40 CFR Part 423 are: free available chlorine, total residual chlorine, total suspended solids, oil and grease, total iron, total copper, and pH. Temperature is also expected from these discharges. Additional potential pollutants are included in the Industrial Wastewater Application Technical Report, Worksheet 2.0.

Cooling water and boiler make-up water are supplied by Lake Starr Reservoir. The City of Austin municipal water plant (CN6000000000, PWS 00000) supplies the facility's potable water and serves as an alternate source of boiler make-up water. Water from the Lake Starr Reservoir is withdrawn at the intake structure and treated with sodium hypochlorite to prevent biofouling and sodium bromide as a chlorine enhancer to improve efficacy and then passed through condensers and auxiliary equipment on a once-through basis to cool equipment and condense exhaust steam.

Low-volume wastewater from blowdown of boiler Units 1 and 2 and metal-cleaning wastes receive no treatment prior to discharge via Outfall 101. Plant floor and equipment drains and stormwater runoff from diked oil storage areas, yards, and storm drains are routed through an oil and water separator prior to discharge via Outfall 101. Domestic wastewater, blowdown, and backwash water from the service water filter, clarifier, and sand filter are routed to the Starr Creek Domestic Sewage Treatment Plant, TPDES Permit No. WQ0010000001, for treatment and disposal. Metal-cleaning waste from equipment cleaning is generally disposed of off-site.

Example 2: Domestic Wastewater TPDES Renewal application

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 Texas Administrative Code Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.

The City of Texas (CN000000000) operates the City of Texas wastewater treatment plant (RN000000000), an activated sludge process plant operated in the complete mix mode. The facility is located at 123 Texas Street, near the City of More Texas, Texas County, Texas 71234.

This application is for a renewal to discharge at an annual average flow of 1,200,000 gallons per day of treated domestic wastewater via Outfalls 001 and 002.

Discharges from the facility are expected to contain five-day carbonaceous biochemical oxygen demand (CBOD₅), total suspended solids (TSS), ammonia nitrogen (NH₃-N), and *Escherichia coli*. Additional potential pollutants are included in the Domestic Technical Report 1.0, Section 7. Pollutant Analysis of Treated Effluent and Domestic Worksheet 4.0 in the permit application package. Domestic wastewater is treated by an activated sludge process plant and the treatment units include a bar screen, a grit chamber, aeration basins, final clarifiers, sludge digesters, a belt filter press, chlorine contact chambers and a dechlorination chamber.

Example 3: Domestic Wastewater TPDES New Application

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 Texas Administrative Code Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.

The City of Texas (CN000000000) proposes to operate the City of Texas wastewater treatment plant (RN000000000), an activated sludge process plant operated in the extended aeration mode. The facility will be located at 123 Texas Street, in the City of More Texas, Texas County, Texas 71234.

This application is for a new application to discharge at a daily average flow of 200,000 gallons per day of treated domestic wastewater.

Discharges from the facility are expected to contain five-day carbonaceous biochemical oxygen demand (CBOD₅), total suspended solids (TSS), ammonia nitrogen (NH₃-N), and *Escherichia coli*. Additional potential pollutants are included in the Domestic Technical Report 1.0, Section 7. Pollutant Analysis of Treated Effluent in the permit application package. Domestic wastewater will be treated by an activated sludge process plant and the treatment units will include a bar screen, a grit chamber, aeration basins, final clarifiers, sludge digesters, a belt filter press, chlorine contact chambers and a dechlorination chamber.

Example 4: Domestic Wastewater TLAP Renewal application

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 Texas Administrative Code Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations

of the permit application.

The City of Texas (CN0000000000) operates the City of Texas wastewater treatment plant (RN0000000000), an activated sludge process plant operated in the complete mix mode. The facility is located at 123 Texas Street, near the City of More Texas, Texas County, Texas 71234.


This application is for a renewal to dispose a daily average flow not to exceed 76,500 gallons per day of treated domestic wastewater via public access subsurface drip irrigation system with a minimum area of 32 acres. This permit will not authorize a discharge of pollutants into water in the state.

Land application of domestic wastewater from the facility are expected to contain five-day biochemical oxygen demand (BOD_5), total suspended solids (TSS), and *Escherichia coli*. Additional potential pollutants are included in the Domestic Technical Report 1.0, Section 7. Pollutant Analysis of Treated Effluent in the permit application package. Domestic wastewater is treated by an activated sludge process plant and the treatment units include a bar screen, an equalization basin, an aeration basin, a final clarifier, an aerobic sludge digester, tertiary filters, and a chlorine contact chamber. In addition, the facility includes a temporary storage that equals to at least three days of the daily average flow.

Rainee Trevino

From: Meeks Jr., Jerry <jerry.meeks2@veolia.com>
Sent: Thursday, June 12, 2025 2:20 PM
To: Rainee Trevino
Subject: Re: Shared files from jerry.meeks2@veolia.com


Categories: NOD Response Review

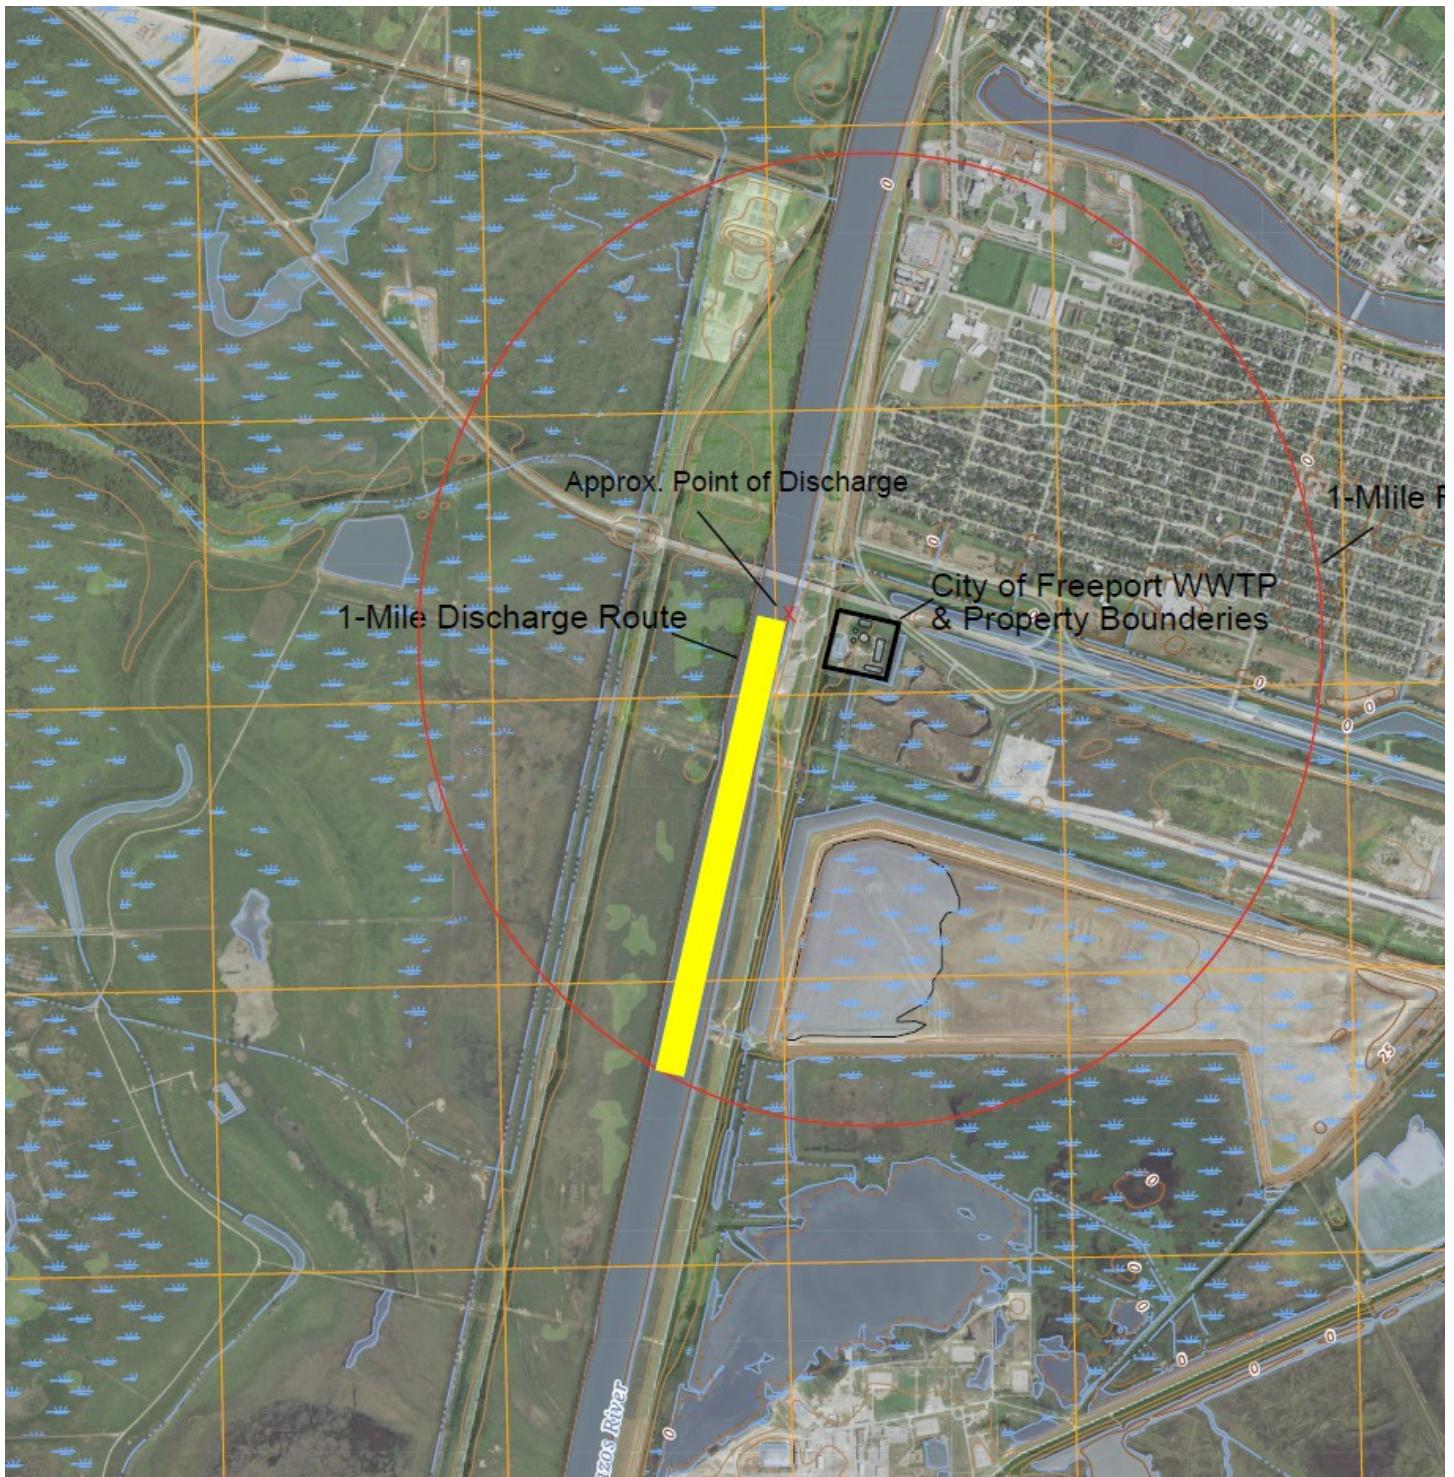

Hope this helps. And if I need to I can reupload this to the ftp site so you have it there.

Jerry Meeks, Jr.
Lead Operator - Freeport Project
Municipal Water Contract Operations
VEOLIA NORTH AMERICA

Phone: +1 979 233 4281
veolianorthamerica.com



On Thu, Jun 12, 2025 at 2:13 PM Rainee Trevino <Rainee.Trevino@tceq.texas.gov> wrote:

-----Original Message-----

From: Rainee Trevino
Sent: Thursday, June 12, 2025 11:38 AM
To: jerry.meeks2@veolia.com
Subject: RE: Shared files from jerry.meeks2@veolia.com

I have received the map. It is still missing the following items labeled:

- *Applicant's property boundary
- *Wastewater treatment facility boundary
- *Point of discharge (ex. X or a dot)
- *The highlighted (yellow or light-colored highlighter) discharge route for three stream miles or until the effluent reaches a classified segment. - *One-mile radius

Regards,
Rainee Trevino

-----Original Message-----

From: Rainee Trevino
Sent: Thursday, June 12, 2025 9:39 AM
To: jerry.meeks2@veolia.com
Subject: RE: Shared files from jerry.meeks2@veolia.com

Good morning, Jerry,

Thanks, I am working with our folks who retrieve the applications and documents from the server to get that. Once I have it and have reviewed it, I will follow up.

Regards,
Rainee Trevino

-----Original Message-----

From: jerry.meeks2@veolia.com <jerry.meeks2@veolia.com>
Sent: Wednesday, June 11, 2025 4:17 PM
To: Rainee Trevino <Rainee.Trevino@tceq.texas.gov>
Subject: Shared files from jerry.meeks2@veolia.com

One or more files have been shared with you from jerry.meeks2@veolia.com. Login to <https://ftps.tceq.texas.gov> to retrieve the files. Files will be available until 06/18/2025.