



Administrative Package Cover Page

This file contains the following documents:

1. Summary of application (in plain language)
 - English
 - Alternative Language (Spanish)
 2. First Notice (NORI-Notice of Receipt of Application and Intent to Obtain a Permit)
 - English
 - Alternative Language (Spanish)
 3. Application materials
-



Portada de Paquete Administrativo

Este archivo contiene los siguientes documentos:

1. Resumen en lenguaje sencillo (PLS, por sus siglas en inglés) de la actividad propuesta
 - Inglés
 - Idioma alternativo (español)
2. Primer aviso (NORI, por sus siglas en inglés)
 - Inglés
 - Idioma alternativo (español)
3. Solicitud original



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

PLAIN LANGUAGE SUMMARY FOR TPDES OR TLAP PERMIT APPLICATIONS

Plain Language Summary Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary as required by [Title 30, Texas Administrative Code \(30 TAC\), Chapter 39, Subchapter H](#). Applicants may modify the template as necessary to accurately describe their facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how the applicant will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements.

If you are subject to the alternative language notice requirements in [30 TAC Section 39.426](#), **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package**. For your convenience, a Spanish template has been provided below.

ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS Enter 'INDUSTRIAL' or 'DOMESTIC' here WASTEWATER/STORMWATER

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.

TCCI Josephine WWTP LLC (CN606288934) proposes to operate Cross Creek Ranch WWTP (RN112017587), a domestic wastewater treatment facility. The facility will be located at appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615, in Josephine, Hunt County, Texas 75189. The applicant is currently applying to the Texas Commission on Environmental Quality for a new Texas Pollutant Discharge Elimination System (TPDES) Permit in order to discharge a maximum of 1,500,000 gallons per day of treated domestic wastewater from the proposed Wastewater Treatment Plant that is to be installed on the site.

Discharges from the facility are expected to contain trace amounts of five-day carbonaceous biochemical oxygen demand (CBOD₅), total suspended solids (TSS), phosphorus (P), and ammonia nitrogen (NH₃-N). Removal of bacteria and pathogens through the MBR process is 96% or greater, and E. Coli concentration is reduced to zero through the use of U.V.. Domestic wastewater will be treated by MBR (membrane bio-reactor) treatment technology. The facility

includes an influent pump station, equalization, fine screen, anoxic, oxic, and membrane cells with ultraviolet disinfection and a sludge press.

PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

AGUAS RESIDUALES Introduzca 'INDUSTRIALES' o 'DOMÉSTICAS' aquí /AGUAS PLUVIALES

El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.

TCCI Josephine WWTP LLC (CN606288934) propone operar Cross Creek Ranch WWTP RN112017587, una instalación de tratamiento de aguas residuales domésticas. La instalación estará ubicada en aproximadamente 1,54 millas al oeste de la intersección de Hwy 66 y CR 2615, en Josephine, Condado de Hunt, Texas 75189. El solicitante actualmente está solicitando a la Comisión de Calidad Ambiental de Texas un nuevo Permiso del Sistema de Eliminación de Descargas Contaminantes de Texas (TPDES) para descargar un máximo de 1.500.000 galones por día de aguas residuales domésticas tratadas de la Planta de Tratamiento de Aguas Residuales propuesta que se instalará en el sitio.

Se espera que las descargas de la instalación contengan razas de demanda bioquímica de oxígeno carbonoso (CBOD₅) de cinco días, sólidos suspendidos totales (SST), fósforo (P) y nitrógeno amoniacal (NH₃-N). La eliminación de bacterias y patógenos mediante el proceso MBR es del 96% o más, y la concentración de E. Coli se reduce a cero mediante el uso de rayos UV. Aguas residuales domésticas. estará tratado por tecnología de tratamiento MBR (biorreactor de membrana). La instalación incluye estación de bombeo de afluente, ecualización, malla fina, celdas anóxicas, óxicas y de membrana con desinfección ultravioleta y prensa de lodos.

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY



AMENDED NOTICE OF RECEIPT OF APPLICATION AND INTENT TO OBTAIN WATER QUALITY PERMIT

PROPOSED PERMIT NO. WQ0016586001

APPLICATION. TCCI Josephine WWTP LLC, 4675 Dallas Parkway, Suite 575, Dallas, Texas 75254, has applied to the Texas Commission on Environmental Quality (TCEQ) for proposed Texas Pollutant Discharge Elimination System (TPDES) Permit No. WQ0016586001 (EPA I.D. No. TX0146439) to authorize the discharge of treated wastewater at a volume not to exceed an annual average flow of 1,500,000 gallons per day. The domestic wastewater treatment facility will be located approximately 1.54 miles west of the intersection of County Road 2615 and Highway 66, near the city of Josephine, in Hunt County, Texas 75189. The discharge route will be from the plant site to an unnamed tributary, thence to Brushy Creek, thence to West Caddo Creek, thence to Caddo Creek, thence to Lake Tawakoni. TCEQ received this application on July 30, 2024. The permit application will be available for viewing and copying at Wolfe City Public Library, 204 East Williams Street, Wolfe City, Texas prior to the date this notice is published in the newspaper. The application, including any updates, and associated notices are available electronically at the following webpage:

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. This link to an electronic map of the site or facility's general location is provided as a public courtesy and not part of the application or notice. For the exact location, refer to the application.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-96.278888,33.043055&level=18>

ALTERNATIVE LANGUAGE NOTICE. Alternative language notice in Spanish is available at: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

El aviso de idioma alternativo en español está disponible en

<https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>.

ADDITIONAL NOTICE. TCEQ's Executive Director has determined the application is administratively complete and will conduct a technical review of the application. After technical review of the application is complete, the Executive Director may prepare a draft permit and will issue a preliminary decision on the application. **Notice of the Application and Preliminary Decision will be published and mailed to those who are on the county-wide mailing list and to those who are on the mailing list for this application. That notice will contain the deadline for submitting public comments.**

PUBLIC COMMENT / PUBLIC MEETING. You may submit public comments or request a public meeting on this application. The purpose of a public meeting is to provide the opportunity to submit comments or to ask questions about the application. TCEQ will hold a public meeting if the Executive Director determines that there is a significant degree of public

interest in the application or if requested by a local legislator. A public meeting is not a contested case hearing.

OPPORTUNITY FOR A CONTESTED CASE HEARING. After the deadline for submitting public comments, the Executive Director will consider all timely comments and prepare a response to all relevant and material, or significant public comments. **Unless the application is directly referred for a contested case hearing, the response to comments, and the Executive Director's decision on the application, will be mailed to everyone who submitted public comments and to those persons who are on the mailing list for this application.** If comments are received, the mailing will also provide instructions for requesting reconsideration of the Executive Director's decision and for requesting a contested case hearing. A contested case hearing is a legal proceeding similar to a civil trial in state district court.

TO REQUEST A CONTESTED CASE HEARING, YOU MUST INCLUDE THE FOLLOWING ITEMS IN YOUR REQUEST: your name, address, phone number; applicant's name and proposed permit number; the location and distance of your property/activities relative to the proposed facility; a specific description of how you would be adversely affected by the facility in a way not common to the general public; a list of all disputed issues of fact that you submit during the comment period and, the statement "[I/we] request a contested case hearing." If the request for contested case hearing is filed on behalf of a group or association, the request must designate the group's representative for receiving future correspondence; identify by name and physical address an individual member of the group who would be adversely affected by the proposed facility or activity; provide the information discussed above regarding the affected member's location and distance from the facility or activity; explain how and why the member would be affected; and explain how the interests the group seeks to protect are relevant to the group's purpose.

Following the close of all applicable comment and request periods, the Executive Director will forward the application and any requests for reconsideration or for a contested case hearing to the TCEQ Commissioners for their consideration at a scheduled Commission meeting.

The Commission may only grant a request for a contested case hearing on issues the requestor submitted in their timely comments that were not subsequently withdrawn. **If a hearing is granted, the subject of a hearing will be limited to disputed issues of fact or mixed questions of fact and law relating to relevant and material water quality concerns submitted during the comment period.**

MAILING LIST. If you submit public comments, a request for a contested case hearing or a reconsideration of the Executive Director's decision, you will be added to the mailing list for this specific application to receive future public notices mailed by the Office of the Chief Clerk. In addition, you may request to be placed on: (1) the permanent mailing list for a specific applicant name and permit number; and/or (2) the mailing list for a specific county. If you wish to be placed on the permanent and/or the county mailing list, clearly specify which list(s) and send your request to TCEQ Office of the Chief Clerk at the address below.

INFORMATION AVAILABLE ONLINE. For details about the status of the application, visit the Commissioners' Integrated Database at www.tceq.texas.gov/goto/cid. Search the database using the permit number for this application, which is provided at the top of this notice.

AGENCY CONTACTS AND INFORMATION. All public comments and requests must be submitted either electronically at <https://www14.tceq.texas.gov/epic/eComment/>, or in writing to the Texas Commission on Environmental Quality, Office of the Chief Clerk, MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Please be aware that any contact information you provide, including your name, phone number, email address and physical address will become part of the agency's public record. For more information about this permit application or the permitting process, please call the TCEQ Public Education Program, Toll Free, at 1-800-687-4040 or visit their website at www.tceq.texas.gov/goto/pep. Si desea información en Español, puede llamar al 1-800-687-4040.

Further information may also be obtained from TCCI Josephine WWTP LLC at the address stated above or by calling Mr. Rane Wilson, Lead Hydrogeologist, reUse Engineering Inc, at 570-567-4297.

Issuance Date: September 27, 2024

Comisión de Calidad Ambiental del Estado de Texas



MODIFICADO AVISO DE RECIBO DE LA SOLICITUD Y EL INTENTO DE OBTENER PERMISO PARA LA CALIDAD DEL AGUA

PERMISO PROPUESTO NO. WQ0016586001

SOLICITUD. TCCI Josephine WWTP LLC, 4675 Dallas Parkway, Suite 575, Dallas, Texas 75254, ha solicitado a la Comisión de Calidad Ambiental del Estado de Texas (TCEQ) para el propuesto Permiso No. WQ0016586001 (EPA I.D. No. TX0146439) del Sistema de Eliminación de Descargas de Contaminantes de Texas (TPDES) para autorizar la descarga de aguas residuales tratadas en un volumen que no sobrepasa un flujo promedio diario de 1.500.000 galones por día. La planta está ubicada aproximadamente 1,54 millas al oeste de la intersección de County Road 2615 y Carretera 66, cerca de la ciudad de Josephine en el Condado de Hunt, Texas. La ruta de descarga será desde el sitio de la planta hasta un afluente sin nombre, de allí a Brushy Creek, de allí a West Caddo Creek, de allí a Caddo Creek, de allí al lago Tawakoni. La TCEQ recibió esta solicitud el 30 de julio de 2024. La solicitud para el permiso estará disponible para leerla y copiarla en Wolfe City Public Library, 204 East Williams Street, Wolfe City, Texas antes de la fecha de publicación de este aviso en el periódico. La solicitud (cualquier actualización y aviso inclusive) está disponible electrónicamente en la siguiente página web: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. Este enlace a un mapa electrónico de la ubicación general del sitio o de la instalación es proporcionado como una cortesía y no es parte de la solicitud o del aviso. Para la ubicación exacta, consulte la solicitud.

<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-96.278888,33.043055&level=18>

AVISO ADICIONAL. El Director Ejecutivo de la TCEQ ha determinado que la solicitud es administrativamente completa y conducirá una revisión técnica de la solicitud. Después de completar la revisión técnica, el Director Ejecutivo puede preparar un borrador del permiso y emitirá una Decisión Preliminar sobre la solicitud. **El aviso de la solicitud y la decisión preliminar serán publicados y enviado a los que están en la lista de correo de las personas a lo largo del condado que desean recibir los avisos y los que están en la lista de correo que desean recibir avisos de esta solicitud. El aviso dará la fecha límite para someter comentarios públicos.**

COMENTARIO PUBLICO / REUNION PUBLICA. Usted puede presentar **comentarios públicos o pedir una reunión pública sobre esta solicitud.** El propósito de una reunión pública es dar la oportunidad de presentar comentarios o hacer preguntas acerca de la solicitud. La TCEQ realiza una reunión pública si el Director Ejecutivo determina que hay un grado de interés público suficiente en la solicitud o si un legislador local lo pide. Una reunión pública no es una audiencia administrativa de lo contencioso.

OPORTUNIDAD DE UNA AUDIENCIA ADMINISTRATIVA DE LO CONTENCIOSO.

Después del plazo para presentar comentarios públicos, el Director Ejecutivo considerará todos los comentarios apropiados y preparará una respuesta a todo los comentarios públicos esenciales, pertinentes, o significativos. **A menos que la solicitud haya sido referida directamente a una audiencia administrativa de lo contencioso, la respuesta a los comentarios y la decisión del Director Ejecutivo sobre la solicitud serán enviados por correo a todos los que presentaron un comentario público y a las personas que están en la lista para recibir avisos sobre esta solicitud. Si se reciben comentarios, el aviso también proveerá instrucciones para pedir una reconsideración de la decisión del Director Ejecutivo y para pedir una audiencia administrativa de lo contencioso.** Una audiencia administrativa de lo contencioso es un procedimiento legal similar a un procedimiento legal civil en un tribunal de distrito del estado.

PARA SOLICITAR UNA AUDIENCIA DE CASO IMPUGNADO, USTED DEBE INCLUIR EN SU SOLICITUD LOS SIGUIENTES DATOS: su nombre, dirección, y número de teléfono; el nombre del solicitante y número del permiso; la ubicación y distancia de su propiedad/actividad con respecto a la instalación; una descripción específica de la forma cómo usted sería afectado adversamente por el sitio de una manera no común al público en general; una lista de todas las cuestiones de hecho en disputa que usted presente durante el período de comentarios; y la declaración "[Yo/nosotros] solicito/solicitamos una audiencia de caso impugnado". Si presenta la petición para una audiencia de caso impugnado de parte de un grupo o asociación, debe identificar una persona que representa al grupo para recibir correspondencia en el futuro; identificar el nombre y la dirección de un miembro del grupo que sería afectado adversamente por la planta o la actividad propuesta; proveer la información indicada anteriormente con respecto a la ubicación del miembro afectado y su distancia de la planta o actividad propuesta; explicar cómo y porqué el miembro sería afectado; y explicar cómo los intereses que el grupo desea proteger son pertinentes al propósito del grupo.

Después del cierre de todos los períodos de comentarios y de petición que aplican, el Director Ejecutivo enviará la solicitud y cualquier petición para reconsideración o para una audiencia de caso impugnado a los Comisionados de la TCEQ para su consideración durante una reunión programada de la Comisión. La Comisión sólo puede conceder una solicitud de una audiencia de caso impugnado sobre los temas que el solicitante haya presentado en sus comentarios oportunos que no fueron retirados posteriormente. Si se concede una audiencia, el tema de la audiencia estará limitado a cuestiones de hecho en disputa o cuestiones mixtas de hecho y de derecho relacionadas a intereses pertinentes y materiales de calidad del agua que se hayan presentado durante el período de comentarios.

LISTA DE CORREO. Si somete comentarios públicos, un pedido para una audiencia administrativa de lo contencioso o una reconsideración de la decisión del Director Ejecutivo, la Oficina del Secretario Principal enviará por correo los avisos públicos en relación con la solicitud. Además, puede pedir que la TCEQ ponga su nombre en una o más de las listas de correos siguientes (1) la lista de correo permanente para recibir los avisos de el solicitante indicado por nombre y número del permiso específico y/o (2) la lista de correo de todas las solicitudes en un condado específico. Si desea que se agregue su nombre en una de las listas designe cual lista(s) y envía por correo su pedido a la Oficina del Secretario Principal de la TCEQ.

CONTACTOS E INFORMACIÓN A LA AGENCIA. Todos los comentarios públicos y

solicitudes deben ser presentadas electrónicamente vía <http://www14.tceq.texas.gov/epic/eComment/> o por escrito dirigidos a la Comisión de Texas de Calidad Ambiental, Oficial de la Secretaría (Office of Chief Clerk), MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Tenga en cuenta que cualquier información personal que usted proporcione, incluyendo su nombre, número de teléfono, dirección de correo electrónico y dirección física pasarán a formar parte del registro público de la Agencia. Para obtener más información acerca de esta solicitud de permiso o el proceso de permisos, llame al programa de educación pública de la TCEQ, gratis, al 1-800-687-4040. Si desea información en Español, puede llamar al 1-800-687-4040.

También se puede obtener información adicional del TCCI Josephine WWTP LLC a la dirección indicada arriba o llamando a Sr. Rane Wilson, Hidrogeólogo principal de reUse Engineering, Inc al 570-567- 4297.

Fecha de emisión 27 de septiembre de 2024

August 26, 2024

Ms. Abesha Michael
Applications Review and Processing Team (MC148)
Water Quality Division
Texas Commission of Environmental Quality

RE: Application for Proposed Permit No.: WQ0016586001 (EPA I.D. No. TX0146439)
Applicant Name: TCCI Josephine WWTP LLC (CN606288934)
Site Name: Cross Creek Ranch WWTP (RN112017587)
Type of Application: New

Dear Ms. Michael,

Thank you for your prompt review of the submitted application and the follow-up NOD letter. Please see below for the requested responses:

1. The Plain Language Summary has been updated with the CN and RN numbers as requested.
See Attachment 1.
2. The NORI is correct as it is written.
3. Please see Attachment 2 for the Spanish NORI.
4. On the phone we discussed some discrepancies with the adjacent landowners' property boundaries, as it showed multiple properties instead of the one adjacent property. Please see Attachment 3 for the revised map. If there are any other questions about it, please let me know.

Thank you for your assistance with the application and for your prompt review! Please let me know if there are any questions about the responses or documents provided.

Respectfully,

Hilary Bond
Director of Permitting and Entitlements
reUse Engineering, Inc.

Enclosure(s)
Attachment 1- Plain Language Summary
Attachment 2 – Spanish NORI
Attachment 3 – Revised Landowner Map

cc: Mr. Rane Wilson, P.G., reUse Engineering, Inc.



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

PLAIN LANGUAGE SUMMARY FOR TPDES OR TLAP PERMIT APPLICATIONS

Plain Language Summary Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary as required by [Title 30, Texas Administrative Code \(30 TAC\), Chapter 39, Subchapter H](#). Applicants may modify the template as necessary to accurately describe their facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how the applicant will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements.

If you are subject to the alternative language notice requirements in [30 TAC Section 39.426](#), **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package**. For your convenience, a Spanish template has been provided below.

ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS Enter 'INDUSTRIAL' or 'DOMESTIC' here WASTEWATER/STORMWATER

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.

TCCI Josephine WWTP LLC (CN606288934) proposes to operate Cross Creek Ranch WWTP (RN112017587), a domestic wastewater treatment facility. The facility will be located at appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615, in Josephine, Hunt County, Texas 75189. The applicant is currently applying to the Texas Commission on Environmental Quality for a new Texas Pollutant Discharge Elimination System (TPDES) Permit in order to discharge a maximum of 1,500,000 gallons per day of treated domestic wastewater from the proposed Wastewater Treatment Plant that is to be installed on the site.

Discharges from the facility are expected to contain trace amounts of five-day carbonaceous biochemical oxygen demand (CBOD₅), total suspended solids (TSS), phosphorus (P), and ammonia nitrogen (NH₃-N). Removal of bacteria and pathogens through the MBR process is 96% or greater, and E. Coli concentration is reduced to zero through the use of U.V.. Domestic wastewater will be treated by MBR (membrane bio-reactor) treatment technology. The facility

includes an influent pump station, equalization, fine screen, anoxic, oxic, and membrane cells with ultraviolet disinfection and a sludge press.

PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

AGUAS RESIDUALES Introduzca 'INDUSTRIALES' o 'DOMÉSTICAS' aquí /**AGUAS PLUVIALES**

El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.

TCCI Josephine WWTP LLC (CN606288934) propone operar Cross Creek Ranch WWTP RN112017587, una instalación de tratamiento de aguas residuales domésticas. La instalación estará ubicada en aproximadamente 1,54 millas al oeste de la intersección de Hwy 66 y CR 2615, en Josephine, Condado de Hunt, Texas 75189. El solicitante actualmente está solicitando a la Comisión de Calidad Ambiental de Texas un nuevo Permiso del Sistema de Eliminación de Descargas Contaminantes de Texas (TPDES) para descargar un máximo de 1.500.000 galones por día de aguas residuales domésticas tratadas de la Planta de Tratamiento de Aguas Residuales propuesta que se instalará en el sitio.

Se espera que las descargas de la instalación contengan razas de demanda bioquímica de oxígeno carbonoso (CBOD₅) de cinco días, sólidos suspendidos totales (SST), fósforo (P) y nitrógeno amoniacal (NH₃-N). La eliminación de bacterias y patógenos mediante el proceso MBR es del 96% o más, y la concentración de E. Coli se reduce a cero mediante el uso de rayos UV. Aguas residuales domésticas . estará tratado por tecnología de tratamiento MBR (biorreactor de membrana). La instalación incluye estación de bombeo de afluente, ecualización, malla fina, celdas anóxicas, óxicas y de membrana con desinfección ultravioleta y prensa de lodos.

INSTRUCTIONS

1. Enter the name of applicant in this section. The applicant name should match the name associated with the customer number.
2. Enter the Customer Number in this section. Each Individual or Organization is issued a unique 11-digit identification number called a CN (e.g. CN123456789).
3. Choose “operates” in this section for existing facility applications or choose “proposes to operate” for new facility applications.
4. Enter the name of the facility in this section. The facility name should match the name associated with the regulated entity number.
5. Enter the Regulated Entity number in this section. Each site location is issued a unique 11-digit identification number called an RN (e.g. RN123456789).
6. Choose the appropriate article (a or an) to complete the sentence.
7. Enter a description of the facility in this section. For example: steam electric generating facility, nitrogenous fertilizer manufacturing facility, etc.
8. Choose “is” for an existing facility or “will be” for a new facility.
9. Enter the location of the facility in this section.
10. Enter the City nearest the facility in this section.
11. Enter the County nearest the facility in this section.
12. Enter the zip code for the facility address in this section.
13. Enter a summary of the application request in this section. For example: renewal to discharge 25,000 gallons per day of treated domestic wastewater, new application to discharge process wastewater and stormwater on an intermittent and flow-variable basis, or major amendment to reduce monitoring frequency for pH, etc. If more than one outfall is included in the application, provide applicable information for each individual outfall.
14. List all pollutants expected in the discharge from this facility in this section. If applicable, refer to the pollutants from any federal numeric effluent limitations that apply to your facility.
15. Enter the discharge types from your facility in this section (e.g., stormwater, process wastewater, once through cooling water, etc.)
16. Choose the appropriate verb tense to complete the sentence.
17. Enter a description of the wastewater treatment used at your facility. Include a description of each process, starting with initial treatment and finishing with the outfall/point of disposal. Use additional lines for individual discharge types if necessary.

Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at WO-ARPTeam@tceq.texas.gov or by phone at (512) 239-4671.

Example

Individual Industrial Wastewater Application

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.

ABC Corporation (CN600000000) operates the Starr Power Station (RN10000000000), a two-unit gas-fired electric generating facility. Unit 1 has a generating capacity of 393 megawatts (MWs) and Unit 2 has a generating capacity of 528 MWs. The facility is located at 1356 Starr Street, near the City of Austin, Travis County, Texas 78753.

This application is for a renewal to discharge 870,000,000 gallons per day of once through cooling water, auxiliary cooling water, and also authorizes the following waste streams monitored inside the facility (internal outfalls) before it is mixed with the other wastewaters authorized for discharge via main Outfall 001, referred to as “previously monitored effluents” (low-volume wastewater, metal-cleaning waste, and stormwater (from diked oil storage area yards and storm drains)) via Outfall 001. Low-volume waste sources, metal-cleaning waste, and stormwater drains on a continuous and flow-variable basis via internal Outfall 101.

The discharge of once through cooling water via Outfall 001 and low-volume waste and metal-cleaning waste via Outfall 101 from this facility is subject to federal effluent limitation guidelines at 40 CFR Part 423. The pollutants expected from these discharges based on 40 CFR Part 423 are: free available chlorine, total residual chlorine, total suspended solids, oil and grease, total iron, total copper, and pH. Temperature is also expected from these discharges. Additional potential pollutants are included in the Industrial Wastewater Application Technical Report, Worksheet 2.0.

Cooling water and boiler make-up water are supplied by Lake Starr Reservoir. The City of Austin municipal water plant (CN600000000, PWS 00000) supplies the facility’s potable water and serves as an alternate source of boiler make-up water. Water from the Lake Starr Reservoir is withdrawn at the intake structure and treated with sodium hypochlorite to prevent biofouling and sodium bromide as a chlorine enhancer to improve efficacy and then passed through condensers and auxiliary equipment on a once-through basis to cool equipment and condense exhaust steam.

Low-volume wastewater from blowdown of boiler Units 1 and 2 and metal-cleaning wastes receive no treatment prior to discharge via Outfall 101. Plant floor and equipment drains and stormwater runoff from diked oil storage areas, yards, and storm drains are routed through an oil and water separator prior to discharge via Outfall 101. Domestic wastewater, blowdown, and backwash water from the service water filter, clarifier, and sand filter are routed to the Starr Creek Domestic Sewage Treatment Plant, TPDES Permit No. WQ0010000001, for treatment and disposal. Metal-cleaning waste from equipment cleaning is generally disposed of off-site.

Comisión de Calidad Ambiental del Estado de Texas



AVISO DE RECIBO DE LA SOLICITUD Y EL INTENTO DE OBTENER PERMISO PARA LA CALIDAD DEL AGUA

PERMISO PROPUESTO NO. WQ00_____

SOLICITUD. TCCI Josephine WWTP LLC, 14675 Dallas Parkway, Suite 575, Dallas, Texas 75254 ha solicitado a la Comisión de Calidad Ambiental del Estado de Texas (TCEQ) para el propuesto Permiso No. WQ0016586001 (EPA I.D. No. TX0146439) del Sistema de Eliminación de Descargas de Contaminantes de Texas (TPDES) para autorizar la descarga de aguas residuales tratadas en un volumen que no sobrepasa un flujo promedio diario de 1.500.000 galones por día. La planta está ubicada aproximadamente 1,54 millas al oeste de la intersección de County Road 2615 y Carretera 66, cerca de la ciudad de Josephine en el Condado de Hunt, Texas. La ruta de descarga es del sitio de la planta a un afluente sin nombre del arroyo Brushy; de allí a Brushy Creek; de allí a West Caddo Creek (*Pendiente de confirmación de RWA*). La TCEQ recibió esta solicitud el 30 de julio de 2024. La solicitud para el permiso estará disponible para leerla y copiarla en Wolfe City Public Library, 102 TX-11, Front Desk, Wolfe City, Texas antes de la fecha de publicación de este aviso en el periódico. La solicitud (cualquier actualización y aviso inclusive) está disponible electrónicamente en la siguiente página web: <https://www.tceq.texas.gov/permitting/wastewater/pending-permits/tpdes-applications>. Este enlace a un mapa electrónico de la ubicación general del sitio o de la instalación es proporcionado como una cortesía y no es parte de la solicitud o del aviso. Para la ubicación exacta, consulte la solicitud.
<https://gisweb.tceq.texas.gov/LocationMapper/?marker=-96.278888,33.043055&level=18>

[Include the following non-italicized sentence if the facility is located in the Coastal Management Program boundary. The Coastal Management Program boundary is the area along the Texas Coast of the Gulf of México as depicted on the map in 31 TAC §503.1 and includes part or all of the following counties: Cameron, Willacy, Kenedy, Kleberg, Nueces, San Patricio, Aransas, Refugio, Calhoun, Victoria, Jackson, Matagorda, Brazoria, Galveston, Harris, Chambers, Jefferson y Orange.] El Director Ejecutivo de la TCEQ ha revisado esta medida para ver si está de acuerdo con los objetivos y las regulaciones del Programa de Administración Costero de Texas (CMP) de acuerdo con las regulaciones del Consejo Coordinador de la Costa (CCC) y ha determinado que la acción es conforme con las metas y regulaciones pertinentes del CMP.

AVISO ADICIONAL. El Director Ejecutivo de la TCEQ ha determinado que la solicitud es administrativamente completa y conducirá una revisión técnica de la solicitud. Después de completar la revisión técnica, el Director Ejecutivo puede preparar un borrador del permiso y emitirá una Decisión Preliminar sobre la solicitud. **El aviso de la solicitud y la decisión preliminar serán publicados y enviado a los que están en la lista de correo de las**

personas a lo largo del condado que desean recibir los avisos y los que están en la lista de correo que desean recibir avisos de esta solicitud. El aviso dará la fecha límite para someter comentarios públicos.

COMENTARIO PUBLICO / REUNION PUBLICA. Usted puede presentar **comentarios públicos o pedir una reunión pública sobre esta solicitud.** El propósito de una reunión pública es dar la oportunidad de presentar comentarios o hacer preguntas acerca de la solicitud. La TCEQ realiza una reunión pública si el Director Ejecutivo determina que hay un grado de interés público suficiente en la solicitud o si un legislador local lo pide. Una reunión pública no es una audiencia administrativa de lo contencioso.

OPORTUNIDAD DE UNA AUDIENCIA ADMINISTRATIVA DE LO CONTENCIOSO. Después del plazo para presentar comentarios públicos, el Director Ejecutivo considerará todos los comentarios apropiados y preparará una respuesta a todos los comentarios públicos esenciales, pertinentes, o significativos. **A menos que la solicitud haya sido referida directamente a una audiencia administrativa de lo contencioso, la respuesta a los comentarios y la decisión del Director Ejecutivo sobre la solicitud serán enviados por correo a todos los que presentaron un comentario público y a las personas que están en la lista para recibir avisos sobre esta solicitud. Si se reciben comentarios, el aviso también proveerá instrucciones para pedir una reconsideración de la decisión del Director Ejecutivo y para pedir una audiencia administrativa de lo contencioso.** Una audiencia administrativa de lo contencioso es un procedimiento legal similar a un procedimiento legal civil en un tribunal de distrito del estado.

PARA SOLICITAR UNA AUDIENCIA DE CASO IMPUGNADO, USTED DEBE INCLUIR EN SU SOLICITUD LOS SIGUIENTES DATOS: su nombre, dirección, y número de teléfono; el nombre del solicitante y número del permiso; la ubicación y distancia de su propiedad/actividad con respecto a la instalación; una descripción específica de la forma cómo usted sería afectado adversamente por el sitio de una manera no común al público en general; una lista de todas las cuestiones de hecho en disputa que usted presente durante el período de comentarios; y la declaración "[Yo/nosotros] solicito/solicitamos una audiencia de caso impugnado". Si presenta la petición para una audiencia de caso impugnado de parte de un grupo o asociación, debe identificar una persona que representa al grupo para recibir correspondencia en el futuro; identificar el nombre y la dirección de un miembro del grupo que sería afectado adversamente por la planta o la actividad propuesta; proveer la información indicada anteriormente con respecto a la ubicación del miembro afectado y su distancia de la planta o actividad propuesta; explicar cómo y porqué el miembro sería afectado; y explicar cómo los intereses que el grupo desea proteger son pertinentes al propósito del grupo.

Después del cierre de todos los períodos de comentarios y de petición que aplican, el Director Ejecutivo enviará la solicitud y cualquier petición para reconsideración o para una audiencia de caso impugnado a los Comisionados de la TCEQ para su consideración durante una reunión programada de la Comisión. La Comisión sólo puede conceder una solicitud de una audiencia de caso impugnado sobre los temas que el solicitante haya presentado en sus comentarios oportunos que no fueron retirados posteriormente. Si se concede una audiencia, el tema de la audiencia estará limitado a cuestiones de hecho en disputa o cuestiones mixtas de hecho y de derecho relacionadas a intereses pertinentes y materiales de calidad del agua que se hayan presentado durante el período de comentarios.

LISTA DE CORREO. Si somete comentarios públicos, un pedido para una audiencia administrativa de lo contencioso o una reconsideración de la decisión del Director Ejecutivo, la Oficina del Secretario Principal enviará por correo los avisos públicos en relación con la solicitud. Además, puede pedir que la TCEQ ponga su nombre en una o más de las listas de correos siguientes (1) la lista de correo permanente para recibir los avisos de el solicitante indicado por nombre y número del permiso específico y/o (2) la lista de correo de todas las solicitudes en un condado específico. Si desea que se agregue su nombre en una de las listas designe cual lista(s) y envía por correo su pedido a la Oficina del Secretario Principal de la TCEQ.

CONTACTOS E INFORMACIÓN A LA AGENCIA. Todos los comentarios públicos y solicitudes deben ser presentadas electrónicamente vía

<http://www14.tceq.texas.gov/epic/eComment/> o por escrito dirigidos a la Comisión de Texas de Calidad Ambiental, Oficial de la Secretaría (Office of Chief Clerk), MC-105, P.O. Box 13087, Austin, Texas 78711-3087. Tenga en cuenta que cualquier información personal que usted proporcione, incluyendo su nombre, número de teléfono, dirección de correo electrónico y dirección física pasarán a formar parte del registro público de la Agencia. Para obtener más información acerca de esta solicitud de permiso o el proceso de permisos, llame al programa de educación pública de la TCEQ, gratis, al 1-800-687-4040. Si desea información en Español, puede llamar al 1-800-687-4040.

También se puede obtener información adicional del TCCI Josephine WWTP LLC a la dirección indicada arriba o llamando a Sr. Rane Wilson, Hidrogeólogo principal de reUse Engineering, Inc al 570-567- 4297.

Fecha de emisión _____ *[Date notice issued]*

Jon Niermann, *Chairman*
Bobby Janecka, *Commissioner*
Catarina R. Gonzales, *Commissioner*
Kelly Keel, *Executive Director*



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

Protecting Texas by Reducing and Preventing Pollution

July 30, 2024

Dear Applicant:

Re: Confirmation of Submission of the New Public Domestic Wastewater Individual Permit Application

This is an acknowledgement that you have successfully completed Public Domestic Wastewater Individual Permit Application.

ER Account Number: ER105186
Application Reference Number: 654722
Authorization Number: WQ0016586001
Site Name: Cross Creek Ranch WWTP
Regulated Entity: RN112017587 - CROSS CREEK RANCH WWTP
Customer(s): CN606288934 - Tcci Josephine WWTP LLC

Please be aware that TCEQ staff may contact your designated contact for any additional information.

If you have any questions, you may contact the Applications Review and Processing Team by email at WQ-ARPTeam@tceq.texas.gov or by telephone at (512) 239-4671.

Sincerely,
Applications Review and Processing Team
Water Quality Division

Texas Commission on Environmental Quality**New Domestic or Industrial Individual Permit****Site Information (Regulated Entity)**

What is the name of the site to be authorized?	Cross Creek Ranch WWTP
Does the site have a physical address?	No
Because there is no physical address, describe how to locate this site:	Appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615
City	Josephine
State	TX
ZIP	75189
County	HUNT
Latitude (N) (##.#####)	33.043133
Longitude (W) (-###.#####)	-96.278942
Primary SIC Code	4952
Secondary SIC Code	
Primary NAICS Code	221320
Secondary NAICS Code	

Regulated Entity Site Information

What is the Regulated Entity's Number (RN)?	
What is the name of the Regulated Entity (RE)?	Cross Creek Ranch WWTP
Does the RE site have a physical address?	No
Because there is no physical address, describe how to locate this site:	Appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615
City	Josephine
State	TX
ZIP	75189
County	HUNT
Latitude (N) (##.#####)	
Longitude (W) (-###.#####)	
Facility NAICS Code	
What is the primary business of this entity?	Wastewater treatment

TCCI Jo-Customer (Applicant) Information (Owner)

How is this applicant associated with this site?	Owner
What is the applicant's Customer Number (CN)?	
Type of Customer	Corporation
Full legal name of the applicant:	

Legal Name	TCCI Josephine WWTP LLC
Texas SOS Filing Number	0805340241
Federal Tax ID	934877054
State Franchise Tax ID	32092853483
State Sales Tax ID	
Local Tax ID	
DUNS Number	084624419
Number of Employees	0-20
Independently Owned and Operated?	Yes
I certify that the full legal name of the entity applying for this permit has been provided and is legally authorized to do business in Texas.	Yes
Responsible Authority Contact	
Organization Name	TCCI Josephine WWTP LLC
Prefix	
First	Tommy
Middle	
Last	Cansler
Suffix	
Credentials	
Title	President
Responsible Authority Mailing Address	
Enter new address or copy one from list:	
Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	14675 DALLAS PKWY STE 575
Routing (such as Mail Code, Dept., or Attn:)	
City	DALLAS
State	TX
ZIP	75254
Phone (###-###-####)	4696888224
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	george@tccitx.com

Billing Contact

Responsible contact for receiving billing statements:

Select the permittee that is responsible for payment of the annual fee.	TCCI Josephine WWTP LLC
Organization Name	TCCI Josephine WWTP LLC
Prefix	

First	Tommy
Middle	
Last	Cansler
Suffix	
Credentials	
Title	President
Enter new address or copy one from list:	TCCI Josephine WWTP LLC
Mailing Address	
Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	14675 DALLAS PKWY STE 575
Routing (such as Mail Code, Dept., or Attn:)	
City	DALLAS
State	TX
ZIP	75254
Phone (###-###-####)	4696888224
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	george@tccitx.com

Application Contact

Person TCEQ should contact for questions about this application:

Same as another contact?

Organization Name	reUse Engineering Inc
Prefix	
First	Hilary
Middle	
Last	Bond
Suffix	
Credentials	
Title	Director of Permitting and Entitlements
Enter new address or copy one from list:	
Mailing Address	
Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	4411 S INTERSTATE 35 STE 100
Routing (such as Mail Code, Dept., or Attn:)	
City	GEORGETOWN
State	TX
ZIP	78626

Phone (###-###-####)	5122850302
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	hilary@reuseeng.com

Technical Contact

Person TCEQ should contact for questions about this application:

Same as another contact?

Organization Name	reUse Engineering Inc
Prefix	MR
First	Rane
Middle	
Last	Wilson
Suffix	
Credentials	PG
Title	Lead Hydrogeologist

Enter new address or copy one from list:

Mailing Address

Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	4411 S INTERSTATE 35 STE 100
Routing (such as Mail Code, Dept., or Attn:)	
City	GEORGETOWN
State	TX
ZIP	78626
Phone (###-###-####)	5705674297
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	rane@reuseeng.com

DMR Contact

Person responsible for submitting Discharge Monitoring Report

Forms:

Same as another contact?

Organization Name	TCCI Land Development
Prefix	MR
First	Tommy
Middle	

Last	Cansler
Suffix	
Credentials	
Title	President
Enter new address or copy one from list:	TCCI Josephine WWTP LLC
Mailing Address:	
Address Type	Domestic
Mailing Address (include Suite or Bldg. here, if applicable)	14675 DALLAS PKWY STE 575
Routing (such as Mail Code, Dept., or Attn:)	
City	DALLAS
State	TX
ZIP	75254
Phone (###-###-####)	4696888224
Extension	
Alternate Phone (###-###-####)	
Fax (###-###-####)	
E-mail	111tcci@att.net

Section 1# Permit Contact

Permit Contact#: 1

Person TCEQ should contact throughout the permit term.

1) Same as another contact?	TCCI Josephine WWTP LLC
2) Organization Name	TCCI Land Development Inc
3) Prefix	
4) First	Tommy
5) Middle	
6) Last	Cansler
7) Suffix	
8) Credentials	
9) Title	President
Mailing Address	
10) Enter new address or copy one from list	
11) Address Type	Domestic
11.1) Mailing Address (include Suite or Bldg. here, if applicable)	14675 DALLAS PKWY STE 575
11.2) Routing (such as Mail Code, Dept., or Attn:)	
11.3) City	DALLAS
11.4) State	TX
11.5) ZIP	75254
12) Phone (###-###-####)	4696888224

13) Extension

14) Alternate Phone (###-###-####)

15) Fax (###-###-####)

16) E-mail

george@tccitx.com

Public Notice Information

Individual Publishing the Notices

1) Prefix

MRS

2) First and Last Name

Hilary Bond

3) Credential

4) Title

Director of Permitting and Entitlements

5) Organization Name

reUse Engineering Inc

6) Mailing Address

4411 S INTERSTATE 35 STE 100

7) Address Line 2

8) City

GEORGETOWN

9) State

TX

10) Zip Code

78626

11) Phone (###-###-####)

5122850302

12) Extension

13) Fax (###-###-####)

14) Email

hilary@reuseeng.com

Contact person to be listed in the Notices

15) Prefix

MR

16) First and Last Name

Rane Wilson

17) Credential

18) Title

Lead Hydrogeologist

19) Organization Name

reUse Engineering Inc

20) Phone (###-###-####)

5705674297

21) Fax (###-###-####)

22) Email

rane@reuseeng.com

Bilingual Notice Requirements

23) Is a bilingual education program required by the Texas Education Code at the elementary or middle school nearest to the facility or proposed facility?

Yes

23.1) Are the students who attend either the elementary school or the middle school enrolled in a bilingual education program at that school?

No

23.2) Do the students at these schools attend a bilingual education program at another location?

Yes

23.3) Would the school be required to provide a bilingual education program but the school has waived out of this requirement under 19

No

TAC 89.1205(g)?

23.4) Which language is required by the bilingual program?

Spanish

Section 1# Public Viewing Information

County#: 1

1) County	HUNT
2) Public building name	Wolfe City Public Library
3) Location within the building	Front Desk
4) Physical Address of Building	102 TX-11
5) City	Wolfe City
6) Contact Name	
7) Phone (###-###-####)	9034967311
8) Extension	
9) Is the location open to the public?	Yes

Owner Information

Owner of Treatment Facility

1) Prefix	
2) First and Last Name	
3) Organization Name	TCCI Josephine WWTP LLC
4) Mailing Address	14675 Dallas Pkwy Ste 575
5) City	Dallas
6) State	TX
7) Zip Code	75254
8) Phone (###-###-####)	4696888224
9) Extension	
10) Email	111tcci@att.net
11) What is ownership of the treatment facility?	Private

Owner of Land (where treatment facility is or will be)

12) Prefix	
13) First and Last Name	
14) Organization Name	TCCI Josephine WWTP LLC
15) Mailing Address	14675 Dallas Pkwy Ste 575
16) City	Dallas
17) State	TX
18) Zip Code	75254
19) Phone (###-###-####)	4696888224
20) Extension	

21) Email	111tcci@att.net
22) Is the landowner the same person as the facility owner or co-applicant?	Yes

Admin General Information

1) Is the facility located on or does the treated effluent cross American Indian Land?	No
2) What is the authorization type that you are seeking?	Public Domestic Wastewater
2.1) Is the facility previously authorized under a Water Quality individual permit?	No
2.2) What is the proposed total flow in MGD discharged at the facility?	1.5
2.3) Select the applicable fee	>=1.0 MGD - \$2,050
3) What is your facility operational status?	Inactive
4) What is the classification for your authorization?	TPDES
4.1) City nearest the outfall(s):	Josephine
4.2) County where the outfalls are located:	HUNT
4.3) Is or will the treated wastewater discharge to a city, county, or state highway right-of-way, or a flood control district drainage ditch?	No
4.4) Is the daily average discharge at your facility of 5 MGD or more?	No
5) Did any person formerly employed by the TCEQ represent your company and get paid for service regarding this application?	No

Plain Language

1) Plain Language	
[File Properties]	
File Name	LANG_10053 XB TCCI CCR PLS.docx
Hash	9D4FE1AB1D1964BD77475DCC63DF1BBF5543E9F11E14A7699416167180A87616
MIME-Type	application/vnd.openxmlformats-officedocument.wordprocessingml.document

Supplemental Permit Information Form

1) Supplemental Permit Information Form (SPIF)	
[File Properties]	
File Name	SPIF_10053 XH TCCI CCR SPIF.docx
Hash	44920EFA70878AE2210ED05BCD64373D81C4E1B3613D8CCEA4184B2B9B647A4A
MIME-Type	application/vnd.openxmlformats-officedocument.wordprocessingml.document

Domestic Attachments

1) Have you clearly outlined and labeled the required information on the original full size USGS Topographic Map? Yes

1.1) I certify that I have clearly outlined and labeled the required information on the Topographic map and attached here.

[File Properties]

File Name	MAP_10053 XD TX_Josephine_20220524_TM_geo.pdf
Hash	86077EDBD0A9729F8C885FC5873D0C6CD2DC9979228A3134A089483CBBBC2BD9
MIME-Type	application/pdf

2) Public Involvement Plan attachment (TCEQ Form 20960)

[File Properties]

File Name	PIP_10053 XC PIP Form - CCR.pdf
Hash	B3CAB7B26A23D9680FF3F963B03EBB72D72204E0674A0C1409F16538601B0704
MIME-Type	application/pdf

3) Administrative Report 1.1

[File Properties]

File Name	ARPT_10053 Admin RPT 1.1 CCR.pdf
Hash	EA7444E1D6A0C221FD60FEA1FB6B95D1A3A6CAD9B1ECF2C745ECA7316F1C1D13
MIME-Type	application/pdf

4) I confirm that all required sections of Technical Report 1.0 are complete and will be included in the Technical Attachment. Yes

4.1) I confirm that Technical Report 1.1 is complete and included in the Technical Attachment. Yes

4.2) I confirm that Worksheet 2.0 (Receiving Waters) is complete and included in the Technical Attachment. Yes

4.3) Are you planning to include Worksheet 2.1 (Stream Physical Characteristics) in the Technical Attachment? No

4.4) Are you planning to include Worksheet 4.0 (Pollutant Analyses Requirements) in the Technical Attachment? No

4.5) Are you planning to include Worksheet 5.0 (Toxicity Testing Requirements) in the Technical Attachment? No

4.6) I confirm that Worksheet 6.0 (Industrial Waste Contribution) is complete and included in the Technical Attachment. Yes

4.7) Are you planning to include Worksheet 7.0 (Class V Injection Well Inventory/Authorization Form) in the Technical Attachment? No

4.8) Technical Attachment

[File Properties]

File Name	TECH_10054 Technical RPT (New Form) CCR.docx
-----------	---

Hash A3A762C1E26842CD48DB4A997713ADE6A1FD792A65A3A2081535699C17EDF533

MIME-Type application/vnd.openxmlformats-officedocument.wordprocessingml.document

5) Affected Landowners Map

[File Properties]

File Name LANDMP_10053 XE Landowners Map CCR.pdf

Hash 3A4BE79C75BC771FDC5D1E109B924BA2194AA83E0A87FBFDD16D9B3D0464BD71

MIME-Type application/pdf

6) Landowners Cross Reference List

[File Properties]

File Name LANDCRL_10053 XE2 Landowners List
CCR.doc

Hash E7504136B2B069D47F09A0ED618A41F9F2FD442A0B2017F8C0A4F10B9470697C

MIME-Type application/msword

7) Landowner Avery Template

[File Properties]

File Name LANDAT_10053 XE2 Landowner Labels
CCR.doc

Hash 5D40A548D9E9E13FA16CB7F643EF6162EC155D130B0C7409D10A95C2998E902D

MIME-Type application/msword

8) Buffer Zone Map

[File Properties]

File Name BUFF_ZM_10053 XG Buffer Zone Map CCR.pdf

Hash 893E1831E4839F073F1BAA772C25EBFFD28105D42699F981C521345869561E97

MIME-Type application/pdf

9) Flow Diagram

[File Properties]

File Name FLDIA_10054 X1A Process Flow Diagram
30K.pdf

Hash 683CC363A5E6285F05F7CD527302F42FD252CA76239EEA92D175958DDB2C1B9B

MIME-Type application/pdf

[File Properties]

File Name FLDIA_10054 X1B Process Flow Diagram
(250K).pdf

Hash 79DD75D752DBD244899D23F75CCCEE662EC4D88CCB2DB68864DB3F09F580FC11

MIME-Type application/pdf

[File Properties]

File Name	FLDIA_10054 X1C Process Flow Diagram (500K).pdf
Hash	15FCCD52A2C38B205FD2868F4B49E19DBA339203F1B05C566CCF859627447241
MIME-Type	application/pdf

10) Site Drawing

[File Properties]

File Name	SITEDR_10054 X2 Site Drawing CCR.pdf
Hash	45261D42703FB831F1C53EB2EE925F310BC9287F21A6DF62739394E04CC96F1F
MIME-Type	application/pdf

11) Original Photographs

[File Properties]

File Name	ORIGPH_10053 XF Photos - Cross Creek .reduced.pdf
Hash	CB8581B65FCD73383F143300BA611A96EE3226AB7C1FF609C38F7F1DED41FBDE
MIME-Type	application/pdf

12) Design Calculations

[File Properties]

File Name	DES_CAL_10054 X5B BP982 MBR 250000 gpd.pdf
Hash	F026E60DD1DD22CCAD3EA40EC981770867D98DD5630CE1C90C3E2A32AF261FFE
MIME-Type	application/pdf

[File Properties]

File Name	DES_CAL_10054 X5C BP 815 - 500000 gpd MBR.pdf
Hash	8C0D0F19A0867E15542F579BF879CFD8631E2B3E7F3E3403D059129659E8D7CD
MIME-Type	application/pdf

[File Properties]

File Name	DES_CAL_10054 X5A BP 160 - 30000 MBR.pdf
Hash	B9E6291C6AA1AEEAA1CB9BF16BEE05CF849EC9F7FA0A61E1D94EA3D170D989FB
MIME-Type	application/pdf

13) Solids Management Plan

[File Properties]

File Name	SMP_10054 X7 Solids Management Plan (CROSS CREEK RANCH 30K & 1.5MGD).docx
Hash	DDD6BF6B9F110BAE8B5F37B82378AB4D1F3355B0DCE27394BF94C992154C87AF
MIME-Type	application/vnd.openxmlformats-

officedocument.wordprocessingml.document

14) Water Balance

[File Properties]

File Name	WB_BLANK PLACEHOLDER.docx
Hash	DF81D8FC48D6BD6E47C7F61D39CC180A923C9592004A2C41EC7209760C15ED2B
MIME-Type	application/vnd.openxmlformats-officedocument.wordprocessingml.document

15) Other Attachments

[File Properties]

File Name	OTHER_10054 X4 Regionalization Packet.pdf
Hash	38DA948F29696D949B773A9DDF8053D40EE1C8963990EF2F20CFA025901C7DF0
MIME-Type	application/pdf

[File Properties]

File Name	OTHER_10054 X3 LUE Dev (1.50MGD - 5 Years).pdf
Hash	09608E8E34DA661E7317697F278BF8FE7A8A4822023C91858EAF891E26A9BC83
MIME-Type	application/pdf

[File Properties]

File Name	OTHER_10054 X6 Wind Rose.jpg
Hash	CAA7B733B2918600A6360E898CB2725B24C788C7A641C023571B3310D55B3BED
MIME-Type	image/jpeg

[File Properties]

File Name	OTHER_Sig Auth - Tommy Cansler - TCCI Josephine WWTP LLC.pdf
Hash	932C6137265A41ADC6F654967AB0DFF6FEF284F371E23E2C5FBC7AE3F10E68F2
MIME-Type	application/pdf

[File Properties]

File Name	OTHER_Sig Auth - Tommy Cansler - TCCI Josephine WWTP LLC.sigaudit.pdf
Hash	50592BD69F9A66DBEAD927640E6D009FB34E11FA98ECF6311488593B01434C6E
MIME-Type	application/pdf

Certification

I certify that I am authorized under 30 Texas Administrative Code 305.44 to sign this document and can provide documentation in proof of such authorization upon request.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

1. I am Randall Nelson, the owner of the STEERS account ER105186.
2. I have the authority to sign this data on behalf of the applicant named above.
3. I have personally examined the foregoing and am familiar with its content and the content of any attachments, and based upon my personal knowledge and/or inquiry of any individual responsible for information contained herein, that this information is true, accurate, and complete.
4. I further certify that I have not violated any term in my TCEQ STEERS participation agreement and that I have no reason to believe that the confidentiality or use of my password has been compromised at any time.
5. I understand that use of my password constitutes an electronic signature legally equivalent to my written signature.
6. I also understand that the attestations of fact contained herein pertain to the implementation, oversight and enforcement of a state and/or federal environmental program and must be true and complete to the best of my knowledge.
7. I am aware that criminal penalties may be imposed for statements or omissions that I know or have reason to believe are untrue or misleading.
8. I am knowingly and intentionally signing New Domestic or Industrial Individual Permit.
9. My signature indicates that I am in agreement with the information on this form, and authorize its submittal to the TCEQ.

OWNER Signature: Randall Nelson OWNER

Customer Number:

Legal Name:

TCCI Josephine WWTP LLC

Account Number:

ER105186

Signature IP Address:

75.225.208.199

Signature Date:

2024-07-30

Signature Hash:

38BF6283B2907AF14FA76904D80382CE012C396242A6CD109F25084C755FD49B

Form Hash Code at time
of Signature:

66B021736097898ED126D99AED0AFE444CDD1C922FA889DE7274D60C2B9AD333

Fee Payment

Transaction by:

The application fee payment transaction was made by ER105186/Randall Nelson

Paid by:

The application fee was paid by HILARY BOND

Fee Amount:

\$2000.00

Paid Date:

The application fee was paid on 2024-07-30

Transaction/Voucher number:

The transaction number is 582EA000619330 and the voucher number is 714930

Submission

Reference Number:

The application reference number is 654722

Submitted by:

The application was submitted by
ER105186/Randall Nelson

Submitted Timestamp:

The application was submitted on 2024-07-30 at
11:52:00 CDT

Submitted From:

The application was submitted from IP address
75.225.208.199

Confirmation Number:

The confirmation number is 553838

Steers Version:

The STEERS version is 6.79

Additional Information

Application Creator: This account was created by Randall Nelson

DOMESTIC WASTEWATER PERMIT APPLICATION ADMINISTRATIVE REPORT 1.0

The following information is required for new and amendment applications.

Section 1. Affected Landowner Information (Instructions Page 36)

A. Indicate by a check mark that the landowners map or drawing, with scale, includes the following information, as applicable:

- ☒ The applicant's property boundaries
- ☒ The facility site boundaries within the applicant's property boundaries
- ☒ The distance the buffer zone falls into adjacent properties and the property boundaries of the landowners located within the buffer zone
- ☒ The property boundaries of all landowners surrounding the applicant's property (Note: if the application is a major amendment for a lignite mine, the map must include the property boundaries of all landowners adjacent to the new facility (ponds).)
- ☒ The point(s) of discharge and highlighted discharge route(s) clearly shown for one mile downstream
- ☒ The property boundaries of the landowners located on both sides of the discharge route for one full stream mile downstream of the point of discharge
- ☐ The property boundaries of the landowners along the watercourse for a one-half mile radius from the point of discharge if the point of discharge is into a lake, bay, estuary, or affected by tides
- ☐ The boundaries of the effluent disposal site (for example, irrigation area or subsurface drainfield site) and all evaporation/holding ponds within the applicant's property
- ☐ The property boundaries of all landowners surrounding the effluent disposal site
- ☐ The boundaries of the sludge land application site (for land application of sewage sludge for beneficial use) and the property boundaries of landowners surrounding the applicant's property boundaries where the sewage sludge land application site is located
- ☐ The property boundaries of landowners within one-half mile in all directions from the applicant's property boundaries where the sewage sludge disposal site (for example, sludge surface disposal site or sludge monofill) is located

B. ☒ Indicate by a check mark that a separate list with the landowners' names and mailing addresses cross-referenced to the landowner's map has been provided.

C. Indicate by a check mark in which format the landowners list is submitted:

- ☒ USB Drive ☐ Four sets of labels

D. Provide the source of the landowners' names and mailing addresses:

<https://gis.bisclient.com/huntcad>

E. As required by *Texas Water Code* § 5.115, is any permanent school fund land affected by this application?

- ☐ Yes ☒ No

If **yes**, provide the location and foreseeable impacts and effects this application has on the land(s):

Click to enter text.

Section 2. Original Photographs (Instructions Page 38)

Provide original ground level photographs. Indicate with checkmarks that the following information is provided.

- ☒ At least one original photograph of the new or expanded treatment unit location
- ☒ At least two photographs of the existing/proposed point of discharge and as much area downstream (photo 1) and upstream (photo 2) as can be captured. If the discharge is to an open water body (e.g., lake, bay), the point of discharge should be in the right or left edge of each photograph showing the open water and with as much area on each respective side of the discharge as can be captured.
- ☐ At least one photograph of the existing/proposed effluent disposal site
- ☒ A plot plan or map showing the location and direction of each photograph

Section 3. Buffer Zone Map (Instructions Page 38)

A. Buffer zone map. Provide a buffer zone map on 8.5 x 11-inch paper with all of the following information. The applicant's property line and the buffer zone line may be distinguished by using dashes or symbols and appropriate labels.

- The applicant's property boundary;
- The required buffer zone; and
- Each treatment unit; and
- The distance from each treatment unit to the property boundaries.

B. Buffer zone compliance method. Indicate how the buffer zone requirements will be met. Check all that apply.

- ☒ Ownership
- ☒ Restrictive easement
- ☐ Nuisance odor control
- ☐ Variance

C. Unsuitable site characteristics. Does the facility comply with the requirements regarding unsuitable site characteristic found in 30 TAC § 309.13(a) through (d)?

- ☒ Yes ☐ No



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

PLAIN LANGUAGE SUMMARY FOR TPDES OR TLAP PERMIT APPLICATIONS

Plain Language Summary Template and Instructions for Texas Pollutant Discharge Elimination System (TPDES) and Texas Land Application (TLAP) Permit Applications

Applicants should use this template to develop a plain language summary as required by [Title 30, Texas Administrative Code \(30 TAC\), Chapter 39, Subchapter H](#). Applicants may modify the template as necessary to accurately describe their facility as long as the summary includes the following information: (1) the function of the proposed plant or facility; (2) the expected output of the proposed plant or facility; (3) the expected pollutants that may be emitted or discharged by the proposed plant or facility; and (4) how the applicant will control those pollutants, so that the proposed plant will not have an adverse impact on human health or the environment.

Fill in the highlighted areas below to describe your facility and application in plain language. Instructions and examples are provided below. Make any other edits necessary to improve readability or grammar and to comply with the rule requirements.

If you are subject to the alternative language notice requirements in [30 TAC Section 39.426](#), **you must provide a translated copy of the completed plain language summary in the appropriate alternative language as part of your application package**. For your convenience, a Spanish template has been provided below.

ENGLISH TEMPLATE FOR TPDES or TLAP NEW/RENEWAL/AMENDMENT APPLICATIONS Enter 'INDUSTRIAL' or 'DOMESTIC' here WASTEWATER/STORMWATER

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and is not a federal enforceable representation of the permit application.

TCCI Josephine WWTP LLC (2. Enter Customer Number here (i.e., CN6#####)) proposes to operate Cross Creek Ranch WWTP (5. Enter Regulated Entity Number here (i.e., RN1#####)), a domestic wastewater treatment facility. The facility will be located at appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615, in Josephine, Hunt County, Texas 75189. The applicant is currently applying to the Texas Commission on Environmental Quality for a new Texas Pollutant Discharge Elimination System (TPDES) Permit in order to discharge a maximum of 1,500,000 gallons per day of treated domestic wastewater from the proposed Wastewater Treatment Plant that is to be installed on the site.

Discharges from the facility are expected to contain trace amounts of five-day carbonaceous biochemical oxygen demand (CBOD₅), total suspended solids (TSS), phosphorus (P), and ammonia nitrogen (NH₃-N). Removal of bacteria and pathogens through the MBR process is 96% or greater, and E. Coli concentration is reduced to zero through the use of U.V.. Domestic wastewater will be treated by MBR (membrane bio-reactor) treatment technology. The facility

includes an influent pump station, equalization, fine screen, anoxic, oxic, and membrane cells with ultraviolet disinfection and a sludge press.

PLANTILLA EN ESPAÑOL PARA SOLICITUDES NUEVAS/RENOVACIONES/ENMIENDAS DE TPDES o TLAP

AGUAS RESIDUALES Introduzca 'INDUSTRIALES' o 'DOMÉSTICAS' aquí /AGUAS PLUVIALES

El siguiente resumen se proporciona para esta solicitud de permiso de calidad del agua pendiente que está siendo revisada por la Comisión de Calidad Ambiental de Texas según lo requerido por el Capítulo 39 del Código Administrativo de Texas 30. La información proporcionada en este resumen puede cambiar durante la revisión técnica de la solicitud y no es una representación ejecutiva fedérale de la solicitud de permiso.

TCCI Josephine WWTP LLC (2. Introduzca el número de cliente aquí (es decir, CN6#####).) propone operar Cross Creek Ranch WWTP 5. Introduzca el número de entidad regulada aquí (es decir, RN1#####), una instalación de tratamiento de aguas residuales domésticas. La instalación estará ubicada en aproximadamente 1,54 millas al oeste de la intersección de Hwy 66 y CR 2615, en Josephine, Condado de Hunt, Texas 75189. El solicitante actualmente está solicitando a la Comisión de Calidad Ambiental de Texas un nuevo Permiso del Sistema de Eliminación de Descargas Contaminantes de Texas (TPDES) para descargar un máximo de 1.500.000 galones por día de aguas residuales domésticas tratadas de la Planta de Tratamiento de Aguas Residuales propuesta que se instalará en el sitio.

Se espera que las descargas de la instalación contengan razas de demanda bioquímica de oxígeno carbonoso (CBOD₅) de cinco días, sólidos suspendidos totales (SST), fósforo (P) y nitrógeno amoniacal (NH₃-N). La eliminación de bacterias y patógenos mediante el proceso MBR es del 96% o más, y la concentración de E. Coli se reduce a cero mediante el uso de rayos UV. Aguas residuales domésticas. estará tratado por tecnología de tratamiento MBR (biorreactor de membrana). La instalación incluye estación de bombeo de afluente, ecualización, malla fina, celdas anóxicas, óxicas y de membrana con desinfección ultravioleta y prensa de lodos.

INSTRUCTIONS

1. Enter the name of applicant in this section. The applicant name should match the name associated with the customer number.
2. Enter the Customer Number in this section. Each Individual or Organization is issued a unique 11-digit identification number called a CN (e.g. CN123456789).
3. Choose “operates” in this section for existing facility applications or choose “proposes to operate” for new facility applications.
4. Enter the name of the facility in this section. The facility name should match the name associated with the regulated entity number.
5. Enter the Regulated Entity number in this section. Each site location is issued a unique 11-digit identification number called an RN (e.g. RN123456789).
6. Choose the appropriate article (a or an) to complete the sentence.
7. Enter a description of the facility in this section. For example: steam electric generating facility, nitrogenous fertilizer manufacturing facility, etc.
8. Choose “is” for an existing facility or “will be” for a new facility.
9. Enter the location of the facility in this section.
10. Enter the City nearest the facility in this section.
11. Enter the County nearest the facility in this section.
12. Enter the zip code for the facility address in this section.
13. Enter a summary of the application request in this section. For example: renewal to discharge 25,000 gallons per day of treated domestic wastewater, new application to discharge process wastewater and stormwater on an intermittent and flow-variable basis, or major amendment to reduce monitoring frequency for pH, etc. If more than one outfall is included in the application, provide applicable information for each individual outfall.
14. List all pollutants expected in the discharge from this facility in this section. If applicable, refer to the pollutants from any federal numeric effluent limitations that apply to your facility.
15. Enter the discharge types from your facility in this section (e.g., stormwater, process wastewater, once through cooling water, etc.)
16. Choose the appropriate verb tense to complete the sentence.
17. Enter a description of the wastewater treatment used at your facility. Include a description of each process, starting with initial treatment and finishing with the outfall/point of disposal. Use additional lines for individual discharge types if necessary.

Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at WQ-ARPTeam@tceq.texas.gov or by phone at (512) 239-4671.

Example

Individual Industrial Wastewater Application

The following summary is provided for this pending water quality permit application being reviewed by the Texas Commission on Environmental Quality as required by 30 TAC Chapter 39. The information provided in this summary may change during the technical review of the application and are not federal enforceable representations of the permit application.

ABC Corporation (CN600000000) operates the Starr Power Station (RN10000000000), a two-unit gas-fired electric generating facility. Unit 1 has a generating capacity of 393 megawatts (MWs) and Unit 2 has a generating capacity of 528 MWs. The facility is located at 1356 Starr Street, near the City of Austin, Travis County, Texas 78753.

This application is for a renewal to discharge 870,000,000 gallons per day of once through cooling water, auxiliary cooling water, and also authorizes the following waste streams monitored inside the facility (internal outfalls) before it is mixed with the other wastewaters authorized for discharge via main Outfall 001, referred to as “previously monitored effluents” (low-volume wastewater, metal-cleaning waste, and stormwater (from diked oil storage area yards and storm drains)) via Outfall 001. Low-volume waste sources, metal-cleaning waste, and stormwater drains on a continuous and flow-variable basis via internal Outfall 101.

The discharge of once through cooling water via Outfall 001 and low-volume waste and metal-cleaning waste via Outfall 101 from this facility is subject to federal effluent limitation guidelines at 40 CFR Part 423. The pollutants expected from these discharges based on 40 CFR Part 423 are: free available chlorine, total residual chlorine, total suspended solids, oil and grease, total iron, total copper, and pH. Temperature is also expected from these discharges. Additional potential pollutants are included in the Industrial Wastewater Application Technical Report, Worksheet 2.0.

Cooling water and boiler make-up water are supplied by Lake Starr Reservoir. The City of Austin municipal water plant (CN600000000, PWS 00000) supplies the facility’s potable water and serves as an alternate source of boiler make-up water. Water from the Lake Starr Reservoir is withdrawn at the intake structure and treated with sodium hypochlorite to prevent biofouling and sodium bromide as a chlorine enhancer to improve efficacy and then passed through condensers and auxiliary equipment on a once-through basis to cool equipment and condense exhaust steam.

Low-volume wastewater from blowdown of boiler Units 1 and 2 and metal-cleaning wastes receive no treatment prior to discharge via Outfall 101. Plant floor and equipment drains and stormwater runoff from diked oil storage areas, yards, and storm drains are routed through an oil and water separator prior to discharge via Outfall 101. Domestic wastewater, blowdown, and backwash water from the service water filter, clarifier, and sand filter are routed to the Starr Creek Domestic Sewage Treatment Plant, TPDES Permit No. WQ0010000001, for treatment and disposal. Metal-cleaning waste from equipment cleaning is generally disposed of off-site.



Texas Commission on Environmental Quality

Public Involvement Plan Form for Permit and Registration Applications

The Public Involvement Plan is intended to provide applicants and the agency with information about how public outreach will be accomplished for certain types of applications in certain geographical areas of the state. It is intended to apply to new activities; major changes at existing plants, facilities, and processes; and to activities which are likely to have significant interest from the public. This preliminary screening is designed to identify applications that will benefit from an initial assessment of the need for enhanced public outreach.

All applicable sections of this form should be completed and submitted with the permit or registration application. For instructions on how to complete this form, see TCEQ-20960-inst.

Section 1. Preliminary Screening

New Permit or Registration Application

New Activity - modification, registration, amendment, facility, etc. (see instructions)

If neither of the above boxes are checked, completion of the form is not required and does not need to be submitted.

Section 2. Secondary Screening

Requires public notice,

Considered to have significant public interest, and

Located within any of the following geographical locations:

- Austin
- Dallas
- Fort Worth
- Houston
- San Antonio
- West Texas
- Texas Panhandle
- Along the Texas/Mexico Border
- Other geographical locations should be decided on a case-by-case basis

**If all the above boxes are not checked, a Public Involvement Plan is not necessary.
Stop after Section 2 and submit the form.**

Public Involvement Plan not applicable to this application. Provide **brief** explanation.

Past TPDES Permits pursued for comparable subdivisions in nearby counties in Texas (Hunt, Kaufman, Denton) have not received significant public interest. (I.e. WQ0016219001, WQ0013434002, WQ0016242001, WQ0016040001, WQ0016434001)

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

SUPPLEMENTAL PERMIT INFORMATION FORM (SPIF)

FOR AGENCIES REVIEWING DOMESTIC OR INDUSTRIAL TPDES WASTEWATER PERMIT APPLICATIONS

TCEQ USE ONLY:

Application type: ____Renewal ____Major Amendment ____Minor Amendment ____New

County: _____ Segment Number: _____

Admin Complete Date: _____

Agency Receiving SPIF:

____ Texas Historical Commission

____ U.S. Fish and Wildlife

____ Texas Parks and Wildlife Department

____ U.S. Army Corps of Engineers

This form applies to TPDES permit applications only. (Instructions, Page 53)

Complete this form as a separate document. TCEQ will mail a copy to each agency as required by our agreement with EPA. If any of the items are not completely addressed or further information is needed, we will contact you to provide the information before issuing the permit. Address each item completely.

Do not refer to your response to any item in the permit application form. Provide each attachment for this form separately from the Administrative Report of the application. The application will not be declared administratively complete without this SPIF form being completed in its entirety including all attachments. Questions or comments concerning this form may be directed to the Water Quality Division's Application Review and Processing Team by email at WQ-ARPTeam@tceq.texas.gov or by phone at (512) 239-4671.

The following applies to all applications:

1. Permittee: TCCI Josephine WWTP LLC

Permit No. WQ00 _____

EPA ID No. TX _____

Address of the project (or a location description that includes street/highway, city/vicinity, and county):

The WWTF will be located appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615, Josephine, 75189

Provide the name, address, phone and fax number of an individual that can be contacted to answer specific questions about the property.

Prefix (Mr., Ms., Miss): Mr.

First and Last Name: Rane Wilson

Credential (P.E, P.G., Ph.D., etc.): PG

Title: Lead Hydrogeologist

Mailing Address: 4411 S IH-35 Ste 100

City, State, Zip Code: Georgetown, TX 78626

Phone No.: 570-567-4297 Ext.:

Fax No.:

E-mail Address: rane@reuseeng.com

2. List the county in which the facility is located: Hunt
3. If the property is publicly owned and the owner is different than the permittee/applicant, please list the owner of the property.

N/A

4. Provide a description of the effluent discharge route. The discharge route must follow the flow of effluent from the point of discharge to the nearest major watercourse (from the point of discharge to a classified segment as defined in 30 TAC Chapter 307). If known, please identify the classified segment number.

The discharge point is located at 33.046261 and -96.291969. The discharge point is into an unnamed tributary of Brushy Creek; thence to Brushy Creek; thence into West Caddo Creek (Segment ID 0507C) approximately 10 miles southeast of the discharge point.

5. Please provide a separate 7.5-minute USGS quadrangle map with the project boundaries plotted and a general location map showing the project area. Please highlight the discharge route from the point of discharge for a distance of one mile downstream. (This map is required in addition to the map in the administrative report).

Provide original photographs of any structures 50 years or older on the property.

Does your project involve any of the following? Check all that apply.

- ☒ Proposed access roads, utility lines, construction easements
- ☐ Visual effects that could damage or detract from a historic property's integrity
- ☐ Vibration effects during construction or as a result of project design
- ☐ Additional phases of development that are planned for the future
- ☐ Sealing caves, fractures, sinkholes, other karst features

☐ Disturbance of vegetation or wetlands

1. List proposed construction impact (surface acres to be impacted, depth of excavation, sealing of caves, or other karst features):

Approximately 2 acres will be disturbed to construct the WWTF with additional acreage disturbed for the pressurized discharge line. No wetlands, caves or karst features will be impacted by the proposed WWTF construction.

2. Describe existing disturbances, vegetation, and land use:

Proposed WWTF location is agricultural land.

THE FOLLOWING ITEMS APPLY ONLY TO APPLICATIONS FOR NEW TPDES PERMITS AND MAJOR AMENDMENTS TO TPDES PERMITS

3. List construction dates of all buildings and structures on the property:

There are no buildings or structures on the property. Subdivision is proposed to be constructed on the property adjacent to the Applicants property; completion date unknown. Structures, individual homes, will be subject to individual property owners. No structures other than those related to the WWTF will be constructed on the Applicants property.

4. Provide a brief history of the property, and name of the architect/builder, if known.

There are no buildings or structures on the property. No architect/builder.



TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

DOMESTIC WASTEWATER PERMIT APPLICATION TECHNICAL REPORT 1.0

For any questions about this form, please contact the Domestic Wastewater Permitting Team at 512-239-4671.

The following information is required for all renewal, new, and amendment applications.

Section 1. Permitted or Proposed Flows (Instructions Page 43)

A. Existing/Interim I Phase

Design Flow (MGD): 0.03

2-Hr Peak Flow (MGD): 0.12

Estimated construction start date: Calendar Year 2025

Estimated waste disposal start date: Calendar Year 2026

B. Interim II Phase

Design Flow (MGD): 0.25

2-Hr Peak Flow (MGD): 1.0

Estimated construction start date: Calendar Year 2026

Estimated waste disposal start date: Calendar Year 2027

C. Final Phase

Design Flow (MGD): $0.25 + 0.5 + 0.5 = 1.5$

2-Hr Peak Flow (MGD): 6.0

Estimated construction start date: Calendar Year 2030

Estimated waste disposal start date: Calendar Year 2031

D. Current Operating Phase

Provide the startup date of the facility: [Click to enter text.](#)

Section 2. Treatment Process (Instructions Page 43)

A. Current Operating Phase

Provide a detailed description of the treatment process. **Include the type of treatment plant, mode of operation, and all treatment units.** Start with the plant's head works and

finish with the point of discharge. Include all sludge processing and drying units. **If more than one phase exists or is proposed, a description of *each phase* must be provided.**

The plant is a Membrane Bio-Reactor (MBR) facility, including influent pump station, fine screen, two anoxic tanks, aerobic tank, and membrane cells with ultraviolet disinfection, a sludge press, and an effluent pump station. Phase I will include a 30,000 gpd temporary plant, which will be removed upon the installation of the permanent facility which includes two (2) 250,000 gpd treatment trains and two (2) 500,000 gpd treatment trains for a total of 1,500,000 gpd treated effluent to be discharged in the final phase.

B. Treatment Units

In Table 1.0(1), provide the treatment unit type, the number of units, and dimensions (length, width, depth) of each treatment unit, accounting for ***all*** phases of operation.

Table 1.0(1)(A) - Treatment Units for 30K GPD Treatment Train

Treatment Unit Type	Number of Units	Dimensions (L x W x D)
Fine Screen	2	N/A
Anoxic Tank I	1	10'x10'x12'
Aerobic Tank	1	10'x10'x12'
Membrane Cell	1	10'x10'x12'
Ultraviolet Disinfection	1	N/A
Sludge Press	1	N/A

Table 1.0(1)(B) – Treatment Units for 250K GPD Treatment Train

Fine Screen	4	N/A
Anoxic Tank I	2	33'x10'x17.5'
Aerobic Tank	2	41'x10'x17.5'
Anoxic Tank II	2	24'x10'x17.5'
Membrane Cell	2	50'x10'x17.5'
Ultraviolet Disinfection	4	N/A
Sludge Press	1	N/A

Table 1.0(1)(C) – Treatment Units for 500K GPD Treatment Train

Fine Screen	4	N/A
Anoxic Tank I	2	20'x40'x21'
Aerobic Tank	2	20'x40'x21'
Anoxic Tank II	2	20'x40'x21'
Membrane Cell	2	16'x19.5'x21'
Ultraviolet Disinfection	4	N/A
Sludge Press	1	N/A

C. Process Flow Diagram

Provide flow diagrams for the existing facilities and **each** proposed phase of construction.

Attachment: 1A. Process Flow Diagram 30,000 GPD Unit; 1B Process Flow Diagram 250,000 GPD Unit; and 1C Process Flow Diagram 500,000 GPD Unit

Section 3. Site Information and Drawing (Instructions Page 44)

Provide the TPDES discharge outfall latitude and longitude. Enter N/A if not applicable.

- Latitude: 33.046261
- Longitude: -96.291969

Provide the TLAP disposal site latitude and longitude. Enter N/A if not applicable.

- Latitude: Click to enter text.
- Longitude: Click to enter text.

Provide a site drawing for the facility that shows the following:

- The boundaries of the treatment facility;
- The boundaries of the area served by the treatment facility;
- If land disposal of effluent, the boundaries of the disposal site and all storage/holding ponds; and
- If sludge disposal is authorized in the permit, the boundaries of the land application or disposal site.

Attachment: 2 Site Drawing

Provide the name **and** a description of the area served by the treatment facility.

Cross Creek Ranch WWTP will serve a residential development with proposed 5,463 Living Units Equivalents (LUEs).

Collection System Information **for wastewater TPDES permits only:** Provide information for each **uniquely owned** collection system, existing and new, served by this facility, including satellite collection systems. **Please see the instructions for a detailed explanation and examples.**

Collection System Information

Collection System Name	Owner Name	Owner Type	Population Served
Cross Creek Ranch WWTP	TCCI Josephine WWTP LLC	Privately Owned	5,463 LUEs
		<u>Choose an item.</u>	
		<u>Choose an item.</u>	
		<u>Choose an item.</u>	

Section 4. Unbuilt Phases (Instructions Page 45)

Is the application for a renewal of a permit that contains an unbuilt phase or phases?

☐ Yes ☒ No

If **yes**, does the existing permit contain a phase that has not been constructed **within five years** of being authorized by the TCEQ?

☐ Yes ☐ No

If **yes**, provide a detailed discussion regarding the continued need for the unbuilt phase. **Failure to provide sufficient justification may result in the Executive Director recommending denial of the unbuilt phase or phases.**

Click to enter text.

Section 5. Closure Plans (Instructions Page 45)

Have any treatment units been taken out of service permanently, or will any units be taken out of service in the next five years?

☐ Yes ☒ No

If **yes**, was a closure plan submitted to the TCEQ?

☐ Yes ☐ No

If **yes**, provide a brief description of the closure and the date of plan approval.

Click to enter text.

Section 6. Permit Specific Requirements (Instructions Page 45)

For applicants with an existing permit, check the Other Requirements or Special Provisions of the permit.

A. Summary transmittal

Have plans and specifications been approved for the existing facilities and each proposed phase?

☐ Yes ☒ No

If **yes**, provide the date(s) of approval for each phase: [Click to enter text.](#)

Provide information, including dates, on any actions taken to meet a *requirement or provision* pertaining to the submission of a summary transmittal letter. **Provide a copy of an approval letter from the TCEQ, if applicable.**

[Click to enter text.](#)

B. Buffer zones

Have the buffer zone requirements been met?

☒ Yes ☐ No

Provide information below, including dates, on any actions taken to meet the conditions of the buffer zone. If available, provide any new documentation relevant to maintaining the buffer zones.

See Attachment G of the 10053 Administrative Report. The wastewater treatment facility is either located 150 feet from the nearest property line or an easement (Odor and Noise Abatement) has been/will be created between the Applicant and the neighboring property into which the buffer zone falls.

C. Other actions required by the current permit

Does the *Other Requirements* or *Special Provisions* section in the existing permit require submission of any other information or other required actions? Examples include Notification of Completion, progress reports, soil monitoring data, etc.

☐ Yes ☒ No

If **yes**, provide information below on the status of any actions taken to meet the conditions of an *Other Requirement* or *Special Provision*.

[Click to enter text.](#)

D. Grit and grease treatment

1. Acceptance of grit and grease waste

Does the facility have a grit and/or grease processing facility onsite that treats and decants or accepts transported loads of grit and grease waste that are discharged directly to the wastewater treatment plant prior to any treatment?

☐ Yes ☒ No

If **No**, stop here and continue with Subsection E. Stormwater Management.

2. *Grit and grease processing*

Describe below how the grit and grease waste is treated at the facility. In your description, include how and where the grit and grease is introduced to the treatment works and how it is separated or processed. Provide a flow diagram showing how grit and grease is processed at the facility.

Click to enter text.

3. *Grit disposal*

Does the facility have a Municipal Solid Waste (MSW) registration or permit for grit disposal?

☐ Yes ☐ No

If No, contact the TCEQ Municipal Solid Waste team at 512-239-2335. Note: A registration or permit is required for grit disposal. Grit shall not be combined with treatment plant sludge. See the instruction booklet for additional information on grit disposal requirements and restrictions.

Describe the method of grit disposal.

Click to enter text.

4. *Grease and decanted liquid disposal*

Note: A registration or permit is required for grease disposal. Grease shall not be combined with treatment plant sludge. For more information, contact the TCEQ Municipal Solid Waste team at 512-239-2335.

Describe how the decant and grease are treated and disposed of after grit separation.

Click to enter text.

E. Stormwater management

1. *Applicability*

Does the facility have a design flow of 1.0 MGD or greater in any phase?

☒ Yes ☐ No

Does the facility have an approved pretreatment program, under 40 CFR Part 403?

☐ Yes ☒ No

If no to both of the above, then skip to Subsection F, Other Wastes Received.

2. *MSGP coverage*

Is the stormwater runoff from the WWTP and dedicated lands for sewage disposal currently permitted under the TPDES Multi-Sector General Permit (MSGP), TXR050000?

☐ Yes ☒ No

If yes, please provide MSGP Authorization Number and skip to Subsection F, Other Wastes Received:

TXR05 [Click to enter text.](#) or TXRNE [Click to enter text.](#)

If no, do you intend to seek coverage under TXR050000?

☒ Yes ☐ No

3. *Conditional exclusion*

Alternatively, do you intend to apply for a conditional exclusion from permitting based TXR050000 (Multi Sector General Permit) Part II B.2 or TXR050000 (Multi Sector General Permit) Part V, Sector T 3(b)?

☐ Yes ☒ No

If yes, please explain below then proceed to Subsection F, Other Wastes Received:

[Click to enter text.](#)

4. *Existing coverage in individual permit*

Is your stormwater discharge currently permitted through this individual TPDES or TLAP permit?

☐ Yes ☒ No

If yes, provide a description of stormwater runoff management practices at the site that are authorized in the wastewater permit then skip to Subsection F, Other Wastes Received.

[Click to enter text.](#)

5. *Zero stormwater discharge*

Do you intend to have no discharge of stormwater via use of evaporation or other means?

☐ Yes ☒ No

If yes, explain below then skip to Subsection F. Other Wastes Received.

Note: If there is a potential to discharge any stormwater to surface water in the state as the result of any storm event, then permit coverage is required under the MSGP or an individual discharge permit. This requirement applies to all areas of facilities with treatment plants or systems that treat, store, recycle, or reclaim domestic sewage, wastewater or sewage sludge (including dedicated lands for sewage sludge disposal located within the onsite property boundaries) that meet the applicability criteria of above. You have the option of obtaining coverage under the MSGP for direct discharges, (recommended), or obtaining coverage under this individual permit.

6. Request for coverage in individual permit

Are you requesting coverage of stormwater discharges associated with your treatment plant under this individual permit?

☐ Yes ☒ No

If **yes**, provide a description of stormwater runoff management practices at the site for which you are requesting authorization in this individual wastewater permit and describe whether you intend to comingle this discharge with your treated effluent or discharge it via a separate dedicated stormwater outfall. Please also indicate if you intend to divert stormwater to the treatment plant headworks and indirectly discharge it to water in the state.

Click to enter text.

Note: Direct stormwater discharges to waters in the state authorized through this individual permit will require the development and implementation of a stormwater pollution prevention plan (SWPPP) and will be subject to additional monitoring and reporting requirements. Indirect discharges of stormwater via headworks recycling will require compliance with all individual permit requirements including 2-hour peak flow limitations. All stormwater discharge authorization requests will require additional information during the technical review of your application.

F. Discharges to the Lake Houston Watershed

Does the facility discharge in the Lake Houston watershed?

☐ Yes ☒ No

If yes, attach a Sewage Sludge Solids Management Plan. See Example 5 in the instructions.

Click to enter text.

G. Other wastes received including sludge from other WWTPs and septic waste

1. Acceptance of sludge from other WWTPs

Does or will the facility accept sludge from other treatment plants at the facility site?

☐ Yes ☒ No

If yes, attach sewage sludge solids management plan. See Example 5 of instructions.

In addition, provide the date the plant started or is anticipated to start accepting sludge, an estimate of monthly sludge acceptance (gallons or millions of gallons), an estimate of the BOD₅ concentration of the sludge, and the design BOD₅ concentration of the influent from the collection system. Also note if this information has or has not changed since the last permit action.

Click to enter text.

Note: Permits that accept sludge from other wastewater treatment plants may be required to have influent flow and organic loading monitoring.

2. Acceptance of septic waste

Is the facility accepting or will it accept septic waste?

☐ Yes ☒ No

If yes, does the facility have a Type V processing unit?

☐ Yes ☐ No

If yes, does the unit have a Municipal Solid Waste permit?

☐ Yes ☐ No

If yes to any of the above, provide the date the plant started or is anticipated to start accepting septic waste, an estimate of monthly septic waste acceptance (gallons or millions of gallons), an estimate of the BOD₅ concentration of the septic waste, and the design BOD₅ concentration of the influent from the collection system. Also note if this information has or has not changed since the last permit action.

Click to enter text.

Note: Permits that accept sludge from other wastewater treatment plants may be required to have influent flow and organic loading monitoring.

3. Acceptance of other wastes (not including septic, grease, grit, or RCRA, CERCLA or as discharged by IUs listed in Worksheet 6)

Is or will the facility accept wastes that are not domestic in nature excluding the categories listed above?

☐ Yes ☒ No

If yes, provide the date that the plant started accepting the waste, an estimate how much waste is accepted on a monthly basis (gallons or millions of gallons), a description of the entities generating the waste, and any distinguishing chemical or

other physical characteristic of the waste. Also note if this information has or has not changed since the last permit action.

Click to enter text.

Section 7. Pollutant Analysis of Treated Effluent (Instructions Page 50)

Is the facility in operation?

☐ Yes ☒ No

If **no**, this section is not applicable. Proceed to Section 8.

If **yes**, provide effluent analysis data for the listed pollutants. **Wastewater treatment facilities** complete Table 1.0(2). **Water treatment facilities** discharging filter backwash water, complete Table 1.0(3). Provide copies of the laboratory results sheets. **These tables are not applicable for a minor amendment without renewal.** See the instructions for guidance.

Note: The sample date must be within 1 year of application submission.

Table 1.0(2) – Pollutant Analysis for Wastewater Treatment Facilities

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
CBOD ₅ , mg/l					
Total Suspended Solids, mg/l					
Ammonia Nitrogen, mg/l					
Nitrate Nitrogen, mg/l					
Total Kjeldahl Nitrogen, mg/l					
Sulfate, mg/l					
Chloride, mg/l					
Total Phosphorus, mg/l					
pH, standard units					
Dissolved Oxygen*, mg/l					
Chlorine Residual, mg/l					
<i>E.coli</i> (CFU/100ml) freshwater					
Enterococci (CFU/100ml) saltwater					
Total Dissolved Solids, mg/l					
Electrical Conductivity, µmohs/cm, †					

Oil & Grease, mg/l					
Alkalinity (CaCO ₃)*, mg/l					

*TPDES permits only

†TLAP permits only

Table 1.0(3) – Pollutant Analysis for Water Treatment Facilities

Pollutant	Average Conc.	Max Conc.	No. of Samples	Sample Type	Sample Date/Time
Total Suspended Solids, mg/l					
Total Dissolved Solids, mg/l					
pH, standard units					
Fluoride, mg/l					
Aluminum, mg/l					
Alkalinity (CaCO ₃), mg/l					

Section 8. Facility Operator (Instructions Page 50)

Facility Operator Name: Not yet contracted.

Facility Operator's License Classification and Level: Click to enter text.

Facility Operator's License Number: Click to enter text.

Section 9. Sludge and Biosolids Management and Disposal (Instructions Page 51)

A. WWTP's Biosolids Management Facility Type

Check all that apply. See instructions for guidance

- ☐ Design flow >= 1 MGD
- ☐ Serves >= 10,000 people
- ☐ Class I Sludge Management Facility (per 40 CFR § 503.9)
- ☐ Biosolids generator
- ☐ Biosolids end user – land application (onsite)
- ☐ Biosolids end user – surface disposal (onsite)
- ☐ Biosolids end user – incinerator (onsite)

B. WWTP's Biosolids Treatment Process

Check all that apply. See instructions for guidance.

- ☐ Aerobic Digestion
- ☐ Air Drying (or sludge drying beds)
- ☐ Lower Temperature Composting
- ☐ Lime Stabilization
- ☐ Higher Temperature Composting

- ☐ Heat Drying
- ☐ Thermophilic Aerobic Digestion
- ☐ Beta Ray Irradiation
- ☐ Gamma Ray Irradiation
- ☐ Pasteurization
- ☐ Preliminary Operation (e.g. grinding, de-gritting, blending)
- ☐ Thickening (e.g. gravity thickening, centrifugation, filter press, vacuum filter)
- ☐ Sludge Lagoon
- ☐ Temporary Storage (< 2 years)
- ☐ Long Term Storage (>= 2 years)
- ☐ Methane or Biogas Recovery
- ☐ Other Treatment Process: [Click to enter text.](#)

C. Biosolids Management

Provide information on the *intended* biosolids management practice. Do not enter every management practice that you want authorized in the permit, as the permit will authorize all biosolids management practices listed in the instructions. Rather indicate the management practice the facility plans to use.

Biosolids Management

Management Practice	Handler or Preparer Type	Bulk or Bag Container	Amount (dry metric tons)	Pathogen Reduction Options	Vector Attraction Reduction Option
Choose an item.	Choose an item.	Choose an item.		Choose an item.	Choose an item.
Choose an item.	Choose an item.	Choose an item.		Choose an item.	Choose an item.
Choose an item.	Choose an item.	Choose an item.		Choose an item.	Choose an item.

If “Other” is selected for Management Practice, please explain (e.g. monofill or transport to another WWTP): [Click to enter text.](#)

D. Disposal site

Disposal site name: [REPUBLIC MALOY LANDFILL](#)

TCEQ permit or registration number: [1195B](#)

County where disposal site is located: [Hunt](#)

E. Transportation method

Method of transportation (truck, train, pipe, other): [Truck](#)

Name of the hauler: [The Cleaning Guys](#)

Hauler registration number: 25218

Sludge is transported as a:

Liquid ☐ semi-liquid ☐ semi-solid ☐ solid ☒

Section 10. Permit Authorization for Sewage Sludge Disposal (Instructions Page 53)

A. Beneficial use authorization

Does the existing permit include authorization for land application of sewage sludge for beneficial use?

☐ Yes ☒ No

If **yes**, are you requesting to continue this authorization to land apply sewage sludge for beneficial use?

☐ Yes ☐ No

If **yes**, is the completed **Application for Permit for Beneficial Land Use of Sewage Sludge (TCEQ Form No. 10451)** attached to this permit application (see the instructions for details)?

☐ Yes ☐ No

B. Sludge processing authorization

Does the existing permit include authorization for any of the following sludge processing, storage or disposal options?

Sludge Composting	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Marketing and Distribution of sludge	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Sludge Surface Disposal or Sludge Monofill	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Temporary storage in sludge lagoons	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No

If **yes** to any of the above sludge options and the applicant is requesting to continue this authorization, is the completed **Domestic Wastewater Permit Application: Sewage Sludge Technical Report (TCEQ Form No. 10056)** attached to this permit application?

☐ Yes ☐ No

Section 11. Sewage Sludge Lagoons (Instructions Page 53)

Does this facility include sewage sludge lagoons?

☐ Yes ☒ No

If yes, complete the remainder of this section. If no, proceed to Section 12.

A. Location information

The following maps are required to be submitted as part of the application. For each map, provide the Attachment Number.

- Original General Highway (County) Map:

Attachment: [Click to enter text.](#)

- USDA Natural Resources Conservation Service Soil Map:

Attachment: [Click to enter text.](#)

- Federal Emergency Management Map:

Attachment: [Click to enter text.](#)

- Site map:

Attachment: [Click to enter text.](#)

Discuss in a description if any of the following exist within the lagoon area. Check all that apply.

- ☐ Overlap a designated 100-year frequency flood plain
- ☐ Soils with flooding classification
- ☐ Overlap an unstable area
- ☐ Wetlands
- ☐ Located less than 60 meters from a fault
- ☐ None of the above

Attachment: [Click to enter text.](#)

If a portion of the lagoon(s) is located within the 100-year frequency flood plain, provide the protective measures to be utilized including type and size of protective structures:

[Click to enter text.](#)

B. Temporary storage information

Provide the results for the pollutant screening of sludge lagoons. These results are in addition to pollutant results in *Section 7 of Technical Report 1.0*.

Nitrate Nitrogen, mg/kg: [Click to enter text.](#)

Total Kjeldahl Nitrogen, mg/kg: [Click to enter text.](#)

Total Nitrogen (=nitrate nitrogen + TKN), mg/kg: [Click to enter text.](#)

Phosphorus, mg/kg: [Click to enter text.](#)

Potassium, mg/kg: [Click to enter text.](#)

pH, standard units: [Click to enter text.](#)

Ammonia Nitrogen mg/kg: [Click to enter text.](#)

Arsenic: [Click to enter text.](#)

Cadmium: [Click to enter text.](#)

Chromium: [Click to enter text.](#)

Copper: [Click to enter text.](#)

Lead: [Click to enter text.](#)

Mercury: [Click to enter text.](#)

Molybdenum: [Click to enter text.](#)

Nickel: [Click to enter text.](#)

Selenium: [Click to enter text.](#)

Zinc: [Click to enter text.](#)

Total PCBs: [Click to enter text.](#)

Provide the following information:

Volume and frequency of sludge to the lagoon(s): [Click to enter text.](#)

Total dry tons stored in the lagoons(s) per 365-day period: [Click to enter text.](#)

Total dry tons stored in the lagoons(s) over the life of the unit: [Click to enter text.](#)

C. Liner information

Does the active/proposed sludge lagoon(s) have a liner with a maximum hydraulic conductivity of 1×10^{-7} cm/sec?

☐ Yes ☐ No

If yes, describe the liner below. Please note that a liner is required.

[Click to enter text.](#)

D. Site development plan

Provide a detailed description of the methods used to deposit sludge in the lagoon(s):

[Click to enter text.](#)

Attach the following documents to the application.

- Plan view and cross-section of the sludge lagoon(s)

Attachment: [Click to enter text.](#)

- Copy of the closure plan

Attachment: [Click to enter text.](#)

- Copy of deed recordation for the site

Attachment: [Click to enter text.](#)

- Size of the sludge lagoon(s) in surface acres and capacity in cubic feet and gallons

Attachment: [Click to enter text.](#)

- Description of the method of controlling infiltration of groundwater and surface water from entering the site

Attachment: [Click to enter text.](#)

- Procedures to prevent the occurrence of nuisance conditions

Attachment: [Click to enter text.](#)

E. Groundwater monitoring

Is groundwater monitoring currently conducted at this site, or are any wells available for groundwater monitoring, or are groundwater monitoring data otherwise available for the sludge lagoon(s)?

☐ Yes ☐ No

If groundwater monitoring data are available, provide a copy. Provide a profile of soil types encountered down to the groundwater table and the depth to the shallowest groundwater as a separate attachment.

Attachment: [Click to enter text.](#)

Section 12. Authorizations/Compliance/Enforcement (Instructions Page 55)

A. Additional authorizations

Does the permittee have additional authorizations for this facility, such as reuse authorization, sludge permit, etc?

☐ Yes ☒ No

If yes, provide the TCEQ authorization number and description of the authorization:

[Click to enter text.](#)

B. Permittee enforcement status

Is the permittee currently under enforcement for this facility?

☐ Yes ☒ No

Is the permittee required to meet an implementation schedule for compliance or enforcement?

☐ Yes ☒ No

If yes to either question, provide a brief summary of the enforcement, the implementation schedule, and the current status:

Click to enter text.

Section 13. RCRA/CERCLA Wastes (Instructions Page 55)

A. RCRA hazardous wastes

Has the facility received in the past three years, does it currently receive, or will it receive RCRA hazardous waste?

☐ Yes ☒ No

B. Remediation activity wastewater

Has the facility received in the past three years, does it currently receive, or will it receive CERCLA wastewater, RCRA remediation/corrective action wastewater or other remediation activity wastewater?

☐ Yes ☒ No

C. Details about wastes received

If yes to either Subsection A or B above, provide detailed information concerning these wastes with the application.

Attachment: [Click to enter text.](#)

Section 14. Laboratory Accreditation (Instructions Page 56)

All laboratory tests performed must meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*, which includes the following general exemptions from National Environmental Laboratory Accreditation Program (NELAP) certification requirements:

- The laboratory is an in-house laboratory and is:
 - periodically inspected by the TCEQ; or
 - located in another state and is accredited or inspected by that state; or
 - performing work for another company with a unit located in the same site; or
 - performing pro bono work for a governmental agency or charitable organization.
- The laboratory is accredited under federal law.
- The data are needed for emergency-response activities, and a laboratory accredited under the Texas Laboratory Accreditation Program is not available.
- The laboratory supplies data for which the TCEQ does not offer accreditation.

The applicant should review 30 TAC Chapter 25 for specific requirements.

The following certification statement shall be signed and submitted with every application. See the Signature Page section in the Instructions, for a list of designated representatives who may sign the certification.

CERTIFICATION:

I certify that all laboratory tests submitted with this application meet the requirements of *30 TAC Chapter 25, Environmental Testing Laboratory Accreditation and Certification*.

Printed Name: N/A, no laboratory tests submitted with New Application.

Title: Click to enter text.

Signature: _____

Date: _____

DOMESTIC WASTEWATER PERMIT APPLICATION

TECHNICAL REPORT 1.1

The following information is required for new and amendment major applications.

Section 1. Justification for Permit (Instructions Page 57)

A. Justification of permit need

Provide a detailed discussion regarding the need for any phase(s) not currently permitted. Failure to provide sufficient justification may result in the Executive Director recommending denial of the proposed phase(s) or permit.

There is not currently a central (public or private) wastewater service that is willing to provide service to the proposed development. Sewer treatment per individual lot is not practical and connection to nearby systems is not a viable option. See Attachment 3 for the Projection of LUEs & Wastewater Flow to WWTF Capacity Over Time of Development. The plot shows that the WWTF capacity will increase prior to development and occupation of LUEs (Living Unit Equivalents). Year 0 represents the start of operation, when LUEs are occupied, and wastewater flow begins.

B. Regionalization of facilities

For additional guidance, please review [TCEQ's Regionalization Policy for Wastewater Treatment](#)¹.

Provide the following information concerning the potential for regionalization of domestic wastewater treatment facilities:

1. Municipally incorporated areas

If the applicant is a city, then Item 1 is not applicable. Proceed to Item 2 Utility CCN areas.

Is any portion of the proposed service area located in an incorporated city?

☐ Yes ☒ No ☐ Not Applicable

If yes, within the city limits of: [Click to enter text.](#)

If yes, attach correspondence from the city.

Attachment: [Click to enter text.](#)

If consent to provide service is available from the city, attach a justification for the proposed facility and a cost analysis of expenditures that includes the cost of connecting to the city versus the cost of the proposed facility or expansion attached.

Attachment: [Click to enter text.](#)

2. Utility CCN areas

Is any portion of the proposed service area located inside another utility's CCN area?

☒ Yes ☐ No

¹ <https://www.tceq.texas.gov/permitting/wastewater/tceq-regionalization-for-wastewater>

If **yes**, attach a justification for the proposed facility and a cost analysis of expenditures that includes the cost of connecting to the CCN facilities versus the cost of the proposed facility or expansion.

Attachment: 4A Utility (Sewer) CCN Map

3. *Nearby WWTPs or collection systems*

Are there any domestic permitted wastewater treatment facilities or collection systems located within a three-mile radius of the proposed facility?

☒ Yes ☐ No

If **yes**, attach a list of these facilities and collection systems that includes each permittee's name and permit number, and an area map showing the location of these facilities and collection systems.

Attachment: 4B Wastewater Outfall Map

If **yes**, attach proof of mailing a request for service to each facility and collection system, the letters requesting service, and correspondence from each facility and collection system.

Attachment: Letters and responses included in Attachment 4.

If the facility or collection system agrees to provide service, attach a justification for the proposed facility and a cost analysis of expenditures that includes the cost of connecting to the facility or collection system versus the cost of the proposed facility or expansion.

Attachment: Click to enter text.

Section 2. Proposed Organic Loading (Instructions Page 59)

Is this facility in operation?

☐ Yes ☒ No

If **no**, proceed to Item B, Proposed Organic Loading.

If **yes**, provide organic loading information in Item A, Current Organic Loading

A. Current organic loading

Facility Design Flow (flow being requested in application): Click to enter text.

Average Influent Organic Strength or BOD₅ Concentration in mg/l: Click to enter text.

Average Influent Loading (lbs/day = total average flow X average BOD₅ conc. X 8.34): Click to enter text.

Provide the source of the average organic strength or BOD₅ concentration.

Click to enter text.

B. Proposed organic loading

This table must be completed if this application is for a facility that is not in operation or if this application is to request an increased flow that will impact organic loading.

Table 1.1(1) – Design Organic Loading

Source	Total Average Flow (MGD)	Influent BOD5 Concentration (mg/l)
Municipality		
Subdivision	1.50	350
Trailer park – transient		
Mobile home park		
School with cafeteria and showers		
School with cafeteria, no showers		
Recreational park, overnight use		
Recreational park, day use		
Office building or factory		
Motel		
Restaurant		
Hospital		
Nursing home		
Other		
TOTAL FLOW from all sources	1.50	
AVERAGE BOD ₅ from all sources		350

Section 3. Proposed Effluent Quality and Disinfection (Instructions Page 59)

A. Existing/Interim I Phase Design Effluent Quality

Biochemical Oxygen Demand (5-day), mg/l: 10.0

Total Suspended Solids, mg/l: 10.0

Ammonia Nitrogen, mg/l: 5.0

Total Phosphorus, mg/l: 1.0

Dissolved Oxygen, mg/l: 5.0

Other: Click to enter text.

B. Interim II Phase Design Effluent Quality

Biochemical Oxygen Demand (5-day), mg/l: 10.0

Total Suspended Solids, mg/l: 10.0

Ammonia Nitrogen, mg/l: 5.0

Total Phosphorus, mg/l: 1.0

Dissolved Oxygen, mg/l: 5.0

Other: Click to enter text.

C. Final Phase Design Effluent Quality

Biochemical Oxygen Demand (5-day), mg/l: 10.0

Total Suspended Solids, mg/l: 10.0

Ammonia Nitrogen, mg/l: 5.0

Total Phosphorus, mg/l: 1.0

Dissolved Oxygen, mg/l: 5.0

Other: Click to enter text.

D. Disinfection Method

Identify the proposed method of disinfection.

☐ Chlorine: Click to enter text. mg/l after Click to enter text. minutes detention time at peak flow

Dechlorination process: Click to enter text.

☒ Ultraviolet Light: 1.0 seconds contact time at peak flow

☐ Other: Click to enter text.

Section 4. Design Calculations (Instructions Page 59)

Attach design calculations and plant features for each proposed phase. Example 4 of the instructions includes sample design calculations and plant features.

Attachment: 5. Design Calculations

Section 5. Facility Site (Instructions Page 60)

A. 100-year floodplain

Will the proposed facilities be located above the 100-year frequency flood level?

☒ Yes ☐ No

If no, describe measures used to protect the facility during a flood event. Include a site map showing the location of the treatment plant within the 100-year frequency flood level. If applicable, provide the size and types of protective structures.

Click to enter text.

Provide the source(s) used to determine 100-year frequency flood plain.

FEMA Flood Map Service Center (<https://msc.fema.gov/portal/home>)

For a new or expansion of a facility, will a wetland or part of a wetland be filled?

☐ Yes ☒ No

If **yes**, has the applicant applied for a US Corps of Engineers 404 Dredge and Fill Permit?

☐ Yes ☐ No

If **yes**, provide the permit number: [Click to enter text.](#)

If **no**, provide the approximate date you anticipate submitting your application to the Corps: [Click to enter text.](#)

B. Wind rose

Attach a wind rose: [Attachment 6 Wind Rose](#)

Section 6. Permit Authorization for Sewage Sludge Disposal (Instructions Page 60)

A. Beneficial use authorization

Are you requesting to include authorization to land apply sewage sludge for beneficial use on property located adjacent to the wastewater treatment facility under the wastewater permit?

☐ Yes ☒ No

If **yes**, attach the completed **Application for Permit for Beneficial Land Use of Sewage Sludge (TCEQ Form No. 10451)**: [Click to enter text.](#)

B. Sludge processing authorization

Identify the sludge processing, storage or disposal options that will be conducted at the wastewater treatment facility:

- ☐ Sludge Composting
- ☐ Marketing and Distribution of sludge
- ☐ Sludge Surface Disposal or Sludge Monofill

If **any of the above**, sludge options are selected, attach the completed **Domestic Wastewater Permit Application: Sewage Sludge Technical Report (TCEQ Form No. 10056)**: [Click to enter text.](#)

Section 7. Sewage Sludge Solids Management Plan (Instructions Page 61)

Attach a solids management plan to the application.

Attachment: [7. Solids Management Plan](#)

The sewage sludge solids management plan must contain the following information:

- Treatment units and processes dimensions and capacities

- Solids generated at 100, 75, 50, and 25 percent of design flow
- Mixed liquor suspended solids operating range at design and projected actual flow
- Quantity of solids to be removed and a schedule for solids removal
- Identification and ownership of the ultimate sludge disposal site
- For facultative lagoons, design life calculations, monitoring well locations and depths, and the ultimate disposal method for the sludge from the facultative lagoon

An example of a sewage sludge solids management plan has been included as Example 5 of the instructions.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 2.0: RECEIVING WATERS

The following information is required for all TPDES permit applications.

Section 1. Domestic Drinking Water Supply (Instructions Page 64)

Is there a surface water intake for domestic drinking water supply located within 5 miles downstream from the point or proposed point of discharge?

☐ Yes ☒ No

If **no**, proceed to Section 2. If **yes**, provide the following:

Owner of the drinking water supply: [Click to enter text.](#)

Distance and direction to the intake: [Click to enter text.](#)

Attach a USGS map that identifies the location of the intake.

Attachment: [Click to enter text.](#)

Section 2. Discharge into Tidally Affected Waters (Instructions Page 64)

Does the facility discharge into tidally affected waters?

☐ Yes ☒ No

If **no**, proceed to Section 3. If **yes**, complete the remainder of this section. If no, proceed to Section 3.

A. Receiving water outfall

Width of the receiving water at the outfall, in feet: [Click to enter text.](#)

B. Oyster waters

Are there oyster waters in the vicinity of the discharge?

☐ Yes ☐ No

If **yes**, provide the distance and direction from outfall(s).

[Click to enter text.](#)

C. Sea grasses

Are there any sea grasses within the vicinity of the point of discharge?

☐ Yes ☐ No

If **yes**, provide the distance and direction from the outfall(s).

[Click to enter text.](#)

Section 3. Classified Segments (Instructions Page 64)

Is the discharge directly into (or within 300 feet of) a classified segment?

☐ Yes ☒ No

If **yes**, this Worksheet is complete.

If **no**, complete Sections 4 and 5 of this Worksheet.

Section 4. Description of Immediate Receiving Waters (Instructions Page 65)

Name of the immediate receiving waters: Unnamed intermittent stream

A. Receiving water type

Identify the appropriate description of the receiving waters.

- ☒ Stream
- ☐ Freshwater Swamp or Marsh
- ☐ Lake or Pond

Surface area, in acres: Click to enter text.

Average depth of the entire water body, in feet: Click to enter text.

Average depth of water body within a 500-foot radius of discharge point, in feet: Click to enter text.

- ☐ Man-made Channel or Ditch
- ☐ Open Bay
- ☐ Tidal Stream, Bayou, or Marsh
- ☐ Other, specify: Click to enter text.

B. Flow characteristics

If a stream, man-made channel or ditch was checked above, provide the following. For existing discharges, check one of the following that best characterizes the area *upstream* of the discharge. For new discharges, characterize the area *downstream* of the discharge (check one).

- ☒ Intermittent - dry for at least one week during most years
- ☐ Intermittent with Perennial Pools - enduring pools with sufficient habitat to maintain significant aquatic life uses
- ☐ Perennial - normally flowing

Check the method used to characterize the area upstream (or downstream for new dischargers).

- ☐ USGS flow records
- ☐ Historical observation by adjacent landowners
- ☒ Personal observation
- ☐ Other, specify: Click to enter text.

C. Downstream perennial confluences

List the names of all perennial streams that join the receiving water within three miles downstream of the discharge point.

Discharge (33.046261 and -96.291969) is into an unnamed tributary of Brushy Creek; thence into West Caddo Creek (Segment ID 0507C).

D. Downstream characteristics

Do the receiving water characteristics change within three miles downstream of the discharge (e.g., natural or man-made dams, ponds, reservoirs, etc.)?

☐ Yes ☒ No

If yes, discuss how.

[Click to enter text.](#)

E. Normal dry weather characteristics

Provide general observations of the water body during normal dry weather conditions.

Intermittent stream with some small perennial pools and impoundments. No significant aquatic life uses and no recreational uses.

Date and time of observation: April 1, 2024, at approximately 1200 HRS

Was the water body influenced by stormwater runoff during observations?

☐ Yes ☒ No

Section 5. General Characteristics of the Waterbody (Instructions Page 66)

A. Upstream influences

Is the immediate receiving water upstream of the discharge or proposed discharge site influenced by any of the following? Check all that apply.

- | | |
|---|--|
| <input type="checkbox"/> Oil field activities | <input checked="" type="checkbox"/> Urban runoff |
| <input type="checkbox"/> Upstream discharges | <input checked="" type="checkbox"/> Agricultural runoff |
| <input type="checkbox"/> Septic tanks | <input type="checkbox"/> Other(s), specify: Click to enter text. |

B. Waterbody uses

Observed or evidences of the following uses. Check all that apply.

- | | |
|--|--|
| <input checked="" type="checkbox"/> Livestock watering | <input type="checkbox"/> Contact recreation |
| <input type="checkbox"/> Irrigation withdrawal | <input type="checkbox"/> Non-contact recreation |
| <input type="checkbox"/> Fishing | <input type="checkbox"/> Navigation |
| <input type="checkbox"/> Domestic water supply | <input type="checkbox"/> Industrial water supply |
| <input type="checkbox"/> Park activities | <input type="checkbox"/> Other(s), specify: Click to enter text. |

C. Waterbody aesthetics

Check one of the following that best describes the aesthetics of the receiving water and the surrounding area.

- ☐ Wilderness: outstanding natural beauty; usually wooded or unpastured area; water clarity exceptional
- ☐ Natural Area: trees and/or native vegetation; some development evident (from fields, pastures, dwellings); water clarity discolored
- ☒ Common Setting: not offensive; developed but uncluttered; water may be colored or turbid
- ☐ Offensive: stream does not enhance aesthetics; cluttered; highly developed; dumping areas; water discolored

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 2.1: STREAM PHYSICAL CHARACTERISTICS

Required for new applications, major facilities, and applications adding an outfall.

Worksheet 2.1 is not required for discharges to intermittent streams or discharges directly to (or within 300 feet of) a classified segment.

Section 1. General Information (Instructions Page 66)

Date of study: [Click to enter text.](#) Time of study: [Click to enter text.](#)

Stream name: [Click to enter text.](#)

Location: [Click to enter text.](#)

Type of stream upstream of existing discharge or downstream of proposed discharge (check one).

☐ Perennial ☐ Intermittent with perennial pools

Section 2. Data Collection (Instructions Page 66)

Number of stream bends that are well defined: [Click to enter text.](#)

Number of stream bends that are moderately defined: [Click to enter text.](#)

Number of stream bends that are poorly defined: [Click to enter text.](#)

Number of riffles: [Click to enter text.](#)

Evidence of flow fluctuations (check one):

☐ Minor ☐ moderate ☐ severe

Indicate the observed stream uses and if there is evidence of flow fluctuations or channel obstruction/modification.

[Click to enter text.](#)

Stream transects

In the table below, provide the following information for each transect downstream of the existing or proposed discharges. Use a separate row for each transect.

Table 2.1(1) - Stream Transect Records

Stream type at transect Select riffle, run, glide, or pool. See Instructions, Definitions section.	Transect location	Water surface width (ft)	Stream depths (ft) at 4 to 10 points along each transect from the channel bed to the water surface. Separate the measurements with commas.
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			
Choose an item.			

Section 3. Summarize Measurements (Instructions Page 66)

Streambed slope of entire reach, from USGS map in feet/feet: [Click to enter text.](#)

Approximate drainage area above the most downstream transect (from USGS map or county highway map, in square miles): [Click to enter text.](#)

Length of stream evaluated, in feet: [Click to enter text.](#)

Number of lateral transects made: [Click to enter text.](#)

Average stream width, in feet: [Click to enter text.](#)

Average stream depth, in feet: [Click to enter text.](#)

Average stream velocity, in feet/second: [Click to enter text.](#)

Instantaneous stream flow, in cubic feet/second: [Click to enter text.](#)

Indicate flow measurement method (type of meter, floating chip timed over a fixed distance, etc.): [Click to enter text.](#)

Size of pools (large, small, moderate, none): [Click to enter text.](#)

Maximum pool depth, in feet: [Click to enter text.](#)

DOMESTIC WASTEWATER PERMIT APPLICATION WORKSHEET 3.0: LAND DISPOSAL OF EFFLUENT

The following is required for renewal, new, and amendment permit applications.

Section 1. Type of Disposal System (Instructions Page 68)

Identify the method of land disposal:

- | | |
|---|--|
| <input type="checkbox"/> Surface application | <input type="checkbox"/> Subsurface application |
| <input type="checkbox"/> Irrigation | <input type="checkbox"/> Subsurface soils absorption |
| <input type="checkbox"/> Drip irrigation system | <input type="checkbox"/> Subsurface area drip dispersal system |
| <input type="checkbox"/> Evaporation | <input type="checkbox"/> Evapotranspiration beds |
| <input type="checkbox"/> Other (describe in detail): Click to enter text. | |

NOTE: All applicants without authorization or proposing new/amended subsurface disposal MUST complete and submit Worksheet 7.0.

For existing authorizations, provide Registration Number: [Click to enter text.](#)

Section 2. Land Application Site(s) (Instructions Page 68)

In table 3.0(1), provide the requested information for the land application sites. Include the agricultural or cover crop type (wheat, cotton, alfalfa, bermuda grass, native grasses, etc.), land use (golf course, hayland, pastureland, park, row crop, etc.), irrigation area, amount of effluent applied, and whether or not the public has access to the area. Specify the amount of land area and the amount of effluent that will be allotted to each agricultural or cover crop, if more than one crop will be used.

Table 3.0(1) – Land Application Site Crops

Crop Type & Land Use	Irrigation Area (acres)	Effluent Application (GPD)	Public Access? Y/N

Section 3. Storage and Evaporation Lagoons/Ponds (Instructions Page 68)

Table 3.0(2) – Storage and Evaporation Ponds

Pond Number	Surface Area (acres)	Storage Volume (acre-feet)	Dimensions	Liner Type

Attach a copy of a liner certification that was prepared, signed, and sealed by a Texas licensed professional engineer for each pond.

Attachment: [Click to enter text.](#)

Section 4. Flood and Runoff Protection (Instructions Page 68)

Is the land application site within the 100-year frequency flood level?

☐ Yes ☐ No

If yes, describe how the site will be protected from inundation.

[Click to enter text.](#)

Provide the source used to determine the 100-year frequency flood level:

[Click to enter text.](#)

Provide a description of tailwater controls and rainfall run-on controls used for the land application site.

[Click to enter text.](#)

Section 5. Annual Cropping Plan (Instructions Page 68)

Attach an Annual Cropping Plan which includes a discussion of each of the following items. If not applicable, provide a detailed explanation indicating why. **Attachment:** [Click to enter text.](#)

- Soils map with crops
- Cool and warm season plant species
- Crop yield goals
- Crop growing season
- Crop nutrient requirements
- Additional fertilizer requirements
- Minimum/maximum harvest height (for grass crops)
- Supplemental watering requirements
- Crop salt tolerances
- Harvesting method/number of harvests
- Justification for not removing existing vegetation to be irrigated

Section 6. Well and Map Information (Instructions Page 69)

Attach a USGS map with the following information shown and labeled. If not applicable, provide a detailed explanation indicating why. **Attachment:** [Click to enter text.](#)

- The boundaries of the land application site(s)
- Waste disposal or treatment facility site(s)
- On-site buildings
- Buffer zones
- Effluent storage and tailwater control facilities
- All water wells within 1-mile radius of the disposal site or property boundaries
- All springs and seeps onsite and within 500 feet of the property boundaries
- All surface waters in the state onsite and within 500 feet of the property boundaries
- All faults and sinkholes onsite and within 500 feet of the property

List and cross reference all water wells located within a half-mile radius of the disposal site or property boundaries shown on the USGS map in the following table. Attach additional pages as necessary to include all of the wells.

Table 3.0(3) – Water Well Data

Well ID	Well Use	Producing? Y/N	Open, cased, capped, or plugged?	Proposed Best Management Practice
			Choose an item.	
			Choose an item.	
			Choose an item.	
			Choose an item.	
			Choose an item.	

If water quality data or well log information is available please include the information in an attachment listed by Well ID.

Attachment: [Click to enter text.](#)

Section 7. Groundwater Quality (Instructions Page 69)

Attach a Groundwater Quality Technical Report which assesses the impact of the wastewater disposal system on groundwater. This report shall include an evaluation of the water wells (including the information in the well table provided in Item 6. above), the wastewater application rate, and pond liners. Indicate by a check mark that this report is provided.

Attachment: [Click to enter text.](#)

Are groundwater monitoring wells available onsite? ☐ Yes ☐ No

Do you plan to install ground water monitoring wells or lysimeters around the land application site? ☐ Yes ☐ No

If yes, provide the proposed location of the monitoring wells or lysimeters on a site map.

Attachment: [Click to enter text.](#)

Section 8. Soil Map and Soil Analyses (Instructions Page 70)

A. Soil map

Attach a USDA Soil Survey map that shows the area to be used for effluent disposal.

Attachment: [Click to enter text.](#)

B. Soil analyses

Attach the laboratory results sheets from the soil analyses. **Note:** for renewal applications, the current annual soil analyses required by the permit are acceptable as long as the test date is less than one year prior to the submission of the application.

Attachment: [Click to enter text.](#)

List all USDA designated soil series on the proposed land application site. Attach additional pages as necessary.

Table 3.0(4) – Soil Data

Soil Series	Depth from Surface	Permeability	Available Water Capacity	Curve Number

Section 9. Effluent Monitoring Data (Instructions Page 71)

Is the facility in operation?

☐ Yes ☐ No

If no, this section is not applicable and the worksheet is complete.

If yes, provide the effluent monitoring data for the parameters regulated in the existing permit. If a parameter is not regulated in the existing permit, enter N/A.

Table 3.0(5) – Effluent Monitoring Data

[illegible]

Provide a discussion of all persistent excursions above the permitted limits and any corrective actions taken.

Click to enter text.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 3.1: SURFACE LAND DISPOSAL OF EFFLUENT

The following is required for new and major amendment permit applications. Renewal and minor amendment permit applications may be asked for this worksheet on a case by case basis.

Section 1. Surface Disposal (Instructions Page 72)

Complete the item that applies for the method of disposal being used.

A. Irrigation

Area under irrigation, in acres: [Click to enter text.](#)

Design application frequency:

hours/day [Click to enter text.](#) And days/week [Click to enter text.](#)

Land grade (slope):

average percent (%): [Click to enter text.](#)

maximum percent (%): [Click to enter text.](#)

Design application rate in acre-feet/acre/year: [Click to enter text.](#)

Design total nitrogen loading rate, in lbs N/acre/year: [Click to enter text.](#)

Soil conductivity (mmhos/cm): [Click to enter text.](#)

Method of application: [Click to enter text.](#)

Attach a separate engineering report with the water balance and storage volume calculations, method of application, irrigation efficiency, and nitrogen balance.

Attachment: [Click to enter text.](#)

B. Evaporation ponds

Daily average effluent flow into ponds, in gallons per day: [Click to enter text.](#)

Attach a separate engineering report with the water balance and storage volume calculations.

Attachment: [Click to enter text.](#)

C. Evapotranspiration beds

Number of beds: [Click to enter text.](#)

Area of bed(s), in acres: [Click to enter text.](#)

Depth of bed(s), in feet: [Click to enter text.](#)

Void ratio of soil in the beds: [Click to enter text.](#)

Storage volume within the beds, in acre-feet: [Click to enter text.](#)

Attach a separate engineering report with the water balance and storage volume calculations, and a description of the lining.

Attachment: [Click to enter text.](#)

D. Overland flow

Area used for application, in acres: [Click to enter text.](#)

Slopes for application area, percent (%): [Click to enter text.](#)

Design application rate, in gpm/foot of slope width: [Click to enter text.](#)

Slope length, in feet: [Click to enter text.](#)

Design BOD₅ loading rate, in lbs BOD₅/acre/day: [Click to enter text.](#)

Design application frequency:

hours/day: [Click to enter text.](#) **And** days/week: [Click to enter text.](#)

Attach a separate engineering report with the method of application and design requirements according to *30 TAC Chapter 217*.

Attachment: [Click to enter text.](#)

Section 2. Edwards Aquifer (Instructions Page 73)

Is the facility subject to *30 TAC Chapter 213*, Edwards Aquifer Rules?

☐ Yes ☐ No

If **yes**, is the facility located on the Edwards Aquifer Recharge Zone?

☐ Yes ☐ No

If **yes**, attach a geological report addressing potential recharge features.

Attachment: [Click to enter text.](#)

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 3.2: SURFACE LAND DISPOSAL OF EFFLUENT

The following **is required** for **new and major amendment** permit applications. Renewal and minor amendments applicants may be asked for the worksheet on a case by case basis.

NOTE: All applicants proposing new/amended subsurface disposal **MUST** complete and submit Worksheet 7.0. This worksheet applies to any subsurface disposal system that **does not meet** the definition of a subsurface area drip dispersal system as defined in *30 TAC Chapter 222, Subsurface Area Drip Dispersal System*.

Section 1. Subsurface Application (Instructions Page 74)

Identify the type of system:

- ☐ Conventional Gravity Drainfield, Beds, or Trenches (new systems must be less than 5,000 GPD)
- ☐ Low Pressure Dosing
- ☐ Other, specify: [Click to enter text.](#)

Application area, in acres: [Click to enter text.](#)

Area of drainfield, in square feet: [Click to enter text.](#)

Application rate, in gal/square foot/day: [Click to enter text.](#)

Depth to groundwater, in feet: [Click to enter text.](#)

Area of trench, in square feet: [Click to enter text.](#)

Dosing duration per area, in hours: [Click to enter text.](#)

Number of beds: [Click to enter text.](#)

Dosing amount per area, in inches/day: [Click to enter text.](#)

Infiltration rate, in inches/hour: [Click to enter text.](#)

Storage volume, in gallons: [Click to enter text.](#)

Area of bed(s), in square feet: [Click to enter text.](#)

Soil Classification: [Click to enter text.](#)

Attach a separate engineering report with the information required in *30 TAC § 309.20*, excluding the requirements of *§ 309.20 b(3)(A)* and *(B)* design analysis which may be asked for on a case by case basis. Include a description of the schedule of dosing basin rotation.

Attachment: [Click to enter text.](#)

Section 2. Edwards Aquifer (Instructions Page 74)

Is the subsurface system over the Edwards Aquifer Recharge Zone as mapped by TCEQ?

- ☐ Yes ☐ No

Is the subsurface system over the Edwards Aquifer Transition Zone as mapped by TCEQ?

- ☐ Yes ☐ No

If yes to either question, the subsurface system may be prohibited by *30 TAC §213.8*. Please call the Municipal Permits Team, at 512-239-4671, to schedule a pre-application meeting.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 3.3: SUBSURFACE AREA DRIP DISPERSAL (SADDS) LAND DISPOSAL OF EFFLUENT

The following **is required** for **new and major amendment** subsurface area drip dispersal system permit applications. Renewal and minor amendments applicants may be asked for the worksheet on a case by case basis.

NOTE: All applicants proposing new/amended subsurface disposal **MUST** complete and submit Worksheet 7.0. This worksheet applies to any subsurface disposal system that **meets** the definition of a subsurface area drip dispersal system as defined in *30 TAC Chapter 222, Subsurface Area Drip Dispersal System*.

Section 1. Administrative Information (Instructions Page 75)

A. Provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the owner of the treatment facility:

B. [Click to enter text.](#) Is the owner of the land where the treatment facility is located the same as the owner of the treatment facility?

☐ Yes ☐ No

If **no**, provide the legal name of all corporations or other business entities managed, owned, or otherwise closely related to the owner of the land where the treatment facility is located.

[Click to enter text.](#)

C. Owner of the subsurface area drip dispersal system: [Click to enter text.](#)

D. Is the owner of the subsurface area drip dispersal system the same as the owner of the wastewater treatment facility or the site where the wastewater treatment facility is located?

☐ Yes ☐ No

If **no**, identify the names of all corporations or other business entities managed, owned, or otherwise closely related to the entity identified in Item 1.C.

[Click to enter text.](#)

E. Owner of the land where the subsurface area drip dispersal system is located: [Click to enter text.](#)

F. Is the owner of the land where the subsurface area drip dispersal system is located the same as owner of the wastewater treatment facility, the site where the wastewater treatment facility is located, or the owner of the subsurface area drip dispersal system?

☐ Yes ☐ No

If **no**, identify the name of all corporations or other business entities managed, owned, or otherwise closely related to the entity identified in item 1.E.

[Click to enter text.](#)

Section 2. Subsurface Area Drip Dispersal System (Instructions Page 75)

A. Type of system

- ☐ Subsurface Drip Irrigation
- ☐ Surface Drip Irrigation
- ☐ Other, specify: [Click to enter text.](#)

B. Irrigation operations

Application area, in acres: [Click to enter text.](#)

Infiltration Rate, in inches/hour: [Click to enter text.](#)

Average slope of the application area, percent (%): [Click to enter text.](#)

Maximum slope of the application area, percent (%): [Click to enter text.](#)

Storage volume, in gallons: [Click to enter text.](#)

Major soil series: [Click to enter text.](#)

Depth to groundwater, in feet: [Click to enter text.](#)

C. Application rate

Is the facility located **west** of the boundary shown in *30 TAC § 222.83* **and** also using a vegetative cover of non-native grasses over seeded with cool season grasses during the winter months (October-March)?

☐ Yes ☐ No

If **yes**, then the facility may propose a hydraulic application rate not to exceed 0.1 gal/square foot/day.

Is the facility located **east** of the boundary shown in *30 TAC § 222.83* **or** in any part of the state when the vegetative cover is any crop other than non-native grasses?

☐ Yes ☐ No

If **yes**, the facility must use the formula in *30 TAC §222.83* to calculate the maximum hydraulic application rate.

Do you plan to submit an alternative method to calculate the hydraulic application rate for approval by the executive director?

☐ Yes ☐ No

Hydraulic application rate, in gal/square foot/day: [Click to enter text.](#)

Nitrogen application rate, in lbs/gal/day: [Click to enter text.](#)

D. Dosing information

Number of doses per day: [Click to enter text.](#)

Dosing duration per area, in hours: [Click to enter text.](#)

Rest period between doses, in hours: [Click to enter text.](#)

Dosing amount per area, in inches/day: [Click to enter text.](#)

Number of zones: [Click to enter text.](#)

Does the proposed subsurface drip irrigation system use tree vegetative cover as a crop?

☐ Yes ☐ No

If **yes**, provide a vegetation survey by a certified arborist. Please call the Water Quality Assessment Team at (512) 239-4671 to schedule a pre-application meeting.

Attachment: [Click to enter text.](#)

Section 3. Required Plans (Instructions Page 75)

A. Recharge feature plan

Attach a Recharge Feature Plan with all information required in *30 TAC §222.79*.

Attachment: [Click to enter text.](#)

B. Soil evaluation

Attach a Soil Evaluation with all information required in *30 TAC §222.73*.

Attachment: [Click to enter text.](#)

C. Site preparation plan

Attach a Site Preparation Plan with all information required in *30 TAC §222.75*.

Attachment: [Click to enter text.](#)

D. Soil sampling/testing

Attach soil sampling and testing that includes all information required in *30 TAC §222.157*.

Attachment: [Click to enter text.](#)

Section 4. Floodway Designation (Instructions Page 76)

A. Site location

Is the existing/proposed land application site within a designated floodway?

☐ Yes ☐ No

B. Flood map

Attach either the FEMA flood map or alternate information used to determine the floodway.

Attachment: [Click to enter text.](#)

Section 5. Surface Waters in the State (Instructions Page 76)

A. Buffer Map

Attach a map showing appropriate buffers on surface waters in the state, water wells, and springs/seeps.

Attachment: [Click to enter text.](#)

B. Buffer variance request

Do you plan to request a buffer variance from water wells or waters in the state?

☐ Yes ☐ No

If **yes**, then attach the additional information required in *30 TAC § 222.81(c)*.

Attachment: [Click to enter text.](#)

Section 6. Edwards Aquifer (Instructions Page 76)

A. Is the SADDs located over the Edwards Aquifer Recharge Zone as mapped by TCEQ?

☐ Yes ☐ No

B. Is the SADDs located over the Edwards Aquifer Transition Zone as mapped by TCEQ?

☐ Yes ☐ No

If **yes to either question**, then the SADDs may be prohibited by *30 TAC §213.8*. Please call the Municipal Permits Team at 512-239-4671 to schedule a pre-application meeting.

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 4.0: POLLUTANT ANALYSIS REQUIREMENTS

The following **is required** for facilities with a permitted or proposed flow of **1.0 MGD or greater**, facilities with an approved **pretreatment** program, or facilities classified as a **major** facility. See instructions for further details.

This worksheet is not required minor amendments without renewal.

Section 1. Toxic Pollutants (Instructions Page 78)

For pollutants identified in Table 4.0(1), indicate the type of sample.

Grab ☐ Composite ☐

Date and time sample(s) collected: [Click to enter text.](#)

Table 4.0(1) – Toxics Analysis

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Acrylonitrile				50
Aldrin				0.01
Aluminum				2.5
Anthracene				10
Antimony				5
Arsenic				0.5
Barium				3
Benzene				10
Benzidine				50
Benzo(a)anthracene				5
Benzo(a)pyrene				5
Bis(2-chloroethyl)ether				10
Bis(2-ethylhexyl)phthalate				10
Bromodichloromethane				10
Bromoform				10
Cadmium				1
Carbon Tetrachloride				2
Carbaryl				5
Chlordane*				0.2
Chlorobenzene				10
Chlorodibromomethane				10

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Chloroform				10
Chlorpyrifos				0.05
Chromium (Total)				3
Chromium (Tri) (*1)				N/A
Chromium (Hex)				3
Copper				2
Chrysene				5
p-Chloro-m-Cresol				10
4,6-Dinitro-o-Cresol				50
p-Cresol				10
Cyanide (*2)				10
4,4'- DDD				0.1
4,4'- DDE				0.1
4,4'- DDT				0.02
2,4-D				0.7
Demeton (O and S)				0.20
Diazinon				0.5/0.1
1,2-Dibromoethane				10
m-Dichlorobenzene				10
o-Dichlorobenzene				10
p-Dichlorobenzene				10
3,3'-Dichlorobenzidine				5
1,2-Dichloroethane				10
1,1-Dichloroethylene				10
Dichloromethane				20
1,2-Dichloropropane				10
1,3-Dichloropropene				10
Dicofol				1
Dieldrin				0.02
2,4-Dimethylphenol				10
Di-n-Butyl Phthalate				10
Diuron				0.09
Endosulfan I (alpha)				0.01

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Endosulfan II (beta)				0.02
Endosulfan Sulfate				0.1
Endrin				0.02
Ethylbenzene				10
Fluoride				500
Guthion				0.1
Heptachlor				0.01
Heptachlor Epoxide				0.01
Hexachlorobenzene				5
Hexachlorobutadiene				10
Hexachlorocyclohexane (alpha)				0.05
Hexachlorocyclohexane (beta)				0.05
gamma-Hexachlorocyclohexane (Lindane)				0.05
Hexachlorocyclopentadiene				10
Hexachloroethane				20
Hexachlorophene				10
Lead				0.5
Malathion				0.1
Mercury				0.005
Methoxychlor				2
Methyl Ethyl Ketone				50
Mirex				0.02
Nickel				2
Nitrate-Nitrogen				100
Nitrobenzene				10
N-Nitrosodiethylamine				20
N-Nitroso-di-n-Butylamine				20
Nonylphenol				333
Parathion (ethyl)				0.1
Pentachlorobenzene				20
Pentachlorophenol				5
Phenanthrene				10

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Polychlorinated Biphenyls (PCB's) (*3)				0.2
Pyridine				20
Selenium				5
Silver				0.5
1,2,4,5-Tetrachlorobenzene				20
1,1,2,2-Tetrachloroethane				10
Tetrachloroethylene				10
Thallium				0.5
Toluene				10
Toxaphene				0.3
2,4,5-TP (Silvex)				0.3
Tributyltin (see instructions for explanation)				0.01
1,1,1-Trichloroethane				10
1,1,2-Trichloroethane				10
Trichloroethylene				10
2,4,5-Trichlorophenol				50
TTHM (Total Trihalomethanes)				10
Vinyl Chloride				10
Zinc				5

(*1) Determined by subtracting hexavalent Cr from total Cr.

(*2) Cyanide, amenable to chlorination or weak-acid dissociable.

(*3) The sum of seven PCB congeners 1242, 1254, 1221, 1232, 1248, 1260, and 1016.

Section 2. Priority Pollutants

For pollutants identified in Tables 4.0(2)A-E, indicate type of sample.

Grab ☐ Composite ☐

Date and time sample(s) collected: [Click to enter text.](#)

Table 4.0(2)A – Metals, Cyanide, and Phenols

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Antimony				5
Arsenic				0.5
Beryllium				0.5
Cadmium				1
Chromium (Total)				3
Chromium (Hex)				3
Chromium (Tri) (*1)				N/A
Copper				2
Lead				0.5
Mercury				0.005
Nickel				2
Selenium				5
Silver				0.5
Thallium				0.5
Zinc				5
Cyanide (*2)				10
Phenols, Total				10

(*1) Determined by subtracting hexavalent Cr from total Cr.

(*2) Cyanide, amenable to chlorination or weak-acid dissociable

Table 4.0(2)B – Volatile Compounds

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Acrolein				50
Acrylonitrile				50
Benzene				10
Bromoform				10
Carbon Tetrachloride				2
Chlorobenzene				10
Chlorodibromomethane				10
Chloroethane				50
2-Chloroethylvinyl Ether				10
Chloroform				10
Dichlorobromomethane [Bromodichloromethane]				10
1,1-Dichloroethane				10
1,2-Dichloroethane				10
1,1-Dichloroethylene				10
1,2-Dichloropropane				10
1,3-Dichloropropylene [1,3-Dichloropropene]				10
1,2-Trans-Dichloroethylene				10
Ethylbenzene				10
Methyl Bromide				50
Methyl Chloride				50
Methylene Chloride				20
1,1,2,2-Tetrachloroethane				10
Tetrachloroethylene				10
Toluene				10
1,1,1-Trichloroethane				10
1,1,2-Trichloroethane				10
Trichloroethylene				10
Vinyl Chloride				10

Table 4.0(2)C – Acid Compounds

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
2-Chlorophenol				10
2,4-Dichlorophenol				10
2,4-Dimethylphenol				10
4,6-Dinitro-o-Cresol				50
2,4-Dinitrophenol				50
2-Nitrophenol				20
4-Nitrophenol				50
P-Chloro-m-Cresol				10
Pentalchlorophenol				5
Phenol				10
2,4,6-Trichlorophenol				10

Table 4.0(2)D – Base/Neutral Compounds

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Acenaphthene				10
Acenaphthylene				10
Anthracene				10
Benzidine				50
Benzo(a)Anthracene				5
Benzo(a)Pyrene				5
3,4-Benzofluoranthene				10
Benzo(ghi)Perylene				20
Benzo(k)Fluoranthene				5
Bis(2-Chloroethoxy)Methane				10
Bis(2-Chloroethyl)Ether				10
Bis(2-Chloroisopropyl)Ether				10
Bis(2-Ethylhexyl)Phthalate				10
4-Bromophenyl Phenyl Ether				10
Butyl benzyl Phthalate				10
2-Chloronaphthalene				10
4-Chlorophenyl phenyl ether				10
Chrysene				5
Dibenzo(a,h)Anthracene				5
1,2-(o)Dichlorobenzene				10
1,3-(m)Dichlorobenzene				10
1,4-(p)Dichlorobenzene				10
3,3-Dichlorobenzidine				5
Diethyl Phthalate				10
Dimethyl Phthalate				10
Di-n-Butyl Phthalate				10
2,4-Dinitrotoluene				10
2,6-Dinitrotoluene				10
Di-n-Octyl Phthalate				10
1,2-Diphenylhydrazine (as Azo- benzene)				20
Fluoranthene				10

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Fluorene				10
Hexachlorobenzene				5
Hexachlorobutadiene				10
Hexachlorocyclo-pentadiene				10
Hexachloroethane				20
Indeno(1,2,3-cd)pyrene				5
Isophorone				10
Naphthalene				10
Nitrobenzene				10
N-Nitrosodimethylamine				50
N-Nitrosodi-n-Propylamine				20
N-Nitrosodiphenylamine				20
Phenanthrene				10
Pyrene				10
1,2,4-Trichlorobenzene				10

Table 4.0(2)E - Pesticides

Pollutant	AVG Effluent Conc. (µg/l)	MAX Effluent Conc. (µg/l)	Number of Samples	MAL (µg/l)
Aldrin				0.01
alpha-BHC (Hexachlorocyclohexane)				0.05
beta-BHC (Hexachlorocyclohexane)				0.05
gamma-BHC (Hexachlorocyclohexane)				0.05
delta-BHC (Hexachlorocyclohexane)				0.05
Chlordane				0.2
4,4-DDT				0.02
4,4-DDE				0.1
4,4,-DDD				0.1
Dieldrin				0.02
Endosulfan I (alpha)				0.01
Endosulfan II (beta)				0.02
Endosulfan Sulfate				0.1
Endrin				0.02
Endrin Aldehyde				0.1
Heptachlor				0.01
Heptachlor Epoxide				0.01
PCB-1242				0.2
PCB-1254				0.2
PCB-1221				0.2
PCB-1232				0.2
PCB-1248				0.2
PCB-1260				0.2
PCB-1016				0.2
Toxaphene				0.3

* For PCBs, if all are non-detects, enter the highest non-detect preceded by a "<".

Section 3. Dioxin/Furan Compounds

A. Indicate which of the following compounds from may be present in the influent from a contributing industrial user or significant industrial user. Check all that apply.

- ☐ 2,4,5-trichlorophenoxy acetic acid
Common Name 2,4,5-T, CASRN 93-76-5
- ☐ 2-(2,4,5-trichlorophenoxy) propanoic acid
Common Name Silvex or 2,4,5-TP, CASRN 93-72-1
- ☐ 2-(2,4,5-trichlorophenoxy) ethyl 2,2-dichloropropionate
Common Name Erbon, CASRN 136-25-4
- ☐ 0,0-dimethyl 0-(2,4,5-trichlorophenyl) phosphorothioate
Common Name Ronnel, CASRN 299-84-3
- ☐ 2,4,5-trichlorophenol
Common Name TCP, CASRN 95-95-4
- ☐ hexachlorophene
Common Name HCP, CASRN 70-30-4

For each compound identified, provide a brief description of the conditions of its/their presence at the facility.

[Click to enter text.](#)

B. Do you know or have any reason to believe that 2,3,7,8 Tetrachlorodibenzo-P-Dioxin (TCDD) or any congeners of TCDD may be present in your effluent?

☐ Yes ☐ No

If **yes**, provide a brief description of the conditions for its presence.

[Click to enter text.](#)

C. If any of the compounds in Subsection A **or** B are present, complete Table 4.0(2)F.

For pollutants identified in Table 4.0(2)F, indicate the type of sample.

Grab ☐ Composite ☐

Date and time sample(s) collected: [Click to enter text.](#)

Table 4.0(2)F – Dioxin/Furan Compounds

Compound	Toxic Equivalenc y Factors	Wastewater Concentration (ppq)	Wastewater Equivalents (ppq)	Sludge Concentration (ppt)	Sludge Equivalents (ppt)	MAL (ppq)
2,3,7,8 TCDD	1					10
1,2,3,7,8 PeCDD	0.5					50
2,3,7,8 HxCDDs	0.1					50
1,2,3,4,6,7,8 HpCDD	0.01					50
2,3,7,8 TCDF	0.1					10
1,2,3,7,8 PeCDF	0.05					50
2,3,4,7,8 PeCDF	0.5					50
2,3,7,8 HxCDFs	0.1					50
2,3,4,7,8 HpCDFs	0.01					50
OCDD	0.0003					100
OCDF	0.0003					100
PCB 77	0.0001					0.5
PCB 81	0.0003					0.5
PCB 126	0.1					0.5
PCB 169	0.03					0.5
Total						

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 5.0: TOXICITY TESTING REQUIREMENTS

The following **is required** for facilities with a current operating design flow of **1.0 MGD or greater**, with an EPA-approved **pretreatment** program (or those required to have one under 40 CFR Part 403), or are required to perform Whole Effluent Toxicity testing. See instructions for further details.

This worksheet is not required minor amendments without renewal.

Section 1. Required Tests (Instructions Page 88)

Indicate the number of 7-day chronic or 48-hour acute Whole Effluent Toxicity (WET) tests performed in the four and one-half years prior to submission of the application.

7-day Chronic: [Click to enter text.](#)

48-hour Acute: [Click to enter text.](#)

Section 2. Toxicity Reduction Evaluations (TREs)

Has this facility completed a TRE in the past four and a half years? Or is the facility currently performing a TRE?

☐ Yes ☐ No

If yes, describe the progress to date, if applicable, in identifying and confirming the toxicant.

[Click to enter text.](#)

Section 3. Summary of WET Tests

If the required biomonitoring test information has not been previously submitted via both the Discharge Monitoring Reports (DMRs) and the Table 1 (as found in the permit), provide a summary of the testing results for all valid and invalid tests performed over the past four and one-half years. Make additional copies of this table as needed.

Table 5.0(1) Summary of WET Tests

Test Date	Test Species	NOEC Survival	NOEC Sub-lethal

DOMESTIC WASTEWATER PERMIT APPLICATION

WORKSHEET 6.0: INDUSTRIAL WASTE CONTRIBUTION

The following is required for all publicly owned treatment works.

Section 1. All POTWs (Instructions Page 89)

A. Industrial users (IUs)

Provide the number of each of the following types of industrial users (IUs) that discharge to your POTW and the daily flows from each user. See the Instructions for definitions of Categorical IUs, Significant IUs - non-categorical, and Other IUs.

If there are no users, enter 0 (zero).

Categorical IUs:

Number of IUs: [Click to enter text.](#)

Average Daily Flows, in MGD: [Click to enter text.](#)

Significant IUs - non-categorical:

Number of IUs: [Click to enter text.](#)

Average Daily Flows, in MGD: [Click to enter text.](#)

Other IUs:

Number of IUs: [Click to enter text.](#)

Average Daily Flows, in MGD: [Click to enter text.](#)

B. Treatment plant interference

In the past three years, has your POTW experienced treatment plant interference (see instructions)?

☐ Yes ☐ No

If yes, identify the dates, duration, description of interference, and probable cause(s) and possible source(s) of each interference event. Include the names of the IUs that may have caused the interference.

[Click to enter text.](#)

C. Treatment plant pass through

In the past three years, has your POTW experienced pass through (see instructions)?

☐ Yes ☐ No

If **yes**, identify the dates, duration, a description of the pollutants passing through the treatment plant, and probable cause(s) and possible source(s) of each pass through event. Include the names of the IUs that may have caused pass through.

Click to enter text.

D. Pretreatment program

Does your POTW have an approved pretreatment program?

☐ Yes ☐ No

If **yes**, complete Section 2 only of this Worksheet.

Is your POTW required to develop an approved pretreatment program?

☐ Yes ☐ No

If **yes**, complete Section 2.c. and 2.d. only, and skip Section 3.

If **no to either question above**, skip Section 2 and complete Section 3 for each significant industrial user and categorical industrial user.

Section 2. POTWs with Approved Programs or Those Required to Develop a Program (Instructions Page 90)

A. Substantial modifications

Have there been any **substantial modifications** to the approved pretreatment program that have not been submitted to the TCEQ for approval according to *40 CFR §403.18*?

☐ Yes ☐ No

If **yes**, identify the modifications that have not been submitted to TCEQ, including the purpose of the modification.

Click to enter text.

B. Non-substantial modifications

Have there been any **non-substantial modifications** to the approved pretreatment program that have not been submitted to TCEQ for review and acceptance?

☐ Yes ☐ No

If yes, identify all non-substantial modifications that have not been submitted to TCEQ, including the purpose of the modification.

Click to enter text.

C. Effluent parameters above the MAL

In Table 6.0(1), list all parameters measured above the MAL in the POTW's effluent monitoring during the last three years. Submit an attachment if necessary.

Table 6.0(1) – Parameters Above the MAL

Pollutant	Concentration	MAL	Units	Date

D. Industrial user interruptions

Has any SIU, CIU, or other IU caused or contributed to any problems (excluding interferences or pass throughs) at your POTW in the past three years?

☐ Yes ☐ No

If yes, identify the industry, describe each episode, including dates, duration, description of the problems, and probable pollutants.

Click to enter text.

Section 3. Significant Industrial User (SIU) Information and Categorical Industrial User (CIU) (Instructions Page 90)

A. General information

Company Name: [Click to enter text.](#)

SIC Code: [Click to enter text.](#)

Contact name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Telephone number: [Click to enter text.](#)

Email address: [Click to enter text.](#)

B. Process information

Describe the industrial processes or other activities that affect or contribute to the SIU(s) or CIU(s) discharge (i.e., process and non-process wastewater).

[Click to enter text.](#)

C. Product and service information

Provide a description of the principal product(s) or services performed.

[Click to enter text.](#)

D. Flow rate information

See the Instructions for definitions of “process” and “non-process wastewater.”

Process Wastewater:

Discharge, in gallons/day: [Click to enter text.](#)

Discharge Type: ☐ Continuous ☐ Batch ☐ Intermittent

Non-Process Wastewater:

Discharge, in gallons/day: [Click to enter text.](#)

Discharge Type: ☐ Continuous ☐ Batch ☐ Intermittent

E. Pretreatment standards

Is the SIU or CIU subject to technically based local limits as defined in the *instructions*?

☐ Yes ☐ No

Is the SIU or CIU subject to categorical pretreatment standards found in *40 CFR Parts 405-471*?

☐ Yes ☐ No

If subject to categorical pretreatment standards, indicate the applicable category and subcategory for each categorical process.

Category: Subcategories: [Click to enter text.](#)

[Click or tap here to enter text.](#) [Click to enter text.](#)

Category: [Click to enter text.](#)

Subcategories: [Click to enter text.](#)

Category: [Click to enter text.](#)

Subcategories: [Click to enter text.](#)

Category: [Click to enter text.](#)

Subcategories: [Click to enter text.](#)

Category: [Click to enter text.](#)

Subcategories: [Click to enter text.](#)

F. Industrial user interruptions

Has the SIU or CIU caused or contributed to any problems (e.g., interferences, pass through, odors, corrosion, blockages) at your POTW in the past three years?

☐ Yes ☐ No

If yes, identify the SIU, describe each episode, including dates, duration, description of problems, and probable pollutants.

[Click to enter text.](#)

WORKSHEET 7.0

TEXAS COMMISSION ON ENVIRONMENTAL QUALITY

CLASS V INJECTION WELL INVENTORY/AUTHORIZATION FORM

Submit the completed form to:

TCEQ
IUC Permits Team
Radioactive Materials Division
MC-233
PO Box 13087
Austin, Texas 78711-3087
512-239-6466

For TCEQ Use Only
Reg. No. _____
Date Received _____
Date Authorized _____

Section 1. General Information (Instructions Page 92)

1. TCEQ Program Area

Program Area (PST, VCP, IHW, etc.): [Click to enter text.](#)

Program ID: [Click to enter text.](#)

Contact Name: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

2. Agent/Consultant Contact Information

Contact Name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

3. Owner/Operator Contact Information

☐ Owner ☐ Operator

Owner/Operator Name: [Click to enter text.](#)

Contact Name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

4. Facility Contact Information

Facility Name: [Click to enter text.](#)

Address: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Location description (if no address is available): [Click to enter text.](#)

Facility Contact Person: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

5. **Latitude and Longitude, in degrees-minutes-seconds**

Latitude: [Click to enter text.](#)

Longitude: [Click to enter text.](#)

Method of determination (GPS, TOPO, etc.): [Click to enter text.](#)

Attach topographic quadrangle map as attachment A.

6. **Well Information**

Type of Well Construction, select one:

- ☐ Vertical Injection
- ☐ Subsurface Fluid Distribution System
- ☐ Infiltration Gallery
- ☐ Temporary Injection Points
- ☐ Other, Specify: [Click to enter text.](#)

Number of Injection Wells: [Click to enter text.](#)

7. **Purpose**

Detailed Description regarding purpose of Injection System:

[Click to enter text.](#)

Attach a Site Map as Attachment B (Attach the Approved Remediation Plan, if appropriate.)

8. **Water Well Driller/Installer**

Water Well Driller/Installer Name: [Click to enter text.](#)

City, State, and Zip Code: [Click to enter text.](#)

Phone Number: [Click to enter text.](#)

License Number: [Click to enter text.](#)

Section 2. Proposed Down Hole Design

Attach a diagram signed and sealed by a licensed engineer as Attachment C.

Table 7.0(1) – Down Hole Design Table

Name of String	Size	Setting Depth	Sacks Cement/Grout – Slurry Volume – Top of Cement	Hole Size	Weight (lbs/ft) PVC/Steel
Casing					
Tubing					
Screen					

Section 3. Proposed Trench System, Subsurface Fluid Distribution System, or Infiltration Gallery

Attach a diagram signed and sealed by a licensed engineer as Attachment D.

System(s) Dimensions: [Click to enter text.](#)

System(s) Construction: [Click to enter text.](#)

Section 4. Site Hydrogeological and Injection Zone Data

1. Name of Contaminated Aquifer: [Click to enter text.](#)
2. Receiving Formation Name of Injection Zone: [Click to enter text.](#)
3. Well/Trench Total Depth: [Click to enter text.](#)
4. Surface Elevation: [Click to enter text.](#)
5. Depth to Ground Water: [Click to enter text.](#)
6. Injection Zone Depth: [Click to enter text.](#)
7. Injection Zone vertically isolated geologically? ☐ Yes ☐ No
Impervious Strata between Injection Zone and nearest Underground Source of Drinking Water:
Name: [Click to enter text.](#)
Thickness: [Click to enter text.](#)
8. Provide a list of contaminants and the levels (ppm) in contaminated aquifer
Attach as Attachment E.
9. Horizontal and Vertical extent of contamination and injection plume
Attach as Attachment F.
10. Formation (Injection Zone) Water Chemistry (Background levels) TDS, etc.
Attach as Attachment G.
11. Injection Fluid Chemistry in PPM at point of injection
Attach as Attachment H.
12. Lowest Known Depth of Ground Water with < 10,000 PPM TDS: [Click to enter text.](#)
13. Maximum injection Rate/Volume/Pressure: [Click to enter text.](#)
14. Water wells within 1/4 mile radius (attach map as Attachment I): [Click to enter text.](#)
15. Injection wells within 1/4 mile radius (attach map as Attachment J): [Click to enter text.](#)
16. Monitor wells within 1/4 mile radius (attach drillers logs and map as Attachment K): [Click to enter text.](#)
17. Sampling frequency: [Click to enter text.](#)
18. Known hazardous components in injection fluid: [Click to enter text.](#)

Section 5. Site History

1. Type of Facility: [Click to enter text.](#)
2. Contamination Dates: [Click to enter text.](#)
3. Original Contamination (VOCs, TPH, BTEX, etc.) and Concentrations (attach as Attachment L): [Click to enter text.](#)
4. Previous Remediation (attach results of any previous remediation as attachment M): [Click to enter text.](#)

NOTE: Authorization Form should be completed in detail and authorization given by the TCEQ before construction, operation, and/or conversion can begin. Attach additional pages as necessary.

Class V Injection Well Designations

- 5A07 Heat Pump/AC return (IW used for groundwater to heat and/or cool buildings)
- 5A19 Industrial Cooling Water Return Flow (IW used to cool industrial process equipment)
- 5B22 Salt Water Intrusion Barrier (IW used to inject fluids to prevent the intrusion of salt water into an aquifer)
- 5D02 Storm Water Drainage (IW designed for the disposal of rain water)
- 5D04 Industrial Stormwater Drainage Wells (IW designed for the disposal of rain water associated with industrial facilities)
- 5F01 Agricultural Drainage (IW that receive agricultural runoff)
- 5R21 Aquifer Recharge (IW used to inject fluids to recharge an aquifer)
- 5S23 Subsidence Control Wells (IW used to control land subsidence caused by ground water withdrawal)
- 5W09 Untreated Sewage
- 5W10 Large Capacity Cesspools (Cesspools that are designed for 5,000 gpd or greater)
- 5W11 Large Capacity Septic systems (Septic systems designed for 5,000 gpd or greater)
- 5W12 WTP disposal
- 5W20 Industrial Process Waste Disposal Wells
- 5W31 Septic System (Well Disposal method)
- 5W32 Septic System Drainfield Disposal
- 5X13 Mine Backfill (IW used to control subsidence, dispose of mining byproducts, and/or fill sections of a mine)
- 5X25 Experimental Wells (Pilot Test) (IW used to test new technologies or tracer dye studies)
- 5X26 Aquifer Remediation (IW used to clean up, treat, or prevent contamination of a USDW)
- 5X27 Other Wells
- 5X28 Motor Vehicle Waste Disposal Wells (IW used to dispose of waste from a motor vehicle site - These are currently banned)
- 5X29 Abandoned Drinking Water Wells (waste disposal)

Landowner's Cross Reference List

1. Parcel 200967

TCCI JOSEPHINE HUNT COUNTY MUD NO 3 LLC
3930 GLADE RD STE 108
COLLEYVILLE, TX 76034


TCCI JOSEPHINE HUNT COUNTY MUD NO 3 LLC
3930 GLADE RD STE 108
COLLEYVILLE TX 76034



U.S. DEPARTMENT OF THE INTERIOR
U.S. GEOLOGICAL SURVEY





JOSEPHINE QUADRANGLE
TEXAS
7.5-MINUTE SERIES

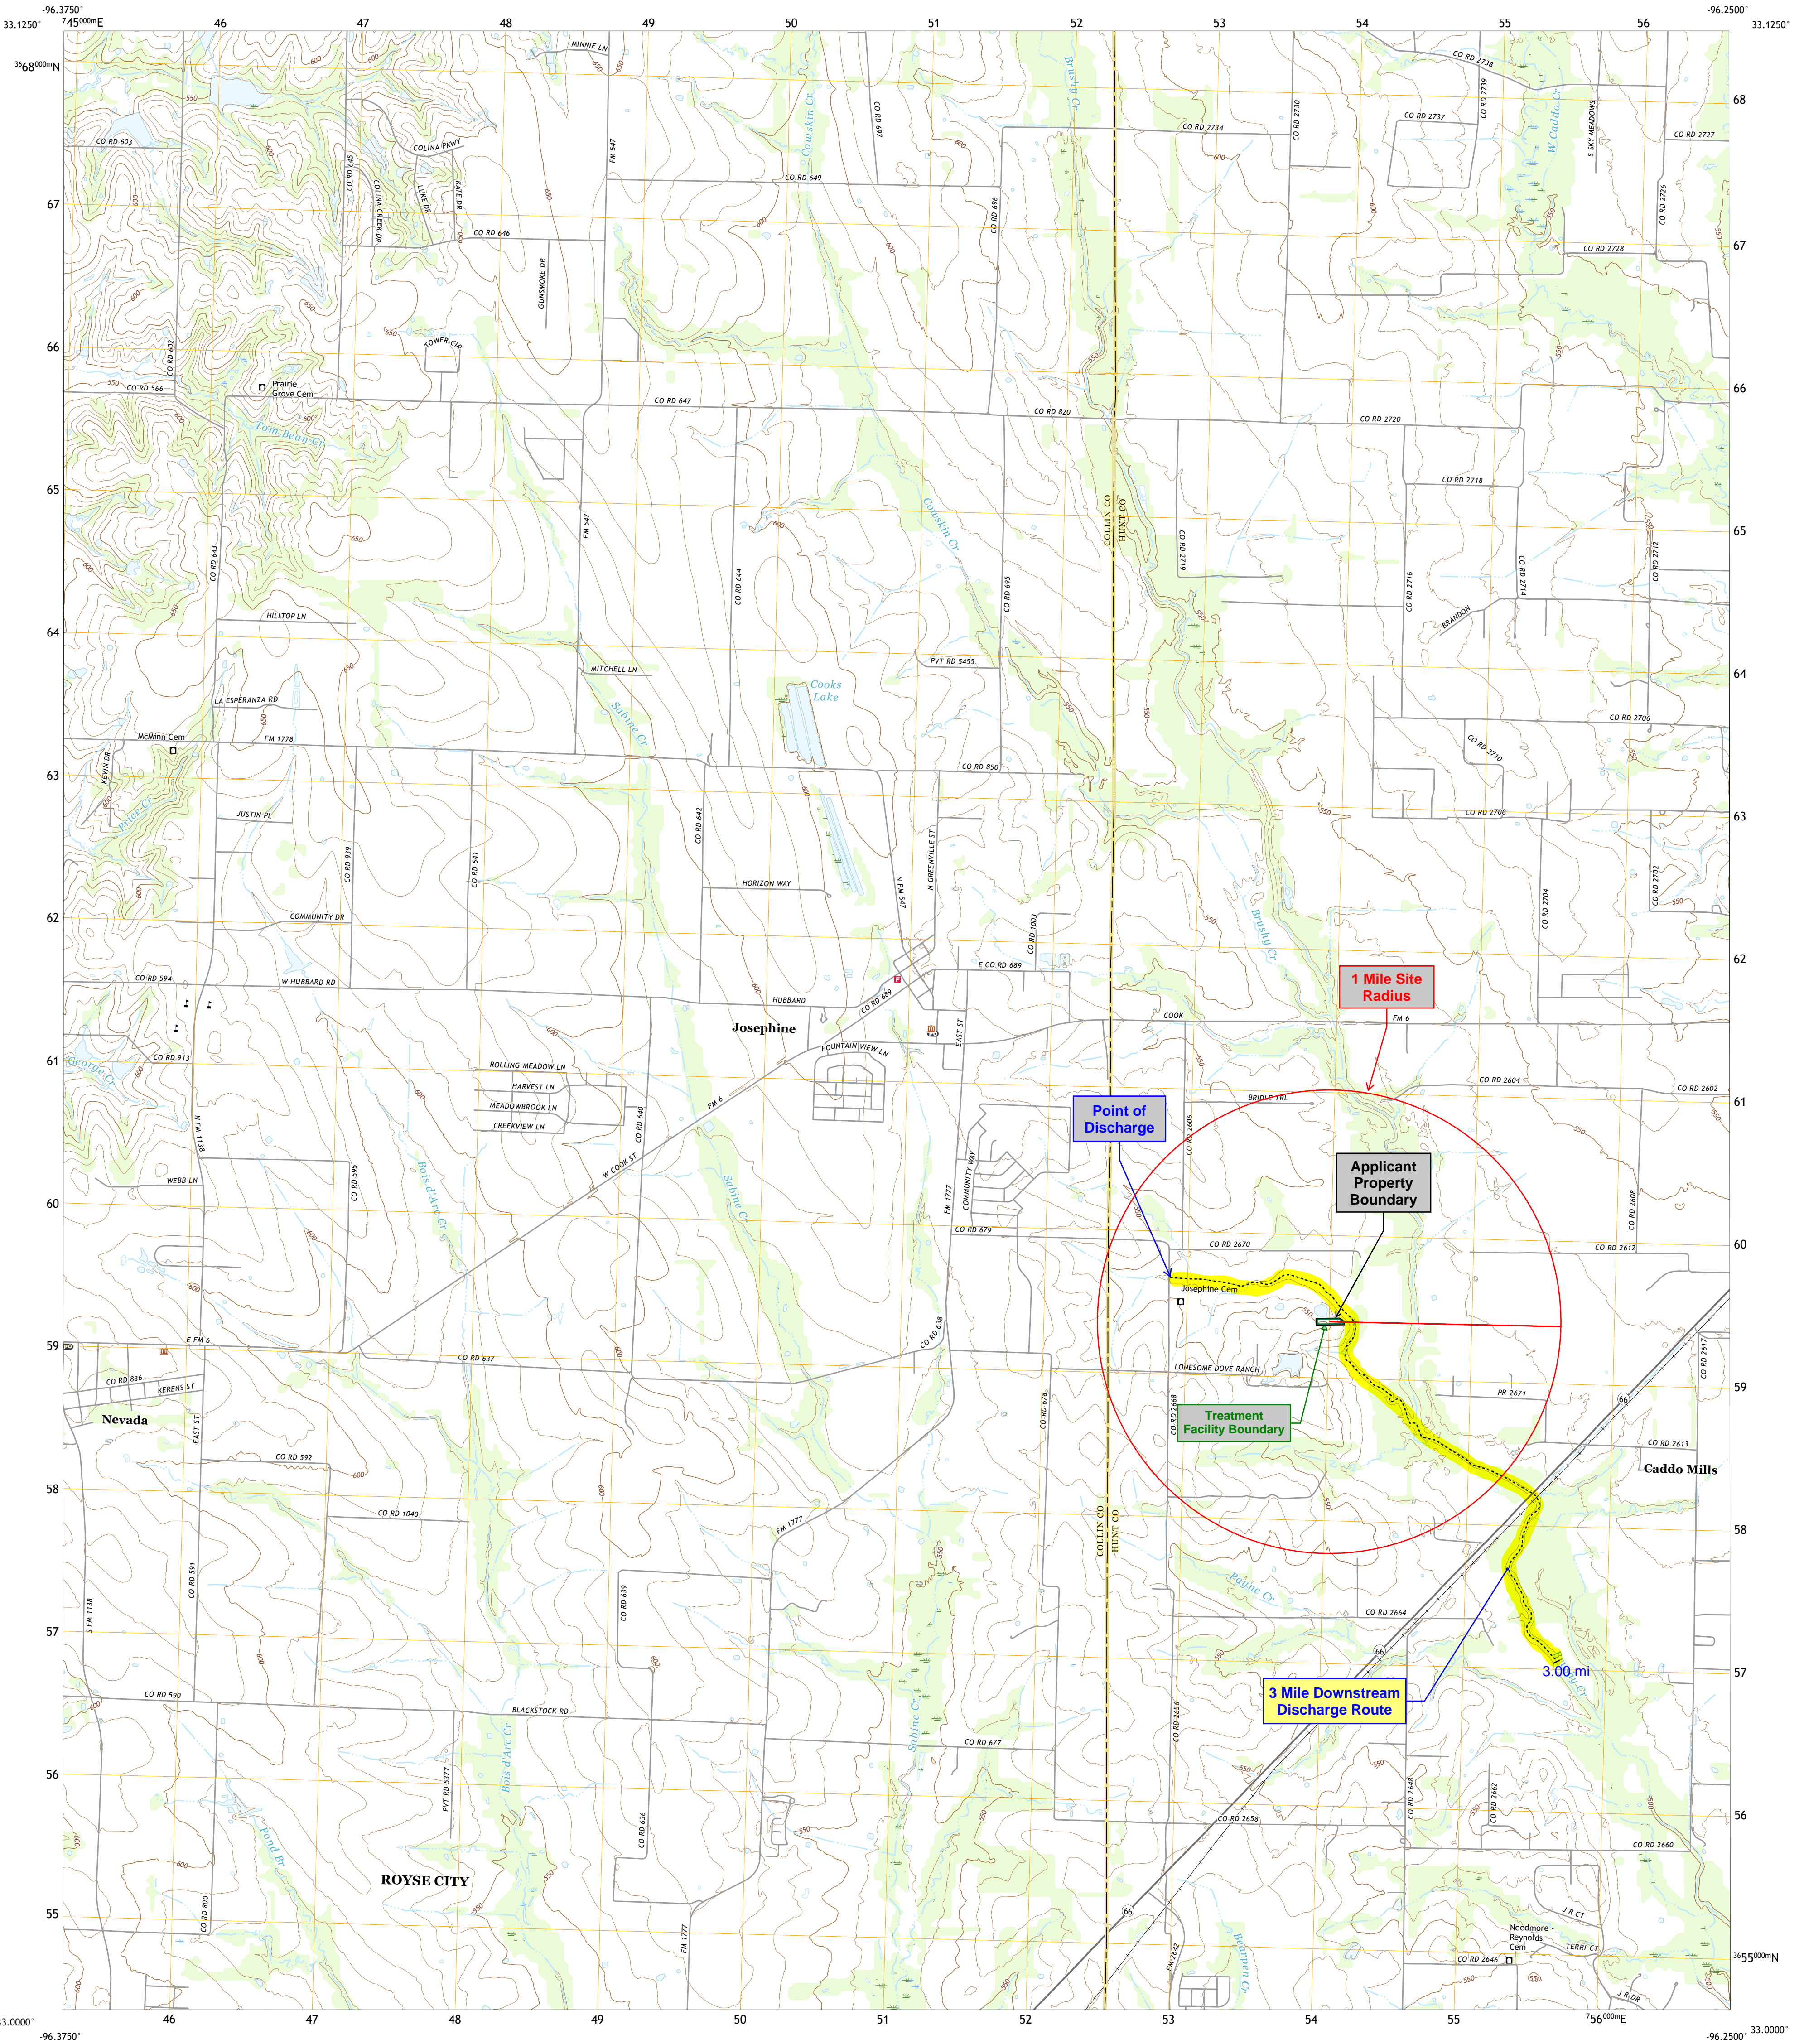

Produced by the United States Geological Survey

North American Datum of 1983 (NAD83)
World Geodetic System of 1984 (WGS84). Projection and
1 000-meter grid/Universal Transverse Mercator, Zone 14S
This map is not a legal document. Boundaries may be
generalized for this map scale. Private lands within government
reservations may not be shown. Obtain permission before
entering private lands.

Imagery.....NAIP, September 2016 - November 2016
Roads.....U.S. Census Bureau, 2015 - 2018
Names.....GNIS, 2000 - 2021
Hydrography.....National Hydrography Dataset, 2002 - 2018
Contours.....National Elevation Dataset, 2021
Boundaries.....Multiple sources; see metadata file 2019 - 2021
Wetlands.....FWS National Wetlands Inventory Not Available

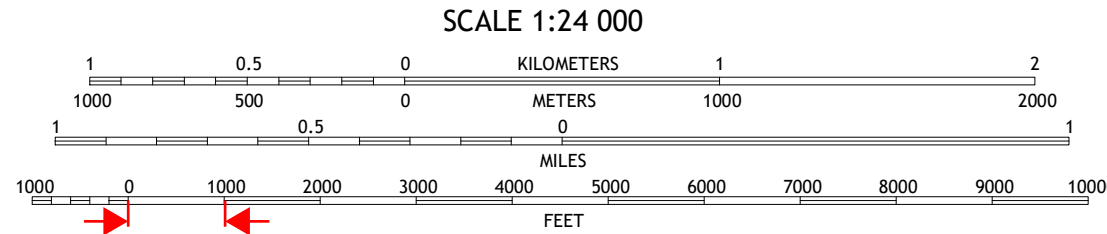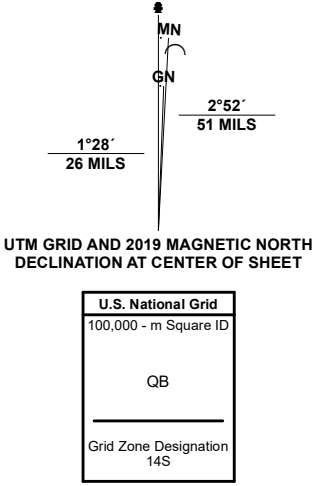

CONTOUR INTERVAL 10 FEET
NORTH AMERICAN VERTICAL DATUM OF 1988
This map was produced to conform with the
National Geospatial Program US Topo Product Standard.



1	2	3
4	5	6
7	8	9

ROAD CLASSIFICATION	
Expressway	Local Connector
Secondary Hwy	Local Road
Ramp	4WD
Interstate Route	US Route
	State Route

JOSEPHINE, TX
2022



TCC JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS
USGS TOPOGRAPHIC MAP
Attachment D





Applicant's Property Boundary

Treatment Facility Boundary

Area Served By WWTF

Photo Location

reUse
ENGINEERING

4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880

TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS

ORIGINAL PHOTOGRAPHS
Attachment E

WWTF

VIEW TO NORTHEAST



WWTF

VIEW TO SOUTH



DISCHARGE POINT

UPSTREAM - VIEW TO WEST


DISCHARGE POINT




DISCHARGE POINT



DOWNSTREAM - VIEW TO EAST

DISCHARGE POINT

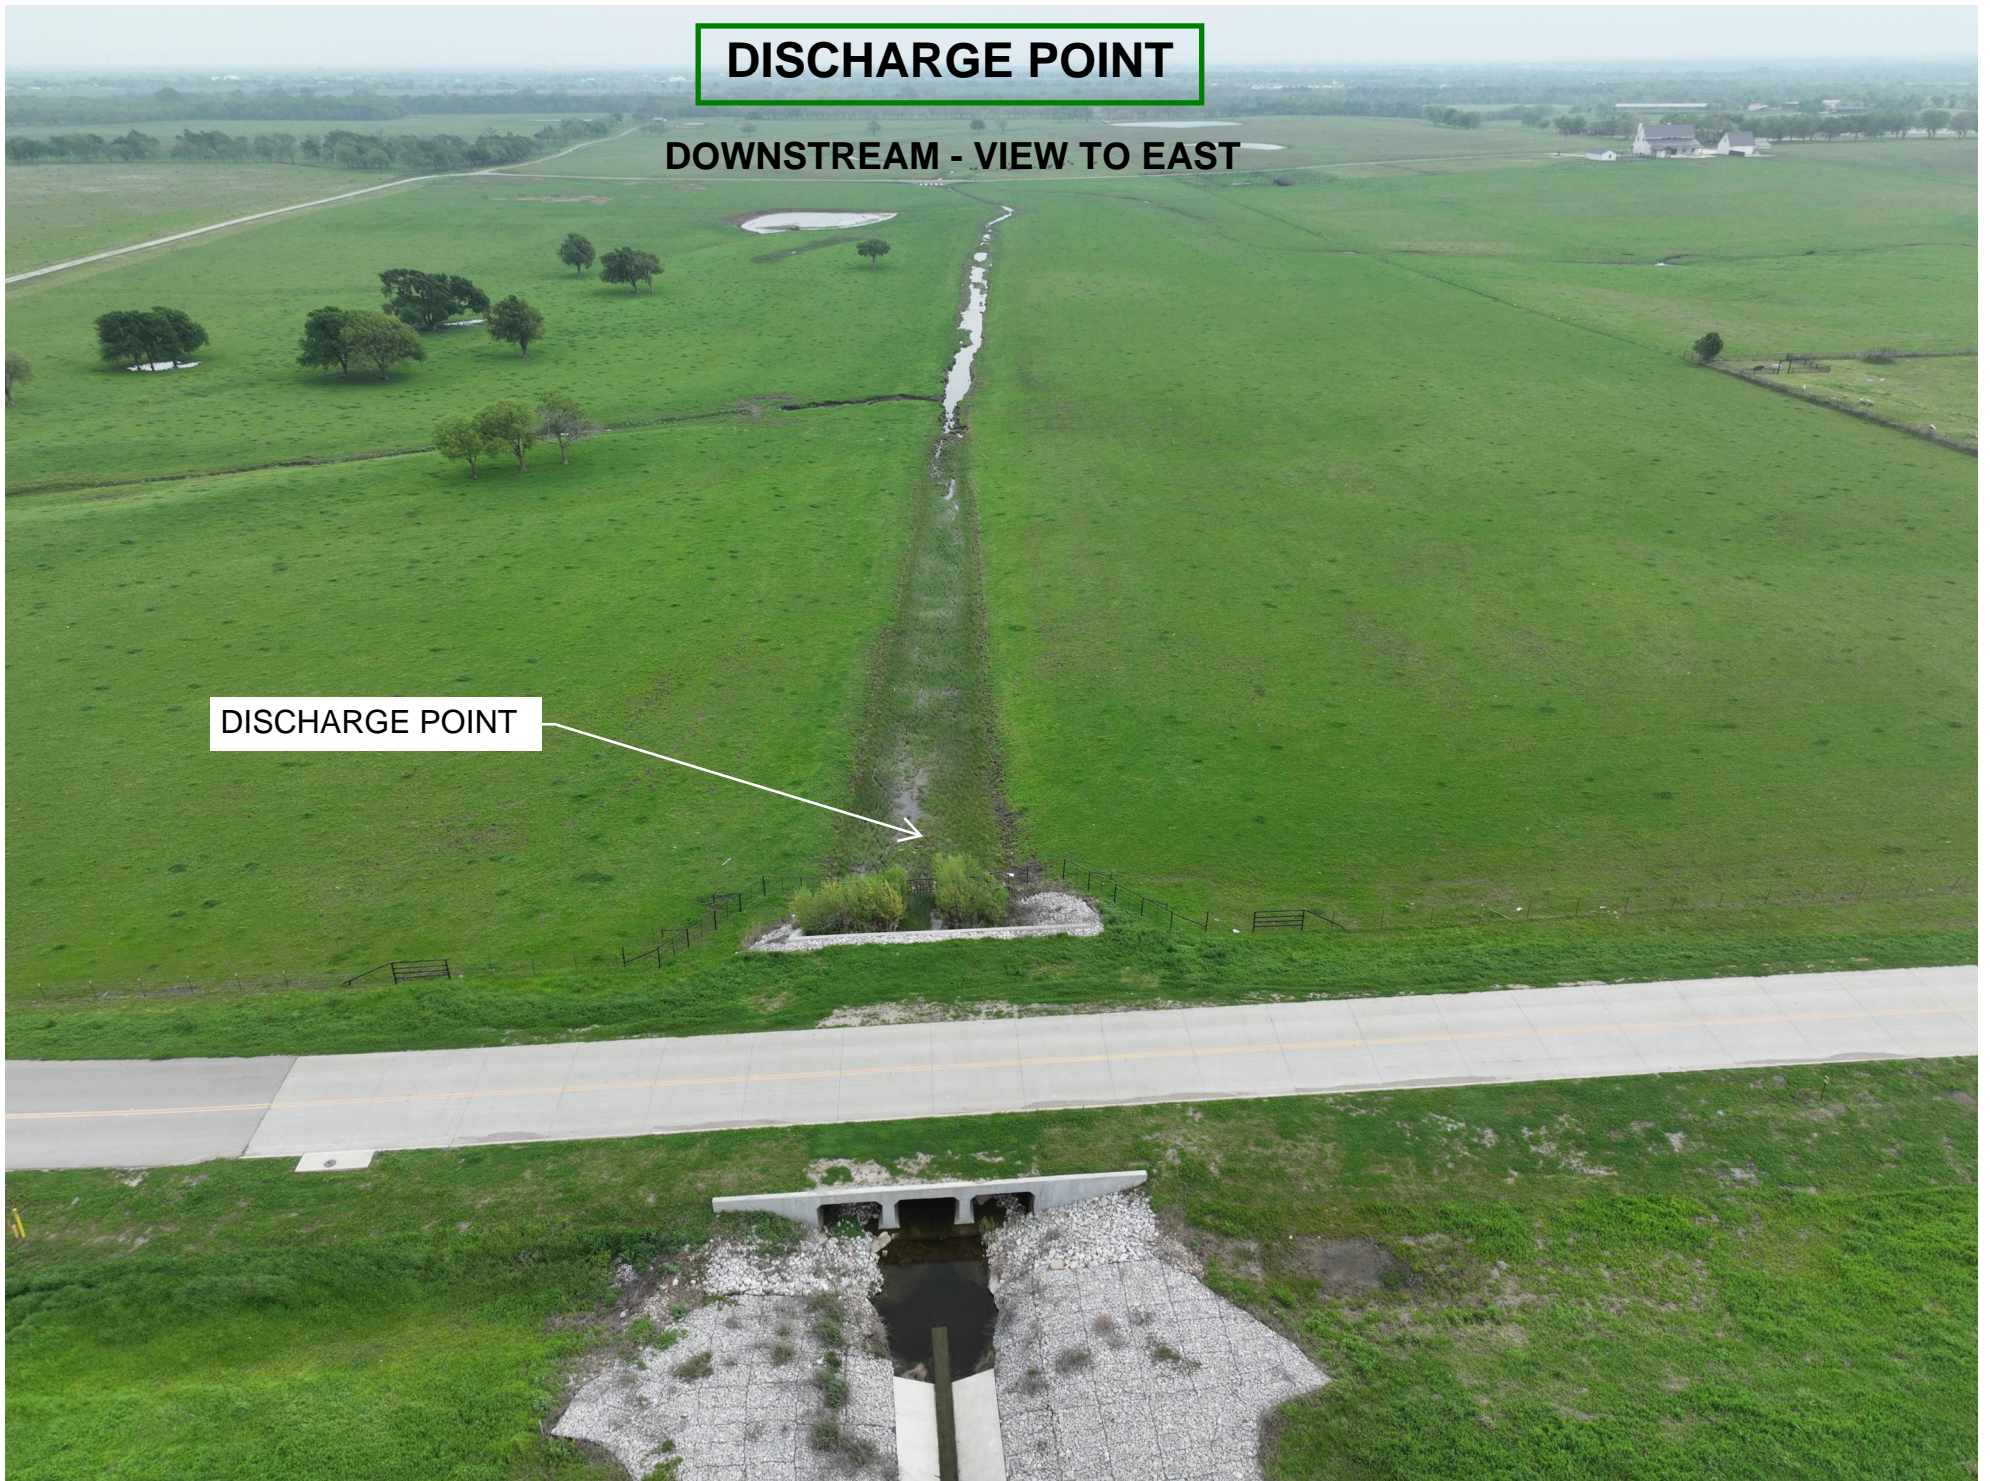

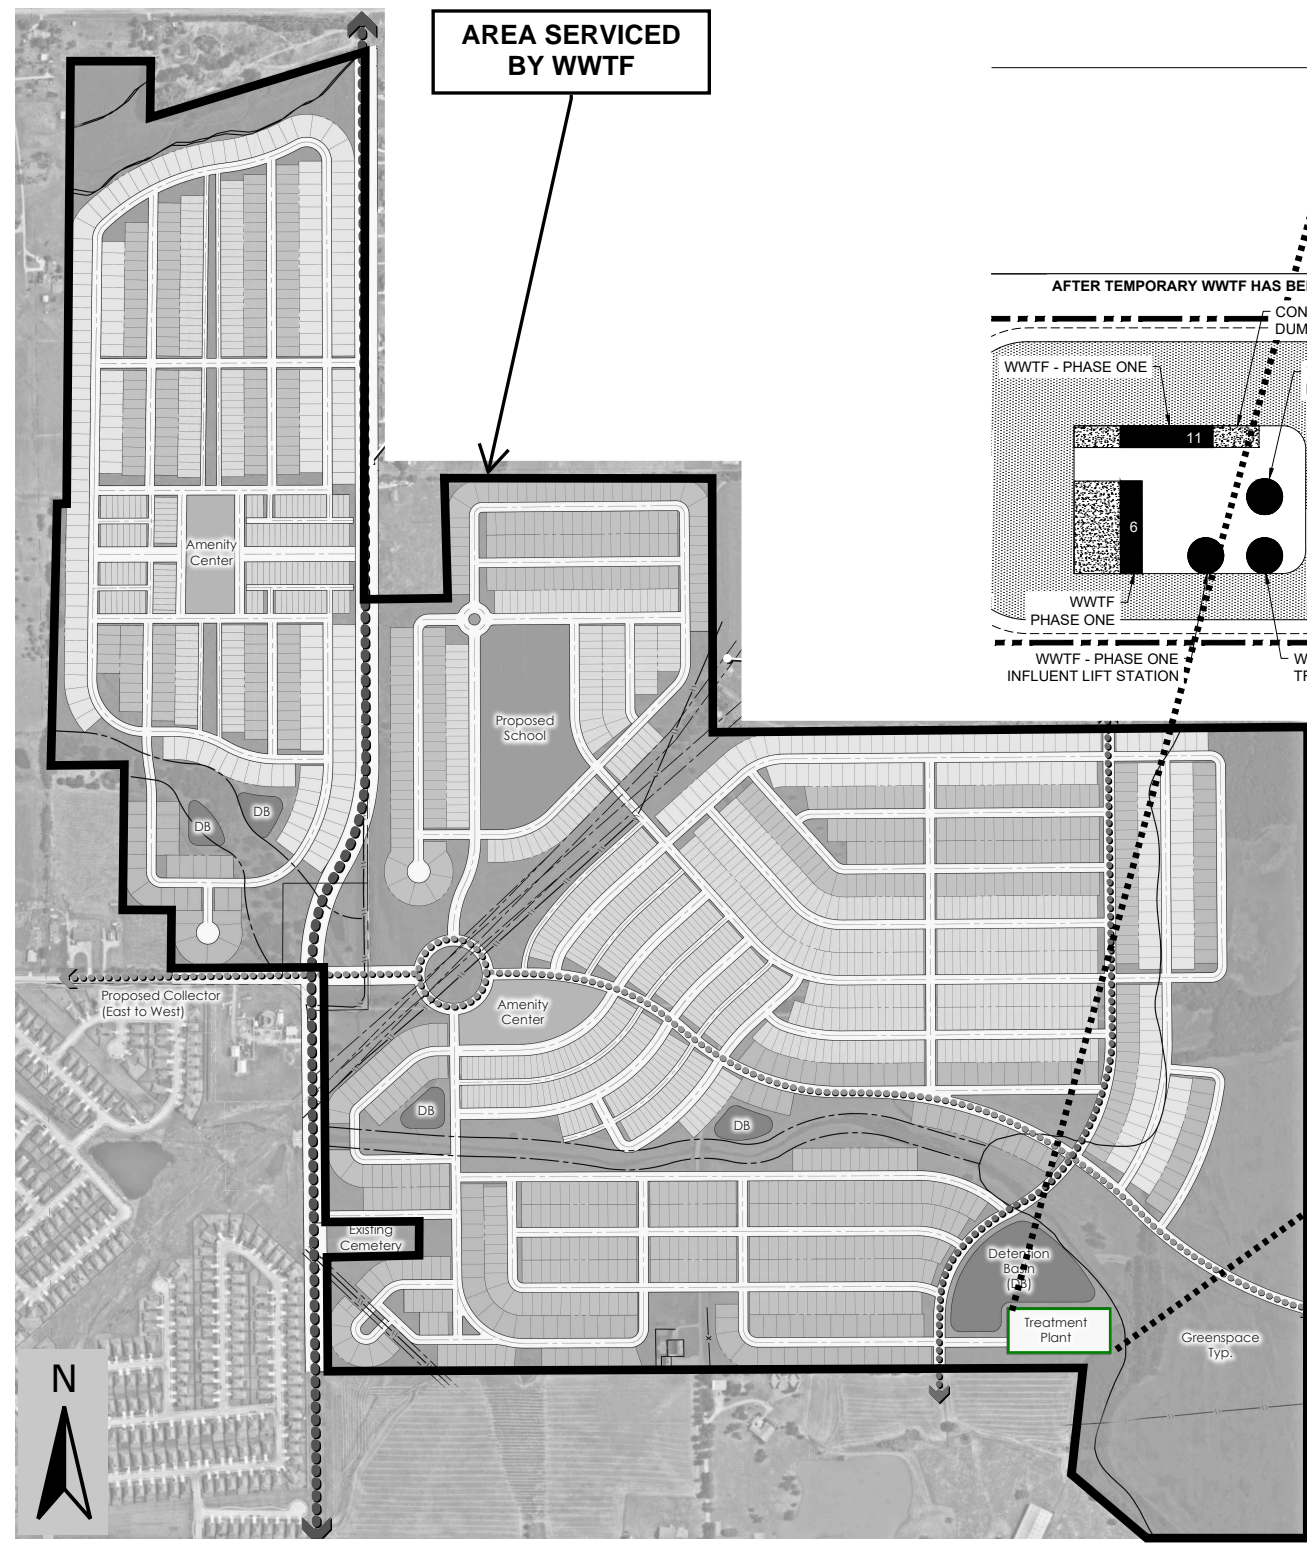

AREA SERVICED BY WWTF

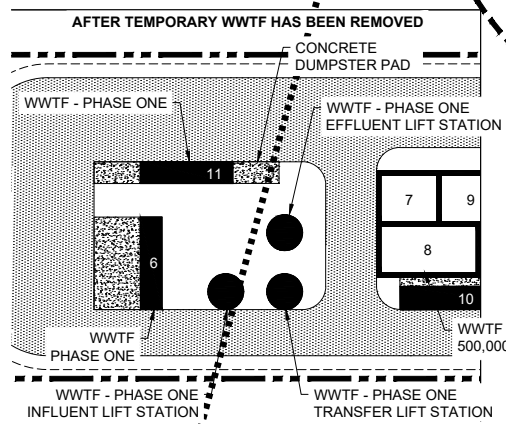
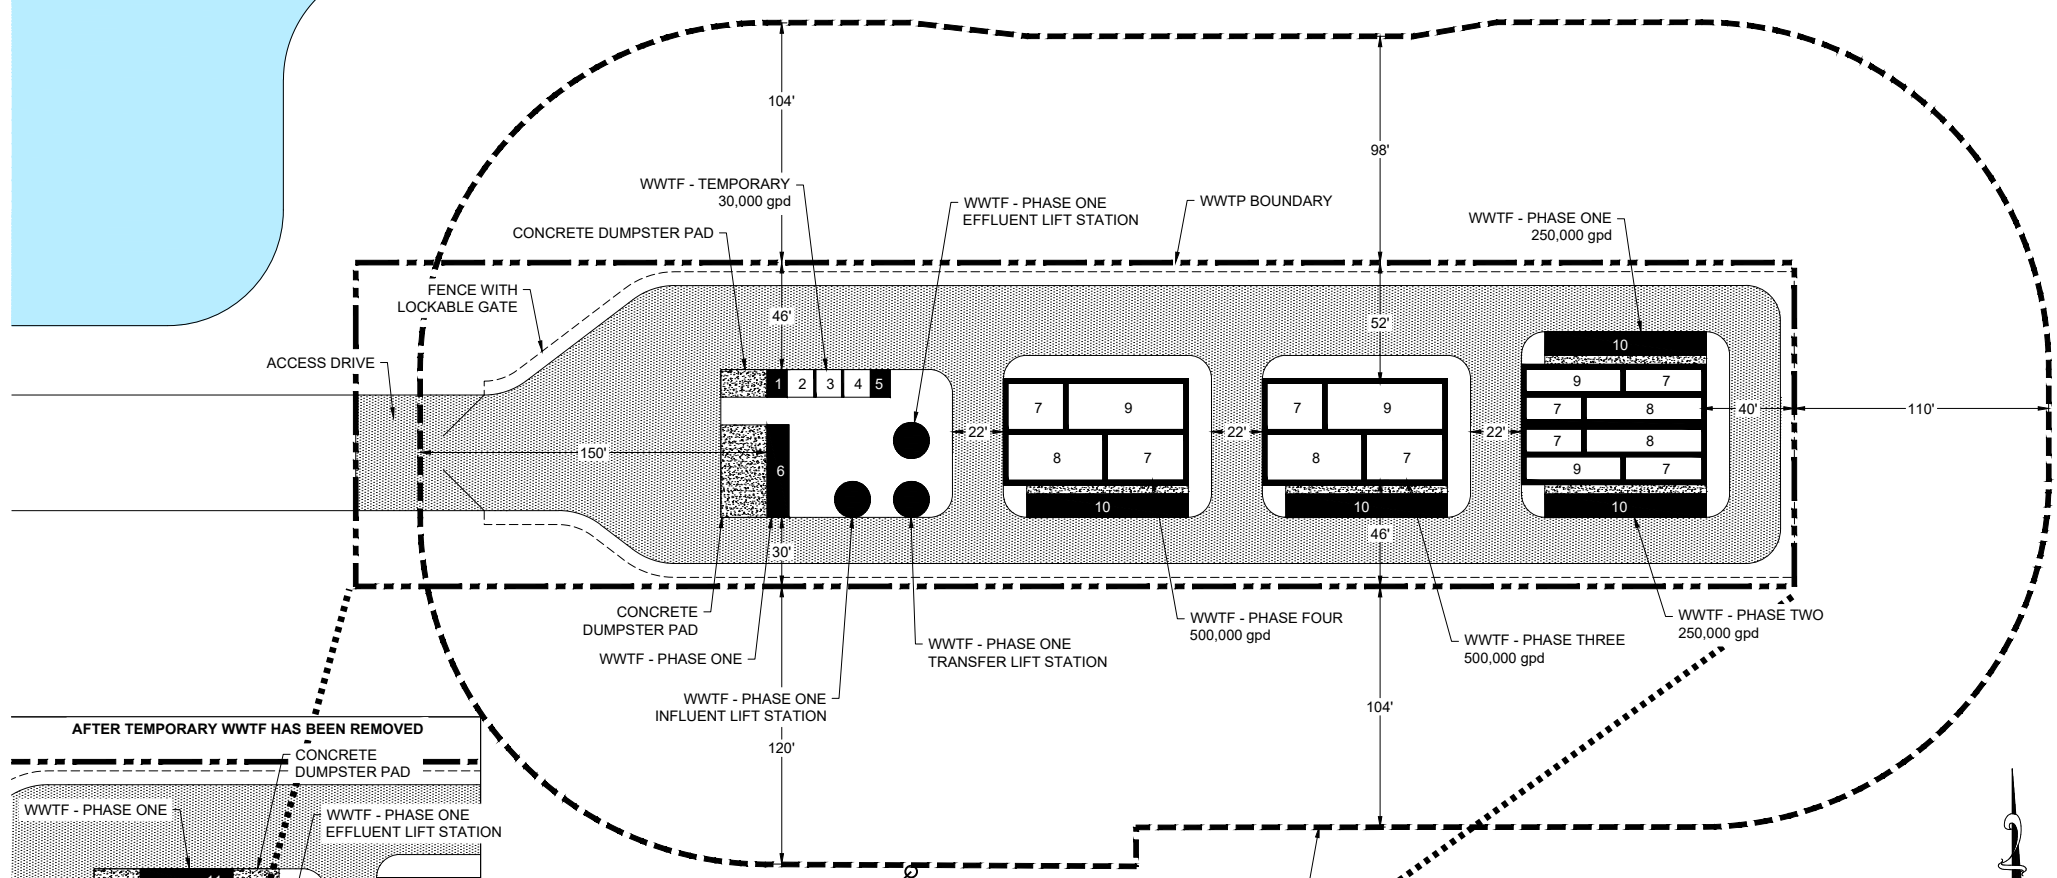


150-FT BUFFER ZONE SURROUNDING WWTF

- TEMPORARY PHASE:**
1. INLET SCREEN
 2. ANOXIC
 3. AEROBIC
 4. MEMBRANE
 5. PUMPS & BLOWERS

- ALL PHASES:**
6. INLET SCREEN SKID
 7. ANOXIC TANK
 8. AEROBIC TANK
 9. MEMBRANE TANK
 10. PERMEATE & BLOWER SKID
 11. SLUDGE PRESS SKID

THE APPLICANT WILL HAVE AN ODOR & ABATEMENT EASEMENT WITH THE ADJACENT PROPERTY OWNER INTO WHICH THE 150-FT BUFFER ZONE FALLS

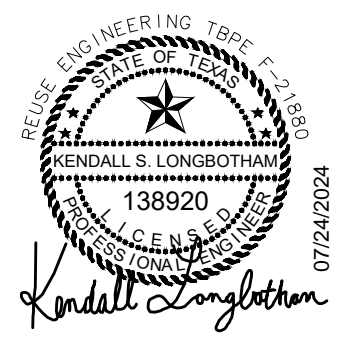


reUse
ENGINEERING
4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880

**TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS**


**BUFFER ZONE MAP
Attachment G**

Membrane Bioreactor Technology applying A3's patented
MaxFlow Plate Ultrafiltration Membrane Modules

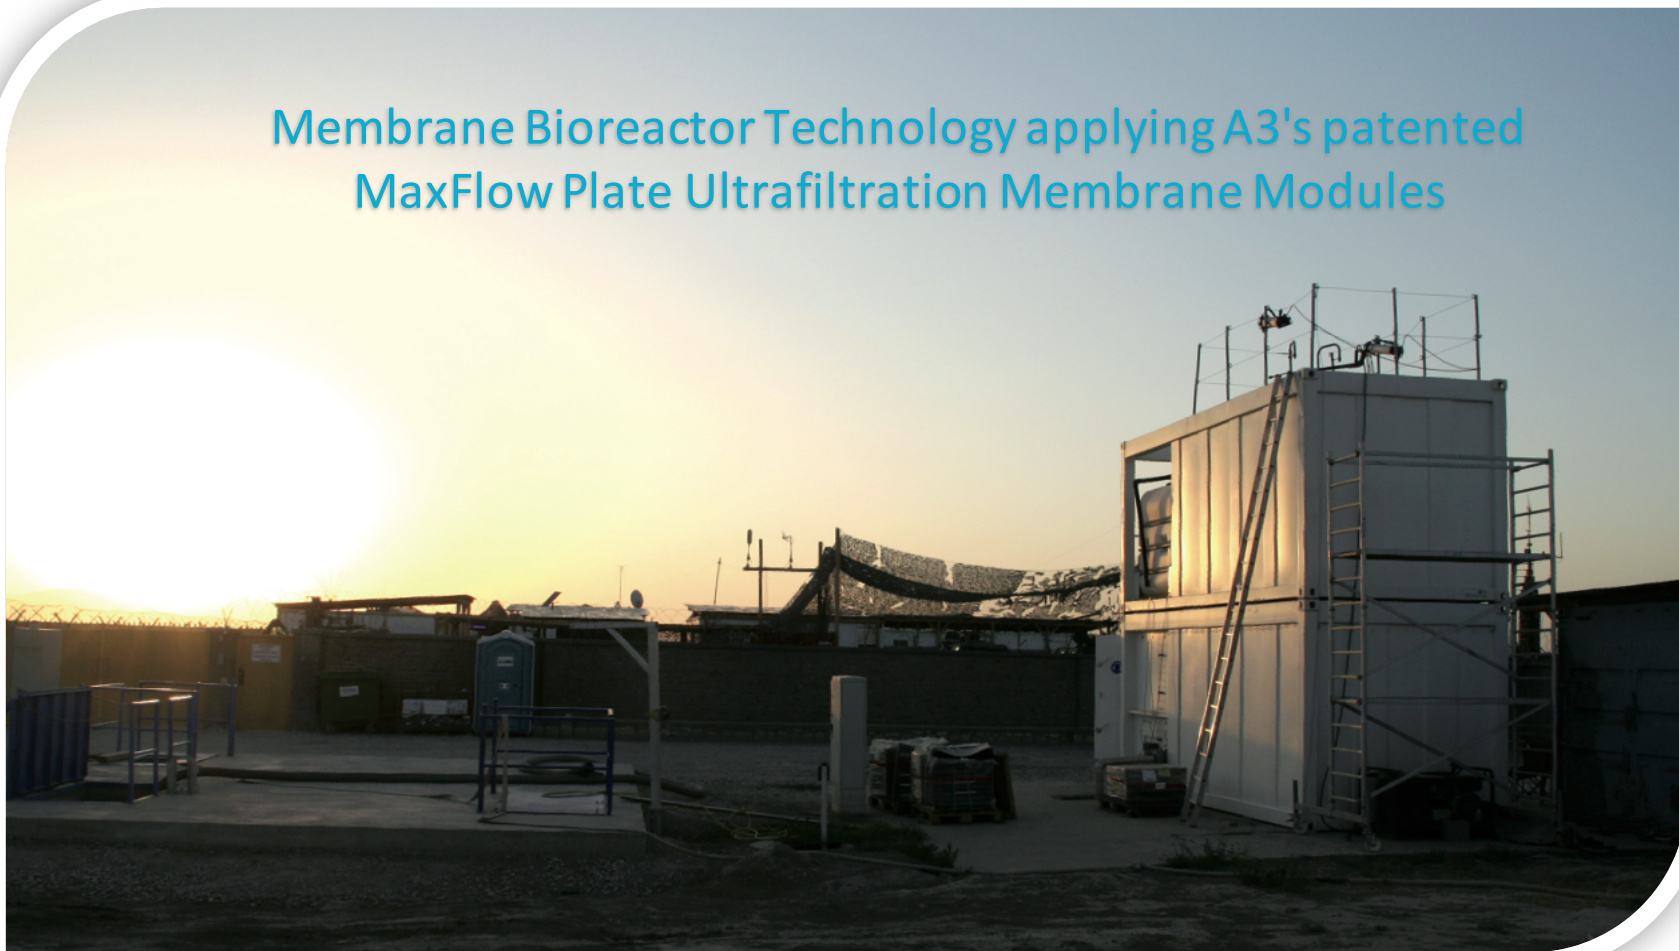


Process Summary

Influent & Effluent Parameters

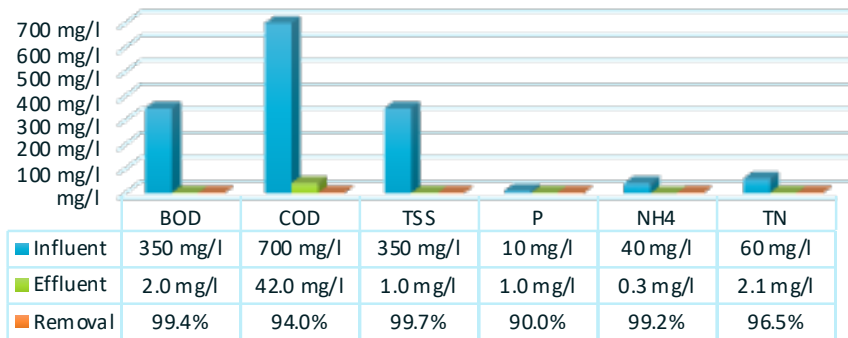

PROCESS PARAMETERS

Sludge Age	25 d
Total Reactor Volume	22,440 gal
Total SOR	191 kgO2/d
MLSS in Anoxic / Aerobic Tank	7,034 mg/l
MLSS in Membrane Tank	8,808 mg/l
HRT	18 h
F/M RATIO (BOD)	0.071
F/M RATIO (COD)	0.142
Total Membrane Surface	9,042 sf

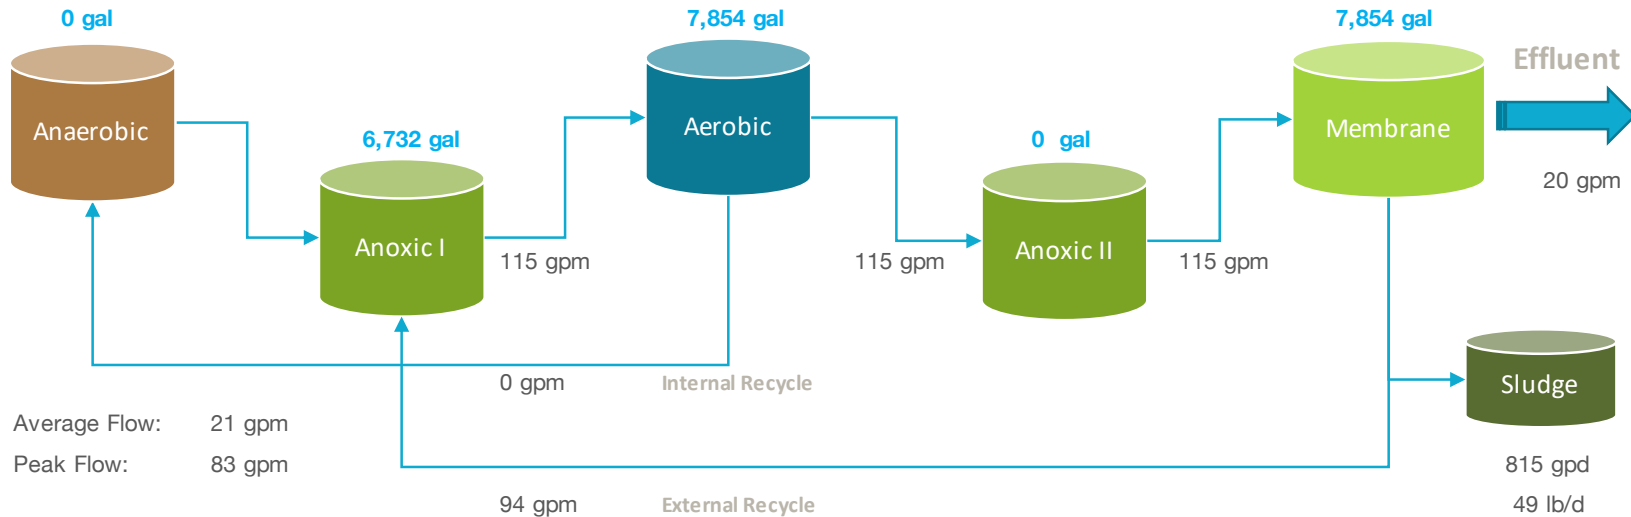

Aeration	Flow	Pressure
EQ	0 scfm	0.0 psi
Sludge	0 scfm	0.0 psi
Aerobic	99 scfm	6.5 psi
Membrane	161 scfm	6.0 psi

Applied Options:

NO	DAF
NO	RO

9/28/22

Biological Process Calculation

Influent Charateristics	Symbol	Value	Units
Type of wastewater		municipal	
Temperature	T	15	°C
pH	-	7.0	-
H ₂ CO ₃ alkalinity	Alk _i	250	mg/l as CaCO ₃
Site pressure / elevation	p _{a,i}	14.2	psi
Average daily flow	Q _i	30,000	gpd
Peak daily flow	Q _{i, max,d}	60,000	gpd
Hourly peak flow	Q _{i, max,p}	83	gpm
Peak factor	-	4.0	-
Average daily flow	Q _i	114	m ³ /d
Max. monthly average daily flow	Q _{i, max,d}	227	m ³ /d
Hourly peak flow	Q _{i, max,h}	18.9	m ³ /h
Total BOD	S _{BOD,i}	350	mgBOD/l
Total COD	S _{COD,i}	700	mgCOD/l
COD/BOD ratio	-	2.00	-
Rapidly biodegradable COD	S _{s,i}	175	mgCOD/l
Volitale fatty acids (VFA)	S _{VFA,i}	26	mgCOD/l
Fermentable COD	S _{F,i}	149	mgCOD/l
Slowly biodegradable COD	S _{ss,i}	378	mgCOD/l
Biodegradable COD	S _{bio,i}	553	mgCOD/l
Soluble inert COD	S _{SIN,i}	42	mgCOD/l
Particulate inert COD	S _{PIN,i}	105	mgCOD/l


Influent Charateristics	Symbol	Value	Units
NO ₃	N _{NO3,i}	0	mg/l
NH ₄	N _{a,i}	40.0	mg/l
TKN	N _{TKN,i}	60.0	mg/l
TP	P _i	10.0	mg/l
Dissolved Oxygen	S _{O2,i}	0.0	mg/l
FSA fraction	f _{a/TKN,i}	0.7	-
Fixed (inorganic) suspended solids	X _{FSS,i}	47.5	mgISS/l
TSS concentration	S _{TSS,i}	350.0	mgTSS/l
Total BOD mass	FS _{BOD,i}	39.7	kgBOD/d
Total COD mass	FS _{COD,i}	79.5	kgCOD/d
Total NH ₄ mass	FS _{a,i}	4.5	kgNH ₄ /d
Total TKN mass	FS _{TKN,i}	6.8	kgTKN/d
Total P mass	FS _{P,i}	1.1	kgP/d

Effluent Characteristics	Symbol	Value	Units
Waste Sludge	FX _t	49	lb/d
Waste Sludge	Q _w	815	gpd
Effluent BOD	S _{BOD,e}	< 3	mgBOD/l
Effluent COD	S _{COD,e}	42	mgCOD/l
Effluent TSS	S _{TSS,e}	1.0	mgTSS/l
Effluent P	P _e	1.0	mgP/l
Effluent NH ₄	N _{a,e}	0.3	mgN/l
Effluent NO ₃	N _{NO3,e}	0.0	mgN/l
Effluent TN (N _{ne} + N _{te})	N _{t,e}	2.1	mgN/l

Bioreactor Characteristics	Symbol	Value	Units	Biological Oxygen Demand	Symbol	Value	Units
Temperature	T_{bio}	15	°C	OD for synth & endo respiration (PAO)	FO_{PAO}	0	kgO ₂ /d
Sludge retention time / Sludge age	SRT	25	d	OD for synth & endo respiration (OHO)	FO_{OHO}	50	kgO ₂ /d
Reactor volume	$V_{P,chosen}$	22,440	gallons	Mass carbonaceous oxygen demand	FO_C	50	kgO ₂ /d
Reactor volume	$V_{P,chosen}$	85	m ³	Carbonaceous oxygen utilization rate	O_c	59%	-
Reactor volume	$V_{P,calc}$	20,384	gallons	Nitrification oxygen demand	FO_n	21	kgO ₂ /d
Average MLSS concentration	X_{TSS}	7,250	mgTSS/l	Total oxygen demand	FO_t	72	kgO ₂ /d
Food to microorganism ratio	$F/M_{BOD,used}$	0.071	kgBOD/kgMLSS	Oxygen recovered by denitrification	FO_d	13	kgO ₂ /d
Food to microorganism ratio	$F/M_{COD,used}$	0.142	kgCOD/kgMLSS	Net total oxygen demand (AOR)	FO_{td}	58	kgO ₂ /d
Membrane tank MLSS concentration	X_M	8,808	mgTSS/l	Oxygen saturation @ operating temp.	c_s	10.2	mg/l
Aerobic/Anoxic tank MLSS concentration	X_{Bio}	7,034	mgTSS/l	Desired oxygen level	c_x	2.0	mg/l
Number of anaerobic zones	$\#_{AN}$	0	-	Transfer coefficient	α	0.40	-
Number of anoxic zones	$\#_{AO}$	1	-	Diffuser water depth	DWD	9.5	feet
Number of aerobic zones	$\#_{AE}$	1	-	Oxygen transfer efficiency	OTE	1.87	%
External recycle ratio	m	4.5	-	Standard total oxygen demand (SOR)	SOR	191	kgO ₂ /d
Internal recycle ratio	a	0	-	Required air flow	Q_{air}	97	scfm
DO in m recycle	O_m	0	mgO ₂ /l	Oxygen requir. per volume & depth	OS	16.7	gO ₂ /(Nm ₃ *mD)
DO in a recycle	O_a	0	mgO ₂ /l				
Recycle ratio to anaerobic tank (PAO)	s	0	-				
DO in s recycle	$S_{O2,s}$	0	mgO ₂ /l				
Nitrate on s recycle	$S_{NO3,s}$	0	mg/l				
TKN/COD ratio	$f_{TKN/COD}$	0.086	mgTKN/mgCOD				
Carbon source addition (Micro C)	B_{MicroC}	0.0	lb/d				
Carbon source addition (Micro C)	S_{MicroC}	0.00	gpd				
Nominal hydraulic retention time	HRT_n	18.0	h				
Actual hydraulic retention time	HRT_a	3.3	h				

Membrane Module Design

	Symbol	Value	Units
Permeate on cycle	T_o	8	minute
Permeate off cycle (relaxation)	T_s	2	minute
Effective membrane module surface	$A_{m,eff}$	84.0	m ²
Effective membrane module surface	$A_{m,eff}$	904	ft ²
Total number of membrane modules	N_M	10	-
Total membrane module surface	A_{total}	840	m ²
Total membrane module surface	A_{total}	9,042	ft ²
Nominal average daily flux	$Q_{ave,n}$	7.0	lmh
Nominal max. daily flux	$Q_{ave,n,max,mo}$	14.1	lmh
Nominal peak hourly flux	$Q_{peak,n}$	28.2	lmh
Average daily flux (excluding rest cycle)	$Q_{ave,n}$	3.3	gfd
Max. Daily flux (ex. rest cycle)	$Q_{ave,n,max,mo}$	6.6	gfd
Peak hourly flux (ex. rest cycle)	$Q_{peak,n}$	13.3	gfd
Total membrane module displacement vol.	$V_{modules}$	110	ft ³
Total membrane module displacement vol.	$V_{modules}$	823	gallons
Aeration modules	$A\#$	5	-
Membrane module aeration requirement	Q_{am}	28.5	acfm
Total membrane modules aeration	$Q_{am,total}$	143	acfm
Membrane diffuser water depth	DWD_m	9.00	feet
Oxygen requirement per volume & depth	OS	13	gO ₂ /(Nm ₃ *m _D)
Standard oxygen rate, membrane aeration	SOR_m	436	lbO ₂ /d
Standard oxygen rate, membrane aeration	SOR_m	200	kgO ₂ /d

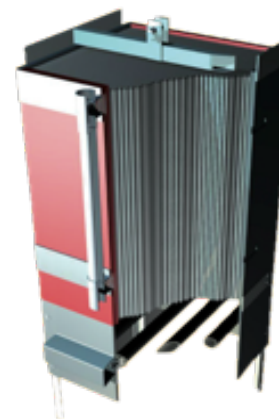

- ✓ Patented, innovative A3's MaxFlow™ membrane filtration modules manufactured in USA.
- ✓ The MaxFlow™ module "open channel design" provides optimal biofilm control, minimizes the quantity of chemical cleaning procedures and avoids module clogging.
- ✓ The compact module design enables dual-stack and triple-stack installations. It allows for a high membrane packing density resulting in a small footprint and high energy efficiency.
- ✓ Most existing conventional treatment plants can be retrofitted with MaxFlow™ membranes due to the


Kinetic Constants	Symbol	Value	Units	Stoichiometric Constants	Symbol	Value	Units
Yield coefficient OHO	Y_{OHO}	0.40	mgVSS/mgCOD	COD/BOD ratio	-	2.00	-
Yield coefficient OHO,OBS	$Y_{OHO,obs}$	0.06	mgVSS/mgCOD	Readily biodeg. org. fraction (RBCOD)	$f_{s,COD}$	0.25	g/gTCOD
Fermentation rate at 20°C	$K_{F,20}$	0.06	m3/gVSSd	Non-biodegradable particulate COD	$f_{PNb,COD}$	0.15	g/gTCOD
Temperature coefficient for $k_{F,T}$	Θ_{KF}	1.029	-	Non-biodegradable soluble COD	$f_{SNb,COD}$	0.06	g/gTCOD
Fermentation rate at T	$K_{F,T}$	0.05	m3/gVSSd	SVFA fraction of RBCOD	$f_{SVFA,SSI}$	0.15	g/gCOD _{ss}
Endogenous respiration rate (decay)	$b_{OHO,20}$	0.24	gVSS/gVSSd	VSS/TSS of activated sludge	f_{VT}	0.73	mgVSS/mgTSS
Endogenous respiration rate T	$b_{OHO,T}$	0.21	gVSS/gVSSd	COD/VSS of activated sludge	f_{cv}	1.48	kgCOD/kgVSS
Yield coefficient FSA	Y_A	0.10	mgVSS/mgFSA	True synthesis fraction	f_s^0	0.57	-
Nitri. pH sensitivity coefficient	K_I	1.13	-	Endogenous residue fraction	$f_{H/E,OHO}$	0.2	-
Nitri. pH sensitivity coefficient	K_{max}	9.50	-	ISS content of OHOs	$f_{ISS,OHO}$	0.15	-
Nitri. pH sensitivity coefficient	K_{II}	0.30	-	Active fraction - VSS	f_{avOHO}	25%	-
Max. specific growth rate at 20°C	μ_{Am}	0.45	1/d	Active fraction - TSS	f_{at}	18%	-
Max. spec. growth rate - Temp/pH	μ_{AmTpH}	0.21	1/d	Influent FSA fraction	$f_{FSA,i}$	0.67	-
Half saturation coefficient	K_n	0.75	mgFSA/l	Non-bio. soluble orgN fraction (inerts)	$f_{SNb,N}$	0.03	-
Half saturation coefficient - Temp	K_{nT}	0.42	mgFSA/l	Non-bio. particulate orgN fraction	f_n	0.12	-
Endogenous respiration rate (decay)	b_A	0.04	1/d	Permissible unaer. sludge mass fraction	f_{xm}	0.65	-
Temperature coefficient for $k_{F,T}$	θ_n	1.123	-	Design unaerated sludge mass fraction	f_{xt}	0.30	-
Endogenous respiration rate T	b_{AT}	0.022	1/d	Minimum primary anoxic mass fraction	f_{x1min}	0.08	-
Temperature sensitivity coefficient	Θ_{nk1}	1.20	-	Primary anoxic mass fraction	f_{x1}	0.30	-
Temperature sensitivity coefficient	Θ_{nk2}	1.05	-	Secondary anoxic mass fraction	f_{x2}	0.00	-
Temperature sensitivity coefficient	Θ_{nk3}	1.03	-	Anaerobic mass fraction	f_{AN}	0.00	-
Denitrification rates at 20°C	k_1	0.70	-	Non-bio. particulate orgP fraction	$f_{P,XE,OHO}$	0.05	mgP/mgVSS
Denitrification rates at 20°C	k_2	0.10	-	Endogenous residue fraction	$f_{XE,PAO}$	0.25	gEVSS/gAVSS
Denitrification rates at 20°C	k_3	0.08	-	P fraction in active PAO mass	$f_{P,PAO}$	0.38	gP/gAVSS
Denitrification rates	k_{1T}	0.281	-	VSS/TSS ratio for PAO active mass	$f_{VT,PAO}$	0.46	gVSS/gTSS
Denitrification rates	k_{2T}	0.079	-	Ratio of P release /VFA uptake	$f_{PO4,REL}$	0.5	gP/gCOD
Denitrification rates	k_{3T}	0.069	-	Frac. of fixed inorganic s. solids of PAO	$f_{FSS,PAO}$	1.3	gFSS/gAVSS
Yield coefficient PAO	Y_{PAO}	0.45	gAVSS/gCOD	P content of TSS	$f_{P,TSS}$	0.041	gP/gTSS
Yield coefficient PAO	$Y_{PAO,obs}$	0.22	gAVSS/gCOD	P content of VSS	$f_{P,FSS,i}$	0.02	gP/gVSS
Endogenous respiration rate (decay)	$b_{PAO,20}$	0.04	gEVSS/gCOD	TKN/COD ratio	f_{ns}	0.09	mgTKN/mgCOD
Temperature coefficient for $k_{F,T}$	$\Theta_{b,PAO}$	1.029	-	Nitrogen content of active biomass	$f_{N,VSS}$	0.10	gN/gAVSS
Endogenous respiration rate T	$b_{PAO,T}$	0.03	gEVSS/gVSSd				

Biological Mass Balance

	Symbol	Value	Units
Sludge age	SRT	25 d	
Mixed liquor suspended solids	X_{TSS}	7,250 mgTSS/l	
Readiable biodegradabe COD flux	$FS_{S,i}$	20 kgCOD/d	
Daily flux of VFAs	$FS_{VFA,i}$	3 kgCOD/d	
Daily flux of fermentable COD	$FS_{F,i}$	17 kgCOD/d	
Daily flux of biodegradable COD	$FS_{bio,i}$	63 kgCOD/d	
Daily flux of particulate inert COD	$FS_{PIN,i}$	12 kgCOD/d	
Daily flux of fixed inorganic sus. solids	$FS_{ISS,i}$	5 kgISS/d	
Influent particulate non-bio. COD	$FX_{VSS,i}$	8 kgVSS/d	
Mass nitrogen into sludge prod.	FN_{Sludge}	2 kgN/d	
Mass of nitrate generated per day	FN_{NO3}	5 kgN/d	
VFAs stored by PAOs	$FS_{S,PAO}$	0 kgCOD/d	
Remaining biodegradable COD	$FCOD_{b,OH0}$	63 kgCOD/d	
Mass nitrifiers	MX_A	7 kgVSS	
Active biomass PAO	MX_{PAO}	0 KgAVSS	
Endogenous active biomass PAO	$MX_{E,PAO}$	0 kgEVSS	
Bio mass	MX_{bio}	102 kgVSS	
Active organism mass	MX_{OH0}	102 kgVSS	
Endogenous residue mass	$MX_{E,OH0}$	106 kgVSS	
Non-biodegradable particulate mass	MX_{IV}	201 kgVSS	
Volatile suspended solids mass	MX_{VSS}	409 kgVSS	
Inorganic suspended solid mass	MX_{ISS}	150 kgISS	
Total suspended solids mass	MX_{TSS}	559 kgTSS	
Mass/Sludge TSS wasted	FX_t	22 KgTSS/d	
Mass/Sludge VSS wasted	FX_V	16 kgVSS/d	
Effluent COD	$S_{COD,e}$	42 mgCOD/l	
COD mass out (effluent and waste)	$FS_{COD,e}$	5 kgCOD/d	
Mass/Sludge COD wasted	$FX_{COD,s}$	24 kgCOD/d	

Alkalinity

	Symbol	Value	Units
Alkalinity Nitrification as $CaCO_3$ (consumed)	Alk_{Nltri}	290 mg/l as $CaCO_3$	
Alkalinity Denitrification as $CaCO_3$ (recovered)	$Alk_{Denltri}$	146 mg/l as $CaCO_3$	
Alkalinity ef	Alk_e	100 mg/l as $CaCO_3$	
Alkalinity inf	Alk_i	250 mg/l as $CaCO_3$	
Alkalinity Alum (consumed)	Alk_{Alum}	0.0 mg/l as $CaCO_3$	
Alkalinity Total	Alk_{total}	106 mg/l as $CaCO_3$	
Alkalinity Added	Alk_{added}	-6 mg/l as $CaCO_3$	
Alkalinity Added	$XAlk_{added}$	0 lb/d	
Density caustic solution (50%)	-	12.76 lb/gal	
Alkalinity recovered	$Alk_{recovered}$	0.4 lb $CaCO_3$ /lb	
Caustic needed	-	0.0 lb/d	
Caustic needed	-	0.0 gpd	

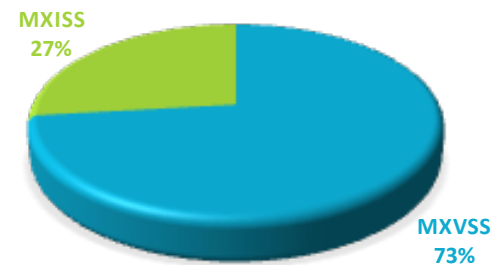

$$MX_{TSS} = MX_{ISS} + MX_{VSS}$$

$$V_p = \frac{MX_{TSS}}{X_{TSS}}$$

$$FX_t = \frac{MX_{TSS}}{SRT}$$

N Removal

	Symbol	Value	Units
Factor of safety	S_f	1.2	-
Nitrogen requirements	FN_{synth}	2	kgN/d
Nitrogen requirements	$TKN_{i,synth}$	14.42	gN/m ³
Influent non-bio. soluble organic N	$N_{nbios,i}$	1.8	mgN/l
Influent non-bio. particulate org. N	$N_{nbio,p,i}$	8.5	mgN/l
Influent biodegradable organic N	$N_{bio,i}$	18.2	mgN/l
Effluent non-bio. soluble organic N	$N_{nbios,e}$	1.8	mgN/l
NH ₄ concentration avail. for nitri.	N_{an}	40.9	mgN/l
Effluent ammonia	$N_{a,e}$	0.3	mgN/l
Effluent TKN	$N_{TKN,e}$	2.1	mgN/l
N concentration into sludge prod.	N_s	17.3	mgN/l
Nitrification capacity	N_c	40.6	mgN/l
Denitrification potential RBCOD	$D_{p1RBCOD}$	24.7	mgNO ₃ -N/l
Denitrification potential SBCOD	$D_{p1SBCOD}$	21.3	mgNO ₃ -N/l
Denitrification potential RBCOD	$D_{p3RBCOD}$	0.0	mgNO ₃ -N/l
Denitrification potential SBCOD	$D_{p3SBCOD}$	0.0	mgNO ₃ -N/l
Minimum sludge age for nitri.	SRT_m	7.9	d
Denitrification potential primary tank	D_{p1}	46.0	mgN/l
Denitrification potential secondary tank	D_{p3}	0.0	mgN/l
Denitri. potential recycle rate ($f_{xm} = f_{xdm}$)	D_{p^*}	33.2	mgN/l
Effluent nitrate	$N_{NO3,e}$	0.0	mgN/l
Effluent nitrate @ f_{xdm} & recycle rate	N_{NO3,e^*}	7.4	mgN/l


P Removal

	Symbol	Value	Units
COD lost in anaerobic reatcor	$S_{F,ANn}$	0.0	gCOD/m ³
COD lost in anaerobic reatcor	S_{F,ANn^*}	0.0	gCOD/m ³
Fermentable COD for AN reactor	$S_{F,i,conv}$	0.0	gCOD/m ³
DO in influent	$SO_{2,i}$	0.0	mgO ₂ /l
PO ₄ release AN reactor	$S_{PO4,rel}$	0.0	gP/m ³
P removal by PAOs	ΔP_{PAO}	0.0	gP/m ³
P removal by OHOs	ΔP_{OHO}	1.1	gP/m ³
P removal by endgeneous biomass	ΔP_{XE}	1.9	gP/m ³
P removal by influent inert mass	ΔP_{XI}	3.5	gP/m ³
P into sludge production	P_s	5.8	gP/m ³
Potential P removal by system	$\Delta P_{SYS,POT}$	12.3	gP/m ³
Actual P removal by system	$\Delta P_{SYS,ACT}$	10.0	gP/m ³
Effluent particulate P from TSS	$X_{P,e}$	0.0	gP/m ³
Influent total P	P_i	10.0	gP/m ³
Effluent total P	P_{e^*}	0.0	gP/m ³
P precipitated	P_{prec}	0.0	mgP/l
Precipitation chemical	B_{Alum}	0.0	lb/d
Precipitation chemical	Solution	0.0	gal/d
Density Alum	Z_{AL}^{3+}	0.100	lbAL/lbP _{prec}
Density Iron	Z_{FE}^{3+}	0.077	lbFE/lbP _{prec}
Alum efficiency	-	40.0	g/kg
Chemical precipitation sludge	-	0.0	lb/d

Mechanical Process Calculation

Tank Dimensions	Quantity / Trains	Length	Width	Dia.	Degree	Height	Liquid level	Volume per train	Volume Total	Volume Total
Anaerob	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Anoxic I	1	10.00 ft	10.00 ft	.00 ft	0.0	12.00 ft	9.00 ft	6,732 gal	6,732 gal	25.5 m3
Aerobic	1	10.00 ft	10.00 ft	.00 ft	0.0	12.00 ft	10.50 ft	7,854 gal	7,854 gal	29.7 m3
Anoxic II	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Anoxic Buffer	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Membrane	1	10.00 ft	10.00 ft	.00 ft	0.0	12.00 ft	10.50 ft	7,854 gal	7,854 gal	29.7 m3
Sludge	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
EQ	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3

Tank Design	Symbol	Value	Units	
Total process tank volume	22,440	gallons	Weir level	1.9 inches
Total process tank volume _{calc}	20,384	gallons	Weir length	1.0 ft
Un aerated tank percentage	30	%	Velocity	1.31 fps
Total tank volume	22,440	gallons	Vertical tank	0
Membrane modules volume	823	gallons	Horz. Tank	0
F/M _{used,BOD}	0.071	kgBOD/kgMLSS	Diameter	0 ft
F/M _{used,COD}	0.142	kgCOD/kgMLSS		

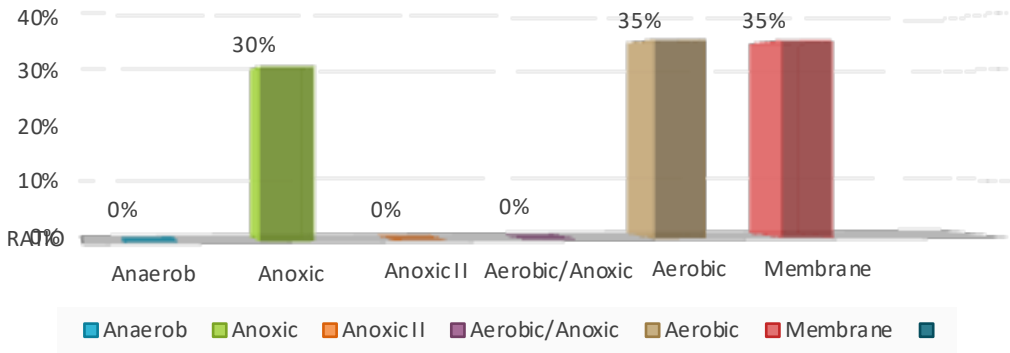

Process Volume Distribution


Air Flow Design	Symbol	Membrane per train	Aerobic per train	Sludge	EQ	Unit
Minimum air flow	$Q_{A, re}$	143	97	0	0	acfm / scfm
Chosen air flow - actual	$Q_{A, chosen}$	144	89	0	0	acfm
Chosen air flow - inlet	$Q_{A, chosen}$	273	168	0	0	m ³ /h
Chosen air flow - inlet	$Q_{A, chosen}$	161	99	0	0	scfm
Chosen air flow - piping	$Q_{A, chosen}$	113	68	0	0	acfm
Pipe pressure	p_b	6.0	6.5	0.0	0.0	psi
Pipe losses	H	0.25	0.73	0.00	0.00	psi
Equivalent length in pipe losses	L_p	400	400	400	400	feet
Pipe diameter	d	3.0	2.0	3.0	3.0	inches
Internal pipe diameter	d_i	3.26	2.16	3.26	3.26	inches
Standard temperature	T_1	293	293	293	293	K
Pipe temperature	T_2	324	326	293	293	K
Constant	f	0.02	0.02	0.09	0.09	-
Air velocity	v	32.5	44.7	0.0	0.0	fps
Atmospheric pressure	$p_{a, l}$	14.2	14.2	14.2	14.2	psi
Absolute pressure	p_2	20.2	20.7	14.2	14.2	psi
Pressure due to tank liquid level	$p_{DWD, m}$	3.9	4.4	0.0	0.0	psi
Pressure due to aeration device	p_{DWD}	0.7	0.5	0.5	0.5	psi
Pressure due to pipe losses & elev.	$p_{DWD, s}$	0.8	1.3	0.6	0.6	psi
Total pipe losses	p_t	5.5	6.2	1.1	1.1	psi
Total pipe losses	p_t	376.8	426.7	75.8	75.8	mbar

$$H = 9.82 \cdot 10^{-8} \cdot \frac{(f \cdot L_p \cdot T_2 \cdot Q_{A, chosen})}{(p_2 d_i)^5}$$

$$f = \frac{(0.029 \cdot d_i^{0.027})}{Q_{A, chosen}^{0.148}} \quad T_2 = T_1 \left(\frac{p_2}{p_{a, l}} \right)^{0.283}$$




Membrane Bioreactor Technology applying A3's patented
MaxFlow Plate Ultrafiltration Membrane Modules

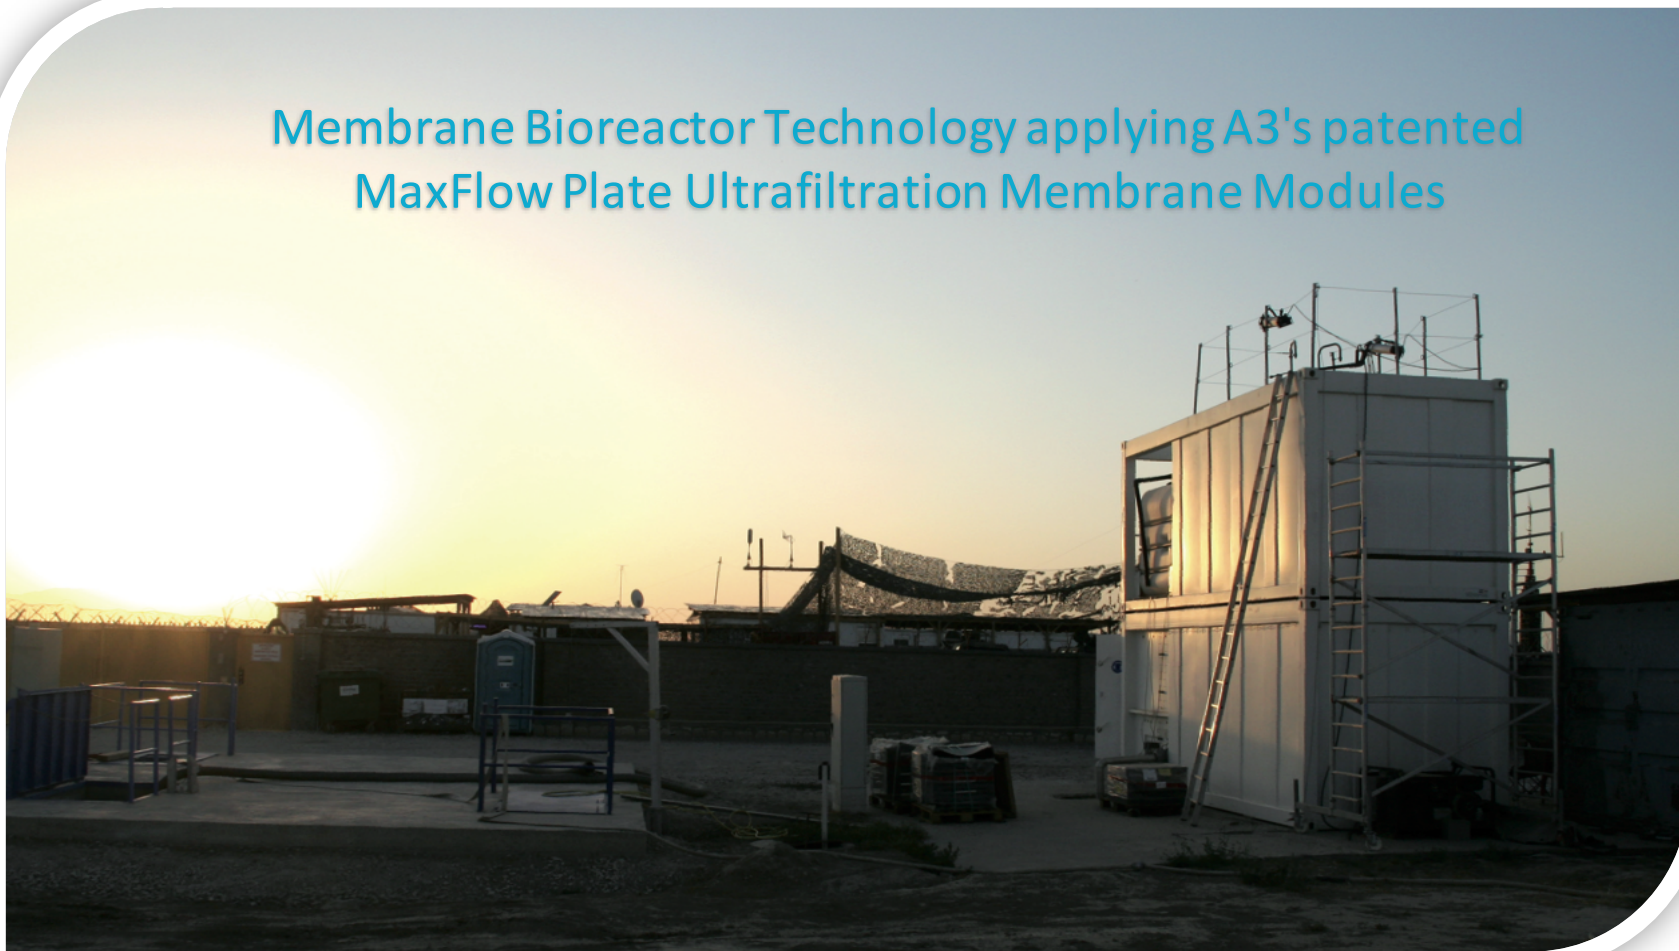


Process Summary

Influent & Effluent Parameters

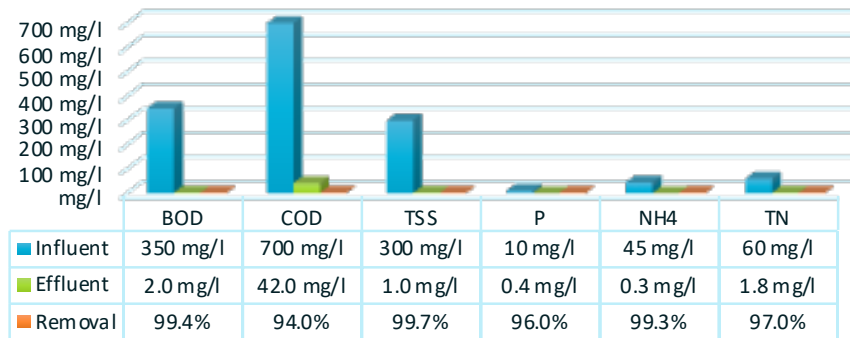

PROCESS PARAMETERS

Sludge Age	25 d
Total Reactor Volume	162,480 gal
Total SOR	1,616 kgO2/d
MLSS in Anoxic / Aerobic Tank	7,733 mg/l
MLSS in Membrane Tank	9,940 mg/l
HRT	16 h
F/M RATIO (BOD)	0.072
F/M RATIO (COD)	0.145
Total Membrane Surface	68,006 sf

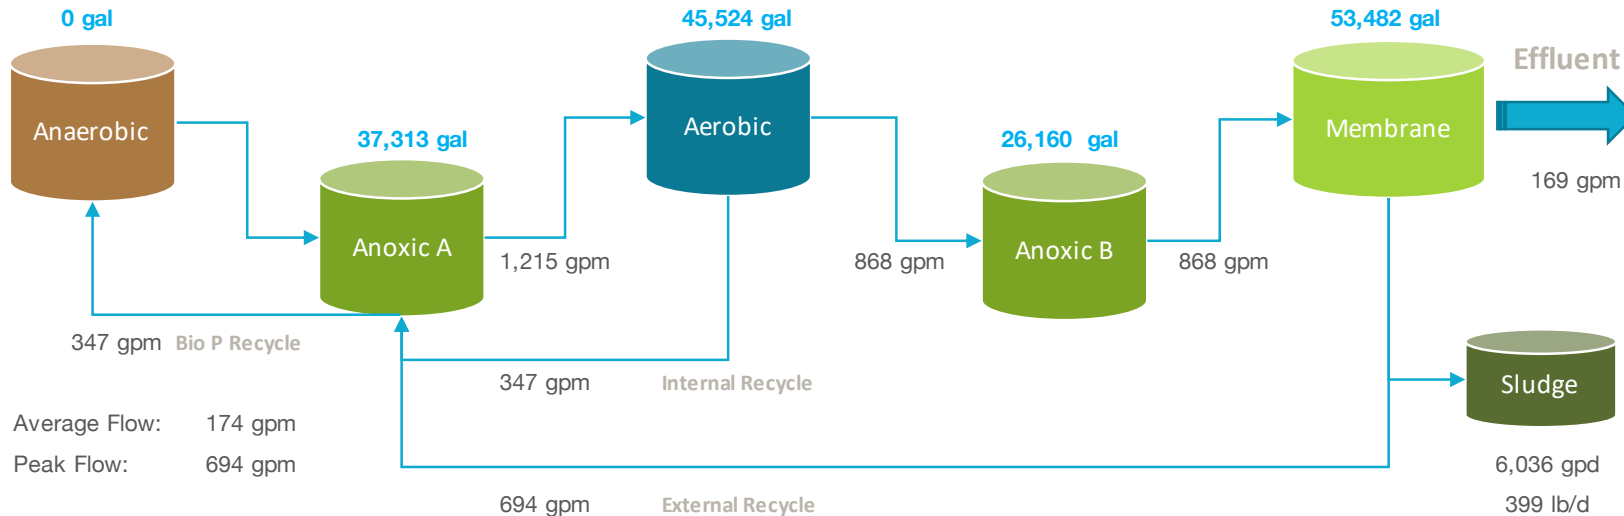

Aeration	Flow	Pressure
EQ	0 scfm	0.0 psi
Sludge	0 scfm	0.0 psi
Aerobic	543 scfm	8.0 psi
Membrane	765 scfm	8.0 psi

Applied Options:

NO	DAF
NO	RO

5/8/24

Biological Process Calculation

Influent Charateristics	Symbol	Value	Units
Type of wastewater		municipal	
Temperature	T	20	°C
pH	-	7.5	-
H ₂ CO ₃ alkalinity	Alk _i	7	mg/l as CaCO ₃
Site pressure / elevation	p _{a,i}	14.5	psi
Average daily flow	Q _i	250,000	gpd
Peak daily flow	Q _{i, max,d}	625,000	gpd
Hourly peak flow	Q _{i, max,p}	694	gpm
Peak factor	-	4.0	-
Average daily flow	Q _i	946	m ³ /d
Max. monthly average daily flow	Q _{i, max,d}	2,366	m ³ /d
Hourly peak flow	Q _{i, max,h}	157.7	m ³ /h
Total BOD	S _{BOD,i}	350	mgBOD/l
Total COD	S _{COD,i}	700	mgCOD/l
COD/BOD ratio	-	2.00	-
Rapidly biodegradable COD	S _{s,i}	175	mgCOD/l
Volitale fatty acids (VFA)	S _{VFA,i}	26	mgCOD/l
Fermentable COD	S _{F,i}	149	mgCOD/l
Slowly biodegradable COD	S _{ss,i}	378	mgCOD/l
Biodegradable COD	S _{bio,i}	553	mgCOD/l
Soluble inert COD	S _{SIN,i}	42	mgCOD/l
Particulate inert COD	S _{PIN,i}	105	mgCOD/l


Influent Charateristics	Symbol	Value	Units
NO ₃	N _{NO3,i}	0.0	mg/l
NH ₄	N _{a,i}	45.0	mg/l
TKN	N _{TKN,i}	60.0	mg/l
TP	P _i	10.0	mg/l
Dissolved Oxygen	S _{O2,i}	0.0	mg/l
FSA fraction	f _{a/TKN,i}	0.8	-
Fixed (inorganic) suspended solids	X _{FSS,i}	47.5	mgISS/l
TSS concentration	S _{TSS,i}	300.0	mgTSS/l
Total BOD mass	FS _{BOD,i}	331.2	kgBOD/d
Total COD mass	FS _{COD,i}	662.4	kgCOD/d
Total NH ₄ mass	FS _{a,i}	42.6	kgNH ₄ /d
Total TKN mass	FS _{TKN,i}	56.8	kgTKN/d
Total P mass	FS _{P,i}	9.5	kgP/d

Effluent Characteristics	Symbol	Value	Units
Waste Sludge	FX _t	399	lb/d
Waste Sludge	Q _w	6,036	gpd
Effluent BOD	S _{BOD,e}	< 3	mgBOD/l
Effluent COD	S _{COD,e}	42	mgCOD/l
Effluent TSS	S _{TSS,e}	1.0	mgTSS/l
Effluent P	P _e	0.4	mgP/l
Effluent NH ₄	N _{a,e}	0.3	mgN/l
Effluent NO ₃	N _{NO3,e}	0.0	mgN/l
Effluent TN (N _{ne} + N _{te})	N _{t,e}	1.8	mgN/l

Bioreactor Characteristics	Symbol	Value	Units	Biological Oxygen Demand	Symbol	Value	Units
Temperature	T_{bio}	20	°C	OD for synth & endo respiration (PAO)	FO_{PAO}	0	kgO ₂ /d
Sludge retention time / Sludge age	SRT	25	d	OD for synth & endo respiration (OHO)	FO_{OHO}	425	kgO ₂ /d
Reactor volume	$V_{P,chosen}$	162,480	gallons	Mass carbonaceous oxygen demand	FO_C	425	kgO ₂ /d
Reactor volume	$V_{P,chosen}$	615	m ³	Carbonaceous oxygen utilization rate	O_c	69%	-
Reactor volume	$V_{P,calc}$	150,903	gallons	Nitrification oxygen demand	FO_n	178	kgO ₂ /d
Average MLSS concentration	X_{TSS}	8,000	mgTSS/l	Total oxygen demand	FO_t	604	kgO ₂ /d
Food to microorganism ratio	$F/M_{BOD,used}$	0.072	kgBOD/kgMLSS	Oxygen recovered by denitrification	FO_d	112	kgO ₂ /d
Food to microorganism ratio	$F/M_{COD,used}$	0.145	kgCOD/kgMLSS	Net total oxygen demand (AOR)	FO_{td}	492	kgO ₂ /d
Membrane tank MLSS concentration	X_M	9,940	mgTSS/l	Oxygen saturation @ operating temp.	c_s	9.2	mg/l
Aerobic/Anoxic tank MLSS concentration	X_{Bio}	7,733	mgTSS/l	Desired oxygen level	c_x	2.0	mg/l
Number of anaerobic zones	$\#_{AN}$	0	-	Transfer coefficient	α	0.40	-
Number of anoxic zones	$\#_{AO}$	1	-	Diffuser water depth	DWD	13.5	feet
Number of aerobic zones	$\#_{AE}$	1	-	Oxygen transfer efficiency	OTE	2	%
External recycle ratio	m	4	-	Standard total oxygen demand (SOR)	SOR	1,616	kgO ₂ /d
Internal recycle ratio	a	2	-	Required air flow	Q_{air}	537	scfm
DO in m recycle	O_m	1	mgO ₂ /l	Oxygen requir. per volume & depth	OS	17.9	gO ₂ /(Nm ₃ *mD)
DO in a recycle	O_a	0	mgO ₂ /l				
Recycle ratio to anaerobic tank (PAO)	s	0	-				
DO in s recycle	$S_{O_2,s}$	0	mgO ₂ /l				
Nitrate on s recycle	$S_{NO_3,s}$	0	mg/l				
TKN/COD ratio	$f_{TKN/COD}$	0.086	mgTKN/mgCOD				
Carbon source addition (Micro C)	B_{MicroC}	0.0	lb/d				
Carbon source addition (Micro C)	S_{MicroC}	0.00	gpd				
Nominal hydraulic retention time	HRT_n	15.6	h				
Actual hydraulic retention time	HRT_a	2.2	h				

Membrane Module Design

	Symbol	Value	Units
Permeate on cycle	T_o	8	minute
Permeate off cycle (relaxation)	T_s	2	minute
Effective membrane module surface	$A_{m,eff}$	87.8	m ²
Effective membrane module surface	$A_{m,eff}$	945	ft ²
Total number of membrane modules	N_M	72	-
Total membrane module surface	A_{total}	6,318	m ²
Total membrane module surface	A_{total}	68,006	ft ²
Nominal average daily flux	$Q_{ave,n}$	7.8	lmh
Nominal max. daily flux	$Q_{ave,n,max,mo}$	19.5	lmh
Nominal peak hourly flux	$Q_{peak,n}$	31.2	lmh
Average daily flux (excluding rest cycle)	$Q_{ave,n}$	3.7	gfd
Max. Daily flux (ex. rest cycle)	$Q_{ave,n,max,mo}$	9.2	gfd
Peak hourly flux (ex. rest cycle)	$Q_{peak,n}$	14.7	gfd
Total membrane module displacement vol.	$V_{modules}$	792	ft ³
Total membrane module displacement vol.	$V_{modules}$	5,924	gallons
Aeration modules	$A\#$	24	-
Membrane module aeration requirement	Q_{am}	28.5	acfm
Total membrane modules aeration	$Q_{am,total}$	684	acfm
Membrane diffuser water depth	DWD_m	13.0	feet
Oxygen requirement per volume & depth	OS	13	gO ₂ /(Nm ₃ *m _D)
Standard oxygen rate, membrane aeration	SOR_m	3,248	lbO ₂ /d
Standard oxygen rate, membrane aeration	SOR_m	1,488	kgO ₂ /d

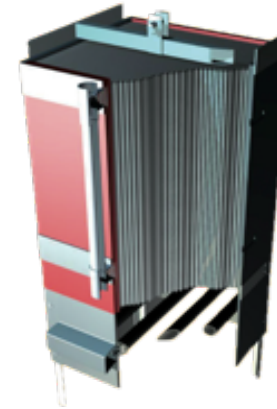

- ✓ Patented, innovative A3's MaxFlow™ membrane filtration modules manufactured in USA.
- ✓ The MaxFlow™ module "open channel design" provides optimal biofilm control, minimizes the quantity of chemical cleaning procedures and avoids module clogging.
- ✓ The compact module design enables dual-stack and triple-stack installations. It allows for a high membrane packing density resulting in a small footprint and high energy efficiency.
- ✓ Most existing conventional treatment plants can be retrofitted with MaxFlow™ membranes due to the


Kinetic Constants	Symbol	Value	Units	Stoichiometric Constants	Symbol	Value	Units
Yield coefficient OHO	Y_{OHO}	0.40	mgVSS/mgCOD	COD/BOD ratio	-	2.00	-
Yield coefficient OHO,OBS	$Y_{OHO,obs}$	0.06	mgVSS/mgCOD	Readily biodeg. org. fraction (RBCOD)	$f_{s,COD}$	0.25	g/gTCOD
Fermentation rate at 20°C	$k_{F,20}$	0.06	m3/gVSSd	Non-biodegradable particulate COD	$f_{PNb,COD}$	0.15	g/gTCOD
Temperature coefficient for $k_{F,T}$	Θ_{kF}	1.029	-	Non-biodegradable soluble COD	$f_{SNb,COD}$	0.06	g/gTCOD
Fermentation rate at T	$k_{F,T}$	0.06	m3/gVSSd	SVFA fraction of RBCOD	$f_{SVFA,SSI}$	0.15	g/gCOD _{SS}
Endogenous respiration rate (decay)	$b_{OHO,20}$	0.24	gVSS/gVSSd	VSS/TSS of activated sludge	f_{VT}	0.73	mgVSS/mgTSS
Endogenous respiration rate T	$b_{OHO,T}$	0.24	gVSS/gVSSd	COD/VSS of activated sludge	f_{cv}	1.48	kgCOD/kgVSS
Yield coefficient FSA	Y_A	0.10	mgVSS/mgFSA	True synthesis fraction	f_s^0	0.57	-
Nitri. pH sensitivity coefficient	K_I	1.13	-	Endogenous residue fraction	$f_{H/E,OHO}$	0.2	-
Nitri. pH sensitivity coefficient	K_{max}	9.50	-	ISS content of OHOs	$f_{ISS,OHO}$	0.15	-
Nitri. pH sensitivity coefficient	K_{II}	0.30	-	Active fraction - VSS	f_{avOHO}	23%	-
Max. specific growth rate at 20°C	μ_{Am}	0.45	1/d	Active fraction - TSS	f_{at}	16%	-
Max. spec. growth rate - Temp/pH	μ_{AmTpH}	0.44	1/d	Influent FSA fraction	$f_{FSA,i}$	0.75	-
Half saturation coefficient	K_n	0.75	mgFSA/l	Non-bio. soluble orgN fraction (inerts)	$f_{SNb,N}$	0.025	-
Half saturation coefficient - Temp	K_{nT}	0.75	mgFSA/l	Non-bio. particulate orgN fraction	f_n	0.12	-
Endogenous respiration rate (decay)	b_A	0.04	1/d	Permissible unaer. sludge mass fraction	f_{xm}	0.78	-
Temperature coefficient for $k_{F,T}$	θ_n	1.123	-	Design unaerated sludge mass fraction	f_{xt}	0.39	-
Endogenous respiration rate T	b_{AT}	0.040	1/d	Minimum primary anoxic mass fraction	f_{x1min}	0.04	-
Temperature sensitivity coefficient	Θ_{nk1}	1.20	-	Primary anoxic mass fraction	f_{x1}	0.23	-
Temperature sensitivity coefficient	Θ_{nk2}	1.05	-	Secondary anoxic mass fraction	f_{x2}	0.16	-
Temperature sensitivity coefficient	Θ_{nk3}	1.03	-	Anaerobic mass fraction	f_{AN}	0.00	-
Denitrification rates at 20°C	k_1	0.70	-	Non-bio. particulate orgP fraction	$f_{P,XE,OHO}$	0.05	mgP/mgVSS
Denitrification rates at 20°C	k_2	0.10	-	Endogenous residue fraction	$f_{XE,PAO}$	0.25	gEVSS/gAVSS
Denitrification rates at 20°C	k_3	0.08	-	P fraction in active PAO mass	$f_{P,PAO}$	0.38	gP/gAVSS
Denitrification rates	k_{1T}	0.700	-	VSS/TSS ratio for PAO active mass	$f_{VT,PAO}$	0.46	gVSS/gTSS
Denitrification rates	k_{2T}	0.101	-	Ratio of P release /VFA uptake	$f_{PO4,REL}$	0.5	gP/gCOD
Denitrification rates	k_{3T}	0.080	-	Frac. of fixed inorganic s. solids of PAO	$f_{FSS,PAO}$	1.3	gFSS/gAVSS
Yield coefficient PAO	Y_{PAO}	0.45	gAVSS/gCOD	P content of TSS	$f_{P,TSS}$	0.037	gP/gTSS
Yield coefficient PAO	$Y_{PAO,obs}$	0.20	gAVSS/gCOD	P content of VSS	$f_{P,FSS,i}$	0.02	gP/gVSS
Endogenous respiration rate (decay)	$b_{PAO,20}$	0.04	gEVSS/gCOD	TKN/COD ratio	f_{ns}	0.09	mgTKN/mgCOD
Temperature coefficient for $k_{F,T}$	$\Theta_{b,PAO}$	1.029	-	Nitrogen content of active biomass	$f_{N,VSS}$	0.10	gN/gAVSS
Endogenous respiration rate T	$b_{PAO,T}$	0.04	gEVSS/gVSSd				

Biological Mass Balance

	Symbol	Value	Units
Sludge age	SRT	25 d	
Mixed liquor suspended solids	X _{TSS}	8,000 mgTSS/l	
Readable biodegradable COD flux	FS _{S,i}	166 kgCOD/d	
Daily flux of VFAs	FS _{VFA,i}	25 kgCOD/d	
Daily flux of fermentable COD	FS _{F,i}	141 kgCOD/d	
Daily flux of biodegradable COD	FS _{bio,i}	523 kgCOD/d	
Daily flux of particulate inert COD	FS _{PIN,i}	99 kgCOD/d	
Daily flux of fixed inorganic sus. solids	FS _{ISS,i}	45 kgISS/d	
Influent particulate non-bio. COD	FX _{VSS,i}	67 kgVSS/d	
Mass nitrogen into sludge prod.	FN _{Sludge}	16 kgN/d	
Mass of nitrate generated per day	FN _{NO3}	39 kgN/d	
VFAs stored by PAOs	FS _{S,PAO}	0 kgCOD/d	
Remaining biodegradable COD	FCOD _{b,OH0}	523 kgCOD/d	
Mass nitrifiers	MX _A	49 kgVSS	
Active biomass PAO	MX _{PAO}	0 KgAVSS	
Endogenous active biomass PAO	MX _{E,PAO}	0 kgEVSS	
Bio mass	MX _{bio}	752 kgVSS	
Active organism mass	MX _{OH0}	752 kgVSS	
Endogenous residue mass	MX _{E,OH0}	902 kgVSS	
Non-biodegradable particulate mass	MX _{Iv}	1,678 kgVSS	
Volatile suspended solids mass	MX _{VSS}	3,333 kgVSS	
Inorganic suspended solid mass	MX _{ISS}	1,236 kgISS	
Total suspended solids mass	MX _{TSS}	4,569 kgTSS	
Mass/Sludge TSS wasted	FX _t	183 KgTSS/d	
Mass/Sludge VSS wasted	FX _v	133 kgVSS/d	
Effluent COD	S _{COD,e}	42 mgCOD/l	
COD mass out (effluent and waste)	FS _{COD,e}	40 kgCOD/d	
Mass/Sludge COD wasted	FX _{COD,s}	197 kgCOD/d	

Alkalinity

	Symbol	Value	Units
Alkalinity Nitrification as CaCO ₃ (consumed)	Alk _{Nitri}	295 mg/l as CaCO ₃	
Alkalinity Denitrification as CaCO ₃ (recovered)	Alk _{Denitri}	148 mg/l as CaCO ₃	
Alkalinity _{ef}	Alk _e	100 mg/l as CaCO ₃	
Alkalinity _{inf}	Alk _i	7 mg/l as CaCO ₃	
Alkalinity Alum (consumed)	Alk _{Alum}	0.0 mg/l as CaCO ₃	
Alkalinity _{Total}	Alk _{total}	-139 mg/l as CaCO ₃	
Alkalinity _{Added}	Alk _{added}	239 mg/l as CaCO ₃	
Alkalinity _{Added}	XAlk _{added}	494 lb/d	
Density caustic solution (50%)	-	12.76 lb/gal	
Alkalinity _{recovered}	Alk _{recovered}	0.4 lbCaCO ₃ /lb	
Caustic _{needed}	-	197.7 lb/d	
Caustic _{needed}	-	15.5 gpd	

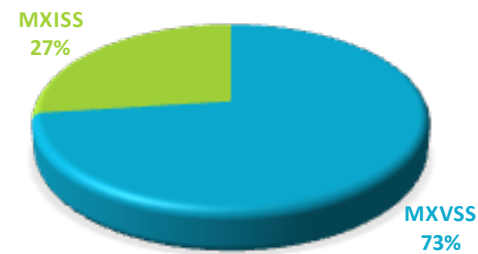

$$MX_{TSS} = MX_{ISS} + MX_{VSS}$$

$$V_p = \frac{MX_{TSS}}{X_{TSS}}$$

$$FX_t = \frac{MX_{TSS}}{SRT}$$

N Removal

	Symbol	Value	Units
Factor of safety	S_f	1.2	-
Nitrogen requirements	FN_{synth}	13	kgN/d
Nitrogen requirements	$TKN_{i,\text{synth}}$	14.09	gN/m ³
Influent non-bio. soluble organic N	$N_{\text{nbios},i}$	1.5	mgN/l
Influent non-bio. particulate org. N	$N_{\text{nbio},i}$	8.5	mgN/l
Influent biodegradable organic N	$N_{\text{bio},i}$	13.5	mgN/l
Effluent non-bio. soluble organic N	$N_{\text{nbios},e}$	1.5	mgN/l
NH ₄ concentration avail. for nitr.	N_{an}	41.6	mgN/l
Effluent ammonia	$N_{\text{a},e}$	0.3	mgN/l
Effluent TKN	$N_{\text{TKN},e}$	1.8	mgN/l
N concentration into sludge prod.	N_s	16.9	mgN/l
Nitrification capacity	N_c	41.3	mgN/l
Denitrification potential RBCOD	$D_{p1\text{RBCOD}}$	24.7	mgNO ₃ -N/l
Denitrification potential SBCOD	$D_{p1\text{SBCOD}}$	18.4	mgNO ₃ -N/l
Denitrification potential RBCOD	$D_{p3\text{RBCOD}}$	0.0	mgNO ₃ -N/l
Denitrification potential SBCOD	$D_{p3\text{SBCOD}}$	10.2	mgNO ₃ -N/l
Minimum sludge age for nitr.	SRT_m	4.4	d
Denitrification potential primary tank	D_{p1}	43.2	mgN/l
Denitrification potential secondary tank	D_{p3}	10.2	mgN/l
Denitri. potential recycle rate ($f_{xm} = f_{xdm}$)	D_{p^*}	36.8	mgN/l
Effluent nitrate	$N_{\text{NO}_3,e}$	0.0	mgN/l
Effluent nitrate @ f_{xdm} & recycle rate	N_{NO_3,e^*}	5.9	mgN/l


P Removal

	Symbol	Value	Units
COD lost in anaerobic reactor	$S_{F,ANn}$	0.0	gCOD/m ³
COD lost in anaerobic reactor	S_{F,ANn^*}	0.0	gCOD/m ³
Fermentable COD for AN reactor	$S_{F,I,\text{conv}}$	0.0	gCOD/m ³
DO in influent	$S_{O_2,i}$	0.0	mgO ₂ /l
PO ₄ release AN reactor	$S_{PO_4,\text{rel}}$	0.0	gP/m ³
P removal by PAOs	ΔP_{PAO}	0.0	gP/m ³
P removal by OHOs	ΔP_{OHO}	0.8	gP/m ³
P removal by endogenous biomass	ΔP_{XE}	1.9	gP/m ³
P removal by influent inert mass	ΔP_{XI}	3.5	gP/m ³
P into sludge production	P_s	5.2	gP/m ³
Potential P removal by system	$\Delta P_{\text{SYS,POT}}$	11.5	gP/m ³
Actual P removal by system	$\Delta P_{\text{SYS,ACT}}$	10.0	gP/m ³
Effluent particulate P from TSS	$X_{P,e}$	0.0	gP/m ³
Influent total P	P_i	10.0	gP/m ³
Effluent total P	P_{e^*}	0.0	gP/m ³
P precipitated	P_{prec}	0.0	mgP/l
Precipitation chemical	B_{Alum}	0.0	lb/d
Precipitation chemical	Solution	0.0	gal/d
Density Alum	Z_{AL}^{3+}	0.100	lb _{AL} /lb _{prec}
Density Iron	Z_{FE}^{3+}	0.077	lb _{FE} /lb _{prec}
Alum efficiency	-	40.0	g/kg
Chemical precipitation sludge	-	0.0	lb/d

Mechanical Process Calculation

Tank Dimensions	Trains	Length	Width	Dia.	Degree	Height	Liquid level	Volume per train	Volume Total	Volume Total
Anaerobic	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Anoxic I	1	33.00 ft	10.00 ft	.00 ft	0.0	17.50 ft	15.12 ft	37,313 gal	37,313 gal	141.2 m3
Aerobic	1	41.00 ft	10.00 ft	.00 ft	0.0	17.50 ft	14.84 ft	45,524 gal	45,524 gal	172.3 m3
Anoxic II	1	24.00 ft	10.00 ft	.00 ft	0.0	17.50 ft	14.57 ft	26,160 gal	26,160 gal	99.0 m3
Anoxic Buffer	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Membrane	1	50.00 ft	10.00 ft	.00 ft	0.0	17.50 ft	14.30 ft	53,482 gal	53,482 gal	202.4 m3
Sludge	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
EQ	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3

Tank Design	Symbol	Value	Units
Total process tank volume	162,480	gallons	Weir level 3.3 inches
Total process tank volume _{calc}	150,903	gallons	Weir length 5.0 ft
Unaerated tank percentage	39	%	Velocity 1.71 fps
Total tank volume	162,480	gallons	Vertical tank 0
Membrane modules volume	5,924	gallons	Horz. Tank 0
F/M _{used,BOD}	0.072	kgBOD/kgMLSS	Diameter 0 ft
F/M _{used,COD}	0.145	kgCOD/kgMLSS	

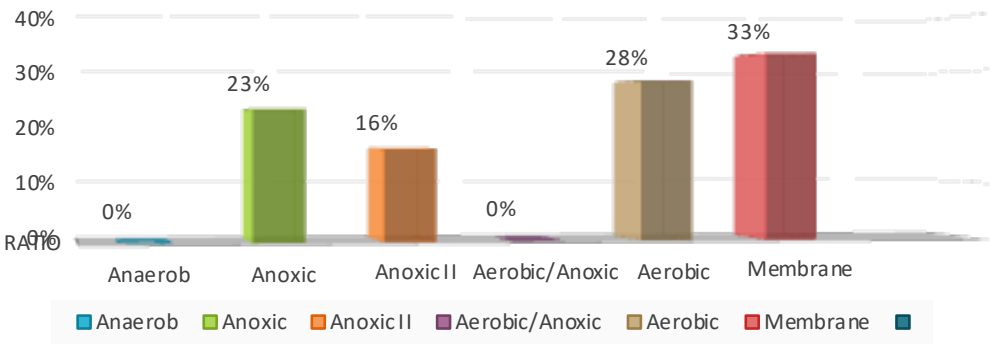

Process Volume Distribution


Air Flow Design	Symbol	Membrane per train	Aerobic per train	Sludge	EQ	Unit
Minimum air flow	$Q_{A,re}$	684	537	0	0	acfm / scfm
Chosen air flow - actual	$Q_{A, chosen}$	685	501	0	0	acfm
Chosen air flow - inlet	$Q_{A,chosen}$	1,300	923	0	0	m ³ /h
Chosen air flow - inlet	$Q_{A,chosen}$	765	543	0	0	scfm
Chosen air flow - piping	$Q_{A,chosen}$	493	350	0	0	acfm
Pipe pressure	p_b	8.0	8.0	0.0	0.0	psi
Pipe losses	H	0.19	0.10	0.00	0.00	psi
Equivalent length in pipe losses	L_p	600	600	400	400	feet
Pipe diameter	d	6.0	6.0	4.0	3.0	inches
Internal pipe diameter	d_i	6.36	6.36	4.26	3.26	inches
Standard temperature	T_1	293	293	293	293	K
Pipe temperature	T_2	332	332	293	293	K
Constant	f	0.02	0.02	0.09	0.09	-
Air velocity	v	37.3	26.5	0.0	0.0	fps
Atmospheric pressure	$p_{a,1}$	14.5	14.5	14.5	14.5	psi
Absolute pressure	p_2	22.5	22.5	14.5	14.5	psi
Pressure due to tank liquid level	$p_{DWD,m}$	5.7	6.2	0.0	0.0	psi
Pressure due to aeration device	p_{DWD}	0.7	0.5	0.5	0.5	psi
Pressure due to pipe losses & elev.	$p_{DWD,s}$	0.6	0.5	0.4	0.4	psi
Total pipe losses	p_t	6.9	7.2	0.9	0.9	psi
Total pipe losses	p_t	479.0	499.5	62.1	62.1	mbar

$$H = 9.82 \cdot 10^{-8} \cdot \frac{(f \cdot L_p \cdot T_2 \cdot Q_{A,chosen})}{(p_2 d_i)^5}$$

$$f = \frac{(0.029 \cdot d_i^{0.027})}{Q_{A,chosen}^{0.148}} \quad T_2 = T_1 \left(\frac{p_2}{p_{a,1}} \right)^{0.283}$$




Membrane Bioreactor Technology applying A3's patented
MaxFlow Plate Ultrafiltration Membrane Modules

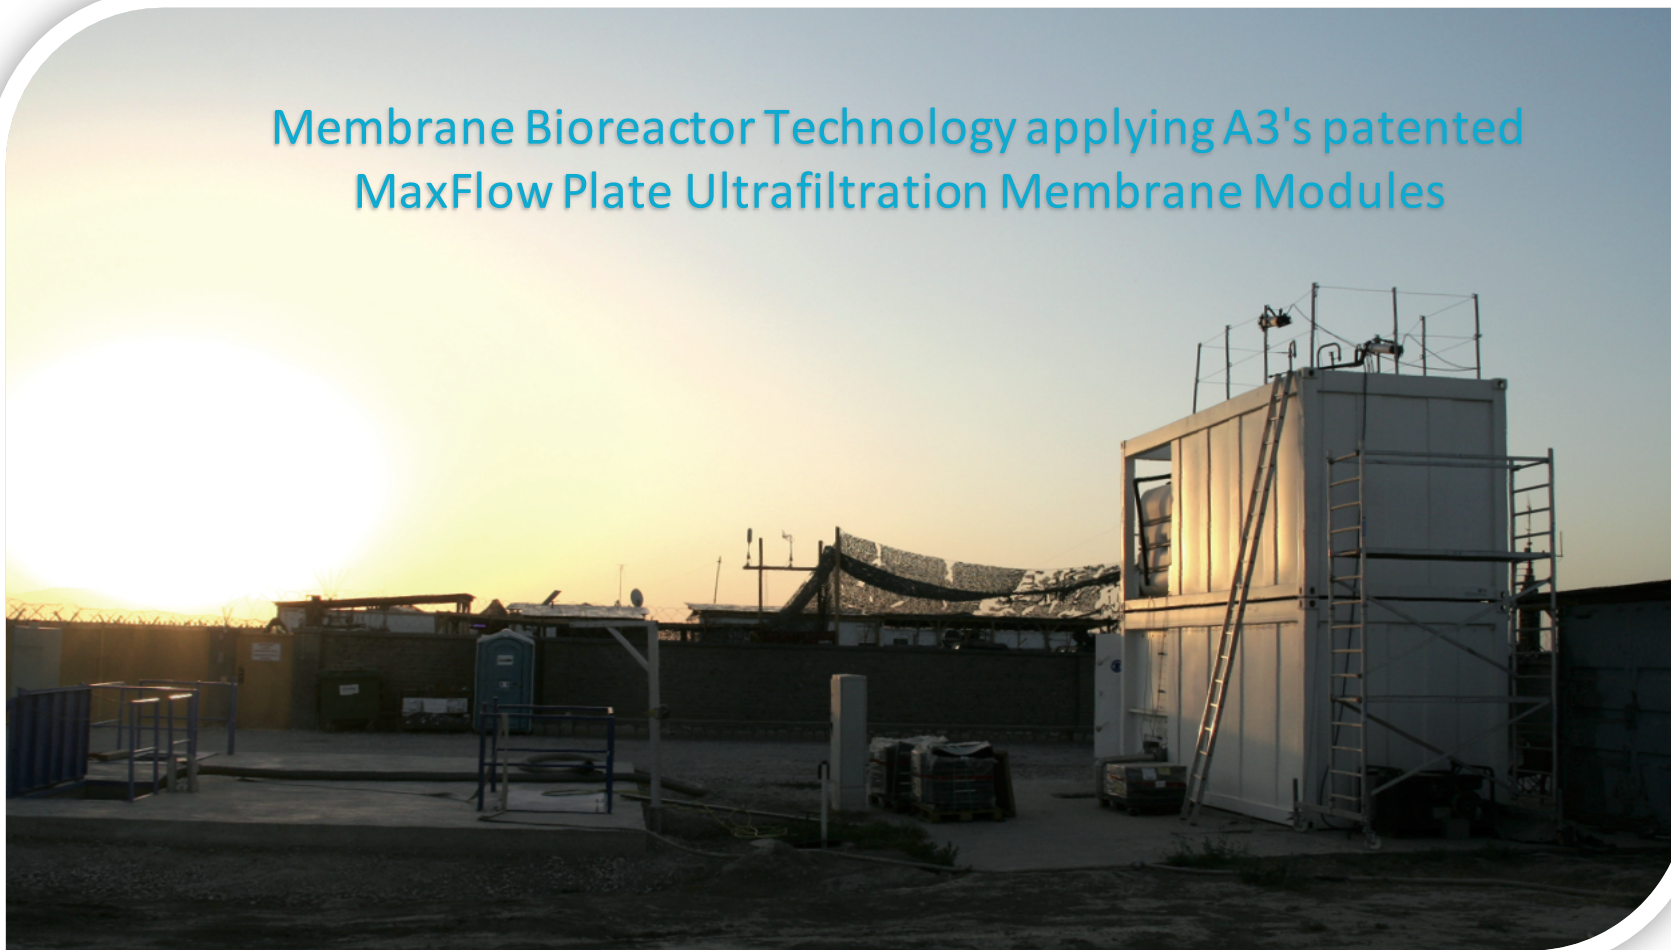


Process Summary

Influent & Effluent Parameters

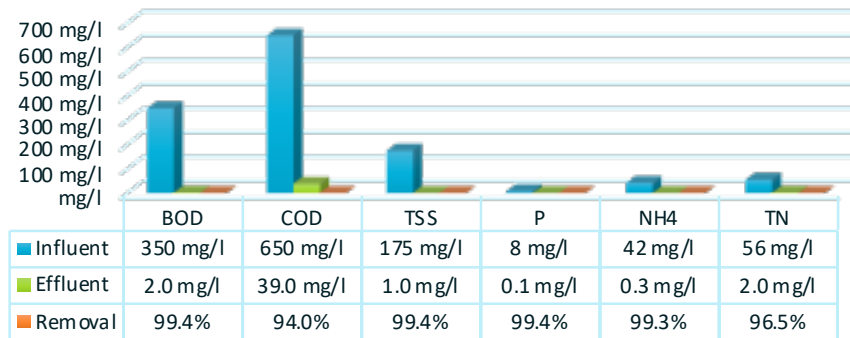

PROCESS PARAMETERS

Sludge Age	36 d
Total Reactor Volume	310,240 gal
Total SOR	3,062 kgO2/d
MLSS in Anoxic / Aerobic Tank	10,696 mg/l
MLSS in Membrane Tank	13,696 mg/l
HRT	15 h
F/M RATIO (BOD)	0.056
F/M RATIO (COD)	0.104
Total Membrane Surface	101,267 sf

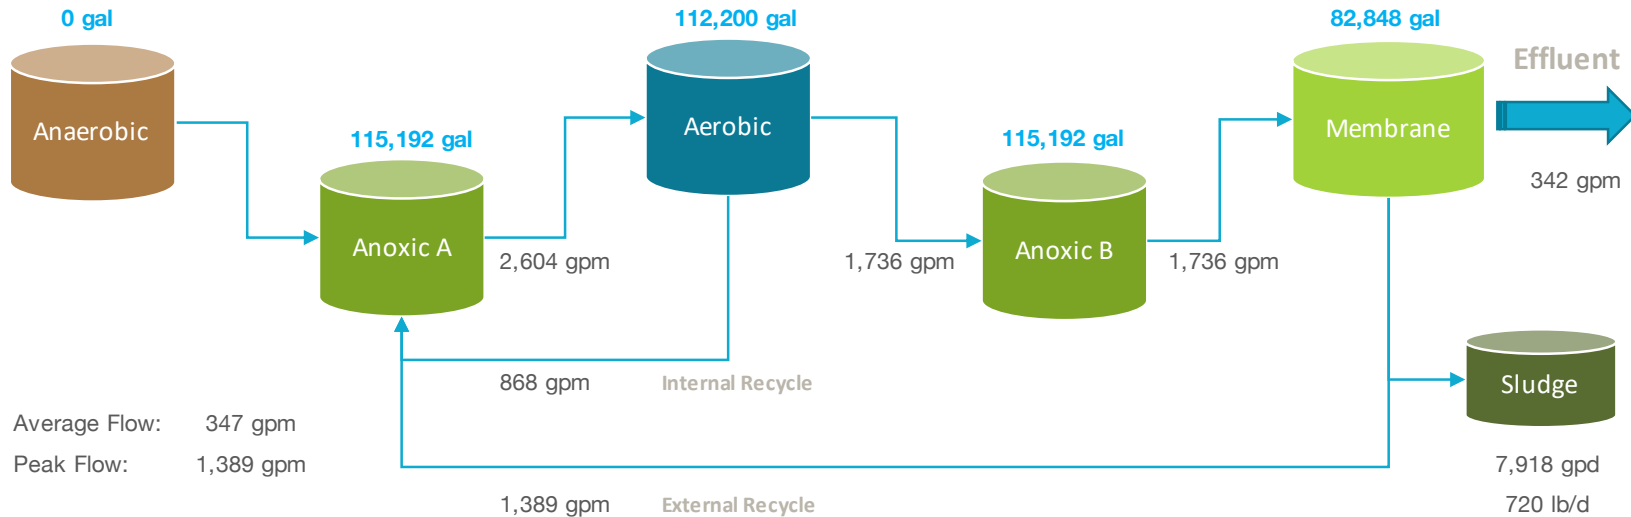

Aeration	Flow	Pressure
EQ	0 scfm	0.0 psi
Sludge	0 scfm	0.0 psi
Aerobic	777 scfm	10.0 psi
Membrane	849 scfm	8.5 psi

Applied Options:

475

NO	DAF
NO	RO

1/12/21

Biological Process Calculation

Influent Charateristics

	Symbol	Value	Units
Type of wastewater		municipal	
Temperature	T	20	°C
pH	-	7.0	-
H ₂ CO ₃ alkalinity	Alk _i	250	mg/l as CaCO ₃
Site pressure / elevation	p _{a,i}	14.5	psi
Average daily flow	Q _i	500,000	gpd
Peak daily flow	Q _{i, max,d}	1,250,000	gpd
Hourly peak flow	Q _{i, max,p}	1,389	gpm
Peak factor	-	4.0	-
Average daily flow	Q _i	1,893	m ³ /d
Max. monthly average daily flow	Q _{i, max,d}	4,731	m ³ /d
Hourly peak flow	Q _{i, max,h}	315.4	m ³ /h
Total BOD	S _{BOD,i}	350	mgBOD/l
Total COD	S _{COD,i}	650	mgCOD/l
COD/BOD ratio	-	1.86	-
Rapidly biodegradable COD	S _{s,i}	163	mgCOD/l
Volitale fatty acids (VFA)	S _{VFA,i}	25	mgCOD/l
Fermentable COD	S _{F,i}	138	mgCOD/l
Slowly biodegradable COD	S _{ss,i}	351	mgCOD/l
Biodegradable COD	S _{bio,i}	514	mgCOD/l
Soluble inert COD	S _{SIN,i}	39	mgCOD/l
Particulate inert COD	S _{PIN,i}	98	mgCOD/l

Influent Charateristics

	Symbol	Value	Units
NO ₃	N _{NO3,i}	0	mg/l
NH ₄	N _{a,i}	42.0	mg/l
TKN	N _{TKN,i}	56.0	mg/l
TP	P _i	8.0	mg/l
Dissolved Oxygen	S _{O2,i}	0.0	mg/l
FSA fraction	f _{a/TKN,i}	0.8	-
Fixed (inorganic) suspended solids	X _{FSS,i}	47.5	mgISS/l
TSS concentration	S _{TSS,i}	175.0	mgTSS/l
Total BOD mass	FS _{BOD,i}	662.4	kgBOD/d
Total COD mass	FS _{COD,i}	1,230.1	kgCOD/d
Total NH ₄ mass	FS _{a,i}	79.5	kgNH ₄ /d
Total TKN mass	FS _{TKN,i}	106.0	kgTKN/d
Total P mass	FS _{P,i}	15.1	kgP/d

Effluent Characteristics

	Symbol	Value	Units
Waste Sludge	FX _t	720	lb/d
Waste Sludge	Q _w	7,918	gpd
Effluent BOD	S _{BOD,e}	< 3	mgBOD/l
Effluent COD	S _{COD,e}	39	mgCOD/l
Effluent TSS	S _{TSS,e}	1.0	mgTSS/l
Effluent P	P _e	0.05	mgP/l
Effluent NH ₄	N _{a,e}	0.3	mgN/l
Effluent NO ₃	N _{NO3,e}	0.0	mgN/l
Effluent TN (N _{ne} + N _{te})	N _{t,e}	2.0	mgN/l

Bioreactor Characteristics

	Symbol	Value	Units
Temperature	T_{bio}	20	°C
Sludge retention time / Sludge age	SRT	36	d
Reactor volume	$V_{P,chosen}$	310,240	gallons
Reactor volume	$V_{P,chosen}$	1,174	m ³
Reactor volume	$V_{P,calc}$	285,043	gallons
Average MLSS concentration	X_{TSS}	11,000	mgTSS/l
Food to microorganism ratio	$F/M_{BOD,used}$	0.056	kgBOD/kgMLSS
Food to microorganism ratio	$F/M_{COD,used}$	0.104	kgCOD/kgMLSS
Membrane tank MLSS concentration	X_M	13,696	mgTSS/l
Aerobic/Anoxic tank MLSS concentration	X_{Bio}	10,696	mgTSS/l
Number of anaerobic zones	$\#_{AN}$	0	-
Number of anoxic zones	$\#_{AO}$	2	-
Number of aerobic zones	$\#_{AE}$	1	-
External recycle ratio	m	4	-
Internal recycle ratio	a	2.5	-
DO in m recycle	O_m	2	mgO ₂ /l
DO in a recycle	O_a	1	mgO ₂ /l
Recycle ratio to anaerobic tank (PAO)	s	0	-
DO in s recycle	$S_{O2,s}$	0	mgO ₂ /l
Nitrate on s recycle	$S_{NO3,s}$	0	mg/l
TKN/COD ratio	$f_{TKN/COD}$	0.086	mgTKN/mgCOD
Carbon source addition (Micro C)	B_{MicroC}	0.0	lb/d
Carbon source addition (Micro C)	S_{MicroC}	0.00	gpd
Nominal hydraulic retention time	HRT _n	14.9	h
Actual hydraulic retention time	HRT _a	2.0	h

Biological Oxygen Demand

	Symbol	Value	Units
OD for synth & endo respiration (PAO)	FO_{PAO}	0	kgO ₂ /d
OD for synth & endo respiration (OHO)	FO_{OHO}	806	kgO ₂ /d
Mass carbonaceous oxygen demand	FO_C	806	kgO ₂ /d
Carbonaceous oxygen utilization rate	O_c	69%	-
Nitrification oxygen demand	FO_n	339	kgO ₂ /d
Total oxygen demand	FO_t	1,145	kgO ₂ /d
Oxygen recovered by denitrification	FO_d	213	kgO ₂ /d
Net total oxygen demand (AOR)	FO_{td}	932	kgO ₂ /d
Oxygen saturation @ operating temp.	C_s	9.2	mg/l
Desired oxygen level	C_x	2.0	mg/l
Transfer coefficient	α	0.40	-
Diffuser water depth	DWD	18	feet
Oxygen transfer efficiency	OTE	2	%
Standard total oxygen demand (SOR)	SOR	3,062	kgO ₂ /d
Required air flow	Q_{air}	763	scfm
Oxygen requir. per volume & depth	OS	17.9	gO ₂ /(Nm ₃ *mD)

Membrane Module Design

	Symbol	Value	Units
Permeate on cycle	T_o	8	minute
Permeate off cycle (relaxation)	T_s	2	minute
Effective membrane module surface	$A_{m,eff}$	84.0	m ²
Effective membrane module surface	$A_{m,eff}$	904	ft ²
Total number of membrane modules	N_M	112	-
Total membrane module surface	A_{total}	9,408	m ²
Total membrane module surface	A_{total}	101,267	ft ²
Nominal average flux	$Q_{ave,n}$	10.5	lmh
Nominal monthly max. average flux	$Q_{ave,n,max,mo}$	26.2	lmh
Nominal peak flux (including duty cycles)	$Q_{peak,n}$	41.9	lmh
Average flux (excluding rest cycle)	$Q_{ave,n}$	4.9	gfd
Monthly max. average flux (ex. rest cycle)	$Q_{ave,n,max,mo}$	12.3	gfd
Peak flux (including duty cycles)	$Q_{peak,n}$	19.7	gfd
Total membrane module displacement vol.	$V_{modules}$	1,232	ft ³
Total membrane module displacement vol.	$V_{modules}$	9,215	gallons
Aeration modules	$A\#$	28	-
Membrane module aeration requirement	Q_{am}	28.5	acfm
Total membrane modules aeration	$Q_{am,total}$	798	acfm
Membrane diffuser water depth	DWD_m	16.5	feet
Oxygen requirement per volume & depth	OS	13	gO ₂ /(Nm ₃ *m _D)
Standard oxygen rate, membrane aeration	SOR_m	4,810	lbO ₂ /d
Standard oxygen rate, membrane aeration	SOR_m	2,203	kgO ₂ /d



- ✓ Patented, innovative A3's MaxFlow™ membrane filtration modules manufactured in USA.
- ✓ The MaxFlow™ module "open channel design" provides optimal biofilm control, minimizes the quantity of chemical cleaning procedures and avoids module clogging.
- ✓ The compact module design enables dual-stack and triple-stack installations. It allows for a high membrane packing density resulting in a small footprint and high energy efficiency.
- ✓ Most existing conventional treatment plants can be retrofitted with MaxFlow™ membranes due to the


Kinetic Constants	Symbol	Value	Units	Stoichiometric Constants	Symbol	Value	Units
Yield coefficient OHO	Y_{OHO}	0.40	mgVSS/mgCOD	COD/BOD ratio	-	1.86	-
Yield coefficient OHO,OBS	$Y_{OHO,obs}$	0.04	mgVSS/mgCOD	Readily biodeg. org. fraction (RBCOD)	$f_{s,COD}$	0.25	g/gTCOD
Fermentation rate at 20°C	$k_{F,20}$	0.06	m3/gVSSd	Non-biodegradable particulate COD	$f_{PNb,COD}$	0.15	g/gTCOD
Temperature coefficient for $k_{F,T}$	θ_{kF}	1.029	-	Non-biodegradable soluble COD	$f_{SNb,COD}$	0.06	g/gTCOD
Fermentation rate at T	$k_{F,T}$	0.06	m3/gVSSd	SVFA fraction of RBCOD	$f_{SVFA,SSI}$	0.15	g/gCOD _{ss}
Endogenous respiration rate (decay)	$b_{OHO,20}$	0.24	gVSS/gVSSd	VSS/TSS of activated sludge	f_{VT}	0.71	mgVSS/mgTSS
Endogenous respiration rate T	$b_{OHO,T}$	0.24	gVSS/gVSSd	COD/VSS of activated sludge	f_{cv}	1.5	kgCOD/kgVSS
Yield coefficient FSA	Y_A	0.10	mgVSS/mgFSA	True synthesis fraction	f_s^0	0.57	-
Nitri. pH sensitivity coefficient	K_I	1.13	-	Endogenous residue fraction	$f_{H/E,OHO}$	0.2	-
Nitri. pH sensitivity coefficient	K_{max}	9.50	-	ISS content of OHOs	$f_{ISS,OHO}$	0.15	-
Nitri. pH sensitivity coefficient	K_{II}	0.30	-	Active fraction - VSS	f_{avOHO}	17%	-
Max. specific growth rate at 20°C	μ_{Am}	0.45	1/d	Active fraction - TSS	f_{at}	12%	-
Max. spec. growth rate - Temp/pH	μ_{AmTpH}	0.38	1/d	Influent FSA fraction	$f_{FSA,i}$	0.75	-
Half saturation coefficient	K_n	0.75	mgFSA/l	Non-bio. soluble orgN fraction (inerts)	$f_{SNb,N}$	0.03	-
Half saturation coefficient - Temp	K_{nT}	0.75	mgFSA/l	Non-bio. particulate orgN fraction	f_n	0.12	-
Endogenous respiration rate (decay)	b_A	0.04	1/d	Permissible unaer. sludge mass fraction	f_{xm}	0.79	-
Temperature coefficient for $k_{F,T}$	θ_n	1.123	-	Design unaerated sludge mass fraction	f_{xt}	0.37	-
Endogenous respiration rate T	b_{AT}	0.040	1/d	Minimum primary anoxic mass fraction	f_{x1min}	0.03	-
Temperature sensitivity coefficient	θ_{nk1}	1.20	-	Primary anoxic mass fraction	f_{x1}	0.37	-
Temperature sensitivity coefficient	θ_{nk2}	1.05	-	Secondary anoxic mass fraction	f_{x2}	0.00	-
Temperature sensitivity coefficient	θ_{nk3}	1.03	-	Anaerobic mass fraction	f_{AN}	0.00	-
Denitrification rates at 20°C	k_1	0.70	-	Non-bio. particulate orgP fraction	$f_{P,XE,OHO}$	0.05	mgP/mgVSS
Denitrification rates at 20°C	k_2	0.10	-	Endogenous residue fraction	$f_{XE,PAO}$	0.25	gEVSS/gAVSS
Denitrification rates at 20°C	k_3	0.08	-	P fraction in active PAO mass	$f_{P,PAO}$	0.38	gP/gAVSS
Denitrification rates	k_{1T}	0.700	-	VSS/TSS ratio for PAO active mass	$f_{VT,PAO}$	0.46	gVSS/gTSS
Denitrification rates	k_{2T}	0.101	-	Ratio of P release /VFA uptake	$f_{PO4,REL}$	0.5	gP/gCOD
Denitrification rates	k_{3T}	0.080	-	Frac. of fixed inorganic s. solids of PAO	$f_{FSS,PAO}$	1.3	gFSS/gAVSS
Yield coefficient PAO	Y_{PAO}	0.45	gAVSS/gCOD	P content of TSS	$f_{P,TSS}$	0.051	gP/gTSS
Yield coefficient PAO	$Y_{PAO,obs}$	0.16	gAVSS/gCOD	P content of VSS	$f_{P,FSS,i}$	0.05	gP/gVSS
Endogenous respiration rate (decay)	$b_{PAO,20}$	0.04	gEVSS/gCOD	TKN/COD ratio	f_{ns}	0.09	mgTKN/mgCOD
Temperature coefficient for $k_{F,T}$	$\theta_{b,PAO}$	1.029	-	Nitrogen content of active biomass	$f_{N,VSS}$	0.10	gN/gAVSS
Endogenous respiration rate T	$b_{PAO,T}$	0.04	gEVSS/gVSSd				

Biological Mass Balance

	Symbol	Value	Units
Sludge age	SRT	36 d	
Mixed liquor suspended solids	X _{TSS}	11,000 mgTSS/l	
Readable biodegradable COD flux	FS _{S,i}	308 kgCOD/d	
Daily flux of VFAs	FS _{VFA,i}	46 kgCOD/d	
Daily flux of fermentable COD	FS _{F,i}	261 kgCOD/d	
Daily flux of biodegradable COD	FS _{bio,i}	972 kgCOD/d	
Daily flux of particulate inert COD	FS _{PIN,i}	185 kgCOD/d	
Daily flux of fixed inorganic sus. solids	FS _{ISS,i}	90 kgISS/d	
Influent particulate non-bio. COD	FX _{VSS,i}	123 kgVSS/d	
Mass nitrogen into sludge prod.	FN _{Sludge}	28 kgN/d	
Mass of nitrate generated per day	FN _{NO3}	74 kgN/d	
VFAs stored by PAOs	FS _{S,PAO}	0 kgCOD/d	
Remaining biodegradable COD	FCOD _{b,OHo}	972 kgCOD/d	
Mass nitrifiers	MX _A	109 kgVSS	
Active biomass PAO	MX _{PAO}	0 KgAVSS	
Endogenous active biomass PAO	MX _{E,PAO}	0 kgEVSS	
Bio mass	MX _{bio}	1,460 kgVSS	
Active organism mass	MX _{OHo}	1,460 kgVSS	
Endogenous residue mass	MX _{E,OHo}	2,524 kgVSS	
Non-biodegradable particulate mass	MX _{Iv}	4,428 kgVSS	
Volatile suspended solids mass	MX _{VSS}	8,413 kgVSS	
Inorganic suspended solid mass	MX _{ISS}	3,455 kgISS	
Total suspended solids mass	MX _{TSS}	11,868 kgTSS	
Mass/Sludge TSS wasted	FX _t	330 KgTSS/d	
Mass/Sludge VSS wasted	FX _v	234 kgVSS/d	
Effluent COD	S _{COD,e}	39 mgCOD/l	
COD mass out (effluent and waste)	FS _{COD,e}	74 kgCOD/d	
Mass/Sludge COD wasted	FX _{COD,s}	351 kgCOD/d	

Alkalinity

	Symbol	Value	Units
Alkalinity Nitrification as CaCO ₃ (consumed)	Alk _{Nitri}	280 mg/l as CaCO ₃	
Alkalinity Denitrification as CaCO ₃ (recovered)	Alk _{Denitri}	141 mg/l as CaCO ₃	
Alkalinity _{ef}	Alk _e	100 mg/l as CaCO ₃	
Alkalinity _{inf}	Alk _i	250 mg/l as CaCO ₃	
Alkalinity Alum (consumed)	Alk _{Alum}	0.0 mg/l as CaCO ₃	
Alkalinity _{Total}	Alk _{total}	111 mg/l as CaCO ₃	
Alkalinity _{Added}	Alk _{added}	-11 mg/l as CaCO ₃	
Alkalinity _{Added}	XAlk _{added}	0 lb/d	
Density caustic solution (50%)	-	12.76 lb/gal	
Alkalinity _{recovered}	Alk _{recovered}	0.4 lbCaCO ₃ /lb	
Caustic _{needed}	-	0.0 lb/d	
Caustic _{needed}	-	0.0 gpd	

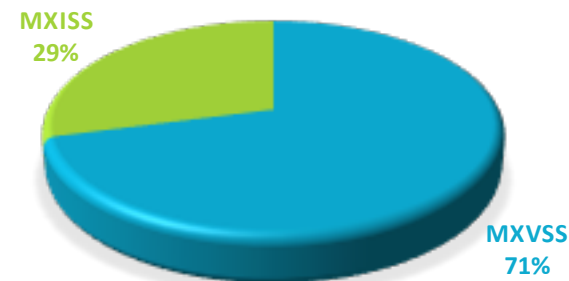

$$MX_{TSS} = MX_{ISS} + MX_{VSS}$$

$$V_p = \frac{MX_{TSS}}{X_{TSS}}$$

$$FX_t = \frac{MX_{TSS}}{SRT}$$

N Removal

	Symbol	Value	Units
Factor of safety	S_f	1.2	-
Nitrogen requirements	FN_{synth}	23	kgN/d
Nitrogen requirements	$TKN_{i,\text{synth}}$	12.35	gN/m ³
Influent non-bio. soluble organic N	$N_{\text{nbios},i}$	1.68	mgN/l
Influent non-bio. particulate org. N	$N_{\text{nbio},i}$	7.8	mgN/l
Influent biodegradable organic N	$N_{\text{bio},i}$	12.3	mgN/l
Effluent non-bio. soluble organic N	$N_{\text{nbios},e}$	1.68	mgN/l
NH ₄ concentration avail. for nitri.	N_{an}	39.5	mgN/l
Effluent ammonia	$N_{\text{a},e}$	0.3	mgN/l
Effluent TKN	$N_{\text{TKN},e}$	2.0	mgN/l
N concentration into sludge prod.	N_s	14.8	mgN/l
Nitrification capacity	N_c	39.2	mgN/l
Denitrification potential RBCOD	$D_{p1\text{RBCOD}}$	22.5	mgNO ₃ -N/l
Denitrification potential SBCOD	$D_{p1\text{SBCOD}}$	28.9	mgNO ₃ -N/l
Denitrification potential RBCOD	$D_{p3\text{RBCOD}}$	0.0	mgNO ₃ -N/l
Denitrification potential SBCOD	$D_{p3\text{SBCOD}}$	0.0	mgNO ₃ -N/l
Minimum sludge age for nitri.	SRT_m	5.0	d
Denitrification potential primary tank	D_{p1}	51.5	mgN/l
Denitrification potential secondary tank	D_{p3}	0.0	mgN/l
Denitri. potential recycle rate ($f_{xm} = f_{xdm}$)	D_{p^*}	37.6	mgN/l
Effluent nitrate	$N_{\text{NO}_3,e}$	0.0	mgN/l
Effluent nitrate @ f_{xdm} & recycle rate	N_{NO_3,e^*}	5.2	mgN/l

P Removal


	Symbol	Value	Units
COD lost in anaerobic reactor	$S_{F,ANn}$	0.0	gCOD/m ³
COD lost in anaerobic reactor	S_{F,ANn^*}	0.0	gCOD/m ³
Fermentable COD for AN reactor	$S_{F,i,\text{conv}}$	0.0	gCOD/m ³
DO in influent	$S_{O_2,i}$	0.0	mgO ₂ /l
PO ₄ release AN reactor	$S_{PO_4,\text{rel}}$	0.0	gP/m ³
P removal by PAOs	ΔP_{PAO}	0.0	gP/m ³
P removal by OHOs	ΔP_{OHO}	0.6	gP/m ³
P removal by endogeneous biomass	ΔP_{XE}	1.9	gP/m ³
P removal by influent inert mass	ΔP_{XI}	3.3	gP/m ³
P into sludge production	P_s	6.2	gP/m ³
Potential P removal by system	$\Delta P_{\text{SYS,POT}}$	12.0	gP/m ³
Actual P removal by system	$\Delta P_{\text{SYS,ACT}}$	8.0	gP/m ³
Effluent particulate P from TSS	$X_{p,e}$	0.1	gP/m ³
Influent total P	P_i	8.0	gP/m ³
Effluent total P	P_{e^*}	0.1	gP/m ³
P precipitated	P_{prec}	0.0	mgP/l
Precipitation chemical	B_{Alum}	0.0	lb/d
Precipitation chemical	Solution	0.0	gal/d
Density Alum	Z_{AL}^{3+}	0.100	lb _{AL} /lb _{prec}
Density Iron	Z_{FE}^{3+}	0.077	lb _{FE} /lb _{prec}
Alum efficiency	-	40.0	g/kg
Chemical precipitation sludge	-	0.0	lb/d

Mechanical Process Calculation

Tank Dimensions	Quantity / Trains	Length	Width	Dia.	Degree	Height	Liquid level	Volume per train	Volume Total	Volume Total
Anaerob	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Anoxic I	1	20.00 ft	40.00 ft	.00 ft	0.0	21.00 ft	19.25 ft	115,192 gal	115,192 gal	436.0 m3
Aerobic	1	20.00 ft	40.00 ft	.00 ft	0.0	21.00 ft	18.75 ft	112,200 gal	112,200 gal	424.7 m3
Anoxic II	1	20.00 ft	40.00 ft	.00 ft	0.0	21.00 ft	19.25 ft	115,192 gal	115,192 gal	436.0 m3
Anoxic Buffer	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
Membrane	2	16.00 ft	19.50 ft	.00 ft	0.0	21.00 ft	17.75 ft	41,424 gal	82,848 gal	313.6 m3
Sludge	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3
EQ	0	.00 ft	.00 ft	.00 ft	0.0	.00 ft	.00 ft	gal	gal	0.0 m3

Tank Design

	Symbol	Value	Units		
Total process tank volume	310,240	gallons		Weir level	3.4 inches
Total process tank volume _{calc}	285,043	gallons		Weir length	10.0 ft
Unaaerated tank percentage	37	%		Velocity	1.75 fps
Total tank volume	310,240	gallons		Vertical tank	0
Membrane modules volume	9,215	gallons		Horz. Tank	0
F/M _{used,BOD}	0.056	kgBOD/kgMLSS		Diameter	0 ft
F/M _{used,COD}	0.104	kgCOD/kgMLSS			

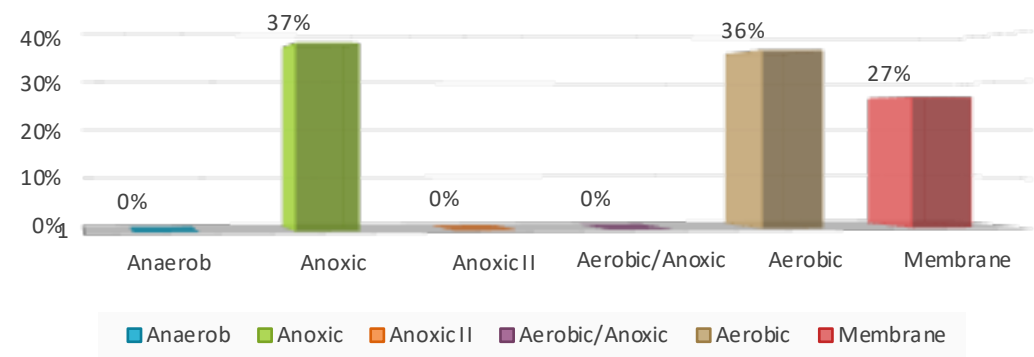

Process Volume Distribution




Air Flow Design	Symbol	Membrane	Aerobic	Sludge	EQ	Unit
Minimum air flow	$Q_{A, re}$	798	763	0	0	acfm / scfm
Chosen air flow - actual	$Q_{A, chosen}$	800	712	0	0	acfm
Chosen air flow - inlet	$Q_{A, chosen}$	1,442	1,321	0	0	m ³ /h
Chosen air flow - inlet	$Q_{A, chosen}$	849	777	0	0	scfm
Chosen air flow - piping	$Q_{A, chosen}$	535	460	0	0	acfm
Pipe pressure	p_b	8.5	10.0	0.0	0.0	psi
Pipe losses	H	0.18	0.13	0.00	0.00	psi
Equivalent length in pipe losses	L_p	500	500	250	250	feet
Pipe diameter	d	6.0	6.0	3.0	2.0	inches
Internal pipe diameter	d_i	6.36	6.36	3.26	2.16	inches
Standard temperature	T_1	293	293	293	293	K
Pipe temperature	T_2	334	340	293	293	K
Constant	f	0.02	0.02	0.09	0.09	-
Air velocity	v	40.5	34.8	0.0	0.0	fps
Atmospheric pressure	$p_{a,1}$	14.5	14.5	14.5	14.5	psi
Absolute pressure	p_2	23.0	24.5	14.5	14.5	psi
Pressure due to tank liquid level	$p_{DWD, m}$	7.2	7.9	0.0	0.0	psi
Pressure due to aeration device	p_{DWD}	0.8	0.7	0.5	0.5	psi
Pressure due to pipe losses & elev.	$p_{DWD, s}$	0.5	0.4	0.3	0.3	psi
Total pipe losses	p_t	8.5	9.1	0.8	0.8	psi
Total pipe losses	p_t	583.5	625.8	55.2	55.2	mbar

$$H = 9.82 \cdot 10^{-8} \cdot \frac{(f \cdot L_p \cdot T_2 \cdot Q_{A, chosen})}{(p_2 d_i)^5}$$

$$f = \frac{(0.029 \cdot d_i^{0.027})}{Q_{A, chosen}^{0.148}} \quad T_2 = T_1 \left(\frac{p_2}{p_{a,1}} \right)^{0.283}$$




See Technical Report
Attachment 5B
Design Calculations
for 30,000 GPD
Treatment

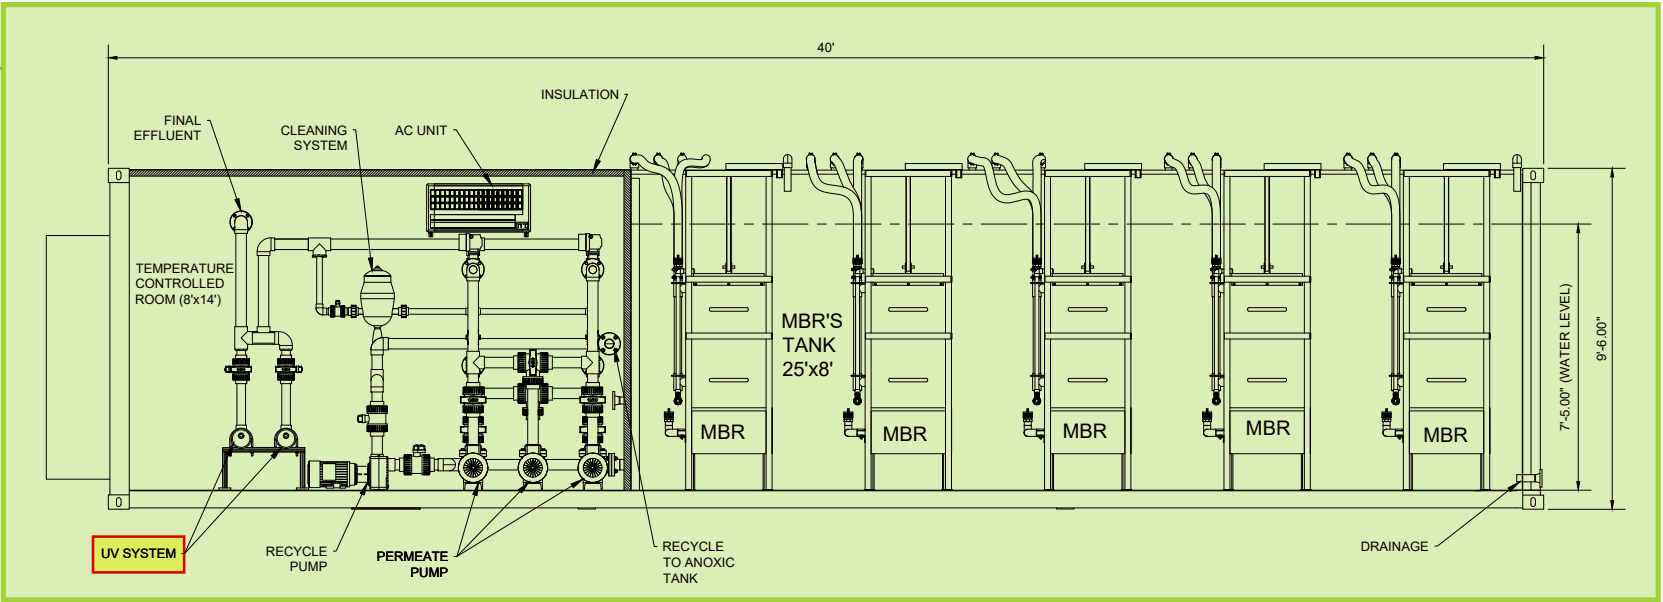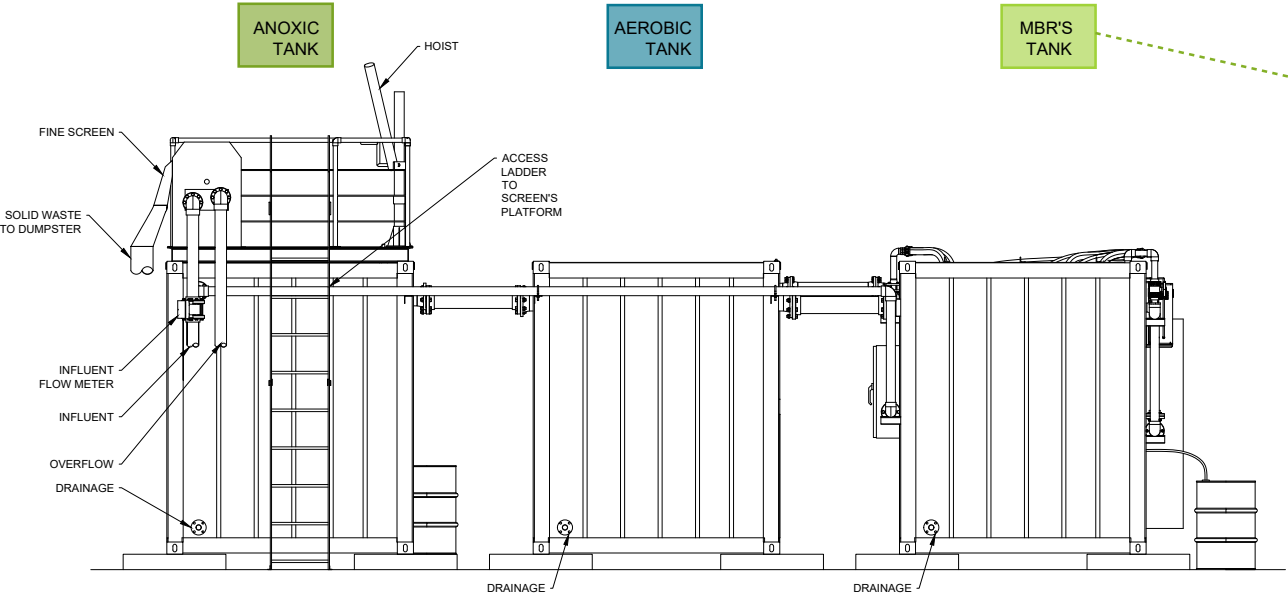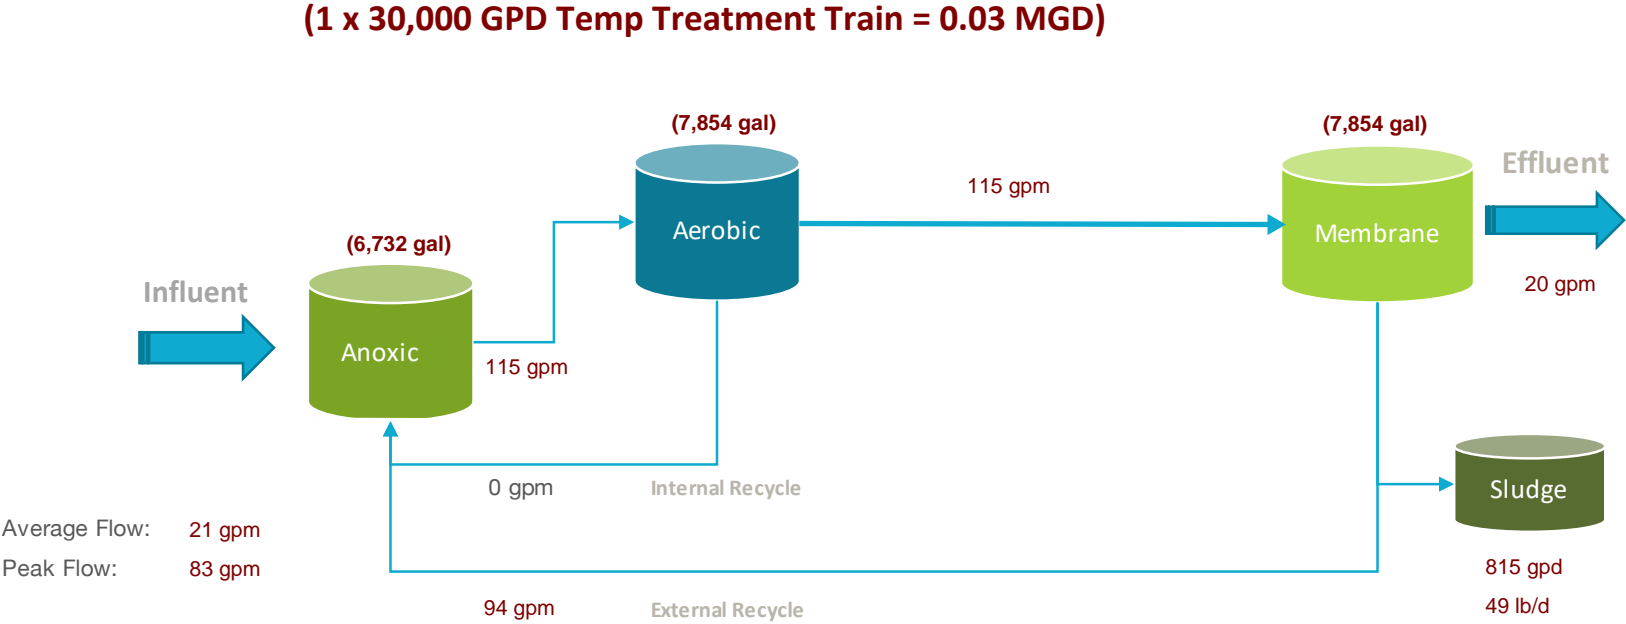

Example of Process Flow/Treatment Process (provided from
design for 80,000 gpd Treatment Plant)

Disclaimer
This drawing was created by A3-USA
for a separate project. It is presented
here for illustrative purposes only.
Sizes and dimensions will vary.



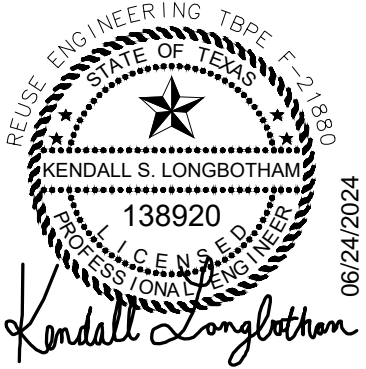


TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS

PROCESS FLOW DIAGRAM
30,000 GPD UNIT
Attachment 1A

The 1.50 MGD Treatment Facility will be comprised of four (4) treatment trains: Two (2) each at 250,000 GPD and Two (2) each at 500,000 GPD


250,000 GPD
Treatment Train:
See 10054
Technical Report
Attachment 5-
Design Calculations

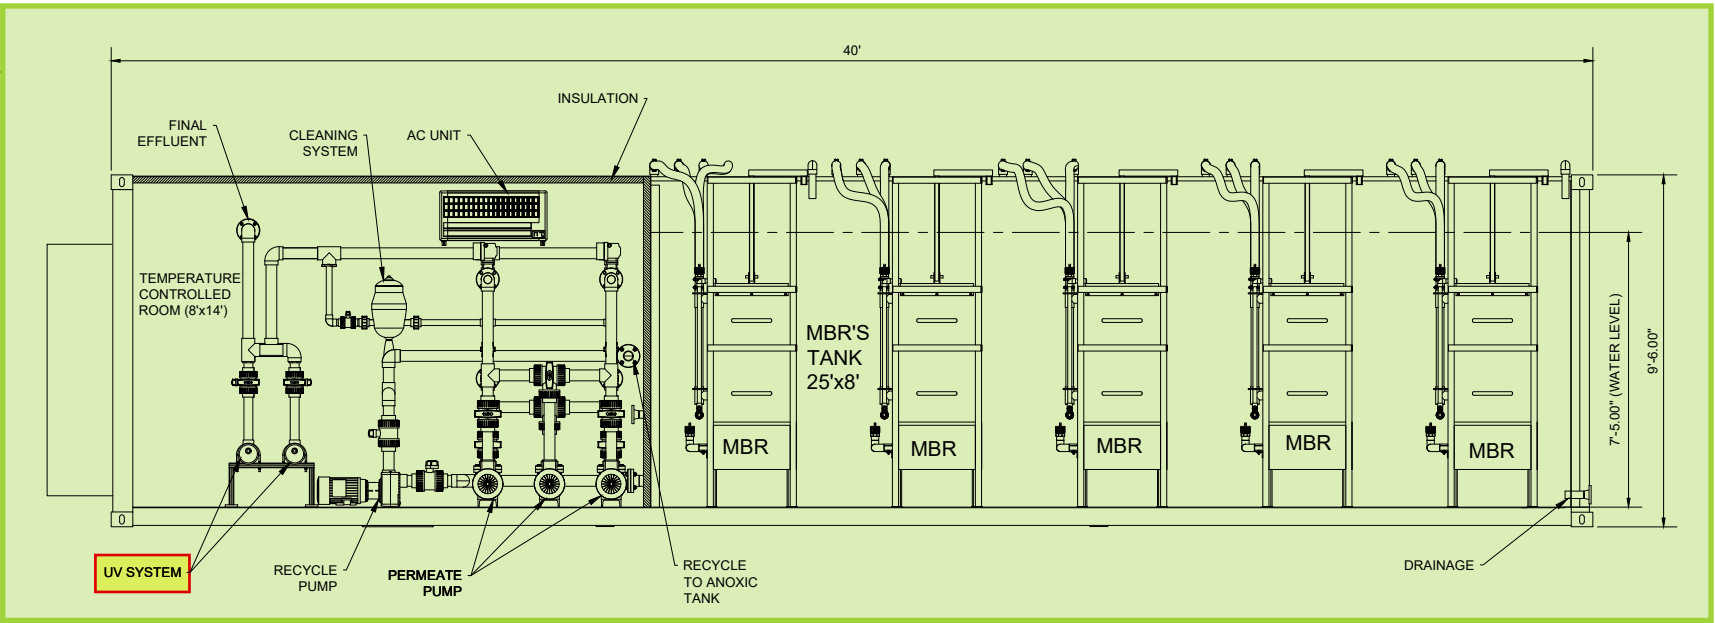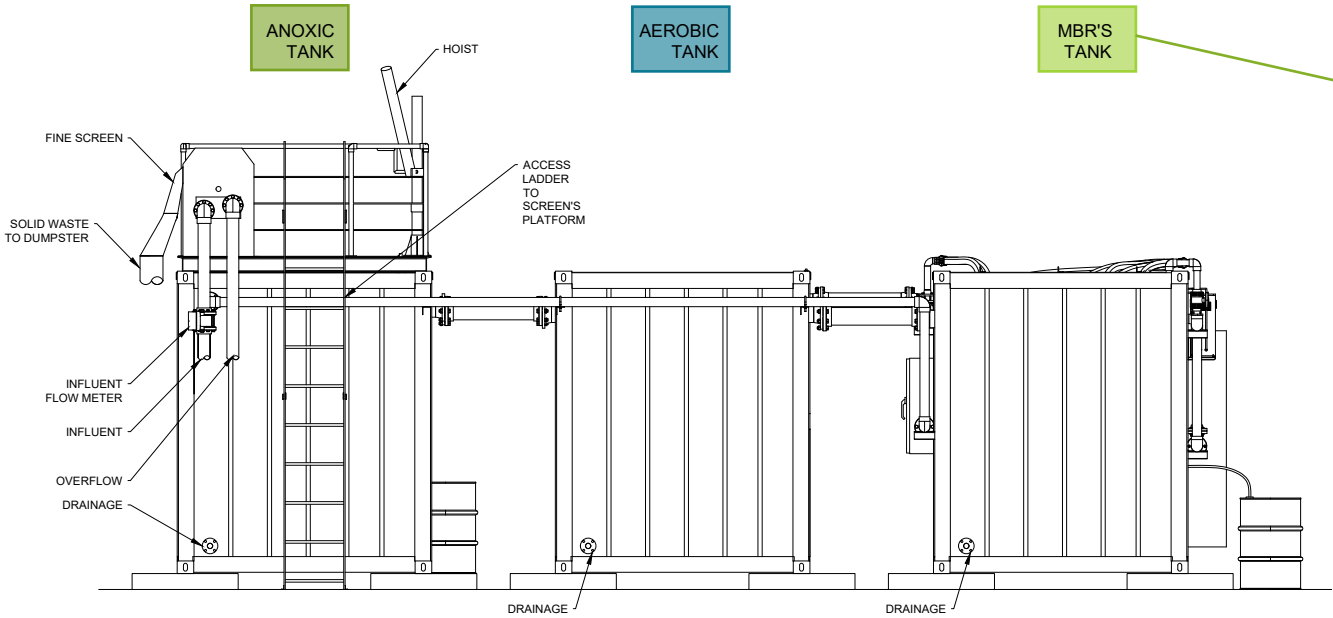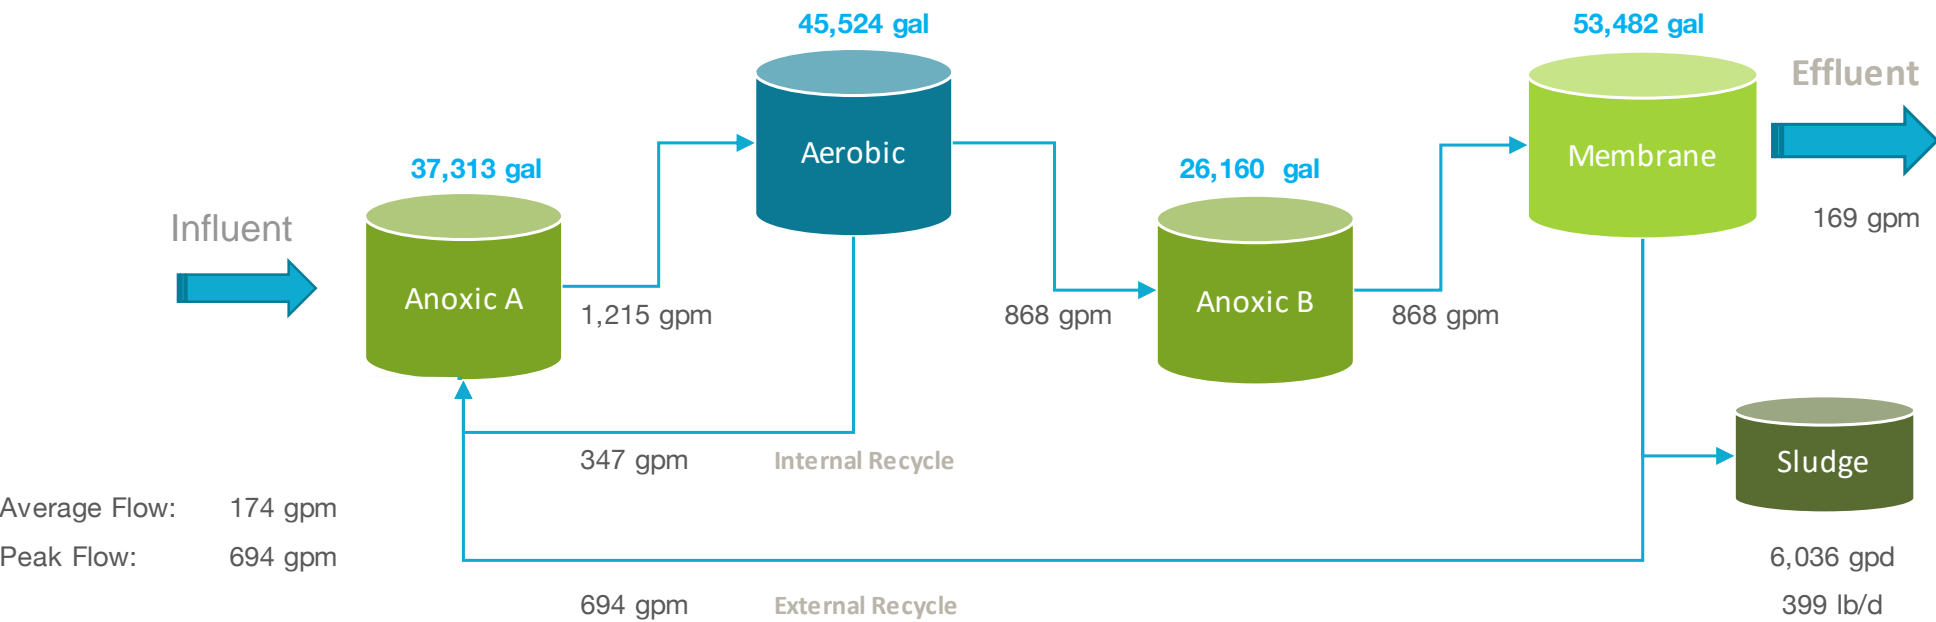

Example of Process Flow/Treatment Process (provided from
design for 80,000 gpd Treatment Plant)

Disclaimer

This drawing was created by A3-USA
for a separate project. It is presented
here for illustrative purposes only.
Sizes and dimensions will vary.

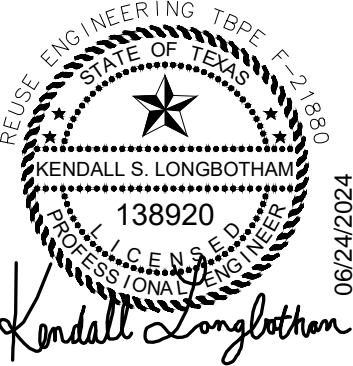

reUse
ENGINEERING
4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880




TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS

PROCESS FLOW DIAGRAM
250,000 GPD UNIT

Attachment 1B


The 1.50 MGD Treatment Facility will be comprised of four (4) treatment trains: Two (2) each at 250,000 GPD and Two (2) each at 500,000 GPD

500,000 GPD
Treatment Train:
See 10054
Technical Report
Attachment 5-
Design Calculations

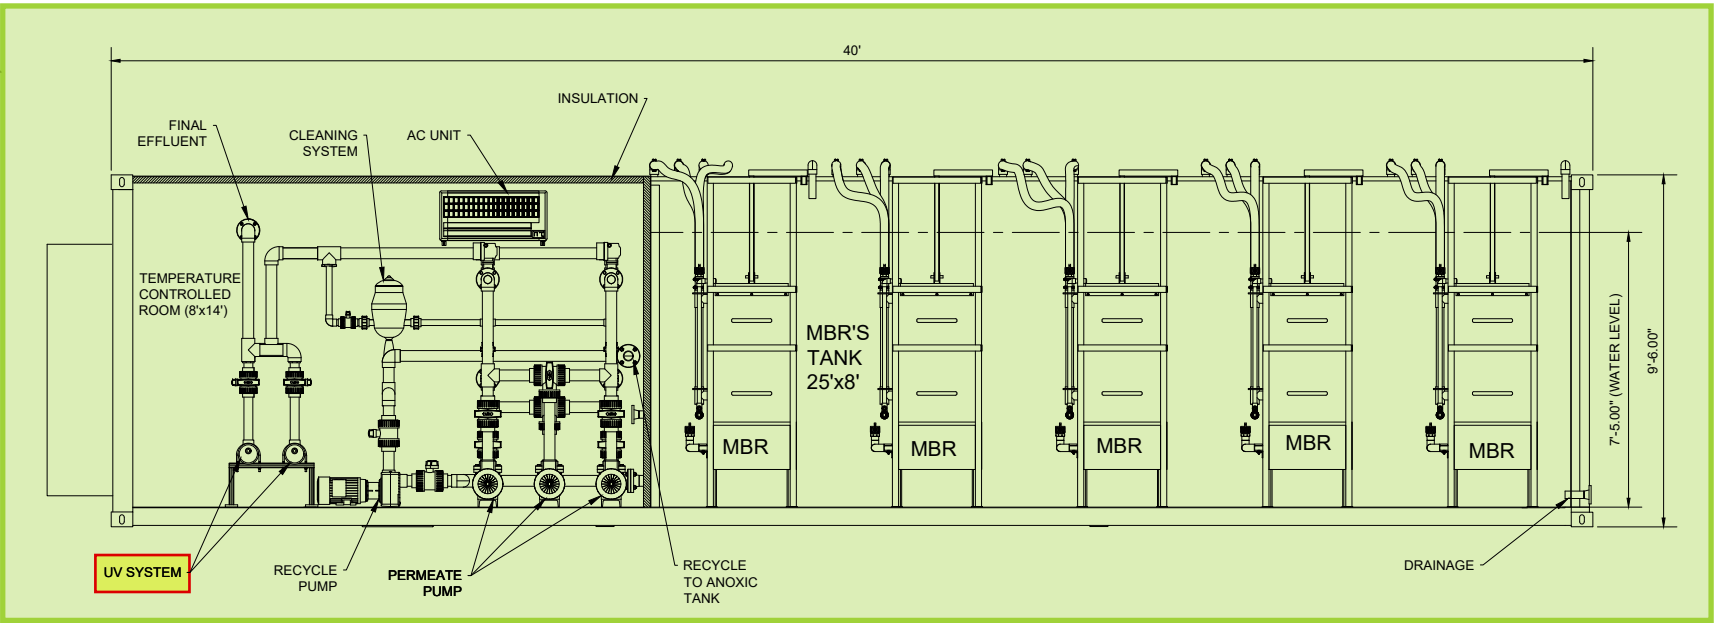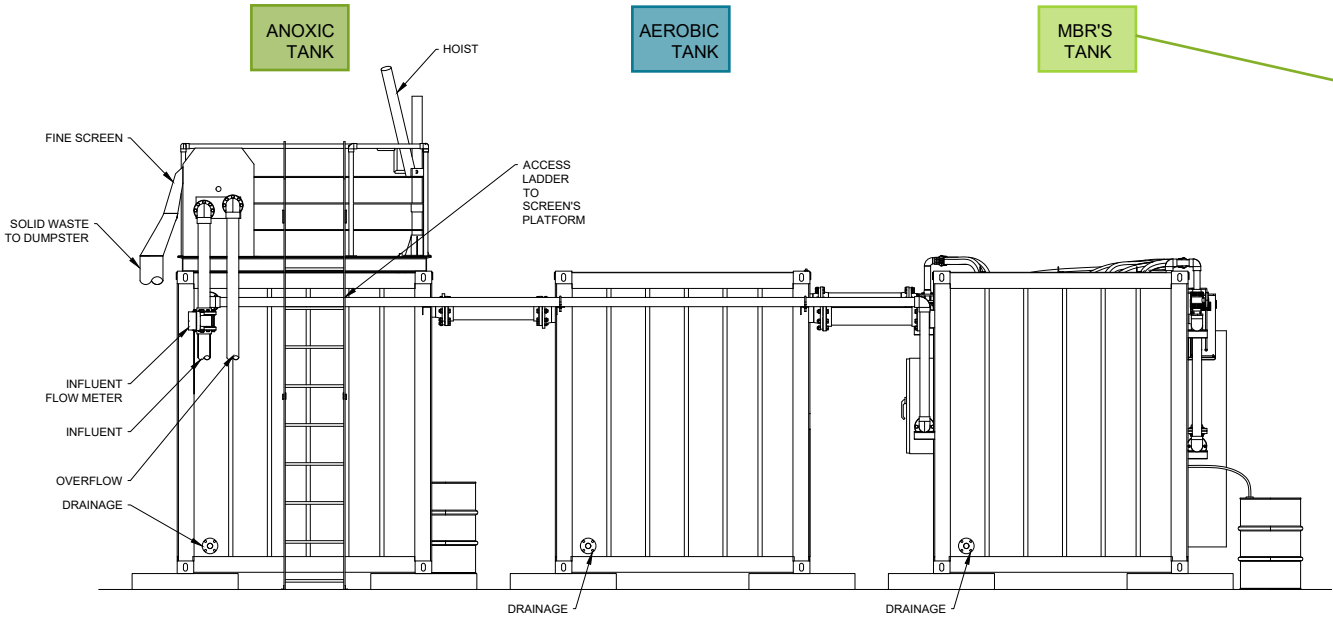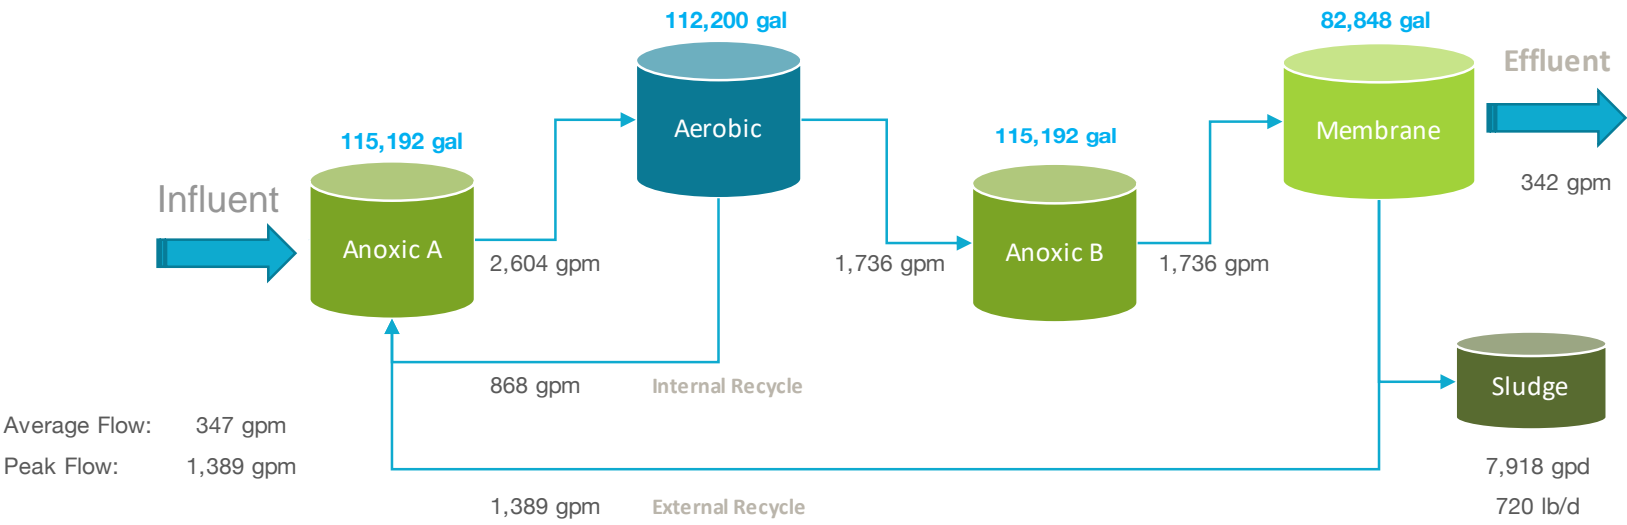

Example of Process Flow/Treatment Process (provided from design for 80,000 gpd Treatment Plant)

Disclaimer
This drawing was created by A3-USA for a separate project. It is presented here for illustrative purposes only. Sizes and dimensions will vary.

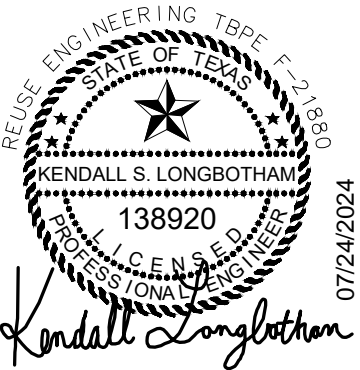

reUse
ENGINEERING
4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880

TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS
PROCESS FLOW DIAGRAM
500,000 GPD UNIT
Attachment 1C



		<u>Design Flow</u> gpd	<u>Cumulative</u> <u>Flow</u> gpd
Interim Ph 1 Temp WWTF	1A	30,000	30,000
WWTF	1B	250,000	250,000
WWTF	2	250,000	500,000
WWTF	3	500,000	1,000,000
WWTF	4	500,000	1,500,000

		<u>Development</u> <u>per Year</u> <u>LUE</u>	<u>Cumulative</u> <u>Development</u> <u>LUE</u>	<u>Projected</u> <u>Flow</u> gpd
Year	1	125	125	28,125
Year	2	980	1,105	248,625
Year	3	1,760	1,885	424,125
Year	4	1,813	3,698	832,050
Year	5	1,765	5,463	1,229,175

LUE (Living Unit Equivalents)

225

gpd/LUE

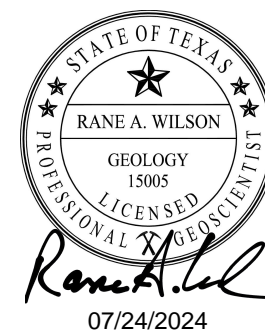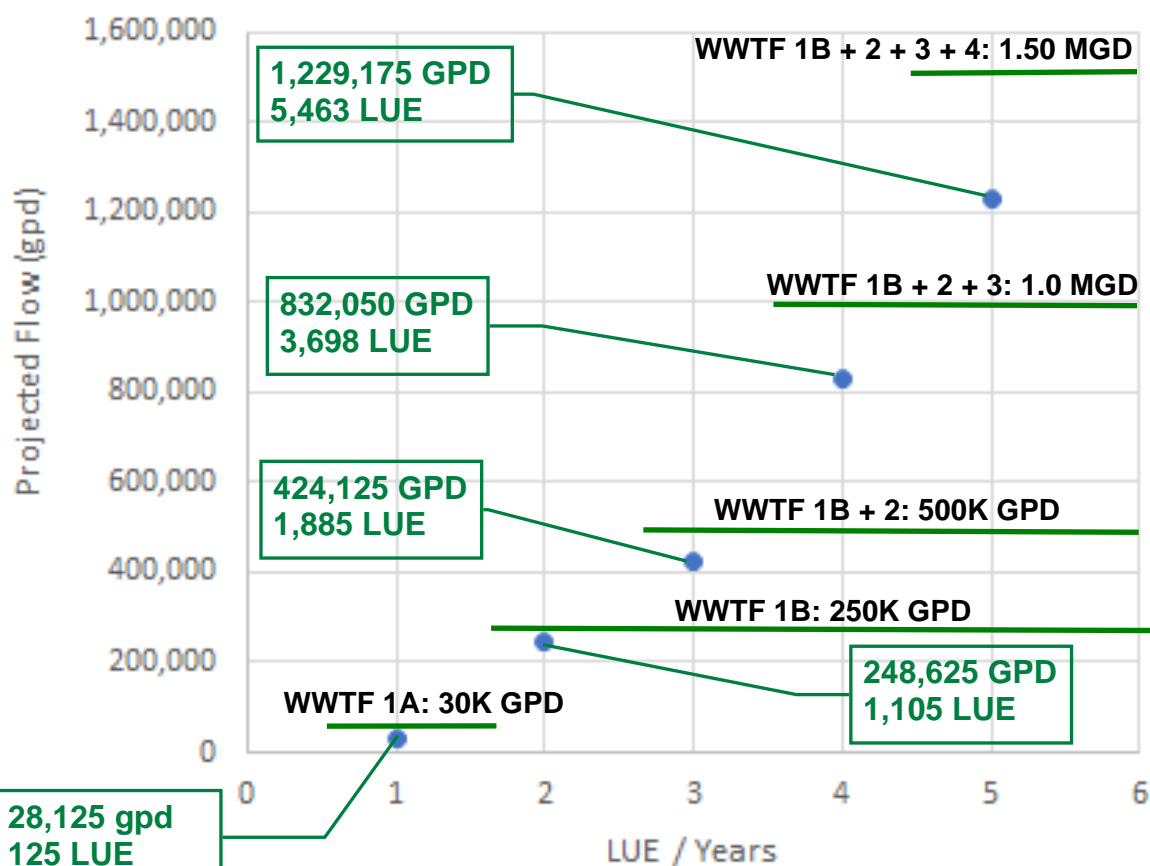

reUse
ENGINEERING
4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880


TCCI JOSEPHINE WWTP, LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS

PROJECTION OF LUES &
WASTEWATER FLOW
Attachment 3


ATTACHMENT 4

REGIONALIZATION OF FACILITIES

INCLUDES:
CCN MAP
NEARBY OUTFALLS
REQUEST FOR SERVICES LETTERS
DENIAL LETTERS
CERTIFIED MAIL PROOF

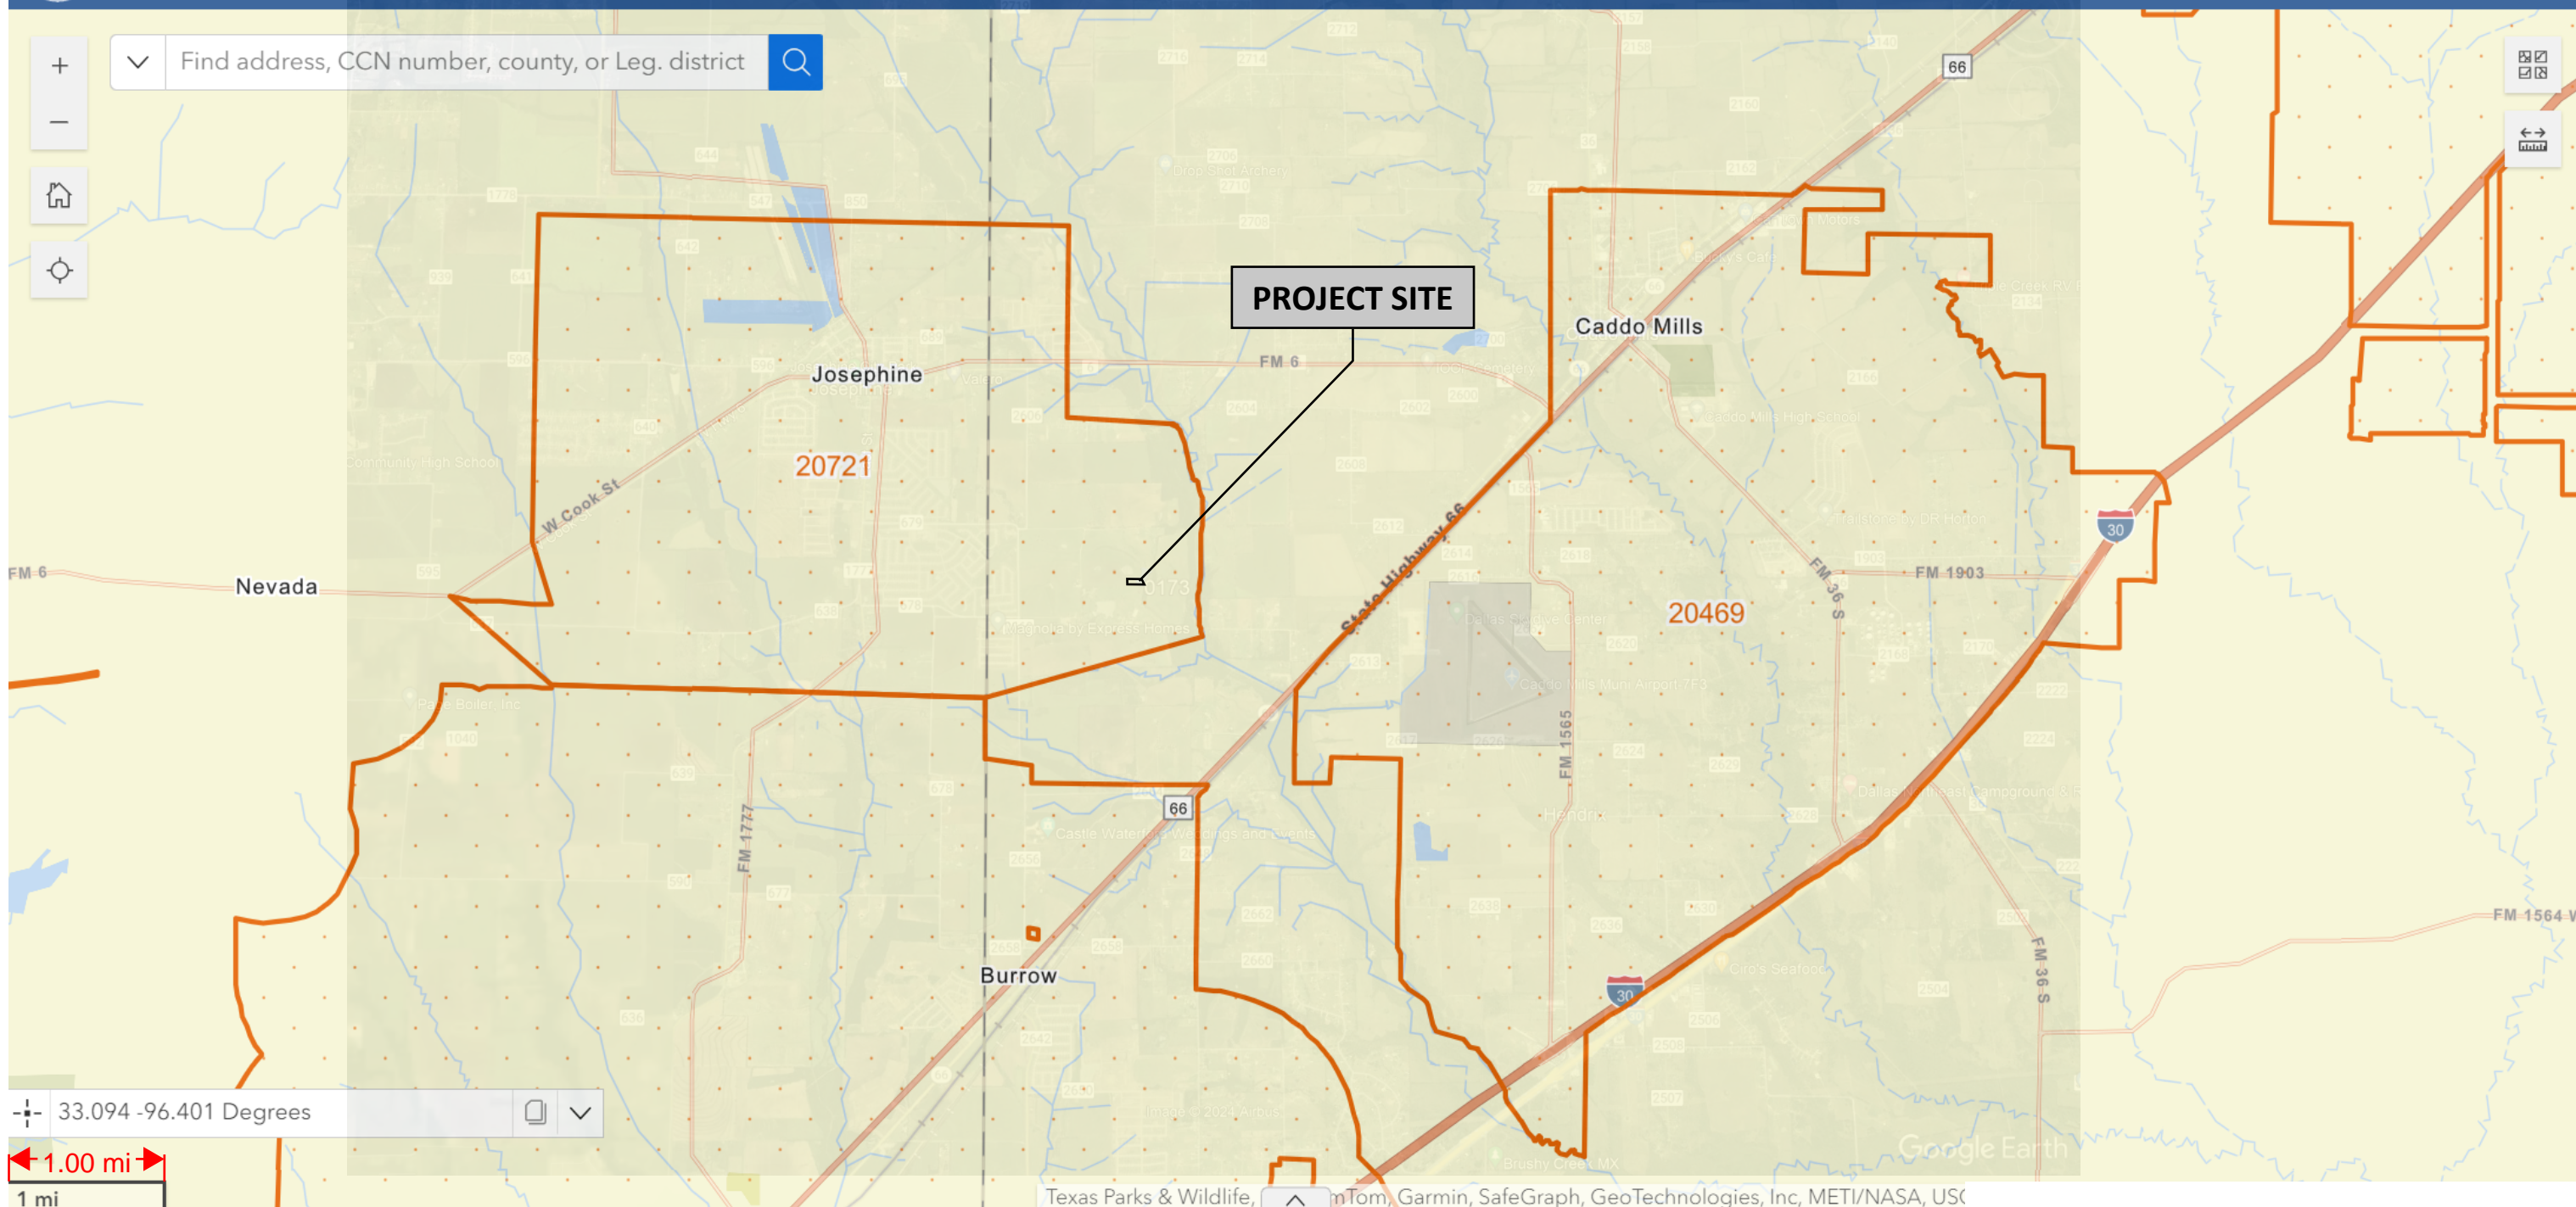


Sewer CCN: 20721 - City of Josephine
Status - Commission Approved

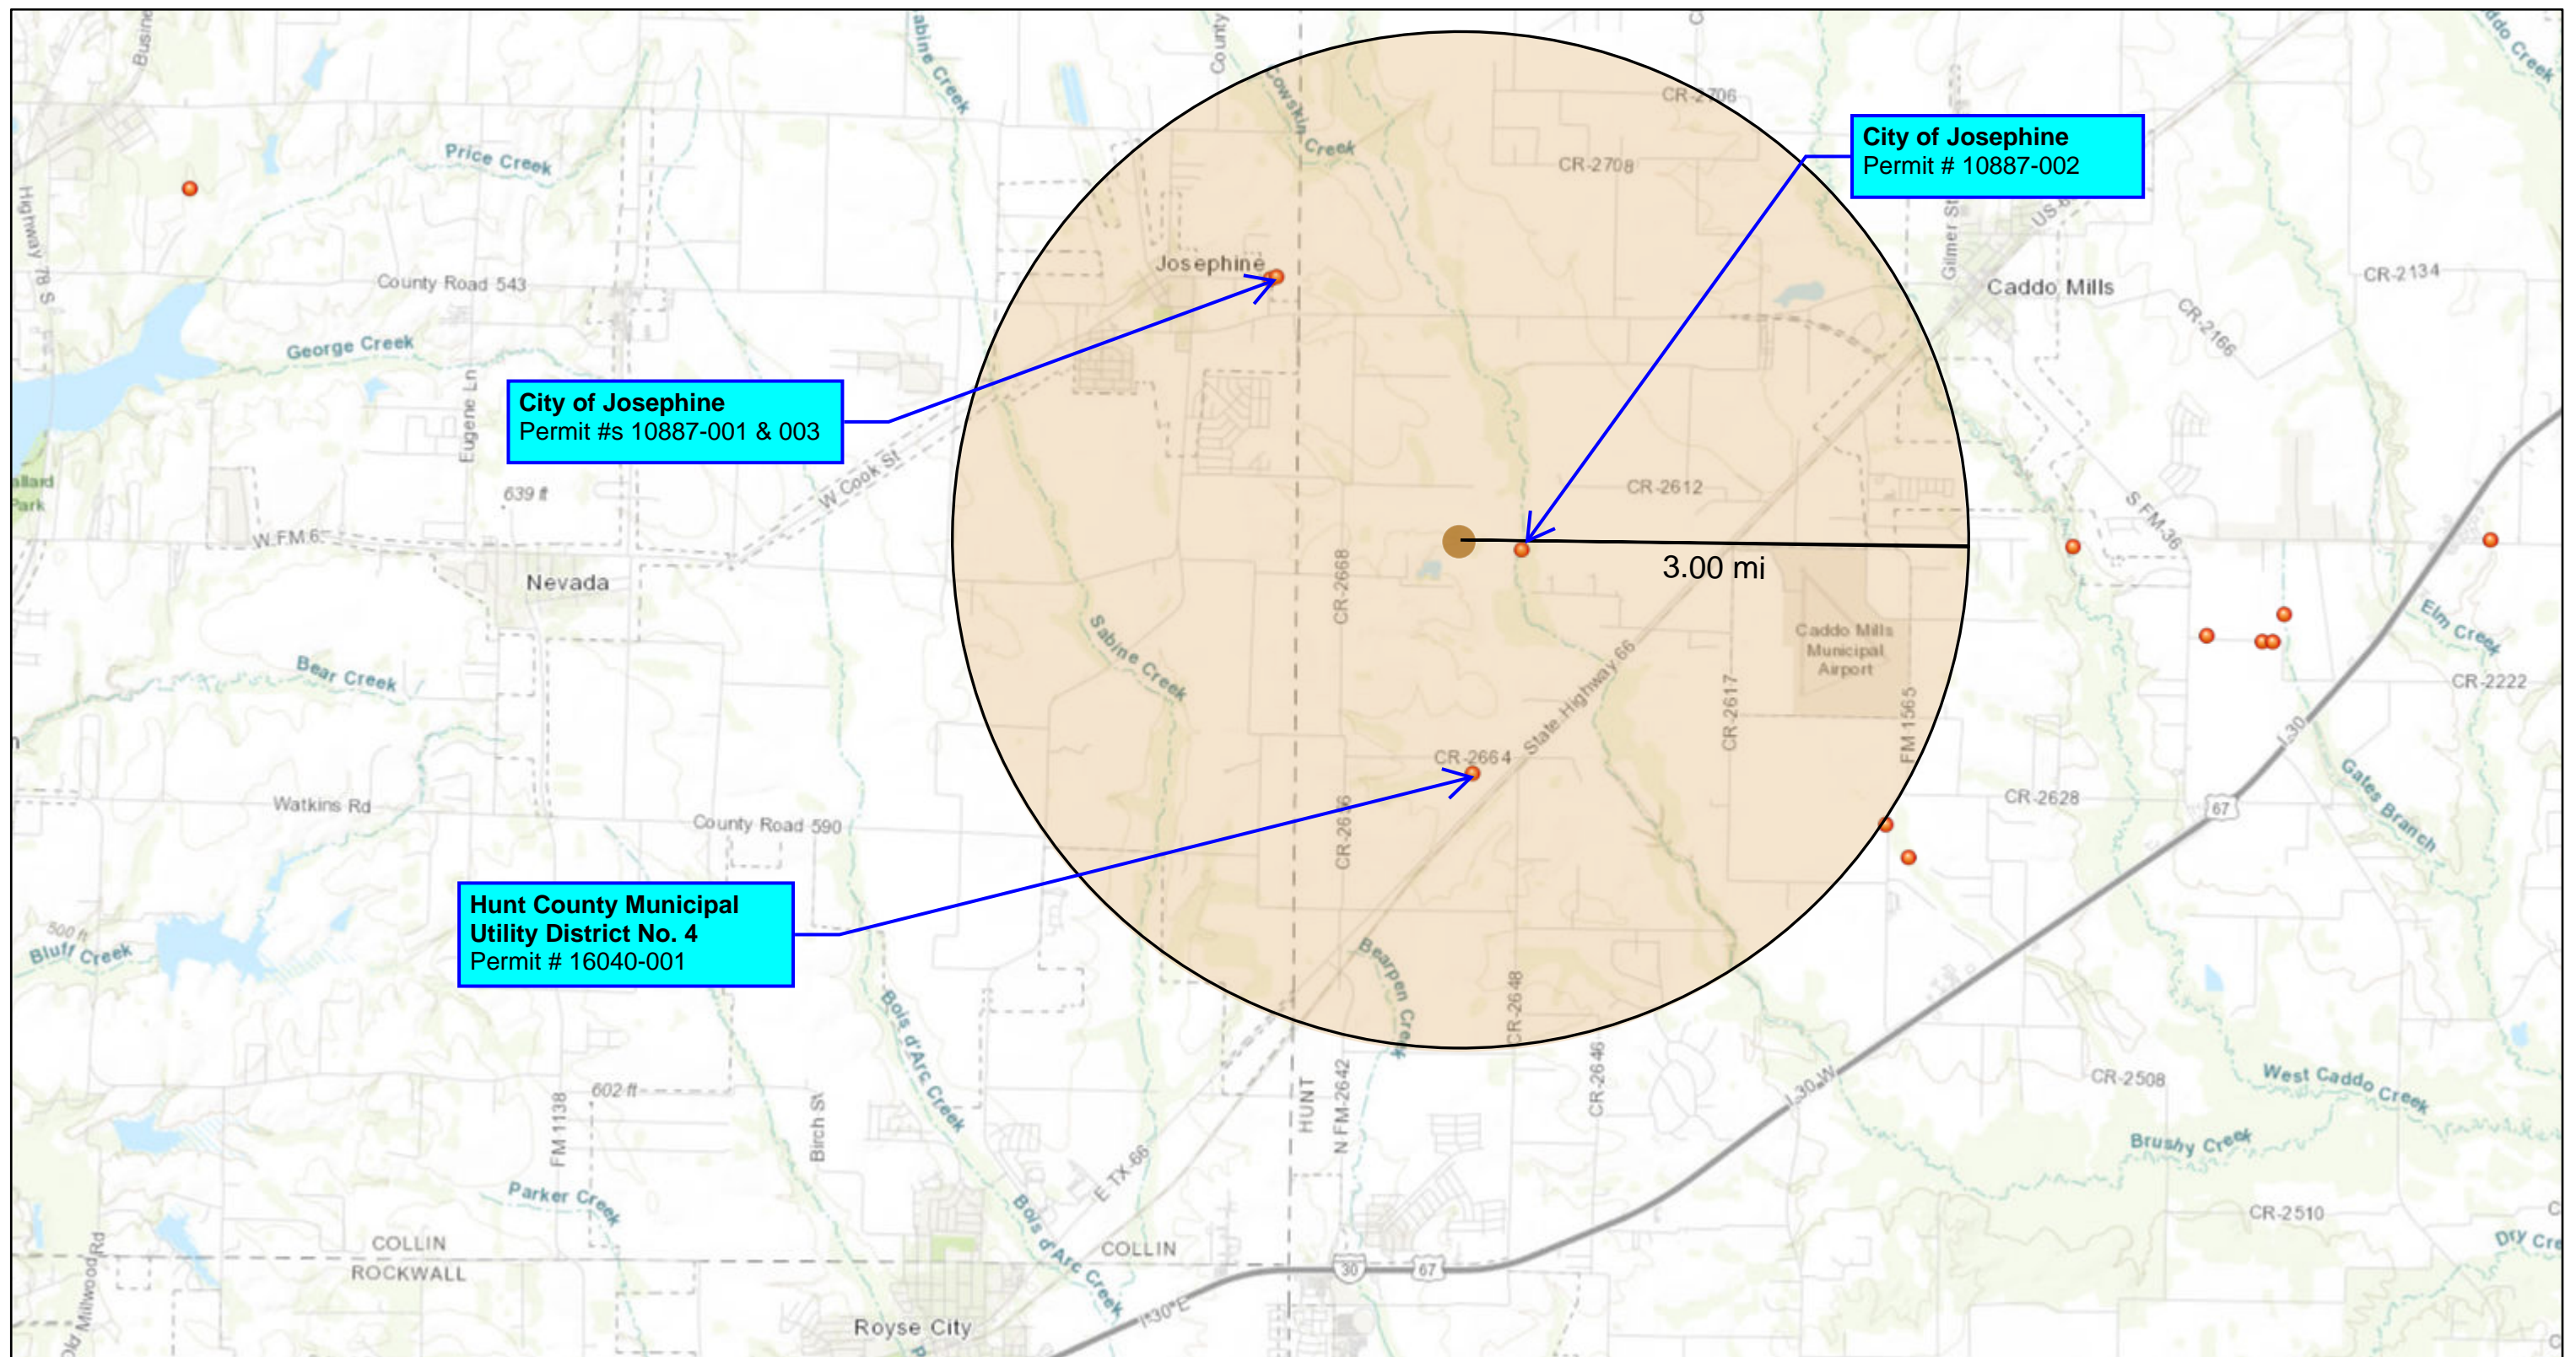

Wastewater Outfalls

1:72,224



reUse
ENGINEERING
4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880

TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS

WASTEWATER OUTFALL
MAP

Attachment 4B

June 24, 2024

Ms. Lisa Palomba
City Administrator
City of Josephine
PO Box 99
Josephine, TX 75164
(972) 694-7281

RE: TCCI Josephine WWTP LLC – Application for New Permit
Located appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615 in Josephine, Hunt County, Texas.


reUse Engineering, Inc., on behalf of TCCI Josephine WWTP LLC, is in the process of submitting a request to the Texas Commission on Environmental Quality (TCEQ) for a Domestic Wastewater Discharge Permit for a proposed Wastewater Treatment Plant at the above referenced location. See attached. The client's property is located:

- A. Within the City of Josephine CCN No. 20721
- B. Approx. 0.3 miles west of City of Josephine outfall 10887-002
- C. Approx. 1.9 miles southeast of City of Josephine outfalls 10887-001 and 10887-003

We are required to contact all existing TPDES permittees within a three-mile radius of the site. We are requesting that the City of Josephine either express interest in providing wastewater services to this site or provide a letter of Denial of Service, stating that it cannot/will not provide wastewater service to TCCI Josephine WWTP LLC. A response is requested within 30 days of receipt of this letter, though an expedited response is greatly appreciated if at all possible.

Please contact me if you have any questions.

Respectfully Submitted,

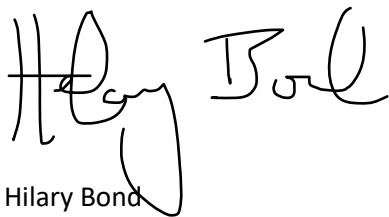

Hilary Bond
reUse Engineering, Inc.
Director of Permitting and Entitlements
4411 S IH-35 Suite 100
Georgetown, TX 78626
(512) 285-0302

July 01, 2024

Hilary Bond
reUse Engineering, Inc.
Director of Permitting and Entitlements
4411 S. IH-35 Suite 100
Georgetown, TX 78626
(512) 285-0302

Re: TCCI Josephine WWTP LLC-New Permit Application

Letter of Denial

The City of Josephine isn't interested/ will not provide wastewater services to TCCI Josephine WWTP LLC.

Best Regards,
Kirk Peters
Assistant City Administrator
972-843-8282



June 24, 2024

Mr. Samuel Spiers
Attorney for Hunt County MUD No. 4 (Permit No. 16040-001)
Coats Rose
9 Greenway Plaza, Suite 1000
Houston, Texas 77046
(713)653-7310

RE: TCCI Josephine WWTP LLC – Application for New Permit
Located appx. 1.54 mi west of the intersection of Hwy 66 and CR 2615 in Josephine, Hunt County, Texas.

reUse Engineering, Inc., on behalf of TCCI Josephine WWTP LLC, is in the process of submitting a request to the Texas Commission on Environmental Quality (TCEQ) for a Domestic Wastewater Discharge Permit for a proposed Wastewater Treatment Plant at the above referenced location. See attached. The client's property is located **approximately 1.35 miles north of Hunt County MUD No. 4.**

We are required to contact all existing TPDES permittees within a three-mile radius of the site. We are requesting that the Hunt County MUD No. 4 either express interest in providing wastewater services to this site or provide a letter of Denial of Service, stating that it cannot/will not provide wastewater service to TCCI Josephine WWTP LLC. A response is requested within 30 days of receipt of this letter, though an expedited response is greatly appreciated if at all possible.

Please contact me if you have any questions.

Respectfully Submitted,



Hilary Bond
reUse Engineering, Inc.
Director of Permitting and Entitlements
4411 S IH-35 Suite 100
Georgetown, TX 78626
(512) 285-0302

No response provided within 30 days

From: [USPS Retail Service](#)
To: [USPS Retail Service](#)
Subject: USPS Retail Service
Date: Monday, June 24, 2024 2:25:28 PM



NEW BRAUNFELS
651 N BUSINESS IH 35 STE 428
NEW BRAUNFELS, TX 78130-9808
(800)275-8777

06/24/2024			02:12 PM
Product	Qty	Unit Price	Price
Priority Mail®	1		\$9.60
Josephine, TX 75164			
Weight: 0 lb 1.10 oz			
Expected Delivery Date			
Wed 06/26/2024			
Insurance			\$0.00
Up to \$100.00 included			
Certified Mail®			\$4.40
Tracking #:			
9589 8710 5278 1998 7519 43			
Total			\$14.00
Priority Mail®	1		\$9.60
Houston, TX 77046			
Weight: 0 lb 0.90 oz			
Expected Delivery Date			
Wed 06/26/2024			
Insurance			\$0.00
Up to \$100.00 included			
Certified Mail®			\$4.40
Tracking #:			
9589 8710 5278 1998 7519 26			
Total			\$14.00
Grand Total:			\$28.00
Credit Card Remit			\$28.00
Card Name: AMEX			
Account #: XXXXXXXXXX1048			
Approval #: 827181			
Transaction #: 814			
AID: ANNNNNNS1610801		Chip	
AL: AMERICAN EXPRESS			
PIN: Not Required			

In a hurry? Self-service kiosks offer quick and easy check-out. Any Retail Associate can show you how.

Text your tracking number to 28777 (2USPS) to get the latest status. Standard Message and Data rates may apply. You may also visit <https://link.edgepiot.com/s/16d252ae/waqE3Ov20k0xjw0nplogJA7uhttp://www.usps.com/> USPS Tracking or call 1-800-222-1811.

Save this receipt as evidence of insurance. For information on filing an insurance claim go to https://link.edgepiot.com/s/6fb9f86e/zx848y_VVX-H17sRT7Z5Q7uhttps://www.usps.com/help/claims.htm or call 1-800-222-1811

Preview your Mail
Track your Packages
Sign up for FREE @ <https://link.edgepiot.com/s/8a17d948/S3xup0uP0U0kz0dxKapksw?uhttps://informedelivery.usps.com/>

All sales final on stamps and postage. Refunds for guaranteed services only. Thank you for your business.


Tell us about your experience.
Go to: <https://link.edgepiot.com/s/cd84f6fc/18Tg8E0J12YpWd6dFnd8Q7uhttps://postalexperience.com/ps?mt=9> or call 1-800-410-7420.

UFN: 486328-8331
Receipt #: 840-57808095-4-7858061-2
Clerk: 06

Privacy Act Statement: Your information will be used to provide you with an electronic receipt for your purchase transaction via email. Collection is authorized by 39 USC 401, 403, and 404. Providing the information is voluntary, but if not provided, we will be unable to process your request to receive an electronic receipt. We do not disclose your information to third parties without your consent, except to facilitate the transaction, to act on your behalf or request, or as legally required. This includes the following limited circumstances: to a congressional office on your behalf; to financial entities regarding financial transaction issues; to a U.S. Postal Service auditor; to entities, including law enforcement, as required by law or in legal proceedings; to contractors and other entities aiding us to fulfill the service (service providers); to process servers; to domestic government agencies if needed as part of their duties; and to a foreign government agency for violations and alleged violations of law. For more information on our privacy policies visit <https://link.edgepiot.com/s/cde92c7b/-n5Ztac9b2civvActfM07uhttp://www.usps.com/privacypolicy>.

This is an automated email. Please do not reply to this message. This message is for the designated recipient only and may contain privileged, proprietary, or otherwise private information. If you have received it in error, please delete. Any other use of this email by you is prohibited.

ceeded to the destination. If suspicious content is detected, you will see a warning.

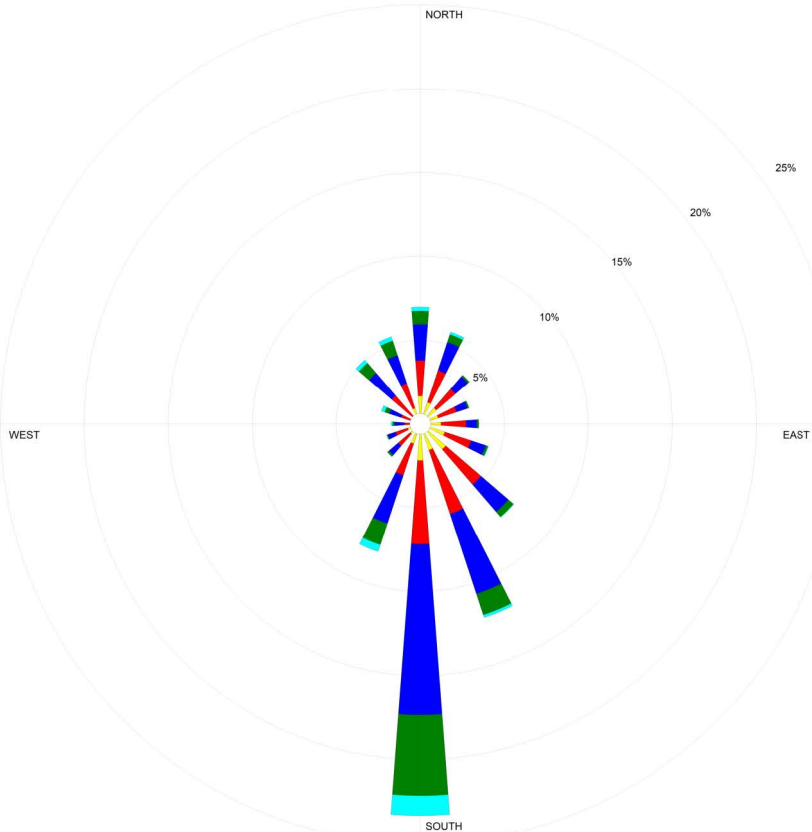

Wind Speed (m/s)



MODELER

Sara West

DATE

8/29/2002

COMPANY NAME

USDA-ARS

DISPLAY

Wind Speed

UNIT

m/s

COMMENTS

AVG. WIND SPEED

5.76 m/s

CALM WINDS

2.32%

ORIENTATION

**Direction
(blowing from)**

PLOT YEAR-DATE-TIME

**1961
Apr 1 - Apr 30
Midnight - 11 PM**



Thursday, July 25, 2024

Authorization Form

This form authorizes reUse to sign and submit any documents required for the TCEQ permit application submittal on your behalf.

Name	Tommy Cansler, Pres
Title	President
Company/Client Legal Name	TCCI Josephine WWTP LLC
Email	george@tccitx.com

I, Tommy Cansler, Pres., hereby authorize reUse Engineering, Inc. to act as Authorized Signatory on behalf of TCCI Josephine WWTP LLC for any documents required by TCEQ for the purposes of applying for a Municipal Domestic Wastewater permit. This includes but is not limited to a Texas Pollutant Discharge Elimination Systems (TPDES) permit and/or a Texas Land Application Permit (TLAP).

I provide signature authorization for any documents included in the permitting process, including but not limited to the Core Data Form (TCEQ-10400), Domestic Wastewater Administrative Report (TCEQ-10053), Denial of Service requests for CCNs and other nearby facilities, STEERS online submission signatures, and any letters or follow-up documents that the TCEQ may request in order to complete the permit application.

Signature

TITLE	Signature Authorization Form
DOCUMENT ID	242065538601049
DOCUMENT PAGES	1
STATUS	COMPLETED
TIME ZONE	America/New York

DOCUMENT HISTORY

Signed

Jul 25, 2024
03:20 PMSigned
IP: 72.176.247.37



Thursday, July 25, 2024

Authorization Form

This form authorizes reUse to sign and submit any documents required for the TCEQ permit application submittal on your behalf.

Name	Tommy Cansler, Pres
Title	President
Company/Client Legal Name	TCCI Josephine WWTP LLC
Email	george@tccitx.com

I, Tommy Cansler, Pres., hereby authorize reUse Engineering, Inc. to act as Authorized Signatory on behalf of TCCI Josephine WWTP LLC for any documents required by TCEQ for the purposes of applying for a Municipal Domestic Wastewater permit. This includes but is not limited to a Texas Pollutant Discharge Elimination Systems (TPDES) permit and/or a Texas Land Application Permit (TLAP).



I provide signature authorization for any documents included in the permitting process, including but not limited to the Core Data Form (TCEQ-10400), Domestic Wastewater Administrative Report (TCEQ-10053), Denial of Service requests for CCNs and other nearby facilities, STEERS online submission signatures, and any letters or follow-up documents that the TCEQ may request in order to complete the permit application.

Signature



Hunt County, TX

Note: Drawing is for layout only. No work to begin without Geotech and Structural Reports and Designs Available!

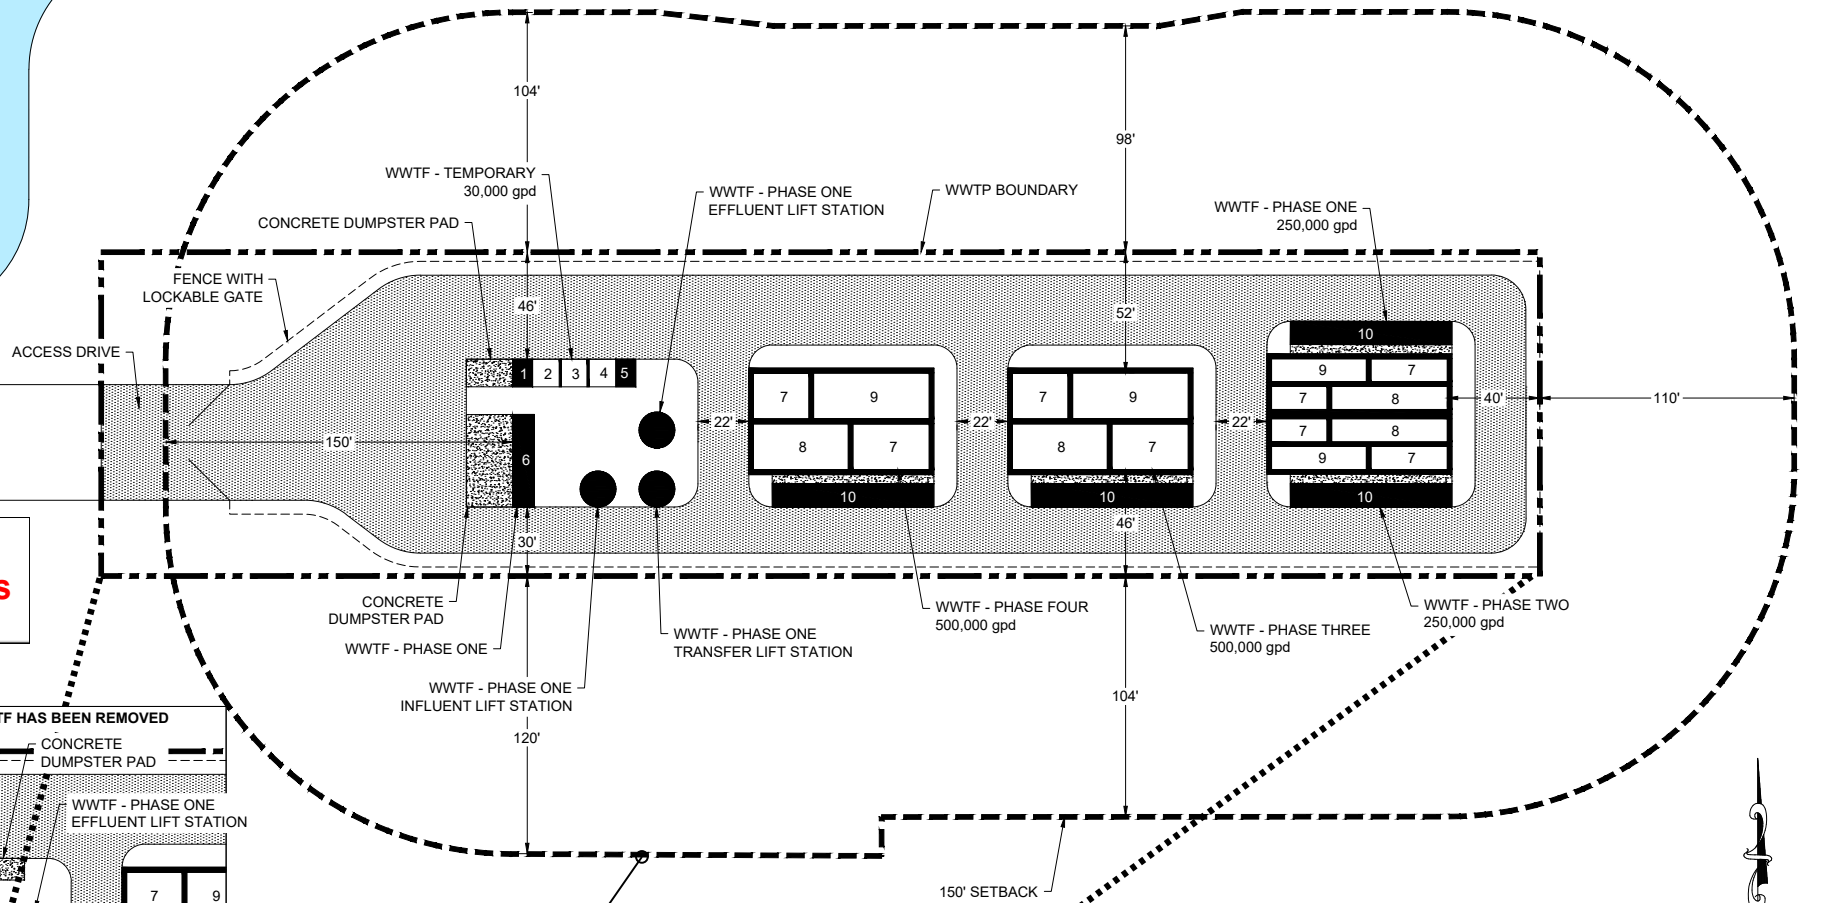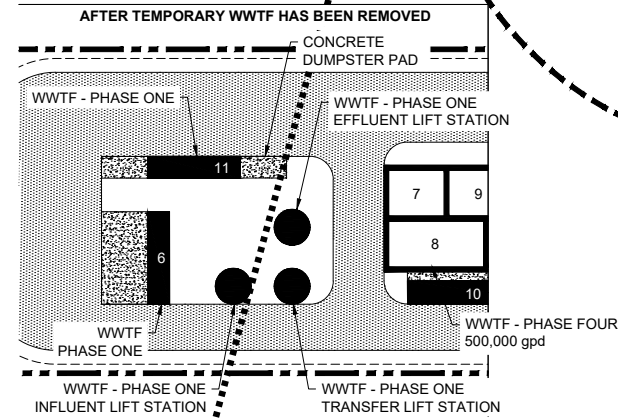

150-FT BUFFER ZONE SURROUNDING WWTF

AREA SERVED BY WWTF



TEMPORARY PHASE:

1. INLET SCREEN
2. ANOXIC
3. AEROBIC
4. MEMBRANE
5. PUMPS & BLOWERS

ALL PHASES:

6. INLET SCREEN SKID
7. ANOXIC TANK
8. AEROBIC TANK
9. MEMBRANE TANK
10. PERMEATE & BLOWER SKID
11. SLUDGE PRESS SKID

THE APPLICANT WILL HAVE AN ODOR & ABATEMENT EASEMENT WITH THE ADJACENT PROPERTY OWNER INTO WHICH THE 150-FT BUFFER ZONE FALLS

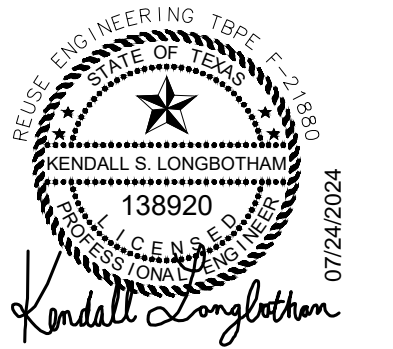

reUse
ENGINEERING
4411 SIH 35, Suite 100
Georgetown, TX 78626
TX Firm No. 21880

TCCI JOSEPHINE WWTP LLC
TPDES PERMIT APPLICATION
HUNT COUNTY, TEXAS

SITE DRAWING
Attachment 2

SOLIDS MANAGEMENT PLAN

TCCI JOSEPHINE WWTP, LLC CROSS CREEK RANCH WWTP WWTF Phase 1A

Influent Design Flow:

Phase 1A: 0.030 MGD, Total

Influent BOD Concentration: 350 mg/L

MBR Basin MLVSS: 8,808 mg/L

See **Attachment 1A - Process Flow Diagram** and **Attachment 5A - Design Calculations**. Attachment 5A shows calculations for one (1) 30,000 gpd (0.03 MGD) treatment train. In the final phase, there will be three (3) 250,000 gpd (0.25 MGD) treatment trains operating at full capacity for a total of 0.750 MGD in the final phase.

Table 1 – Sludge Production for 0.03 MGD Design Flow

Solids Generated	100%	75%	50%	25%
Lbs./d Influent BOD ₅	87.62	65.7	43.8	21.9
Lbs./d Dry Sludge Produced	49.0	36.8	24.5	12.3

Sludge will be sent from the Recycled Activated Sludge flow stream to the Sludge Screw Press. Calculations are based on 815 gpd of waste sludge, which equates to 49 lb/d (Table 1). The sludge will be pressed in the Sludge Screw Press to remove liquids and produce a dry sludge cake. All liquid will be decanted from the Screw Press and returned to the headworks for treatment. No wet solids will be produced through the treatment process. Dry sludge will be removed from the screw press and deposited into an 1 cubic yard (CY) roll-off container for disposal on a regular basis (Table 2).

Table 2 – Sludge Removal Schedule

Removal Schedule	100%	75%	50%	25%	Unit
Dry Waste Sludge	49.0	36.8	24.5	12.3	lb/d
Wet Waste Sludge	815	611	408	204	gpd
Wet Sludge	109.0	81.7	54.5	27.2	CF/d
Wet Sludge	4.0	3.0	2.0	1.0	CY/d
Reduction Factor	18.0	(provided by MBR WWTP manufacturer)			
Dry Sludge	0.2	0.2	0.1	0.1	CY/d
Dumpster Volume	1	1	1	1	CY
Recurring Sludge Removal	4	6	9	18	days

The Sludge Age (Solids Retention Time) for a Total Reactor Volume of approximately 22,440 gallons is 25 days, with an annual average sludge production of 17,885 lbs. dry sludge produced at 100% capacity. The dewatered sludge will be transported by a registered hauler, The Cleaning Guys (TCEQ Sludge Registration ID #25218) to the Republic Maloy Landfill (TCEQ Sludge Registration ID #1195B) in Hunt County, Texas.

SOLIDS MANAGEMENT PLAN

TCCI JOSEPHINE WWTP, LLC CROSS CREEK RANCH WWTP WWTF Phase 1B & 2

Influent Design Flow:

Phase 1B: 0.250 MGD

Phase 2: 0.250 MGD

Influent BOD Concentration: 350 mg/L

MBR Basin MLVSS: 9,940 mg/L

See **Attachment 1 - Process Flow Diagram** and **Attachment 5 - Design Calculations**. Attachment 5 shows calculations for one (1) 250,000 gpd (0.250 MGD) treatment train. In the final phase, there will be two (2) 250,000 gpd treatment trains operating with two subsequent phases, each at 500,000 gpd.

Table 1 – Sludge Production for 0.250 MGD Design Flow

Solids Generated	100%	75%	50%	25%
Lbs./d Influent BOD ₅	730.2	547.7	365.1	182.6
Lbs./d Dry Sludge Produced	399.0	299.3	199.5	99.8

Sludge will be sent from the Recycled Activated Sludge flow stream to the Sludge Screw Press. Calculations are based on 6,036 gpd of waste sludge, which equates to 399 lb./d (Table 1). The sludge will be pressed in the Sludge Screw Press to remove liquids and produce a dry sludge cake. All liquid will be decanted from the Screw Press and returned to the headworks for treatment. No wet solids will be produced through the treatment process. Dry sludge will be removed from the screw press and deposited into an 8 cubic yard (CY) roll-off container for disposal on a regular basis (Table 2).

Table 2 – Sludge Removal Schedule

Removal Schedule	100%	75%	50%	25%	Unit
Dry Waste Sludge	399.0	299.3	199.5	99.8	lb/d
Wet Waste Sludge	6,036	4,527	3,018	1,509	gpd
Wet Sludge	807.0	605.2	403.5	201.7	CF/d
Wet Sludge	29.9	22.4	14.9	7.5	CY/d
Reduction Factor	18.0	(provided by MBR WWTP manufacturer)			
Dry Sludge	1.7	1.2	0.8	0.4	CY/d
Dumpster Volume	8.0	8.0	8.0	8.0	CY
Recurring Sludge Removal	5	6	10	19	days

The Sludge Age (Solids Retention Time) for a Total Reactor Volume of approximately 162,480 gallons is 25 days, with an annual average sludge production of 145,635 lbs. dry sludge produced at 100% capacity. The dewatered sludge will be transported by a registered hauler, The Cleaning Guys (TCEQ Sludge Registration ID #25218) to the Republic Maloy Landfill (TCEQ Sludge Registration ID #1195B) in Hunt County, Texas.

SOLIDS MANAGEMENT PLAN

TCCI JOSEPHINE WWTP, LLC CROSS CREEK RANCH WWTP WWTF Phase 3 & 4

Influent Design Flow:

Phase 3: 0.500 MGD

Phase 4: 0.500 MGD, Total 1.50 MGD

Influent BOD Concentration: 350 mg/L

MBR Basin MLVSS: 13,696 mg/L

See **Attachment 1 - Process Flow Diagram** and **Attachment 5 - Design Calculations**. Attachment 5 shows calculations for one (1) 500,000 gpd (0.500 MGD) treatment train. In the final phase, there will be one (1) 250,000 gpd treatment train and two (2) 500,000 gpd treatment trains operating at full capacity for a total of 1.25 MGD.

Table 1 – Sludge Production for 0.250 MGD Design Flow

Solids Generated	100%	75%	50%	25%
Lbs./d Influent BOD ₅	1,460.4	1,095.3	730.2	365.1
Lbs./d Dry Sludge Produced	720.0	540.0	360.0	180.0

Sludge will be sent from the Recycled Activated Sludge flow stream to the Sludge Screw Press. Calculations are based on 7,918 gpd of waste sludge, which equates to 720 lb./d (Table 1). The sludge will be pressed in the Sludge Screw Press to remove liquids and produce a dry sludge cake. All liquid will be decanted from the Screw Press and returned to the headworks for treatment. No wet solids will be produced through the treatment process. Dry sludge will be removed from the screw press and deposited into an 8 cubic yard (CY) roll-off container for disposal on a regular basis (Table 2).

Table 2 – Sludge Removal Schedule

Removal Schedule	100%	75%	50%	25%	Unit
Dry Waste Sludge	720.0	540.0	360.0	180.0	lb/d
Wet Waste Sludge	7,918	5,939	3,959	1,980	gpd
Wet Sludge	1,058.6	793.9	529.3	264.6	CF/d
Wet Sludge	39.2	29.4	19.6	9.8	CY/d
Reduction Factor	18.0	(provided by MBR WWTP manufacturer)			
Dry Sludge	2.2	1.6	1.1	0.5	CY/d
Dumpster Volume	8.0	8.0	8.0	8.0	CY
Recurring Sludge Removal	4	5	7	15	days

The Sludge Age (Solids Retention Time) for a Total Reactor Volume of approximately 310,240 gallons is 25 days, with an annual average sludge production of 262,800 lbs. dry sludge produced at 100% capacity. The dewatered sludge will be transported by a registered hauler, The Cleaning Guys (TCEQ Sludge Registration ID #25218) to the Republic Maloy Landfill (TCEQ Sludge Registration ID #1195B) in Hunt County, Texas.

